



---

# Source Water Assessment

A Hydrogeologic Susceptibility and  
Vulnerability Assessment for  
the Afognak Logging Camp

Afognak Island, Alaska

PWSID # 250354.001

July 2004

Drinking Water Protection Program Report #1486

Alaska Department of Environmental Conservation

# Source Water Assessment for the Afognak Logging Camp

Afognak Island, Alaska

PWSID# 250354.001

July 2004

Drinking Water Protection Program Report #1486

The Drinking Water Protection Program (DWPP) is producing Source Water Assessments in compliance with the Safe Drinking Water Act Amendments of 1996. Each assessment includes a delineation of the source water area, an inventory of potential and existing contaminant sources that may impact the water, a risk ranking for each of these contaminants, and an evaluation of the potential vulnerability of these drinking water sources.

These assessments are intended to provide public water systems owners/operators, communities, and local governments with the best available information that may be used to protect the quality of their drinking water. The assessments combine information obtained from various sources, including the U.S. Environmental Protection Agency, Alaska Department of Environmental Conservation (ADEC), public water system owners/operators, and other public information sources. The results of this assessment are subject to change if additional data becomes available. It is anticipated this assessment will be updated every five years to reflect any changes in the vulnerability and/or susceptibility of public drinking water source. If you have any additional information that may affect the results of this assessment, please contact the Program Coordinator of DWPP, (907) 269-7521.

## CONTENTS

	Page
SECTION	
Executive Summary	1
Drinking Water System and Area Overview	1
Afognak Logging Camp Drinking Water Protection Area	1
Inventory of Potential and Existing Contaminant Sources	2
Ranking of Contaminant Risks	2
Vulnerability of the Drinking Water System	2
References	7

## TABLES

TABLE	1. Definition of Zones	1
	2. Susceptibility of the Water Source	3
	3. Afognak Logging Camp Contaminant Risks	3
	4. Afognak Logging Camp Overall Vulnerability	3

## APPENDICES

APPENDIX	A.	Afognak Logging Camp Drinking Water Protection Area (Map 1)	
	B.	Contaminant Source Inventory and Risk Rankings (Tables 1-4)	
	C.	Afognak Logging Camp Drinking Water Protection Area and Potential and Existing Contaminant Sources (Map 2)	
	D.	Vulnerability Analysis and Contaminant Risks (Charts 1 – 13)	

# Source Water Assessment for the Afognak Logging Camp Water System

## Drinking Water Protection Program Alaska Department of Environmental Conservation

### EXECUTIVE SUMMARY

The Afognak Logging Camp water system is a (currently inactive) Class A (community) water system that obtains water from a small stream, approximately 1000-feet north of the logging camp. Access to the intake area is not restricted. The overall protection area is approximately 115 acres in size and received a susceptibility rating of “**very high**”. *A rating of high to very high is typical for all systems with surface water intakes.* Potential and existing sources of the following contaminants were evaluated for the Source Water Assessment: bacteria and viruses, nitrates and/or nitrites, heavy metals, cyanide, and other inorganic chemicals, synthetic organic chemicals, volatile organic chemicals, and other organic chemicals. Historical logging activity has been identified as a potential source of contaminants for the drinking water source. This evaluation included all available water sampling data submitted to ADEC by the system operator. The samples may have been collected from either raw water or post-treated water. Combining the susceptibility of the surface water source with the contaminant risks, this water system has received a vulnerability rating of “**medium**” for all contaminant categories except volatile organic chemicals, which received a vulnerability rating of “**high**”. This assessment can be used as a foundation for local voluntary protection efforts as well as a basis for the continuous efforts on the part of the Afognak Native Corporation to protect public health.

### DRINKING WATER SYSTEM AND AREA OVERVIEW

The Afognak Logging Camp (Sec. 33, T023S, R020W, Seward Meridian) is located along Kazakof Bay, on the south coast of Afognak Island in the Kodiak Archipelago (Please see the inset of Map 1 in Appendix A for location). The camp is currently inactive and is owned by the Afognak Native Corporation.

The logging camp can support a working population of 120 (ADEC, 2003). The intake is located on a small stream, approximately 1000-feet north of the camp. Access to the intake area is not restricted (See Map 1 of Appendix A).

The Kodiak Archipelago is warmed by the Japanese current. The climate is similar to Southeast Alaska, with less precipitation. January temperatures range from 14 to 46; July temperatures vary from 39 to 76. Average annual rainfall is 74 inches (ADCED, 2003).

The 2000 sanitary survey indicates that, when active, the water intake is screened, inspected regularly, and protected from ice buildup and siltation. The survey also states that the system’s average daily production is approximately 5000 gallons.

### AFOGNAK LOGGING CAMP DRINKING WATER PROTECTION AREA

Identifying the pathways most likely for surface contamination to reach water intake areas is the first step in determining the water system’s risk. These are initially determined by looking at the drainage area contributing overland water flow to a surface water source intake. The entire drainage area is also known as the “drinking water protection area”. Please refer to pages 10-11 of the “Guidance Manual for Class A Public Water Systems” for additional information.

The protection area established for surface water sources by the ADEC is usually separated into three zones, limited by the watershed boundary. These zones correspond to the overland-flow distance that water travels to get to the source. The ADEC Drinking Water Protection Program’s Technical Advisory Committee developed guidelines for derivation of these zones in 1998. The following is a summary of the three protection area zones:

**Table 1. Definition of Zones**

<b>Zone</b>	<b>Definition</b>
A	Areas within 1000-ft of lakes or streams
B	Areas within 1-mile of lakes or streams
C	The watershed boundary

The protection area for the Afognak Logging Camp water intake includes each of these Zones, although due to the small size of the watershed, Zones B and C cover the same area (See Map 1 of Appendix A).

## INVENTORY OF POTENTIAL AND EXISTING CONTAMINANT SOURCES

The Drinking Water Protection Program has completed an inventory of potential and existing sources of contamination within the Afognak Logging Camp protection area. This inventory was completed through a search of agency records and other publicly available information. There is a wide array of potential contamination sources to surface water. These contaminants are found within agricultural, residential, commercial, and industrial areas, but *can also occur within areas that have little or no development.*

For Class A public water system assessments, six categories of drinking water contaminants were inventoried. They include:

- Bacteria and viruses;
- Nitrates and/or nitrites;
- Volatile organic chemicals;
- Heavy metals, cyanide, and other inorganic chemicals;
- Synthetic Organic Chemicals; and
- Other Organic Chemicals.

Sources identified in the protection area are displayed on Map 2 of Appendix C and summarized in Table 1 of Appendix B.

## RANKING OF CONTAMINANT RISKS

Once potential and existing sources of contamination have been identified, they are assigned a ranking according to what category and level of risk they represent. Ranking of contaminant risks for “potential” or “existing” sources of contamination is a function of the toxicity and the volume of specific contaminants associated with that source. Rankings include:

- Low;
- Medium;
- High; and
- Very High.

The time-of-travel for contaminants within the water is dependent on the physical and chemical characteristics of each contaminant. Bacteria and Viruses are only inventoried in Zone A because of their short life span. Only “Very High” and “High” rankings are inventoried within Zones B and C due to the probability of contaminant dilution by the time the contaminants reach the water intake.

The remaining tables in Appendix B (if necessary) contain the ranking of potential and existing sources of contamination with respect to bacteria and viruses,

nitrates and/or nitrites, volatile organic chemicals, heavy metals, cyanide, and other inorganic chemicals, synthetic organic chemicals, and other organic chemicals.

## VULNERABILITY OF THE DRINKING WATER SYSTEM

Vulnerability of a drinking water source to contamination is a combination of two factors:

- Surface Water Susceptibility; and
- Contaminant risks.

Appendix D contains 13 charts, which together form the ‘Vulnerability Analysis’ for the public drinking water Source Water Assessment. Chart 1 analyzes the ‘Susceptibility of the Surface Water Source’ to contamination by looking at the climate, terrain, and intake location. Chart 2 analyzes ‘Contaminant Risks’ for the drinking water source with respect to bacteria and viruses. The ‘Contaminant Risks’ portion of the analysis considers potential sources of contaminants as well as a review of contamination that has or may have occurred, but has not arrived or been detected at the intake area. Chart 3 contains the ‘Vulnerability Analysis for Bacteria and Viruses’, which is a composite score of the Vulnerability Analysis and the overall Susceptibility. Charts 4 through 13 repeat the Contaminant Risks and Vulnerability Analyses for nitrates and nitrites, volatile organic chemicals, heavy metals, cyanide, and other inorganic chemicals, synthetic organic chemicals, and other organic chemicals, respectively.

A score for the Surface Water Susceptibility of the source is reached by considering the properties of the water intake and the surrounding area. The derivation of this information is presented below and the data for this source is shown in Chart 1 of Appendix D.

Susceptibility of the Surface Water Source – always considered to be “high” (30 points)

+

Adequate Construction of the Intake (0 – 5 Points)

+

Runoff Potential Within Zone B (0 – 5 Points)

+

Dilution Capacity of the Surface Water (0 – 10 Points)

=

Natural Susceptibility  
(0 – 50 Points)

A ranking is assigned for the Surface Water Susceptibility according to the point score:

Surface Water Source Susceptibility Ratings	
40 to 50 pts	Very High
30 to < 40 pts	High

**Table 2. Susceptibility of the Water Source**

	Score	Rating
Minimum Allowable Susceptibility	30	
Intake Construction Adequate	0	
Runoff Potential	5	
Dilution Capacity	10	
<b>Overall Susceptibility</b>	<b>45</b>	<b>Very High</b>

For contaminants, risks to a drinking water source depend on the type, number or density, and distribution of the contaminant sources. The Contaminant Risk score has been derived from an examination of existing, and historical contamination sources that have been detected in the protection area through routine sampling. It also evaluates potential sources of contamination. Flow charts are used to assign a point score, and ratings are assigned in the same way as the susceptibility:

Contaminant Risk Ratings	
40 to 50 pts	Very High
30 to < 40 pts	High
20 to < 30 pts	Medium
< 20 pts	Low

Table 3 summarizes the Contaminant Risks for each category of drinking water contaminants.

**Table 3. Afognak Logging Camp Contaminant Risks**

Category	Score	Rating
Bacteria and Viruses	0	Low
Nitrates and/or Nitrites	3	Low
Volatile Organic Chemicals	15	Low
Heavy Metals, Cyanide, and Other Inorganic Chemicals	2	Low
Synthetic Organic Chemicals	0	Low
Other Organic Chemicals	0	Low

Finally, an overall vulnerability score is assigned for each contaminant type by combining each of the contaminant risk scores with the susceptibility score:

$$\begin{aligned}
 &\text{Susceptibility of the Surface Water Source} \\
 &\quad (0 - 50 \text{ points}) \\
 &\quad + \\
 &\text{Contaminant Risks (0 - 50 points)} \\
 &\quad = \\
 &\text{Vulnerability of the} \\
 &\text{Drinking Water Source to Contamination (0 - 100).}
 \end{aligned}$$

Again, rankings are assigned according to a point score:

Overall Vulnerability Ratings	
80 to 100 pts	Very High
60 to < 80 pts	High
40 to < 60 pts	Medium
< 40 pts	Low

Table 4 contains the overall vulnerability scores and ratings for each of the six categories of drinking water contaminants. Note: scores are rounded off to the nearest five.

**Table 4. Afognak Logging Camp Overall Vulnerability**

Category	Score	Rating
Bacteria and Viruses	45	Medium
Nitrates and Nitrites	48	Medium
Volatile Organic Chemicals	60	High
Heavy Metals, Cyanide, and Other Inorganic Chemicals	45	Medium
Synthetic Organic Chemicals	45	Medium
Other Organic Chemicals	45	Medium

### Bacteria and Viruses

The contaminant risk for bacteria and viruses is “low”. Typically, coliform detection in raw water samples collected from surface water sources is normal. (See Chart 2 – Contaminant Risks for Bacteria and Viruses in Appendix D).

Coliforms (a bacteria) are found naturally in the environment and although they aren’t necessarily a health threat, they are an indicator of other potentially harmful bacteria in the water, more specifically, fecal coliforms and E. coli which only come from human and animal fecal waste. Harmful bacteria can cause diarrhea, cramps, nausea, headaches, or other symptoms

(EPA, 2003). Positive samples increase the overall vulnerability of the drinking water source, indicating that the source is susceptible to bacteria and virus contamination.

Positive bacteria counts have not been detected in recent sampling.

After combining the contaminant risk for bacteria and viruses with the natural susceptibility of the source, the overall vulnerability of the source to bacteria and virus contamination is “medium”.

#### **Nitrates and Nitrites**

The contaminant risk for nitrates and nitrites is “low” (See Chart 4 - Contaminant Risks for Nitrates and/or Nitrites in Appendix D). Nitrates are very mobile, moving at approximately the same rate as water.

Sampling history for the water source indicates that nitrates have not been detected in recent sampling. The Maximum Contaminant Level (MCL) for nitrates is 10 milligrams per liter (mg/L). The MCL is the maximum level of contaminant that is allowed to exist in drinking water and still be consumed by humans without harmful health effects (EPA, 2003).

Possible sources of nitrates/nitrites could be from logging, or human/animal activity along roads, ATV trails, or snowmachine trails located within the protection area.

After combining the contaminant risk for nitrates and nitrites with the natural susceptibility of the source, the overall vulnerability of the source to contamination is “medium”.

#### **Volatile Organic Chemicals**

The contaminant risk for volatile organic chemicals is “low” (See Chart 6 – Contaminant Risks for Volatile Organic Chemicals in Appendix D).

Trihalomethanes and chloroform were detected at levels below the MCL during sampling in 2001-2, although these chemicals typically originate during the process of water treatment and not from the source waters. The MCL for chloroform is 0.2 milligrams per liter (mg/L) and the MCL for total trihalomethanes is 0.1 mg/L.

Possible sources of volatile organic chemicals could be from logging activity or from human/animal activity along roads, ATV trails, or snowmachine trails located within the protection area.

After combining the contaminant risk for volatile organic chemicals with the natural susceptibility of the

source, the overall vulnerability of the source to contamination is “high”.

#### **Heavy Metals, Cyanide, and Other Inorganic Chemicals**

The contaminant risk for heavy metals is “low”. Copper and lead have been detected in samples collected during 2000-2003, but at levels below the MCL (See Chart 8 – Contaminant Risks for Heavy Metals, Cyanide, and Other Inorganic Chemicals in Appendix D). The MCL for copper is 1.3 mg/l. and the MCL for lead is 0.015 mg/l.

The most common source of these chemicals is the infrastructure of the distribution system following the treatment process and not from the source waters. Additional sources of heavy metals could be from logging activity or from activity along roads, ATV trails, or snowmachine trails located within the protection area.

After combining the contaminant risk for heavy metals with the natural susceptibility of the source, the overall vulnerability of the well to contamination is “medium”.

#### **Synthetic Organic Chemicals**

The contaminant risk for synthetic organic chemicals is “low”.

Review of the historical sampling data indicates that test results for ethylene dibromide in 2001-2002 were negative.

After combining the contaminant risk with the natural susceptibility of the source, the overall vulnerability to synthetic organic chemicals of the source is “medium” (See Chart 11 – Contaminant Risks for Synthetic Organic Chemicals in Appendix D).

#### **Other Organic Chemicals**

The contaminant risk for other organic chemicals is “low”.

Review of the historical sampling data indicates that no other organic chemicals have been sampled recently.

After combining the contaminant risk with the natural susceptibility of the source, the overall vulnerability to other organic chemicals of the source is “medium” (See Chart 13 – Contaminant Risks for Other Organic Chemicals in Appendix D).

### **Using the Source Water Assessment**

This assessment of contaminant risks can be used as a foundation for local voluntary protection efforts as well as a basis for the continuous efforts on the part of the Afognak Native Corporation to protect public health. It is anticipated that Source Water Assessments will be updated every five years to reflect any changes in the vulnerability and/or susceptibility of the drinking water source.



## **REFERENCES**

Alaska Department of Community and Economic Development (ADCED), 2003 [WWW document]. URL [http://www.dced.state.ak.us/cbd/commdb/CF\\_COMDB.htm](http://www.dced.state.ak.us/cbd/commdb/CF_COMDB.htm)

United States Environmental Protection Agency (EPA), 2003 [WWW document]. URL <http://www.epa.gov/safewater/mcl.html>.


## **APPENDIX A**

### **Afognak Logging Camp Drinking Water Protection Area Location Map (Map 1)**



**Map 1: Afognak Logging Camp Drinking Water Protection Area**

**PWSID: 250354.001**



**Data Sources:**


**Background image**  
- USGS 1:63,000 mapping

*Protection zones were delineated based upon streams noted on USGS 1:63,000 mapping.*

*For this PWS Zone C (the entire watershed) covers the same area as Zone B (areas within 1-mile of the lake).*

**Legend**

- Water System Intake
- Zone A Protection Area
- Zone B Protection Area
- Zone C Protection Area
- Stream

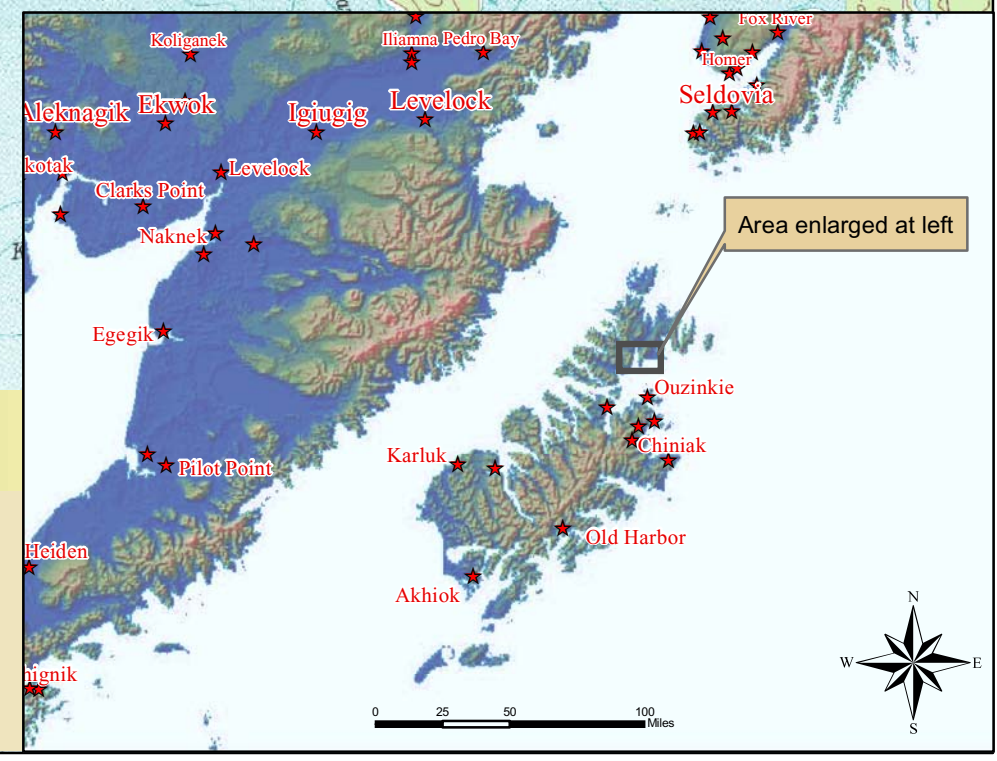

## **APPENDIX B**

### **Contaminant Source Inventory and Risk Rankings (Tables 1-4)**

**Table 1**

**Contaminant Source Inventory for  
Afognak Logging Camp**

**PWSID 250354.001**

<b>Contaminant Source Type</b>	<b>Contaminant Source ID</b>	<b>CS ID tag</b>	<b>Zone</b>	<b>Map Number</b>	<b>Comments</b>
Logging (inactive around source intake)	E02	E02-1-2	A	2	Approximate locations based on 1996 Sanitary Survey. Operator reports logging is inactive around the source intake.

**Table 2**

*Contaminant Source Inventory and Risk Ranking for  
Afognak Logging Camp  
Sources of Nitrates/Nitrites*

**PWSID 250354.001**

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Logging (inactive around source intake)	E02	E02-1-2	A	Low	2	Approximate locations based on 1996 Sanitary Survey. Operator reports logging is inactive around the source intake.

**Table 3**

*Contaminant Source Inventory and Risk Ranking for  
Afognak Logging Camp  
Sources of Volatile Organic Chemicals*

**PWSID 250354.001**

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Logging (inactive around source intake)	E02	E02-1-2	A	Medium	2	Approximate locations based on 1996 Sanitary Survey. Operator reports logging is inactive around the source intake.

**Table 4**

*Contaminant Source Inventory and Risk Ranking for  
Afognak Logging Camp  
Sources of Heavy Metals, Cyanide and Other Inorganic Chemicals*


**PWSID 250354.001**

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Logging (inactive around source intake)	E02	E02-1-2	A	Low	2	Approximate locations based on 1996 Sanitary Survey. Operator reports logging is inactive around the source intake.




## **APPENDIX C**

### **Afognak Logging Camp Drinking Water Protection Area and Potential and Existing Contaminant Sources (Map 2)**

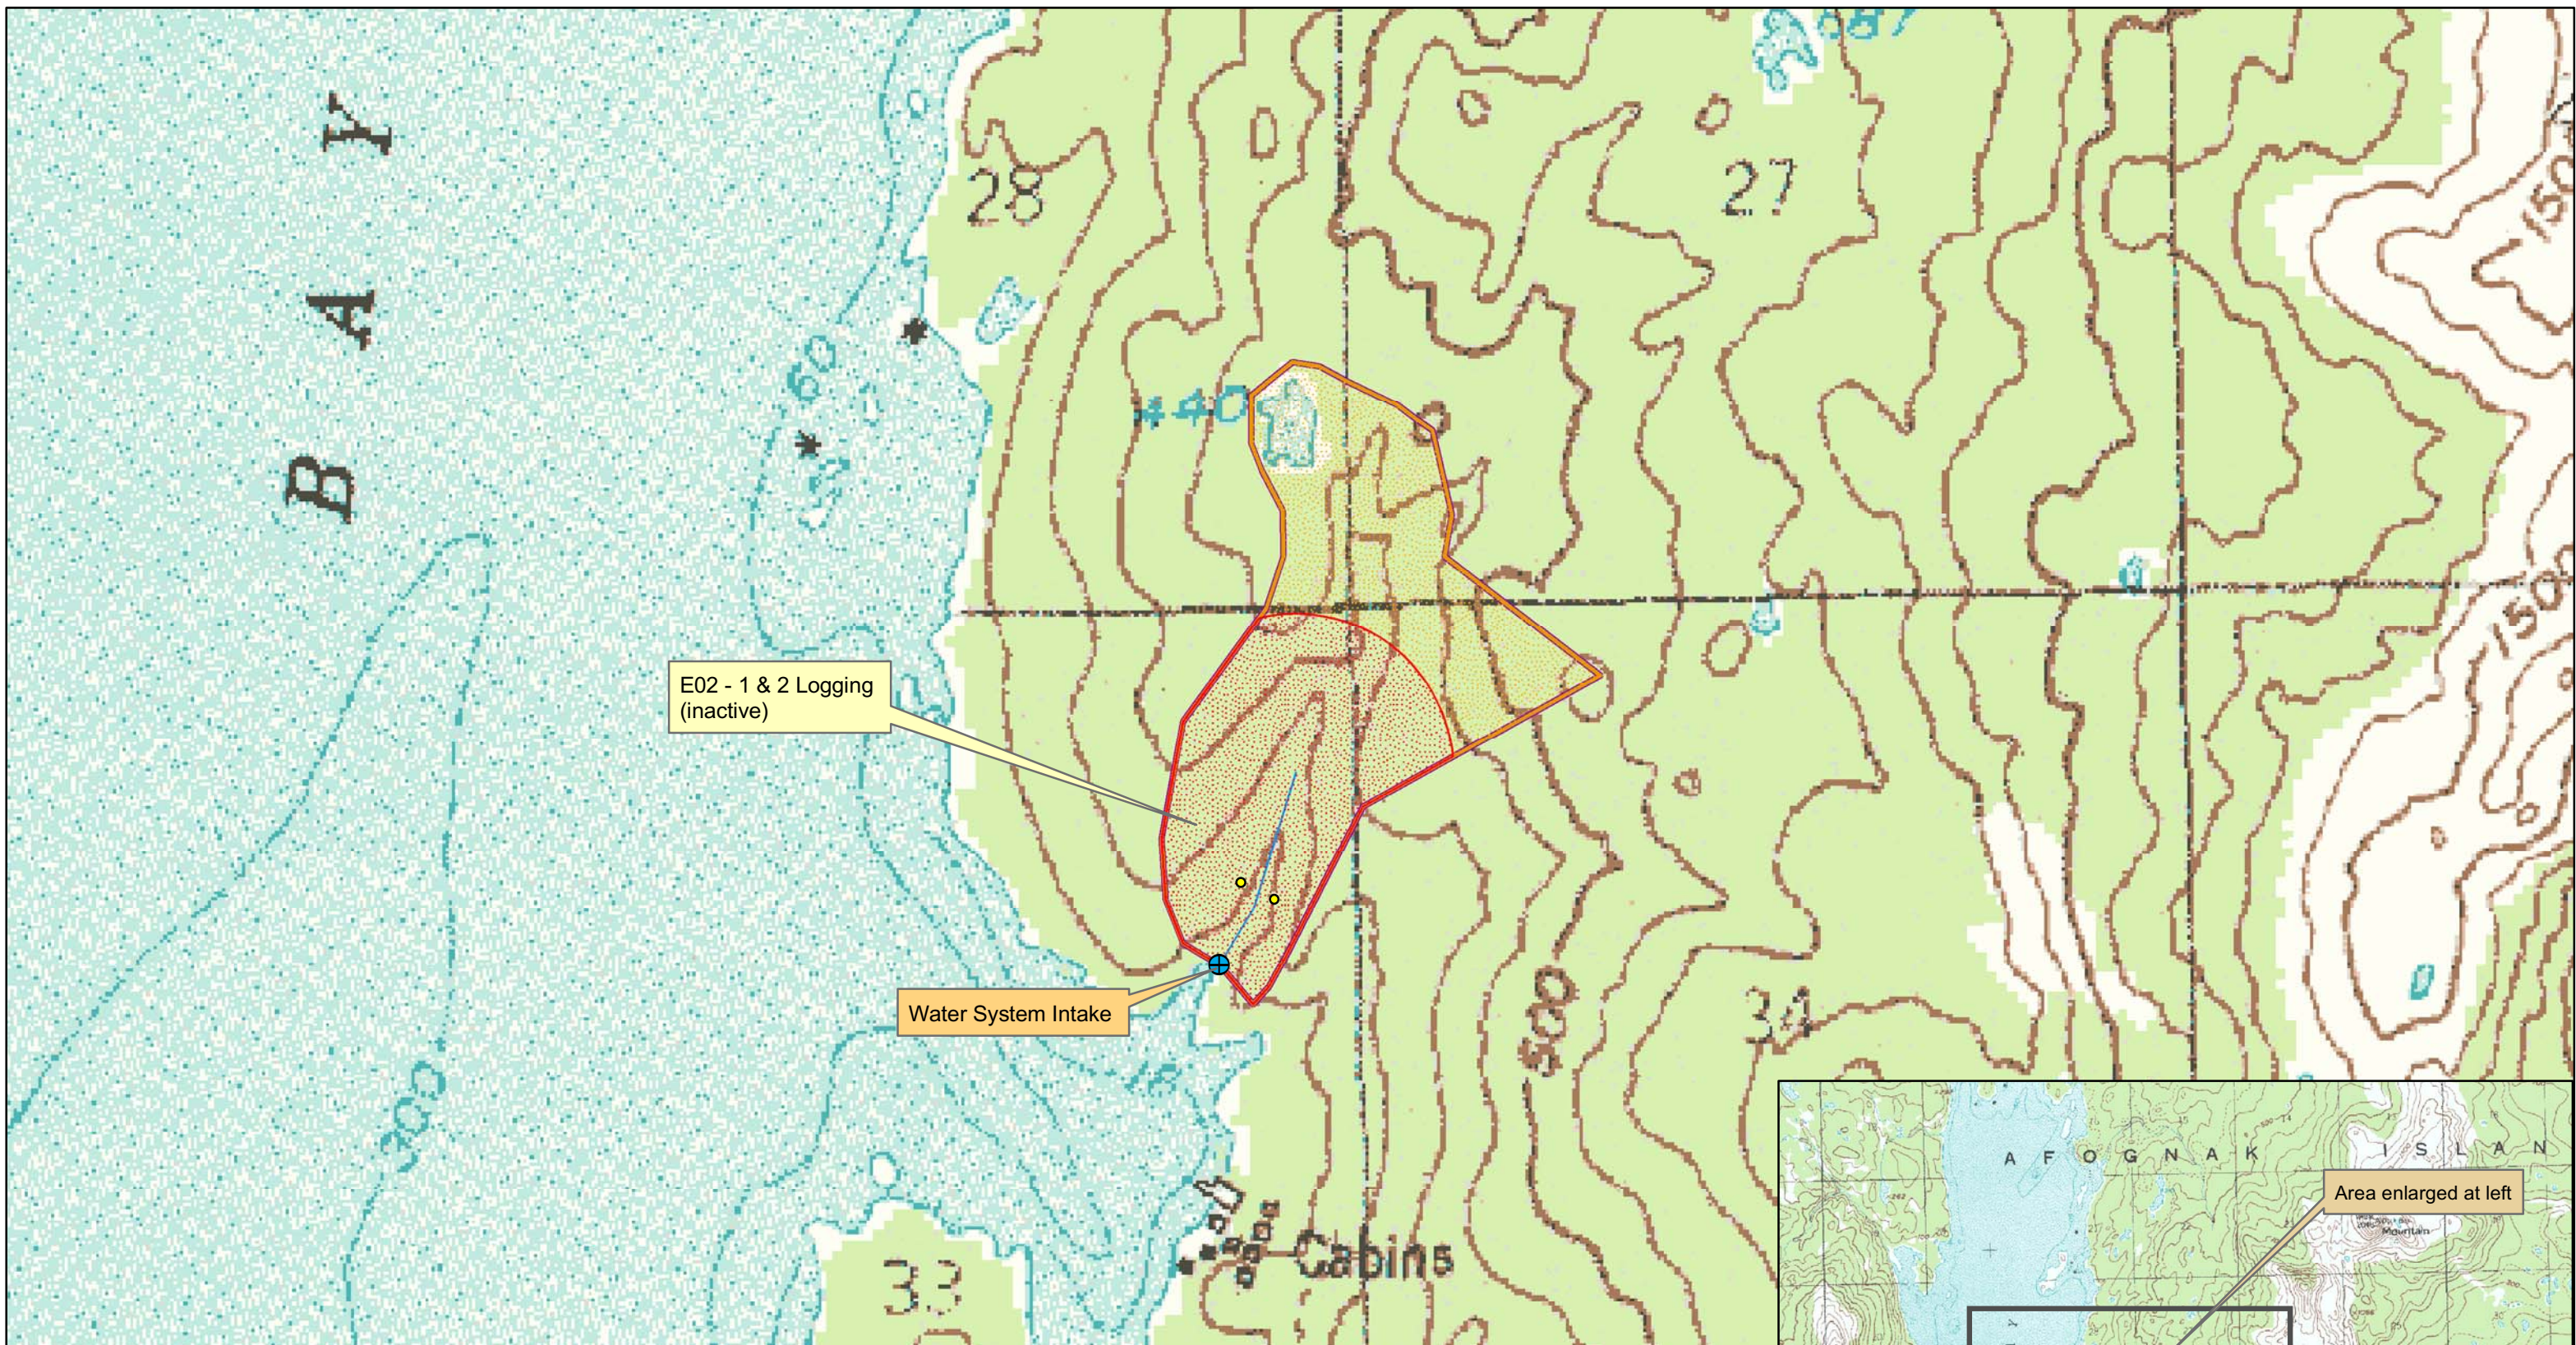

**Map 2: Potential and Existing Contaminant Sources**

**PWSID: 250354.001**








**Data Sources:**


**Background image**  
- USGS 1:63,000 mapping

*Protection zones were delineated based upon streams noted on USGS 1:63,000 mapping.*

*For this PWS Zone C (the entire watershed) covers the same area as Zone B (areas within 1-mile of the lake).*

**Legend**

-  Water System Intake
-  Zone A Protection Area
-  Zone B Protection Area
-  Zone C Protection Area
-  River/Stream

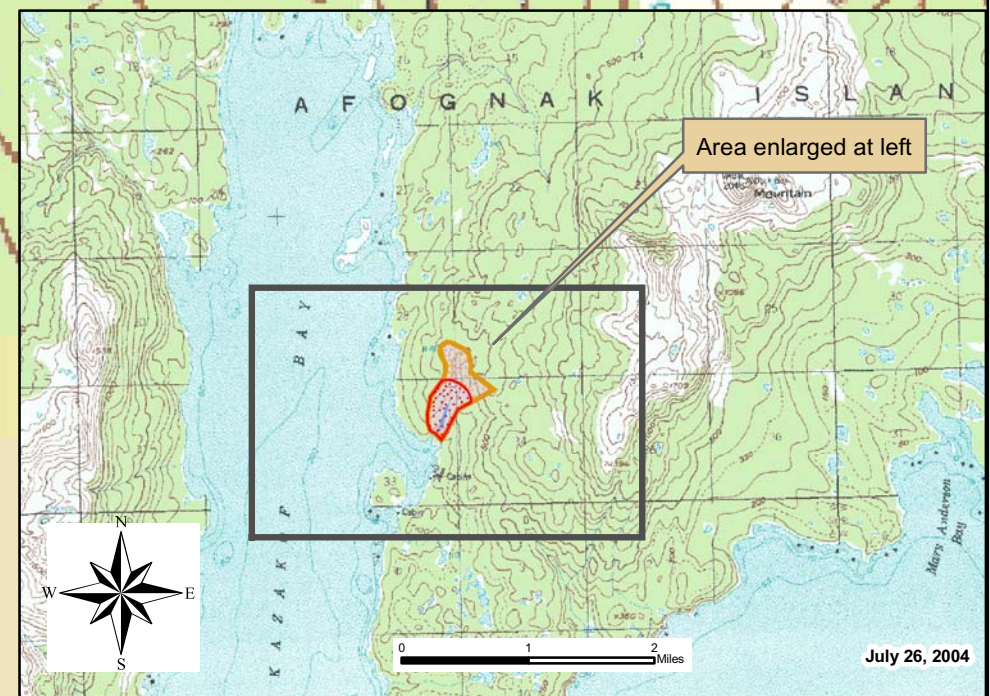

July 26, 2004

## **APPENDIX D**

### **Vulnerability Analysis and Contaminant Risks (Charts 1-13)**

**Chart 1. Susceptibility of the Surface Water Source - Afognak Logging Camp Water System**

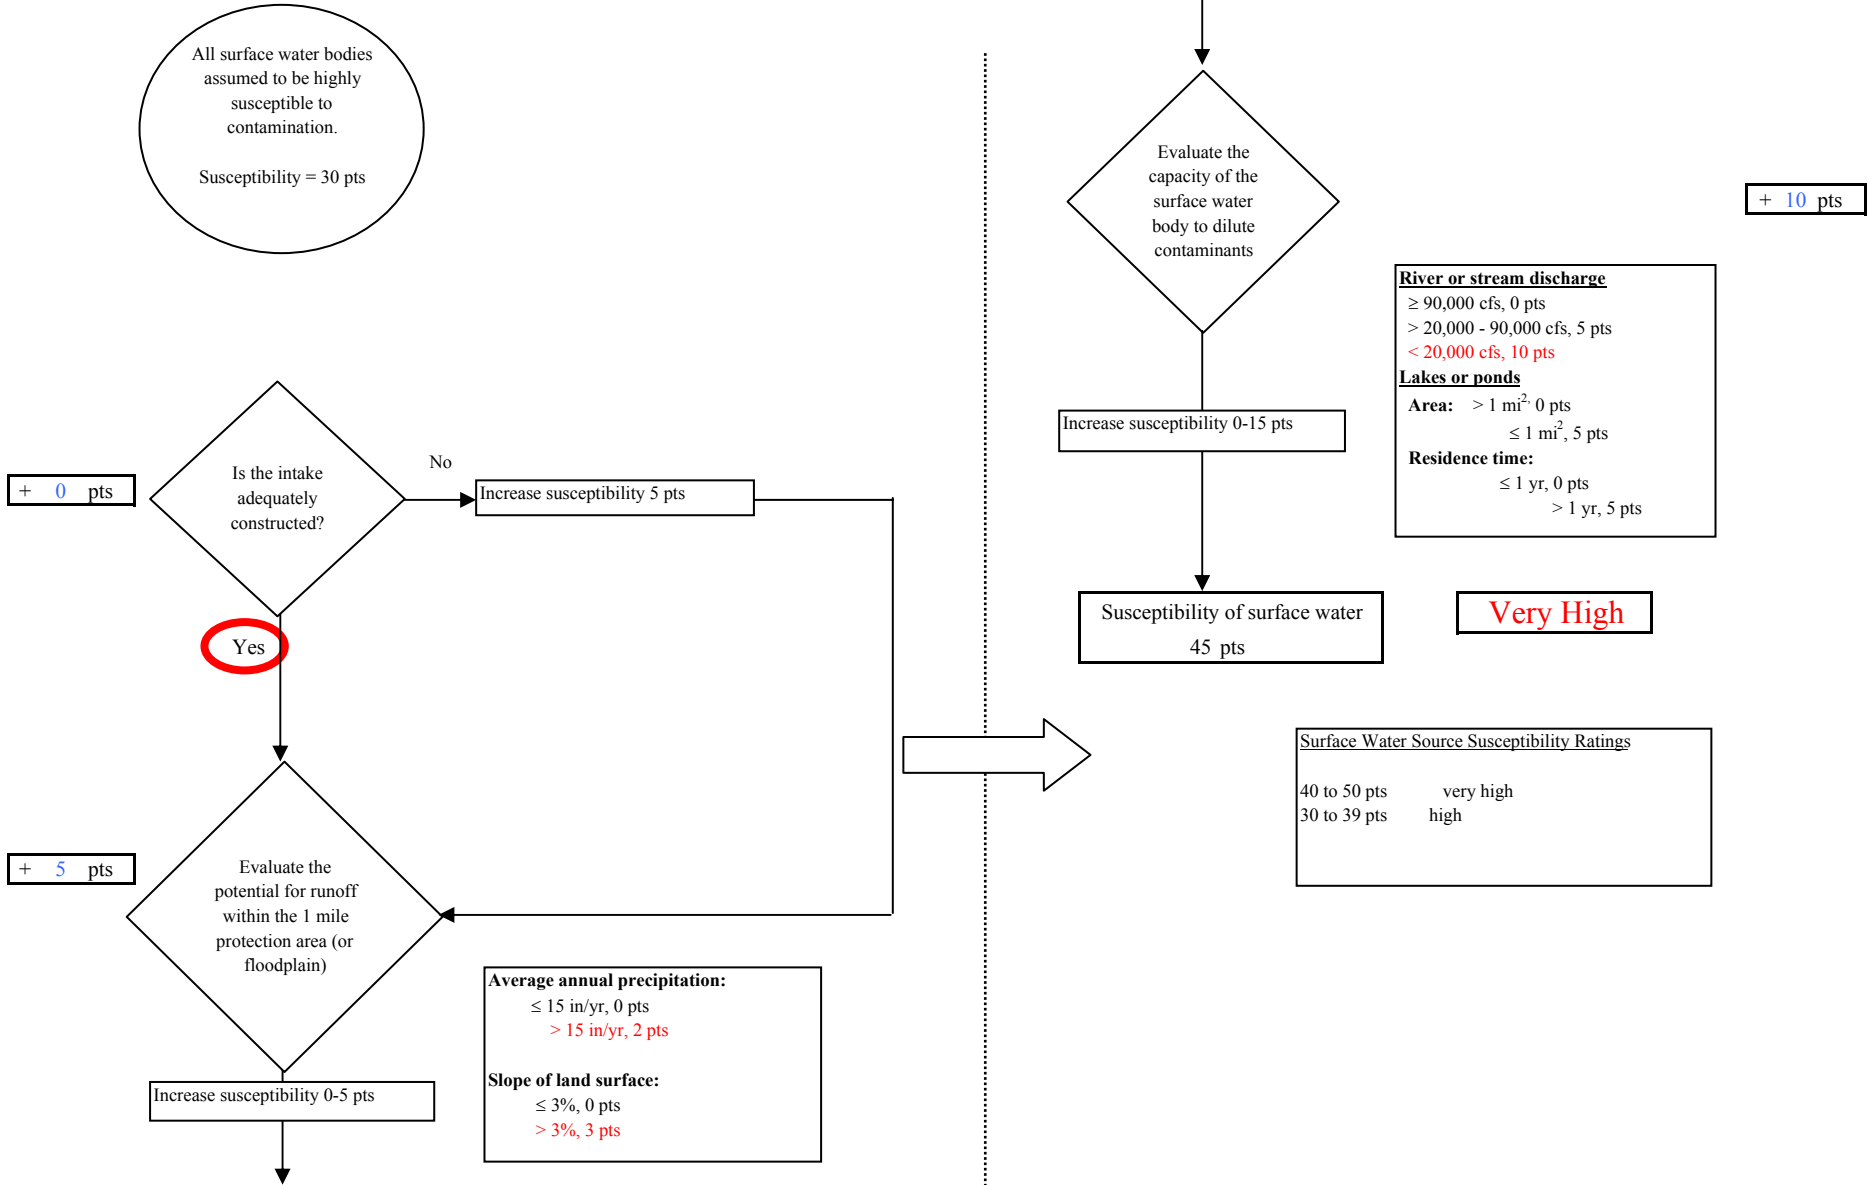


Chart 2. Contaminant risks for Afognak Logging Camp Water System - Bacteria & Viruses





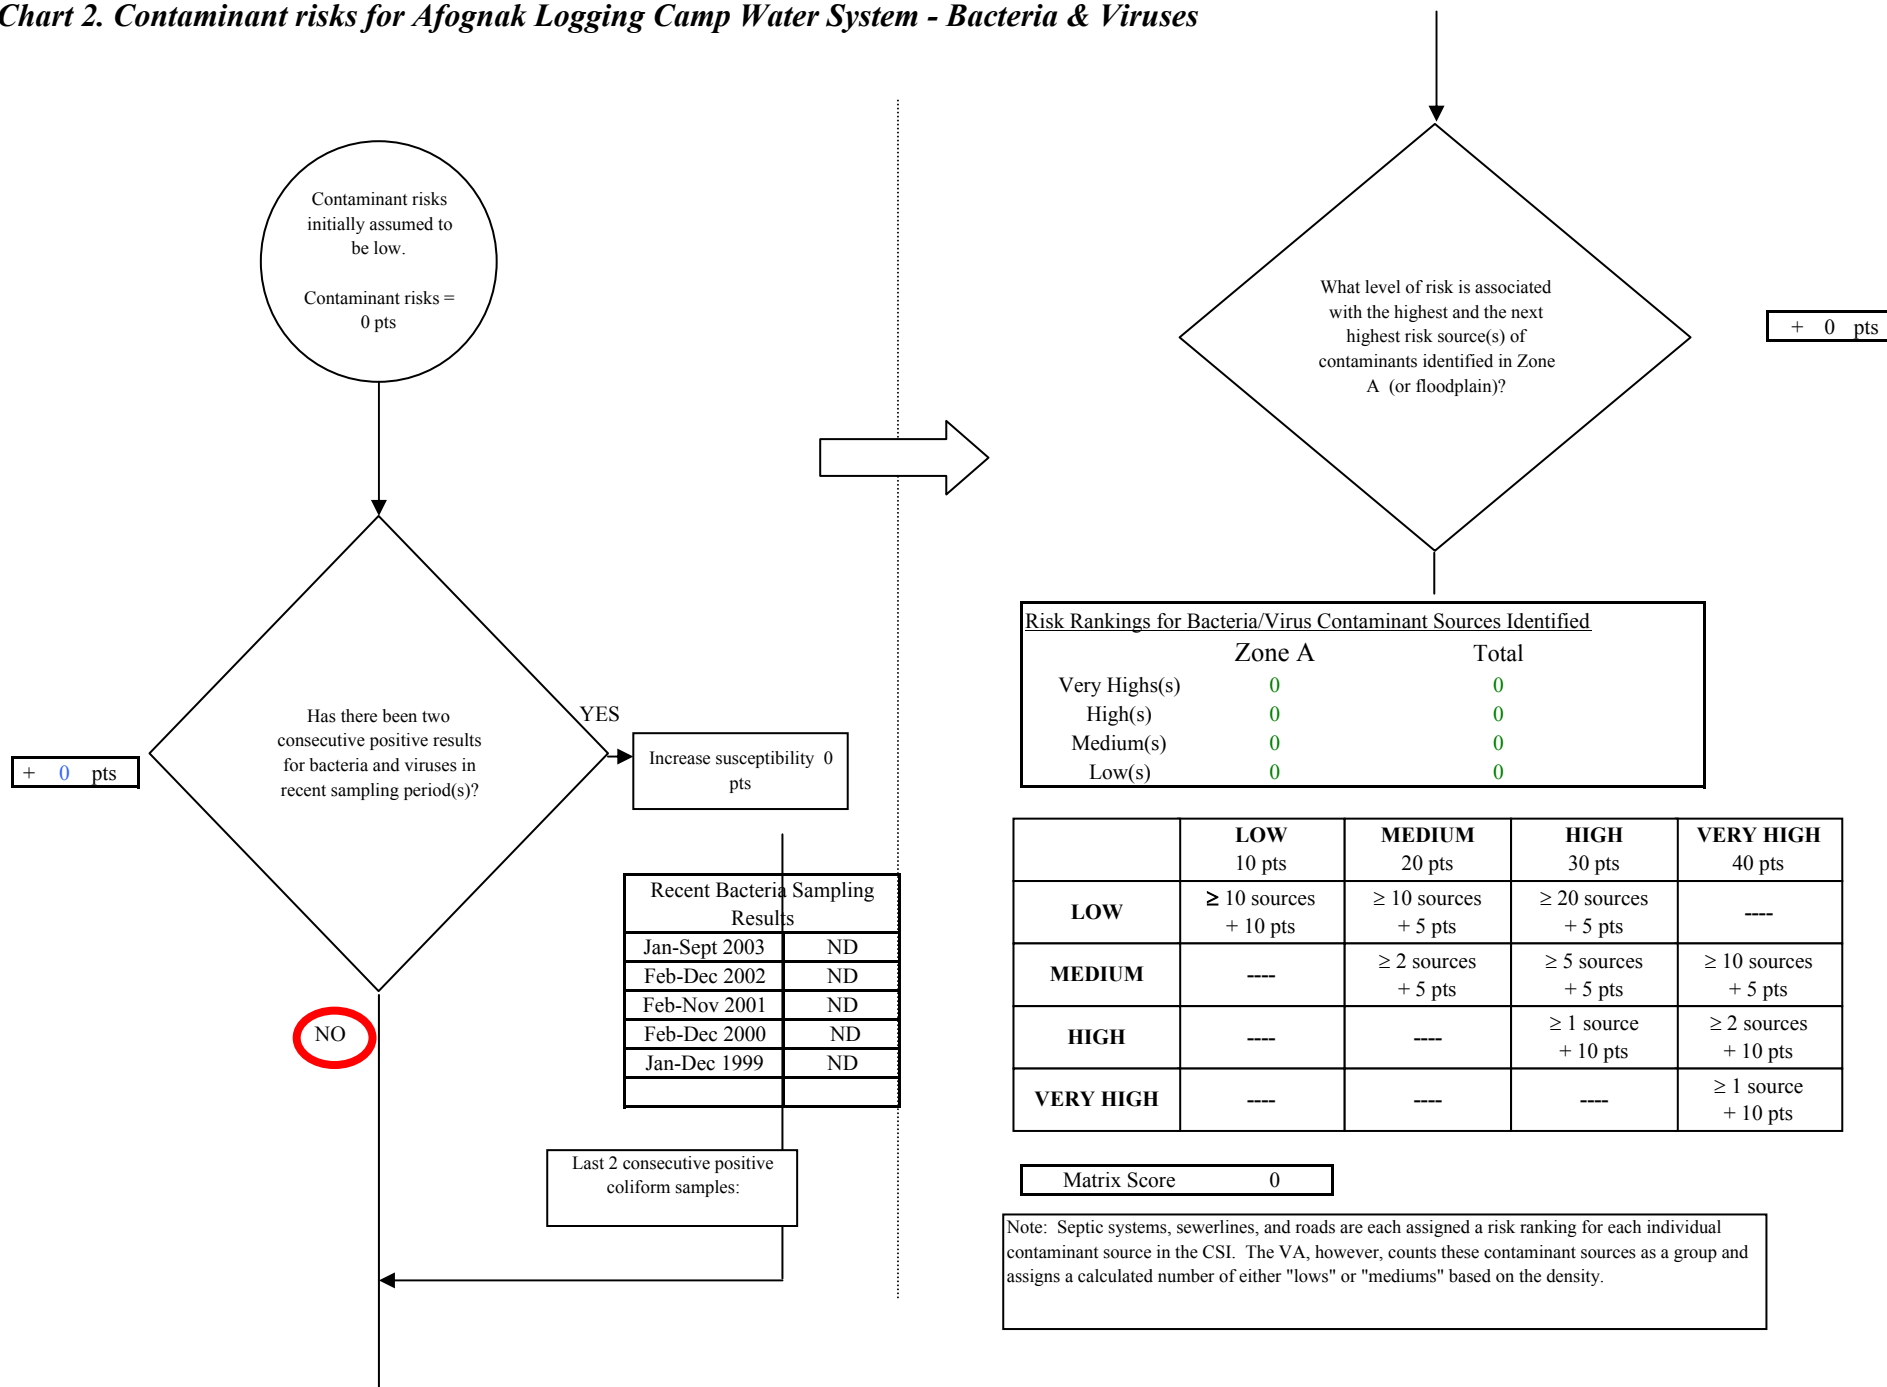



Chart 2. Contaminant risks for Afognak Logging Camp Water System - Bacteria & Viruses

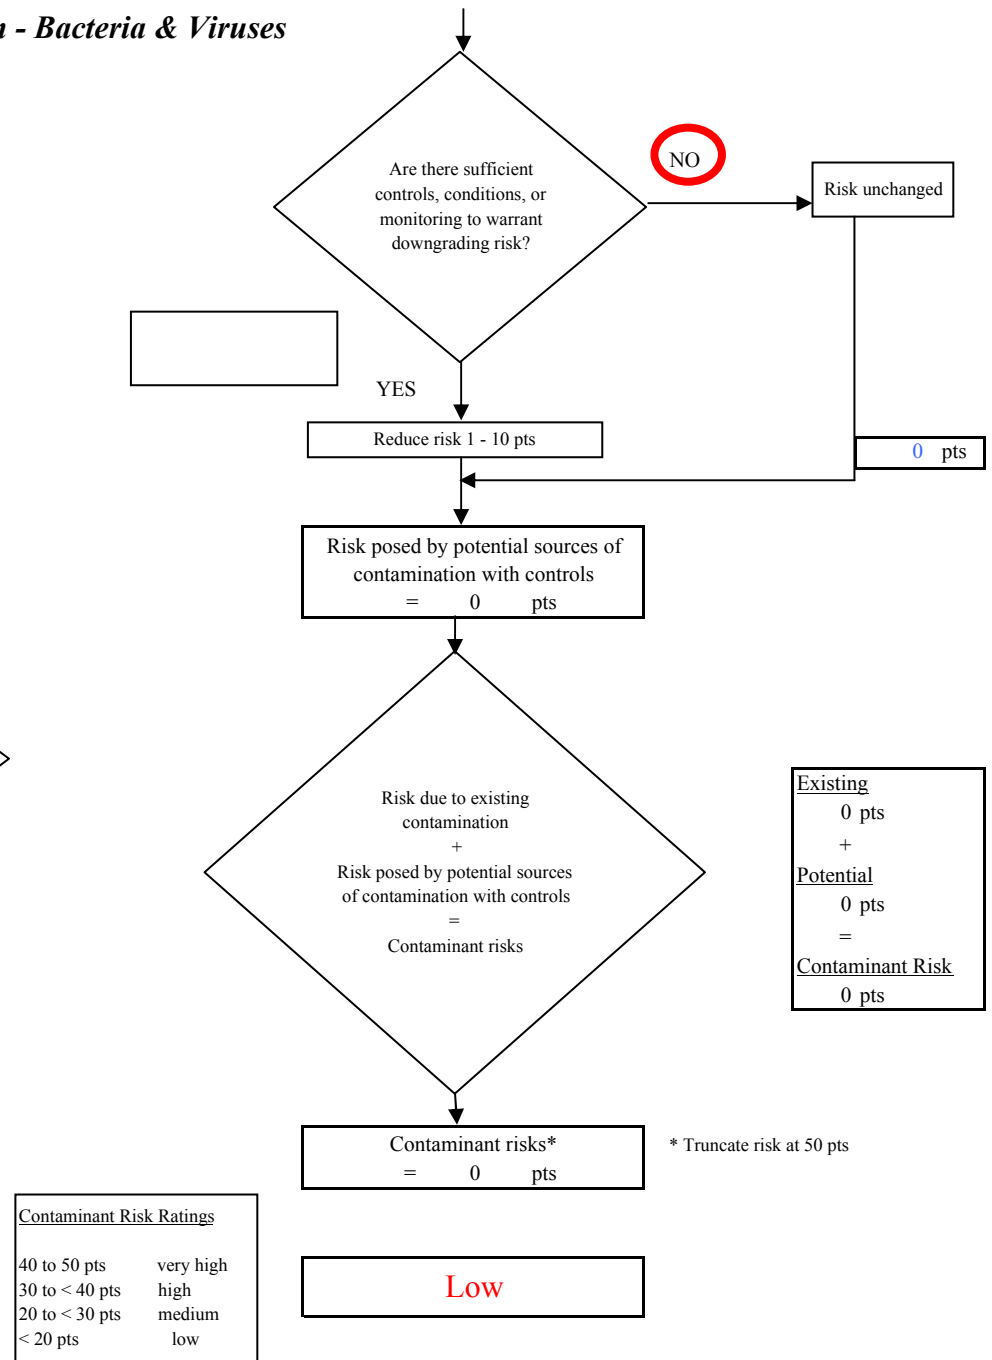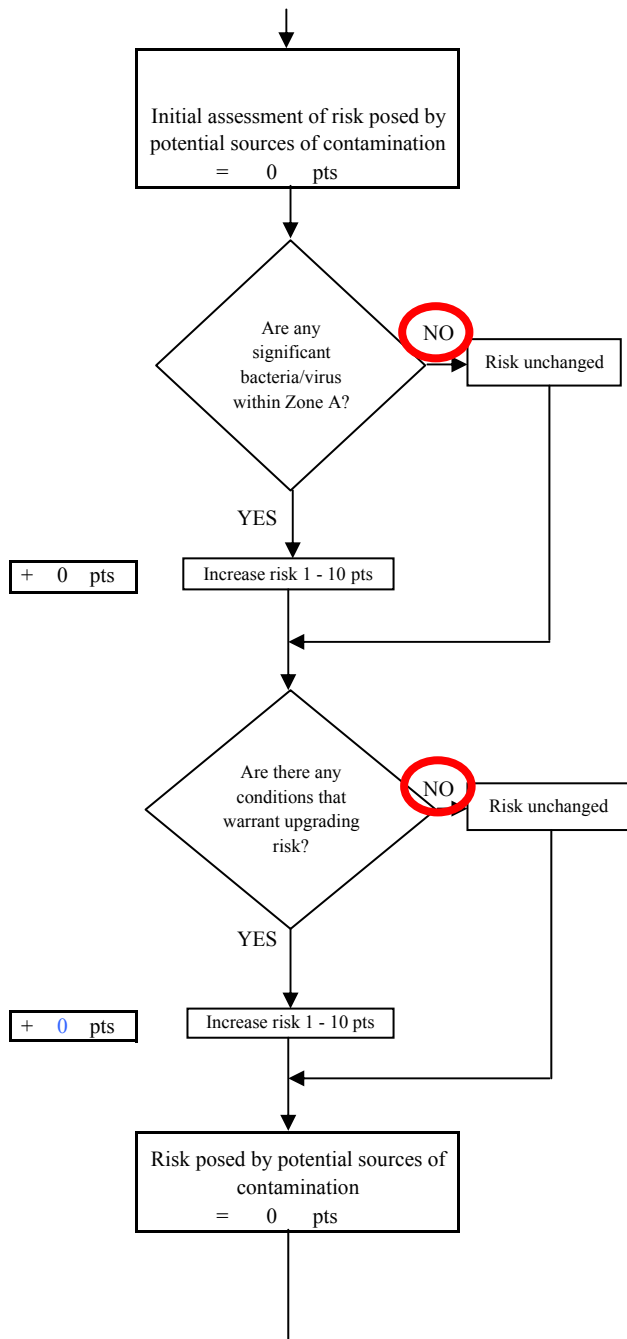

**Chart 3. Vulnerability analysis for Afognak Logging Camp Water System - Bacteria & Viruses**

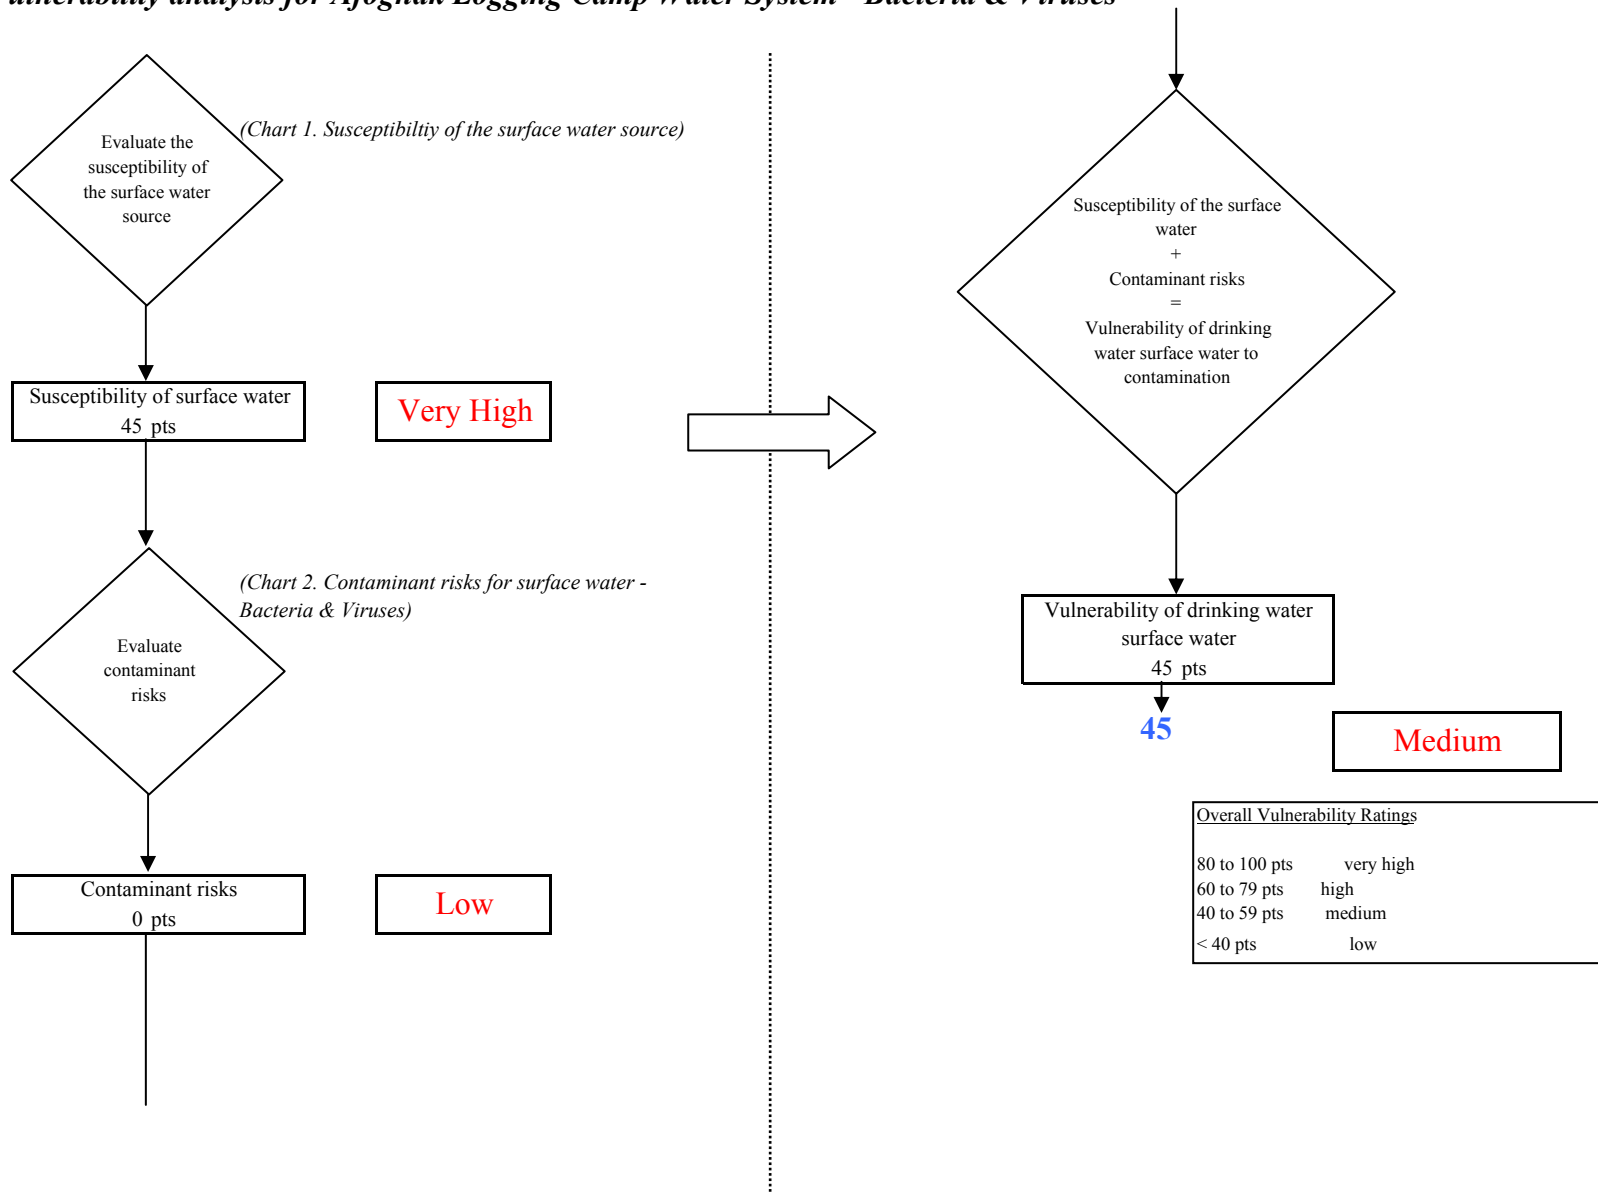


**Chart 4. Contaminant risks for Afognak Logging Camp Water System - Nitrates and Nitrites**

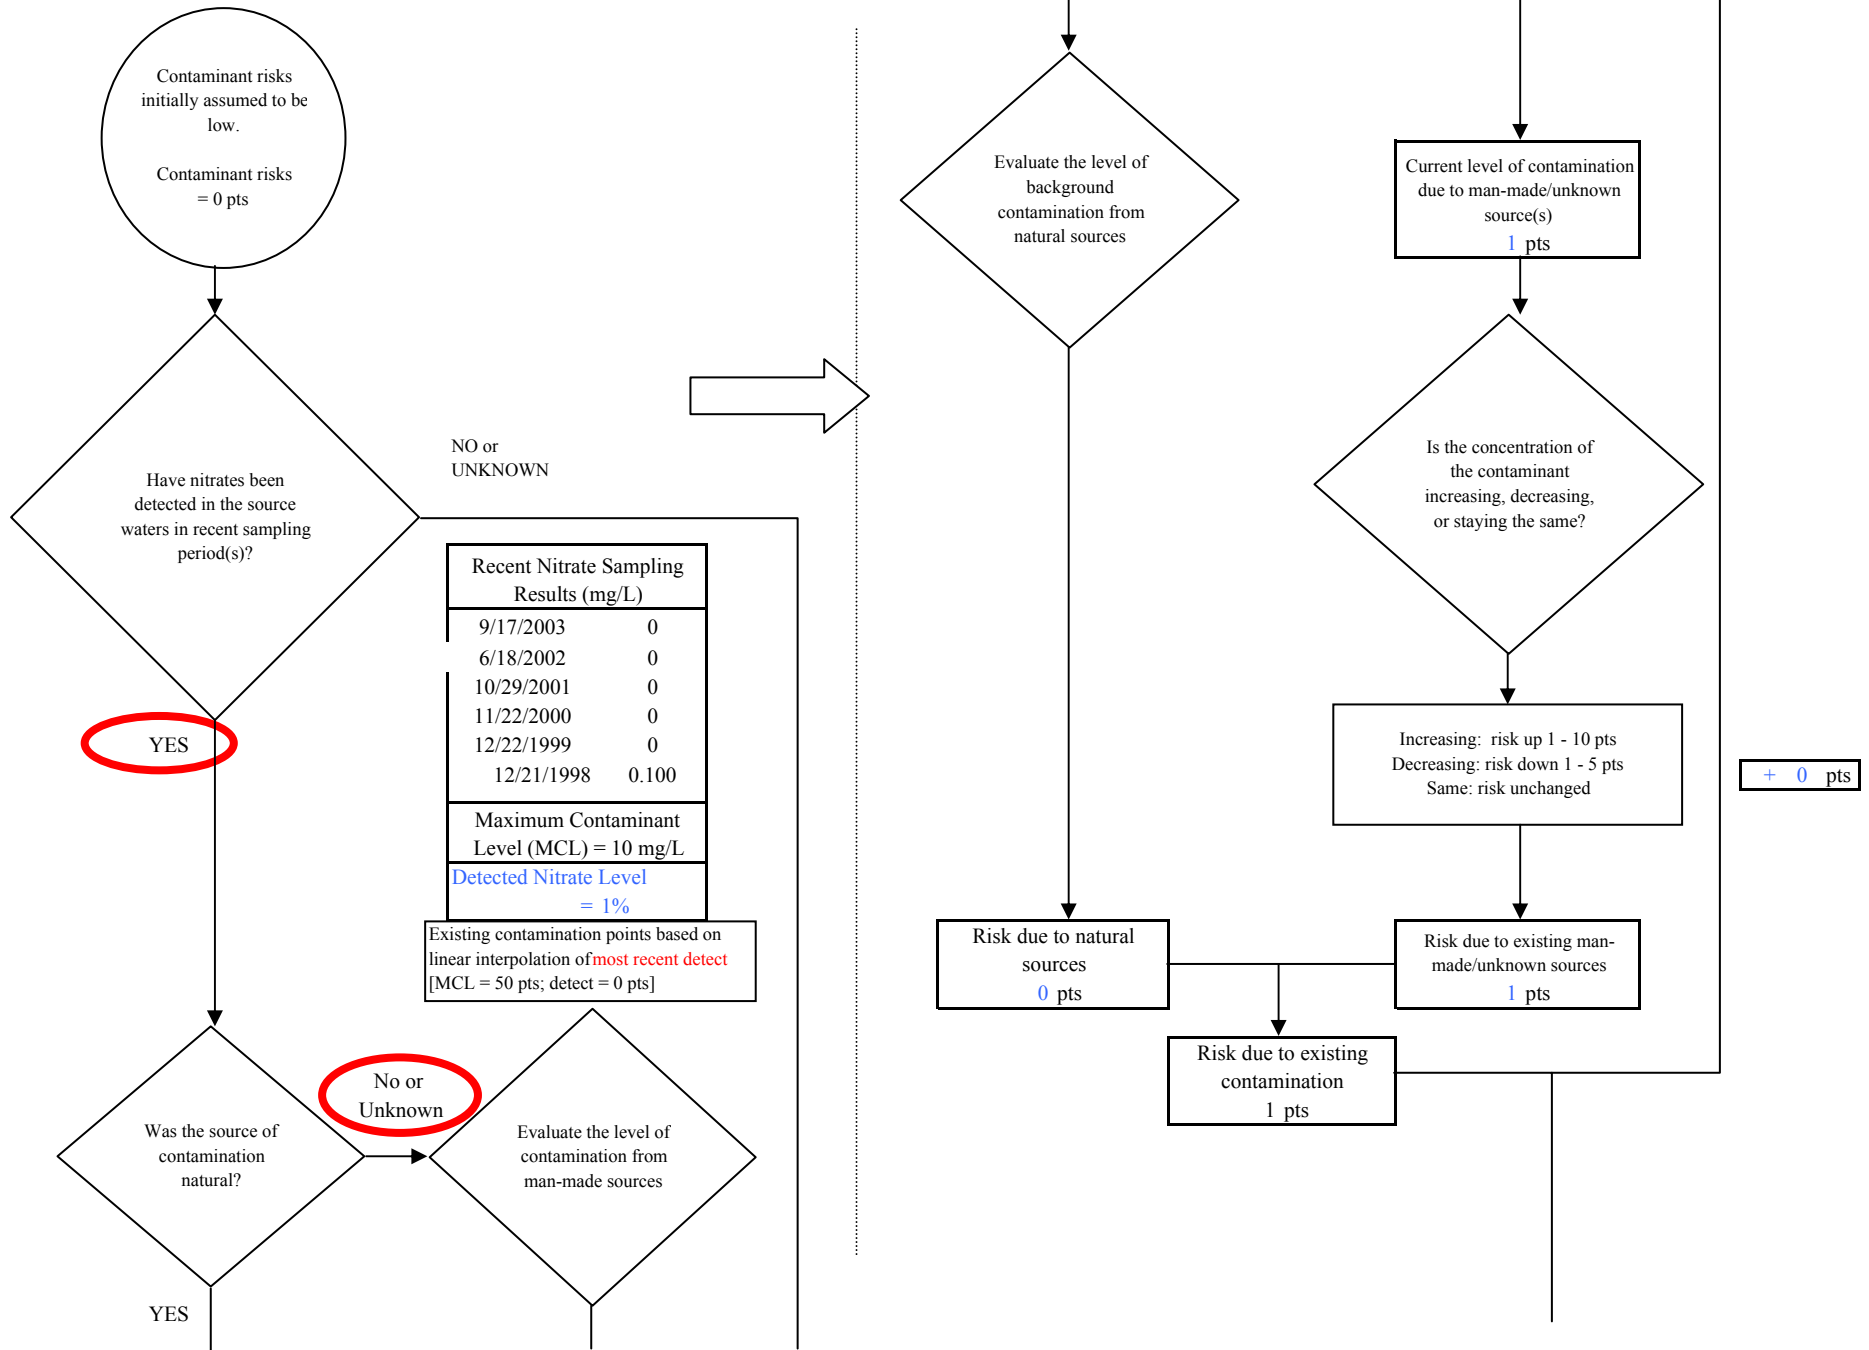



**Chart 4. Contaminant risks for Afognak Logging Camp Water System - Nitrates and Nitrites**


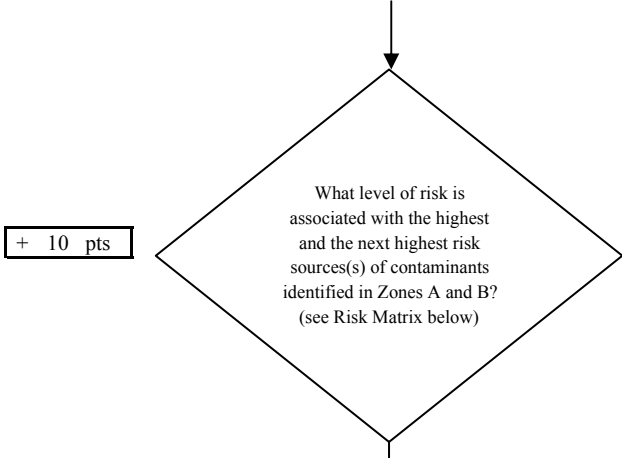


Risk Levels for Nitrate/Nitrite Sources identified in Zones A and B			
	Zone A	Zone B	Total
Very Highs(s)	0	0	0
High(s)	0	0	0
Medium(s)	0	0	0
Low(s)	1	0	1




	<b>LOW</b> 10 pts	<b>MEDIUM</b> 20 pts	<b>HIGH</b> 30 pts	<b>VERY HIGH</b> 40 pts
<b>LOW</b>	≥ 10 sources + 10 pts	≥ 10 sources + 5 pts	≥ 20 sources + 5 pts	----
<b>MEDIUM</b>	----	≥ 2 sources + 5 pts	≥ 5 sources + 5 pts	≥ 10 sources + 5 pts
<b>HIGH</b>	----	----	≥ 1 source + 10 pts	≥ 2 sources + 10 pts
<b>VERY HIGH</b>	----	----	----	≥ 1 source + 10 pts

Matrix Score            10


Note: Septic systems, sewerlines, and roads are each assigned a risk ranking for each individual contaminant source in the CSI. The VA, however, counts these contaminant sources as a group and assigns a calculated number of either "lows" or "mediums" based on the density.

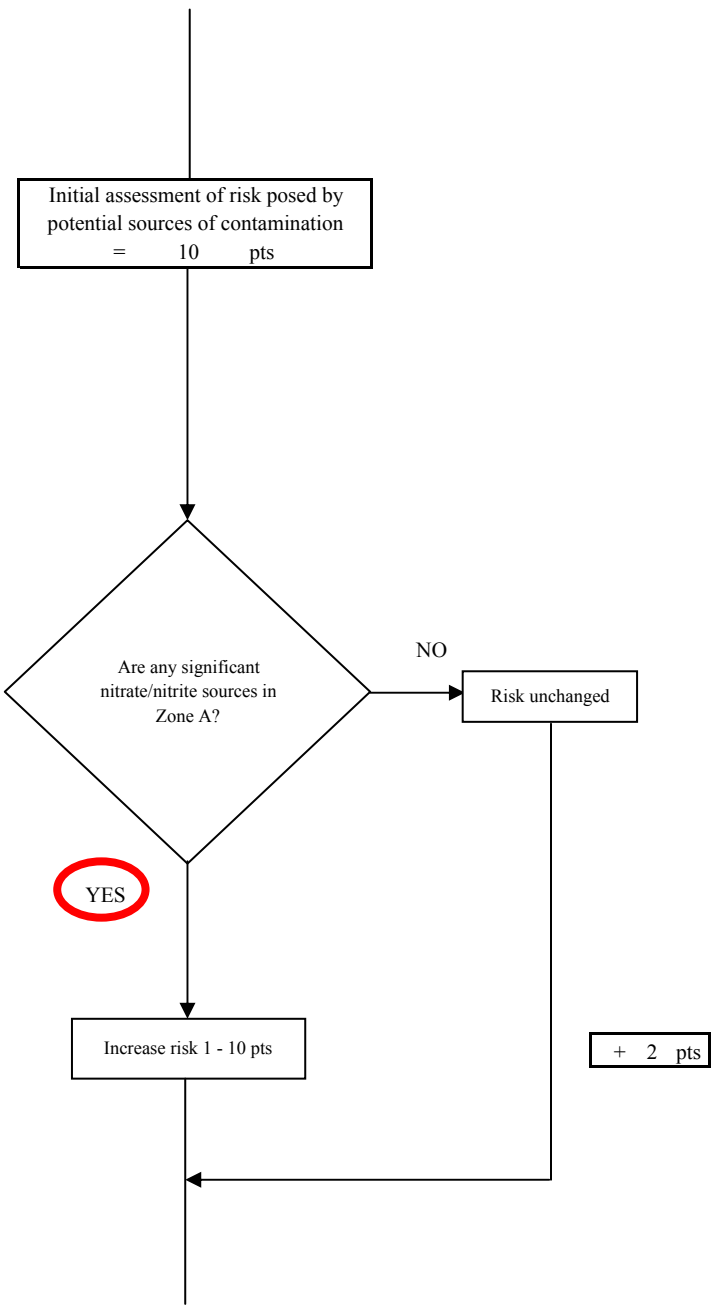


**Chart 4. Contaminant risks for Afognak Logging Camp Water System - Nitrates and Nitrites**

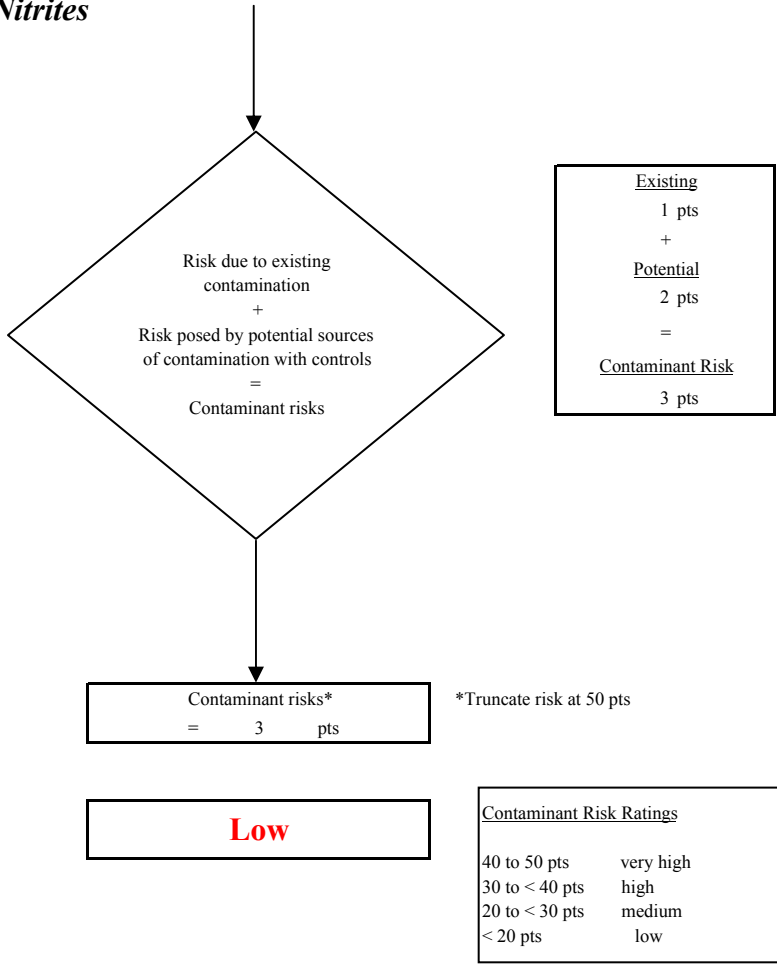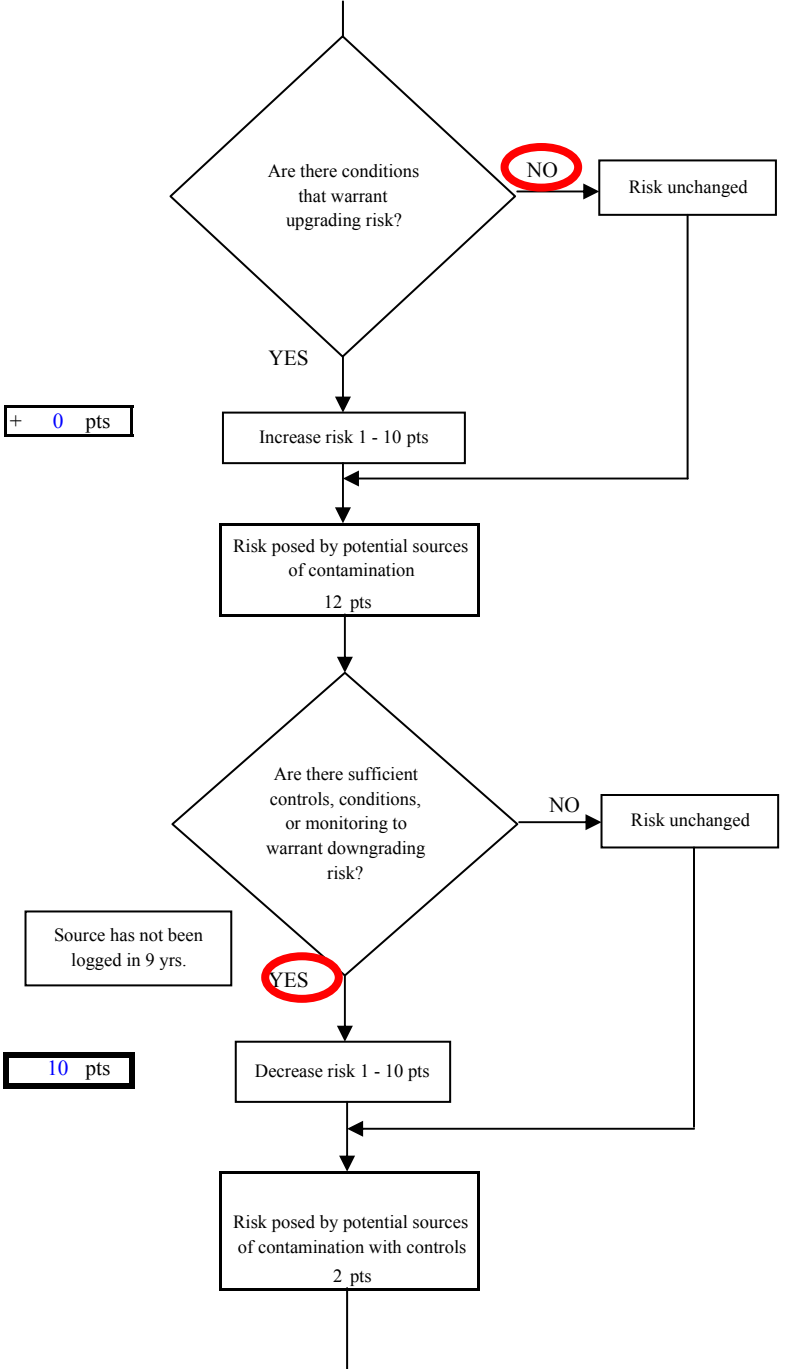


**Chart 5. Vulnerability analysis for Afognak Logging Camp Water System - Nitrates and Nitrites**

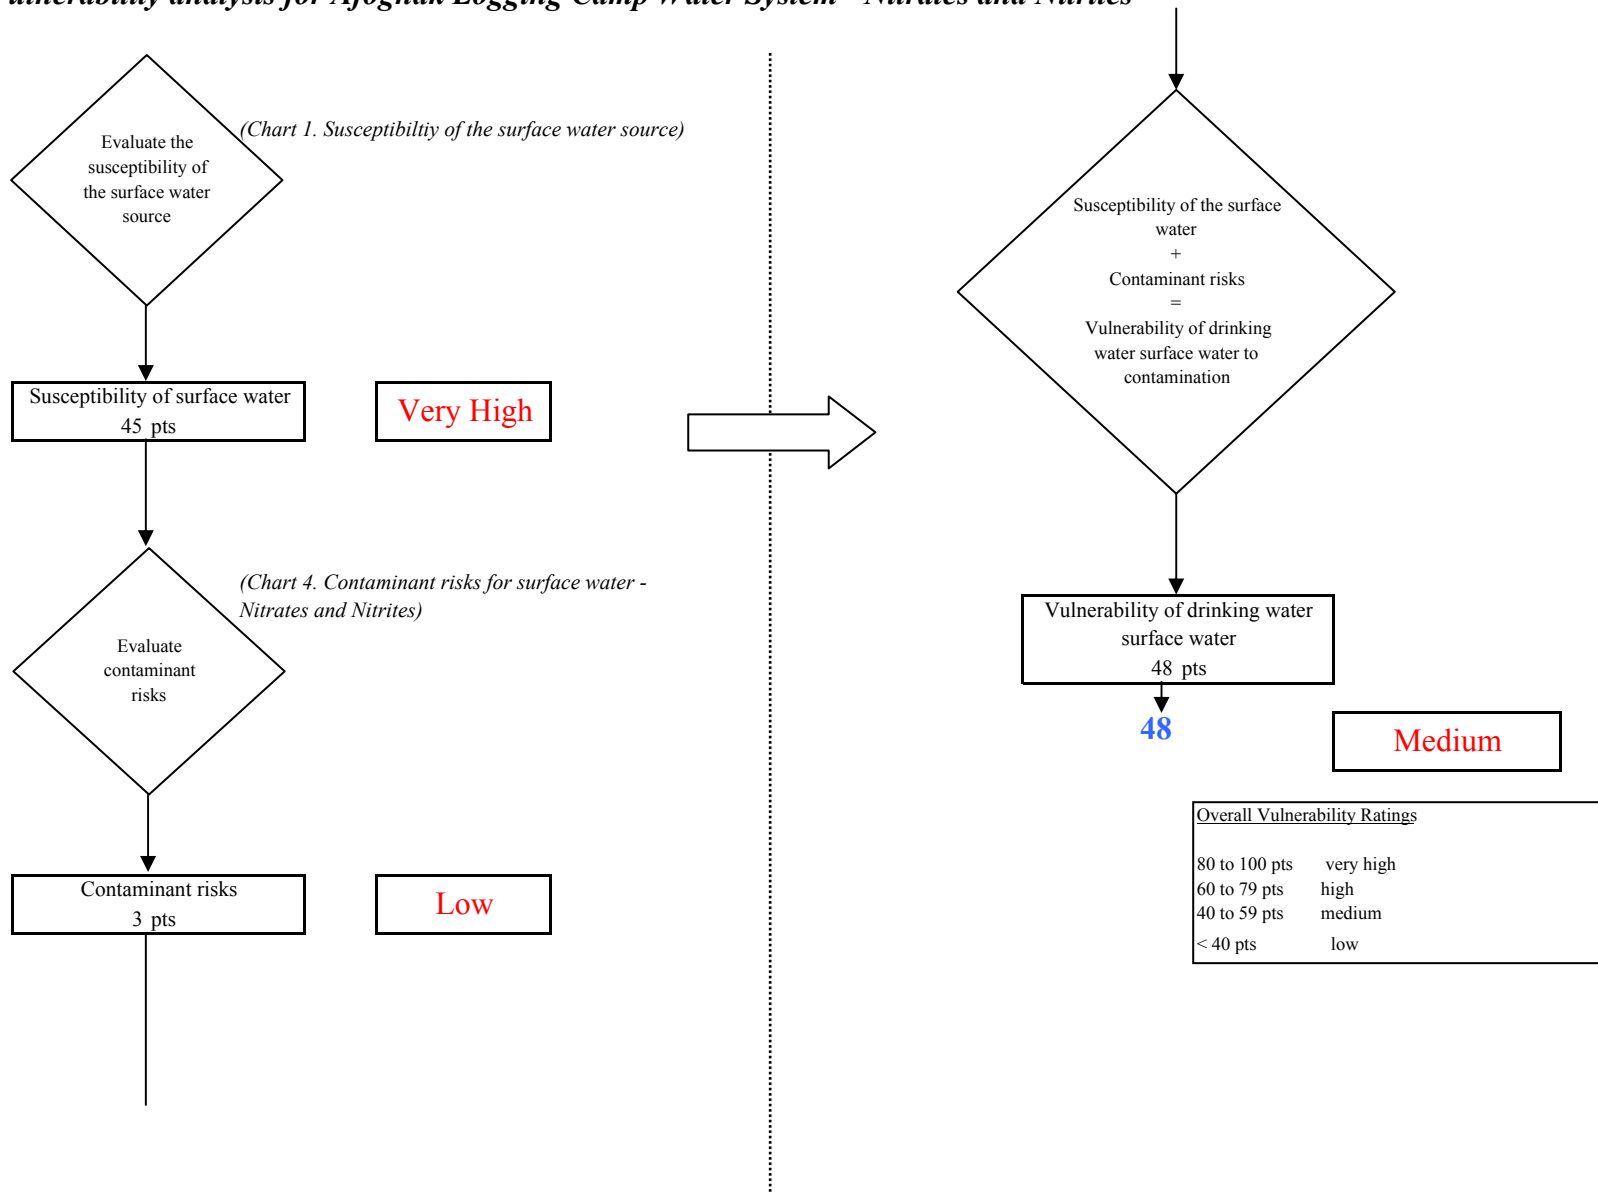


**Chart 6. Contaminant risks for Afognak Logging Camp Water System - Volatile Organic Chemicals**

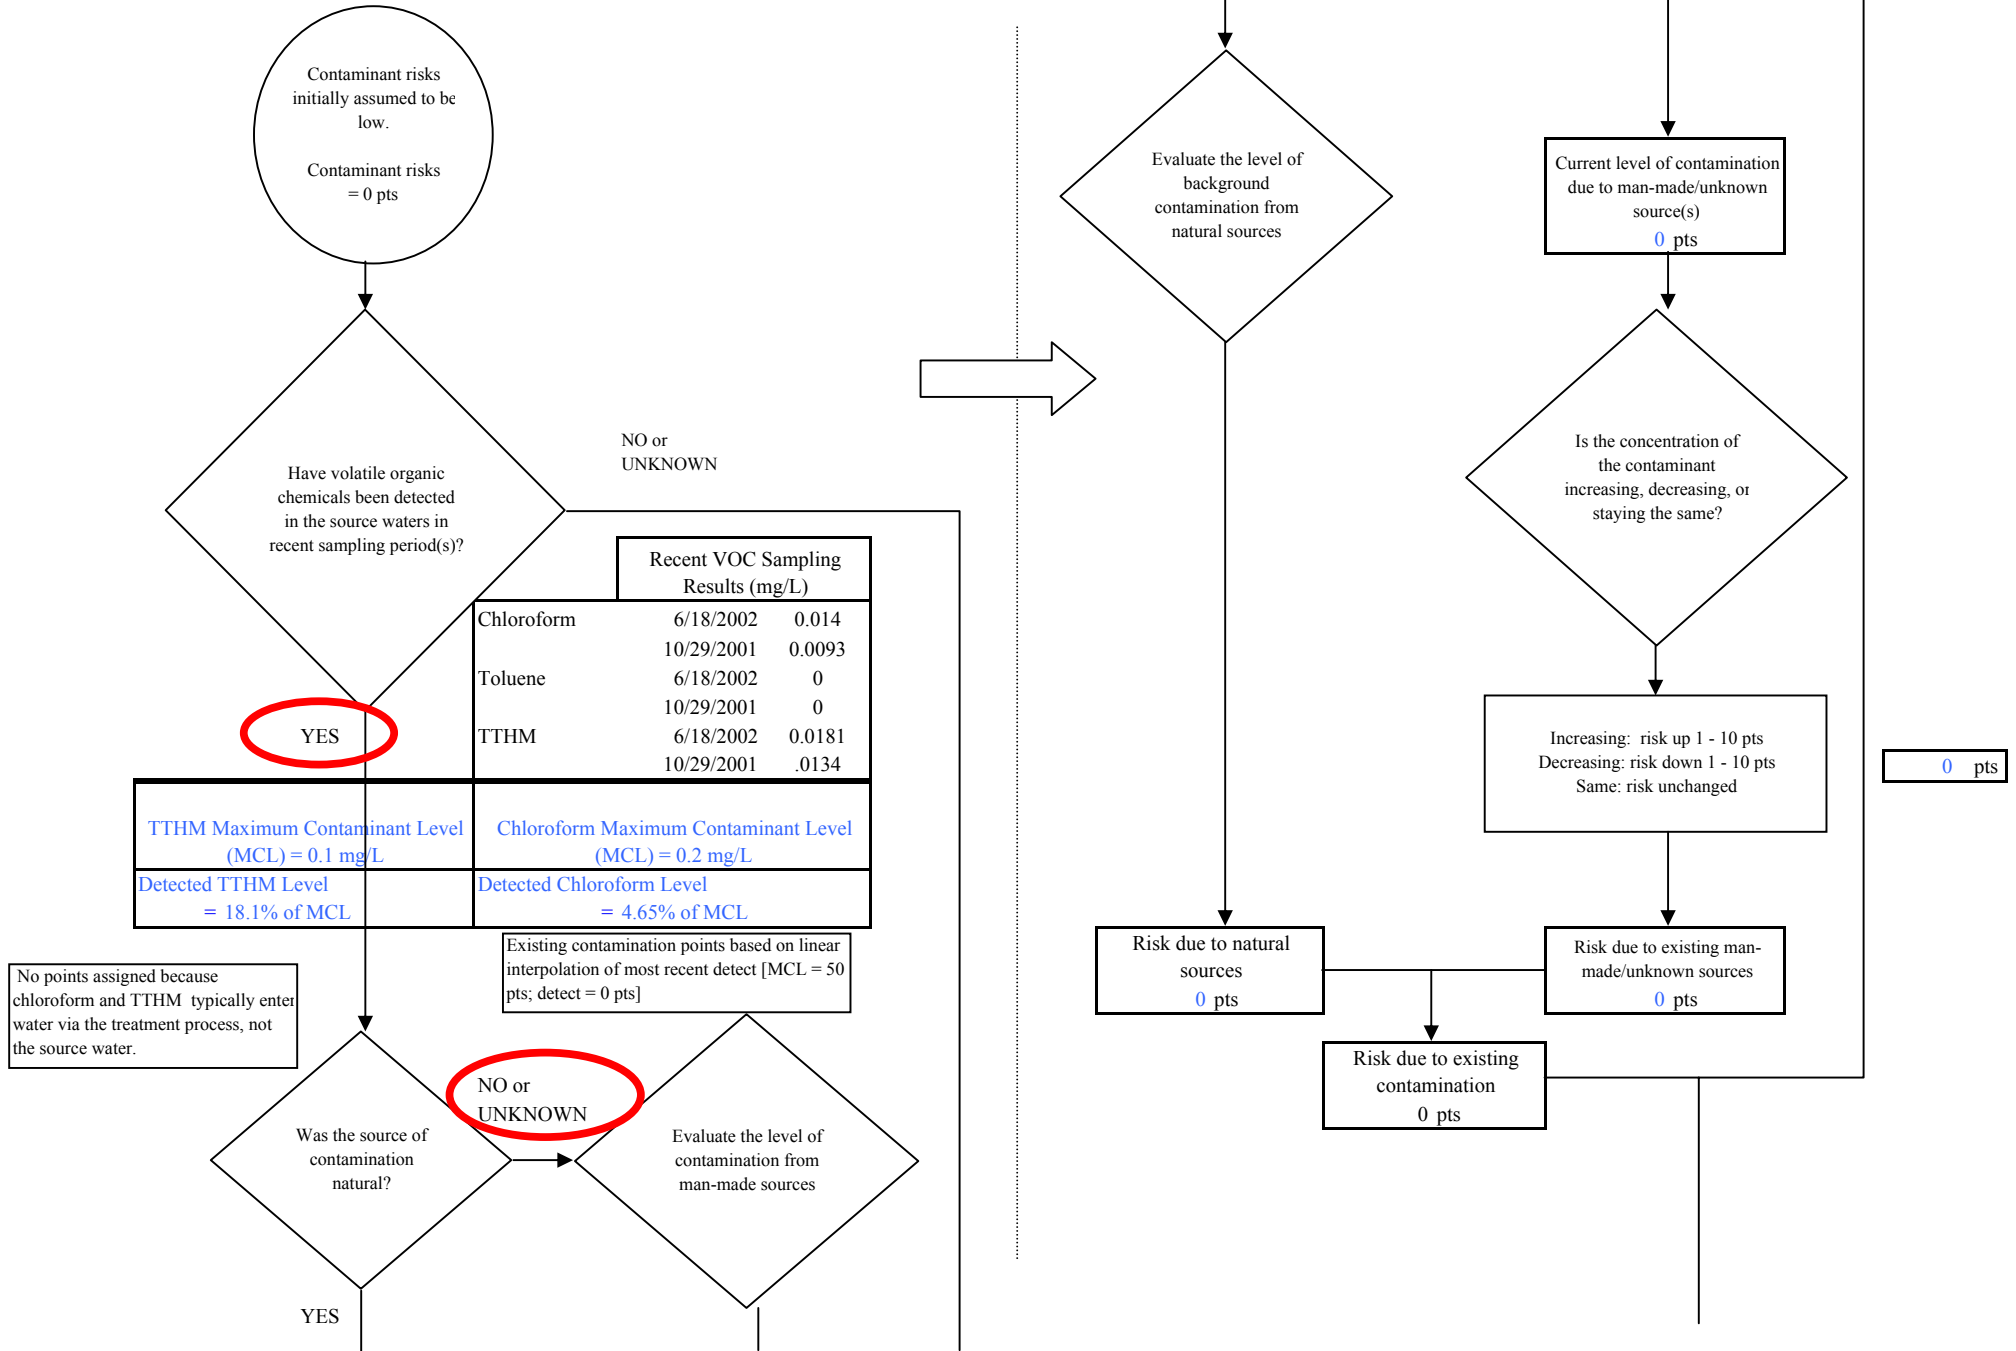


**Chart 6. Contaminant risks for Afognak Logging Camp Water System - Volatile Organic Chemicals**

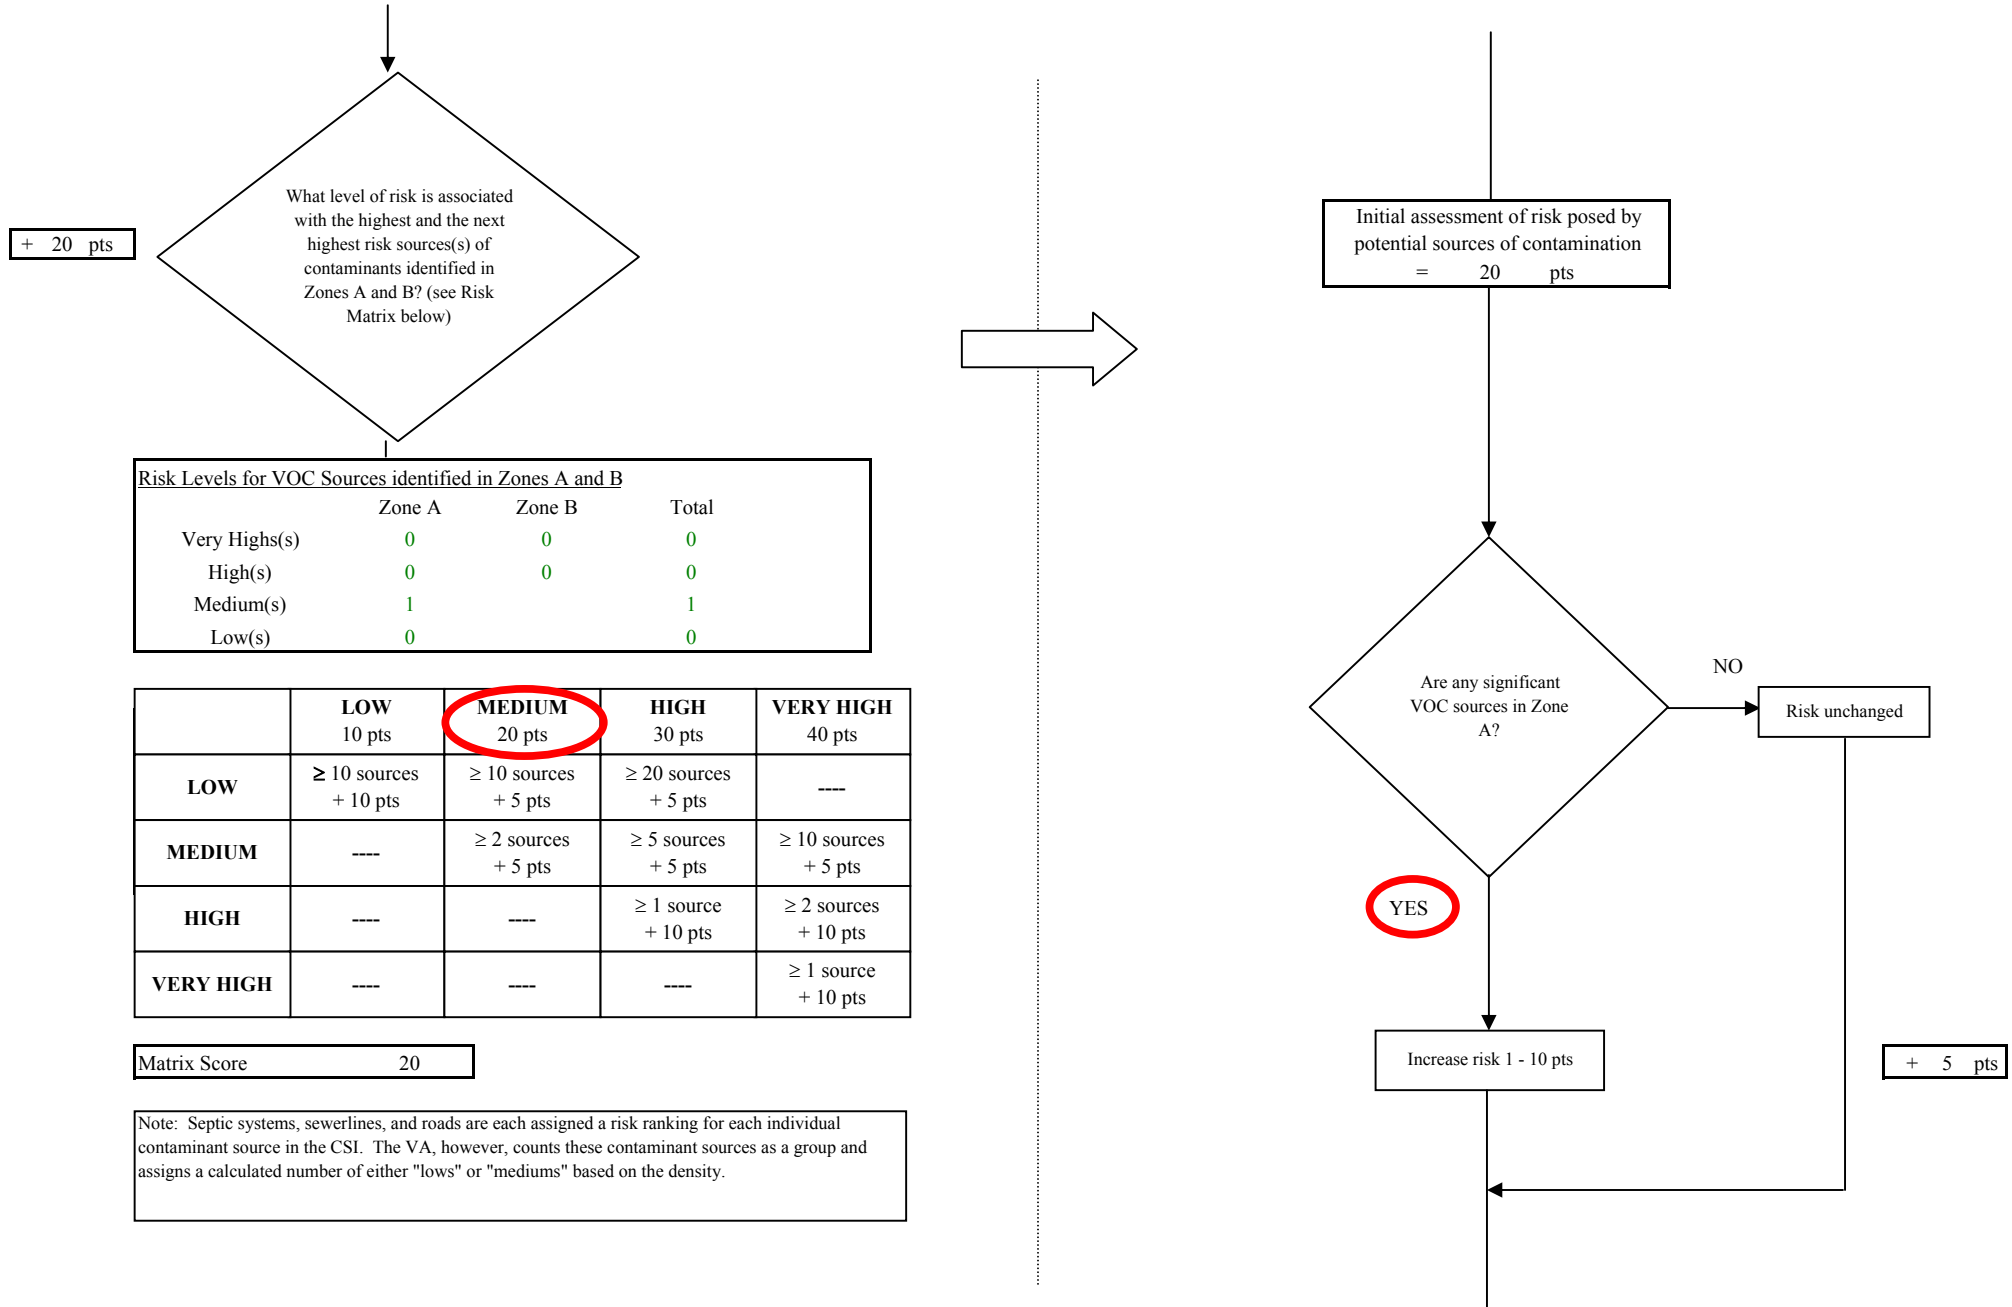


**Chart 6. Contaminant risks for Afognak Logging Camp Water System - Volatile Organic Chemicals**

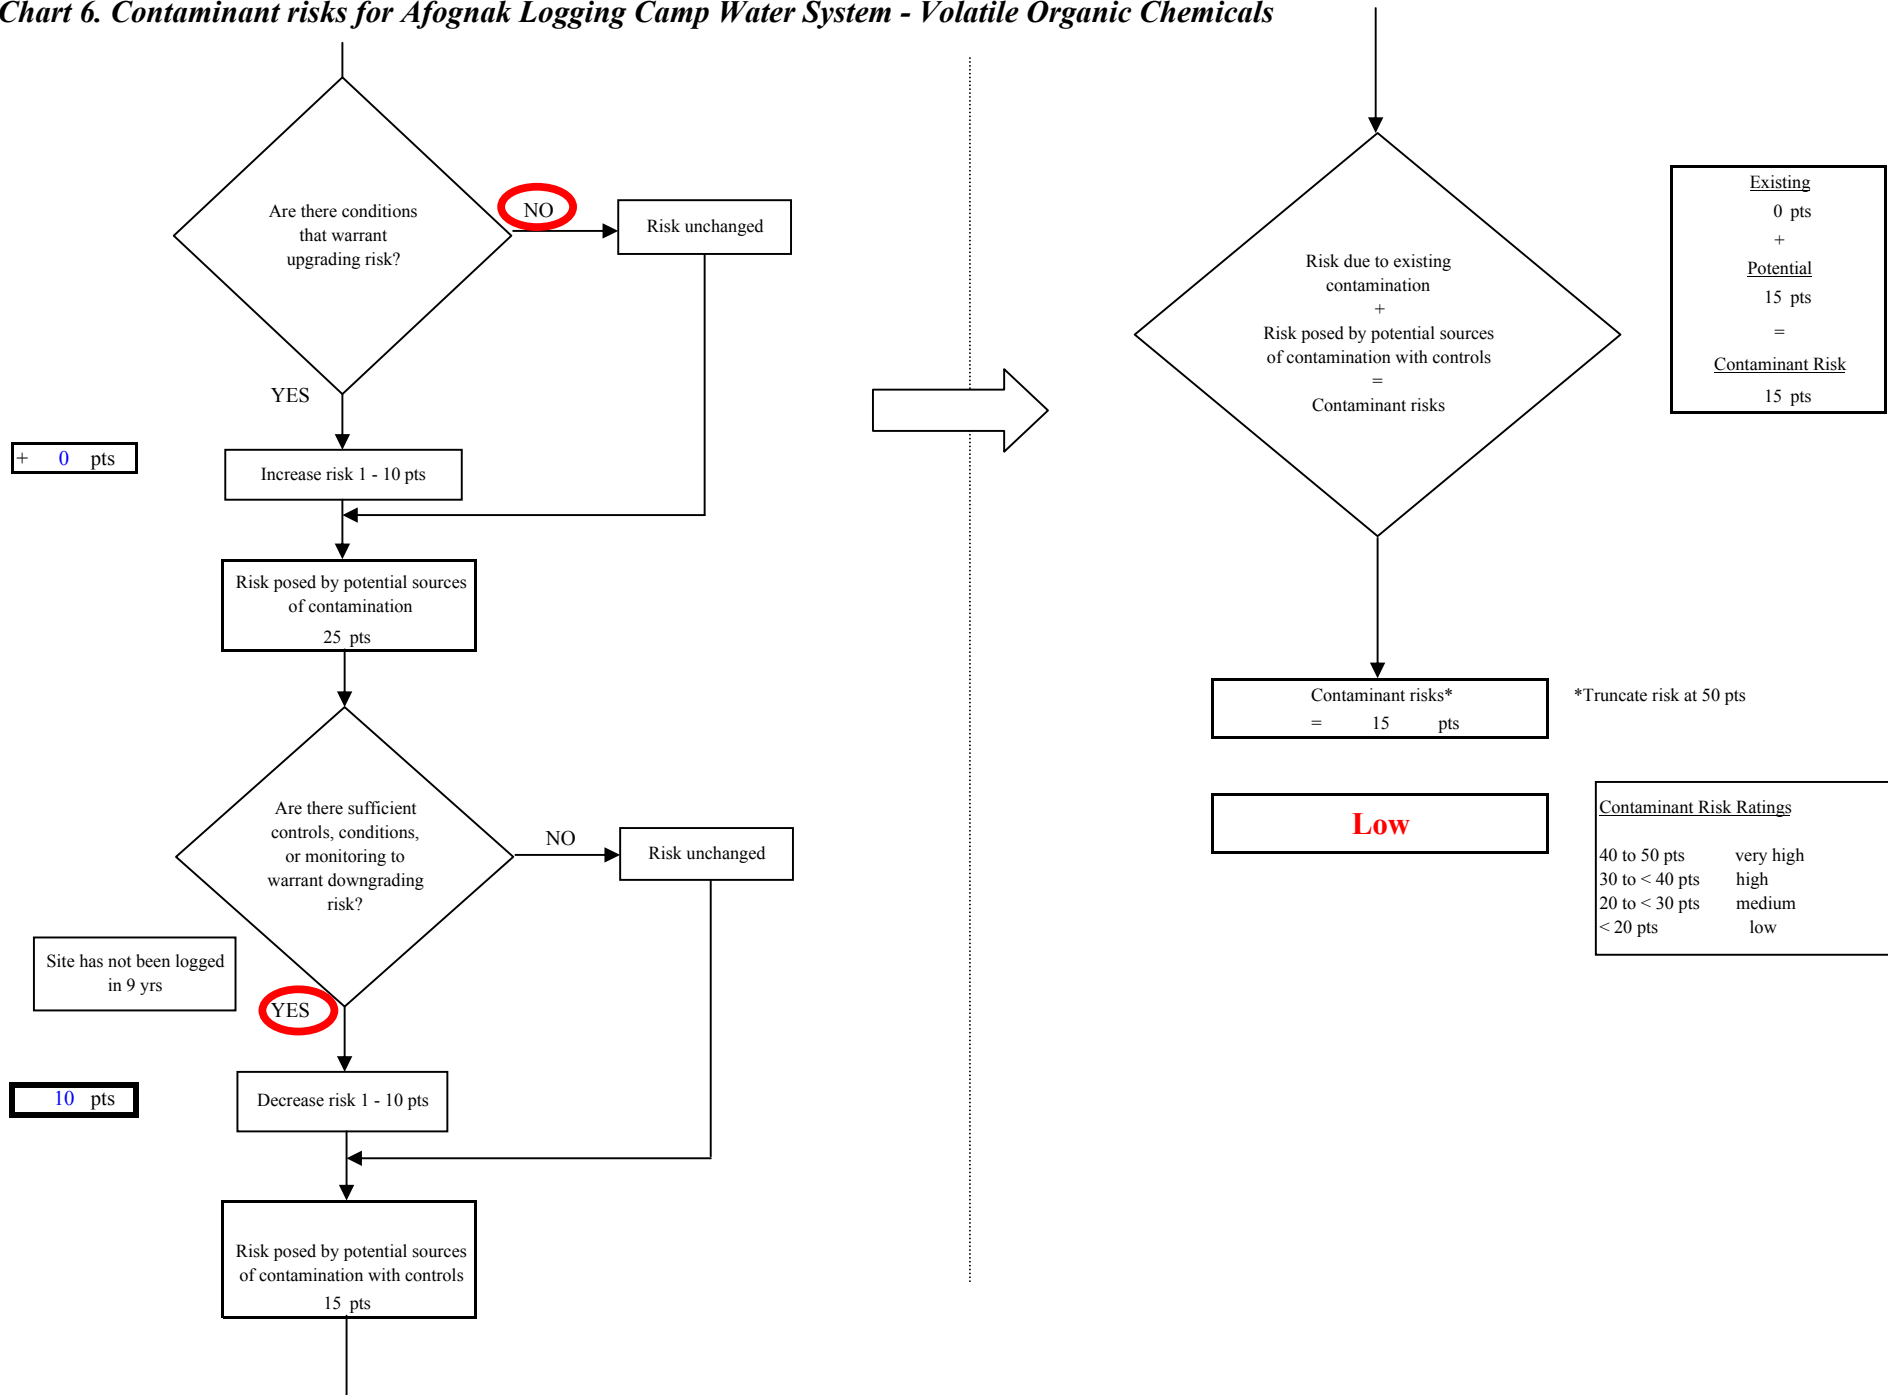

**Chart 7. Vulnerability analysis for Afognak Logging Camp Water System - Volatile Organic Chemicals**

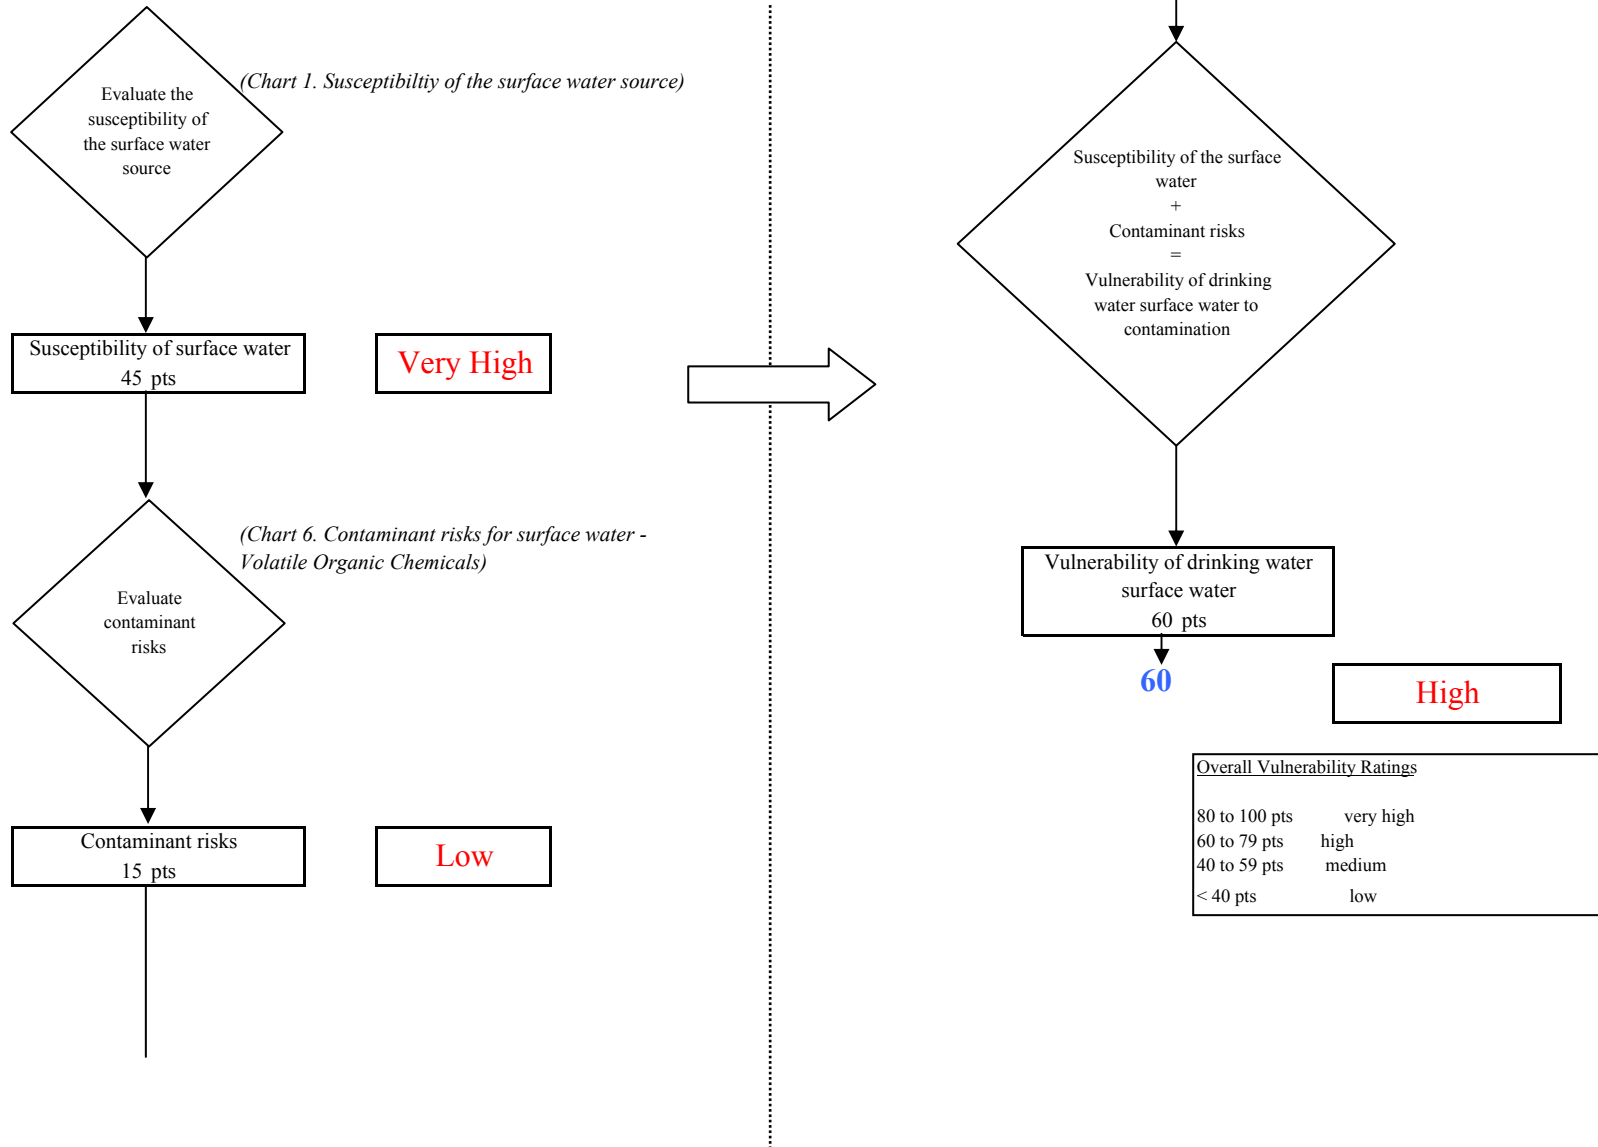


**Chart 8. Contaminant risks for Afognak Logging Camp Water System - Heavy Metals, Cyanide and Other Inorganic Chemicals**

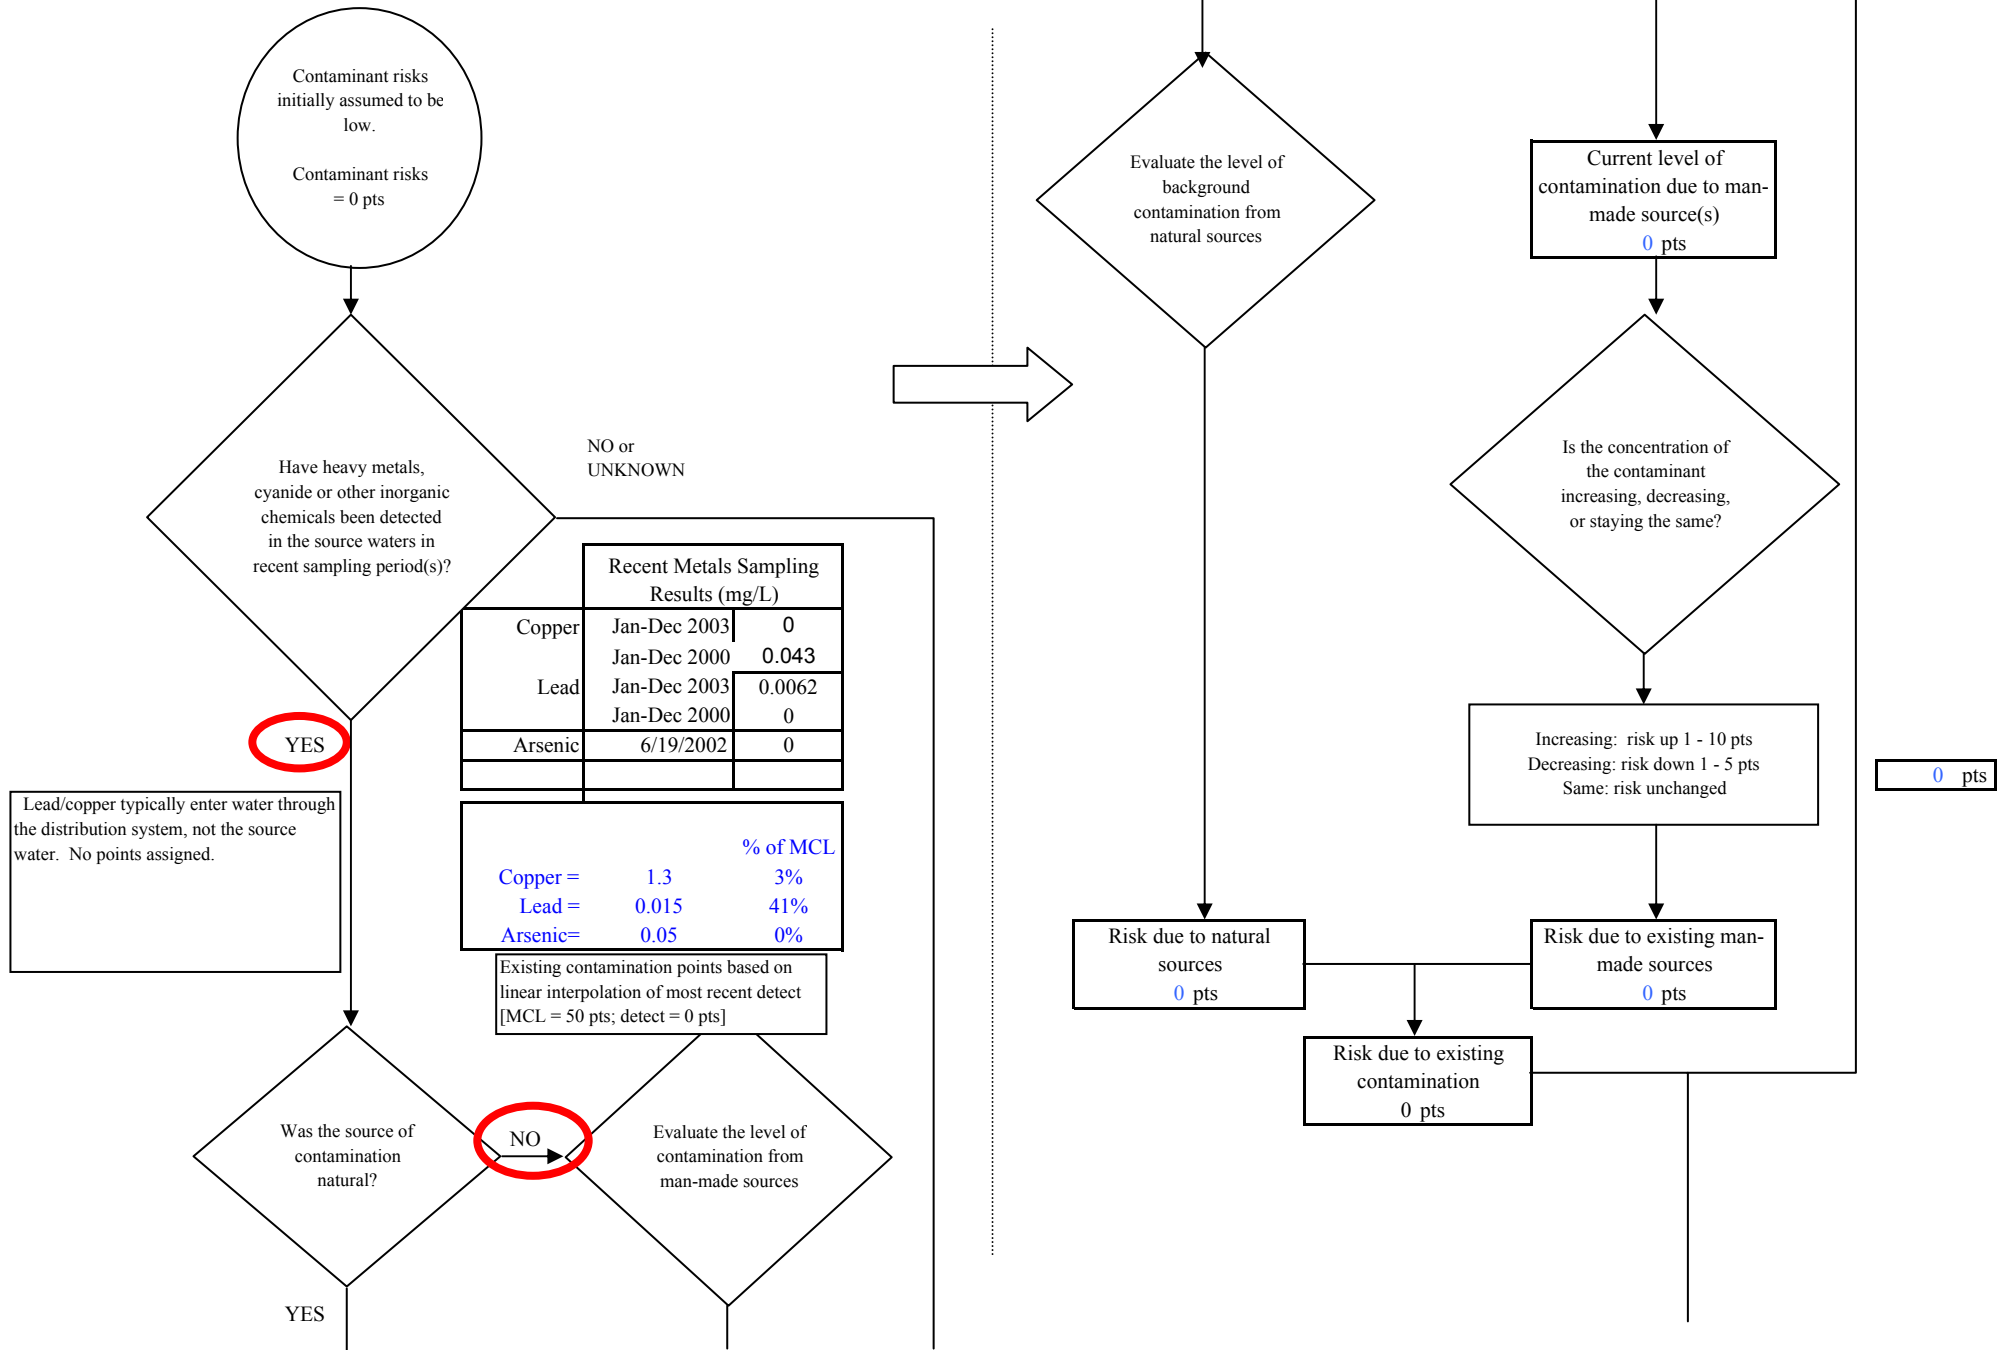



**Chart 8. Contaminant risks for Afognak Logging Camp Water System - Heavy Metals, Cyanide and Other Inorganic Chemicals**


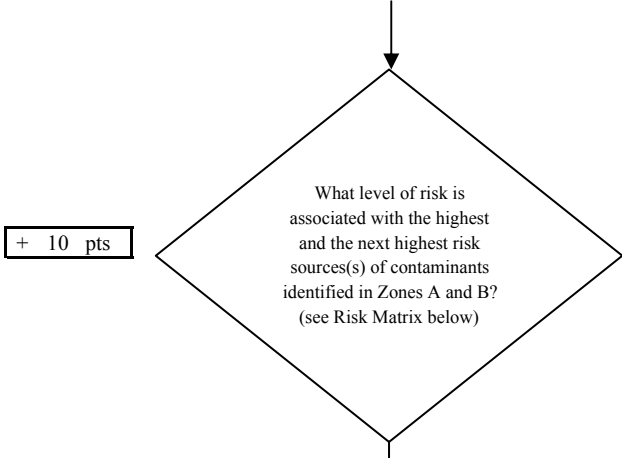


Risk Levels for HM, Cyanide, or OIC Sources identified in Zones A and B			
	Zone A	Zone B	Total
Very High(s)	0	0	0
High(s)	0	0	0
Medium(s)	0	0	0
Low(s)	1	1	1


	<b>LOW</b> 10 pts	<b>MEDIUM</b> 20 pts	<b>HIGH</b> 30 pts	<b>VERY HIGH</b> 40 pts
<b>LOW</b>	≥ 10 sources + 10 pts	≥ 10 sources + 5 pts	≥ 20 sources + 5 pts	----
<b>MEDIUM</b>	----	≥ 2 sources + 5 pts	≥ 5 sources + 5 pts	≥ 10 sources + 5 pts
<b>HIGH</b>	----	----	≥ 1 source + 10 pts	≥ 2 sources + 10 pts
<b>VERY HIGH</b>	----	----	----	≥ 1 source + 10 pts

Matrix Score      10

Note: Septic systems, sewerlines, and roads are each assigned a risk ranking for each individual contaminant source in the CSI. The VA, however, counts these contaminant sources as a group and assigns a calculated number of either "lows" or "mediums" based on the density.

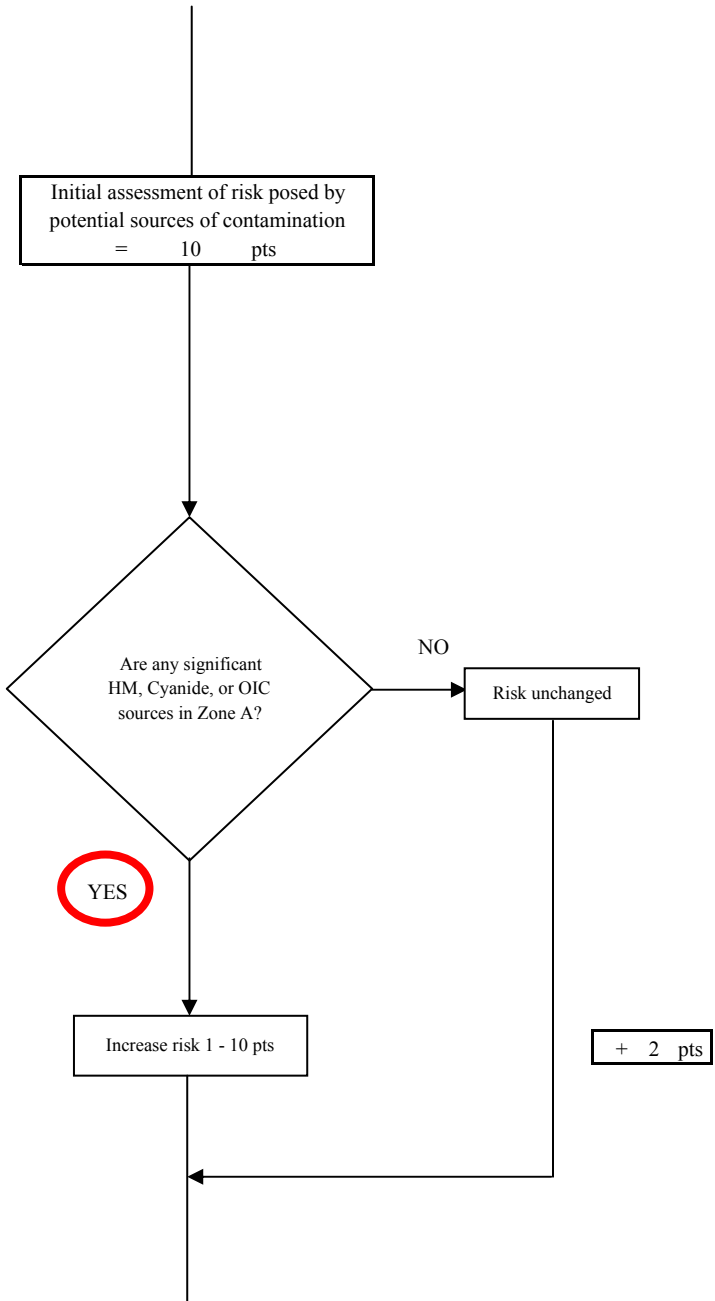

**Chart 8. Contaminant risks for Afognak Logging Camp Water System - Heavy Metals, Cyanide and Other Inorganic Chemicals**

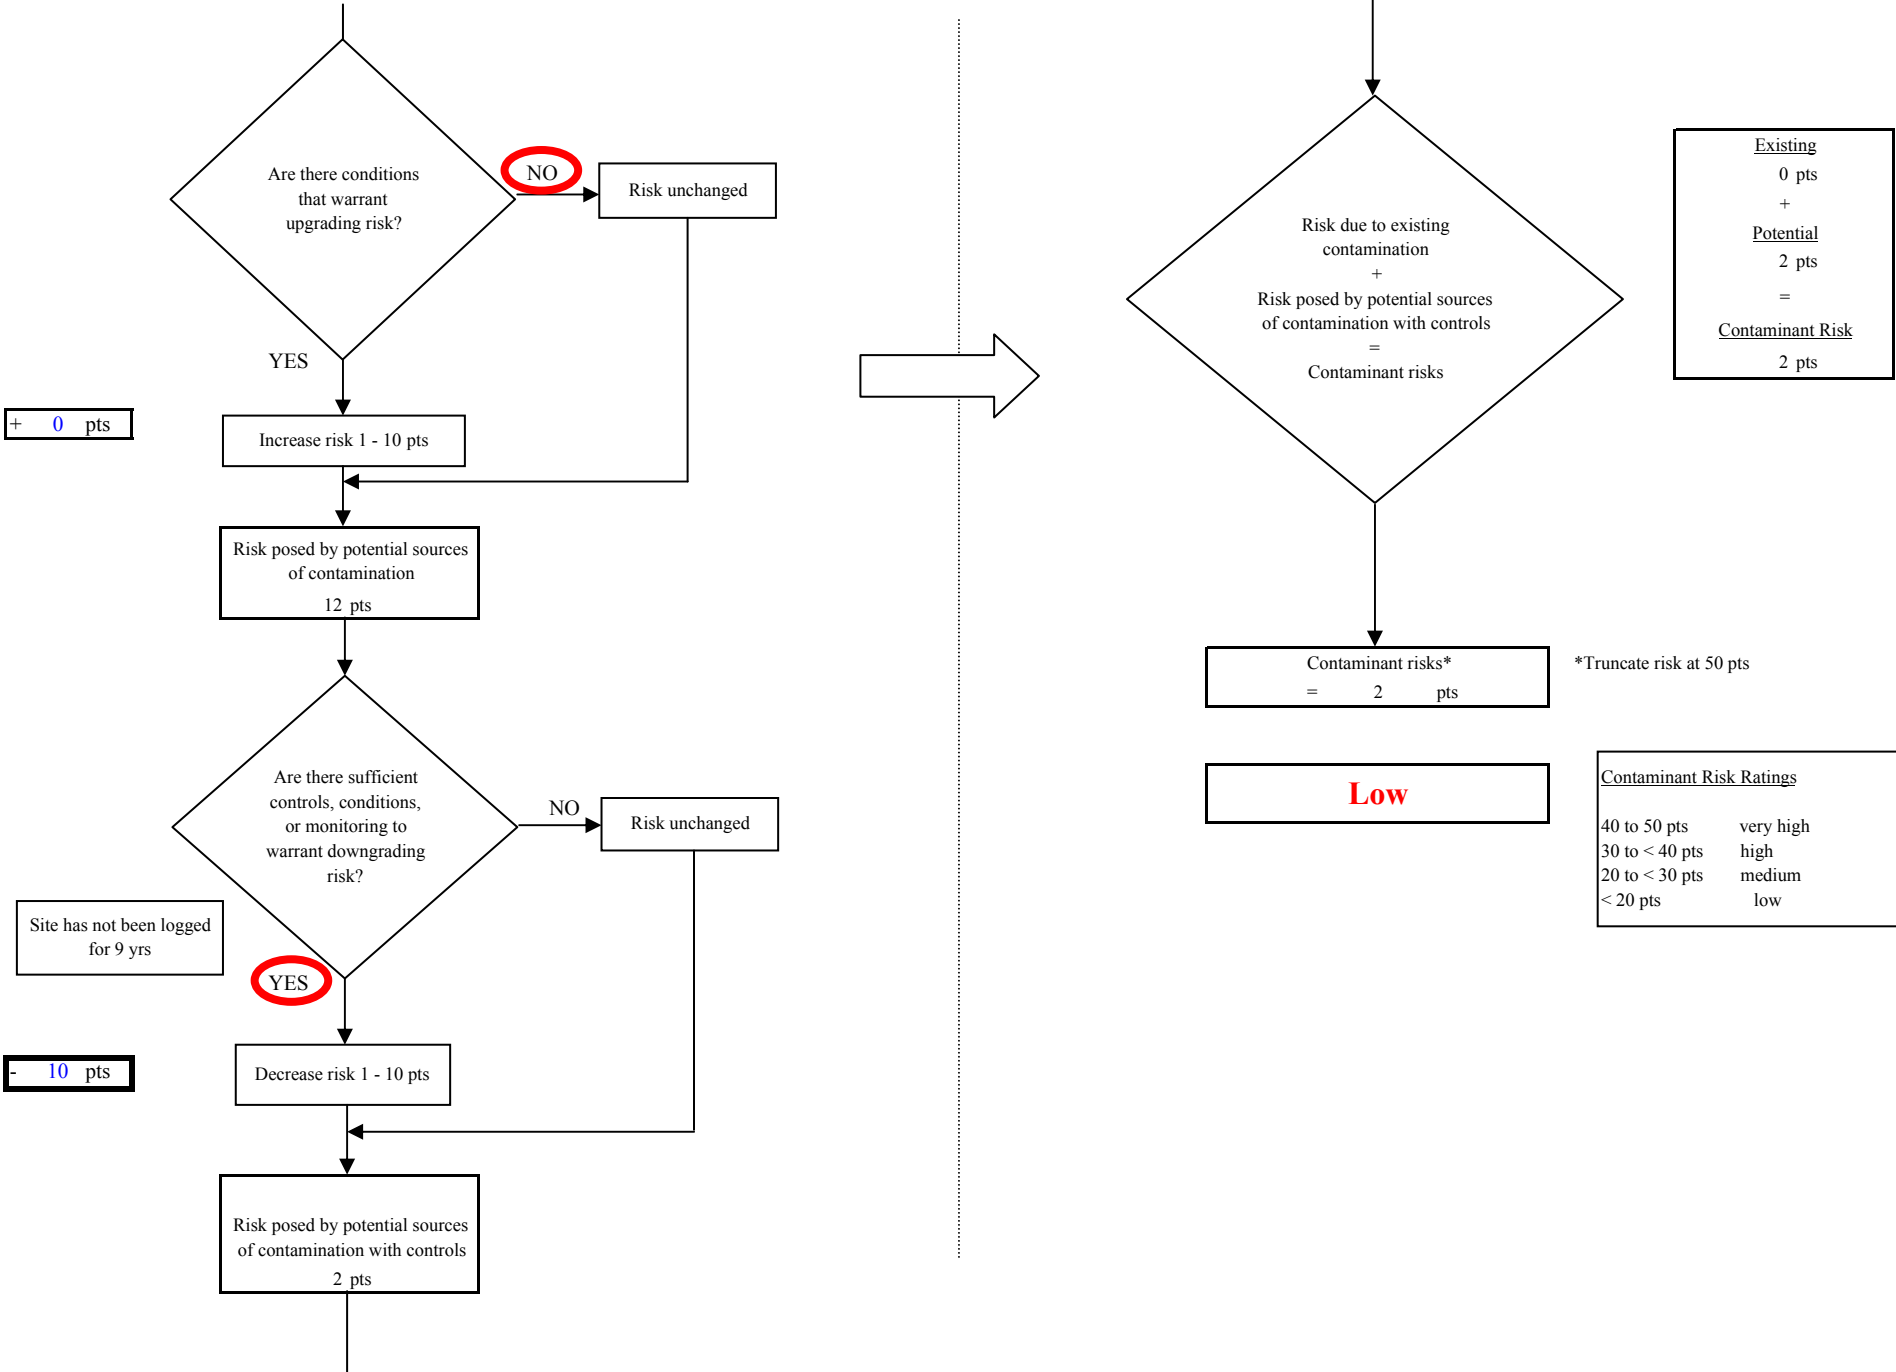

**Chart 9. Vulnerability analysis for Afognak Logging Camp Water System - Heavy Metals, Cyanide and Other Inorganic Chemicals**



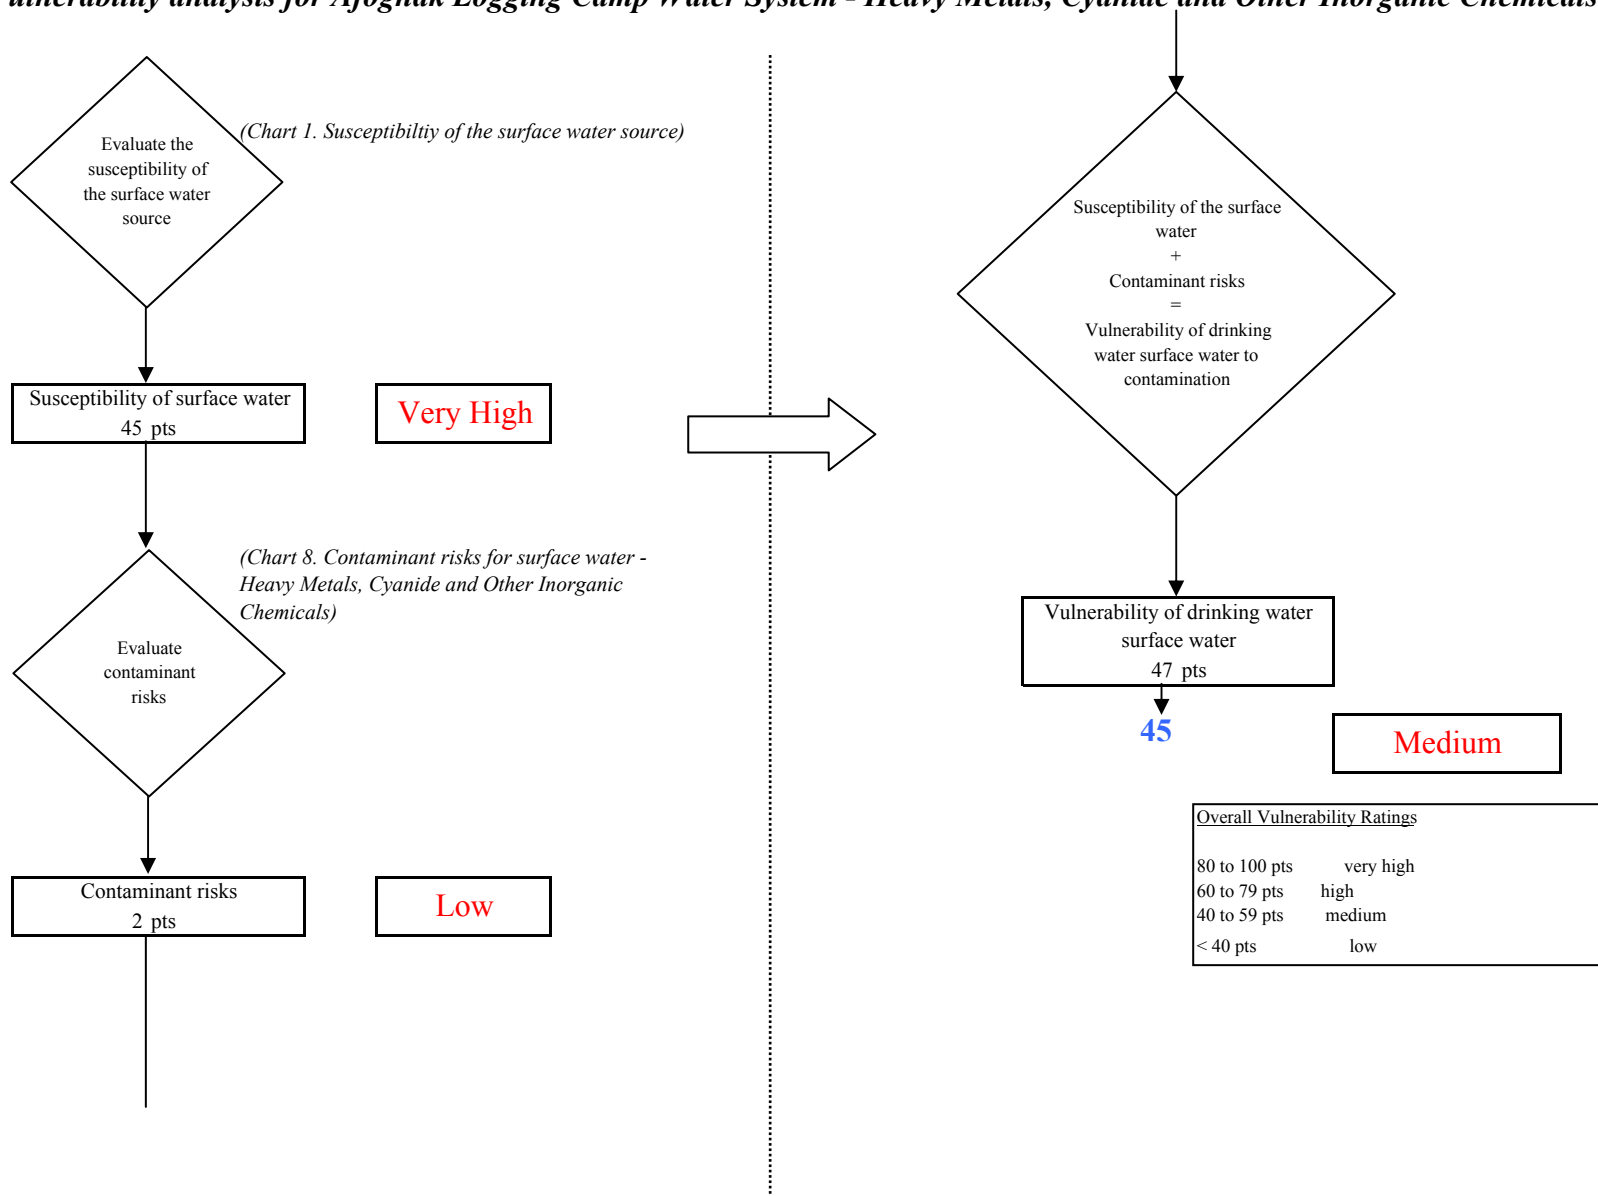



Chart 10. Contaminant risks for Afognak Logging Camp Water System - Synthetic Organic Chemicals

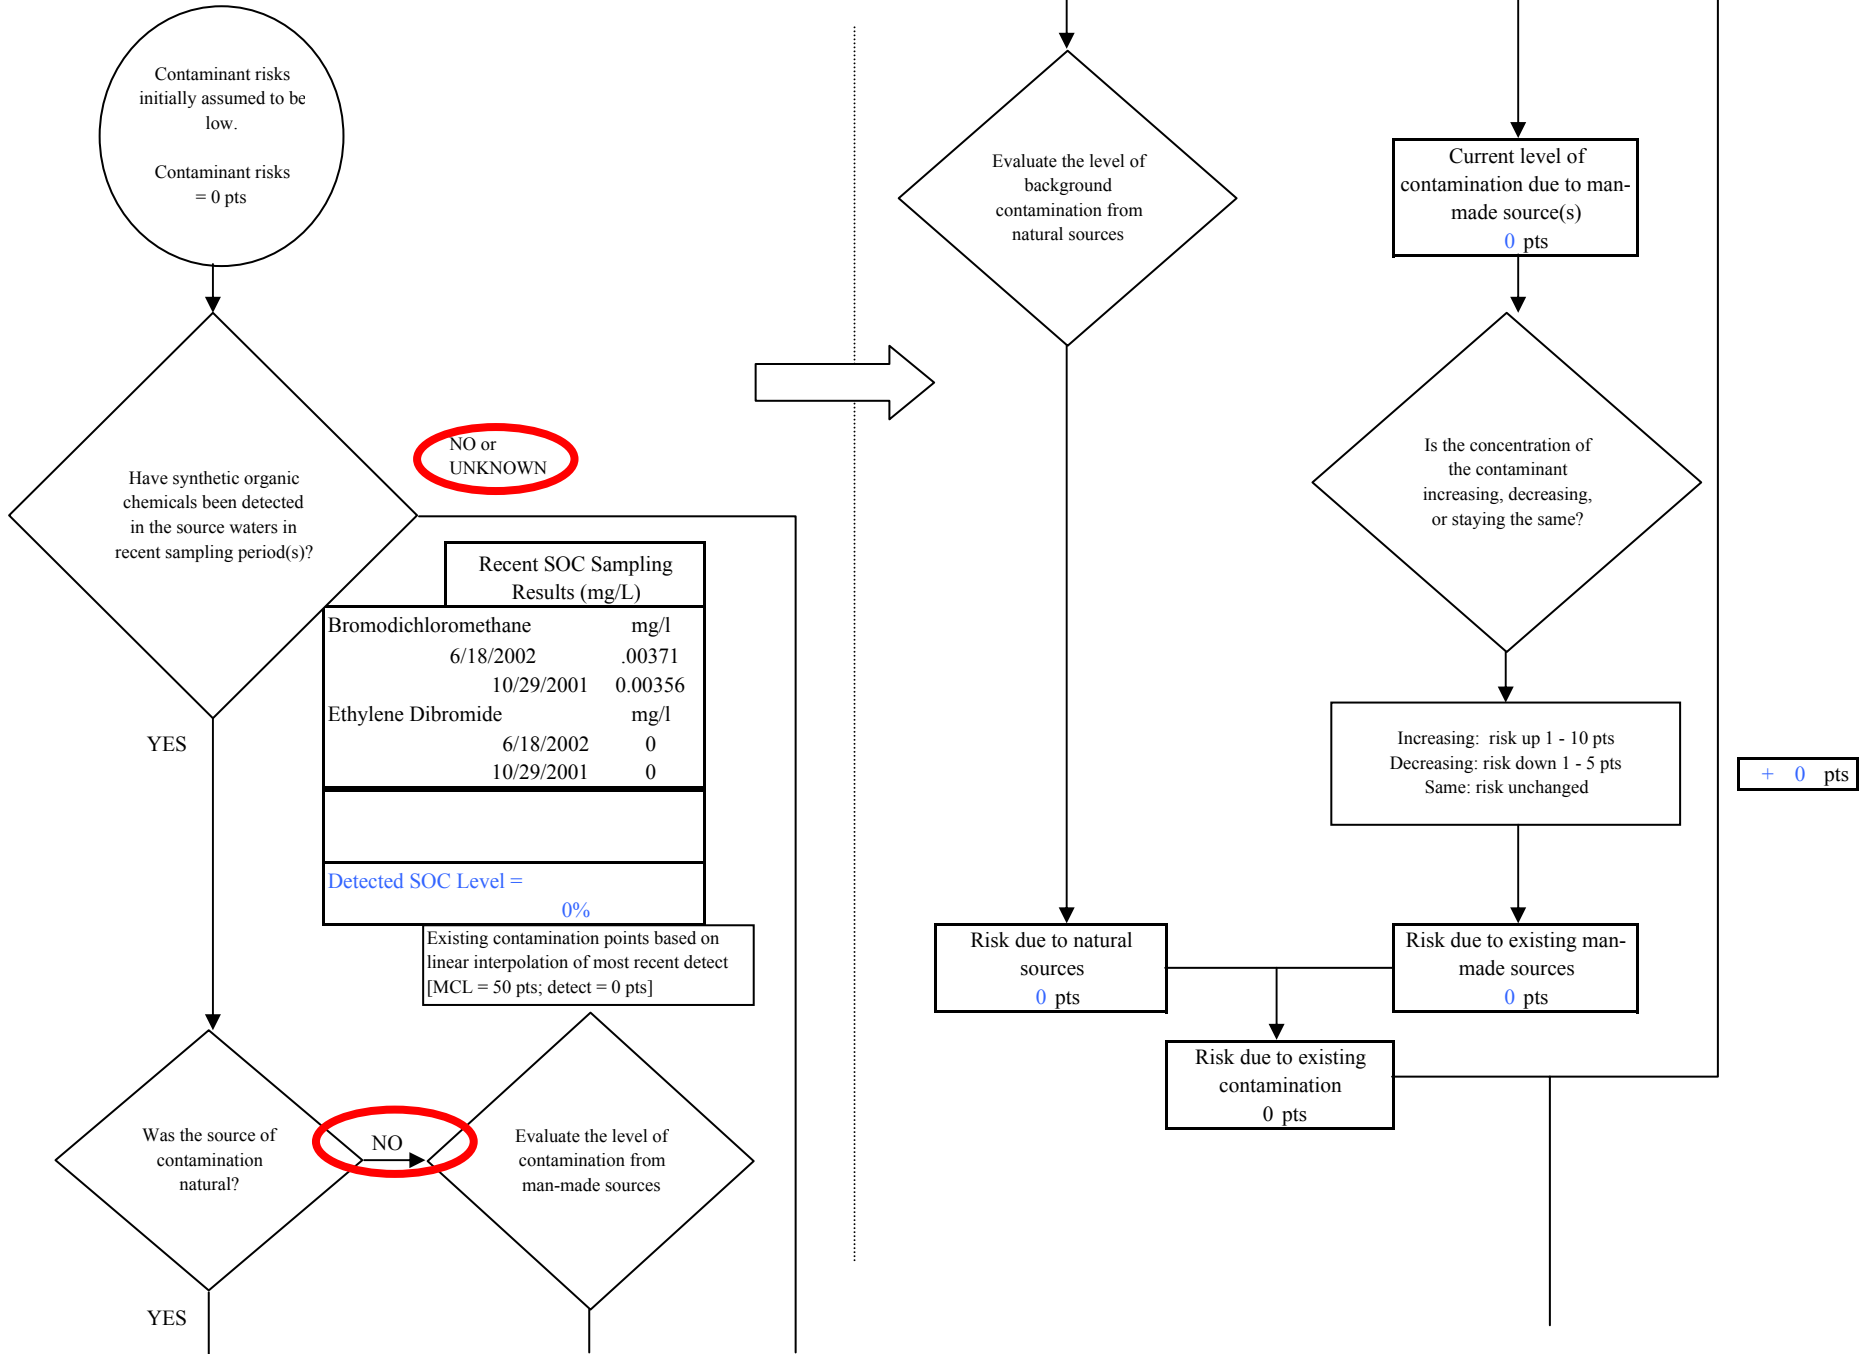


**Chart 10. Contaminant risks for Afognak Logging Camp Water System - Synthetic Organic Chemicals**

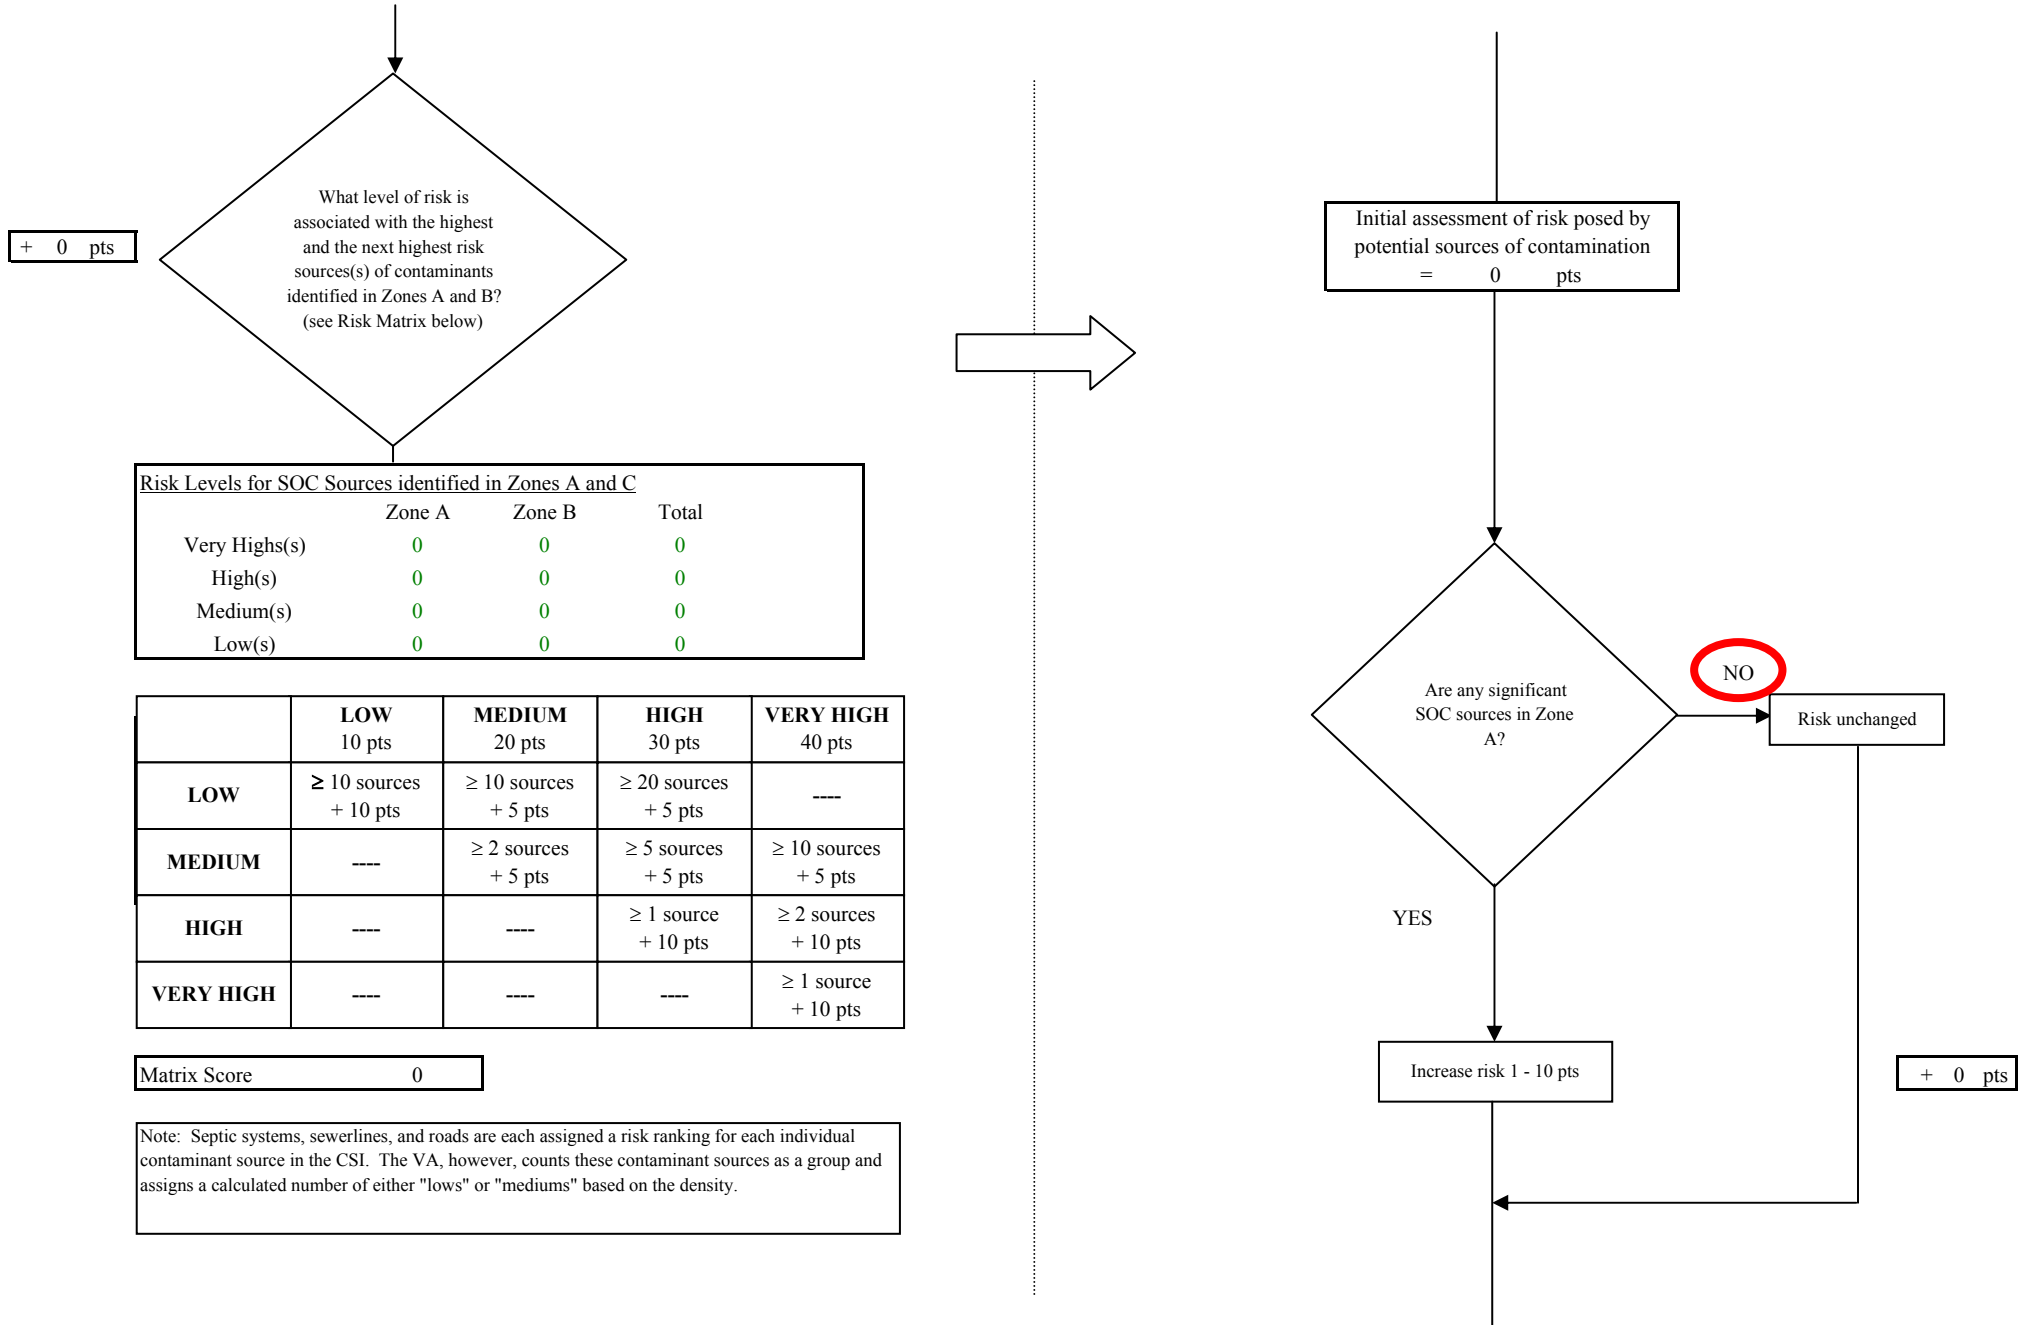


**Chart 10. Contaminant risks for Afognak Logging Camp Water System - Synthetic Organic Chemicals**

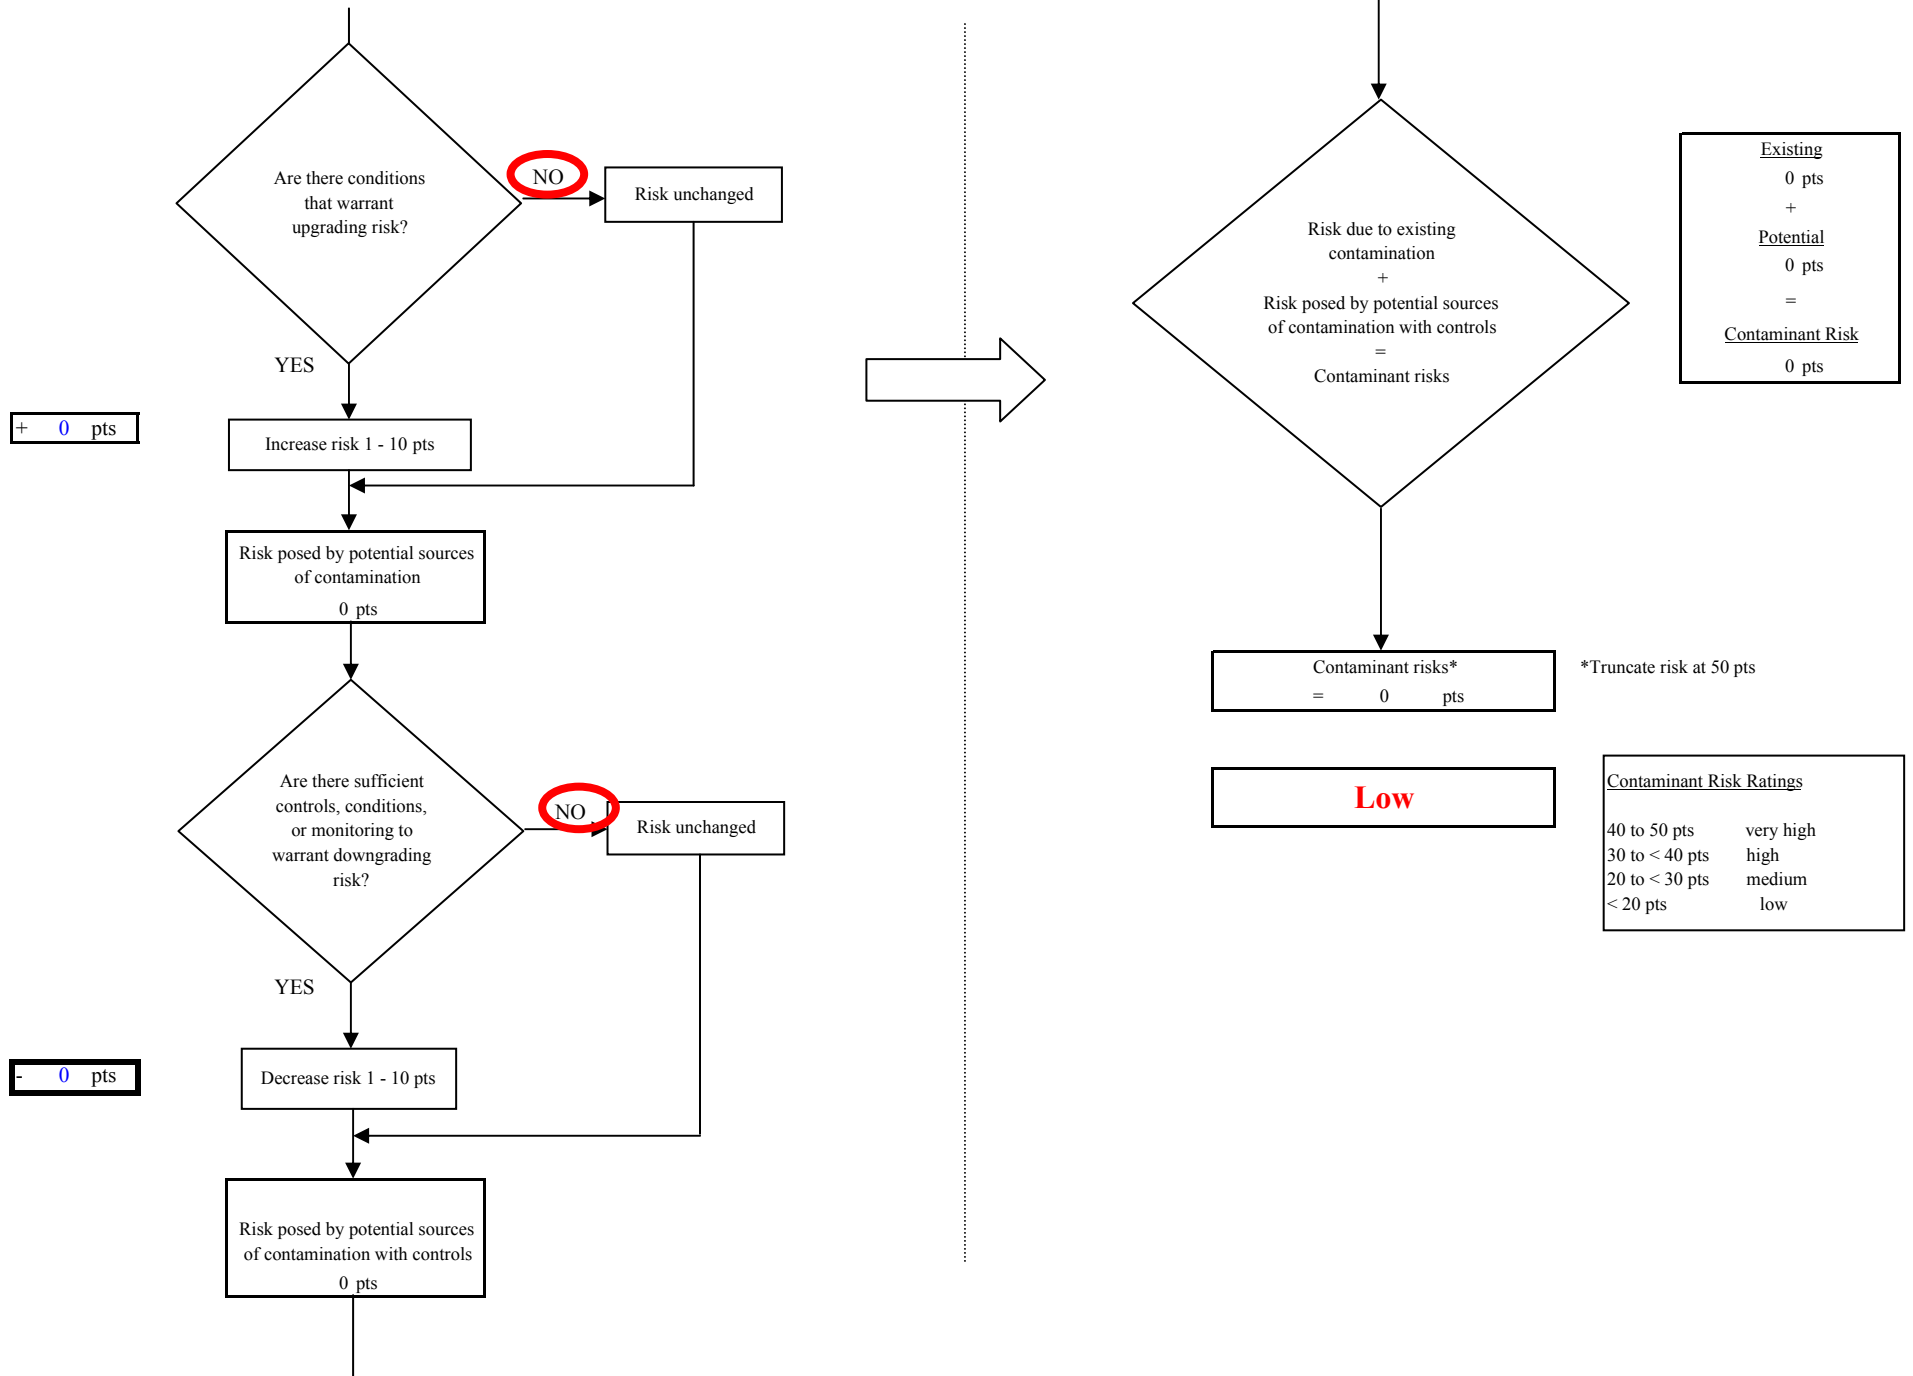

**Chart 11. Vulnerability analysis for Afognak Logging Camp Water System - Synthetic Organic Chemicals**

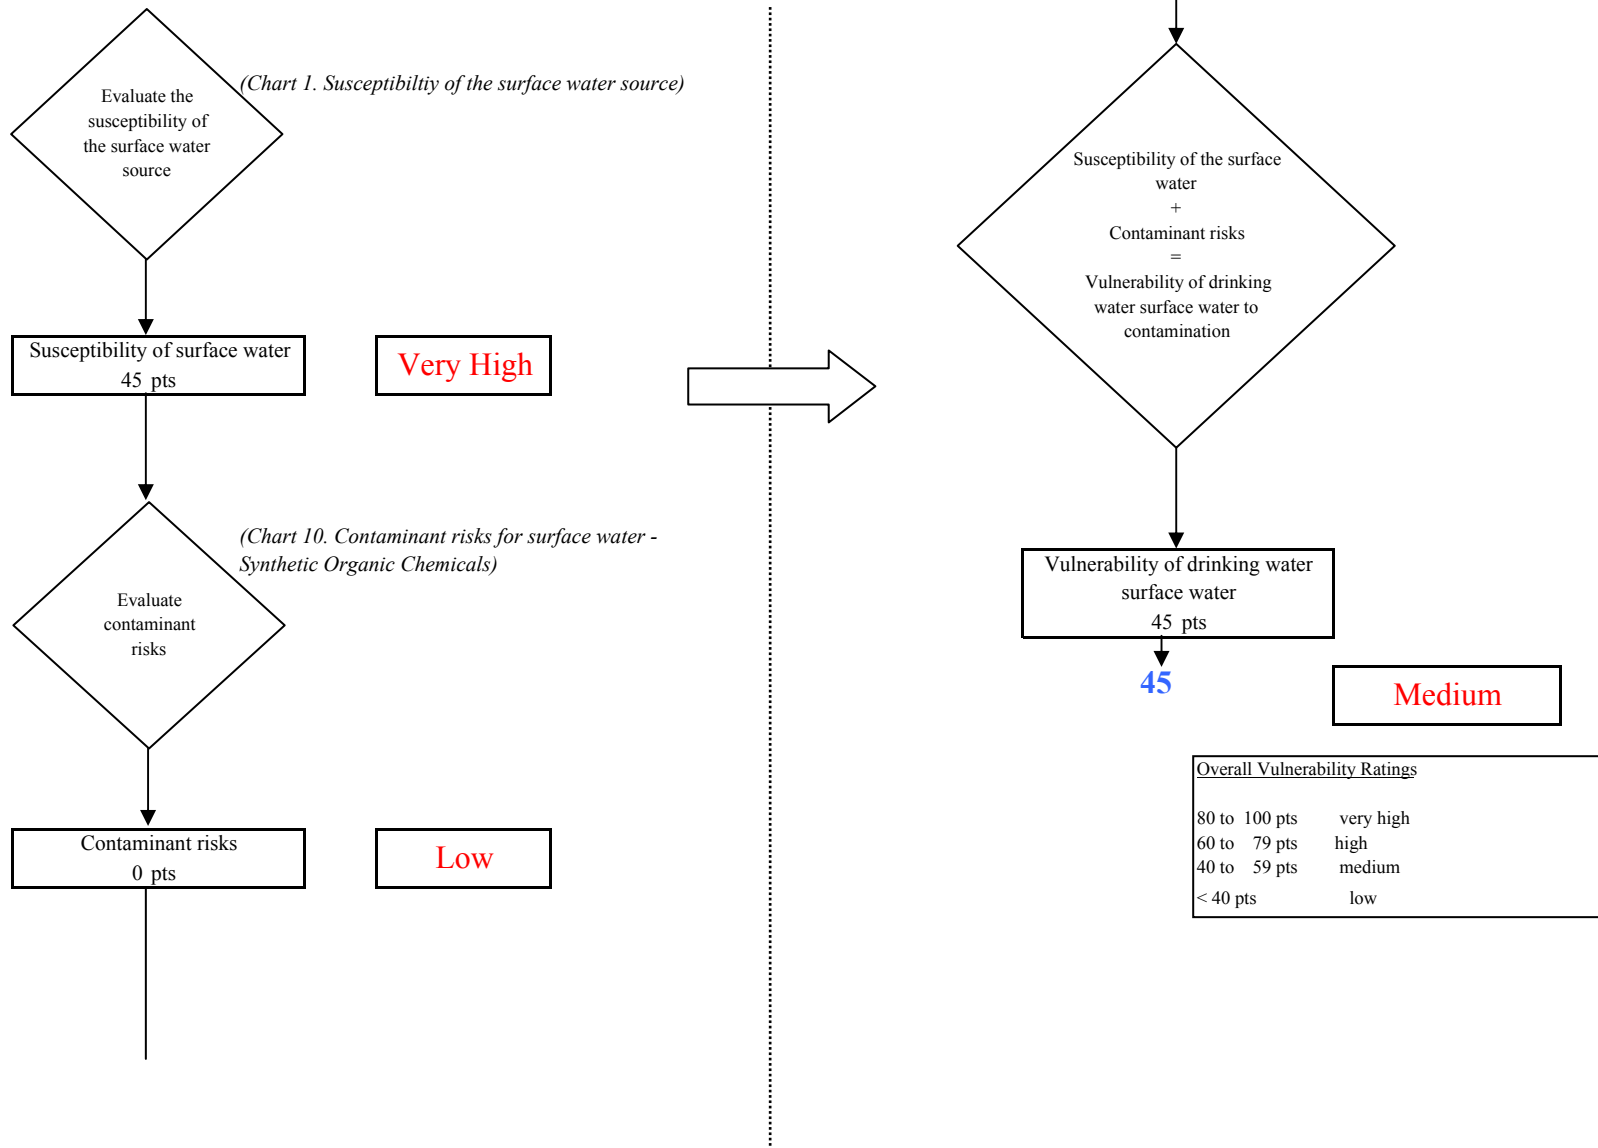

**Chart 12. Contaminant risks for Afognak Logging Camp Water System - Other Organic Chemicals**

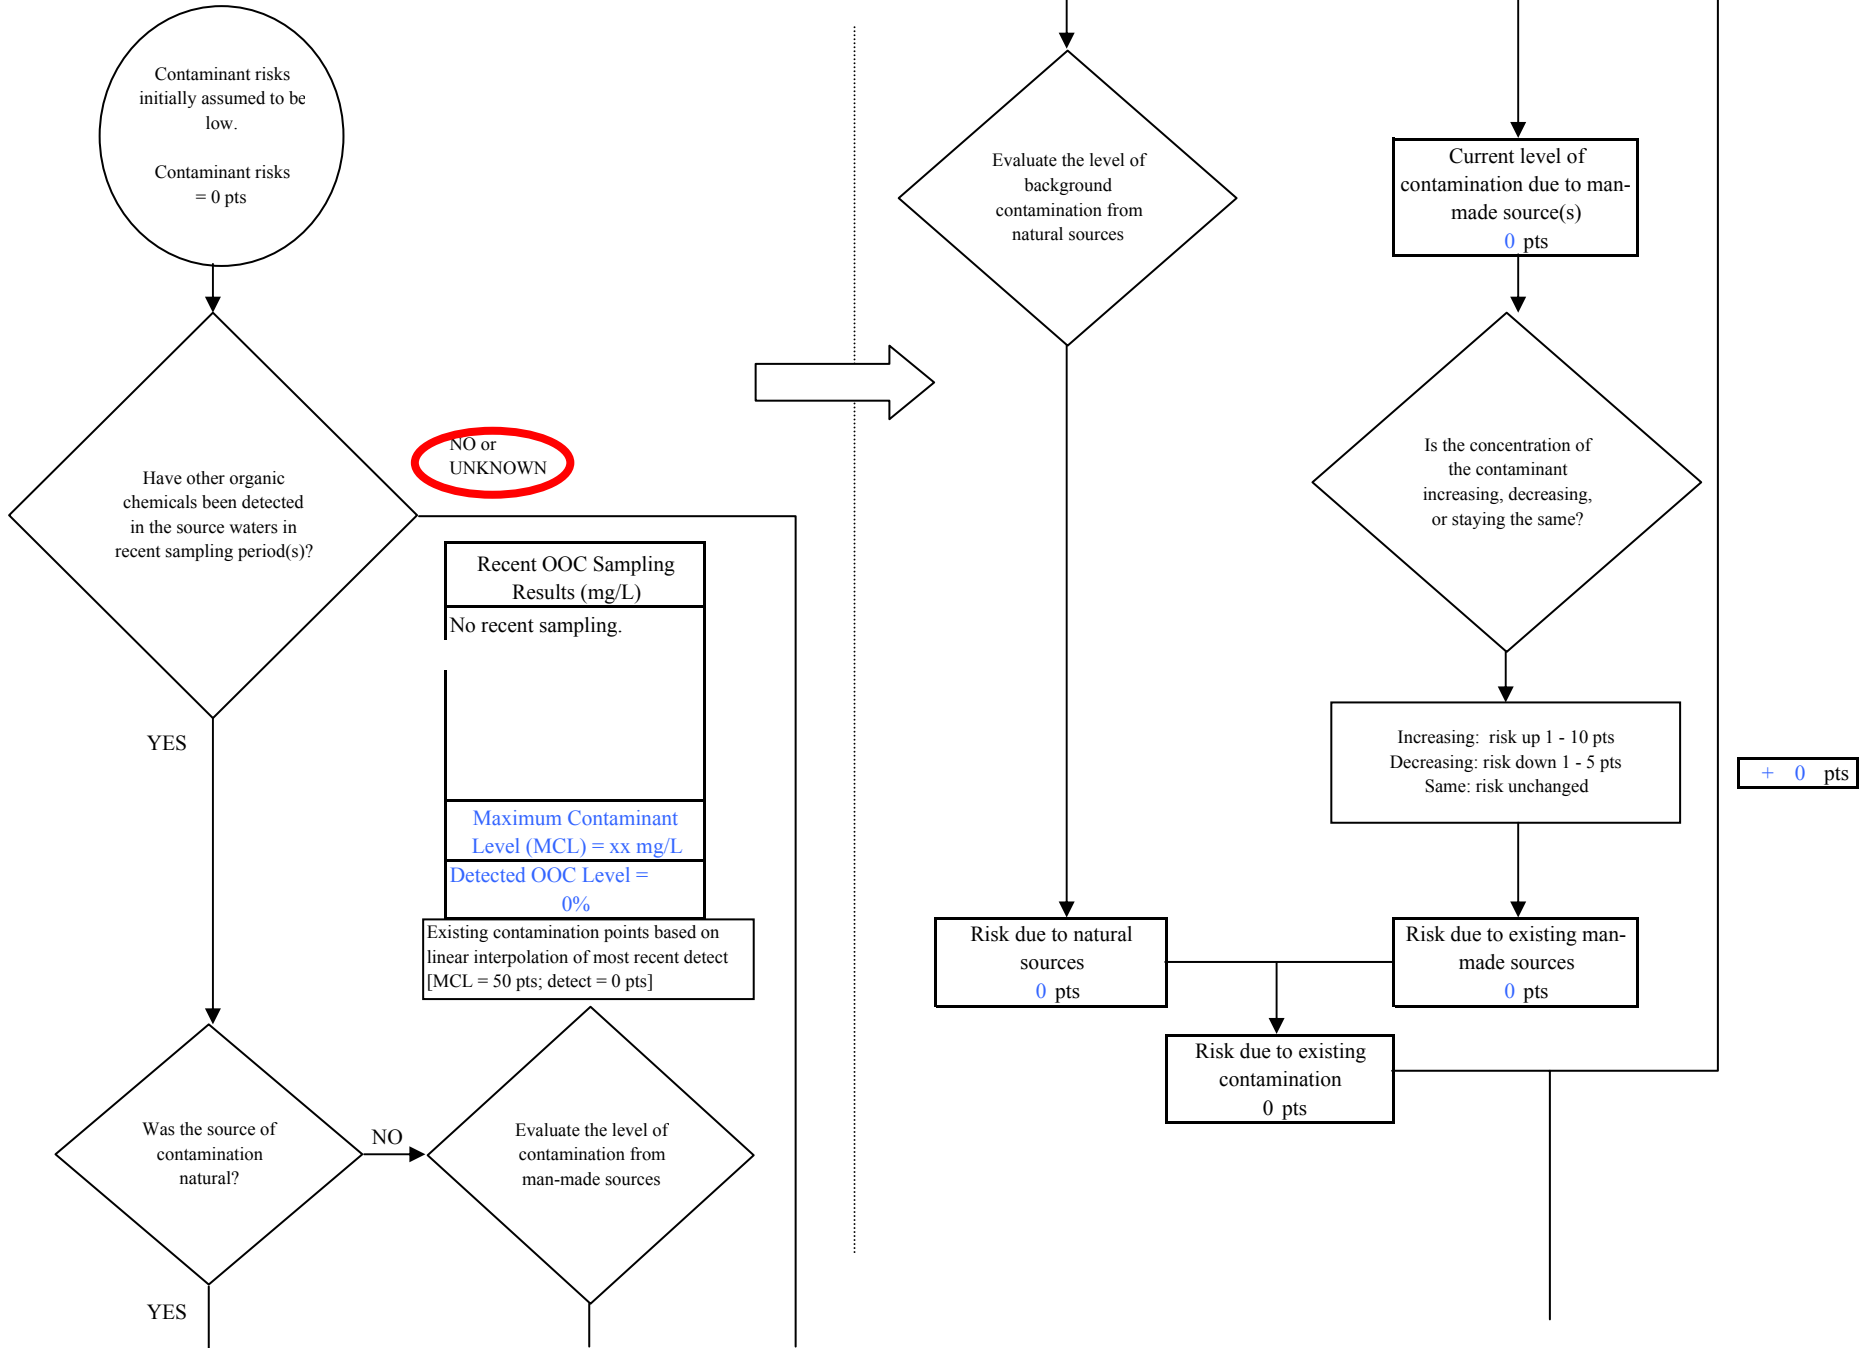



**Chart 12. Contaminant risks for Afognak Logging Camp Water System - Other Organic Chemicals**


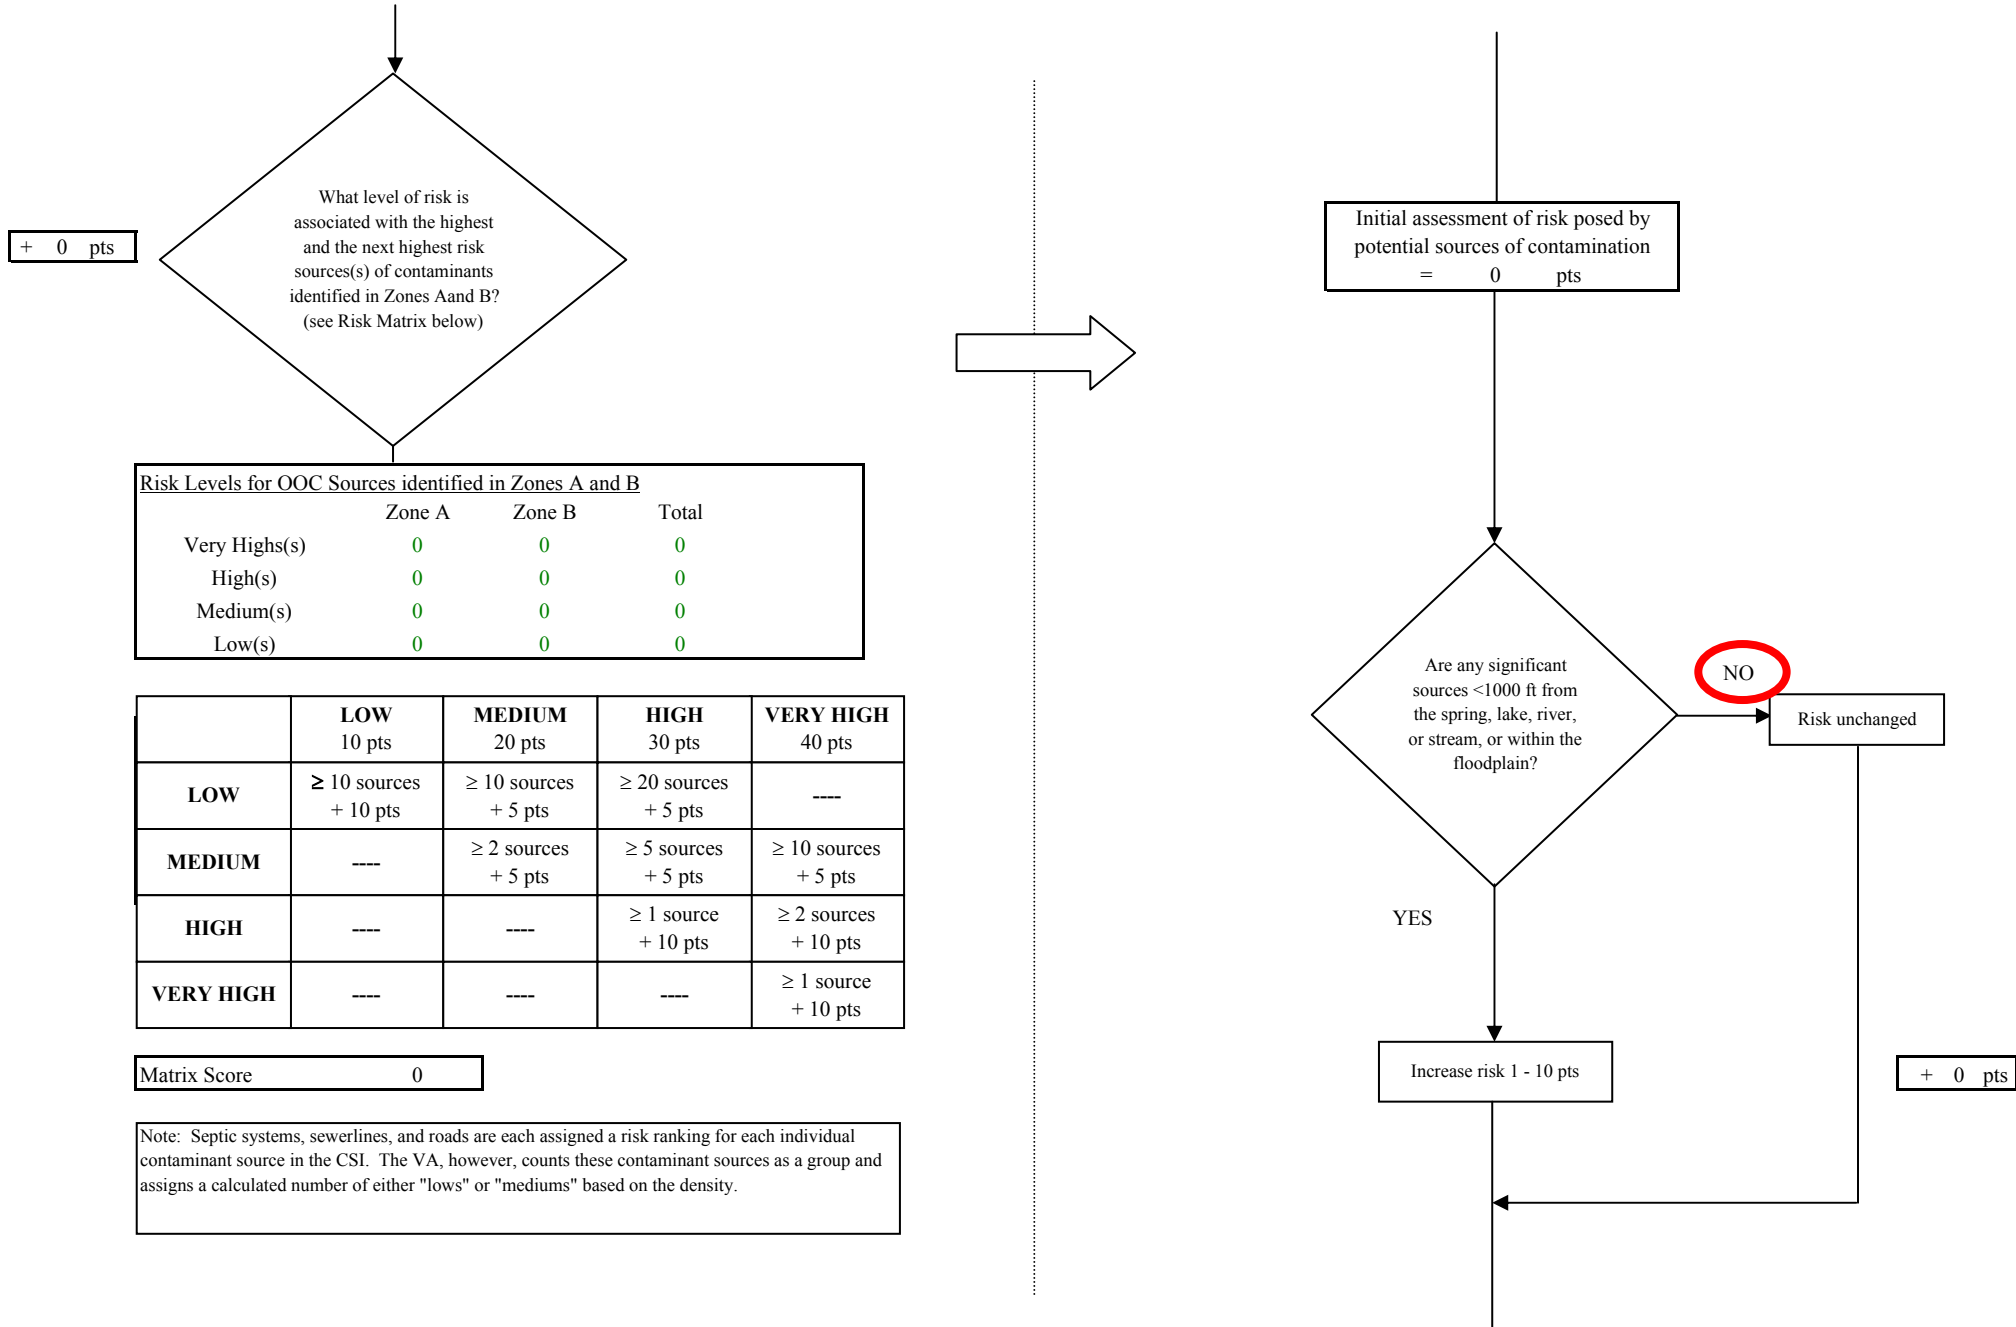


Chart 12. Contaminant risks for Afognak Logging Camp Water System - Other Organic Chemicals



**Chart 13. Vulnerability analysis for Afognak Logging Camp Water System - Other Organic Chemicals**

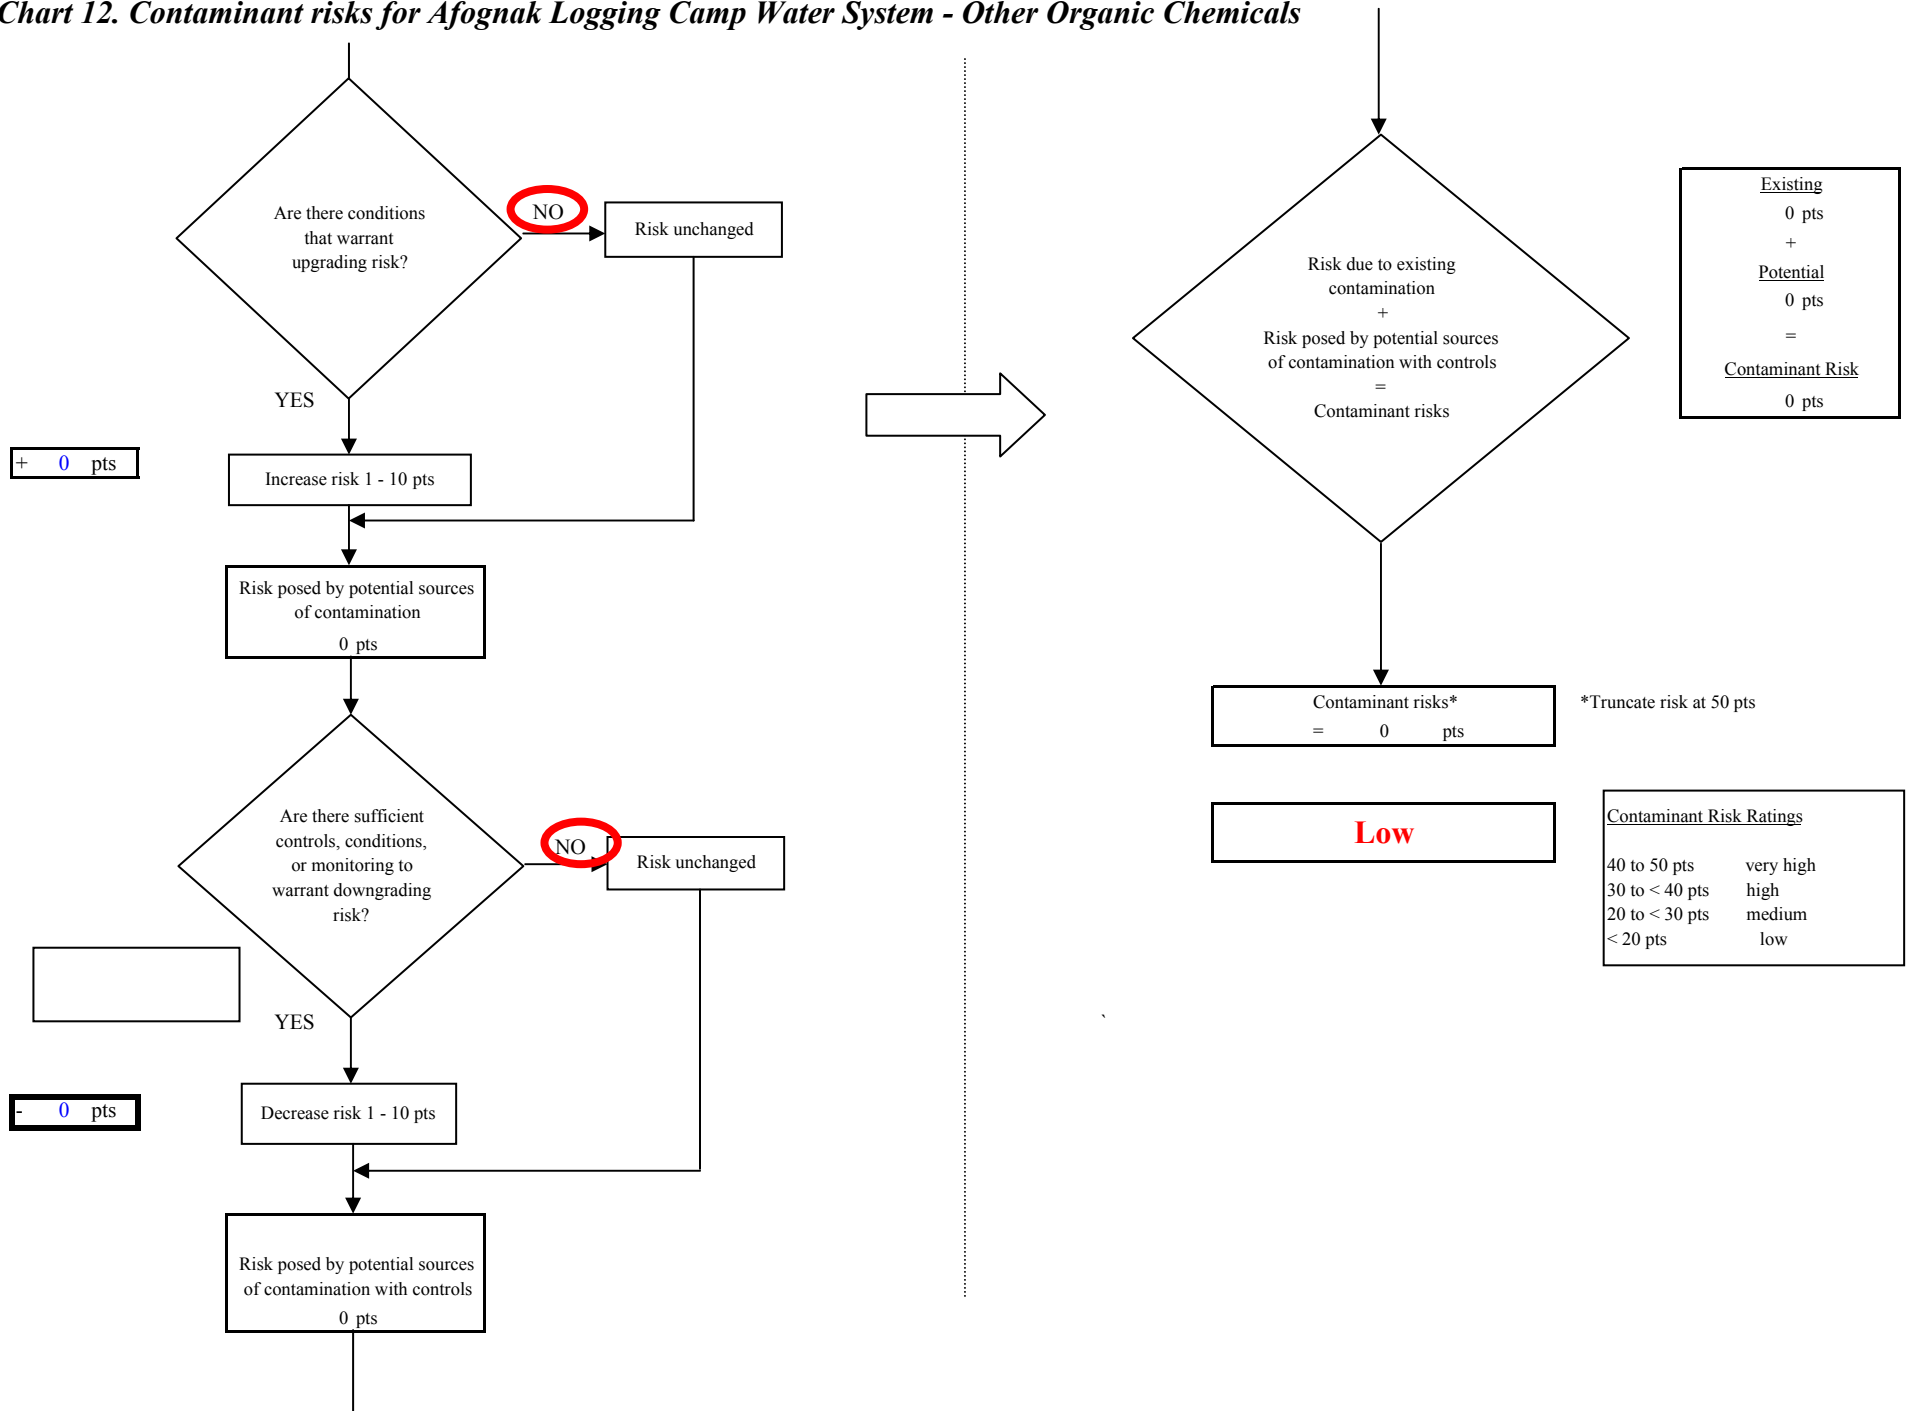