

---

# Source Water Assessment

A Hydrogeologic Susceptibility and  
Vulnerability Assessment for  
Glencaren Court,  
Anchorage, Alaska  
PWSID # 210689

DRINKING WATER PROTECTION PROGRAM REPORT 582

Alaska Department of Environmental Conservation

---

# Source Water Assessment for Glencaren Court Anchorage, Alaska PWSID# 210689

DRINKING WATER PROTECTION PROGRAM REPORT 582

The Drinking Water Protection Program is producing Source Water Assessments in compliance with the Safe Drinking Water Act Amendments of 1996. Each assessment includes a delineation of the source water area, an inventory of potential and existing contaminant sources that may impact the water, a risk ranking for each of these contaminants, and an evaluation of the potential vulnerability of these drinking water sources.

These assessments are intended to provide public water systems owners/operators, communities, and local governments with the best available information that may be used to protect the quality of their drinking water. The assessments combine information obtained from various sources, including the U.S. Environmental Protection Agency, Alaska Department of Environmental Conservation (ADEC), public water system owners/operators, and other public information sources. The results of this assessment are subject to change if additional data becomes available. If you have any additional information that may affect the results of this assessment, please contact the Program Coordinator of DWPP, (907) 269-7521.

---

## CONTENTS

	Page		Page
Executive Summary	1	Inventory of Potential and Existing	
Introduction	1	Contaminant Sources	4
Description of Anchorage Area, Alaska	1	Ranking of Contaminant Risks	4
Glencaren Court’s Public Drinking Water		Vulnerability of Glencaren Court’s Drinking Water	
System	3	Source	4
Glencaren Court’s Protection Area	3	Summary	6
		References	7

## TABLES

TABLE	1. Definition of Zones	4
	2. Susceptibility	4
	3. Contaminant Risks	5
	4. Overall Vulnerability	5

## APPENDICES

APPENDIX	A. Glencaren Court’s Drinking Water Protection Area (Map 1)
	B. Contaminant Source Inventory for Glencaren Court (Table 1)
	Contaminant Source Inventory and Risk Ranking for Glencaren Court – Bacteria and Viruses (Table 2)
	Contaminant Source Inventory and Risk Ranking for Glencaren Court – Nitrates/Nitrites (Table 3)
	Contaminant Source Inventory and Risk Ranking for Glencaren Court – Volatile Organic Chemicals (Table 4)
	Contaminant Source Inventory and Risk Ranking for Glencaren Court – Heavy Metals, Cyanide and Other Organic Chemicals (Table 5)
	Contaminant Source Inventory and Risk Ranking for Glencaren Court – Synthetic Organic Chemicals (Table 6)
	Contaminant Source Inventory and Risk Ranking for Glencaren Court – Other Organic Chemicals (Table 7)
	C. Glencaren Court’s Drinking Water Protection Area and Potential and Existing Contaminant Sources (Maps 2 & 3)
	D. Vulnerability Analysis for Contaminant Source Inventory and Risk Ranking for Glencaren Court’s Public Drinking Water Source (Charts 1 – 14)

# Source Water Assessment for Glencaren Court’s Source of Public Drinking Water, Anchorage, Alaska

## Drinking Water Protection Program Alaska Department of Environmental Conservation

### EXECUTIVE SUMMARY

The public water system for Glencaren Court is a Class A (community) water system consisting of two wells in the Anchorage area. Identified potential and current sources of contaminants for Glencaren Court’s public drinking water source include: sewer lines, a snow disposal area, residential area, an above ground residential heating fuel tank, roads, a public utility easement, and recreation trails. These identified potential and existing sources of contamination are considered sources of bacteria and viruses, nitrates and/or nitrites, volatile organic chemicals, heavy metals, synthetic organic chemicals and other organic chemicals. Overall, the public drinking water source for Glencaren Court received a vulnerability rating of **High** for heavy metals, cyanide and other inorganic chemicals, **Medium** for bacteria and viruses, nitrates and/or nitrites, and volatile organic chemicals, and **Low** for synthetic organic chemicals, and other organic chemicals.

### INTRODUCTION

The Alaska Department of Environmental Conservation (ADEC) is completing source water assessments for all public drinking water sources in the State of Alaska. The purpose of this assessment is to provide public water system owners and/or operators, communities, and local governments with information they can use to preserve the quality of Alaska’s public drinking water supplies. The results of this source water assessment can be used to decide where voluntary protection efforts are needed and feasible, and also what efforts will be most effective in reducing contaminant risks to your water system.

This source water assessment combines a review of the natural conditions at the site and the potential and existing contaminant risks. These are combined to determine the overall vulnerability of the drinking water source to contamination.

### DESCRIPTION OF THE ANCHORAGE AREA, ALASKA

#### Location

Anchorage, located in south-central Alaska, encompasses 1,698 square miles of land and 264 square miles of water. The area containing a majority of the urban development, commonly referred to as the Anchorage Bowl, encompasses approximately 180 square miles [Partick, Brabets, and Glass, 1989] and envelopes the low lands of the area. This area is bounded on the east by the Chugach Mountains and the north, west, and south by the Knik and Turnagain Arm of Cook Inlet (Figure 1). In recent times, urban development has extended eastward along the flanks of the Chugach Mountains. This area, known locally as the Anchorage Hillside, contains development at elevations exceeding 3,700 feet in elevation above sea level.



Figure 1. Index map showing the location of Anchorage, Alaska

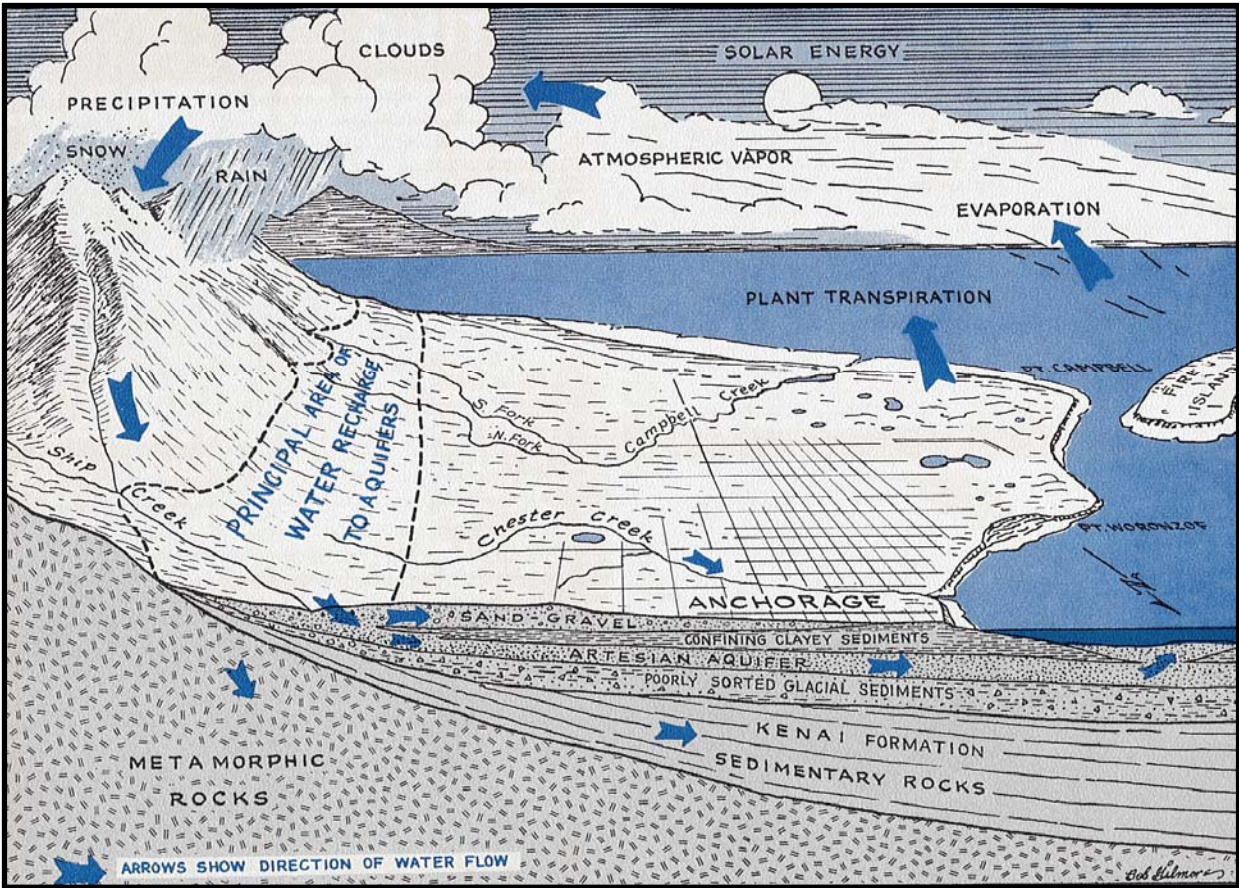


Figure 2. Generalized hydrologic cycle in the Anchorage area [Barnwell, George, Dearborn, Weeks, and Zenone, 1972].

## Climate

The Anchorage area climate is somewhat transitional in that it does not experience large daily and annual temperature fluctuations like those experienced in the interior of Alaska nor does it experience high amounts of precipitation typified by gulf coast regions. Mean annual precipitation at the Anchorage International Airport is approximately 16 inches per year. On average, Anchorage receives a total snow accumulation of 69 inches per year. Precipitation generally increases inland toward the Chugach Mountains where annual precipitation may exceed 160 inches per year [Barnwell, George, Dearborn, Weeks, and Zenone, 1972]. Mean daily temperature ranges from 65° F during July to 8° F in January [Western Regional Climate Center, 2000].

## Physiography and Groundwater Conditions

Surface elevations in the Anchorage area range from sea level at Knik and Turnagain Arms to well over 5,000 feet in the peaks that bound the area. Glacial moraine and outwash deposits primarily mantle the surface of the Anchorage Bowl.

The backbone of the Chugach Mountains is composed primarily of metamorphic marine and volcanic rocks (bedrock). These high peaks that bound Anchorage's east side are flanked with colluvium or slope deposits. These slope deposits eventually grade into the glacial and stream deposits at lower elevations in the Anchorage Bowl.

In the Anchorage area, two principal groundwater flow systems or aquifers exist (see Figure 2). The upper unconfined aquifer or water-table aquifer is separated from a lower confined aquifer system by layers of silty, clayey glacially derived sediments (confining layer) [Ulery and Updike, 1983]. The lower confined aquifer system consists of a series of hydrologically interconnected layers and lenses of gravel, sand and silt that, collectively, form the confined aquifer. The confining layer ranges from 0 to 270 feet thick throughout the Anchorage area and generally thins with increasing distance from Cook Inlet, thus pinching out at the mountain front [Patrick, Brabets, and Glass, 1989].

Water enters or recharges these two aquifer systems in several different ways. Along the front of the Chugach Mountains, groundwater seeps from fractures in

bedrock into the sediments. At these higher elevations, rain and snowmelt also enters the sediments. This area along the mountain front is considered the principal recharge area for wells in the Anchorage area. Precipitation in the low lands may also percolate directly into the ground. Lastly, aquifers may also be recharged by streams where surface water percolates into surrounding permeable sediments (losing reaches of streams). Groundwater flow in the confined aquifer is generally east to west from the mountain front toward Cook Inlet and Turnagain Arm, except in areas where the direction of flow is influenced by large municipal or industrial production wells. The direction of groundwater flow in the upper unconfined aquifer is more variable due to the influence from surficial topography as well as its close connection with surface water bodies.

### **GLENCAREN COURT'S PUBLIC DRINKING WATER SYSTEM**

Glencaren Court is a Class A (non-transient/non-community) water system. The system consists of two wells located off of Muldoon Road, near the base of the Chugach Mountains (See Map 1 of Appendix A). This area is at an elevation of approximately 275 feet above sea level.

There is no well log available for the wells serving Glencaren Court. According to well logs within a ¼-mile distance from Glencaren Court, the wells penetrate layers of sandy and clayey gravel, gravelly silty yellow clay, blue clay, and sandy gravel. The most recent Sanitary Survey (09/24/96) indicates that Well #1 was drilled (1973) to a depth of 190 feet below land surface and Well #2 was drilled (1978) to a depth of 96 feet below land surface. It is suspected that both wells were completed in a confined aquifer setting. Well logs in the area indicate that there is a layer of blue clay at approximately 64 feet below land surface, with a thickness of approximately 33 feet. Near the base of the Chugach Mountains, these clay layers tend to thin out toward the mountains. Therefore, contaminants that enter the subsurface near the base of the mountains may enter the confined aquifer uninhibited by the absence of any protective layer.

The Sanitary Survey indicates that both wells were installed with a cap providing a sanitary seal and that the land surface is appropriately sloped to provide adequate surface water drainage. A properly installed sanitary seal may provide protection against contaminants from entering the source waters at the well casing. Due to the date that the well was installed it is suspected that the wells were not grouted according to ADEC regulations. Proper grouting provides added protection against contaminants traveling along the well

casing and into source waters.

This system operates year-round and serves 650 residents through 350 service connections.

### **GLENCAREN COURT'S PROTECTION AREA**

In order to evaluate whether a drinking water source is at risk, we must first evaluate what are the most likely pathways for surface contamination to reach the groundwater. Some areas are more likely to allow contamination to reach the well than others. These areas are determined by looking at the characteristics of the soil, groundwater, aquifer, and well.

The most probable area for contamination to reach the drinking water well is the area that contributes water to the well, the groundwater recharge area. This area is designated as the Drinking Water Protection Area (DWPA). Because releases of contaminants within the DWPA are most likely to impact the drinking water well, this area will serve as the focus for voluntary protection efforts.

An outline of the immediate watershed was used to determine the size and shape of the DWPA for Glencaren Court. Available geology was also considered to take into account any uncertainties in groundwater flow and aquifer characteristics to arrive at a meaningful DWPA (Please refer to the Guidance Manual for Class A Public Water Systems for additional information).

The DWPAs established for wells by the ADEC are usually separated into four zones, limited by the watershed. These zones correspond to differences in the time-of-travel (TOT) of the water moving through the aquifer to the well. An analytical calculation was used to determine the size and shape of the DWPA. The input parameters describing the attributes of the aquifer in this calculation were adopted from the U.S. Geological Survey (*Patrick, Brabets, and Glass, 1989*), and State of Alaska Department of Water Resources (*Jokela et. al., 1991*).

The time of travel for contaminants within the water varies and is dependent on the physical and chemical characteristics of each contaminant. The following is a summary of the four DWPA zones and the calculated time-of-travel for each:

**Table 1. Definition of Zones**

<b>Zone</b>	<b>Definition</b>
A	¼ the distance for the 2-yr. TOT
B	Less than the 2 year TOT
C	Less Than the 5 year TOT
D	Less than the 10 year TOT

**INVENTORY OF POTENTIAL AND EXISTING CONTAMINANT SOURCES**

The Drinking Water Protection Program has completed an inventory of potential and existing sources of contamination within Glencaren Court’s DWPA. This inventory was completed through a search of agency records and other publicly available information. Potential sources of contamination to the drinking water aquifer include a wide range of categories and types. Potential drinking water contaminants are found within agricultural, residential, commercial, and industrial areas, but can also occur within areas that have little or no development.

For the basis of all Class A public water system assessments, six categories of drinking water contaminants were inventoried. They include:

- Bacteria and viruses;
- Nitrates and/or nitrites;
- Volatile organic chemicals
- Heavy metals, cyanide, and other inorganic chemicals,
- Synthetic organic chemicals, and
- Other organic chemicals.

The sources are displayed on Maps 2 & 3 in Appendix C and summarized in Table 1 of Appendix B.

**RANKING OF CONTAMINANT RISKS**

Once the potential and existing sources of contamination have been identified, they are assigned a ranking according to what type and level of risk they represent. Ranking of contaminant risks for a “potential” or “existing” source of contamination is a function of toxicity and volumes of specific contaminants associated with that source.

Tables 2 through 7 in Appendix B contain the ranking of potential and existing sources of contamination with respect to bacteria and viruses, nitrates and/or nitrites, volatile organic chemicals, heavy metals, synthetic organic chemicals, and other organic chemicals.

**VULNERABILITY OF GLENCAREN COURT’S DRINKING WATER SOURCE**

Vulnerability of a drinking water source to contamination is a combination of two factors:

- Natural susceptibility; and
- Contaminant risks.

Each of the six categories of drinking water contaminants has been analyzed and an overall vulnerability score of 0 to 100 is ultimately assigned:

$$\begin{aligned}
 &\text{Natural Susceptibility (0 – 50 points)} \\
 &+ \\
 &\text{Contaminant Risks (0 – 50 points)} \\
 &= \\
 &\text{Vulnerability of the}
 \end{aligned}$$

Drinking Water Source to Contamination (0 – 100). A score for the Natural Susceptibility is achieved by analyzing the properties of the well and the aquifer.

$$\begin{aligned}
 &\text{Susceptibility of the Wellhead (0 – 25 Points)} \\
 &+ \\
 &\text{Susceptibility of the Aquifer (0 – 25 Points)} \\
 &= \\
 &\text{Natural Susceptibility (Susceptibility of the Well)} \\
 &\text{(0 – 50 Points)}
 \end{aligned}$$

Table 2 shows the Susceptibility scores and ratings for the wells serving Glencaren Court.

**Table 2. Susceptibility**

	<b>Score</b>	<b>Rating</b>
Susceptibility of the Wellhead	5	Low
Susceptibility of the Aquifer	9	Low
Natural Susceptibility	14	Low

Contaminant risks to a drinking water source depend on the type, number or density, and distribution of contaminant sources. This data has been derived from an examination of existing and historical contamination that has been detected at the drinking water source through routine sampling. It also evaluates potential sources of contamination. Table 3 summarizes the

Contaminant Risks for each category of drinking water contaminants.

**Table 3. Contaminant Risks**

Category	Score	Rating
Bacteria and Viruses	25	Medium
Nitrates and/or Nitrites	26	Medium
Volatile Organic Chemicals	25	Medium
Heavy Metals, Cyanide, and Other Inorganic Chemicals	50	Very High
Synthetic Organic Chemicals	12	Low
Other Organic Chemicals	12	Low

Appendix D contains fourteen charts, which together form the ‘Vulnerability Analysis’ for a source water assessment for a public drinking water source. Chart 1 analyzes the ‘Susceptibility of the Wellhead’ to contamination by looking at the construction of the well and its surrounding area. Chart 2 analyzes the ‘Susceptibility of the Aquifer’ to contamination by looking at the naturally occurring attributes of the water source and influences on the groundwater system that might lead to contamination. Chart 3 analyzes ‘Contaminant Risks’ for the drinking water source with respect to bacteria and viruses. The ‘Contaminant Risks’ portion of the analysis considers potential sources of contaminants as well as a review of contamination that has or may have occurred, but has not arrived or been detected at the well. Lastly, Chart 4 contains the ‘Vulnerability Analysis for Bacteria and Viruses’. Charts 5 through 14 contain the Contaminant Risks and Vulnerability Analyses for nitrates and nitrites, volatile organic chemicals, heavy metals, synthetic organic chemicals, and other organic chemicals, respectively.

Table 4 contains the overall vulnerability scores (0 – 100) and ratings for each of the six categories of drinking water contaminants. Note: scores are rounded off to the nearest five.

**Table 4. Overall Vulnerability**

Category	Score	Rating
Bacteria and Viruses	40	Medium
Nitrates and Nitrites	40	Medium
Volatile Organic Chemicals	40	Medium
Heavy Metals, Cyanide and Other Inorganic Chemicals	65	High
Synthetic Organic Chemicals	25	Low
Other Organic Chemicals	25	Low

### Bacteria and Viruses

The contaminant risk for bacteria and viruses is medium with sewer lines and residential area presenting the most significant risk to the drinking water wells (See Chart 3 – Contaminant Risks for Bacteria and Viruses in Appendix D).

After combining the contaminant risk for bacteria and viruses with the natural susceptibility of the wells, the overall vulnerability is medium.

### Nitrates and Nitrites

The contaminant risk for nitrates and nitrites is medium with sewer lines, residential area, and roads presenting the most significant risk to the drinking water wells.

Nitrate concentrations in uncontaminated groundwater are typically less than 2 milligrams per liter (mg/L) and are derived primarily from the decomposition of organic matter in soils [Wang, Strelakos, Jokela, 2000]. Sampling history for Glencaren Court indicates low concentrations of nitrates have been detected in source waters (See Chart 5 - Contaminant Risks for Nitrates and/or Nitrites in Appendix D). The most recent nitrate detection occurred May 15, 2002, at approximately 2% of the Maximum contaminant Level or MCL.

The MCL is the maximum level of contaminant that is allowed to exist in drinking water and still be consumed by humans without harmful health effects. Due to the high solubility and weak retention by soil, nitrates are very mobile, moving at approximately the same rate as water. Though nitrates were detected at the site, concentrations remain at safe levels with respect to human health.

After combining the contaminant risk for nitrates and nitrites with the natural susceptibility of the wells, the overall vulnerability to potential contamination is medium.

### Volatile Organic Chemicals

The contaminant risk for volatile organic chemicals is medium with an above ground residential heating oil tank, roads, sewer lines, and residential area presenting the most significant risk for volatile organic chemicals (See Chart 7 – Contaminant Risks for Volatile Organic Chemicals in Appendix D).

Recent sampling history of Glencaren Court’s wells indicates that no volatile organic chemicals have been detected in the source waters.

After combining the contaminant risk for volatile organic chemicals with the natural susceptibility of the wells, the overall vulnerability to potential contamination is medium.



### **Heavy Metals, Cyanide, and Other Inorganic Chemicals**

The contaminant risk for heavy metals, cyanide and other inorganic chemicals is very high with the sewer lines, residential area, and presenting the most significant risk to the drinking water source (See Chart 9 – Contaminant Risks for Heavy Metals, Cyanide, and Other Inorganic Chemicals in Appendix D).

Review of recent sampling history revealed that low concentrations of inorganic chemicals have been detected in Glencaren Court's source waters. Sampling done on August 22, 2001 detected arsenic at 0.008mg/L or 80% of the MCL for arsenic (0.01mg/L). Barium was also detected in the sample at approximately 3% of the MCL for barium (2mg/L). The most recent water sample was taken on May 15, 2002 and lab analysis revealed that arsenic was not detected (See Chart 9 – Contaminant Risks for Heavy Metals and Other Inorganic Chemicals in Appendix D). Combining the contaminant risk with the natural susceptibility of the well leads to an overall vulnerability to heavy metals and other inorganic chemical contamination of high.

According to the EPA "Arsenic occurs naturally in rocks and soil, water, air, and plants and animals. It can be further released into the environment through natural activities such as volcanic action, erosion of rocks, and forest fires, or through human actions. Approximately 90 percent of industrial arsenic in the U.S. is currently used as a wood preservative, but arsenic is also used in paints, dyes, metals, drugs, soaps, and semi-conductors. Agricultural applications, mining, and smelting also contribute to arsenic releases in the environment." (EPA, 2001).

Studies have linked long-term exposure to arsenic in drinking water to cancer of the bladder, lungs, skin, kidney, nasal passages, liver, and prostate. Non-cancer effects of ingesting arsenic include cardiovascular, pulmonary, immunological, neurological, and endocrine (e.g., diabetes) effects. Short-term exposure to high doses of arsenic can cause other adverse health effects, but such effects are unlikely to occur from U.S. public water supplies that are in compliance with the previous arsenic standard of 50 ppb. (EPA, 2001) Review of recent sampling history revealed that no heavy metals, cyanide or other inorganic chemicals have been detected at the well.

Barium can come from the discharge of drilling wastes; discharge from metal refineries; or the erosion of natural deposits. There are no mining activities occurring within or near the protection area for Glencaren Court. It is suspected that the detected levels of barium are a result of the erosion of natural deposits. The (EPA) has found barium to potentially cause the

following health effects when people are exposed to it at levels above the MCL for relatively short periods of time: gastrointestinal disturbances and muscular weakness. Long-term health effects include high blood pressure.

After combining the contaminant risk for heavy metals, cyanide and other inorganic chemicals with the natural susceptibility of the wells, the overall vulnerability is high.

### **Synthetic Organic Chemicals**

The contaminant risk for synthetic organic chemicals is low with sewer lines and residential area presenting the most significant risk. After combining the contaminant risk with the natural susceptibility of the wells, the overall vulnerability to synthetic organic chemicals is low (See Chart 11 – Contaminant Risks for Synthetic Organic Chemicals in Appendix D, respectively).

### **Other Organic Chemicals**

The contaminant risk for other organic chemicals is low with the sewer lines, residential area, and roads presenting the most significant risk. After combining the contaminant risk with the natural susceptibility of the wells, the overall vulnerability to other organic chemicals is low (See Chart 13 – Contaminant Risks for Other Organic Chemicals in Appendix D, respectively).

## **SUMMARY**

A *Source Water Assessment* has been completed for the source of public drinking water serving Glencaren Court. The overall vulnerability of well to contamination is **High** for heavy metals, cyanide, and other inorganic chemicals, **Medium** for bacteria and viruses, nitrates and/or nitrites, and volatile organic chemicals, and **Low** for synthetic organic chemicals, and other organic chemicals. This assessment of contaminant risks can be used as a foundation for local voluntary protection efforts as well as a basis for the continuous efforts on the part of Glencaren Court to protect public health. It is anticipated that *Source Water Assessments* will be updated every five years to reflect any changes in the vulnerability and/or susceptibility of Glencaren Court's public drinking water source.


## REFERENCES

- Barnwell, W.W., George, R.S., Dearborn, L.L., Weeks, J.B., and Zenone, C., 1972, Water for Anchorage: an atlas of the water resources of the Anchorage area, Alaska: U.S. Geological Survey Open-File Report, 76 p.
- Patrick, L.D., Brabets, T.P., and Glass, R.L., 1989, Simulation of ground-water flow at Anchorage, Alaska: U.S. Geological Survey Water-Resources Investigations Report 88-4139, 41p.
- Ulery, C.A. and Updike, R.G, 1983, Subsurface structure of the cohesive facies of the Bootlegger Cove Formation, Southwest Anchorage, Alaska: Alaska Division of Geological and Geophysical Surveys Professional Report 84, 5 p.
- United States Environmental Protection Agency (EPA, Office of Water). 2001, July 23. Retrieved February 2002 [WWW document]. URL [http://www.epa.gov/safewater/ars/ars\\_rule\\_factsheet.html](http://www.epa.gov/safewater/ars/ars_rule_factsheet.html)
- United States Environmental Protection Agency (EPA, Office of Water). 2002, May 22. Retrieved July 12, 2002 [WWW document]. URL <http://www.epa.gov/safewater/dwh/c-ioc/barium.html>
- Wang, B., Strelakos, P.M., and Jokela, B., 2000, Nitrate Source Indicators In Groundwater of the Scimitar Subdivision, Peters Creek Area, Anchorage Alaska: U.S. Geological Survey Water-Resources Investigations Report 00-4137, 25p.
- Western Regional Climate Center, 2000, August 24, Web extension to the *Western Regional Climate Center* [WWW document]. URL <http://www.wrcc.dri.edu/index.html>



## **APPENDIX A**

### **Glencaren Court's Drinking Water Protection Area Location Map (Map 1)**

# Drinking Water Protection Area and Potential & Existing Contaminant Sources for Glencaren Court

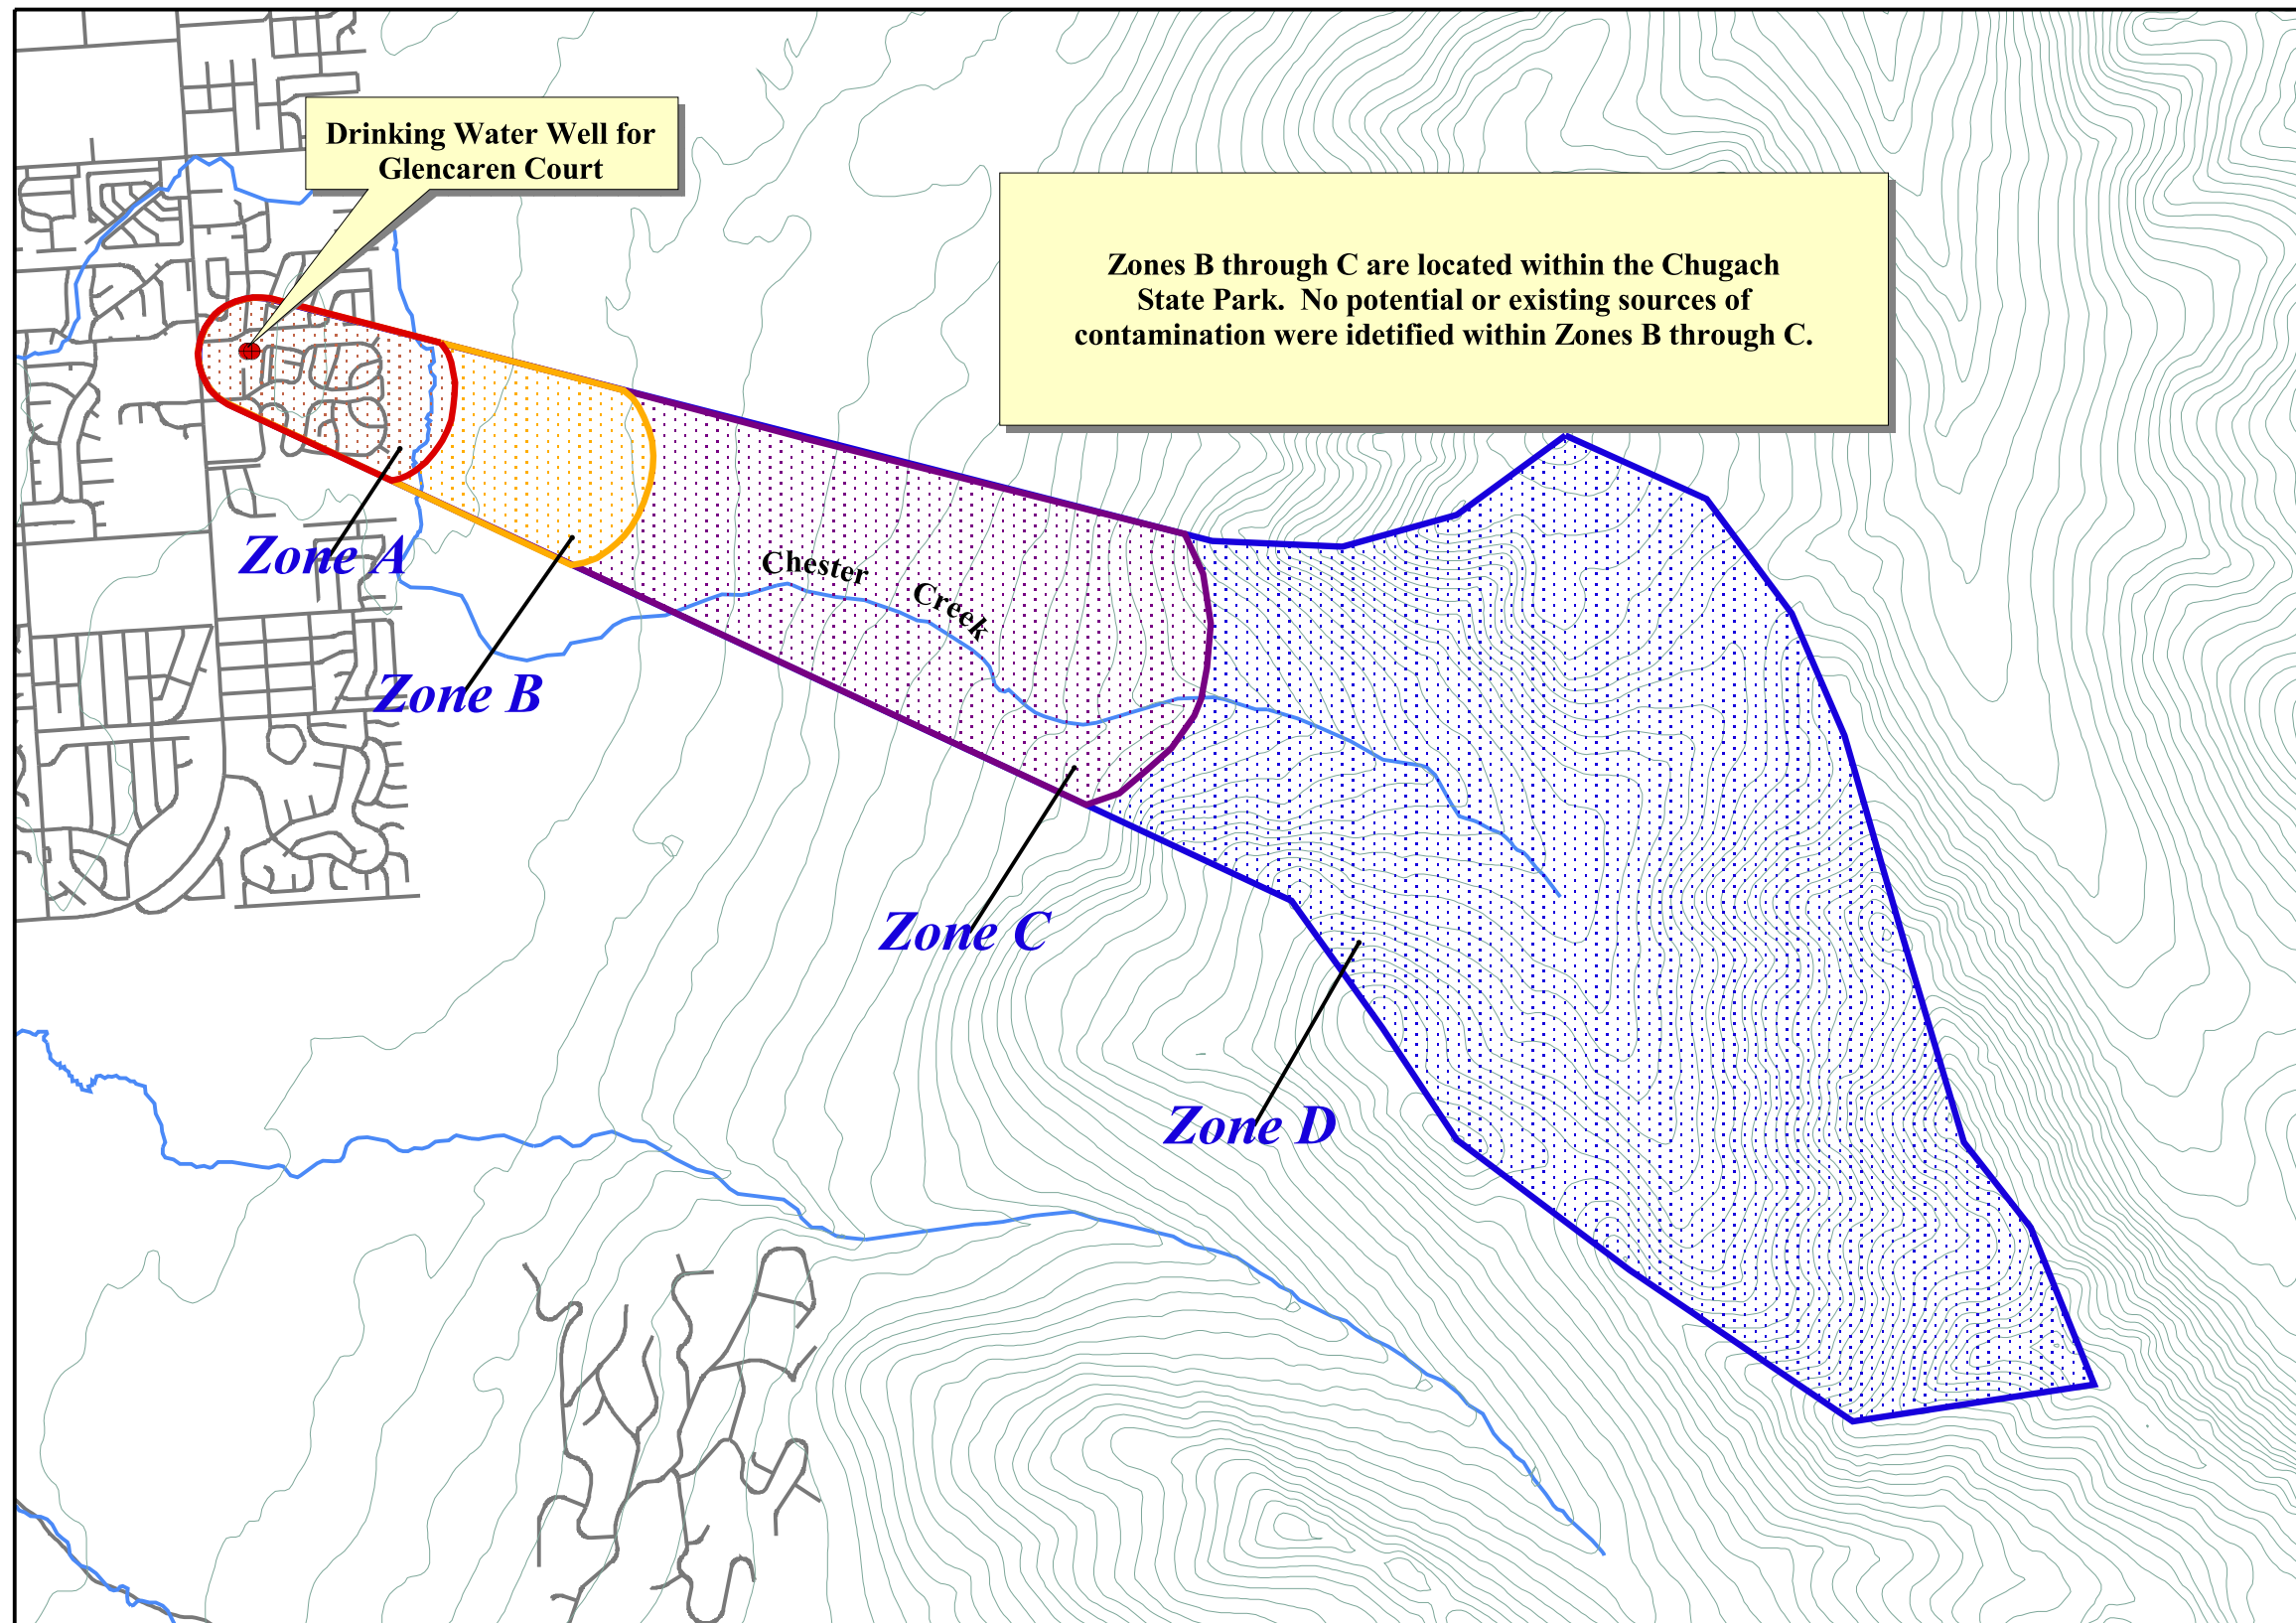

- Glencaren Court Drinking Water Wells
- Zone A Protection Area
  - Several Months Travel Time
- Zone B Protection Area
  - Less Than 2 Years Travel Time
- Zone C Protection Area
  - Less Than 5 Years Travel Time
- Zone D Protection Area
  - Less Than 10 Years Travel Time
- Elevation Contours
- Streams
- Roads
- Lakes

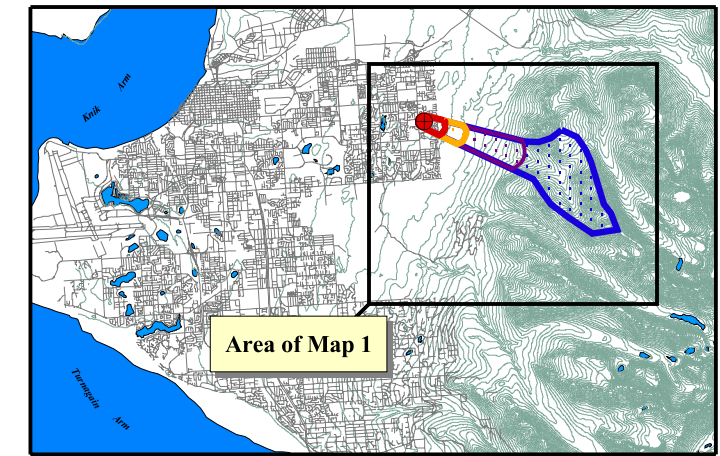

PWSID 210689.001

*Map 1*

## **APPENDIX B**

### **Contaminant Source Inventory and Risk Ranking for Glencaren Court (Tables 1-7)**

**Table 1**

**Contaminant Source Inventory for  
Glencaren Court**

**PWSID 210689.001**

<b>Contaminant Source Type</b>	<b>Contaminant Source ID</b>	<b>CS ID tag</b>	<b>Zone</b>	<b>Location</b>	<b>Map Number</b>	<b>Comments</b>
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D1-1	A	along Parkway	2	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D1-10	A	along Hidden View	2	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D1-11	A		2	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D1-2	A	between Twentieth and Parkway	2	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D1-3	A	off Twentieth to Byrne	2	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D1-4	A	along State	2	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D1-5	A	along Green Dale	2	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D1-6	A	along Twentieth	2	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D1-7	A	along Nineteenth	2	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D1-8	A	along Rebel Ridge	2	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D1-9	A	along Twentieth	2	
Snow disposal areas	D60	D60-1	A	Muldoon and Halligan	3	
Residential Areas	R01	R1-1	A	entire subdivision	3	Approximately 91 acres of residential area.
Tanks, heating oil, residential (above ground)	R08	R8-1	A	off of Muldoon Road	2	
Highways and roads, paved (cement or asphalt)	X20	X20-1	A	Parkway	2	
Highways and roads, paved (cement or asphalt)	X20	X20-10	A	Popcary	2	
Highways and roads, paved (cement or asphalt)	X20	X20-11	A	Rebel Ridge	2	
Highways and roads, paved (cement or asphalt)	X20	X20-12	A	Halligan	2	
Highways and roads, paved (cement or asphalt)	X20	X20-13	A	Molly O	2	

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Location</i>	<i>Map Number</i>	<i>Comments</i>
Highways and roads, paved (cement or asphalt)	X20	X20-14	A	Owen	2	
Highways and roads, paved (cement or asphalt)	X20	X20-15	A	Queen Ann	2	
Highways and roads, paved (cement or asphalt)	X20	X20-16	A	Vincent	2	
Highways and roads, paved (cement or asphalt)	X20	X20-17	A	Andrew Cross	2	
Highways and roads, paved (cement or asphalt)	X20	X20-2	A	Twentieth	2	
Highways and roads, paved (cement or asphalt)	X20	X20-3	A	Halligan	2	
Highways and roads, paved (cement or asphalt)	X20	X20-4	A		2	
Highways and roads, paved (cement or asphalt)	X20	X20-5	A	Green Dale	2	
Highways and roads, paved (cement or asphalt)	X20	X20-6	A	Patrick	2	
Highways and roads, paved (cement or asphalt)	X20	X20-7	A	Nineteenth	2	
Highways and roads, paved (cement or asphalt)	X20	X20-8	A	Byrne	2	
Highways and roads, paved (cement or asphalt)	X20	X20-9	A		2	
Public utility easements/corridors	X42	X42-1	A		3	
Public utility easements/corridors	X42	X42-2	A	Zone A	3	
Dog walking areas/foot trails	X46	X46-1	A	along Muldoon	3	
Dog walking areas/foot trails	X46	X46-2	A	along Chester Creek	3	

Table 2

*Contaminant Source Inventory and Risk Ranking for  
Glencaren Court  
Sources of Bacteria and Viruses*

PWSID 210689.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Location</i>	<i>Map Number</i>	<i>Comments</i>
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D1-1	A	Medium	along Parkway	2	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D1-10	A	Medium	along Hidden View	2	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D1-11	A	Medium		2	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D1-2	A	Medium	between Twentieth and Parkway	2	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D1-3	A	Medium	off Twentieth to Byrne	2	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D1-4	A	Medium	along State	2	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D1-5	A	Medium	along Green Dale	2	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D1-6	A	Medium	along Twentieth	2	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D1-7	A	Medium	along Nineteenth	2	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D1-8	A	Medium	along Rebel Ridge	2	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D1-9	A	Medium	along Twentieth	2	
Residential Areas	R01	R1-1	A	Low	entire subdivision	3	Approximately 91 acres of residential area.
Highways and roads, paved (cement or asphalt)	X20	X20-1	A	Low	Parkway	2	
Highways and roads, paved (cement or asphalt)	X20	X20-10	A	Low	Popcary	2	
Highways and roads, paved (cement or asphalt)	X20	X20-11	A	Low	Rebel Ridge	2	
Highways and roads, paved (cement or asphalt)	X20	X20-12	A	Low	Halligan	2	
Highways and roads, paved (cement or asphalt)	X20	X20-13	A	Low	Molly O	2	
Highways and roads, paved (cement or asphalt)	X20	X20-14	A	Low	Owen	2	



Table 2 (continued)

*Contaminant Source Inventory and Risk Ranking for  
Glencaren Court  
Sources of Bacteria and Viruses*

PWSID 210689.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Location</i>	<i>Map Number</i>	<i>Comments</i>
Highways and roads, paved (cement or asphalt)	X20	X20-15	A	Low	Queen Ann	2	
Highways and roads, paved (cement or asphalt)	X20	X20-16	A	Low	Vincent	2	
Highways and roads, paved (cement or asphalt)	X20	X20-17	A	Low	Andrew Cross	2	
Highways and roads, paved (cement or asphalt)	X20	X20-2	A	Low	Twentieth	2	
Highways and roads, paved (cement or asphalt)	X20	X20-3	A	Low	Halligan	2	
Highways and roads, paved (cement or asphalt)	X20	X20-4	A	Low		2	
Highways and roads, paved (cement or asphalt)	X20	X20-5	A	Low	Green Dale	2	
Highways and roads, paved (cement or asphalt)	X20	X20-6	A	Low	Patrick	2	
Highways and roads, paved (cement or asphalt)	X20	X20-7	A	Low	Nineteenth	2	
Highways and roads, paved (cement or asphalt)	X20	X20-8	A	Low	Byrne	2	
Highways and roads, paved (cement or asphalt)	X20	X20-9	A	Low		2	
Dog walking areas/foot trails	X46	X46-1	A	Low	along Muldoon	3	
Dog walking areas/foot trails	X46	X46-2	A	Low	along Chester Creek	3	

Table 3

*Contaminant Source Inventory and Risk Ranking for  
Glencaren Court  
Sources of Nitrates/Nitrites*

PWSID 210689.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Location</i>	<i>Map Number</i>	<i>Comments</i>
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D1-1	A	Medium	along Parkway	2	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D1-10	A	Medium	along Hidden View	2	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D1-11	A	Medium		2	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D1-2	A	Medium	between Twentieth and Parkway	2	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D1-3	A	Medium	off Twentieth to Byrne	2	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D1-4	A	Medium	along State	2	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D1-5	A	Medium	along Green Dale	2	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D1-6	A	Medium	along Twentieth	2	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D1-7	A	Medium	along Nineteenth	2	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D1-8	A	Medium	along Rebel Ridge	2	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D1-9	A	Medium	along Twentieth	2	
Residential Areas	R01	R1-1	A	Low	entire subdivision	3	Approximately 91 acres of residential area.
Highways and roads, paved (cement or asphalt)	X20	X20-1	A	Low	Parkway	2	
Highways and roads, paved (cement or asphalt)	X20	X20-10	A	Low	Popcary	2	
Highways and roads, paved (cement or asphalt)	X20	X20-11	A	Low	Rebel Ridge	2	
Highways and roads, paved (cement or asphalt)	X20	X20-12	A	Low	Halligan	2	
Highways and roads, paved (cement or asphalt)	X20	X20-13	A	Low	Molly O	2	
Highways and roads, paved (cement or asphalt)	X20	X20-14	A	Low	Owen	2	

Table 3 (continued)

Contaminant Source Inventory and Risk Ranking for  
Glencaren Court  
Sources of Nitrates/Nitrites

PWSID 210689.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Location</i>	<i>Map Number</i>	<i>Comments</i>
Highways and roads, paved (cement or asphalt)	X20	X20-15	A	Low	Queen Ann	2	
Highways and roads, paved (cement or asphalt)	X20	X20-16	A	Low	Vincent	2	
Highways and roads, paved (cement or asphalt)	X20	X20-17	A	Low	Andrew Cross	2	
Highways and roads, paved (cement or asphalt)	X20	X20-2	A	Low	Twentieth	2	
Highways and roads, paved (cement or asphalt)	X20	X20-3	A	Low	Halligan	2	
Highways and roads, paved (cement or asphalt)	X20	X20-4	A	Low		2	
Highways and roads, paved (cement or asphalt)	X20	X20-5	A	Low	Green Dale	2	
Highways and roads, paved (cement or asphalt)	X20	X20-6	A	Low	Patrick	2	
Highways and roads, paved (cement or asphalt)	X20	X20-7	A	Low	Nineteenth	2	
Highways and roads, paved (cement or asphalt)	X20	X20-8	A	Low	Byrne	2	
Highways and roads, paved (cement or asphalt)	X20	X20-9	A	Low		2	
Dog walking areas/foot trails	X46	X46-1	A	Low	along Muldoon	3	
Dog walking areas/foot trails	X46	X46-2	A	Low	along Chester Creek	3	

Table 4

*Contaminant Source Inventory and Risk Ranking for  
Glencaren Court  
Sources of Volatile Organic Chemicals*

PWSID 210689.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Location</i>	<i>Map Number</i>	<i>Comments</i>
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D1-1	A	Low	along Parkway	2	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D1-10	A	Low	along Hidden View	2	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D1-11	A	Low		2	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D1-2	A	Low	between Twentieth and Parkway	2	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D1-3	A	Low	off Twentieth to Byrne	2	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D1-4	A	Low	along State	2	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D1-5	A	Low	along Green Dale	2	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D1-6	A	Low	along Twentieth	2	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D1-7	A	Low	along Nineteenth	2	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D1-8	A	Low	along Rebel Ridge	2	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D1-9	A	Low	along Twentieth	2	
Snow disposal areas	D60	D60-1	A	Low	Muldoon and Halligan	3	
Residential Areas	R01	R1-1	A	Low	entire subdivision	3	Approximately 91 acres of residential area.
Tanks, heating oil, residential (above ground)	R08	R8-1	A	Medium	off of Muldoon Road	2	
Highways and roads, paved (cement or asphalt)	X20	X20-1	A	Low	Parkway	2	
Highways and roads, paved (cement or asphalt)	X20	X20-10	A	Low	Popcary	2	
Highways and roads, paved (cement or asphalt)	X20	X20-11	A	Low	Rebel Ridge	2	
Highways and roads, paved (cement or asphalt)	X20	X20-12	A	Low	Halligan	2	

Table 4 (continued)

*Contaminant Source Inventory and Risk Ranking for  
Glencaren Court  
Sources of Volatile Organic Chemicals*

PWSID 210689.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Location</i>	<i>Map Number</i>	<i>Comments</i>
Highways and roads, paved (cement or asphalt)	X20	X20-13	A	Low	Molly O	2	
Highways and roads, paved (cement or asphalt)	X20	X20-14	A	Low	Owen	2	
Highways and roads, paved (cement or asphalt)	X20	X20-15	A	Low	Queen Ann	2	
Highways and roads, paved (cement or asphalt)	X20	X20-16	A	Low	Vincent	2	
Highways and roads, paved (cement or asphalt)	X20	X20-17	A	Low	Andrew Cross	2	
Highways and roads, paved (cement or asphalt)	X20	X20-2	A	Low	Twentieth	2	
Highways and roads, paved (cement or asphalt)	X20	X20-3	A	Low	Halligan	2	
Highways and roads, paved (cement or asphalt)	X20	X20-4	A	Low		2	
Highways and roads, paved (cement or asphalt)	X20	X20-5	A	Low	Green Dale	2	
Highways and roads, paved (cement or asphalt)	X20	X20-6	A	Low	Patrick	2	
Highways and roads, paved (cement or asphalt)	X20	X20-7	A	Low	Nineteenth	2	
Highways and roads, paved (cement or asphalt)	X20	X20-8	A	Low	Byrne	2	
Highways and roads, paved (cement or asphalt)	X20	X20-9	A	Low		2	
Public utility easements/corridors	X42	X42-1	A	Low		3	
Public utility easements/corridors	X42	X42-2	A	Low	Zone A	3	

Table 5

*Contaminant Source Inventory and Risk Ranking for  
Glencaren Court*

PWSID 210689.001

*Sources of Heavy Metals, Cyanide and Other Inorganic Chemicals*

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Location</i>	<i>Map Number</i>	<i>Comments</i>
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D1-1	A	Low	along Parkway	2	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D1-10	A	Low	along Hidden View	2	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D1-11	A	Low		2	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D1-2	A	Low	between Twentieth and Parkway	2	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D1-3	A	Low	off Twentieth to Byrne	2	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D1-4	A	Low	along State	2	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D1-5	A	Low	along Green Dale	2	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D1-6	A	Low	along Twentieth	2	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D1-7	A	Low	along Nineteenth	2	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D1-8	A	Low	along Rebel Ridge	2	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D1-9	A	Low	along Twentieth	2	
Snow disposal areas	D60	D60-1	A	Low	Muldoon and Halligan	3	
Residential Areas	R01	R1-1	A	Low	entire subdivision	3	Approximately 91 acres of residential area.
Highways and roads, paved (cement or asphalt)	X20	X20-1	A	Low	Parkway	2	
Highways and roads, paved (cement or asphalt)	X20	X20-10	A	Low	Popcary	2	
Highways and roads, paved (cement or asphalt)	X20	X20-11	A	Low	Rebel Ridge	2	
Highways and roads, paved (cement or asphalt)	X20	X20-12	A	Low	Halligan	2	
Highways and roads, paved (cement or asphalt)	X20	X20-13	A	Low	Molly O	2	

Table 5 (continued)

Contaminant Source Inventory and Risk Ranking for  
Glencaren Court

PWSID 210689.001

Sources of Heavy Metals, Cyanide and Other Inorganic Chemicals

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Location</i>	<i>Map Number</i>	<i>Comments</i>
Highways and roads, paved (cement or asphalt)	X20	X20-14	A	Low	Owen	2	
Highways and roads, paved (cement or asphalt)	X20	X20-15	A	Low	Queen Ann	2	
Highways and roads, paved (cement or asphalt)	X20	X20-16	A	Low	Vincent	2	
Highways and roads, paved (cement or asphalt)	X20	X20-17	A	Low	Andrew Cross	2	
Highways and roads, paved (cement or asphalt)	X20	X20-2	A	Low	Twentieth	2	
Highways and roads, paved (cement or asphalt)	X20	X20-3	A	Low	Halligan	2	
Highways and roads, paved (cement or asphalt)	X20	X20-4	A	Low		2	
Highways and roads, paved (cement or asphalt)	X20	X20-5	A	Low	Green Dale	2	
Highways and roads, paved (cement or asphalt)	X20	X20-6	A	Low	Patrick	2	
Highways and roads, paved (cement or asphalt)	X20	X20-7	A	Low	Nineteenth	2	
Highways and roads, paved (cement or asphalt)	X20	X20-8	A	Low	Byrne	2	
Highways and roads, paved (cement or asphalt)	X20	X20-9	A	Low		2	

Table 6

*Contaminant Source Inventory and Risk Ranking for  
Glencaren Court  
Sources of Synthetic Organic Chemicals*

PWSID 210689.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Location</i>	<i>Map Number</i>	<i>Comments</i>
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D1-1	A	Low	along Parkway	2	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D1-10	A	Low	along Hidden View	2	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D1-11	A	Low		2	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D1-2	A	Low	between Twentieth and Parkway	2	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D1-3	A	Low	off Twentieth to Byrne	2	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D1-4	A	Low	along State	2	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D1-5	A	Low	along Green Dale	2	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D1-6	A	Low	along Twentieth	2	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D1-7	A	Low	along Nineteenth	2	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D1-8	A	Low	along Rebel Ridge	2	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D1-9	A	Low	along Twentieth	2	
Residential Areas	R01	R1-1	A	Low	entire subdivision	3	Approximately 91 acres of residential area.



Table 7

*Contaminant Source Inventory and Risk Ranking for  
Glencaren Court  
Sources of Other Organic Chemicals*

PWSID 210689.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Location</i>	<i>Map Number</i>	<i>Comments</i>
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D1-1	A	Low	along Parkway	2	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D1-10	A	Low	along Hidden View	2	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D1-11	A	Low		2	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D1-2	A	Low	between Twentieth and Parkway	2	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D1-3	A	Low	off Twentieth to Byrne	2	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D1-4	A	Low	along State	2	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D1-5	A	Low	along Green Dale	2	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D1-6	A	Low	along Twentieth	2	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D1-7	A	Low	along Nineteenth	2	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D1-8	A	Low	along Rebel Ridge	2	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D1-9	A	Low	along Twentieth	2	
Residential Areas	R01	R1-1	A	Low	entire subdivision	3	Approximately 91 acres of residential area.
Highways and roads, paved (cement or asphalt)	X20	X20-1	A	Low	Parkway	2	
Highways and roads, paved (cement or asphalt)	X20	X20-10	A	Low	Popcary	2	
Highways and roads, paved (cement or asphalt)	X20	X20-11	A	Low	Rebel Ridge	2	
Highways and roads, paved (cement or asphalt)	X20	X20-12	A	Low	Halligan	2	
Highways and roads, paved (cement or asphalt)	X20	X20-13	A	Low	Molly O	2	
Highways and roads, paved (cement or asphalt)	X20	X20-14	A	Low	Owen	2	

Table 7 (continued)

*Contaminant Source Inventory and Risk Ranking for  
Glencaren Court  
Sources of Other Organic Chemicals*


PWSID 210689.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Location</i>	<i>Map Number</i>	<i>Comments</i>
Highways and roads, paved (cement or asphalt)	X20	X20-15	A	Low	Queen Ann	2	
Highways and roads, paved (cement or asphalt)	X20	X20-16	A	Low	Vincent	2	
Highways and roads, paved (cement or asphalt)	X20	X20-17	A	Low	Andrew Cross	2	
Highways and roads, paved (cement or asphalt)	X20	X20-2	A	Low	Twentieth	2	
Highways and roads, paved (cement or asphalt)	X20	X20-3	A	Low	Halligan	2	
Highways and roads, paved (cement or asphalt)	X20	X20-4	A	Low		2	
Highways and roads, paved (cement or asphalt)	X20	X20-5	A	Low	Green Dale	2	
Highways and roads, paved (cement or asphalt)	X20	X20-6	A	Low	Patrick	2	
Highways and roads, paved (cement or asphalt)	X20	X20-7	A	Low	Nineteenth	2	
Highways and roads, paved (cement or asphalt)	X20	X20-8	A	Low	Byrne	2	
Highways and roads, paved (cement or asphalt)	X20	X20-9	A	Low		2	




## **APPENDIX C**

### **Glencaren Court's Drinking Water Protection Area and Potential and Existing Contaminant Sources (Maps 2 & 3)**

# Drinking Water Protection Area and Potential & Existing Contaminant Sources for Glencaren Court

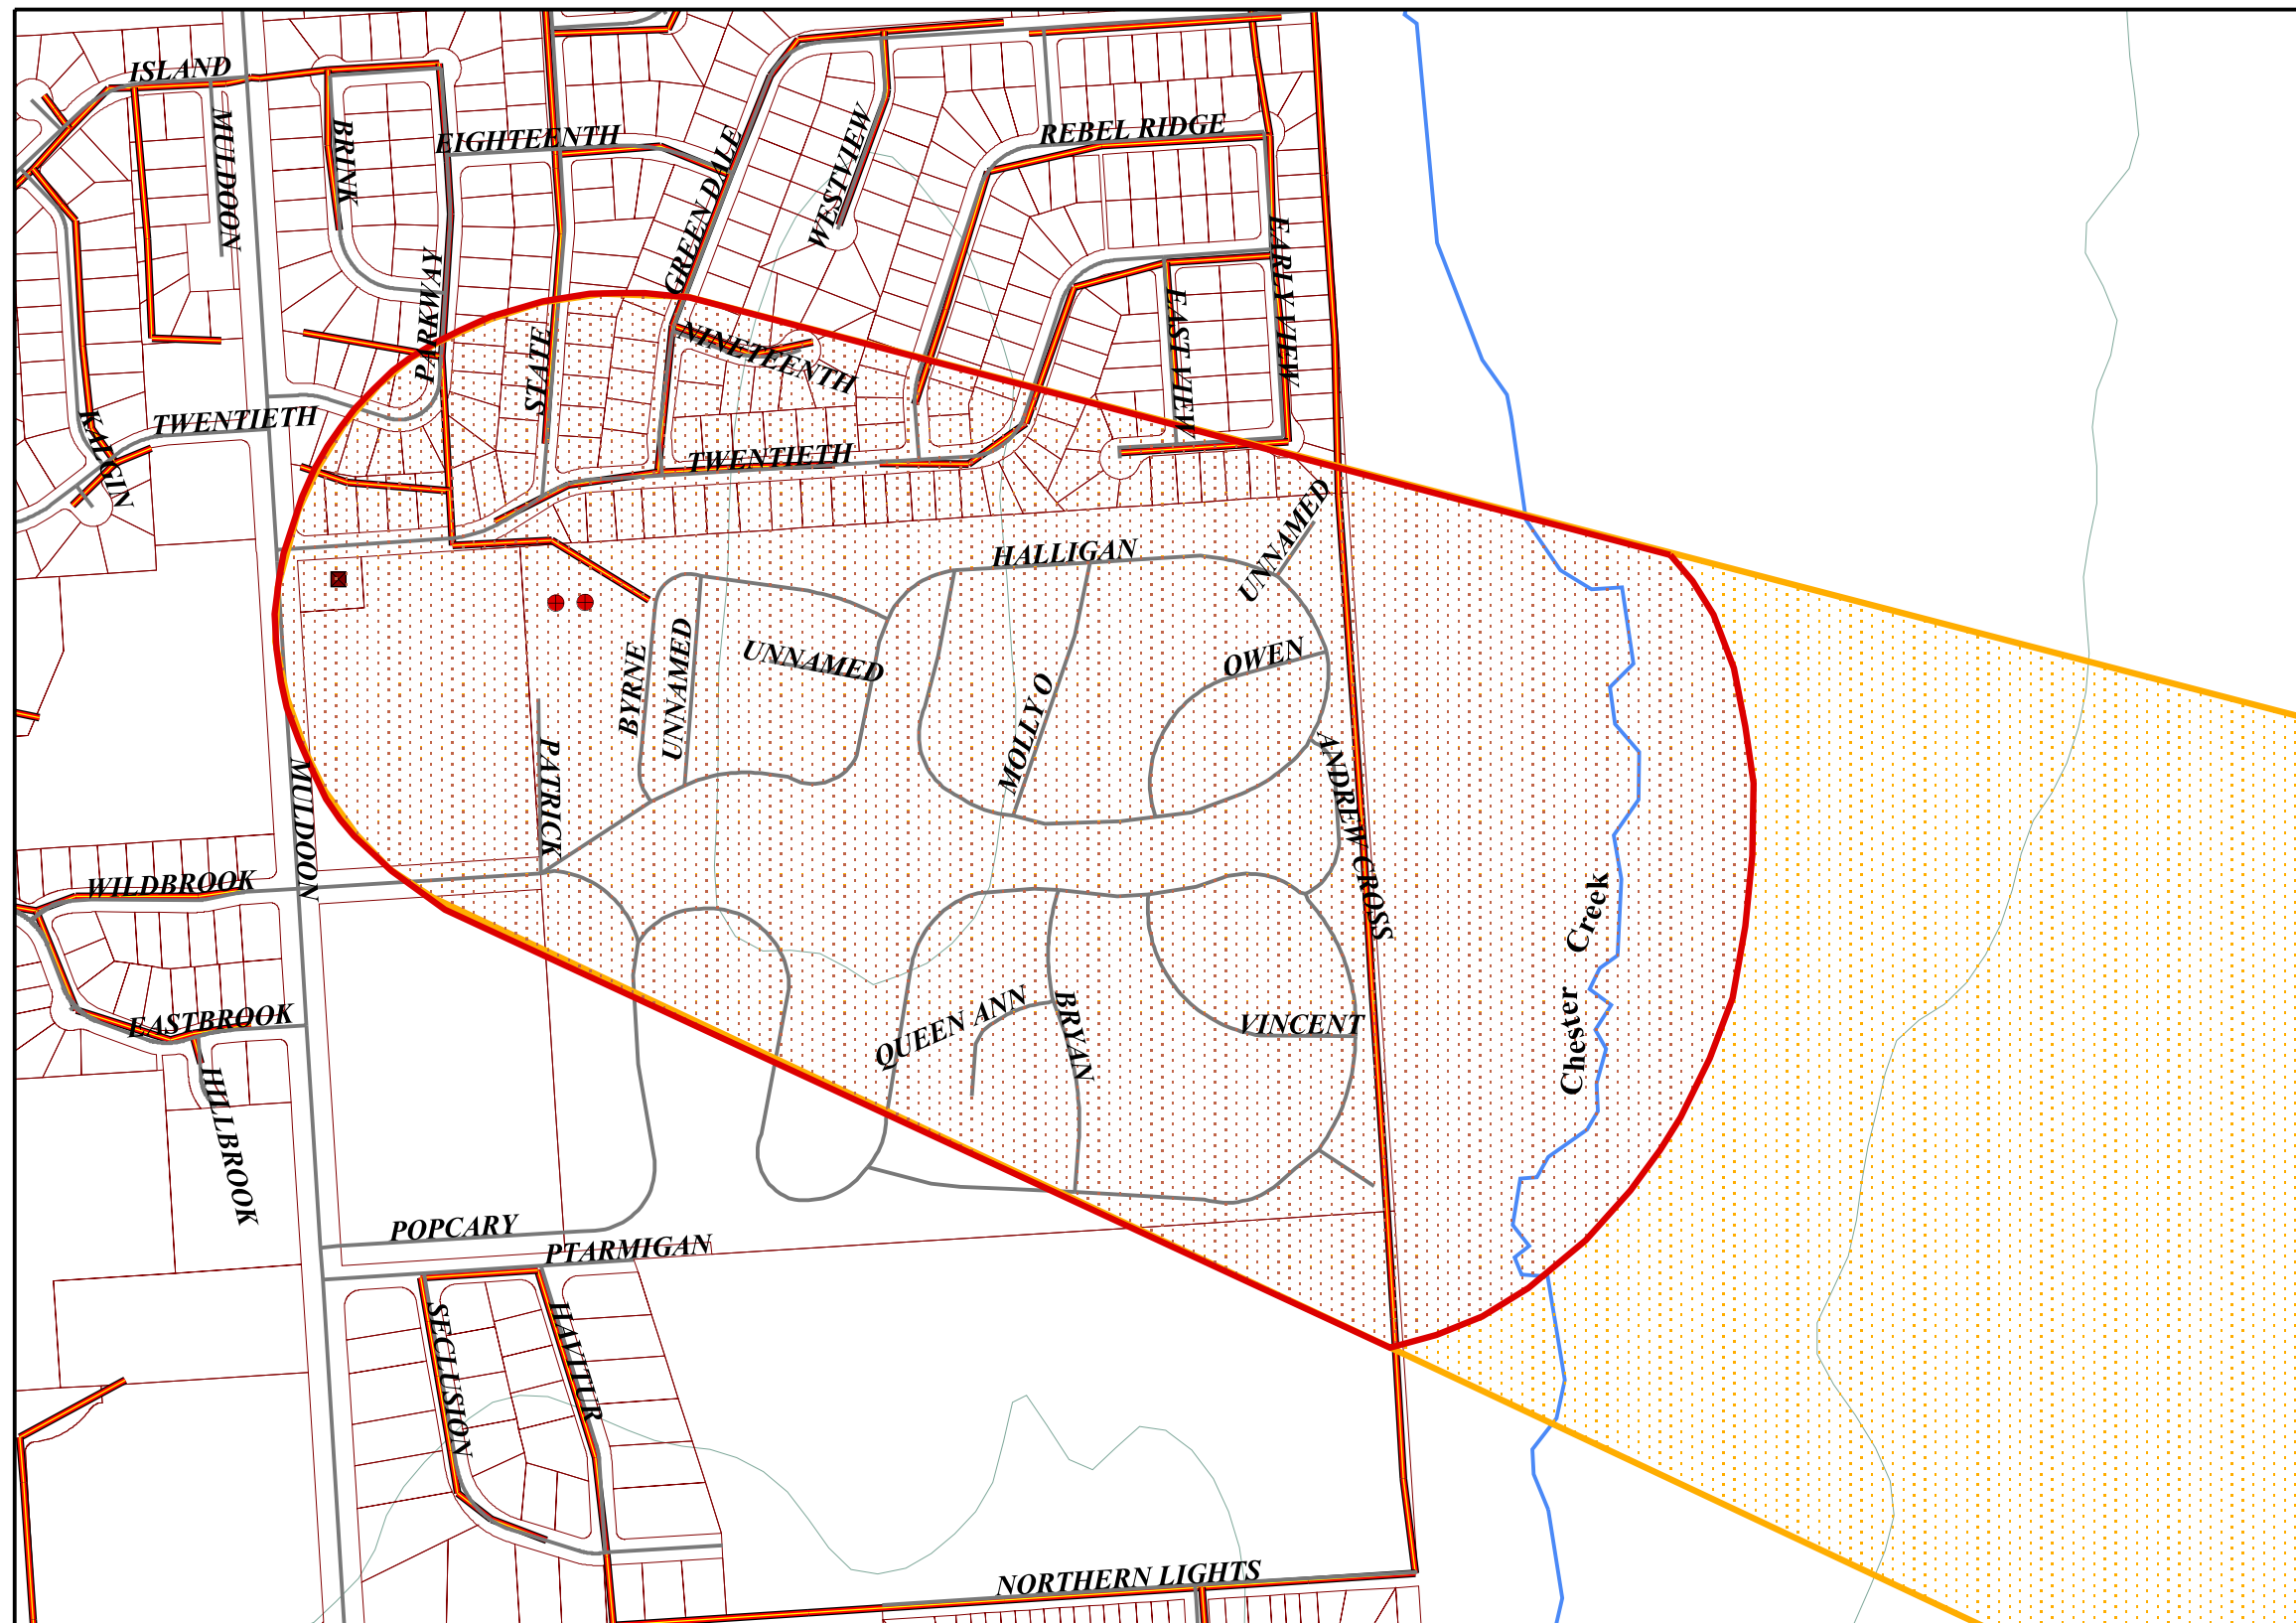


- Glencaren Court Drinking Water Wells
- Zone A Protection Area
- ▨ Several Months Travel Time
- Zone B Protection Area
- ▨ Less Than 2 Years Travel Time
- Potential & Existing Contaminant Sources
- Residential heating oil (above ground tank)
- ⚡ Roads (X20)
- ⚡ Sewers (R2)
- ▭ MOA Land Parcels
- ⚡ Elevation Contours
- ⚡ Streams

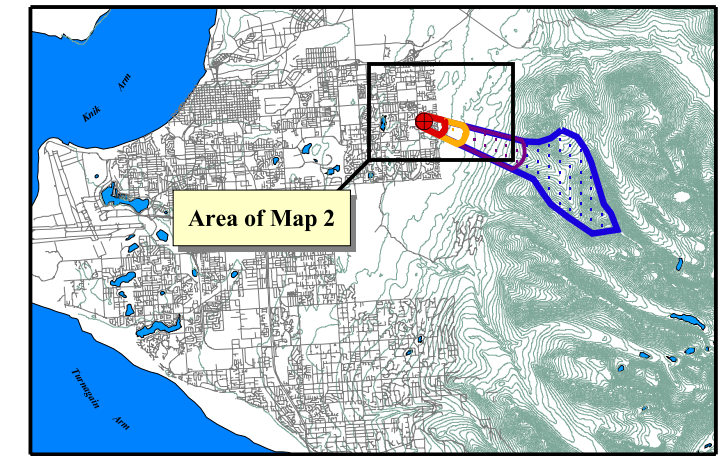



PWSID 210689.001

*Map 2*

# Drinking Water Protection Area and Potential & Existing Contaminant Sources for Glencaren Court

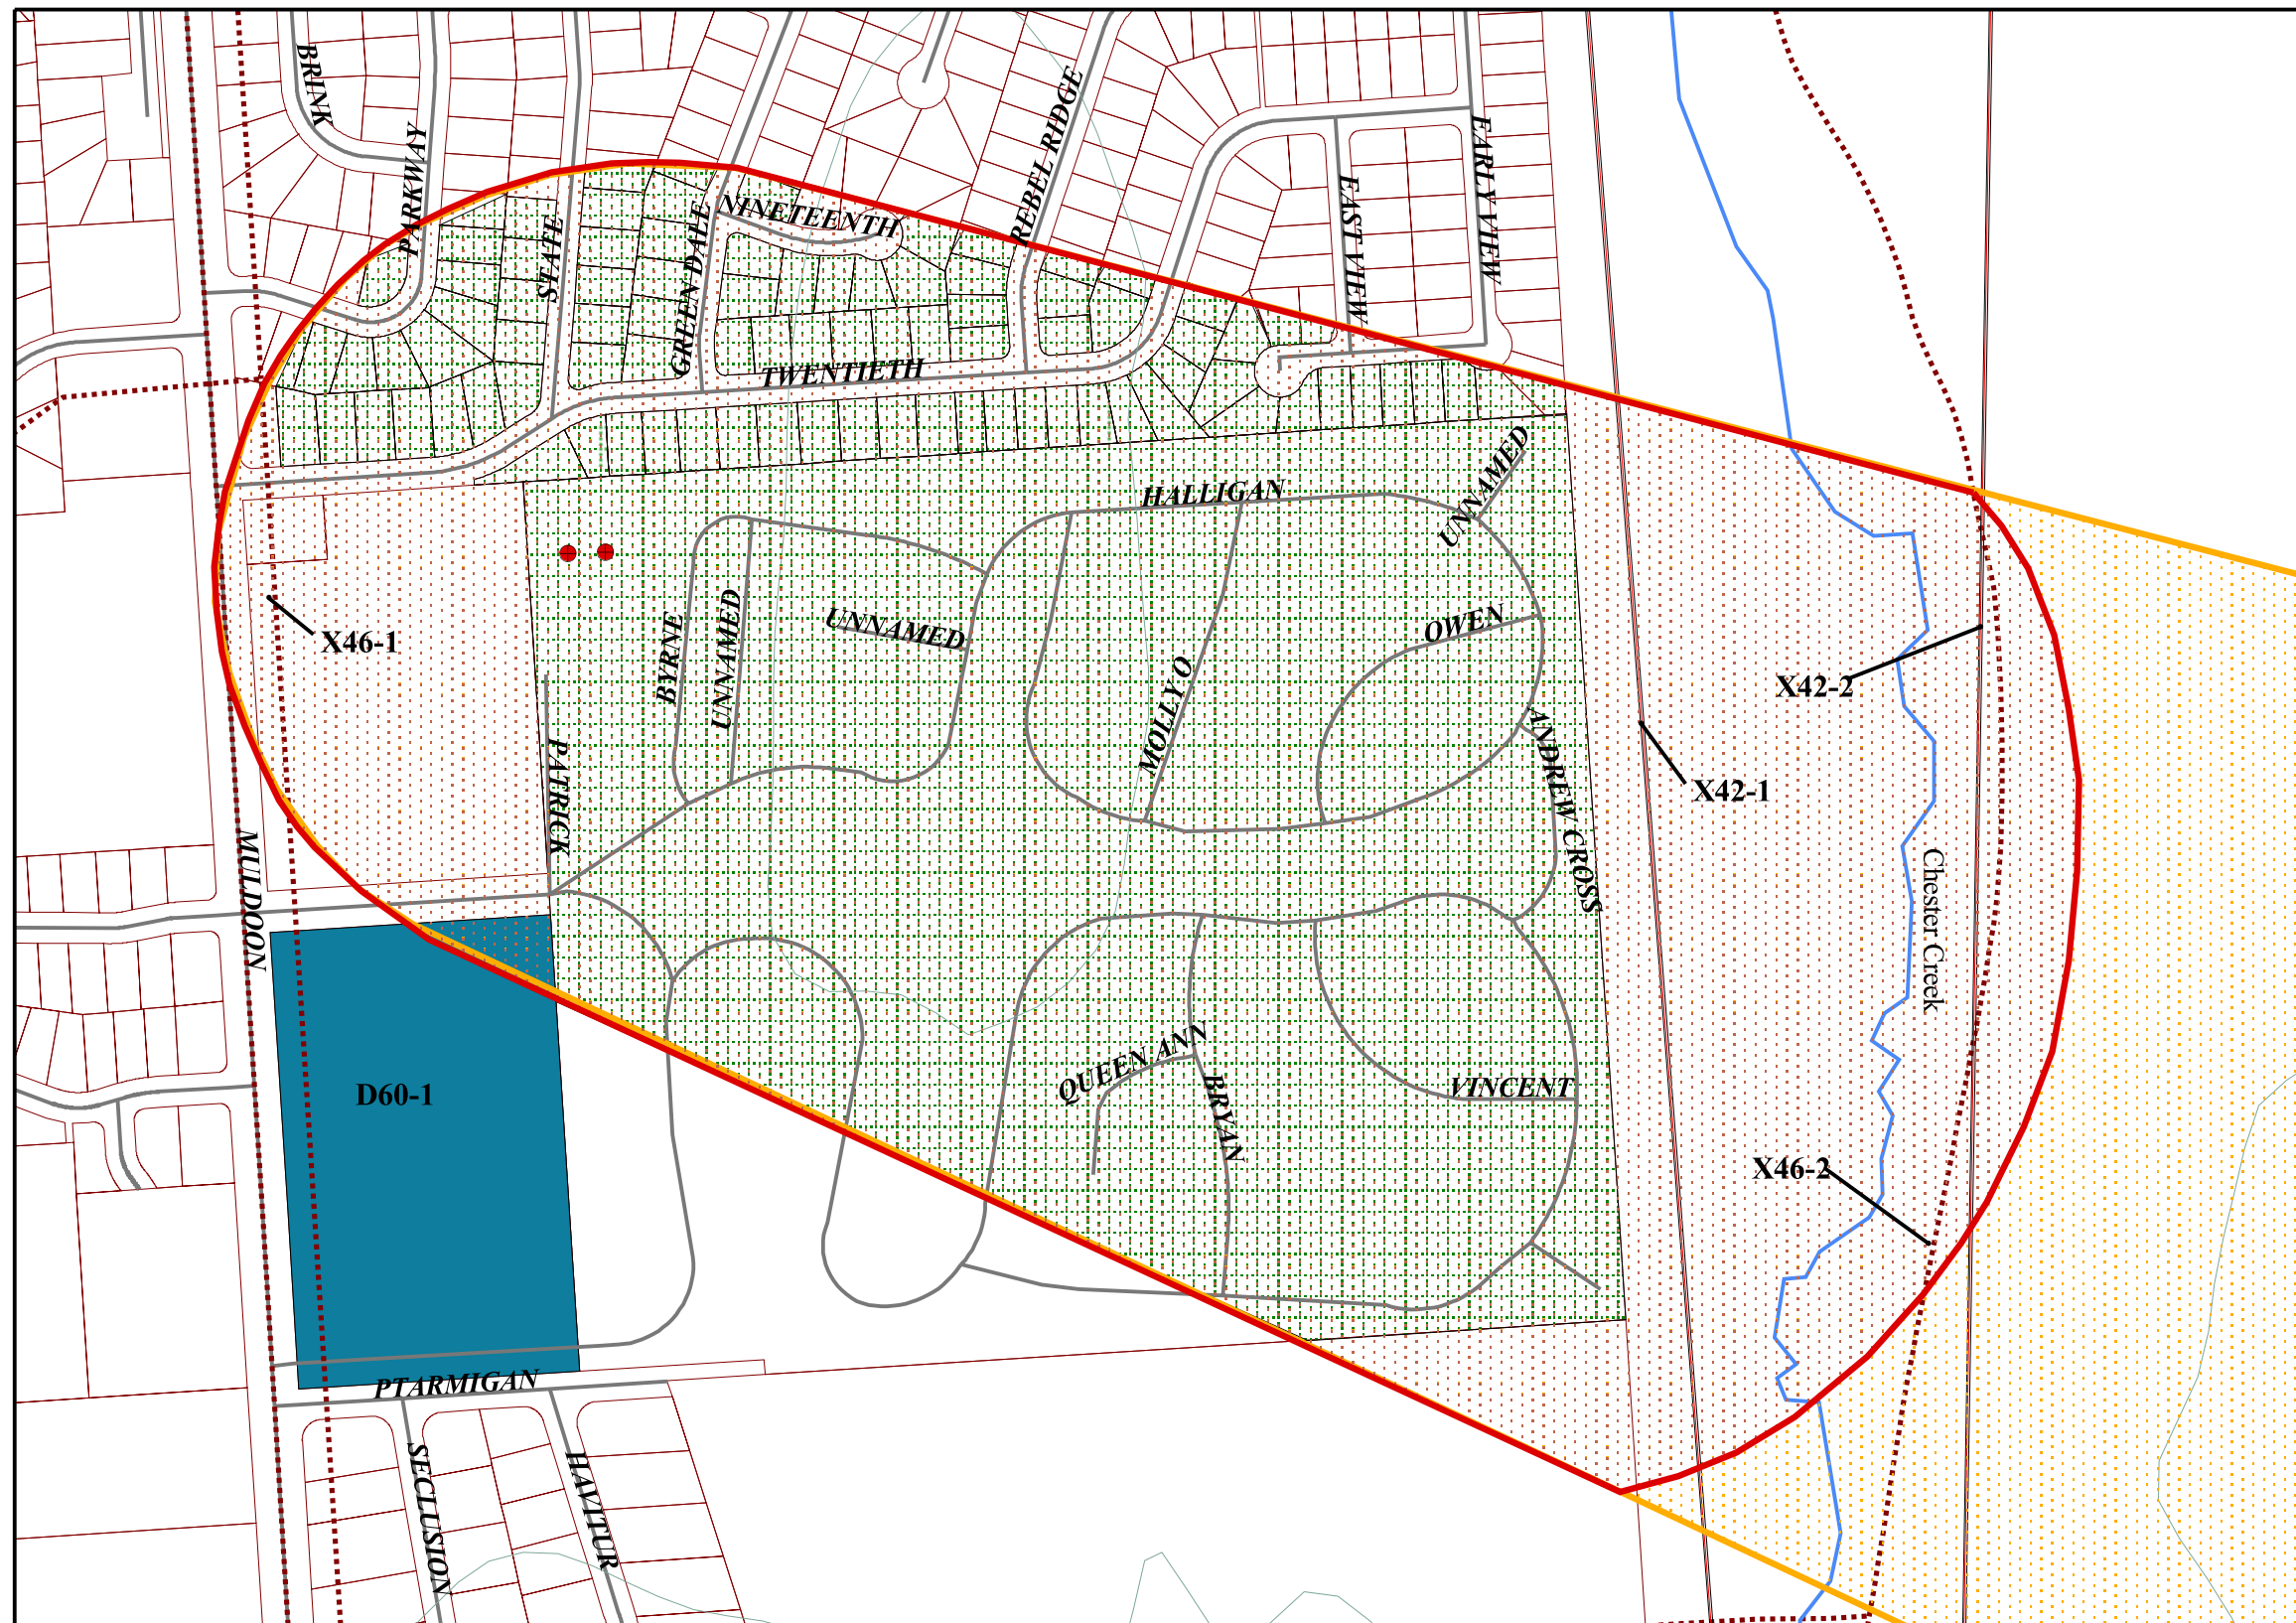

- Glencaren Court Drinking Water Wells
- Zone A Protection Area**
- ▭ Several Months Travel Time
- Zone B Protection Area**
- ▭ Less Than 2 Years Travel Time
- Elevation Contours
- Streams
- Public utility easements/corridors (X42)
- Trails (X46)
- Roads (X20)
- Snow disposal areas (D60)
- ▨ Residential lawns (R1)
- ▭ MOA Land Parcels

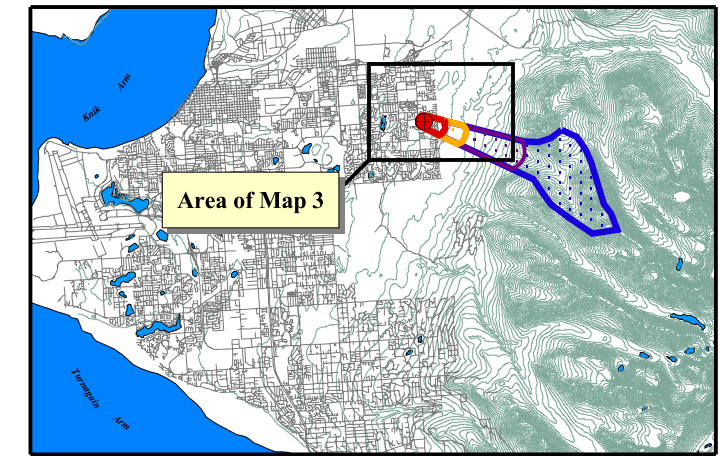


PWSID 210689.001

*Map 3*

## **APPENDIX D**

### **Vulnerability Analysis for Glencaren Court (Charts 1-14)**

**Chart 1. Susceptibility of the wellhead - Glencaren Court**

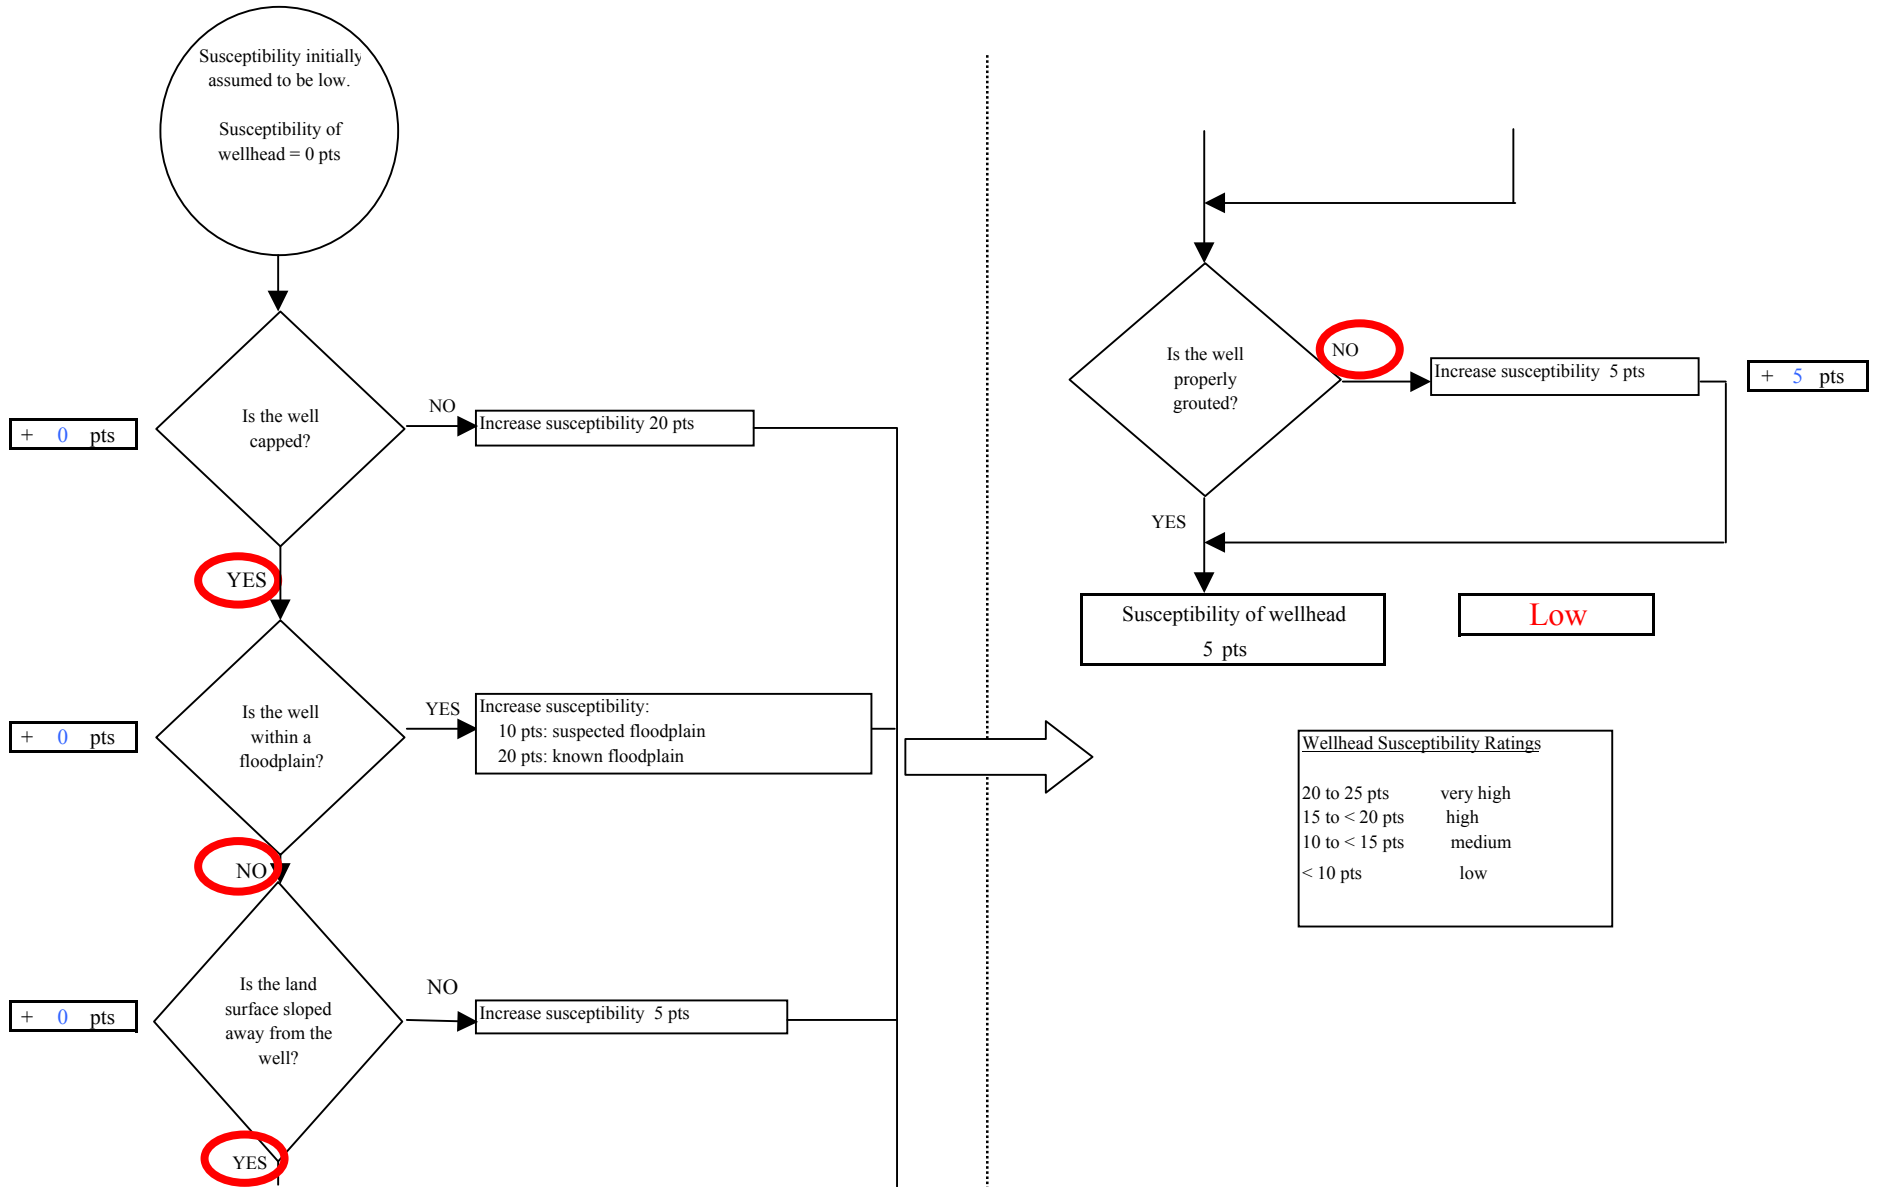

**Chart 2. Susceptibility of the aquifer - Glencaren Court**



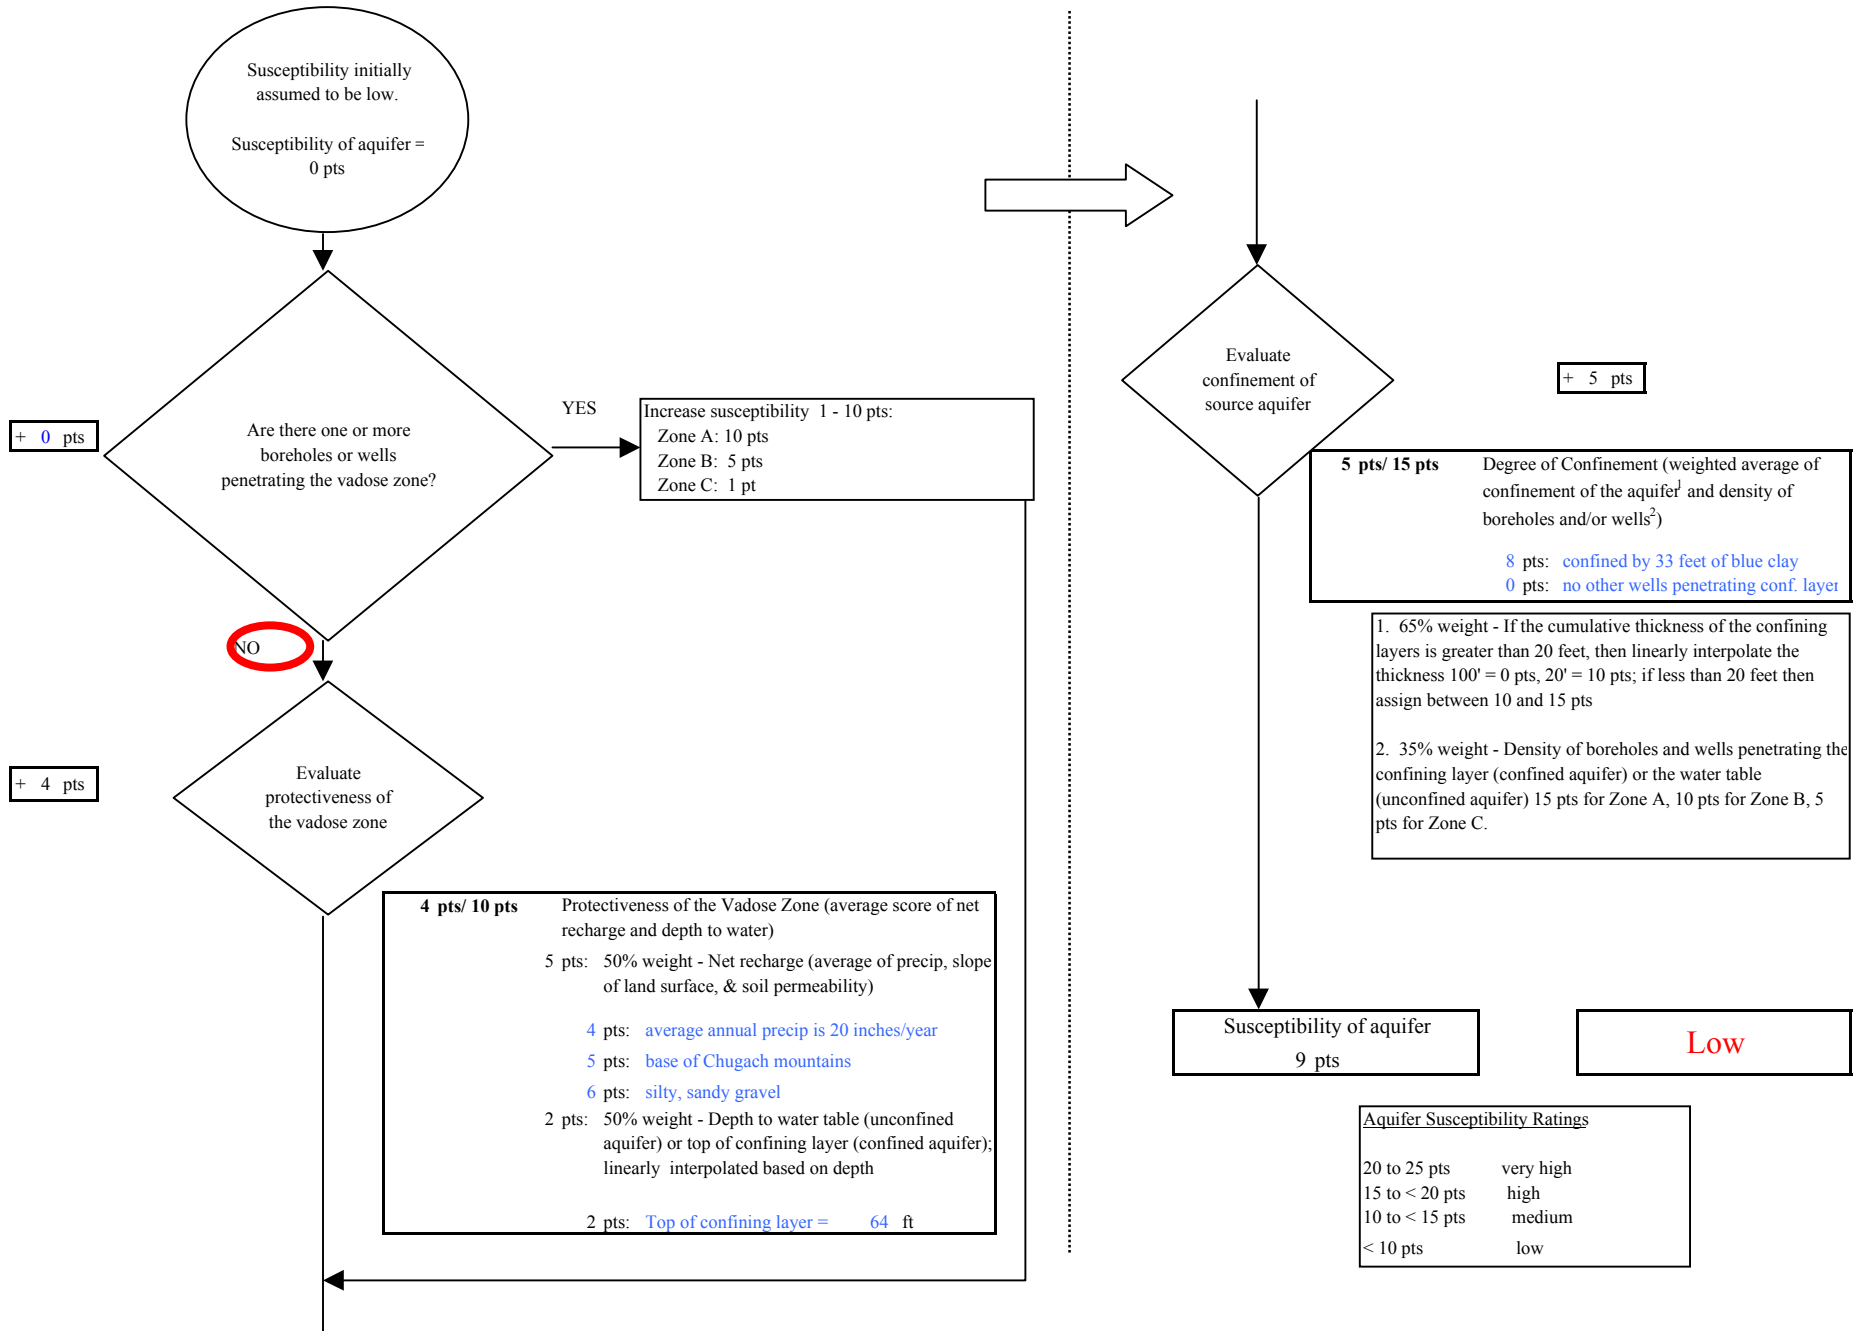




Chart 3. Contaminant risks for *Glencaren Court - Bacteria & Viruses*

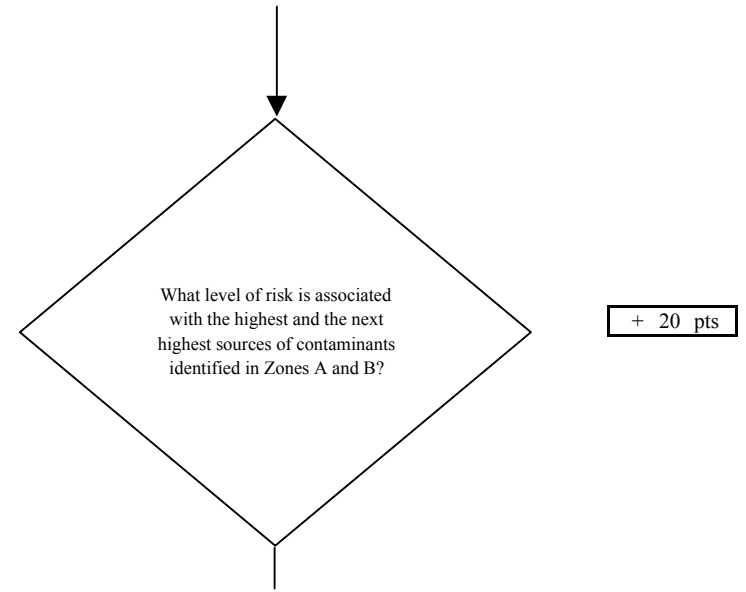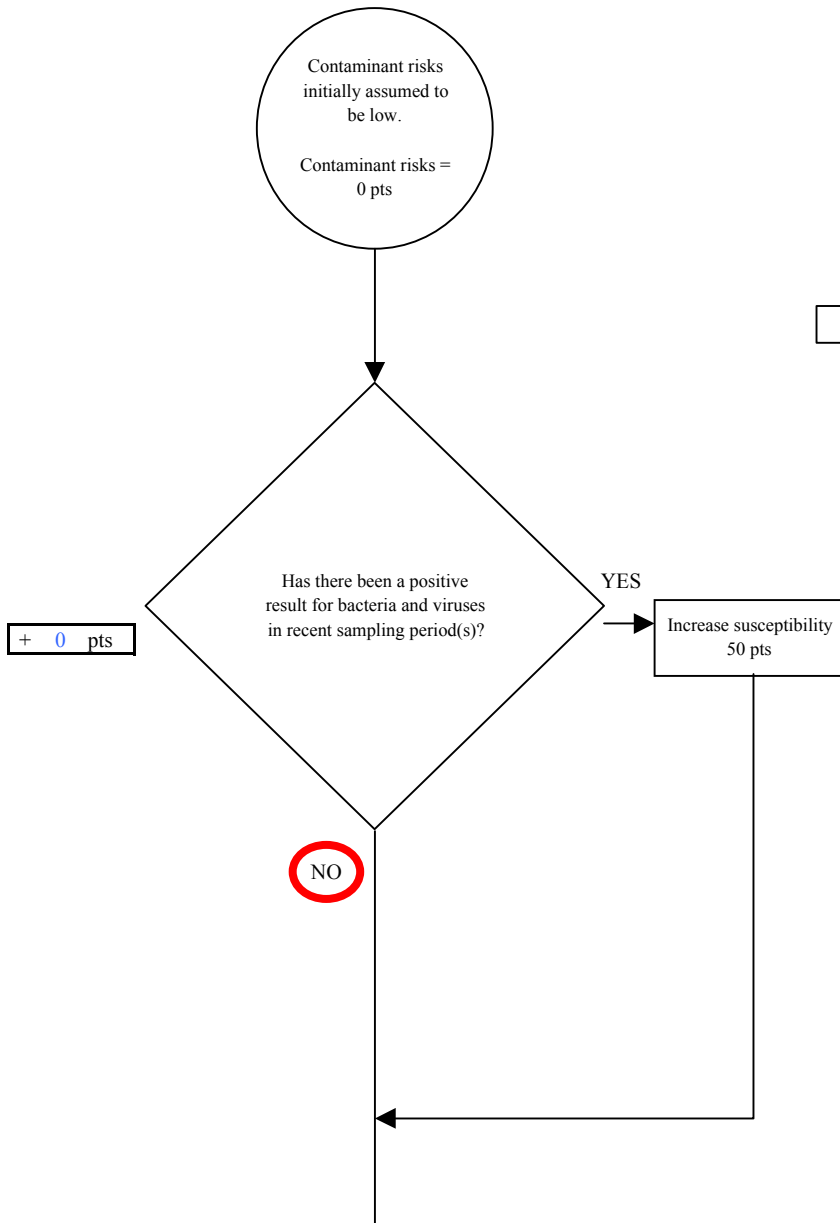



Risk Rankings for Contaminant Sources Identified in Zones A and B			
	Zone A	Zone B	Total
Very High(s)	0	0	0
High(s)	0	0	0
Medium(s)	2	0	2
Low(s)	4	0	4

	LOW 10 pts	<b>MEDIUM 20 pts</b>	HIGH 30 pts	VERY HIGH 40 pts
LOW	≥ 10 sources + 10 pts	≥ 10 sources + 5 pts	≥ 20 sources + 5 pts	----
MEDIUM	----	≥ 2 sources + 5 pts	≥ 5 sources + 5 pts	≥ 10 sources + 5 pts
HIGH	----	----	≥ 1 source + 10 pts	≥ 2 sources + 10 pts
VERY HIGH	----	----	----	≥ 1 source + 10 pts


Matrix Score 20

Note: Septic systems, sewerlines, and roads are each assigned a risk ranking for each individual contaminant source in the CSI. The VA, however, counts these contaminant sources as a group and assigns a calculated number of either "lows" or "mediums" based on the density.

**Chart 3. Contaminant risks for Glencaren Court - Bacteria & Viruses**

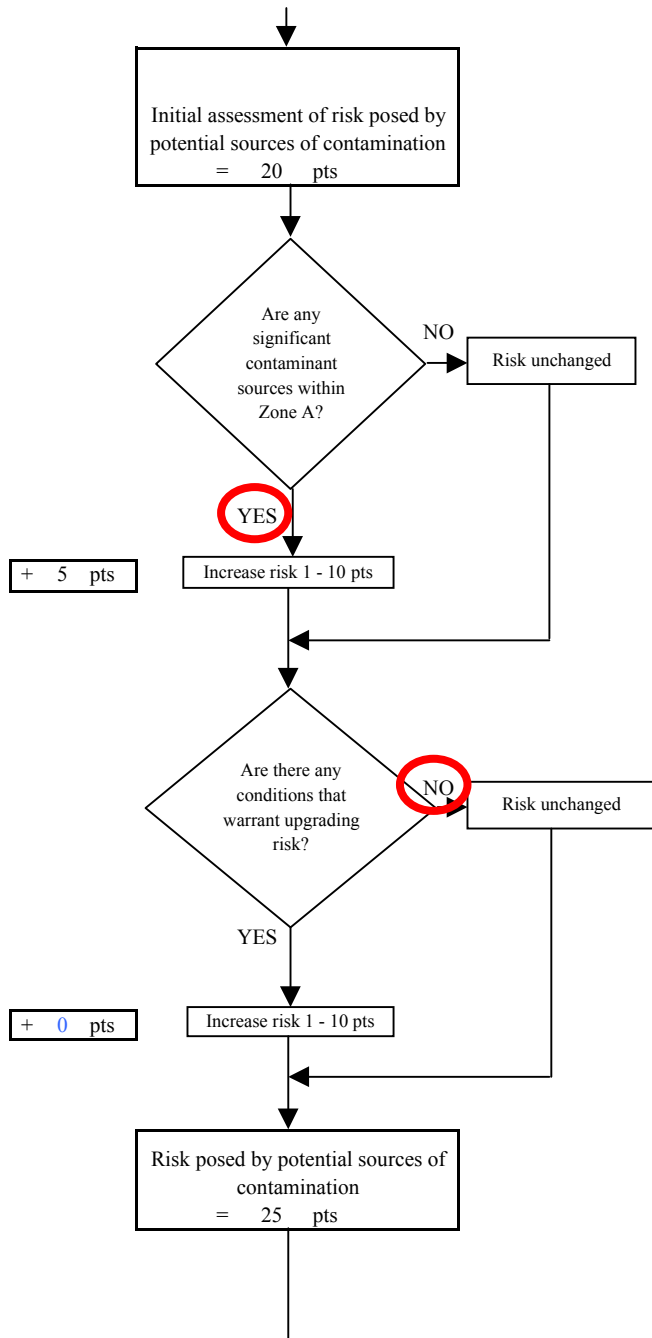

Contaminant Risk Ratings	
40 to 50 pts	very high
30 to < 40 pts	high
20 to < 30 pts	medium
< 20 pts	low

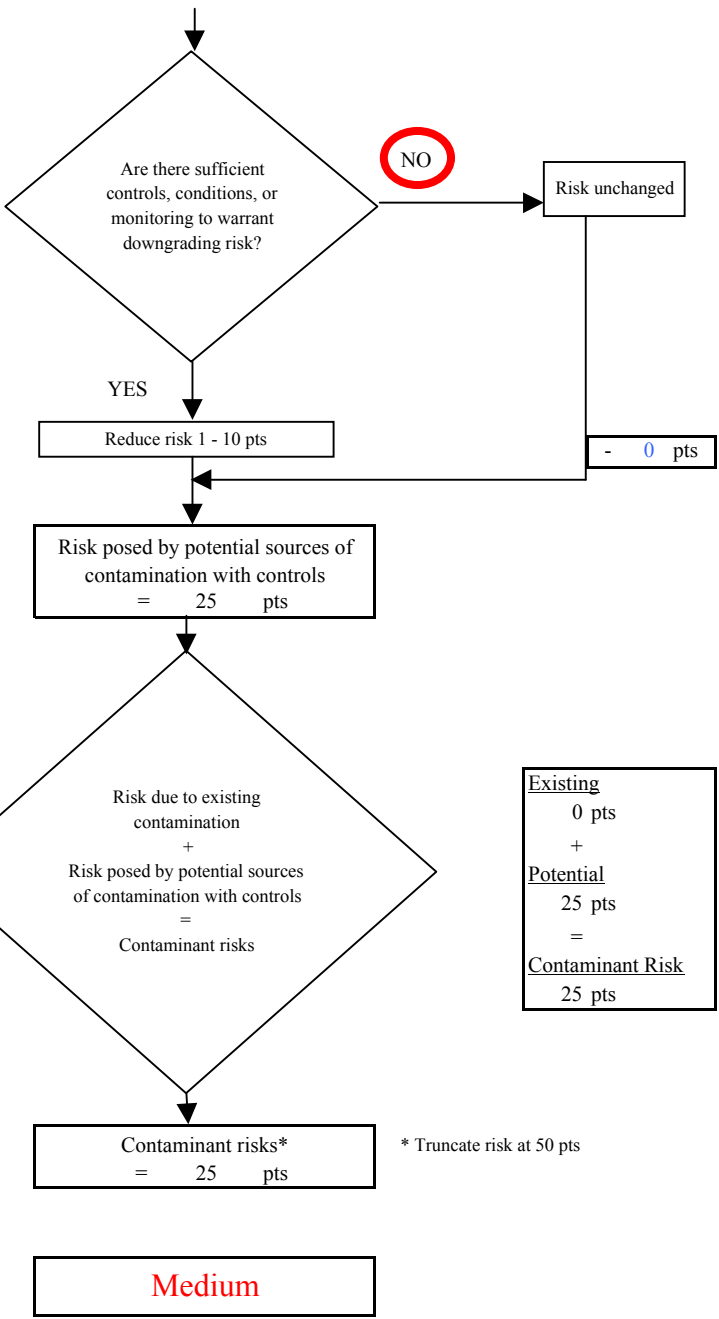

Existing	0 pts
+	
Potential	25 pts
=	
Contaminant Risk	25 pts

\* Truncate risk at 50 pts

**Chart 4. Vulnerability analysis for Glencaren Court - Bacteria & Viruses**

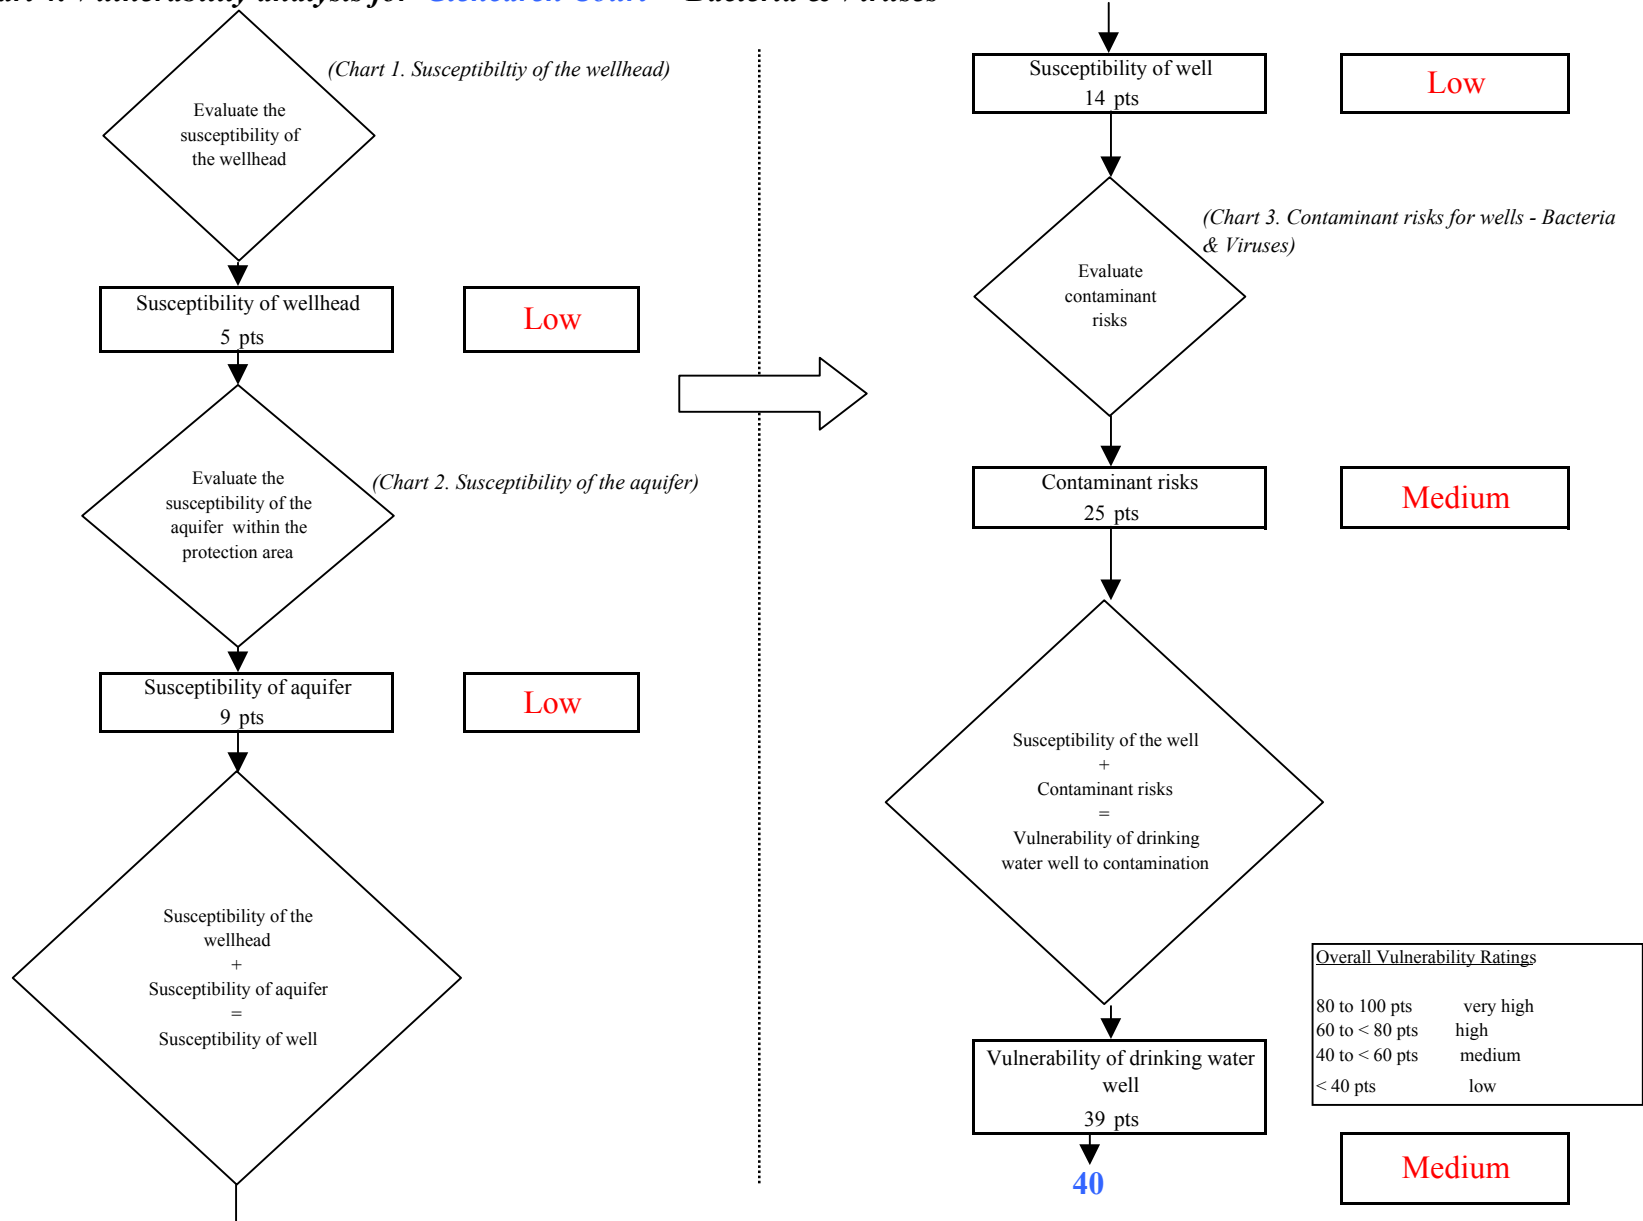


Chart 5. Contaminant risks for *Glencaren Court* - Nitrates and Nitrites


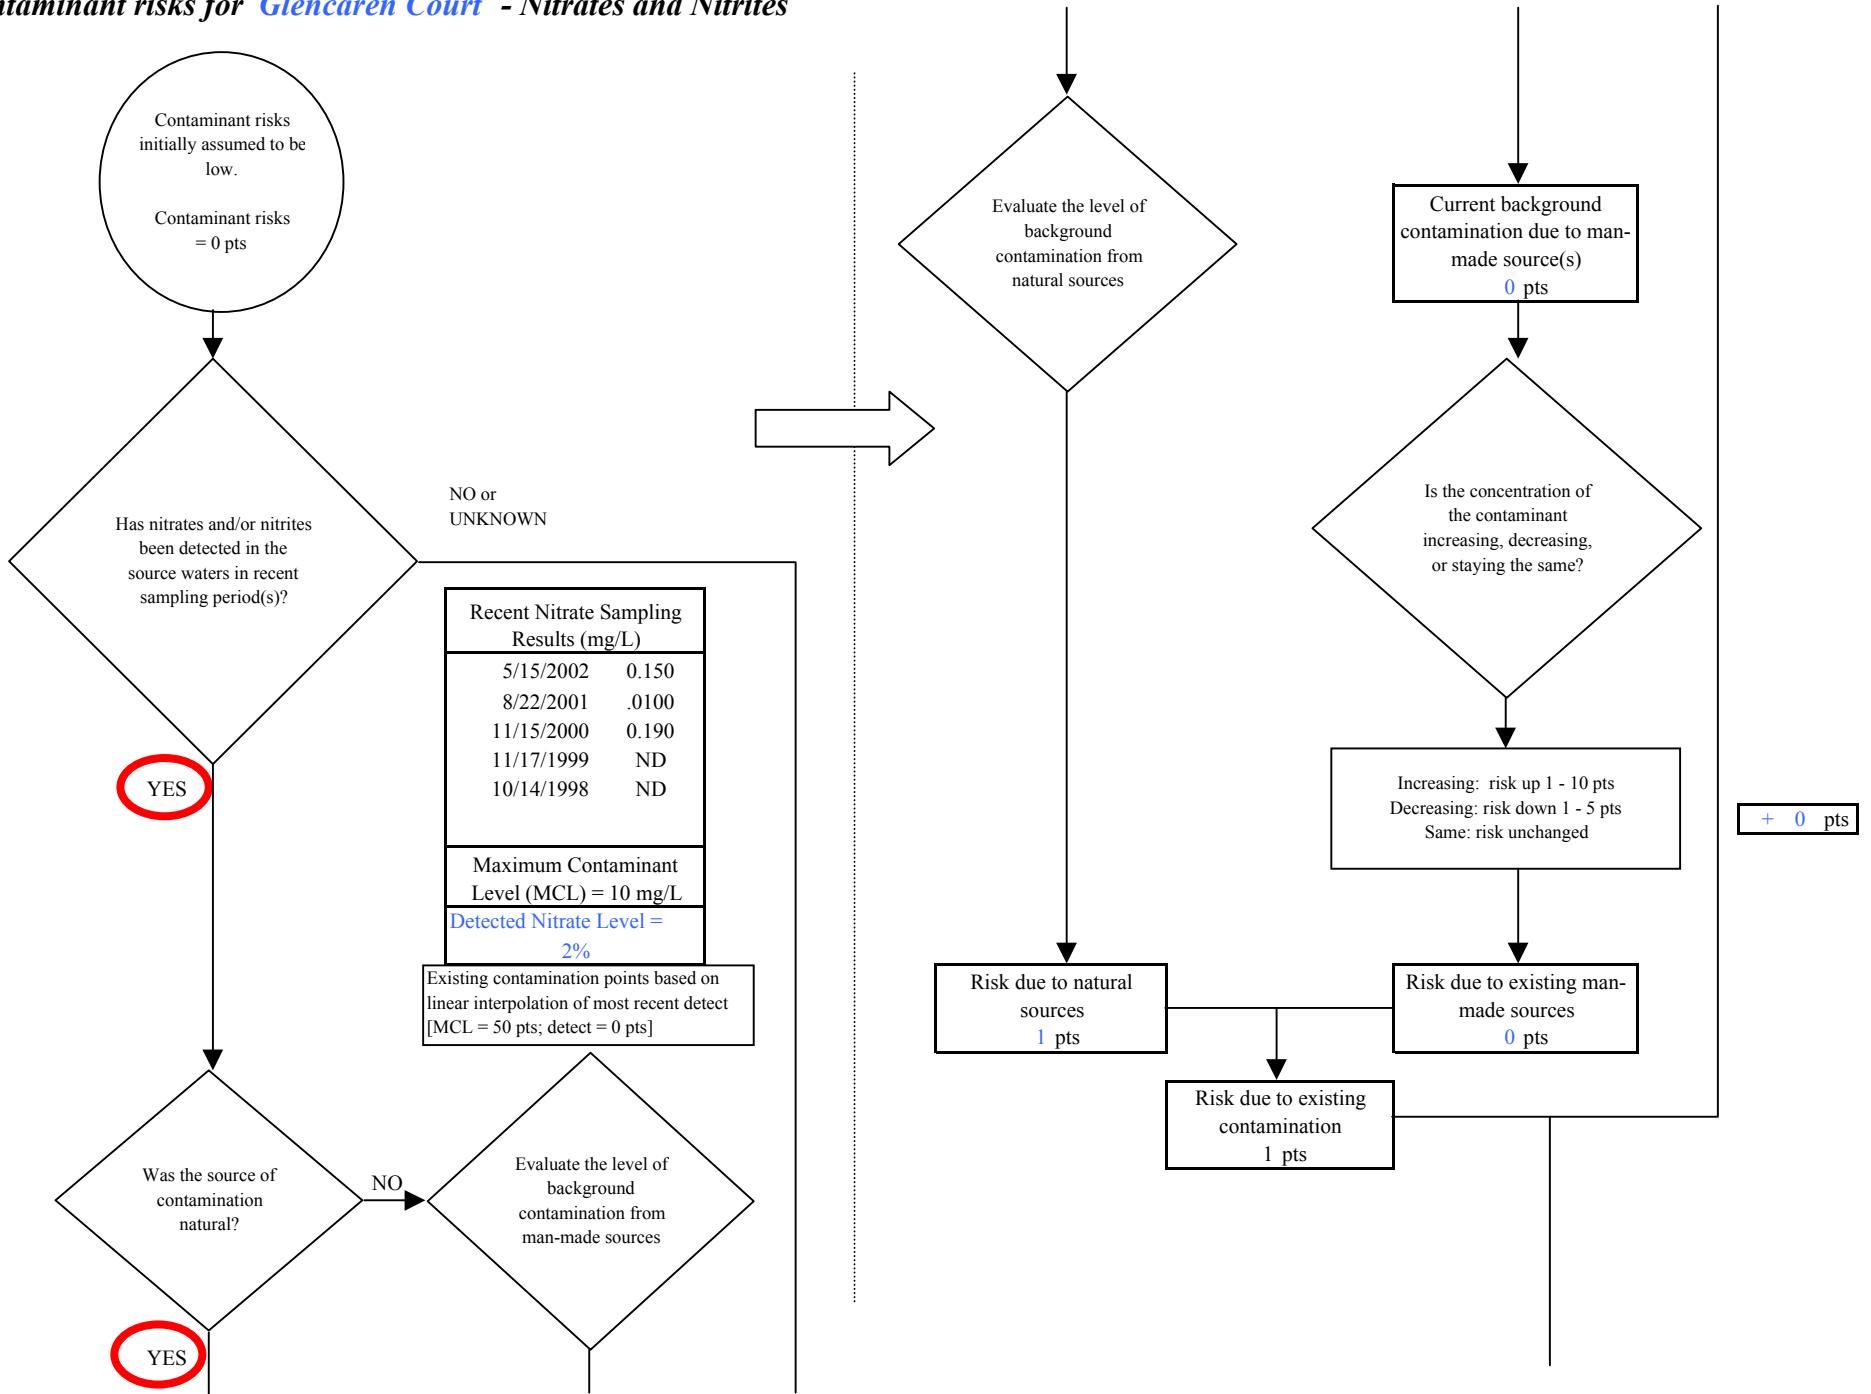


Chart 5. Contaminant risks for Glencaren Court - Nitrates and Nitrites


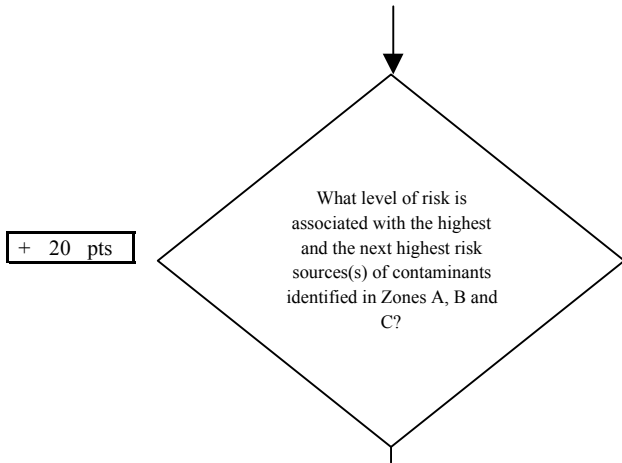


Risk Levels for Contaminant Sources identified in Zones A, B and C			
	Zone A	Zones B&C	Total
Very Highs(s)	0	0	0
High(s)	0	0	0
Medium(s)	2	0	2
Low(s)	4	0	4




	LOW 10 pts	<b>MEDIUM 20 pts</b>	HIGH 30 pts	VERY HIGH 40 pts
LOW	≥ 10 sources + 10 pts	≥ 10 sources + 5 pts	≥ 20 sources + 5 pts	----
MEDIUM	----	≥ 2 sources + 5 pts	≥ 5 sources + 5 pts	≥ 10 sources + 5 pts
HIGH	----	----	≥ 1 source + 10 pts	≥ 2 sources + 10 pts
VERY HIGH	----	----	----	≥ 1 source + 10 pts

Matrix Score 20

Note: Septic systems, sewerlines, and roads are each assigned a risk ranking for each individual contaminant source in the CSI. The VA, however, counts these contaminant sources as a group and assigns a calculated number of either "lows" or "mediums" based on the density.

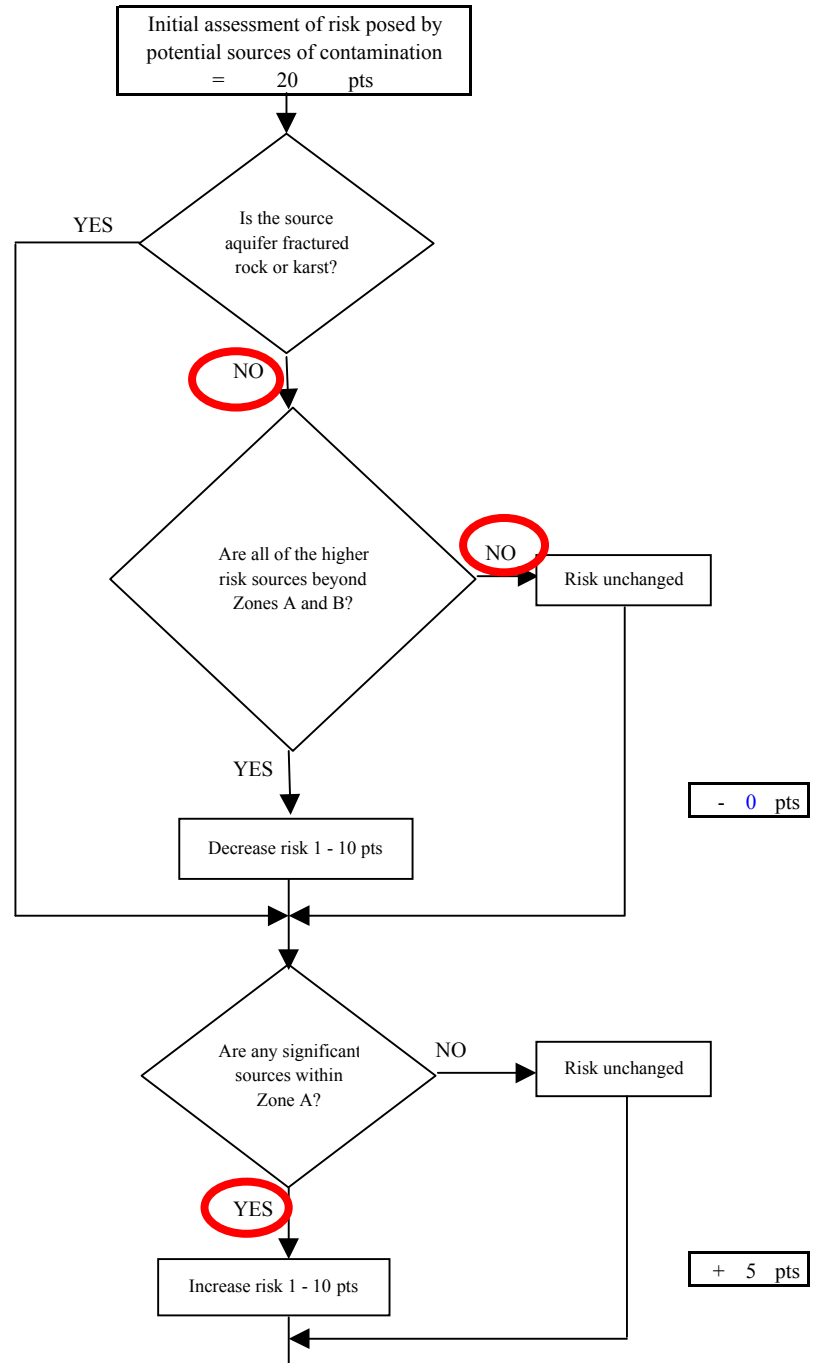

**Chart 5. Contaminant risks for Glencaren Court - Nitrates and Nitrites**

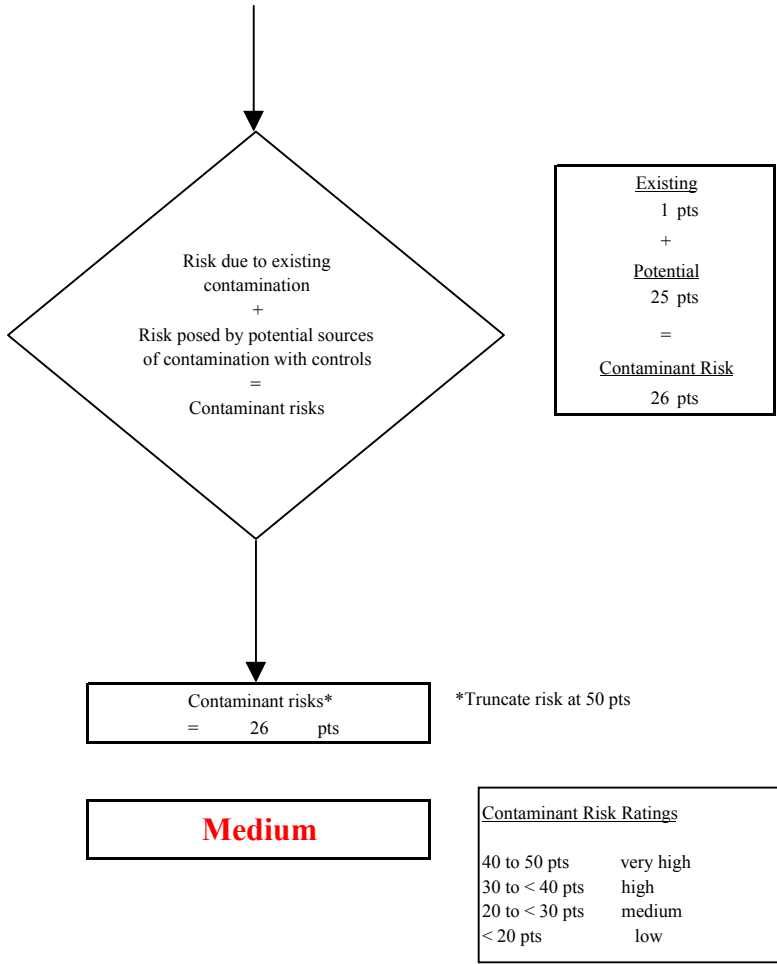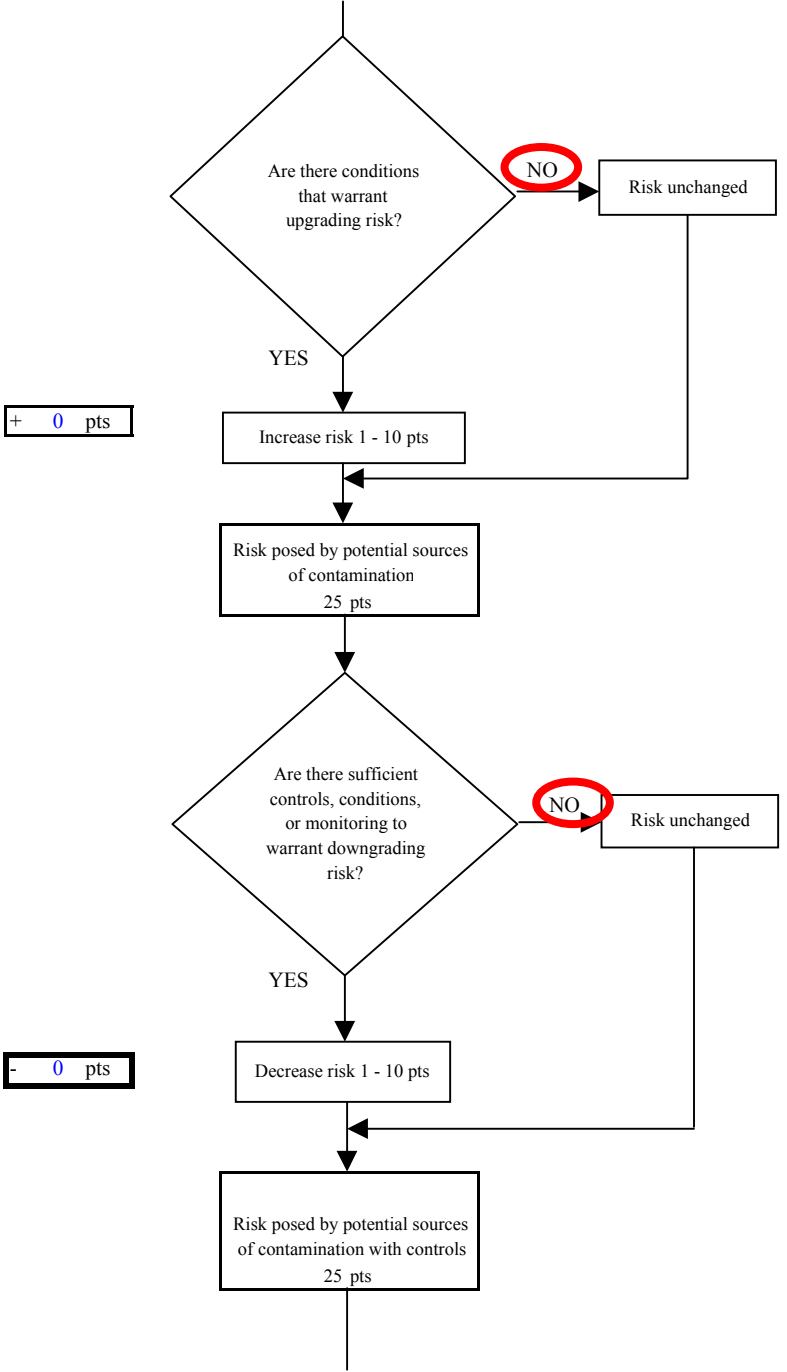

**Chart 6. Vulnerability analysis for Glencaren Court - Nitrates and Nitrites**



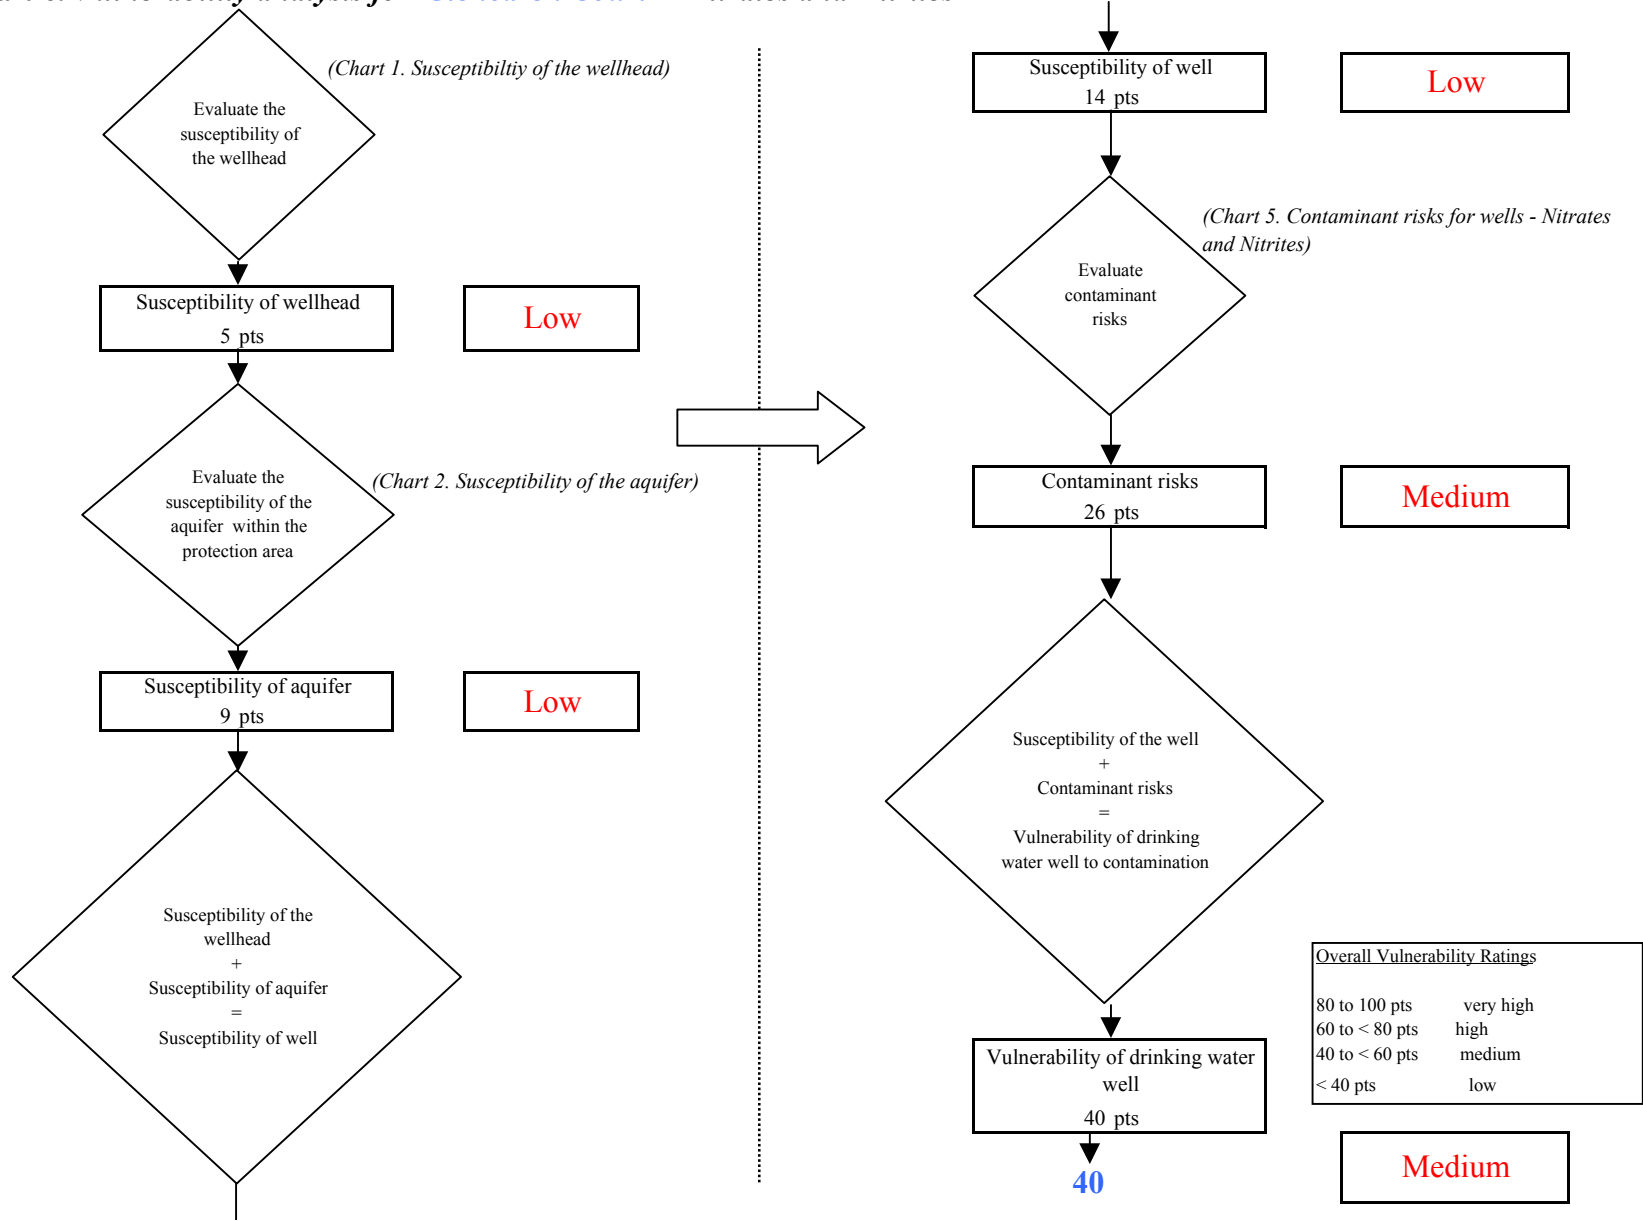


Chart 7. Contaminant risks for *Glencaren Court* - Volatile Organic Chemicals



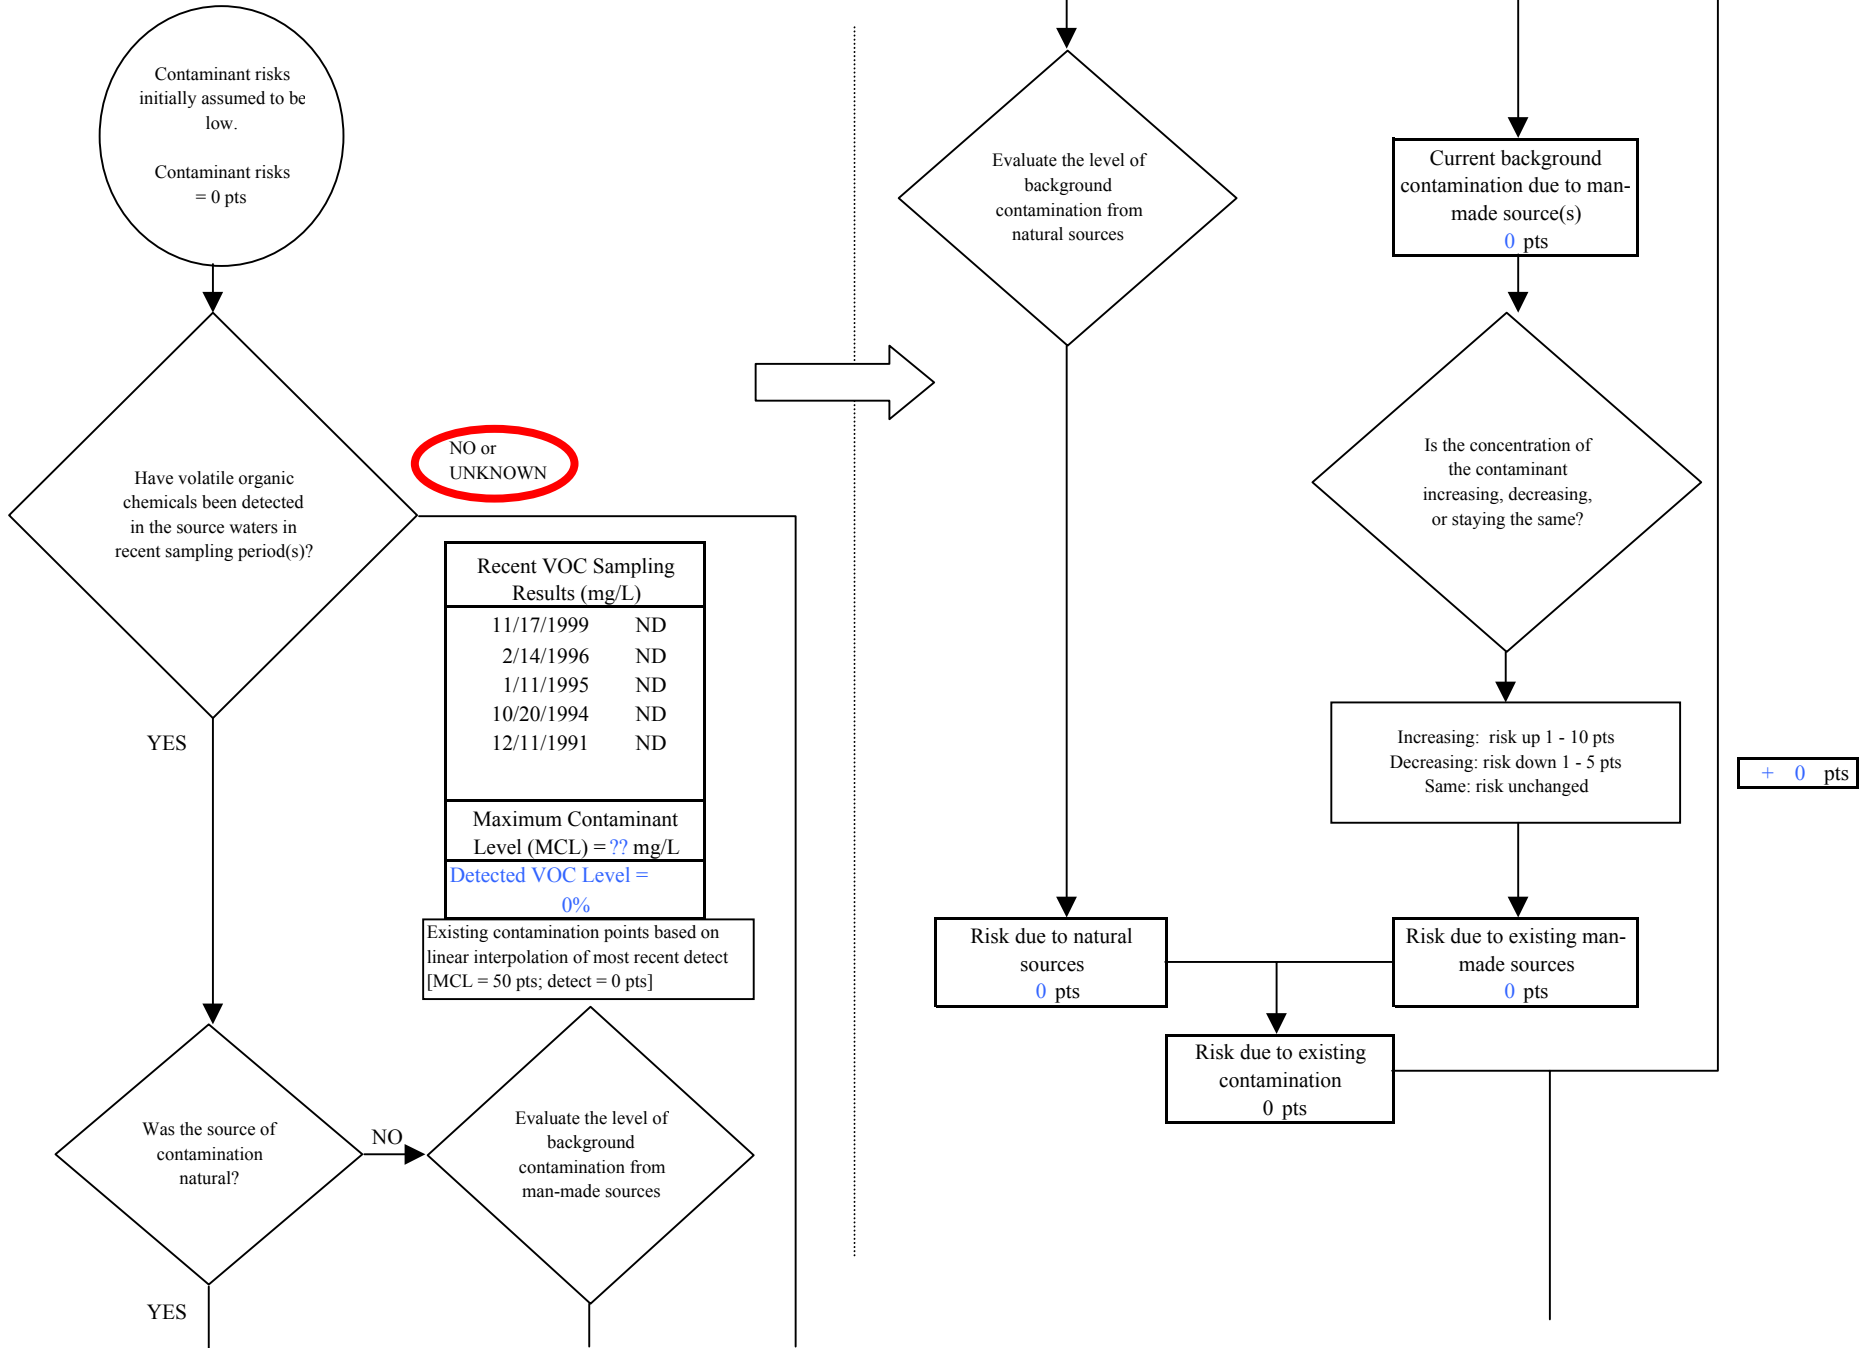

**Chart 7. Contaminant risks for Glencaren Court - Volatile Organic Chemicals**


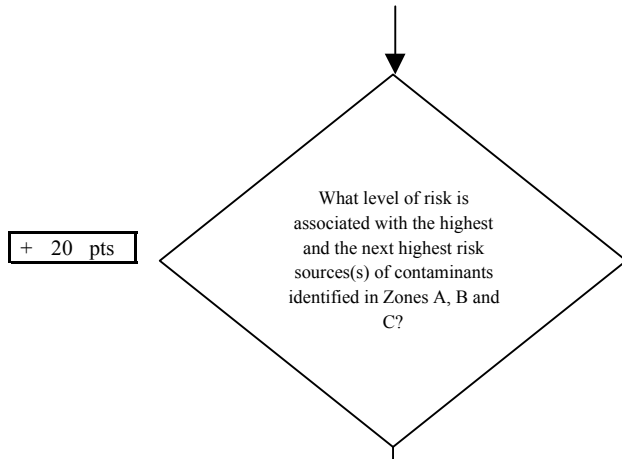


Risk Levels for Contaminant Sources identified in Zones A, B and C			
	Zone A	Zones B&C	Total
Very Highs(s)	0	0	0
High(s)	0	0	0
Medium(s)	1	0	1
Low(s)	6	0	6




	LOW 10 pts	<b>MEDIUM 20 pts</b>	HIGH 30 pts	VERY HIGH 40 pts
<b>LOW</b>	≥ 10 sources + 10 pts	≥ 10 sources + 5 pts	≥ 20 sources + 5 pts	----
<b>MEDIUM</b>	----	≥ 2 sources + 5 pts	≥ 5 sources + 5 pts	≥ 10 sources + 5 pts
<b>HIGH</b>	----	----	≥ 1 source + 10 pts	≥ 2 sources + 10 pts
<b>VERY HIGH</b>	----	----	----	≥ 1 source + 10 pts

Matrix Score      20

Note: Septic systems, sewerlines, and roads are each assigned a risk ranking for each individual contaminant source in the CSI. The VA, however, counts these contaminant sources as a group and assigns a calculated number of either "lows" or "mediums" based on the density.

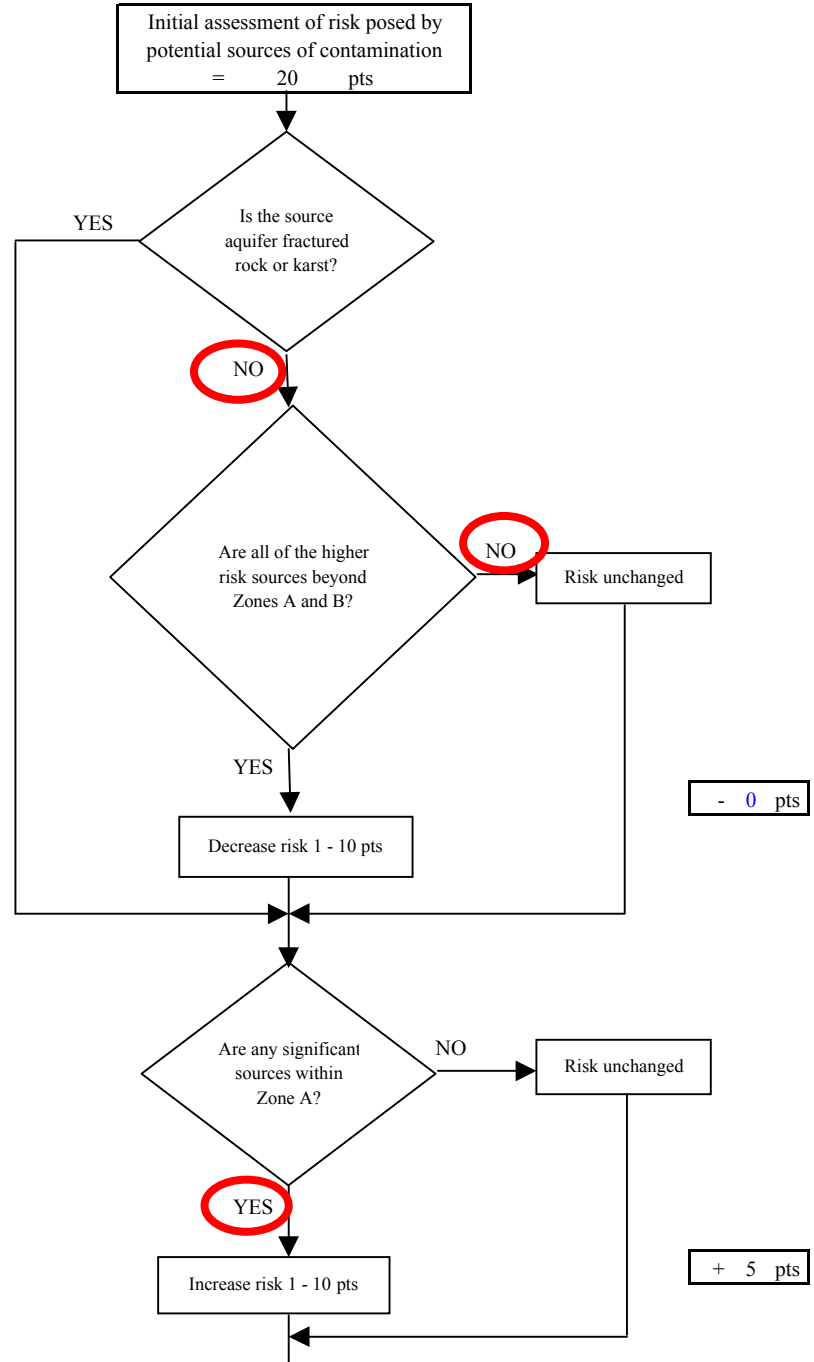

**Chart 7. Contaminant risks for Glencaren Court - Volatile Organic Chemicals**

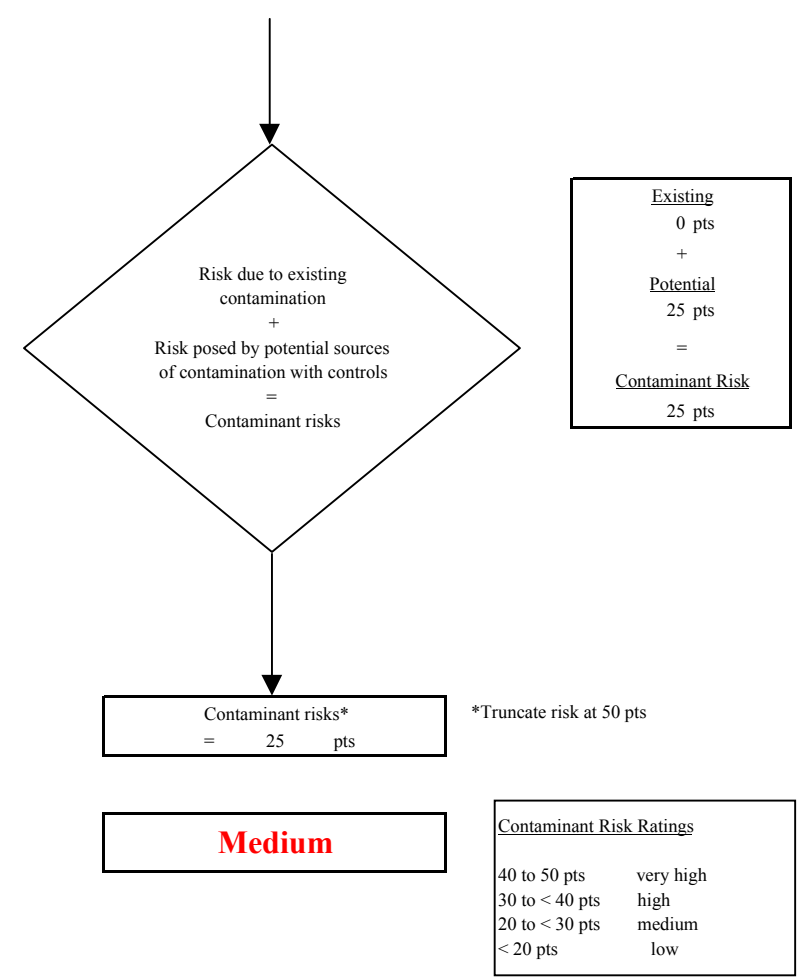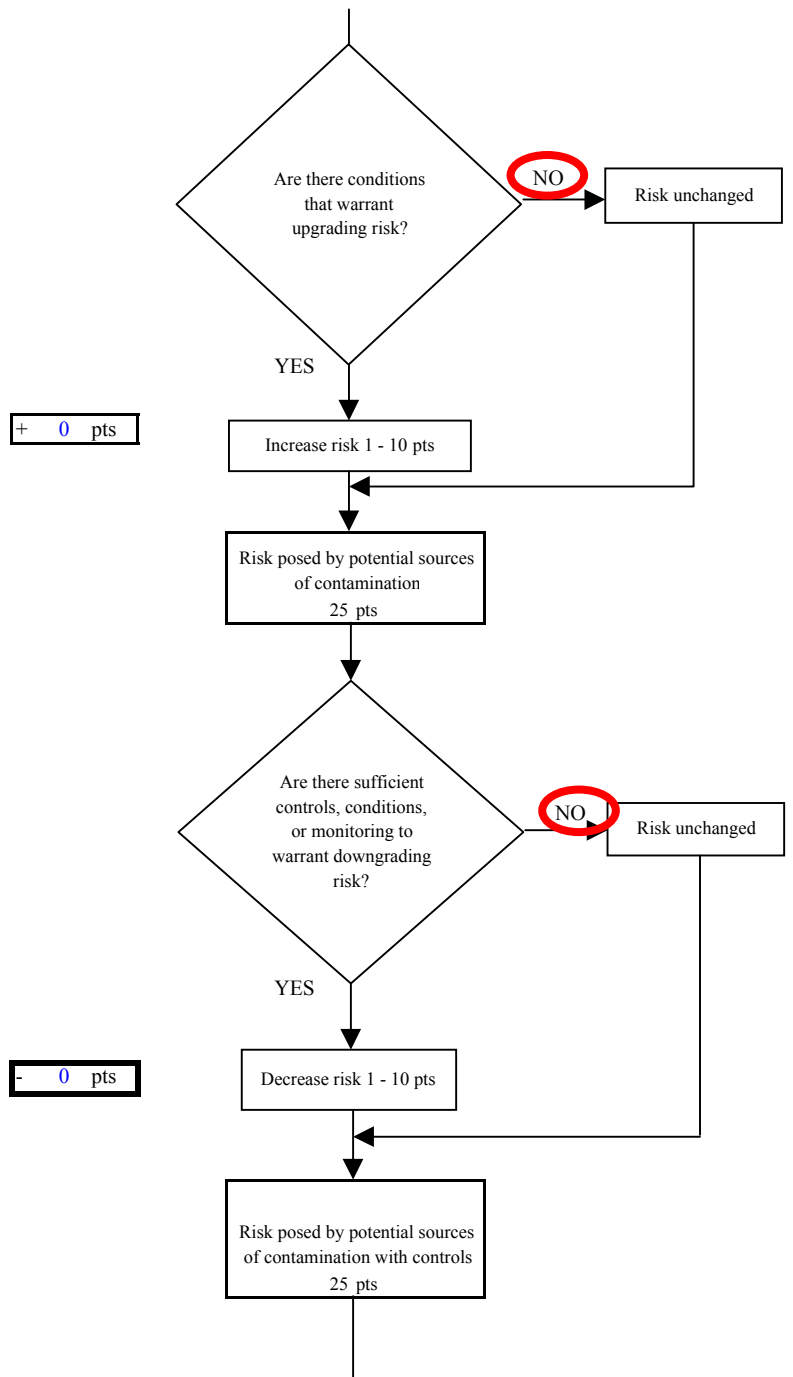

**Chart 8. Vulnerability analysis for Glencaren Court - Volatile Organic Chemicals**



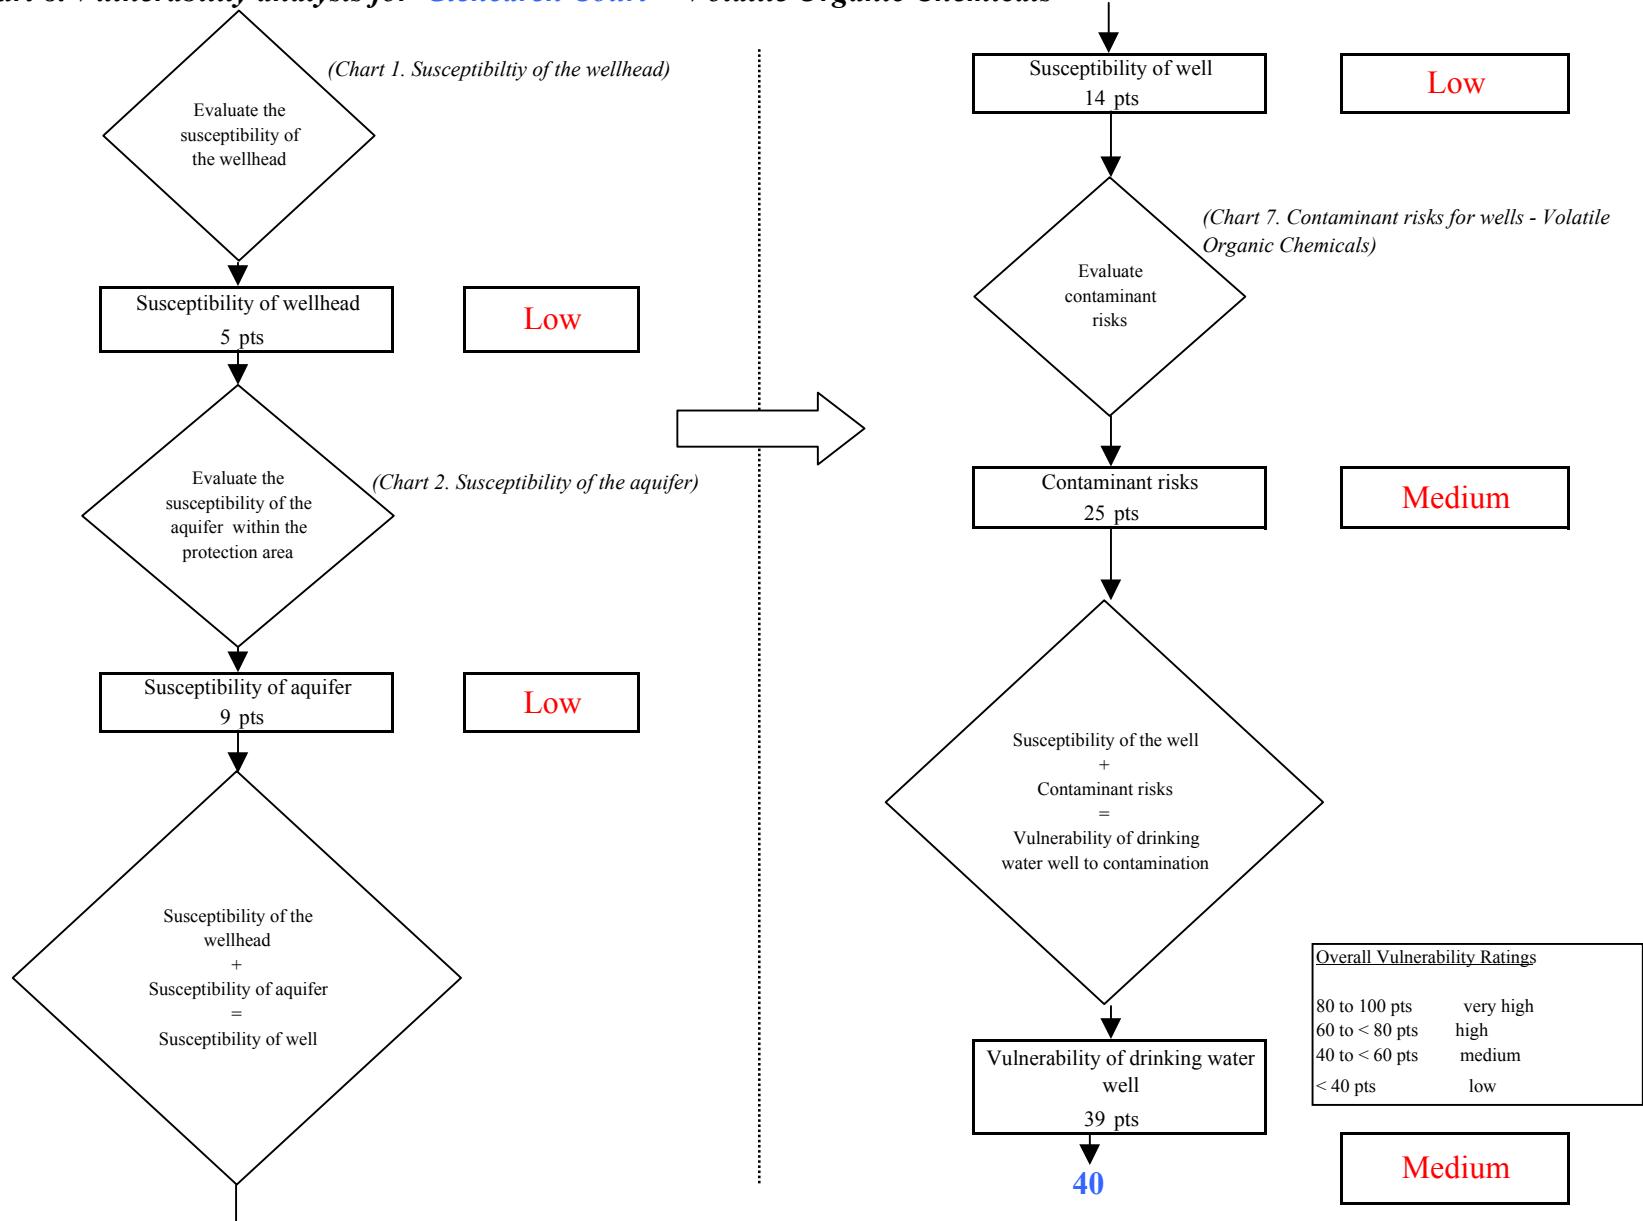


Chart 9. Contaminant risks for *Glencaren Court* - Heavy Metals, Cyanide and Other Inorganic Chemicals

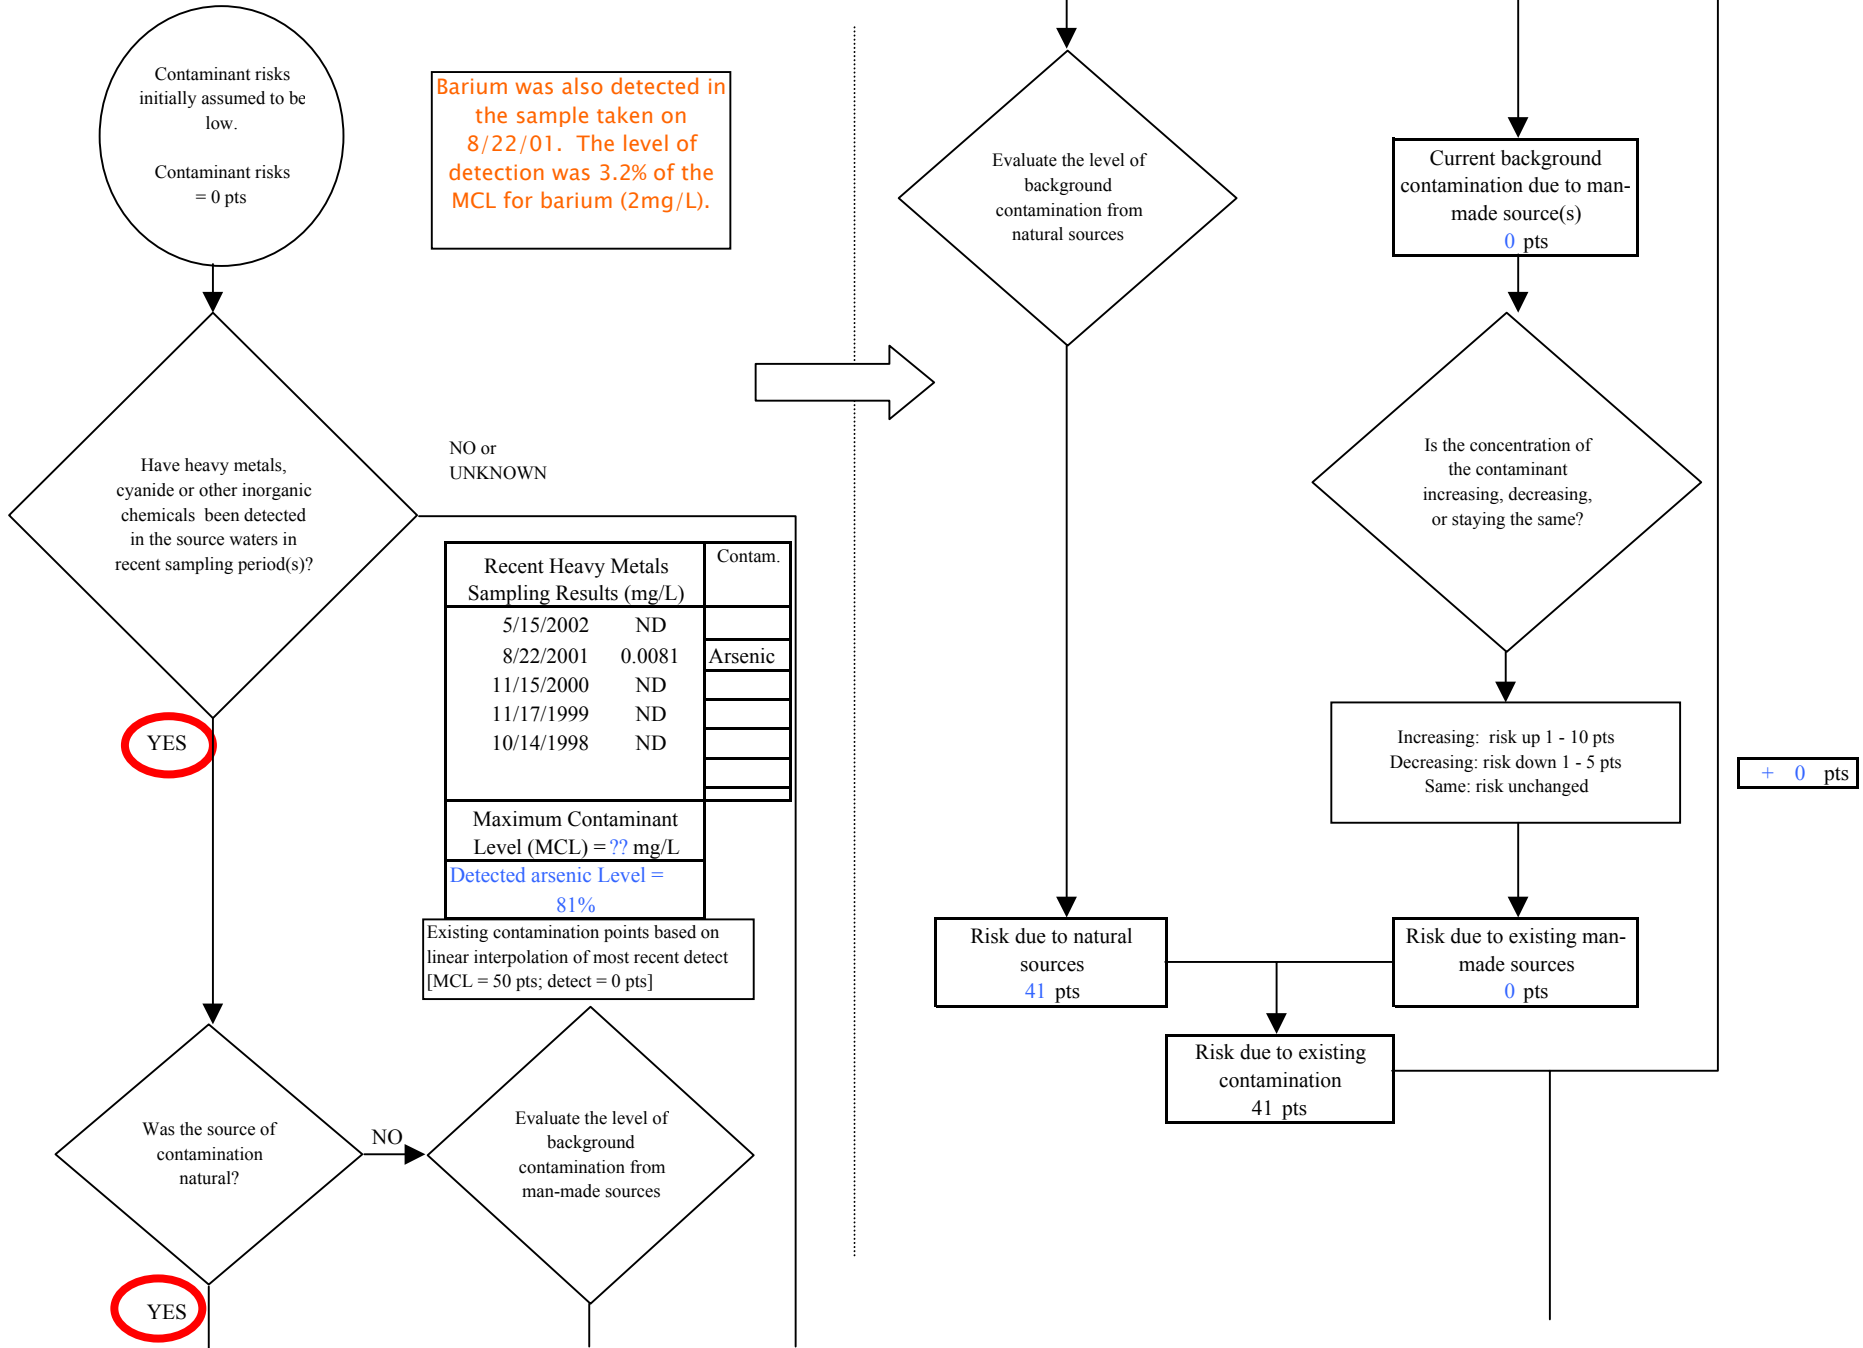

**Chart 9. Contaminant risks for Glencaren Court - Heavy Metals, Cyanide and Other Inorganic Chemicals**

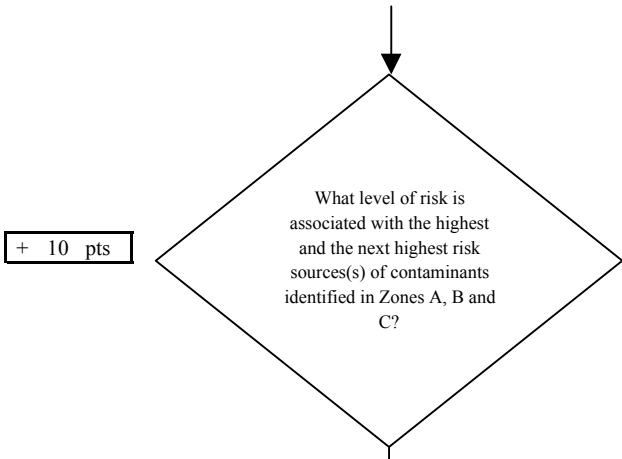



+ 10 pts

Risk Levels for Contaminant Sources identified in Zones A, B and C			
	Zone A	Zones B&C	Total
Very Highs(s)	0	0	0
High(s)	0	0	0
Medium(s)	0	0	0
Low(s)	4	0	4


	<b>LOW</b> 10 pts	<b>MEDIUM</b> 20 pts	<b>HIGH</b> 30 pts	<b>VERY HIGH</b> 40 pts
<b>LOW</b>	≥ 10 sources + 10 pts	≥ 10 sources + 5 pts	≥ 20 sources + 5 pts	----
<b>MEDIUM</b>	----	≥ 2 sources + 5 pts	≥ 5 sources + 5 pts	≥ 10 sources + 5 pts
<b>HIGH</b>	----	----	≥ 1 source + 10 pts	≥ 2 sources + 10 pts
<b>VERY HIGH</b>	----	----	----	≥ 1 source + 10 pts

Matrix Score 10

Note: Septic systems, sewerlines, and roads are each assigned a risk ranking for each individual contaminant source in the CSI. The VA, however, counts these contaminant sources as a group and assigns a calculated number of either "lows" or "mediums" based on the density.

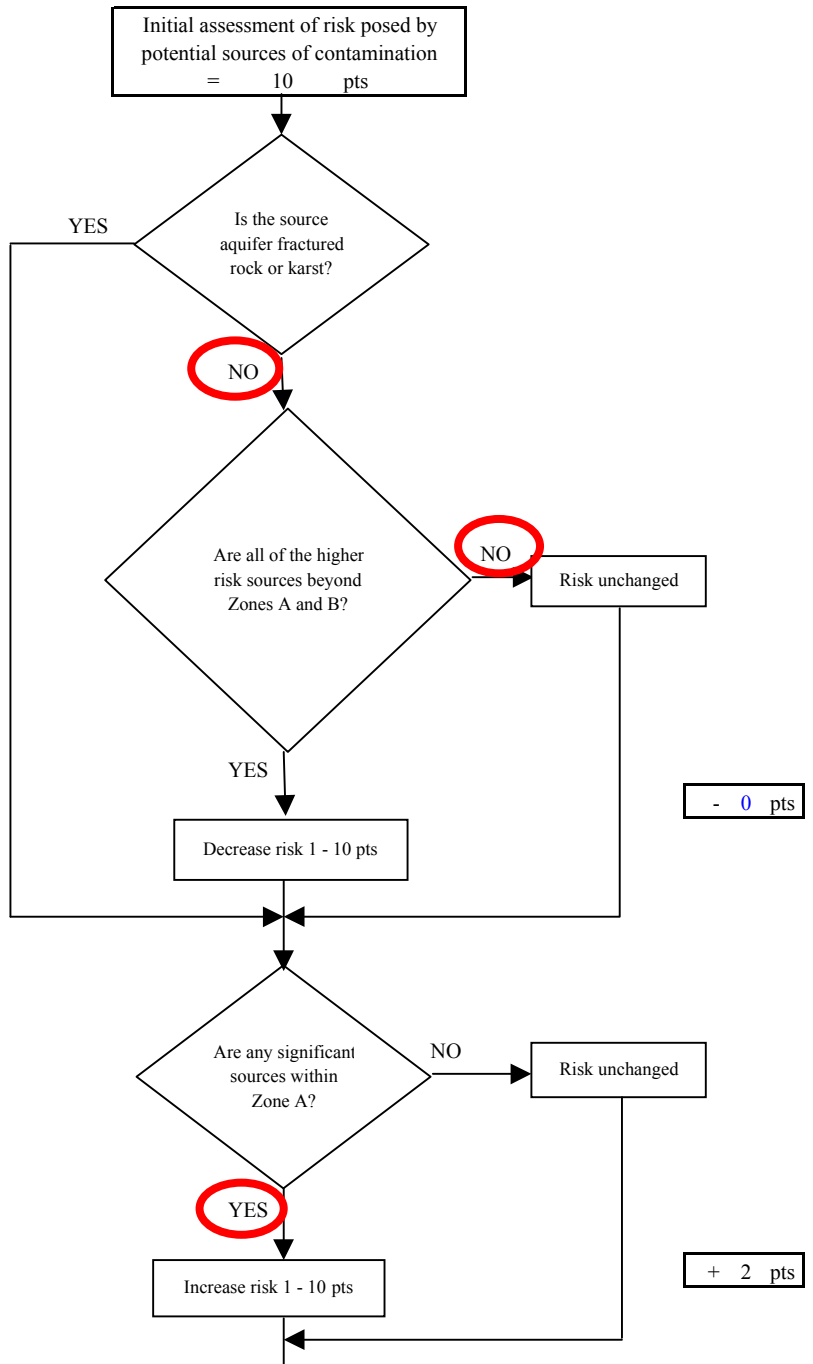

**Chart 9. Contaminant risks for Glencaren Court - Heavy Metals, Cyanide and Other Inorganic Chemicals**

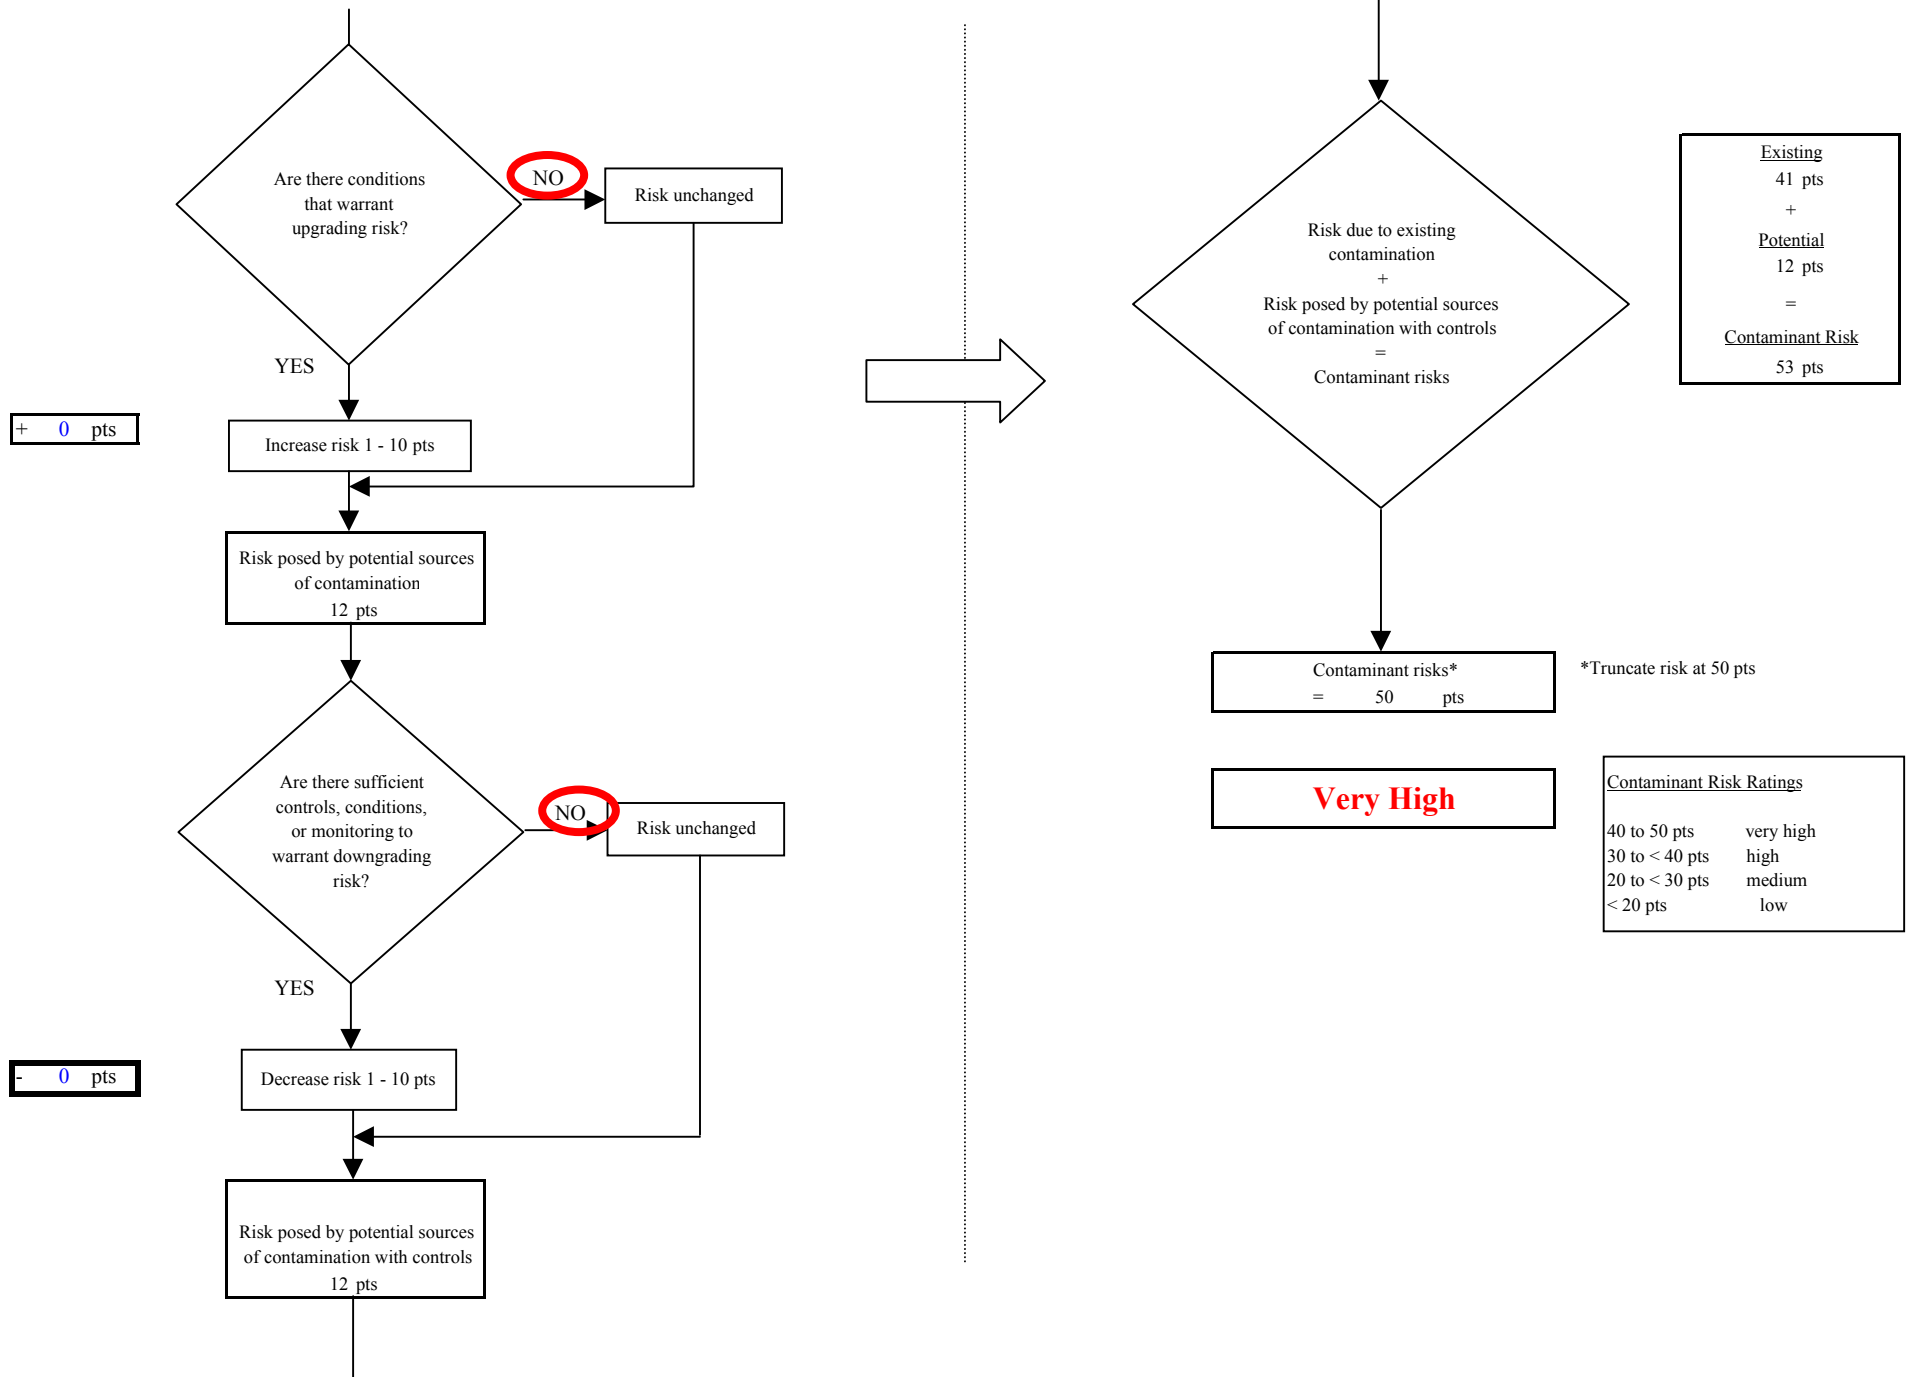

**Chart 10. Vulnerability analysis for *Glencaren Court* - Heavy Metals, Cyanide and Other Inorganic Chemicals**



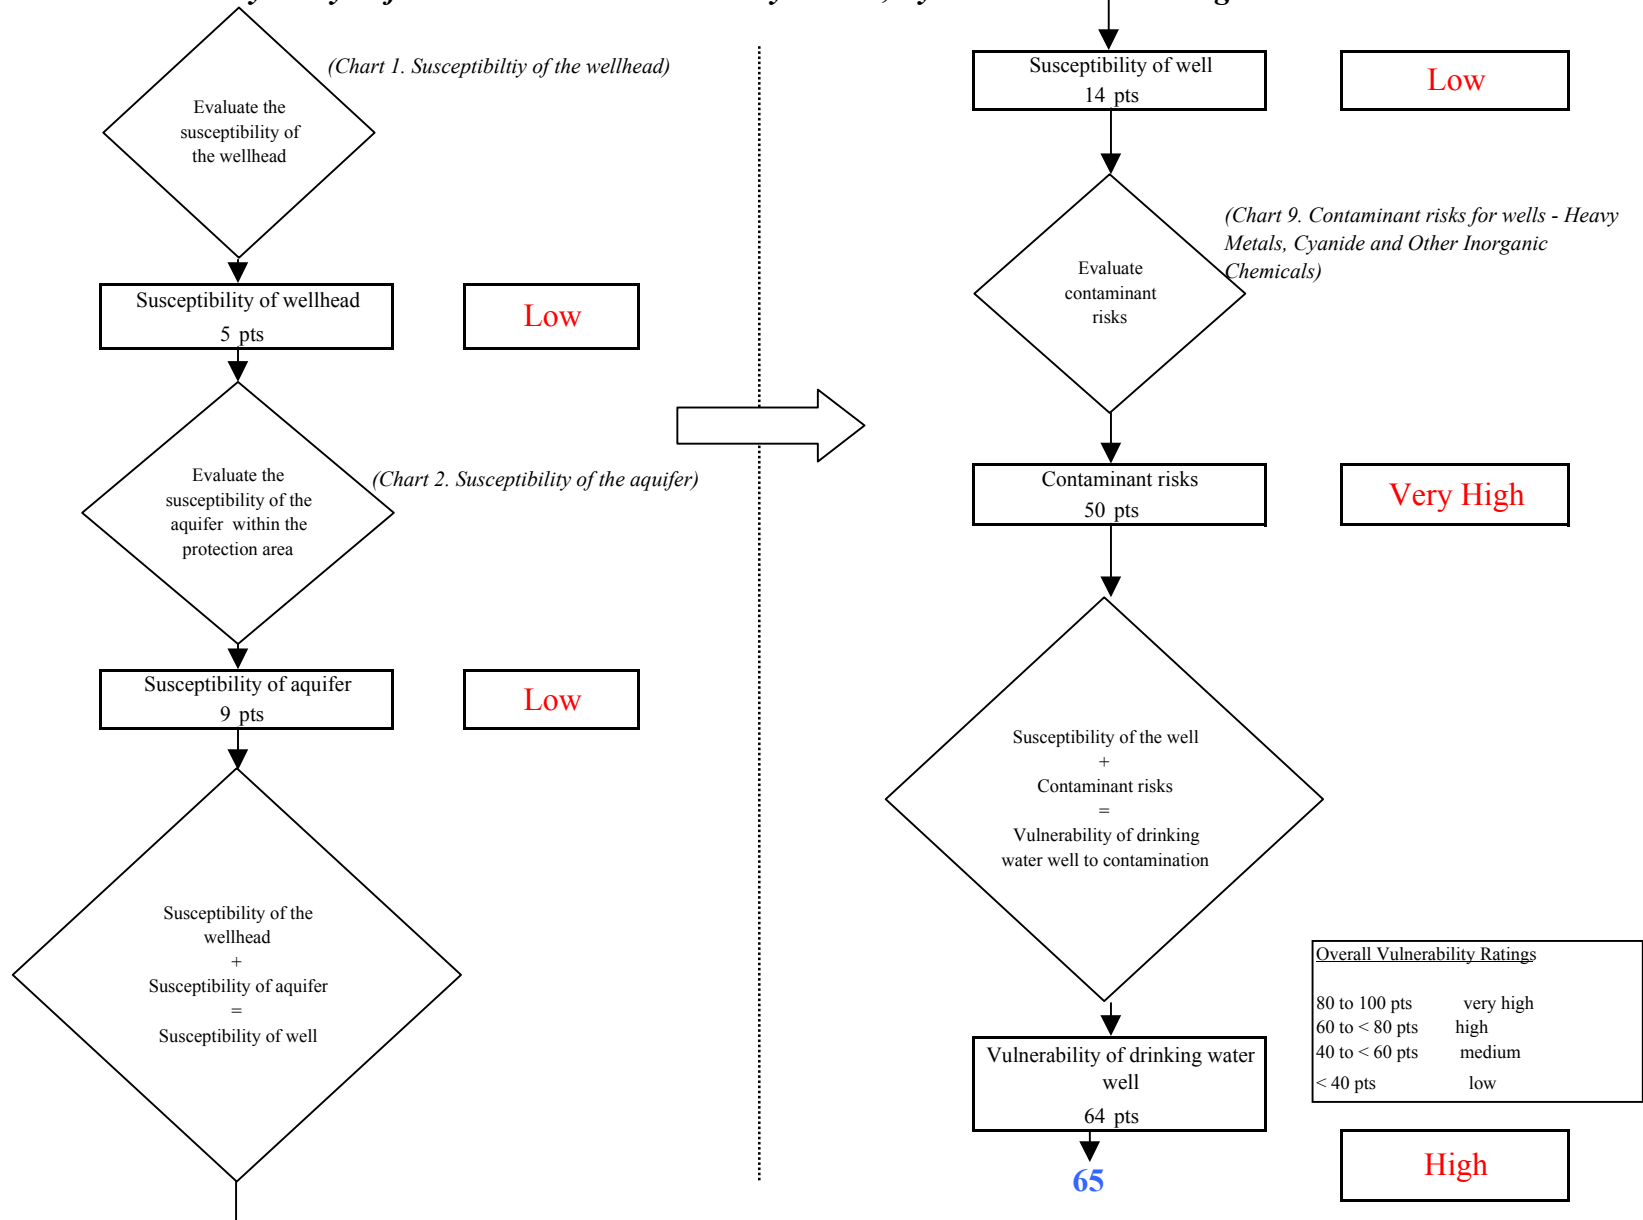


Chart 11. Contaminant risks for *Glencaren Court* - Synthetic Organic Chemicals



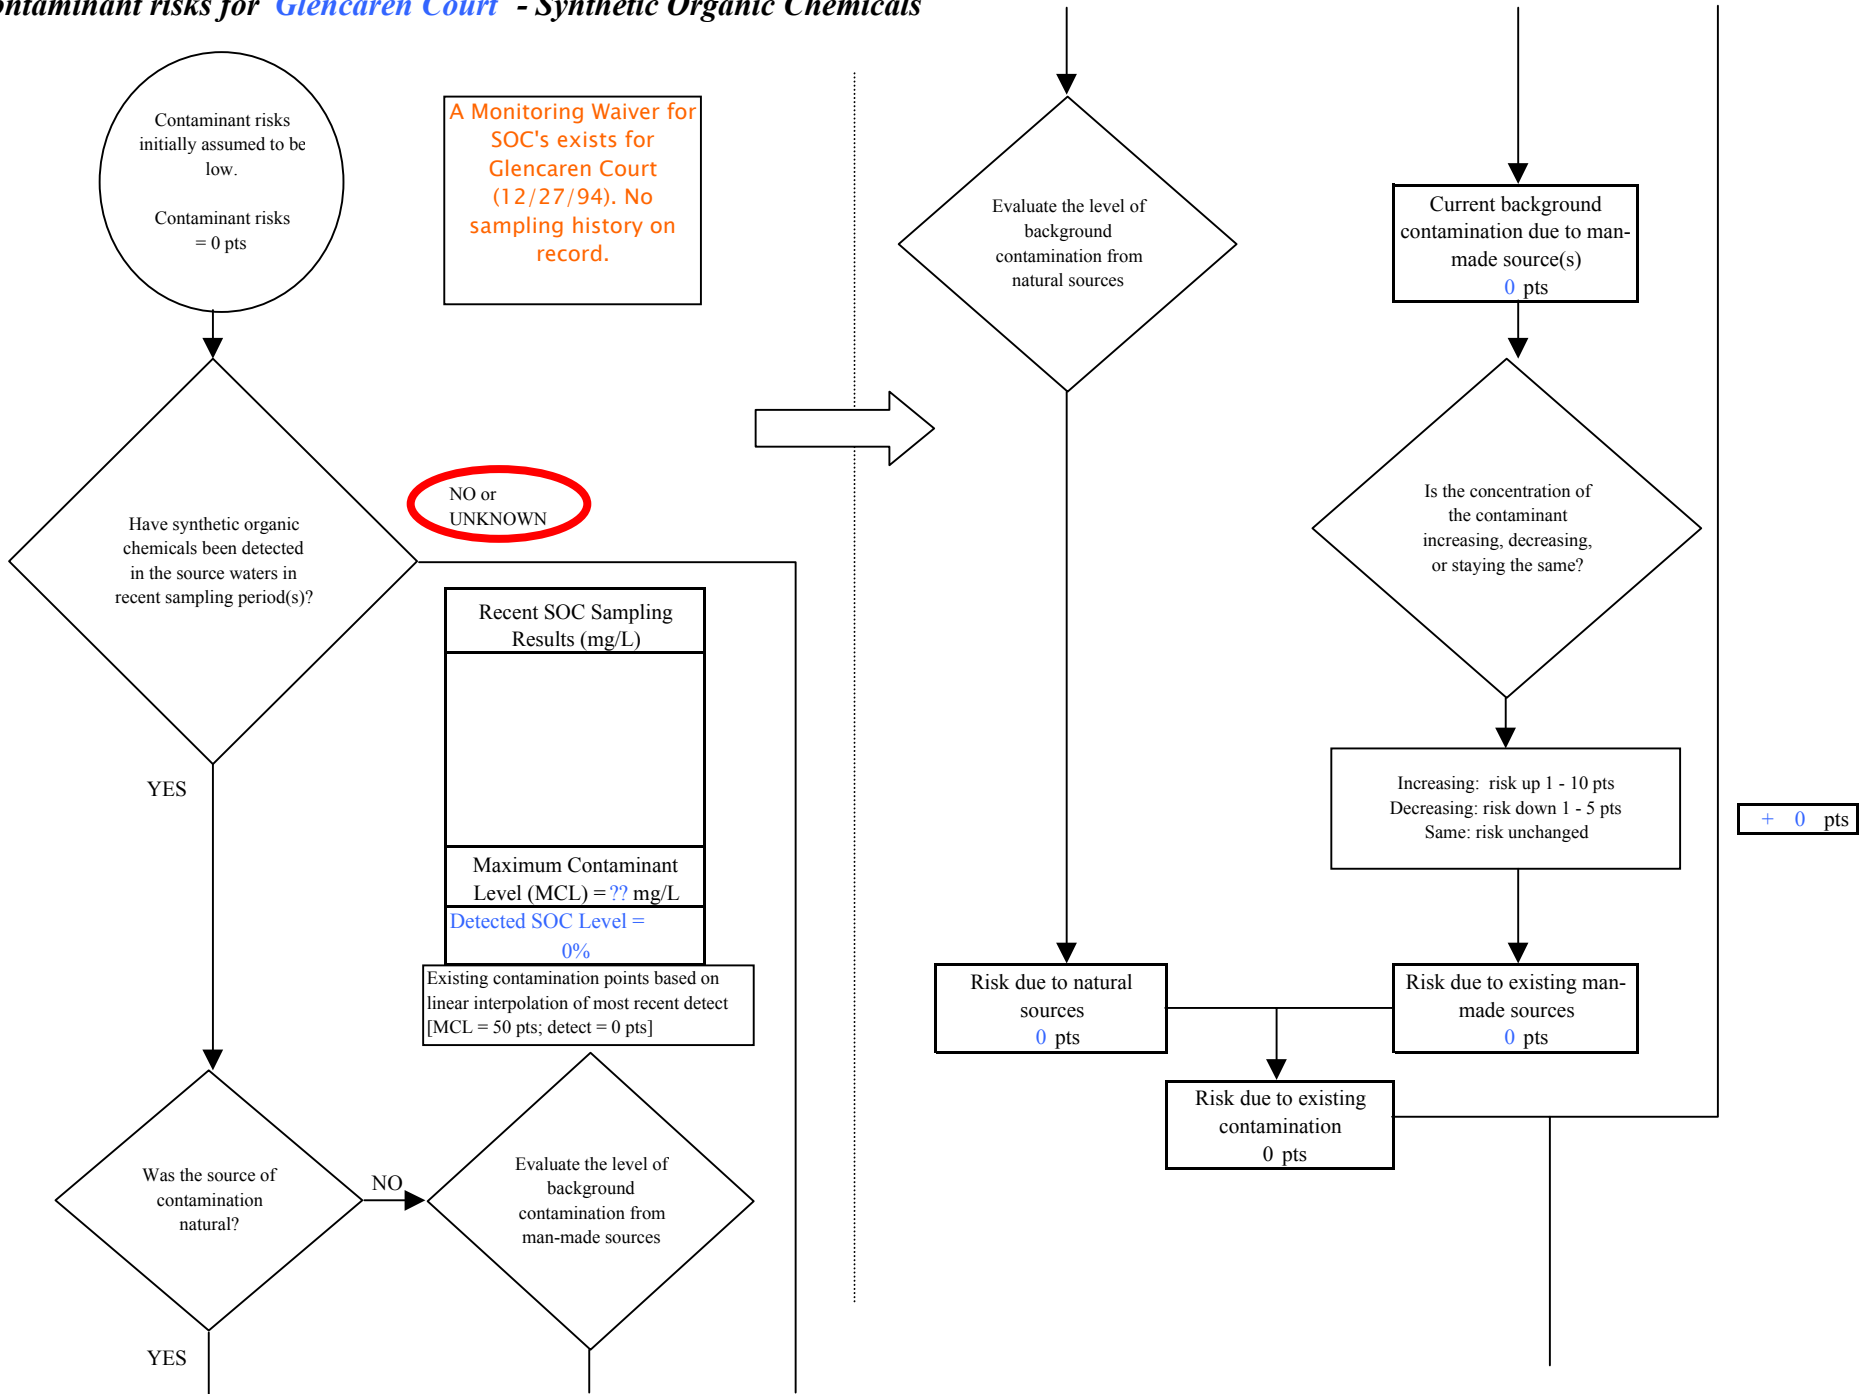

**Chart 11. Contaminant risks for Glencaren Court - Synthetic Organic Chemicals**


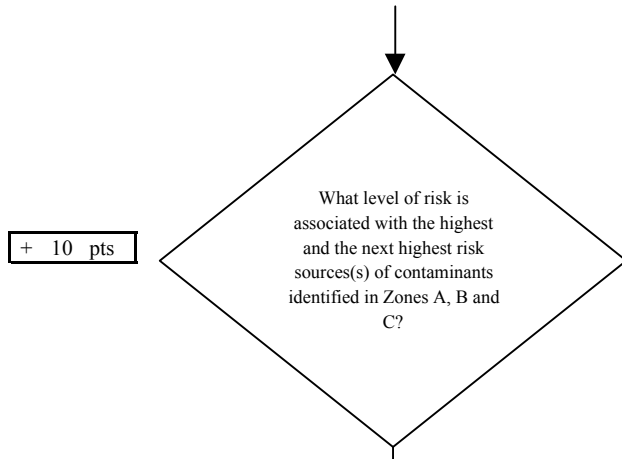


Risk Levels for Contaminant Sources identified in Zones A, B and C			
	Zone A	Zones B&C	Total
Very Highs(s)	0	0	0
High(s)	0	0	0
Medium(s)	0	0	0
Low(s)	2	0	2


	<b>LOW</b> 10 pts	<b>MEDIUM</b> 20 pts	<b>HIGH</b> 30 pts	<b>VERY HIGH</b> 40 pts
<b>LOW</b>	≥ 10 sources + 10 pts	≥ 10 sources + 5 pts	≥ 20 sources + 5 pts	----
<b>MEDIUM</b>	----	≥ 2 sources + 5 pts	≥ 5 sources + 5 pts	≥ 10 sources + 5 pts
<b>HIGH</b>	----	----	≥ 1 source + 10 pts	≥ 2 sources + 10 pts
<b>VERY HIGH</b>	----	----	----	≥ 1 source + 10 pts

Matrix Score      10

Note: Septic systems, sewerlines, and roads are each assigned a risk ranking for each individual contaminant source in the CSI. The VA, however, counts these contaminant sources as a group and assigns a calculated number of either "lows" or "mediums" based on the density.

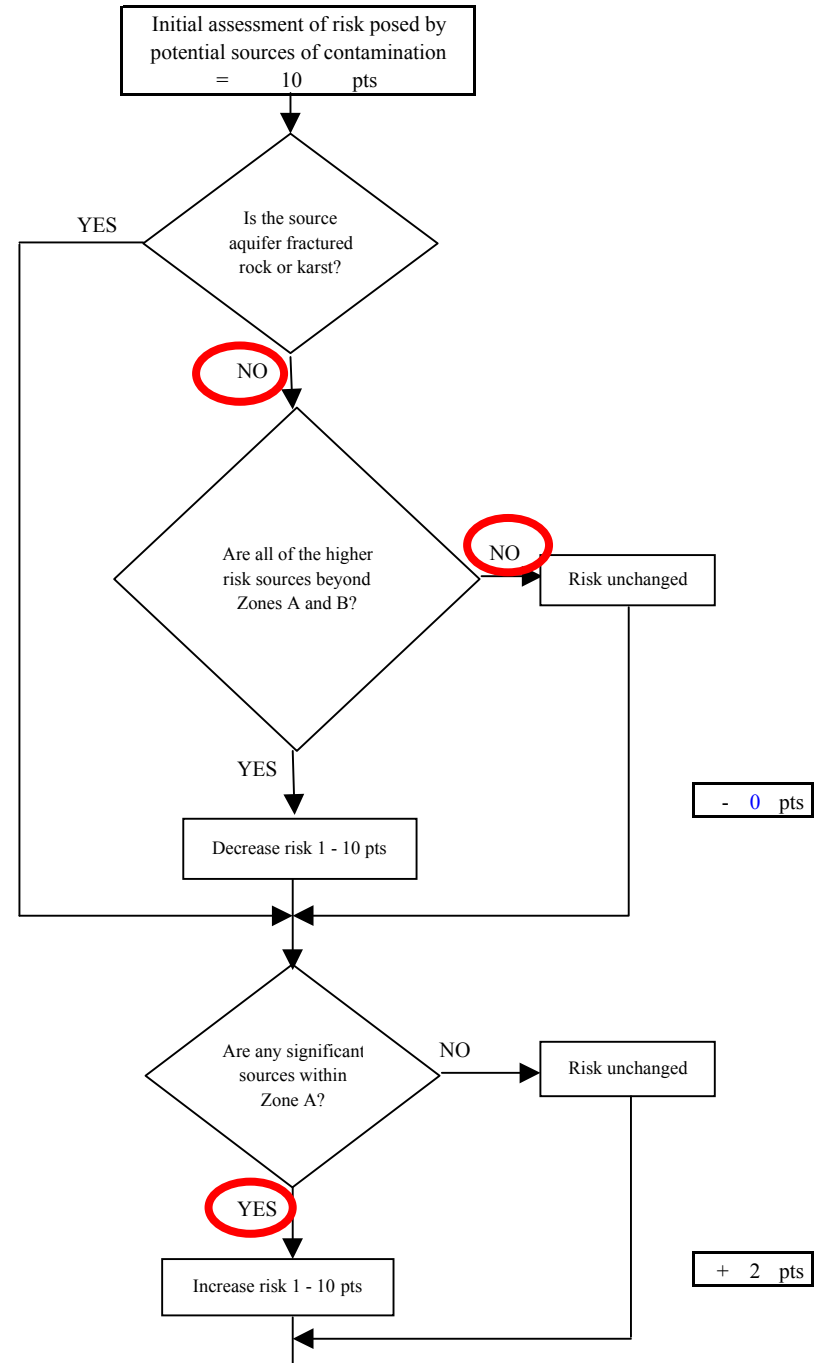

**Chart 11. Contaminant risks for Glencaren Court - Synthetic Organic Chemicals**

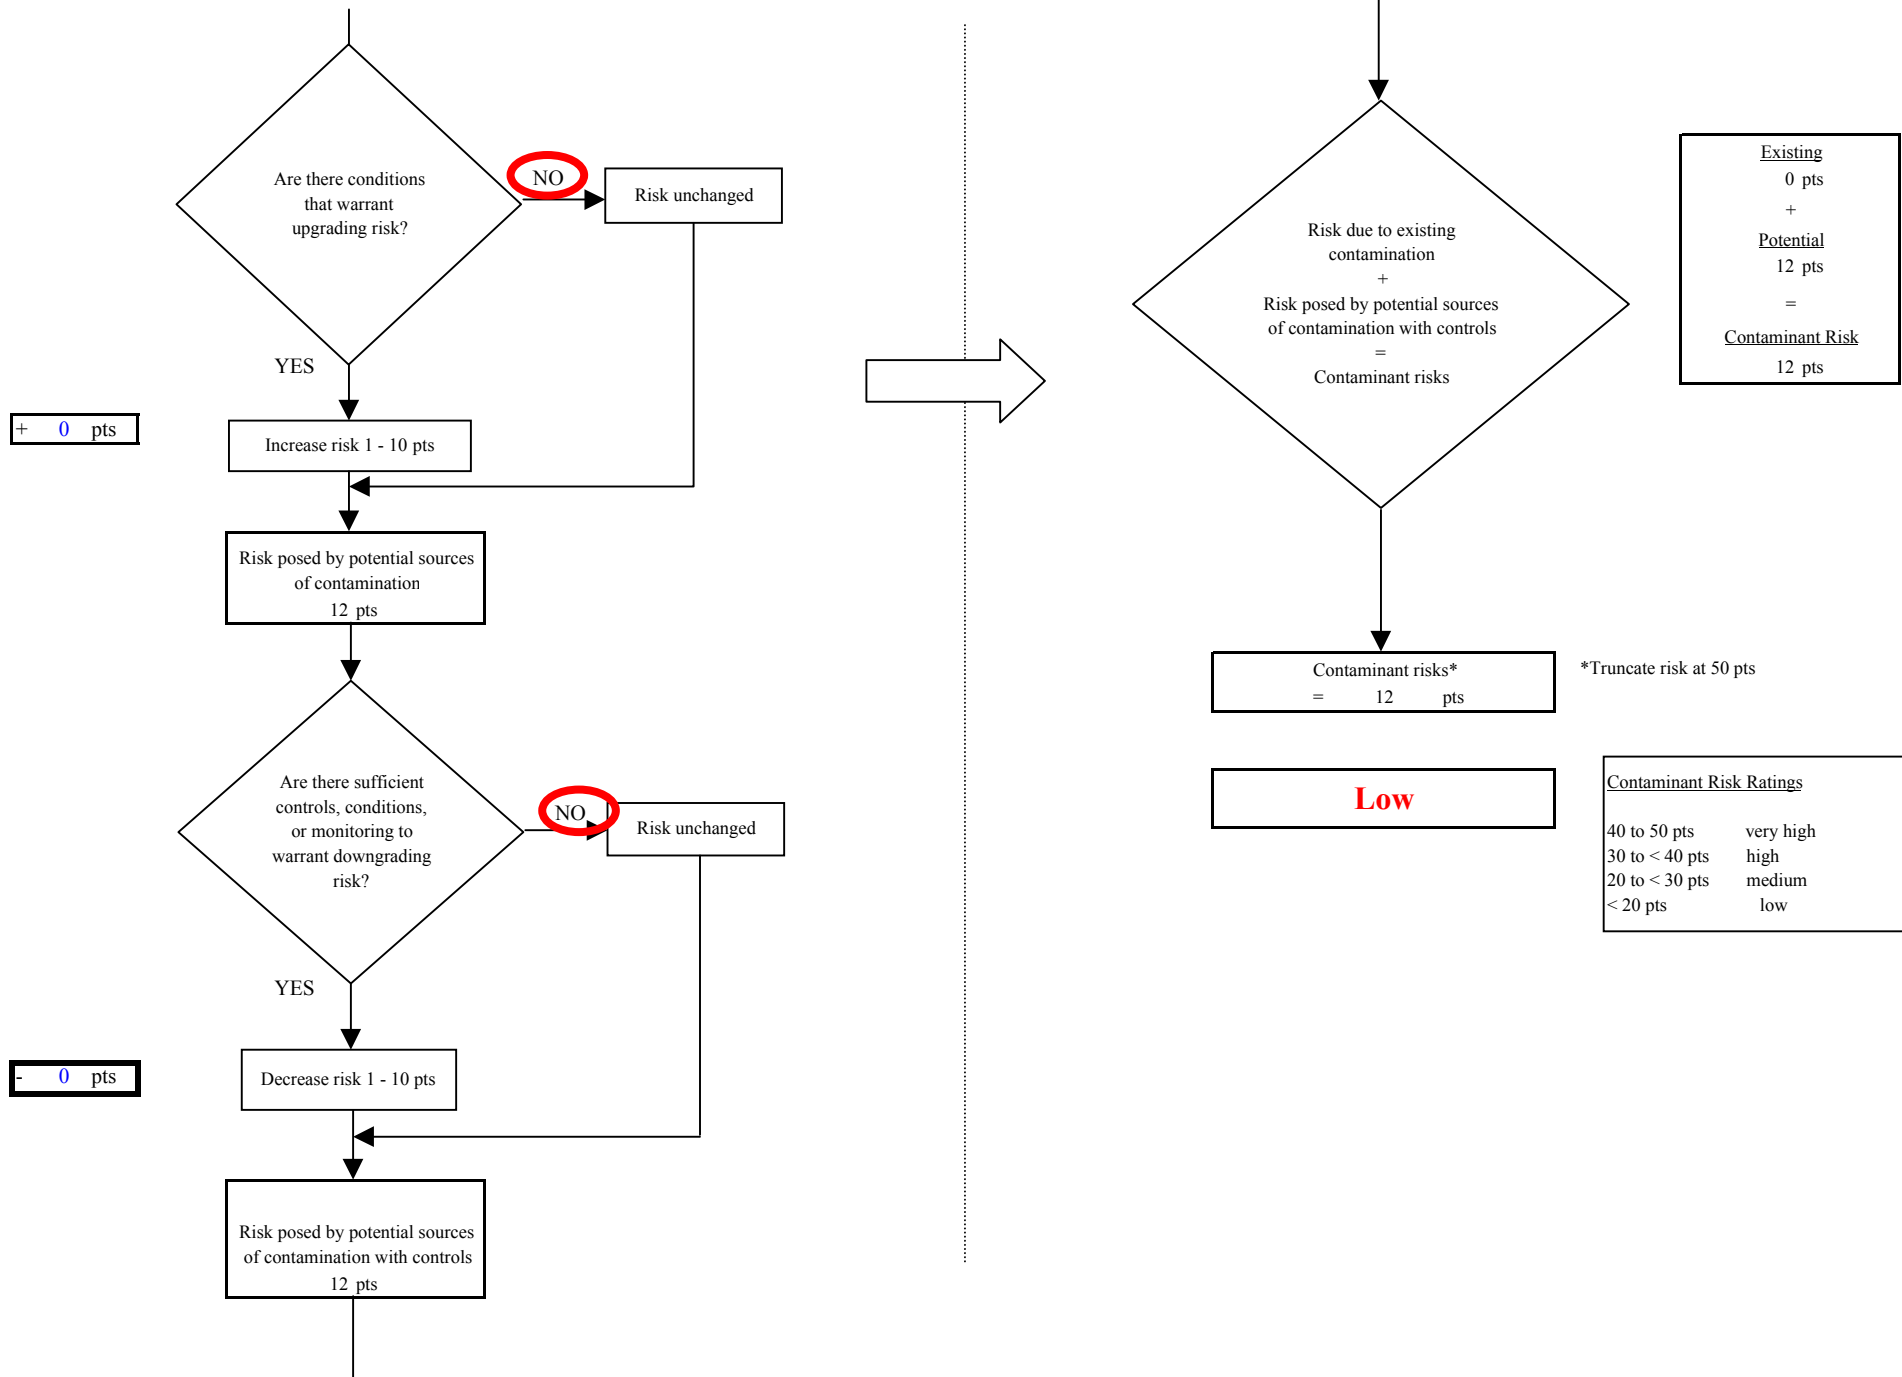

**Chart 12. Vulnerability analysis for *Glencaren Court* - Synthetic Organic Chemicals**



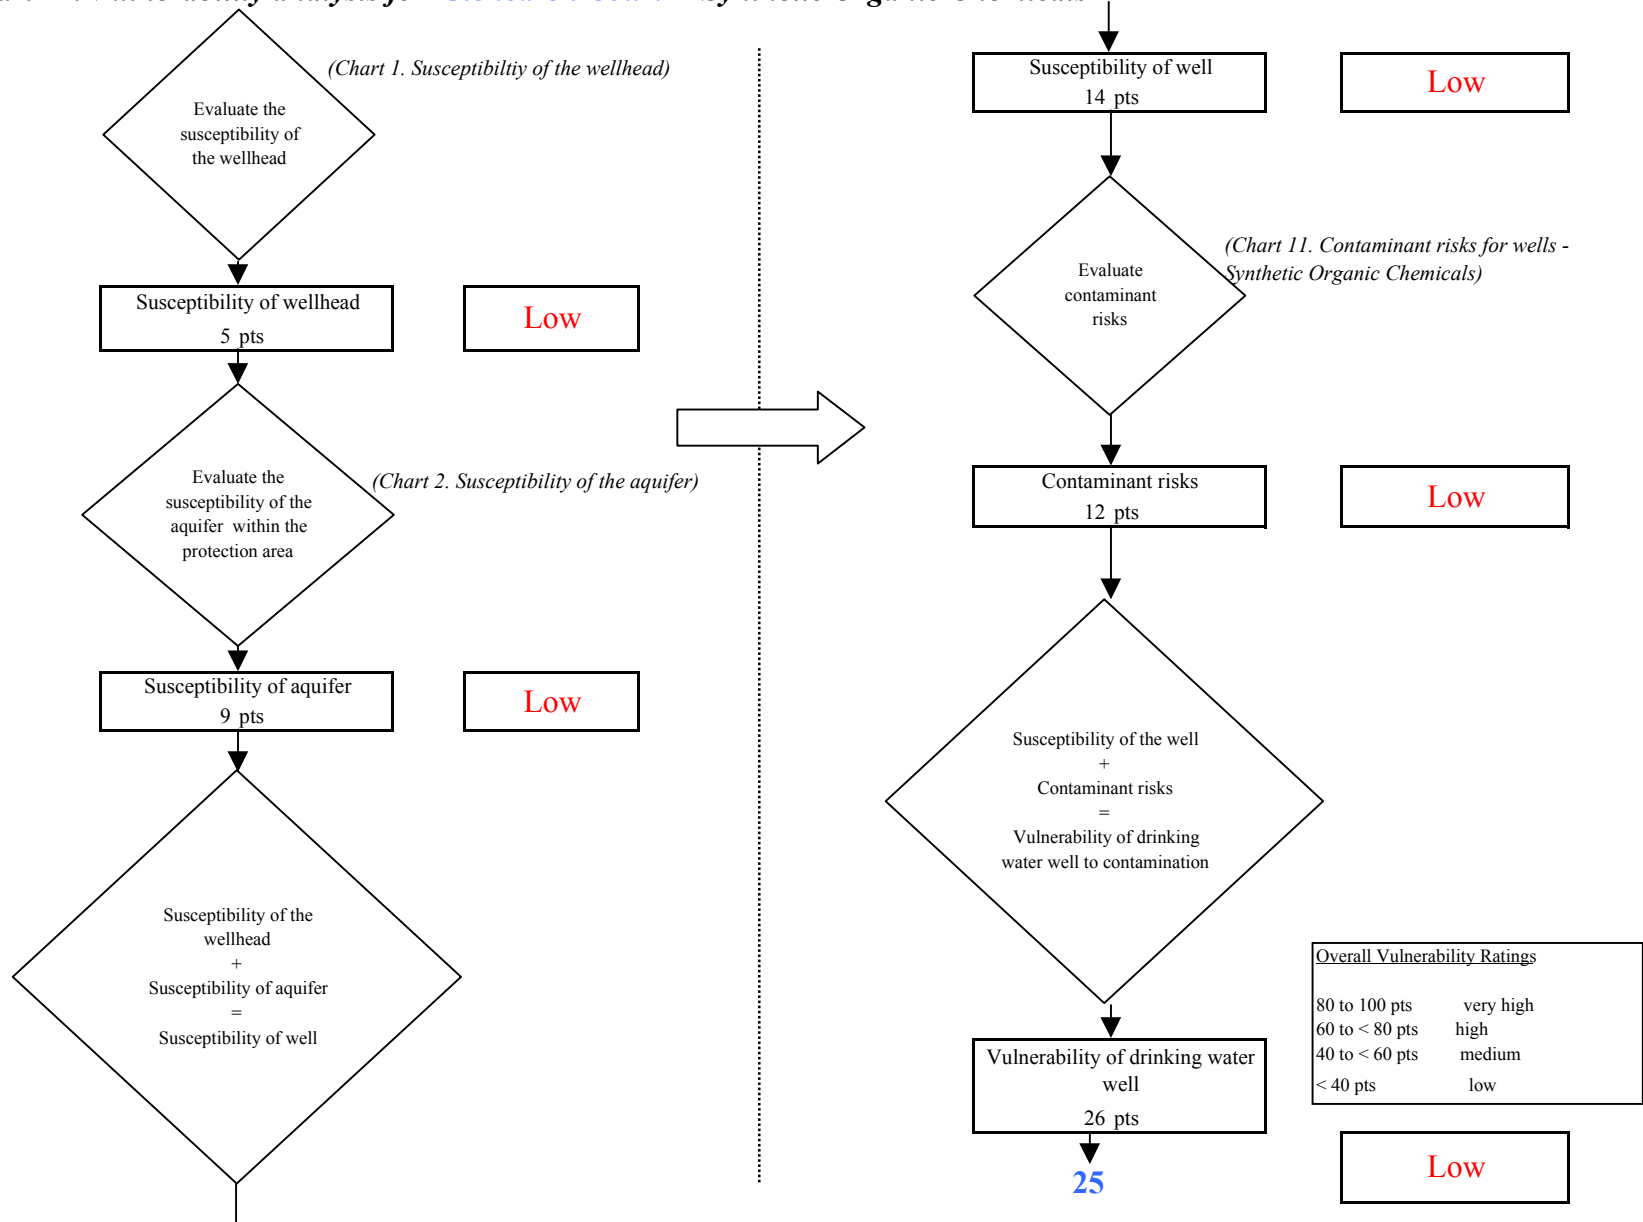


Chart 13. Contaminant risks for *Glencaren Court* - Other Organic Chemicals

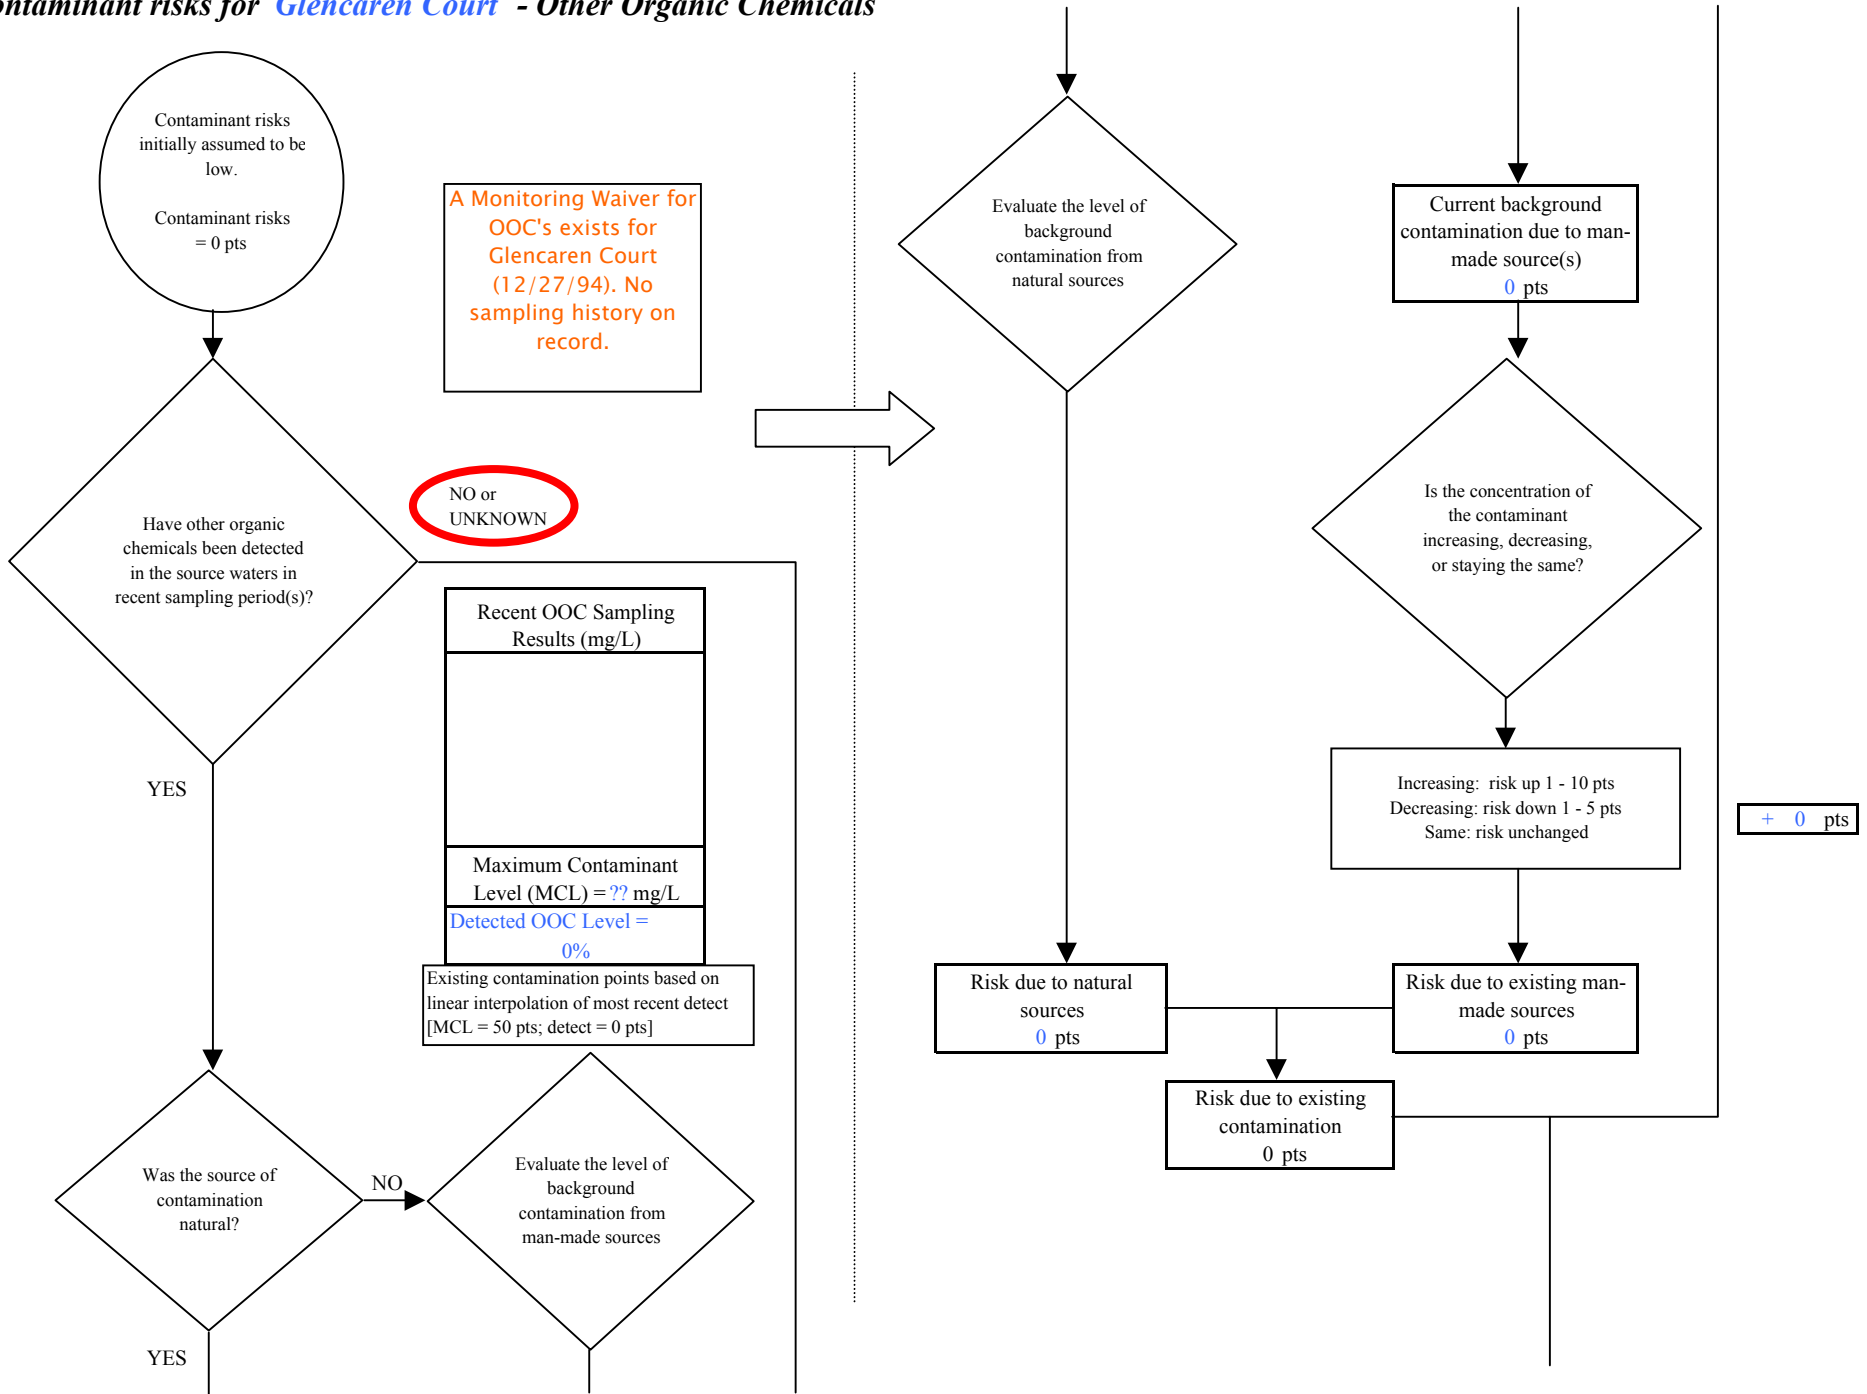

**Chart 13. Contaminant risks for Glencaren Court - Other Organic Chemicals**


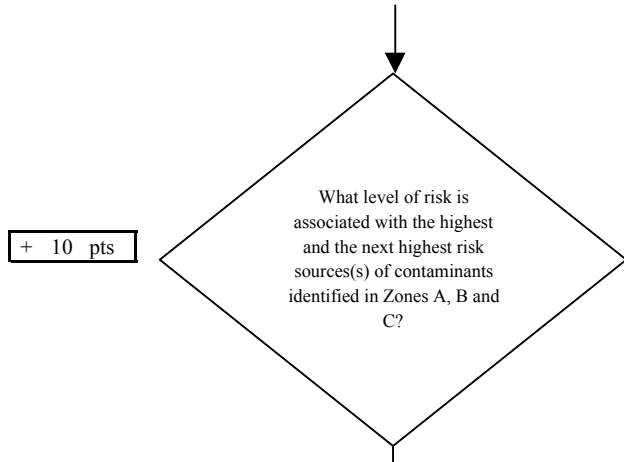


Risk Levels for Contaminant Sources identified in Zones A, B and C			
	Zone A	Zones B&C	Total
Very Highs(s)	0	0	0
High(s)	0	0	0
Medium(s)	0	0	0
Low(s)	3	0	3


	<b>LOW</b> 10 pts	<b>MEDIUM</b> 20 pts	<b>HIGH</b> 30 pts	<b>VERY HIGH</b> 40 pts
<b>LOW</b>	≥ 10 sources + 10 pts	≥ 10 sources + 5 pts	≥ 20 sources + 5 pts	----
<b>MEDIUM</b>	----	≥ 2 sources + 5 pts	≥ 5 sources + 5 pts	≥ 10 sources + 5 pts
<b>HIGH</b>	----	----	≥ 1 source + 10 pts	≥ 2 sources + 10 pts
<b>VERY HIGH</b>	----	----	----	≥ 1 source + 10 pts

Matrix Score      10

Note: Septic systems, sewerlines, and roads are each assigned a risk ranking for each individual contaminant source in the CSI. The VA, however, counts these contaminant sources as a group and assigns a calculated number of either "lows" or "mediums" based on the density.

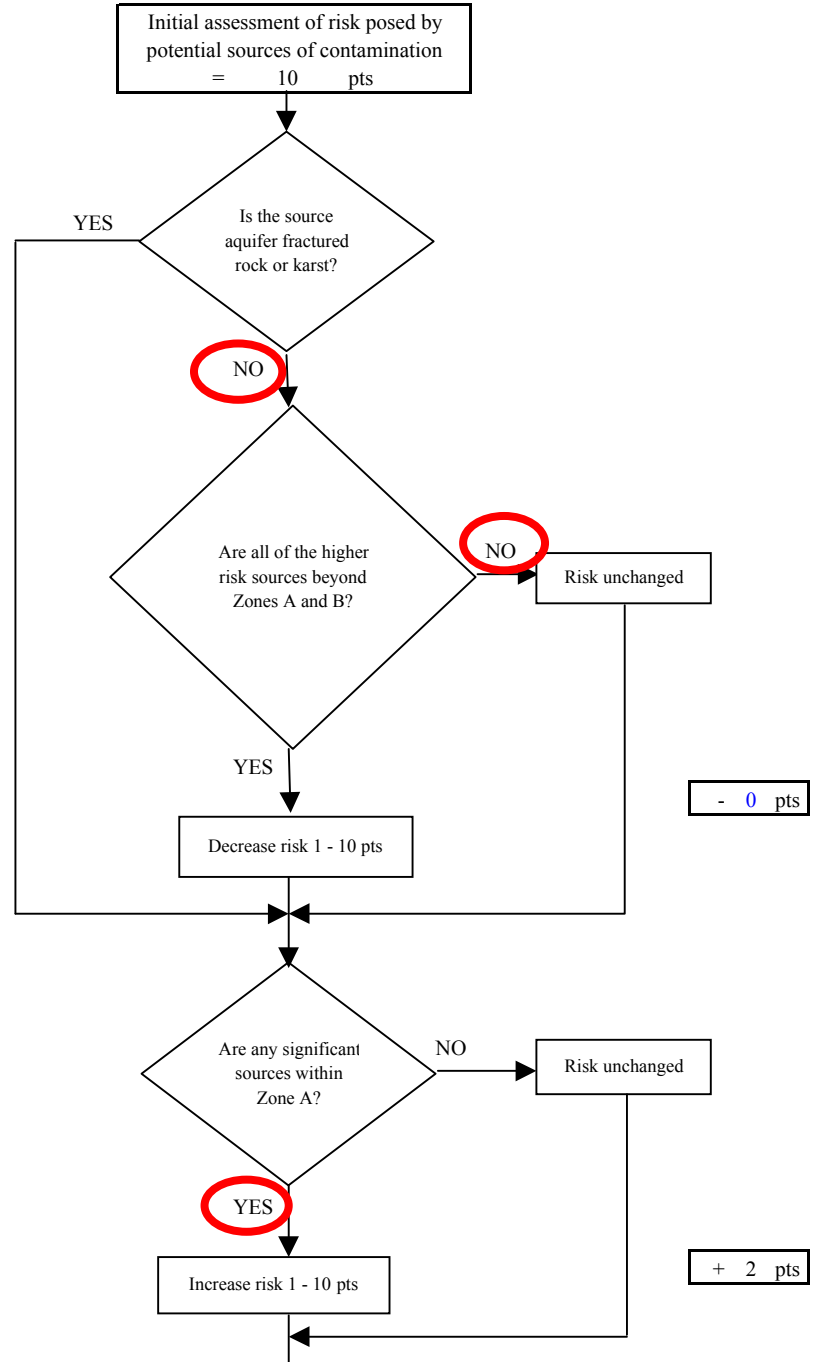

**Chart 13. Contaminant risks for Glencaren Court - Other Organic Chemicals**

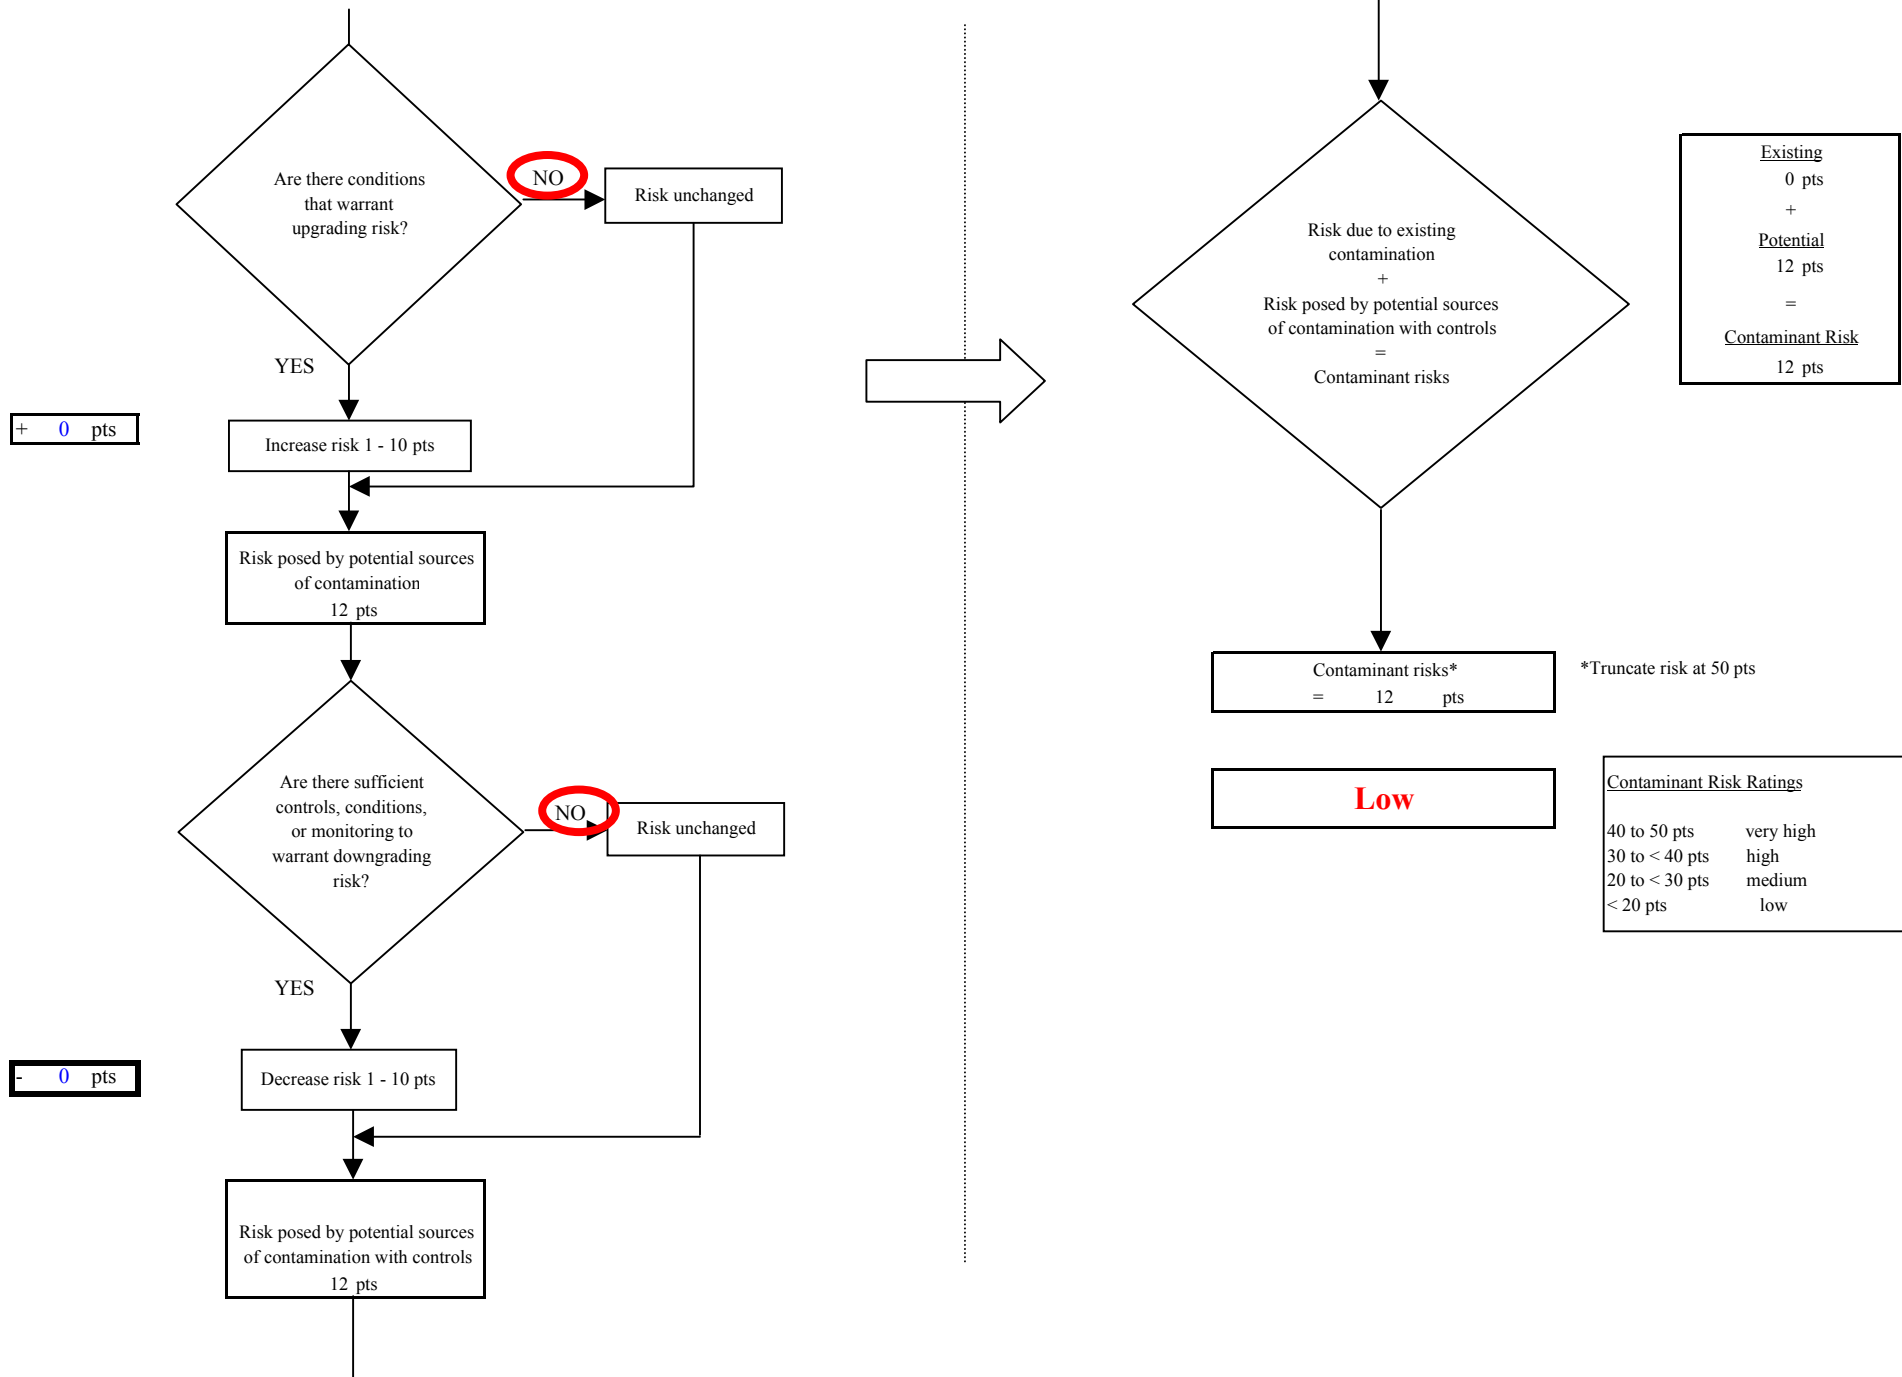

**Chart 14. Vulnerability analysis for *Glencaren Court* - Other Organic Chemicals**

