

Source Water Assessment for
Hillside Baptist Church
Anchorage, Alaska

A Hydrogeologic Susceptibility and Vulnerability Analysis

DRINKING WATER PROTECTION PROGRAM REPORT 160
PWSID 213514.001

December 2001

Source Water Assessment for
Hillside Baptist Church
Anchorage, Alaska

By HEATHER A. HAMMOND

DRINKING WATER PROTECTION PROGRAM REPORT 160
PWSID 213514.001

CONTENTS

	Page		Page
Executive Summary	1	Inventory of Potential and Existing	
Introduction	1	Contaminant Sources	4
Description of the Anchorage area, Alaska	1	Ranking of Contaminant Risks	4
Hillside Baptist Church's Public Water Source	3	Vulnerability of Hillside Baptist Church's	
Assessment/Protection Area for Hillside Baptist		Drinking Water Sources	4
Church's Drinking Water Source	3	Summary	6
		References Cited	7

TABLES

TABLE	1. Natural Susceptibility - Susceptibility of the Wellhead and Aquifer to Contamination	5
	2. Contaminant Risks	5
	3. Overall Vulnerability of Hillside Baptist Church's Public Drinking Water Source to Contamination	6

ILLUSTRATIONS

FIGURE	1. Index map showing the location of Anchorage, Alaska	1
	2. Generalized hydrologic cycle in the Anchorage area	2
	3. Map showing the location of the drinking water source for Hillside Baptist Church	3

APPENDICES

APPENDIX	A. Hillside Baptist Church's Drinking Water Protection Area (Map 1)	
	B. Contaminant Source Inventory for Hillside Baptist Church (Table 1)	
	Contaminant Source Inventory and Risk Ranking for Hillside Baptist Church – Bacteria and Viruses (Table 2)	
	Contaminant Source Inventory and Risk Ranking for Hillside Baptist Church – Nitrates and/or Nitrites (Table 3)	
	Contaminant Source Inventory and Risk Ranking for Hillside Baptist Church – Volatile organic chemicals (Table 4)	
	C. Hillside Baptist Church's Drinking Water Protection Area and Potential and Existing Contaminant Source (Map 2 and Map 4)	
	D. Vulnerability Analysis for Contaminant Source Inventory and Risk Ranking for Hillside Baptist Church's Public Drinking Water Source (Chart 1 – Chart 8 and Table 1 – Table 3)	

Source Water Assessment for Hillside Baptist Church' Source of Public Drinking Water, Anchorage, Alaska

A Hydrogeologic Susceptibility and Vulnerability Analysis

By Heather A. Hammond

Drinking Water Protection Program Alaska Department of Environmental Conservation

EXECUTIVE SUMMARY

The Public Water System for Hillside Baptist Church is a Class B (transient/non-community) water system consisting of one well in the Anchorage area. Identified potential and current sources of contaminants for Hillside Baptist Church include: residential septic systems, paved roads, activities associated with parks and recreation trails, approximately 35 acres of residential area. These identified potential and existing sources of contamination are considered sources of bacteria and viruses, nitrates and/or nitrites, and volatile organic chemicals. Overall, the public water sources for Hillside Baptist Church received a vulnerability rating of **Low** for bacteria and viruses, nitrates and/or nitrites, and volatile organic chemicals.



Figure 1. Index map showing the location of Anchorage, Alaska

INTRODUCTION

The purpose of this environmental assessment is to provide public water system owners and/or operators, communities, and local governments with information they can use to preserve the quality of Alaska's public drinking water supplies. This assessment was completed for the source of public drinking water serving Hillside Baptist Church. This water system consists of one well in the Anchorage area (see Figure 1). This assessment, known under the Alaska Drinking Water Protection Program as the *Source Water Assessment*, has combined a review of the natural hydrogeologic sensitivity with potential and existing contaminant risks to arrive at an overall vulnerability of the drinking water source to contamination. This assessment has been completed as a basis for local voluntary protection efforts and to assist agencies in their efforts to reduce risk to this public drinking water supply.

DESCRIPTION OF THE ANCHORAGE AREA, ALASKA

Location

Anchorage, located in southcentral Alaska, encompasses 1,698 square miles of land and 264 square miles of water. The area containing a majority of the urban development, commonly referred to as the Anchorage Bowl, encompasses approximately 180 square miles [Partick, Brabets, and Glass, 1989] and envelopes the low lands of the area. This area is bounded on the east by the Chugach Mountains and the north, west, and south by the Knik and Turnagain Arms of Cook Inlet (Figure 1). In recent times, urban development has extended eastward along the flanks of the Chugach Mountains. This area, known locally as the Anchorage Hillside, contains development at elevations exceeding 3,700 feet in elevation above sea level.

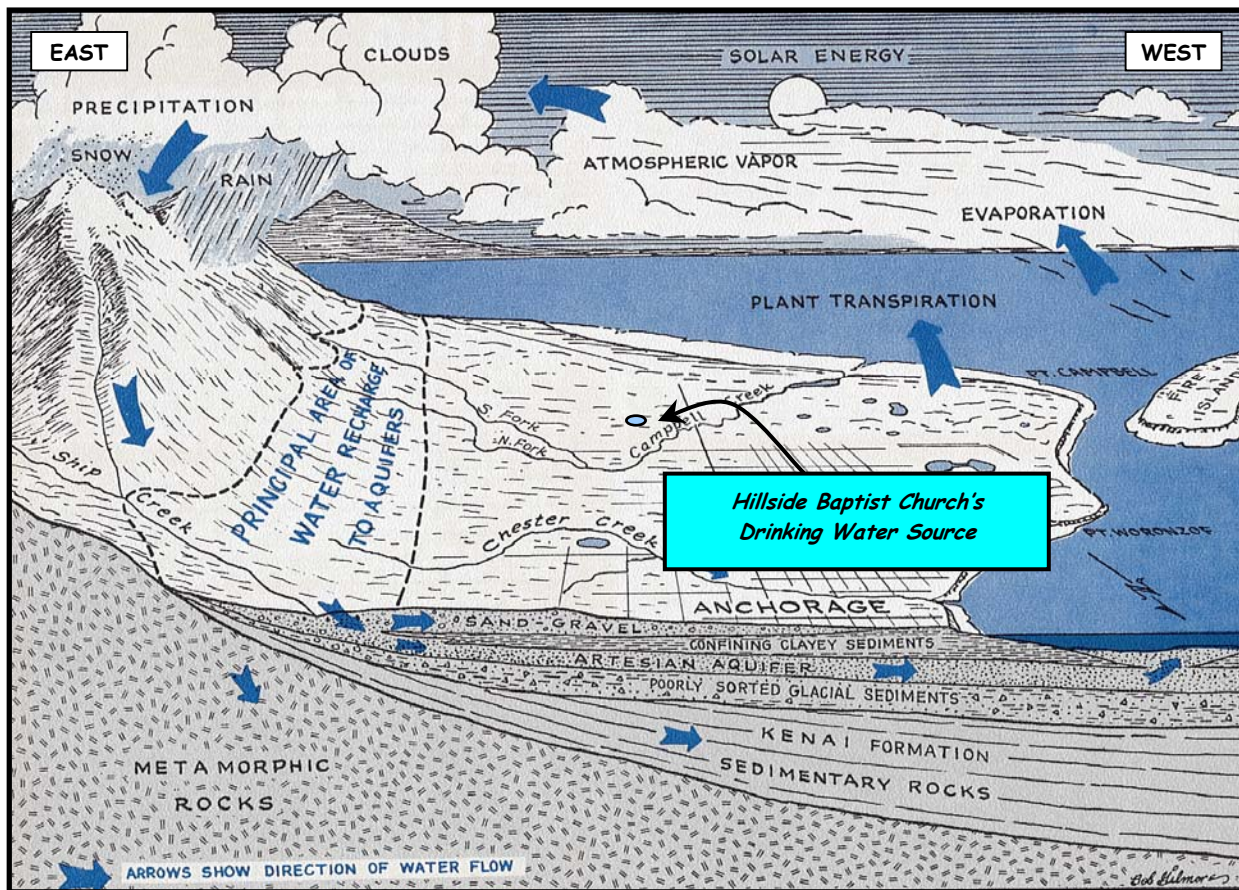


Figure 2. Generalized hydrologic cycle in the Anchorage area [Barnwell, George, Dearborn, Weeks, and Zenone, 1972].

Climate

The Anchorage area climate is somewhat transitional in that it does not experience large daily and annual temperature fluctuations like those experienced in the interior of Alaska nor does it experience high amounts of precipitation typified by gulf coast regions. Mean annual precipitation at the Anchorage International Airport is approximately 16 inches per year. On average, Anchorage receives a total snow accumulation of 69 inches per year. Precipitation generally increases inland toward the Chugach Mountains where annual precipitation may exceed 160 inches per year [Barnwell, George, Dearborn, Weeks, and Zenone, 1972]. Mean daily temperature ranges from 65° F during July to 8° F in January [Western Regional Climate Center, 2000].

Physiography and Groundwater Conditions

Surface elevations in the Anchorage area range from sea level at Knik and Turnagain Arms to well over 5,000 feet in the peaks that bound the area. Glacial moraine and outwash deposits primarily mantle the surface of the Anchorage Bowl.

The backbone of the Chugach Mountains is composed

primarily of metamorphic marine and volcanic rocks (bedrock). These high peaks that bound Anchorage's east-side are flanked with colluvium or slope deposits. These slope deposits eventually grade into the glacial and stream deposits at lower elevations in the Anchorage Bowl.

In the Anchorage area, two principal groundwater flow systems or aquifers exist (see Figure 2). The upper unconfined aquifer or water-table aquifer is separated from a lower confined aquifer system by layers of silty, clayey glacially derived sediments (confining layer) [Ulery and Updike, 1983]. The lower confined aquifer system consists of a series of hydrologically interconnected layers and lenses of gravel, sand and silt that, collectively, form the confined aquifer. The confining layer ranges from 0 to 270 feet thick throughout the Anchorage area and generally thins with increasing distance from Cook Inlet, thus pinching out at the mountain front [Patrick, Brabets, and Glass, 1989].

Water enters or recharges these two aquifer systems in several different ways. Along the front of the Chugach

Mountains, groundwater seeps from fractures in bedrock into the sediments. At these higher elevations, rain and snowmelt also enter the sediments. This area along the mountain front is considered the principal recharge area for wells in the Anchorage area. Precipitation in the low lands may also percolate directly into the ground. Lastly, aquifers may also be recharged by streams where surface water percolates into surrounding permeable sediments (losing reaches of streams). Groundwater flow in the confined aquifer is generally east to west from the mountain front toward Cook Inlet and Turnagain Arm, except in areas where the direction of flow is influenced by large municipal or industrial production wells. The direction of groundwater flow in the upper unconfined aquifer is more variable due to the influence from surficial topography as well as its close connection with surface water bodies.

HILLSIDE BAPTIST CHURCH'S PUBLIC DRINKING WATER SYSTEM

The public water system serving Hillside Baptist Church

is a Class B (transient/non-community) water system, which is owned and operated by Hillside Baptist Church. The system consists of one well, which is located off of O'Malley Road at an elevation of approximately 500 feet above sea level (see Figure 3).

According to the most recent Sanitary Survey (09/11/98) the well site is properly drained and protected against flooding. The Sanitary Survey noted that a sanitary seal was properly installed which may decrease the chances of foreign matter from entering source waters. It is indicated that the well was properly grouted at the time of drilling. Proper grouting provides added protection against contaminants travelling along the well casing and into source waters.

This system operates year round and serves 30 non-residents through one service connection.

ASSESSMENT AND PROTECTION AREA FOR HILLSIDE BAPTIST CHURCH'S DRINKING WATER SOURCE

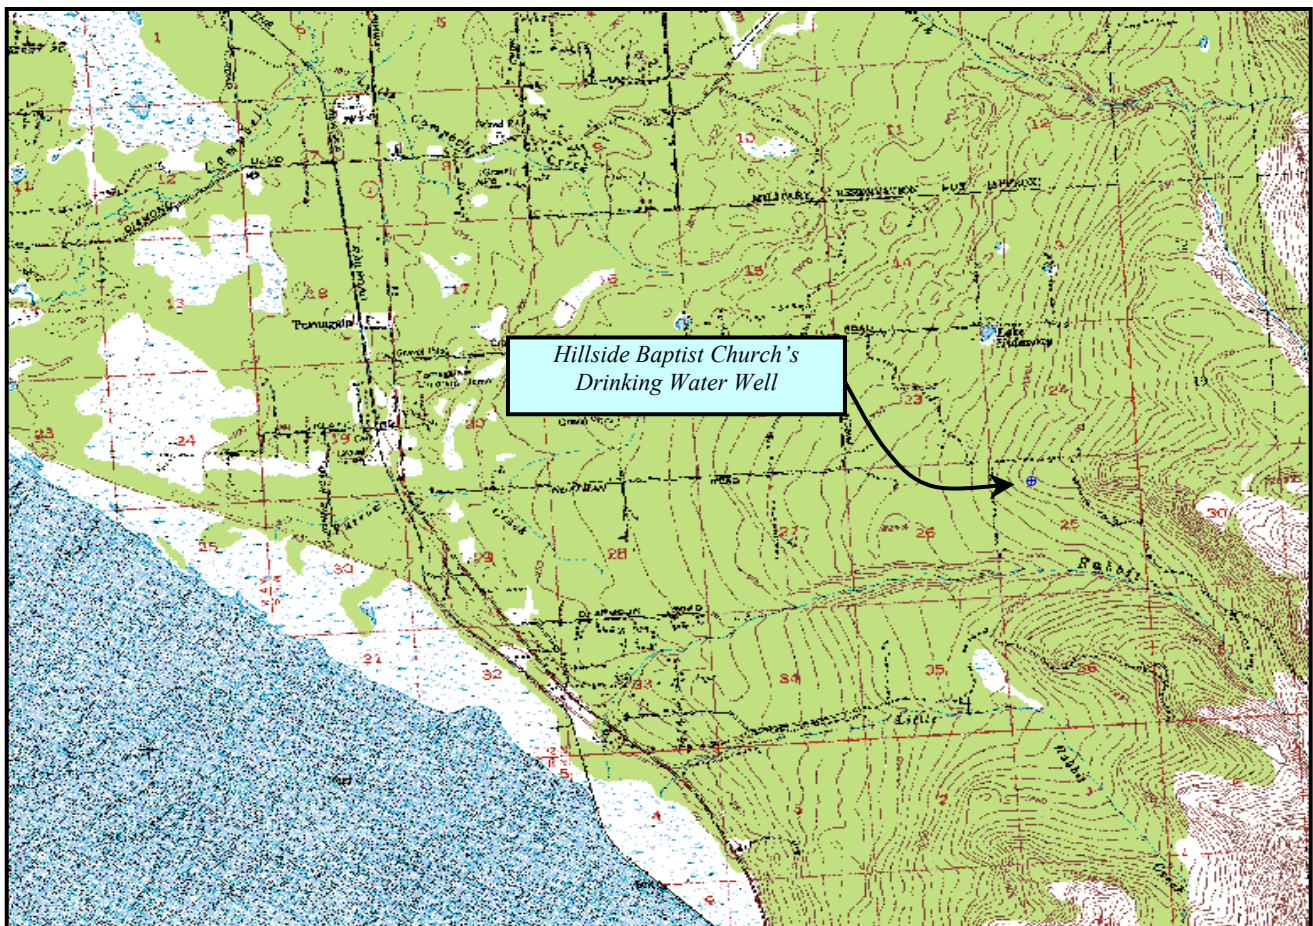


Figure 3. Map showing the location of the drinking water source for Hillside Baptist Church [Base: USGS Anchorage A8].

The Drinking Water Protection and Assessment Area that has been established for the source of drinking water serving Hillside Baptist Church is the area that is most sensitive to contamination. This area has served as a basis for assessing the risk of the drinking water source to contamination. The zones around the drinking water source outline the most critical area for the preservation of the quality of the drinking water for this system. For simplicity, this area will be known as your Drinking Water Protection Area and will serve as the focus for voluntary protection efforts.

Conceptually, groundwater enters the aquifer systems along the front range of the Chugach Mountains (Figure 2) and flows toward Cook Inlet. An analytical calculation was used to determine the size and shape of the area that contributes water to the well. The input parameters describing the attributes of the aquifer in this calculation were adopted from the U.S. Geological Survey [*Patrick, Brabets, and Glass, 1989*]. This analytical calculation was used as a guide as the first step in establishing the protection area for each public drinking water source in Anchorage. Additional methods were further employed to take into account any uncertainties in groundwater flow and aquifer characteristics to arrive at meaningful and conservative protection areas with respect to public health (Please refer to the Guidance Manual for Class B Public Water Systems for additional information).

The Drinking Water Protection Areas established for wells by the Alaska Department of Environmental Conservation are separated into zones. These zones correspond to a time-of-travel. Time-of-travel is the time required for water to move in the saturated zone of the ground from a specific point to the well. The Drinking Water Protection Area for Hillside Baptist Church contains four zones, Zone A through Zone D (See Map 1 in Appendix A). Zone A corresponds to the area between the well and the distance equal to $\frac{1}{4}$ of the distance of the 2-year time-of-travel. Depending on where a contaminant source is located within Zone A, travel time for a contaminant to the well may be on the order of several days to several hours. Zone A also extends downgradient from the well to take into account the area of the aquifer that is influenced by pumping of the well. Zone B corresponds to a time-of-travel of less than two years. Zones C and D correspond to those areas between 5 years and 10 years time-of-travel, respectively.

INVENTORY OF POTENTIAL AND EXISTING CONTAMINANT SOURCES

The Drinking Water Protection Program has completed an inventory of potential and existing sources of

contamination within the Drinking Water Protection Area for Hillside Baptist Church. This survey was completed through a search of agency records and other publicly available information. Potential sources of contamination to drinking water supplies cover a wide range of categories and types. Potential drinking water contaminants are found within agricultural, residential, commercial, and industrial areas, but can also occur within areas that have little or no development.

For the basis of this assessment and all Class B public water system assessments, three categories of drinking water contaminants were inventoried. They include:

- Bacteria and viruses
- Nitrates and/or nitrites
- Volatile organic chemicals

Maps 2 through 4 in Appendix C depict the Contaminant Source Inventory for Hillside Baptist Church. Table 1 in Appendix B lists the inventoried potential sources of contamination within Zones A through D. Below is a summary of the contaminant sources inventoried within the Drinking Water Protection Area for Hillside Baptist Church:

- Residential septic systems;
- paved roads;
- activities associated with parks and recreation trails;
- approximately 35 acres of residential area.

These potential and existing contaminant sources present risk for all three categories of drinking water contaminants for Hillside Baptist Church's source of public drinking water.

RANKING OF CONTAMINANT RISKS

Potential and existing sources of contamination have been sorted, and ranked according to what type and level of risk they represent. Ranking of contaminant risks for a "potential" or "existing" source of contamination is a function of toxicity and volumes of specific contaminants associated with that source. Contaminant risks are further a function of the number and density of those types of contaminant sources as well as the proximity of those sources to the public drinking water well.

VULNERABILITY OF HILLSIDE BAPTIST CHURCH'S DRINKING WATER SOURCE

Vulnerability of a drinking water source to contamination is a combination of two factors:

natural susceptibility; and

- contaminant risks.

Each of the three categories of drinking water contaminants have been analyzed and an overall vulnerability score of 0 to 100 ultimately assigned:

$$\begin{aligned}
 &\text{Natural Susceptibility (0 – 50 points)} \\
 &+ \\
 &\text{Contaminant Risks (0 – 50 points)} \\
 &= \\
 &\text{Vulnerability of the} \\
 &\text{Drinking Water Source to Contamination (0 – 100)}.
 \end{aligned}$$

A score for the Natural Susceptibility is achieved by analyzing the properties of the well and the aquifer.

$$\begin{aligned}
 &\text{Susceptibility of the Wellhead (0 – 25 Points)} \\
 &+ \\
 &\text{Susceptibility of the Aquifer (0 – 25 Points)} \\
 &= \text{Natural Susceptibility (Susceptibility of the Well)} \\
 &\quad \text{(0 – 50 Points)}
 \end{aligned}$$

Based on the information gathered from the well log, the well serving Hillside Baptist Church was completed in a confining aquifer. The depth to the top of the confining unit is approximately 3 feet below land surface. The thickness of the confining layer is suspected to be approximately 61 feet and composed of brown sandy gravel and clay. This confining layer may provide a protective barrier against the movement of contaminants in the subsurface. However, near the base of the Chugach Mountains, these clay layers tend to be discontinuous and thin toward the mountains. Therefore, contaminants that enter the subsurface near the base of the mountains may enter the confined aquifer uninhibited by the absence of any protective layer.

Combining the susceptibility of the wellhead and the aquifer to contamination leads to a score (0 – 50 points) and rating of overall Susceptibility of the well to contamination (See Appendix D). Table 1 depicts the overall Susceptibility score and rating for the source of public drinking water serving Hillside Baptist Church.

Table 1. Natural Susceptibility - Susceptibility of the Wellhead and Aquifer to Contamination

	Score	Rating
Susceptibility of the Wellhead	5	Low
Susceptibility of the Aquifer	12	Medium
Natural Susceptibility	17	Low

Contaminant risks to a drinking water source depend on the type, number or density, and distribution of contaminant sources. A score (0 – 50 points) and rating of Contaminant Risks (See Appendix D) is assigned based on the findings of the Contaminant Source Inventory (See Appendix B - Table 1 – Table 7). This portion of the analysis examines any existing or historical contamination that has been detected at the drinking water source through routine sampling. It also reviews contamination that has or may have occurred but has not arrived or been detected at the well. Table 2 summarizes the Contaminant Risks for each category of drinking water contaminants.

Table 2. Contaminant Risks

Contaminant Risks	Score	Rating
Bacteria and Viruses	22	Medium
Nitrates and/or Nitrites	22	Medium
Volatile Organic Chemicals	22	Medium

Appendix D contains eight charts, which together form the ‘Vulnerability Analysis’ for a Class B public drinking water system. Chart 1 analyzes the ‘Susceptibility of the Wellhead’ to contamination by looking at the construction of the well and its surrounding area. Chart 2 analyzes the ‘Susceptibility of the Aquifer’ to contamination by looking at the naturally occurring attributes of the water source and influences on the groundwater system that might lead to contamination. Chart 3 analyzes ‘Contaminant Risks’ for the drinking water source with respect to bacteria and viruses. The ‘Contaminant Risks’ portion of the analysis considers potential sources of contaminants as well as a review of contamination that has or may have occurred but has not arrived or been detected at the well. Lastly, Chart 4 contains the ‘Vulnerability Analysis for Bacteria and Viruses’. Charts 5 through 8 contain the Contaminant Risks and Vulnerability Analysis for nitrates and nitrites, volatile organic chemicals, respectively.

Vulnerability of the drinking water source to contamination is the combination of susceptibility of the aquifer and the well with contaminant risks. Table 3 contains the overall vulnerability scores (0 – 100) and ratings for each of the three categories of drinking water contaminants (See Appendix D). Note: scores are rounded off to the nearest five.

Table 3. Overall Vulnerability of Hillside Baptist Church’s Public Drinking Water Source to Contamination by Category

Category	Score	Rating
Bacteria and Viruses	35	Low
Nitrates and Nitrites	35	Low
Volatile Organic Chemicals	35	Low

Tables 2 through 4 in Appendix B contain the ranking of potential and existing sources of contamination with respect to bacteria and viruses, nitrates and/or nitrites, and volatile organic chemicals.

Overall, contaminant risks for bacteria and viruses are medium with residential septic systems driving the increase of contaminant risk. Combining this potential bacteria and viruses contamination risk with the natural susceptibility of the well leads to an overall vulnerability to contamination of low.

Other low potential and existing sources of contamination for bacteria and viruses include activities associated with residential areas, parks and recreation trails.

Overall, contaminant risks for nitrates and/or nitrites are medium with residential septic systems driving the increase of contaminant risks. Combining this potential nitrates and/or nitrites contamination risk with the natural susceptibility of the well leads to an overall vulnerability to contamination of low.

Other low potential and existing sources of nitrates and/or nitrites include activities associated with parks and recreation trails, residential area, and paved roads.

Overall, contaminant risk for volatile organic chemicals is medium with paved roads and residential septic systems driving the increase of contaminant risks. Combining this potential volatile organic chemical contamination risk with the natural susceptibility of the well leads to an overall vulnerability to contamination of low.

Other low potential and existing sources of volatile organic chemicals include activities associated with

residential areas.

SUMMARY

A *Source Water Assessment* has been completed for the source of public drinking water serving Hillside Baptist Church. The overall vulnerability of this source to contamination is **Low** for bacteria and viruses, nitrates and/or nitrites and volatile organic chemicals. This assessment of contaminant risks can be used as a foundation for local voluntary protection efforts as well as a basis for the continuous efforts on the part of Hillside Baptist Church to protect public health. It is anticipated that *Source Water Assessments* will be updated every five years to reflect any changes in the vulnerability and/or susceptibility of Hillside Baptist Church’s public drinking water source.


REFERENCES CITED

- Barnwell, W.W., George, R.S., Dearborn, L.L., Weeks, J.B., and Zenone, C., 1972, Water for Anchorage: an atlas of the water resources of the Anchorage area, Alaska: U.S. Geological Survey Open-File Report, 76 p.
- Patrick, L.D., Brabets, T.P., and Glass, R.L., 1989, Simulation of ground-water flow at Anchorage, Alaska: U.S. Geological Survey Water-Resources Investigations Report 88-4139, 41p.
- Ulery, C.A. and Updike, R.G, 1983, Subsurface structure of the cohesive facies of the Bootlegger Cove Formation, Southwest Anchorage, Alaska: Alaska Division of Geological and Geophysical Surveys Professional Report 84, 5 p.
- Western Regional Climate Center, 2000, August 24, Web extension to the *Western Regional Climate Center* [WWW document]. URL <http://www.wrcc.dri.edu/index.html>



APPENDIX A

Hillside Baptist Church's Drinking Water Protection Area

Drinking Water Protection Area for Hillside Baptist Church

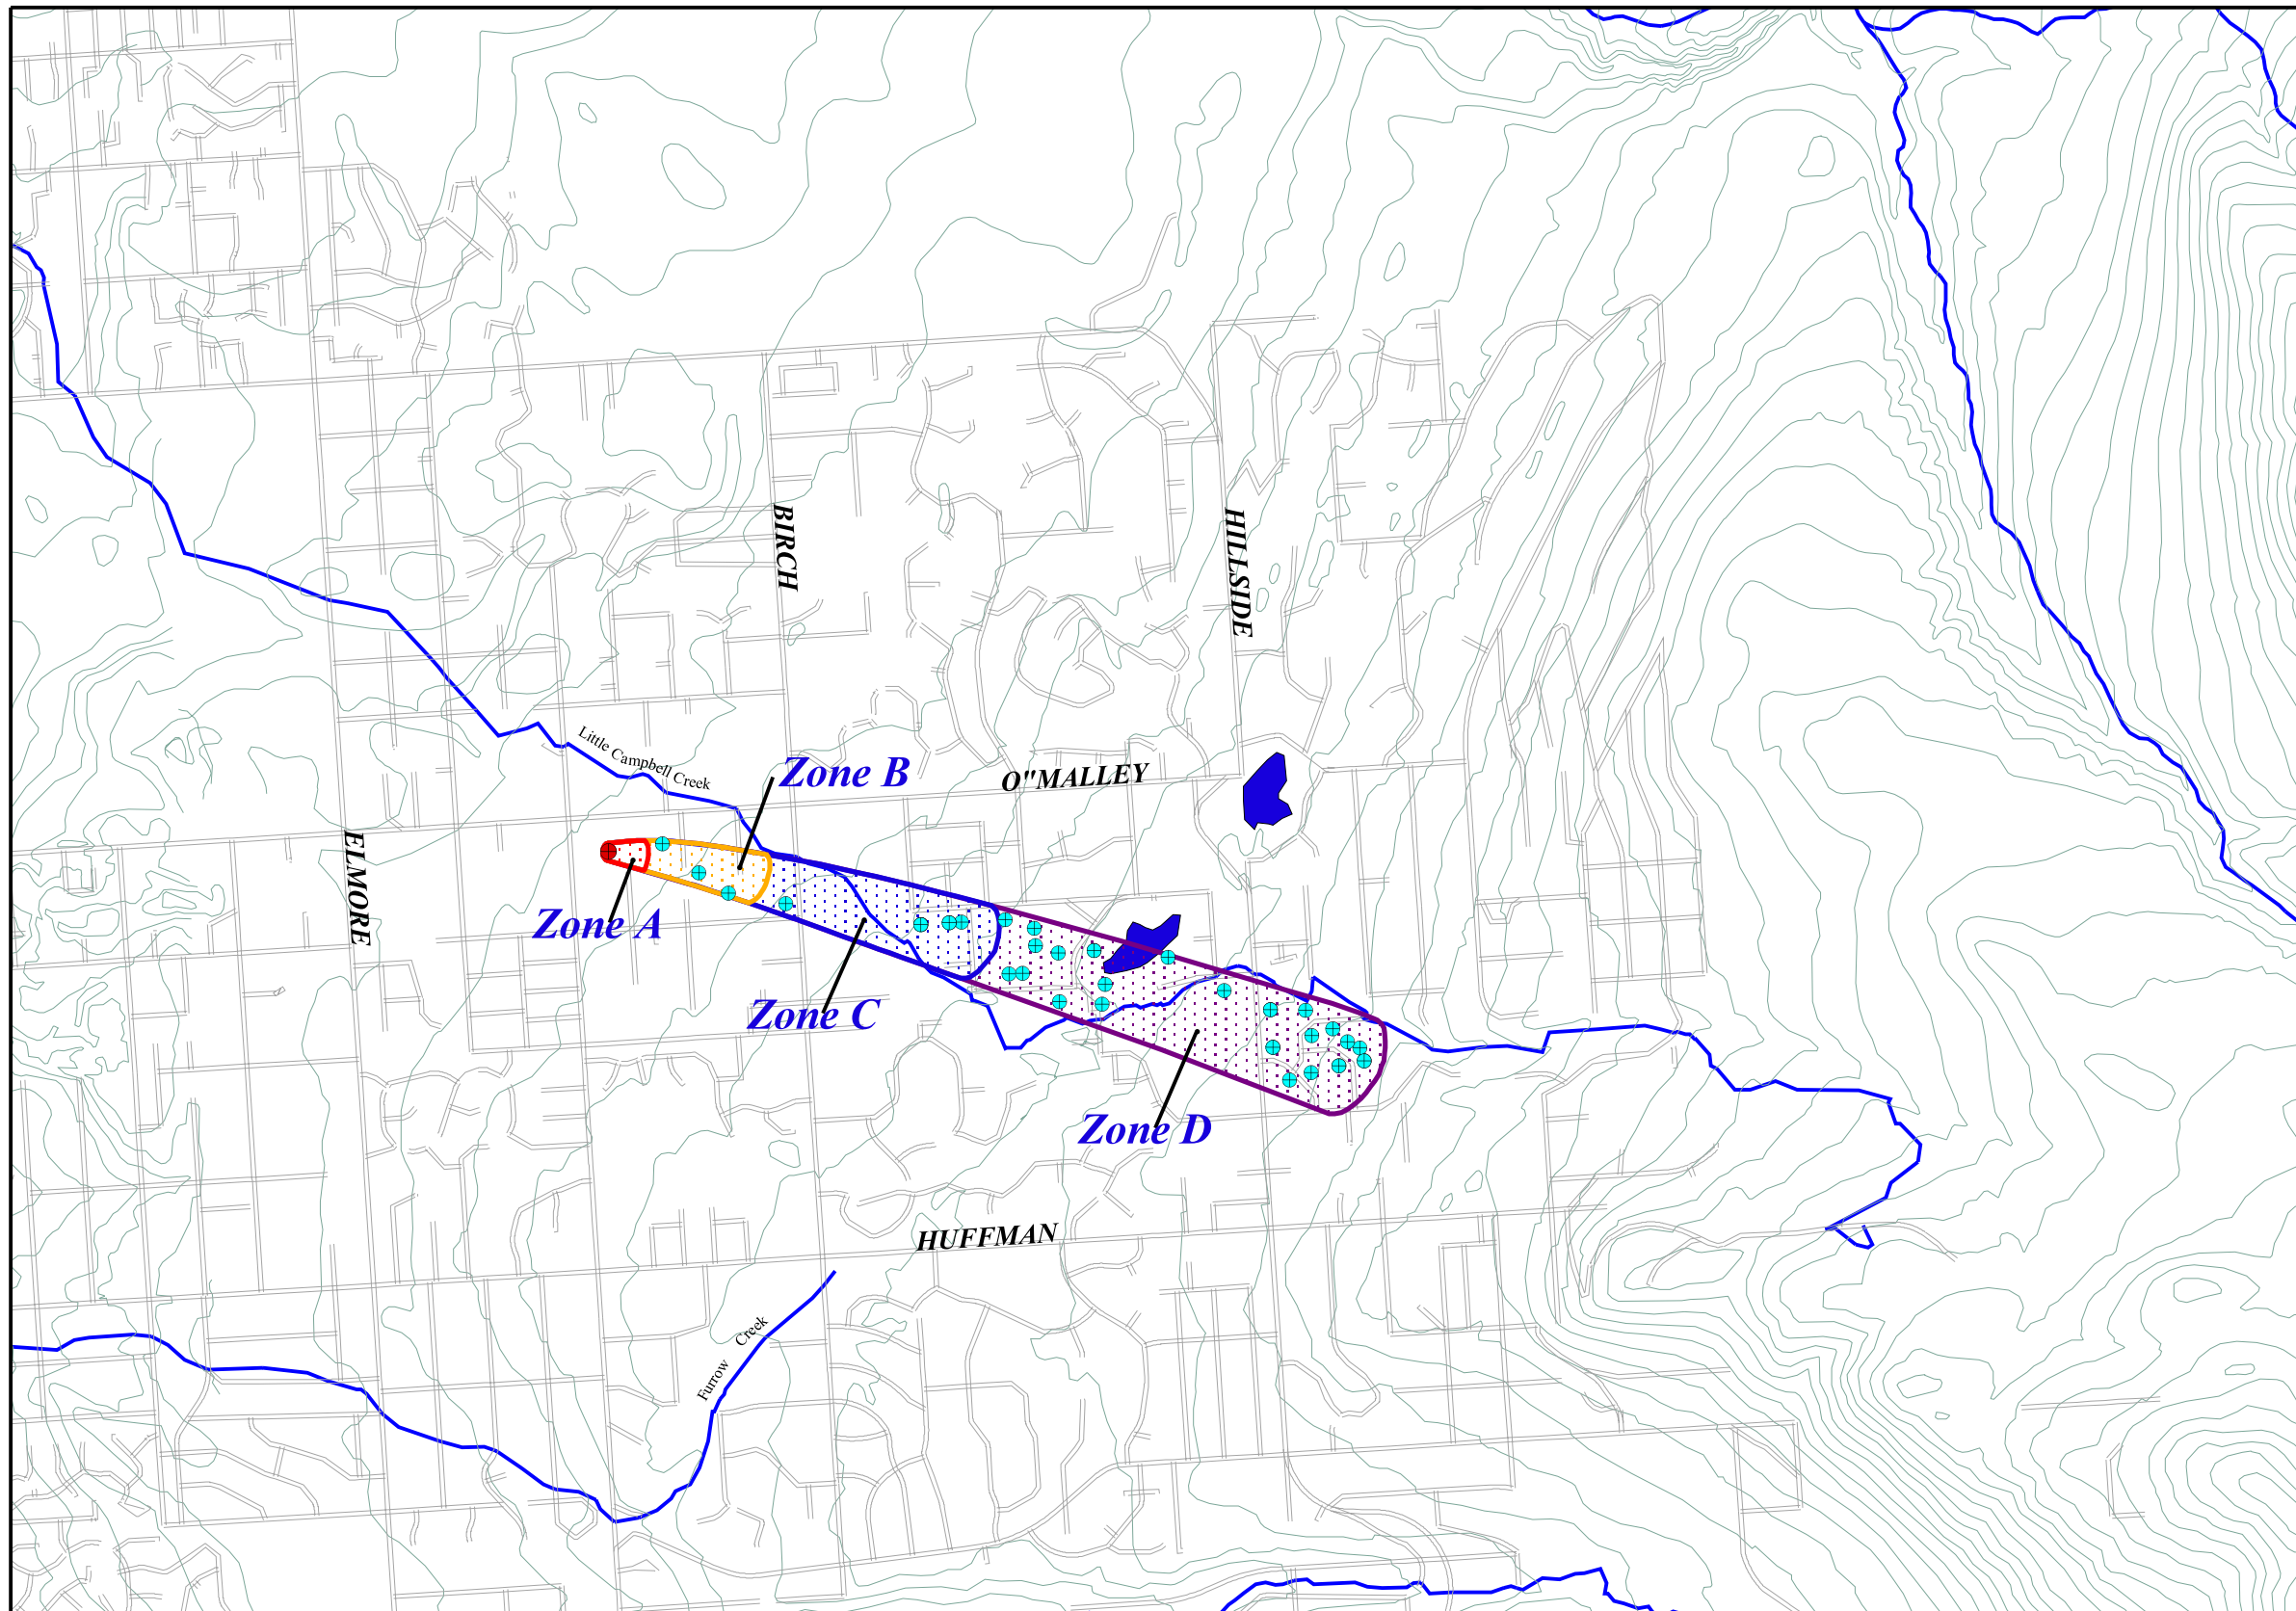

- Hillside Baptist Church DW Well
- Public/Private Wells
- Zone A Protection Area**
- Several Months Travel Time
- Zone B Protection Area**
- Less Than 2 Years Travel Time
- Zone C Protection Area**
- Less Than 5 Years Travel Time
- Zone D Protection Area**
- Less Than 10 Years Travel Time
- Roads
- MOA Lakes
- Elevation Contours
- Anchorage Streams

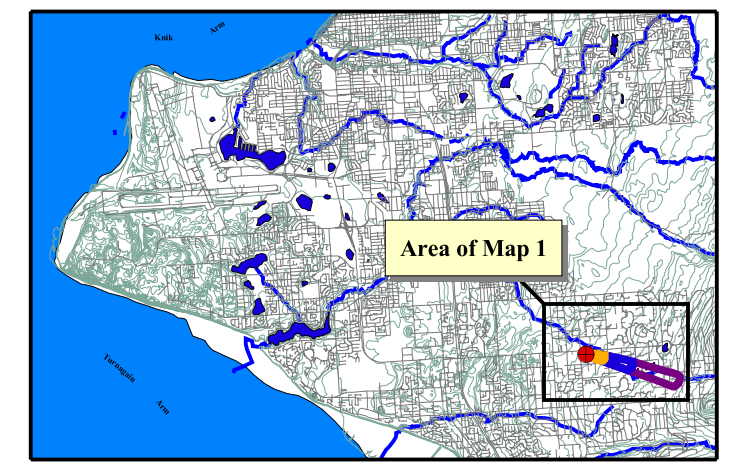

5000 0 5000 10000 Feet

PWSID 213514.001

Map 1

APPENDIX B

Contaminant Source Inventory and Risk Ranking for Hillside Baptist Church

Table 1

**Contaminant Source Inventory for
Hillside Baptist Church**

PWSID 213514.001

Contaminant Source Type	Contaminant Source ID	CS ID tag	Zone	Location	Map Number	Comments
Residential Areas	R01	R1-1	A	Residential areas located within Zone A	2	
Septic systems (serves one or more single-family homes)	R02	R2-1	A	Within Zone A	3	
Septic systems (serves one or more single-family homes)	R02	R2-2	A	Within Zone A	3	
Residential Areas	R01	R1-2	B	Residential areas located within Zone B	2	
Septic systems (serves one or more single-family homes)	R02	R2-10	B	Along One-hundred-twelfth Ave.	3	
Septic systems (serves one or more single-family homes)	R02	R2-11	B	Along Baronik Street	3	
Septic systems (serves one or more single-family homes)	R02	R2-12	B	Along Baronik Street	3	
Septic systems (serves one or more single-family homes)	R02	R2-13	B	Along One-hundred-twelfth Ave.	3	
Septic systems (serves one or more single-family homes)	R02	R2-3	B	Along Totem Road	3	
Septic systems (serves one single-family home)	R02	R2-4	B	Along Totem Road	3	
Septic systems (serves one or more single-family homes)	R02	R2-5	B	Along Totem Road	3	
Septic systems (serves one or more single-family homes)	R02	R2-6	B	Along Totem Road	3	
Septic systems (serves one or more single-family homes)	R02	R2-7	B	Along Totem Road	3	
Septic systems (serves one or more single-family homes)	R02	R2-8	B	Along Totem Road	3	
Septic systems (serves one or more single-family homes)	R02	R2-9	B	Along Totem Road	3	
Highways and roads, paved (cement or asphalt)	X20	X20-1	B	Totem Road	2	
Highways and roads, paved (cement or asphalt)	X20	X20-2	B	Baronik Street	2	
Residential Areas	R01	R1-3	C	Residential areas located within Zone C	2	
Septic systems (serves one or more single-family homes)	R02	R2-14 - 31	C	All septic systems located within Zone C	3	
Highways and roads, paved (cement or asphalt)	X20	X20-3 - 9	C	All roads located within Zone C	2	
Municipal or city parks (with green areas)	X04	X4-1	C	Intersects Zone C along Little Campbell Creek	2	
Municipal or city parks (with green areas)	X04	X4-2	C	Intersects Zone C along Little Campbell Creek	2	
Dog walking areas/foot trails	X46	X46-1 - 3	C	Trails located within Zone C	2	

Table 2

*Contaminant Source Inventory and Risk Ranking for
Hillside Baptist Church
Sources of Bacteria and Viruses*

PWSID 213514.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Overall Rank after Analysis</i>	<i>Location</i>	<i>Map Number</i>	<i>Comments</i>
Septic systems (serves one or more single-family homes)	R02	R2-1	A	Low	1	Within Zone A	3	
Septic systems (serves one or more single-family homes)	R02	R2-2	A	Low	2	Within Zone A	3	
Residential Areas	R01	R1-1	A	Low	3	Residential areas located within Zone A	2	
Septic systems (serves one or more single-family homes)	R02	R2-3	B	Low	4	Along Totem Road	3	
Septic systems (serves one single-family home)	R02	R2-4	B	Low	5	Along Totem Road	3	
Septic systems (serves one or more single-family homes)	R02	R2-5	B	Low	6	Along Totem Road	3	
Residential Areas	R01	R1-2	B	Low	7	Residential areas located within Zone B	2	
Septic systems (serves one or more single-family homes)	R02	R2-6	B	Low	8	Along Totem Road	3	
Septic systems (serves one or more single-family homes)	R02	R2-7	B	Low	9	Along Totem Road	3	
Septic systems (serves one or more single-family homes)	R02	R2-8	B	Low	10	Along Totem Road	3	
Septic systems (serves one or more single-family homes)	R02	R2-10	B	Low		Along One-hundred-twelfth Ave.	3	
Septic systems (serves one or more single-family homes)	R02	R2-11	B	Low		Along Baronik Street	3	
Septic systems (serves one or more single-family homes)	R02	R2-12	B	Low		Along Baronik Street	3	
Septic systems (serves one or more single-family homes)	R02	R2-13	B	Low		Along One-hundred-twelfth Ave.	3	
Septic systems (serves one or more single-family homes)	R02	R2-9	B	Low		Along Totem Road	3	
Highways and roads, paved (cement or asphalt)	X20	X20-1	B	Low		Totem Road	2	
Highways and roads, paved (cement or asphalt)	X20	X20-2	B	Low		Baronik Street	2	

Table 2 (continued)

Contaminant Source Inventory and Risk Ranking for
Hillside Baptist Church
Sources of Bacteria and Viruses

PWSID 213514.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Overall Rank after Analysis</i>	<i>Location</i>	<i>Map Number</i>	<i>Comments</i>
Residential Areas	R01	R1-3	C	Low		Residential areas located within Zone C	2	
Septic systems (serves one or more single-family homes)	R02	R2-14 - 31	C	Low		All septic systems located within Zone C	3	
Highways and roads, paved (cement or asphalt)	X20	X20-3 - 9	C	Low		All roads located within Zone C	2	
Municipal or city parks (with green areas)	X04	X4-1	C	Medium		Intersects Zone C along Little Campbell Creek	2	
Municipal or city parks (with green areas)	X04	X4-2	C	Medium		Intersects Zone C along Little Campbell Creek	2	
Dog walking areas/foot trails	X46	X46-1 - 3	C	Low		Trails located within Zone C	2	
Dog walking areas/foot trails	X46	X46-1 - 3	C	Low		Trails located within Zone C	2	

Table 3

*Contaminant Source Inventory and Risk Ranking for
Hillside Baptist Church
Sources of Nitrates/Nitrites*

PWSID 213514.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Overall Rank after Analysis</i>	<i>Location</i>	<i>Map Number</i>	<i>Comments</i>
Septic systems (serves one or more single-family homes)	R02	R2-1	A	Low	1	Within Zone A	3	
Septic systems (serves one or more single-family homes)	R02	R2-2	A	Low	2	Within Zone A	3	
Residential Areas	R01	R1-1	A	Low	3	Residential areas located within Zone A	2	
Septic systems (serves one or more single-family homes)	R02	R2-3	B	Low	4	Along Totem Road	3	
Septic systems (serves one single-family home)	R02	R2-4	B	Low	5	Along Totem Road	3	
Septic systems (serves one or more single-family homes)	R02	R2-5	B	Low	6	Along Totem Road	3	
Residential Areas	R01	R1-2	B	Low	7	Residential areas located within Zone B	2	
Septic systems (serves one or more single-family homes)	R02	R2-6	B	Low	8	Along Totem Road	3	
Septic systems (serves one or more single-family homes)	R02	R2-7	B	Low	9	Along Totem Road	3	
Septic systems (serves one or more single-family homes)	R02	R2-8	B	Low	10	Along Totem Road	3	
Septic systems (serves one or more single-family homes)	R02	R2-10	B	Low		Along One-hundred-twelfth Ave.	3	
Septic systems (serves one or more single-family homes)	R02	R2-11	B	Low		Along Baronik Street	3	
Septic systems (serves one or more single-family homes)	R02	R2-12	B	Low		Along Baronik Street	3	
Septic systems (serves one or more single-family homes)	R02	R2-13	B	Low		Along One-hundred-twelfth Ave.	3	
Septic systems (serves one or more single-family homes)	R02	R2-9	B	Low		Along Totem Road	3	
Highways and roads, paved (cement or asphalt)	X20	X20-1	B	Low		Totem Road	2	
Highways and roads, paved (cement or asphalt)	X20	X20-2	B	Low		Baronik Street	2	

Table 3 (continued)

Contaminant Source Inventory and Risk Ranking for
Hillside Baptist Church
Sources of Nitrates/Nitrites

PWSID 213514.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Overall Rank after Analysis</i>	<i>Location</i>	<i>Map Number</i>	<i>Comments</i>
Residential Areas	R01	R1-3	C	Low		Residential areas located within Zone C	2	
Septic systems (serves one or more single-family homes)	R02	R2-14 - 31	C	Low		All septic systems located within Zone C	3	
Highways and roads, paved (cement or asphalt)	X20	X20-3 - 9	C	Low		All roads located within Zone C	2	
Municipal or city parks (with green areas)	X04	X4-1	C	Medium		Intersects Zone C along Little Campbell Creek	2	
Municipal or city parks (with green areas)	X04	X4-2	C	Medium		Intersects Zone C along Little Campbell Creek	2	
Dog walking areas/foot trails	X46	X46-1 - 3	C	Low		Trails located within Zone C	2	
Dog walking areas/foot trails	X46	X46-1 - 3	C	Low		Trails located within Zone C	2	

Table 4

*Contaminant Source Inventory and Risk Ranking for
Hillside Baptist Church
Sources of Volatile Organic Chemicals*

PWSID 213514.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Overall Rank after Analysis</i>	<i>Location</i>	<i>Map Number</i>	<i>Comments</i>
Septic systems (serves one or more single-family homes)	R02	R2-1	A	Low	1	Within Zone A	3	
Septic systems (serves one or more single-family homes)	R02	R2-2	A	Low	2	Within Zone A	3	
Residential Areas	R01	R1-1	A	Low	3	Residential areas located within Zone A	2	
Septic systems (serves one or more single-family homes)	R02	R2-3	B	Low	4	Along Totem Road	3	
Septic systems (serves one single-family home)	R02	R2-4	B	Low	5	Along Totem Road	3	
Septic systems (serves one or more single-family homes)	R02	R2-5	B	Low	6	Along Totem Road	3	
Residential Areas	R01	R1-2	B	Low	7	Residential areas located within Zone B	2	
Highways and roads, paved (cement or asphalt)	X20	X20-1	B	Low	8	Totem Road	2	
Highways and roads, paved (cement or asphalt)	X20	X20-2	B	Low	9	Baronik Street	2	
Septic systems (serves one or more single-family homes)	R02	R2-6	B	Low	10	Along Totem Road	3	
Septic systems (serves one or more single-family homes)	R02	R2-10	B	Low		Along One-hundred-twelfth Ave.	3	
Septic systems (serves one or more single-family homes)	R02	R2-11	B	Low		Along Baronik Street	3	
Septic systems (serves one or more single-family homes)	R02	R2-12	B	Low		Along Baronik Street	3	
Septic systems (serves one or more single-family homes)	R02	R2-13	B	Low		Along One-hundred-twelfth Ave.	3	
Septic systems (serves one or more single-family homes)	R02	R2-7	B	Low		Along Totem Road	3	
Septic systems (serves one or more single-family homes)	R02	R2-8	B	Low		Along Totem Road	3	
Septic systems (serves one or more single-family homes)	R02	R2-9	B	Low		Along Totem Road	3	

Table 4 (continued)

Contaminant Source Inventory and Risk Ranking for
Hillside Baptist Church
Sources of Volatile Organic Chemicals


PWSID 213514.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Overall Rank after Analysis</i>	<i>Location</i>	<i>Map Number</i>	<i>Comments</i>
Residential Areas	R01	R1-3	C	Low		Residential areas located within Zone C	2	
Septic systems (serves one or more single-family homes)	R02	R2-14 - 31	C	Low		All septic systems located within Zone C	3	
Highways and roads, paved (cement or asphalt)	X20	X20-3 - 9	C	Low		All roads located within Zone C	2	
Dog walking areas/foot trails	X46	X46-1 - 3	C	0		Trails located within Zone C	2	


APPENDIX C

Hillside Baptist Church's Drinking Water Protection Area and Potential & Existing Contaminant Source

Drinking Water Protection Area for Hillside Baptist Church and Potential & Existing Sources of Contamination

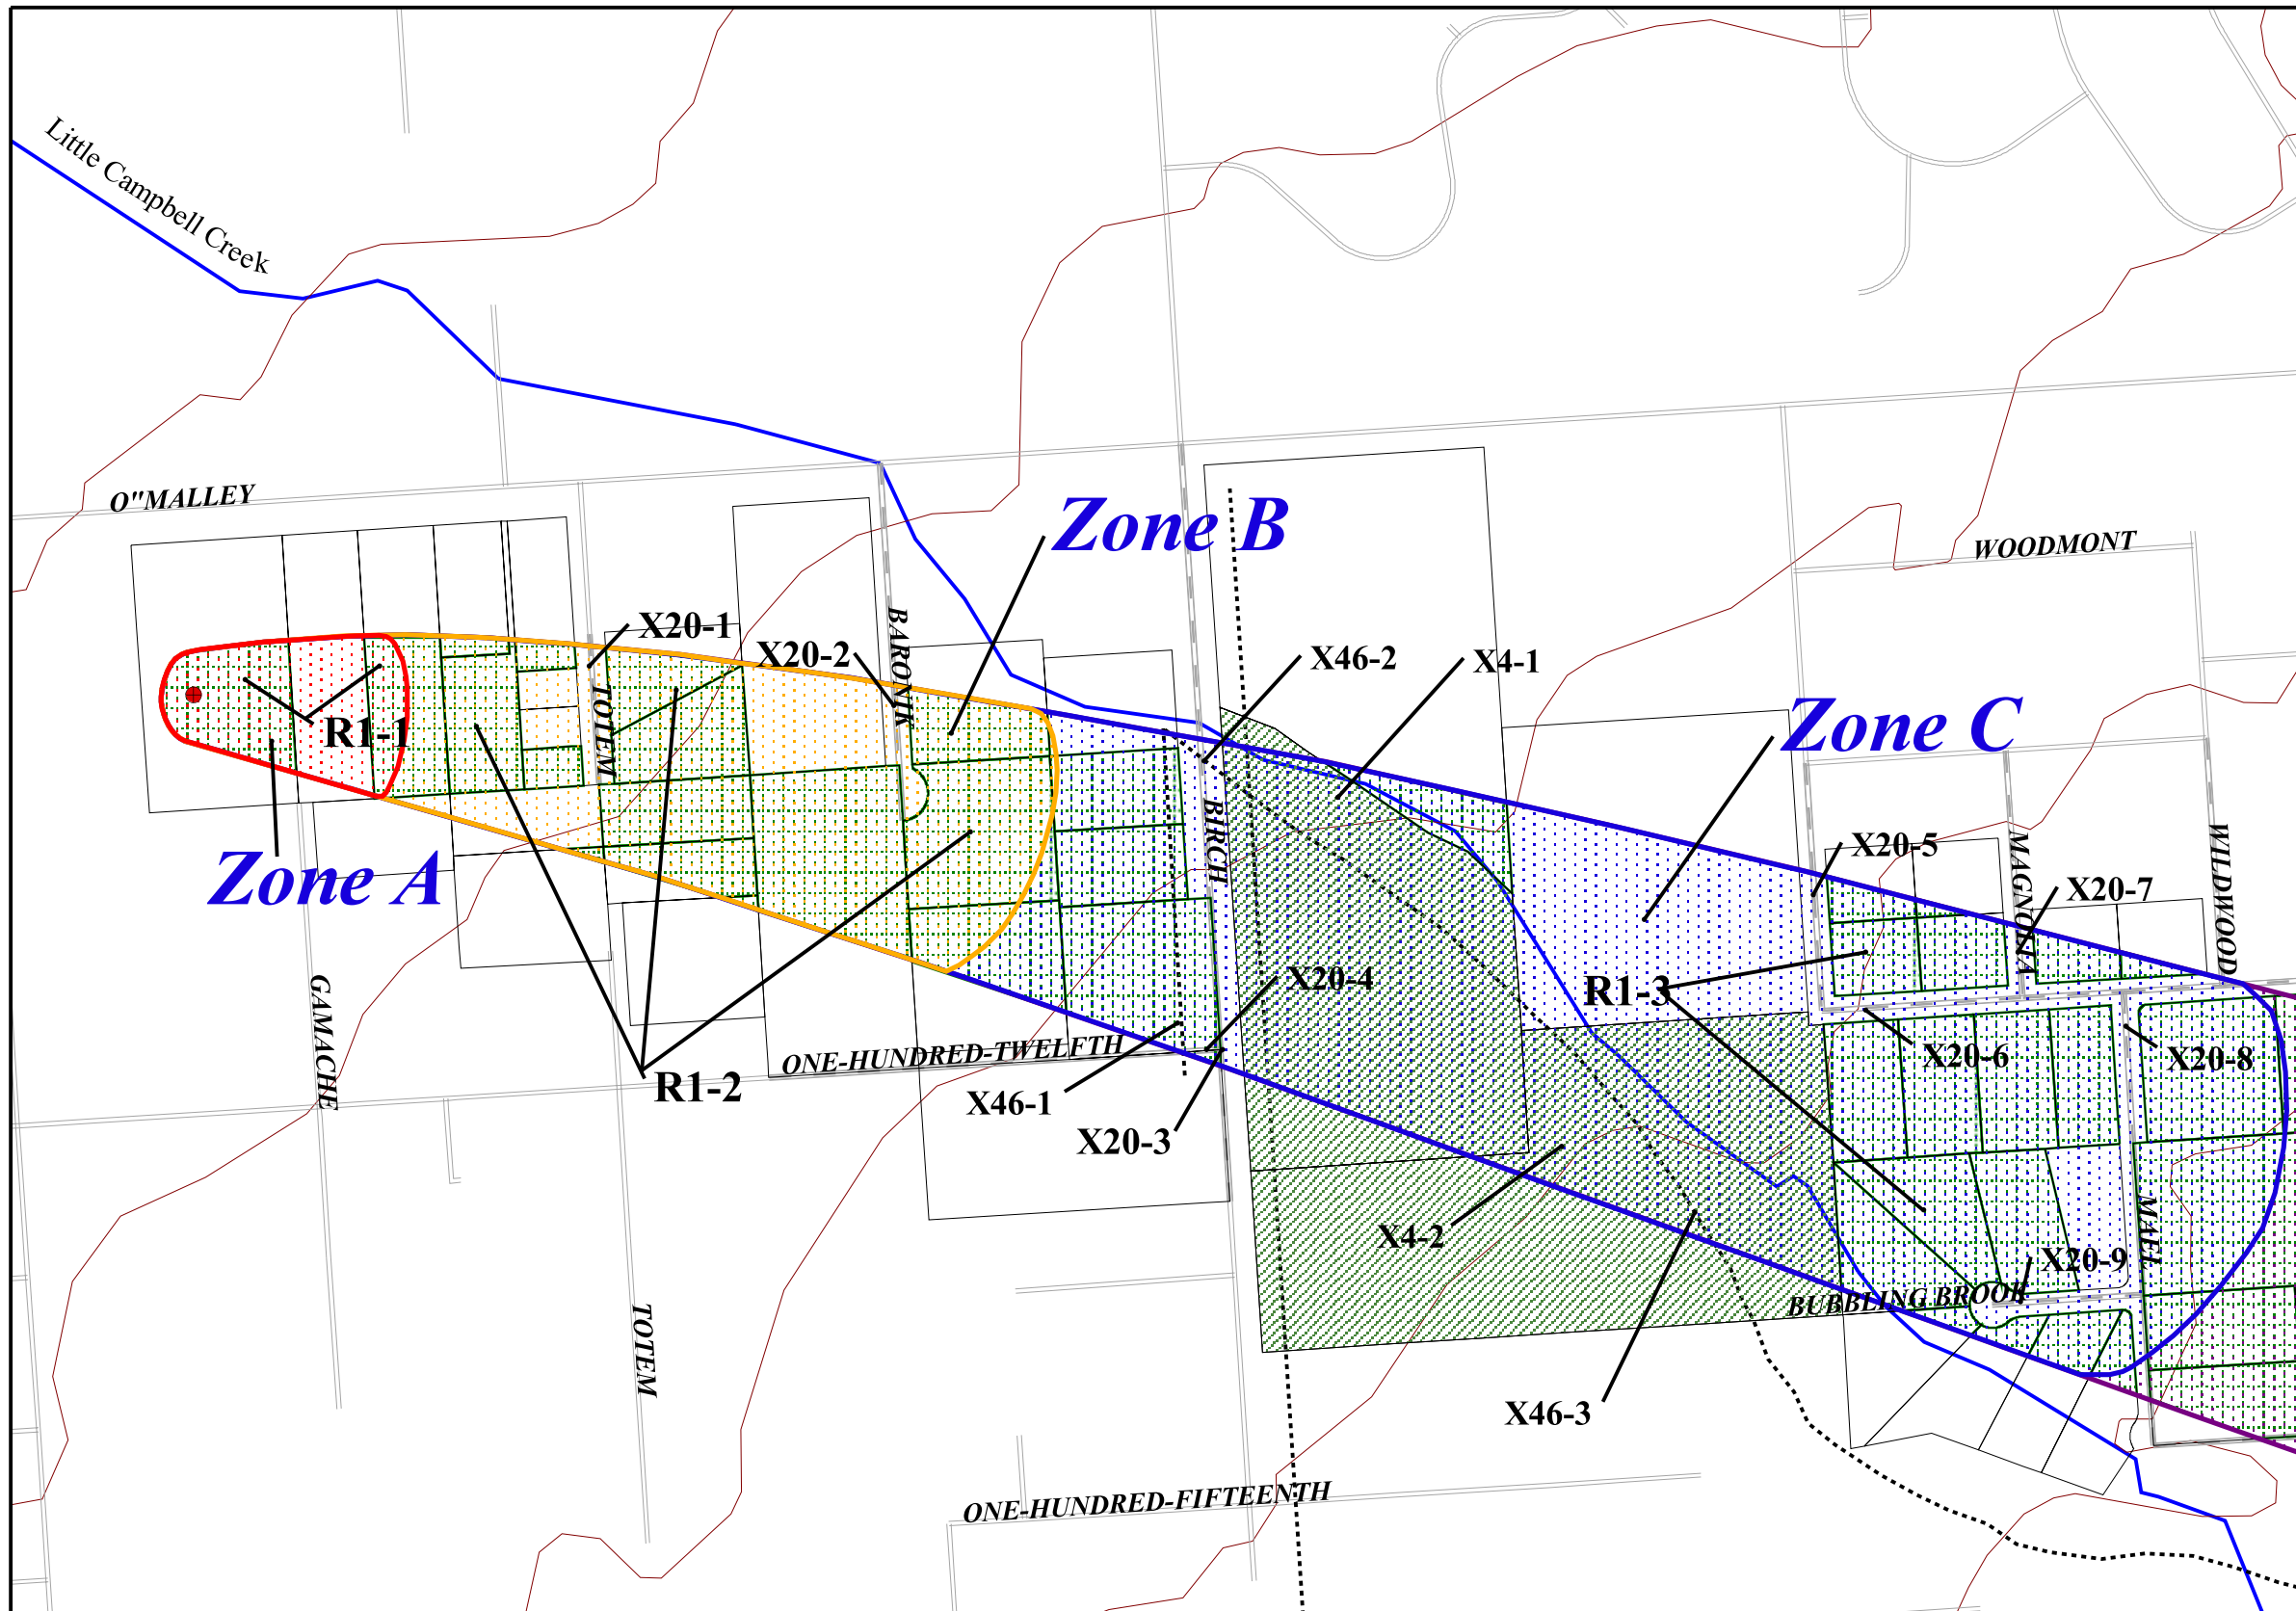

- Hillside Baptist Church DW Well
- Zone A Protection Area**
- Several Months Travel Time
- Zone B Protection Area**
- Less Than 2 Years Travel Time
- Zone C Protection Area**
- Less Than 5 Years Travel Time
- Zone D Protection Area**
- Less Than 10 Years Travel Time
- Moa land parcels.shp
- ▨ Anchorage Parks (X4)
- ▤ Residential Areas (R1)
- ⋯ Trails (X46)
- ⋯ Roads (X20)
- MOA Lakes
- Elevation Contours
- Anchorage Streams

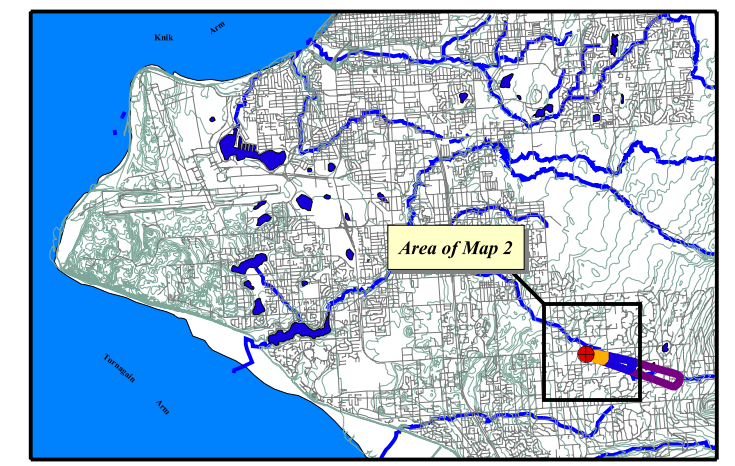


1000 0 1000 2000 Feet



PWSID 213514.001

Map 2

Drinking Water Protection Area for Hillside Baptist Church and Potential & Existing Sources of Contamination

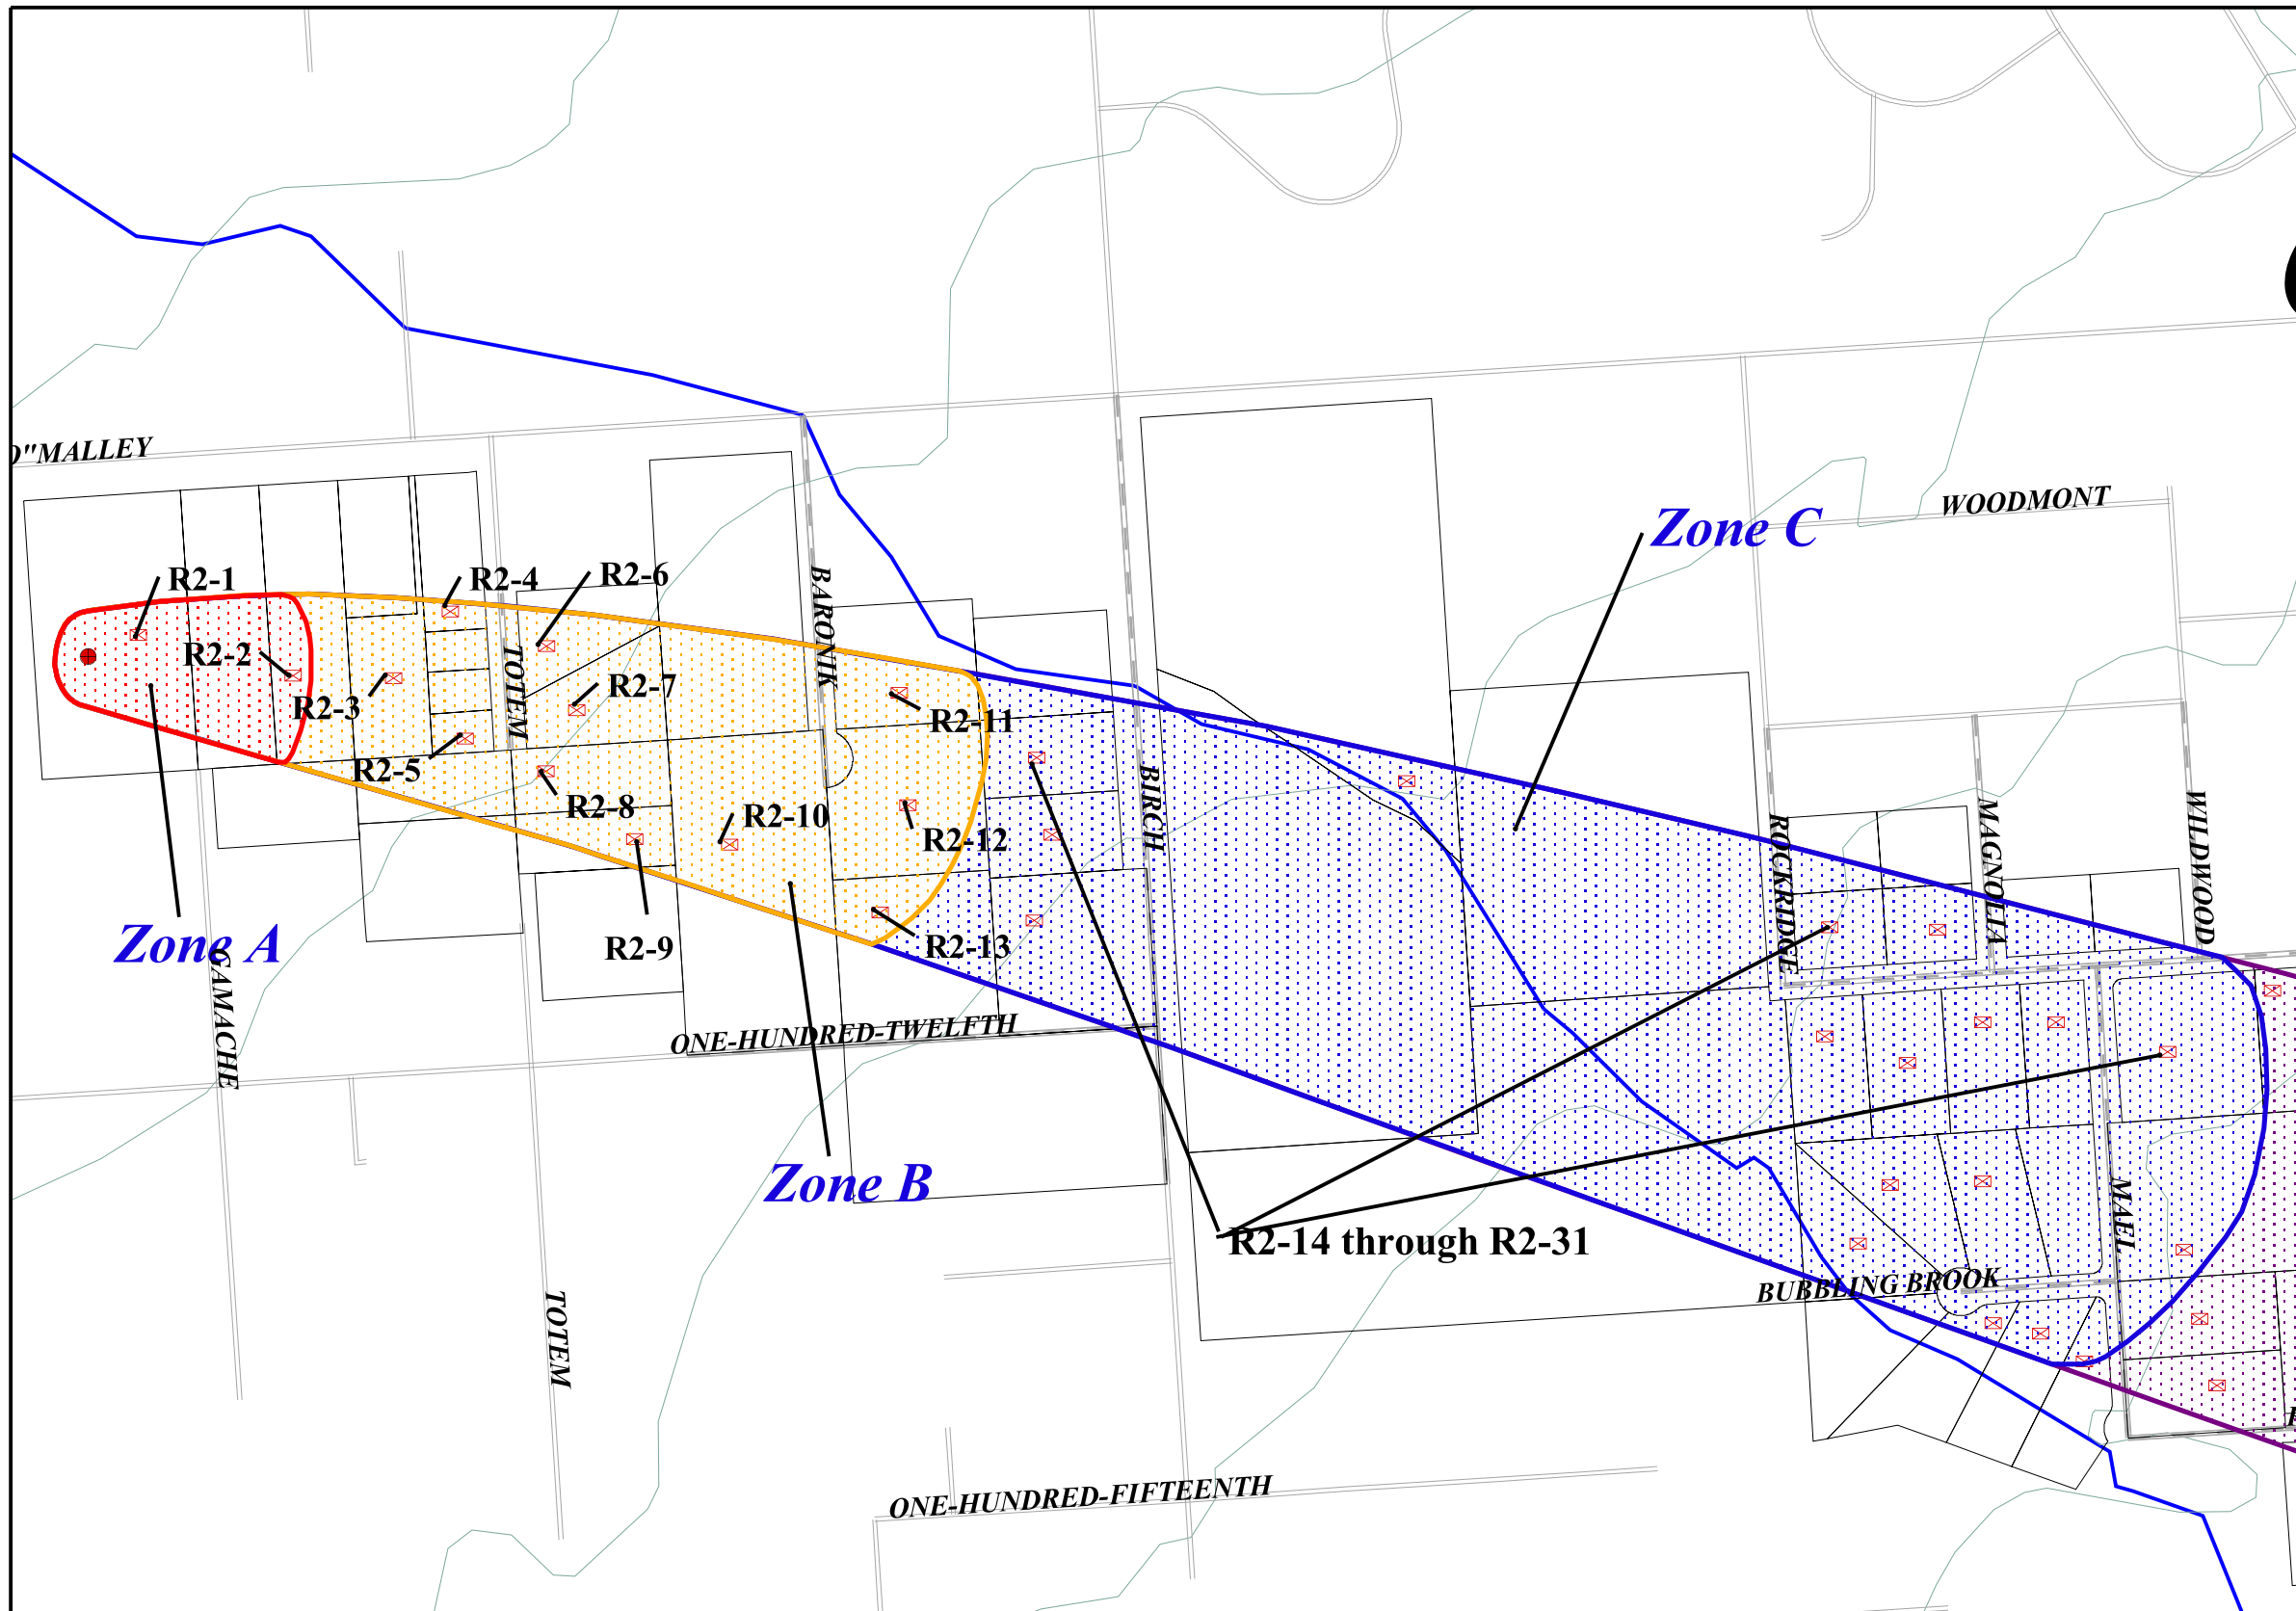


- Hillside Baptist Church DW Well
- Zone A Protection Area
 - ▨ Several Months Travel Time
- Zone B Protection Area
 - ▨ Less Than 2 Years Travel Time
- Zone C Protection Area
 - ▨ Less Than 5 Years Travel Time
- Zone D Protection Area
 - ▨ Less Than 10 Years Travel Time
- Moa land parcels.shp
- ▣ Septic Systems (R2)
- ▬ Roads (X20)
- MOA Lakes
- ▬ Elevation Contours
- ▬ Anchorage Streams

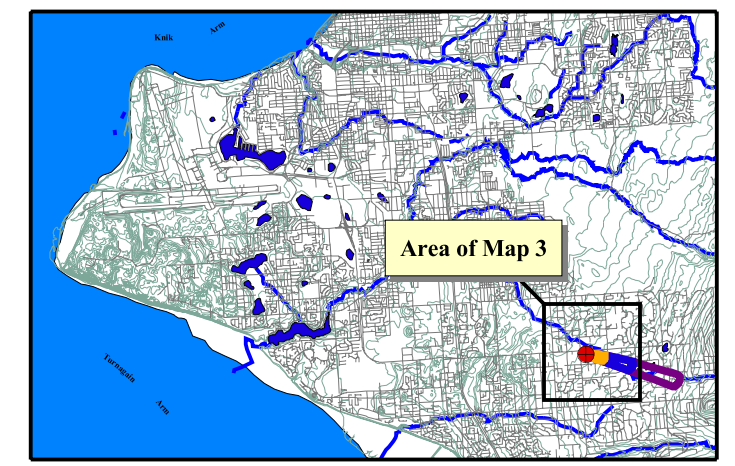



PWSID 213514.001

Map 3

Drinking Water Protection Area for Hillside Baptist Church and Potential & Existing Sources of Contamination

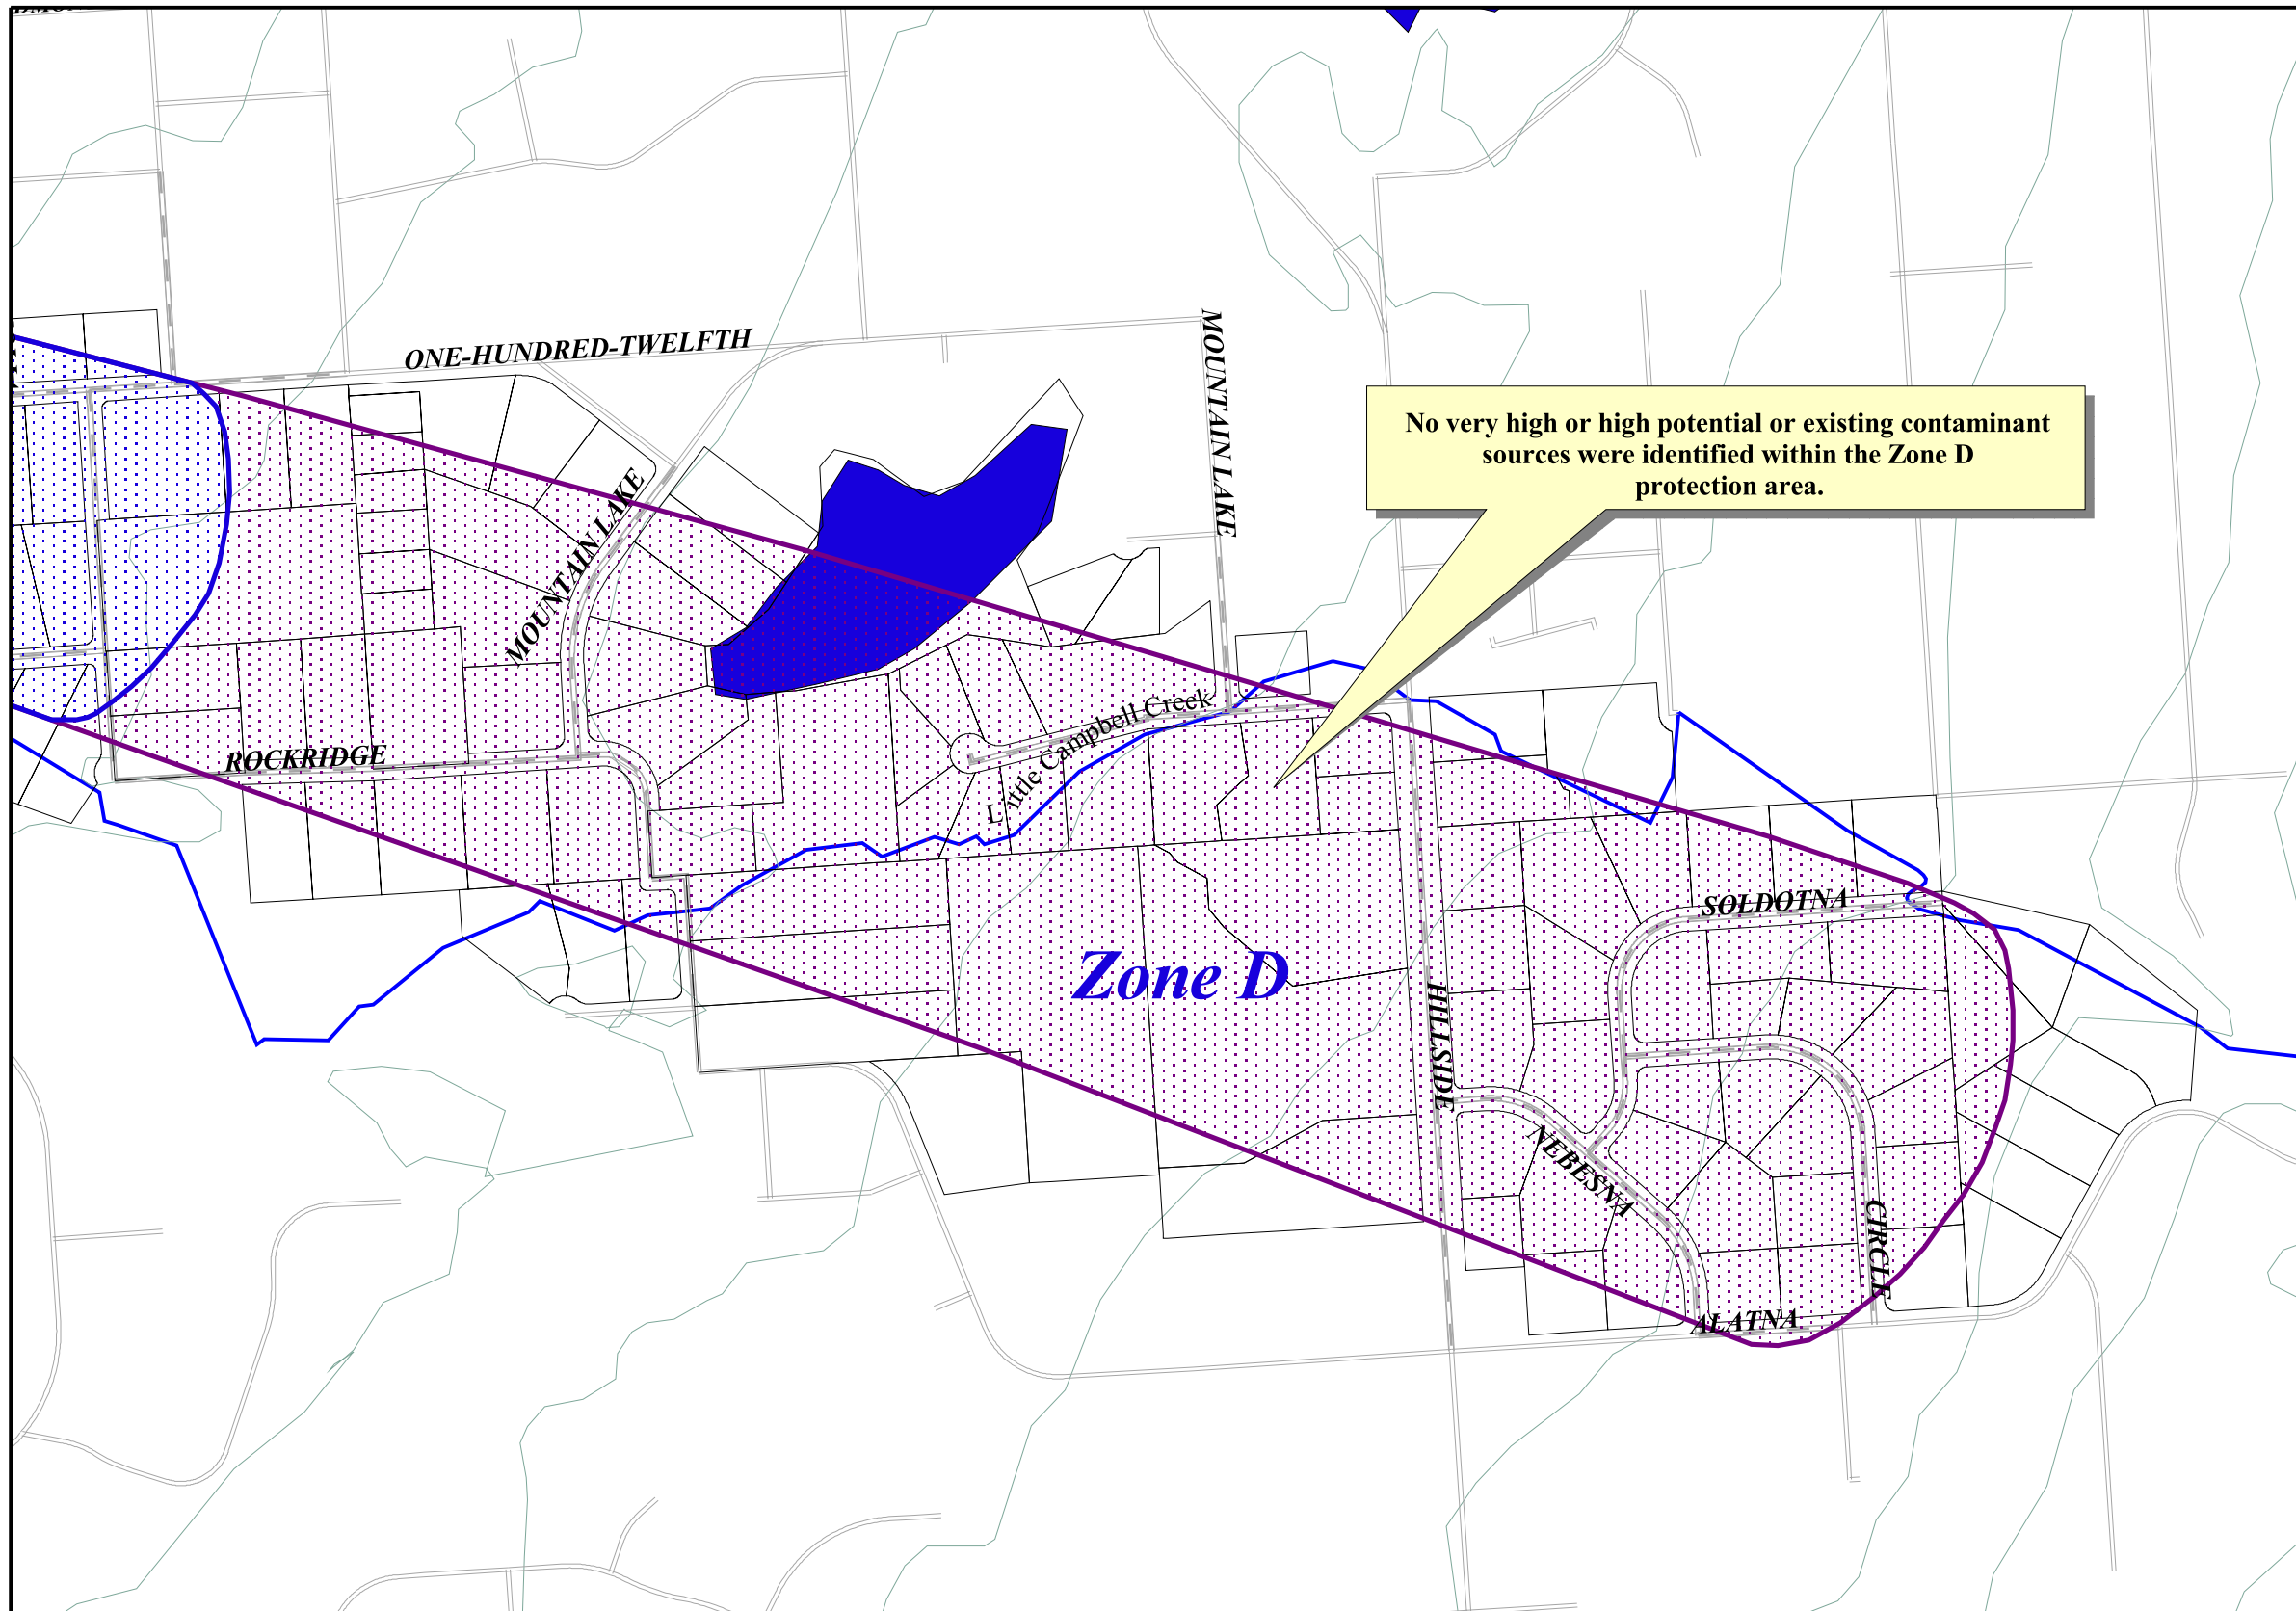

- Hillside Baptist Church DW Well
- Zone A Protection Area**
- ▨ Several Months Travel Time
- Zone B Protection Area**
- ▨ Less Than 2 Years Travel Time
- Zone C Protection Area**
- ▨ Less Than 5 Years Travel Time
- Zone D Protection Area**
- ▨ Less Than 10 Years Travel Time
- Moa land parcels.shp
- Roads (X20)
- MOA Lakes
- Elevation Contours
- Anchorage Streams

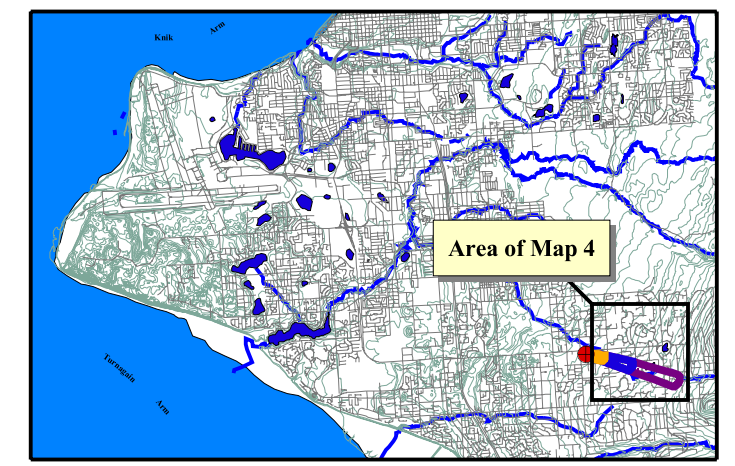

1000 0 1000 2000 Feet


PWSID 213514.001

Map 4

APPENDIX D

Vulnerability Analysis for Hillside Baptist Church's Public Drinking Water Source

Chart 1. Susceptibility of the wellhead - Hillside Baptist Church

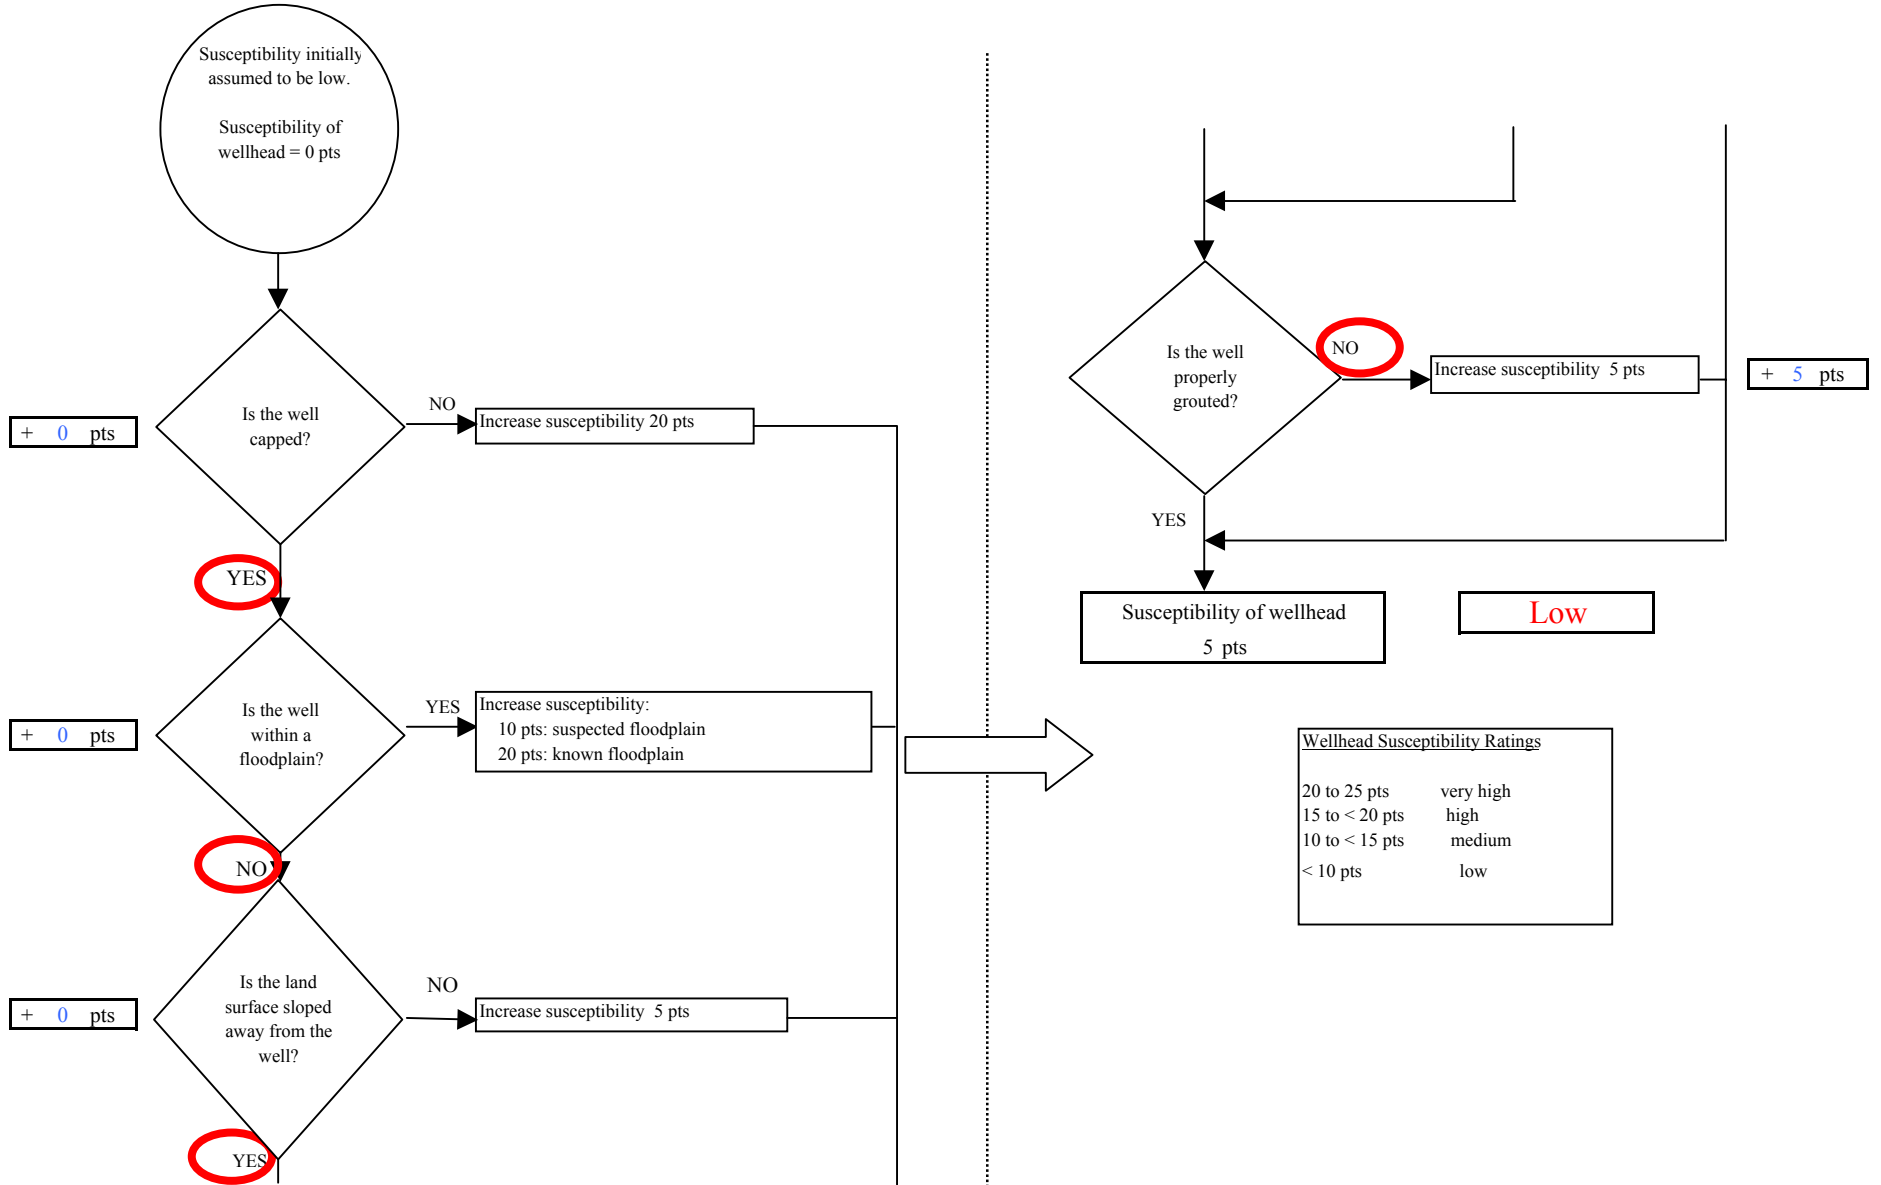

Wellhead Susceptibility Ratings	
20 to 25 pts	very high
15 to < 20 pts	high
10 to < 15 pts	medium
< 10 pts	low

Chart 2. Susceptibility of the aquifer - Hillside Baptist Church




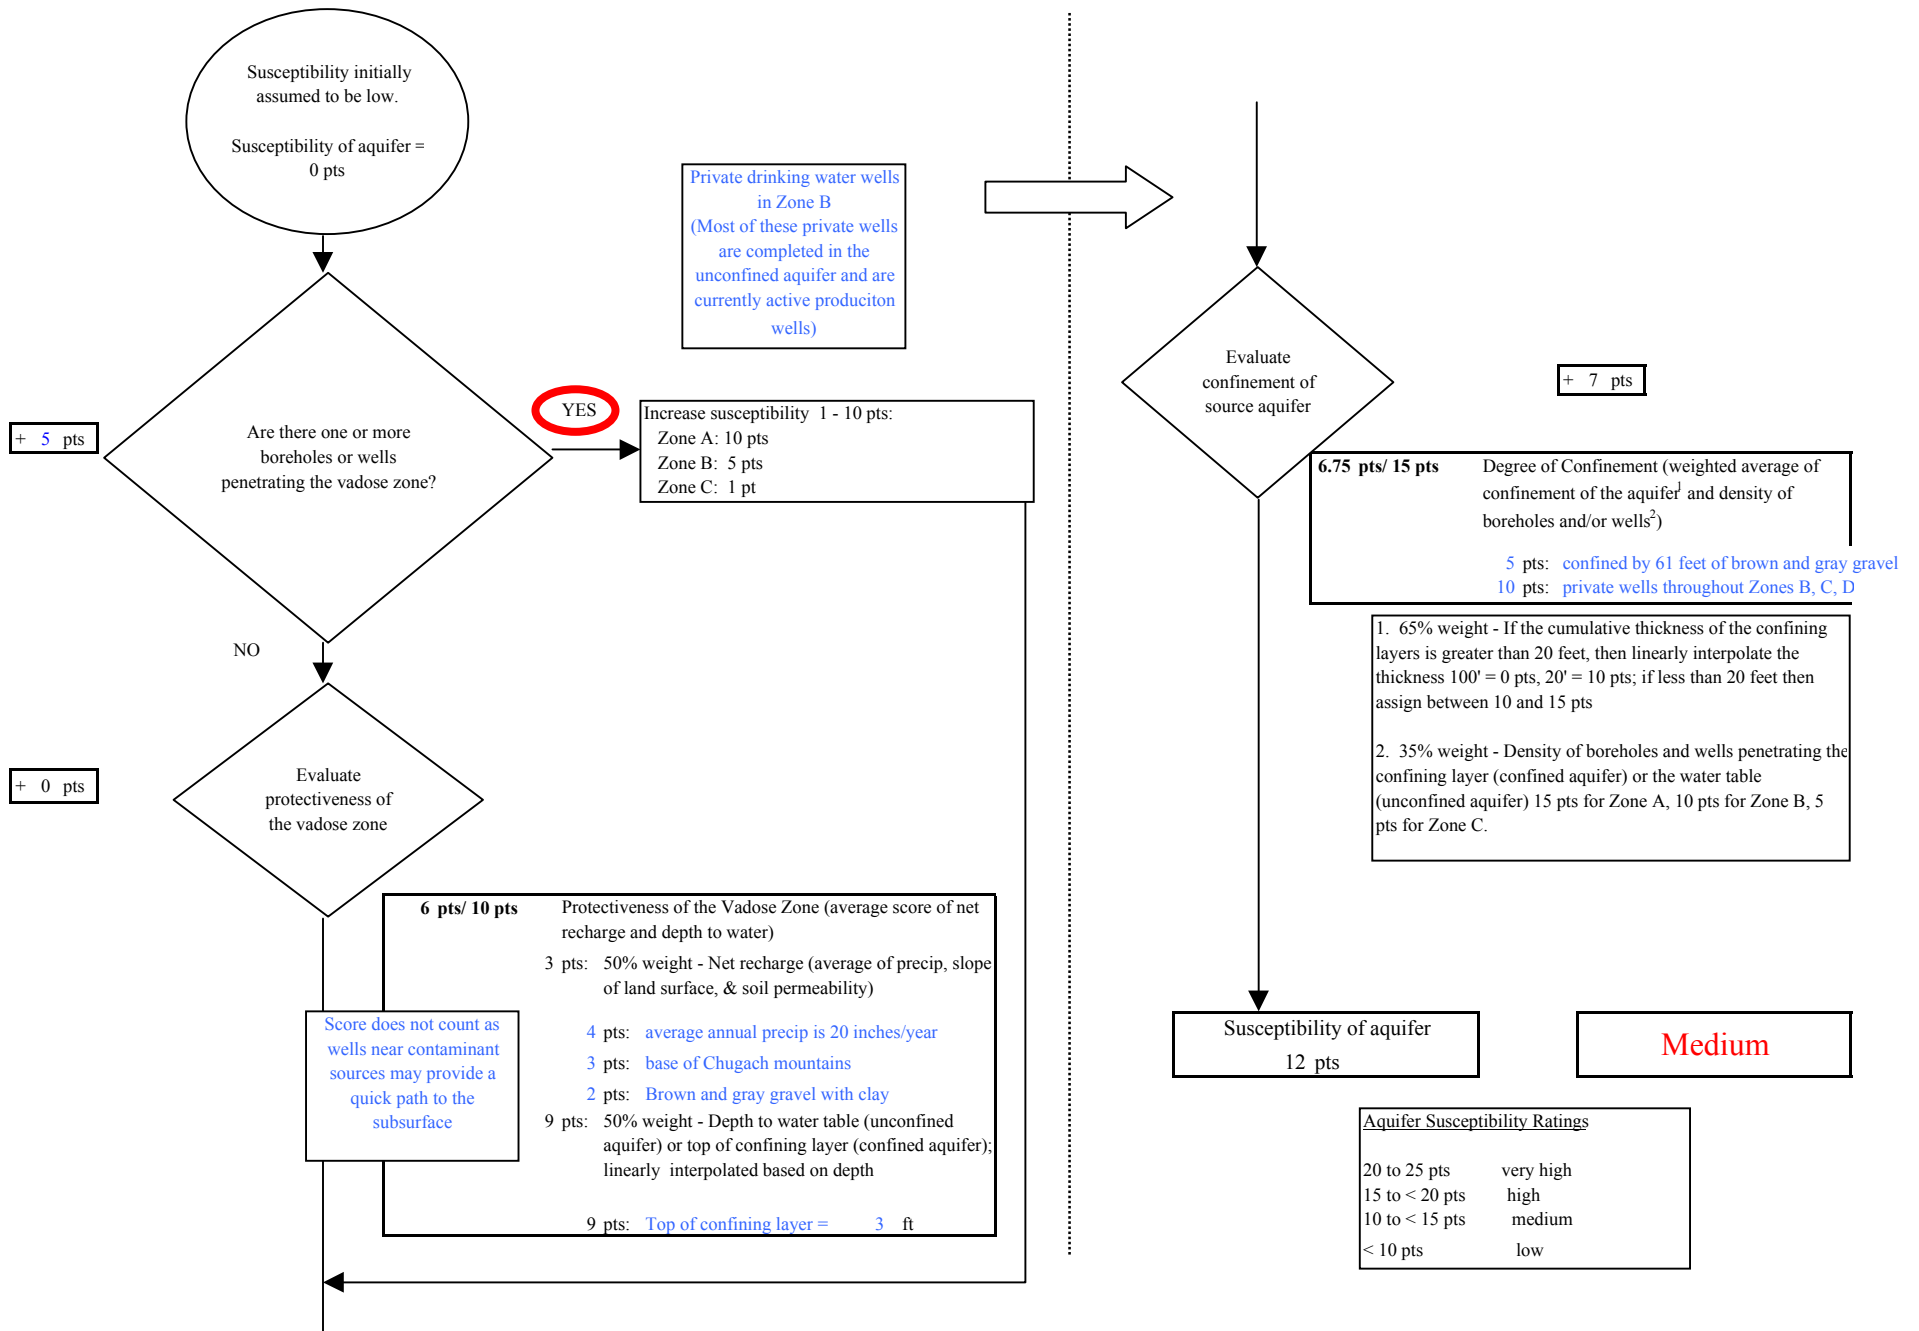


Chart 3. Contaminant risks for Hillside Baptist Church - Bacteria & Viruses

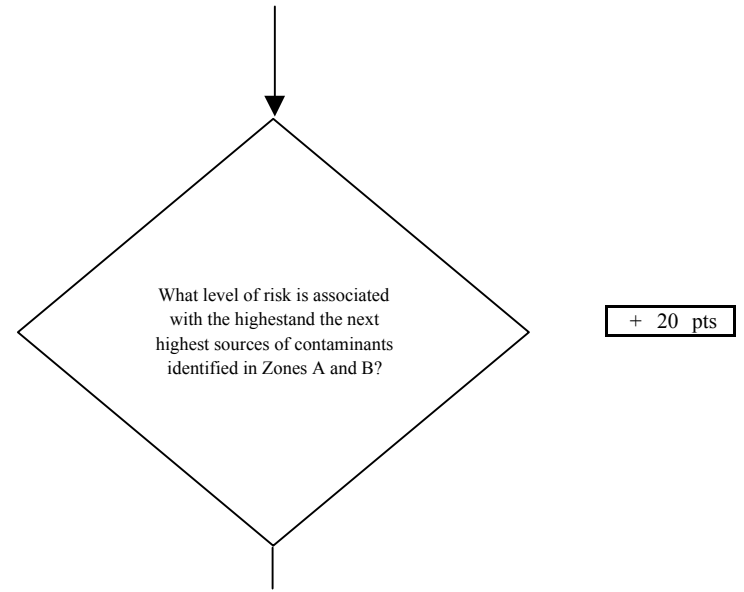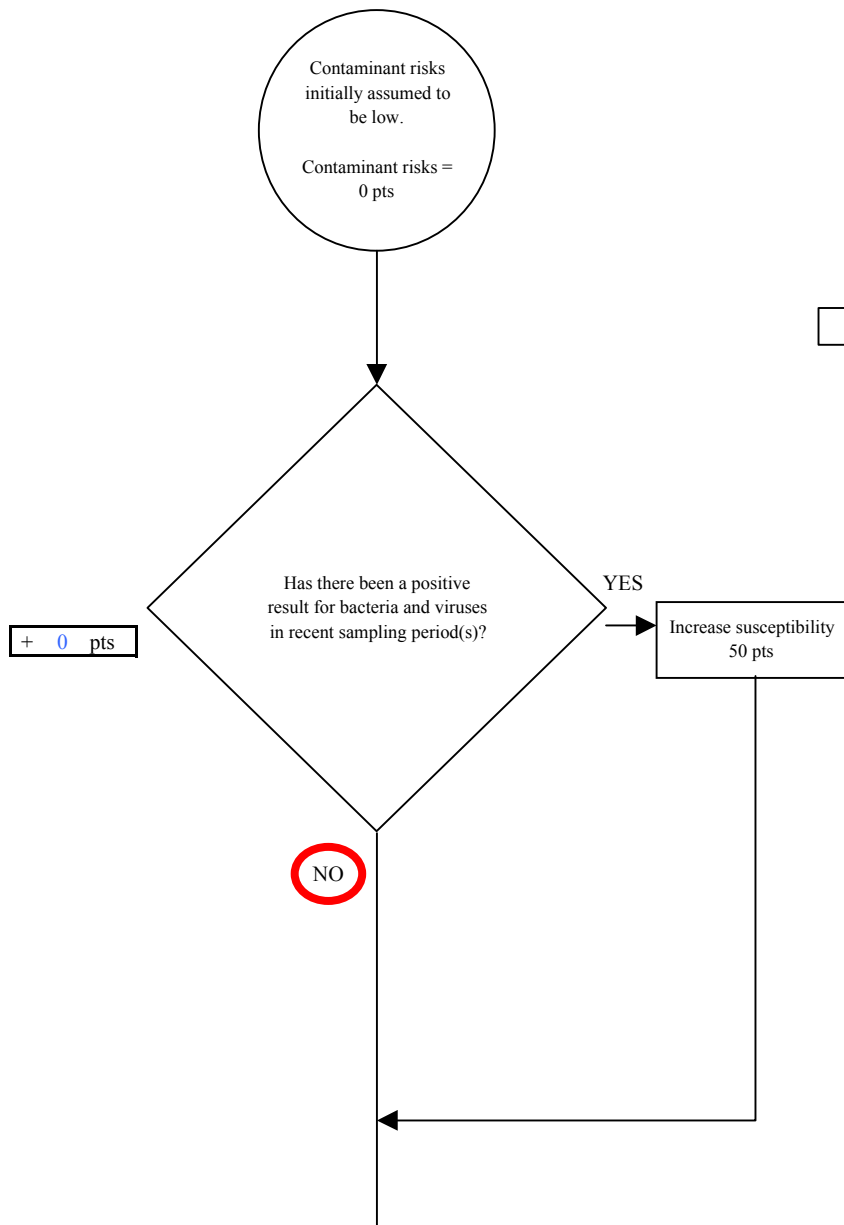

Risk Rankings for Contaminant Sources Identified in Zones A and B




	Zone A	Zone B	Total
Very High(s)	0	0	0
High(s)	0	0	0
Medium(s)	0	0	0
Low(s)	3	17	20

	LOW 10 pts	MEDIUM 20 pts	HIGH 30 pts	VERY HIGH 40 pts
LOW	≥ 10 sources + 10 pts	≥ 10 sources + 5 pts	≥ 20 sources + 5 pts	----
MEDIUM	----	≥ 2 sources + 5 pts	≥ 5 sources + 5 pts	≥ 10 sources + 5 pts
HIGH	----	----	≥ 1 source + 10 pts	≥ 2 sources + 10 pts
VERY HIGH	----	----	----	≥ 1 source + 10 pts

Matrix Score 20

Note: Septic systems, sewerlines, and roads are each assigned a risk ranking for each individual contaminant source in the CSI. The VA, however, counts these contaminant sources as a group and assigns a calculated number of either "lows" or "mediums" based on the density.

Chart 3. Contaminant risks for Hillside Baptist Church - Bacteria & Viruses

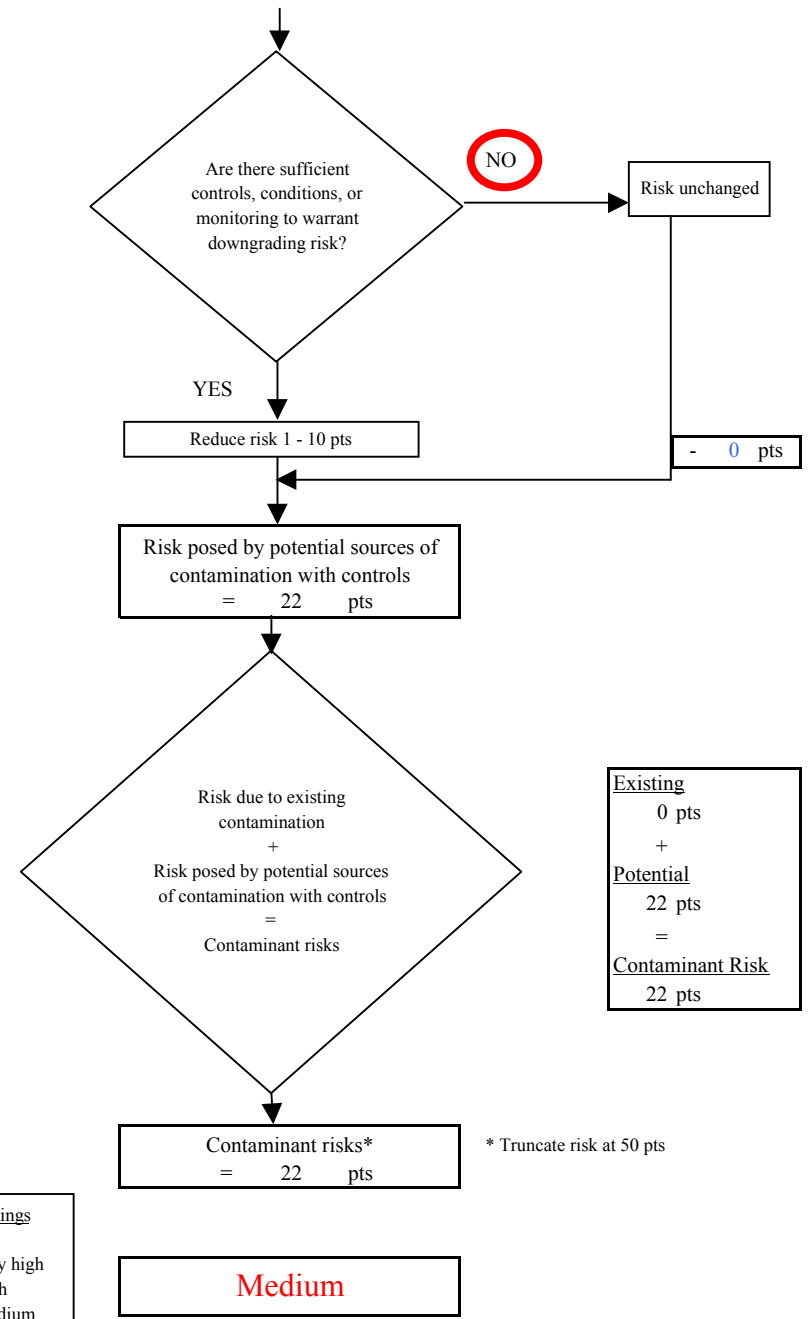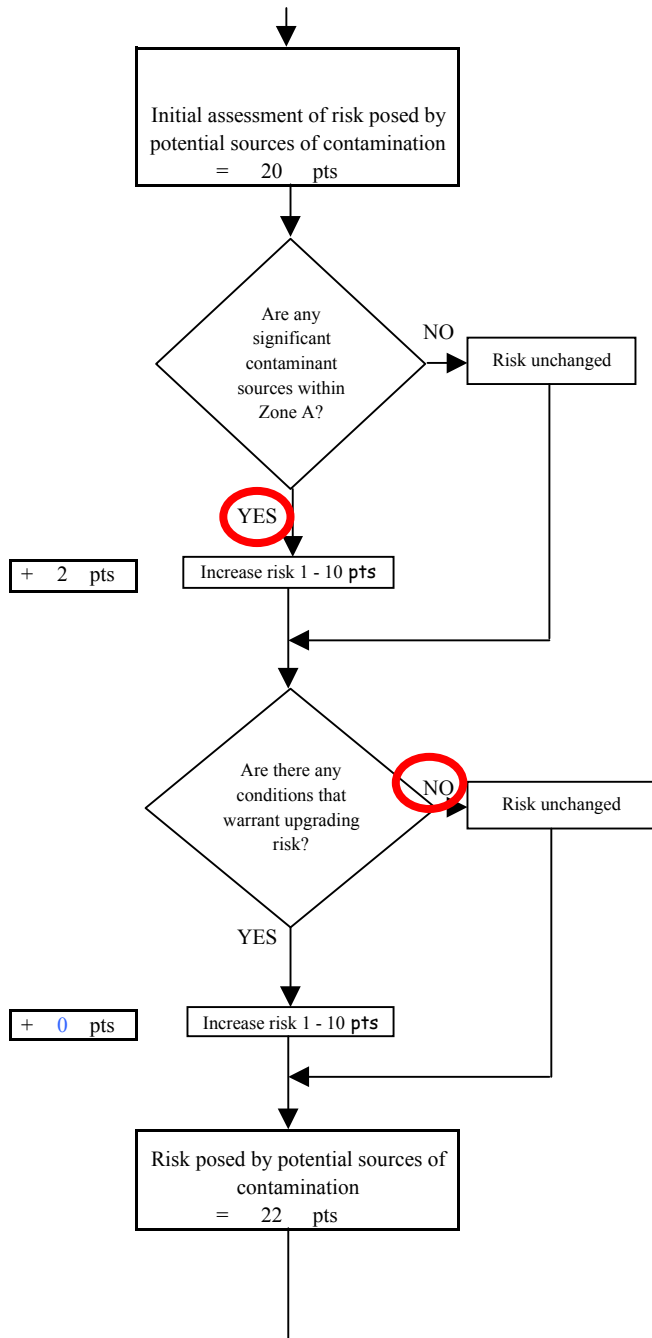

Existing	0 pts
+	
Potential	22 pts
=	
Contaminant Risk	22 pts

Contaminant Risk Ratings	
40 to 50 pts	very high
30 to < 40 pts	high
20 to < 30 pts	medium
< 20 pts	low

* Truncate risk at 50 pts

Chart 4. Vulnerability analysis for Hillside Baptist Church - Bacteria & Viruses

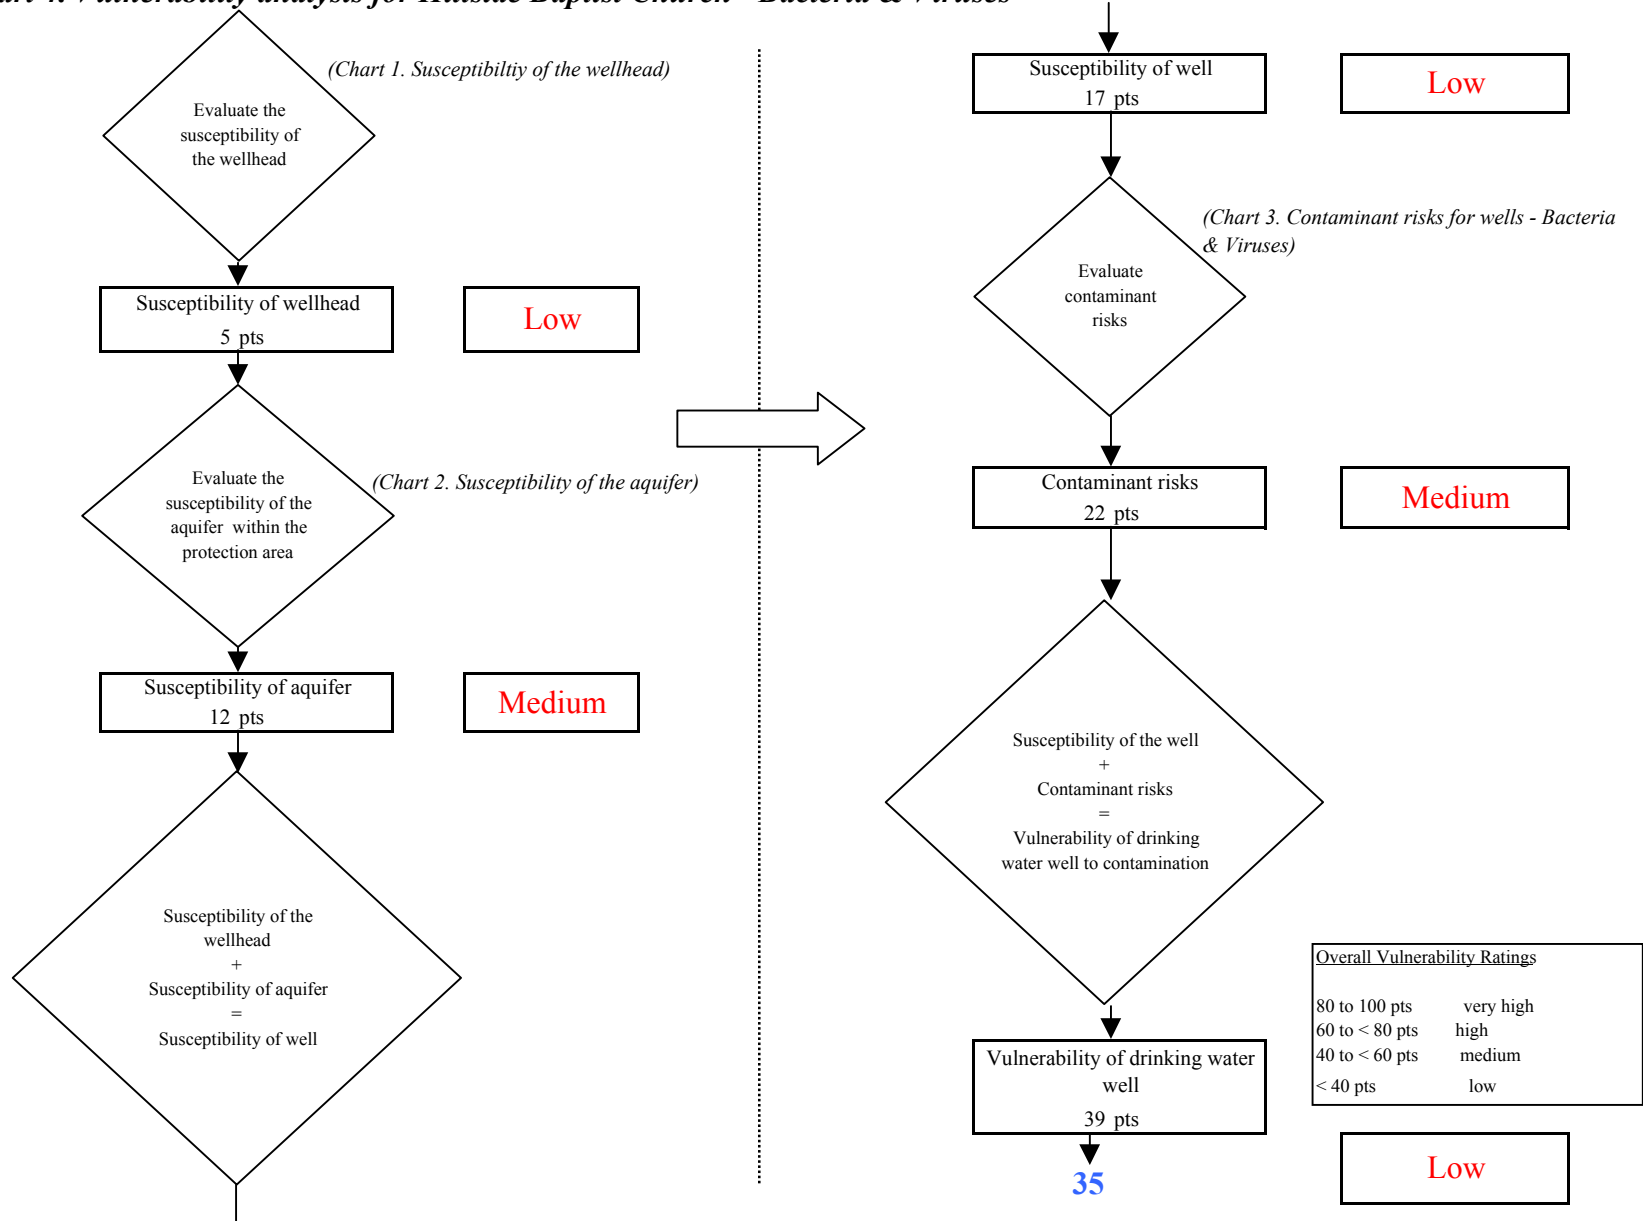


Chart 5. Contaminant risks for Hillside Baptist Church - Nitrates and Nitrites

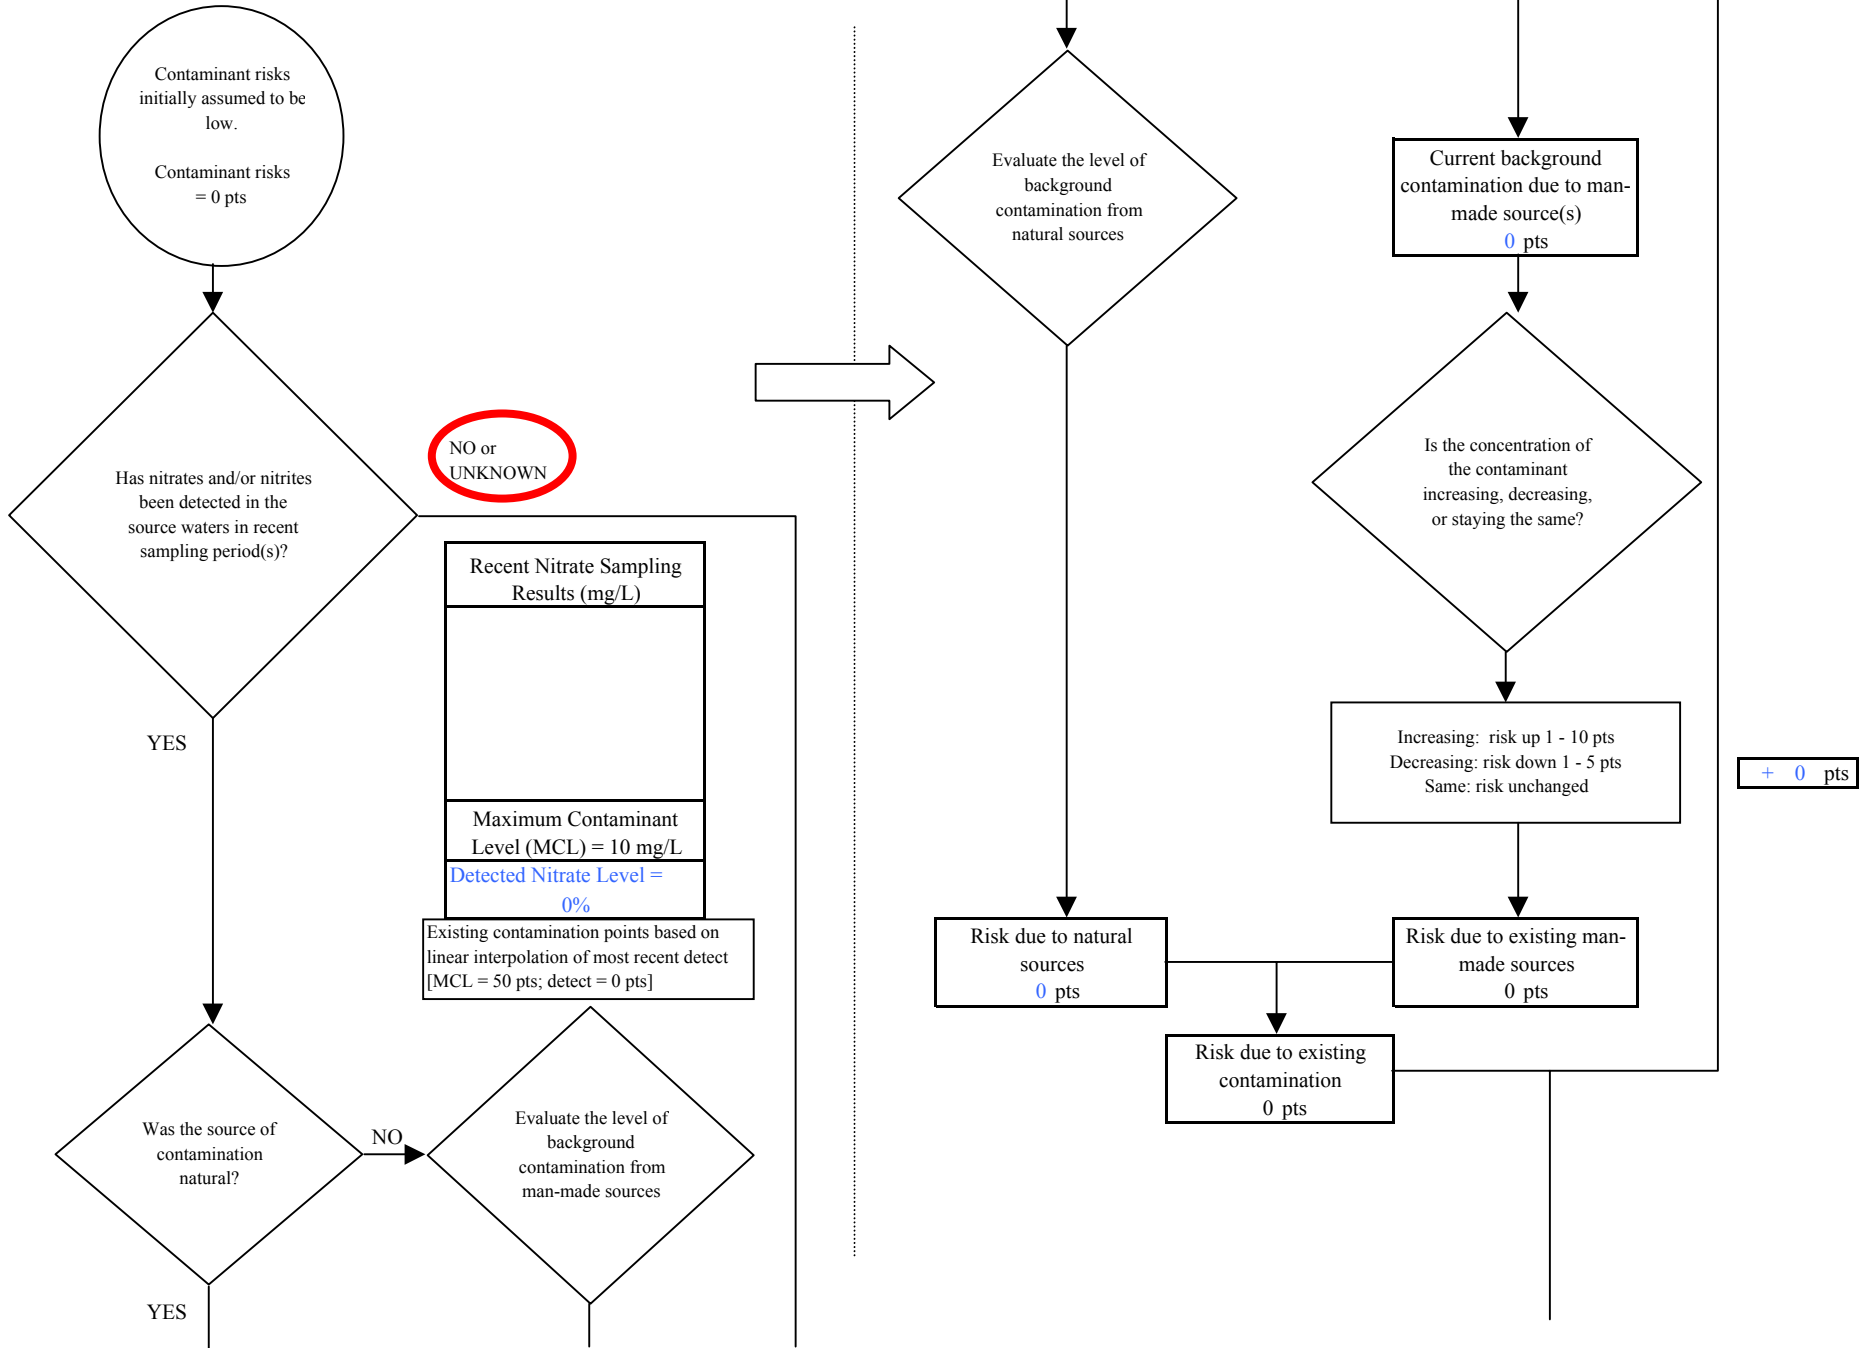


Chart 5. Contaminant risks for Hillside Baptist Church - Nitrates and Nitrites

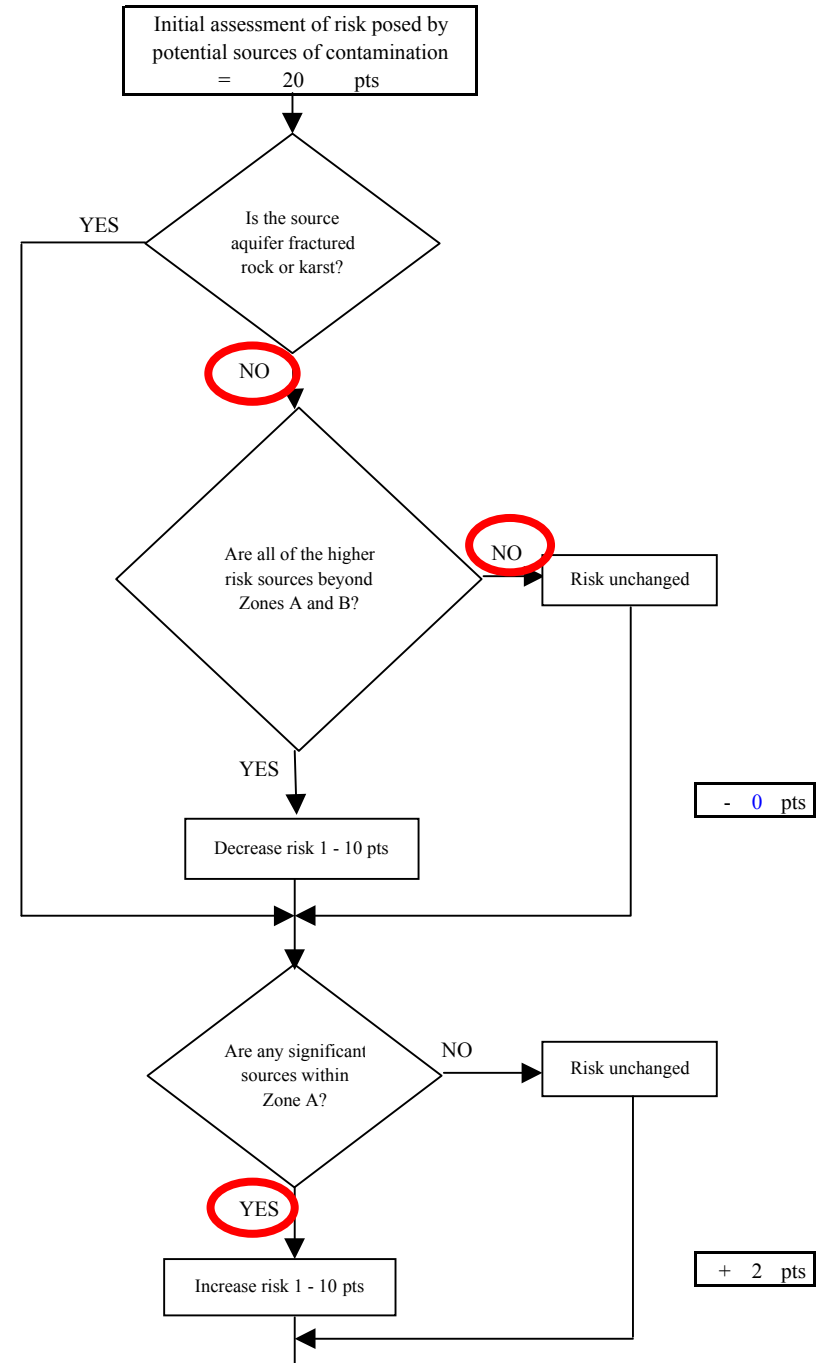

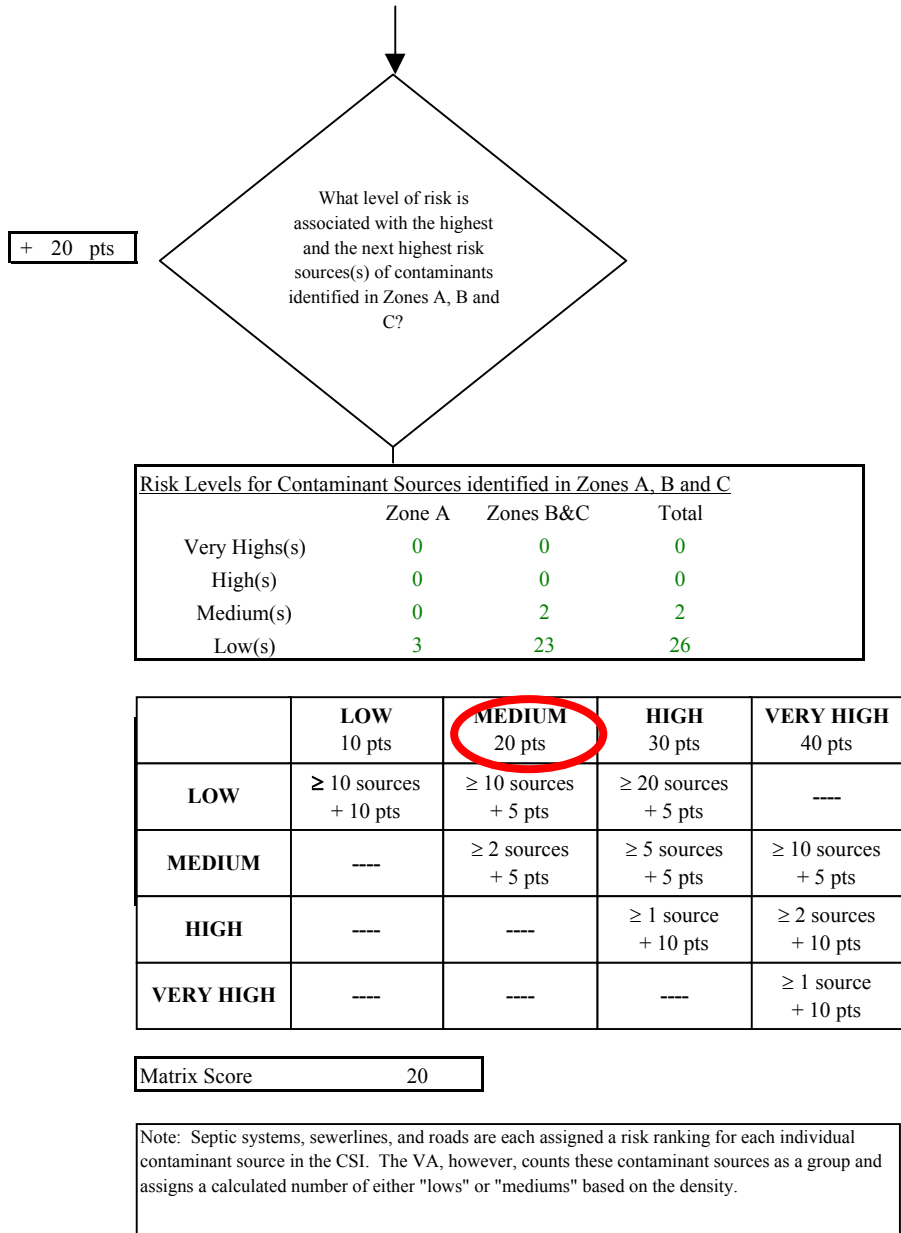


Chart 5. Contaminant risks for Hillside Baptist Church - Nitrates and Nitrites

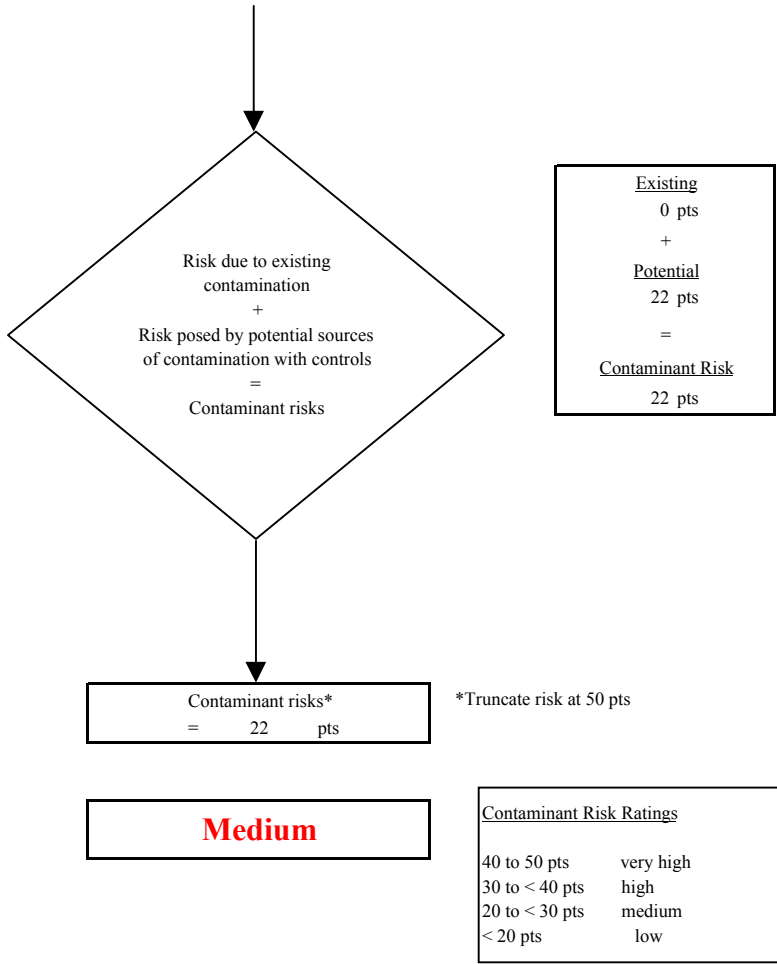

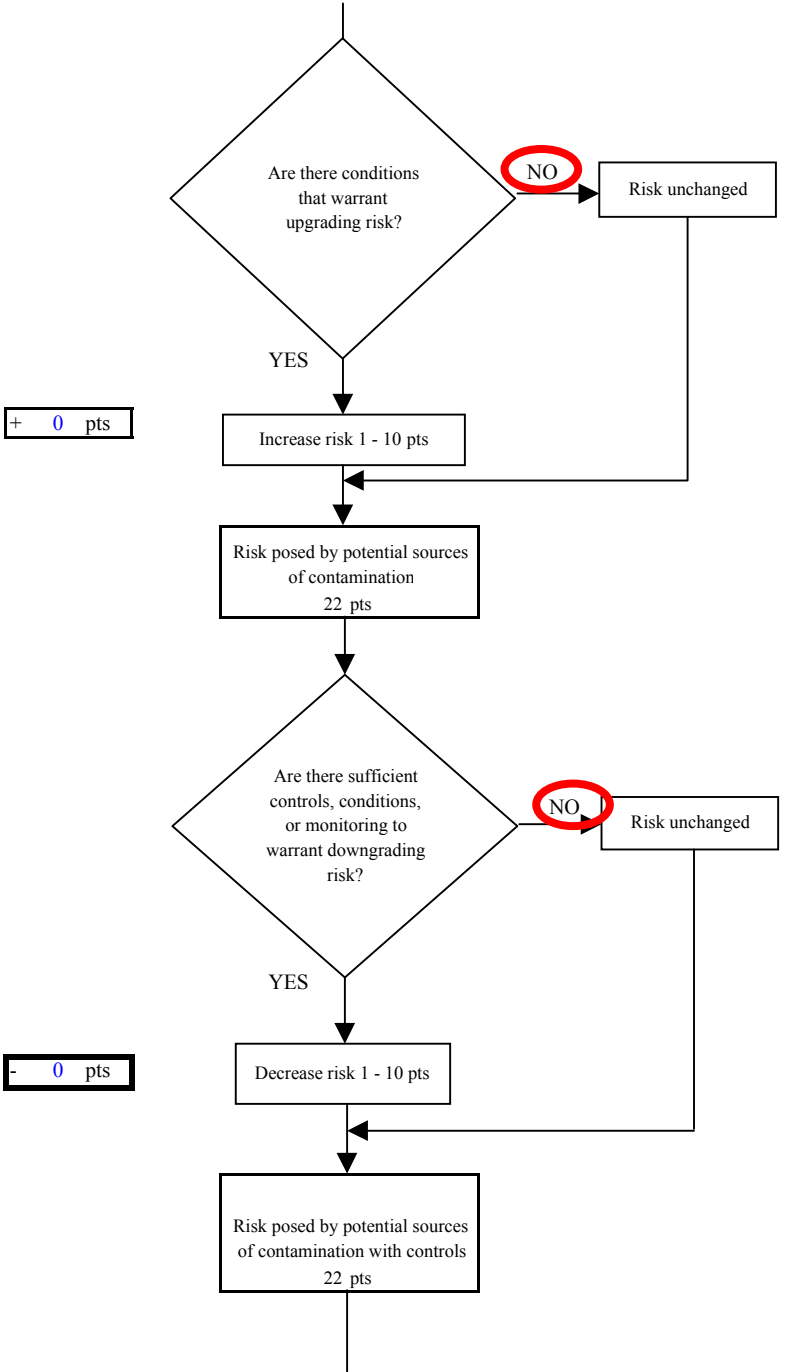


Chart 6. Vulnerability analysis for Hillside Baptist Church - Nitrates and Nitrites

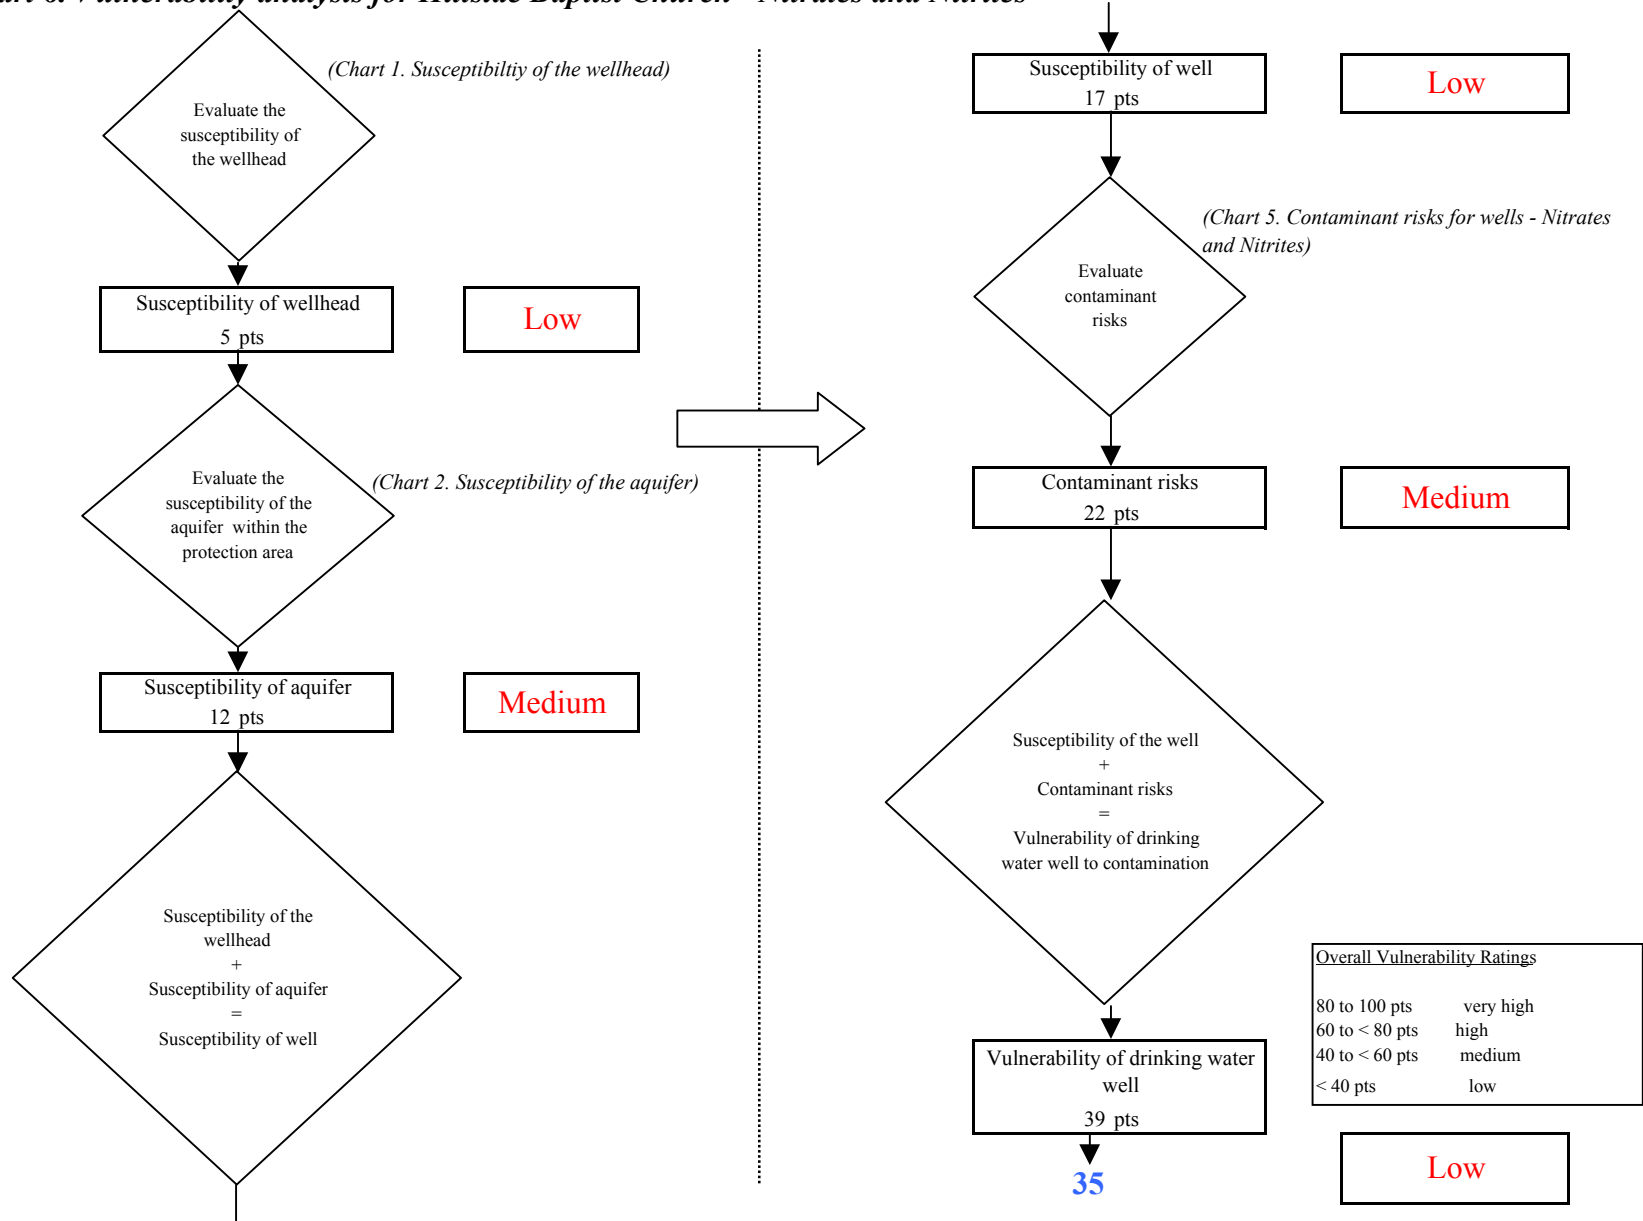


Chart 7. Contaminant risks for Hillside Baptist Church - Volatile Organic Chemicals


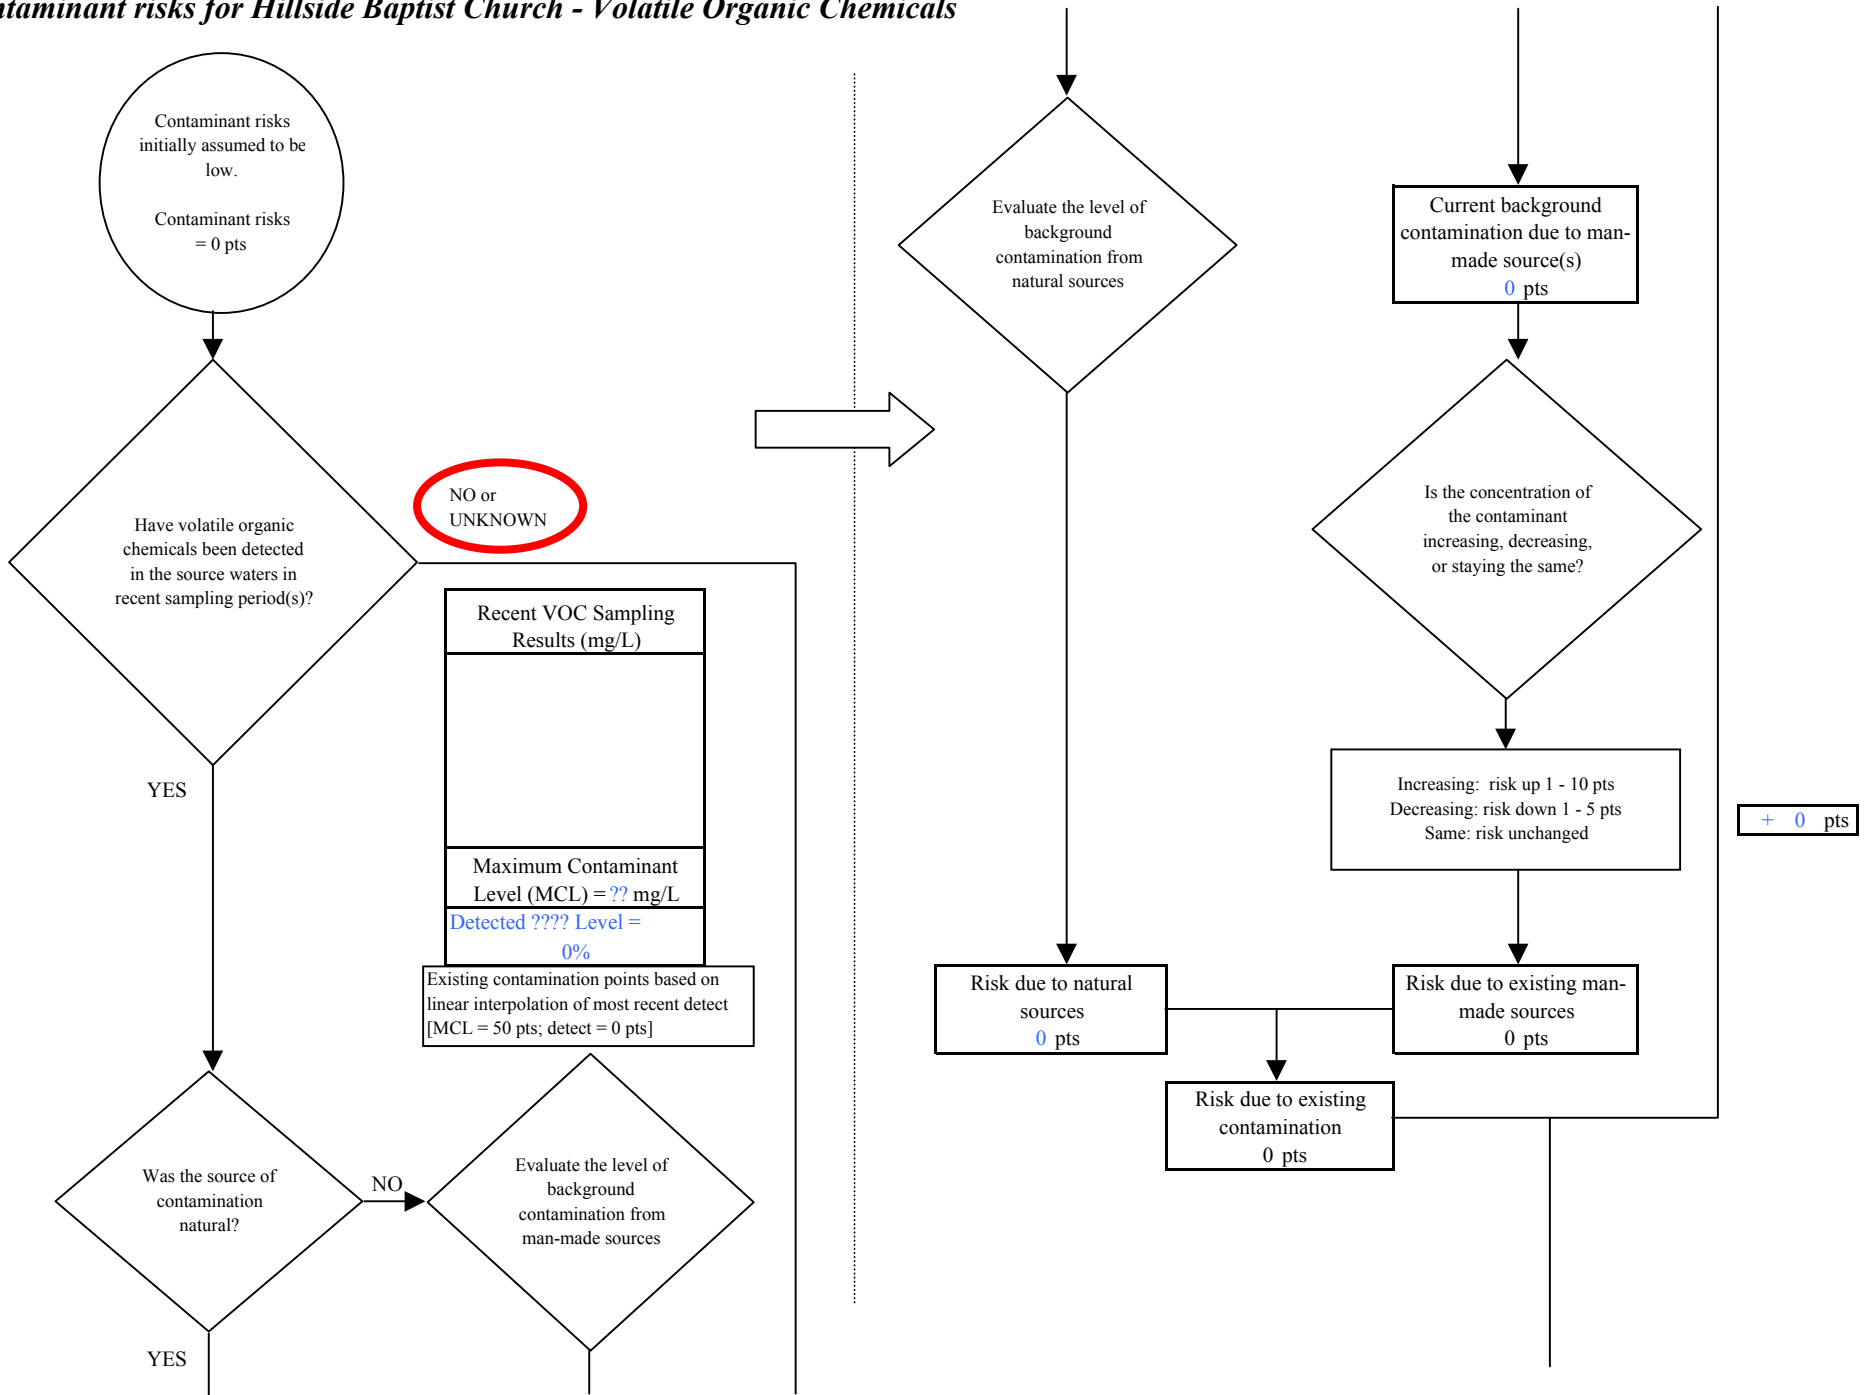


Chart 7. Contaminant risks for Hillside Baptist Church - Volatile Organic Chemicals

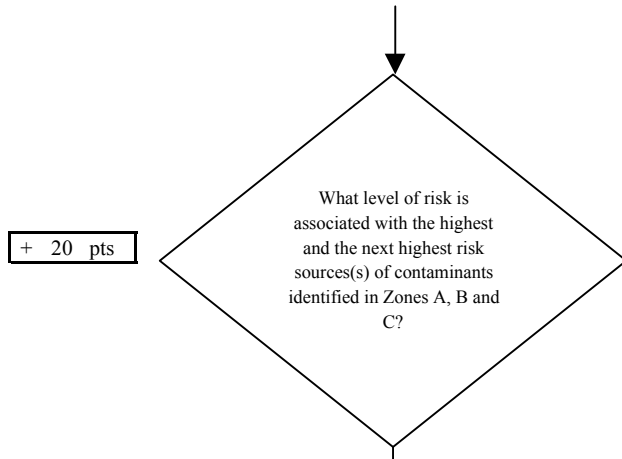

Risk Levels for Contaminant Sources identified in Zones A, B and C			
	Zone A	Zones B&C	Total
Very Highs(s)	0	0	0
High(s)	0	0	0
Medium(s)	0	0	0
Low(s)	4	19	23

	LOW 10 pts	MEDIUM 20 pts	HIGH 30 pts	VERY HIGH 40 pts
LOW	≥ 10 sources + 10 pts	≥ 10 sources + 5 pts	≥ 20 sources + 5 pts	----
MEDIUM	----	≥ 2 sources + 5 pts	≥ 5 sources + 5 pts	≥ 10 sources + 5 pts
HIGH	----	----	≥ 1 source + 10 pts	≥ 2 sources + 10 pts
VERY HIGH	----	----	----	≥ 1 source + 10 pts

Matrix Score 20

Note: Septic systems, sewerlines, and roads are each assigned a risk ranking for each individual contaminant source in the CSI. The VA, however, counts these contaminant sources as a group and assigns a calculated number of either "lows" or "mediums" based on the density.

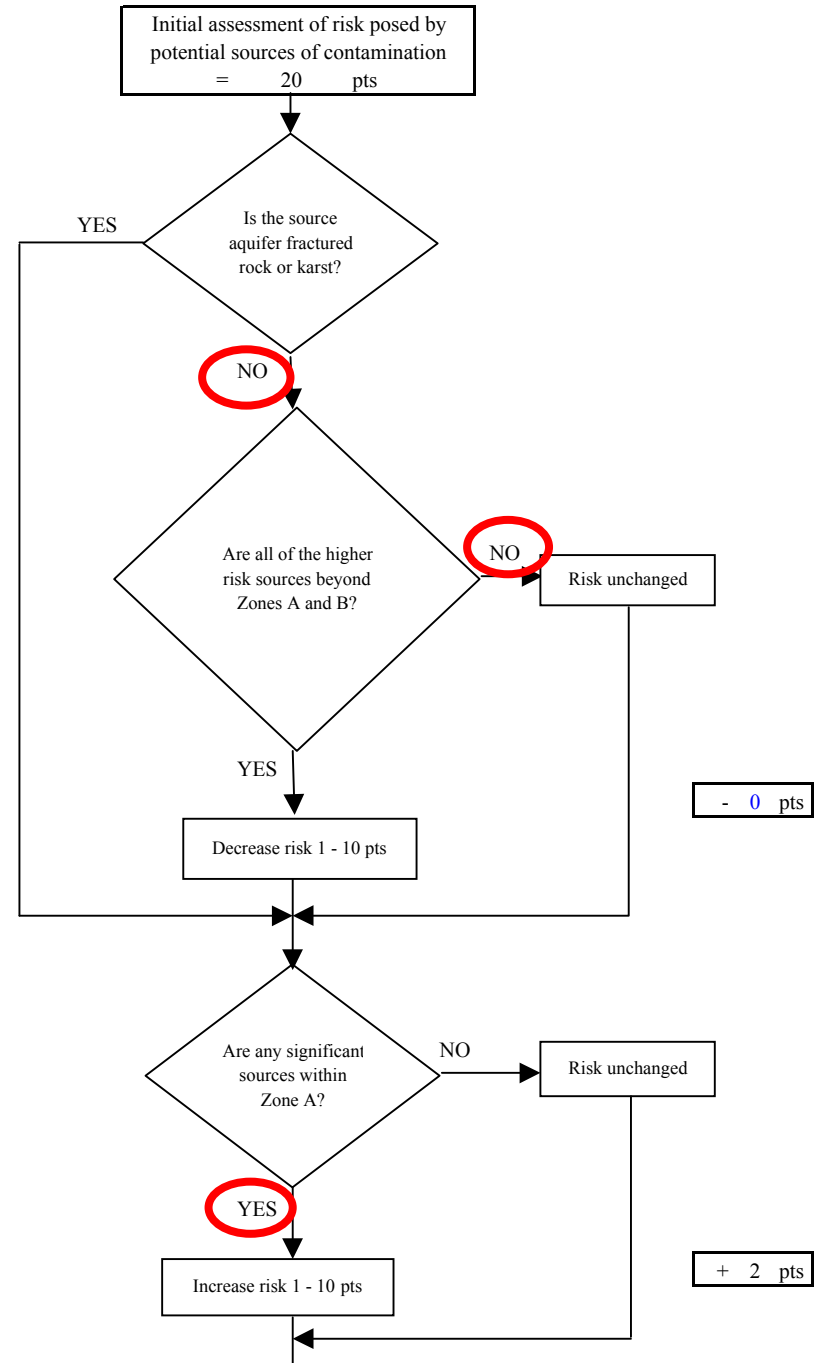



Chart 7. Contaminant risks for Hillside Baptist Church - Volatile Organic Chemicals

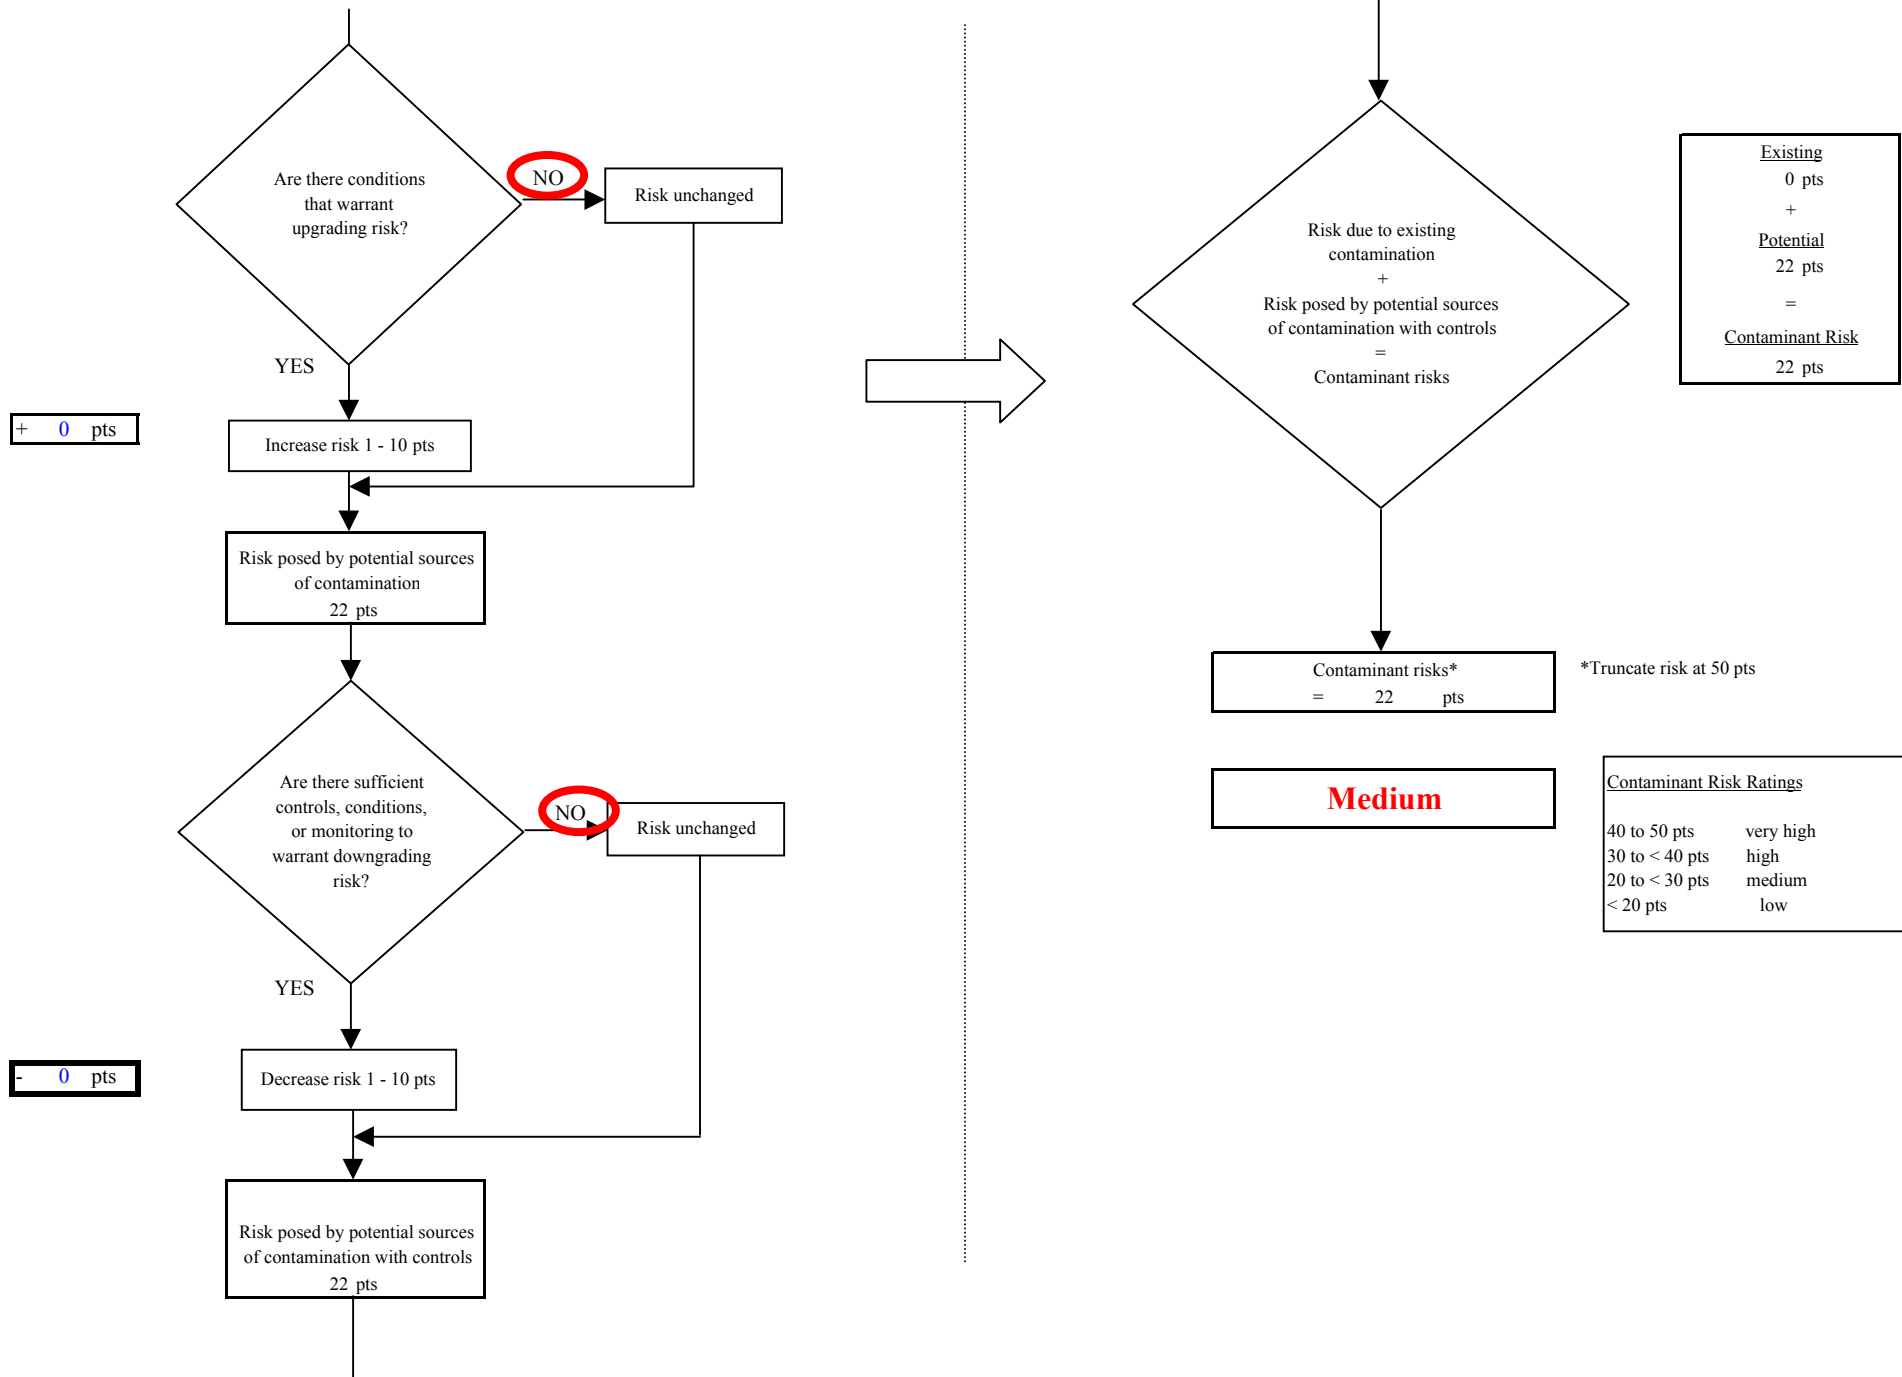


Chart 8. Vulnerability analysis for Hillside Baptist Church - Volatile Organic Chemicals

