

*Source Water Assessment* for  
Homestead Hills  
Anchorage, Alaska

A Hydrogeologic Susceptibility and Vulnerability Analysis

---

DRINKING WATER PROTECTION PROGRAM REPORT 195  
PWSID 211669.001

March 2002

# *Source Water Assessment* for Homestead Hills Anchorage, Alaska

By HEATHER A. HAMMOND

---

DRINKING WATER PROTECTION PROGRAM REPORT 195  
PWSID 211669.001

*The Drinking Water Protection Program is producing Source Water Assessments in compliance with the Safe Drinking Water Act Amendments of 1996. Each assessment includes a delineation of the source water area, an inventory of potential and existing contaminant sources that may impact the water, a risk ranking for each of these contaminants, and an evaluation of the potential vulnerability of these drinking water sources.*

*These assessments are intended to provide public water systems owners/operators, communities, and local governments with the best available information that may be used to protect the quality of their drinking water. The assessments combine information obtained from various sources, including the U.S. Environmental Protection Agency, Alaska Department of Environmental Conservation (ADEC), public water system owners/operators, and other public information sources. The results of this assessment are subject to change if additional data becomes available. If you have any additional information that may affect the results of this assessment, please contact the Program Coordinator of DWPP, (907) 269-7521.*

## CONTENTS

	Page		Page
Executive Summary	1	Inventory of Potential and Existing	
Introduction	1	Contaminant Sources	4
Description of the Anchorage area, Alaska	1	Ranking of Contaminant Risks	4
Homestead Hills' Public		Vulnerability of Homestead Hills' Public Drinking	
Drinking Water Source	3	Water Source	5
Assessment/Protection Area for Homestead Hills'		Summary	6
Public Drinking Water Source	4	References Cited	7

## TABLES

TABLE	1. Natural Susceptibility - Susceptibility of the Wellhead and Aquifer to Contamination	5
	2. Contaminant Risks	5
	3. Overall Vulnerability	6

## ILLUSTRATIONS

FIGURE	1. Index map showing the location of Anchorage, Alaska	1
	2. Generalized hydrologic cycle in the Anchorage area	2
	3. Map showing the location of the drinking water source for Homestead Hills	3

## APPENDICES

APPENDIX	A. Homestead Hills' Drinking Water Protection Area (Map 1)	
	B. Contaminant Source Inventory for Homestead Hills (Table 1)	
	Contaminant Source Inventory and Risk Ranking for Homestead Hills – Bacteria and Viruses (Table 2)	
	Contaminant Source Inventory and Risk Ranking for Homestead Hills – Nitrates and/or Nitrites (Table 3)	
	Contaminant Source Inventory and Risk Ranking for Homestead Hills – Volatile organic chemicals (Table 4)	
	Contaminant Source Inventory and Risk Ranking for Homestead Hills – Heavy metals, cyanide and other inorganic chemicals (Table 5)	
	Contaminant Source Inventory and Risk Ranking for Homestead Hills – Synthetic organic chemicals (Table 6)	
	Contaminant Source Inventory and Risk Ranking for Homestead Hills – Other synthetic organic chemicals (Table 7)	
	C. Homestead Hills Drinking Water Protection Area and Potential and Existing Contaminant Sources (Map 2 through Map 4)	
	D. Vulnerability Analysis and Risk Ranking for Homestead Hills Public Drinking Water Source (Chart 1 – Chart 14 and Table 1 – Table 6)	

# Source Water Assessment for Homestead Hills' Source of Public Drinking Water, Anchorage, Alaska

## A Hydrogeologic Susceptibility and Vulnerability Analysis

By Heather A. Hammond

---

### Drinking Water Protection Program Alaska Department of Environmental Conservation

#### EXECUTIVE SUMMARY

The Public Water System for Homestead Hills is a Class A (community) water system consisting of one well in the Anchorage area. Identified potential and current sources of contaminants for Homestead Hills' public water system includes approximately 33 acres of residential area, residential septic systems, dirt roads, and parks and recreation trails. These identified potential and existing sources of contamination are considered sources of bacteria and viruses, nitrates and/or nitrites, volatile organic chemicals, heavy metals, synthetic organic chemicals, and other organic chemicals. Overall, the public water source for Homestead Hills received a vulnerability rating of **High** for nitrates and/or nitrites; **Medium** for bacteria and viruses; and **Low** for volatile organic chemicals, heavy metals, synthetic organic chemicals, and other organic chemicals.

#### INTRODUCTION

The purpose of this environmental assessment is to provide public water system owners and/or operators, communities, and local governments with information they can use to preserve the quality of Alaska's public drinking water supplies. This assessment was completed for the source of public drinking water serving Homestead Hills. This water system consists of one well in the Anchorage area (see Figure 1). This assessment, known under the Alaska Drinking Water Protection Program as the *Source Water Assessment*, has combined a review of the natural hydrogeologic sensitivity with potential and existing contaminant risks to arrive at an overall vulnerability of the drinking water source to contamination. This assessment has been completed as a basis for local voluntary protection efforts and to assist agencies in their efforts to reduce risk to this public drinking water supply.

#### DESCRIPTION OF THE ANCHORAGE AREA, ALASKA

##### Location

Anchorage, located in southcentral Alaska, encompasses 1,698 square miles of land and 264 square miles of water. The area containing a majority of the urban development, commonly referred to as the Anchorage Bowl, encompasses approximately 180 square miles [Partick, Brabets, and Glass, 1989] and envelopes the low lands of the area. This area is bounded on the east by the Chugach Mountains and the north, west, and south by the Knik and Turnagain Arms of Cook Inlet (Figure 1). In recent times, urban development has extended eastward along the flanks of the Chugach Mountains. This area, known locally as the Anchorage Hillside, contains development at elevations exceeding 3,700 feet in elevation above sea level.



Figure 1. Index map showing the location of Anchorage, Alaska

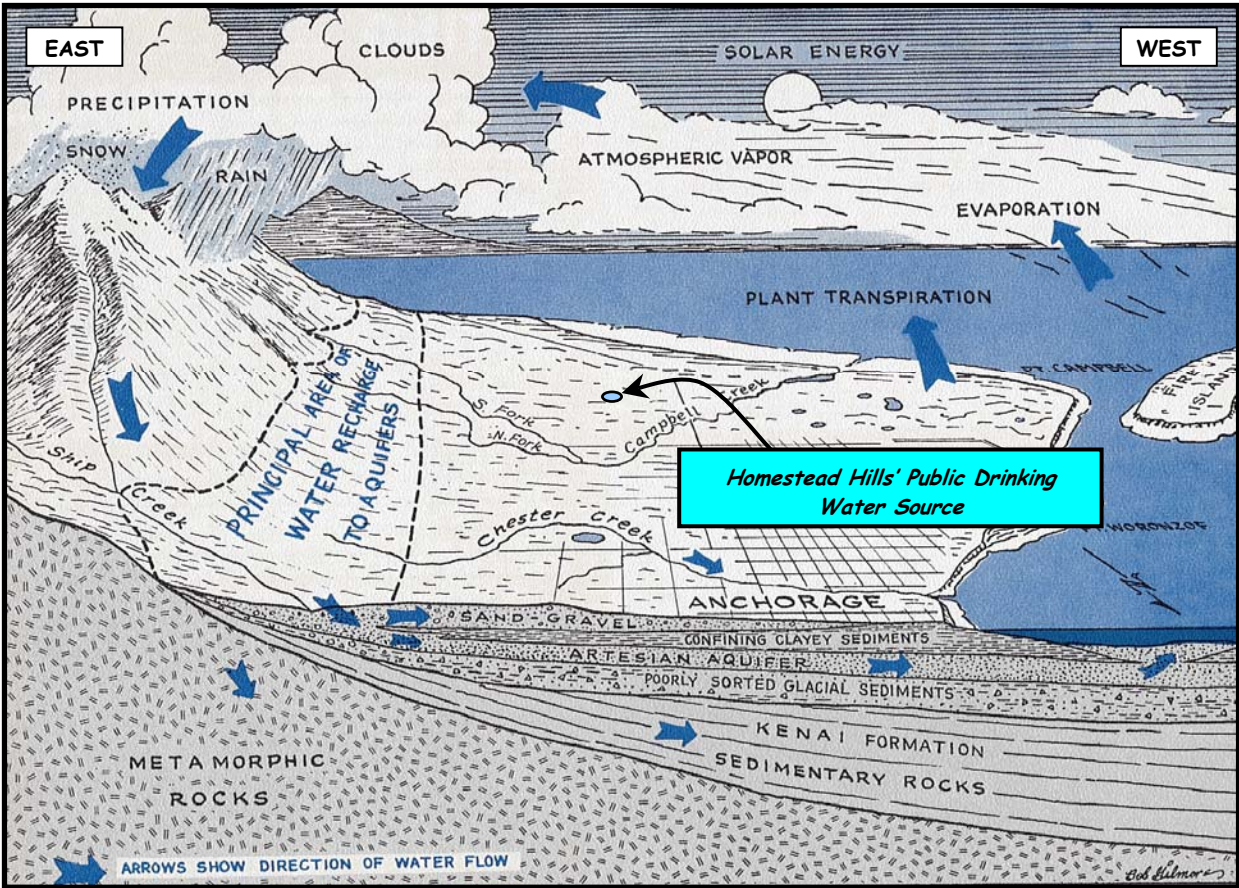


Figure 2. Generalized hydrologic cycle in the Anchorage area [Barnwell, George, Dearborn, Weeks, and Zenone, 1972].

**Climate**

The Anchorage area climate is somewhat transitional in that it does not experience large daily and annual temperature fluctuations like those experienced in the interior of Alaska nor does it experience high amounts of precipitation typified by gulf coast regions. Mean annual precipitation at the Anchorage International Airport is approximately 16 inches per year. On average, Anchorage receives a total snow accumulation of 69 inches per year. Precipitation generally increases inland toward the Chugach Mountains where annual precipitation may exceed 160 inches per year [Barnwell, George, Dearborn, Weeks, and Zenone, 1972]. Mean daily temperature ranges from 65° F during July to 8° F in January [Western Regional Climate Center, 2000].

**Physiography and Groundwater Conditions**

Surface elevations in the Anchorage area range from sea level at Knik and Turnagain Arms to well over 5,000 feet in the peaks that bound the area. Glacial moraine and outwash deposits primarily mantle the surface of the Anchorage Bowl.

The backbone of the Chugach Mountains is composed

primarily of metamorphic marine and volcanic rocks (bedrock). These high peaks that bound Anchorage’s east side are flanked with colluvium or slope deposits. These slope deposits eventually grade into the glacial and stream deposits at lower elevations in the Anchorage Bowl.

In the Anchorage area, two principal groundwater flow systems or aquifers exist (see Figure 2). The upper unconfined aquifer or water-table aquifer is separated from a lower confined aquifer system by layers of silty, clayey glacially derived sediments (confining layer) [Ulery and Updike, 1983]. The lower confined aquifer system consists of a series of hydrologically interconnected layers and lenses of gravel, sand and silt that, collectively, form the confined aquifer. The confining layer ranges from 0 to 270 feet thick throughout the Anchorage area and generally thins with increasing distance from Cook Inlet, thus pinching out at the mountain front [Patrick, Brabets, and Glass, 1989].

Water enters or recharges these two aquifer systems in several different ways. Along the front of the Chugach Mountains, groundwater seeps from fractures in bedrock into the sediments. At these higher elevations, rain and

snowmelt also enters the sediments. This area along the mountain front is considered the principal recharge area for wells in the Anchorage area. Precipitation in the low lands may also percolate directly into the ground. Lastly, aquifers may also be recharged by streams where surface water percolates into surrounding permeable sediments (losing reaches of streams). Groundwater flow in the confined aquifer is generally east to west from the mountain front toward Cook Inlet and Turnagain Arm, except in areas where the direction of flow is influenced by large municipal or industrial production wells. The direction of groundwater flow in the upper unconfined aquifer is more variable due to the influence from surficial topography as well as its close connection with surface water bodies.

### HOMESTEAD HILLS PUBLIC DRINKING WATER SYSTEM

Homestead Hills Public Drinking Water System is a Class A (community) public drinking water system, which is owned and operated by Homestead Hills

Homeowners Association, Inc. The system consists of one well, which is located at 4300 Trapline Drive, Lot 1, Block 2 (Sec. 22, T12N, R3W, SM), at an elevation of approximately 500 feet above sea level (see Figure 3).

Installation of the well occurred June 3, 1972 to a total depth of 74 feet below ground surface. The well was completed in a 6-inch well casing to a total depth of 258 feet below ground surface. It was not indicated on the well log whether the well was screened or grouted during installation. Proper grouting provides added protection against contaminants travelling along the well casing and into source waters.

According to the most recent Sanitary Survey (09/23/96) the well casing is topped with a sanitary seal and the topography surrounding the well is properly graded to divert surface water from flowing toward the well.

This system operates year round and serves approximately 50 residents through 15 service connections.

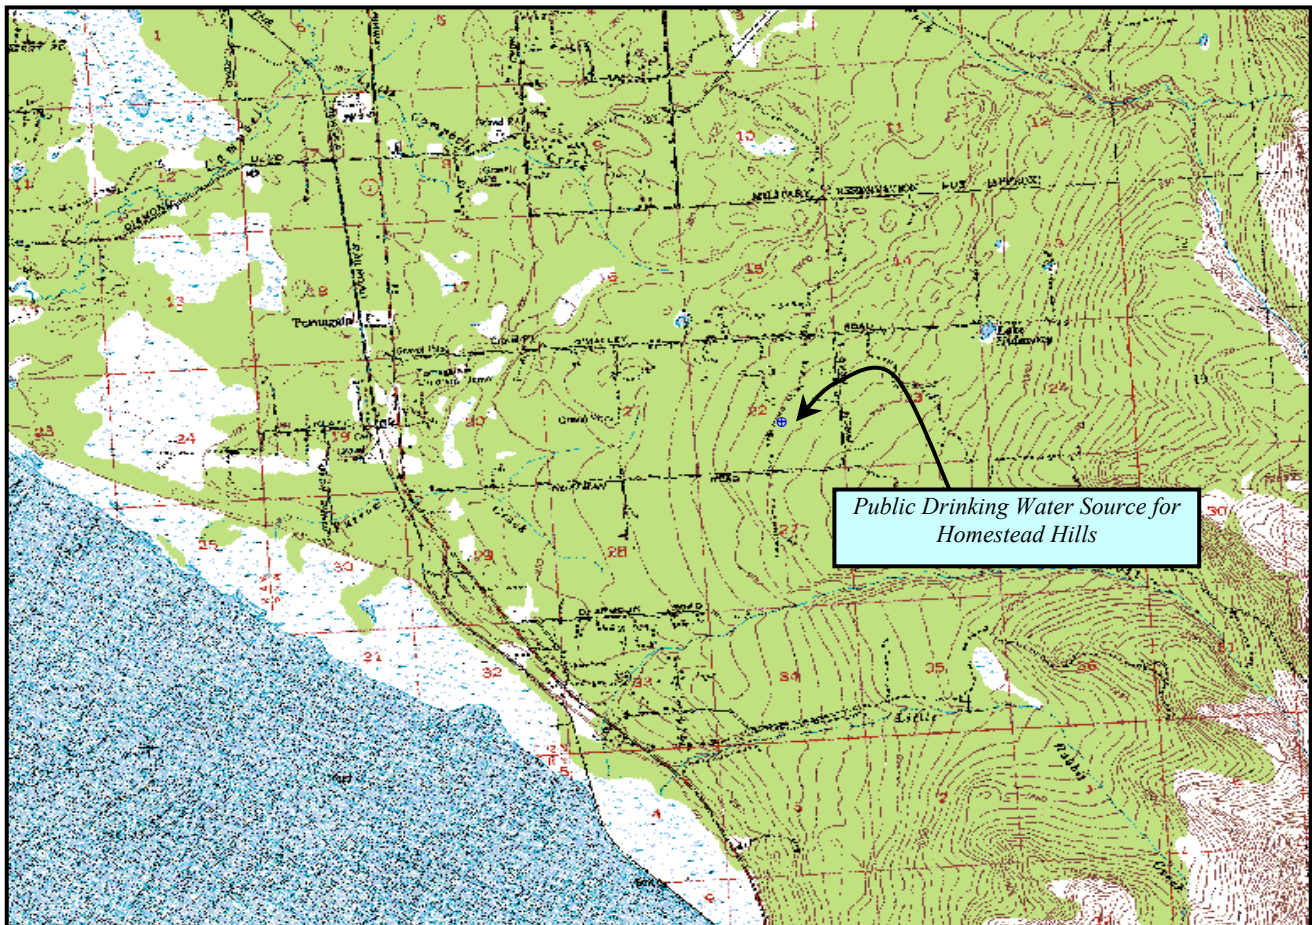


Figure 3. Map showing the location of the drinking water sources for Homestead Hills [Base: USGS Anchorage A8].

## ASSESSMENT AND PROTECTION AREA FOR HOMESTEAD HILLS' PUBLIC DRINKING WATER SOURCE

The Drinking Water Protection and Assessment Area that has been established for Homestead Hills' source of public drinking water is the area that is most sensitive to contamination. This area serves as a basis for assessing the risk of the drinking water source to contamination. The zones around the drinking water source outline the most critical area for the preservation of the quality of the drinking water for this system. For simplicity, this area will be known as your Drinking Water Protection Area and will serve as the focus for voluntary protection efforts.

Conceptually, groundwater enters the aquifer systems along the front range of the Chugach Mountains (Figure 2) and flows toward Cook Inlet. An analytical calculation was used to determine the size and shape of the area that contributes water to the well. The input parameters describing the attributes of the aquifer in this calculation were adopted from the U.S. Geological Survey [*Patrick, Brabets, and Glass, 1989*]. This analytical calculation was used as a guide as the first step in establishing the protection area for each public drinking water source in Anchorage. Additional methods were further employed to take into account any uncertainties in groundwater flow and aquifer characteristics to arrive at meaningful and conservative protection areas with respect to public health (Please refer to the Guidance Manual for Class A Public Water Systems for additional information).

The Drinking Water Protection Areas established for wells by the Alaska Department of Environmental Conservation are separated into zones. These zones correspond to a time-of-travel. Time-of-travel is the time required for water to move in the saturated zone of the ground from a specific point to the well. The Drinking Water Protection Area for Homestead Hills contains four zones, Zone A through Zone D (See Map 1 in Appendix A). Zone A corresponds to the area between the wells and the distance equal to  $\frac{1}{4}$  of the distance of the 2-year time-of-travel. Depending on where a contaminant source is located within Zone A, travel time for a contaminant to the wells may be on the order of several days to several hours. Zone A also extends downgradient from the wells to take into account the area of the aquifer that is influenced by pumping of the wells. Zone B corresponds to a time-of-travel of less than two years. Zones C and D correspond to those areas between 5 years and 10 years time-of-travel, respectively.

## INVENTORY OF POTENTIAL AND EXISTING CONTAMINANT SOURCES

The Drinking Water Protection Program has completed an inventory of potential and existing sources of contamination within the Drinking Water Protection Area for Homestead Hills. This survey was completed through a search of agency records and other publicly available information. Potential sources of contamination to drinking water supplies cover a wide range of categories and types. Potential drinking water contaminants are found within agricultural, residential, commercial, and industrial areas, but can also occur within areas that have little or no development.

For the basis of this assessment and all Class A public water system assessments, six categories of drinking water contaminants were inventoried. They include:

- Bacteria and viruses
- Nitrates and/or nitrites
- Volatile organic chemicals
- Heavy metals, cyanide, and other inorganic chemicals
- Synthetic organic chemicals
- Other organic chemicals

Maps 2 through 4 in Appendix C depict the Contaminant Source Inventory for Homestead Hills. Table 1 in Appendix B lists the inventoried potential sources of contamination within Zones A through D. Below is a summary of the contaminant sources inventoried:

- Approximately 33 acres of residential area;
- residential septic systems;
- dirt roads;
- parks and recreation trails.

These potential and existing contaminant sources present risk for all six categories of drinking water contaminants for the source of public drinking water serving Homestead Hills.

## RANKING OF CONTAMINANT RISKS

Potential and existing sources of contamination have been identified, sorted, and ranked according to what type and level of risk they represent. Ranking of contaminant risks for a "potential" or "existing" source of contamination is a function of toxicity and volumes of specific contaminants associated with that source. Contaminant risks are further a function of the number and density of

those types of contaminant sources as well as the proximity of those sources to the public drinking water wells.

**VULNERABILITY OF HOMESTEAD HILLS’ PUBLIC DRINKING WATER SOURCE**

Vulnerability of a drinking water source to contamination is a combination of two factors:

- natural susceptibility; and
- contaminant risks.

Each of the six categories of drinking water contaminants have been analyzed and an overall vulnerability score of 0 to 100 ultimately assigned:

$$\begin{array}{r}
 \text{Natural Susceptibility (0 – 50 points)} \\
 + \\
 \text{Contaminant Risks (0 – 50 points)} \\
 = \\
 \text{Vulnerability of the} \\
 \text{Drinking Water Source to Contamination (0 – 100).}
 \end{array}$$

A score for the Natural Susceptibility is achieved by analyzing the properties of the well and the aquifer.

$$\begin{array}{r}
 \text{Susceptibility of the Wellhead (0 – 25 Points)} \\
 + \\
 \text{Susceptibility of the Aquifer (0 – 25 Points)} \\
 = \text{Natural Susceptibility (Susceptibility of the Well)} \\
 \text{(0 – 50 Points)}
 \end{array}$$

According to the well log (Sommerville Well Drilling, June 3, 1972) the well was completed in a confined aquifer. The depth to the top of the confining layer is approximately 14 feet below ground surface and consists of a layer of yellow clay mixed with hardpan and compacted gravel and has a thickness of approximately 54 feet. Below this initial confining layer are intermittent layers of clay mixed with sand, gravel and hardpan. These confining layers may provide a protective barrier against the movement of contaminants in the subsurface. However, near the base of the Chugach Mountains, these clay layers tend to be discontinuous and thin toward the mountains. Therefore, contaminants that enter the subsurface near the base of the mountains may enter the confined aquifer uninhibited by the absence of any protective layer.

Combining the susceptibility of the wellhead and the aquifer to contamination leads to a score (0 – 50 points)

and rating of overall Susceptibility of the well to contamination (See Appendix D). Table 1 depicts the overall Susceptibility score and rating for the source of public drinking water serving Homestead Hills.

**Table 1. Natural Susceptibility - Susceptibility of the Wellhead and Aquifer to Contamination**

	Score	Rating
Susceptibility of the Wellhead	5	Low
Susceptibility of the Aquifer	15	High
Natural Susceptibility	20	Medium

Contaminant risks to a drinking water source depend on the type, number or density, and distribution of contaminant sources. A score (0 – 50 points) and rating of Contaminant Risks (See Appendix D) is assigned based on the findings of the Contaminant Source Inventory (See Appendix B - Table 1 – Table 7). This portion of the analysis examines any existing or historical contamination that has been detected at the drinking water source through routine sampling. It also reviews contamination that has or may have occurred but has not arrived or been detected at the well. Table 2 summarizes the Contaminant Risks for each category of drinking water contaminants.

**Table 2. Contaminant Risks to Homestead Hills’ Public Drinking Water Source**

Contaminant Risks	Score	Rating
Bacteria and Viruses	25	Medium
Nitrates and/or Nitrites	40	Very High
Volatile Organic Chemicals	12	Low
Heavy Metals, Cyanide, And Other Inorganic Chemicals	12	Low
Synthetic Organic Chemicals	12	Low
Other Organic Chemicals	12	Low

Appendix D contains fourteen charts, which together form the ‘Vulnerability Analysis’ for a Class A public drinking water system. Chart 1 analyzes the ‘Susceptibility of the Wellhead’ to contamination by looking at the construction of the well and its surrounding area. Chart 2 analyzes the ‘Susceptibility of the Aquifer’ to contamination by looking at the naturally occurring attributes of the water source and influences on the groundwater system that might lead to contamination. Chart 3 analyzes ‘Contaminant Risks’ for the drinking



water source with respect to bacteria and viruses. The ‘Contaminant Risks’ portion of the analysis considers potential sources of contaminants as well as a review of contamination that has or may have occurred but has not arrived or been detected at the well. Lastly, Chart 4 contains the ‘Vulnerability Analysis for Bacteria and Viruses’. Charts 5 through 14 contain the Contaminant Risks and Vulnerability Analysis for nitrates and nitrites, volatile organic chemicals, heavy metals, synthetic organic chemicals, and other organic chemicals, respectively.

Vulnerability of drinking water sources to contamination is the combination of susceptibility of the aquifer and the well with contaminant risks. Table 3 contains the overall vulnerability scores (0 – 100) and ratings for each of the six categories of drinking water contaminants (See Appendix D). Note: scores are rounded off to the nearest five.

**Table 3. Overall Vulnerability of Homestead Hills’ Public Drinking Water Source to Contamination by Category**

Category	Score	Rating
Bacteria and Viruses	45	Medium
Nitrates and Nitrites	60	High
Volatile Organic Chemicals	30	Low
Heavy Metals, Cyanide, and Other Inorganic Chemicals	30	Low
Synthetic Organic Chemicals	30	Low
Other Organic Chemicals	30	Low

Tables 2 through 7 in Appendix B contain the ranking of potential and existing sources of contamination with respect to bacteria and viruses, nitrates and/or nitrites, heavy metals, synthetic organic chemicals, and other organic chemicals, respectively.

Residential areas and parks and recreation trails are sources of potential contamination that present a significant risk for bacteria and viruses and nitrates and/or nitrites. Residential septic systems because of their effluent discharge, are also a potential contaminant concern for bacteria and viruses and nitrites and/or nitrites. There is a high density of residential septic systems within Zones A and B. According to the most recent Sanitary Survey (09/23/96) residential septic systems located on Block 2, Lots 3 and 4 are less than 200 feet from the well location.

bacteria and viruses have not been detected at the source waters serving Homestead Hills. Nitrates and/or nitrites are found in natural background concentration at this site, as elsewhere throughout Alaska. Nitrate concentrations in uncontaminated groundwater are typically less than 2 milligrams per liter (mg/L) and are derived primarily from the decomposition of organic matter in soils [Wang, Strelakos, Jokela, 2000].

Sampling history for Homestead Hills source waters indicates that low concentrations of nitrates have been detected (See Chart 5 – Contaminant Risks for Nitrates and/or Nitrites in Appendix D). Existing nitrate concentration is approximately 20% of the Maximum Contaminant Level or MCL. The MCL is the maximum level of contaminant that is allowed to exist in drinking water and still be consumed by humans without harmful health effects. Due to the high solubility and weak retention by soil, nitrates are very mobile, moving at approximately the same rate as water. Though existing nitrate contamination was detected at the site, concentrations remain at very safe levels with respect to human health.

Dirt roads within the protection area are a significant source of potential contamination from bacteria and viruses, nitrates and/or nitrites, volatile organic chemicals, heavy metals and other organic chemicals. Because roads do pose a potential for fuel spills to occur, major routes were ranked as a low potential source of contamination to the drinking water source.

## SUMMARY

A *Source Water Assessment* has been completed for the source of public drinking water serving Homestead Hills. The overall vulnerability of this source to contamination is **High** for nitrates and/or nitrites; **Medium** for bacteria and viruses; and **Low** for volatile organic chemicals, heavy metals, synthetic organic chemicals, and other organic chemicals. This assessment of contaminant risks can be used as a foundation for local voluntary protection efforts as well as a basis for the continuous efforts on the part of Homestead Hills to protect public health. It is anticipated that *Source Water Assessments* will be updated every five years to reflect any changes in the vulnerability and/or susceptibility of Homestead Hills’ public drinking water source.

Review of the historical sampling data indicates that


## REFERENCES CITED

- Barnwell, W.W., George, R.S., Dearborn, L.L., Weeks, J.B., and Zenone, C., 1972, Water for Anchorage: an atlas of the water resources of the Anchorage area, Alaska: U.S. Geological Survey Open-File Report, 76 p.
- Patrick, L.D., Brabets, T.P., and Glass, R.L., 1989, Simulation of ground-water flow at Anchorage, Alaska: U.S. Geological Survey Water-Resources Investigations Report 88-4139, 41p.
- Ulery, C.A. and Updike, R.G, 1983, Subsurface structure of the cohesive facies of the Bootlegger Cove Formation, Southwest Anchorage, Alaska: Alaska Division of Geological and Geophysical Surveys Professional Report 84, 5 p.
- Wang, B., Strelakos, P.M., and Jokela, B., 2000, Nitrate Source Indicators In Groundwater of the Scimitar Subdivision, Peters Creek Area, Anchorage Alaska: U.S. Geological Survey Water-Resources Investigations Report 00-4137, 25p.
- Western Regional Climate Center, 2000, August 24, Web extension to the *Western Regional Climate Center* [WWW document]. URL <http://www.wrcc.dri.edu/index.html>



## **APPENDIX A**

### **Homestead Hills' Drinking Water Protection Area**

# Drinking Water Protection Area for Homestead Hills

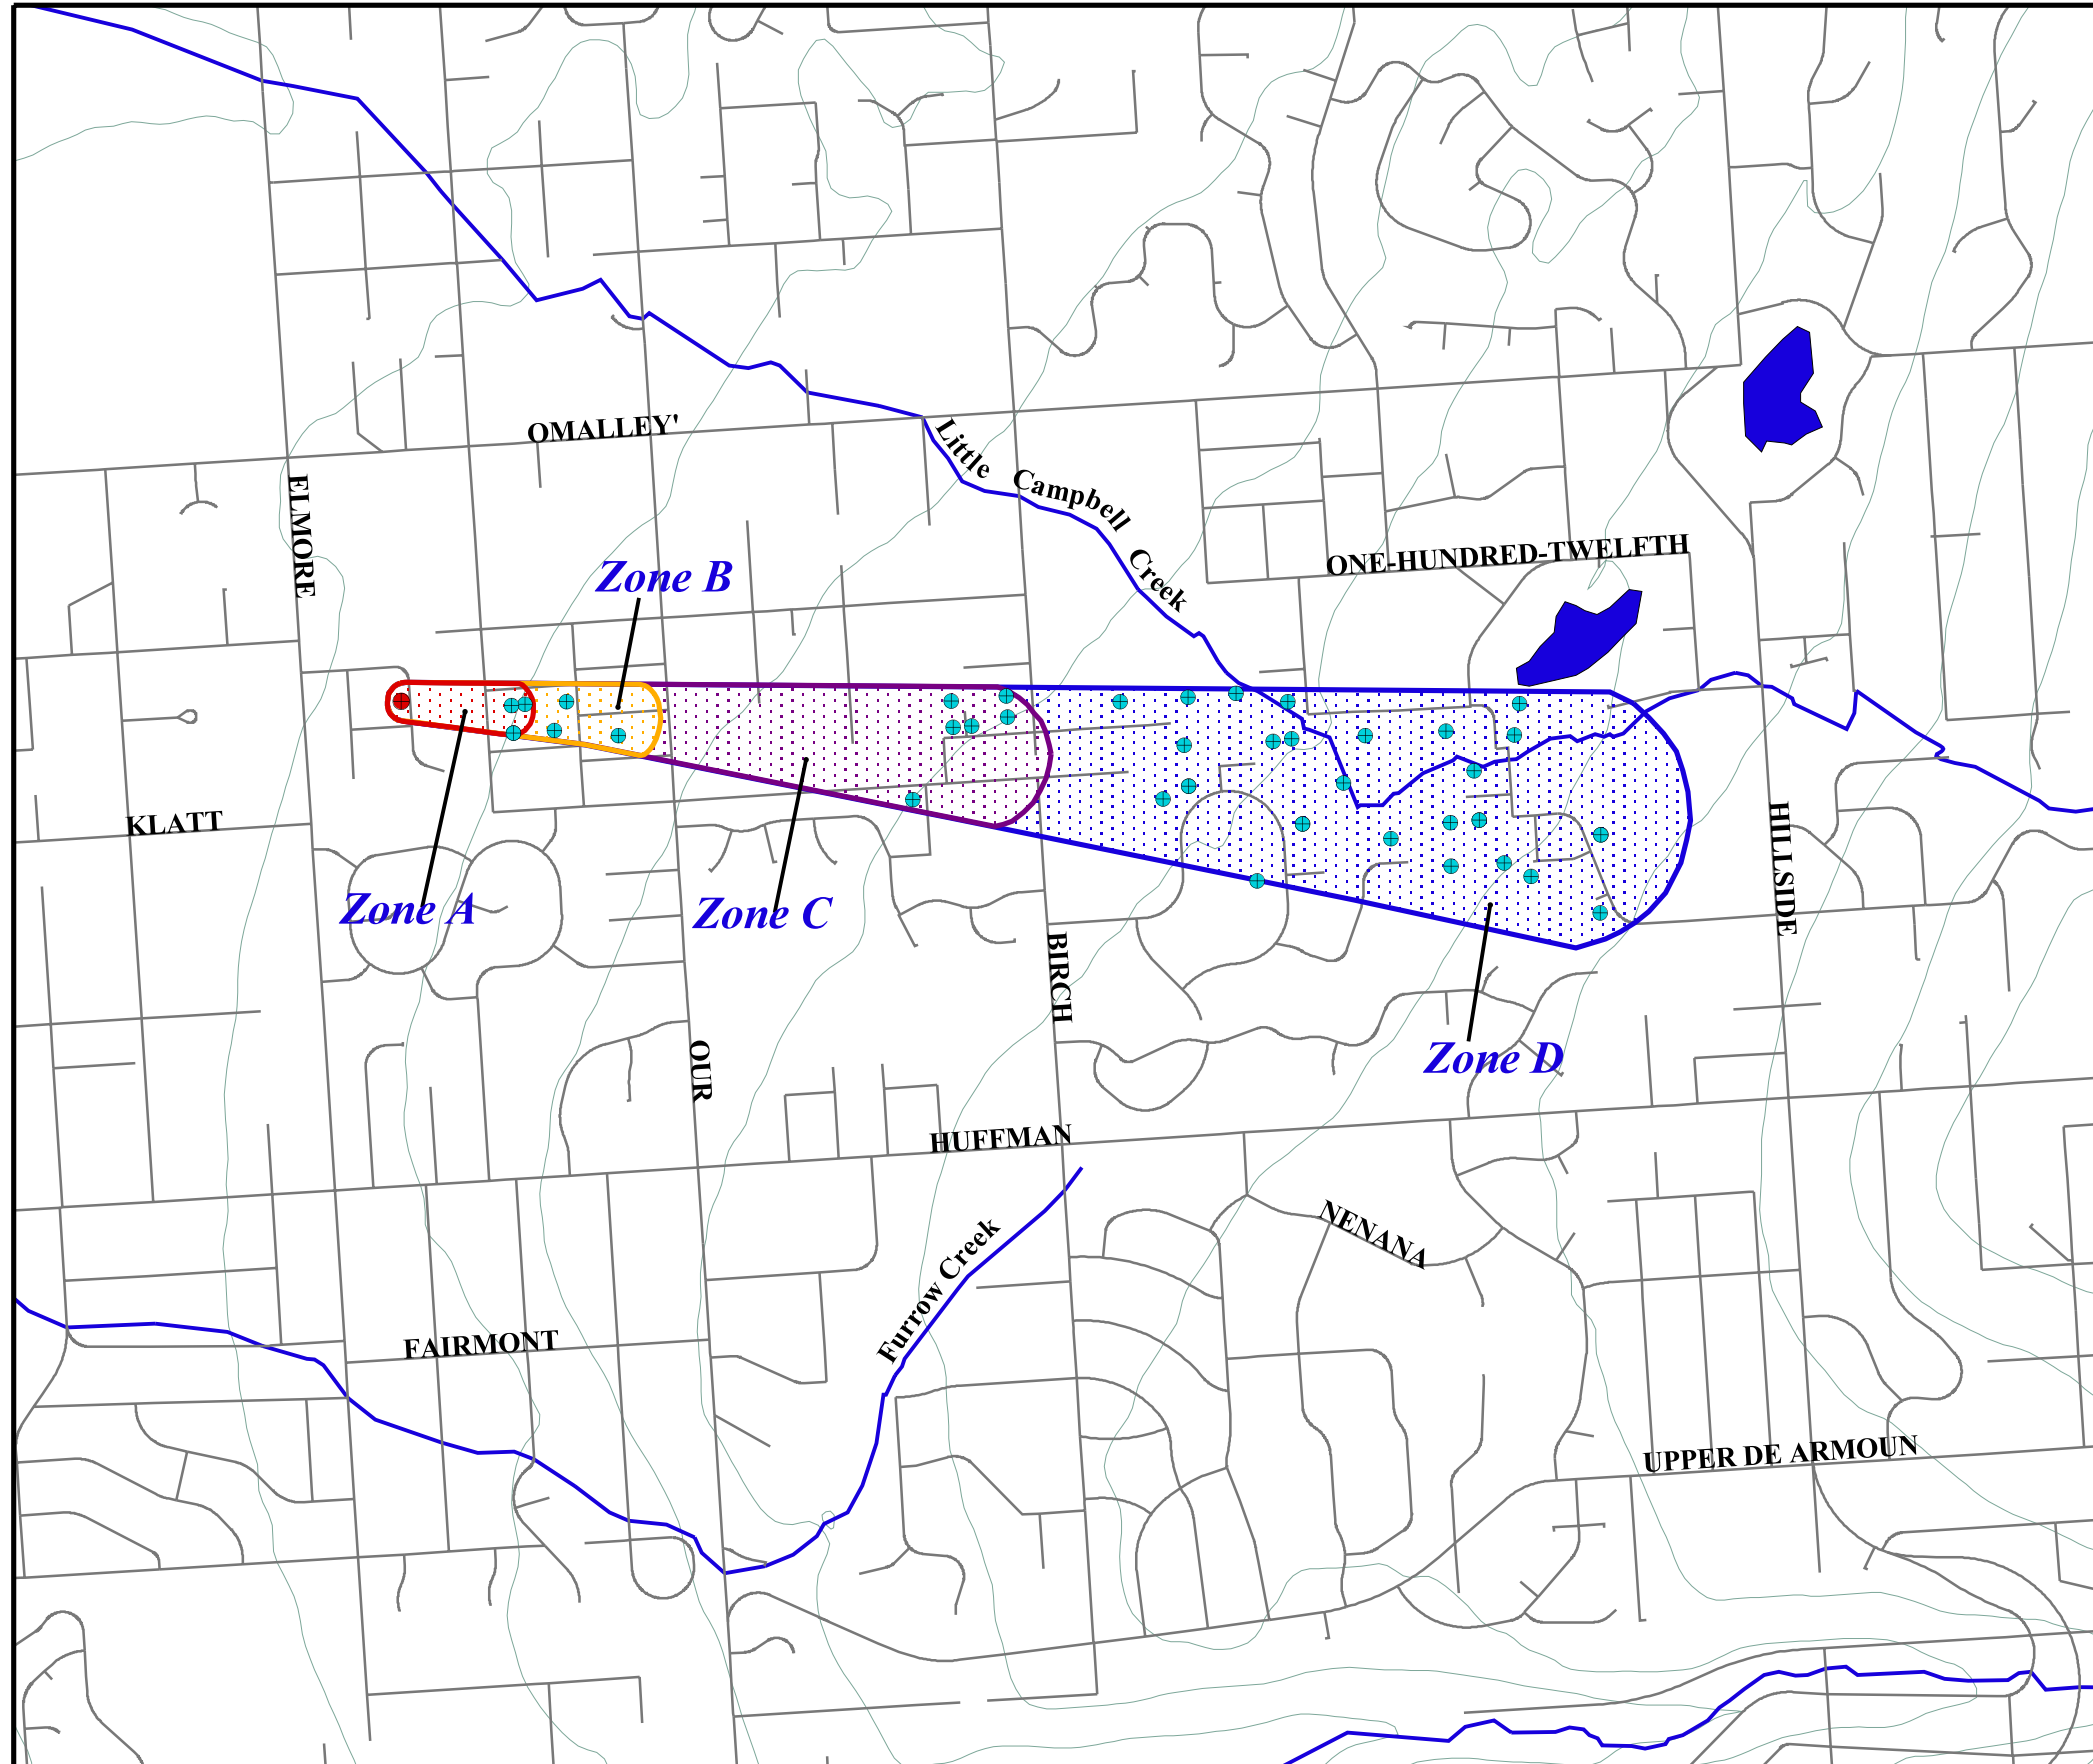

- Homestead Hills Drinking Water Well
- Private and Public DW Wells
- Zone A Protection Area**
- Several Months Travel Time
- Zone B Protection Area**
- Less Than 2 Years Travel Time
- Zone C Protection Area**
- Less Than 5 Years Travel Time
- Zone D Protection Area**
- Less Than 10 Years Travel Time
- Anchorage Roads
- Anchorage Lakes
- Anchorage Streams
- Elevation Contours

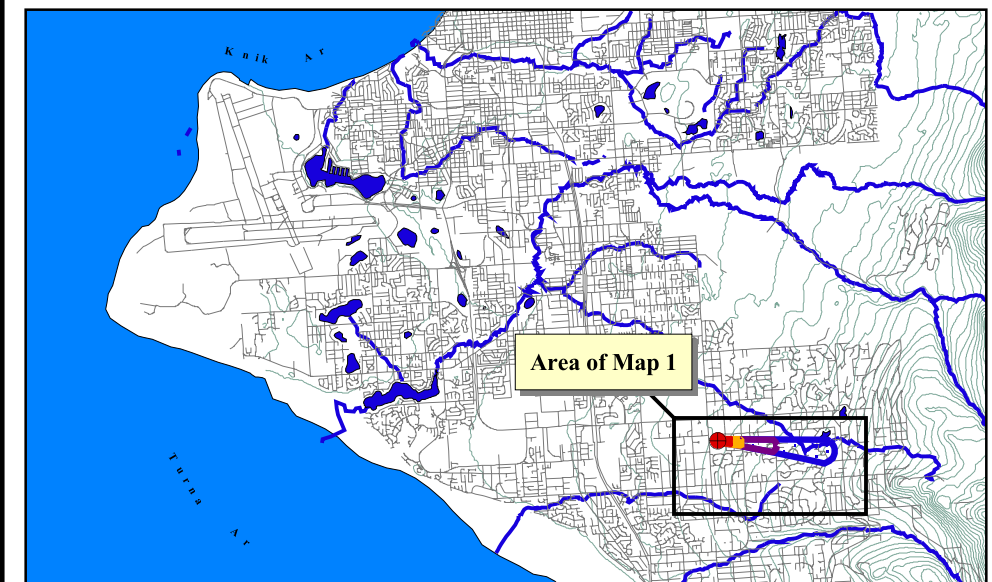

0.5      0      0.5      1 Miles

PWSID 211669.001

Map 1

## **APPENDIX B**

### **Contaminant Source Inventory and Risk Ranking for Homestead Hills**

**Table 1**

**Contaminant Source Inventory for  
Homestead Hills**

**PWSID 211669.001**

<b>Contaminant Source Type</b>	<b>Contaminant Source ID</b>	<b>CS ID tag</b>	<b>Zone</b>	<b>Location</b>	<b>Map Number</b>	<b>Comments</b>
Residential Areas	R01	R1-1	A	Residential areas located within Zone A	2	Approximately 8 acres of residential area.
Septic systems (serves one single-family home)	R02	R2-1	A	Along Trapline Drive	2	
Septic systems (serves one single-family home)	R02	R2-10	A	Along One-hundred-fifteenth Ave.	2	
Septic systems (serves one single-family home)	R02	R2-2	A	Along Trapline Drive	2	
Septic systems (serves one single-family home)	R02	R2-3	A	Along Lipscomb Street	2	
Septic systems (serves one single-family home)	R02	R2-4	A	Along Lipscomb Street	2	
Septic systems (serves one single-family home)	R02	R2-5	A	Along Lipscomb Street	2	
Septic systems (serves one single-family home)	R02	R2-6	A	Along Lipscomb Street	2	
Septic systems (serves one single-family home)	R02	R2-7	A	Along Lipscomb Street	2	
Septic systems (serves one single-family home)	R02	R2-8	A	Along One-hundred-thirteenth Ave.	2	
Septic systems (serves one single-family home)	R02	R2-9	A	Along One-hundred-thirteenth Ave.	2	
Highways and roads, dirt/gravel	X24	X24-1	A	Trapline Drive	2	
Highways and roads, dirt/gravel	X24	X24-2	A	Lipscomb Street	2	
Highways and roads, dirt/gravel	X24	X24-3	A,B	One-hundred-thirteenth Ave.	2	
Residential Areas	R01	R1-2	B	Residential areas located within Zone B	2	Approximately 9 acres of residential area.
Septic systems (serves one single-family home)	R02	R2-11	B	Along One-hundred-fifteenth Ave.	2	
Septic systems (serves one single-family home)	R02	R2-12	B	Along One-hundred-fifteenth Ave.	2	
Septic systems (serves one single-family home)	R02	R2-13	B	Along One-hundred-fifteenth Ave.	2	
Septic systems (serves one single-family home)	R02	R2-14	B	Along One-hundred-thirteenth Ave.	2	
Septic systems (serves one single-family home)	R02	R2-15	B	Along One-hundred-thirteenth Ave.	2	
Septic systems (serves one single-family home)	R02	R2-16	B	Along One-hundred-thirteenth Ave.	2	
Septic systems (serves one single-family home)	R02	R2-17	B	Along Patro Street	2	
Septic systems (serves one single-family home)	R02	R2-18	B	Along One-hundred-fifteenth Ave.	2	
Septic systems (serves one single-family home)	R02	R2-19	B	Along Patro Street	2	

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Location</i>	<i>Map Number</i>	<i>Comments</i>
Septic systems (serves one single-family home)	R02	R2-20	B	Along Patro Street	2	
Septic systems (serves one single-family home)	R02	R2-21	B	Along One-hundred-fifteenth	2	
Septic systems (serves one single-family home)	R02	R2-22	B	Along One-hundred-fifteenth	2	
Septic systems (serves one single-family home)	R02	R2-23	B	Along One-hundred-fifteenth	2	
Septic systems (serves one single-family home)	R02	R2-24	B	Along One-hundred-fifteenth Ave.	2	
Highways and roads, dirt/gravel	X24	X24-4	B	Patro Street	2	
Highways and roads, dirt/gravel	X24	X24-5	B	One-hundred-Fourteenth Ave.	2	
Residential Areas	R01	R1-3	C	Residential areas located within Zone C	3	
Septic systems (serves one single-family home)	R02	R2-25-41	C	All septic systems located within Zone C	3	
Highways and roads, dirt/gravel	X24	X24-6-15	C	All roads located within Zone C	3	
Dog walking areas/foot trails	X46	X46-1	C	Trail along the west side of Birch Road	3	
Dog walking areas/foot trails	X46	X46-2	C	Trail along the east side of Birch Road	3	
Municipal or city parks (with green areas)	X04	X4-1	C,D	Anchorage park located within Zones C and D	3	

Table 2

*Contaminant Source Inventory and Risk Ranking for  
Homestead Hills  
Sources of Bacteria and Viruses*

PWSID 211669.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Overall Rank after Analysis</i>	<i>Location</i>	<i>Map Number</i>	<i>Comments</i>
Residential Areas	R01	R1-1	A	Low	1	Residential areas located within Zone A	2	Approximately 8 acres of residential area.
Residential Areas	R01	R1-2	B	Low	2	Residential areas located within Zone B	2	Approximately 9 acres of residential area.
Septic systems (serves one single-family home)	R02	R2-1	A	Low	3	Along Trapline Drive	2	
Septic systems (serves one single-family home)	R02	R2-2	A	Low	4	Along Trapline Drive	2	
Septic systems (serves one single-family home)	R02	R2-3	A	Low	5	Along Lipscomb Street	2	
Septic systems (serves one single-family home)	R02	R2-4	A	Low	6	Along Lipscomb Street	2	
Septic systems (serves one single-family home)	R02	R2-5	A	Low	7	Along Lipscomb Street	2	
Septic systems (serves one single-family home)	R02	R2-6	A	Low	8	Along Lipscomb Street	2	
Highways and roads, dirt/gravel	X24	X24-1	A	Low	9	Trapline Drive	2	
Highways and roads, dirt/gravel	X24	X24-2	A	Low	10	Lipscomb Street	2	
Septic systems (serves one single-family home)	R02	R2-10	A	Low		Along One-hundred-fifteenth Ave.	2	
Septic systems (serves one single-family home)	R02	R2-7	A	Low		Along Lipscomb Street	2	
Septic systems (serves one single-family home)	R02	R2-8	A	Low		Along One-hundred-thirteenth Ave.	2	
Septic systems (serves one single-family home)	R02	R2-9	A	Low		Along One-hundred-thirteenth Ave.	2	
Highways and roads, dirt/gravel	X24	X24-3	A,B	Low		One-hundred-thirteenth Ave.	2	
Residential Areas	R01	R1-2	B	Low		Residential areas located within Zone B	2	Approximately 9 acres of residential area.
Septic systems (serves one single-family home)	R02	R2-11	B	Low		Along One-hundred-fifteenth Ave.	2	
Septic systems (serves one single-family home)	R02	R2-12	B	Low		Along One-hundred-fifteenth Ave.	2	
Septic systems (serves one single-family home)	R02	R2-13	B	Low		Along One-hundred-fifteenth Ave.	2	



Table 2 (continued)

*Contaminant Source Inventory and Risk Ranking for  
Homestead Hills  
Sources of Bacteria and Viruses*

PWSID 211669.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Overall Rank after Analysis</i>	<i>Location</i>	<i>Map Number</i>	<i>Comments</i>
Septic systems (serves one single-family home)	R02	R2-14	B	Low		Along One-hundred-thirteenth Ave.	2	
Septic systems (serves one single-family home)	R02	R2-15	B	Low		Along One-hundred-thirteenth Ave.	2	
Septic systems (serves one single-family home)	R02	R2-16	B	Low		Along One-hundred-thirteenth Ave.	2	
Septic systems (serves one single-family home)	R02	R2-17	B	Low		Along Patro Street	2	
Septic systems (serves one single-family home)	R02	R2-18	B	Low		Along One-hundred-fifteenth Ave.	2	
Septic systems (serves one single-family home)	R02	R2-19	B	Low		Along Patro Street	2	
Septic systems (serves one single-family home)	R02	R2-20	B	Low		Along Patro Street	2	
Septic systems (serves one single-family home)	R02	R2-21	B	Low		Along One-hundred-fifteenth	2	
Septic systems (serves one single-family home)	R02	R2-22	B	Low		Along One-hundred-fifteenth	2	
Septic systems (serves one single-family home)	R02	R2-23	B	Low		Along One-hundred-fifteenth	2	
Septic systems (serves one single-family home)	R02	R2-24	B	Low		Along One-hundred-fifteenth Ave.	2	
Highways and roads, dirt/gravel	X24	X24-4	B	Low		Patro Street	2	
Highways and roads, dirt/gravel	X24	X24-5	B	Low		One-hundred-Fourteenth Ave.	2	
Residential Areas	R01	R1-3	C	Low		Residential areas located within Zone C	3	
Residential Areas	R01	R1-3	C	Low		Residential areas located within Zone C	3	
Septic systems (serves one single-family home)	R02	R2-25-41	C	Low		All septic systems located within Zone C	3	
Highways and roads, dirt/gravel	X24	X24-6-15	C	Low		All roads located within Zone C	3	

Table 2 (continued)

Contaminant Source Inventory and Risk Ranking for  
Homestead Hills  
Sources of Bacteria and Viruses

PWSID 211669.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Overall Rank after Analysis</i>	<i>Location</i>	<i>Map Number</i>	<i>Comments</i>
Dog walking areas/foot trails	X46	X46-1	C	Low		Trail along the west side of Birch Road	3	
Dog walking areas/foot trails	X46	X46-2	C	Low		Trail along the east side of Birch Road	3	
Municipal or city parks (with green areas)	X04	X4-1	C,D	Medium		Anchorage park located within Zones C and D	3	

Table 3

*Contaminant Source Inventory and Risk Ranking for  
Homestead Hills  
Sources of Nitrates/Nitrites*

PWSID 211669.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Overall Rank after Analysis</i>	<i>Location</i>	<i>Map Number</i>	<i>Comments</i>
Residential Areas	R01	R1-1	A	Low	1	Residential areas located within Zone A	2	Approximately 8 acres of residential area.
Residential Areas	R01	R1-2	B	Low	2	Residential areas located within Zone B	2	Approximately 9 acres of residential area.
Septic systems (serves one single-family home)	R02	R2-1	A	Low	3	Along Trapline Drive	2	
Septic systems (serves one single-family home)	R02	R2-2	A	Low	4	Along Trapline Drive	2	
Septic systems (serves one single-family home)	R02	R2-3	A	Low	5	Along Lipscomb Street	2	
Septic systems (serves one single-family home)	R02	R2-4	A	Low	6	Along Lipscomb Street	2	
Septic systems (serves one single-family home)	R02	R2-5	A	Low	7	Along Lipscomb Street	2	
Septic systems (serves one single-family home)	R02	R2-6	A	Low	8	Along Lipscomb Street	2	
Highways and roads, dirt/gravel	X24	X24-1	A	Low	9	Trapline Drive	2	
Highways and roads, dirt/gravel	X24	X24-2	A	Low	10	Lipscomb Street	2	
Septic systems (serves one single-family home)	R02	R2-10	A	Low		Along One-hundred-fifteenth Ave.	2	
Septic systems (serves one single-family home)	R02	R2-7	A	Low		Along Lipscomb Street	2	
Septic systems (serves one single-family home)	R02	R2-8	A	Low		Along One-hundred-thirteenth Ave.	2	
Septic systems (serves one single-family home)	R02	R2-9	A	Low		Along One-hundred-thirteenth Ave.	2	
Highways and roads, dirt/gravel	X24	X24-3	A,B	Low		One-hundred-thirteenth Ave.	2	
Residential Areas	R01	R1-2	B	Low		Residential areas located within Zone B	2	Approximately 9 acres of residential area.
Septic systems (serves one single-family home)	R02	R2-11	B	Low		Along One-hundred-fifteenth Ave.	2	
Septic systems (serves one single-family home)	R02	R2-12	B	Low		Along One-hundred-fifteenth Ave.	2	
Septic systems (serves one single-family home)	R02	R2-13	B	Low		Along One-hundred-fifteenth Ave.	2	

Table 3 (continued)

*Contaminant Source Inventory and Risk Ranking for  
Homestead Hills  
Sources of Nitrates/Nitrites*

PWSID 211669.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Overall Rank after Analysis</i>	<i>Location</i>	<i>Map Number</i>	<i>Comments</i>
Septic systems (serves one single-family home)	R02	R2-14	B	Low		Along One-hundred-thirteenth Ave.	2	
Septic systems (serves one single-family home)	R02	R2-15	B	Low		Along One-hundred-thirteenth Ave.	2	
Septic systems (serves one single-family home)	R02	R2-16	B	Low		Along One-hundred-thirteenth Ave.	2	
Septic systems (serves one single-family home)	R02	R2-17	B	Low		Along Patro Street	2	
Septic systems (serves one single-family home)	R02	R2-18	B	Low		Along One-hundred-fifteenth Ave.	2	
Septic systems (serves one single-family home)	R02	R2-19	B	Low		Along Patro Street	2	
Septic systems (serves one single-family home)	R02	R2-20	B	Low		Along Patro Street	2	
Septic systems (serves one single-family home)	R02	R2-21	B	Low		Along One-hundred-fifteenth	2	
Septic systems (serves one single-family home)	R02	R2-22	B	Low		Along One-hundred-fifteenth	2	
Septic systems (serves one single-family home)	R02	R2-23	B	Low		Along One-hundred-fifteenth	2	
Septic systems (serves one single-family home)	R02	R2-24	B	Low		Along One-hundred-fifteenth Ave.	2	
Highways and roads, dirt/gravel	X24	X24-4	B	Low		Patro Street	2	
Highways and roads, dirt/gravel	X24	X24-5	B	Low		One-hundred-Fourteenth Ave.	2	
Residential Areas	R01	R1-3	C	Low		Residential areas located within Zone C	3	
Residential Areas	R01	R1-3	C	Low		Residential areas located within Zone C	3	
Septic systems (serves one single-family home)	R02	R2-25-41	C	Low		All septic systems located within Zone C	3	
Highways and roads, dirt/gravel	X24	X24-6-15	C	Low		All roads located within Zone C	3	

Table 3 (continued)

Contaminant Source Inventory and Risk Ranking for  
Homestead Hills  
Sources of Nitrates/Nitrites

PWSID 211669.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Overall Rank after Analysis</i>	<i>Location</i>	<i>Map Number</i>	<i>Comments</i>
Dog walking areas/foot trails	X46	X46-1	C	Low		Trail along the west side of Birch Road	3	
Dog walking areas/foot trails	X46	X46-2	C	Low		Trail along the east side of Birch Road	3	
Municipal or city parks (with green areas)	X04	X4-1	C,D	Medium		Anchorage park located within Zones C and D	3	

Table 4

*Contaminant Source Inventory and Risk Ranking for  
Homestead Hills  
Sources of Volatile Organic Chemicals*

PWSID 211669.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Overall Rank after Analysis</i>	<i>Location</i>	<i>Map Number</i>	<i>Comments</i>
Residential Areas	R01	R1-1	A	Low	1	Residential areas located within Zone A	2	Approximately 8 acres of residential area.
Highways and roads, dirt/gravel	X24	X24-1	A	Low	2	Trapline Drive	2	
Highways and roads, dirt/gravel	X24	X24-2	A	Low	3	Lipscomb Street	2	
Highways and roads, dirt/gravel	X24	X24-3	A,B	Low	4	One-hundred-thirteenth Ave.	2	
Residential Areas	R01	R1-2	B	Low	5	Residential areas located within Zone B	2	Approximately 9 acres of residential area.
Highways and roads, dirt/gravel	X24	X24-4	B	Low	6	Patro Street	2	
Highways and roads, dirt/gravel	X24	X24-5	B	Low	7	One-hundred-Fourteenth Ave.	2	
Septic systems (serves one single-family home)	R02	R2-1	A	Low	8	Along Trapline Drive	2	
Septic systems (serves one single-family home)	R02	R2-2	A	Low	9	Along Trapline Drive	2	
Septic systems (serves one single-family home)	R02	R2-3	A	Low	10	Along Lipscomb Street	2	
Septic systems (serves one single-family home)	R02	R2-10	A	Low		Along One-hundred-fifteenth Ave.	2	
Septic systems (serves one single-family home)	R02	R2-4	A	Low		Along Lipscomb Street	2	
Septic systems (serves one single-family home)	R02	R2-5	A	Low		Along Lipscomb Street	2	
Septic systems (serves one single-family home)	R02	R2-6	A	Low		Along Lipscomb Street	2	
Septic systems (serves one single-family home)	R02	R2-7	A	Low		Along Lipscomb Street	2	
Septic systems (serves one single-family home)	R02	R2-8	A	Low		Along One-hundred-thirteenth Ave.	2	
Septic systems (serves one single-family home)	R02	R2-9	A	Low		Along One-hundred-thirteenth Ave.	2	
Residential Areas	R01	R1-2	B	Low		Residential areas located within Zone B	2	Approximately 9 acres of residential area.
Septic systems (serves one single-family home)	R02	R2-11	B	Low		Along One-hundred-fifteenth Ave.	2	

Table 4 (continued)

*Contaminant Source Inventory and Risk Ranking for  
Homestead Hills  
Sources of Volatile Organic Chemicals*

PWSID 211669.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Overall Rank after Analysis</i>	<i>Location</i>	<i>Map Number</i>	<i>Comments</i>
Septic systems (serves one single-family home)	R02	R2-12	B	Low		Along One-hundred-fifteenth Ave.	2	
Septic systems (serves one single-family home)	R02	R2-13	B	Low		Along One-hundred-fifteenth Ave.	2	
Septic systems (serves one single-family home)	R02	R2-14	B	Low		Along One-hundred-thirteenth Ave.	2	
Septic systems (serves one single-family home)	R02	R2-15	B	Low		Along One-hundred-thirteenth Ave.	2	
Septic systems (serves one single-family home)	R02	R2-16	B	Low		Along One-hundred-thirteenth Ave.	2	
Septic systems (serves one single-family home)	R02	R2-17	B	Low		Along Patro Street	2	
Septic systems (serves one single-family home)	R02	R2-18	B	Low		Along One-hundred-fifteenth Ave.	2	
Septic systems (serves one single-family home)	R02	R2-19	B	Low		Along Patro Street	2	
Septic systems (serves one single-family home)	R02	R2-20	B	Low		Along Patro Street	2	
Septic systems (serves one single-family home)	R02	R2-21	B	Low		Along One-hundred-fifteenth	2	
Septic systems (serves one single-family home)	R02	R2-22	B	Low		Along One-hundred-fifteenth	2	
Septic systems (serves one single-family home)	R02	R2-23	B	Low		Along One-hundred-fifteenth	2	
Septic systems (serves one single-family home)	R02	R2-24	B	Low		Along One-hundred-fifteenth Ave.	2	
Residential Areas	R01	R1-3	C	Low		Residential areas located within Zone C	3	
Residential Areas	R01	R1-3	C	Low		Residential areas located within Zone C	3	
Septic systems (serves one single-family home)	R02	R2-25-41	C	Low		All septic systems located within Zone C	3	
Highways and roads, dirt/gravel	X24	X24-6-15	C	Low		All roads located within Zone C	3	

Table 4 (continued)

Contaminant Source Inventory and Risk Ranking for  
Homestead Hills  
Sources of Volatile Organic Chemicals

PWSID 211669.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Overall Rank after Analysis</i>	<i>Location</i>	<i>Map Number</i>	<i>Comments</i>
--------------------------------	------------------------------	------------------	-------------	----------------------------------	------------------------------------	-----------------	-------------------	-----------------

---



Table 5

*Contaminant Source Inventory and Risk Ranking for  
Homestead Hills*

PWSID 211669.001

*Sources of Heavy Metals, Cyanide and Other Inorganic Chemicals*

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Overall Rank after Analysis</i>	<i>Location</i>	<i>Map Number</i>	<i>Comments</i>
Residential Areas	R01	R1-1	A	Low	1	Residential areas located within Zone A	2	Approximately 8 acres of residential area.
Highways and roads, dirt/gravel	X24	X24-1	A	Low	2	Trapline Drive	2	
Highways and roads, dirt/gravel	X24	X24-2	A	Low	3	Lipscomb Street	2	
Highways and roads, dirt/gravel	X24	X24-3	A,B	Low	4	One-hundred-thirteenth Ave.	2	
Residential Areas	R01	R1-2	B	Low	5	Residential areas located within Zone B	2	Approximately 9 acres of residential area.
Highways and roads, dirt/gravel	X24	X24-4	B	Low	6	Patro Street	2	
Highways and roads, dirt/gravel	X24	X24-5	B	Low	7	One-hundred-Fourteenth Ave.	2	
Septic systems (serves one single-family home)	R02	R2-1	A	Low	8	Along Trapline Drive	2	
Septic systems (serves one single-family home)	R02	R2-2	A	Low	9	Along Trapline Drive	2	
Septic systems (serves one single-family home)	R02	R2-3	A	Low	10	Along Lipscomb Street	2	
Septic systems (serves one single-family home)	R02	R2-10	A	Low		Along One-hundred-fifteenth Ave.	2	
Septic systems (serves one single-family home)	R02	R2-4	A	Low		Along Lipscomb Street	2	
Septic systems (serves one single-family home)	R02	R2-5	A	Low		Along Lipscomb Street	2	
Septic systems (serves one single-family home)	R02	R2-6	A	Low		Along Lipscomb Street	2	
Septic systems (serves one single-family home)	R02	R2-7	A	Low		Along Lipscomb Street	2	
Septic systems (serves one single-family home)	R02	R2-8	A	Low		Along One-hundred-thirteenth Ave.	2	
Septic systems (serves one single-family home)	R02	R2-9	A	Low		Along One-hundred-thirteenth Ave.	2	
Residential Areas	R01	R1-2	B	Low		Residential areas located within Zone B	2	Approximately 9 acres of residential area.
Septic systems (serves one single-family home)	R02	R2-11	B	Low		Along One-hundred-fifteenth Ave.	2	

Table 5 (continued)

Contaminant Source Inventory and Risk Ranking for  
Homestead Hills

PWSID 211669.001

Sources of Heavy Metals, Cyanide and Other Inorganic Chemicals

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Overall Rank after Analysis</i>	<i>Location</i>	<i>Map Number</i>	<i>Comments</i>
Septic systems (serves one single-family home)	R02	R2-12	B	Low		Along One-hundred-fifteenth Ave.	2	
Septic systems (serves one single-family home)	R02	R2-13	B	Low		Along One-hundred-fifteenth Ave.	2	
Septic systems (serves one single-family home)	R02	R2-14	B	Low		Along One-hundred-thirteenth Ave.	2	
Septic systems (serves one single-family home)	R02	R2-15	B	Low		Along One-hundred-thirteenth Ave.	2	
Septic systems (serves one single-family home)	R02	R2-16	B	Low		Along One-hundred-thirteenth Ave.	2	
Septic systems (serves one single-family home)	R02	R2-17	B	Low		Along Patro Street	2	
Septic systems (serves one single-family home)	R02	R2-18	B	Low		Along One-hundred-fifteenth Ave.	2	
Septic systems (serves one single-family home)	R02	R2-19	B	Low		Along Patro Street	2	
Septic systems (serves one single-family home)	R02	R2-20	B	Low		Along Patro Street	2	
Septic systems (serves one single-family home)	R02	R2-21	B	Low		Along One-hundred-fifteenth	2	
Septic systems (serves one single-family home)	R02	R2-22	B	Low		Along One-hundred-fifteenth	2	
Septic systems (serves one single-family home)	R02	R2-23	B	Low		Along One-hundred-fifteenth	2	
Septic systems (serves one single-family home)	R02	R2-24	B	Low		Along One-hundred-fifteenth Ave.	2	
Residential Areas	R01	R1-3	C	Low		Residential areas located within Zone C	3	
Residential Areas	R01	R1-3	C	Low		Residential areas located within Zone C	3	
Septic systems (serves one single-family home)	R02	R2-25-41	C	Low		All septic systems located within Zone C	3	
Highways and roads, dirt/gravel	X24	X24-6-15	C	Low		All roads located within Zone C	3	

Table 5 (continued)

Contaminant Source Inventory and Risk Ranking for  
Homestead Hills

PWSID 211669.001

Sources of Heavy Metals, Cyanide and Other Inorganic Chemicals

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Overall Rank after Analysis</i>	<i>Location</i>	<i>Map Number</i>	<i>Comments</i>
--------------------------------	------------------------------	------------------	-------------	----------------------------------	------------------------------------	-----------------	-------------------	-----------------

---

Table 6

*Contaminant Source Inventory and Risk Ranking for  
Homestead Hills  
Sources of Synthetic Organic Chemicals*

PWSID 211669.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Overall Rank after Analysis</i>	<i>Location</i>	<i>Map Number</i>	<i>Comments</i>
Residential Areas	R01	R1-1	A	Low	1	Residential areas located within Zone A	2	Approximately 8 acres of residential area.
Residential Areas	R01	R1-2	B	Low	2	Residential areas located within Zone B	2	Approximately 9 acres of residential area.
Septic systems (serves one single-family home)	R02	R2-1	A	Low	3	Along Trapline Drive	2	
Septic systems (serves one single-family home)	R02	R2-2	A	Low	4	Along Trapline Drive	2	
Septic systems (serves one single-family home)	R02	R2-3	A	Low	5	Along Lipscomb Street	2	
Septic systems (serves one single-family home)	R02	R2-4	A	Low	6	Along Lipscomb Street	2	
Septic systems (serves one single-family home)	R02	R2-5	A	Low	7	Along Lipscomb Street	2	
Septic systems (serves one single-family home)	R02	R2-6	A	Low	8	Along Lipscomb Street	2	
Septic systems (serves one single-family home)	R02	R2-7	A	Low	9	Along Lipscomb Street	2	
Septic systems (serves one single-family home)	R02	R2-8	A	Low	10	Along One-hundred-thirteenth Ave.	2	
Septic systems (serves one single-family home)	R02	R2-10	A	Low		Along One-hundred-fifteenth Ave.	2	
Septic systems (serves one single-family home)	R02	R2-9	A	Low		Along One-hundred-thirteenth Ave.	2	
Residential Areas	R01	R1-2	B	Low		Residential areas located within Zone B	2	Approximately 9 acres of residential area.
Septic systems (serves one single-family home)	R02	R2-11	B	Low		Along One-hundred-fifteenth Ave.	2	
Septic systems (serves one single-family home)	R02	R2-12	B	Low		Along One-hundred-fifteenth Ave.	2	
Septic systems (serves one single-family home)	R02	R2-13	B	Low		Along One-hundred-fifteenth Ave.	2	
Septic systems (serves one single-family home)	R02	R2-14	B	Low		Along One-hundred-thirteenth Ave.	2	
Septic systems (serves one single-family home)	R02	R2-15	B	Low		Along One-hundred-thirteenth Ave.	2	

Table 6 (continued)

*Contaminant Source Inventory and Risk Ranking for  
Homestead Hills  
Sources of Synthetic Organic Chemicals*

PWSID 211669.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Overall Rank after Analysis</i>	<i>Location</i>	<i>Map Number</i>	<i>Comments</i>
Septic systems (serves one single-family home)	R02	R2-16	B	Low		Along One-hundred-thirteenth Ave.	2	
Septic systems (serves one single-family home)	R02	R2-17	B	Low		Along Patro Street	2	
Septic systems (serves one single-family home)	R02	R2-18	B	Low		Along One-hundred-fifteenth Ave.	2	
Septic systems (serves one single-family home)	R02	R2-19	B	Low		Along Patro Street	2	
Septic systems (serves one single-family home)	R02	R2-20	B	Low		Along Patro Street	2	
Septic systems (serves one single-family home)	R02	R2-21	B	Low		Along One-hundred-fifteenth	2	
Septic systems (serves one single-family home)	R02	R2-22	B	Low		Along One-hundred-fifteenth	2	
Septic systems (serves one single-family home)	R02	R2-23	B	Low		Along One-hundred-fifteenth	2	
Septic systems (serves one single-family home)	R02	R2-24	B	Low		Along One-hundred-fifteenth Ave.	2	
Residential Areas	R01	R1-3	C	Low		Residential areas located within Zone C	3	
Residential Areas	R01	R1-3	C	Low		Residential areas located within Zone C	3	
Septic systems (serves one single-family home)	R02	R2-25-41	C	Low		All septic systems located within Zone C	3	
Municipal or city parks (with green areas)	X04	X4-1	C,D	Low		Anchorage park located within Zones C and D	3	

Table 7

*Contaminant Source Inventory and Risk Ranking for  
Homestead Hills  
Sources of Other Organic Chemicals*

PWSID 211669.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Overall Rank after Analysis</i>	<i>Location</i>	<i>Map Number</i>	<i>Comments</i>
Residential Areas	R01	R1-1	A	Low	1	Residential areas located within Zone A	2	Approximately 8 acres of residential area.
Residential Areas	R01	R1-2	B	Low	2	Residential areas located within Zone B	2	Approximately 9 acres of residential area.
Septic systems (serves one single-family home)	R02	R2-1	A	Low	3	Along Trapline Drive	2	
Septic systems (serves one single-family home)	R02	R2-2	A	Low	4	Along Trapline Drive	2	
Septic systems (serves one single-family home)	R02	R2-3	A	Low	5	Along Lipscomb Street	2	
Septic systems (serves one single-family home)	R02	R2-4	A	Low	6	Along Lipscomb Street	2	
Septic systems (serves one single-family home)	R02	R2-5	A	Low	7	Along Lipscomb Street	2	
Septic systems (serves one single-family home)	R02	R2-6	A	Low	8	Along Lipscomb Street	2	
Septic systems (serves one single-family home)	R02	R2-7	A	Low	9	Along Lipscomb Street	2	
Septic systems (serves one single-family home)	R02	R2-8	A	Low	10	Along One-hundred-thirteenth Ave.	2	
Septic systems (serves one single-family home)	R02	R2-10	A	Low		Along One-hundred-fifteenth Ave.	2	
Septic systems (serves one single-family home)	R02	R2-9	A	Low		Along One-hundred-thirteenth Ave.	2	
Highways and roads, dirt/gravel	X24	X24-1	A	Low		Trapline Drive	2	
Highways and roads, dirt/gravel	X24	X24-2	A	Low		Lipscomb Street	2	
Highways and roads, dirt/gravel	X24	X24-3	A,B	Low		One-hundred-thirteenth Ave.	2	
Residential Areas	R01	R1-2	B	Low		Residential areas located within Zone B	2	Approximately 9 acres of residential area.
Septic systems (serves one single-family home)	R02	R2-11	B	Low		Along One-hundred-fifteenth Ave.	2	
Septic systems (serves one single-family home)	R02	R2-12	B	Low		Along One-hundred-fifteenth Ave.	2	
Septic systems (serves one single-family home)	R02	R2-13	B	Low		Along One-hundred-fifteenth Ave.	2	

Table 7 (continued)

*Contaminant Source Inventory and Risk Ranking for  
Homestead Hills  
Sources of Other Organic Chemicals*

PWSID 211669.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Overall Rank after Analysis</i>	<i>Location</i>	<i>Map Number</i>	<i>Comments</i>
Septic systems (serves one single-family home)	R02	R2-14	B	Low		Along One-hundred-thirteenth Ave.	2	
Septic systems (serves one single-family home)	R02	R2-15	B	Low		Along One-hundred-thirteenth Ave.	2	
Septic systems (serves one single-family home)	R02	R2-16	B	Low		Along One-hundred-thirteenth Ave.	2	
Septic systems (serves one single-family home)	R02	R2-17	B	Low		Along Patro Street	2	
Septic systems (serves one single-family home)	R02	R2-18	B	Low		Along One-hundred-fifteenth Ave.	2	
Septic systems (serves one single-family home)	R02	R2-19	B	Low		Along Patro Street	2	
Septic systems (serves one single-family home)	R02	R2-20	B	Low		Along Patro Street	2	
Septic systems (serves one single-family home)	R02	R2-21	B	Low		Along One-hundred-fifteenth	2	
Septic systems (serves one single-family home)	R02	R2-22	B	Low		Along One-hundred-fifteenth	2	
Septic systems (serves one single-family home)	R02	R2-23	B	Low		Along One-hundred-fifteenth	2	
Septic systems (serves one single-family home)	R02	R2-24	B	Low		Along One-hundred-fifteenth Ave.	2	
Highways and roads, dirt/gravel	X24	X24-4	B	Low		Patro Street	2	
Highways and roads, dirt/gravel	X24	X24-5	B	Low		One-hundred-Fourteenth Ave.	2	
Residential Areas	R01	R1-3	C	Low		Residential areas located within Zone C	3	
Residential Areas	R01	R1-3	C	Low		Residential areas located within Zone C	3	
Septic systems (serves one single-family home)	R02	R2-25-41	C	Low		All septic systems located within Zone C	3	
Highways and roads, dirt/gravel	X24	X24-6-15	C	Low		All roads located within Zone C	3	

*Table 7 (continued)*

*Contaminant Source Inventory and Risk Ranking for  
Homestead Hills  
Sources of Other Organic Chemicals*

*PWSID 211669.001*

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Overall Rank after Analysis</i>	<i>Location</i>	<i>Map Number</i>	<i>Comments</i>
--------------------------------	------------------------------	------------------	-------------	----------------------------------	------------------------------------	-----------------	-------------------	-----------------


---





## **APPENDIX C**

### **Homestead Hills' Drinking Water Protection Area and Potential & Existing Contaminant Sources**

# Drinking Water Protection Area and Potential & Existing Contaminant Sources for Homestead Hills

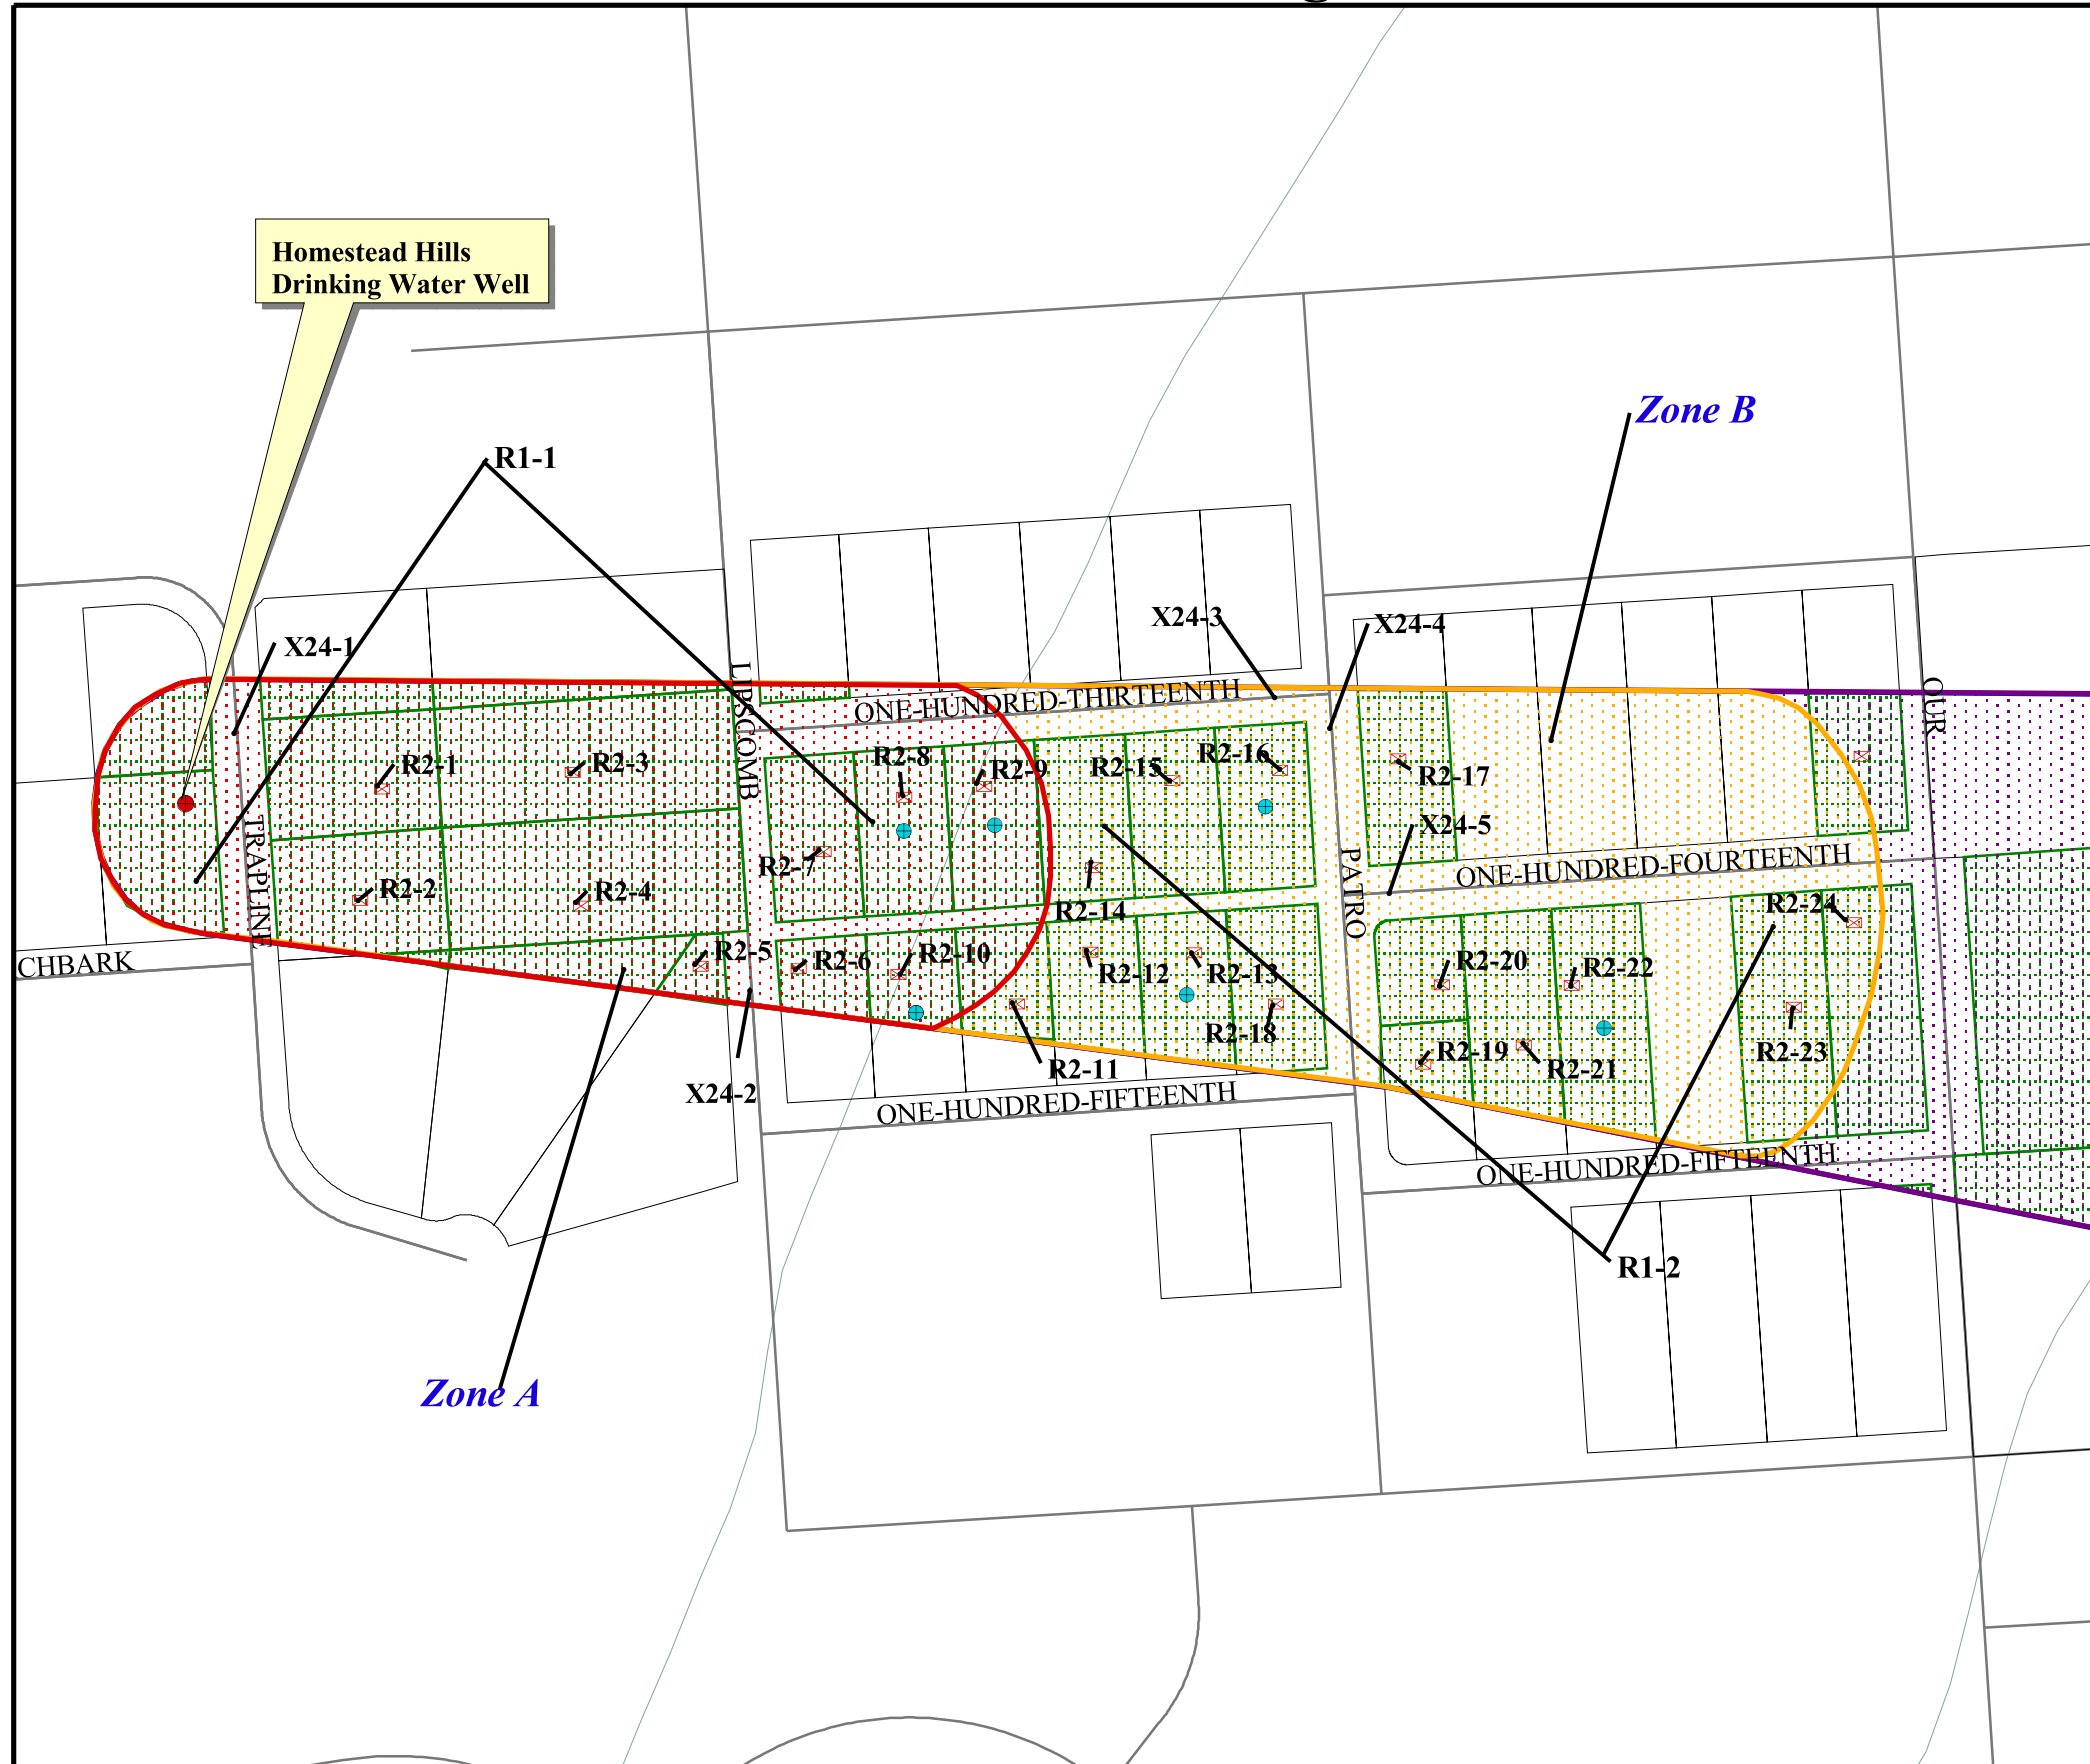

- Homestead Hills Drinking Water Well
- Private and Public DW Wells
- Zone A Protection Area**
- Several Months Travel Time
- Zone B Protection Area**
- Less Than 2 Years Travel Time
- Zone C Protection Area**
- Less Than 5 Years Travel Time
- Zone D Protection Area**
- Less Than 10 Years Travel Time
- Lawns and Gardens (R1)
- Septic Systems (R2)
- Anchorage Land Parcels
- ▬ Roads (X24)
- Anchorage Lakes
- ▬ Anchorage Streams
- ▬ Elevation Contours

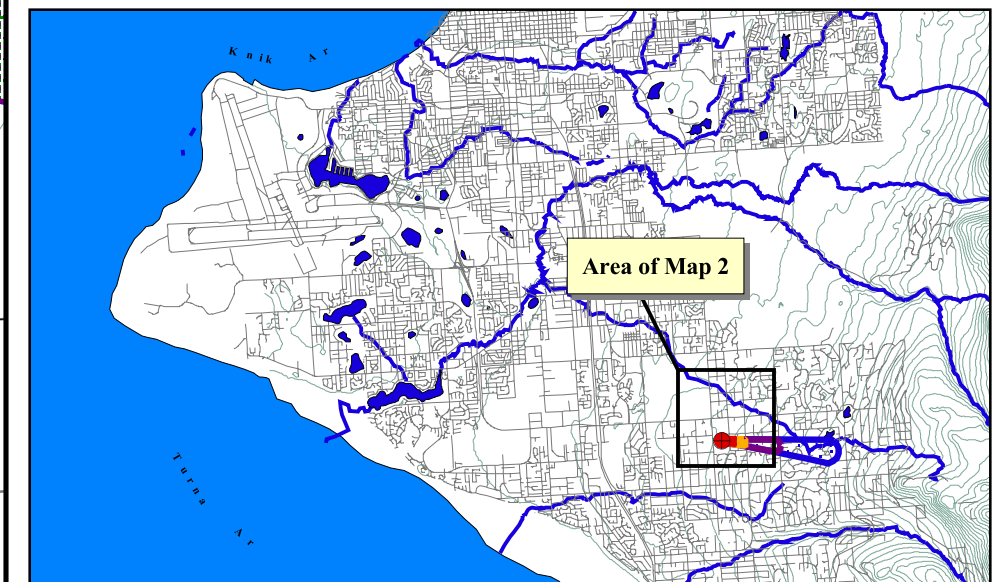


400 0 400 800 Feet

PWSID 211669.001



*Map 2*

# Drinking Water Protection Area and Potential & Existing Contaminant Sources for Homestead Hills

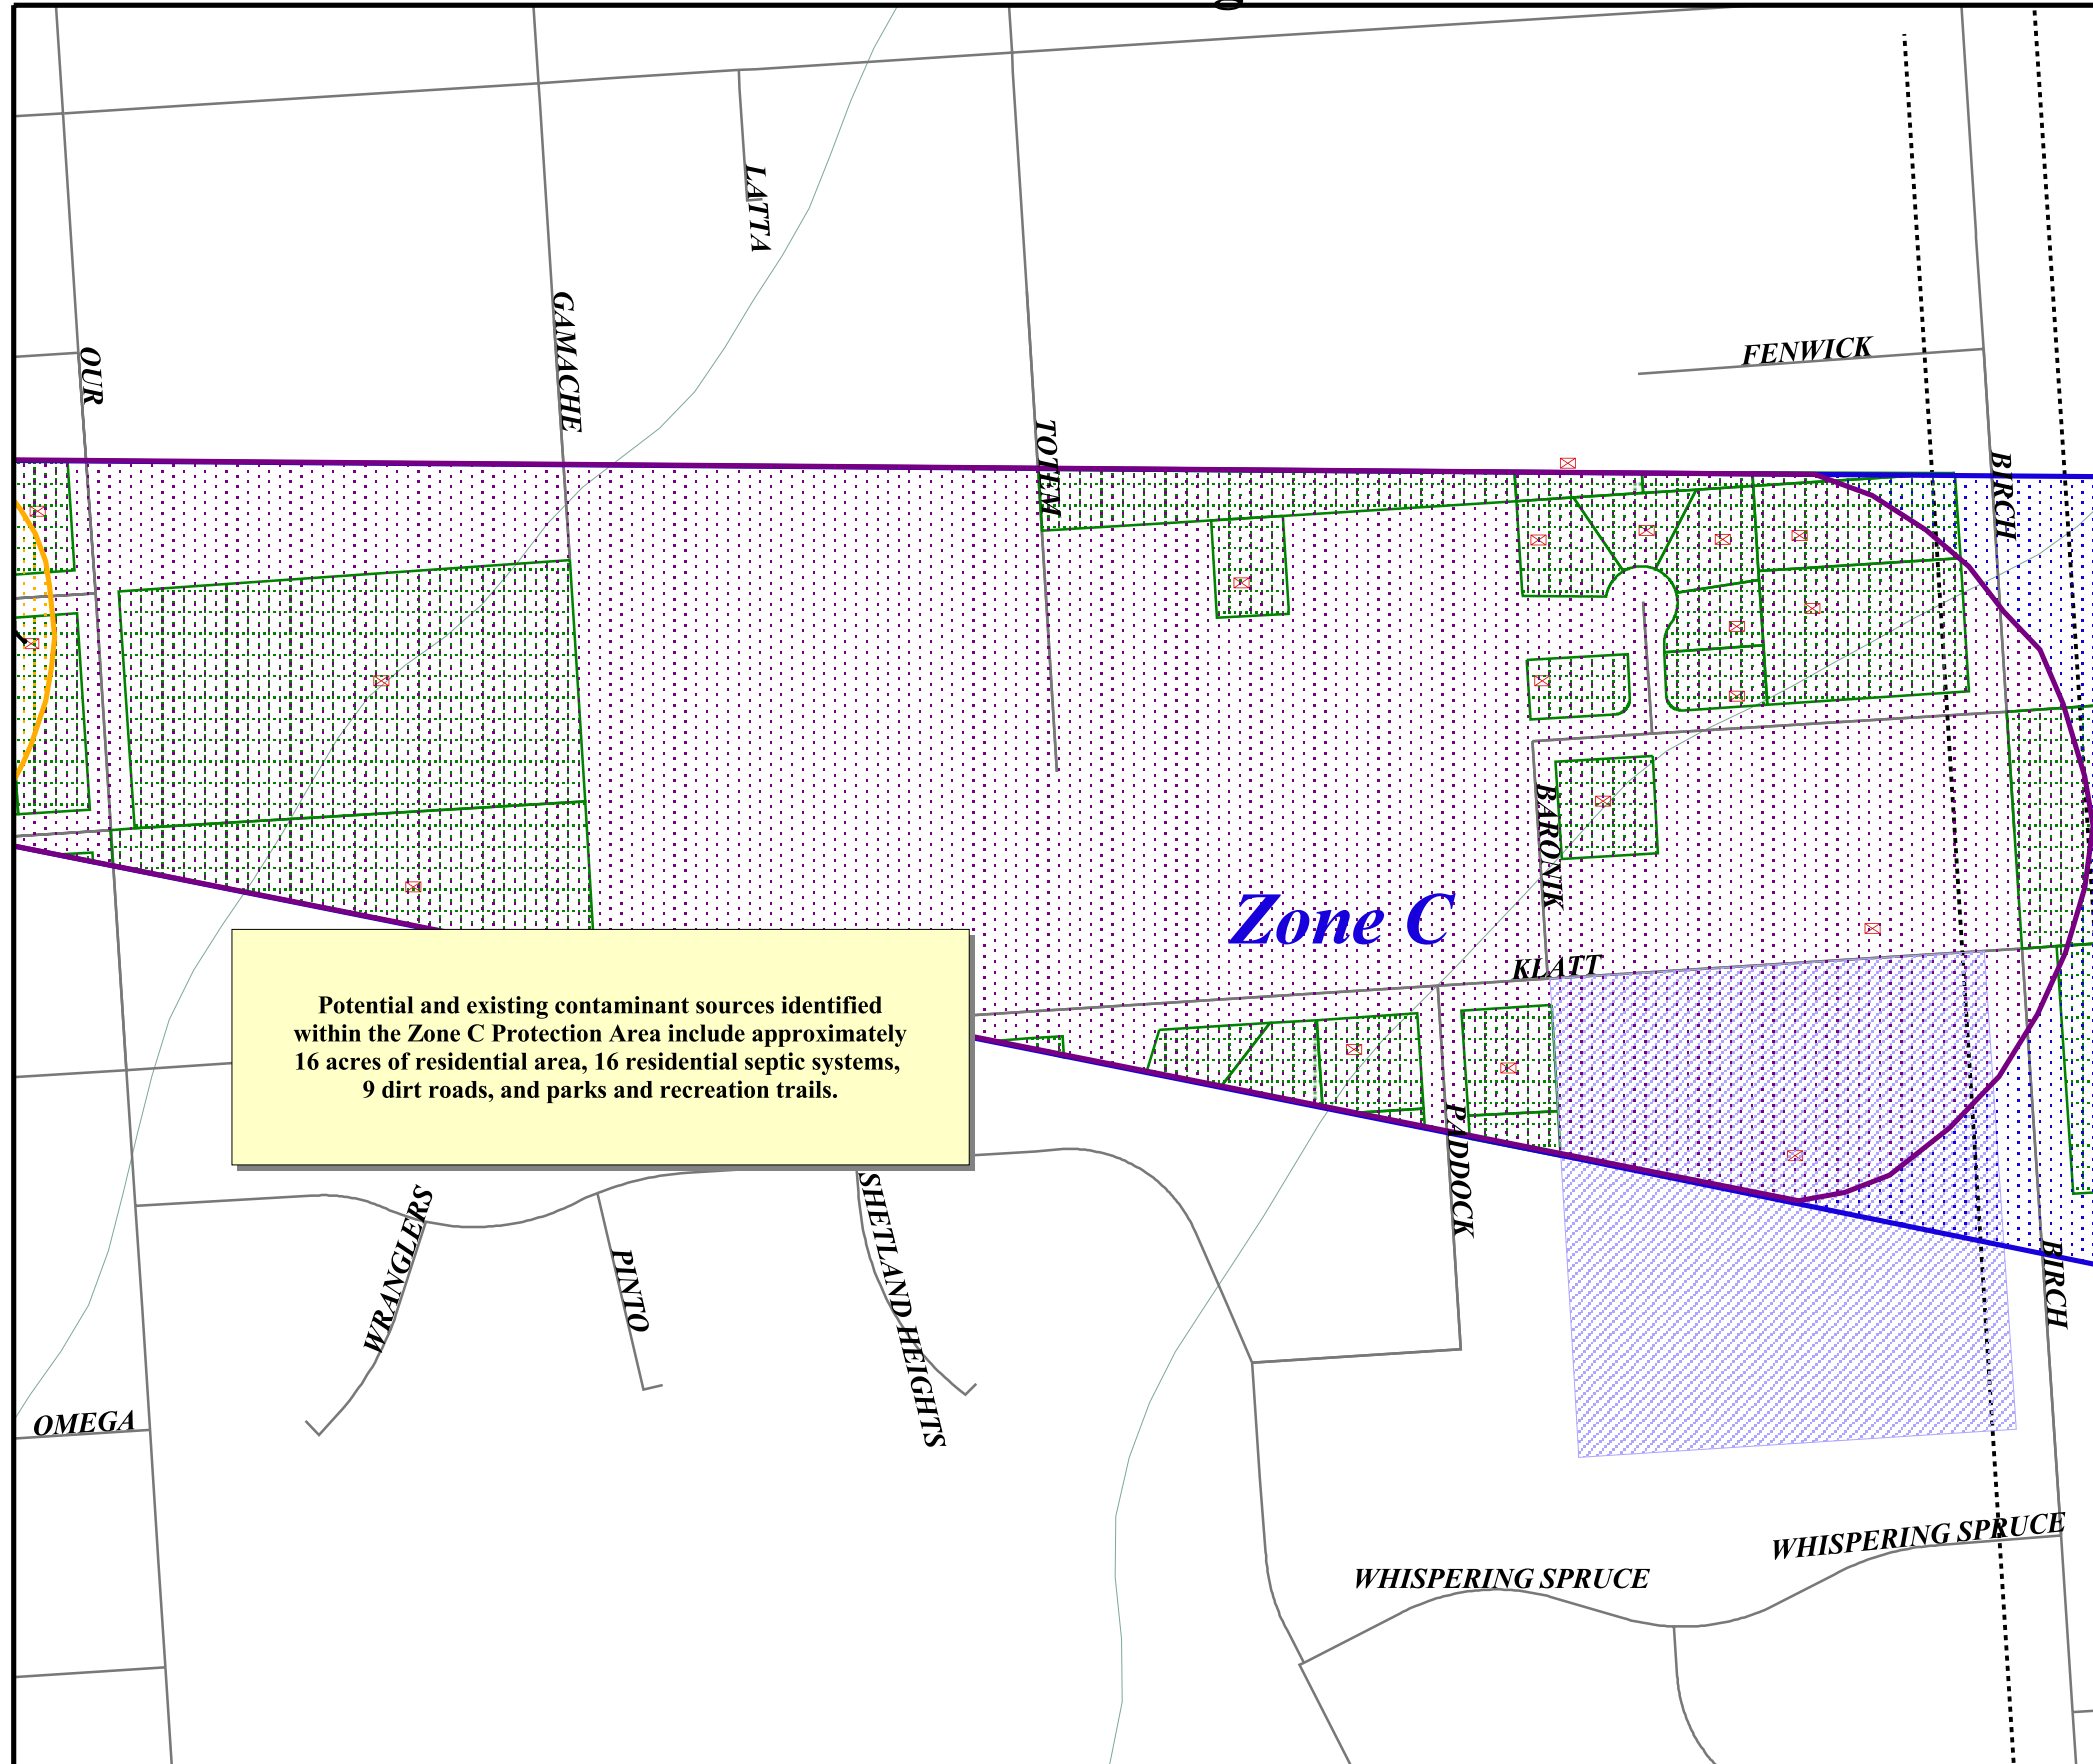

Potential and existing contaminant sources identified within the Zone C Protection Area include approximately 16 acres of residential area, 16 residential septic systems, 9 dirt roads, and parks and recreation trails.


- Homestead Hills Drinking Water Well
- Zone A Protection Area
  - Several Months Travel Time
- Zone B Protection Area
  - Less Than 2 Years Travel Time
- Zone C Protection Area
  - Less Than 5 Years Travel Time
- Zone D Protection Area
  - Less Than 10 Years Travel Time
- Anchorage Parks (X4)
- Lawns and Gardens (R1)
- Septic Systems (R2)
- Trails (X46)
- Roads (X24)
- Anchorage Lakes
- Anchorage Streams
- Elevation Contours

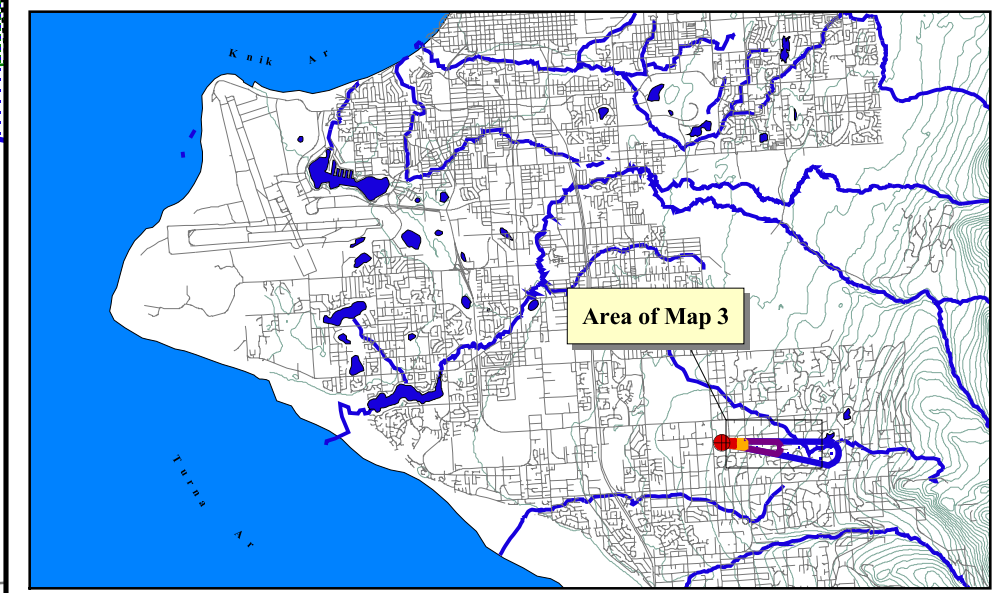



PWSID 211669.001

## Map 3

# Drinking Water Protection Area and Potential & Existing Contaminant Sources for Homestead Hills

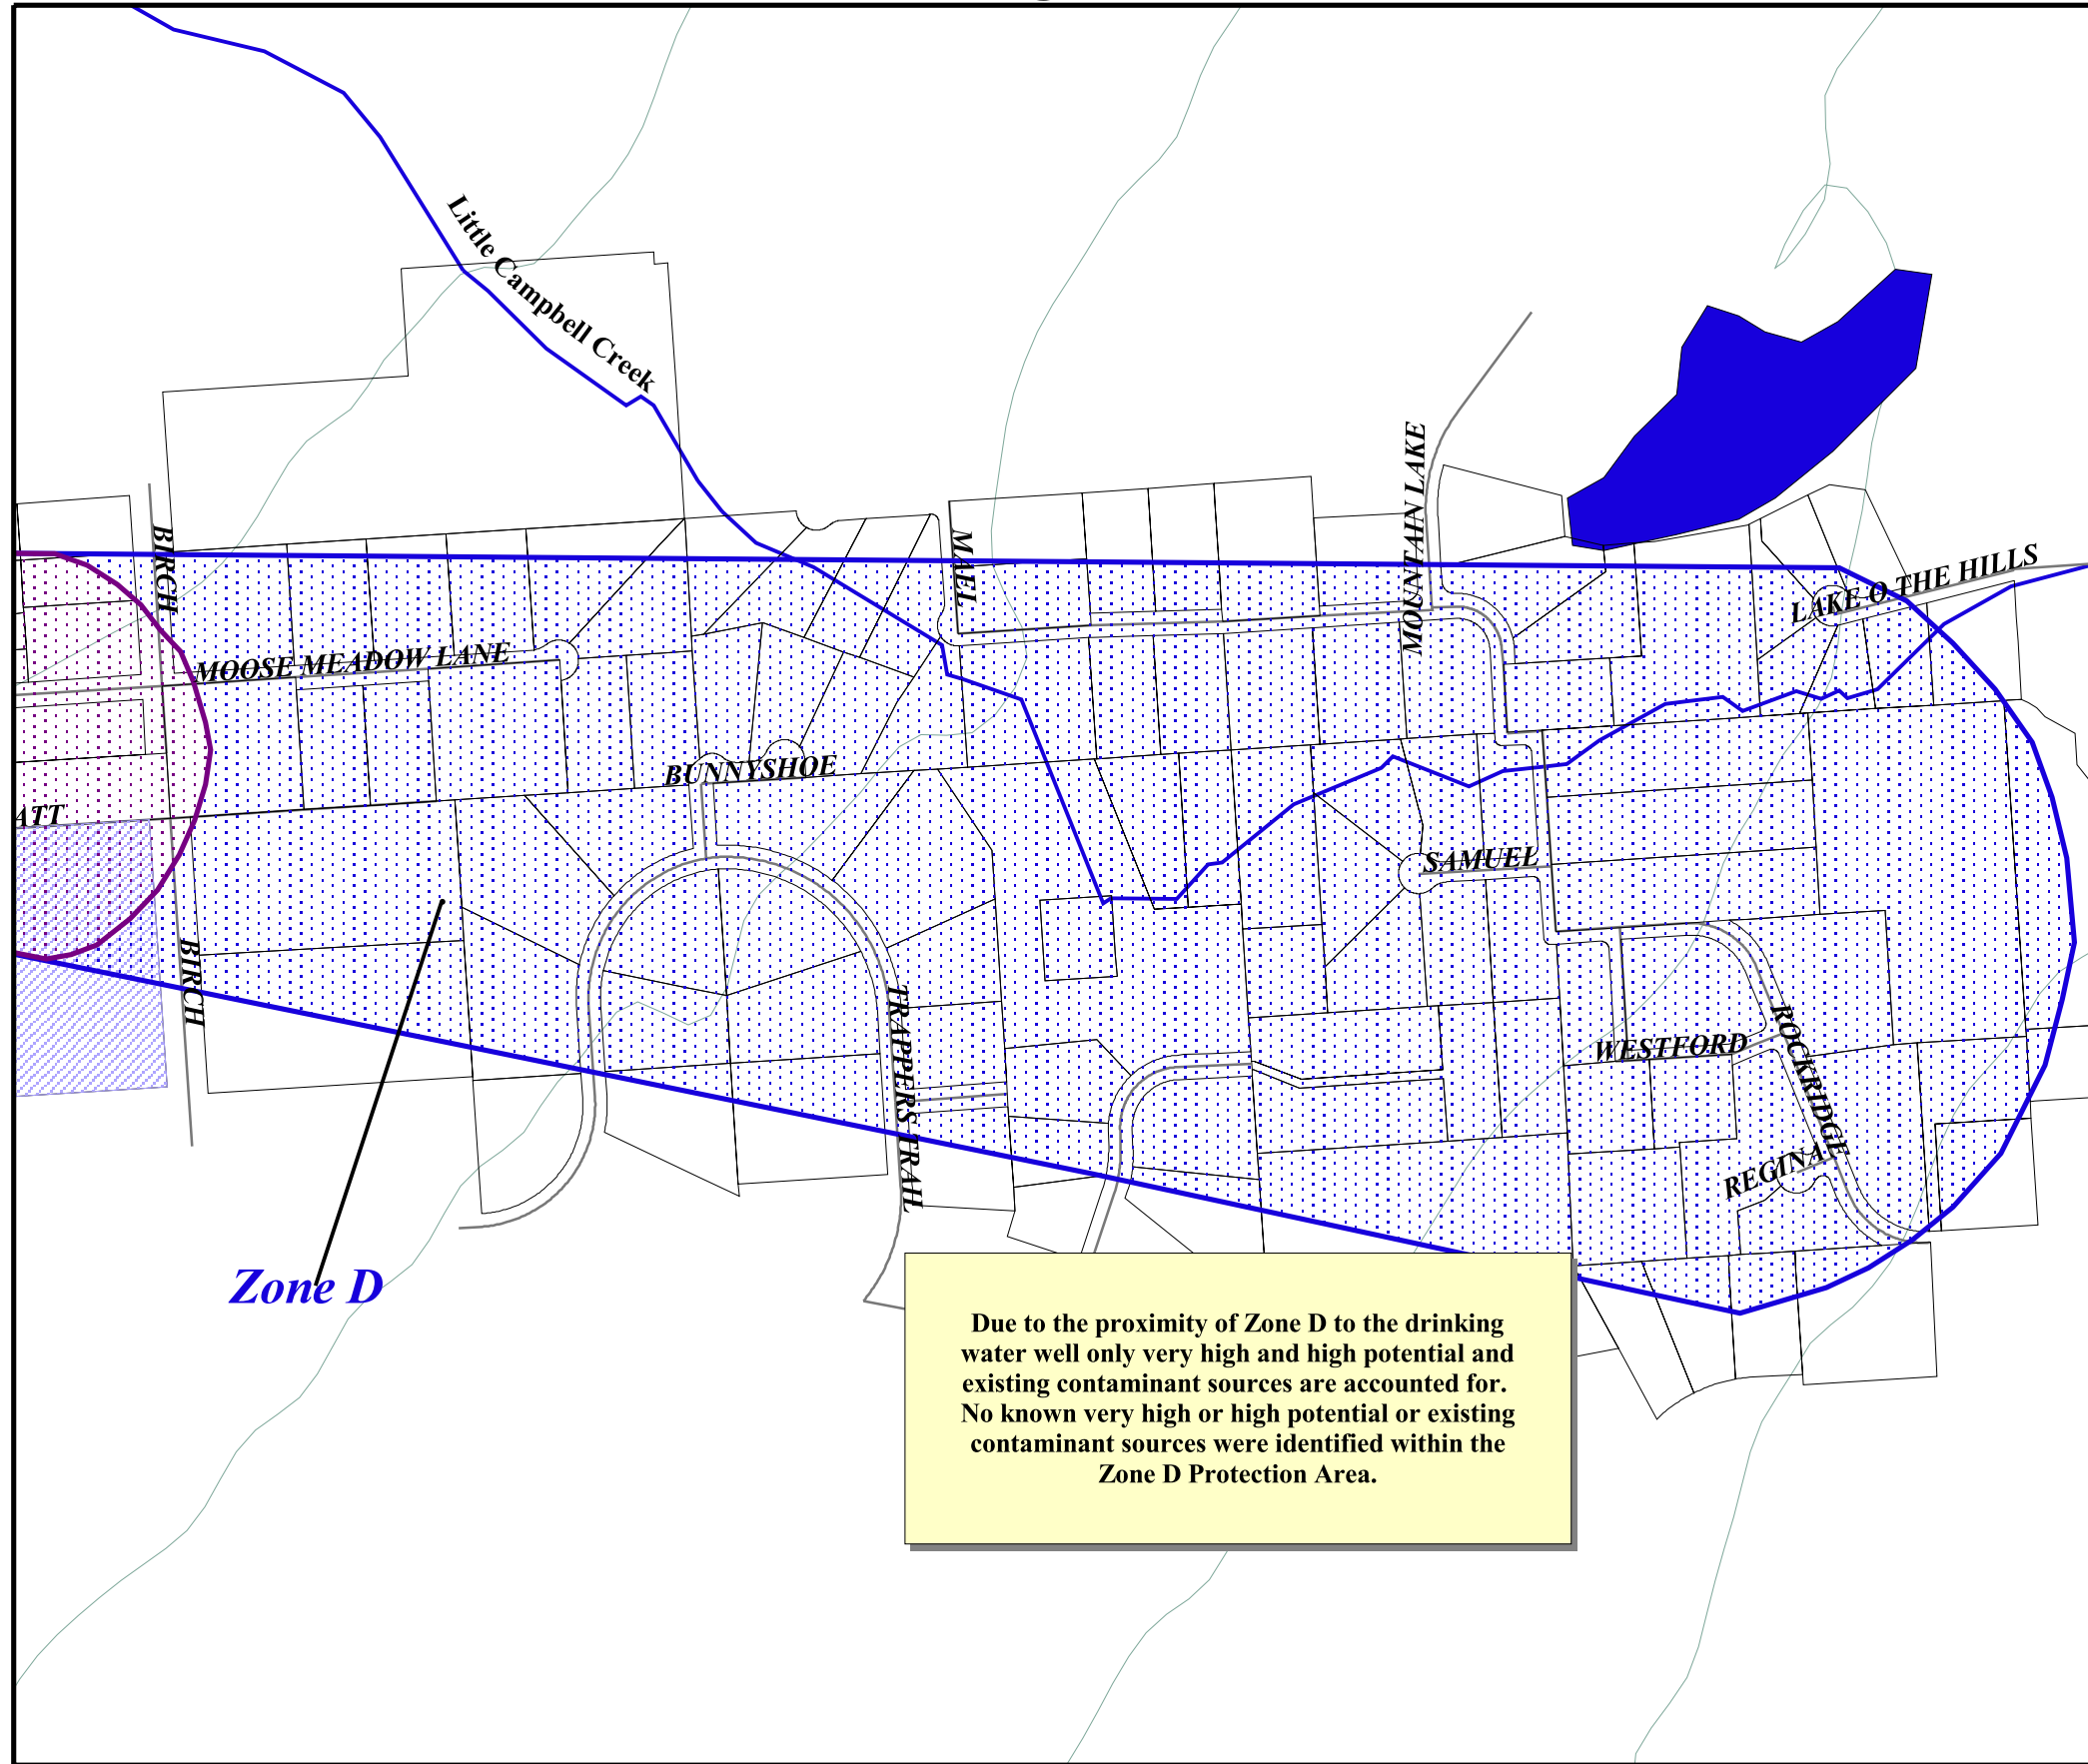

- Homestead Hills DW Well
- Zone A Protection Area**
- Several Months Travel Time
- Zone B Protection Area**
- Less Than 2 Years Travel Time
- Zone C Protection Area**
- Less Than 5 Years Travel Time
- Zone D Protection Area**
- Less Than 10 Years Travel Time
- Anchorage Parks (X4)
- Anchorage Land Parcels
- Roads (X24)
- Anchorage Lakes
- Anchorage Streams
- Elevation Contours

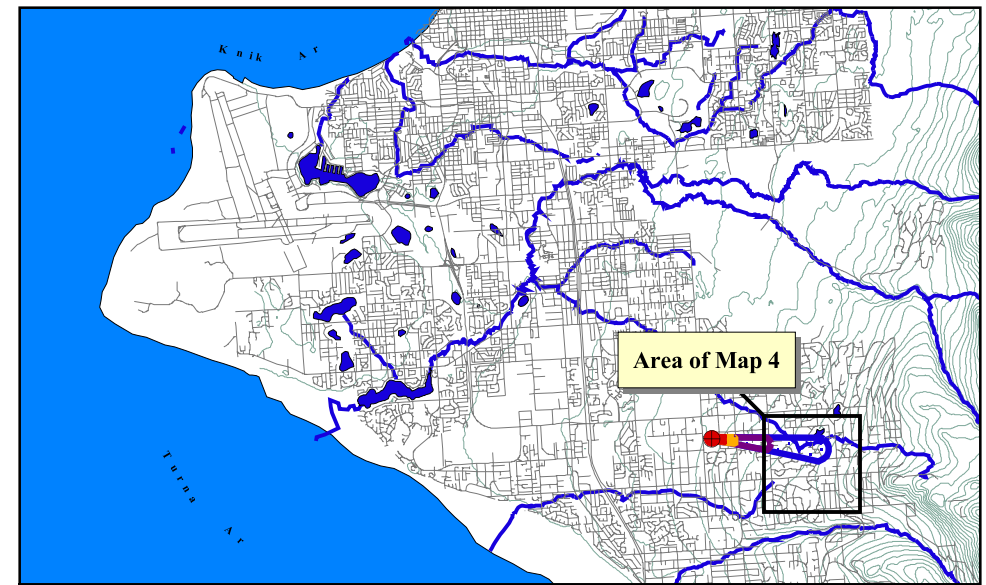

Due to the proximity of Zone D to the drinking water well only very high and high potential and existing contaminant sources are accounted for. No known very high or high potential or existing contaminant sources were identified within the Zone D Protection Area.




PWSID 211669.001

## Map 4

## **APPENDIX D**

### **Vulnerability Analysis for Homestead Hills' Public Drinking Water Source**

**Chart 1. Susceptibility of the wellhead - Homestead Hills**

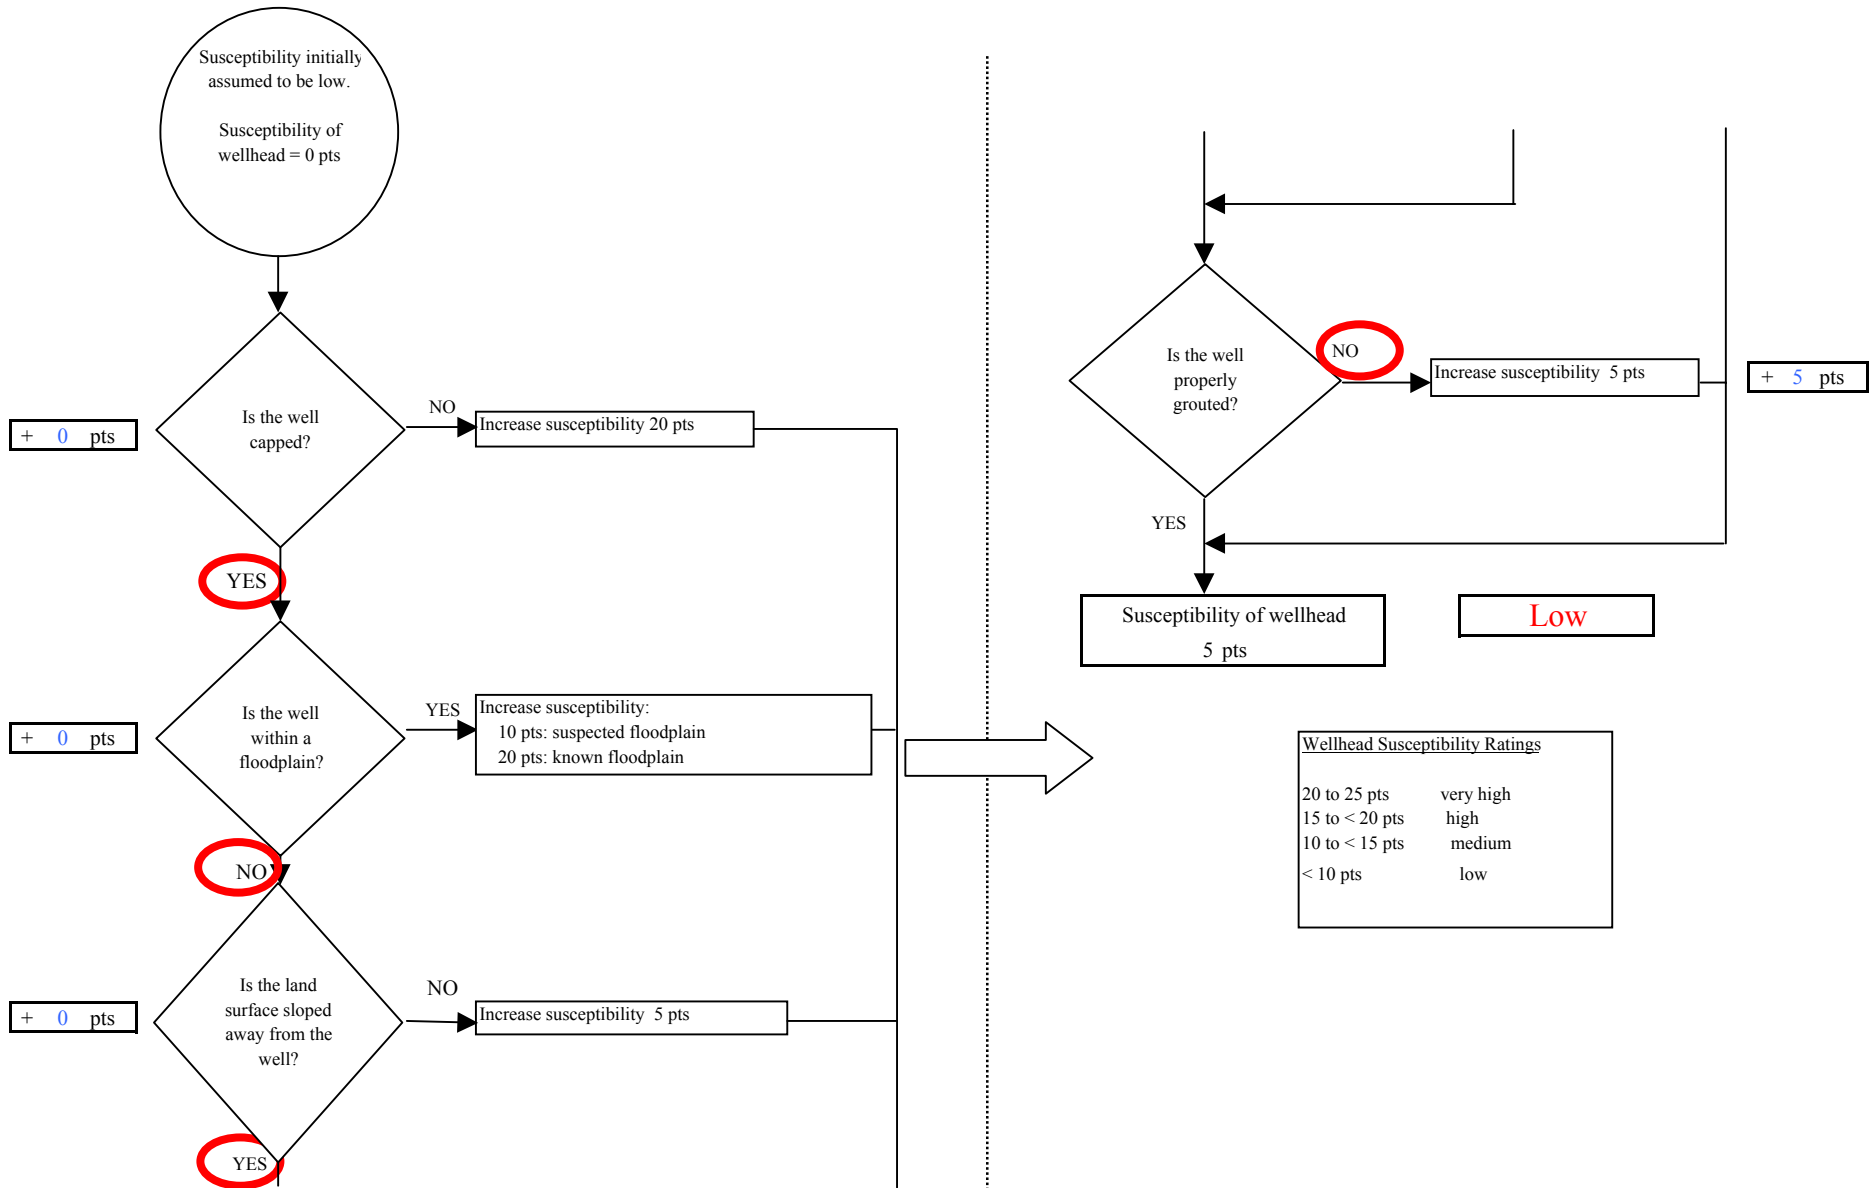

**Chart 2. Susceptibility of the aquifer - Homestead Hills**




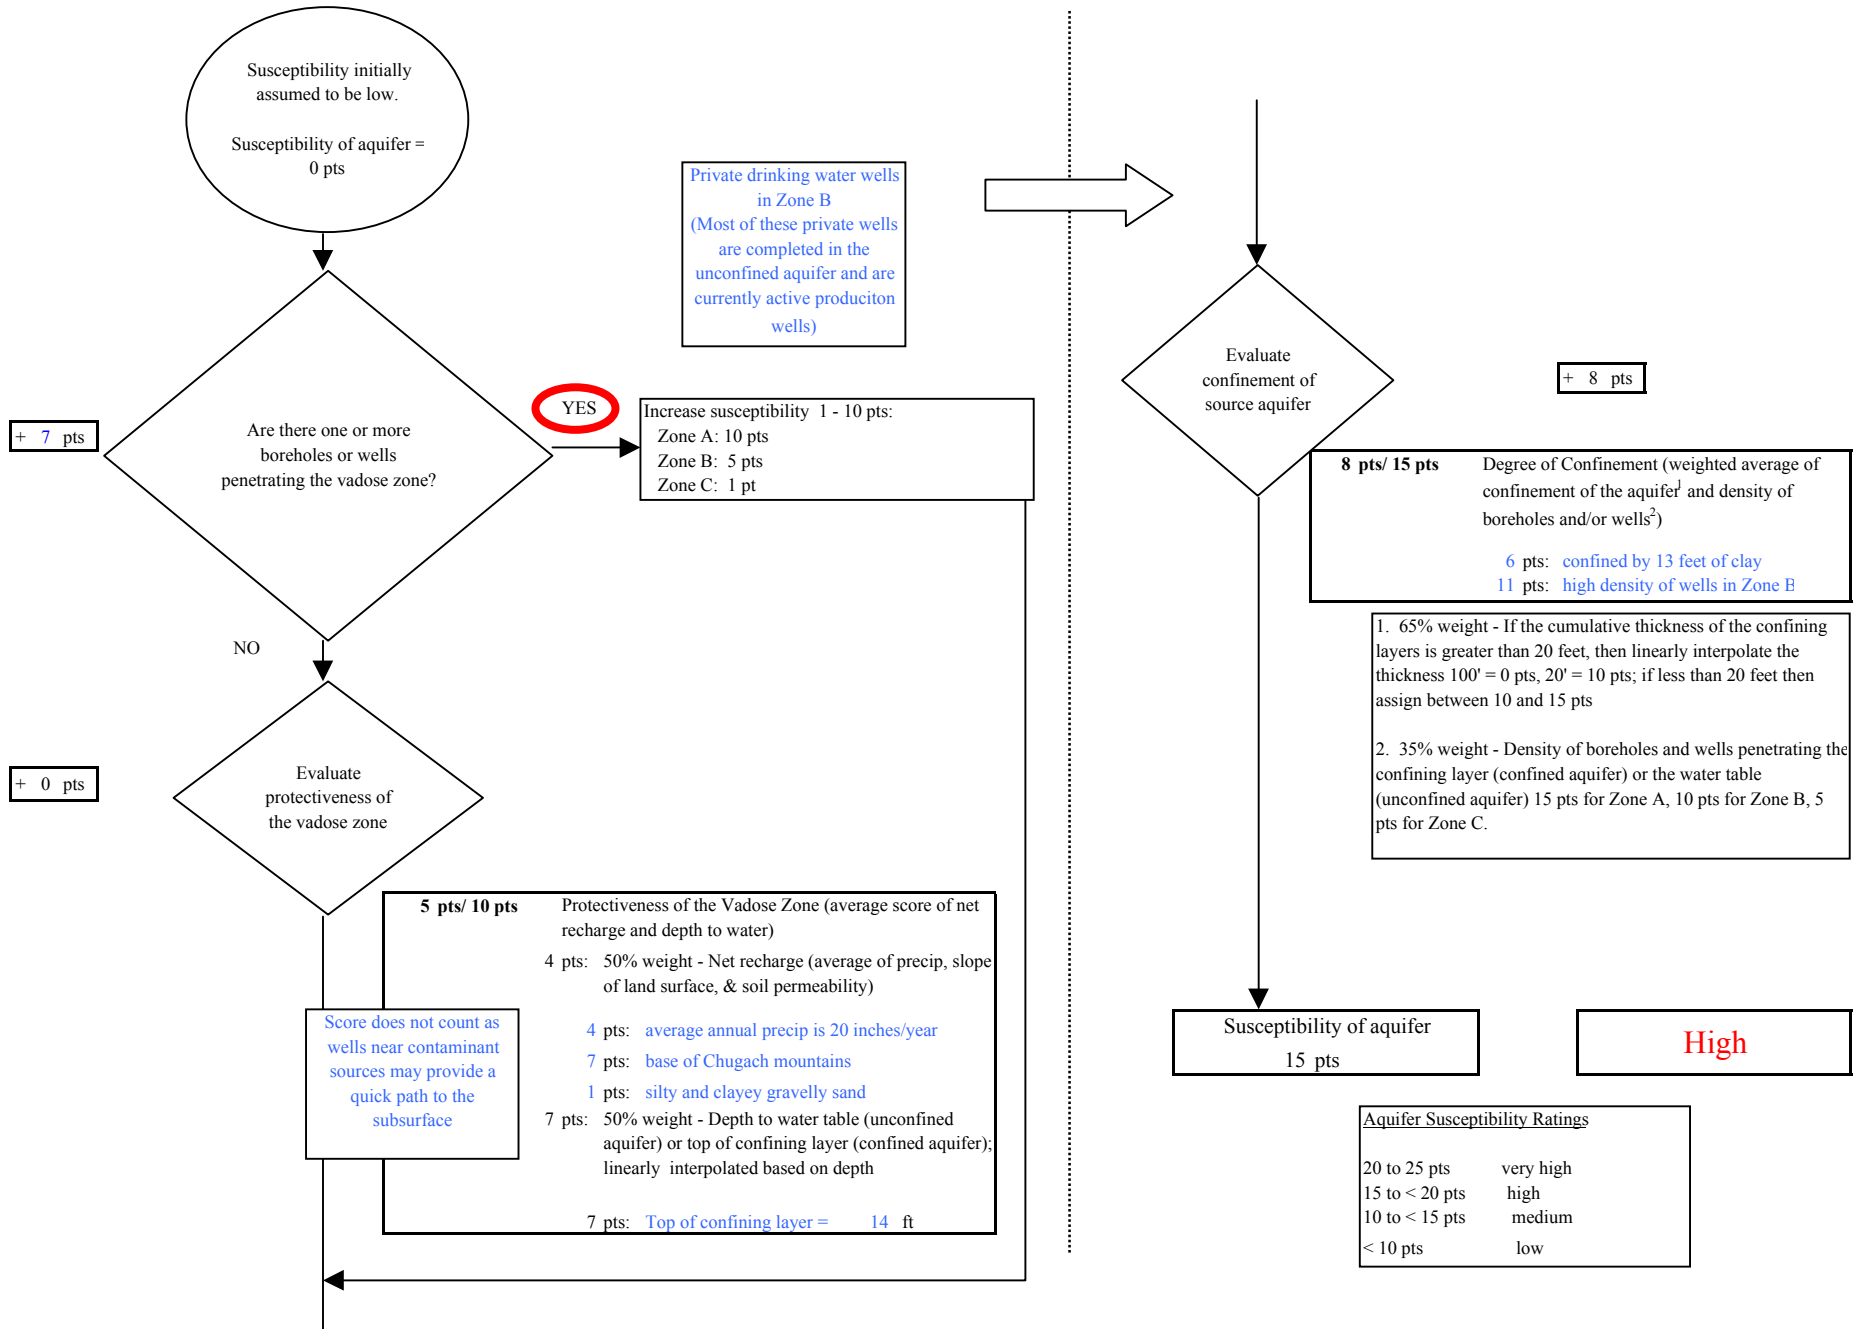


Chart 3. Contaminant risks for *Homestead Hills - Bacteria & Viruses*

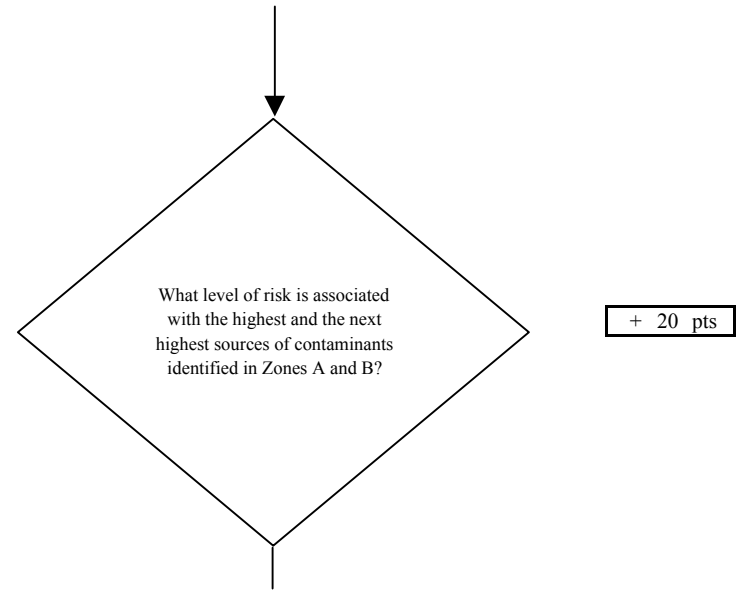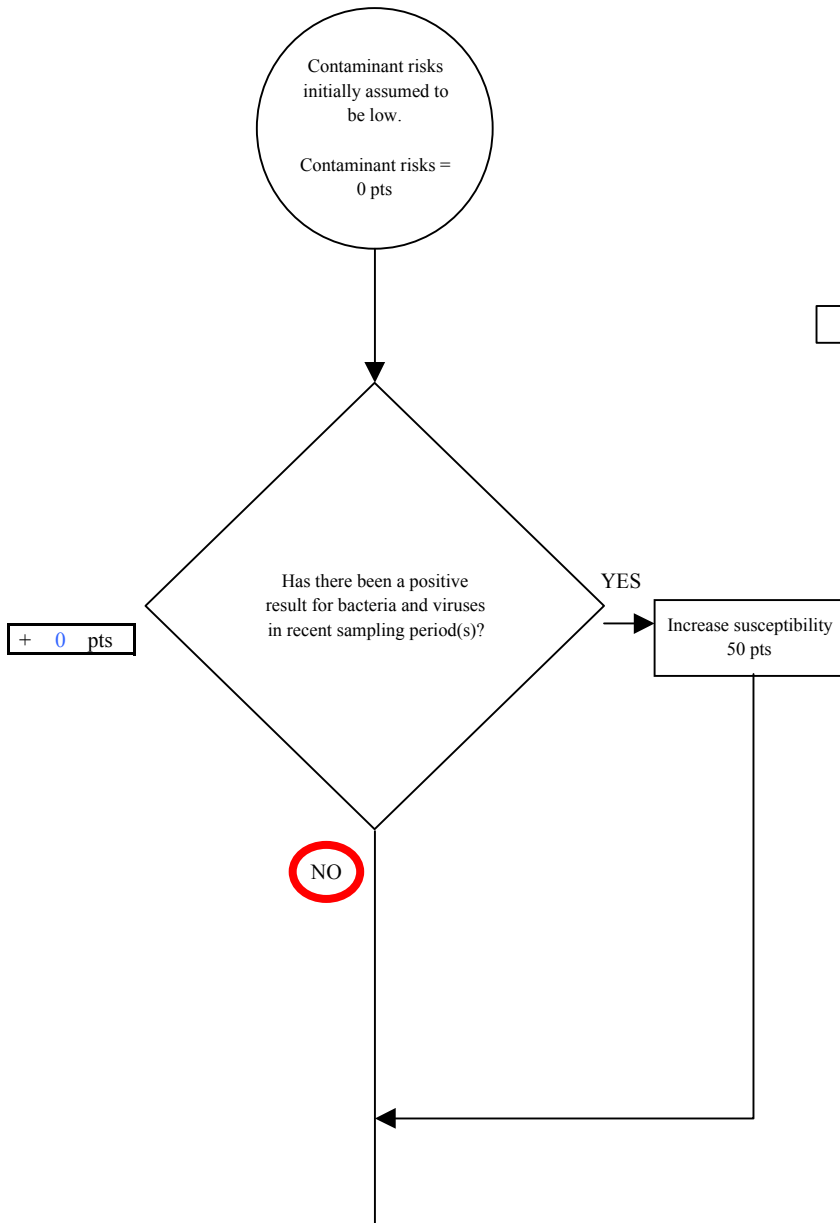

Risk Rankings for Contaminant Sources Identified in Zones A and B			
	Zone A	Zone B	Total
Very High(s)	0	0	0
High(s)	0	0	0
Medium(s)	0	0	0
Low(s)	12	5	17




	LOW 10 pts	MEDIUM 20 pts	HIGH 30 pts	VERY HIGH 40 pts
LOW	≥ 10 sources + 10 pts	≥ 10 sources + 5 pts	≥ 20 sources + 5 pts	----
MEDIUM	----	≥ 2 sources + 5 pts	≥ 5 sources + 5 pts	≥ 10 sources + 5 pts
HIGH	----	----	≥ 1 source + 10 pts	≥ 2 sources + 10 pts
VERY HIGH	----	----	----	≥ 1 source + 10 pts

Matrix Score 20

Note: Septic systems, sewerlines, and roads are each assigned a risk ranking for each individual contaminant source in the CSI. The VA, however, counts these contaminant sources as a group and assigns a calculated number of either "lows" or "mediums" based on the density.



**Chart 3. Contaminant risks for Homestead Hills - Bacteria & Viruses**

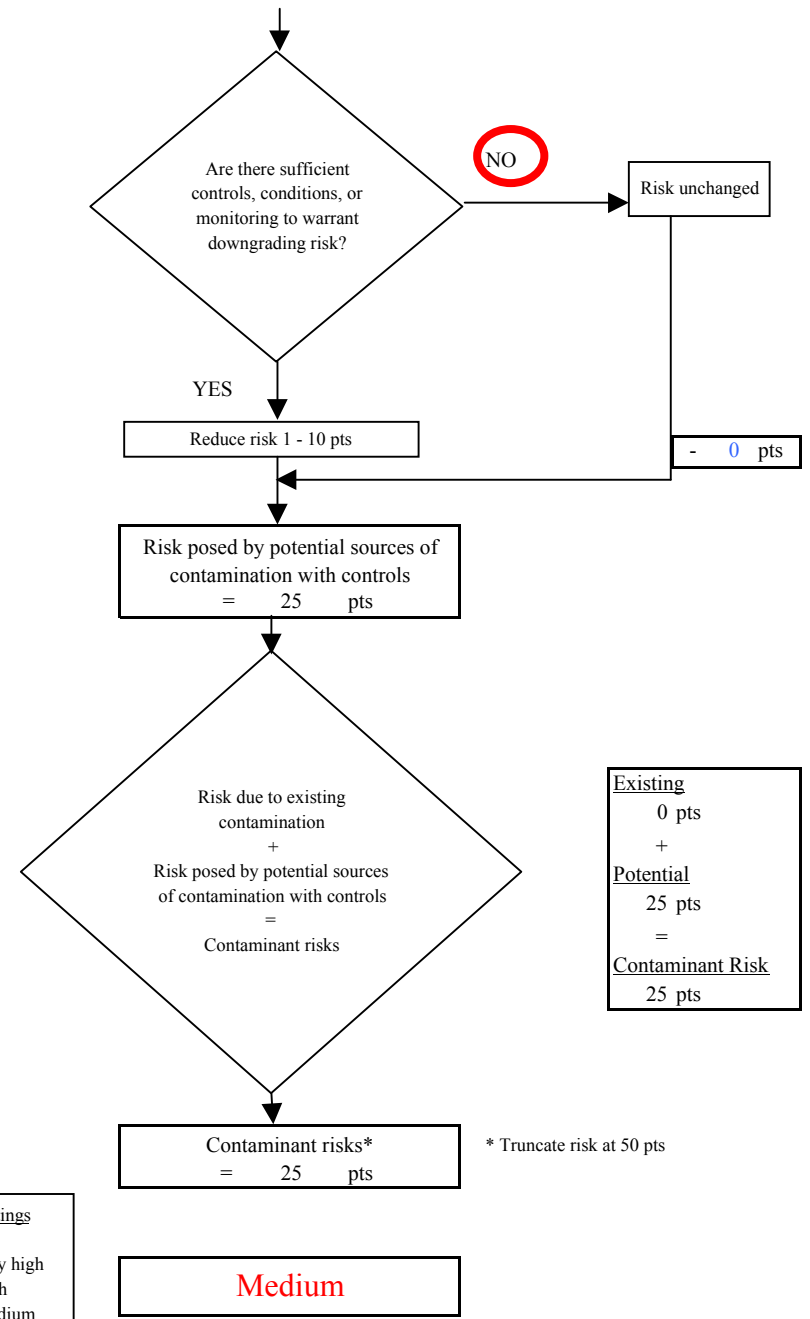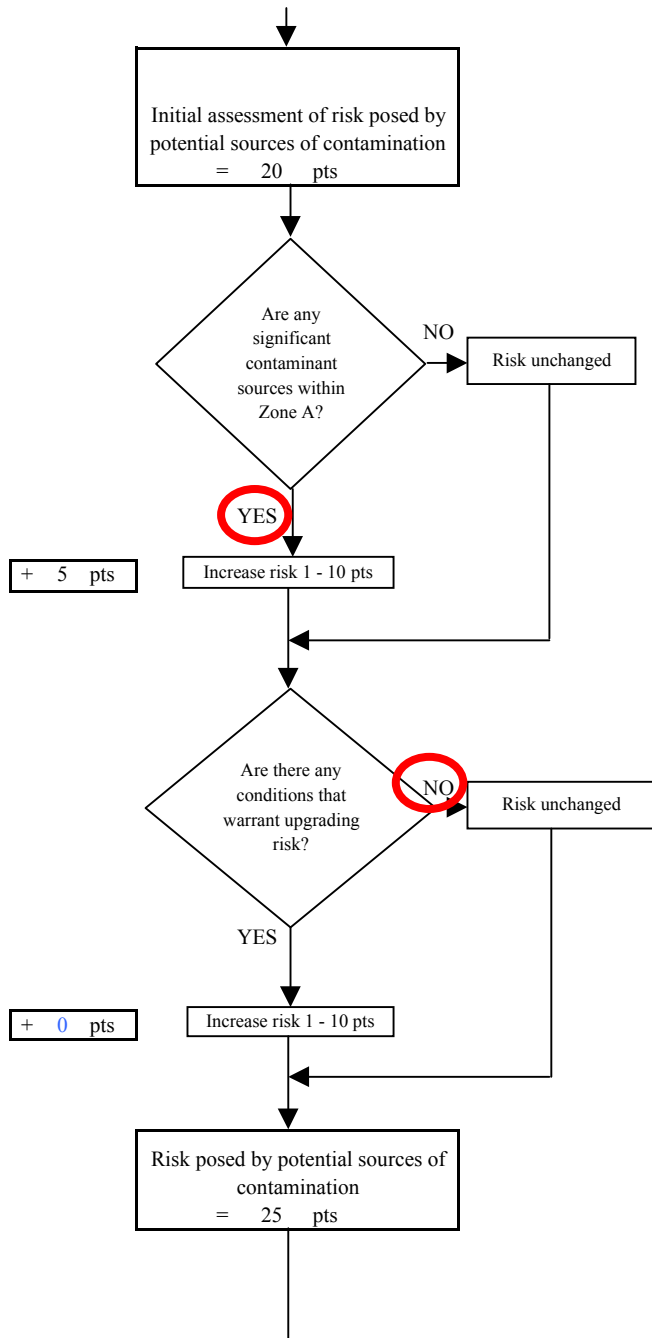

Contaminant Risk Ratings	
40 to 50 pts	very high
30 to < 40 pts	high
20 to < 30 pts	medium
< 20 pts	low

Existing	0 pts
+	
Potential	25 pts
=	
Contaminant Risk	25 pts

\* Truncate risk at 50 pts

**Chart 4. Vulnerability analysis for Homestead Hills - Bacteria & Viruses**



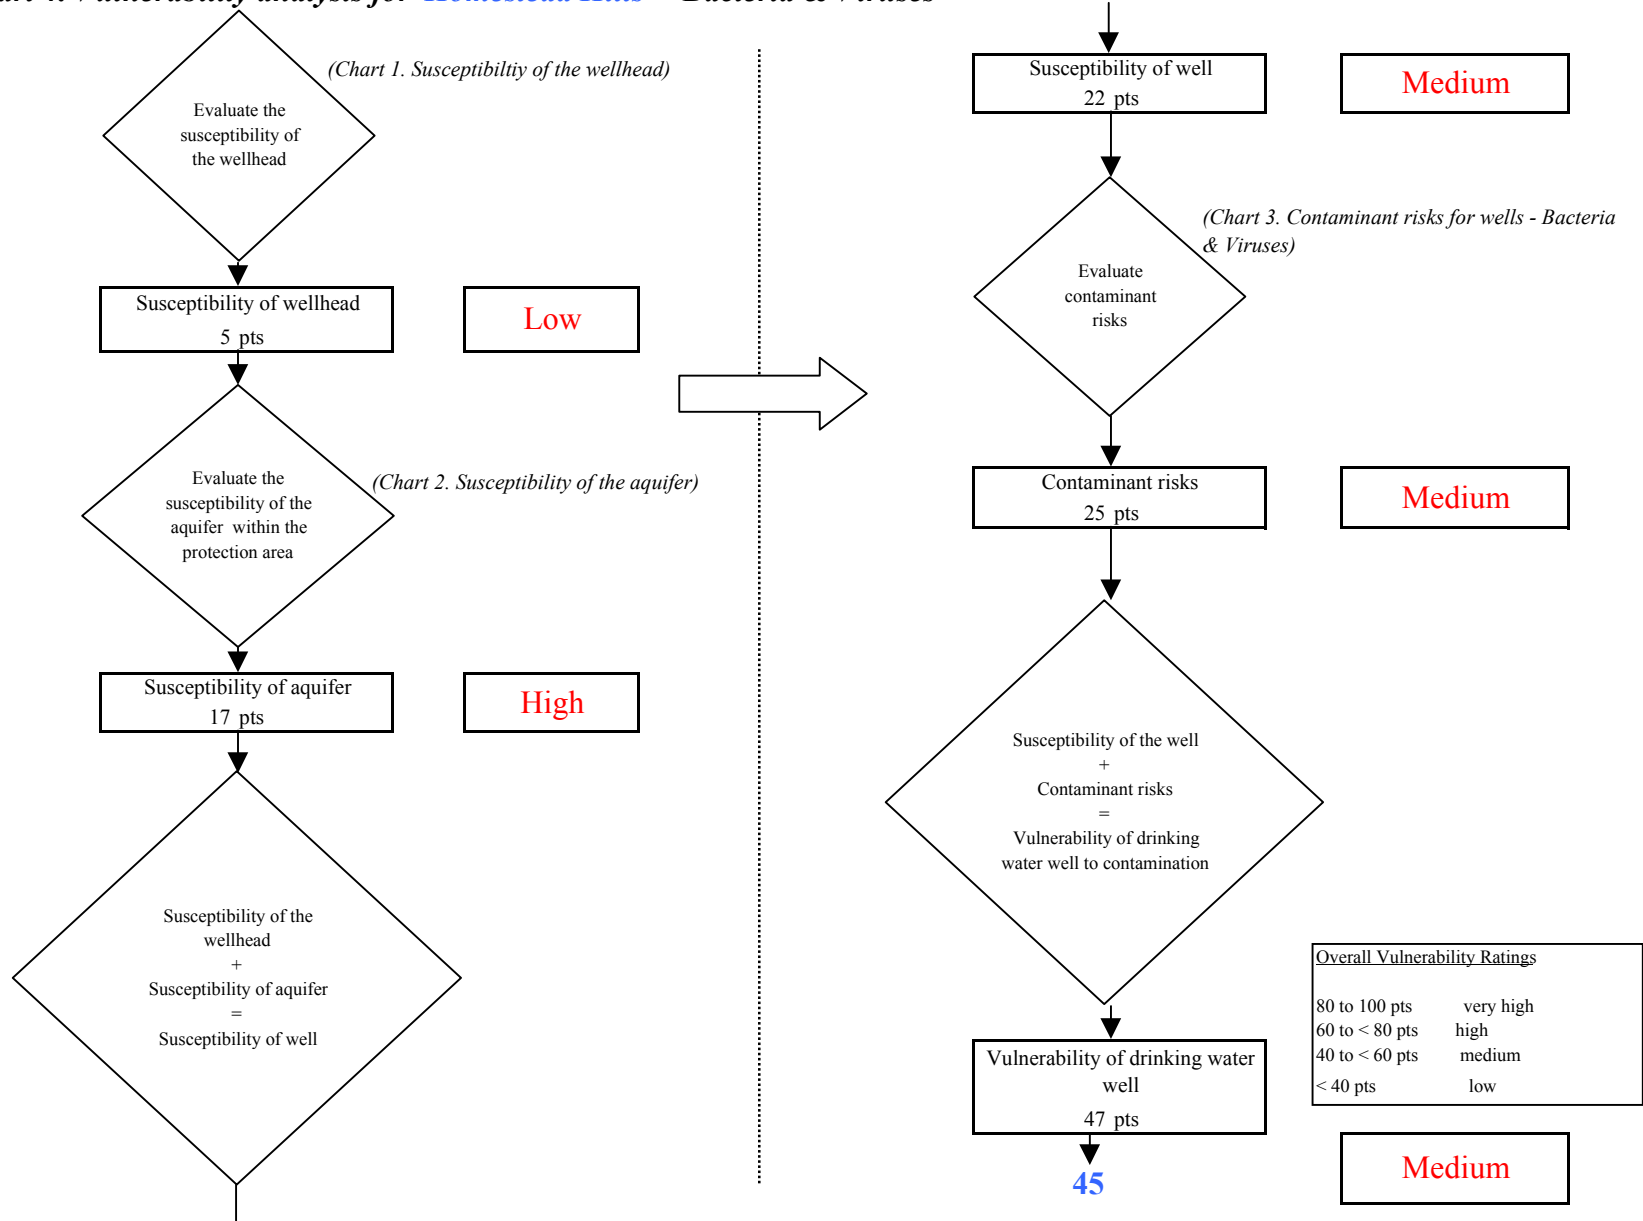


Chart 5. Contaminant risks for *Homestead Hills* - Nitrates and Nitrites

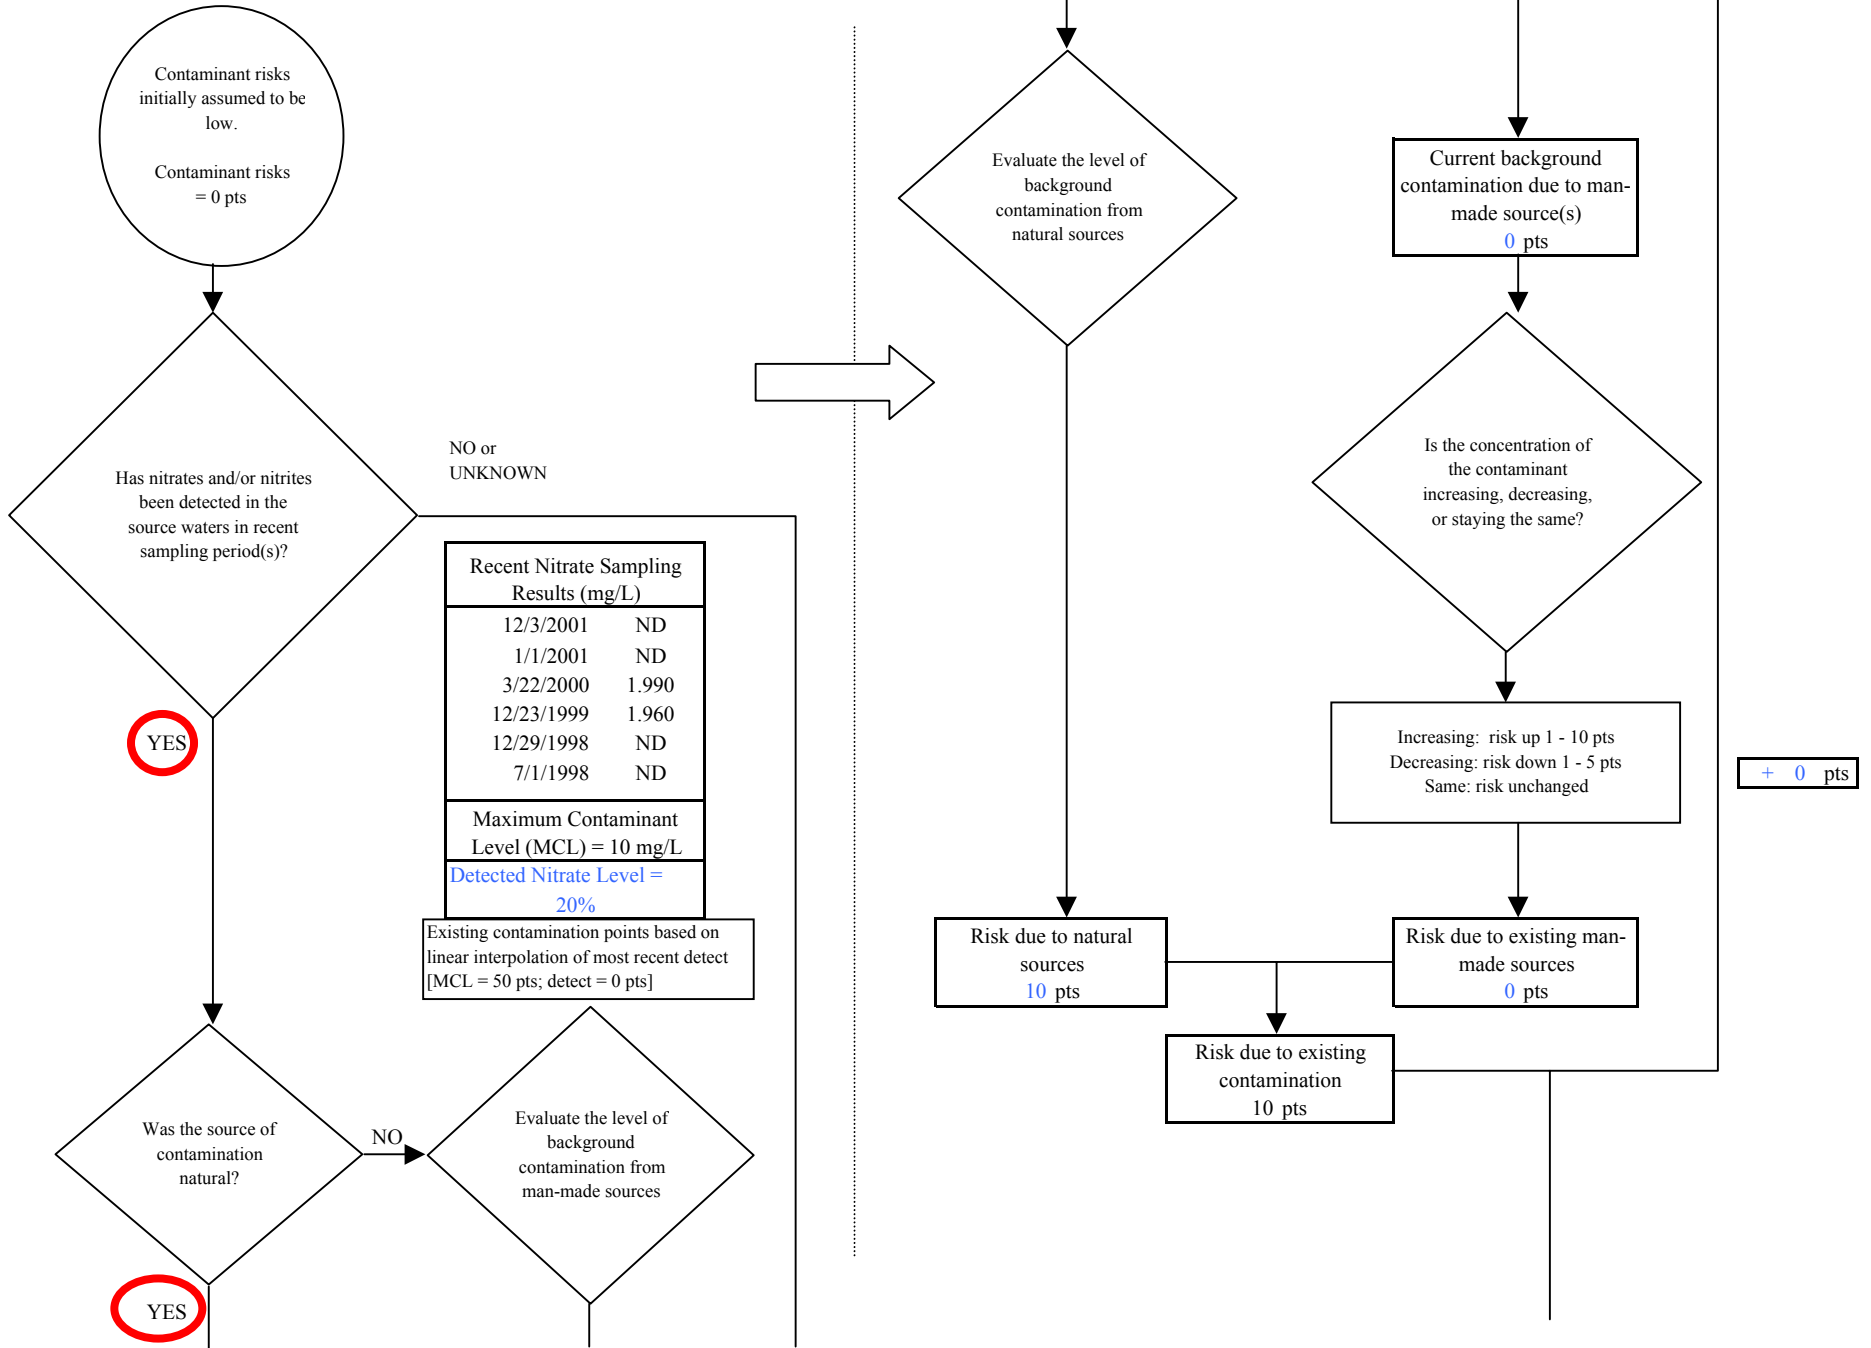

**Chart 5. Contaminant risks for Homestead Hills - Nitrates and Nitrites**


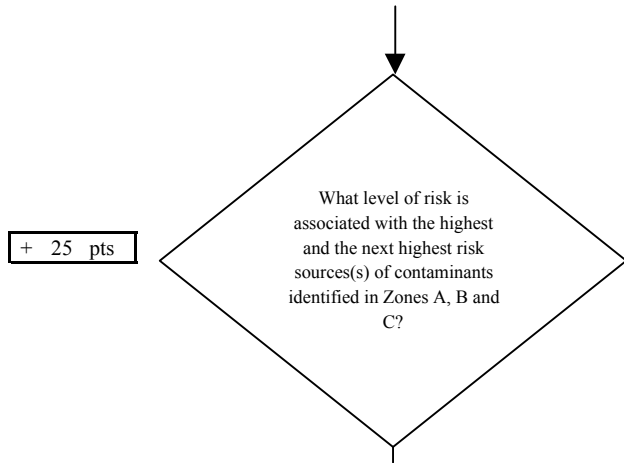


Risk Levels for Contaminant Sources identified in Zones A, B and C			
	Zone A	Zones B&C	Total
Very Highs(s)	0	0	0
High(s)	0	0	0
Medium(s)	0	1	1
Low(s)	12	9	21




	LOW 10 pts	MEDIUM 20 pts	HIGH 30 pts	VERY HIGH 40 pts
<b>LOW</b>	≥ 10 sources + 10 pts	≥ 10 sources + 5 pts	≥ 20 sources + 5 pts	---
<b>MEDIUM</b>	---	≥ 2 sources + 5 pts	≥ 5 sources + 5 pts	≥ 10 sources + 5 pts
<b>HIGH</b>	---	---	≥ 1 source + 10 pts	≥ 2 sources + 10 pts
<b>VERY HIGH</b>	---	---	---	≥ 1 source + 10 pts

Matrix Score      25

Note: Septic systems, sewerlines, and roads are each assigned a risk ranking for each individual contaminant source in the CSI. The VA, however, counts these contaminant sources as a group and assigns a calculated number of either "lows" or "mediums" based on the density.

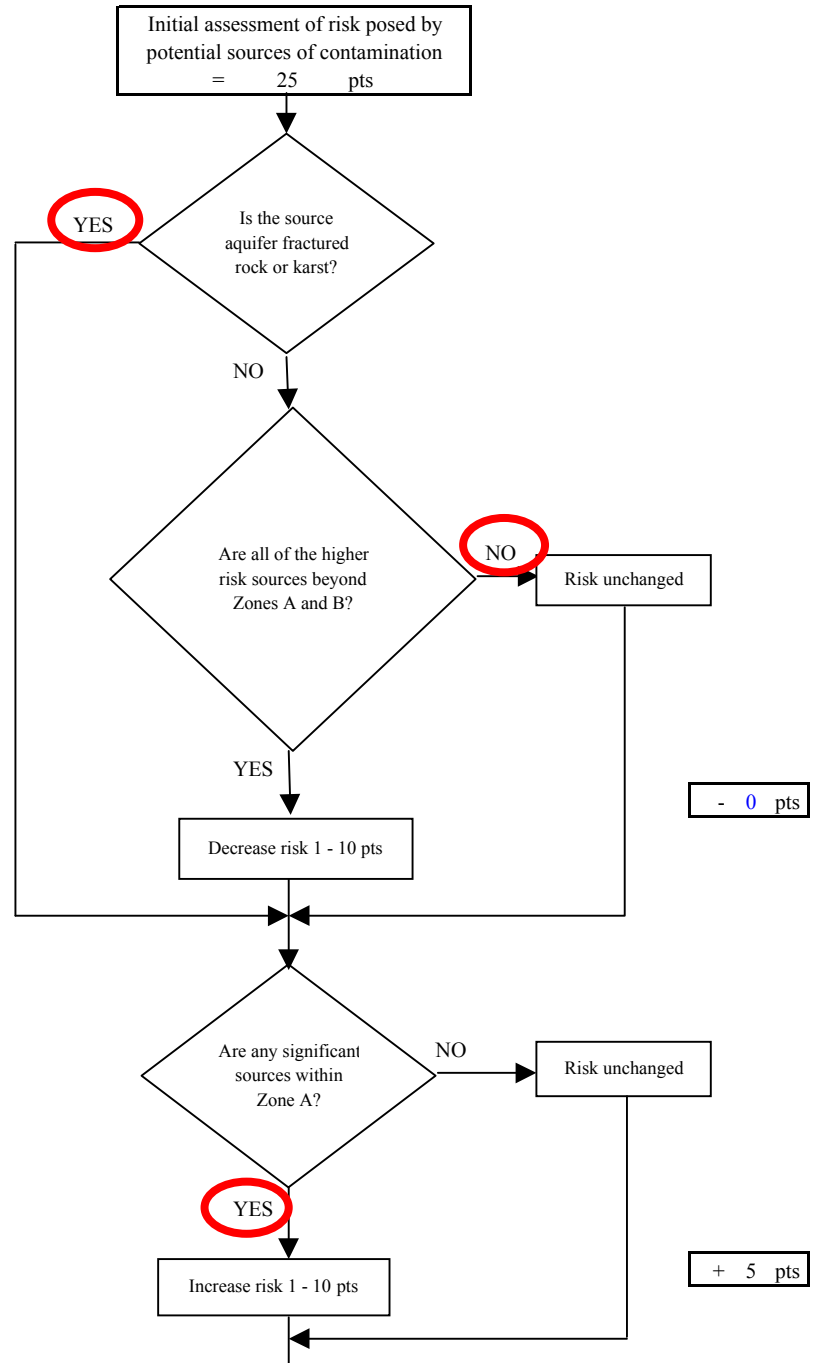

**Chart 5. Contaminant risks for Homestead Hills - Nitrates and Nitrites**

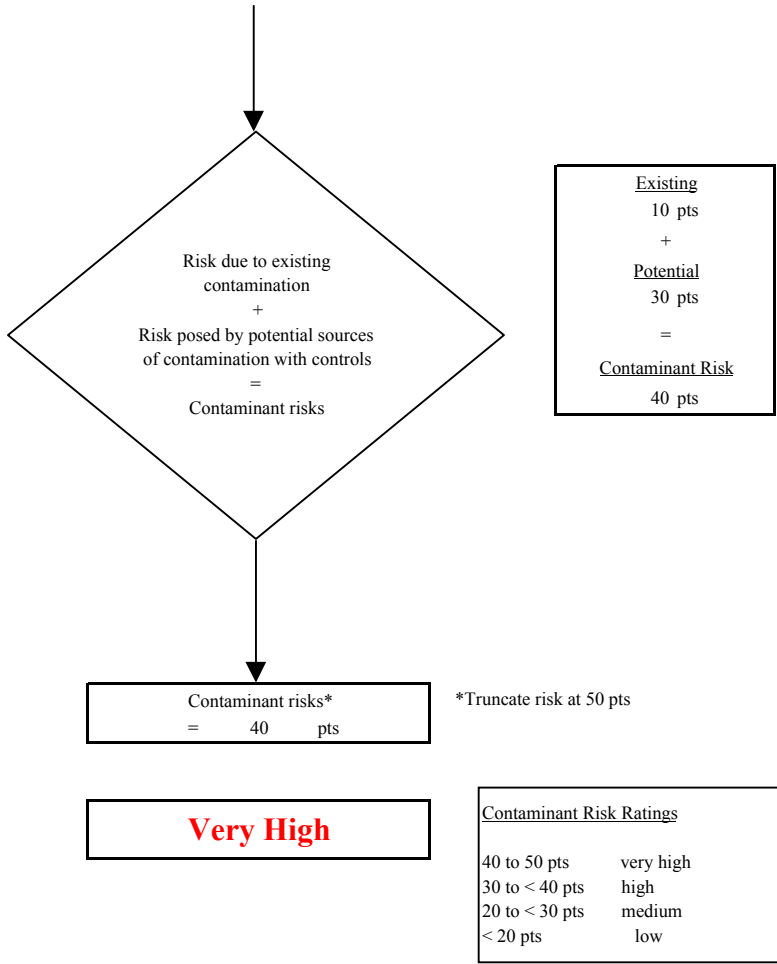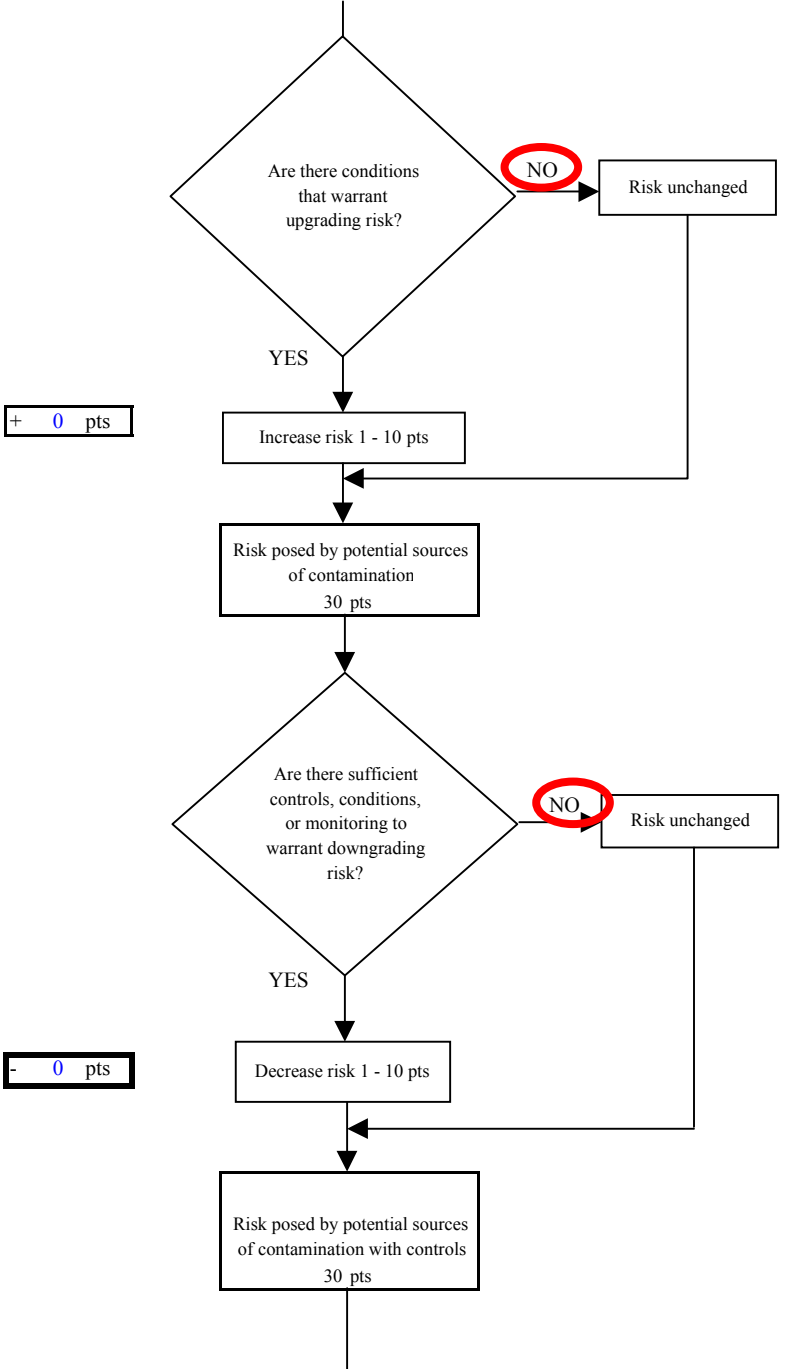

**Chart 6. Vulnerability analysis for Homestead Hills - Nitrates and Nitrites**



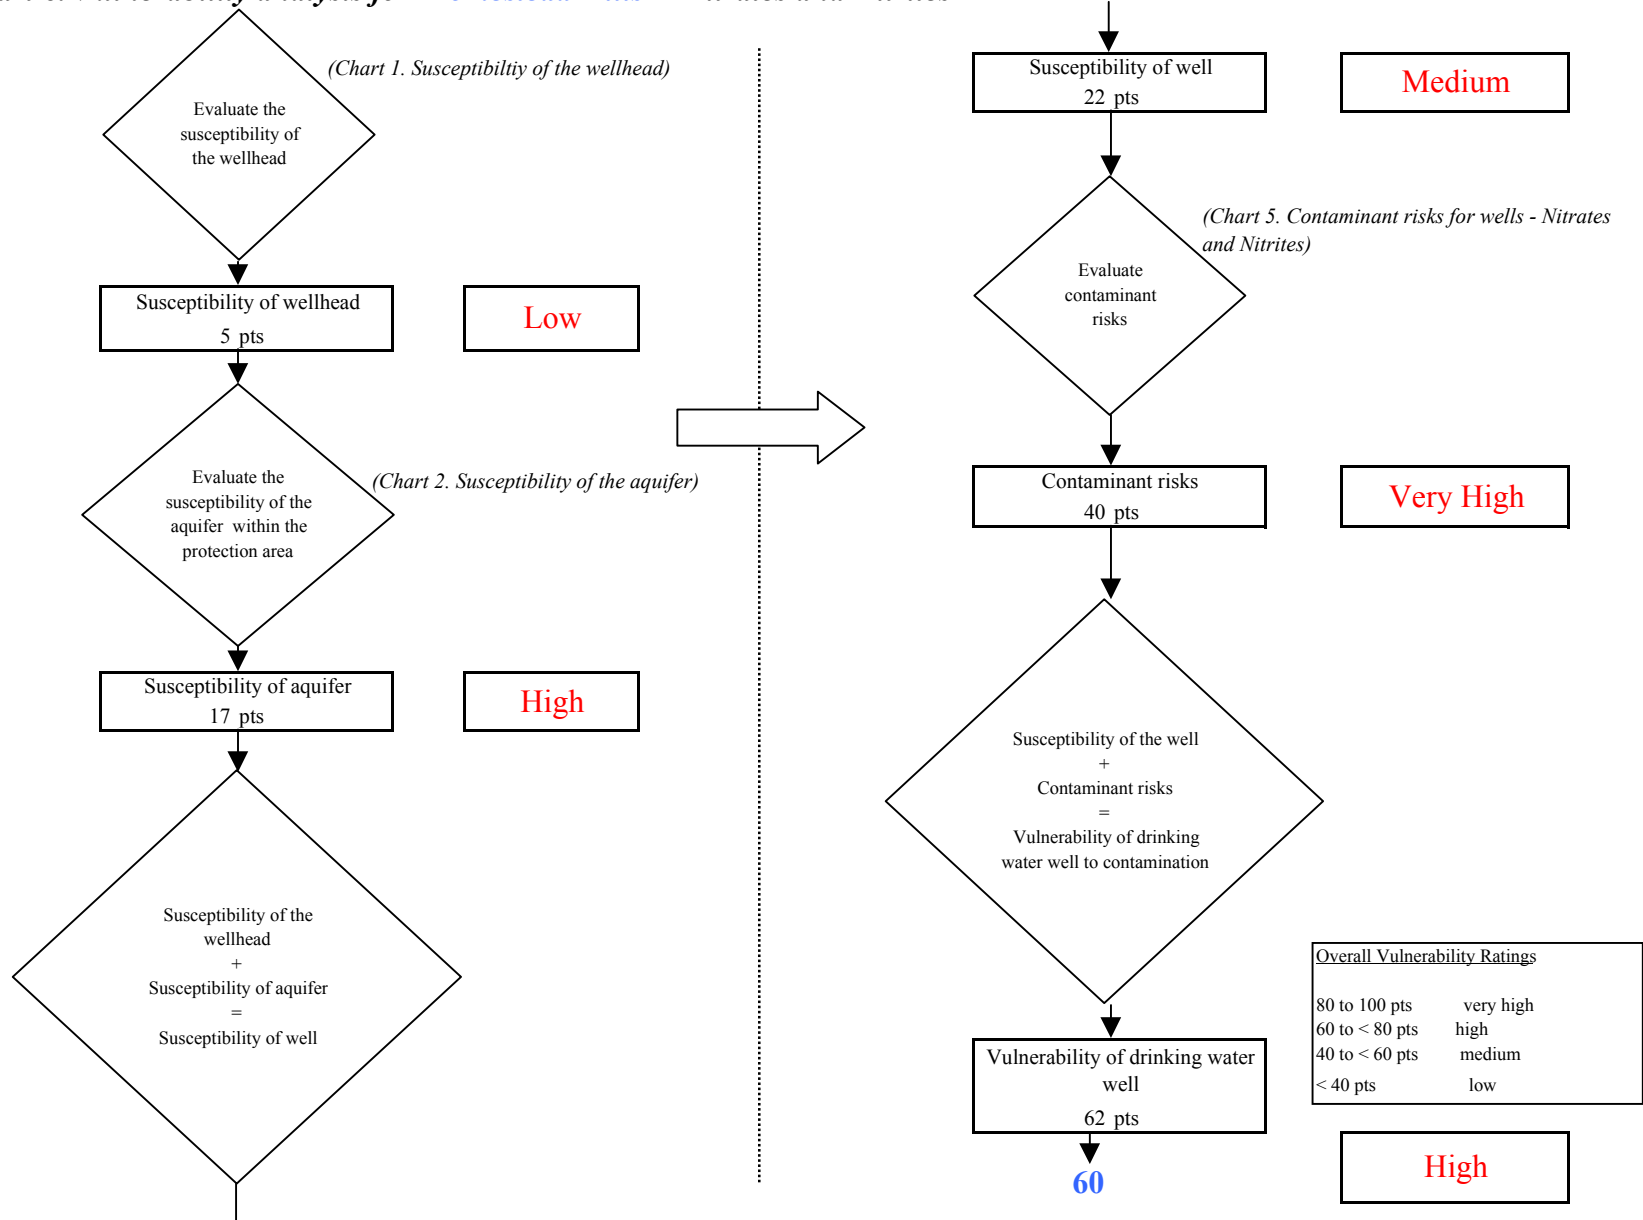


Chart 7. Contaminant risks for *Homestead Hills* - Volatile Organic Chemicals

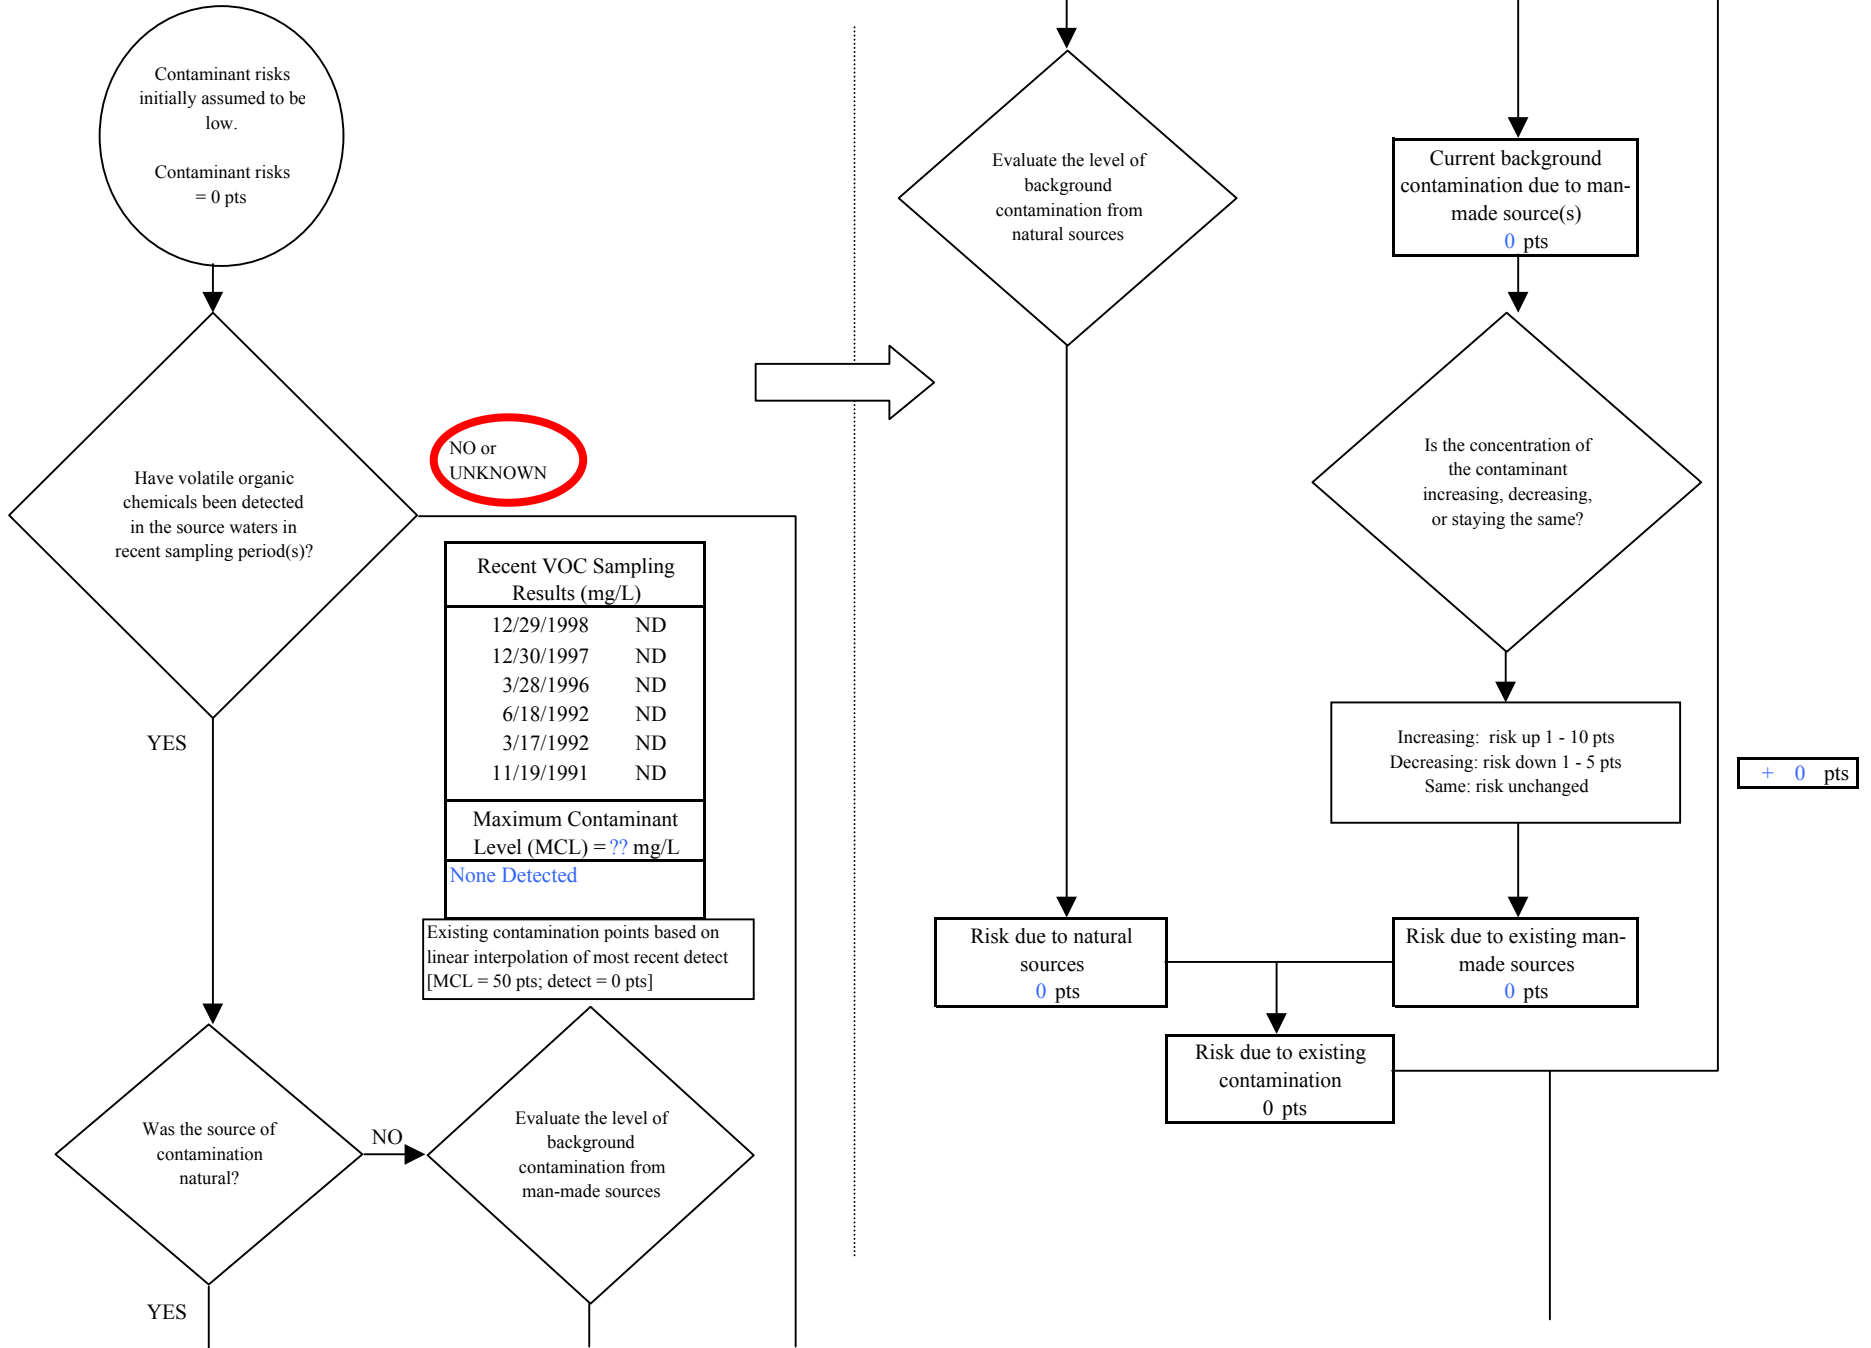

**Chart 7. Contaminant risks for Homestead Hills - Volatile Organic Chemicals**


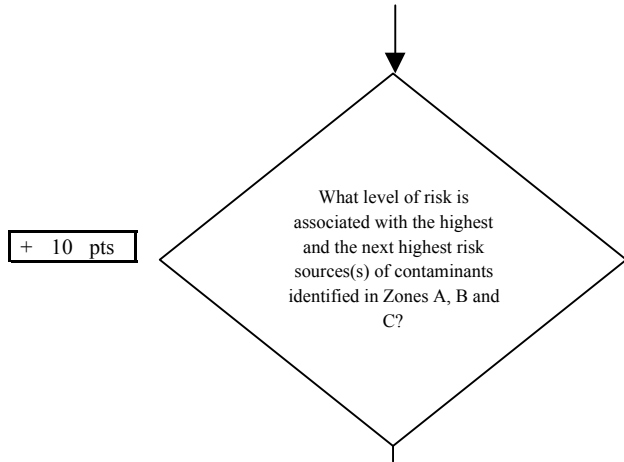


Risk Levels for Contaminant Sources identified in Zones A, B and C			
	Zone A	Zones B&C	Total
Very Highs(s)	0	0	0
High(s)	0	0	0
Medium(s)	0	0	0
Low(s)	3	5	8

	<b>LOW</b> 10 pts	<b>MEDIUM</b> 20 pts	<b>HIGH</b> 30 pts	<b>VERY HIGH</b> 40 pts
<b>LOW</b>	≥ 10 sources + 10 pts	≥ 10 sources + 5 pts	≥ 20 sources + 5 pts	----
<b>MEDIUM</b>	----	≥ 2 sources + 5 pts	≥ 5 sources + 5 pts	≥ 10 sources + 5 pts
<b>HIGH</b>	----	----	≥ 1 source + 10 pts	≥ 2 sources + 10 pts
<b>VERY HIGH</b>	----	----	----	≥ 1 source + 10 pts




Matrix Score      10

Note: Septic systems, sewerlines, and roads are each assigned a risk ranking for each individual contaminant source in the CSI. The VA, however, counts these contaminant sources as a group and assigns a calculated number of either "lows" or "mediums" based on the density.

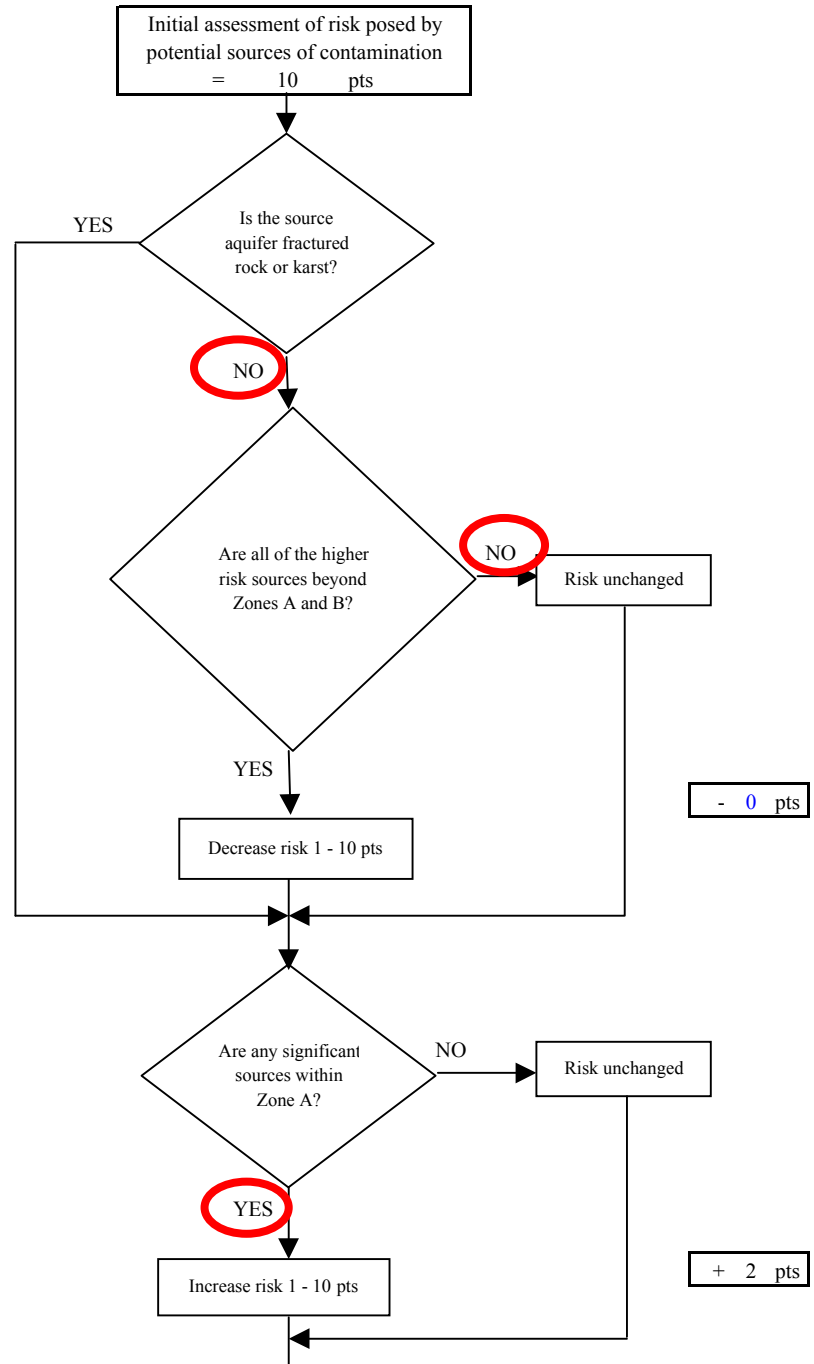



**Chart 7. Contaminant risks for Homestead Hills - Volatile Organic Chemicals**

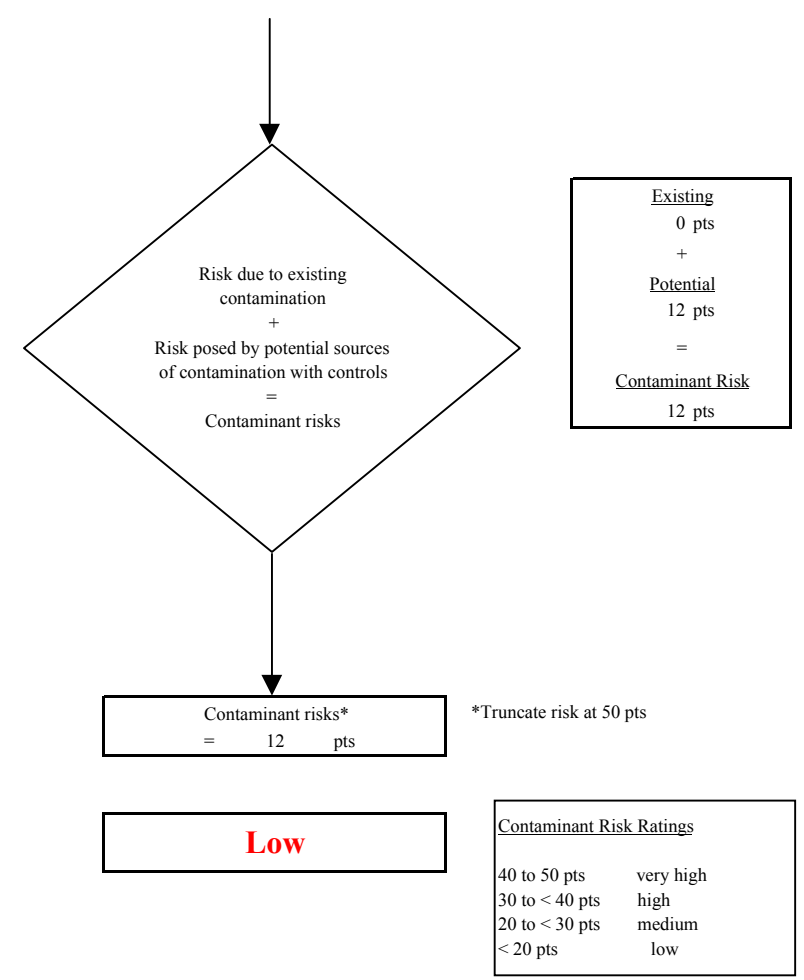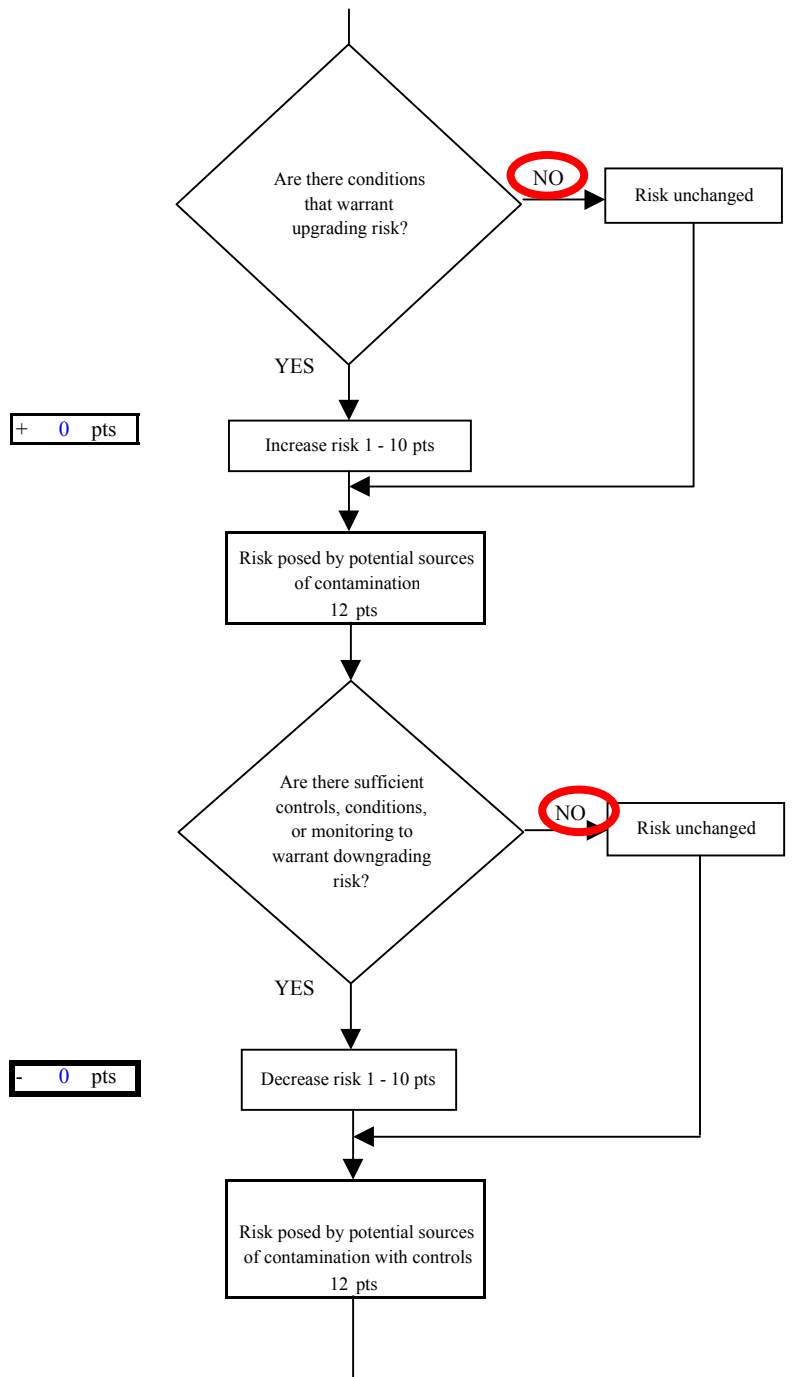

**Chart 8. Vulnerability analysis for Homestead Hills - Volatile Organic Chemicals**



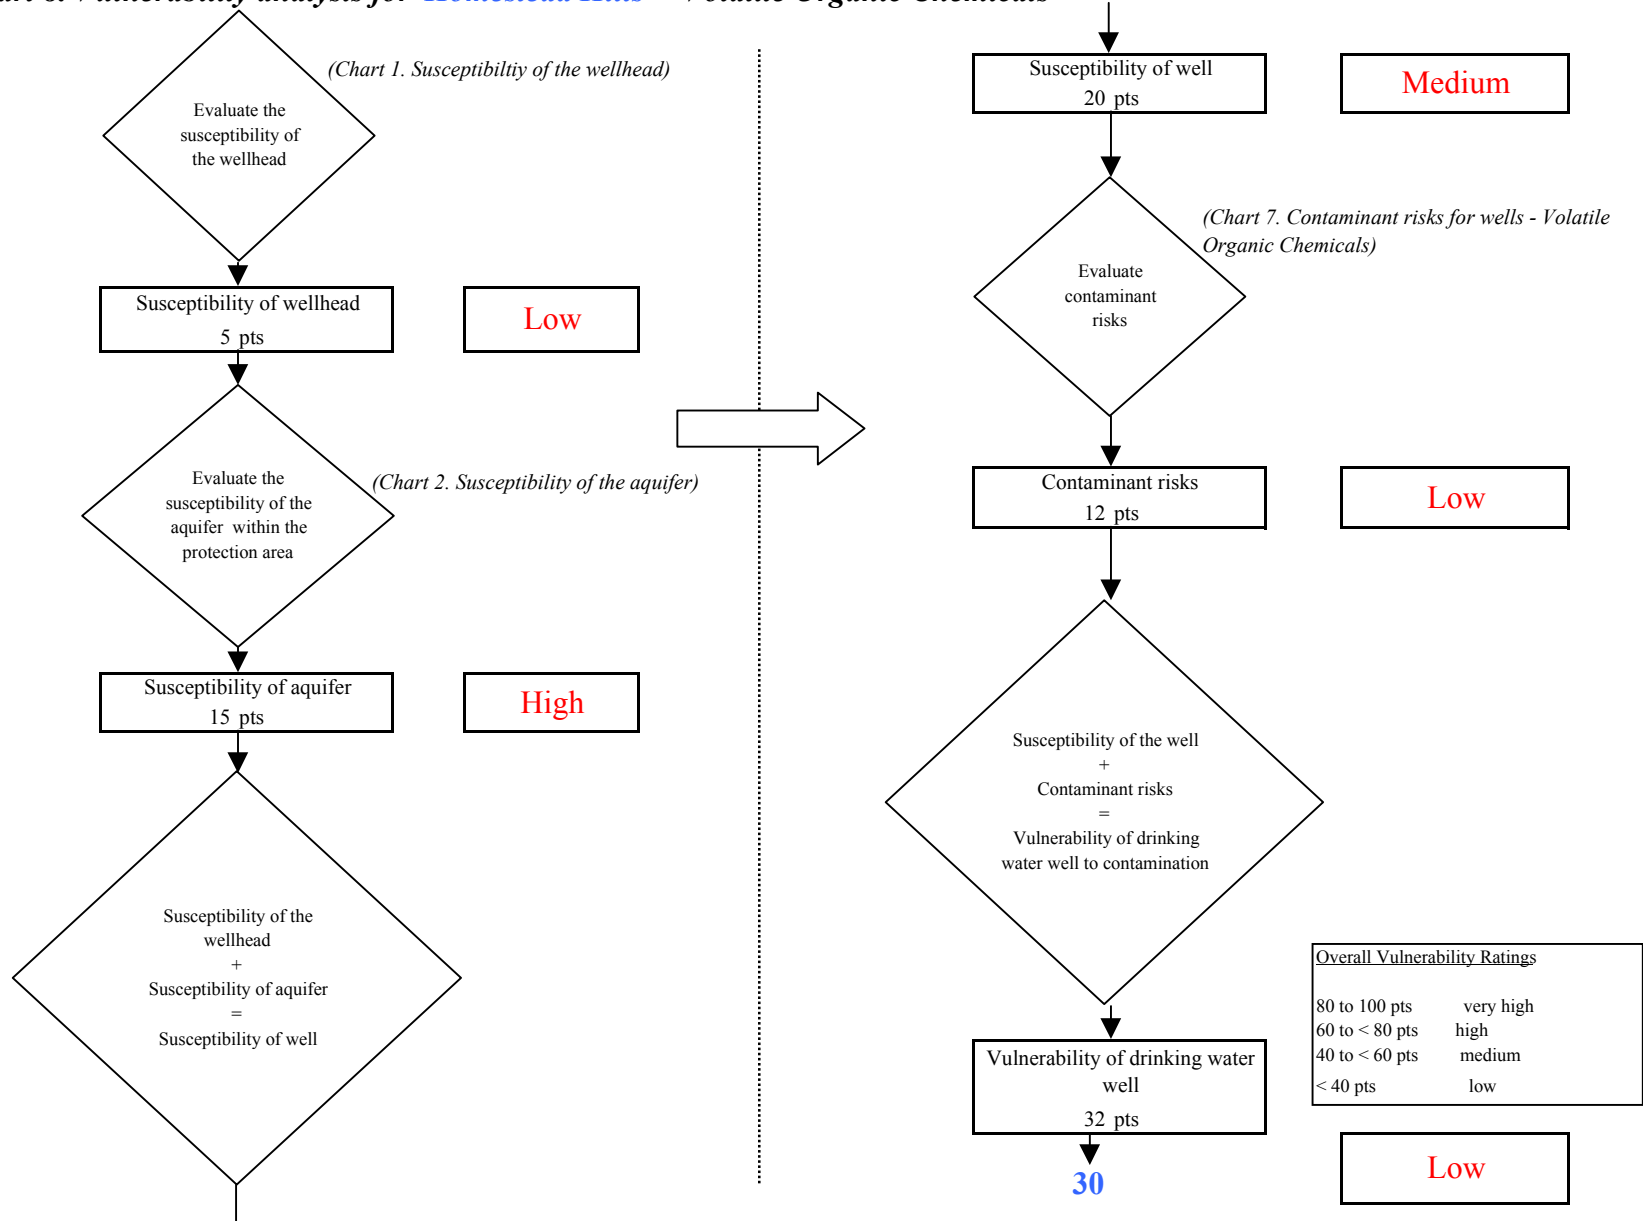


Chart 9. Contaminant risks for *Homestead Hills* - Heavy Metals, Cyanide and Other Inorganic Chemicals

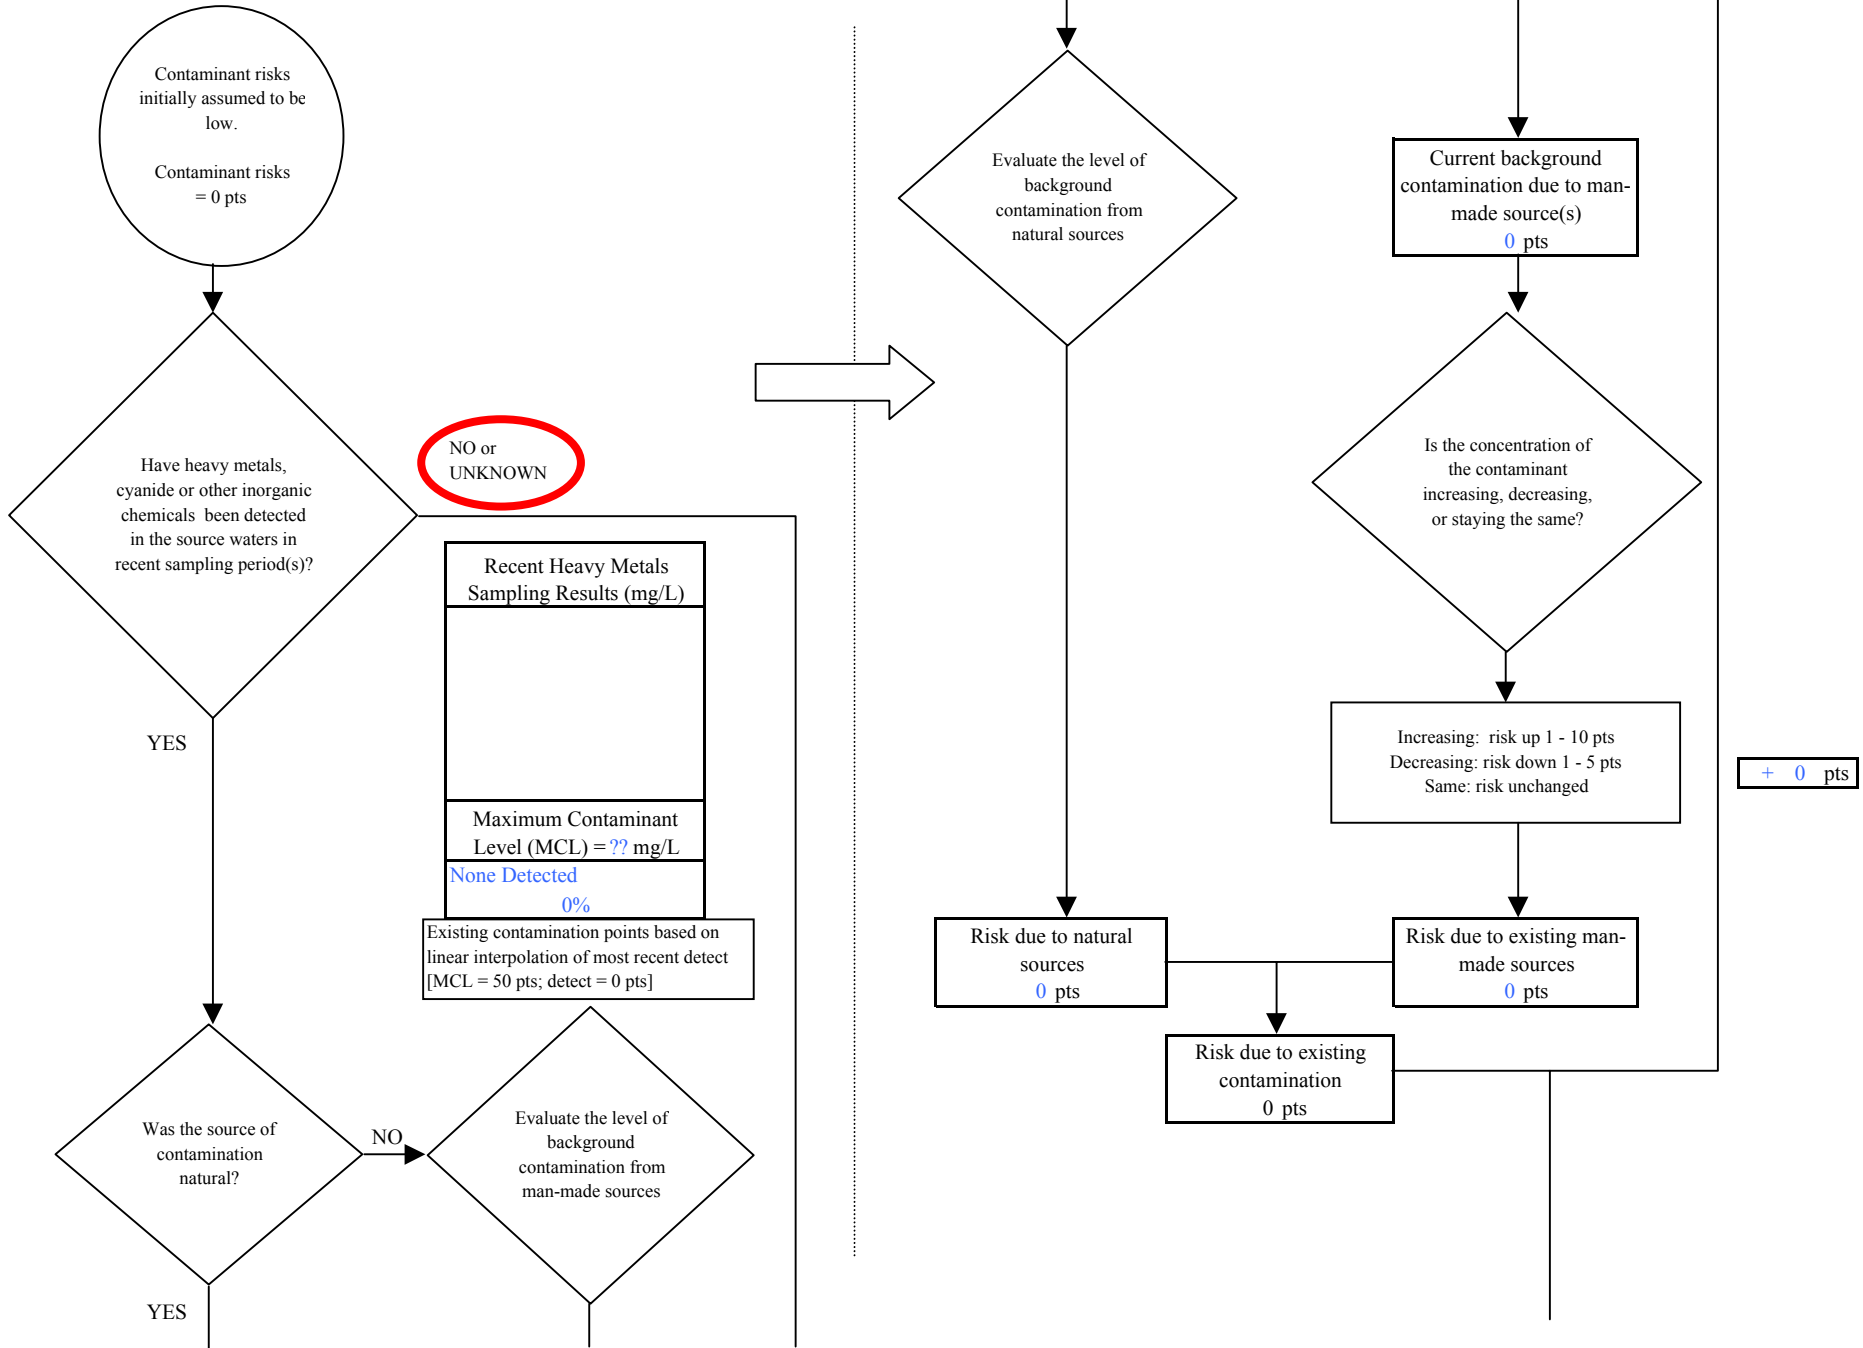

**Chart 9. Contaminant risks for Homestead Hills - Heavy Metals, Cyanide and Other Inorganic Chemicals**

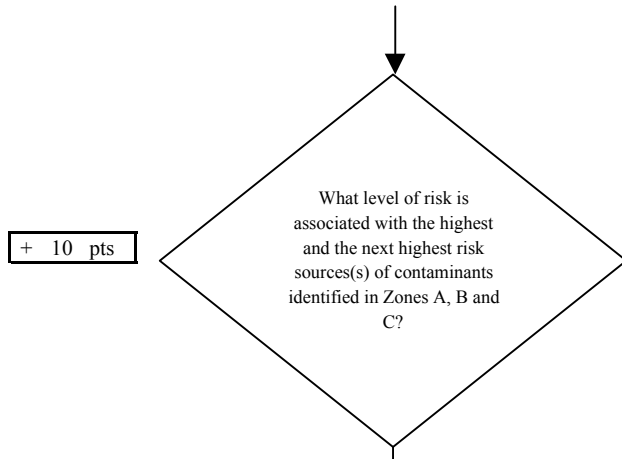



+ 10 pts

Risk Levels for Contaminant Sources identified in Zones A, B and C			
	Zone A	Zones B&C	Total
Very Highs(s)	0	0	0
High(s)	0	0	0
Medium(s)	0	0	0
Low(s)	3	6	9


	<b>LOW</b> 10 pts	<b>MEDIUM</b> 20 pts	<b>HIGH</b> 30 pts	<b>VERY HIGH</b> 40 pts
<b>LOW</b>	≥ 10 sources + 10 pts	≥ 10 sources + 5 pts	≥ 20 sources + 5 pts	----
<b>MEDIUM</b>	----	≥ 2 sources + 5 pts	≥ 5 sources + 5 pts	≥ 10 sources + 5 pts
<b>HIGH</b>	----	----	≥ 1 source + 10 pts	≥ 2 sources + 10 pts
<b>VERY HIGH</b>	----	----	----	≥ 1 source + 10 pts

Matrix Score 10

Note: Septic systems, sewerlines, and roads are each assigned a risk ranking for each individual contaminant source in the CSI. The VA, however, counts these contaminant sources as a group and assigns a calculated number of either "lows" or "mediums" based on the density.

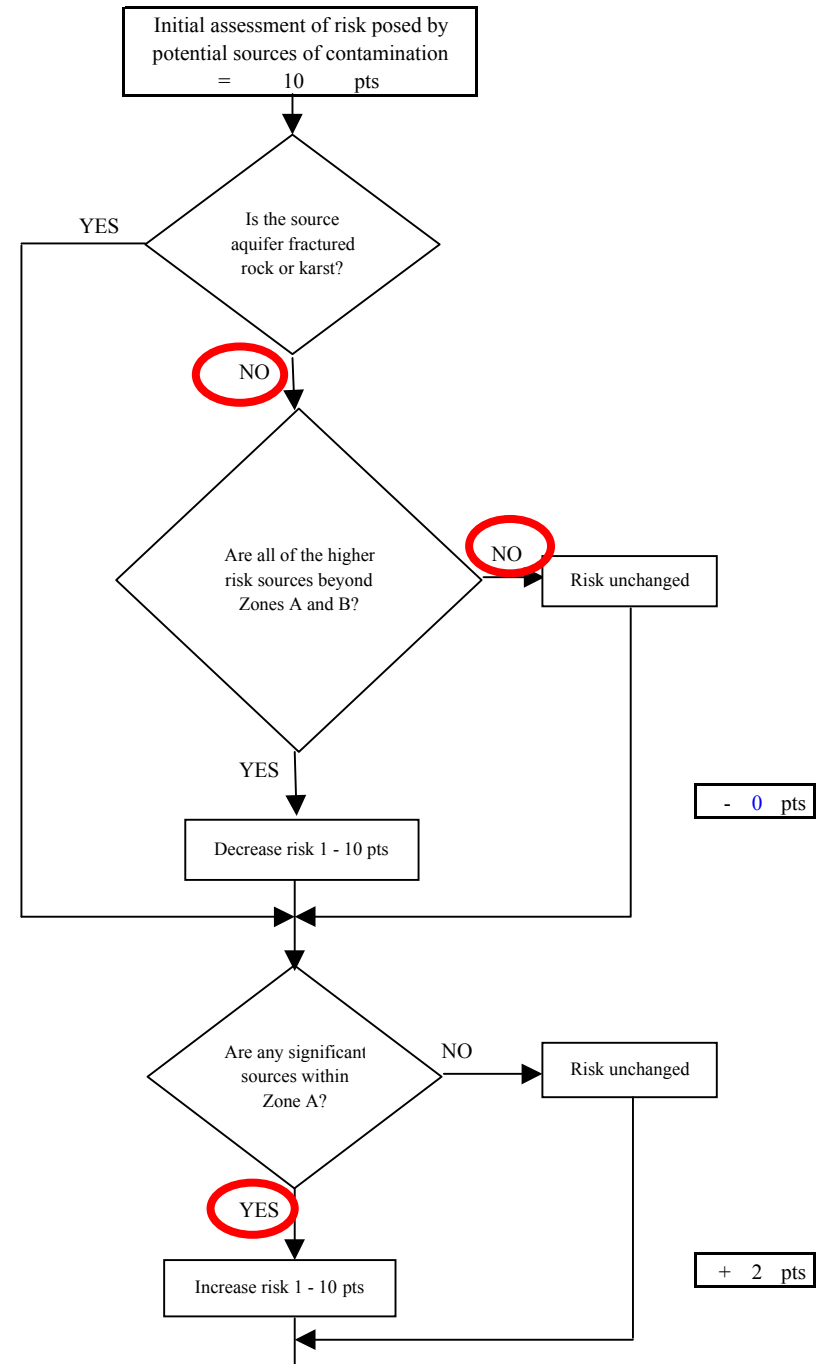

**Chart 9. Contaminant risks for Homestead Hills - Heavy Metals, Cyanide and Other Inorganic Chemicals**

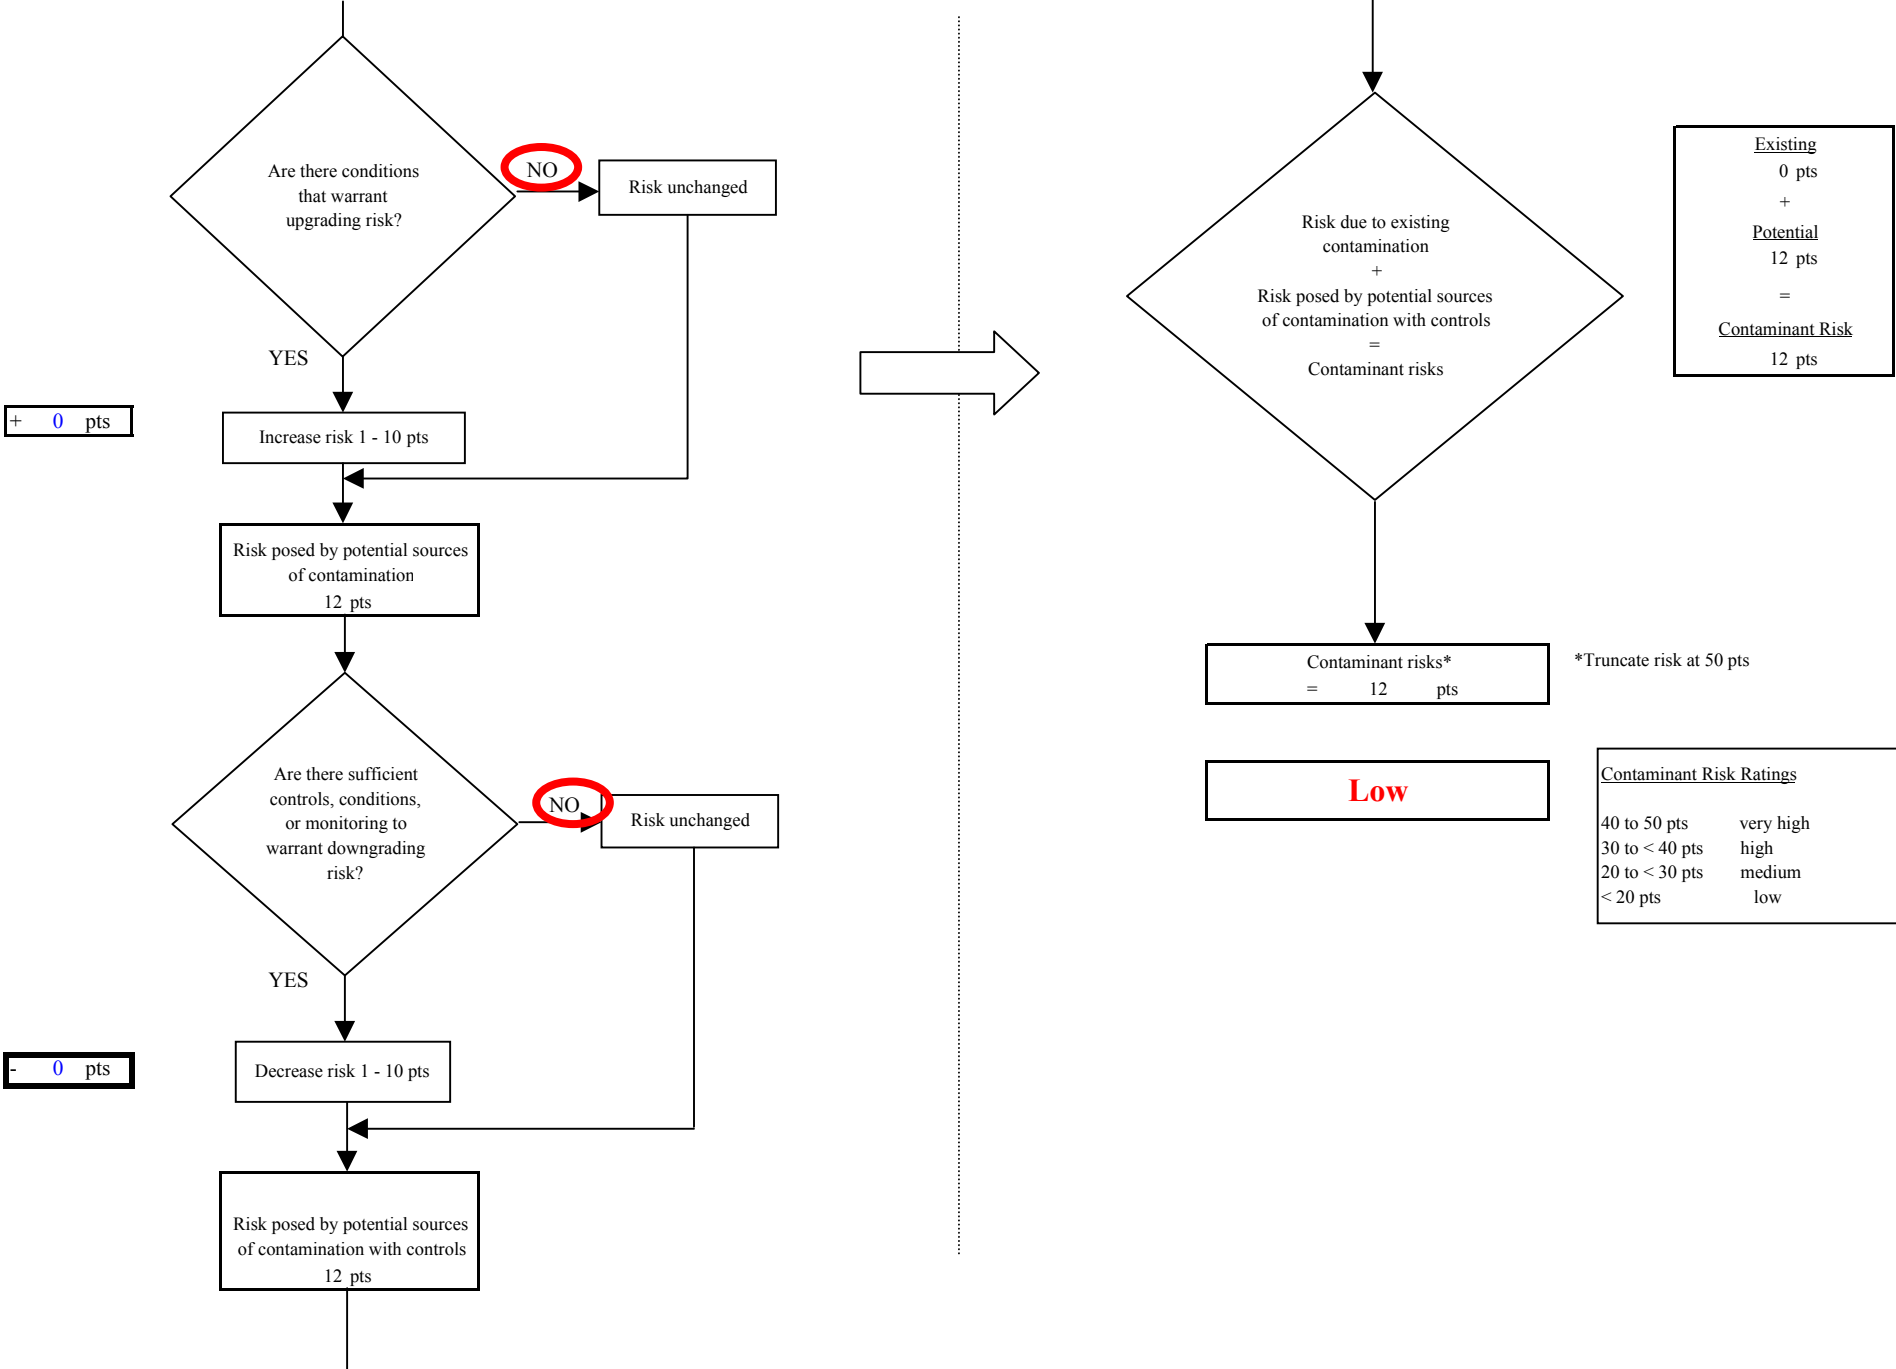

**Chart 10. Vulnerability analysis for *Homestead Hills* - Heavy Metals, Cyanide and Other Inorganic Chemicals**

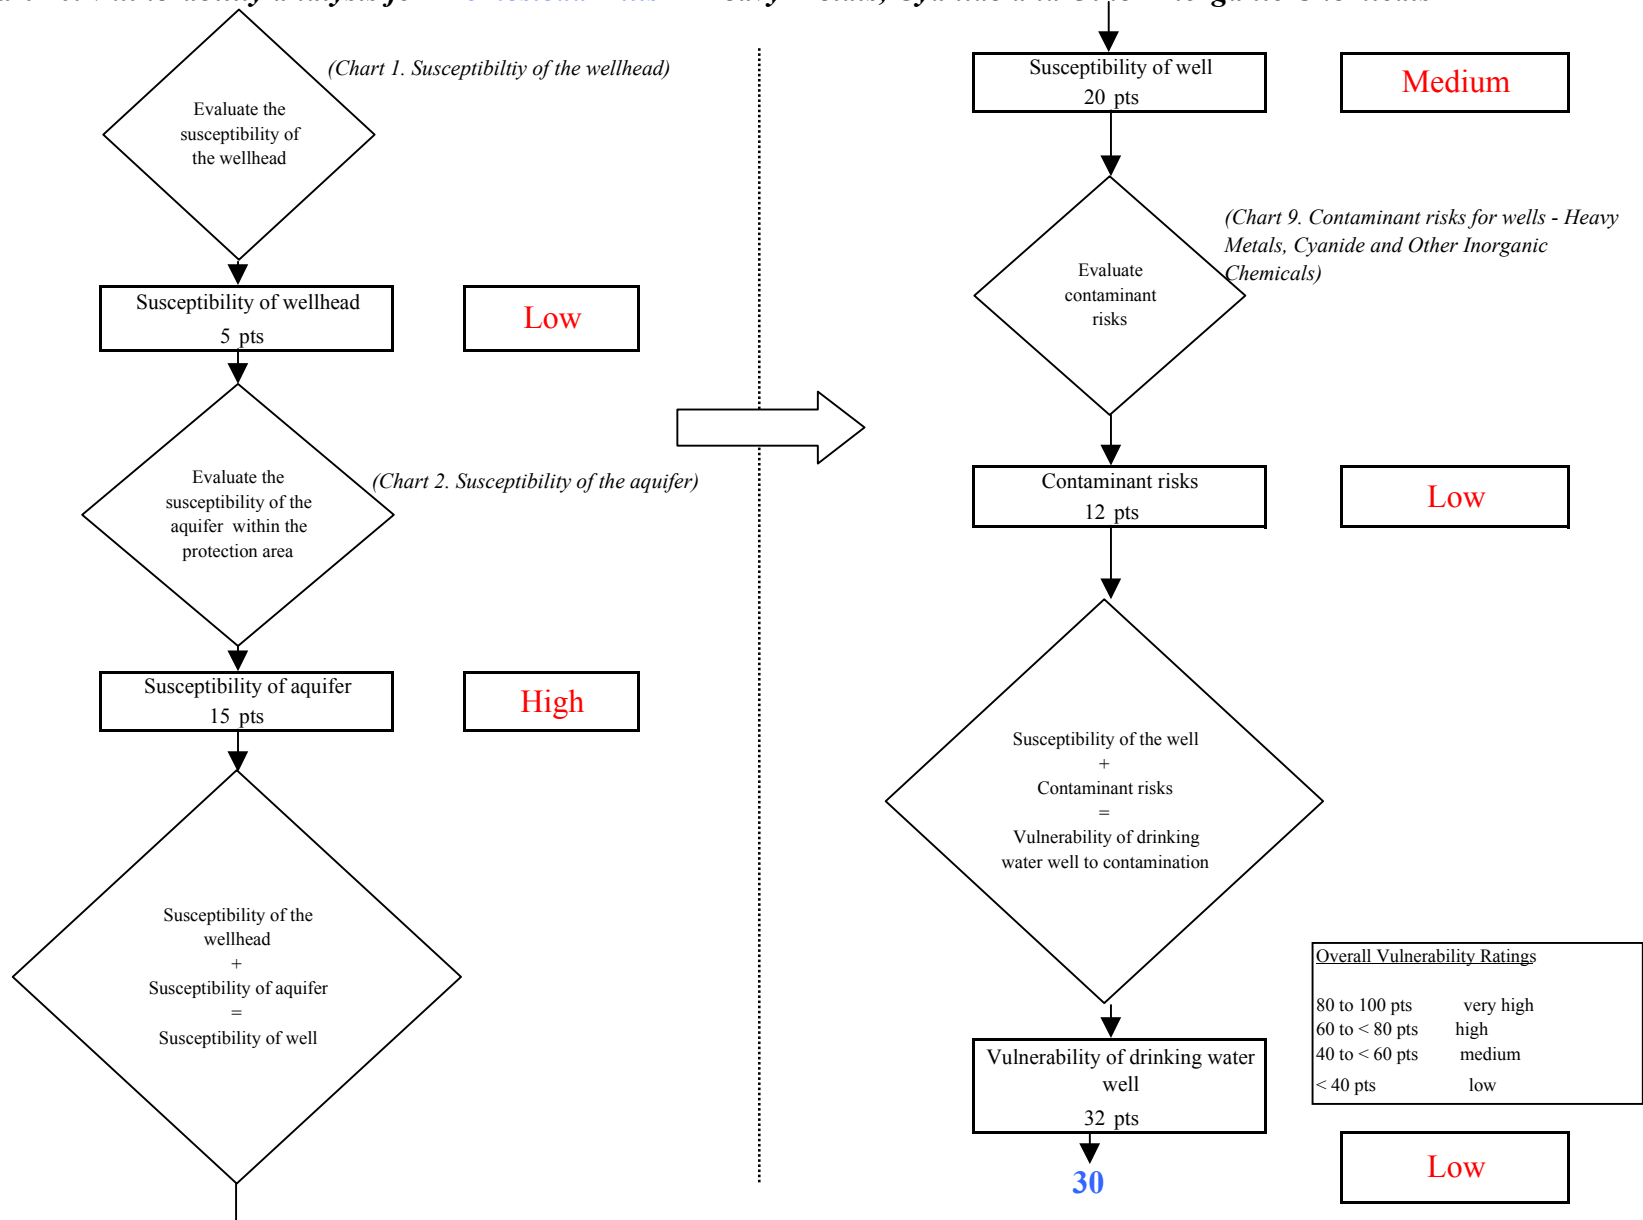


Chart 11. Contaminant risks for *Homestead Hills* - Synthetic Organic Chemicals


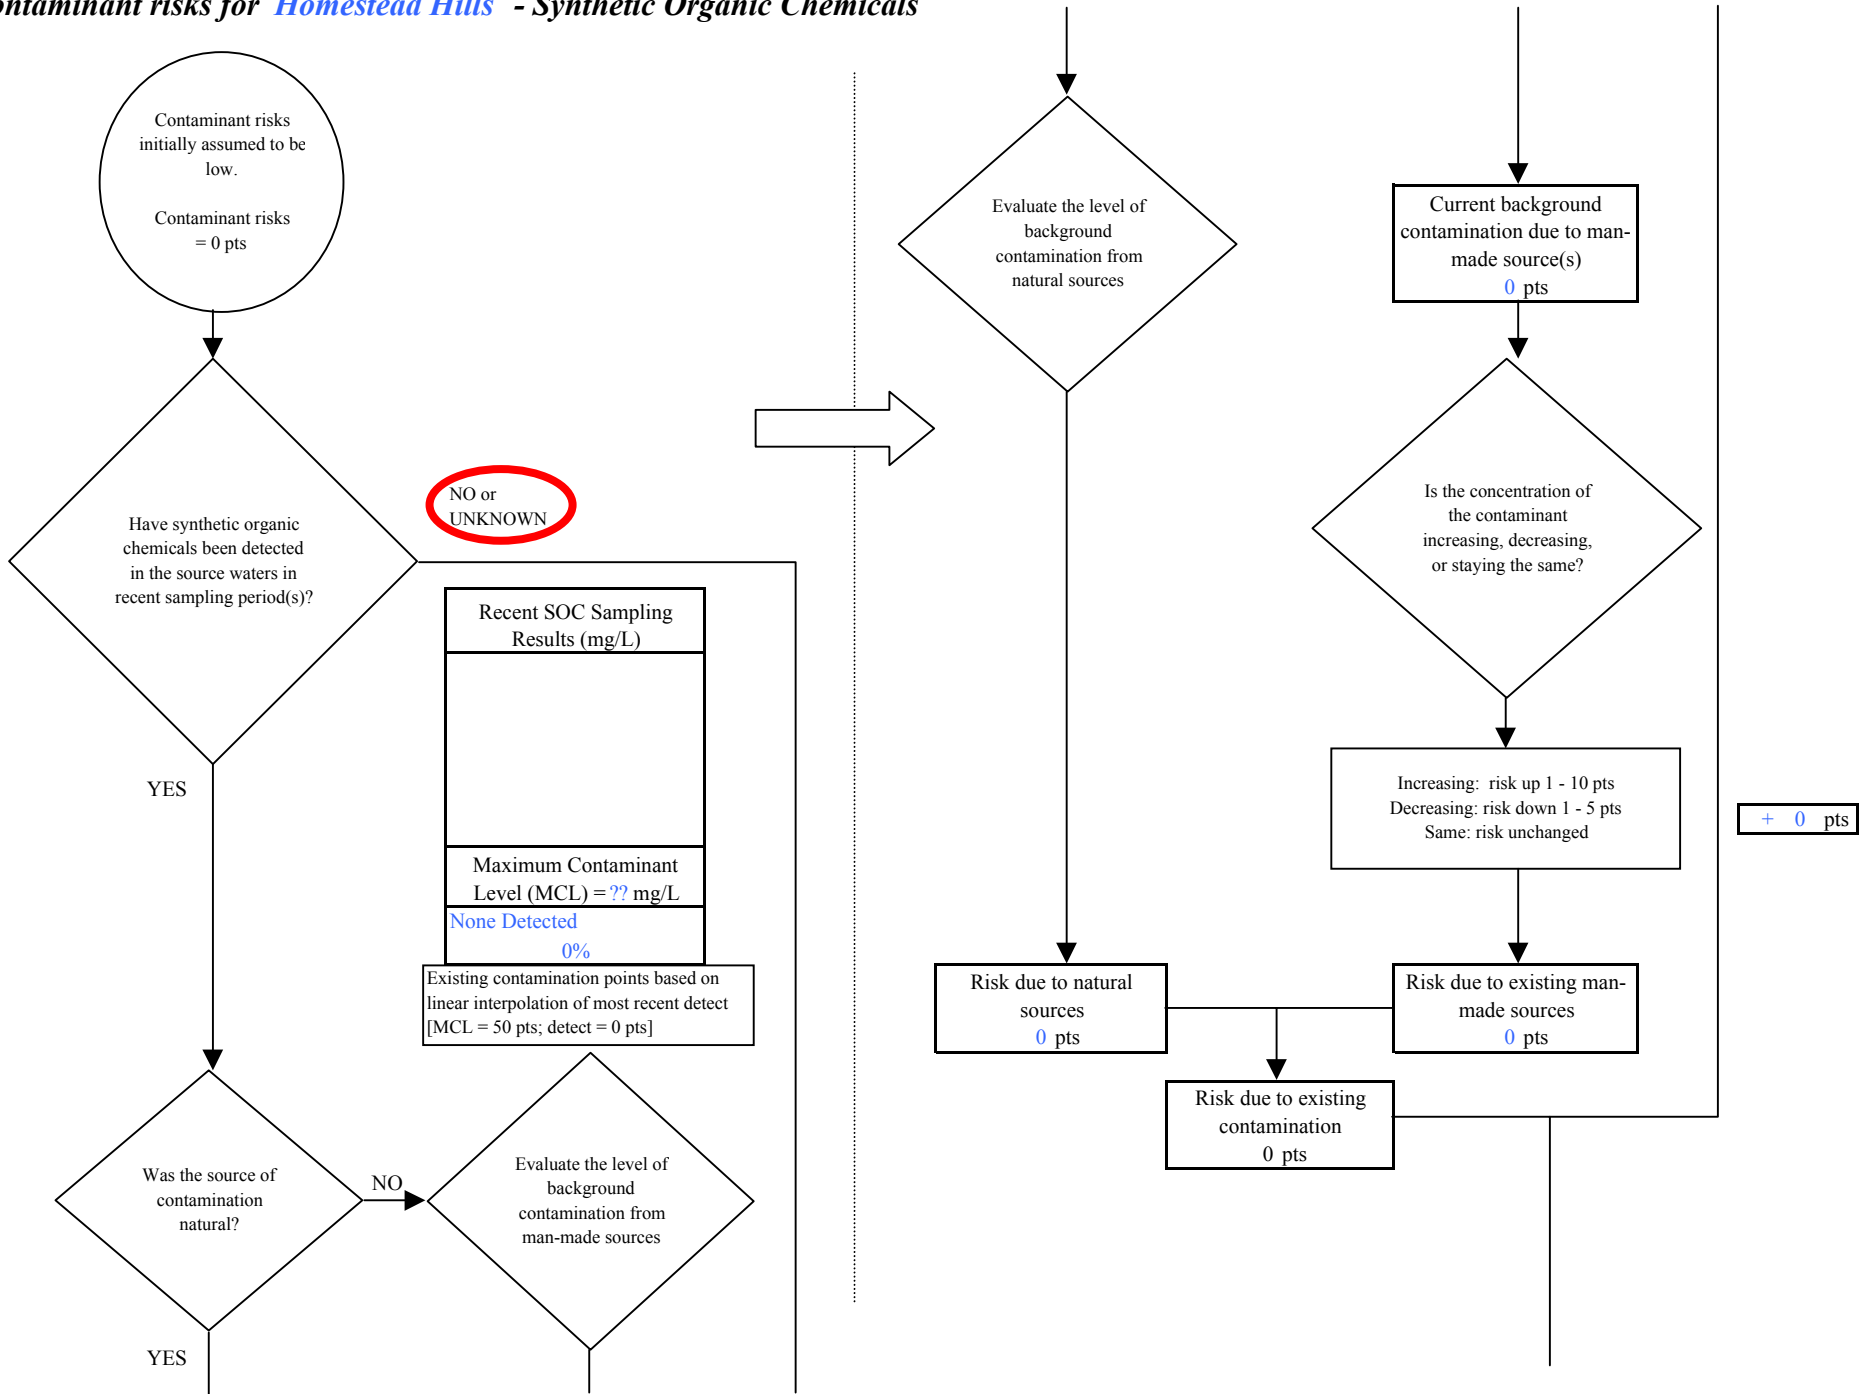


Chart 11. Contaminant risks for Homestead Hills - Synthetic Organic Chemicals


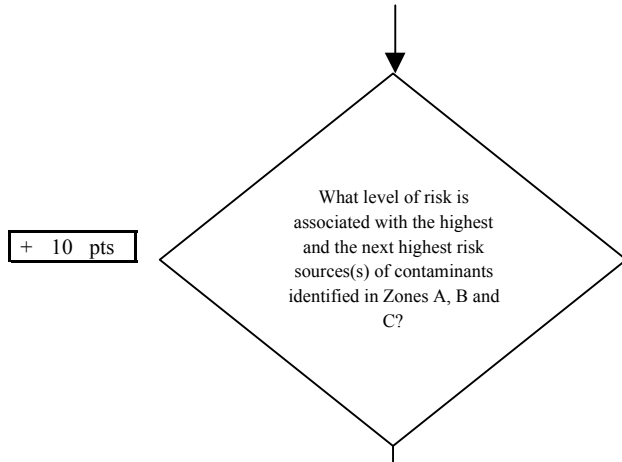


Risk Levels for Contaminant Sources identified in Zones A, B and C			
	Zone A	Zones B&C	Total
Very Highs(s)	0	0	0
High(s)	0	0	0
Medium(s)	0	0	0
Low(s)	2	5	7

	<b>LOW</b> 10 pts	<b>MEDIUM</b> 20 pts	<b>HIGH</b> 30 pts	<b>VERY HIGH</b> 40 pts
<b>LOW</b>	≥ 10 sources + 10 pts	≥ 10 sources + 5 pts	≥ 20 sources + 5 pts	----
<b>MEDIUM</b>	----	≥ 2 sources + 5 pts	≥ 5 sources + 5 pts	≥ 10 sources + 5 pts
<b>HIGH</b>	----	----	≥ 1 source + 10 pts	≥ 2 sources + 10 pts
<b>VERY HIGH</b>	----	----	----	≥ 1 source + 10 pts


Matrix Score      10

Note: Septic systems, sewerlines, and roads are each assigned a risk ranking for each individual contaminant source in the CSI. The VA, however, counts these contaminant sources as a group and assigns a calculated number of either "lows" or "mediums" based on the density.

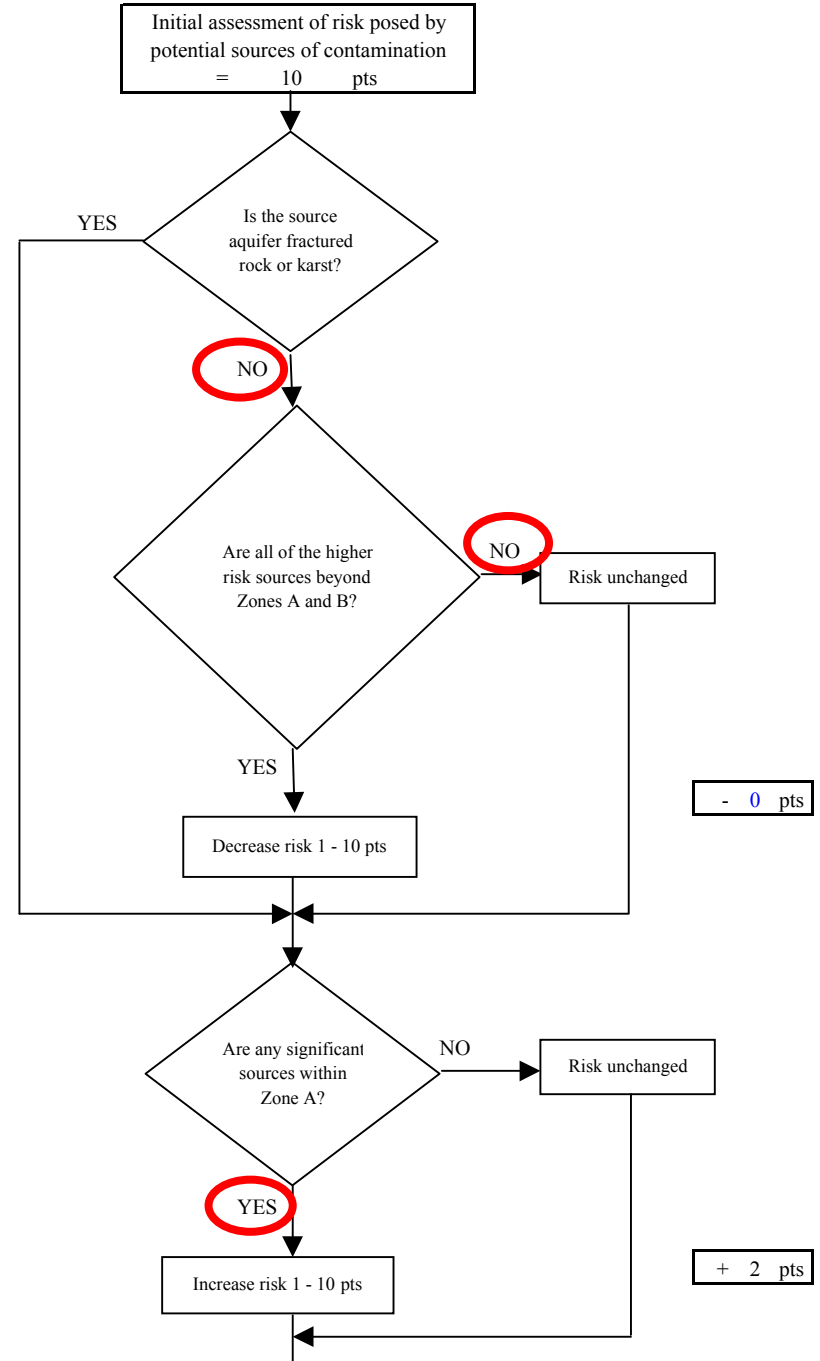



**Chart 11. Contaminant risks for Homestead Hills - Synthetic Organic Chemicals**

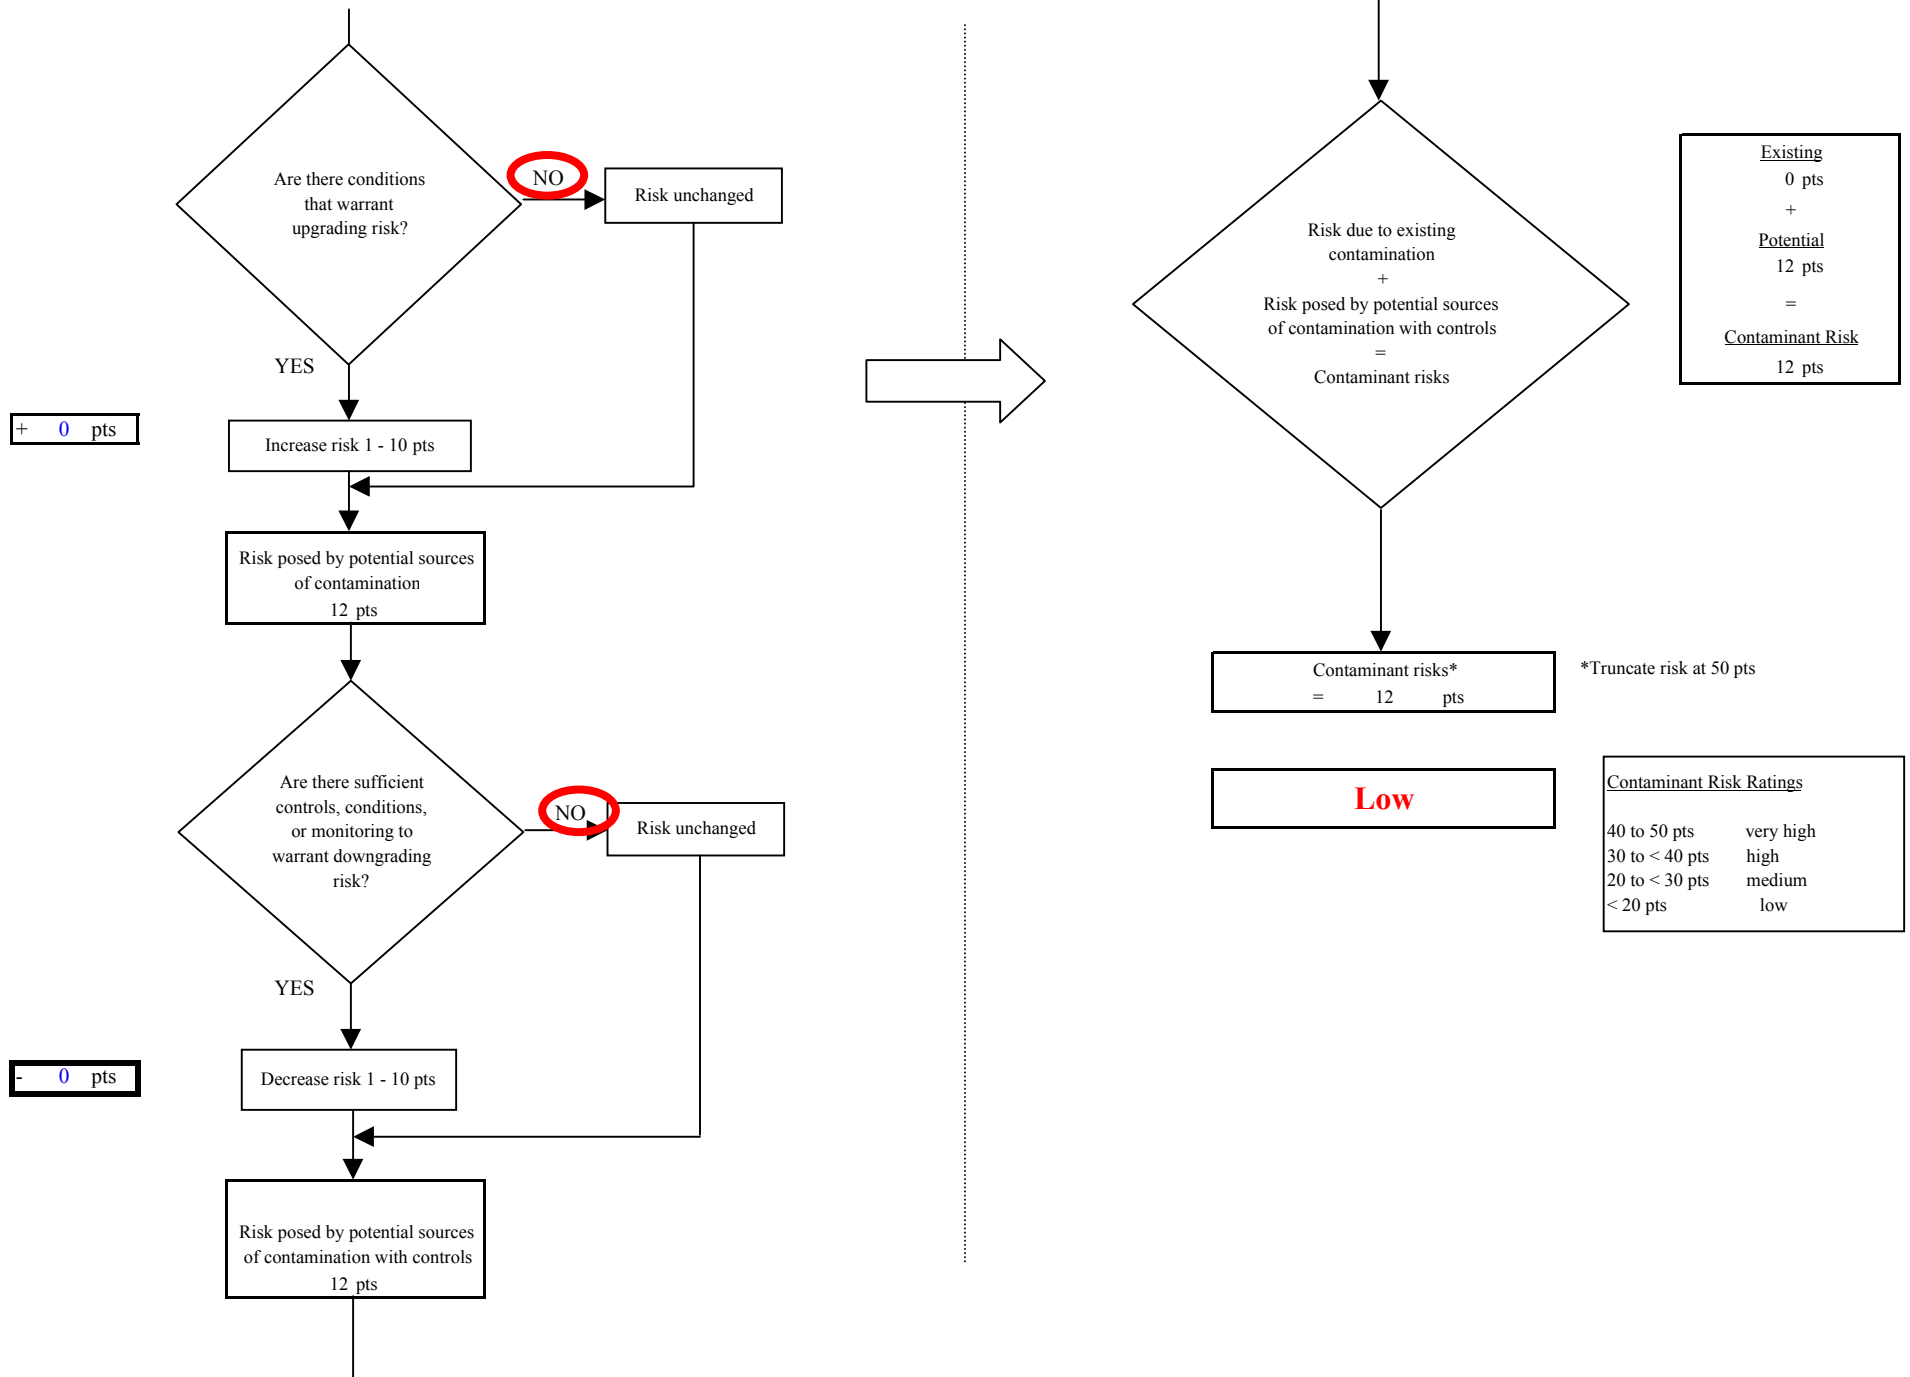

**Chart 12. Vulnerability analysis for *Homestead Hills* - Synthetic Organic Chemicals**



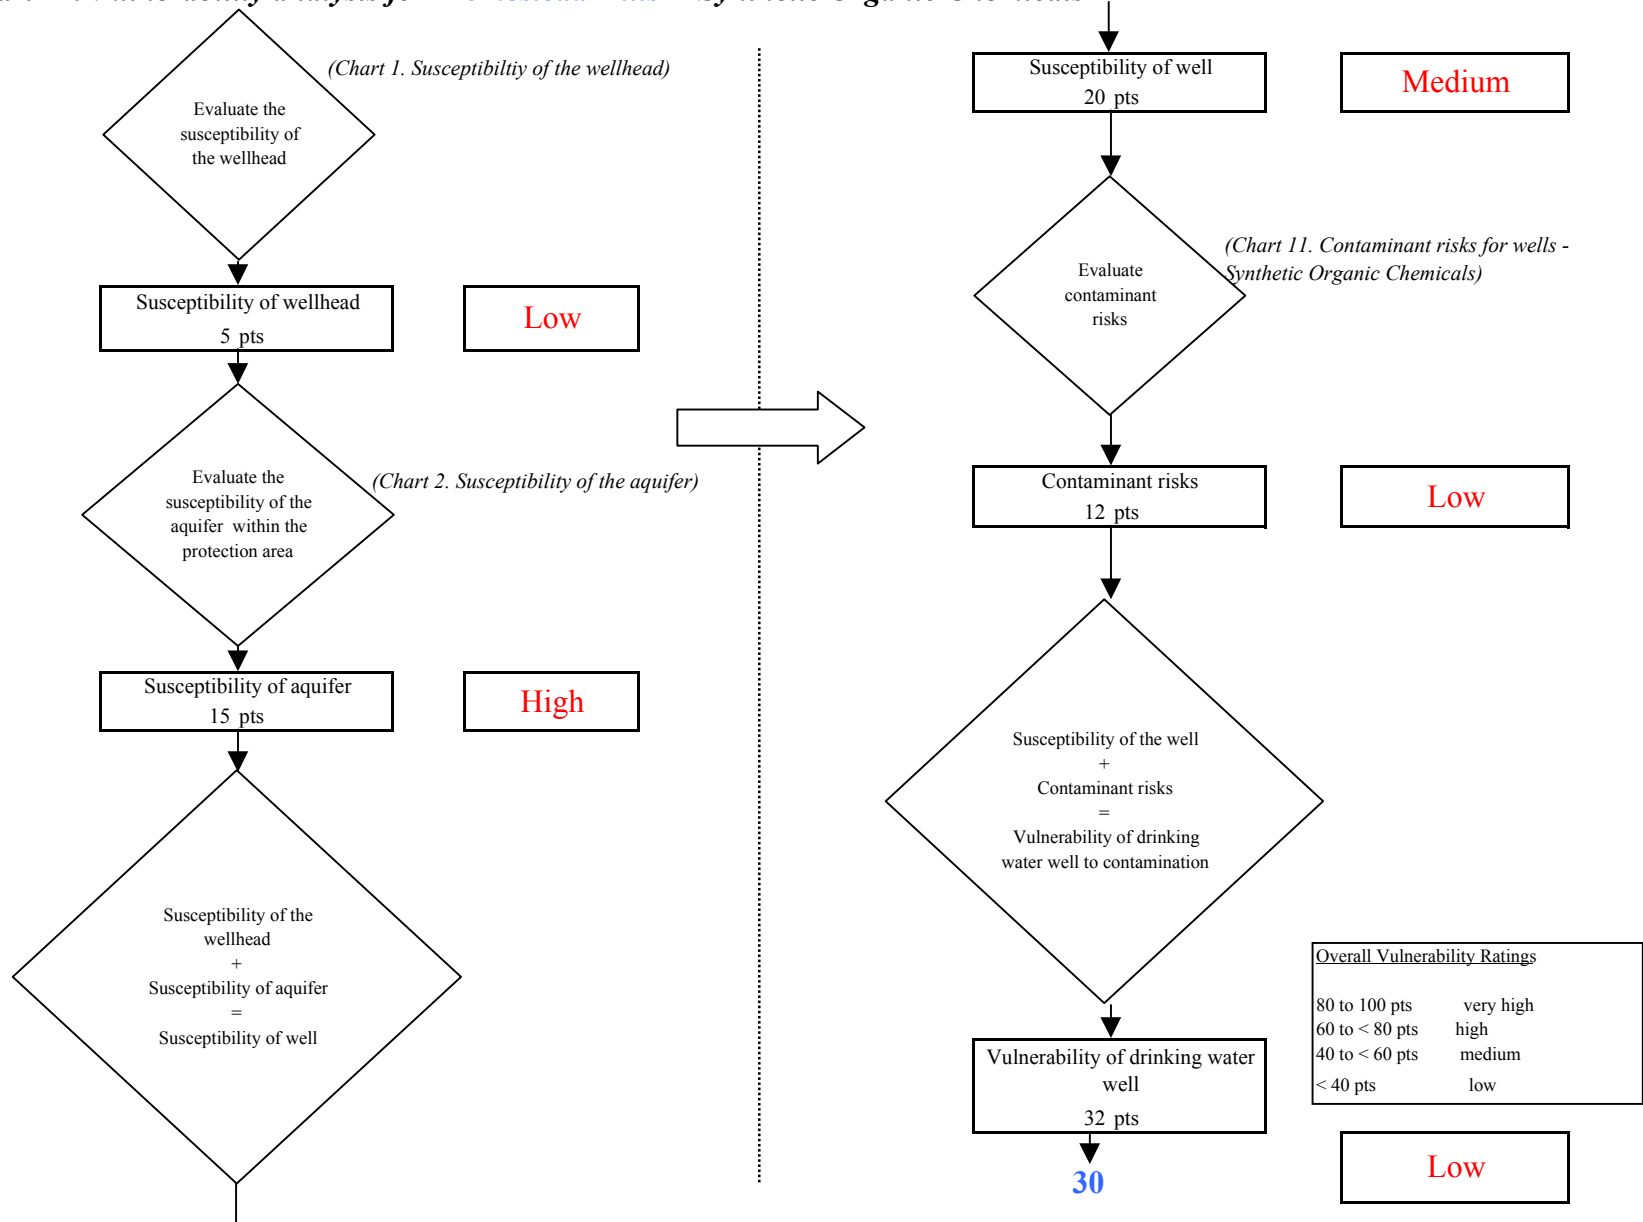


Chart 13. Contaminant risks for *Homestead Hills* - Other Organic Chemicals

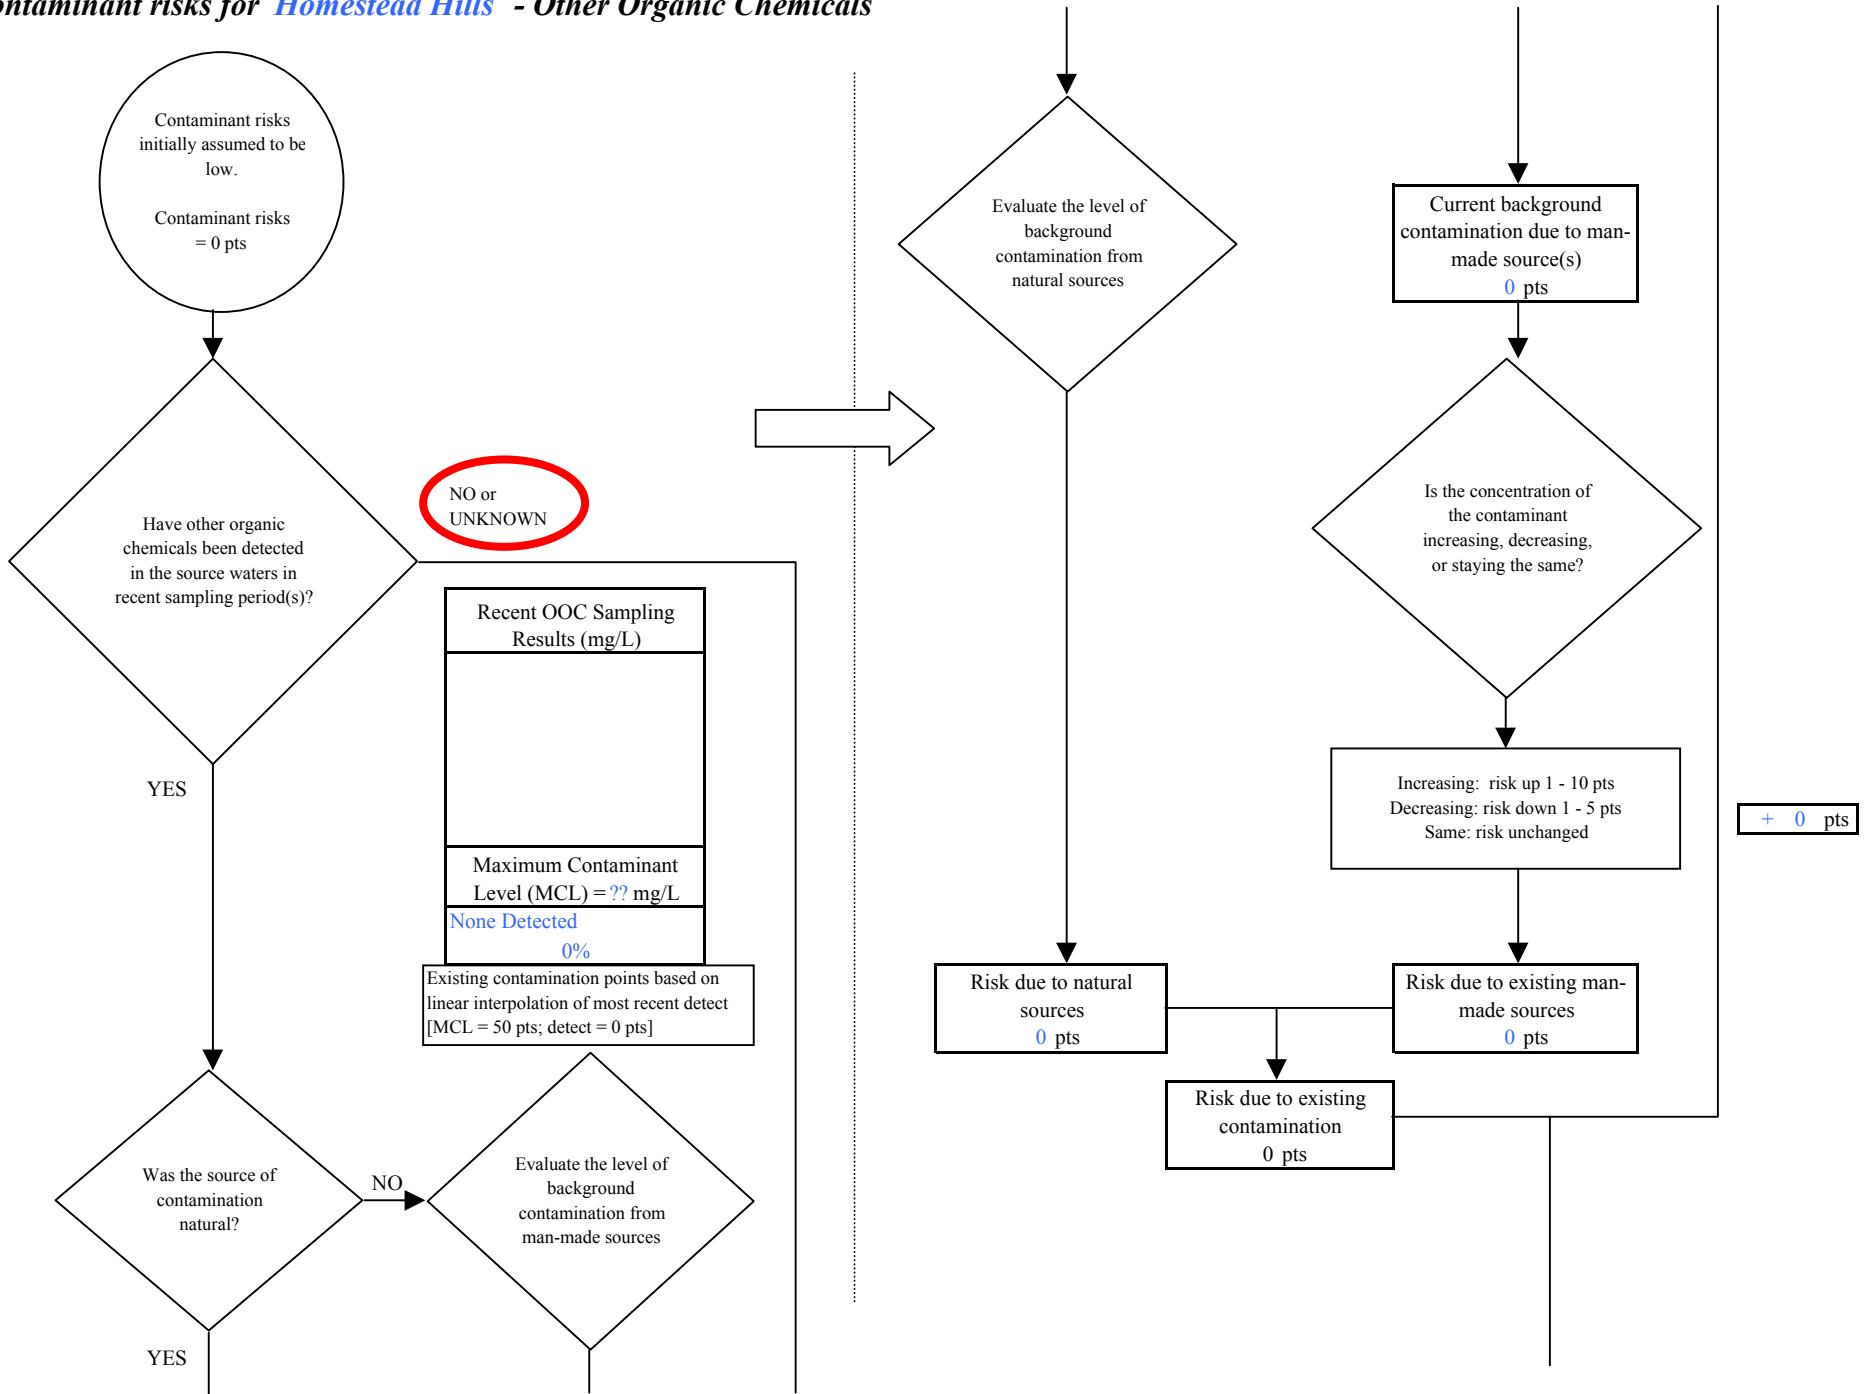

**Chart 13. Contaminant risks for Homestead Hills - Other Organic Chemicals**


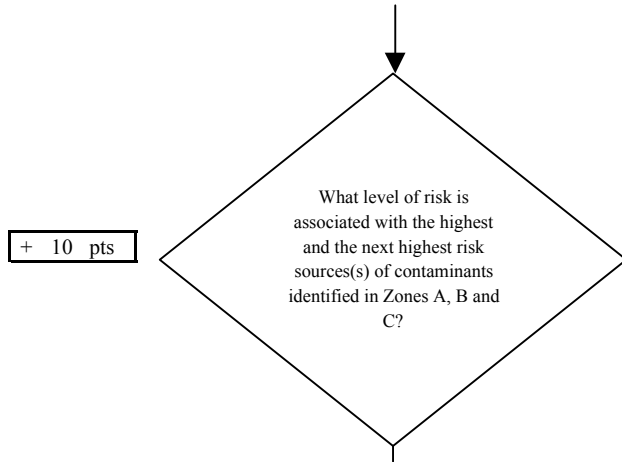


Risk Levels for Contaminant Sources identified in Zones A, B and C			
	Zone A	Zones B&C	Total
Very Highs(s)	0	0	0
High(s)	0	0	0
Medium(s)	0	0	0
Low(s)	3	5	8


	<b>LOW</b> 10 pts	<b>MEDIUM</b> 20 pts	<b>HIGH</b> 30 pts	<b>VERY HIGH</b> 40 pts
<b>LOW</b>	≥ 10 sources + 10 pts	≥ 10 sources + 5 pts	≥ 20 sources + 5 pts	----
<b>MEDIUM</b>	----	≥ 2 sources + 5 pts	≥ 5 sources + 5 pts	≥ 10 sources + 5 pts
<b>HIGH</b>	----	----	≥ 1 source + 10 pts	≥ 2 sources + 10 pts
<b>VERY HIGH</b>	----	----	----	≥ 1 source + 10 pts

Matrix Score      10

Note: Septic systems, sewerlines, and roads are each assigned a risk ranking for each individual contaminant source in the CSI. The VA, however, counts these contaminant sources as a group and assigns a calculated number of either "lows" or "mediums" based on the density.

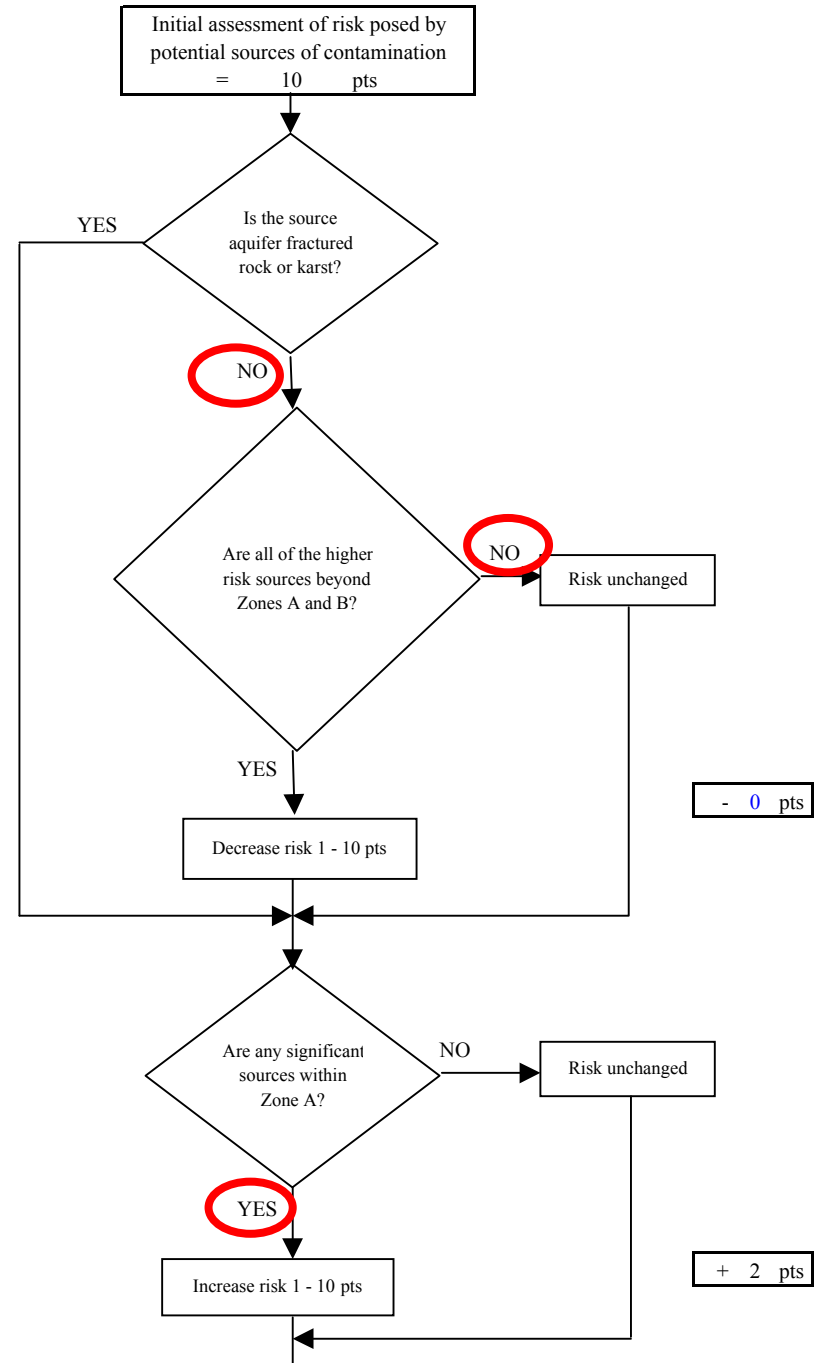

**Chart 13. Contaminant risks for Homestead Hills - Other Organic Chemicals**

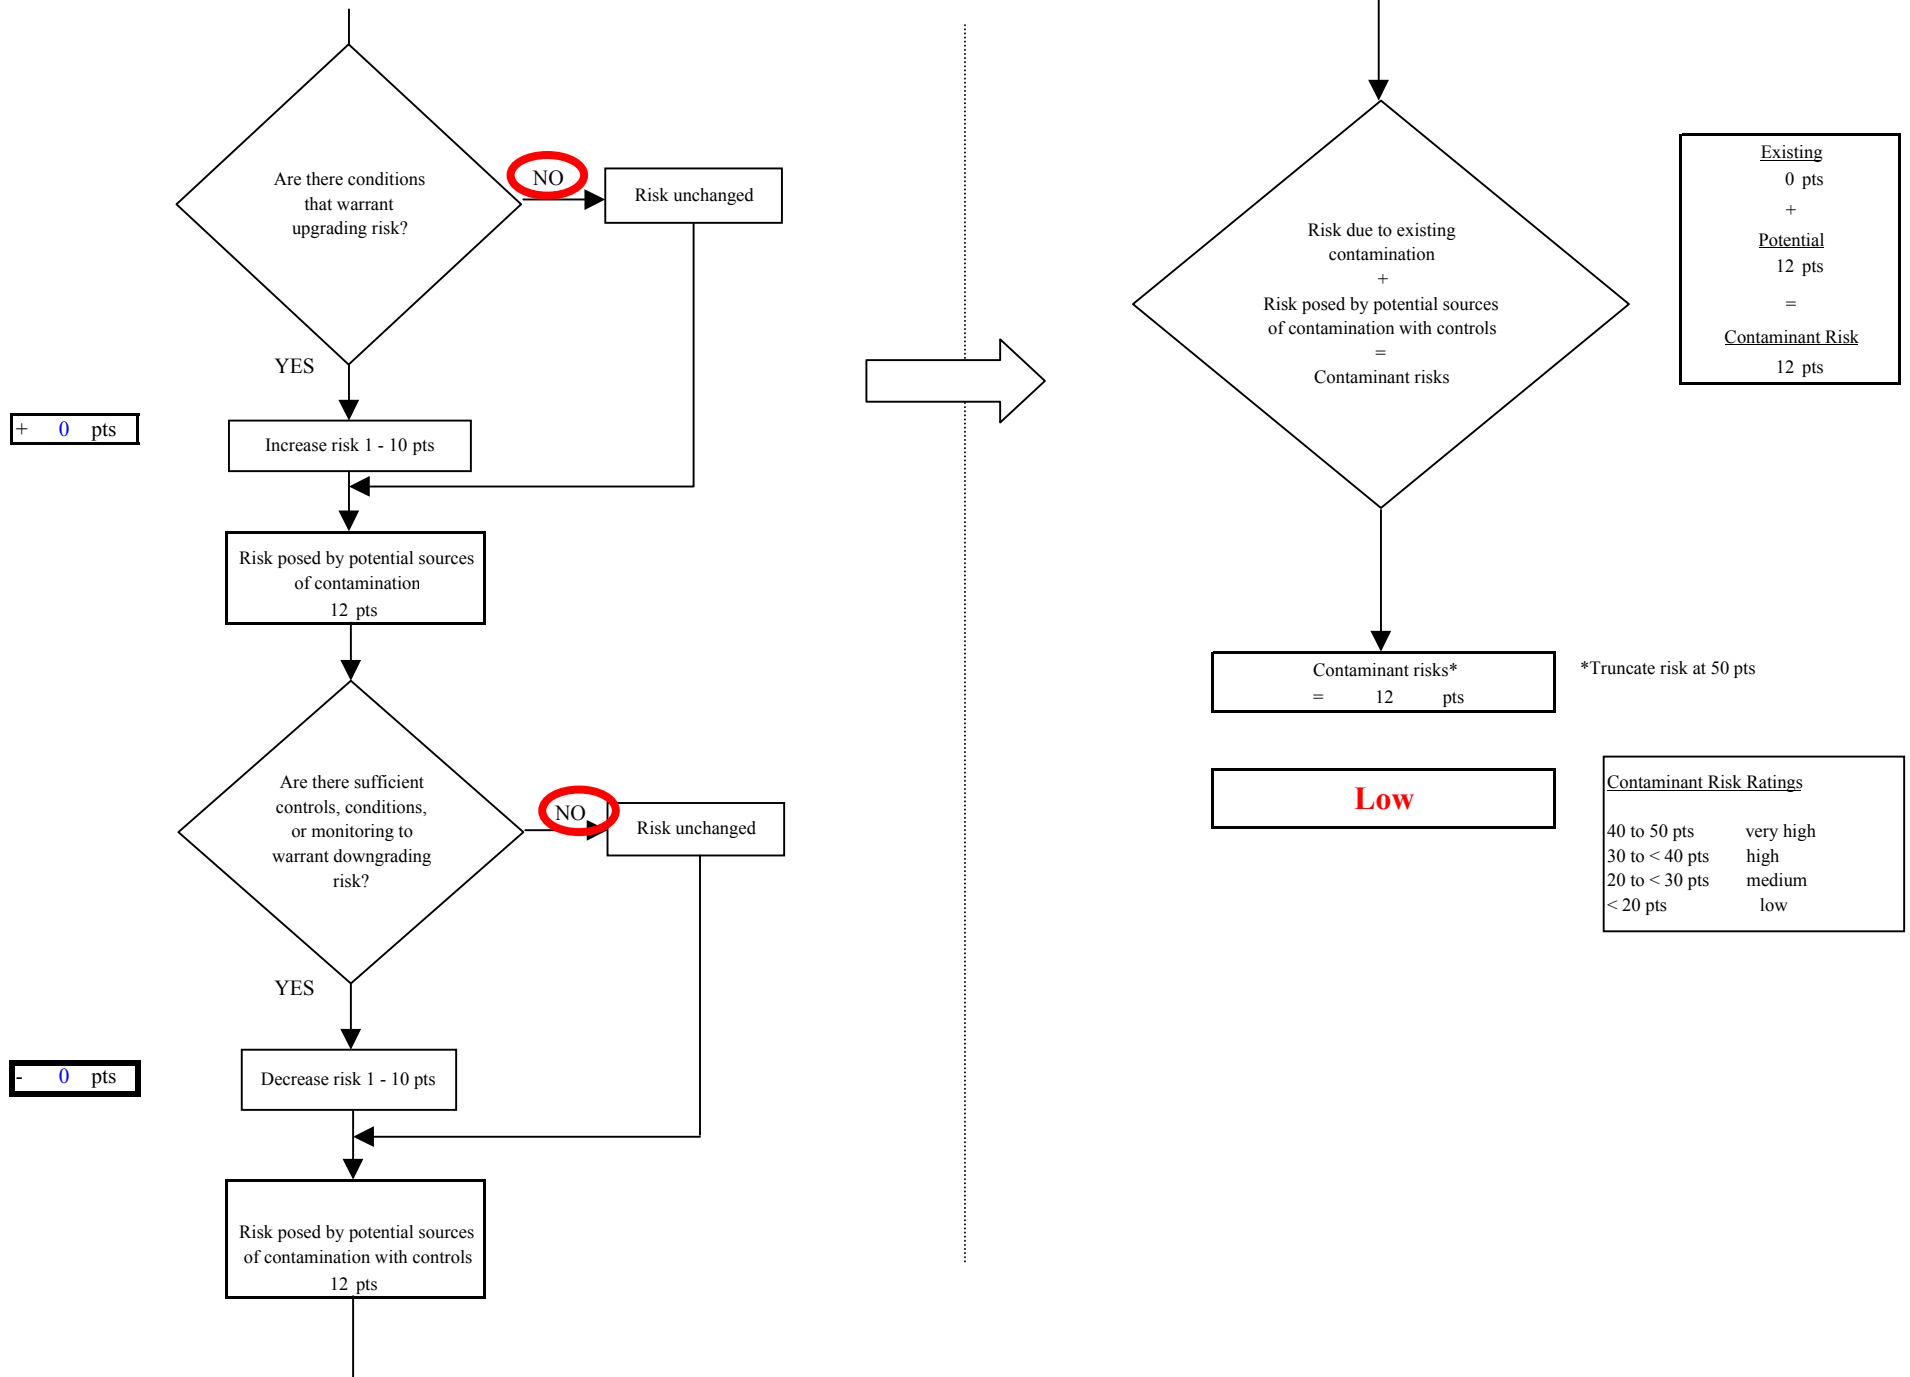

**Chart 14. Vulnerability analysis for *Homestead Hills* - Other Organic Chemicals**

