

---

# Source Water Assessment

A Hydrogeologic Susceptibility and  
Vulnerability Assessment for  
KSD Joe Parent Vocational Education Center  
Drinking Water System,  
Aniak, Alaska

PWSID # 271716.001

May 2004

DRINKING WATER PROTECTION PROGRAM REPORT 1139  
Alaska Department of Environmental Conservation

Source Water Assessment for  
KSD Joe Parent Vocational Education Center  
Drinking Water System  
Aniak, Alaska

PWSID # 271716.001

DRINKING WATER PROTECTION PROGRAM REPORT 1139

The Drinking Water Protection Program (DWPP) is producing Source Water Assessments in compliance with the Safe Drinking Water Act Amendments of 1996. Each assessment includes a delineation of the source water area, an inventory of potential and existing contaminant sources that may impact the water, a risk ranking for each of these contaminants, and an evaluation of the potential vulnerability of these drinking water sources.

These assessments are intended to provide public water systems owners/operators, communities, and local governments with the best available information that may be used to protect the quality of their drinking water. The assessments combine information obtained from various sources, including the U.S. Environmental Protection Agency, Alaska Department of Environmental Conservation (ADEC), public water system owners/operators, and other public information sources. The results of this assessment are subject to change if additional data becomes available. It is anticipated this assessment will be updated every five years to reflect any changes in the vulnerability and/or susceptibility of public drinking water source. If you have any additional information that may affect the results of this assessment, please contact the Program Coordinator of DWPP, (907) 269-7521.

## CONTENTS

EXECUTIVE SUMMARY.....	1	INVENTORY OF POTENTIAL AND EXISTING	
PUBLIC DRINKING WATER SYSTEM .....	1	CONTAMINANT SOURCES .....	2
DRINKING WATER PROTECTION AREA.....	2	RANKING OF CONTAMINANT RISKS .....	2
		VULNERABILITY OF DRINKING WATER	
		SYSTEM .....	3

## TABLES

Table 1. Definition of Zones.....	2
Table 2. Susceptibility .....	3
Table 3. Contaminant Risks.....	4
Table 4. Overall Vulnerability.....	4

## APPENDICES

APPENDIX	A. KSD Joe Parent Vocational Education Center Drinking Water Protection Area (Map A)
	B. Contaminant Source Inventory for KSD Joe Parent Vocational Education Center (Table 1) Contaminant Source Inventory and Risk Ranking for KSD Joe Parent Vocational Education Center – Bacteria and Viruses (Table 2) Contaminant Source Inventory and Risk Ranking for KSD Joe Parent Vocational Education Center – Nitrates/Nitrites (Table 3) Contaminant Source Inventory and Risk Ranking for KSD Joe Parent Vocational Education Center – Volatile Organic Chemicals (Table 4) Contaminant Source Inventory and Risk Ranking for KSD Joe Parent Vocational Education Center – Heavy Metals, Cyanide and Other Inorganic Chemicals (Table 5) Contaminant Source Inventory and Risk Ranking for KSD Joe Parent Vocational Education Center – Synthetic Organic Chemicals (Table 6) Contaminant Source Inventory and Risk Ranking for KSD Joe Parent Vocational Education Center – Other Organic Chemicals (Table 7)
	C. KSD Joe Parent Vocational Education Center Drinking Water Protection Area and Potential and Existing Contaminant Sources (Map C)
	D. Vulnerability Analysis for Contaminant Source Inventory and Risk Ranking for KSD Joe Parent Vocational Education Center Public Drinking Water Source (Charts 1 – 14)

# Source Water Assessment for KSD Joe Parent Vocational Education Center Source of Public Drinking Water, Aniak, Alaska

---

## Drinking Water Protection Program Alaska Department of Environmental Conservation

### EXECUTIVE SUMMARY

The KSD Joe Parent Vocational Education Center has one Public Water System (PWS) well. The well (PWS No. 271716.001) has been used as a drinking water source since it was drilled in 1957.

The well is a Class A (community and non-transient non-community) water system located on the west side of Aniak, Alaska, on the south bank of the Kuskokwim River. Available records indicate that there is no secondary storage of drinking water, other than two pressure tanks, and that the untreated drinking water source is derived directly from the wellhead. This system operates seasonally and serves approximately 35 non-residents through one service connection. The wellhead received a susceptibility rating of **Very High** and the aquifer received a susceptibility rating of **Very High**. Combining these two ratings produce a **Very High** rating for the natural susceptibility of the well.

Identified potential and current sources of contaminants for the public drinking water source include: aboveground fuel tanks, water supply wells, an airport, domestic wastewater collection systems, underground fuel tanks, ADEC recognized contaminated sites and leaking underground storage tank (LUST) sites, petroleum product bulk station/terminals, airports, electric power generation, firehouses, motor/motor vehicle repair shops, a large capacity septic system, and medical/veterinary facilities. These identified potential and existing sources of contamination are considered as sources of bacteria and viruses, nitrates and/or nitrites, volatile organic chemicals, heavy metals, cyanide and other inorganic chemicals, synthetic organic chemicals, and other organic chemicals contaminant categories.

Overall, the water well received a vulnerability rating of **Very High** for nitrates and nitrites, volatile organic chemicals, and other organic chemicals, a vulnerability rating of **High** for heavy metals, cyanide and other inorganic chemicals, and synthetic organic chemicals, and a vulnerability rating of **Medium** for bacteria and viruses.

### PUBLIC DRINKING WATER SYSTEM

The KSD Joe Parent Vocational Education Center well is a Class A (community/non-transient/non-community) public water system. The system is located on the west side of Aniak, Alaska, on the south bank of the Kuskokwim River (Sec. 11, T17N, R57W, Seward Meridian; see Map A of Appendix A). Aniak is located on the south bank of the Kuskokwim River in the Yukon-Kuskokwim Delta. The village is located about 92 miles northeast of Bethel and 317 miles west of Anchorage. The community has a population of 539 (ADCED, 2003). Average annual precipitation in Aniak is 19 inches, including approximately 60 inches of snowfall. Temperatures can be as extreme as -55 to 87°F.

The community of Aniak obtains most of their water supply from individual wells. Most households are served by the piped sewage collection system and the remaining households either have individual septic tanks or pit privies (ADCED, 2003). Aniak receives electrical power from the Aniak Light and Power Company. Power generating facilities are fueled by diesel. Refuse is collected by individuals and transported to the landfill (ADCED, 2003).

According to information supplied by ADEC for the KSD Joe Parent Vocational Education Center PWS, the depth of the primary water well is 60 feet below the ground surface. Based on available construction details for surrounding wells, it is assumed that the well is screened in an unconfined aquifer. The well is located within a floodplain.

Information acquired from a March 2003 sanitary survey for the public water system indicated that the land surface was sloped away from the well. Generally, land surfaces that slope away from the wellhead promote surface water drainage, which reduces the potential of contaminant migration down the well casing annulus. The sanitary survey indicates that the well is grouted according to ADEC regulations. Proper grouting provides added protection against contaminants traveling along the well casing annulus and into source waters.

Aniak is located on a flat former floodplain of the Kuskokwim River and the topographic relief in the area is less than 20 feet. Soils information is limited. Generally, the soils consist of sandy silt overlying sand and fine gravels. Aniak is located in an area that is considered a discontinuous permafrost zone and the permafrost masses are small, thin and generally isolated (U.S. Department of Health and Human Services, et. al, 1983).

C	Less Than the 5 year time -of-travel
D	Less than the 10 year time -of-travel

---

The DWPA for the KSD Joe Parent Vocational Education Center PWS was determined using an analytical calculation and includes Zones A, B, C, and D (See Map A of Appendix A).

**DRINKING WATER PROTECTION AREA**

In order to evaluate whether a drinking water source is at risk, we must first evaluate what are the most likely pathways for surface contamination to reach the groundwater. These areas are determined by looking at the characteristics of the soil, groundwater, aquifer, and well.

The most probable area for contamination to reach the drinking water well is the area that contributes water to the well, the groundwater recharge area. This area is designated as the drinking water protection area (DWPA). Because releases of contaminants within the protection area are most likely to impact the drinking water well, this area will serve as the focus for voluntary protection efforts. An analytical calculation was used to determine the size and shape of the DWPA for the KSD Joe Parent Vocational Education Center PWS. The input parameters describing the attributes of the aquifer in this calculation were adopted from Groundwater (Freeze and Cherry, 1979). Available geology and groundwater contours were also considered to take into account any uncertainties in groundwater flow and aquifer characteristics to arrive at a meaningful protection area.

The protection areas established for wells by the ADEC are usually separated into four zones, limited by the watershed. These zones correspond to differences in the time-of-travel (TOT) of the water moving through the aquifer to the well (Please refer to the Guidance Manual for Class A Public Water Systems for additional information).

The time of travel for contaminants within the water varies and is dependent on the physical and chemical characteristics of each contaminant. The following is a summary of the four protection area zones for wells and the calculated time -of-travel for each:

**Table 1. Definition of Zones**

Zone	Definition
A	¼ the distance for the 2-yr. time -of-travel
B	Less than the 2 year time-of-travel

**INVENTORY OF POTENTIAL AND EXISTING CONTAMINANT SOURCES**

The Drinking Water Protection Program has completed an inventory of potential and existing sources of contamination within the KSD Joe Parent Vocational Education Center DWPA. This inventory was completed through a search of agency records and other publicly available information. Potential sources of contamination to the drinking water aquifer include a wide range of categories and types. Potential drinking water contaminants are found within agricultural, residential, commercial, and industrial areas, but can also occur within areas that have little or no development.

For the basis of all Class A public water system assessments, six categories of drinking water contaminants were inventoried. They include:

- Bacteria and viruses,
- Nitrates and/or nitrites,
- Volatile organic chemicals,
- Heavy metals, cyanide and other inorganic chemicals,
- Synthetic organic chemicals,
- Other organic chemicals.

The sources are displayed on Map C of Appendix C and summarized in Table 1 of Appendix B.

**RANKING OF CONTAMINANT RISKS**

Once the potential and existing sources of contamination have been identified, they are assigned a ranking according to what type and level of risk they represent. Ranking of contaminant risks for a “potential” or “existing” source of contamination is a function of toxicity and volumes of specific contaminants associated with that source. Rankings include:

- Low,
- Medium,
- High, and
- Very High.

The time-of-travel for contaminants within the water varies and is dependent on the physical and chemical characteristics of each contaminant. Bacteria and Viruses are only inventoried in Zones A and B because of their short life span. Only “Very High” and “High” rankings are inventoried within the outer Zone D due to the probability of contaminant dilution by the time the contaminants get to the well. Tables 2 through 4 in Appendix B contain the ranking of potential and existing sources of contamination with respect to bacteria and viruses, nitrates and/or nitrites, volatile organic chemicals, heavy metals, cyanide and other inorganic chemicals, synthetic organic chemicals, and other organic chemicals.

**VULNERABILITY OF THE DRINKING WATER SYSTEM**

Vulnerability of a drinking water source to contamination is a combination of two factors:

- Natural susceptibility, and
- Contaminant risks.

Appendix D contains fourteen charts, which together form the ‘Vulnerability Analysis’ for a source water assessment for a public drinking water source. Chart 1 analyzes the ‘Susceptibility of the Wellhead’ to contamination by looking at the construction of the well and its surrounding area. Chart 2 analyzes the ‘Susceptibility of the Aquifer’ to contamination by looking at the naturally occurring attributes of the water source and influences on the groundwater system that might lead to contamination. Chart 3 analyzes ‘Contaminant Risks’ for the drinking water source with respect to bacteria and viruses. The ‘Contaminant Risks’ portion of the analysis considers potential sources of contaminants as well as a review of contamination that has or may have occurred, but has not arrived or been detected at the well. Chart 4 contains the ‘Vulnerability Analysis for Bacteria and Viruses’. Charts 5 through 14 contain the Contaminant Risks and Vulnerability Analyses for nitrates and nitrites, volatile organic chemicals, heavy metals, cyanide and other inorganic chemicals, synthetic organic chemicals, and other organic chemicals, respectively.

A score for the Natural Susceptibility is reached by considering the properties of the well and the aquifer.

Susceptibility of the Wellhead (0 – 25 Points)  
(Chart 1 of Appendix D)

+

Susceptibility of the Aquifer (0 – 25 Points)  
(Chart 2 of Appendix D)

=

Natural Susceptibility (Susceptibility of the Well)  
(0 – 50 Points)

A ranking is assigned for the Natural Susceptibility according to the point score:

Natural Susceptibility Ratings	
40 to 50 pts	Very High
30 to < 40 pts	High
20 to < 30 pts	Medium
< 20 pts	Low

The KSD Joe Parent Vocational Education Center’s water well is in an unconfined aquifer. Unconfined aquifers are more susceptible to potential groundwater quality impacts posed by the migration of surface water contaminants downward from the surface. Table 2 shows the susceptibility scores and ratings for this PWS.

**Table 2. Susceptibility**

	Score	Rating
Susceptibility of the Wellhead	20	Very High
Susceptibility of the Aquifer	25	Very High
Natural Susceptibility	45	Very High

Contaminant risks to a drinking water source depend on the type, number or density, and distribution of contaminant sources. This score has been derived from an examination of existing and historical contamination that has been detected at the drinking water source through routine sampling. It also evaluates potential sources of contamination. Flow charts are used to assign a point score, and ratings are assigned in the same way as for the natural susceptibility:

Contaminant Risk Ratings	
40 to 50 pts	Very High
30 to < 40 pts	High
20 to < 30 pts	Medium
< 20 pts	Low

Table 3 summarizes the Contaminant Risks for each category of drinking water contaminants.

**Table 3. Contaminant Risks**

Category	Score	Rating
Bacteria and Viruses	10	Low
Nitrates and/or Nitrites	38	High
Volatile Organic Chemicals	50	Very High
Heavy Metals, Cyanide and Other Inorganic Chemicals	27	Medium
Synthetic Organic Chemicals	30	High
Other Organic Chemicals	45	Very High

Finally, an overall vulnerability score is assigned for each water system by combining each of the contaminant risk scores with the natural susceptibility score:

$$\begin{array}{r}
 \text{Natural Susceptibility (0 – 50 points)} \\
 + \\
 \text{Contaminant Risks (0 – 50 points)} \\
 = \\
 \text{Vulnerability of the} \\
 \text{Drinking Water Source to Contamination (0 – 100)}.
 \end{array}$$

Again, rankings are assigned according to a point score:

Overall Vulnerability Ratings	
80 to 100 pts	Very High
60 to < 80 pts	High
40 to < 60 pts	Medium
< 40 pts	Low

Table 4 contains the overall vulnerability scores (0–100) and ratings for each of the six categories of drinking water contaminants. Note: scores are rounded off to the nearest five.

**Table 4. Overall Vulnerability**

Category	Score	Rating
Bacteria and Viruses	55	Medium
Nitrates and Nitrites	85	Very High
Volatile Organic Chemicals	95	Very High
Heavy Metals, Cyanide and Other Inorganic Chemicals	70	High
Synthetic Organic Chemicals	75	High

Other Organic Chemicals      90      Very High

**Bacteria and Viruses**

The contaminant risk for bacteria and viruses is **Low**. The risk is primarily attributed to the presence of a large capacity septic system in Zone C (see Table 2 – Appendix B).

No positive bacteria counts have been reported in recent (within five years) sampling events (See Chart 3 – Contaminant Risks for Bacteria and Viruses in Appendix D). Only a small amount of bacteria and viruses are required to endanger public health.

After combining the contaminant risk for bacteria and viruses with the natural susceptibility of the well, the overall vulnerability of the well to contamination is **Medium**.

**Nitrates and Nitrites**

The contaminant risk for nitrates and nitrites is **High**. The risk to this source of public drinking water is primarily attributed to the presence of a large capacity septic system in Zone C (see Table 3 – Appendix B).

Nitrates are very mobile, moving at approximately the same rate as water. The sampling history for this well indicates that low levels of nitrates have been detected in recent sampling events. However, the reported concentrations of nitrates do not exceed the maximum contaminant level (MCL) of 10 mg/L. Nitrate concentrations in uncontaminated groundwater are typically less than 2 mg/L; therefore, nitrate concentrations above 2 mg/L may be indicative of man-made sources (See Chart 5 - Contaminant Risks for Nitrates and/or Nitrites in Appendix D).

Nitrate levels are often derived from the decomposition of organic matter in soils. Although the nitrate source is unknown, such occurrences may be attributed to septic systems or other sources. After combining the contaminant risk for nitrates and nitrites with the natural susceptibility of the well, the overall vulnerability of the well to nitrate and nitrite contamination is **Very High**.

**Volatile Organic Chemicals**

The contaminant risk for volatile organic chemicals is **Very High**. The risk is primarily attributed to the presence of an airport, ADEC recognized contaminated sites and LUST sites, and petroleum product bulk station/terminals located in Zones A, B, and C. Numerous other potential contaminant sources

are also found within the protection area (see Table 4 – Appendix B).

All recent sampling data for VOCs were below detection levels (See Chart 7 – Contaminant Risks for Volatile Organic Chemicals in Appendix D).

After combining the contaminant risk for volatile organic chemicals with the natural susceptibility of the well, the overall vulnerability of the well to contamination is **Very High**.

### **Heavy Metals, Cyanide and Other Inorganic Chemicals**

The contaminant risk for heavy metals, cyanide and other inorganic chemicals is **Medium**. The risk is primarily attributed to the presence of electric power generation and motor/motor vehicle repair shops located in Zones B and C. Numerous other potential contaminant sources are also found within the protection area (see Table 5 – Appendix B).

Based on review of recent sampling records for this public water system, moderate levels of copper and lead have been detected in recent sampling history, but have not exceeded their respective MCLs of 1.3 mg/L and 0.015 mg/L (see Chart 8 – Contaminant Risks for Heavy Metals, Cyanide, and Other Inorganic Chemicals in Appendix D).

The reported concentrations of copper and lead in recent sampling events are not likely to be representative of source water conditions. These two analytes are likely attributed to either the water treatment process or water distribution network; therefore, no risk points were assigned based on the presence of these analytes.

After combining the contaminant risk for heavy metals, cyanide and other inorganic chemicals with the natural susceptibility of the well, the overall vulnerability of the well to contamination is **High**.

### **Synthetic Organic Chemicals**

The contaminant risk for synthetic organic chemicals is **High**. The risk is primarily attributed to the presence of an airport located in Zones A, B, and C. Numerous other potential contaminant sources are also found within the protection area (see Table 6 – Appendix B).

No recent sampling data was available in ADEC records for the KSD Joe Parent Vocational Education Center (See Chart 11 – Contaminant Risks for Synthetic Organic Chemicals in Appendix D).

After combining the contaminant risk for synthetic organic chemicals with the natural susceptibility of the well, the overall vulnerability of the well to contamination is **High**.

### **Other Organic Chemicals**

The contaminant risk for other organic chemicals is **Very High**. The risk is primarily attributed to the presence of petroleum product bulk station/terminals and electric power generation located in Zone B. Numerous other potential contaminant sources are also found within the protection area (see Table 7 – Appendix B).

No recent sampling data was available in ADEC records for the KSD Joe Parent Vocational Education Center (See Chart 13 – Contaminant Risks for Other Organic Chemicals in Appendix D).

After combining the contaminant risk for other organic chemicals with the natural susceptibility of the well, the overall vulnerability of the well to contamination is **Very High**.

### **Using the Source Water Assessment**

This assessment of contaminant risks can be used as a foundation for local voluntary protection efforts as well as a basis for the continuous efforts on the part of the KSD Joe Parent Vocational Education Center and the community of Aniak to protect public health. It is anticipated that Source Water Assessments will be updated every five years to reflect any changes in the vulnerability and/or susceptibility of the drinking water source.




## REFERENCES

- Alaska Department of Community and Economic Development (ADCED), 2003 [WWW document]. URL: [http://www.dced.state.ak.us/cbd/commdb/CF\\_COMDB.htm](http://www.dced.state.ak.us/cbd/commdb/CF_COMDB.htm)
- Alaska Department of Environmental Conservation, Contaminated Sites Database, 2003 [WWW database], URL [http://www.state.ak.us/dec/dspar/csites/cs\\_search.htm](http://www.state.ak.us/dec/dspar/csites/cs_search.htm)
- Alaska Department of Environmental Conservation, Leaking Underground Storage Tank Database, 2003 [WWW database], URL [http://www.dec.state.ak.us/spar/stp/ust/search/fac\\_search.asp](http://www.dec.state.ak.us/spar/stp/ust/search/fac_search.asp)
- Freeze, R. A., and Cherry, J.A. 1979, Groundwater, Prentice-Hall, Englewood Cliffs, New Jersey
- United States Department of Health and Human Services, et.al, 1983. Final Report, Sanitation Facilities Construction for Aniak, Alaska, Project No. AN-80-222.
- United States Environmental Protection Agency (EPA), 2002 [WWW document]. URL <http://www.epa.gov/safewater/mcl.html>.

# **APPENDIX A**

## **Drinking Water Protection Area Location Map (Map A)**

Public Water Well System for PWS #271716.001 KSD Joe Parent Voc. Ed. Center

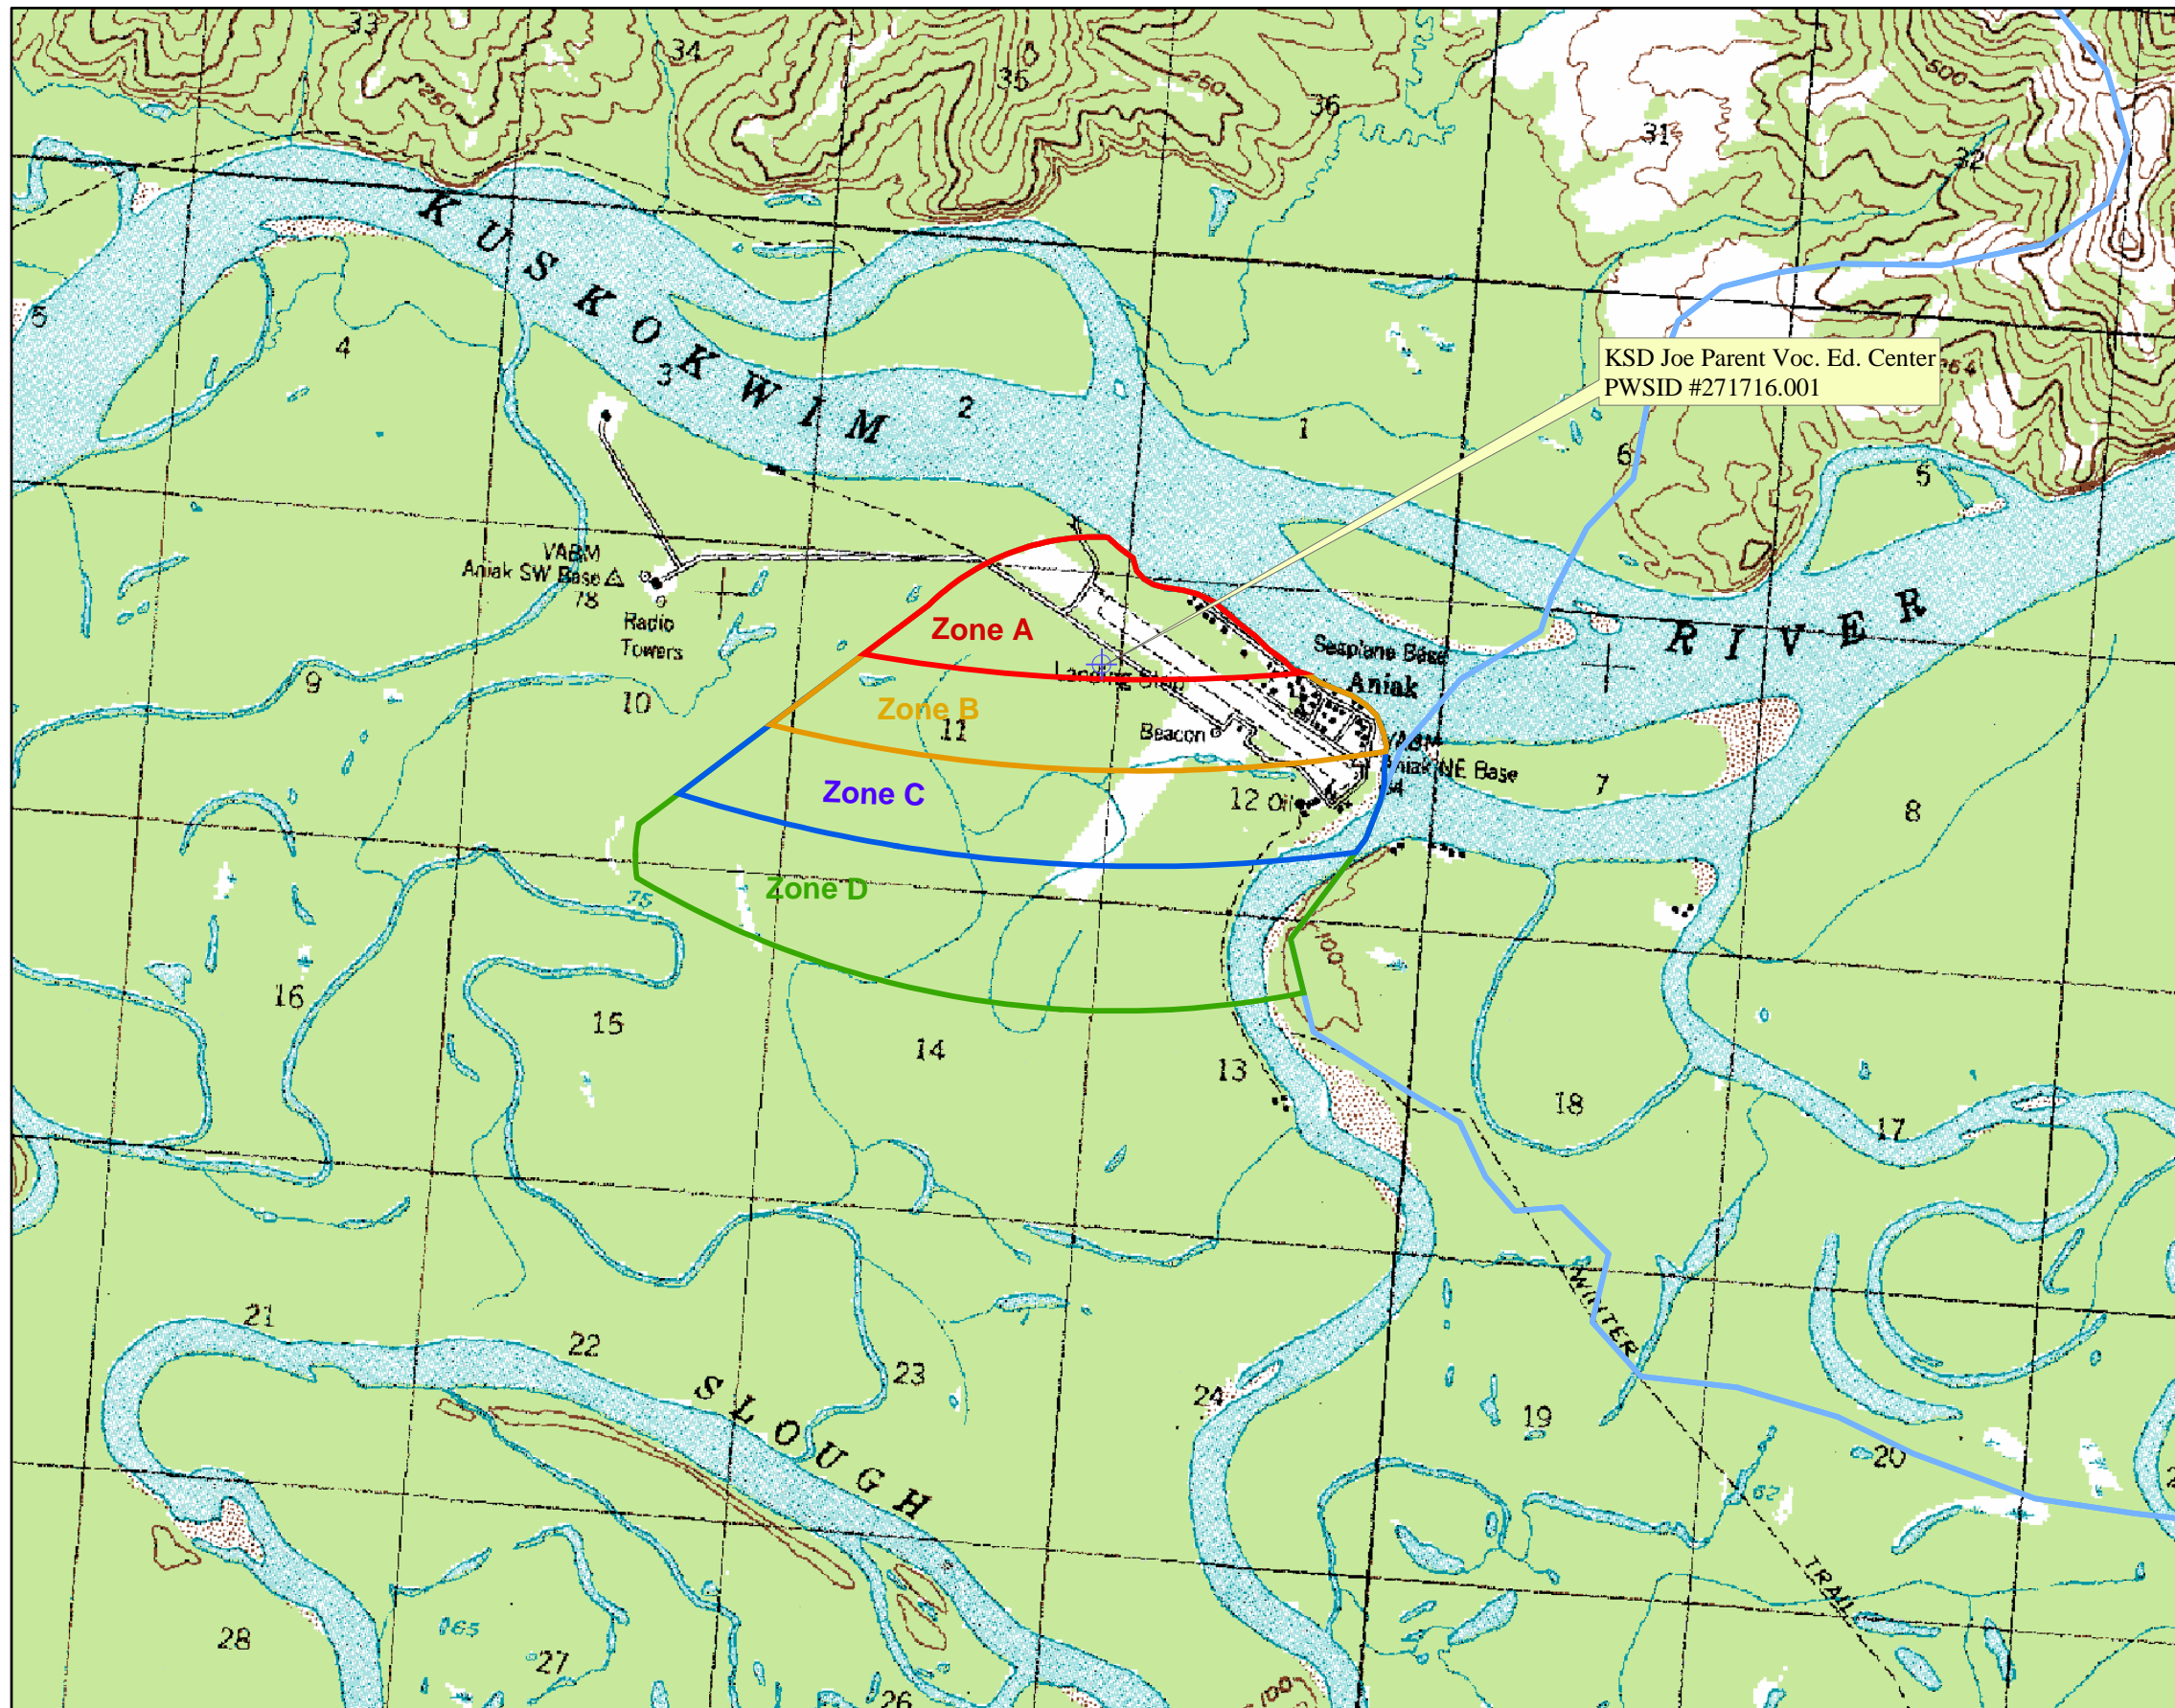

**LEGEND**

⊕ Public Water System Well

**Groundwater Protection Zones**

- Zone A – Several Months Travel Time
- Zone B – Less Than 2 Years Travel Time
- Zone C – Less Than 5 Years Travel Time
- Zone D – Less Than 10 Years Travel Time



**Hydrography/Physical**

- Parcels
- Stream
- Lake or Pond
- Contours
- Watershed Boundary

**Data Sources:**

- Contaminant Sources, Public Water System Wells, Contours
- Alaska Department of Environmental Conservation (ADEC)
- Critical Facilities, Federal Emergency Management Agency (FEMA)
- All other data:
- United States Geological Survey (USGS)
- Drinking Water Protection Areas based on "Alaska Drinking Water Protection Program - Guidance Manual for Class A Public Water Systems" published by ADEC

URS Corporation does not guarantee the accuracy or validity of the data provided.

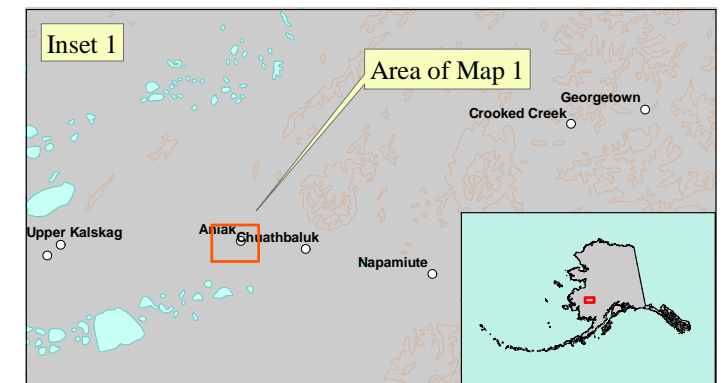

## **APPENDIX B**

### **Contaminant Source Inventory and Risk Ranking (Tables 1-7)**

**Table 1****Contaminant Source Inventory for  
KSD Joe Parent Voc. Ed. Center****PWSID 271716.001**

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Map Number</i>	<i>Comments</i>
Tanks, heating oil, nonresidential (aboveground)	T14	T14-01	A	C	Aniak Propane Sales
Tanks, heating oil, nonresidential (aboveground)	T14	T14-02	A	C	Diamond Willow Café
Tanks, heating oil, nonresidential (aboveground)	T14	T14-03	A	C	George Givot Shop
Tanks, heating oil, nonresidential (aboveground)	T14	T14-04	A	C	Sanbiel Step & Shop
Tanks, heating oil, nonresidential (aboveground)	T14	T14-05	A	C	Catholic Church
Tanks, heating oil, nonresidential (aboveground)	T14	T14-06	A	C	Aniak Traditional Council
Tanks, heating oil, nonresidential (aboveground)	T14	T14-07	A	C	KSD Office
Tanks, heating oil, nonresidential (aboveground)	T14	T14-08	A	C	Post Office
Tanks, heating oil, nonresidential (aboveground)	T14	T14-09	A	C	Aniak Middle School
Water supply wells	W09	W09-01	A	C	1 water supply well in Zone A
Airports	X14	X14-01	A	C	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D01-01	B	C	
Closed tanks, gasoline (underground)	T13	T13-01	B	C	Mark Air Aniak Station
Tanks, heating oil, nonresidential (aboveground)	T14	T14-10	B	C	Aniak Light & Power
Tanks, heating oil, nonresidential (aboveground)	T14	T14-11	B	C	Aniak Power House
Tanks, heating oil, nonresidential (aboveground)	T14	T14-12	B	C	AC Store
Tanks, heating oil, nonresidential (aboveground)	T14	T14-13	B	C	Bush-Tell
Tanks, heating oil, nonresidential (aboveground)	T14	T14-14	B	C	Assembly of God Church
Tanks, heating oil, nonresidential (aboveground)	T14	T14-15	B	C	Old Community Hall
Tanks, heating oil, nonresidential (aboveground)	T14	T14-16	B	C	Fire Station
Tanks, heating oil, nonresidential (aboveground)	T14	T14-17	B	C	Library
Tanks, heating oil, nonresidential (aboveground)	T14	T14-18	B	C	Aniak City Office
Tanks, heating oil, nonresidential (aboveground)	T14	T14-19	B	C	Alascom
Tanks, heating oil, nonresidential (aboveground)	T14	T14-20	B	C	Aniak High School

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Map Number</i>	<i>Comments</i>
Tanks, heating oil, nonresidential (aboveground)	T14	T14-21	B	C	Auntie Mary Nicoli Elementary
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-01	B	C	Aniak White Alice Site, RecKey #1989250902506, Status: Active, the Air Force White Alice Communications site operated from 1955 to 1979, has since been converted to middle school, contaminants of concern are PCBs and petroleum hydrocarbons.
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-02	B	C	Mark Air, RecKey #1992250119301, Status: Active, soils with high concentrations of BTEX, GRO and DRO were found at the base and north wall of the former 2,000-gallon Avgas UST excavation.
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-03	B	C	ADOT&PF Aniak Maintenance Station, RecKey #1993250104007, Status: Active, leaking fuel from storage and transfer system
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-04	B	C	ADOT&PF Aniak Runway Apron, RecKey #1994250127201, Status: Active, contaminated soils discovered on runway apron.
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-05	B	C	Aniak Apartments, RecKey #1995250126801, Status: Closed, four 500-gallon LUSTs removed, approximately 65 cubic yards of soil removed.
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-06	B	C	ADOT&PF Aniak City Shop Building, RecKey #1996250114201, Status: Active, stained soils noted due to area that was used as a garage/maintenance station.
Open Leaking Underground Fuel Storage Tank (LUST) Sites	U07	U07-01	B	C	Mark Air Aniak, RecKey #1992250019301, Event ID 656, Facility ID 1377, a fuel line that supplies Jet A to an AST was found to be leaking. Petroleum contamination found in a sewer line extending from Mark Air to lift station.
Water supply wells	W09	W09-02	B	C	1 water supply well in Zone B
Petroleum product bulk station/terminals	X11	X11-01	B	C	Yukon Fuels
Petroleum product bulk station/terminals	X11	X11-02	B	C	Tank Farm Area A
Airports	X14	X14-02	B	C	
Electric power generation (fossil fuels)	X36	X36-01	B	C	Aniak Light & Power
Electric power generation (fossil fuels)	X36	X36-02	B	C	Aniak Power House
Firehouses	X38	X38-01	B	C	
Motor /motor vehicle repair shops	C31	C31-01	C	C	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-01	C	C	FAA Aniak Directional Finder
Tanks, heating oil, nonresidential (aboveground)	T14	T14-22	C	C	Clinic
Tanks, heating oil, nonresidential (aboveground)	T14	T14-23	C	C	State of Alaska Office

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Map Number</i>	<i>Comments</i>
Tanks, heating oil, nonresidential (aboveground)	T14	T14-24	C	C	State Troopers Office
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-07	C	C	FAA Aniak Rural Communication Facility, no further information available in ADEC Contaminated Sites database.
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-08	C	C	ADOT&PF Aniak Building 301, RecKey #1992250933502, Status: Active, DDT and petroleum contamination.
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-09	C	C	FAA Aniak Maintenance Building 200, RecKey #1992250933551, Status: Active, soils contaminated with GRO, DRO, RRO and possibly DDT and malathion.
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-10	C	C	Alaska Commercial Property Aniak, RecKey #1994250109003, Status: Inactive, DRO and GRO contamination.
Open Leaking Underground Fuel Storage Tank (LUST) Sites	U07	U07-02	C	C	FAA Aniak DF, RecKey #1995250022901, Event ID 2003, Facility ID 1362, nonregulated petroleum UST and AST leaked near FAA Shop Building 200.
Airports	X14	X14-03	C	C	
Medical/veterinary facilities (doctor or dentist offices, hospitals, nursing homes)	X40	X40-01	C	C	

**Table 2**

*Contaminant Source Inventory and Risk Ranking for  
KSD Joe Parent Voc. Ed. Center  
Sources of Bacteria and Viruses*

*PWSID 271716.001*

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Domestic wastewater collection systems (sewer line or lift stations)	D01	D01-01	B	Medium	C	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-01	C	High	C	FAA Aniak Directional Finder
Medical/veterinary facilities (doctor or dentist offices, hospitals, nursing homes)	X40	X40-01	C	Medium	C	



Table 3

*Contaminant Source Inventory and Risk Ranking for  
KSD Joe Parent Voc. Ed. Center  
Sources of Nitrates/Nitrites*

PWSID 271716.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Airports	X14	X14-01	A	Low	C	
Domestic wastewater collection systems (sewer line or lift stations)	D01	D01-01	B	Medium	C	
Airports	X14	X14-02	B	Low	C	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-01	C	High	C	FAA Aniak Directional Finder
Airports	X14	X14-03	C	Low	C	
Medical/veterinary facilities (doctor or dentist offices, hospitals, nursing homes)	X40	X40-01	C	Low	C	

Table 4

*Contaminant Source Inventory and Risk Ranking for  
KSD Joe Parent Voc. Ed. Center  
Sources of Volatile Organic Chemicals*

PWSID 271716.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Tanks, heating oil, nonresidential (aboveground)	T14	T14-01	A	Low	C	Aniak Propane Sales
Tanks, heating oil, nonresidential (aboveground)	T14	T14-02	A	Low	C	Diamond Willow Café
Tanks, heating oil, nonresidential (aboveground)	T14	T14-03	A	Low	C	George Givot Shop
Tanks, heating oil, nonresidential (aboveground)	T14	T14-04	A	Low	C	Sanbiel Step & Shop
Tanks, heating oil, nonresidential (aboveground)	T14	T14-05	A	Low	C	Catholic Church
Tanks, heating oil, nonresidential (aboveground)	T14	T14-06	A	Low	C	Aniak Traditional Council
Tanks, heating oil, nonresidential (aboveground)	T14	T14-07	A	Low	C	KSD Office
Tanks, heating oil, nonresidential (aboveground)	T14	T14-08	A	Low	C	Post Office
Tanks, heating oil, nonresidential (aboveground)	T14	T14-09	A	Low	C	Aniak Middle School
Airports	X14	X14-01	A	High	C	
Domestic wastewater collection systems (sewer line or lift stations)	D01	D01-01	B	Low	C	
Closed tanks, gasoline (underground)	T13	T13-01	B	Medium	C	Mark Air Aniak Station
Tanks, heating oil, nonresidential (aboveground)	T14	T14-10	B	Low	C	Aniak Light & Power
Tanks, heating oil, nonresidential (aboveground)	T14	T14-11	B	Low	C	Aniak Power House
Tanks, heating oil, nonresidential (aboveground)	T14	T14-12	B	Low	C	AC Store
Tanks, heating oil, nonresidential (aboveground)	T14	T14-13	B	Low	C	Bush-Tell
Tanks, heating oil, nonresidential (aboveground)	T14	T14-14	B	Low	C	Assembly of God Church
Tanks, heating oil, nonresidential (aboveground)	T14	T14-15	B	Low	C	Old Community Hall
Tanks, heating oil, nonresidential (aboveground)	T14	T14-16	B	Low	C	Fire Station
Tanks, heating oil, nonresidential (aboveground)	T14	T14-17	B	Low	C	Library
Tanks, heating oil, nonresidential (aboveground)	T14	T14-18	B	Low	C	Aniak City Office
Tanks, heating oil, nonresidential (aboveground)	T14	T14-19	B	Low	C	Alascom
Tanks, heating oil, nonresidential (aboveground)	T14	T14-20	B	Low	C	Aniak High School

Table 4 (continued)

*Contaminant Source Inventory and Risk Ranking for  
KSD Joe Parent Voc. Ed. Center  
Sources of Volatile Organic Chemicals*

PWSID 271716.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Tanks, heating oil, nonresidential (aboveground)	T14	T14-21	B	Low	C	Auntie Mary Nicoli Elementary
Contaminated sites, DEC recognized, non-Superfund non-RCRA	U04	U04-01	B	High	C	Aniak White Alice Site, RecKey #1989250902506, Status: Active, the Air Force White Alice Communications site operated from 1955 to 1979, has been converted to middle school, contaminants of concern are PCBs and petroleum hydrocarbons.
Contaminated sites, DEC recognized, non-Superfund non-RCRA	U04	U04-02	B	High	C	Mark Air, RecKey #1992250119301, Status: Active, soils with high concentrations of BTEX, GRO and DRO were found at the base and north of the former 2,000-gallon Avgas UST excavation.
Contaminated sites, DEC recognized, non-Superfund non-RCRA	U04	U04-03	B	High	C	ADOT&PF Aniak Maintenance Station, RecKey #1993250104007, Status Active, leaking fuel from storage and transfer system
Contaminated sites, DEC recognized, non-Superfund non-RCRA	U04	U04-04	B	High	C	ADOT&PF Aniak Runway Apron, RecKey #1994250127201, Status: Active, contaminated soils discovered on runway apron.
Contaminated sites, DEC recognized, non-Superfund non-RCRA	U04	U04-05	B	High	C	Aniak Apartments, RecKey #1995250126801, Status: Closed, four 500-gal LUSTs removed, approximately 65 cubic yards of soil removed.
Contaminated sites, DEC recognized, non-Superfund non-RCRA	U04	U04-06	B	High	C	ADOT&PF Aniak City Shop Building, RecKey #1996250114201, Status: Active, stained soils noted due to area that was used as a garage/maintenance station.
Open Leaking Underground Fuel Storage Tank (LUST) Sites	U07	U07-01	B	High	C	Mark Air Aniak, RecKey #1992250019301, Event ID 656, Facility ID 13' fuel line that supplies Jet A to an AST was found to be leaking. Petroleum contamination found in a sewer line extending from Mark Air to lift station.
Petroleum product bulk station/terminals	X11	X11-01	B	Very High	C	Yukon Fuels
Petroleum product bulk station/terminals	X11	X11-02	B	Very High	C	Tank Farm Area A
Airports	X14	X14-02	B	High	C	
Electric power generation (fossil fuels)	X36	X36-01	B	Medium	C	Aniak Light & Power
Electric power generation (fossil fuels)	X36	X36-02	B	Medium	C	Aniak Power House
Firehouses	X38	X38-01	B	Low	C	
Motor /motor vehicle repair shops	C31	C31-01	C	Medium	C	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-01	C	Low	C	FAA Aniak Directional Finder
Tanks, heating oil, nonresidential (aboveground)	T14	T14-22	C	Low	C	Clinic
Tanks, heating oil, nonresidential (aboveground)	T14	T14-23	C	Low	C	State of Alaska Office

*Contaminant Source Inventory and Risk Ranking for  
KSD Joe Parent Voc. Ed. Center  
Sources of Volatile Organic Chemicals*

*PWSID 271716.001*

*Table 4 (continued)*

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Tanks, heating oil, nonresidential (aboveground)	T14	T14-24	C	Low	C	State Troopers Office
Contaminated sites, DEC recognized, non-Superfund non-RCRA	U04	U04-07	C	High	C	FAA Aniak Rural Communication Facility, no further information available in ADEC Contaminated Sites database.
Contaminated sites, DEC recognized, non-Superfund non-RCRA	U04	U04-08	C	High	C	ADOT&PF Aniak Building 301, RecKey #1992250933502, Status: Active DDT and petroleum contamination.
Contaminated sites, DEC recognized, non-Superfund non-RCRA	U04	U04-09	C	High	C	FAA Aniak Maintenance Building 200, RecKey #1992250933551, Status: Active, soils contaminated with GRO, DRO, RRO and possibly DDT and malathion.
Contaminated sites, DEC recognized, non-Superfund non-RCRA	U04	U04-10	C	High	C	Alaska Commercial Property Aniak, RecKey #1994250109003, Status: Inactive, DRO and GRO contamination.
Open Leaking Underground Fuel Storage Tank (LUST) Sites	U07	U07-02	C	High	C	FAA Aniak DF, RecKey #1995250022901, Event ID 2003, Facility ID 13 nonregulated petroleum UST and AST leaked near FAA Shop Building 200.
Airports	X14	X14-03	C	High	C	
Medical/veterinary facilities (doctor or dentist offices, hospitals, nursing homes)	X40	X40-01	C	Low	C	

Table 5

*Contaminant Source Inventory and Risk Ranking for  
KSD Joe Parent Voc. Ed. Center  
Sources of Heavy Metals, Cyanide and Other Inorganic Chemicals*

PWSID 271716.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Tanks, heating oil, nonresidential (aboveground)	T14	T14-01	A	Low	C	Aniak Propane Sales
Tanks, heating oil, nonresidential (aboveground)	T14	T14-02	A	Low	C	Diamond Willow Café
Tanks, heating oil, nonresidential (aboveground)	T14	T14-03	A	Low	C	George Givot Shop
Tanks, heating oil, nonresidential (aboveground)	T14	T14-04	A	Low	C	Sanbiel Step & Shop
Tanks, heating oil, nonresidential (aboveground)	T14	T14-05	A	Low	C	Catholic Church
Tanks, heating oil, nonresidential (aboveground)	T14	T14-06	A	Low	C	Aniak Traditional Council
Tanks, heating oil, nonresidential (aboveground)	T14	T14-07	A	Low	C	KSD Office
Tanks, heating oil, nonresidential (aboveground)	T14	T14-08	A	Low	C	Post Office
Tanks, heating oil, nonresidential (aboveground)	T14	T14-09	A	Low	C	Aniak Middle School
Airports	X14	X14-01	A	Low	C	
Domestic wastewater collection systems (sewer line or lift stations)	D01	D01-01	B	Low	C	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-10	B	Low	C	Aniak Light & Power
Tanks, heating oil, nonresidential (aboveground)	T14	T14-11	B	Low	C	Aniak Power House
Tanks, heating oil, nonresidential (aboveground)	T14	T14-12	B	Low	C	AC Store
Tanks, heating oil, nonresidential (aboveground)	T14	T14-13	B	Low	C	Bush-Tell
Tanks, heating oil, nonresidential (aboveground)	T14	T14-14	B	Low	C	Assembly of God Church
Tanks, heating oil, nonresidential (aboveground)	T14	T14-15	B	Low	C	Old Community Hall
Tanks, heating oil, nonresidential (aboveground)	T14	T14-16	B	Low	C	Fire Station
Tanks, heating oil, nonresidential (aboveground)	T14	T14-17	B	Low	C	Library
Tanks, heating oil, nonresidential (aboveground)	T14	T14-18	B	Low	C	Aniak City Office
Tanks, heating oil, nonresidential (aboveground)	T14	T14-19	B	Low	C	Alascom
Tanks, heating oil, nonresidential (aboveground)	T14	T14-20	B	Low	C	Aniak High School
Tanks, heating oil, nonresidential (aboveground)	T14	T14-21	B	Low	C	Auntie Mary Nicoli Elementary

*Contaminant Source Inventory and Risk Ranking for  
KSD Joe Parent Voc. Ed. Center*

*PWSID 271716.001*

*Table 5 (continued)*

*Sources of Heavy Metals, Cyanide and Other Inorganic Chemicals*

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Contaminated sites, DEC recognized, non-Superfund non-RCRA	U04	U04-01	B	Low	C	Aniak White Alice Site, RecKey #1989250902506, Status: Active, the Air Force White Alice Communications site operated from 1955 to 1979, has been converted to middle school, contaminants of concern are PCBs and petroleum hydrocarbons.
Contaminated sites, DEC recognized, non-Superfund non-RCRA	U04	U04-02	B	Low	C	Mark Air, RecKey #1992250119301, Status: Active, soils with high concentrations of BTEX, GRO and DRO were found at the base and north of the former 2,000-gallon Avgas UST excavation.
Contaminated sites, DEC recognized, non-Superfund non-RCRA	U04	U04-03	B	Low	C	ADOT&PF Aniak Maintenance Station, RecKey #1993250104007, Status: Active, leaking fuel from storage and transfer system
Contaminated sites, DEC recognized, non-Superfund non-RCRA	U04	U04-04	B	Low	C	ADOT&PF Aniak Runway Apron, RecKey #1994250127201, Status: Active, contaminated soils discovered on runway apron.
Contaminated sites, DEC recognized, non-Superfund non-RCRA	U04	U04-05	B	Low	C	Aniak Apartments, RecKey #1995250126801, Status: Closed, four 500-gal LUSTs removed, approximately 65 cubic yards of soil removed.
Contaminated sites, DEC recognized, non-Superfund non-RCRA	U04	U04-06	B	Low	C	ADOT&PF Aniak City Shop Building, RecKey #1996250114201, Status: Active, stained soils noted due to area that was used as a garage/maintenance station.
Petroleum product bulk station/terminals	X11	X11-01	B	Low	C	Yukon Fuels
Petroleum product bulk station/terminals	X11	X11-02	B	Low	C	Tank Farm Area A
Airports	X14	X14-02	B	Low	C	
Electric power generation (fossil fuels)	X36	X36-01	B	Medium	C	Aniak Light & Power
Electric power generation (fossil fuels)	X36	X36-02	B	Medium	C	Aniak Power House
Firehouses	X38	X38-01	B	Low	C	
Motor /motor vehicle repair shops	C31	C31-01	C	Medium	C	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-01	C	Low	C	FAA Aniak Directional Finder
Tanks, heating oil, nonresidential (aboveground)	T14	T14-22	C	Low	C	Clinic
Tanks, heating oil, nonresidential (aboveground)	T14	T14-23	C	Low	C	State of Alaska Office
Tanks, heating oil, nonresidential (aboveground)	T14	T14-24	C	Low	C	State Troopers Office
Contaminated sites, DEC recognized, non-Superfund non-RCRA	U04	U04-07	C	Low	C	FAA Aniak Rural Communication Facility, no further information available in ADEC Contaminated Sites database.

Table 5 (continued)

*Contaminant Source Inventory and Risk Ranking for  
KSD Joe Parent Voc. Ed. Center  
Sources of Heavy Metals, Cyanide and Other Inorganic Chemicals*

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Contaminated sites, DEC recognized, non-Superfund non-RCRA	U04	U04-08	C	Low	C	ADOT&PF Aniak Building 301, RecKey #1992250933502, Status: Active DDT and petroleum contamination.
Contaminated sites, DEC recognized, non-Superfund non-RCRA	U04	U04-09	C	Low	C	FAA Aniak Maintenance Building 200, RecKey #1992250933551, Status: Active, soils contaminated with GRO, DRO, RRO and possibly DDT and malathion.
Contaminated sites, DEC recognized, non-Superfund non-RCRA	U04	U04-10	C	Low	C	Alaska Commercial Property Aniak, RecKey #1994250109003, Status: Inactive, DRO and GRO contamination.
Airports	X14	X14-03	C	Low	C	
Medical/veterinary facilities (doctor or dentist offices, hospitals, nursing homes)	X40	X40-01	C	Low	C	

*Contaminant Source Inventory and Risk Ranking for  
KSD Joe Parent Voc. Ed. Center  
Sources of Synthetic Organic Chemicals*

PWSID 271716.001

Table 6

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Airports	X14	X14-01	A	Medium	C	
Domestic wastewater collection systems (sewer line or lift stations)	D01	D01-01	B	Low	C	
Contaminated sites, DEC recognized, non-Superfund non-RCRA	U04	U04-01	B	Low	C	Aniak White Alice Site, RecKey #1989250902506, Status: Active, the Air Force White Alice Communications site operated from 1955 to 1979, has been converted to middle school, contaminants of concern are PCBs and petroleum hydrocarbons.
Contaminated sites, DEC recognized, non-Superfund non-RCRA	U04	U04-02	B	Low	C	Mark Air, RecKey #1992250119301, Status: Active, soils with high concentrations of BTEX, GRO and DRO were found at the base and north v of the former 2,000-gallon Avgas UST excavation.
Contaminated sites, DEC recognized, non-Superfund non-RCRA	U04	U04-03	B	Low	C	ADOT&PF Aniak Maintenance Station, RecKey #1993250104007, Status Active, leaking fuel from storage and transfer system
Contaminated sites, DEC recognized, non-Superfund non-RCRA	U04	U04-04	B	Low	C	ADOT&PF Aniak Runway Apron, RecKey #1994250127201, Status: Active, contaminated soils discovered on runway apron.
Contaminated sites, DEC recognized, non-Superfund non-RCRA	U04	U04-05	B	Low	C	Aniak Apartments, RecKey #1995250126801, Status: Closed, four 500-gal LUSTs removed, approximately 65 cubic yards of soil removed.
Contaminated sites, DEC recognized, non-Superfund non-RCRA	U04	U04-06	B	Low	C	ADOT&PF Aniak City Shop Building, RecKey #1996250114201, Status: Active, stained soils noted due to area that was used as a garage/maintenance station.
Open Leaking Underground Fuel Storage Tank (LUST) Sites	U07	U07-01	B	Low	C	Mark Air Aniak, RecKey #1992250019301, Event ID 656, Facility ID 13' fuel line that supplies Jet A to an AST was found to be leaking. Petroleum contamination found in a sewer line extending from Mark Air to lift station.
Petroleum product bulk station/terminals	X11	X11-01	B	Low	C	Yukon Fuels
Petroleum product bulk station/terminals	X11	X11-02	B	Low	C	Tank Farm Area A
Airports	X14	X14-02	B	Medium	C	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-01	C	Low	C	FAA Aniak Directional Finder
Contaminated sites, DEC recognized, non-Superfund non-RCRA	U04	U04-07	C	Low	C	FAA Aniak Rural Communication Facility, no further information available ADEC Contaminated Sites database.
Contaminated sites, DEC recognized, non-Superfund non-RCRA	U04	U04-08	C	Low	C	ADOT&PF Aniak Building 301, RecKey #1992250933502, Status: Active DDT and petroleum contamination.



*Contaminant Source Inventory and Risk Ranking for  
KSD Joe Parent Voc. Ed. Center  
Sources of Synthetic Organic Chemicals*

*PWSID 271716.001*

*Table 6 (continued)*

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Contaminated sites, DEC recognized, non-Superfund non-RCRA	U04	U04-09	C	Low	C	FAA Aniak Maintenance Building 200, RecKey #1992250933551, Status: Active, soils contaminated with GRO, DRO, RRO and possibly DDT and malathion.
Contaminated sites, DEC recognized, non-Superfund non-RCRA	U04	U04-10	C	Low	C	Alaska Commercial Property Aniak, RecKey #1994250109003, Status: Inactive, DRO and GRO contamination.
Open Leaking Underground Fuel Storage Tank (LUST) Sites	U07	U07-02	C	Low	C	FAA Aniak DF, RecKey #1995250022901, Event ID 2003, Facility ID 13 nonregulated petroleum UST and AST leaked near FAA Shop Building 200.
Airports	X14	X14-03	C	Medium	C	
Medical/veterinary facilities (doctor or dentist offices, hospitals, nursing homes)	X40	X40-01	C	Low	C	

*Contaminant Source Inventory and Risk Ranking for  
KSD Joe Parent Voc. Ed. Center  
Sources of Other Organic Chemicals*

PWSID 271716.001

Table 7

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Airports	X14	X14-01	A	Medium	C	
Domestic wastewater collection systems (sewer line or lift stations)	D01	D01-01	B	Low	C	
Contaminated sites, DEC recognized, non-Superfund non-RCRA	U04	U04-01	B	Low	C	Aniak White Alice Site, RecKey #1989250902506, Status: Active, the Air Force White Alice Communications site operated from 1955 to 1979, has been converted to middle school, contaminants of concern are PCBs and petroleum hydrocarbons.
Contaminated sites, DEC recognized, non-Superfund non-RCRA	U04	U04-02	B	Low	C	Mark Air, RecKey #1992250119301, Status: Active, soils with high concentrations of BTEX, GRO and DRO were found at the base and north of the former 2,000-gallon Avgas UST excavation.
Contaminated sites, DEC recognized, non-Superfund non-RCRA	U04	U04-03	B	Low	C	ADOT&PF Aniak Maintenance Station, RecKey #1993250104007, Status Active, leaking fuel from storage and transfer system
Contaminated sites, DEC recognized, non-Superfund non-RCRA	U04	U04-04	B	Low	C	ADOT&PF Aniak Runway Apron, RecKey #1994250127201, Status: Active, contaminated soils discovered on runway apron.
Contaminated sites, DEC recognized, non-Superfund non-RCRA	U04	U04-05	B	Low	C	Aniak Apartments, RecKey #1995250126801, Status: Closed, four 500-gal LUSTs removed, approximately 65 cubic yards of soil removed.
Contaminated sites, DEC recognized, non-Superfund non-RCRA	U04	U04-06	B	Low	C	ADOT&PF Aniak City Shop Building, RecKey #1996250114201, Status: Active, stained soils noted due to area that was used as a garage/maintenance station.
Open Leaking Underground Fuel Storage Tank (LUST) Sites	U07	U07-01	B	Low	C	Mark Air Aniak, RecKey #1992250019301, Event ID 656, Facility ID 13' fuel line that supplies Jet A to an AST was found to be leaking. Petroleum contamination found in a sewer line extending from Mark Air to lift station.
Petroleum product bulk station/terminals	X11	X11-01	B	High	C	Yukon Fuels
Petroleum product bulk station/terminals	X11	X11-02	B	High	C	Tank Farm Area A
Airports	X14	X14-02	B	Medium	C	
Electric power generation (fossil fuels)	X36	X36-01	B	High	C	Aniak Light & Power
Electric power generation (fossil fuels)	X36	X36-02	B	High	C	Aniak Power House
Motor /motor vehicle repair shops	C31	C31-01	C	Medium	C	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-01	C	Low	C	FAA Aniak Directional Finder
Contaminated sites, DEC recognized, non-Superfund non-RCRA	U04	U04-07	C	Low	C	FAA Aniak Rural Communication Facility, no further information available in ADEC Contaminated Sites database.

*Contaminant Source Inventory and Risk Ranking for  
KSD Joe Parent Voc. Ed. Center  
Sources of Other Organic Chemicals*

*PWSID 271716.001*


*Table 7 (continued)*

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Contaminated sites, DEC recognized, non-Superfund non-RCRA	U04	U04-08	C	Low	C	ADOT&PF Aniak Building 301, RecKey #1992250933502, Status: Active DDT and petroleum contamination.
Contaminated sites, DEC recognized, non-Superfund non-RCRA	U04	U04-09	C	Low	C	FAA Aniak Maintenance Building 200, RecKey #1992250933551, Status: Active, soils contaminated with GRO, DRO, RRO and possibly DDT and malathion.
Contaminated sites, DEC recognized, non-Superfund non-RCRA	U04	U04-10	C	Low	C	Alaska Commercial Property Aniak, RecKey #1994250109003, Status: Inactive, DRO and GRO contamination.
Open Leaking Underground Fuel Storage Tank (LUST) Sites	U07	U07-02	C	Low	C	FAA Aniak DF, RecKey #1995250022901, Event ID 2003, Facility ID 13 nonregulated petroleum UST and AST leaked near FAA Shop Building 200.
Airports	X14	X14-03	C	Medium	C	

## **APPENDIX C**

### **Drinking Water Protection Area and Potential and Existing Contaminant Sources (Map C)**

**Public Water Well System for PWS #271716.001 KSD Joe Parent Voc. Ed. Center  
Showing Potential and Existing Sources of Contamination**


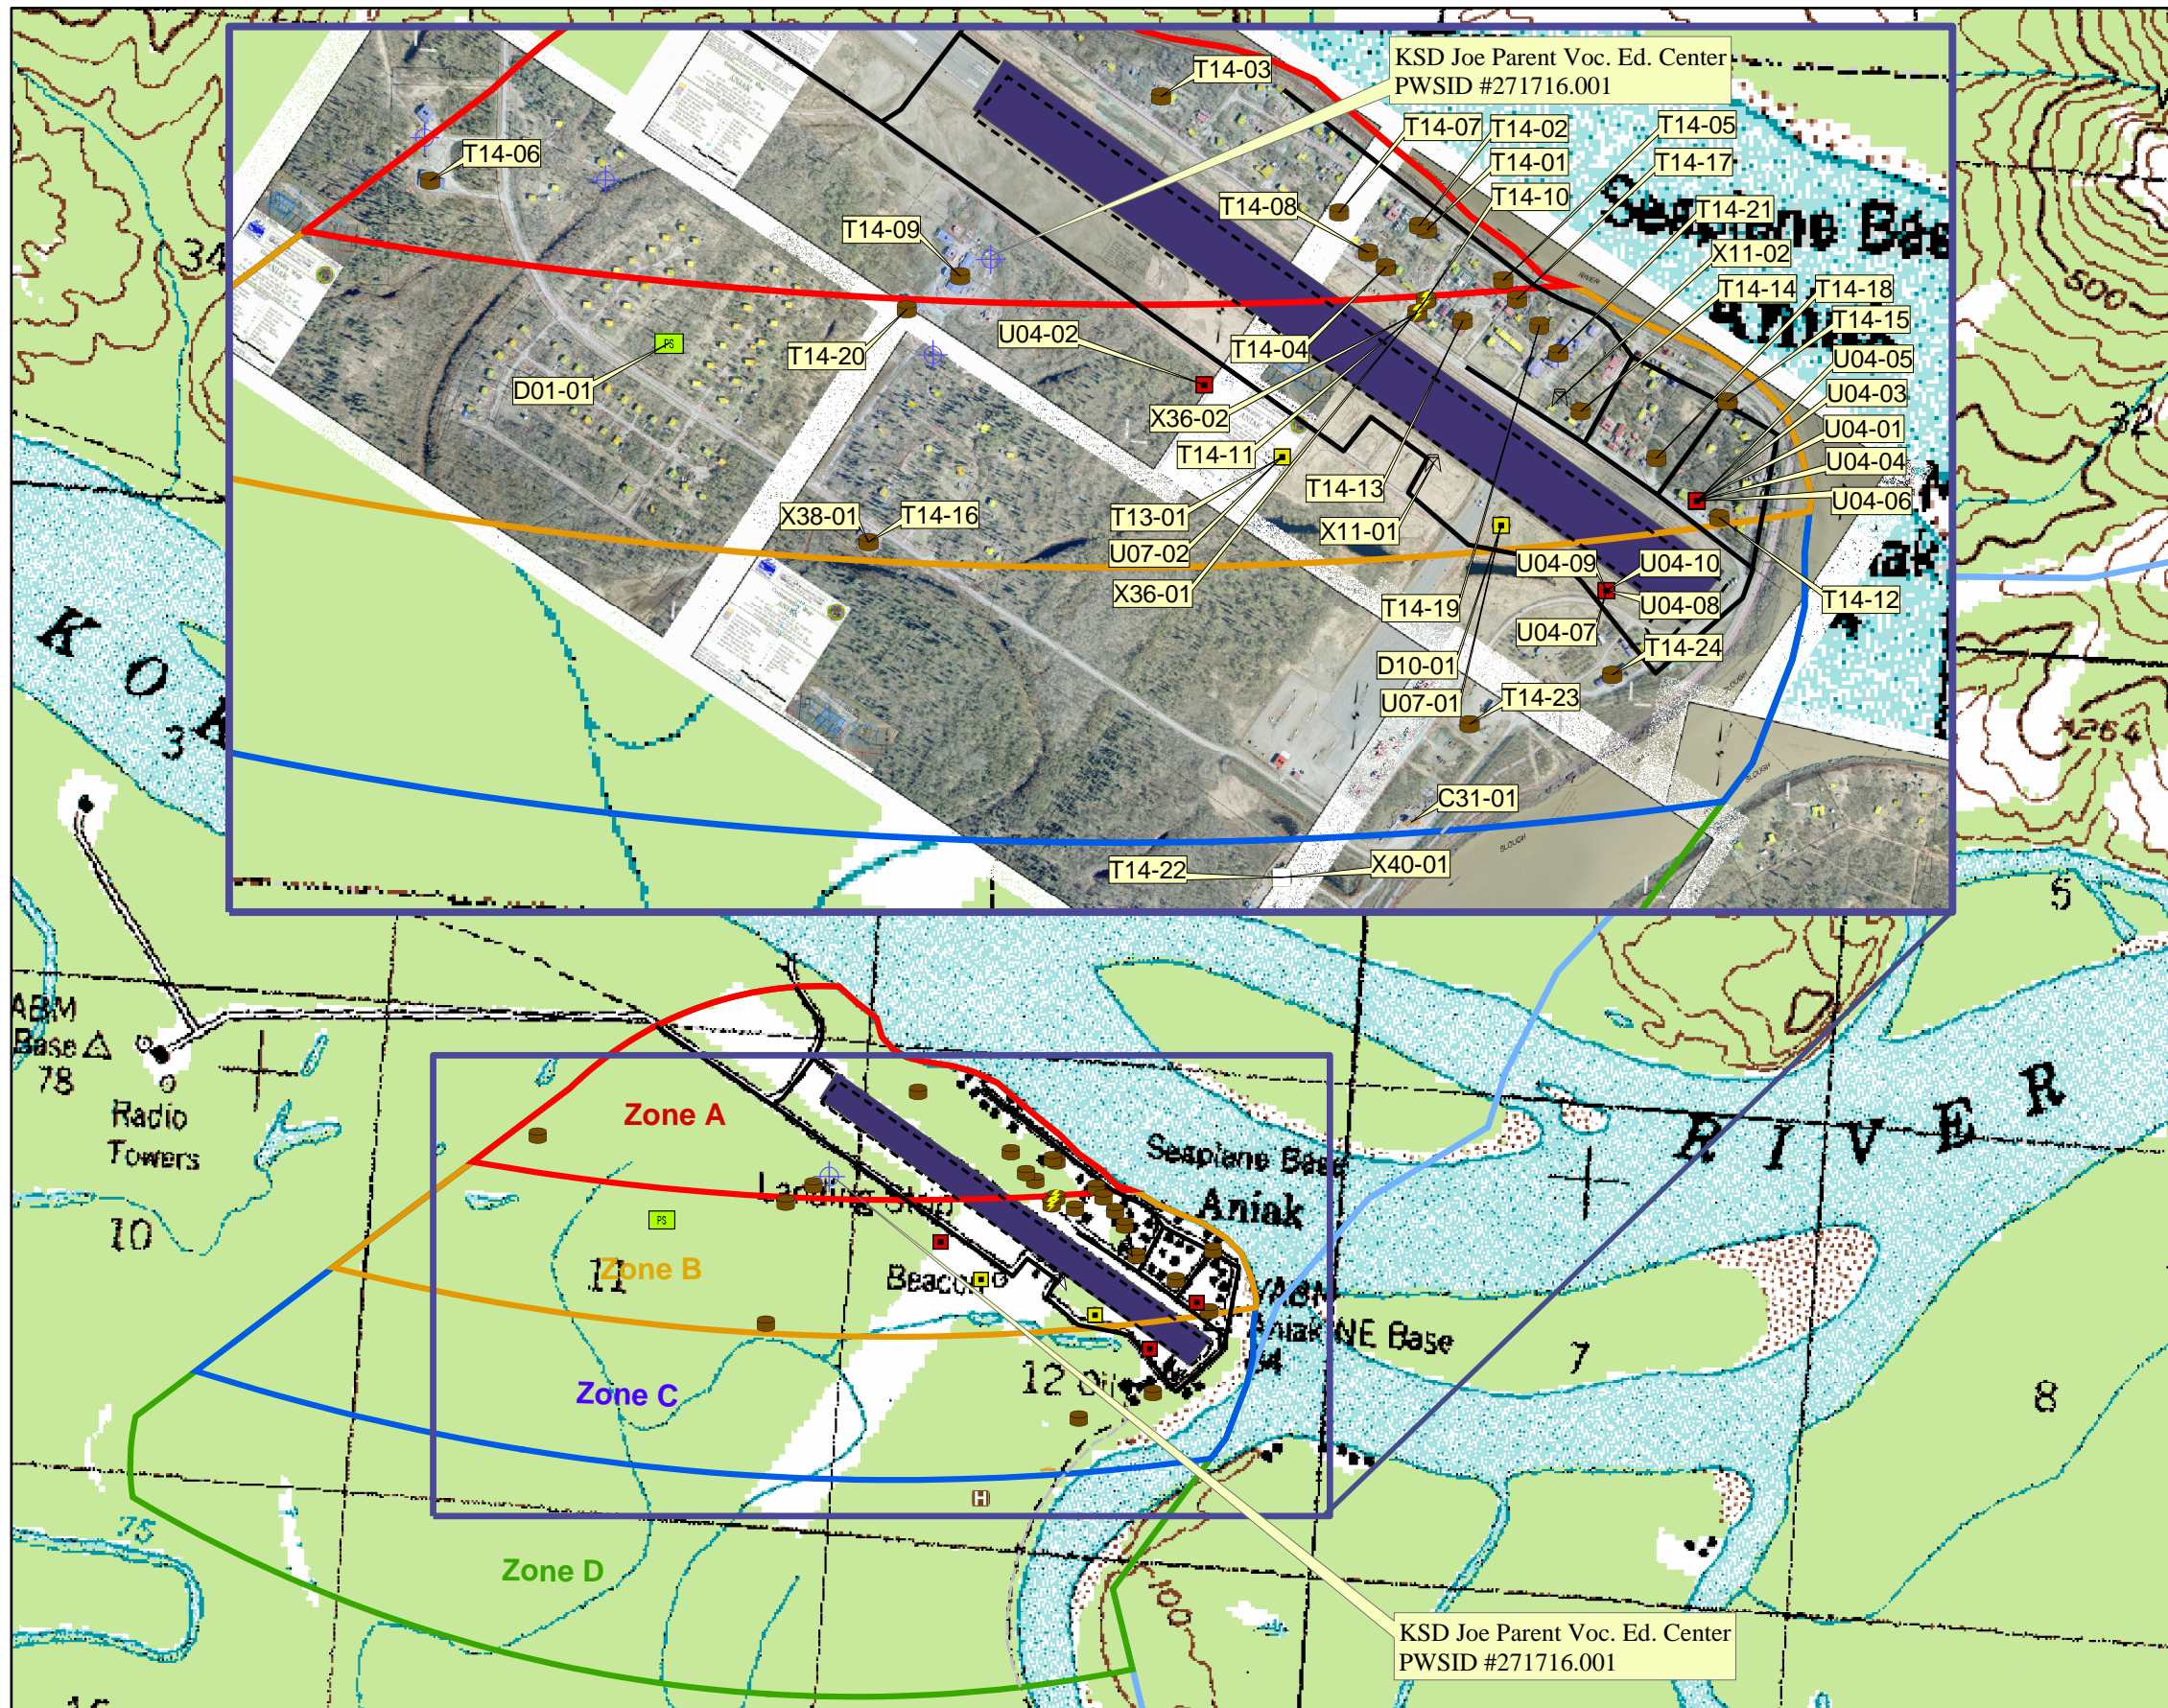


**LEGEND**

- Public Water System Well
- Groundwater Protection Zones**
  - Zone A – Several Months Travel Time
  - Zone B – Less Than 2 Years Travel Time
  - Zone C – Less Than 5 Years Travel Time
  - Zone D – Less Than 10 Years Travel Time
- Hydrography/Physical**
  - Parcels
  - Stream
  - Lake or Pond
  - Contours
  - Watershed Boundary
- Transportation**
  - Primary Route (Class 1)
  - Secondary Route (Class 2)
  - Road (Class 3)
  - Road (Class 4)
  - Road (Class 5, Four-wheel drive)
  - Road Ferry Crossing
- Existing or Potential Contaminant Sources**
  - Motor/motor vehicle repair shops (C31)
  - Domestic wastewater collection systems (sewer lines or lift stations) (D01)
  - Injection Wells (Class V) Large Capacity Septic System (D10)
  - Closed tanks, gasoline (underground) (T13)
  - Tanks, heating oil, nonresidential (aboveground) (T14)
  - Contaminated sites, DEC recognized, non-Superfund, non-RCRA (U04)
  - Open Leaking Underground Storage Tank (LUST) (lubricants or other petroleum products) (U07)
  - Petroleum product bulk station/terminals (X11)
  - Electric power generation (fossil fuels) (X36)
  - Firehouses (X38)
  - Medical/veterinary facilities (X40)
  - Airport or landing strip (X14)

**Data Sources:**  
 - Contaminant Sources, Public Water System Wells, Contours  
 - Alaska Department of Environmental Conservation (ADEC)  
 - Critical Facilities, Federal Emergency Management Agency (FEMA)  
**All other data:**  
 - United States Geological Survey (USGS)  
 - Drinking Water Protection Areas based on "Alaska Drinking Water Protection Program - Guidance Manual for Class A Public Water Systems" published by ADEC


URS Corporation does not guarantee the accuracy or validity of the data provided.

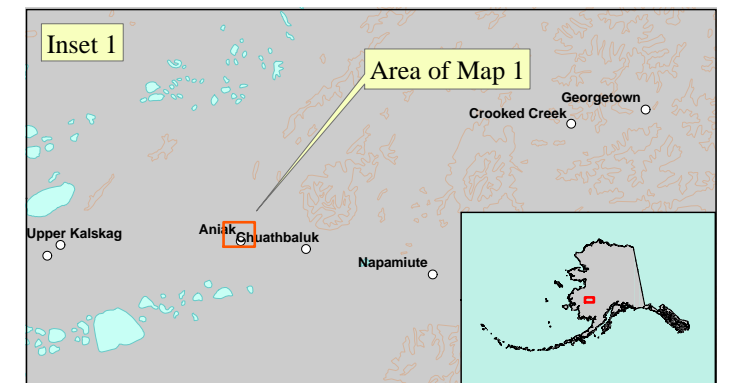


## **APPENDIX D**

### **Vulnerability Analysis for Public Drinking Water Source (Charts 1-14)**

**Chart 1. Susceptibility of the wellhead - KSD Joe Parent Voc. Ed. Center (PWS No. 271716.001)**

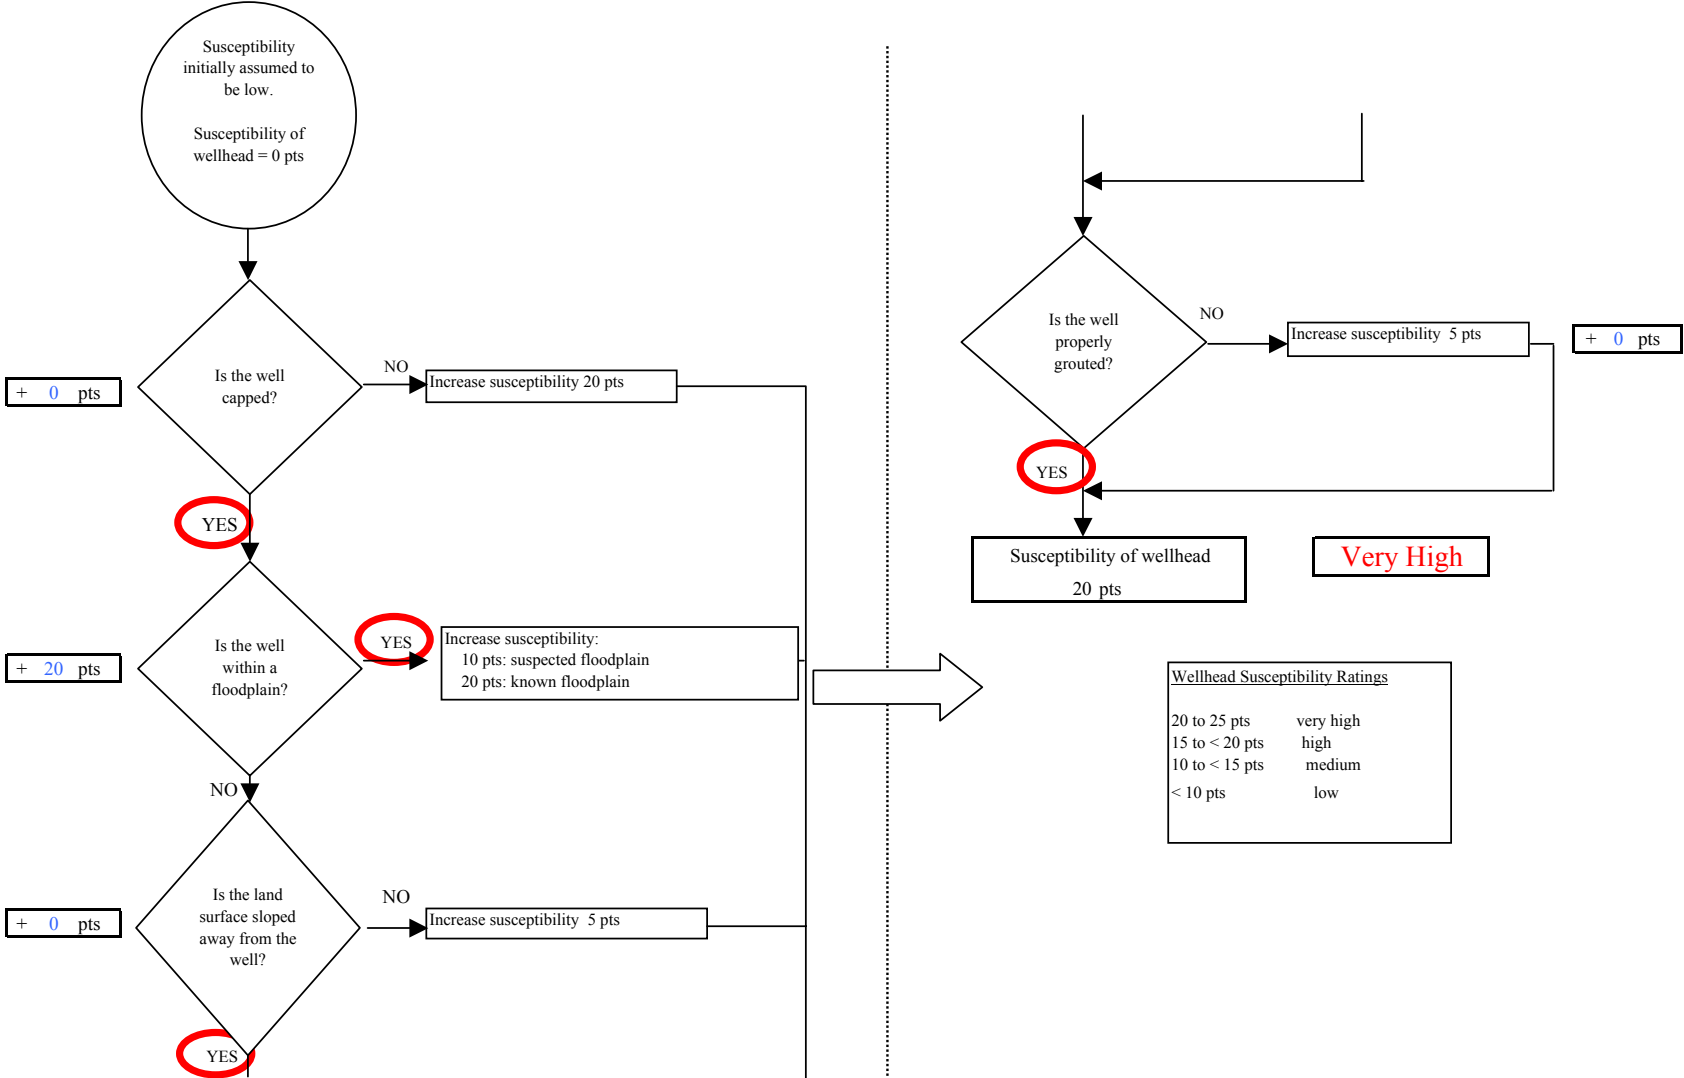


**Chart 2. Susceptibility of the aquifer KSD Joe Parent Voc. Ed. Center (PWS No. 271716.001)**

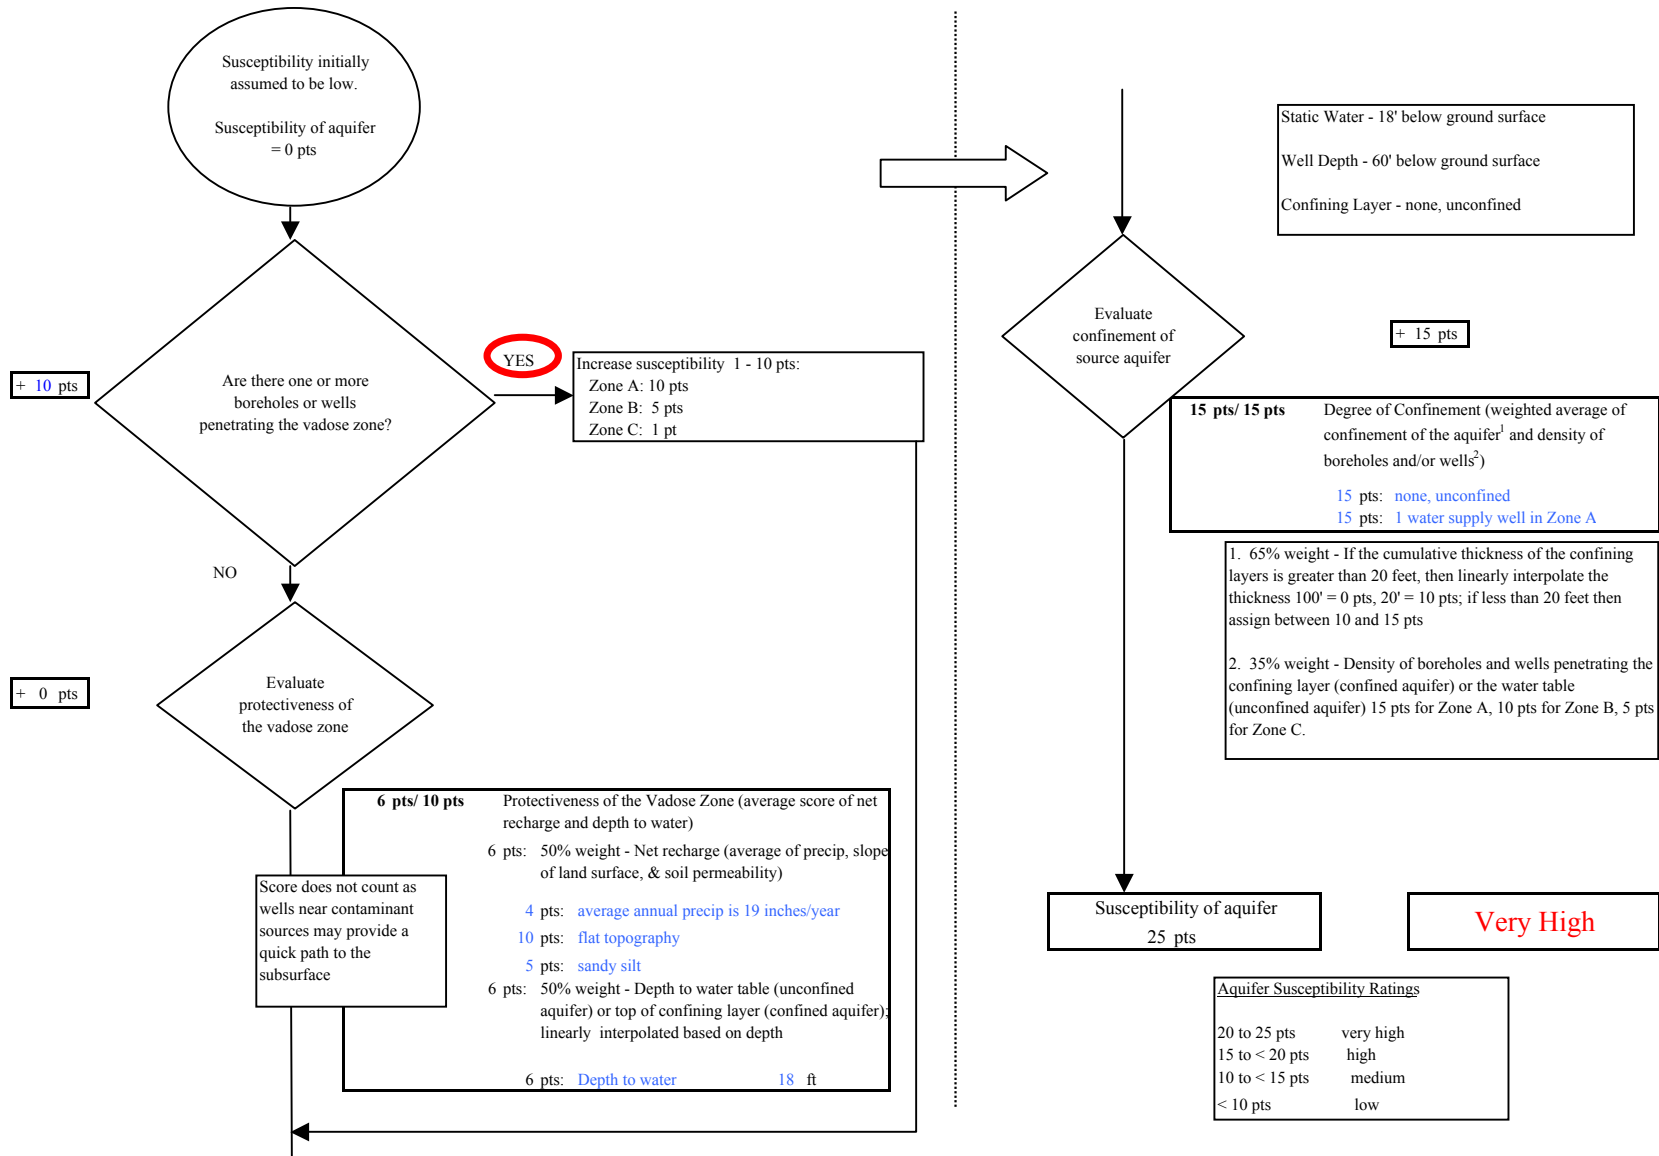




**Chart 3. Contaminant risks for KSD Joe Parent Voc. Ed. Center (PWS No. 271716.001) - Bacteria & Viruses**

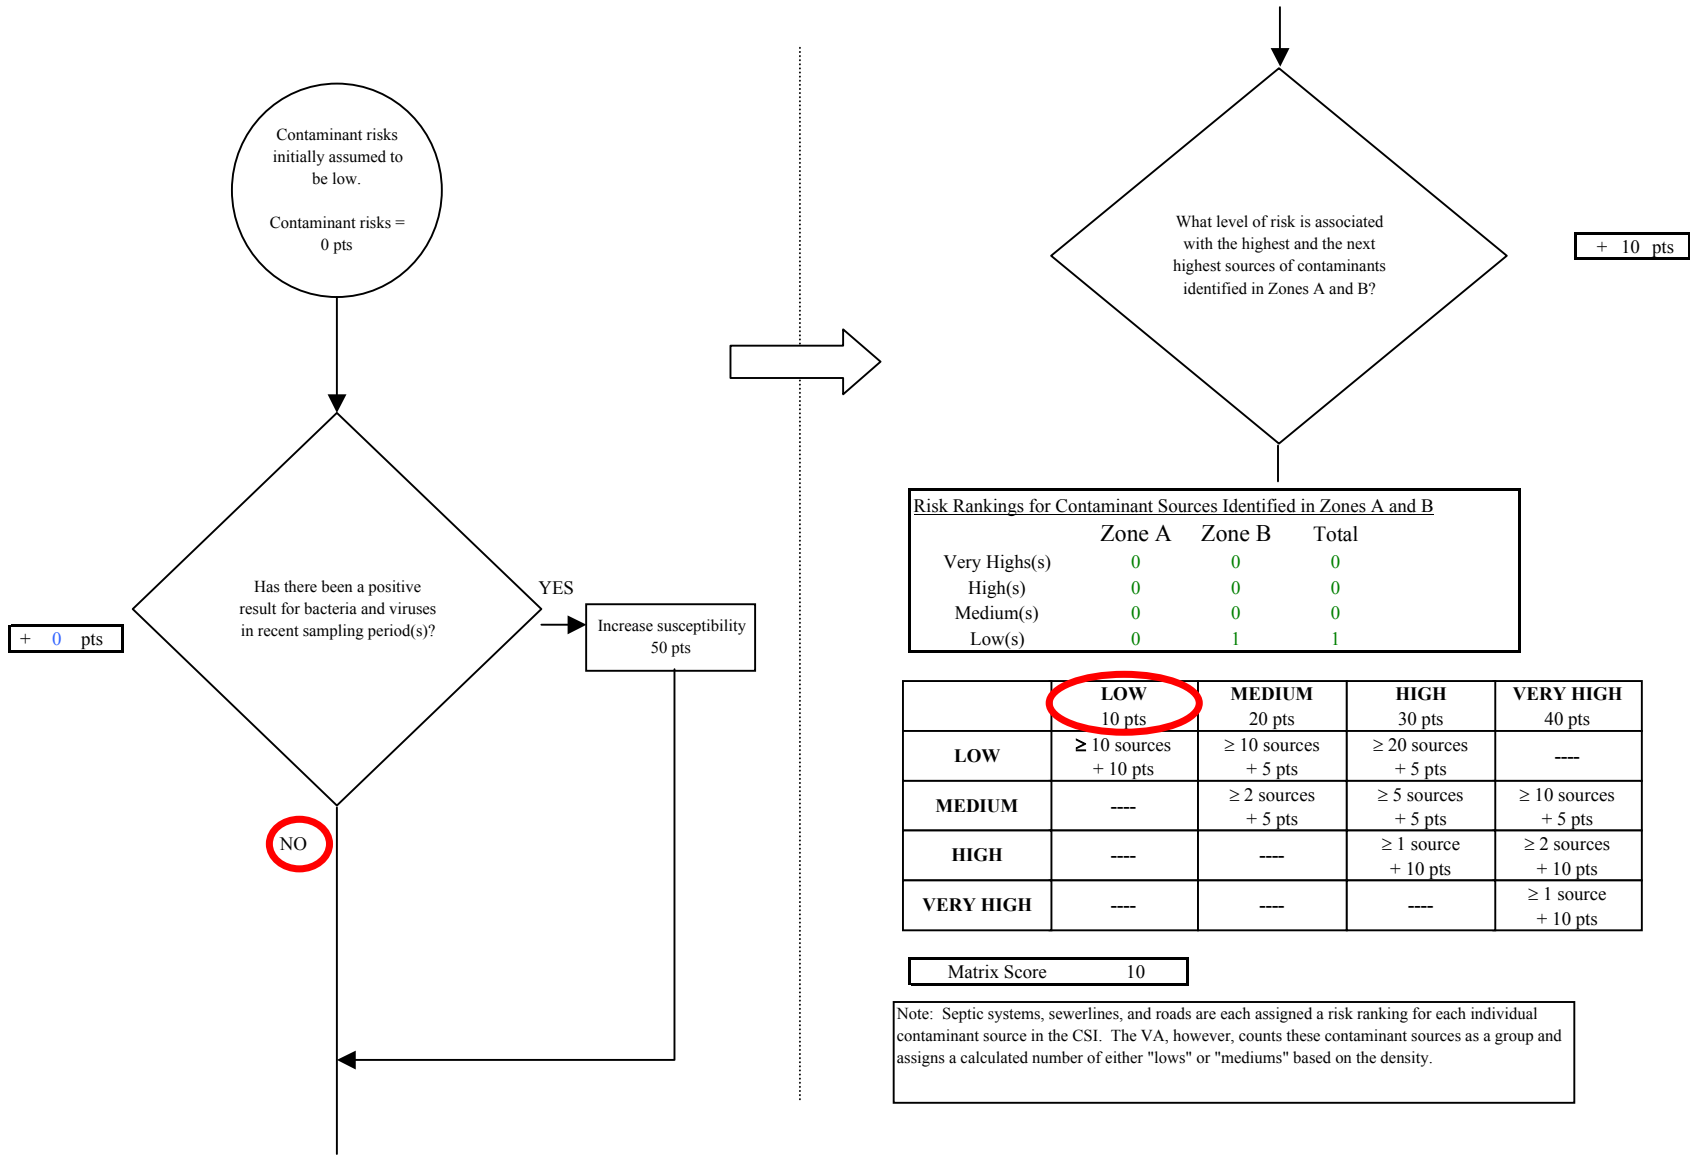

**Chart 3. Contaminant risks for KSD Joe Parent Voc. Ed. Center (PWS No. 271716.001) - Bacteria & Viruses**

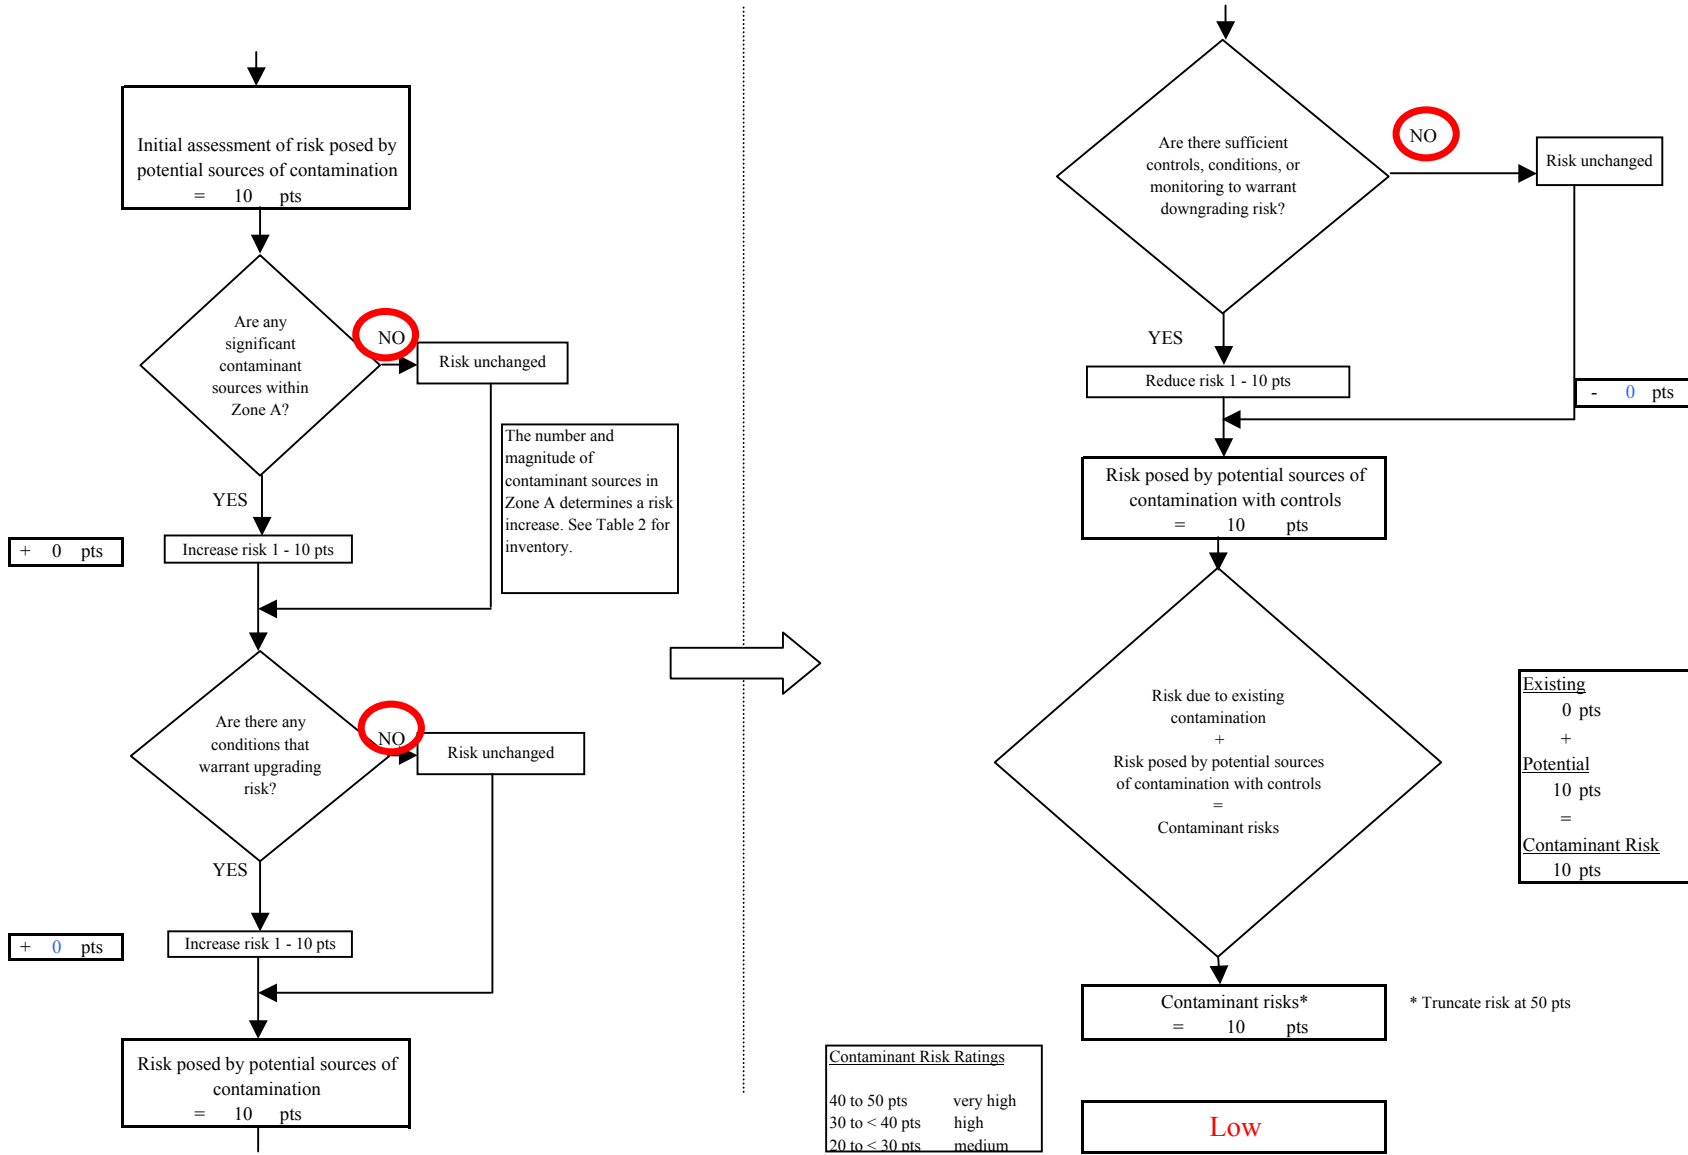

**Chart 4. Vulnerability analysis for KSD Joe Parent Voc. Ed. Center (PWS No. 271716.001) - Bacteria & Viruses**

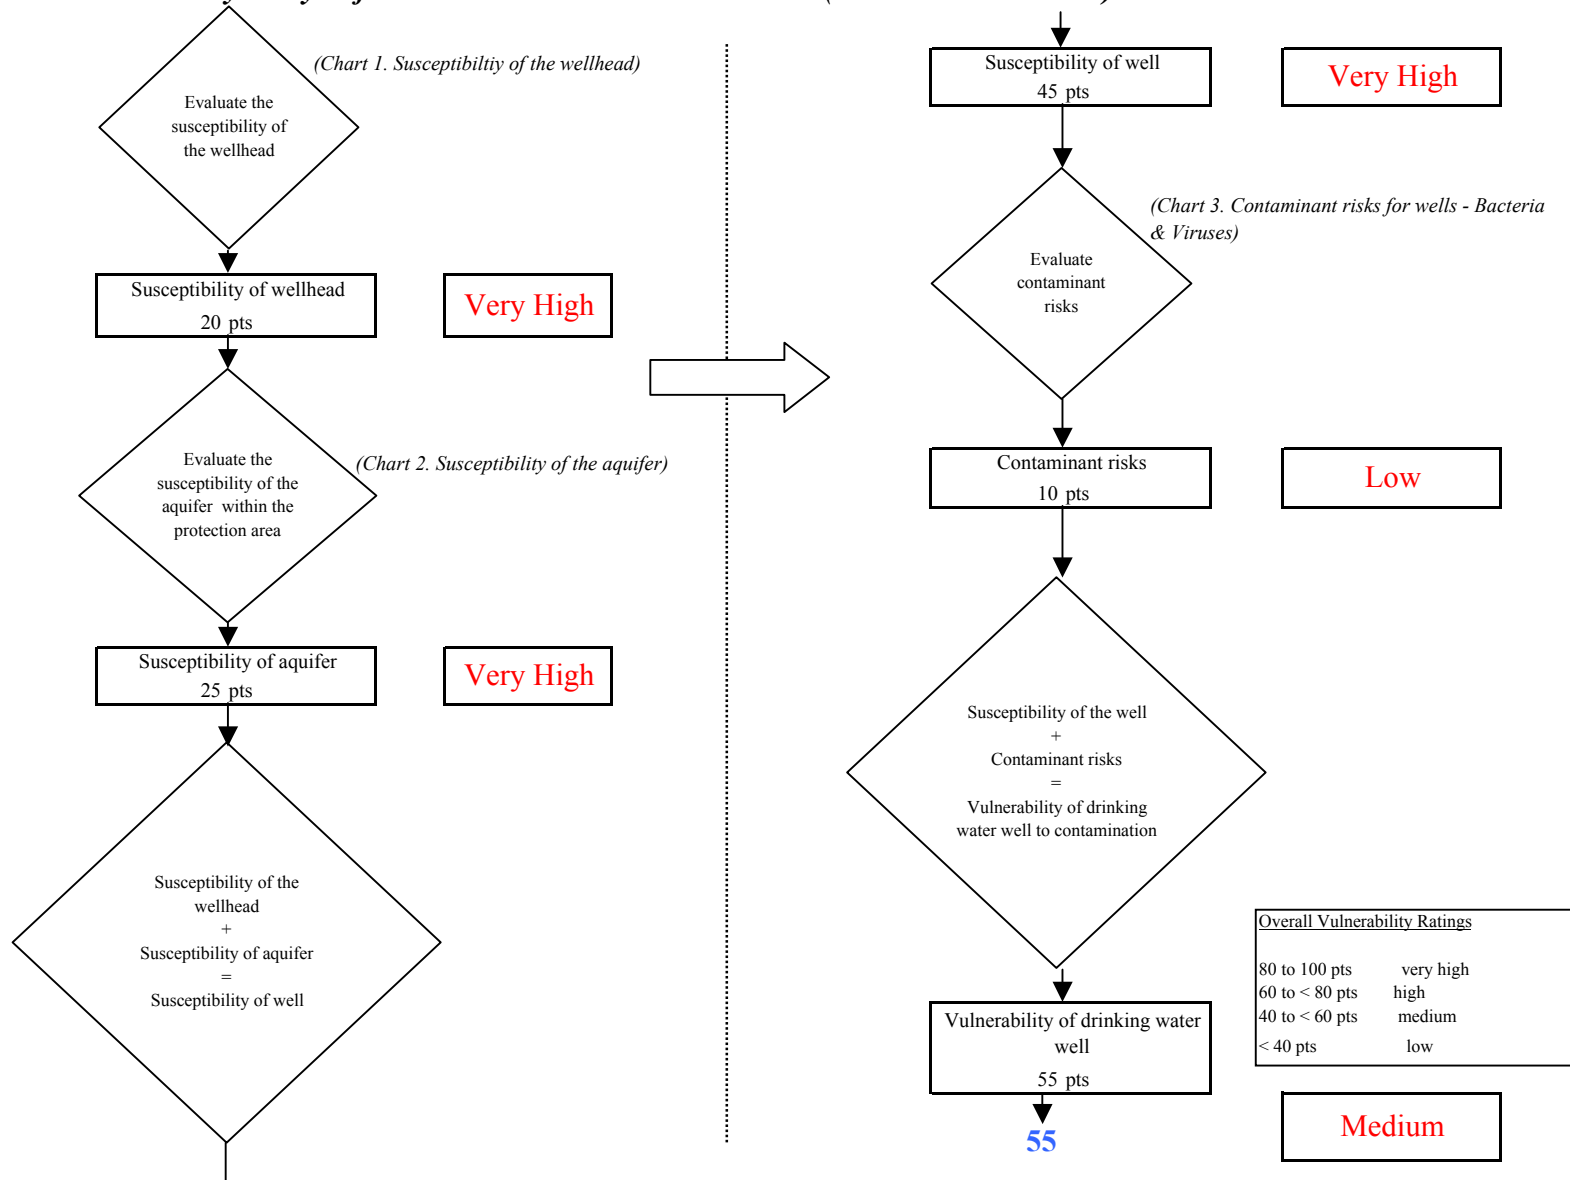


Chart 5. Contaminant risks for KSD Joe Parent Voc. Ed. Center (PWS No. 271716.001) - Nitrates and Nitrites





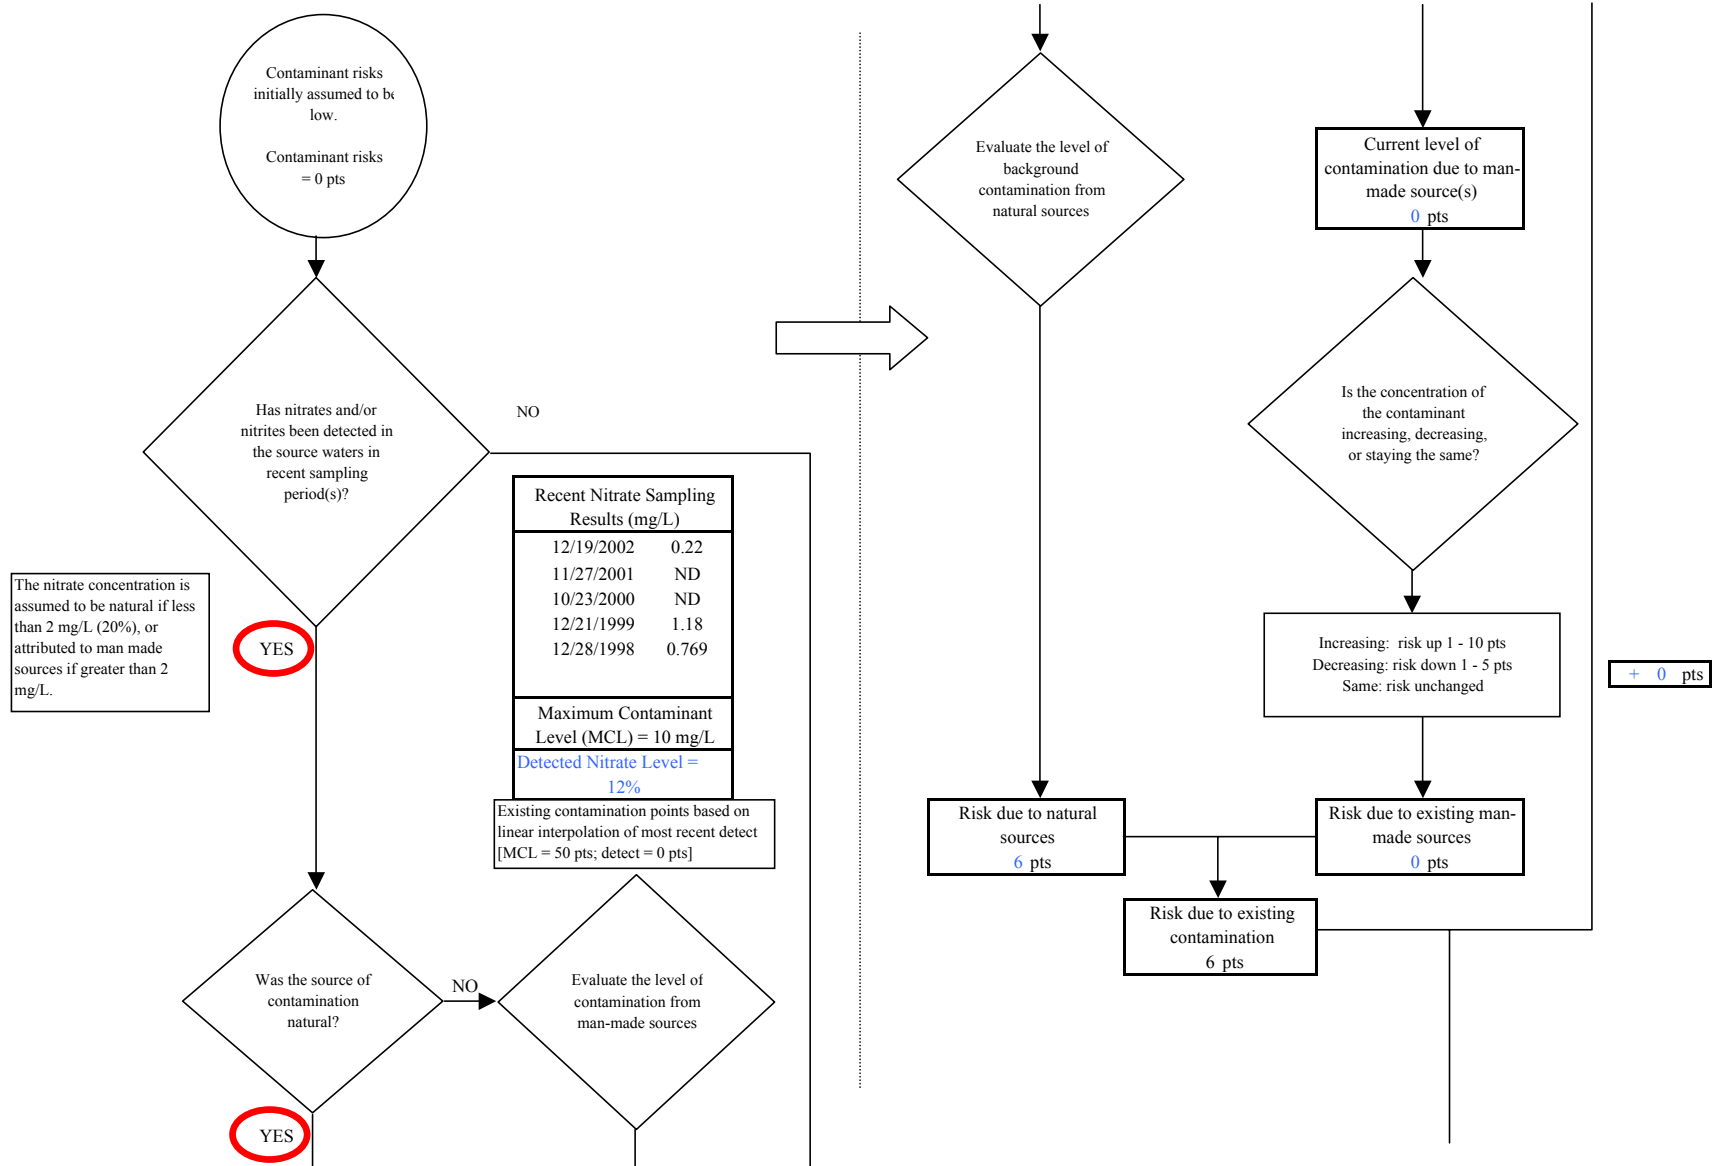



Chart 5. Contaminant risks for KSD Joe Parent Voc. Ed. Center (PWS No. 271716.001) - Nitrates and Nitrites

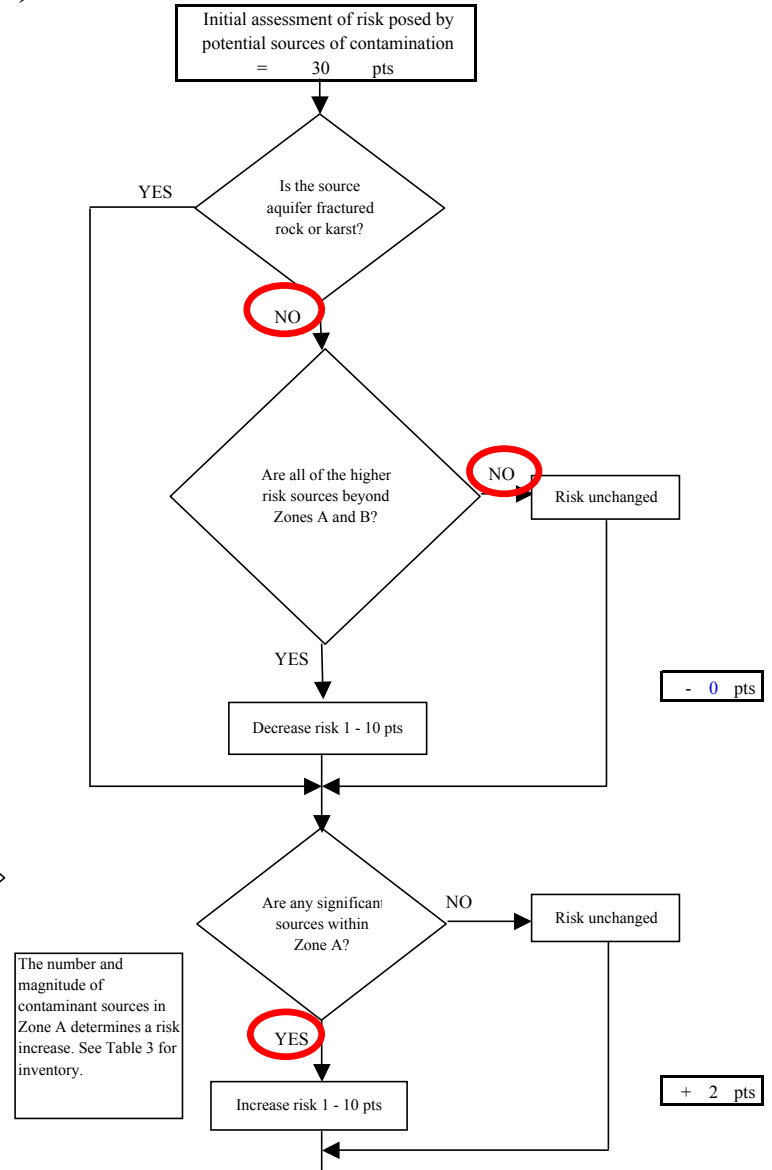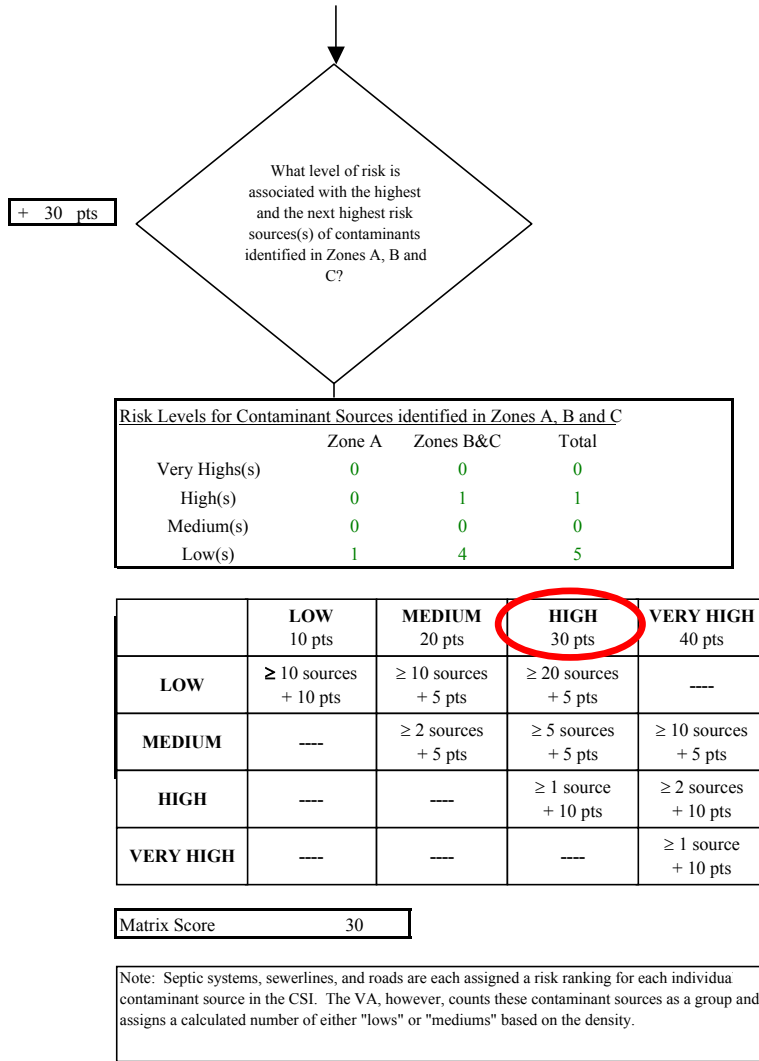

**Chart 5. Contaminant risks for KSD Joe Parent Voc. Ed. Center (PWS No. 271716.001) - Nitrates and Nitrites**

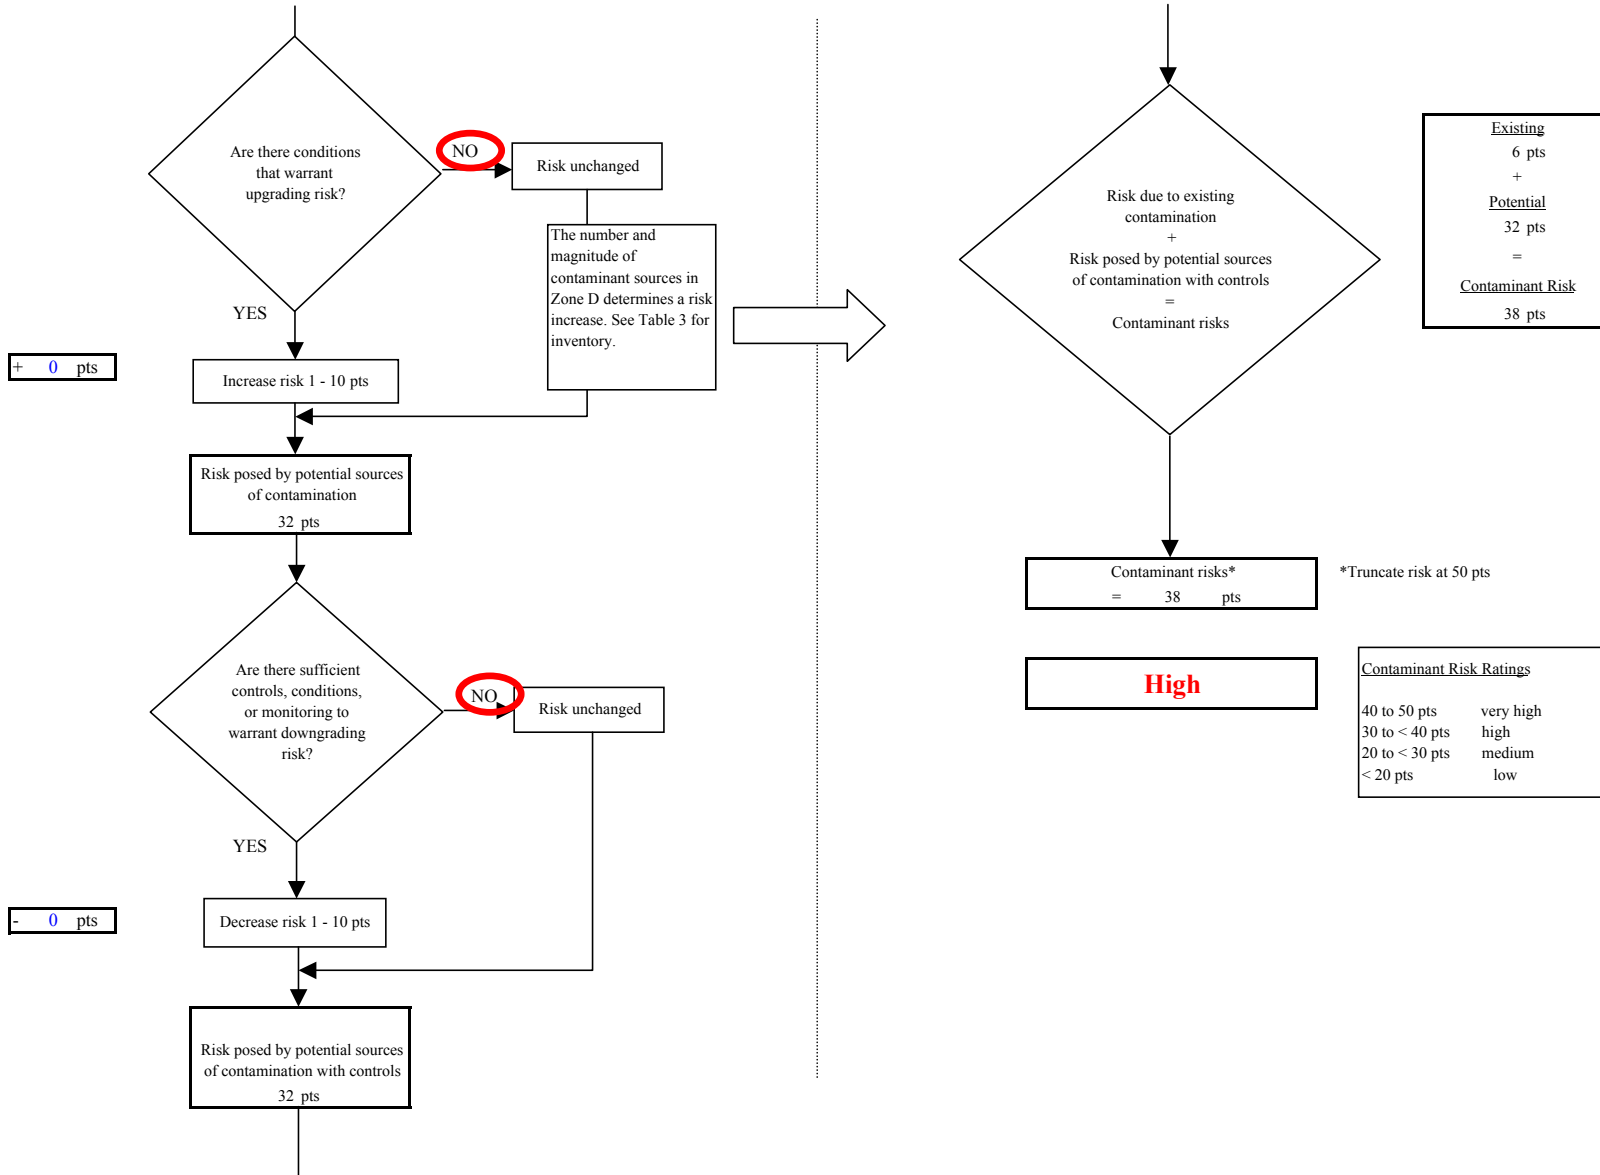

**Chart 6. Vulnerability analysis for KSD Joe Parent Voc. Ed. Center (PWS No. 271716.001) - Nitrates and Nitrites**

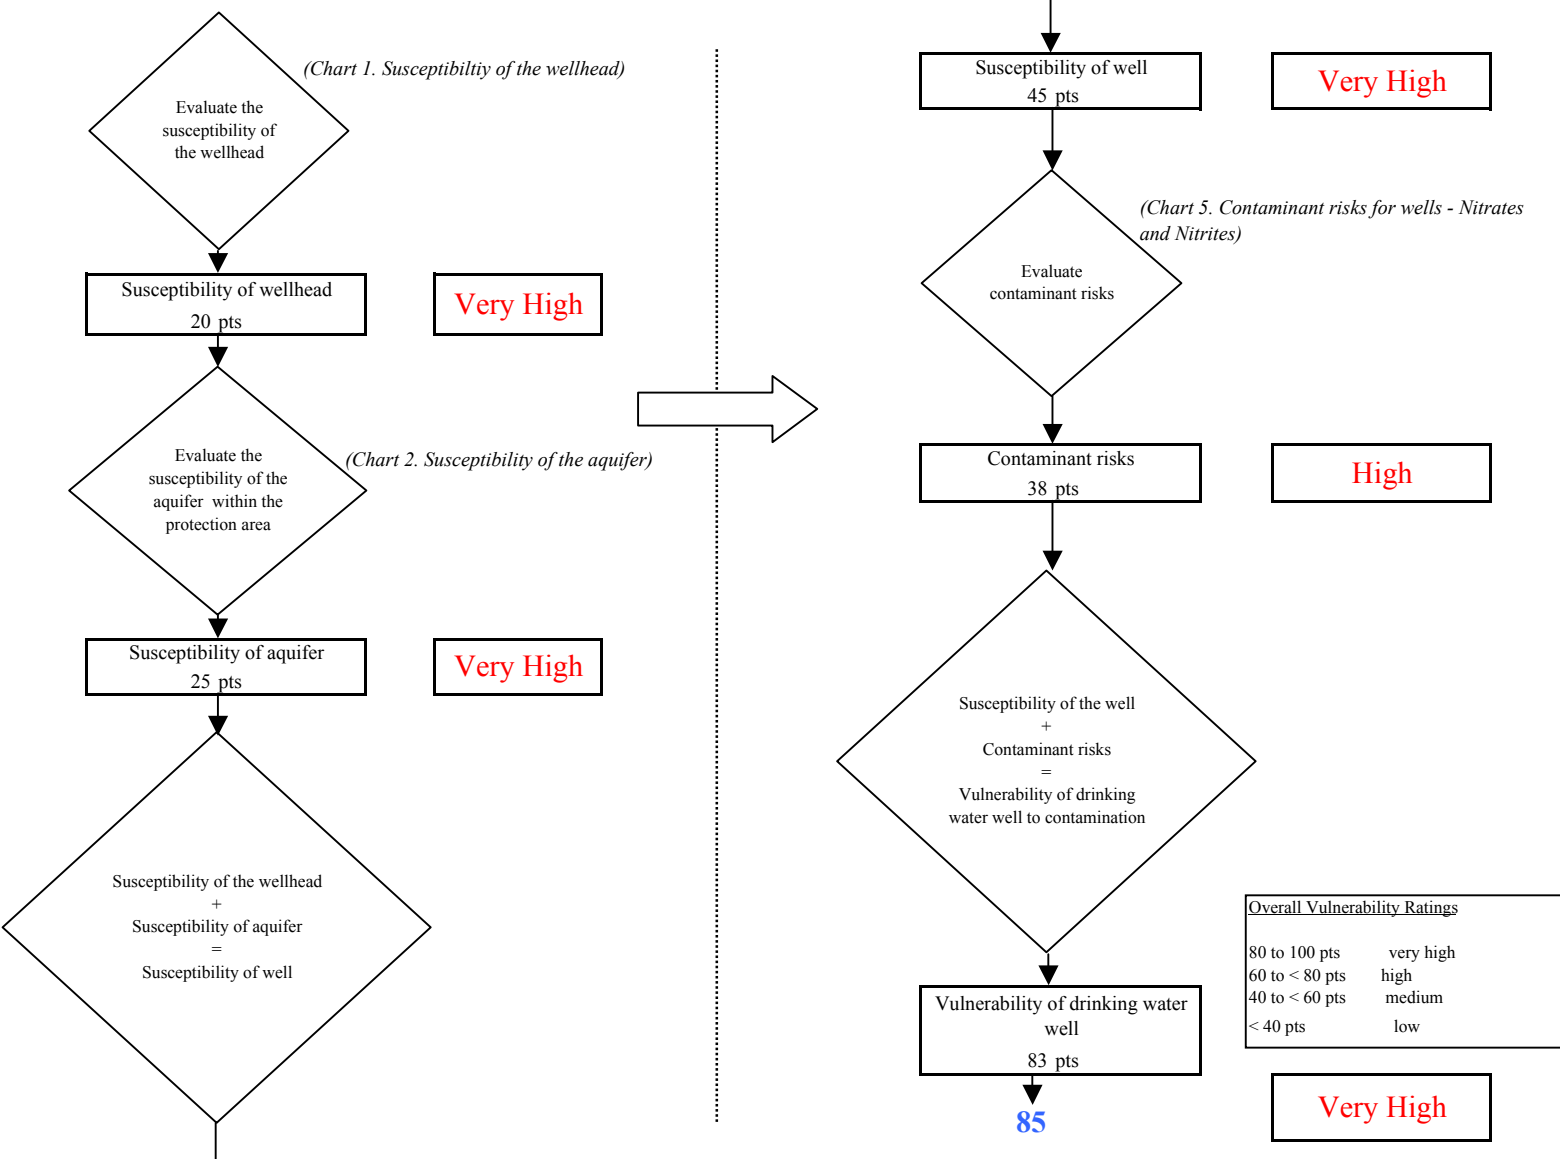

**Chart 7. Contaminant risks for KSD Joe Parent Voc. Ed. Center (PWS No. 271716.001) - Volatile Organic Chemicals**




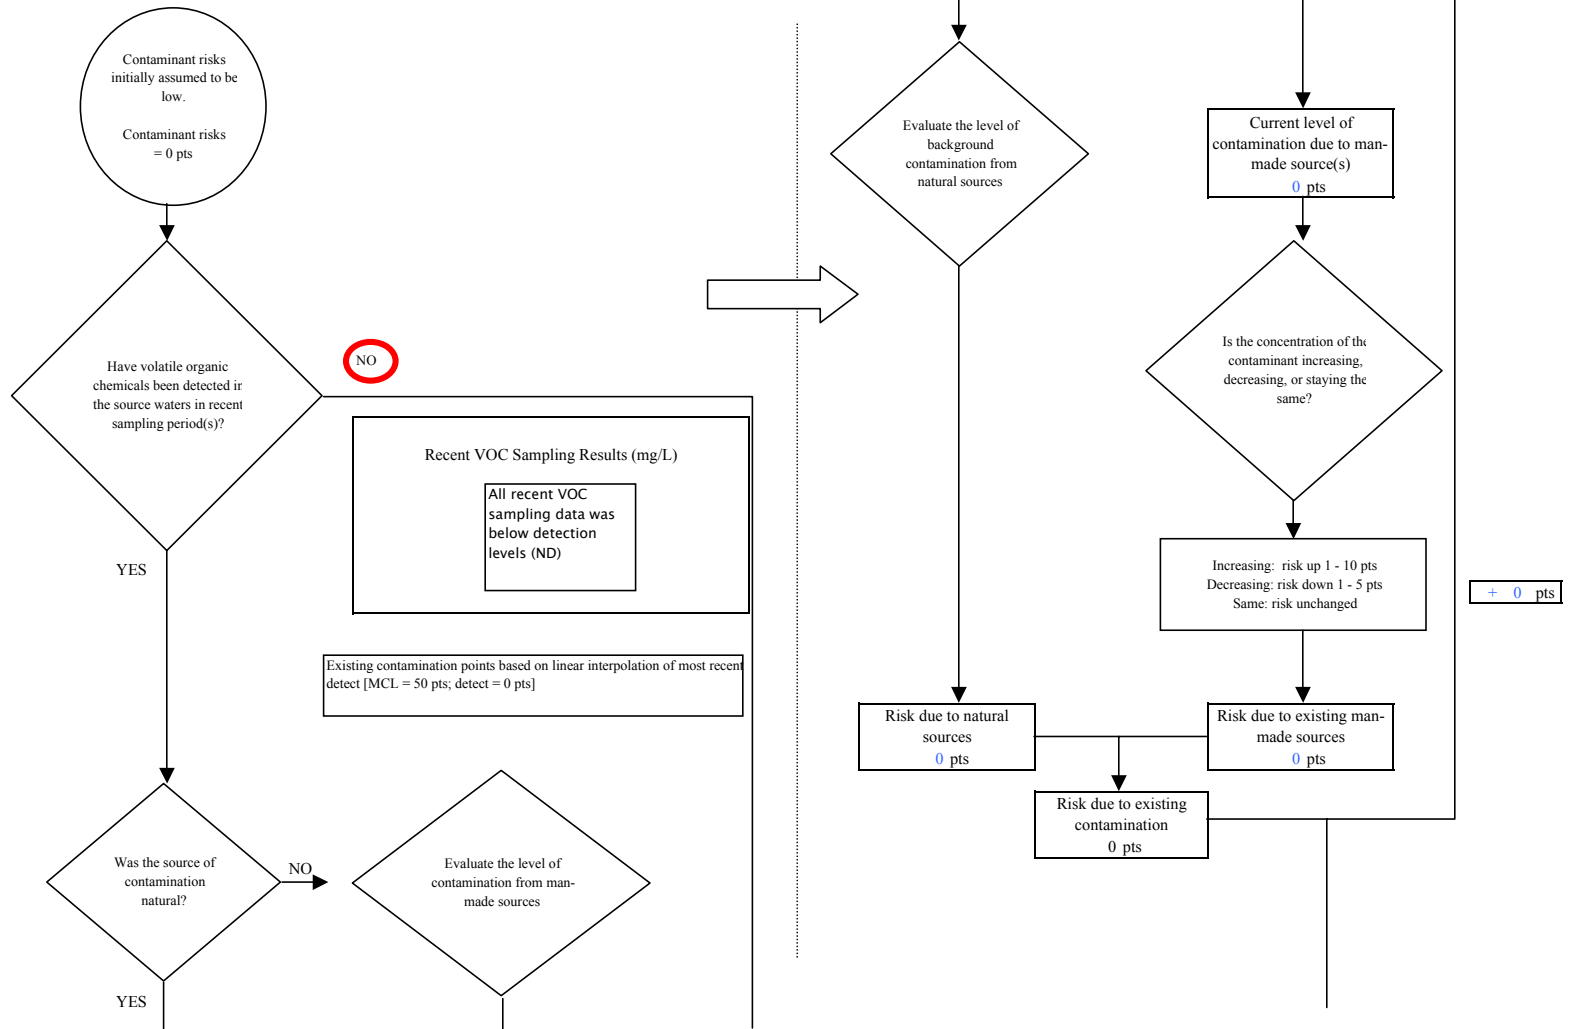





Chart 7. Contaminant risks for KSD Joe Parent Voc. Ed. Center (PWS No. 271716.001) - Volatile Organic Chemicals

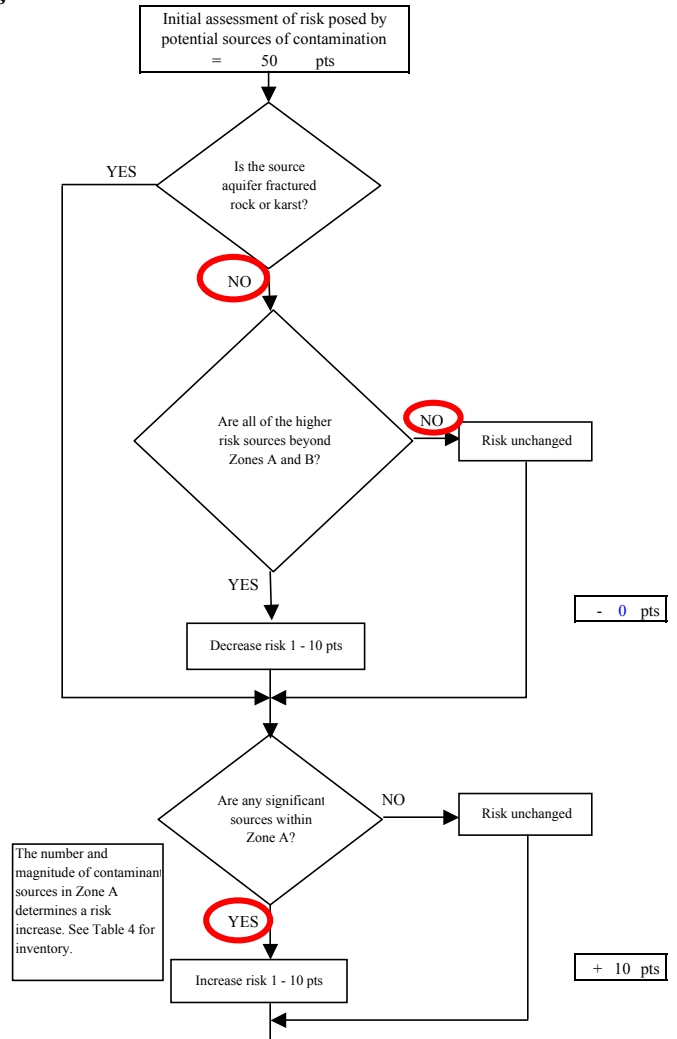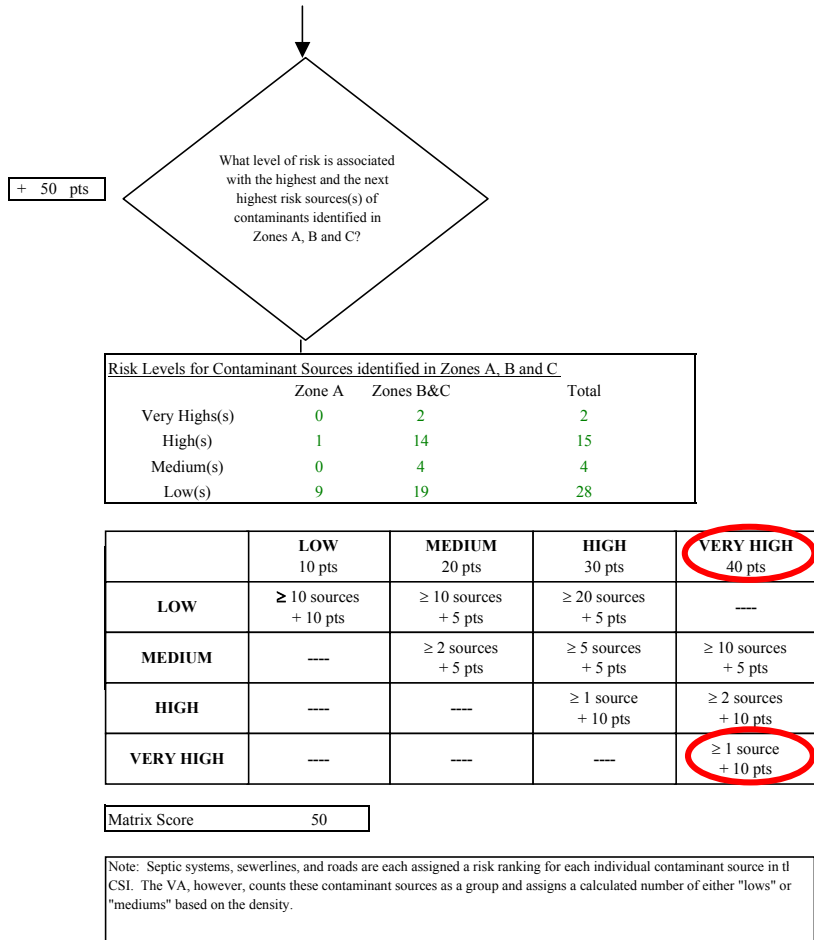


**Chart 7. Contaminant risks for KSD Joe Parent Voc. Ed. Center (PWS No. 271716.001) - Volatile Organic Chemicals**

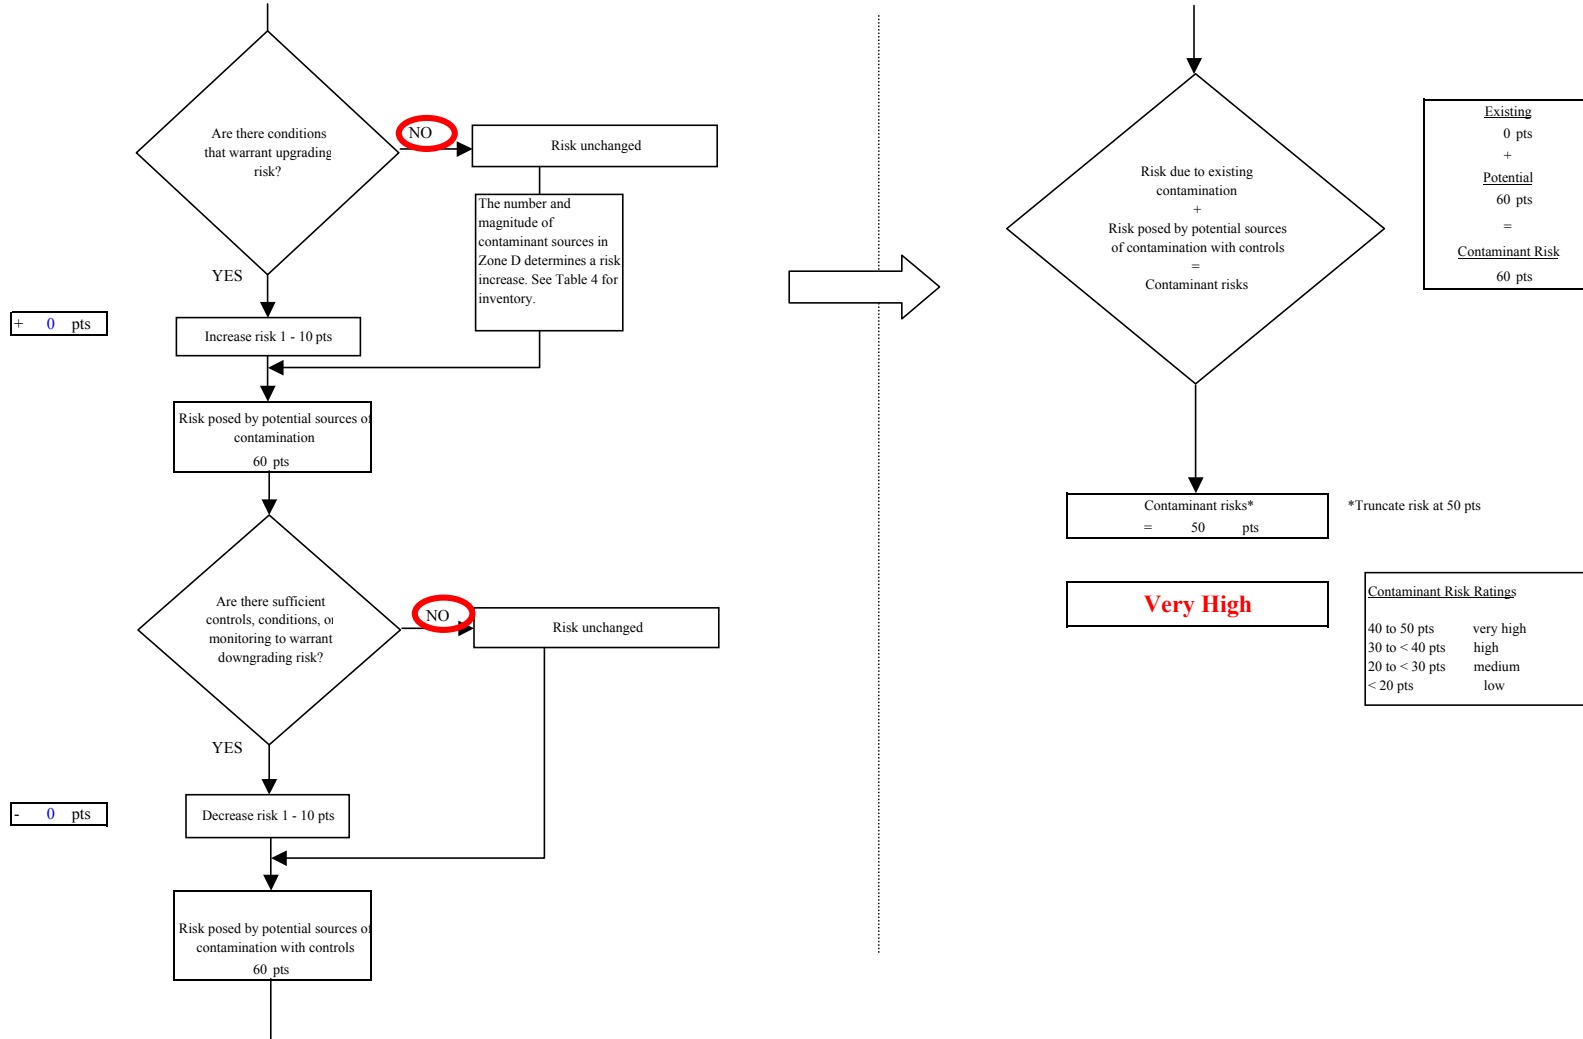




**Chart 8. Vulnerability analysis for KSD Joe Parent Voc. Ed. Center (PWS No. 271716.001) - Volatile Organic Chemicals**

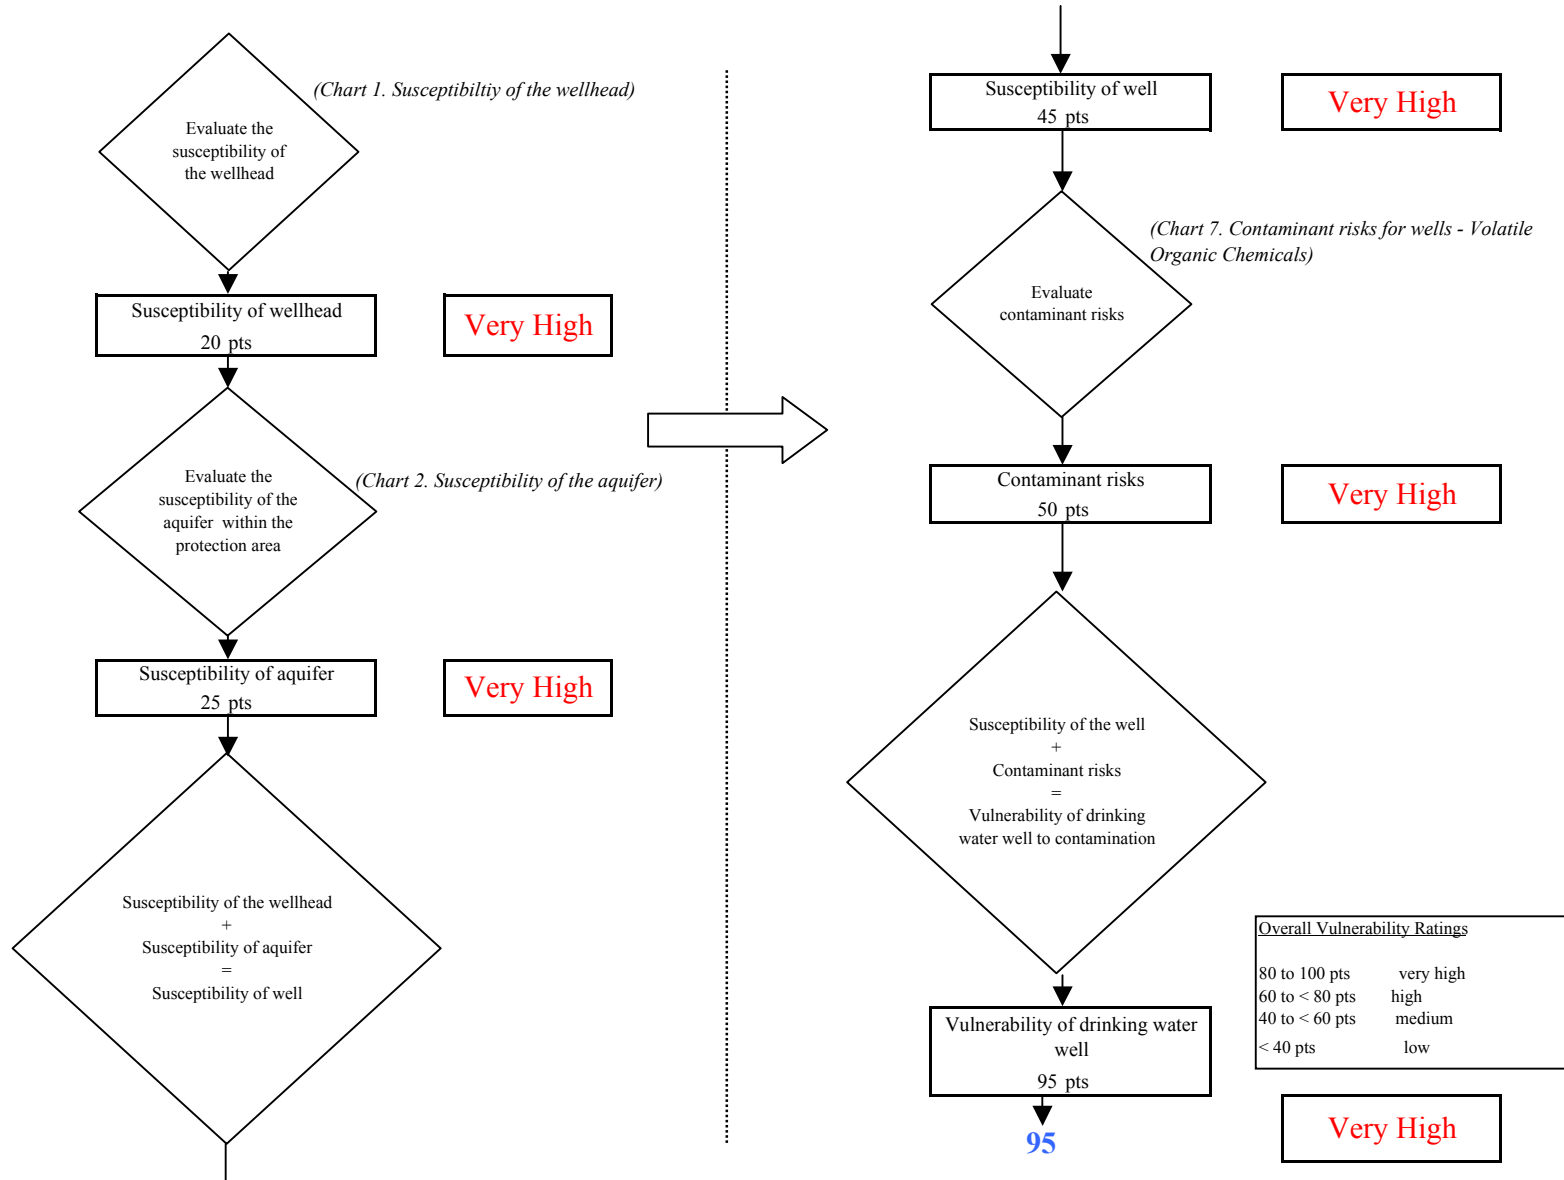

**Chart 9. Contaminant risks for KSD Joe Parent Voc. Ed. Center (PWS No. 271716.001) - Heavy Metals, Cyanide and Other Inorganic Chemicals**

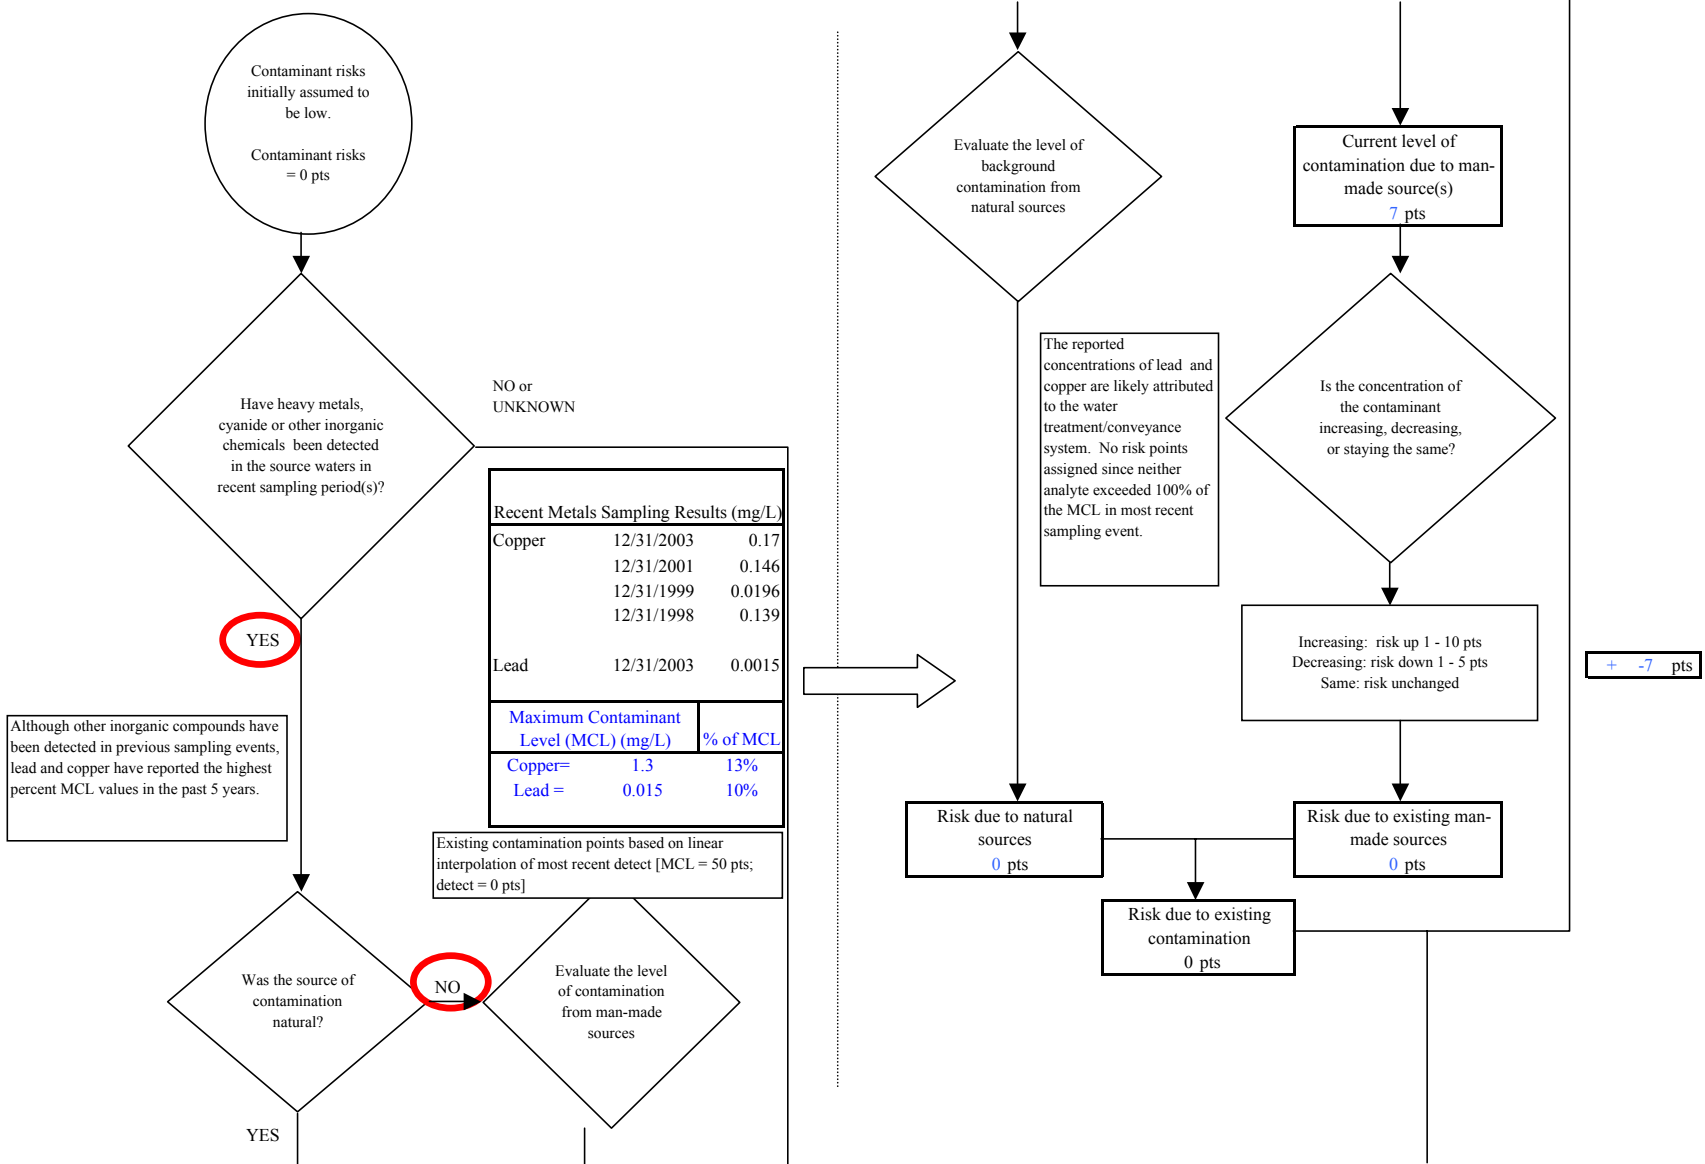


**Chart 9. Contaminant risks for KSD Joe Parent Voc. Ed. Center (PWS No. 271716.001) - Heavy Metals, Cyanide and Other Inorganic Chemicals**

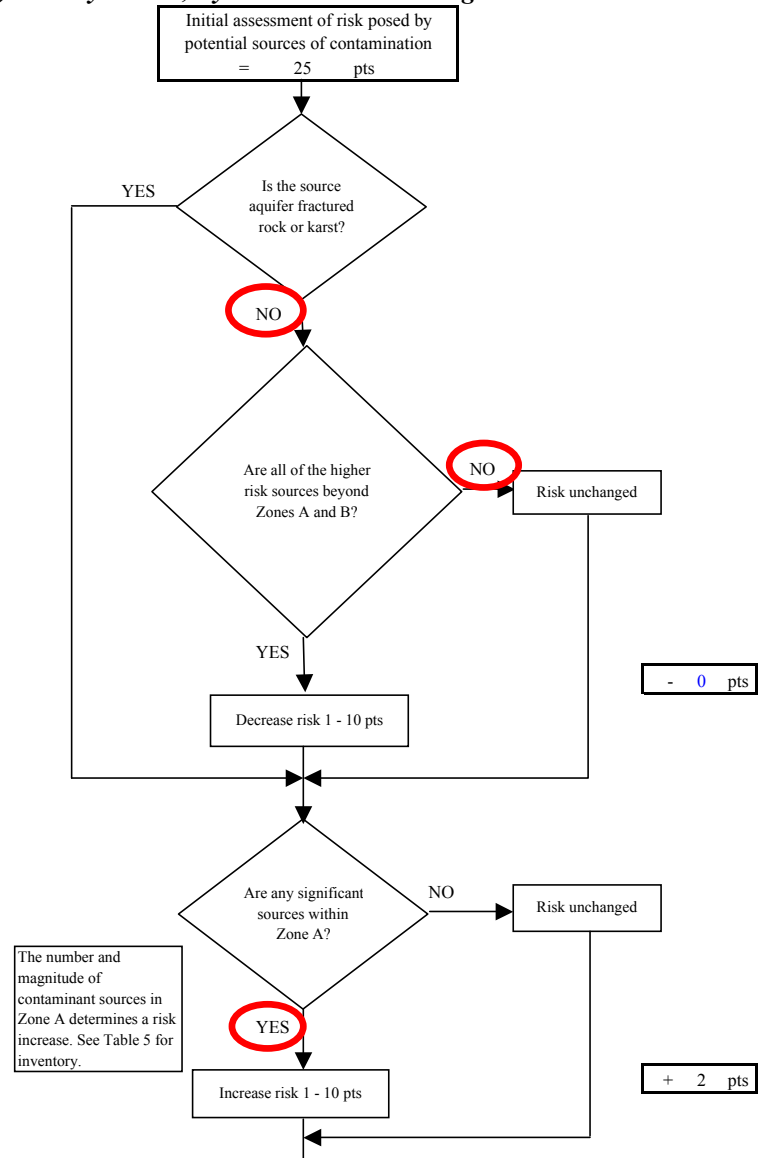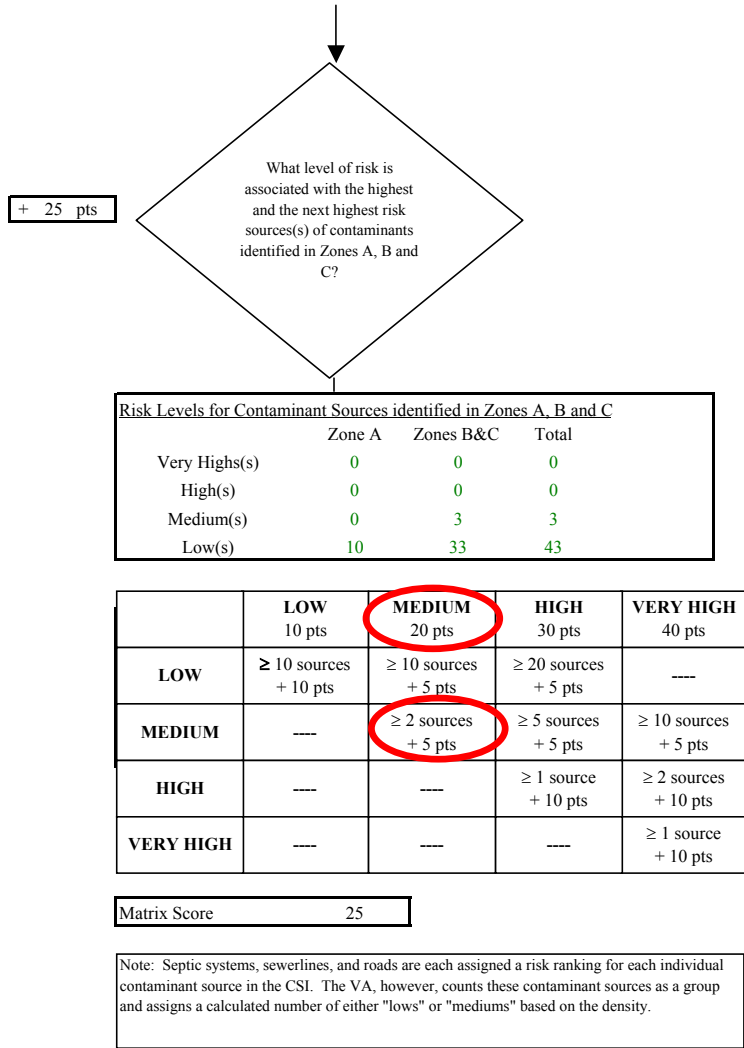

The number and magnitude of contaminant sources in Zone A determines a risk increase. See Table 5 for inventory.

**Chart 9. Contaminant risks for KSD Joe Parent Voc. Ed. Center (PWS No. 271716.001) - Heavy Metals, Cyanide and Other Inorganic Chemicals**

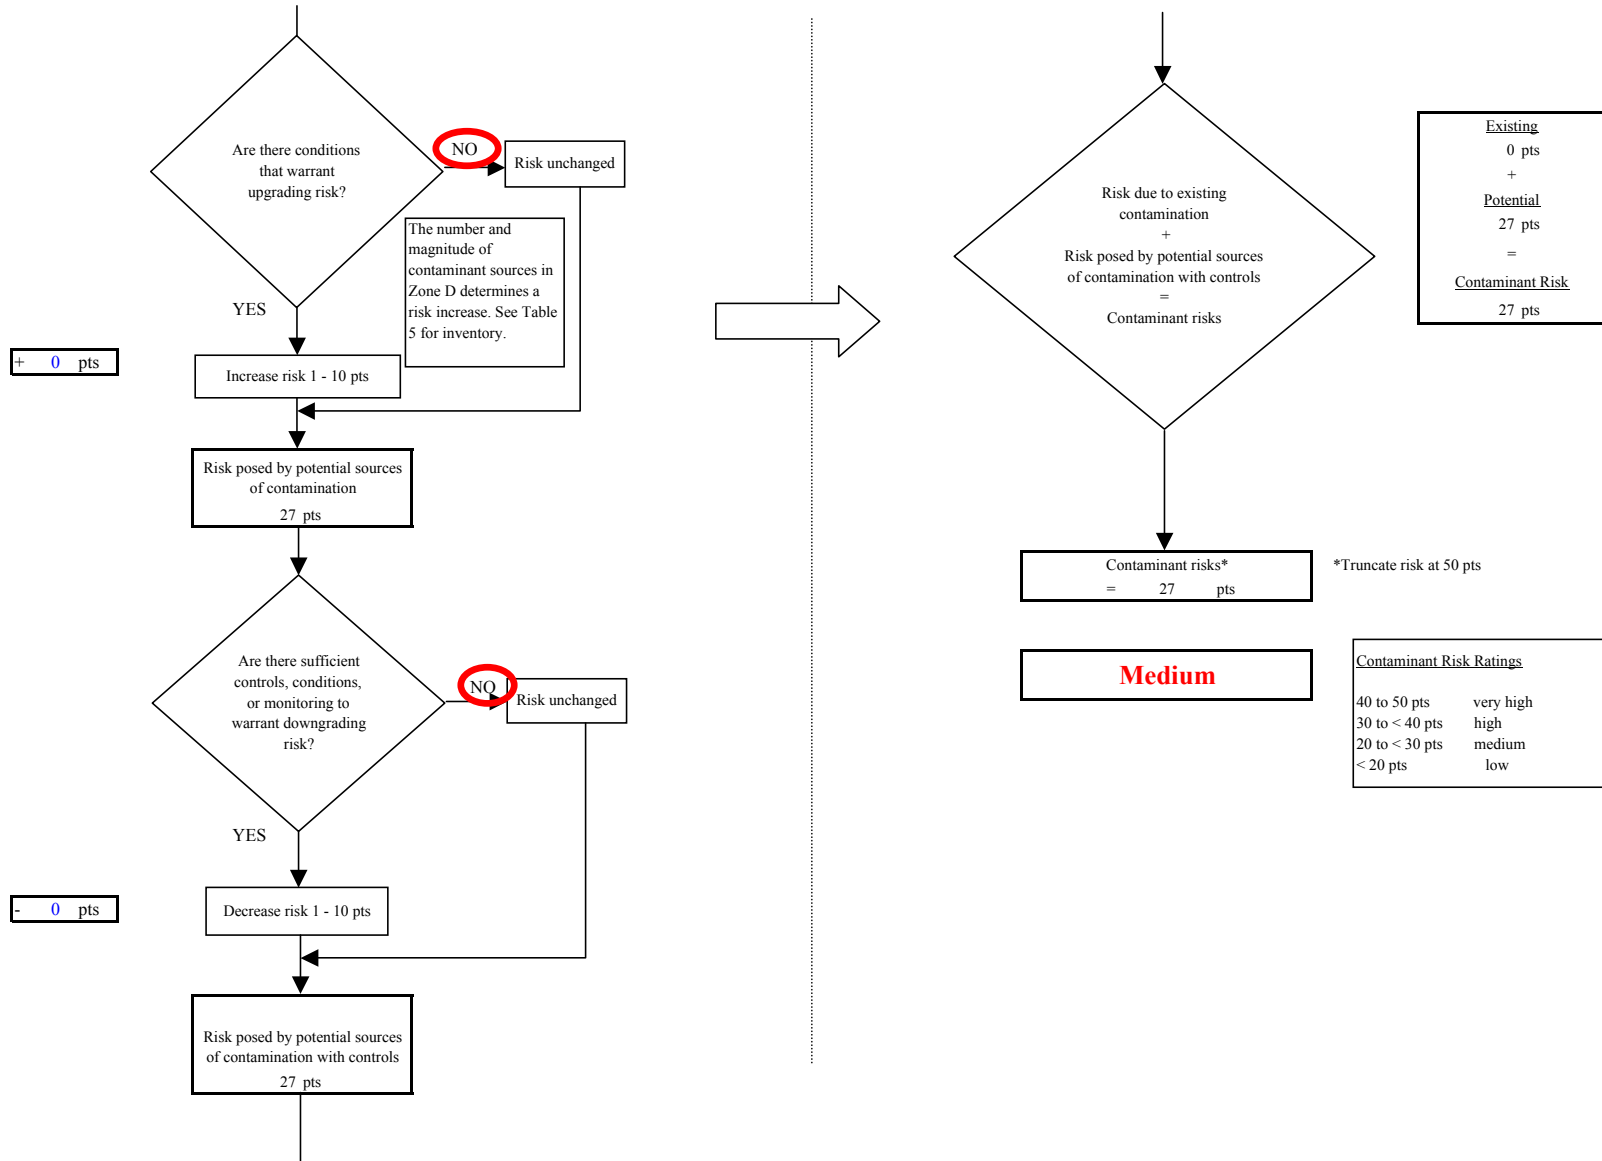

**Chart 10. Vulnerability analysis for KSD Joe Parent Voc. Ed. Center (PWS No. 271716.001) - Heavy Metals, Cyanide and Other Inorganic Chemicals**

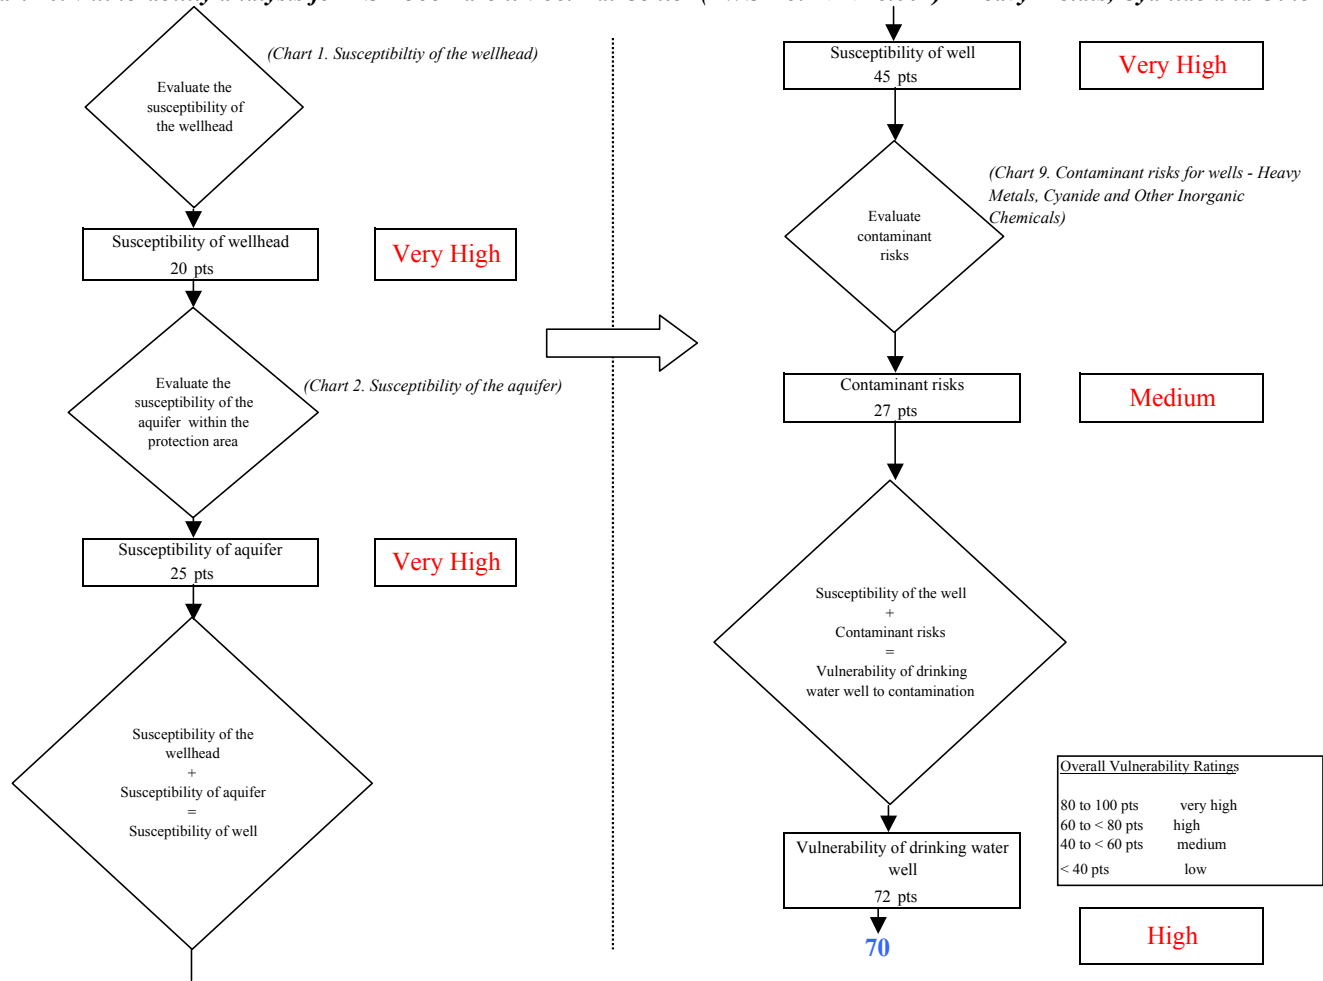


Chart 11. Contaminant risks for KSD Joe Parent Voc. Ed. Center (PWS No. 271716.001) - Synthetic Organic Chemicals




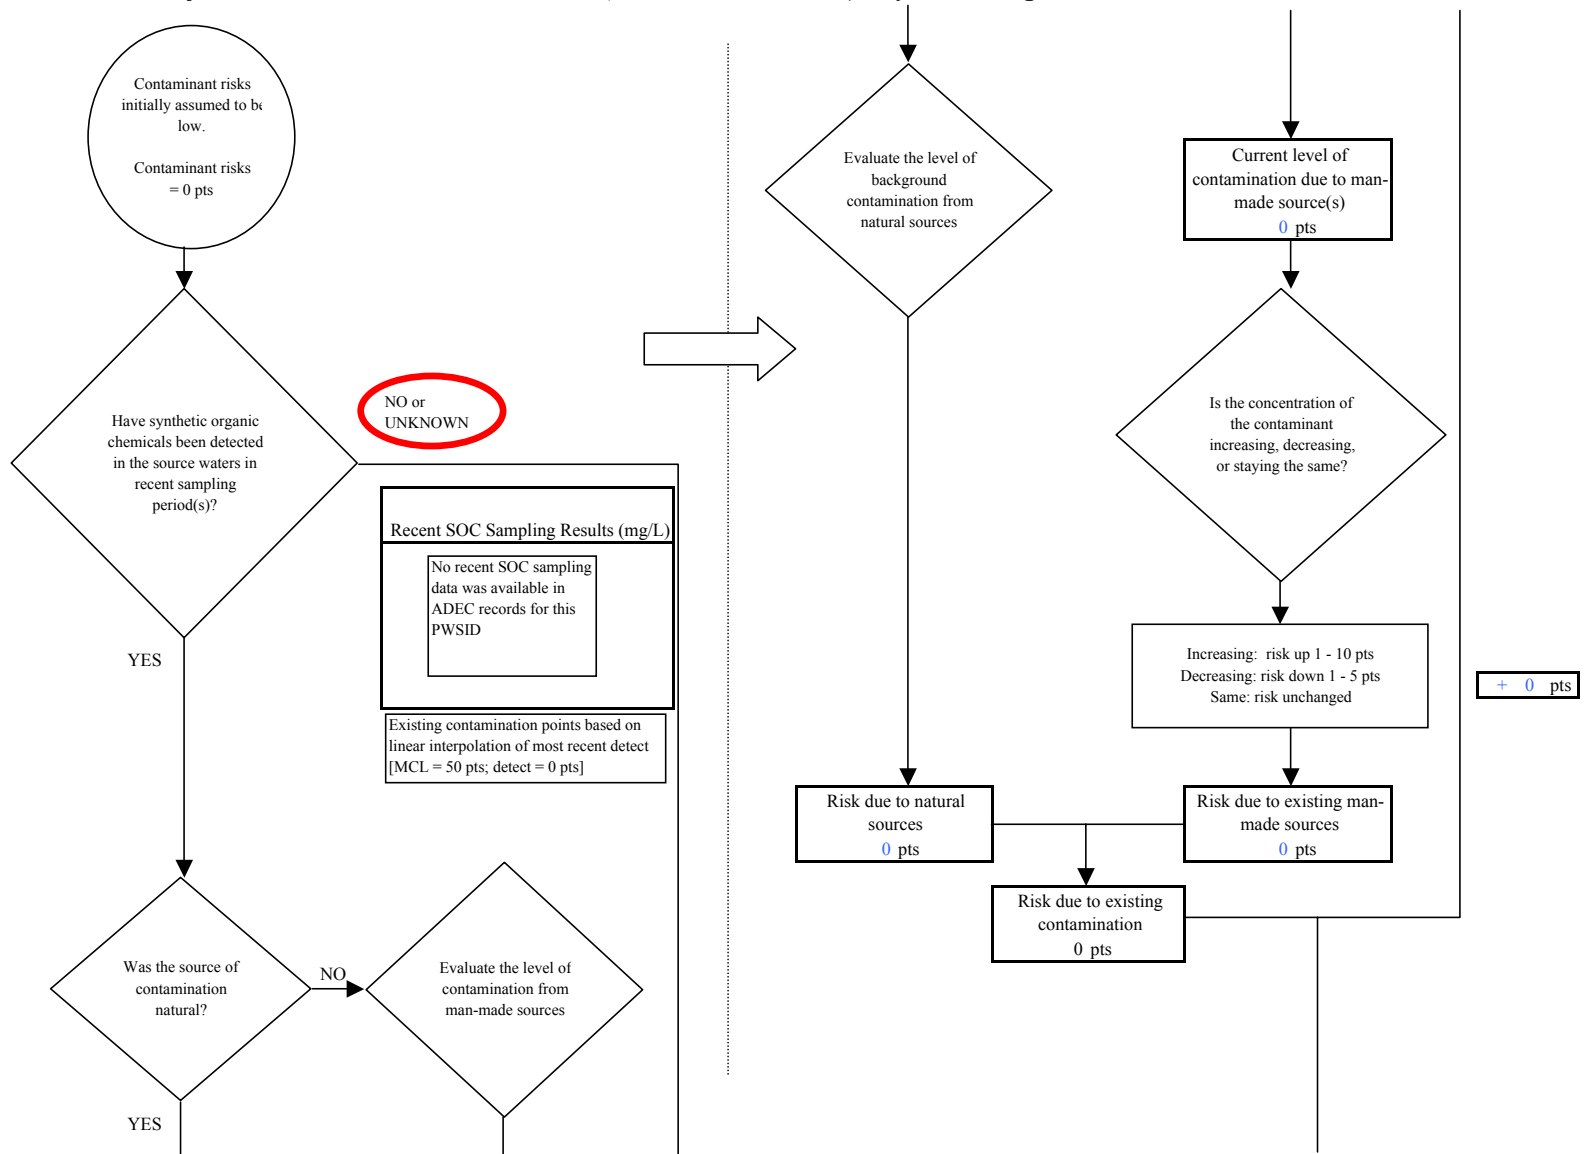




Chart 11. Contaminant risks for KSD Joe Parent Voc. Ed. Center (PWS No. 271716.001) - Synthetic Organic Chemicals

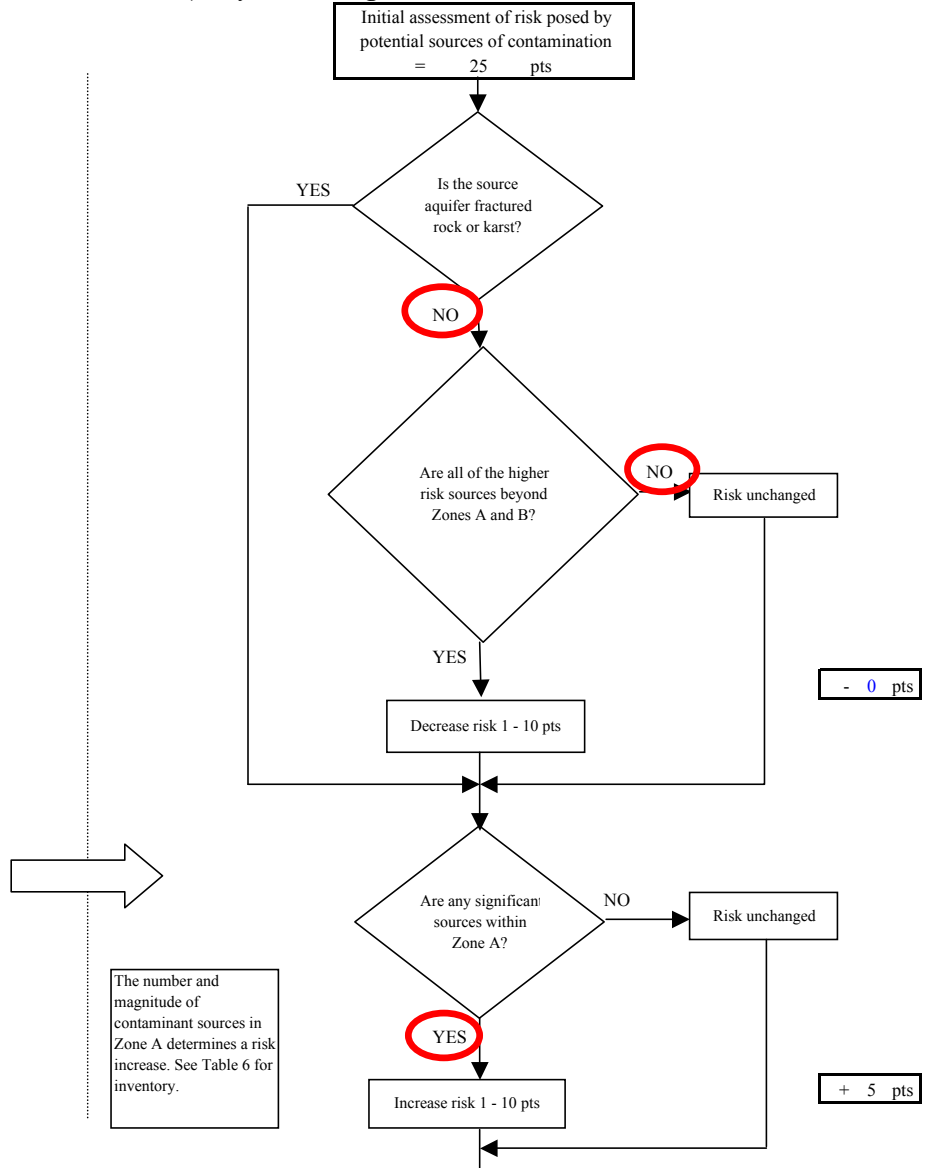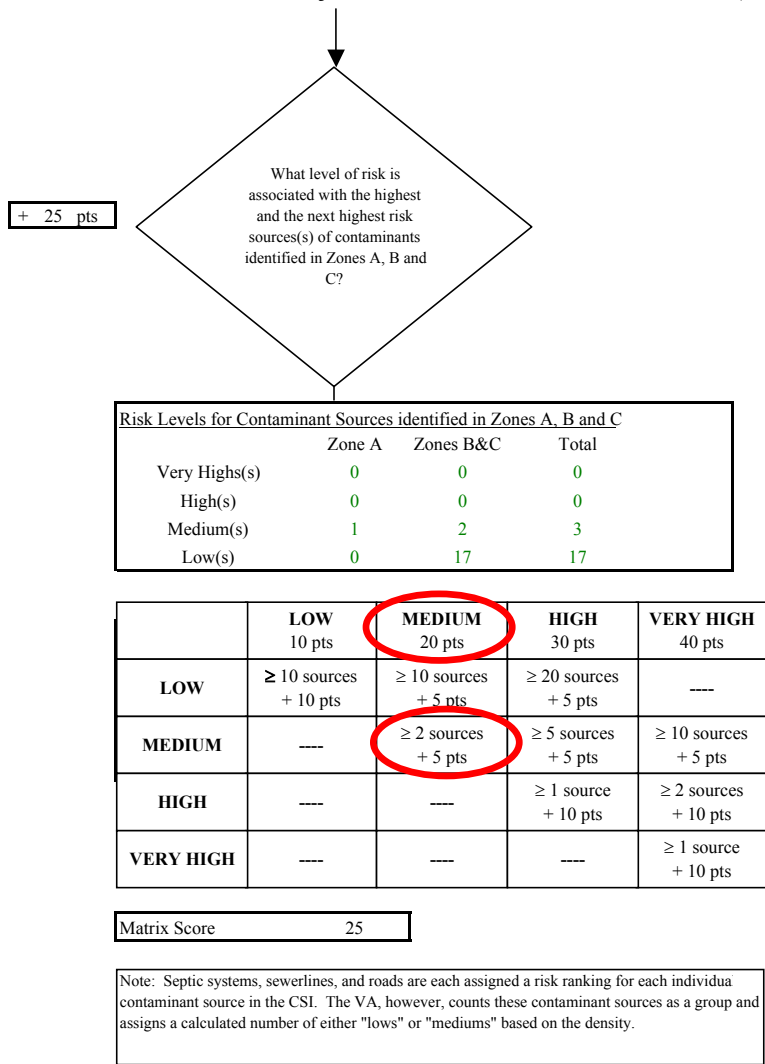

**Chart 11. Contaminant risks for KSD Joe Parent Voc. Ed. Center (PWS No. 271716.001) - Synthetic Organic Chemicals**

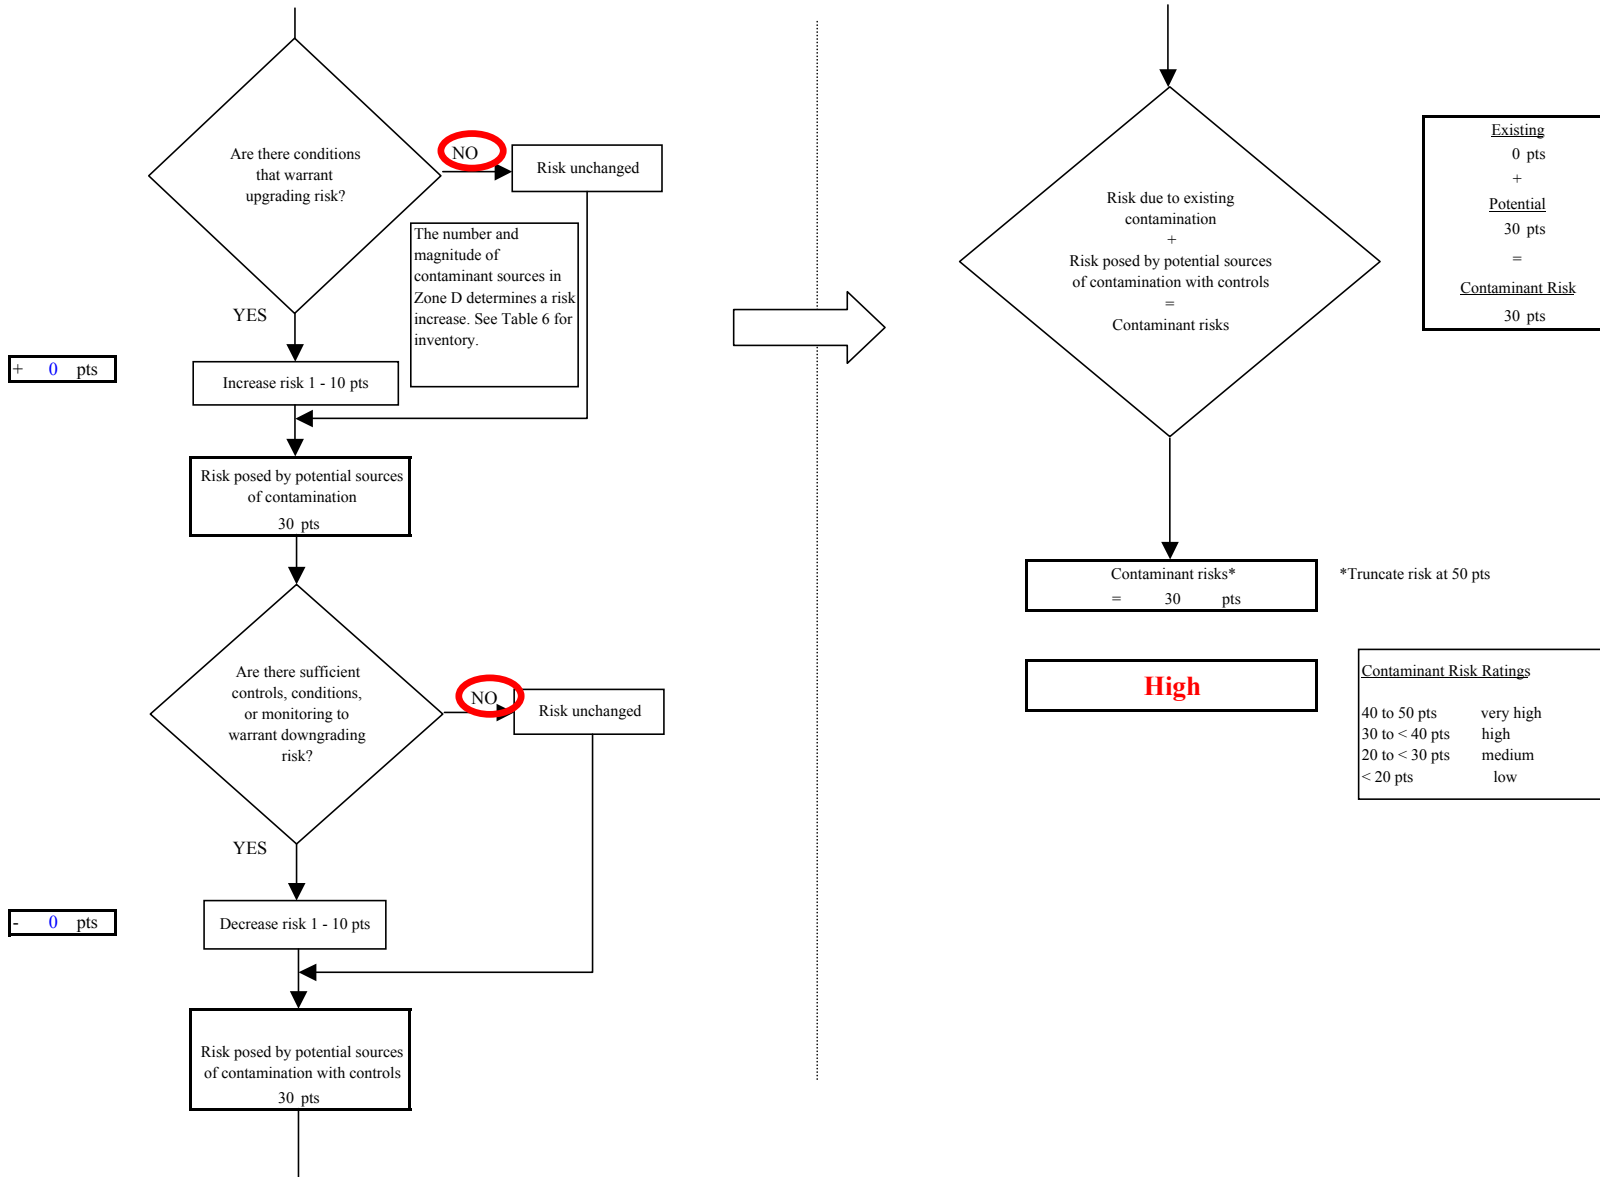

**Chart 12. Vulnerability analysis for KSD Joe Parent Voc. Ed. Center (PWS No. 271716.001) - Synthetic Organic Chemicals**

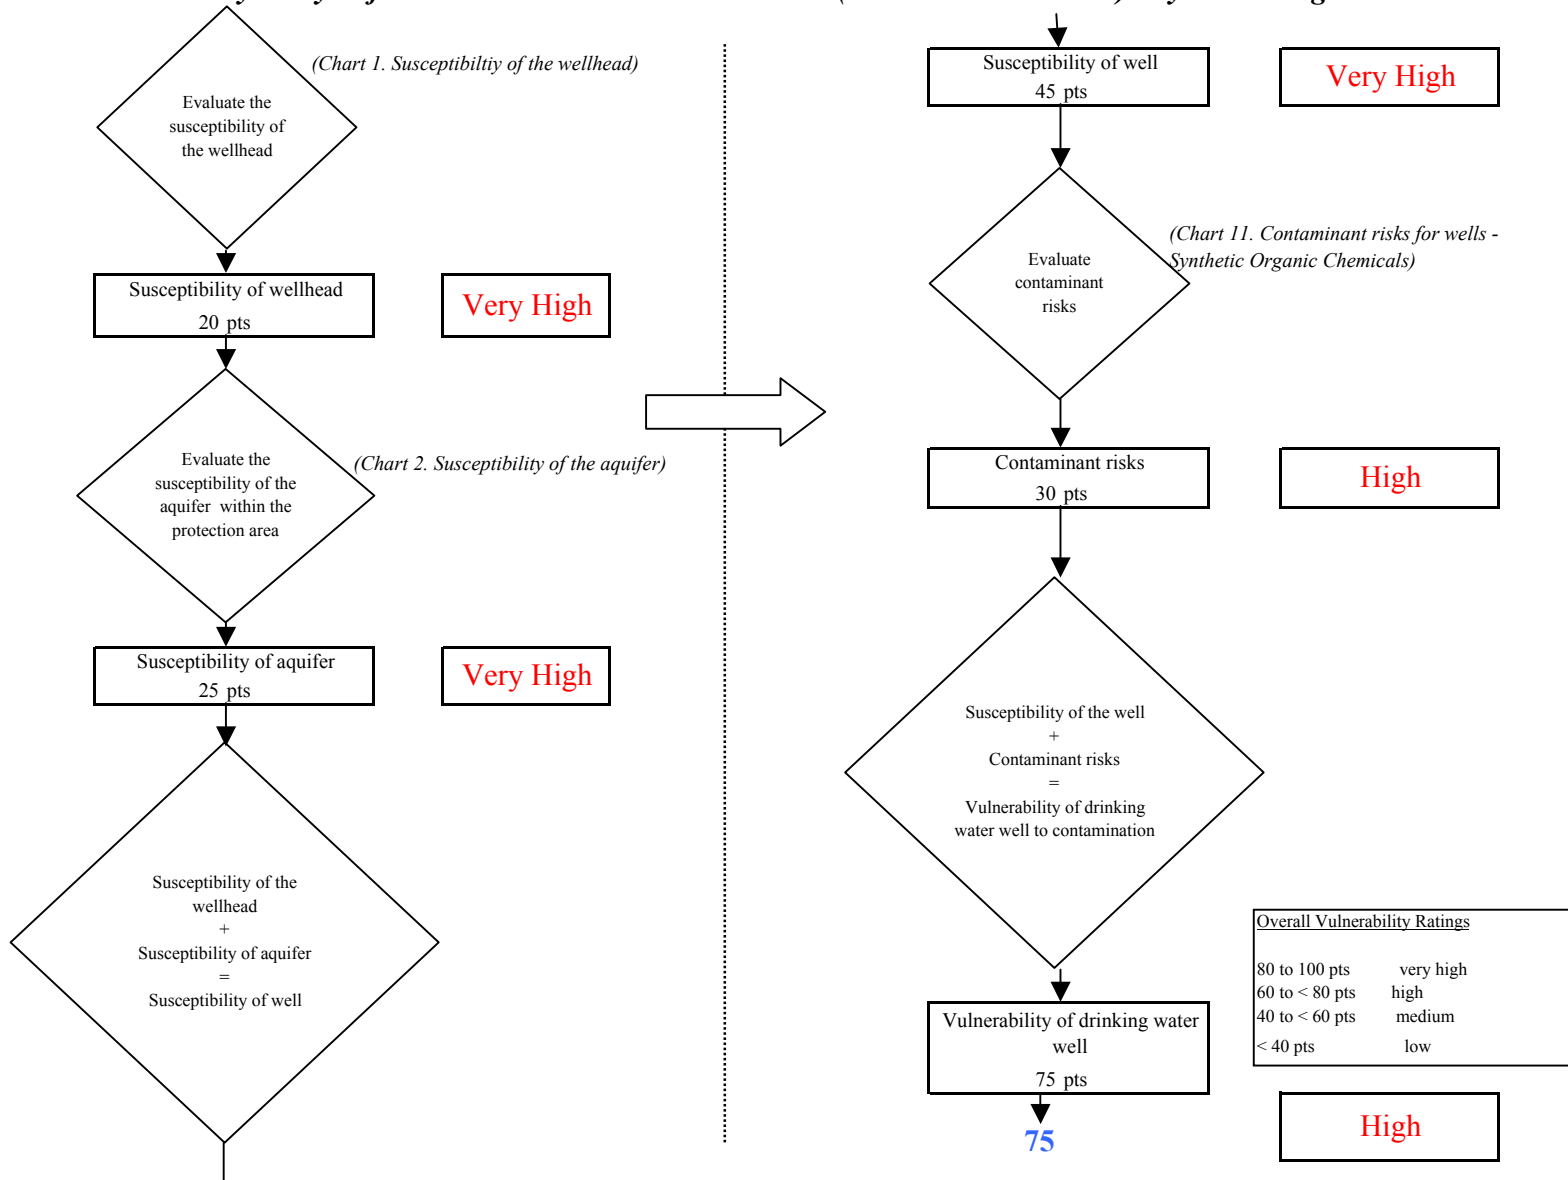


Chart 13. Contaminant risks for KSD Joe Parent Voc. Ed. Center (PWS No. 271716.001) - Other Organic Chemicals

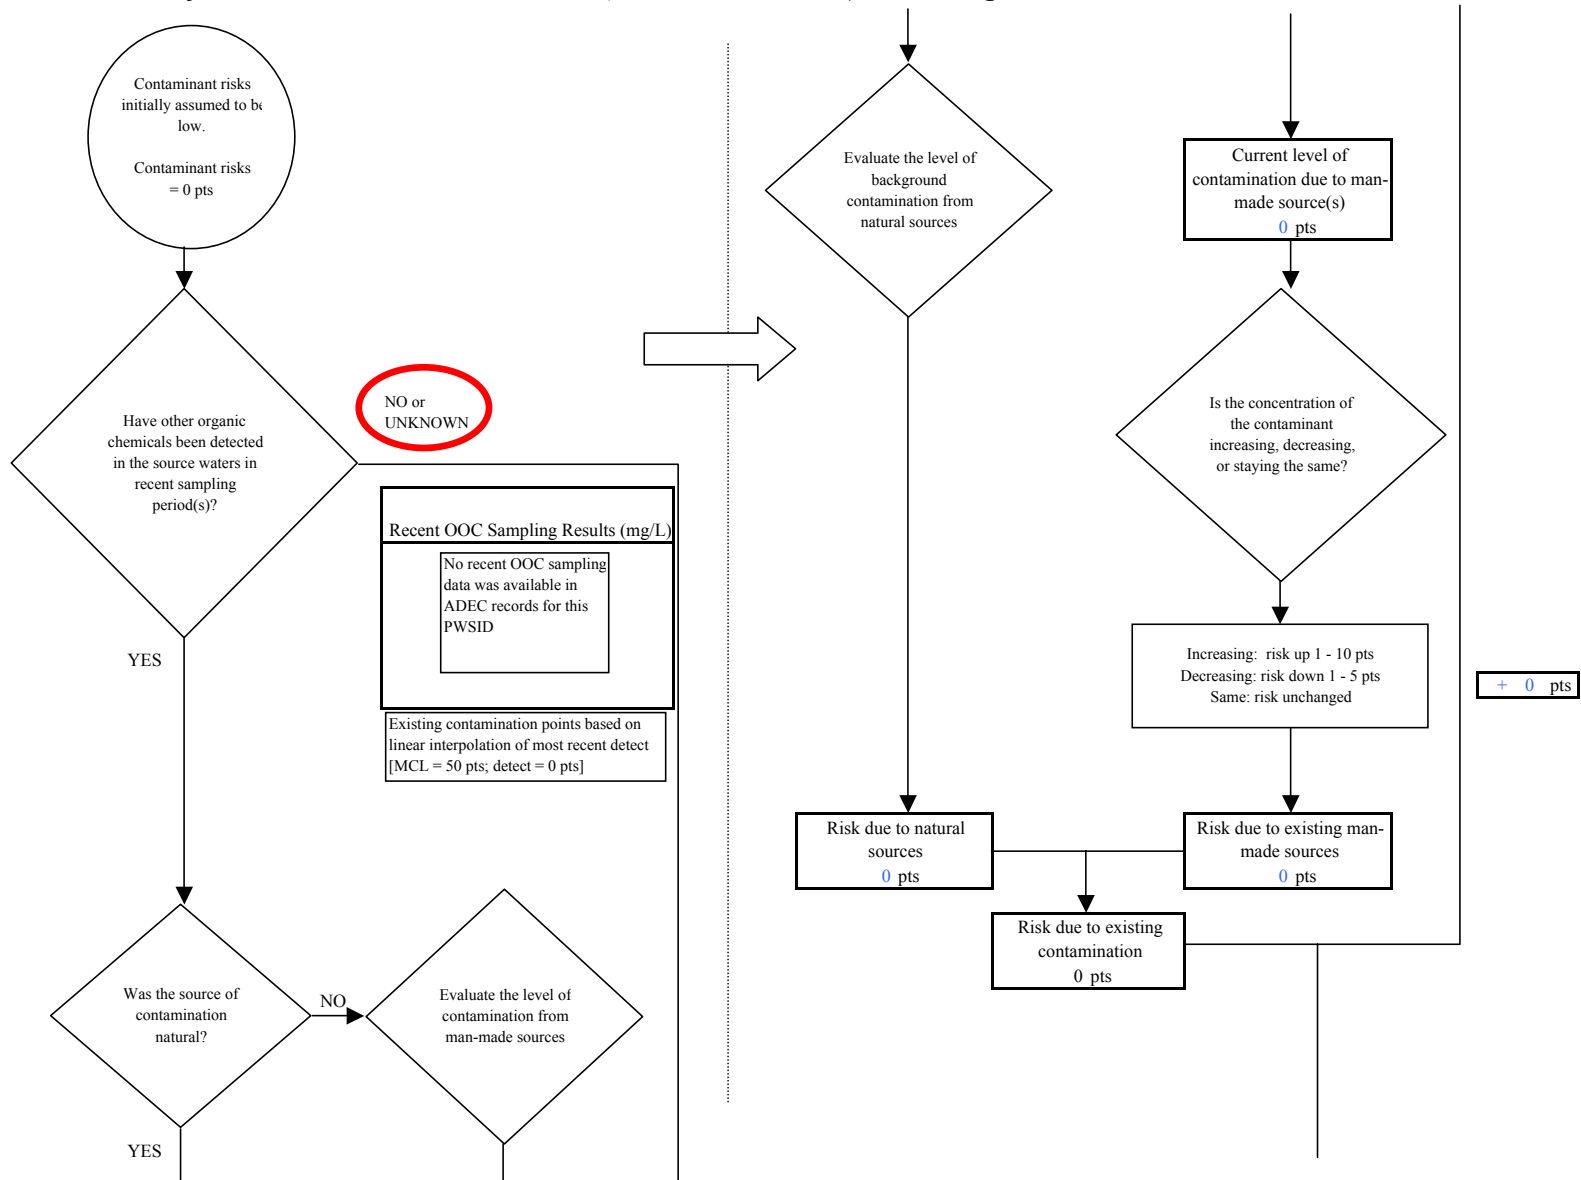


Chart 13. Contaminant risks for KSD Joe Parent Voc. Ed. Center (PWS No. 271716.001) - Other Organic Chemicals




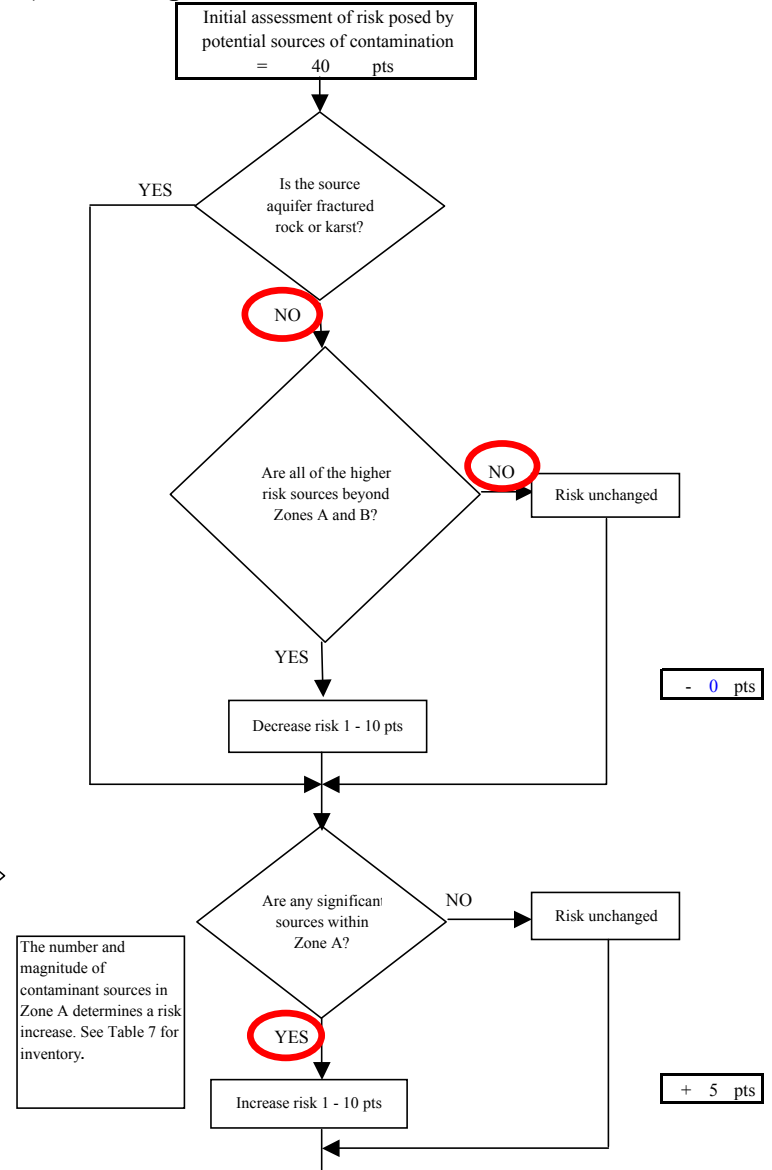


Chart 13. Contaminant risks for KSD Joe Parent Voc. Ed. Center (PWS No. 271716.001) - Other Organic Chemicals

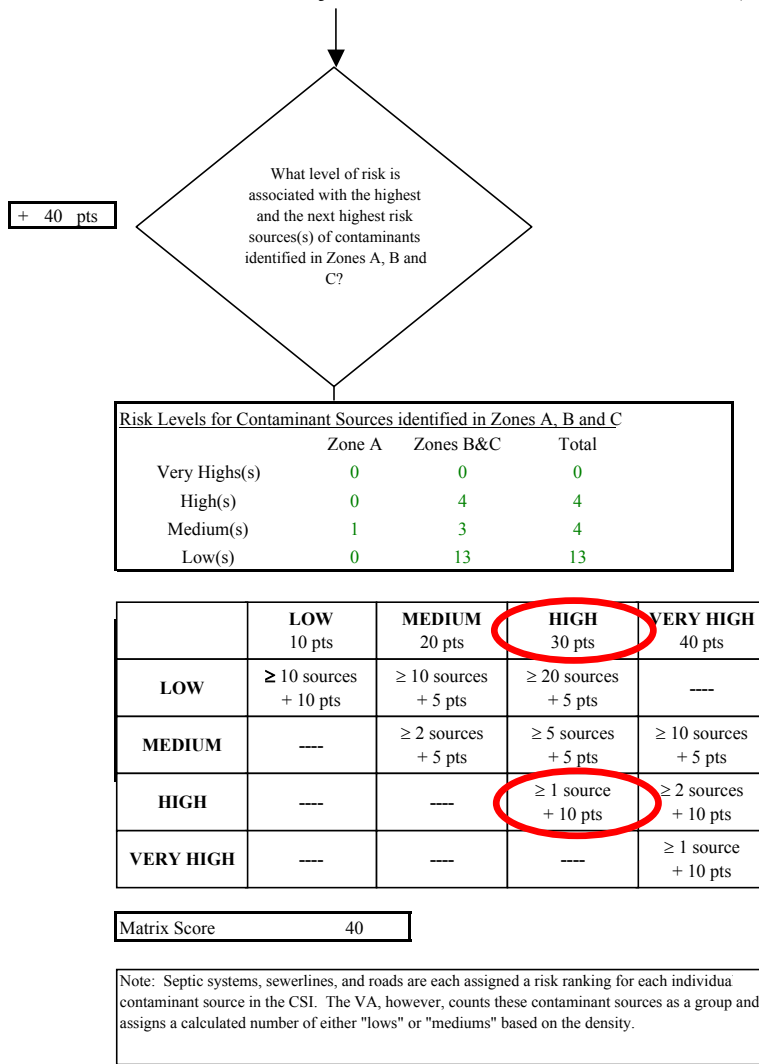

**Chart 14. Vulnerability analysis for KSD Joe Parent Voc. Ed. Center (PWS No. 271716.001) - Other Organic Chemicals**

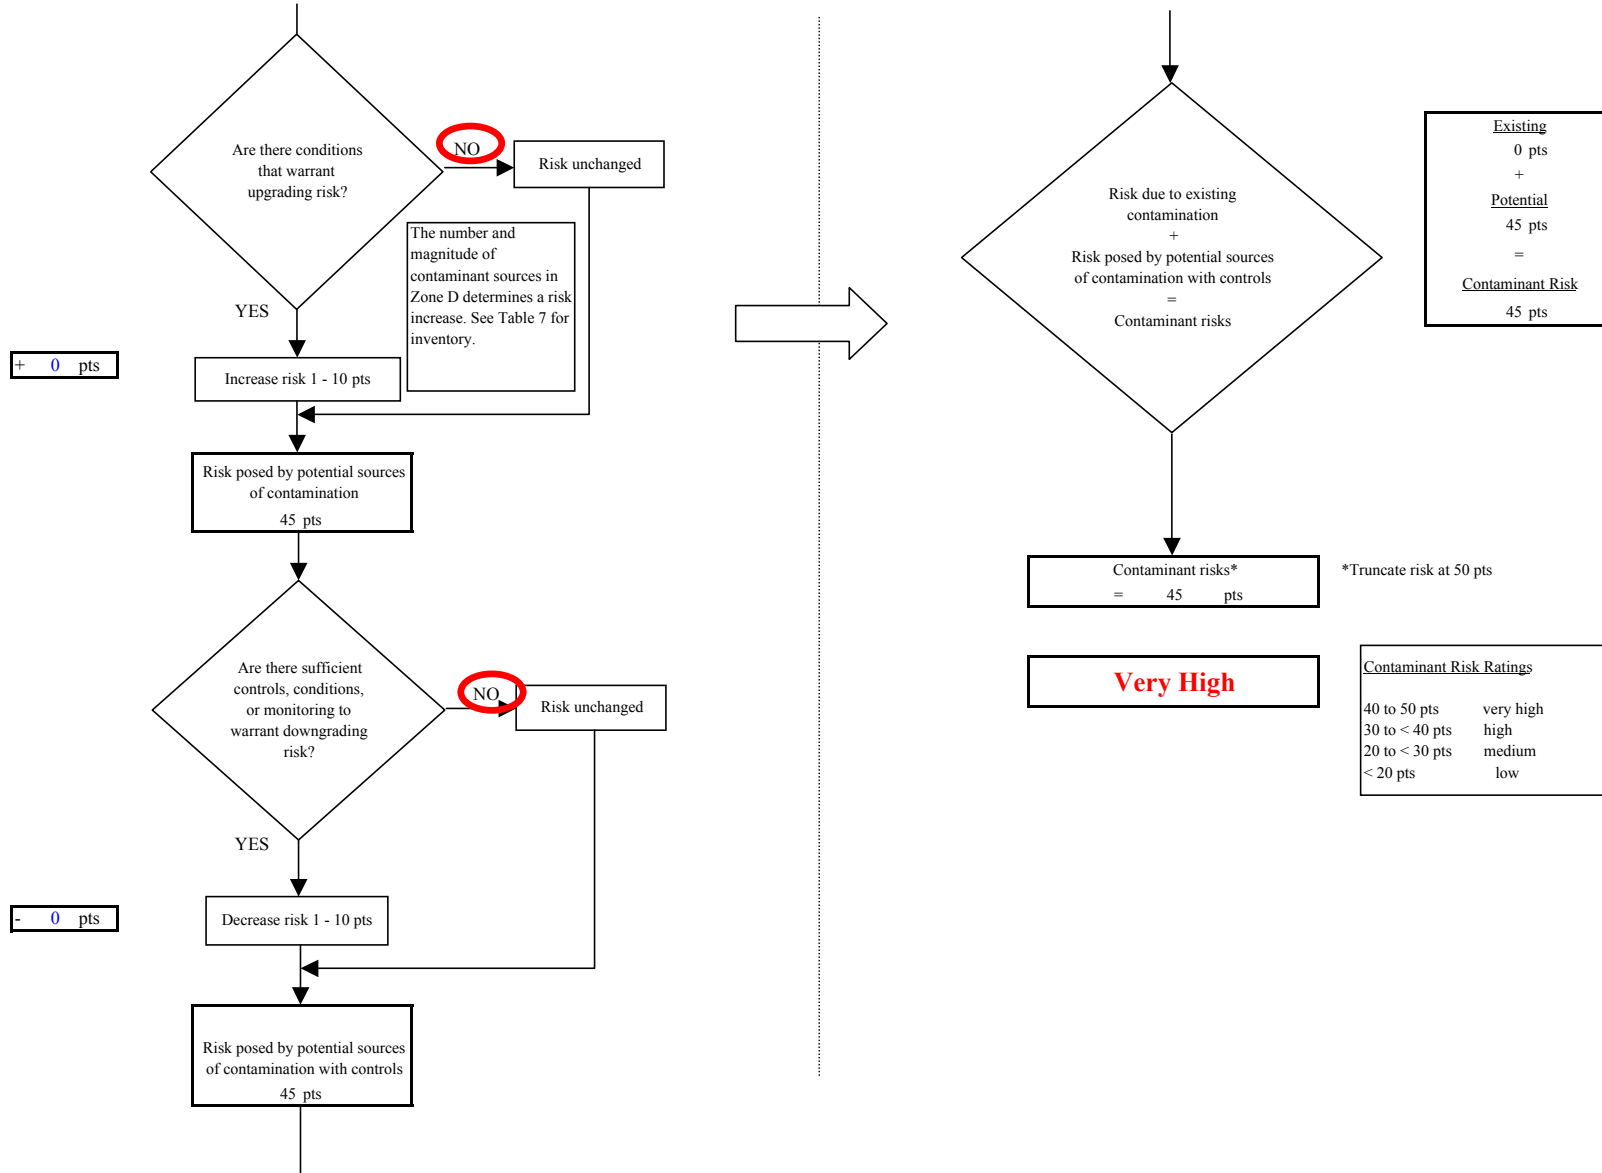