



Source Water Assessment

A Hydrogeologic Susceptibility and
Vulnerability Assessment for
US Army Bethel National Guard
Public Drinking Water System,
Bethel, Alaska

PWSID # 270419.001

DRINKING WATER PROTECTION REPORT 1760

Alaska Department of Environmental Conservation

January, 2009

Source Water Assessment for
US Army Bethel National Guard
Public Drinking Water System,
Bethel, Alaska
PWSID# 270419.001

DRINKING WATER PROTECTION REPORT 1760

The Drinking Water Protection (DWP) section of the Drinking Water Program is producing Source Water Assessments in compliance with the Safe Drinking Water Act Amendments of 1996. Each assessment includes a delineation of the source water area, an inventory of potential and existing contaminant sources that may impact the water, a risk ranking for each of these contaminants, and an evaluation of the potential vulnerability of these drinking water sources.

These assessments are intended to provide public water systems owners/operators, communities, and local governments with the best available information that may be used to protect the quality of their drinking water. The assessments combine information obtained from various sources, including the U.S. Environmental Protection Agency, Alaska Department of Environmental Conservation (DEC), public water system owners/operators, and other public information sources. The results of this assessment are subject to change if additional data becomes available. It is anticipated this assessment will be updated every five years to reflect any changes in the vulnerability and/or susceptibility of public drinking water source. If you have any additional information that may affect the results of this assessment, please contact the DWP staff at the following toll-free number 1-866-956-7656.

January, 2009

CONTENTS

	Page		Page
Executive Summary.....	1	Ranking of Contaminant Risks	2
US Army Bethel National Guard		Vulnerability of US Army Bethel National Guard	
Public Drinking Water System	1	Drinking Water System.....	2
US Army Bethel National Guard		References.....	5
Drinking Water Protection Area.....	1	Appendix A	7
Inventory of Potential and		Appendix B	9
Existing Contaminant Sources.....	2	Appendix C	11

TABLES

Table 1. Definition of Zones.....	2
Table 2. Susceptibility	3
Table 3. Contaminant Risks.....	3
Table 4. Overall Vulnerability.....	4

APPENDICES

- APPENDIX
- A. US Army Bethel National Guard Drinking Water Protection Area (Map A)
 - B. Contaminant Source Inventory for US Army Bethel National Guard (Table 1)
 - Contaminant Source Inventory and Risk Ranking for US Army Bethel National Guard – Bacteria and Viruses (Table 2)
 - Contaminant Source Inventory and Risk Ranking for US Army Bethel National Guard – Nitrates/Nitrites (Table 3)
 - Contaminant Source Inventory and Risk Ranking for US Army Bethel National Guard – Volatile Organic Chemicals (Table 4)
 - C. US Army Bethel National Guard Drinking Water Protection Area and Potential and Existing Contaminant Sources (Map C)

Source Water Assessment for US Army Bethel National Guard

Source of Public Drinking Water, Bethel, Alaska

Drinking Water Protection Alaska Department of Environmental Conservation

EXECUTIVE SUMMARY

The public water system for US Army Bethel National Guard is a Class B (transient/non-community) water system consisting of one well located between 4th and 5th Avenues in Bethel, Alaska. The wellhead received a susceptibility rating of **Medium** and the aquifer received a susceptibility rating of **High**. Combining these two ratings produces a **Medium** rating for the natural susceptibility of the well. Identified potential and current sources of contaminants for US Army Bethel National Guard public drinking water source include: domestic wastewater collection system, Class V injection wells, wastewater holding tanks, abandoned wells, laundromats without dry cleaning, landfills, cemeteries, motor vehicle repair shops, diesel and gasoline tanks, electric power generation, petroleum product bulk station, motor vehicle storage yards, firehouses, DEC recognized non-Superfund contaminated sites, LUST open leaking underground storage tank, monitoring wells, Glycol disposal, assumed septic systems, assumed and confirmed heating oil tanks, and roads. These identified potential and existing sources of contamination are considered as sources of bacteria and viruses, nitrates and/or nitrites, and volatile organic chemicals. Overall, the public water sources for US Army Bethel National Guard received a vulnerability rating of **High** for all three contaminant categories. This assessment of contaminant risks can be used as a foundation for local voluntary protection efforts as well as a basis for the continuous efforts on the part of US Army Bethel National Guard to protect public health.

US ARMY BETHEL NATIONAL GUARD PUBLIC DRINKING WATER SYSTEM

The US Army Bethel National Guard public water system is a Class B (transient/non-community) water system. The system consists of one well located between 4th and 5th Avenues in Bethel, Alaska (see Map A in Appendix A). Bethel lies at the mouth of the Kuskokwim River, about 400 air miles west of Anchorage. The city has a population of 5,653 according to the 2000 census (ADCCED, 2009). Some residents of Bethel are hooked up to water and sewer system, but most have water delivered and use septic tanks. Electricity is provided by Bethel Utilities Corporation. Bethel is categorized as a large town/Regional Center and it serves as a transportation

hub for the Yukon – Kuskokwim Delta and southwestern Alaska (ADCCED 2009).

Bethel lies on the alluvial plain of the Kuskokwim River. The area around Bethel is made up of large deposits of alluvium consisting of mud, silt, sand, gravel, and boulders, but also containing wood, peat, and other organic material. The soils of this area are similar in their composition to those of Alaska's western coastal plain and river deltas (Dorava and Hogan, 1995).

Groundwater in the Bethel area is mostly present in the form of an aquifer confined under permafrost in layers of silt, sand, and pebbles. A few isolated areas exist east and west of the city that are free of permafrost to a depth of 60 meters (Dorava and Hogan, 1995).

According to a well test log (06/30/1993), the depth of the well is approximately 400 feet below the ground surface. Based on data from a nearby well, the well is completed in a confined aquifer.

This system operates continuously and serves 12 residents through an unknown number of service connections.

US ARMY BETHEL NATIONAL GUARD DRINKING WATER PROTECTION AREA

In order to evaluate whether a drinking water source is at risk, we must first evaluate what are the most likely pathways for surface contamination to reach the groundwater. These areas are determined by looking at the characteristics of the soil, groundwater, aquifer, and well.

The most probable area for contamination to reach the drinking water well is the drinking water protection area. The drinking water protection area is the area circling the well (the area influenced by pumping) and also the area upgradient of the well, usually forming a parabola shape. Because releases of contaminants within the protection area are most likely to impact the well, this area will serve as the focus for voluntary protection efforts.

There are many different methods for calculating the size of protection areas. Drinking Water Protection (DWP) uses a combination of two simple groundwater flow equations, the Thiem and uniform flow equations for all groundwater wells screened in unconsolidated

material. The orientation of the protection zone is then drawn using a water table elevation map (if available) or a land surface elevation map of the area. The protection zone calculated by DWP is an estimate using the available information and resources, and may differ slightly from the actual capture zone. Because of uncertainties and changing site conditions, a factor of safety is added to the protection zone to form the drinking water protection area for the well.

The parameters used to calculate the shape of this protection zone are general for the whole alluvial plain and were obtained from various United States Geological Survey (USGS) reports, area well logs, and the Groundwater textbook by Freeze and Cherry (Freeze and Cherry, 1979).

The protection areas established for wells by the DEC are usually separated into two zones, limited by the watershed. These zones correspond to differences in the time-of-travel (TOT) of the water moving through the aquifer to the well. An analytical calculation was used to determine the size and shape of the protection area.

The time-of-travel for contaminants within the water varies and is dependent on the physical and chemical characteristics of each contaminant. The following is a summary of the two protection area zones for wells and the calculated time-of-travel for each:

Table 1. Definition of Zones

Zone	Definition
A	Several months time-of-travel
B	Less than the 2 year time-of-travel

The drinking water protection area for US Army Bethel National Guard was determined using an analytical calculation and includes Zones A and B (see Map A in Appendix A).

INVENTORY OF POTENTIAL AND EXISTING CONTAMINANT SOURCES

DWP has completed an inventory of potential and existing sources of contamination within the US Army Bethel National Guard drinking water protection area. This inventory was completed through a search of agency records and other publicly available information. Potential sources of contamination to the drinking water aquifer include a wide range of categories and types. Potential drinking water contaminants are found within agricultural, residential, commercial, and industrial areas, but can also occur within areas that have little or no development.

For the basis of all Class B public water system assessments, the following three categories of drinking water contaminants were inventoried:

- Bacteria and viruses;
- Nitrates and/or nitrites;
- Volatile organic chemicals

The sources are displayed on Map C of Appendix C and summarized in Table 1 of Appendix B.

RANKING OF CONTAMINANT RISKS

Once the potential and existing sources of contamination have been identified, they are assigned a ranking according to what type and level of risk they represent. Ranking of contaminant risks for a “potential” or “existing” source of contamination is a function of toxicity and volumes of specific contaminants associated with that source. Rankings include:

- Low;
- Medium;
- High; and
- Very High.

Tables 2 through 4 in Appendix B contain the ranking of potential and existing sources of contamination with respect to bacteria and viruses, nitrates and/or nitrites, and volatile organic chemicals.

VULNERABILITY OF US ARMY BETHEL NATIONAL GUARD DRINKING WATER SYSTEM

Vulnerability of a drinking water source to contamination is a combination of two factors:

- Natural Susceptibility; and
- Contaminant Risks.

A score for the Natural Susceptibility of the well is reached by considering the properties of the well and the aquifer.

Susceptibility of the Wellhead (0-25 Points)

+

Susceptibility of the Aquifer (0-25 Points)

=

Natural Susceptibility of the Well (0-50 Points)

A ranking is assigned for the Natural Susceptibility according to the point score:

Natural Susceptibility Ratings	
40-50 pts	Very High
30 to < 40 pts	High
20 to < 30 pts	Medium
< 20 pts	Low

Factors contributing to the susceptibility of the wellhead are: whether the sanitary seal is in place, protection from flooding, and if the well casing is properly grouted.

The wellhead for the US Army Bethel National Guard received a **Medium** susceptibility rating largely because it lies within a suspected floodplain. There is no available sanitary survey for this system. A Potable Water Treatment System Plan Review (01/08/2002) indicates that a sanitary seal is installed on the well and the well is grouted. The status of the slope of the land around the well is unknown. Sanitary seals prevent potential contaminants from entering the well, while sloping of the land surface away from the wellhead provides adequate surface water drainage, and concrete or grouting around the wellhead helps to prevent potential contaminants from traveling down the outside of the well casing.

Factors contributing to the susceptibility of the aquifer are: whether the aquifer is confined or unconfined, whether the well is completed in unconsolidated or fractured bedrock, whether wells and bore holes are penetrating the aquifer and, if applicable, the confining layer.

The US Army Bethel National Guard system draws water from a confined aquifer overlain by 382 feet of permafrost (based on a nearby proxy well). It received a **High** susceptibility rating because of the presence of other wells that penetrate the vadose zone within the protection area. Wells penetrating the vadose zone can allow contaminants to travel into the shared aquifer with precipitation and runoff.

Table 2 summarizes the Susceptibility scores and ratings for the US Army Bethel National Guard system.

Table 2. Susceptibility

	Score	Rating
Susceptibility of the Wellhead	10	Medium
Susceptibility of the Aquifer	15	High
Natural Susceptibility	25	Medium

Contaminant risks are derived from an evaluation of the routine sampling results of the water system and the presence of potential sources of contamination. Contaminant risks to a drinking water source depend on the type and distribution of contaminant sources. Flow charts are used to assign a point score, and ratings are assigned in the same way as for the natural susceptibility:

Contaminant Risk Ratings	
40-50 pts	Very High
30 to < 40 pts	High
20 to < 30 pts	Medium
< 20 pts	Low

Table 3 summarizes the Contaminant Risks for each category of drinking water contaminants for the US Army Bethel National Guard system.

Table 3. Contaminant Risks

Category	Score	Rating
Bacteria and Viruses	40	Very High
Nitrates and/or Nitrites	50	Very High
Volatile Organic Chemicals	50	Very High

Finally, an overall vulnerability score is assigned for each water system by combining each of the contaminant risk scores with the natural susceptibility score:

$$\begin{aligned}
 &\text{Natural Susceptibility (0-50 Points)} \\
 &\quad + \\
 &\text{Contaminant Risks (0-50 Points)} \\
 &\quad = \\
 &\text{Vulnerability of the Drinking Water Source to} \\
 &\quad \text{Contamination (0-100 Points)}
 \end{aligned}$$

Again, rankings are assigned according to a point score:

Overall Vulnerability Ratings	
80-100 pts	Very High
60 to < 80 pts	High
40 to < 60 pts	Medium
< 40 pts	Low

Table 4 contains the overall vulnerability scores (0-100) and ratings for each of the three categories of drinking water contaminants for the US Army Bethel National Guard system. Note: scores are rounded off to the nearest five.

Table 4. Overall Vulnerability

Category	Score	Rating
Bacteria and Viruses	65	High
Nitrates and/or Nitrites	75	High
Volatile Organic Chemicals	75	High

Bacteria and Viruses

The contaminant risk for bacteria and viruses is **Very High**, with sewer lines, injection wells, wastewater holding tanks, abandoned wells, laundromats without dry cleaning, landfills, assumed septic systems, and roads contributing to the risk to the drinking water well.

Coliforms (a bacteria) are found naturally in the environment and while not necessarily a direct health threat, they are an indicator of other potentially harmful bacteria in the water, more specifically fecal coliforms and E. coli. These bacteria only come from human and animal fecal waste and can cause diarrhea, cramps, nausea, headaches, and other symptoms (EPA, 2008).

Only a small number of bacteria and viruses are required to endanger public health. Positive samples for bacteria and viruses increase the overall vulnerability of the drinking water source, indicating that the source is susceptible to bacteria and virus contamination. Bacteria and viruses have not been detected in the water within the last 5 years of water sampling of the system at US Army Bethel National Guard (data reviewed in April, 2008).

After combining the contaminant risk for bacteria and viruses with the natural susceptibility of the well, the overall vulnerability of the well to contamination is **High**.

Nitrates and Nitrites

The contaminant risk for nitrates and nitrites is **Very High**, with sewer lines, wastewater holding tanks, abandoned wells, cemeteries, laundromats without dry cleaning, landfills, assumed septic systems and roads contributing to the risk to the drinking water well.

Sampling history for US Army Bethel National Guard well indicates that nitrates have not been detected in the water within the last 5 years of sampling (data reviewed in April, 2008).

After combining the contaminant risk for nitrates and nitrites with the natural susceptibility of the well, the overall vulnerability of the well to contamination is **High**.

Volatile Organic Chemicals

The contaminant risk for volatile organic chemicals is **Very High**, with sewer lines, Class V injection wells, wastewater holding tanks, abandoned wells, laundromats without dry cleaning, landfills, motor vehicle repair shops, diesel and gasoline tanks, electric power generation, petroleum product bulk station, motor vehicle storage yards, firehouses, assumed septic systems, assumed and confirmed heating oil tanks, and roads contributing to the risk to the drinking water well.

The drinking water at US Army Bethel National Guard has not recently been sampled for volatile organic chemicals (data reviewed in April, 2008).

After combining the contaminant risk for volatile organic chemicals with the natural susceptibility of the well, the overall vulnerability of the well to contamination is **High**.

Using the Source Water Assessment

This assessment of contaminant risks can be used as a foundation for local voluntary protection efforts as well as a basis for the continuous efforts on the part of US Army Bethel National Guard to protect public health. It is anticipated that Source Water Assessments will be updated every five years to reflect any changes in the vulnerability and/or susceptibility of US Army Bethel National Guard drinking water source.

REFERENCES

Alaska Department of Commerce, Community and Economic Development (ADCCED), Accessed 2009 [WWW document]. URL: http://www.commerce.state.ak.us/dca/commdb/CF_COMDB.htm

Dorava, J.M. and Hogan, E.V., 1995, Overview of Environmental and Hydrological Conditions at Bethel, Alaska. U.S. Geological Survey Open-File Report 95-173.

Freeze, R.A. and Cherry, J.A., 1979. Groundwater. Prentice-Hall, Englewood Cliffs, NJ.

United States Environmental Protection Agency (EPA), Accessed 2008 [WWW document]. URL: <http://www.epa.gov/safewater/contaminants/index.html>.

APPENDIX A

US Army Bethel National Guard Drinking Water Protection Area Location Map (Map A)

Public Water Well System for PWS #270419.001 US Army Bethel National Guard



Legend



- Class B Public Water System Well
- Groundwater Protection Zones**
- Zone A Protection Area - Several Months Travel Time
- Zone B Protection Area - 2 Years Travel Time

Data Sources:
Contaminant Sources, Public Water System Wells, Alaska Department of Environmental Conservation (ADEC)

All other data:
Alaska Statewide Digital Mapping Initiative (SDMI)

Drinking Water Protection Areas based on "Alaska Drinking Water Protection Program - Guidance Manual for Class B Public Water Systems" published by ADEC

URS Corporation does not guarantee the accuracy or validity of the data provided.

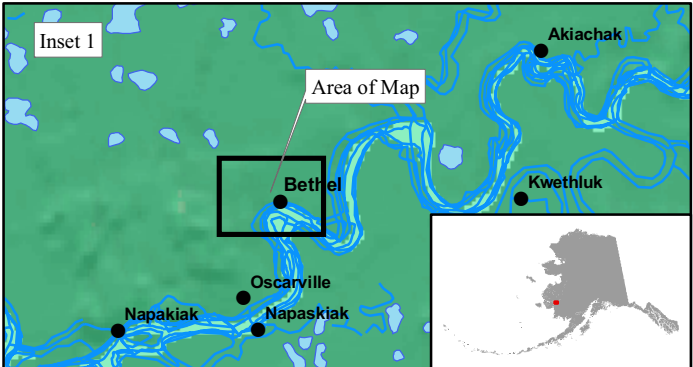

US Army Bethel National Guard
PWS 270419.001

Appendix A Map A

APPENDIX B

Contaminant Source Inventory and Risk Ranking for US Army Bethel National Guard (Tables 1-4)

Table 1**Contaminant Source Inventory for
US ARMY BETHEL NATL GUARD****PWSID 270419.001**

Contaminant Source Type	Contaminant Source ID	CS ID tag	Zone	Map Number	Comments
Motor /motor vehicle repair shops	C31	C31-02	A	C	
Motor /motor vehicle repair shops	C31	C31-03	A	C	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D01-04	A	C	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D01-05	A	C	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D01-06	A	C	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D01-07	A	C	
Injection wells (Class V) Motor Vehicle Waste Disposal Well	D42	D42-01	A	C	
Injection wells (Class V) Motor Vehicle Waste Disposal Well	D42	D42-02	A	C	
Septic systems (serves one single-family home)	R02	R02	A	C	40 assumed septic systems
Tanks, heating oil, residential (above ground)	R08	R08	A	C	40 assumed heating oil tanks
Tanks, diesel (above ground)	T06	T06-02	A	C	
Tanks, diesel (above ground)	T06	T06-03	A	C	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-08	A	C	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-09	A	C	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-10	A	C	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-11	A	C	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-12	A	C	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-13	A	C	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-14	A	C	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-15	A	C	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-16	A	C	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-17	A	C	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-18	A	C	
Wastewater Holding Tank	T22	T22-01	A	C	

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Map Number</i>	<i>Comments</i>
Wastewater Holding Tank	T22	T22-02	A	C	
Wastewater Holding Tank	T22	T22-03	A	C	
Wastewater Holding Tank	T22	T22-04	A	C	
Wastewater Holding Tank	T22	T22-05	A	C	
Wastewater Holding Tank	T22	T22-06	A	C	
Wastewater Holding Tank	T22	T22-07	A	C	
Wastewater Holding Tank	T22	T22-08	A	C	
Wastewater Holding Tank	T22	T22-09	A	C	
Wastewater Holding Tank	T22	T22-10	A	C	
Wastewater Holding Tank	T22	T22-11	A	C	
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-01	A	C	
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-02	A	C	
Open Leaking Underground Fuel Storage Tank (LUST) Sites	U07	U07-01	A	C	
Open Leaking Underground Fuel Storage Tank (LUST) Sites	U07	U07-02	A	C	
Abandoned wells	W01	W01-01	A	C	
Abandoned wells	W01	W01-02	A	C	
Monitoring wells	W06	W06-01	A	C	
Monitoring wells	W06	W06-02	A	C	
Cemeteries	X01	X01-01	A	C	
Cemeteries	X01	X01-02	A	C	
Cemeteries	X01	X01-03	A	C	
Glycol (disposal or storage)	X07	X07-01	A	C	
Glycol (disposal or storage)	X07	X07-02	A	C	
Glycol (disposal or storage)	X07	X07-03	A	C	
Glycol (disposal or storage)	X07	X07-04	A	C	
Glycol (disposal or storage)	X07	X07-05	A	C	
Glycol (disposal or storage)	X07	X07-06	A	C	

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Map Number</i>	<i>Comments</i>
Glycol (disposal or storage)	X07	X07-07	A	C	
Highways and roads, paved (cement or asphalt)	X20	X20	A	C	3 roads
Electric power generation (fossil fuels)	X36	X36-01	A	C	
Electric power generation (fossil fuels)	X36	X36-02	A	C	
Laundromats without dry cleaning	C22	C22-01	B	C	
Laundromats without dry cleaning	C22	C22-02	B	C	
Motor /motor vehicle repair shops	C31	C31-01	B	C	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D01-01	B	C	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D01-02	B	C	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D01-03	B	C	
Landfills (municipal; Class II)	D50	D50	B	C	
Septic systems (serves one single-family home)	R02	R02	B	C	20 assumed septic systems
Tanks, heating oil, residential (above ground)	R08	R08	B	C	20 assumed heating oil tanks
Tanks, diesel (above ground)	T06	T06-01	B	C	
Tanks, gasoline (above ground)	T10	T10-01	B	C	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-01	B	C	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-02	B	C	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-03	B	C	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-04	B	C	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-05	B	C	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-06	B	C	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-07	B	C	
Petroleum product bulk station/terminals	X11	X11-01	B	C	
Highways and roads, paved (cement or asphalt)	X20	X20	B	C	1 road
Motor vehicle/general storage yards/facilities	X27	X27-01	B	C	
Firehouses	X38	X38-01	B	C	
Firehouses	X38	X38-02	B	C	

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Map Number</i>	<i>Comments</i>
Firehouses	X38	X38-03	B	C	
Firehouses	X38	X38-04	B	C	

Table 2

*Contaminant Source Inventory and Risk Ranking for
US ARMY BETHEL NATL GUARD
Sources of Bacteria and Viruses*

PWSID 270419.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D01-04	A	Medium	C	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D01-05	A	Medium	C	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D01-06	A	Medium	C	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D01-07	A	Medium	C	
Injection wells (Class V) Motor Vehicle Waste Disposal Well	D42	D42-01	A	Low	C	
Injection wells (Class V) Motor Vehicle Waste Disposal Well	D42	D42-02	A	Low	C	
Septic systems (serves one single-family home)	R02	R02	A	Low	C	40 assumed septic systems
Wastewater Holding Tank	T22	T22-01	A	Low	C	
Wastewater Holding Tank	T22	T22-02	A	Low	C	
Wastewater Holding Tank	T22	T22-03	A	Low	C	
Wastewater Holding Tank	T22	T22-04	A	Low	C	
Wastewater Holding Tank	T22	T22-05	A	Low	C	
Wastewater Holding Tank	T22	T22-06	A	Low	C	
Wastewater Holding Tank	T22	T22-07	A	Low	C	
Wastewater Holding Tank	T22	T22-08	A	Low	C	
Wastewater Holding Tank	T22	T22-09	A	Low	C	
Wastewater Holding Tank	T22	T22-10	A	Low	C	
Wastewater Holding Tank	T22	T22-11	A	Low	C	

Table 2 (continued)

*Contaminant Source Inventory and Risk Ranking for
US ARMY BETHEL NATL GUARD
Sources of Bacteria and Viruses*

PWSID 270419.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Abandoned wells	W01	W01-01	A	Medium	C	
Abandoned wells	W01	W01-02	A	Medium	C	
Highways and roads, paved (cement or asphalt)	X20	X20	A	Low	C	3 roads
Laundromats without dry cleaning	C22	C22-01	B	Low	C	
Laundromats without dry cleaning	C22	C22-02	B	Low	C	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D01-01	B	Medium	C	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D01-02	B	Medium	C	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D01-03	B	Medium	C	
Landfills (municipal; Class II)	D50	D50	B	High	C	
Septic systems (serves one single-family home)	R02	R02	B	Low	C	20 assumed septic systems
Highways and roads, paved (cement or asphalt)	X20	X20	B	Low	C	1 road

Table 3

*Contaminant Source Inventory and Risk Ranking for
US ARMY BETHEL NATL GUARD
Sources of Nitrates/Nitrites*

PWSID 270419.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D01-04	A	Medium	C	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D01-05	A	Medium	C	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D01-06	A	Medium	C	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D01-07	A	Medium	C	
Septic systems (serves one single-family home)	R02	R02	A	Low	C	40 assumed septic systems
Wastewater Holding Tank	T22	T22-01	A	Low	C	
Wastewater Holding Tank	T22	T22-02	A	Low	C	
Wastewater Holding Tank	T22	T22-03	A	Low	C	
Wastewater Holding Tank	T22	T22-04	A	Low	C	
Wastewater Holding Tank	T22	T22-05	A	Low	C	
Wastewater Holding Tank	T22	T22-06	A	Low	C	
Wastewater Holding Tank	T22	T22-07	A	Low	C	
Wastewater Holding Tank	T22	T22-08	A	Low	C	
Wastewater Holding Tank	T22	T22-09	A	Low	C	
Wastewater Holding Tank	T22	T22-10	A	Low	C	
Wastewater Holding Tank	T22	T22-11	A	Low	C	
Abandoned wells	W01	W01-01	A	High	C	
Abandoned wells	W01	W01-02	A	High	C	
Cemeteries	X01	X01-01	A	Medium	C	

Table 3 (continued)

*Contaminant Source Inventory and Risk Ranking for
US ARMY BETHEL NATL GUARD
Sources of Nitrates/Nitrites*

PWSID 270419.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Cemeteries	X01	X01-02	A	Medium	C	
Cemeteries	X01	X01-03	A	Medium	C	
Highways and roads, paved (cement or asphalt)	X20	X20	A	Low	C	3 roads
Laundromats without dry cleaning	C22	C22-01	B	Low	C	
Laundromats without dry cleaning	C22	C22-02	B	Low	C	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D01-01	B	Medium	C	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D01-02	B	Medium	C	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D01-03	B	Medium	C	
Landfills (municipal; Class II)	D50	D50	B	Very High	C	
Septic systems (serves one single-family home)	R02	R02	B	Low	C	20 assumed septic systems
Highways and roads, paved (cement or asphalt)	X20	X20	B	Low	C	1 road

Table 4

*Contaminant Source Inventory and Risk Ranking for
US ARMY BETHEL NATL GUARD
Sources of Volatile Organic Chemicals*

PWSID 270419.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Motor /motor vehicle repair shops	C31	C31-02	A	Medium	C	
Motor /motor vehicle repair shops	C31	C31-03	A	Medium	C	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D01-04	A	Low	C	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D01-05	A	Low	C	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D01-06	A	Low	C	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D01-07	A	Low	C	
Injection wells (Class V) Motor Vehicle Waste Disposal Well	D42	D42-01	A	High	C	
Injection wells (Class V) Motor Vehicle Waste Disposal Well	D42	D42-02	A	High	C	
Septic systems (serves one single-family home)	R02	R02	A	Low	C	40 assumed septic systems
Tanks, heating oil, residential (above ground)	R08	R08	A	Medium	C	40 assumed heating oil tanks
Tanks, diesel (above ground)	T06	T06-02	A	Medium	C	
Tanks, diesel (above ground)	T06	T06-03	A	Medium	C	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-08	A	Low	C	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-09	A	Low	C	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-10	A	Low	C	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-11	A	Low	C	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-12	A	Low	C	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-13	A	Low	C	

Table 4 (continued)

*Contaminant Source Inventory and Risk Ranking for
US ARMY BETHEL NATL GUARD
Sources of Volatile Organic Chemicals*

PWSID 270419.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Tanks, heating oil, nonresidential (aboveground)	T14	T14-14	A	Low	C	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-15	A	Low	C	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-16	A	Low	C	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-17	A	Low	C	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-18	A	Low	C	
Wastewater Holding Tank	T22	T22-01	A	Medium	C	
Wastewater Holding Tank	T22	T22-02	A	Medium	C	
Wastewater Holding Tank	T22	T22-03	A	Medium	C	
Wastewater Holding Tank	T22	T22-04	A	Medium	C	
Wastewater Holding Tank	T22	T22-05	A	Medium	C	
Wastewater Holding Tank	T22	T22-06	A	Medium	C	
Wastewater Holding Tank	T22	T22-07	A	Medium	C	
Wastewater Holding Tank	T22	T22-08	A	Medium	C	
Wastewater Holding Tank	T22	T22-09	A	Medium	C	
Wastewater Holding Tank	T22	T22-10	A	Medium	C	
Wastewater Holding Tank	T22	T22-11	A	Medium	C	
Abandoned wells	W01	W01-01	A	High	C	
Abandoned wells	W01	W01-02	A	High	C	
Highways and roads, paved (cement or asphalt)	X20	X20	A	Low	C	3 roads
Electric power generation (fossil fuels)	X36	X36-01	A	Medium	C	

Table 4 (continued)

*Contaminant Source Inventory and Risk Ranking for
US ARMY BETHEL NATL GUARD
Sources of Volatile Organic Chemicals*

PWSID 270419.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Electric power generation (fossil fuels)	X36	X36-02	A	Medium	C	
Laundromats without dry cleaning	C22	C22-01	B	Low	C	
Laundromats without dry cleaning	C22	C22-02	B	Low	C	
Motor /motor vehicle repair shops	C31	C31-01	B	Medium	C	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D01-01	B	Low	C	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D01-02	B	Low	C	
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D01-03	B	Low	C	
Landfills (municipal; Class II)	D50	D50	B	High	C	
Septic systems (serves one single-family home)	R02	R02	B	Low	C	20 assumed septic systems
Tanks, heating oil, residential (above ground)	R08	R08	B	Medium	C	20 assumed heating oil tanks
Tanks, diesel (above ground)	T06	T06-01	B	Medium	C	
Tanks, gasoline (above ground)	T10	T10-01	B	Medium	C	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-01	B	Low	C	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-02	B	Low	C	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-03	B	Low	C	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-04	B	Low	C	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-05	B	Low	C	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-06	B	Low	C	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-07	B	Low	C	

Table 4 (continued)

Contaminant Source Inventory and Risk Ranking for
US ARMY BETHEL NATL GUARD
Sources of Volatile Organic Chemicals


PWSID 270419.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Petroleum product bulk station/terminals	X11	X11-01	B	Very High	C	
Highways and roads, paved (cement or asphalt)	X20	X20	B	Low	C	1 road
Motor vehicle/general storage yards/facilities	X27	X27-01	B	Low	C	
Firehouses	X38	X38-01	B	Low	C	
Firehouses	X38	X38-02	B	Low	C	
Firehouses	X38	X38-03	B	Low	C	
Firehouses	X38	X38-04	B	Low	C	

APPENDIX C

US Army Bethel National Guard Drinking Water Protection Area and Potential and Existing Contaminant Sources (Map C)

**Public Water Well System for PWS #270419.001 US Army Bethel National Guard
Showing Potential and Existing Sources of Contamination**

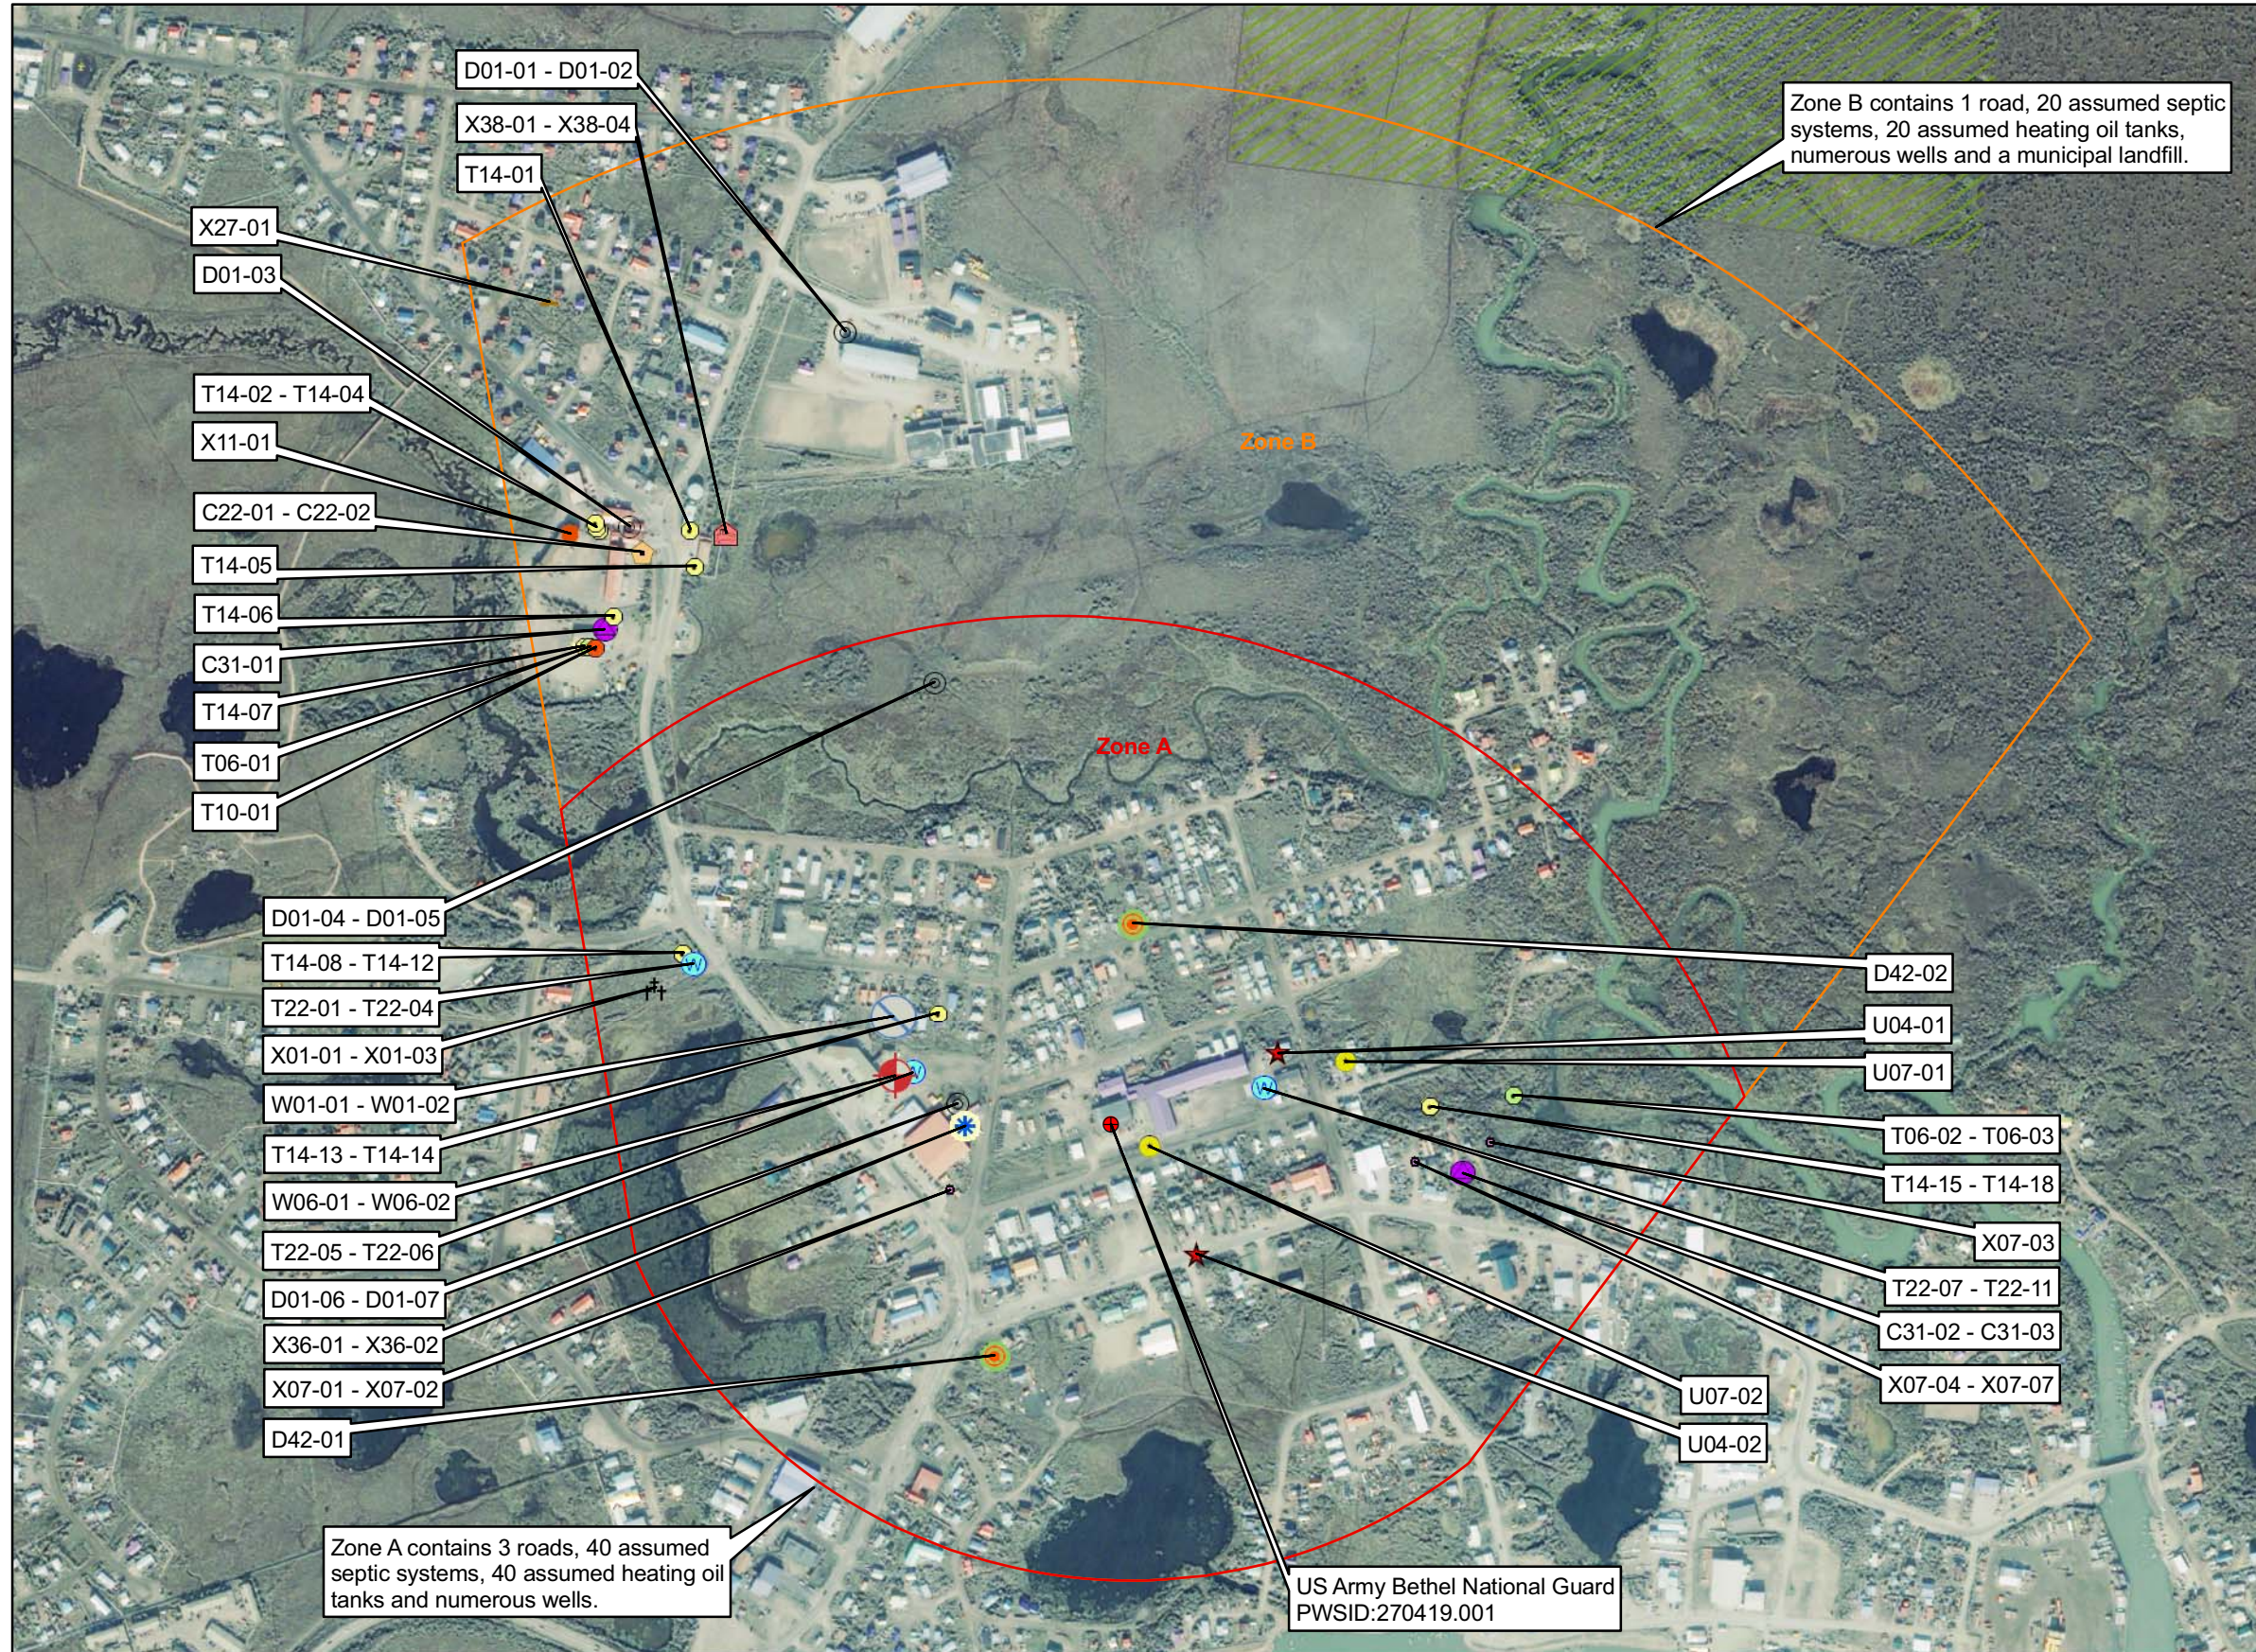

Legend

- Class B Public Water System Well

Groundwater Protection Zones

- Zone A Protection Area - Several Months Travel Time
- Zone B Protection Area - 2 Years Travel Time

Potential and Existing Contaminant Sources

- 🏠 Laundromats without dry cleaning (C22)
- 🚗 Motor /motor vehicle repair shops (C31)
- 🗑️ Domestic wastewater collection systems (sewer lines or lift stations) (D01)
- 🚰 Injection wells (Class V) Motor Vehicle Waste Disposal Well (D42)
- 🛢️ Tanks, diesel (above ground) (T06)
- 🛢️ Tanks, gasoline (above ground) (T10)
- 🛢️ Tanks, heating oil, nonresidential (aboveground) (T14)
- 🚰 Wastewater Holding Tank (T22)
- ★ Contaminated sites, DEC recognized, non-Superfund, non-RCRA (U04)
- 🚰 Open Leaking Underground Fuel Storage Tank (LUST) Sites (U07)
- 🚰 Abandoned wells (W01)
- 🚰 Monitoring wells (W06)
- ⚰ Cemeteries (X01)
- 🚰 Glycol (disposal/storage) (X07)
- 🚰 Petroleum product bulk station/terminals (X11)
- 🚰 Motor vehicle/general storage yards/facilities (X27)
- ⚡ Electric power generation (fossil fuels) (X36)
- 🚒 Firehouses (X38)
- 🗑️ Landfills (municipal; Class II) (D50)

Data Sources:
Contaminant Sources, Public Water System Wells, Alaska Department of Environmental Conservation (ADEC)

All other data:
Alaska Statewide Digital Mapping Initiative (SDMI)

Drinking Water Protection Areas based on "Alaska Drinking Water Protection Program - Guidance Manual for Class B Public Water Systems" published by ADEC.

Apparent misalignment between geographic features and aerial imagery may be present due to differences in source data. URS Corporation does not guarantee the accuracy or validity of the data provided.

