



---

# Source Water Assessment

A Hydrogeologic Susceptibility and  
Vulnerability Assessment for  
Victory Bible Camp  
Drinking Water System,  
Chickaloon, Alaska  
Victory Bible Camp # 226567

DRINKING WATER PROTECTION PROGRAM REPORT 251  
Alaska Department of Environmental Conservation

AUGUST 2002

---

Source Water Assessment for  
Victory Bible Camp  
Drinking Water System,  
Chickaloon, Alaska  
Victory Bible Camp # 226567

By Shannon & Wilson, Inc.

DRINKING WATER PROTECTION PROGRAM REPORT 251

The Drinking Water Protection Program is producing Source Water Assessments in compliance with the Safe Drinking Water Act Amendments of 1996. Each assessment includes a delineation of the source water area, an inventory of potential and existing contaminant sources that may impact the water, a risk ranking for each of these contaminants, and an evaluation of the potential vulnerability of these drinking water sources.

These assessments are intended to provide public water systems owners/operators, communities, and local governments with the best available information that may be used to protect the quality of their drinking water. The assessments combine information obtained from various sources, including the U.S. Environmental Protection Agency, Alaska Department of Environmental Conservation (ADEC), public water system owners/operators, and other public information sources. The results of this assessment are subject to change if additional data becomes available. If you have any additional information that may affect the results of this assessment, please contact the Program Coordinator of DWPP, (907) 269-7521.

---

## CONTENTS

	Page		Page
Executive Summary	1	Inventory of Potential and Existing	
Introduction	1	Contaminant Sources	3
Description of the Matanuska River Valley		Ranking of Contaminant Risks	3
Watershed, Alaska	2	Vulnerability of Victory Bible Camp	
Victory Bible Camp Public Drinking		Drinking Water Source	3
Water System	2	Summary	4
Victory Bible Camp Protection Area	3	References Cited	5

## TABLES

Table 1 - Definition of Zones	3
Table 2 - Natural Susceptibility - Susceptibility of the Aquifer to Contamination	3
Table 3 - Contaminant Risks	4
Table 4 - Overall Vulnerability of Victory Bible Camp to Contamination	4

## ILLUSTRATIONS

FIGURE	1. Index map showing the location of Matanuska River Valley	Page 1
--------	-------------------------------------------------------------	-----------

## APPENDICES

APPENDIX	A. Victory Bible Camp Drinking Water Protection Area (Map 1)	
	B. Contaminant Source Inventory for Victory Bible Camp (Table 1)	
	Contaminant Source Inventory and Risk Ranking for Victory Bible Camp – Bacteria and Viruses (Table 2)	
	Contaminant Source Inventory and Risk Ranking for Victory Bible Camp – Nitrates/Nitrites (Table 3)	
	Contaminant Source Inventory and Risk Ranking for Victory Bible Camp – Volatile Organic Chemicals (Table 4)	
	C. Victory Bible Camp Drinking Water Protection Area and Potential and Existing Contaminant Sources (Maps 2 & 3)	
	D. Vulnerability Analysis for Contaminant Source Inventory and Risk Ranking for Victory Bible Camp Public Drinking Water Source (Charts 1 – 8)	

# Source Water Assessment for Victory Bible Camp Source of Public Drinking Water, Chickaloon, Alaska

By Shannon & Wilson, Inc.

## Drinking Water Protection Program Alaska Department of Environmental Conservation

### EXECUTIVE SUMMARY

The Victory Bible Camp is a Class B (transient/non-community) water system consisting of one spring, located at Mile 94.6 of the Glenn Highway, east of Chickaloon, Alaska. Identified potential and current sources of contaminants for Victory Bible Camp public drinking water source include: large-capacity and single-family septic systems; residential areas; and roads. These identified potential and existing sources of contamination are considered sources of bacteria and viruses, nitrates and/or nitrites, and volatile organic chemicals. Overall, the public water sources for Victory Bible Camp received a vulnerability rating of **Medium** for volatile organic chemicals, **Very High** for bacteria and viruses, and **Very High** for nitrates and nitrites.

### INTRODUCTION

The Alaska Department of Environmental Conservation (ADEC) is completing source water assessments for all public drinking water sources in the State of Alaska. The purpose of this assessment is to provide owners and/or operators, communities, and local governments with information they can use to preserve the quality of Alaska's public drinking water supplies. The results of this source water assessment can be used to decide where voluntary protection efforts are needed and feasible, and also what efforts will be most effective in reducing contaminant risks to your water system. Shannon & Wilson has been contracted to perform these assessments under the supervision of ADEC.

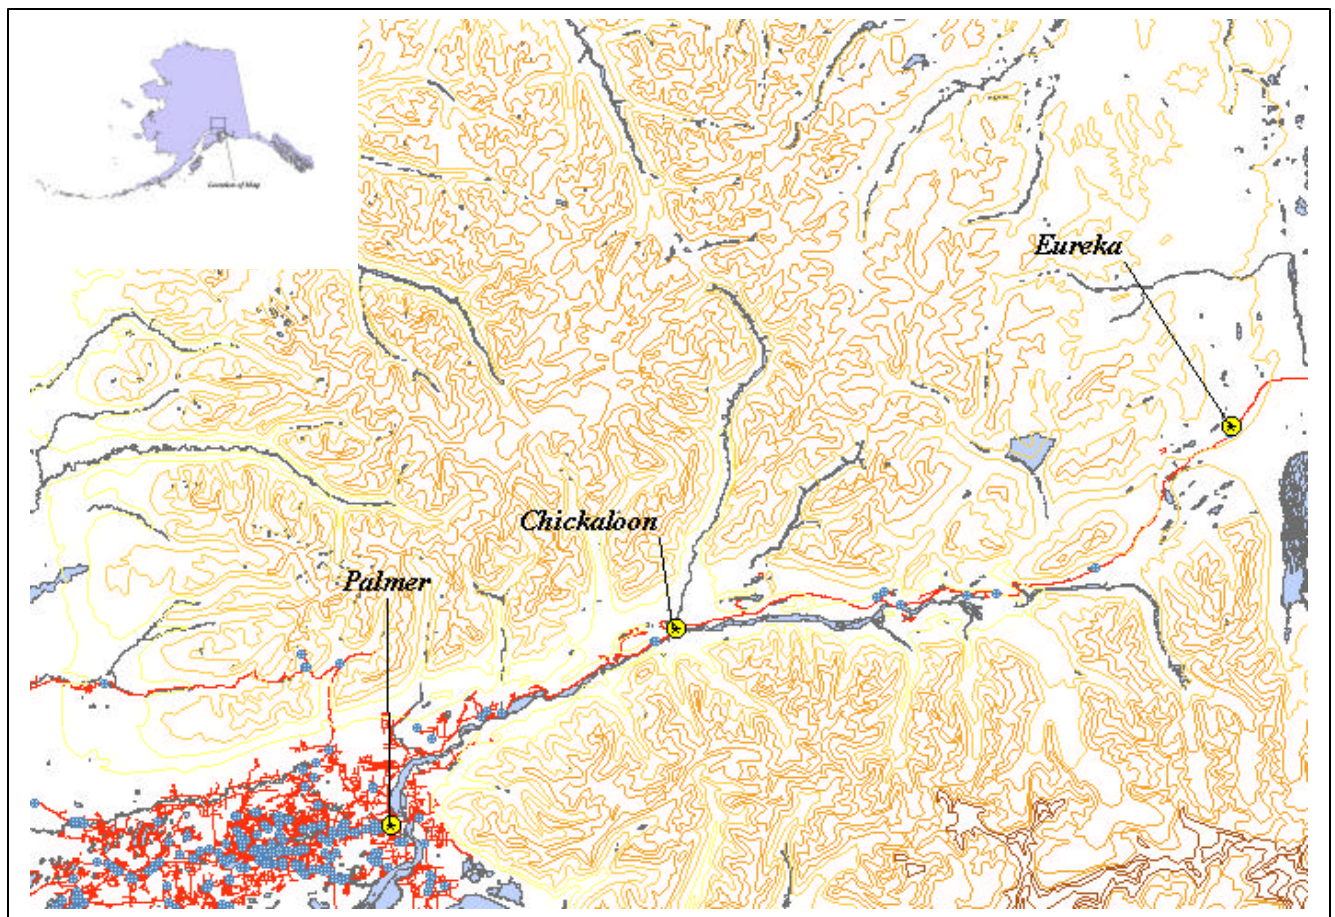


Figure 1. Index map showing the location of the Matanuska River Valley

This source water assessment combines a review of the natural conditions at the site and the potential and existing contaminant risks. These are combined to determine the overall vulnerability of the drinking water source to contamination.

## **DESCRIPTION OF THE MATANUSKA RIVER VALLEY, ALASKA**

### **Location**

The Matanuska River Valley is a narrow incised valley coursing through the Talkeetna Mountains from the terminus of the Matanuska Glacier to Knik Arm. The Matanuska River Valley is shown in Figure 1. The area is located in the Matanuska-Susitna (Mat-Su) Borough and flows by the town of Palmer, Alaska.

Glacial and alluvial forces have shaped the Matanuska River Valley. These forces have resulted in the relatively narrow, incised river valley as the river cuts through the Talkeetna Mountains and a broad meandering river valley as the river exits the mountains. Landforms in the river valley are typified by the steep valley walls, bedrock outcrops, the river floodplains, and lakes and streams.

### **Precipitation**

While the upper portion of the Matanuska River Valley likely experiences higher amounts of precipitation, Palmer averages about 16 inches of precipitation per year, including about 59 inches of snow.

### **Topography and Drainage**

The area topography varies from about 300 feet to 400 feet within the river floodplain to several thousand feet on the surrounding ridges and mountain flanks.

### **Groundwater**

Although the quality can vary significantly in a short distance, groundwater supplies are generally abundant in the areas along the river. Many homes and businesses in the area rely on individual wells for their water supply. Most of these wells are shallow with depths of less than 100 feet to 200 feet. Static water levels in many of these wells are less than 15 feet below the surface. The coarse, alluvial, sandy gravel in the floodplains of the areas streams and rivers provides a large aquifer even in the winter when infiltration is low.

### **Geology and Soils**

Most of the soils in the area provide good sources of sand, gravel and topsoil. The deposition of silt, clay

and organic muck in old lakes, oxbows and depressions means that some areas have soil conditions that vary over relatively short distances. Bedrock outcrops and shallow bedrock are common along the margins of the river floodplain.

## **VICTORY BIBLE CAMP PUBLIC DRINKING WATER SYSTEM**

Victory Bible Camp is a Class B (transient/non-community) water system. The system consists of a spring at Mile 94.6 of the Glenn Highway

The most recent Sanitary Survey (11/22/88) indicates the spring is enclosed by a permanent structure, was not susceptible to flooding, and that the intake was adequately constructed. A properly constructed intake prevents contamination of the source at the system connection.

This system operates year-round and serves 0 residents and more than 200 non-residents through one service connection.

## **VICTORY BIBLE CAMP DRINKING WATER PROTECTION AREA**

In order to evaluate whether a drinking water source is at risk, we must first evaluate what are the most likely pathways for surface contamination to reach the spring. Some areas are more likely to allow contamination to reach the spring than others. These areas are determined by looking at the characteristics of the soil, groundwater, aquifer, and intake.

The most probable area for contamination to reach the spring intake is the area that contributes water to the perched aquifer area. This area is designated as the Drinking Water Protection Area (DWPA). Because a release of contaminants within the DWPA are most likely to impact the drinking water well, this area will serve as the focus for voluntary protection efforts.

Additional methods were also used to take into account any uncertainties in groundwater flow and aquifer characteristics to arrive at a meaningful DWPA (Please refer to the Guidance Manual for Class B Public Water Systems for additional information).

The DWPAs established for springs by the ADEC are separated into three zones. These zones correspond to differences in the aerial distances from the spring intake and the entire watershed boundary. Little is known about the time of travel for contaminants, thus conservative distances have been established to provide protection for the spring. The following is a summary of the three DWPA zones and the calculations for each:

**Table 1. Definition of Zones**

<b>Zone</b>	<b>Definition</b>
A	1000 Feet from the Spring Intake
B	1 Mile from the Spring Intake
C	Entire Watershed

**INVENTORY OF POTENTIAL AND EXISTING CONTAMINANT SOURCES**

The Drinking Water Protection Program has completed an inventory of potential and existing sources of contamination within the Victory Bible Camp DWPA. This inventory was completed through a search of agency records and other publicly available information. Potential sources of contamination to the drinking water aquifer include a wide range of categories and types. Potential drinking water contaminants are found within agricultural, residential, commercial, and industrial areas, but can also occur within areas that have little or no development.

For the basis of all Class B public water system assessments, three categories of drinking water contaminants were inventoried, they include:

- Bacteria and viruses;
- Nitrates and/or nitrites; and
- Volatile organic chemicals.

Inventoried potential sources of contamination within Zones A through Zone C were associated with residential and light industrial type activities. The sources are summarized in the tables in Appendix B.

**RANKING OF CONTAMINANT RISKS**

Once the potential and existing sources of contamination have been identified, they are sorted and ranked according to what type and level of risk they represent. Ranking of contaminant risks for a “potential” or “existing” source of contamination is a function of toxicity and volumes of specific contaminants associated with that source. Further, contaminant risks are a function of the number and density of those types of contaminant sources as well as the proximity of those sources to the well.

**VULNERABILITY OF VICTORY BIBLE CAMP DRINKING WATER SOURCE**

Vulnerability of a drinking water source to contamination is a combination of two factors:

- Natural susceptibility; and
- Contaminant risks.

Each of the three categories of drinking water contaminants has been analyzed and an overall vulnerability score of 0 to 100 is ultimately assigned:

$$\begin{aligned} &\text{Natural Susceptibility (0 – 50 points)} \\ &+ \\ &\text{Contaminant Risks (0 – 50 points)} \\ &= \\ &\text{Vulnerability of the} \\ &\text{Drinking Water Source to Contamination (0 – 100).} \end{aligned}$$

A score for the Natural Susceptibility is achieved by analyzing the properties of the spring and the aquifer.

$$\begin{aligned} &\text{Susceptibility of the Spring (0 – 25 Points)} \\ &+ \\ &\text{Susceptibility of the Aquifer (0 – 25 Points)} \\ &= \\ &\text{Natural Susceptibility (Susceptibility of the Spring)} \\ &\text{(0 – 50 Points)} \end{aligned}$$

The spring for Victory Bible Camp exists in an unconfined aquifer setting. Because an unconfined aquifer is recharged by surface water and precipitation that migrates downward from the surface, contaminants at the surface have the potential to adversely impact this aquifer. Table 2 shows the Overall Susceptibility score and rating for Victory Bible Camp.

**Table 2. Natural Susceptibility - Susceptibility of the Wellhead and Aquifer to Contamination**

	<b>Score</b>	<b>Rating</b>
Susceptibility of the Spring	10	Medium
Susceptibility of the Aquifer	25	Very High
Natural Susceptibility	35	High

Contaminant risks to a drinking water source depend on the type, number or density, and distribution of contaminant sources. This data has been derived from an examination of existing or historical contamination that has been detected at the drinking water source through routine sampling. It also evaluates potential sources of contamination. Table 3 summarizes the Contaminant Risks for each category of drinking water contaminants.

**Table 3. Contaminant Risks**

Category	Score	Rating
Bacteria and Viruses	50	Very High
Nitrates and/or Nitrites	50	Very High
Volatile Organic Chemicals	22	Medium

Appendix D contains eight charts, which together form the ‘Vulnerability Analysis’ for a source water assessment for a public drinking water source. Chart 1 analyzes the ‘Susceptibility of the Spring Outlet/Intake’ to contamination by looking at the construction of the spring and its surrounding area. Chart 2 analyzes the ‘Susceptibility of the Aquifer’ to contamination by looking at the naturally-occurring attributes of the water source and influences on the groundwater system that might lead to contamination. Chart 3 analyzes ‘Contaminant Risks’ for the drinking water source with respect to bacteria and viruses. The ‘Contaminant Risks’ portion of the analysis considers potential sources of contaminants as well as a review of contamination that has or may have occurred, but has not arrived or been detected at the well. Lastly, Chart 4 contains the ‘Vulnerability Analysis for Bacteria and Viruses.’ Charts 5 through 8 contain the Contaminant Risks and Vulnerability Analyses for nitrates and nitrites and volatile organic chemicals, respectively.

Table 4 contains the overall vulnerability scores (0 – 100) and ratings for each of the three categories of drinking water contaminants. Note: scores are rounded off to the nearest five.

**Table 4. Overall Vulnerability of Victory Bible Camp to Contamination by Category**

Category	Score	Rating
Bacteria and Viruses	85	Very High
Nitrates and Nitrites	85	Very High
Volatile Organic Chemicals	55	Medium

Tables 2 through 4 in Appendix B contain the ranking of potential and existing sources of contamination with respect to bacteria and viruses, nitrates and/or nitrites, and volatile organic chemicals.

The large-capacity and single-family septic systems; residential areas; and roads create a risk increase for the bacteria and viruses, and nitrates and nitrites contaminant categories

Only a small amount of bacteria and viruses are required to endanger public health. Bacteria and viruses have not been detected during recent water sampling of the system at Victory Bible Camp.

Nitrates and/or nitrites are found in natural background concentration at this site, as elsewhere throughout Alaska. Nitrate concentrations in uncontaminated groundwater are typically less than 2 milligrams per liter (mg/L) and are derived primarily from the decomposition of organic matter in soils, adopted from the U.S. Geological Survey (Wang, et al., 2000).

Sampling history for Victory Bible Camp well indicates that low concentrations of nitrate have been detected (see Chart 5 - Contaminant Risks for Nitrates and/or Nitrites in Appendix D). Existing nitrate concentration is approximately 0.673 mg/L or 7% of the Maximum Contaminant Level (MCL) of 10 mg/L. The MCL is the maximum level of contaminant that is allowed to exist in drinking water and still be consumed by humans without harmful health effects. Due to the high solubility and weak retention by soil, nitrates are very mobile, moving at approximately the same rate as water. Though existing nitrate contamination was detected at the site, concentrations remain at very safe levels with respect to human health.

The large-capacity and single-family septic systems; residential areas; and roads located in Zones A and B form the greatest risk for volatile organic chemicals.

## SUMMARY

A *Source Water Assessment* has been completed for the sources of public drinking water serving Victory Bible Camp. The overall vulnerability of this source to contamination is **Medium** for volatile organic chemicals, **Very High** for bacteria and viruses, and **Very High** for nitrates and nitrites. This assessment of contaminant risks can be used as a foundation for local voluntary protection efforts as well as a basis for the continuous efforts on the part of Victory Bible Camp to protect public health. It is anticipated that *Source Water Assessments* will be updated every five years to reflect any changes in the vulnerability and/or susceptibility of Victory Bible Camp public drinking water source.

## REFERENCES CITED

Patrick, L.D., Brabets, T.P., and Glass, R.L., 1989, Simulation of ground-water flow at Anchorage, Alaska: US Geological Survey Water-Resources Investigations Report 88-4139, 41p.

Wang, B., Strelakos, P.M., and Jokela, J.B., 2000, Nitrate source indicators in ground water of the scimitar subdivision, Peters Creek Area, Anchorage, Alaska: US Geological Survey Water-Resources Investigations Report 00-4137.




Weather Underground, June 18, 2002, Web extension to the *Western Regional Climate Center* [WWW document]. URL <http://www.wunderground.com>




## **APPENDIX A**

### **Victory Bible Camp Drinking Water Protection Area (Map 1)**

# Drinking Water Protection Areas for Victory Bible Camp

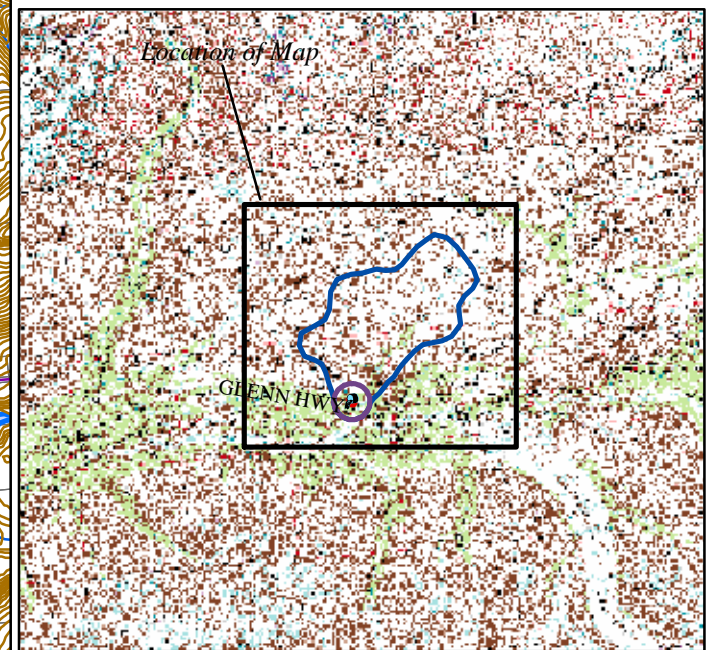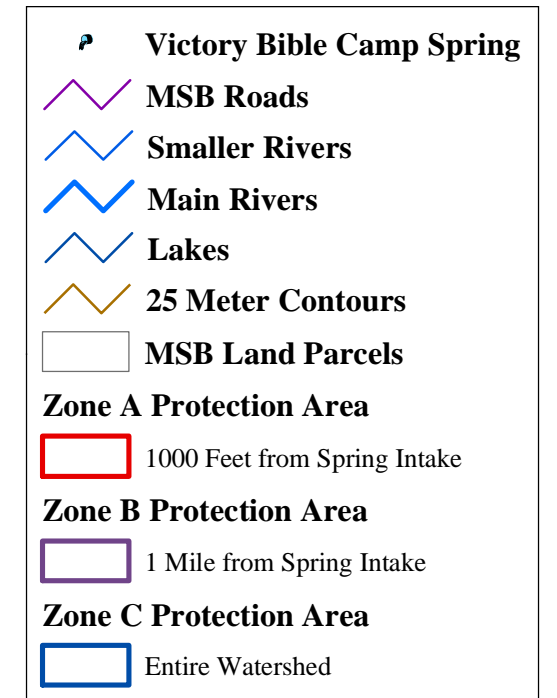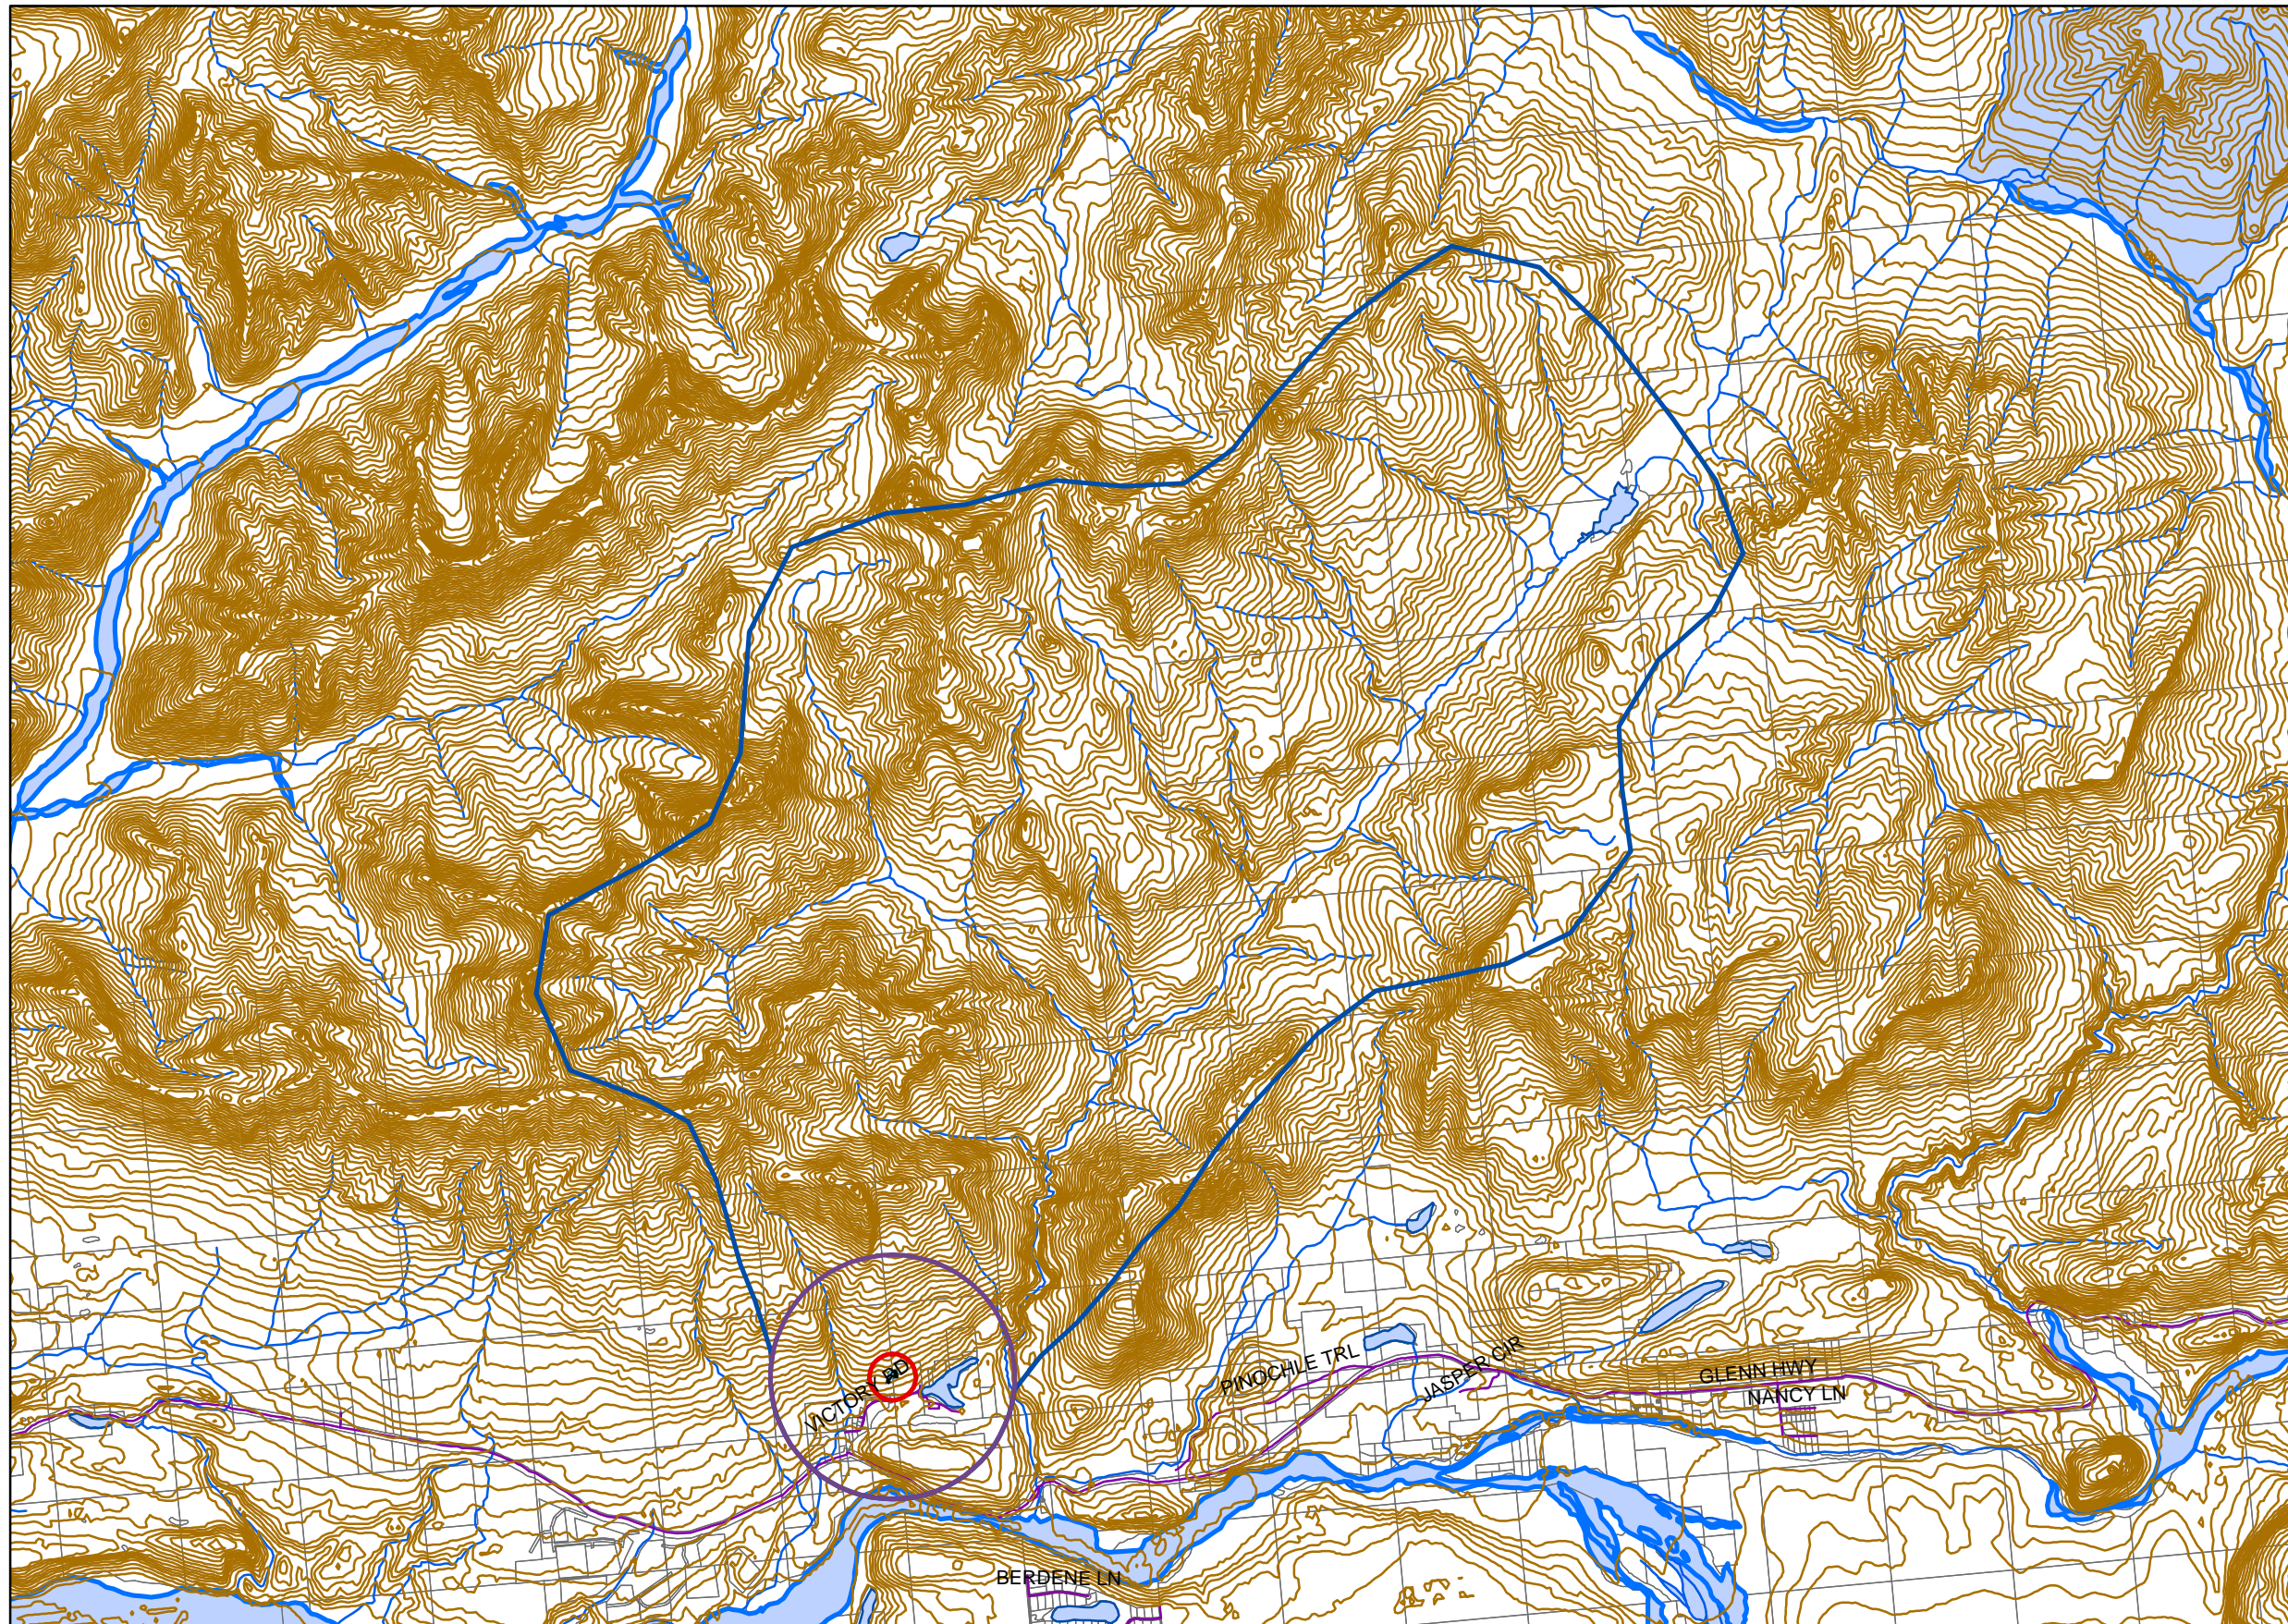

PWSID 226567.001



## Map 1

## **APPENDIX B**

### **Contaminant Source Inventory and Risk Ranking for Victory Bible Camp (Tables 1-4)**

**Table 1****Contaminant Source Inventory for  
Victory Bible Camp Spring****PWSID 226567.001**

<b>Contaminant Source Type</b>	<b>Contaminant Source ID</b>	<b>CS ID tag</b>	<b>Zone</b>	<b>Location</b>	<b>Map Number</b>	<b>Comments</b>
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-1	A	East of Spring	3	
Residential Areas	R01	R1-1	A	Residences along Victory Road	2	1 acre of residential area in Zone A
Septic systems (serves one single-family home)	R02	R2-1	A	South of Spring	3	
Septic systems (serves one single-family home)	R02	R2-2	A	South of Spring	3	
Highways and roads, dirt/gravel	X24	X24-1	A	Victory Road	2	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-2	B	NE of Spring	3	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-3	B	SE of Spring	3	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-4	B	SE of Spring	3	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-5	B	SW of Spring, east off Victory Road	3	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-6	B	West of Spring and Victory Road	3	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-7	B	West of Spring and Victory Road	3	
Residential Areas	R01	R1-2	B	Residences along Victory Road	2	40 acres of residential area in Zone B
Septic systems (serves one single-family home)	R02	R2-3-21	B	North of Glenn Highway, west of Victory Road	3	
Highways and roads, paved (cement or asphalt)	X20	X20-1	B	Glenn Highway	2	
Highways and roads, dirt/gravel	X24	X24-2	B	Victory Court	2	

*Contaminant Source Inventory and Risk Ranking for*

*PWSID 226567.001*

*Table 2*

*Victory Bible Camp Spring*

*Sources of Bacteria and Viruses*

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Overall Rank after Analysis</i>	<i>Location</i>	<i>Map Number</i>	<i>Comments</i>
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-1	A	High	1	East of Spring	3	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-2	B	High	2	NE of Spring	3	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-3	B	High	3	SE of Spring	3	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-4	B	High	4	SE of Spring	3	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-5	B	High	5	SW of Spring, east off Victory Road	3	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-6	B	High	6	West of Spring and Victory Road	3	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-7	B	High	7	West of Spring and Victory Road	3	
Residential Areas	R01	R1-1	A	Low	8	Residences along Victory Road	2	1 acre of residential area in Zone A
Septic systems (serves one single-family home)	R02	R2-1	A	Low	9	South of Spring	3	
Septic systems (serves one single-family home)	R02	R2-2	A	Low	10	South of Spring	3	
Highways and roads, dirt/gravel	X24	X24-1	A	Low		Victory Road	2	
Residential Areas	R01	R1-2	B	Low		Residences along Victory Road	2	40 acres of residential area in Zone B
Residential Areas	R01	R1-2	B	Low		Residences along Victory Road	2	40 acres of residential area in Zone B
Septic systems (serves one single-family home)	R02	R2-3-21	B	Low		North of Glenn Highway, west of Victory Road	3	
Highways and roads, paved (cement or asphalt)	X20	X20-1	B	Low		Glenn Highway	2	
Highways and roads, dirt/gravel	X24	X24-2	B	Low		Victory Court	2	

*Contaminant Source Inventory and Risk Ranking for*

PWSID 226567.001

Table 3

*Victory Bible Camp Spring*

*Sources of Nitrates/Nitrites*

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Overall Rank after Analysis</i>	<i>Location</i>	<i>Map Number</i>	<i>Comments</i>
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-1	A	High	1	East of Spring	3	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-2	B	High	2	NE of Spring	3	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-3	B	High	3	SE of Spring	3	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-4	B	High	4	SE of Spring	3	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-5	B	High	5	SW of Spring, east off Victory Road	3	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-6	B	High	6	West of Spring and Victory Road	3	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-7	B	High	7	West of Spring and Victory Road	3	
Residential Areas	R01	R1-1	A	Low	8	Residences along Victory Road	2	1 acre of residential area in Zone A
Septic systems (serves one single-family home)	R02	R2-1	A	Low	9	South of Spring	3	
Septic systems (serves one single-family home)	R02	R2-2	A	Low	10	South of Spring	3	
Highways and roads, dirt/gravel	X24	X24-1	A	Low		Victory Road	2	
Residential Areas	R01	R1-2	B	Low		Residences along Victory Road	2	40 acres of residential area in Zone B
Residential Areas	R01	R1-2	B	Low		Residences along Victory Road	2	40 acres of residential area in Zone B
Septic systems (serves one single-family home)	R02	R2-3-21	B	Low		North of Glenn Highway, west of Victory Road	3	
Highways and roads, paved (cement or asphalt)	X20	X20-1	B	Low		Glenn Highway	2	
Highways and roads, dirt/gravel	X24	X24-2	B	Low		Victory Court	2	

*Contaminant Source Inventory and Risk Ranking for*

PWSID 226567.001

Table 4

*Victory Bible Camp Spring*

*Sources of Volatile Organic Chemicals*


<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Overall Rank after Analysis</i>	<i>Location</i>	<i>Map Number</i>	<i>Comments</i>
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-1	A	Low	1	East of Spring	3	
Residential Areas	R01	R1-1	A	Low	2	Residences along Victory Road	2	1 acre of residential area in Zone A
Septic systems (serves one single-family home)	R02	R2-1	A	Low	3	South of Spring	3	
Septic systems (serves one single-family home)	R02	R2-2	A	Low	4	South of Spring	3	
Highways and roads, dirt/gravel	X24	X24-1	A	Low	5	Victory Road	2	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-2	B	Low	6	NE of Spring	3	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-3	B	Low	7	SE of Spring	3	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-4	B	Low	8	SE of Spring	3	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-5	B	Low	9	SW of Spring, east off Victory Road	3	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-6	B	Low	10	West of Spring and Victory Road	3	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-7	B	Low		West of Spring and Victory Road	3	
Residential Areas	R01	R1-2	B	Low		Residences along Victory Road	2	40 acres of residential area in Zone B
Residential Areas	R01	R1-2	B	Low		Residences along Victory Road	2	40 acres of residential area in Zone B
Septic systems (serves one single-family home)	R02	R2-3-21	B	Low		North of Glenn Highway, west of Victory Road	3	
Highways and roads, paved (cement or asphalt)	X20	X20-1	B	Low		Glenn Highway	2	
Highways and roads, dirt/gravel	X24	X24-2	B	Low		Victory Court	2	

## **APPENDIX C**


### **Victory Bible Camp Drinking Water Protection Area and Potential and Existing Contaminant Sources (Maps 2-3)**




# Drinking Water Protection Areas for Victory Bible Camp and Potential and Existing Sources of Contamination

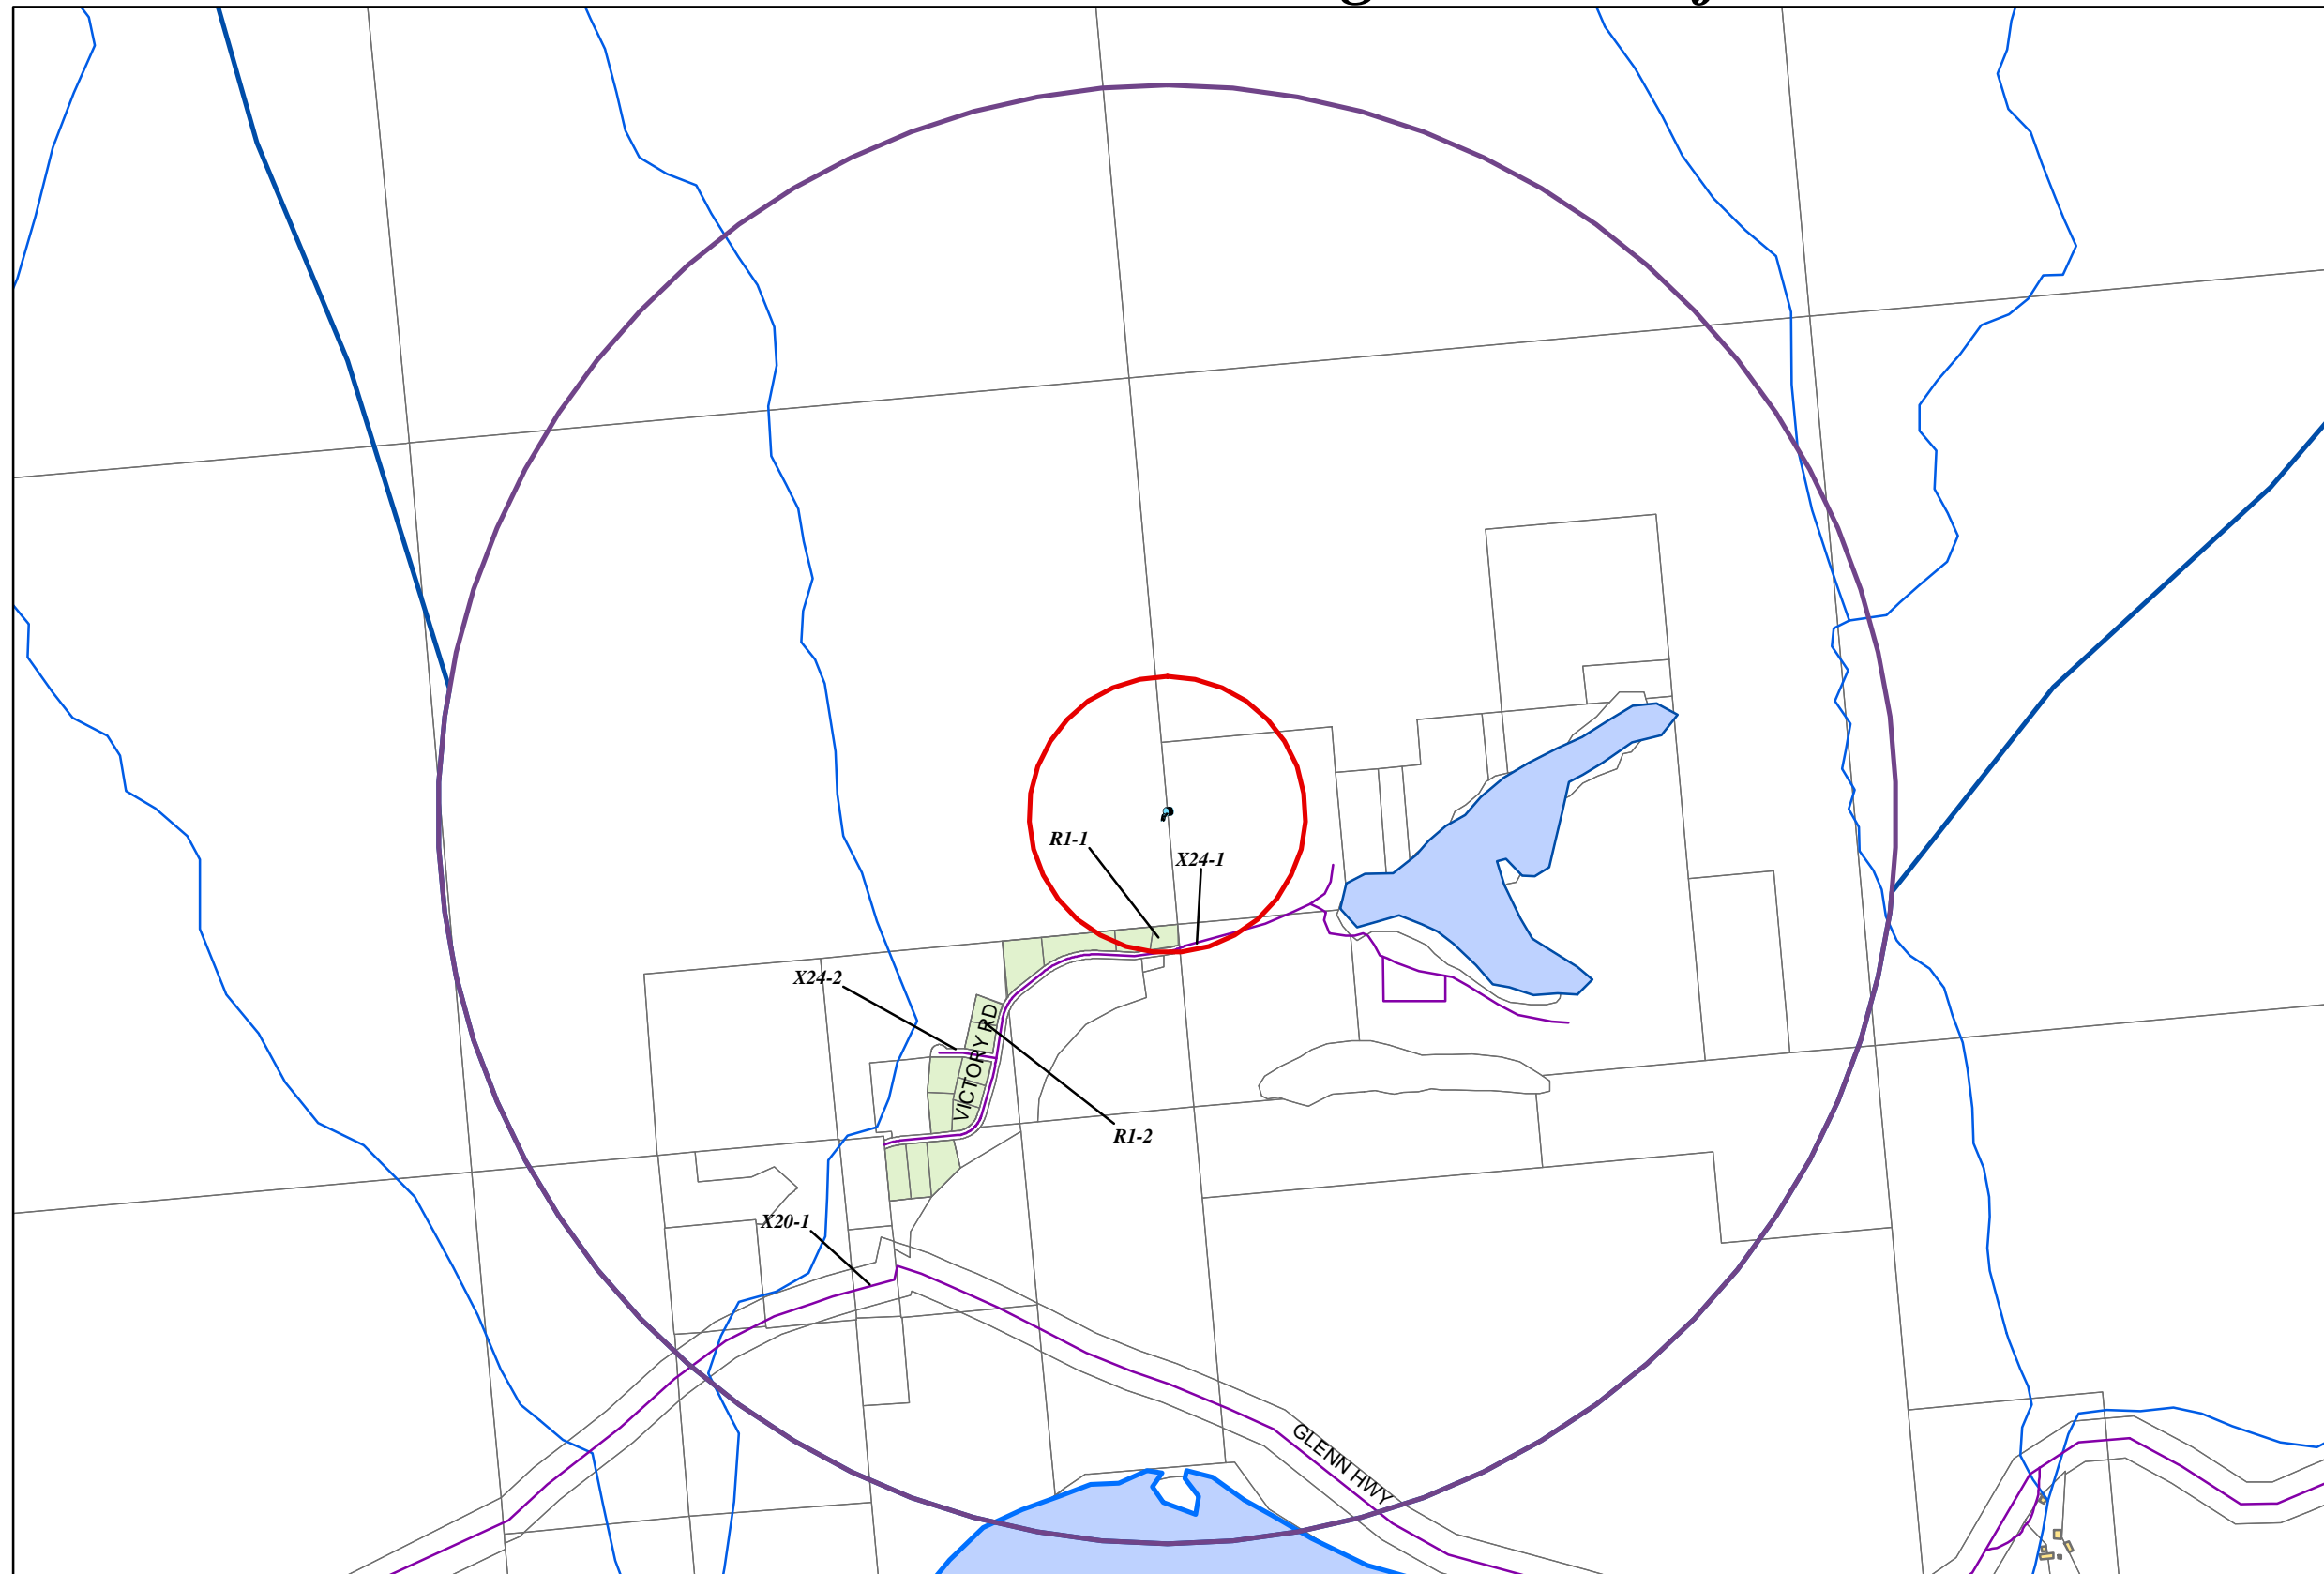

- Victory Bible Camp Spring
- MSB Roads
- Smaller Rivers
- Main Rivers
- Lakes
- MSB Land Parcels
- Residential Areas (R1)
- Zone A Protection Area**
- 1000 Feet from Spring Intake
- Zone B Protection Area**
- 1 Mile from Spring Intake
- Zone C Protection Area**
- Entire Watershed

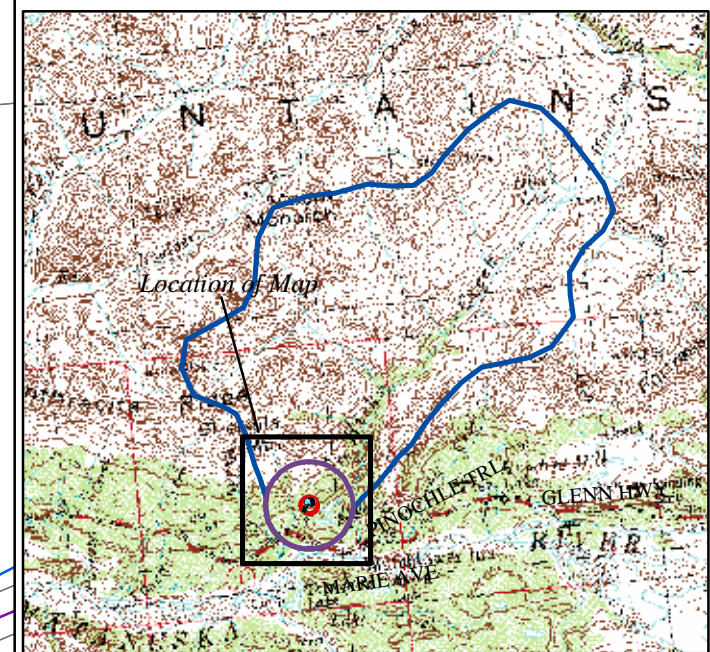


PWSID 226567.001





*Map 2*

# Drinking Water Protection Areas for Victory Bible Camp and Potential and Existing Sources of Contamination

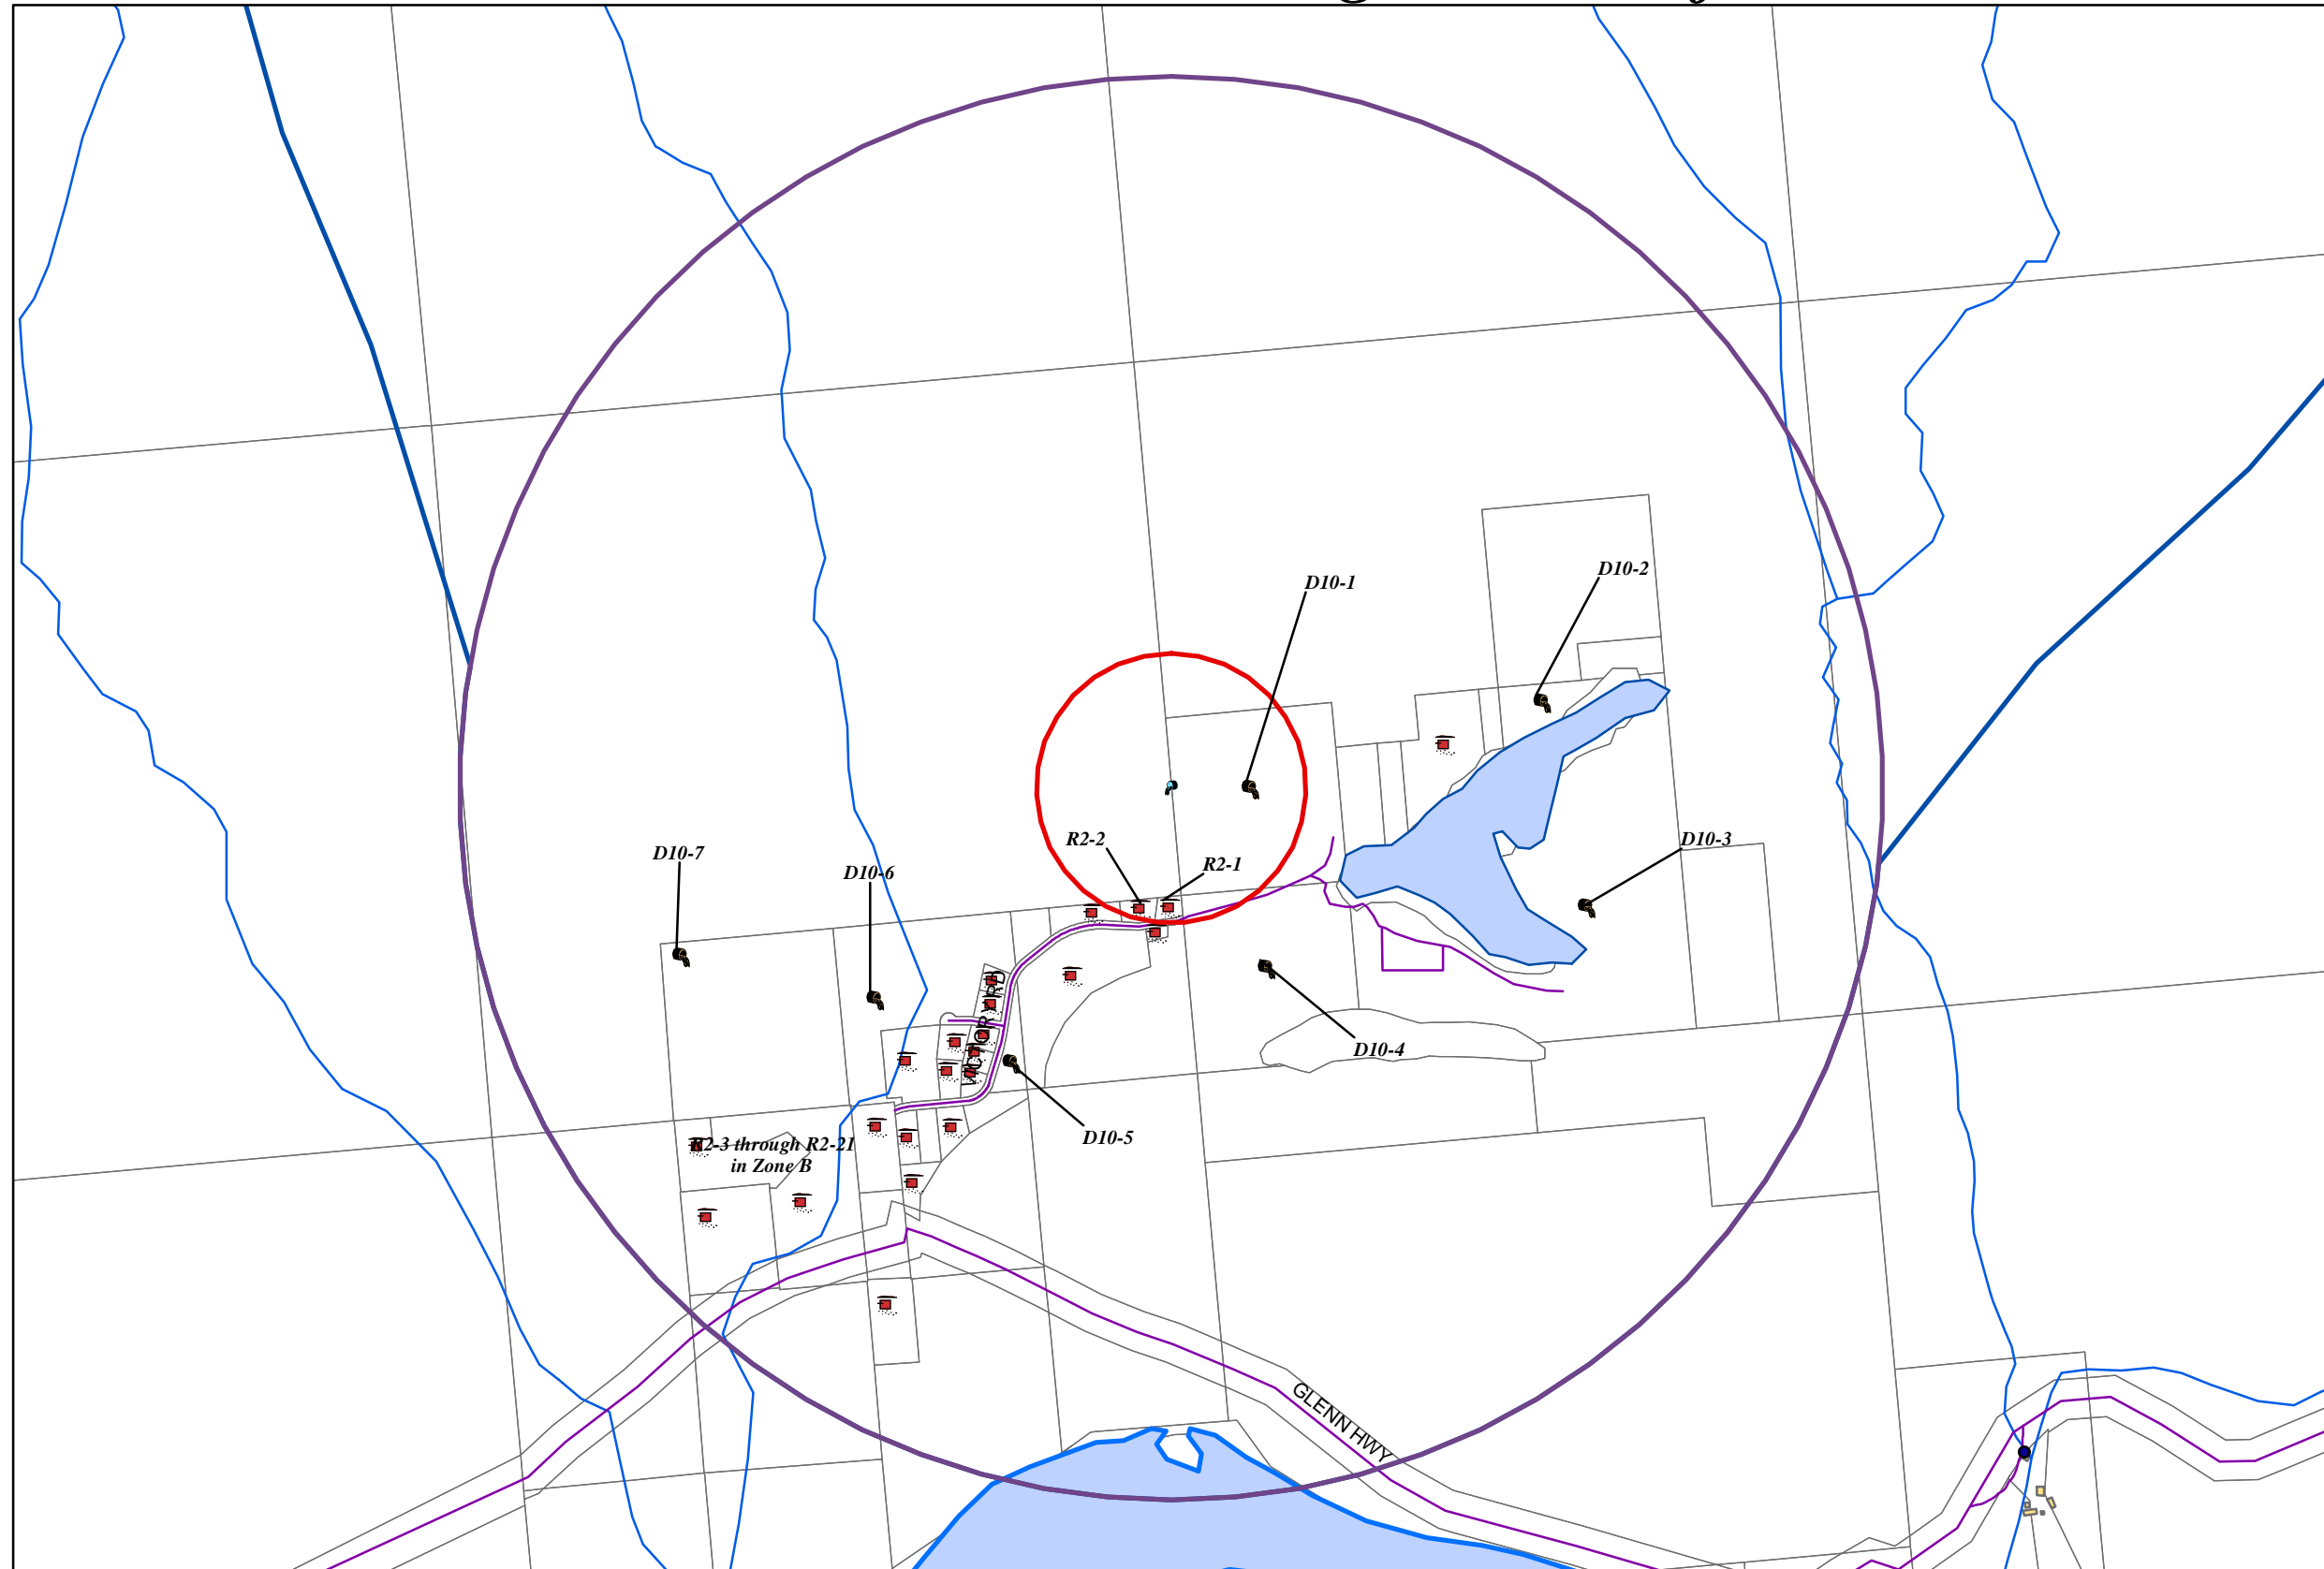


- Victory Bible Camp Spring
- Large Capacity Septic Systems (D10)
- Single Family Septic System (R2)
- MSB Roads
- Smaller Rivers
- Main Rivers
- Lakes
- MSB Land Parcels
- Zone A Protection Area**
- 1000 Feet from Spring Intake
- Zone B Protection Area**
- 1 Mile from Spring Intake
- Zone C Protection Area**
- Entire Watershed

D10-7  
D10-6  
D10-5  
D10-4  
D10-3  
D10-2  
D10-1  
R2-2  
R2-1  
R2-3 through R2-21 in Zone B

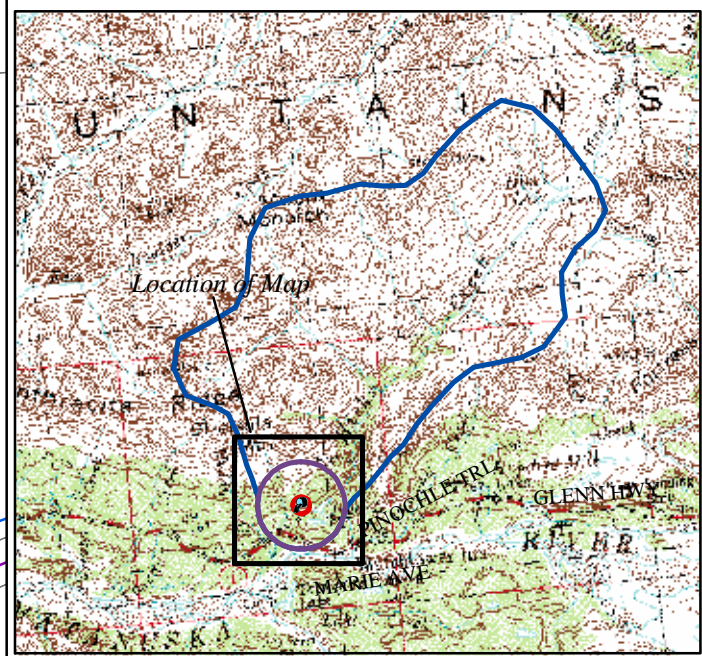

PWSID 226567.001




## Map 3


## **APPENDIX D**

### **Vulnerability Analysis for Victory Bible Camp Public Drinking Water Source (Charts 1-8)**




**Chart 1. Susceptibility of the Spring Outlet/Intake - Victory Bible Camp Spring**

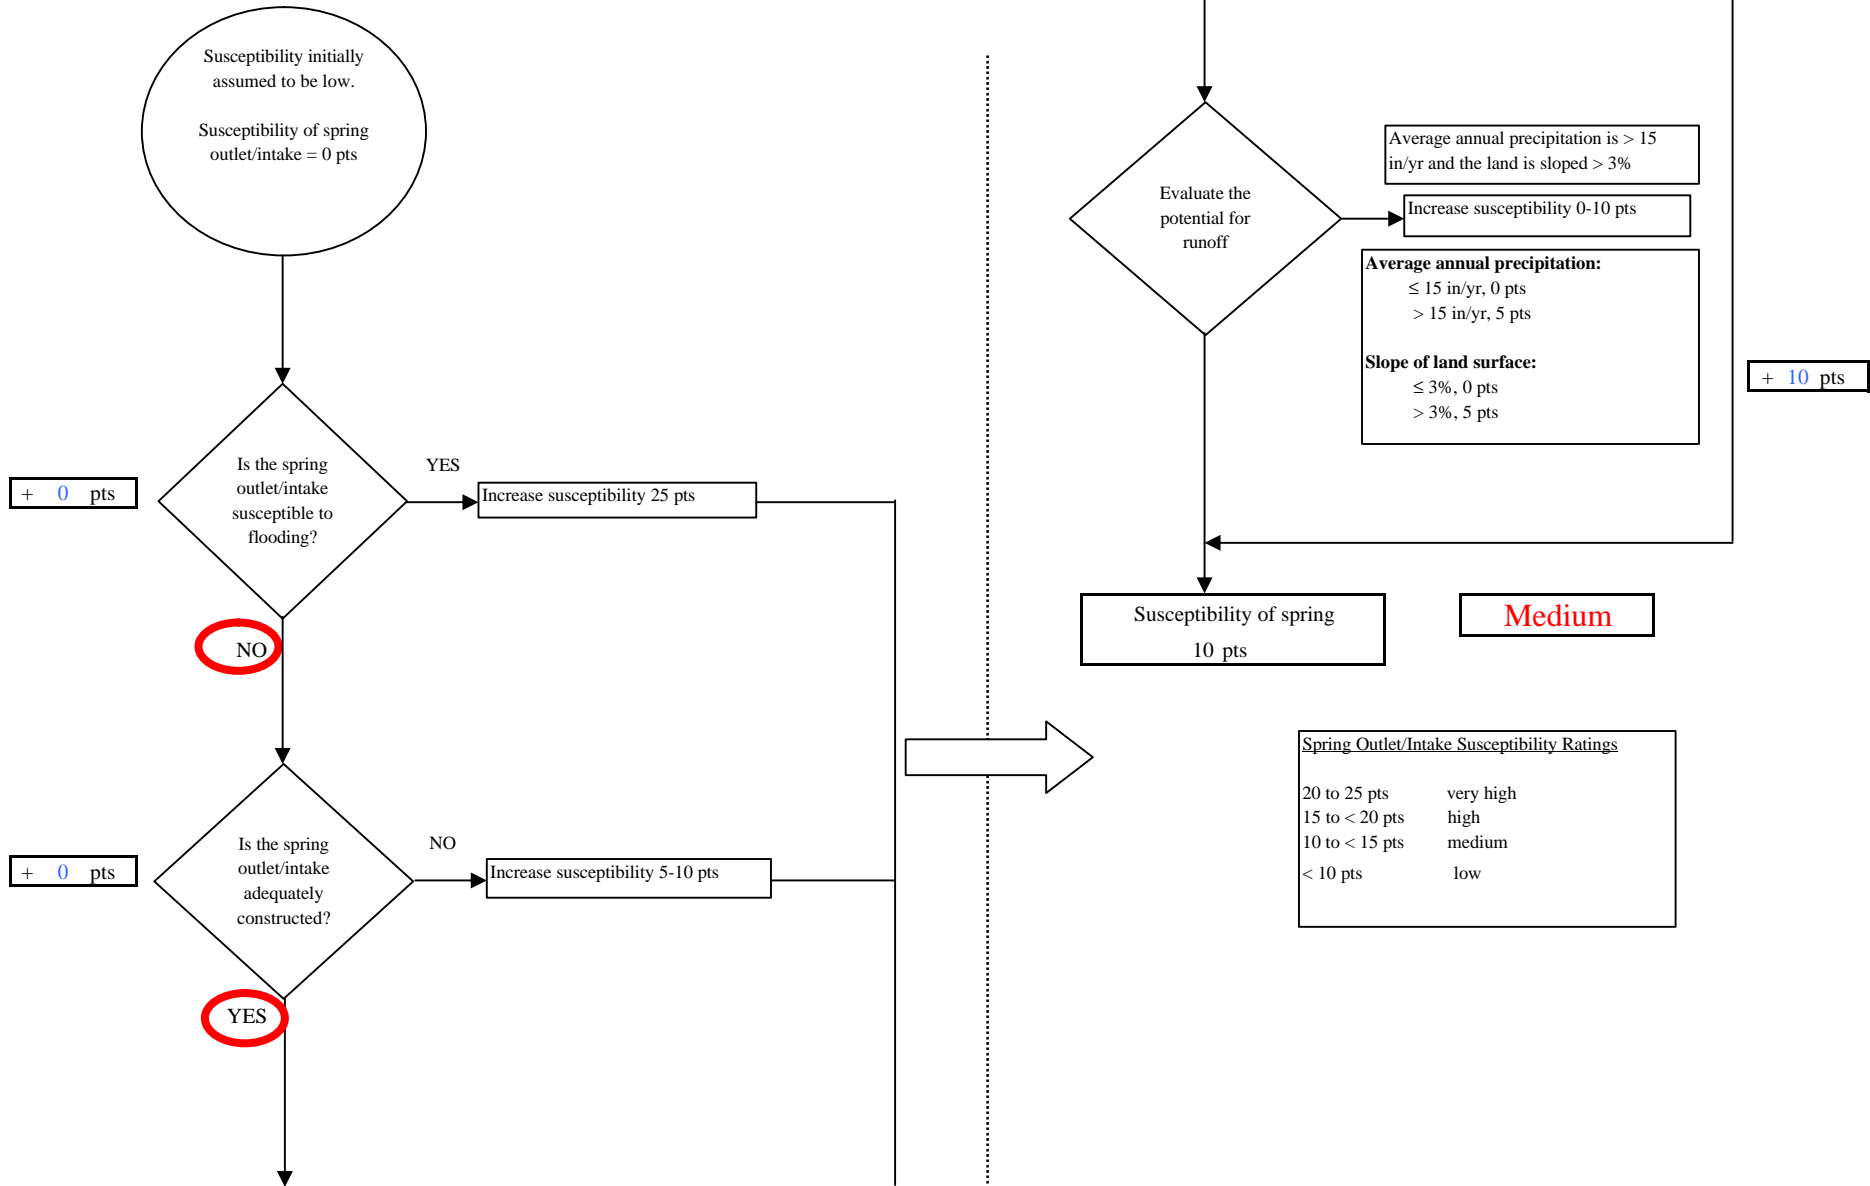

**Chart 2. Susceptibility of the Aquifer - Victory Bible Camp Spring**

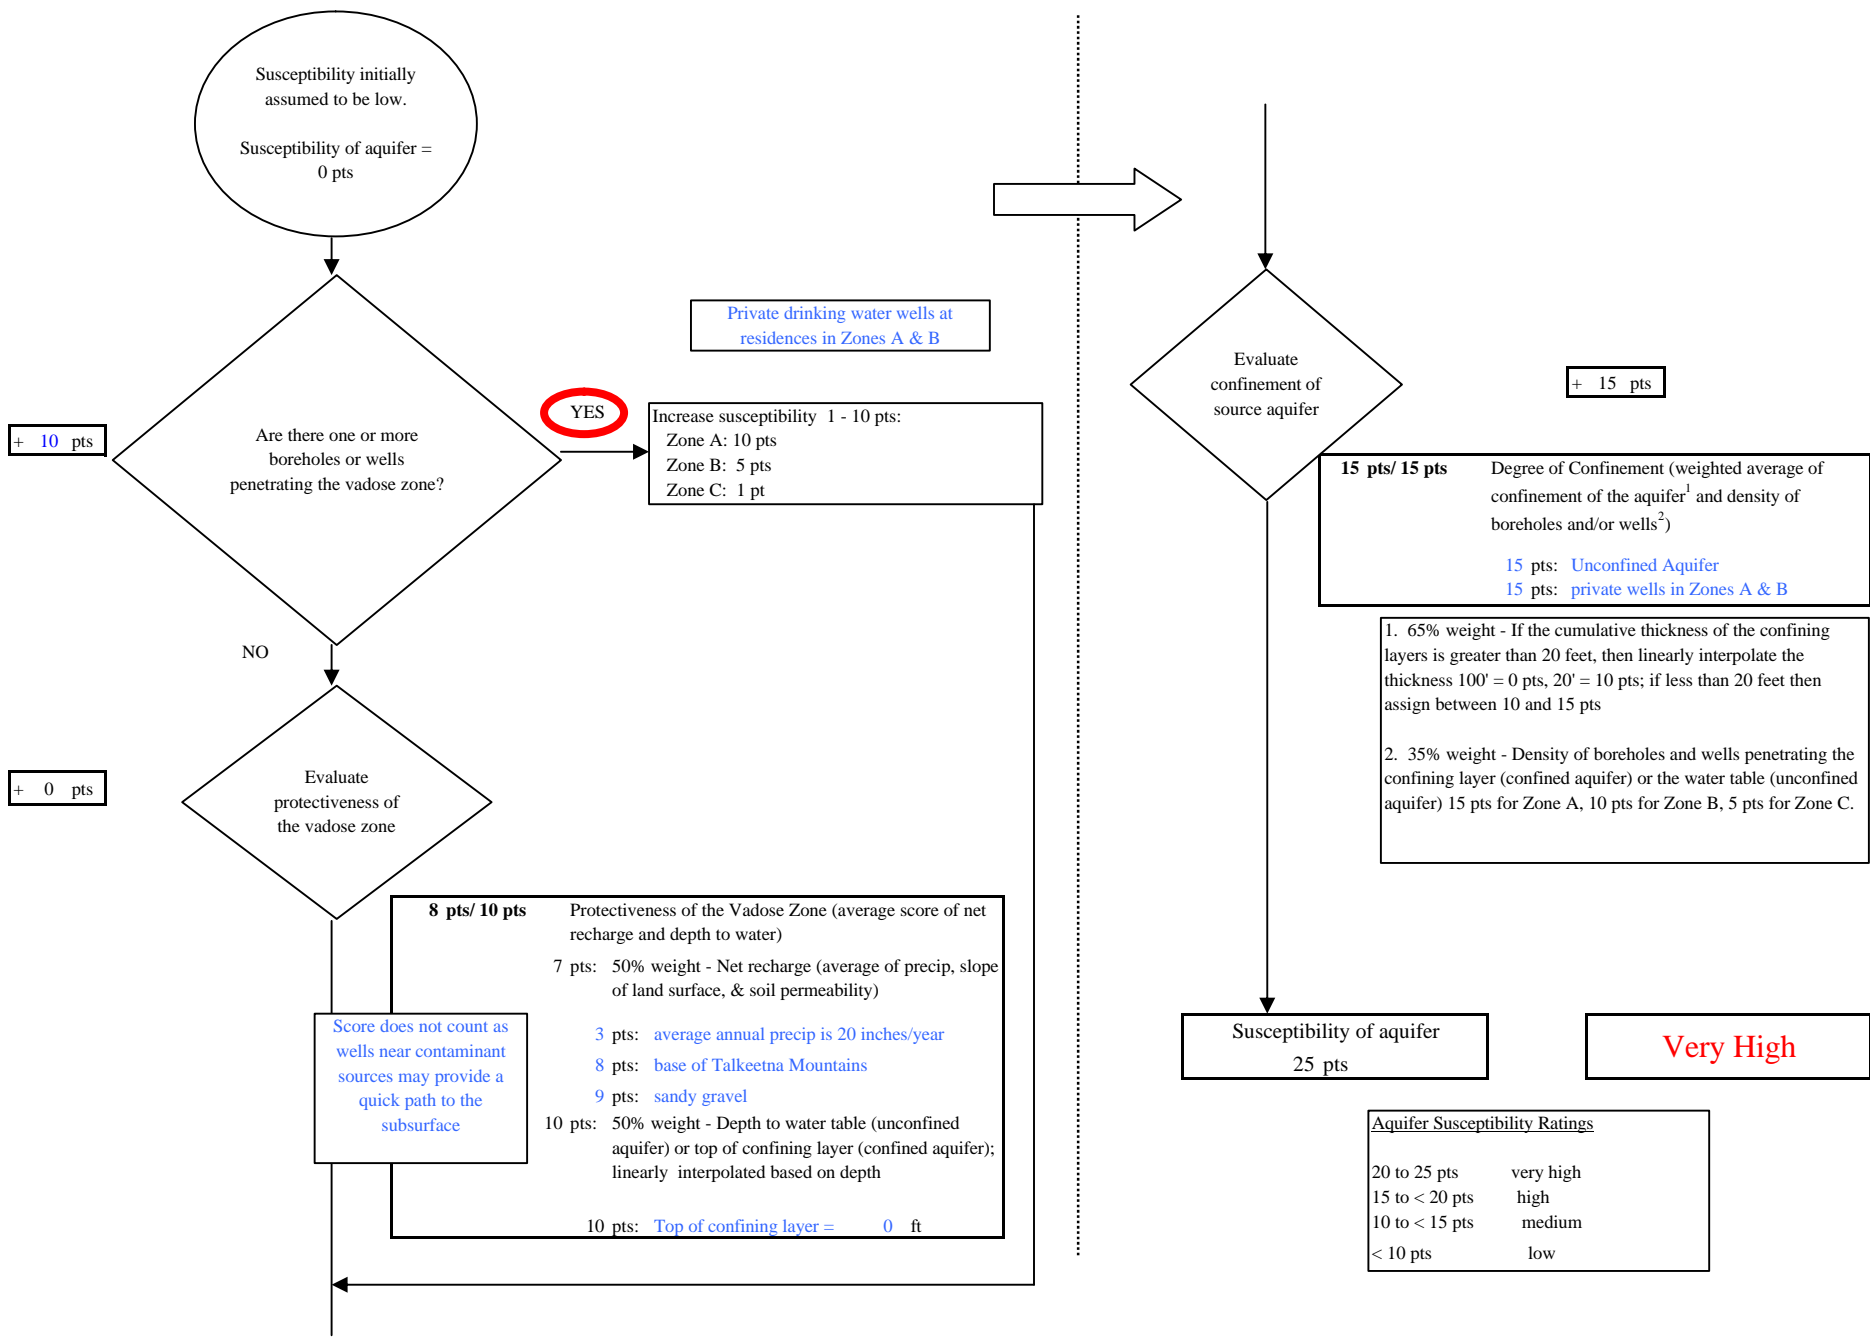

**Chart 3. Contaminant Risks for Victory Bible Camp Spring - Bacteria & Viruses**

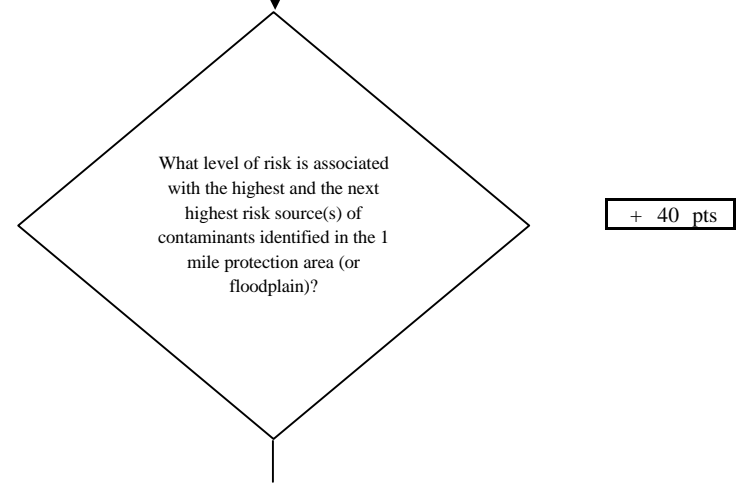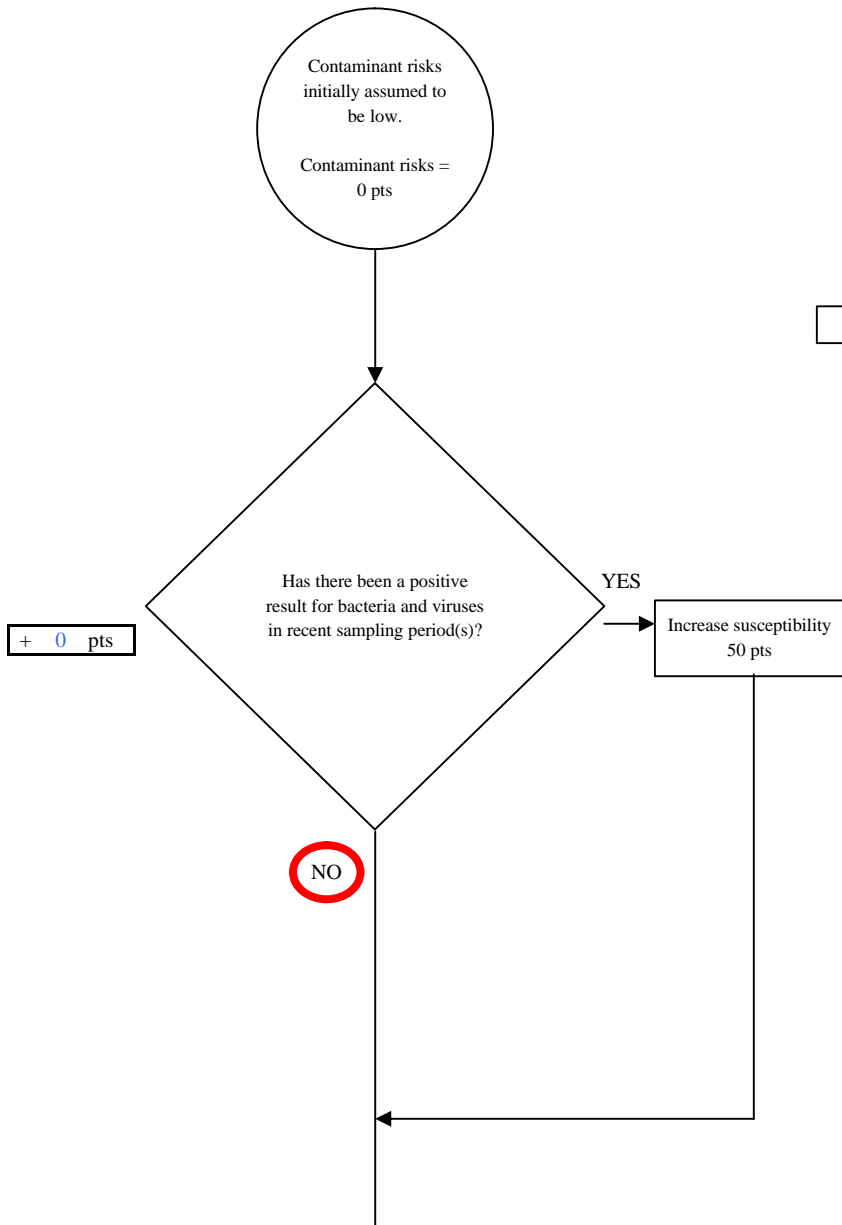




Risk Rankings for Contaminant Sources Identified in Zones A and B			
	Zone A	Zone B	Total
Very High(s)	0	0	0
High(s)	1	6	7
Medium(s)	0	0	0
Low(s)	4	4	8

	LOW 10 pts	MEDIUM 20 pts	HIGH 30 pts	VERY HIGH 40 pts
LOW	<sup>3</sup> 10 sources + 10 pts	≥ 10 sources + 5 pts	≥ 20 sources + 5 pts	----
MEDIUM	----	≥ 2 sources + 5 pts	≥ 5 sources + 5 pts	≥ 10 sources + 5 pts
HIGH	----	----	≥ 1 source + 10 pts	≥ 2 sources + 10 pts
VERY HIGH	----	----	----	≥ 1 source + 10 pts

Matrix Score 40

Note: Septic systems, sewerlines, and roads are each assigned a risk ranking for each individual contaminant source in the CSI. The VA, however, counts these contaminant sources as a group and assigns a calculated number of either "lows" or "mediums" based on the density.

**Chart 3. Contaminant Risks for Victory Bible Camp Spring - Bacteria & Viruses**

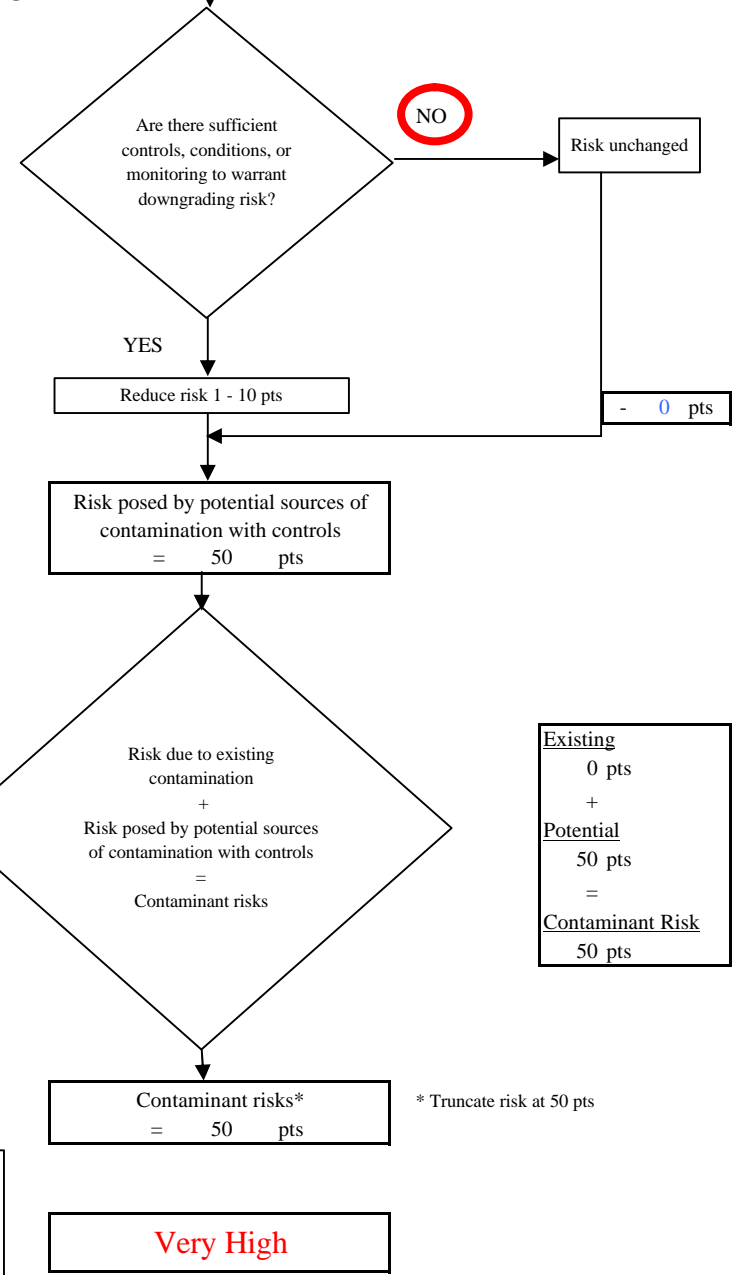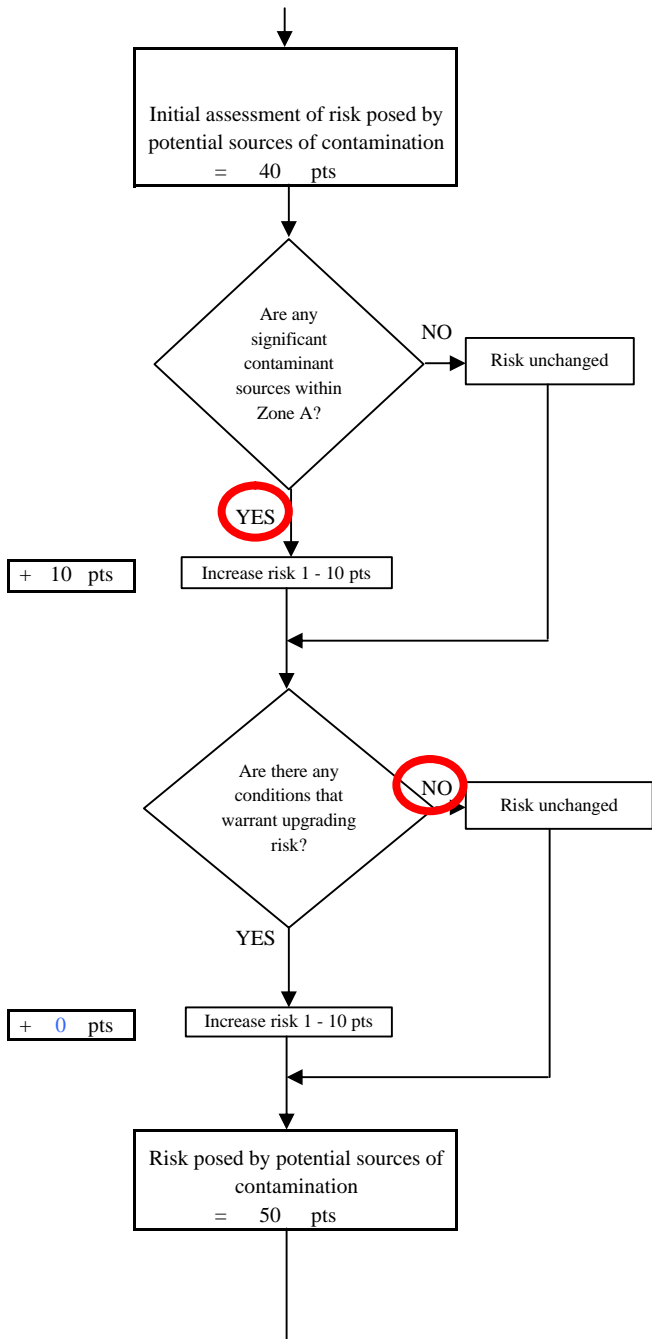


Existing	0 pts
+	
Potential	50 pts
=	
Contaminant Risk	50 pts

Contaminant Risk Ratings	
40 to 50 pts	very high
30 to < 40 pts	high
20 to < 30 pts	medium
< 20 pts	low


\* Truncate risk at 50 pts

**Chart 4. Vulnerability Analysis for Victory Bible Camp Spring - Bacteria & Viruses**

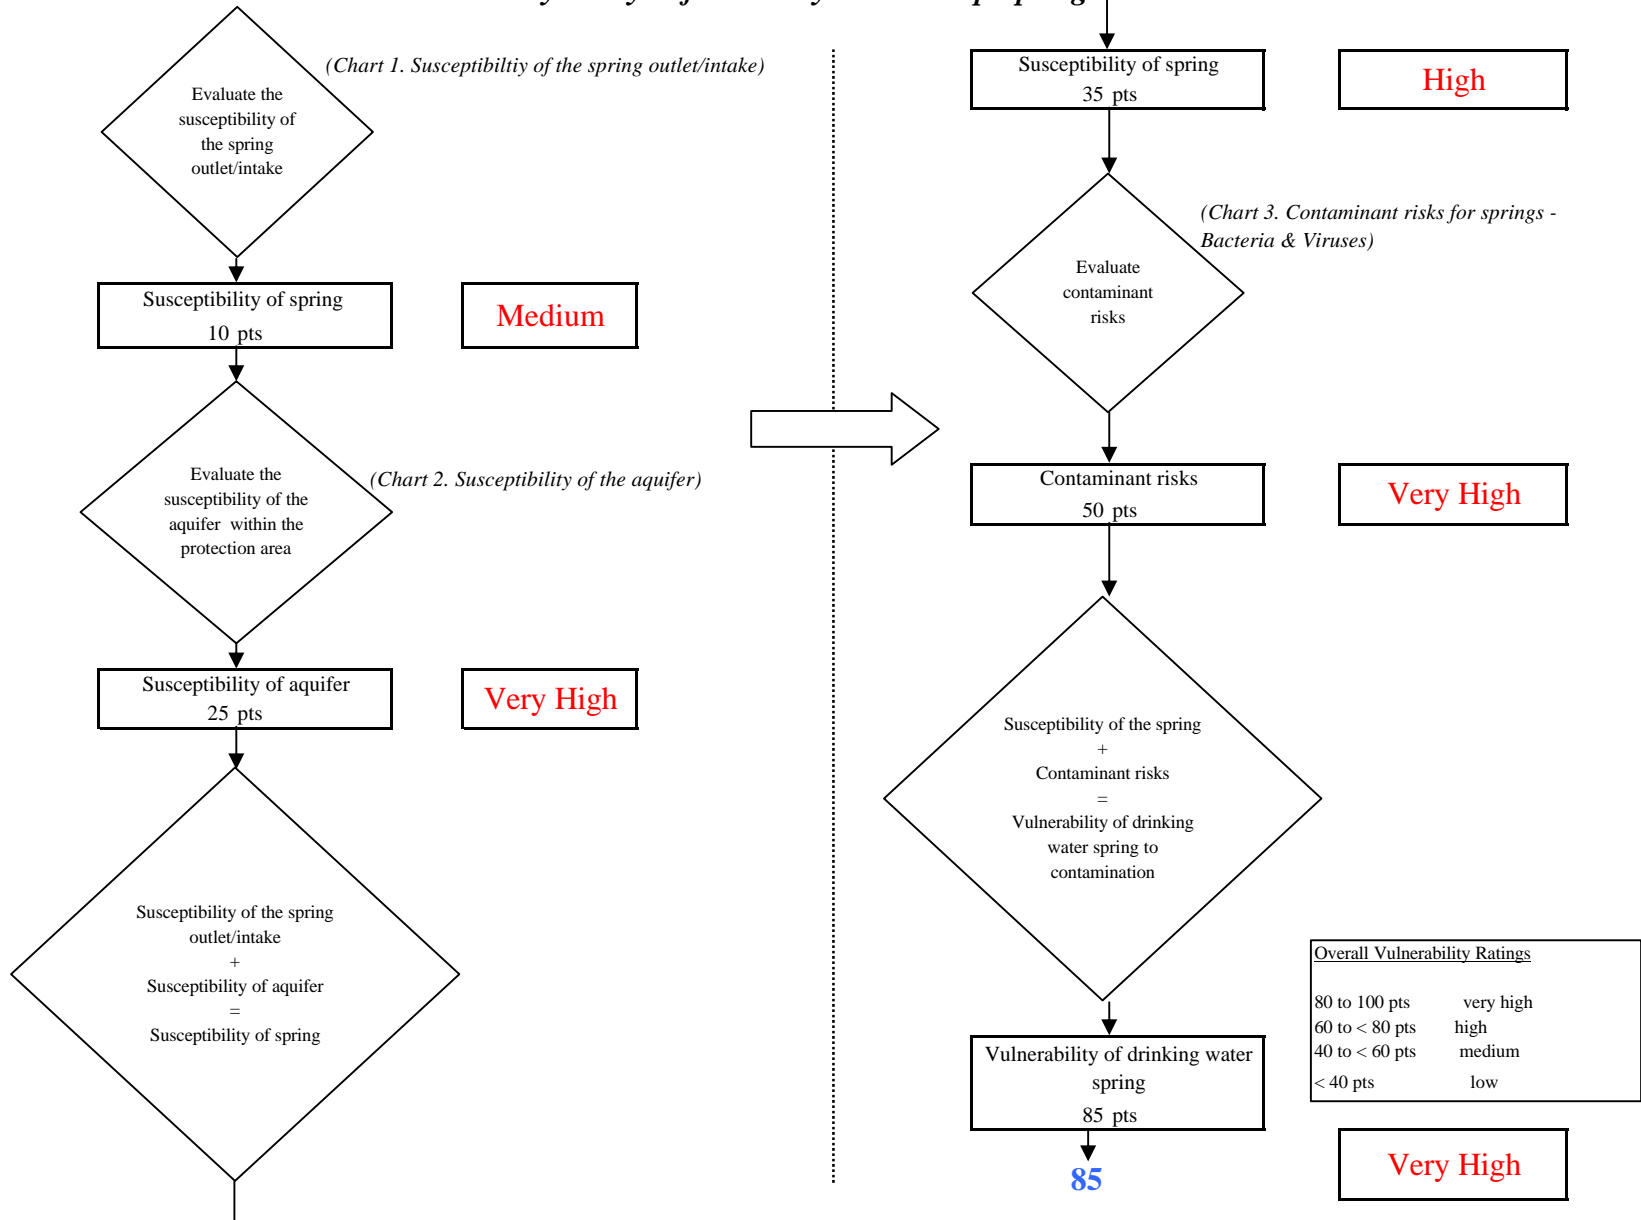





**Chart 5. Contaminant Risks for Victory Bible Camp Spring - Nitrates and Nitrites**

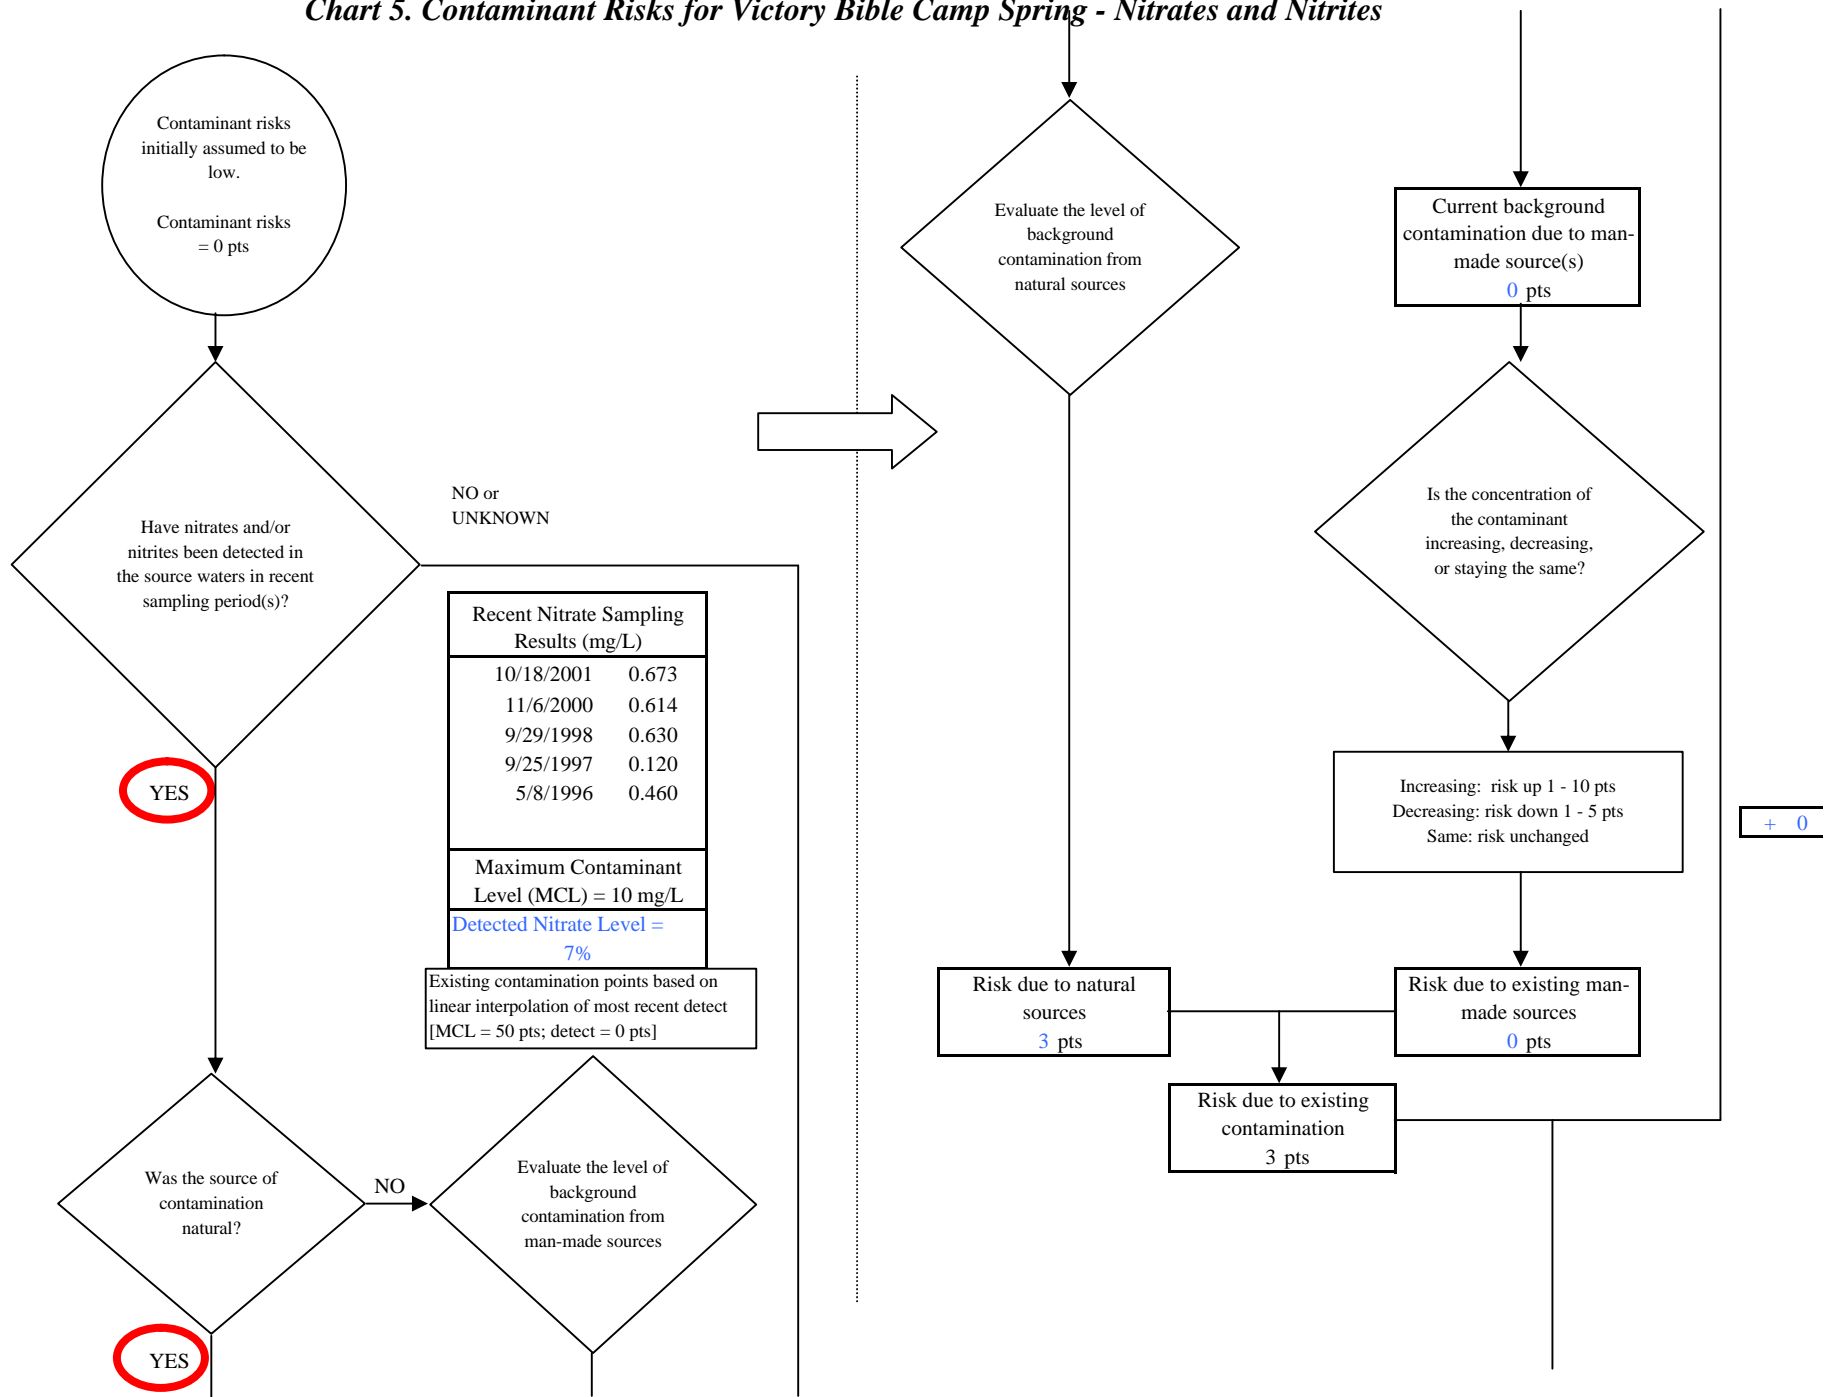


**Chart 5. Contaminant Risks for Victory Bible Camp Spring - Nitrates and Nitrites**

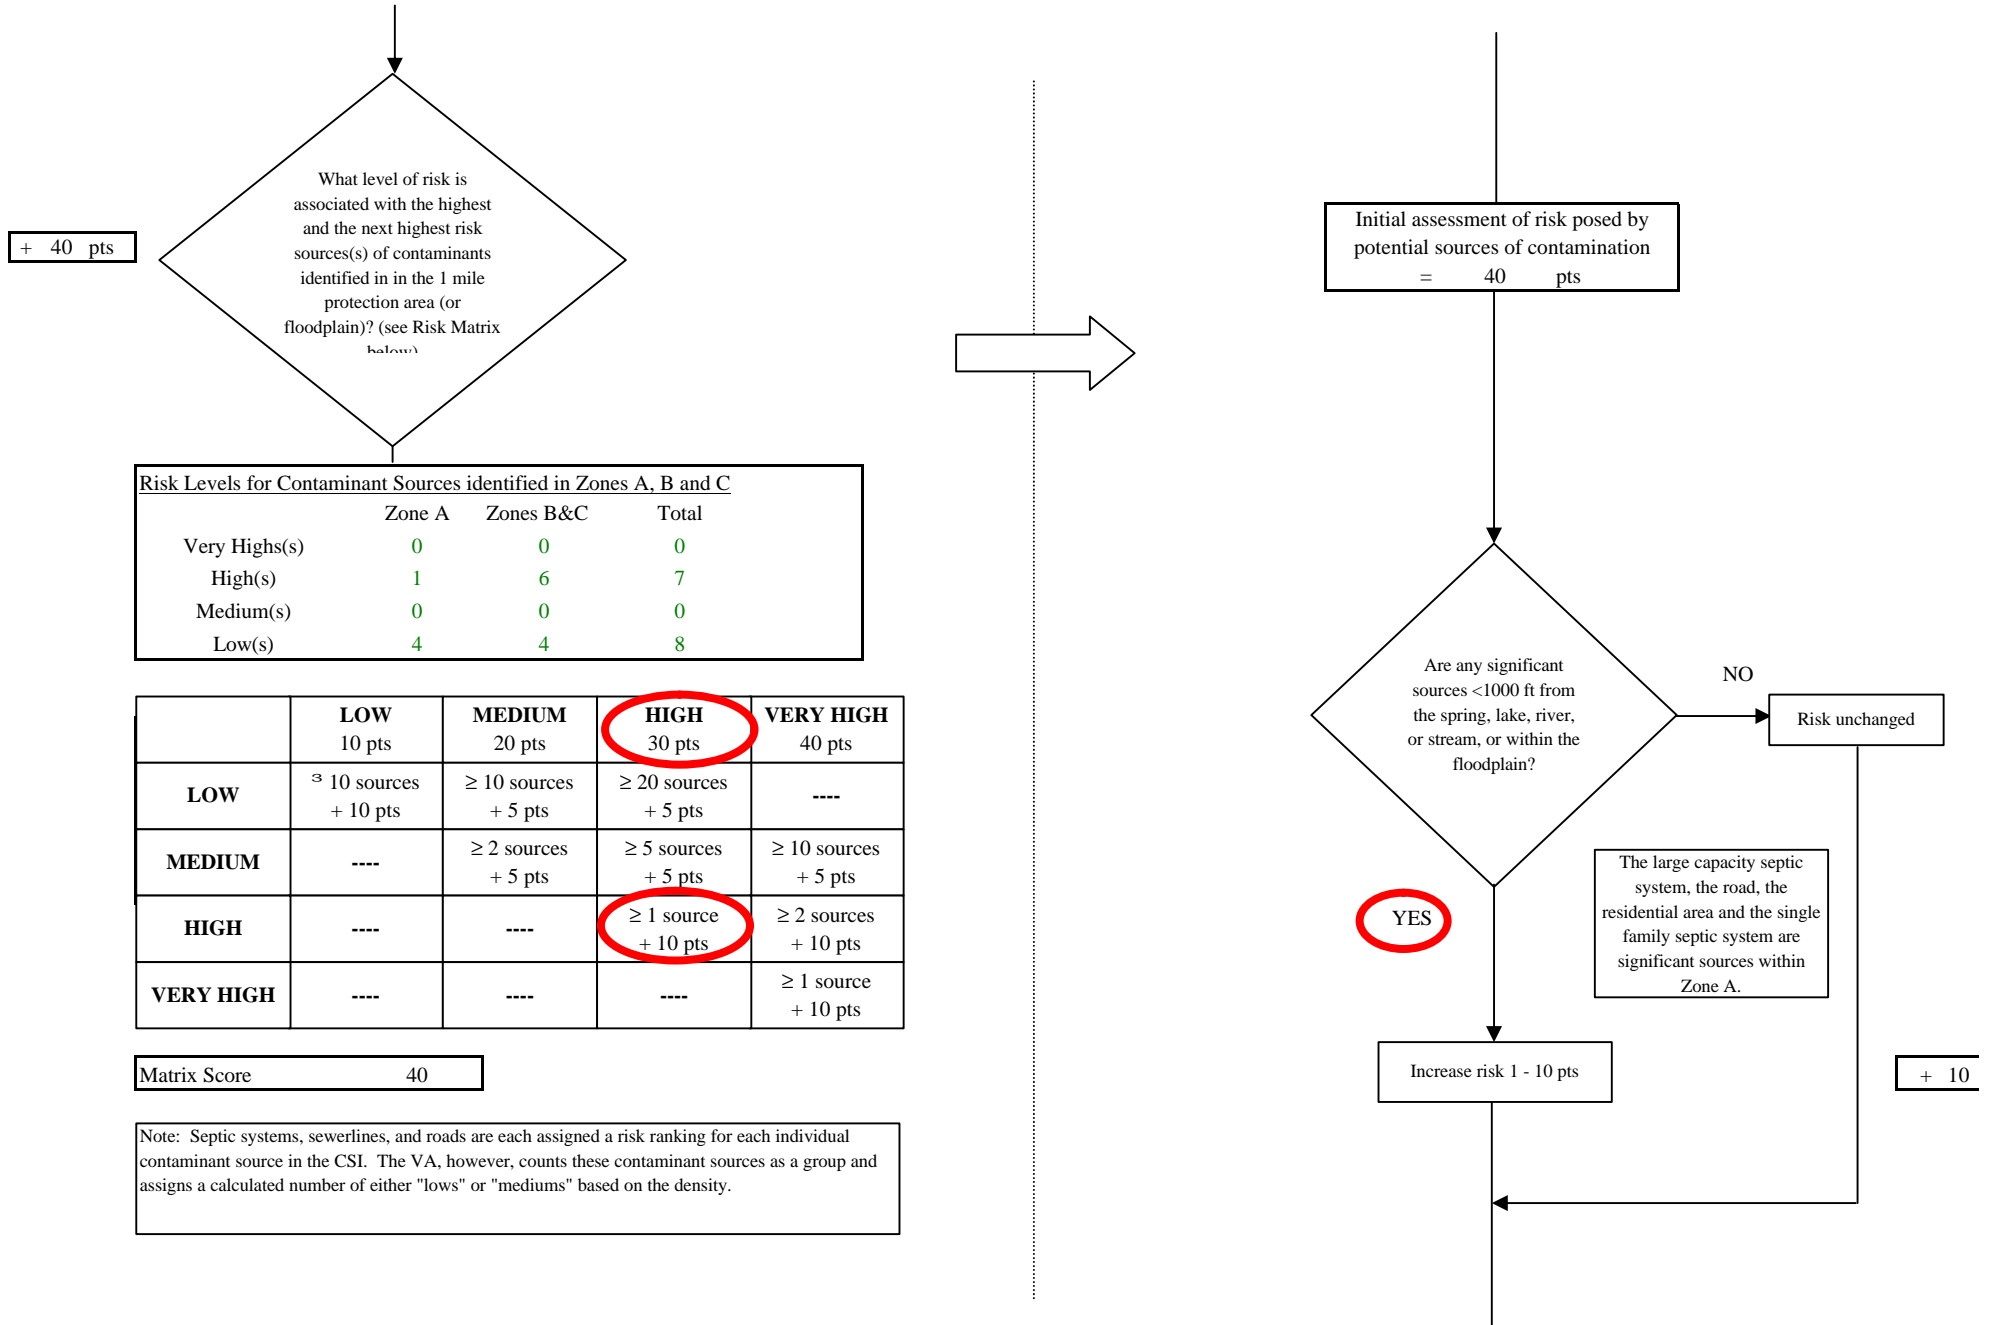


**Chart 5. Contaminant Risks for Victory Bible Camp Spring - Nitrates and Nitrites**

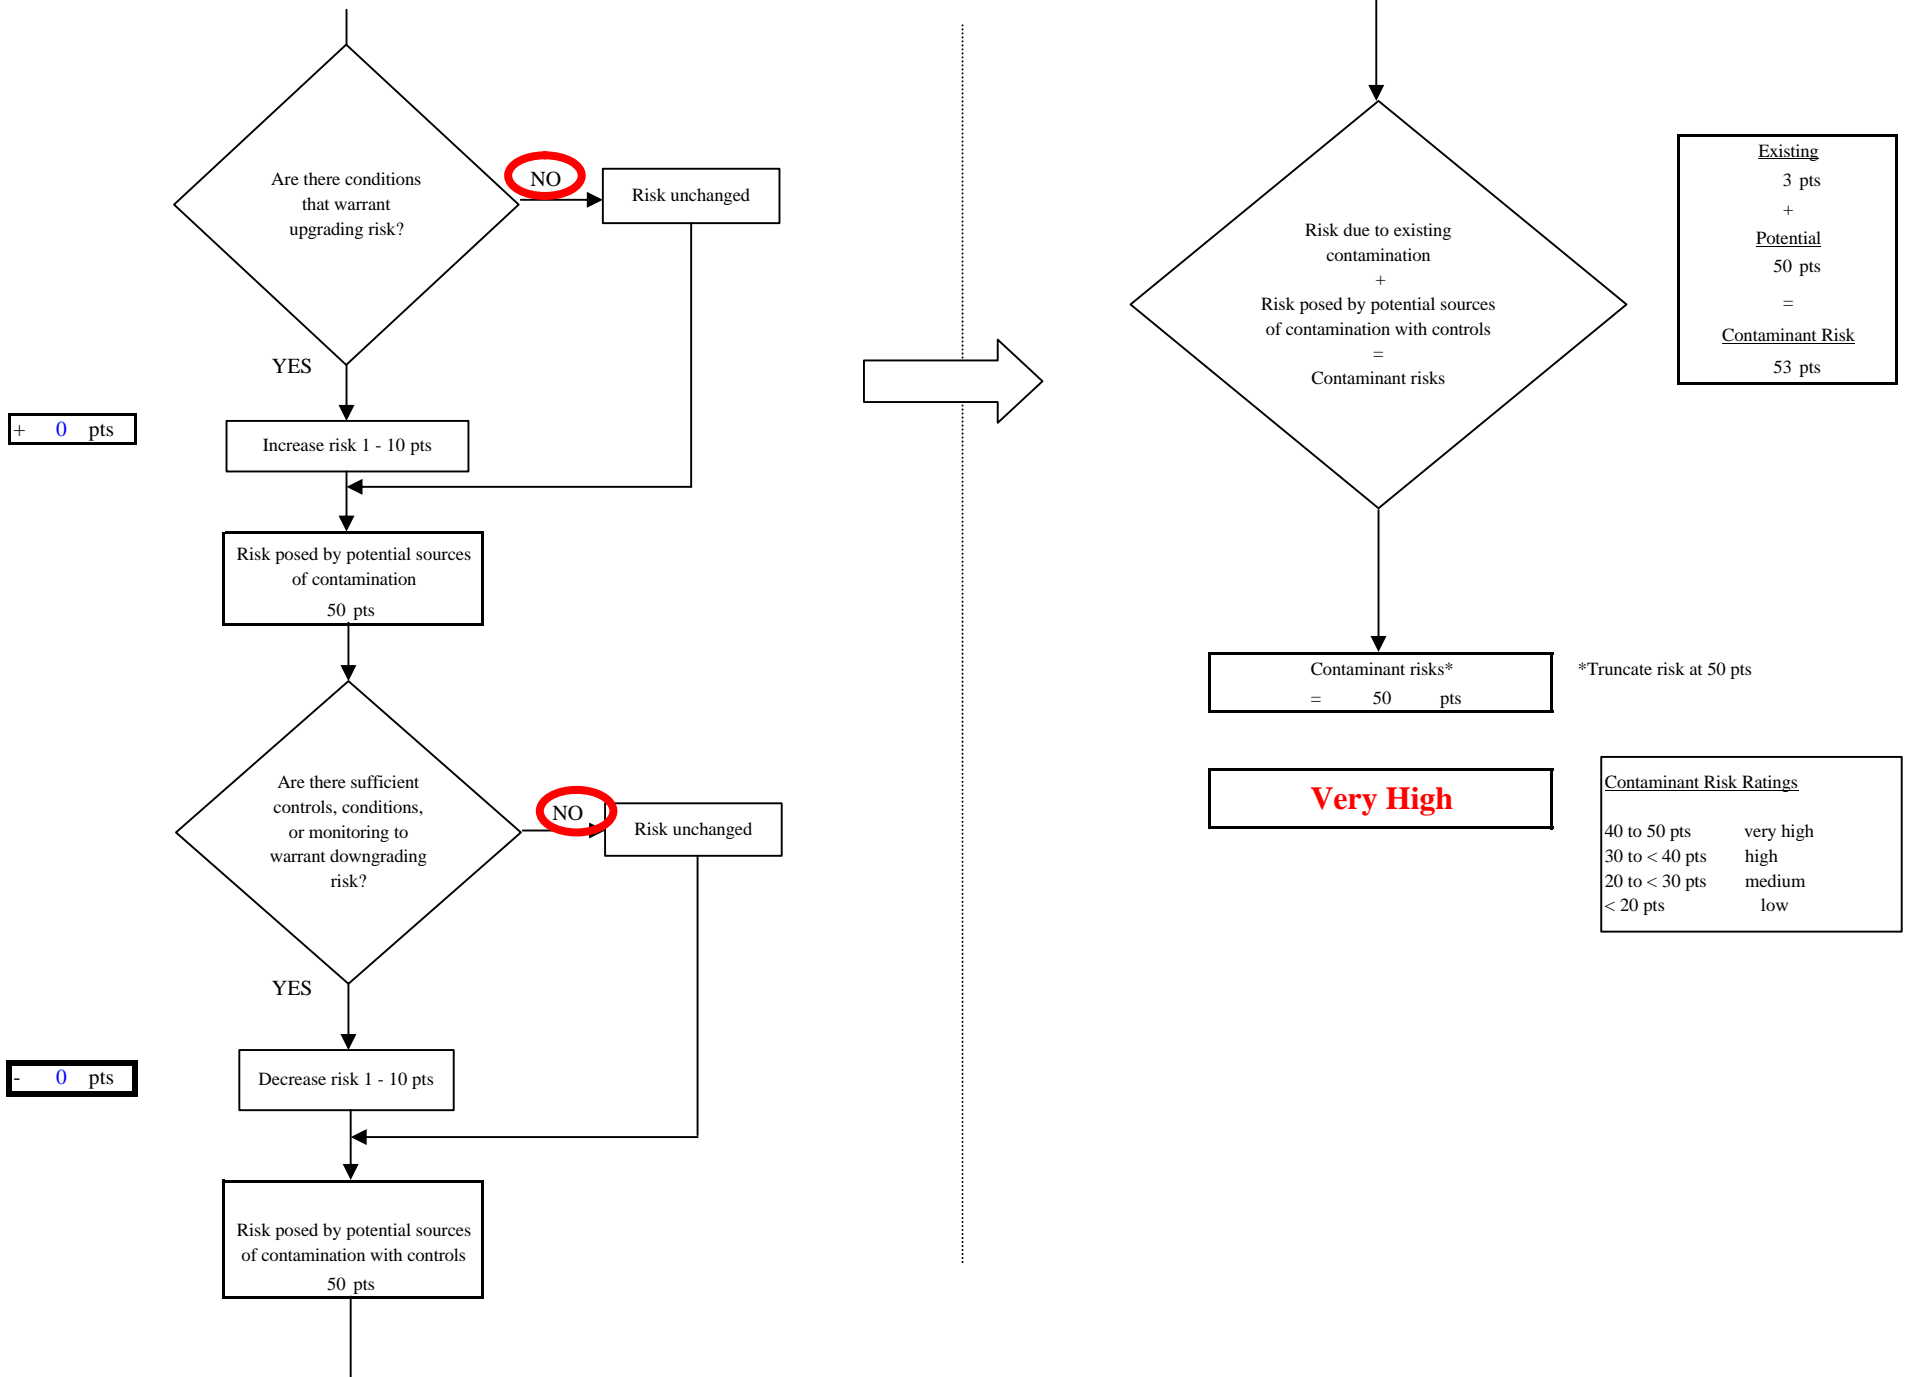




**Chart 6. Vulnerability Analysis for Victory Bible Camp Spring - Nitrates and Nitrites**

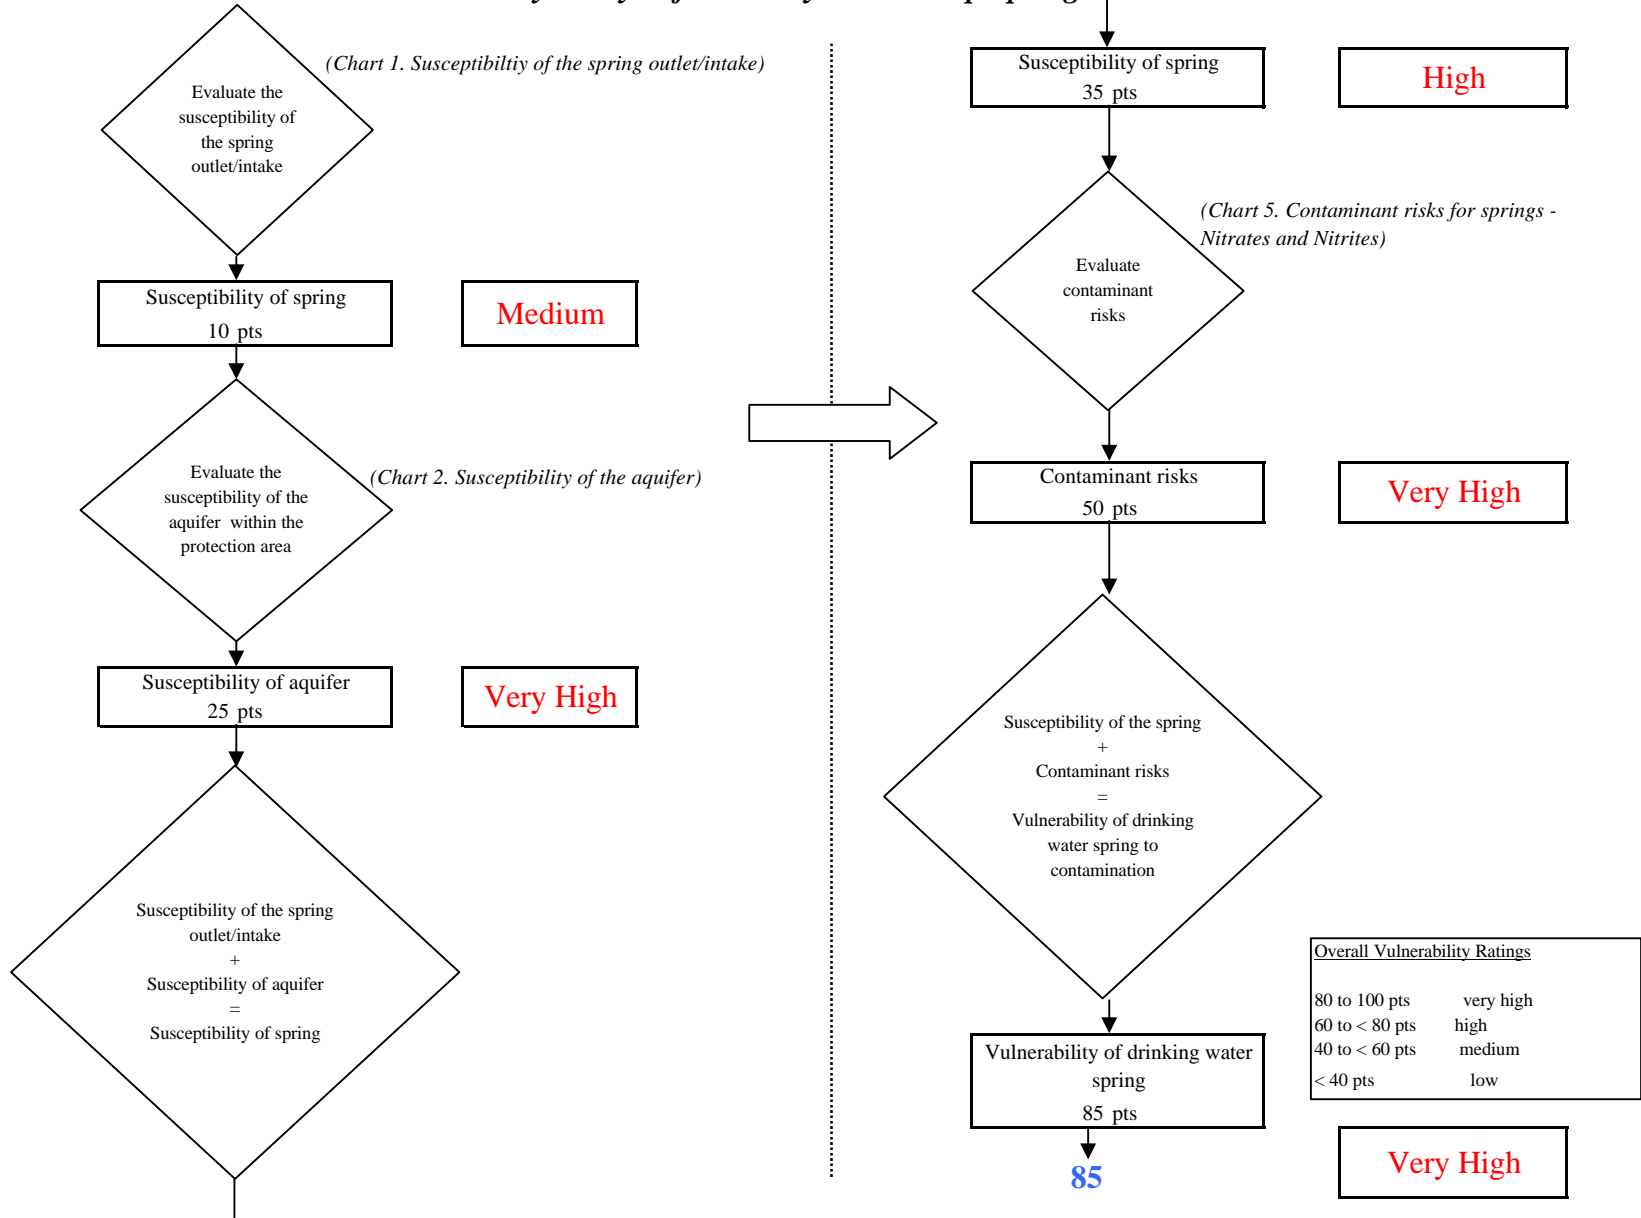


**Chart 7. Contaminant Risks for Victory Bible Camp Spring - Volatile Organic Chemicals**

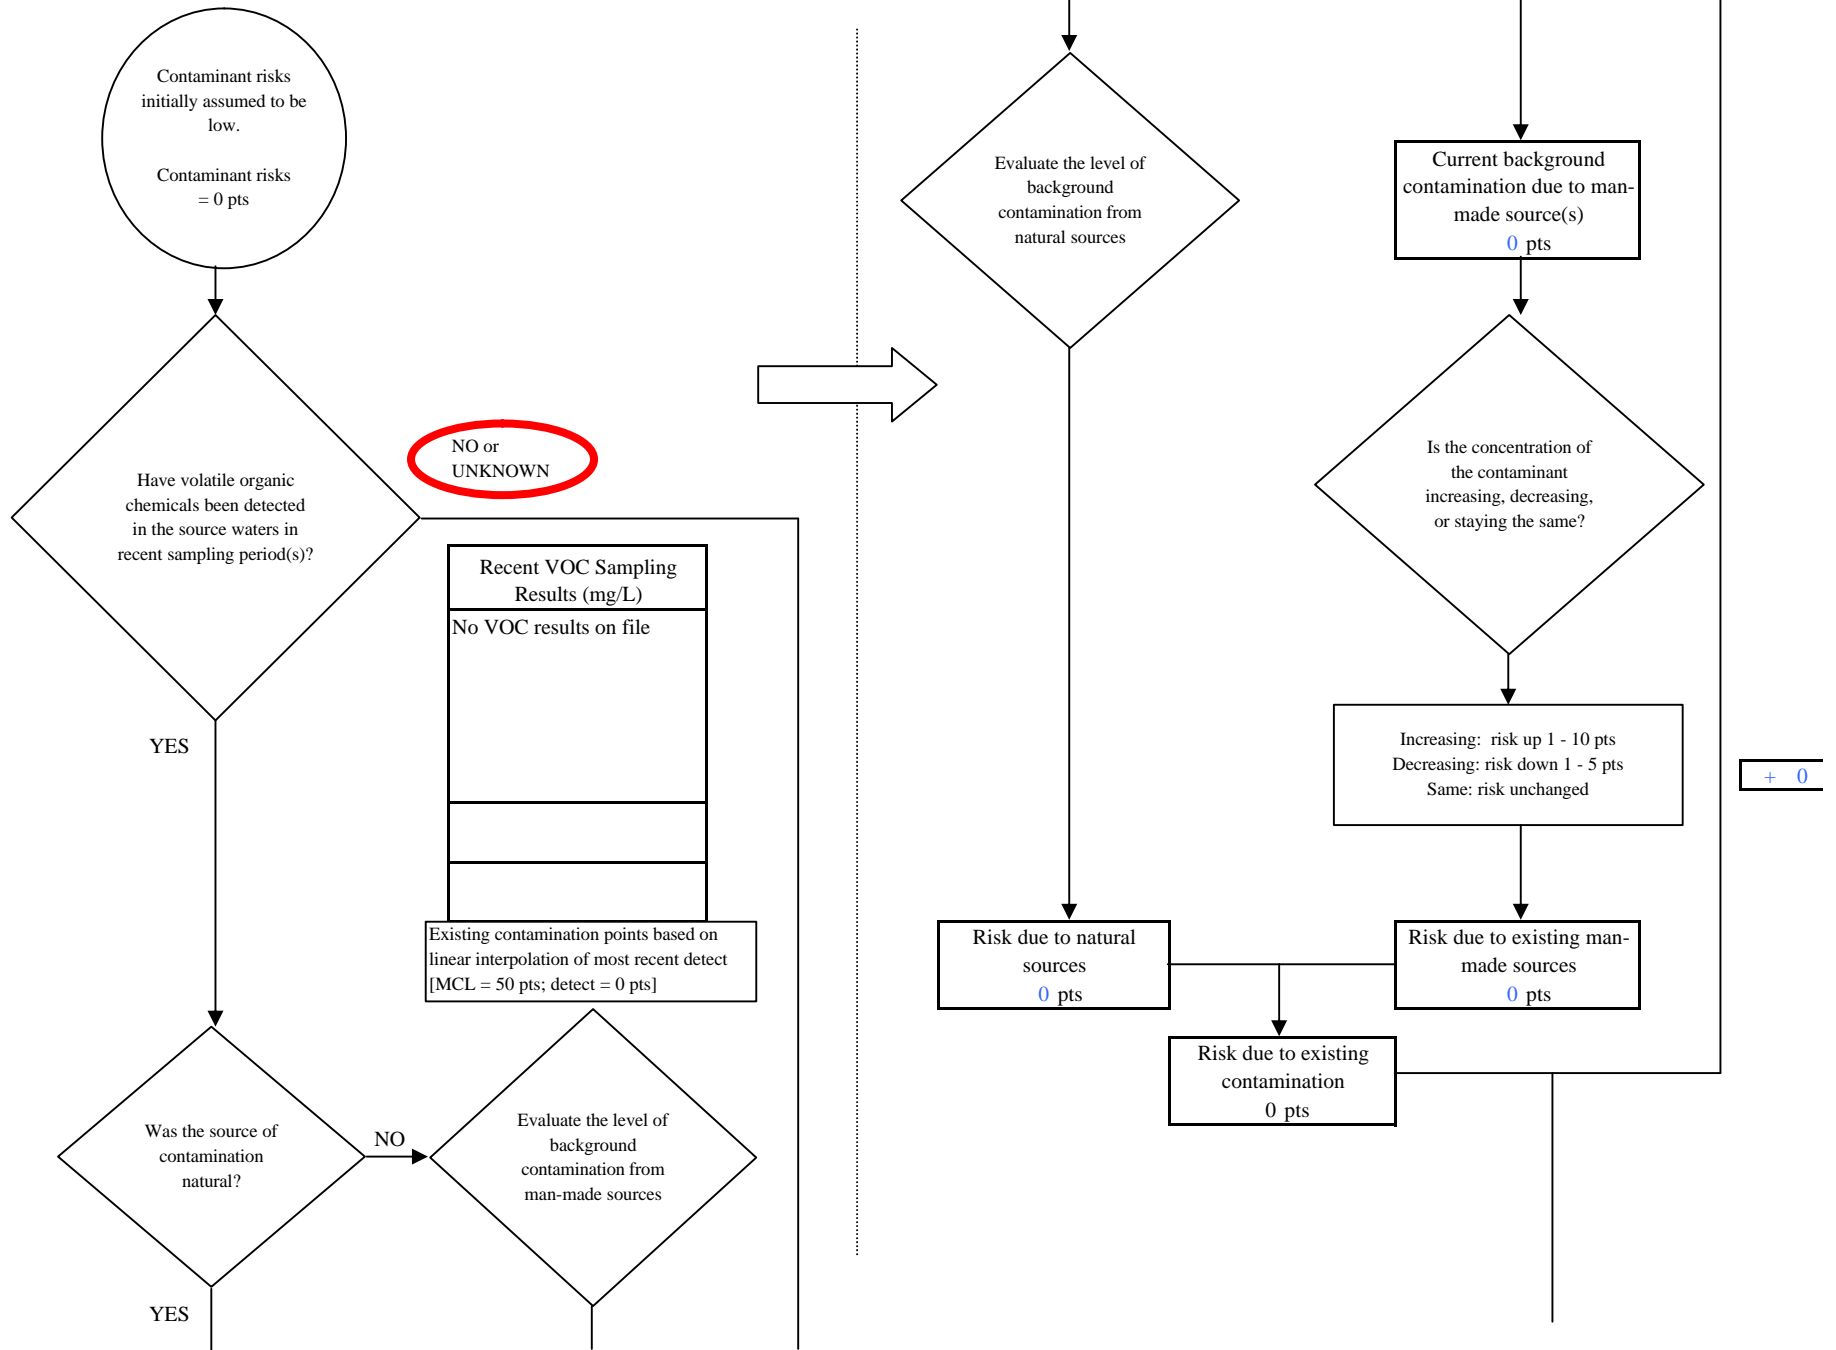

**Chart 7. Contaminant Risks for Victory Bible Camp Spring - Volatile Organic Chemicals**

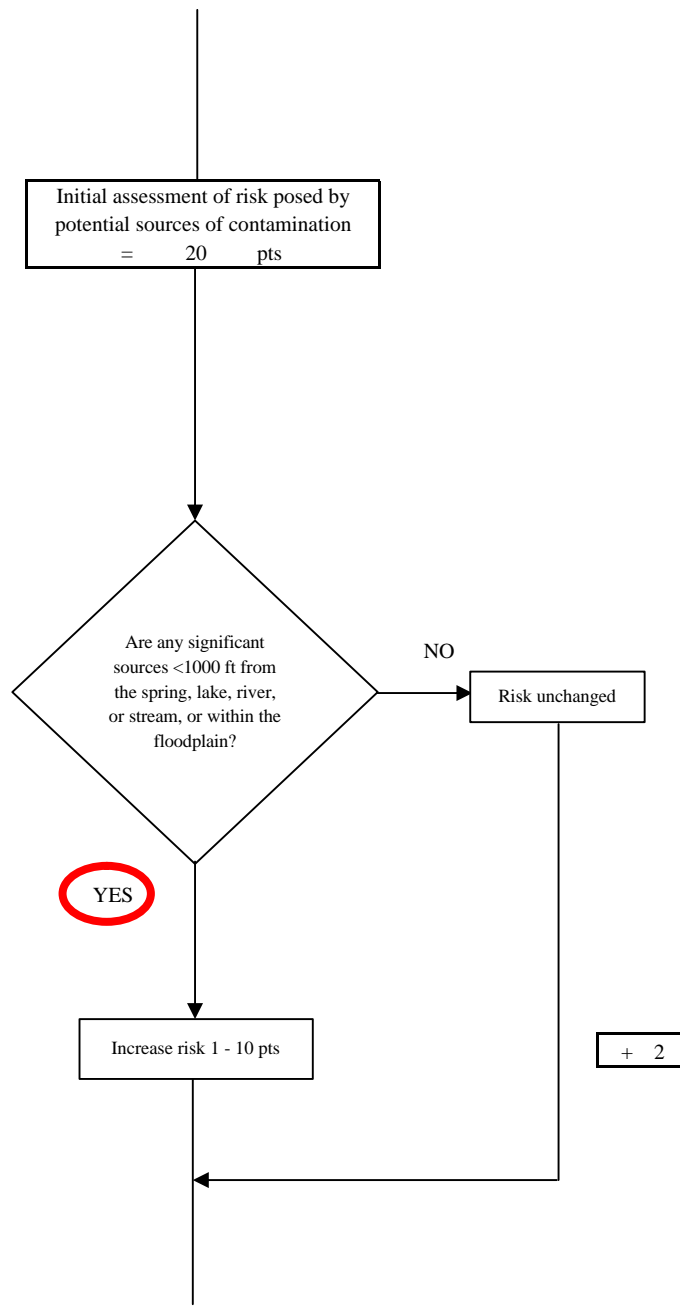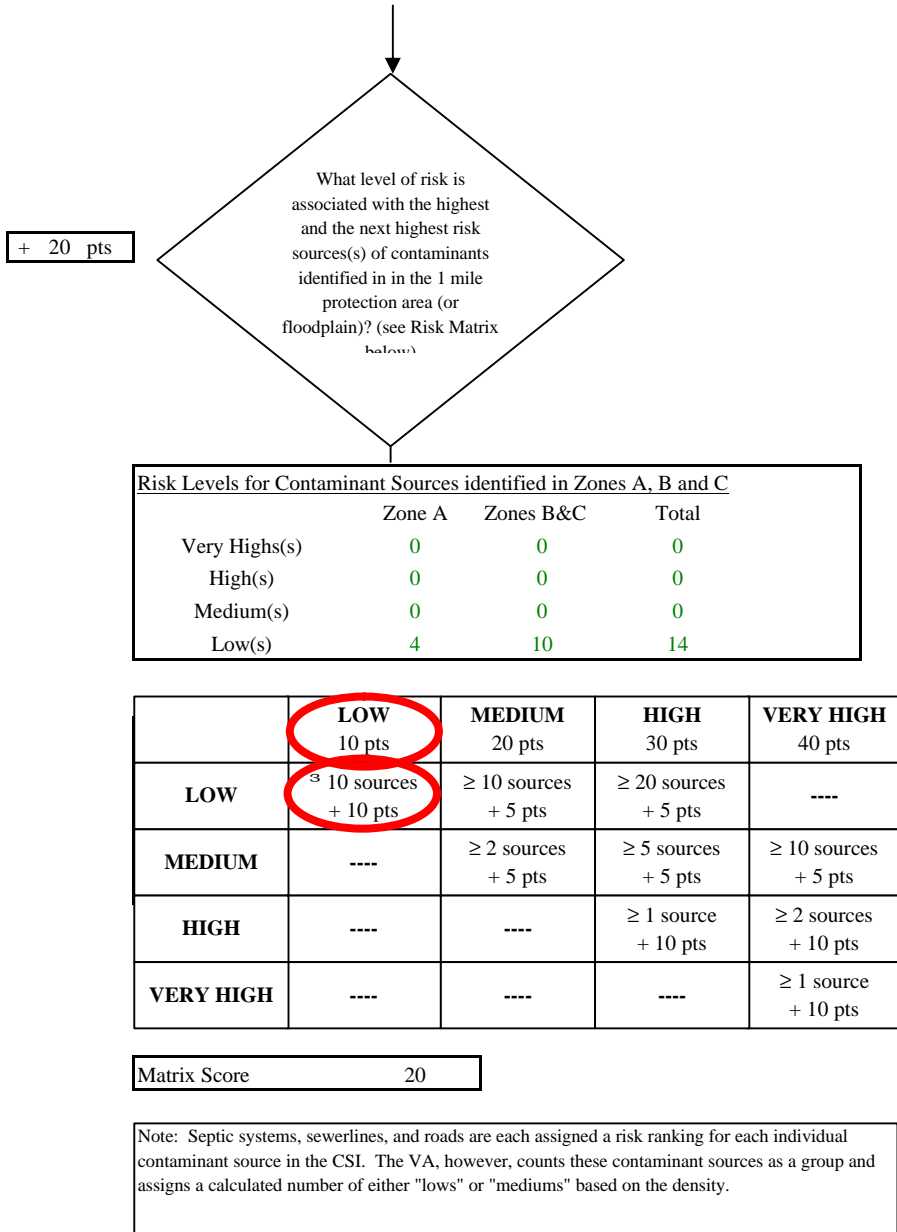

**Chart 7. Contaminant Risks for Victory Bible Camp Spring - Volatile Organic Chemicals**

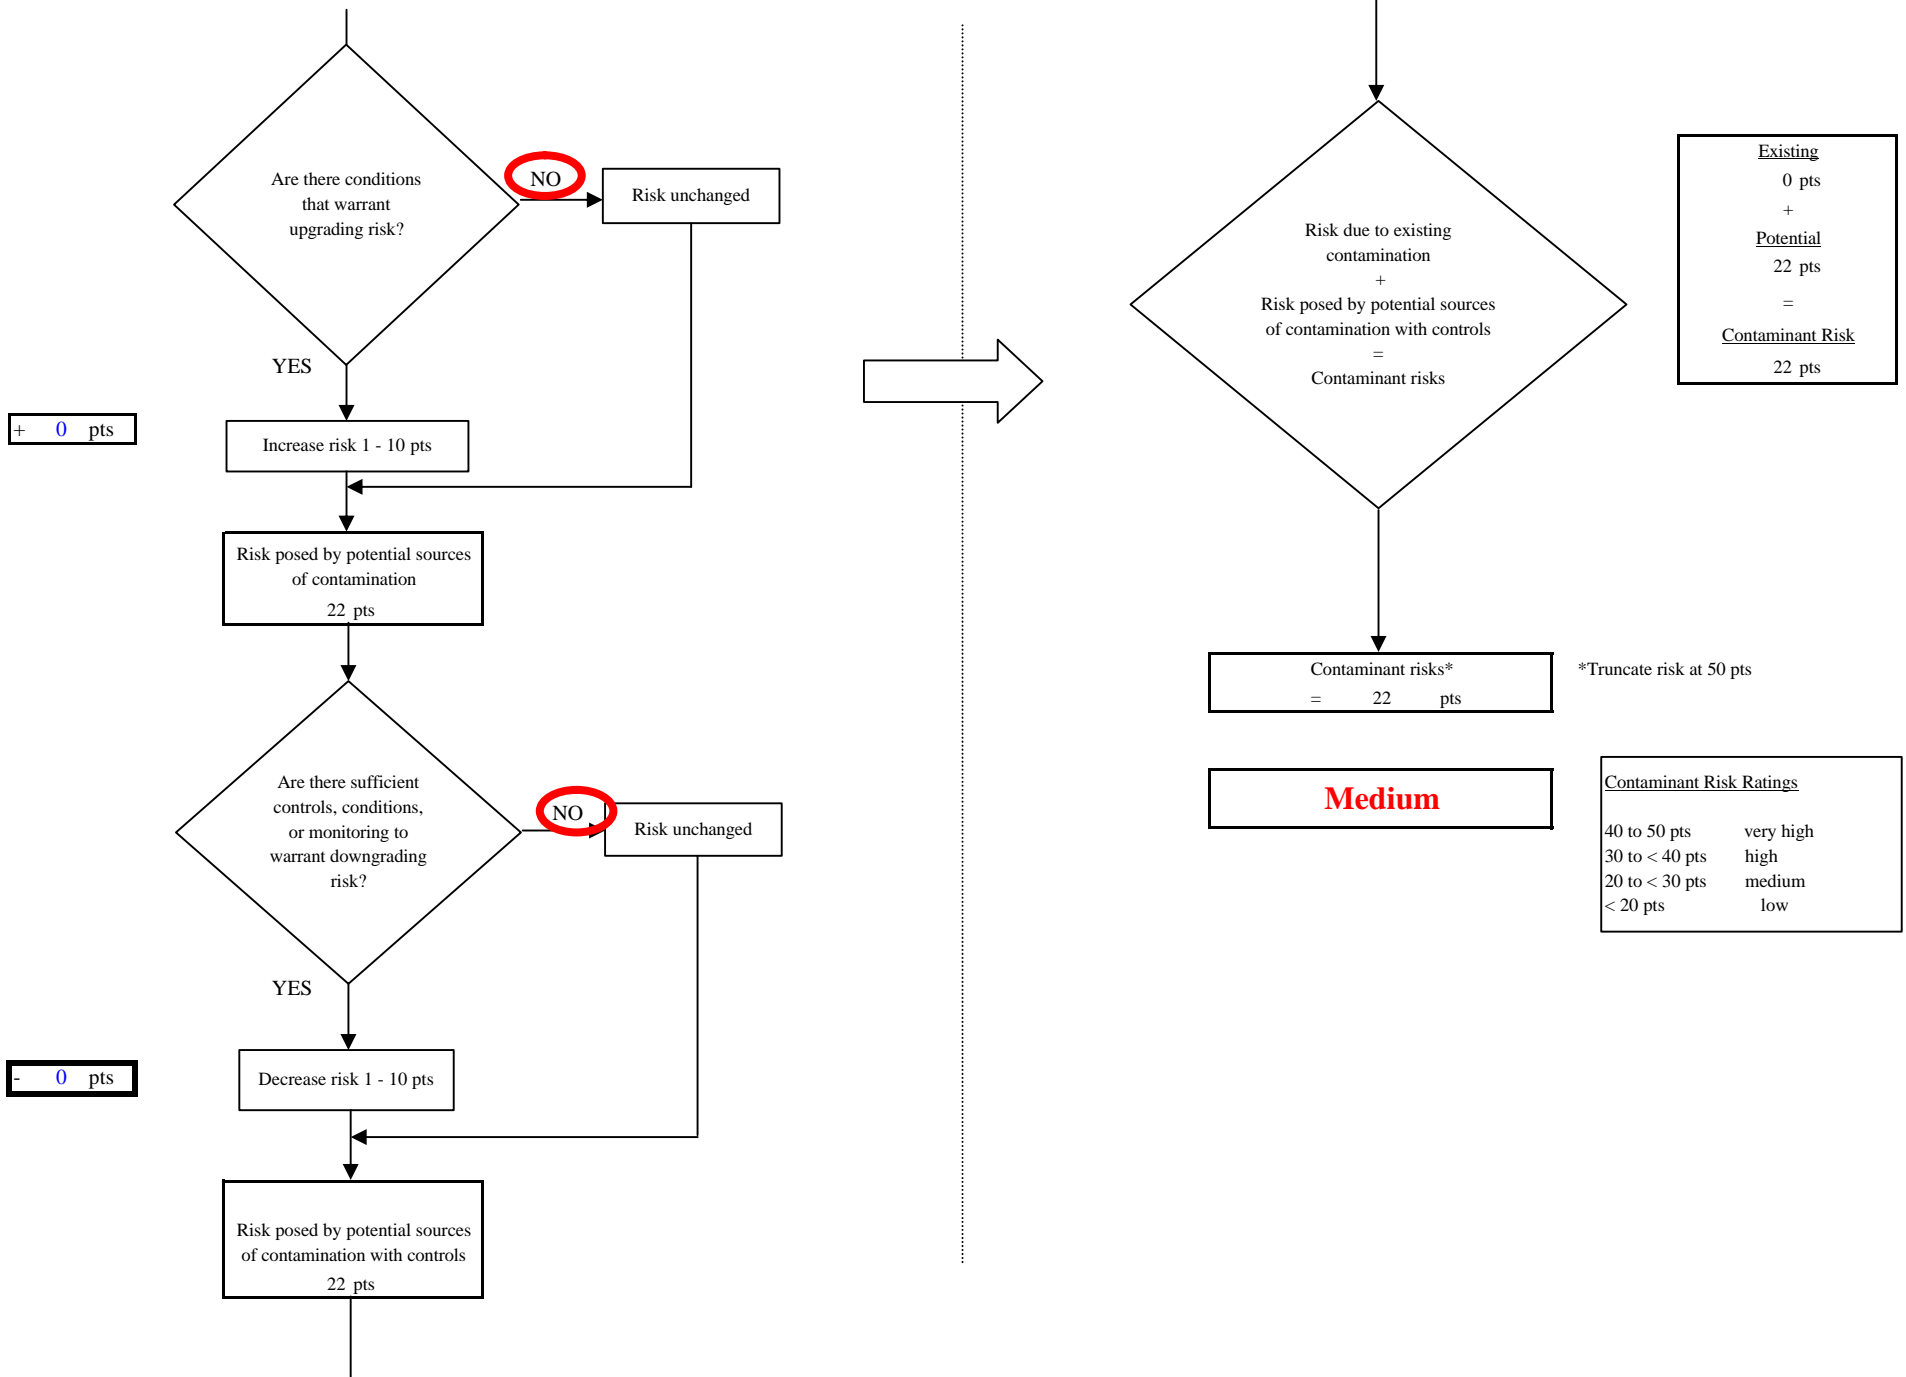

**Chart 8. Vulnerability Analysis for Victory Bible Camp Spring - Volatile Organic Chemicals**

