



Source Water Assessment

A Hydrogeologic Susceptibility and
Vulnerability Assessment for the
ConocoPhillips
Alpine Oilfield Development

PWSID # 333460.001

September 2004

Drinking Water Protection Program Report #1542

Alaska Department of Environmental Conservation

Source Water Assessment for the ConocoPhillips Alpine Oilfield Development

PWSID# 333460.001

September 2004

Drinking Water Protection Program Report #1542

The Drinking Water Protection Program (DWPP) is producing Source Water Assessments in compliance with the Safe Drinking Water Act Amendments of 1996. Each assessment includes a delineation of the source water area, an inventory of potential and existing contaminant sources that may impact the water, a risk ranking for each of these contaminants, and an evaluation of the potential vulnerability of these drinking water sources.

These assessments are intended to provide public water systems owners/operators, communities, and local governments with the best available information that may be used to protect the quality of their drinking water. The assessments combine information obtained from various sources, including the U.S. Environmental Protection Agency, Alaska Department of Environmental Conservation (ADEC), public water system owners/operators, and other public information sources. The results of this assessment are subject to change if additional data becomes available. It is anticipated this assessment will be updated every five years to reflect any changes in the vulnerability and/or susceptibility of public drinking water source. If you have any additional information that may affect the results of this assessment, please contact the Program Coordinator of DWPP, (907) 269-7521.

CONTENTS

	Page
SECTION	
Executive Summary	1
Drinking Water System and Area Overview	1
Alpine Oilfield Development Drinking Water Protection Area	1
Inventory of Potential and Existing Contaminant Sources	2
Ranking of Contaminant Risks	2
Vulnerability of the Drinking Water System	2
References	7

TABLES

TABLE	1. Definition of Zones	1
	2. Susceptibility of the Water Source	3
	3. Contaminant Risks	3
	4. Overall Vulnerability	3

APPENDICES

APPENDIX	A.	Alpine Oilfield Development Drinking Water Protection Area (Map 1)	
	B.	Contaminant Source Inventory and Risk Rankings (Tables 1 - 7)	
	C.	Alpine Oilfield Development Drinking Water Protection Area and Potential and Existing Contaminant Sources (Map 2)	
	D.	Vulnerability Analysis and Contaminant Risks (Charts 1 – 13)	

Source Water Assessment for ConocoPhillips – Alpine Oilfield Water System

Drinking Water Protection Program Alaska Department of Environmental Conservation

EXECUTIVE SUMMARY

The ConocoPhillips – Alpine Oilfield water system is a Class A (community) water system that obtains water from 2 small lakes adjacent to the development. One of the lakes is used as a backup source. The primary intake is located on a lake due west of the development and the secondary intake is located on a lake approximately 0.5-miles to the southwest. Access to the intake areas is not restricted. The overall protection area is approximately 0.6 square miles in size and received a susceptibility rating of “**high**”. *A rating of high to very high is typical for all systems with surface water intakes.* Potential and existing sources of the following contaminants were evaluated for the Source Water Assessment: bacteria and viruses, nitrates and/or nitrites, heavy metals, cyanide, and other inorganic chemicals, synthetic organic chemicals, volatile organic chemicals, and other organic chemicals. Oil wells, chemical storage areas, an airfield, dirt/gravel roads, and oil pipelines were identified as potential sources of contaminants for the drinking water source. This evaluation included all available water sampling data submitted to ADEC by the system operator. The samples may have been collected from either raw water or post-treated water. Combining the susceptibility of the surface water source with the contaminant risks, this water system has received a vulnerability rating of “**medium**” for bacteria and viruses and nitrates/nitrites; “**high**” for volatile organic chemicals, heavy metals, and synthetic organic chemicals; and “**very high**” for other organic chemicals. This assessment can be used as a foundation for local voluntary protection efforts as well as a basis for the continuous efforts on the part of ConocoPhillips to protect public health.

DRINKING WATER SYSTEM AND AREA OVERVIEW

The Alpine Oilfield Development (Sec. 5, T011N, R005E and Sec. 32, T012N, R005E Umiat Meridian) is located in the Colville River Delta area of the North Slope (Please see the inset of Map 1 in Appendix A for location). The water system is a Class A (community) water system that serves the working population year-round and obtains water from 2 small lakes adjacent to the development. One of the lakes is used as a backup source. The primary intake is located on a lake (L9313) due west of the development and the secondary intake is located on a lake (L9312) approximately 0.5-miles to the southwest (See Map 1 of Appendix A).

The climate of the region is arctic. Temperatures range from -56 to 78. The daily minimum temperature is below freezing 297 days each year, on average. Precipitation is light, averaging 5 inches, with an annual snowfall of 20 inches (ADCED, 2004).

The 2000 sanitary survey indicates that intake is screened, maintained, and protected from ice buildup and siltation. The survey also states that the pump capacity of the system is 120 gpm for each of the two pumps at each lake. System operators report that the storage capacity is 150 million gallons for L9313 and 225 million gallons for L9312. The average flow rate of the system is estimated to be approximately 20,000 gallons per day (depending on Alpine Camp populations).

ALPINE OILFIELD DEVELOPMENT DRINKING WATER PROTECTION AREA

Identifying the pathways most likely for surface contamination to reach water intake areas is the first step in determining the water system’s risk. These are initially determined by looking at the drainage area contributing overland water flow to a surface water source intake. The entire drainage area is also known as the “drinking water protection area”. Please refer to pages 10-11 of the “Guidance Manual for Class A Public Water Systems” for additional information.

The protection area established for surface water sources by the ADEC is usually separated into three zones, limited by the watershed boundary. These zones correspond to the overland-flow distance that water travels to get to the source. The ADEC Drinking Water Protection Program’s Technical Advisory Committee developed guidelines for derivation of these zones in 1998. The following is a summary of the three protection area zones:

Table 1. Definition of Zones

Zone	Definition
A	Areas within 1000-ft of lakes or streams
B	Areas within 1-mile of lakes or streams
C	The watershed boundary

The protection area for the Alpine Oilfield intake includes each of these Zones (See Map 1 of Appendix A).

INVENTORY OF POTENTIAL AND EXISTING CONTAMINANT SOURCES

The Drinking Water Protection Program has completed an inventory of potential and existing sources of contamination within the Alpine Oilfield protection area. This inventory was completed through a search of agency records and other publicly available information. There is a wide array of potential contamination sources to surface water. These contaminants are found within agricultural, residential, commercial, and industrial areas, but *can also occur within areas that have little or no development.*

For Class A public water system assessments, six categories of drinking water contaminants were inventoried. They include:

- Bacteria and viruses;
- Nitrates and/or nitrites;
- Volatile organic chemicals;
- Heavy metals, cyanide, and other inorganic chemicals;
- Synthetic Organic Chemicals; and
- Other Organic Chemicals.

Sources identified in the protection area are displayed on Map 2 of Appendix C and summarized in Table 1 of Appendix B.

RANKING OF CONTAMINANT RISKS

Once potential and existing sources of contamination have been identified, they are assigned a ranking according to what category and level of risk they represent. Ranking of contaminant risks for “potential” or “existing” sources of contamination is a function of the toxicity and the volume of specific contaminants associated with that source. Rankings include:

- Low;
- Medium;
- High; and
- Very High.

The time-of-travel for contaminants within the water is dependent on the physical and chemical characteristics of each contaminant. Bacteria and Viruses are only inventoried in Zone A because of their short life span. Only “Very High” and “High” rankings are inventoried within Zones B and C due to the probability of contaminant dilution by the time the contaminants reach the water intake.

The remaining tables in Appendix B (if necessary) contain the ranking of potential and existing sources of

contamination with respect to bacteria and viruses, nitrates and/or nitrites, volatile organic chemicals, heavy metals, cyanide, and other inorganic chemicals, synthetic organic chemicals, and other organic chemicals.

VULNERABILITY OF THE DRINKING WATER SYSTEM

Vulnerability of a drinking water source to contamination is a combination of two factors:

- Surface Water Susceptibility; and
- Contaminant risks.

Appendix D contains 13 charts, which together form the ‘Vulnerability Analysis’ for the public drinking water Source Water Assessment. Chart 1 analyzes the ‘Susceptibility of the Surface Water Source’ to contamination by looking at the climate, terrain, and intake location. Chart 2 analyzes ‘Contaminant Risks’ for the drinking water source with respect to bacteria and viruses. The ‘Contaminant Risks’ portion of the analysis considers potential sources of contaminants as well as a review of contamination that has or may have occurred, but has not arrived or been detected at the intake area. Chart 3 contains the ‘Vulnerability Analysis for Bacteria and Viruses’, which is a composite score of the Vulnerability Analysis and the overall Susceptibility. Charts 4 through 13 repeat the Contaminant Risks and Vulnerability Analyses for nitrates and nitrites, volatile organic chemicals, heavy metals, cyanide, and other inorganic chemicals, synthetic organic chemicals, and other organic chemicals, respectively.

A score for the Surface Water Susceptibility of the source is reached by considering the properties of the water intake and the surrounding area. The derivation of this information is presented below and the data for this source is shown in Chart 1 of Appendix D.

Susceptibility of the Surface Water Source – always considered to be “high” (30 points)

+

Adequate Construction of the Intake (0 – 5 Points)

+

Runoff Potential Within Zone B (0 – 5 Points)

+

Dilution Capacity of the Surface Water (0 – 10 Points)

=

Natural Susceptibility
(0 – 50 Points)

A ranking is assigned for the Surface Water Susceptibility according to the point score:

Surface Water Source Susceptibility Ratings	
40 to 50 pts	Very High
30 to < 40 pts	High

Table 2. Susceptibility of the Water Source

	Score	Rating
Minimum Allowable Susceptibility	30	
Intake Construction Adequate	0	
Runoff Potential	0	
Dilution Capacity	5	
Overall Susceptibility	35	High

For contaminants, risks to a drinking water source depend on the type, number or density, and distribution of the contaminant sources. The Contaminant Risk score has been derived from an examination of existing, and historical contamination sources that have been detected in the protection area through routine sampling. It also evaluates potential sources of contamination. Flow charts are used to assign a point score, and ratings are assigned in the same way as the susceptibility:

Contaminant Risk Ratings	
40 to 50 pts	Very High
30 to < 40 pts	High
20 to < 30 pts	Medium
< 20 pts	Low

Table 3 summarizes the Contaminant Risks for each category of drinking water contaminants.

Table 3. Contaminant Risks

Category	Score	Rating
Bacteria and Viruses	12	Low
Nitrates and/or Nitrites	12	Low
Volatile Organic Chemicals	40	Very High
Heavy Metals, Cyanide, and Other Inorganic Chemicals	40	Very High
Synthetic Organic Chemicals	25	Medium
Other Organic Chemicals	50	Very High

Finally, an overall vulnerability score is assigned for each contaminant type by combining each of the contaminant risk scores with the susceptibility score:

Susceptibility of the Surface Water Source

(0 – 50 points)

+

Contaminant Risks (0 – 50 points)

=

Vulnerability of the
Drinking Water Source to Contamination (0 – 100).

Again, rankings are assigned according to a point score:

Overall Vulnerability Ratings	
80 to 100 pts	Very High
60 to < 80 pts	High
40 to < 60 pts	Medium
< 40 pts	Low

Table 4 contains the overall vulnerability scores and ratings for each of the six categories of drinking water contaminants. Note: scores are rounded off to the nearest five.

Table 4. Overall Vulnerability

Category	Score	Rating
Bacteria and Viruses	45	Medium
Nitrates and Nitrites	45	Medium
Volatile Organic Chemicals	75	High
Heavy Metals, Cyanide, and Other Inorganic Chemicals	75	High
Synthetic Organic Chemicals	60	High
Other Organic Chemicals	85	Very High

Bacteria and Viruses

The contaminant risk for bacteria and viruses is “low”. Typically, coliform detection in raw water samples collected from surface water sources is normal. (See Chart 2 – Contaminant Risks for Bacteria and Viruses in Appendix D).

Coliforms (a bacteria) are found naturally in the environment and although they aren’t necessarily a health threat, they are an indicator of other potentially harmful bacteria in the water, more specifically, fecal coliforms and E. coli which only come from human and animal fecal waste. Harmful bacteria can cause diarrhea, cramps, nausea, headaches, or other symptoms (EPA, 2003). Positive samples increase the overall vulnerability of the drinking water source, indicating that the source is susceptible to bacteria and virus contamination.

Positive bacteria counts have not been detected in recent sampling.

After combining the contaminant risk for bacteria and viruses with the natural susceptibility of the source, the overall vulnerability of the source to bacteria and virus contamination is “medium”.

Nitrates and Nitrites

The contaminant risk for nitrates and nitrites is “low” (See Chart 4 - Contaminant Risks for Nitrates and/or Nitrites in Appendix D). Nitrates are very mobile, moving at approximately the same rate as water.

Sampling history for the water source indicates that nitrates have not been detected in samples collected in 2001 through 2003. The Maximum Contaminant Level (MCL) for nitrates is 10 milligrams per liter (mg/L). The MCL is the maximum level of contaminant that is allowed to exist in drinking water and still be consumed by humans without harmful health effects (EPA, 2003).

Possible sources of nitrates/nitrites could be from airfields, human/animal activity along roads, ATV trails or snowmachine trails located within the protection area.

After combining the contaminant risk for nitrates and nitrites with the natural susceptibility of the source, the overall vulnerability of the source to contamination is “medium”.

Volatile Organic Chemicals

The contaminant risk for volatile organic chemicals is “very high” (See Chart 6 – Contaminant Risks for Volatile Organic Chemicals in Appendix D).

Trihalomethanes and chloroform were detected at levels below the MCL during sampling in 2003, although these chemicals typically originate during the process of water treatment and not from the source waters. The MCL for chloroform is 0.2 milligrams per liter (mg/L) and the MCL for total trihalomethanes is 0.1 mg/L.

Possible sources of volatile organic chemicals could be from oil / chemical spillage, airfields, human/animal activity along roads, ATV trails or snowmachine trails located within the protection area.

After combining the contaminant risk for volatile organic chemicals with the natural susceptibility of the source, the overall vulnerability of the source to contamination is “high”.

Heavy Metals, Cyanide, and Other Inorganic Chemicals

The contaminant risk for heavy metals is “very high”. Copper and lead were detected in samples collected during 2002-2003 at levels below the MCL (See Chart 8 – Contaminant Risks for Heavy Metals, Cyanide, and Other Inorganic Chemicals in Appendix D). The MCL for copper is 1.3 mg/l. and the MCL for lead is 0.015 mg/l.

The most common source of these chemicals is the infrastructure of the distribution system following the treatment process and not from the source waters. Additional sources of heavy metals could be from oil spillage, airfields, activity along roads, ATV or snowmachine trails located within the protection area.

After combining the contaminant risk for heavy metals with the natural susceptibility of the source, the overall vulnerability of the well to contamination is “high”.

Synthetic Organic Chemicals

The contaminant risk for synthetic organic chemicals is “medium”.

Review of the historical sampling data indicates that test results for ethylene dibromide in 2002-2003 were negative.

After combining the contaminant risk with the natural susceptibility of the source, the overall vulnerability to synthetic organic chemicals of the source is “high” (See Chart 11 – Contaminant Risks for Synthetic Organic Chemicals in Appendix D).

Other Organic Chemicals

The contaminant risk for other organic chemicals is “very high”.

Review of the historical sampling data indicates that no other organic chemicals have been sampled recently.

A possible source of other organic chemicals could be from oil / chemical spillage, airfields, or activity along roads located within the protection area.

After combining the contaminant risk with the natural susceptibility of the source, the overall vulnerability to other organic chemicals of the source is “very high” (See Chart 13 – Contaminant Risks for Other Organic Chemicals in Appendix D).

Using the Source Water Assessment

This assessment of contaminant risks can be used as a foundation for local voluntary protection efforts as well as a basis for the continuous efforts on the part of ConocoPhillips to protect public health. It is anticipated that Source Water Assessments will be updated every five years to reflect any changes in the vulnerability and/or susceptibility of the drinking water source.


REFERENCES

Alaska Department of Community and Economic Development (ADCED), 2004 [WWW document]. URL http://www.dced.state.ak.us/cbd/commdb/CF_COMDB.htm


United States Environmental Protection Agency (EPA), 2004 [WWW document]. URL <http://www.epa.gov/safewater/mcl.html>.

APPENDIX A


Alpine Oilfield Development Drinking Water Protection Area Location Map (Map 1)

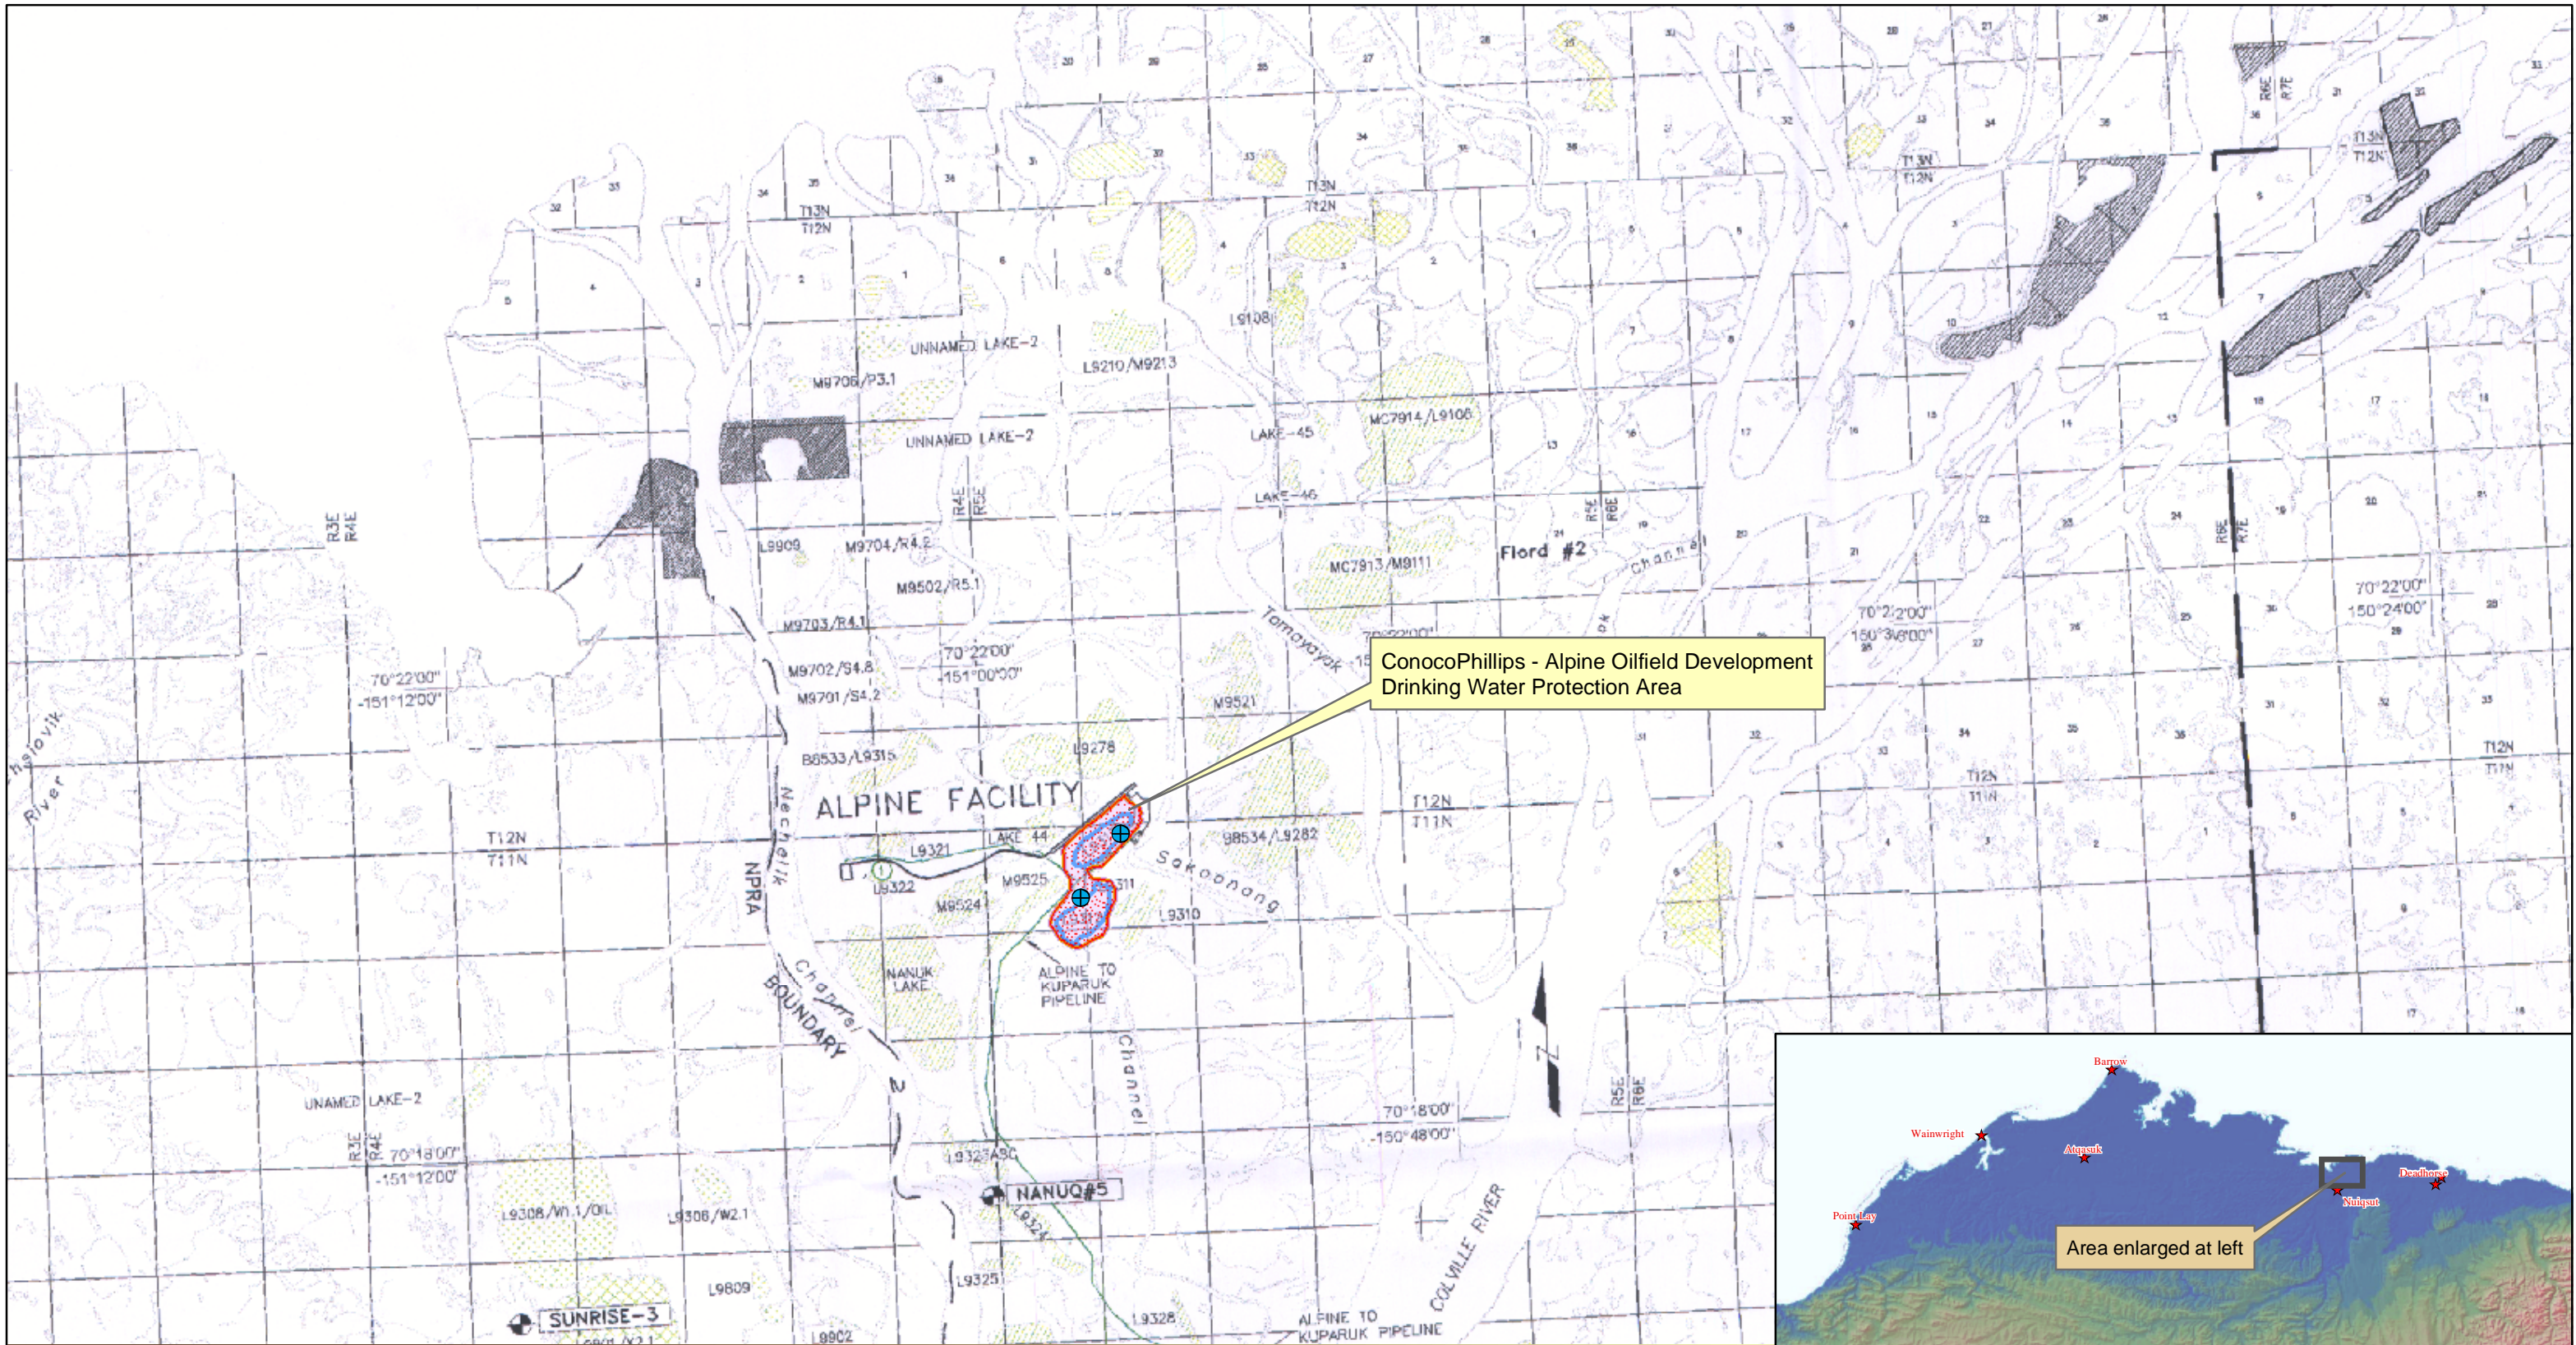

ConocoPhillips - Alpine Oilfield Development Drinking Water Protection Area

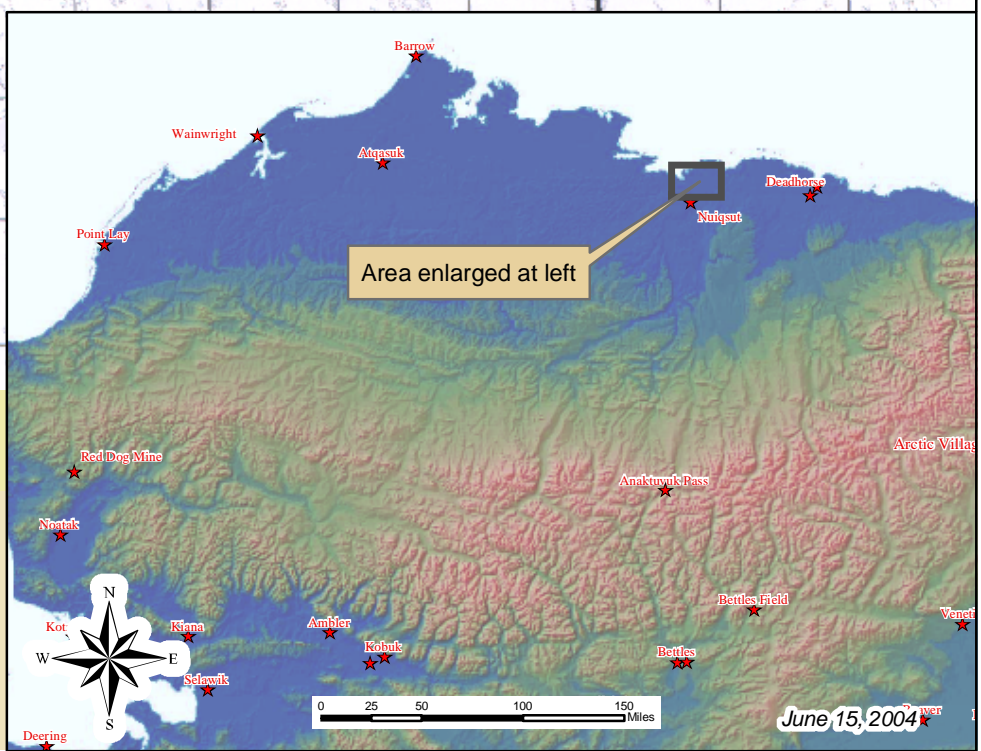

Map 1: ConocoPhillips - Alpine Oilfield Drinking Water Protection Area **PWSID: 333460.001**

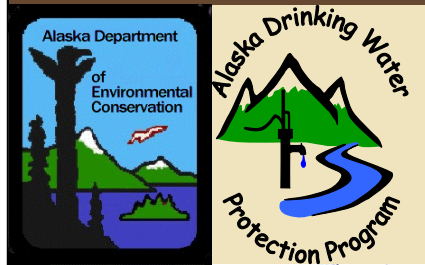

Data Sources: 1:95,197
Protection zones were delineated based upon streams noted on USGS 1:63,000 mapping.
Background image
 - Regional Alpine Facility Map (provided by ConocoPhillips)
For this PWS Zone C (the entire watershed) covers the same area as Zone B (areas within 1-mile of the lake).

- Legend**
- ConocoPhillips - Alpine Oilfield Water Intake
 - Zone A Protection Area
 - Zone B Protection Area
 - Zone C Protection Area

APPENDIX B

Contaminant Source Inventory and Risk Rankings (Tables 1 - 7)

Table 1

**Contaminant Source Inventory for
ConocoPhillips - Alpine Oilfield**

PWSID 333460.001

Contaminant Source Type	Contaminant Source ID	CS ID tag	Zone	Map Number	Comments
Oil and gas extraction wells	W07	W07 1-45	A	2	From ConocoPhillips Mapping
Solvents (storage)	X13	X13 - 1	A	2	From ConocoPhillips Mapping
Airfield	X14	X14 - 1	A	2	From ConocoPhillips Mapping
Roads, dirt/gravel	X24	X24 -1	A	2	From ConocoPhillips Mapping
Pipelines (oil)	X28	X28 - 1	A	2	From ConocoPhillips Mapping

Table 2

*Contaminant Source Inventory and Risk Ranking for
ConocoPhillips - Alpine Oilfield
Sources of Bacteria and Viruses*

PWSID 333460.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Roads, dirt/gravel	X24	X24 -1	A	Low	2	From ConocoPhillips Mapping

Table 3

*Contaminant Source Inventory and Risk Ranking for
ConocoPhillips - Alpine Oilfield
Sources of Nitrates/Nitrites*

PWSID 333460.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Airfield	X14	X14 - 1	A	Low	2	From ConocoPhillips Mapping
Roads, dirt/gravel	X24	X24 -1	A	Low	2	From ConocoPhillips Mapping

Table 4

*Contaminant Source Inventory and Risk Ranking for
ConocoPhillips - Alpine Oilfield
Sources of Volatile Organic Chemicals*

PWSID 333460.001

Contaminant Source Type	Contaminant Source ID	CS ID tag	Zone	Risk Ranking for Analysis	Map Number	Comments
Oil and gas extraction wells	W07	W07 1-45	A	Low	2	From ConocoPhillips Mapping
Solvents (storage)	X13	X13 - 1	A	High	2	From ConocoPhillips Mapping
Airfield	X14	X14 - 1	A	Medium	2	From ConocoPhillips Mapping
Roads, dirt/gravel	X24	X24 -1	A	Low	2	From ConocoPhillips Mapping
Pipelines (oil)	X28	X28 - 1	A	Medium	2	From ConocoPhillips Mapping

Table 5

*Contaminant Source Inventory and Risk Ranking for
ConocoPhillips - Alpine Oilfield
Sources of Heavy Metals, Cyanide and Other Inorganic Chemicals*

PWSID 333460.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Oil and gas extraction wells	W07	W07 1-45	A	High	2	From ConocoPhillips Mapping
Airfield	X14	X14 - 1	A	Low	2	From ConocoPhillips Mapping
Roads, dirt/gravel	X24	X24 -1	A	Low	2	From ConocoPhillips Mapping
Pipelines (oil)	X28	X28 - 1	A	Low	2	From ConocoPhillips Mapping

Table 6

*Contaminant Source Inventory and Risk Ranking for
ConocoPhillips - Alpine Oilfield
Sources of Synthetic Organic Chemicals*

PWSID 333460.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Oil and gas extraction wells	W07	W07 1-45	A	Medium	2	From ConocoPhillips Mapping
Airfield	X14	X14 - 1	A	Medium	2	From ConocoPhillips Mapping

Table 7



*Contaminant Source Inventory and Risk Ranking for
ConocoPhillips - Alpine Oilfield
Sources of Other Organic Chemicals*

PWSID 333460.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Oil and gas extraction wells	W07	W07 1-45	A	Medium	2	From ConocoPhillips Mapping
Solvents (storage)	X13	X13 - 1	A	High	2	From ConocoPhillips Mapping
Airfield	X14	X14 - 1	A	Medium	2	From ConocoPhillips Mapping
Roads, dirt/gravel	X24	X24 -1	A	Low	2	From ConocoPhillips Mapping
Pipelines (oil)	X28	X28 - 1	A	High	2	From ConocoPhillips Mapping

APPENDIX C

Alpine Oilfield Development Drinking Water Protection Area and Potential and Existing Contaminant Sources (Map 2)

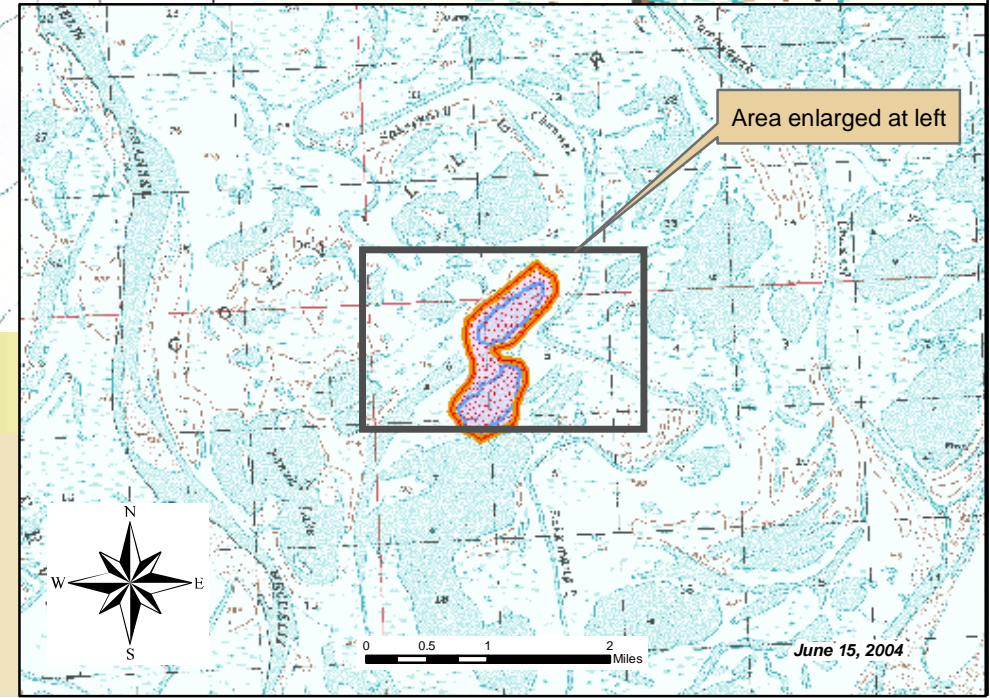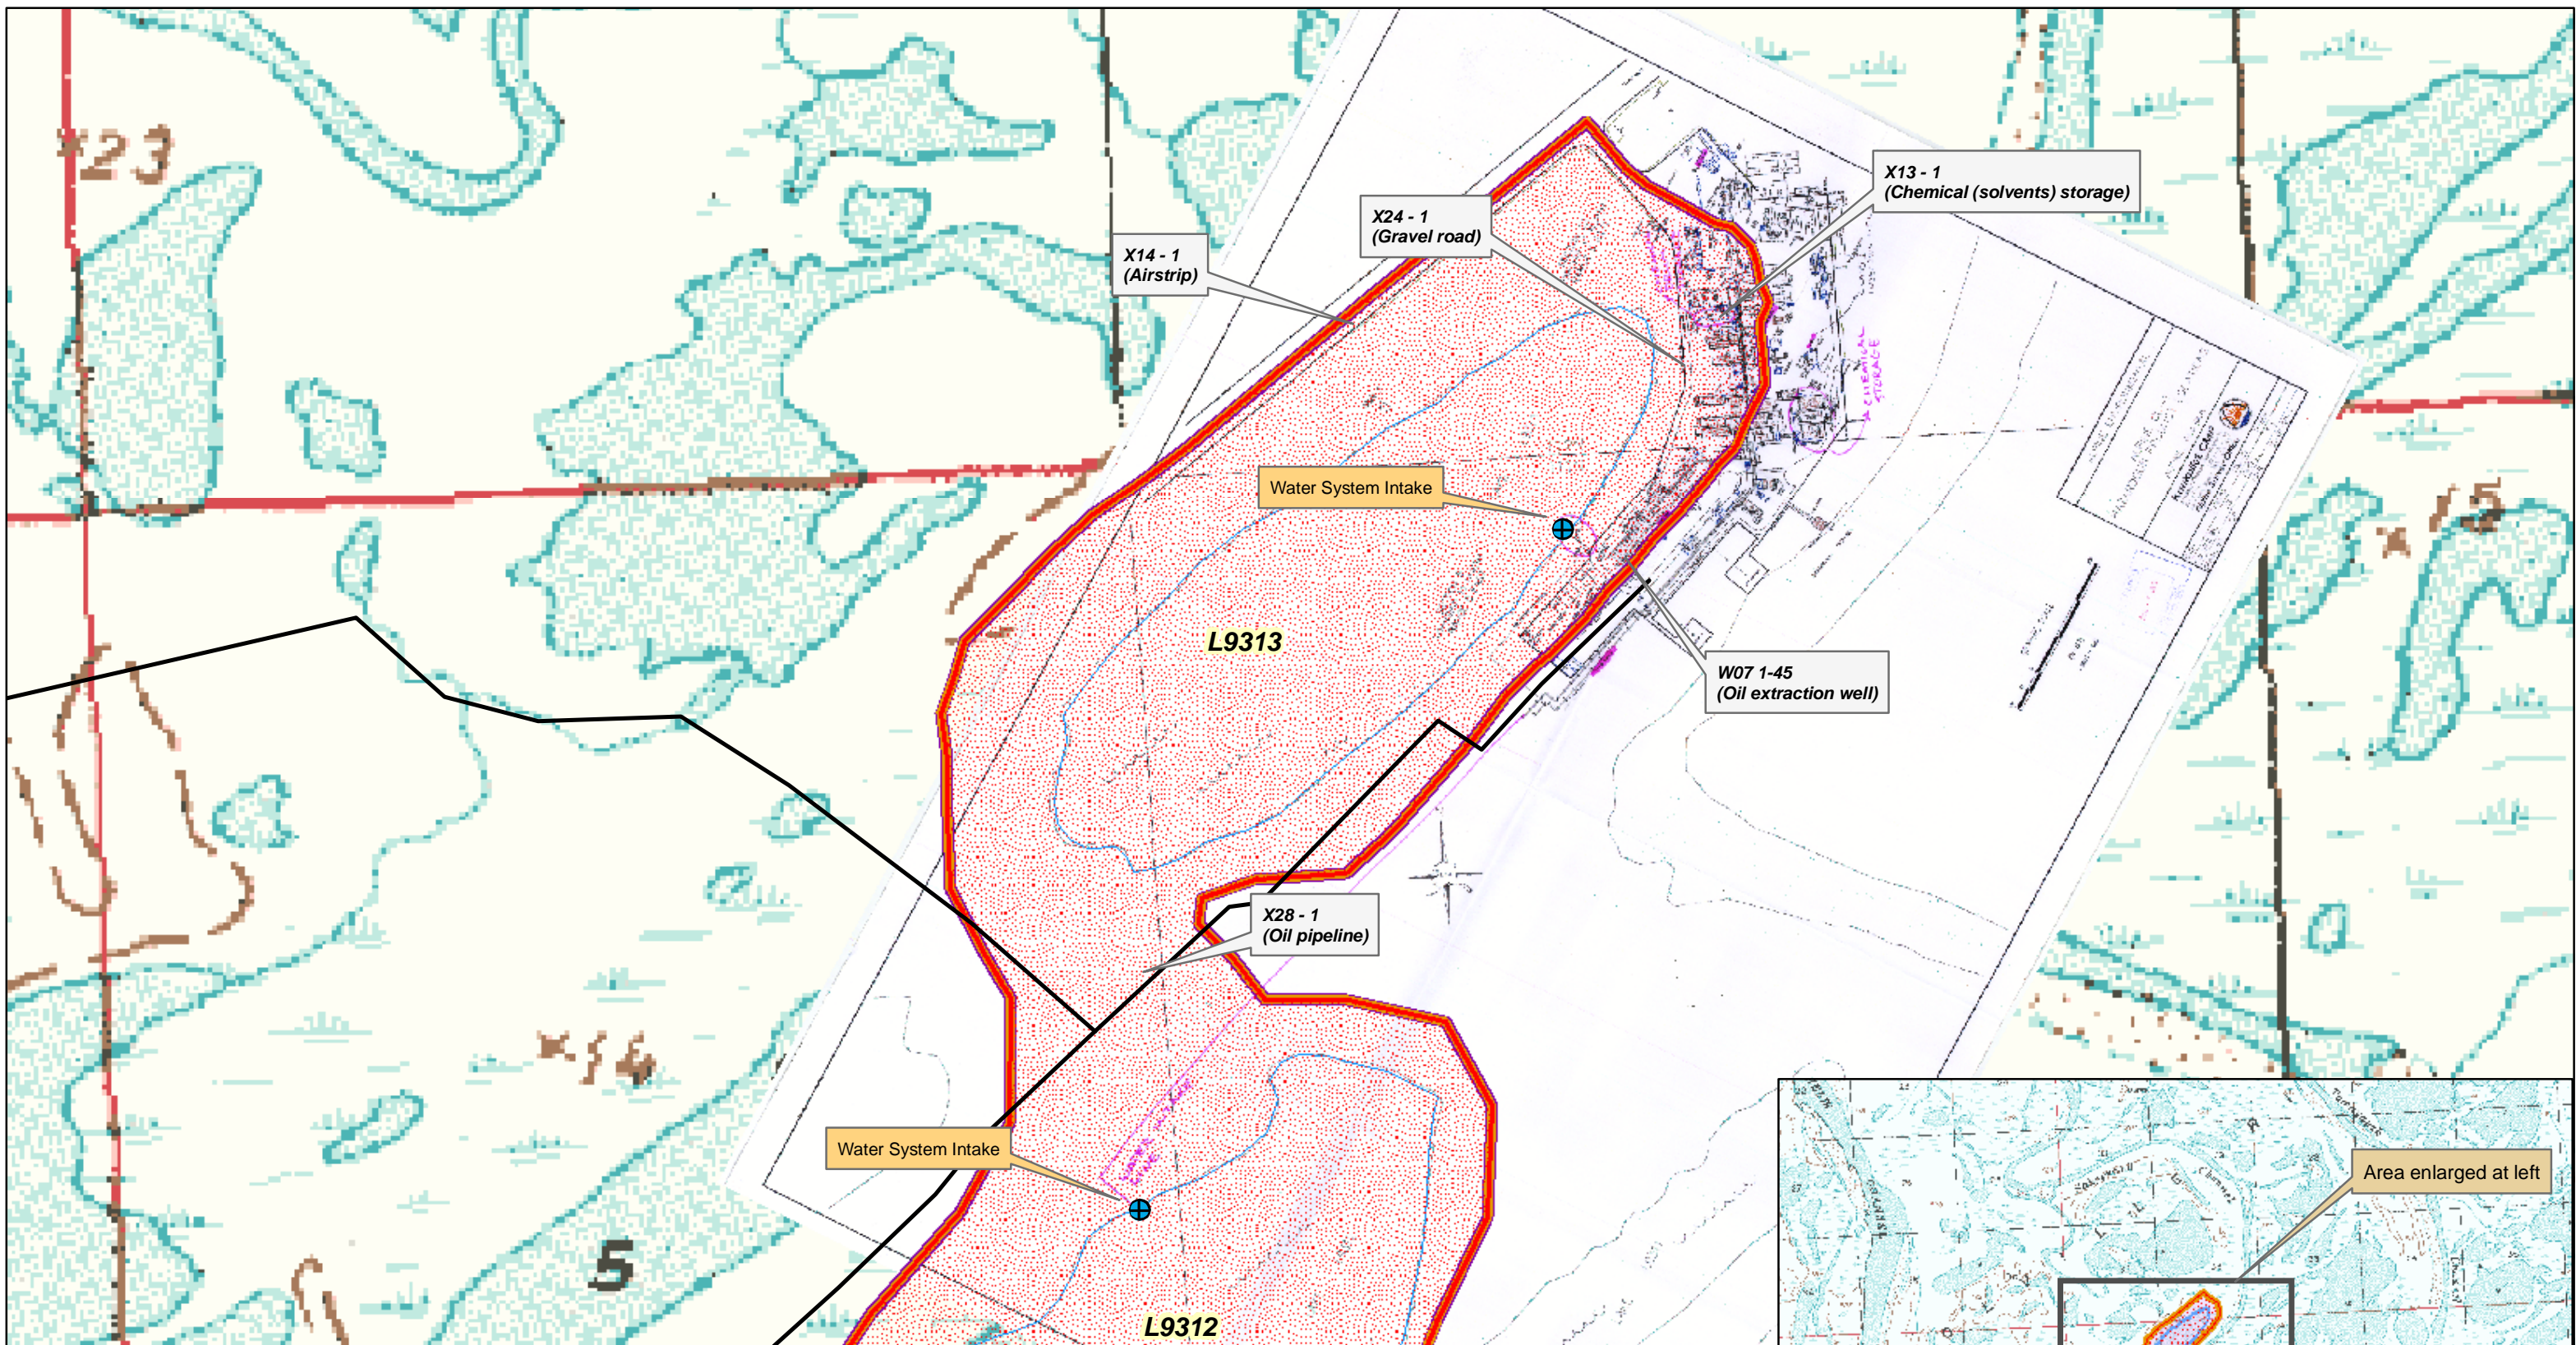

Map 2: Potential and Existing Contaminant Sources

PWSID: 333460.001



0 375 750 1,500 2,250
Feet
1:9,000


Background images
- USGS 1:63,000 mapping
- Site map provided by ConocoPhillips

Protection zones were delineated based upon streams noted on USGS 1:63,000 mapping.

For this PWS Zone C (the entire watershed) covers the same area as Zone B (areas within 1-mile of the lake).

Legend

- ConocoPhillips - Alpine Oilfield Water Intake
- Zone A Protection Area
- Zone B Protection Area
- Zone C Protection Area



0 0.5 1 2 Miles

June 15, 2004

APPENDIX D

Vulnerability Analysis and Contaminant Risks (Charts 1-13)

Chart 1. Susceptibility of the Surface Water Source - ConocoPhillips, Alpine Oil Field

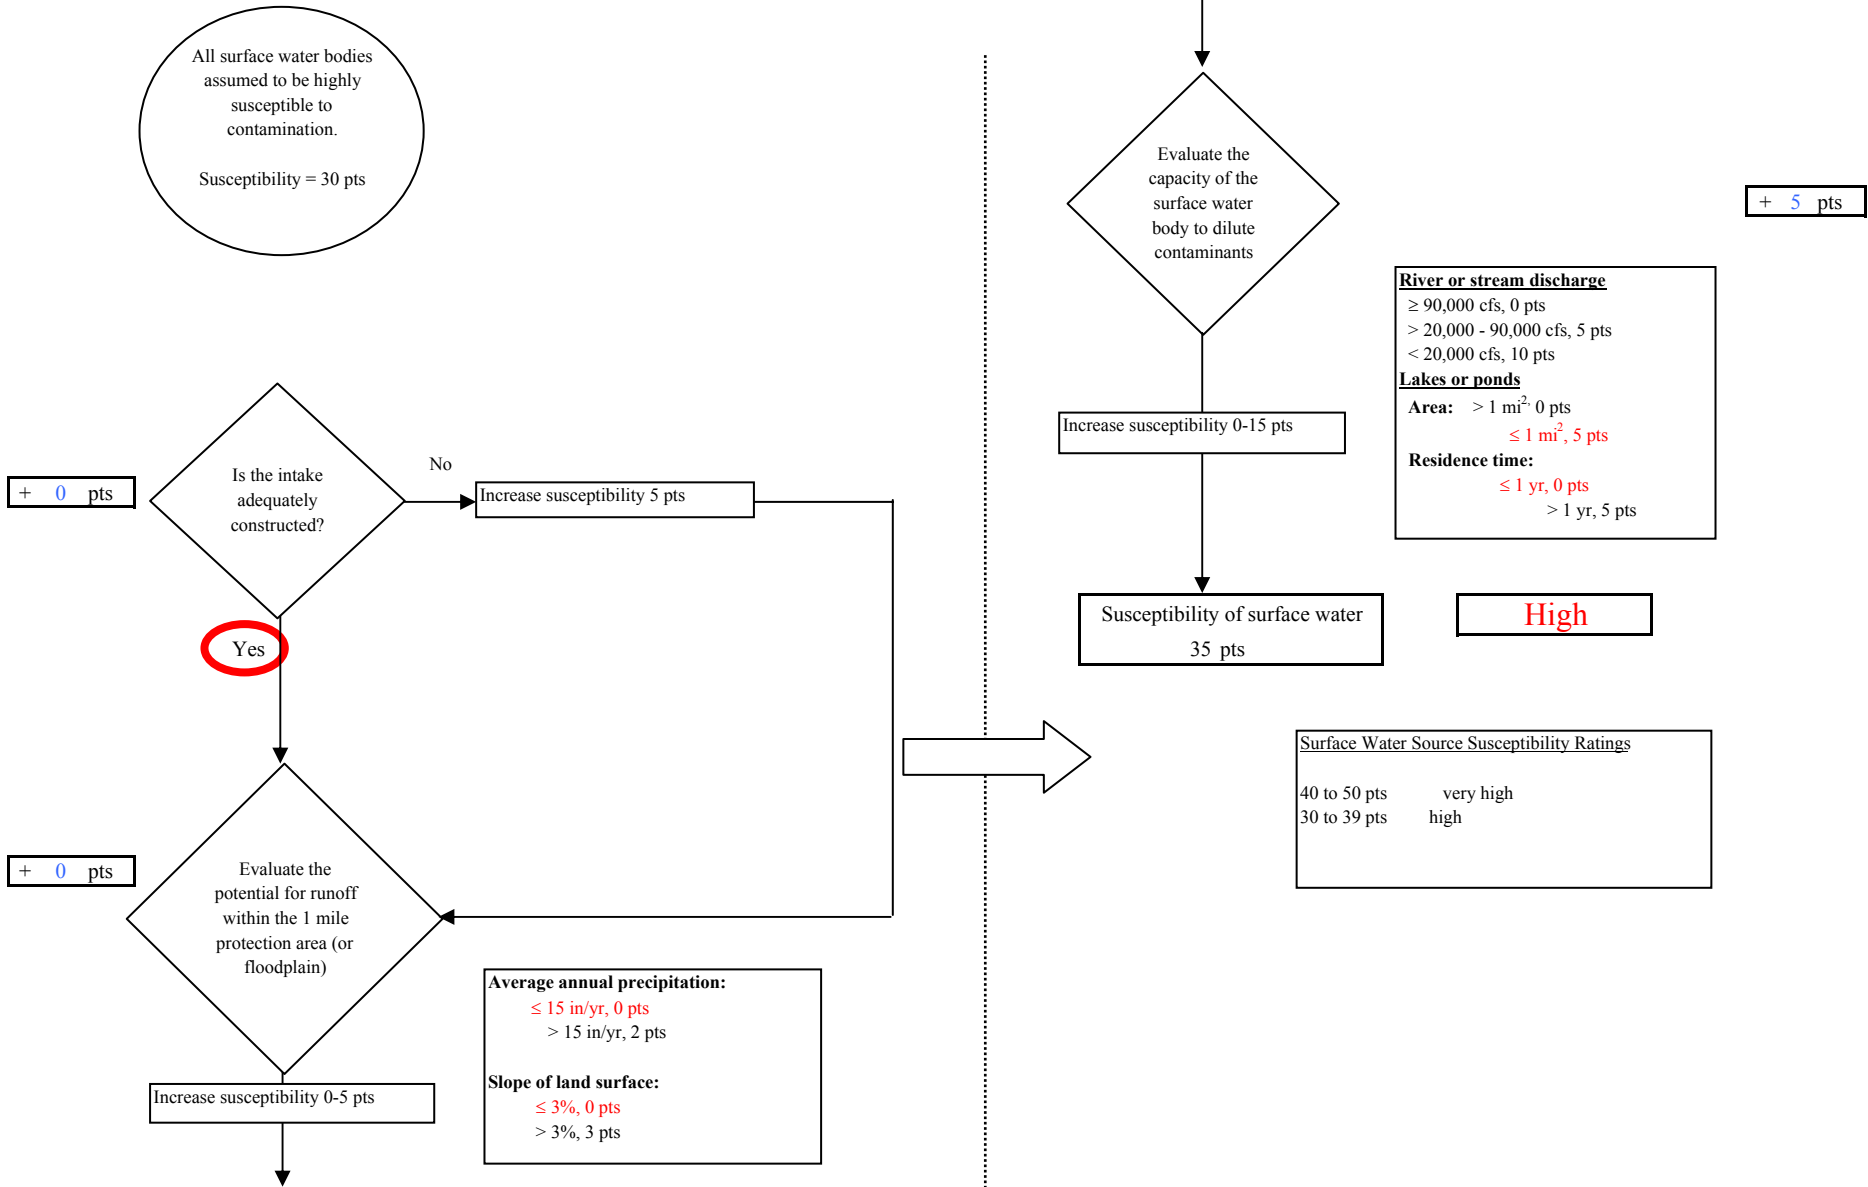


Chart 2. Contaminant risks for ConocoPhillips, Alpine Oil Field - Bacteria & Viruses

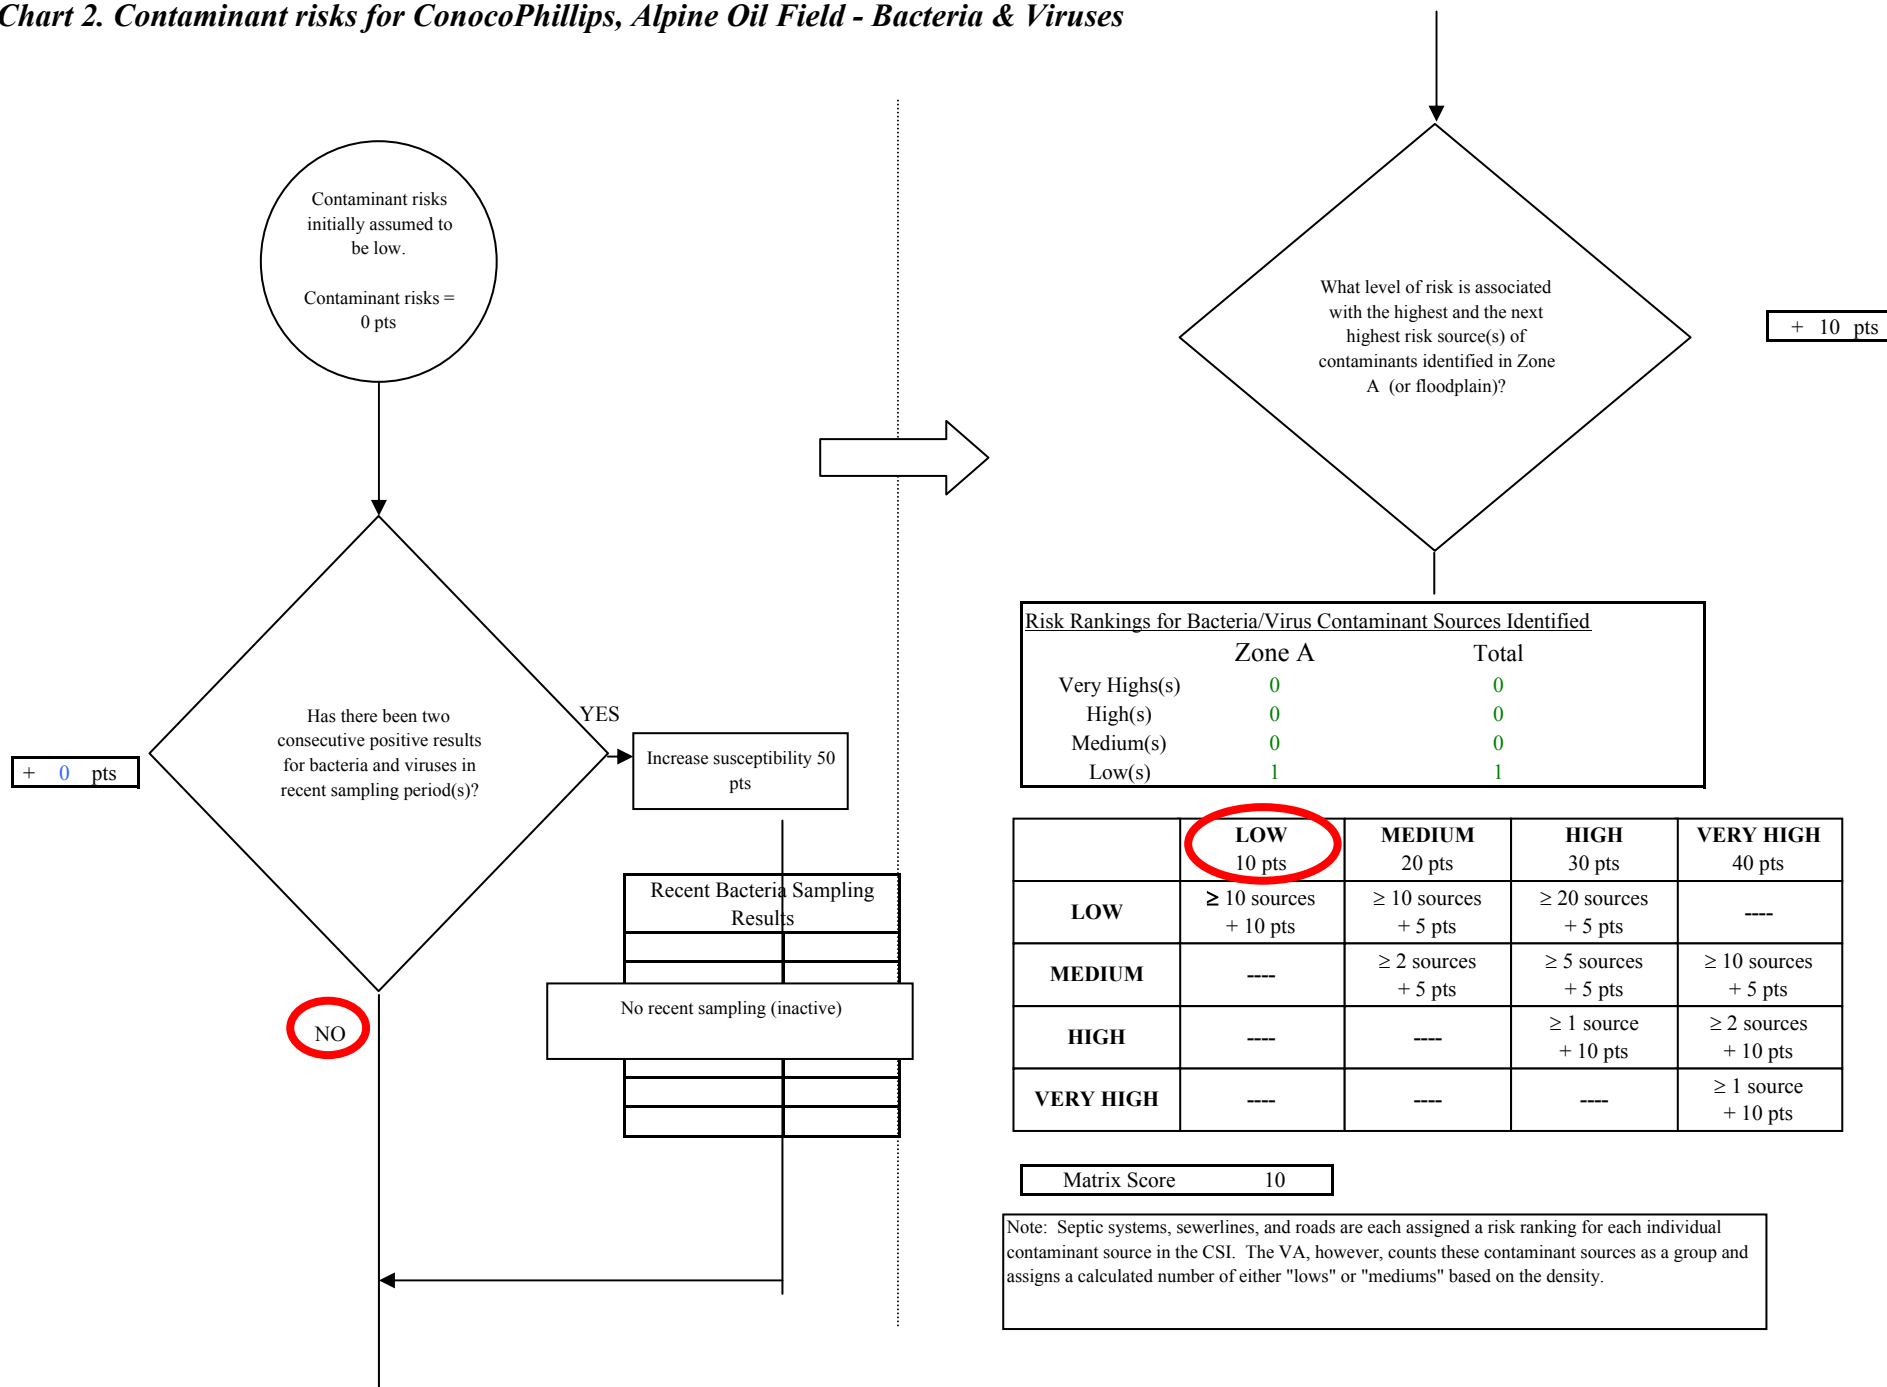


Chart 2. Contaminant risks for ConocoPhillips, Alpine Oil Field - Bacteria & Viruses

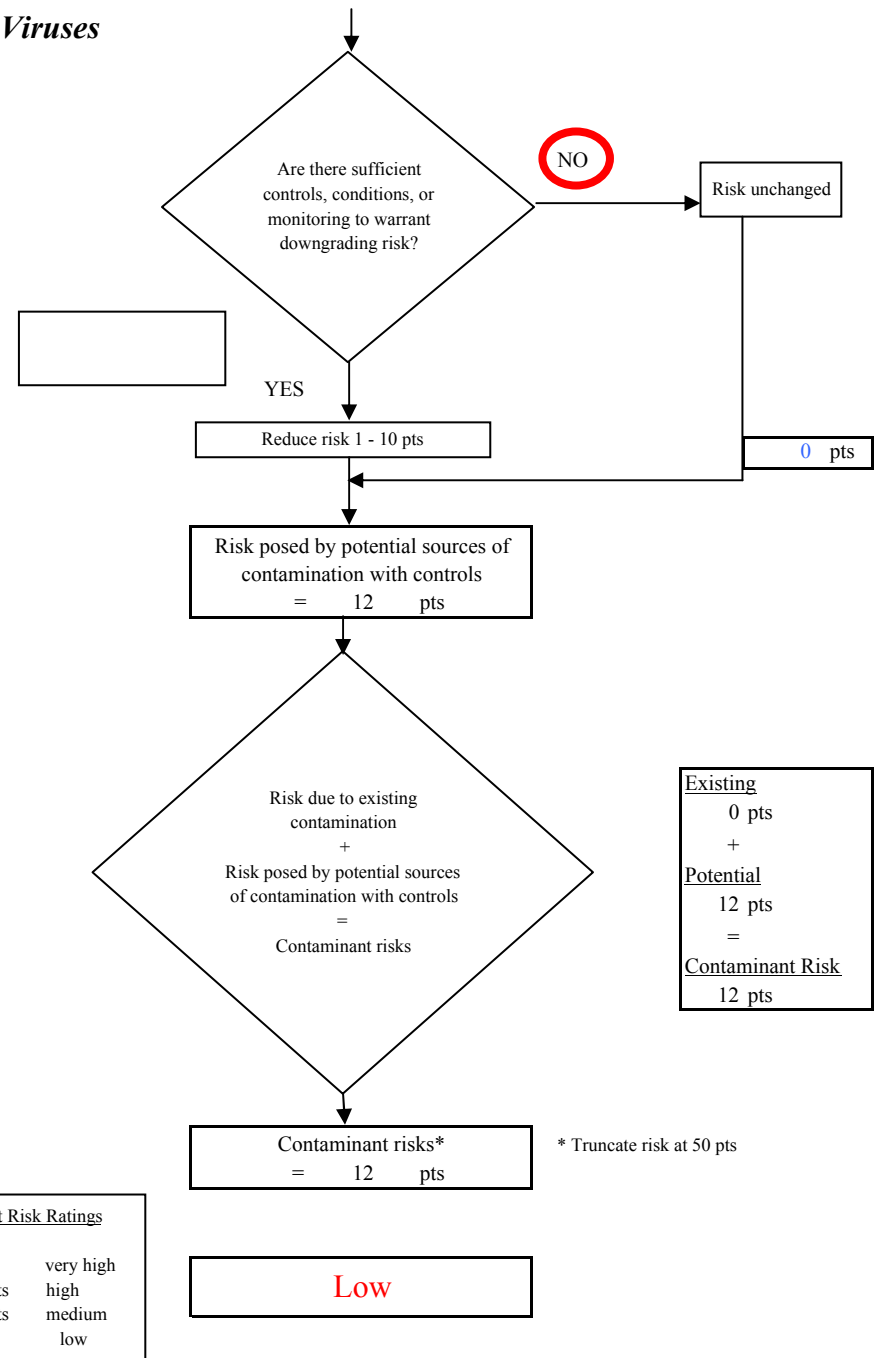

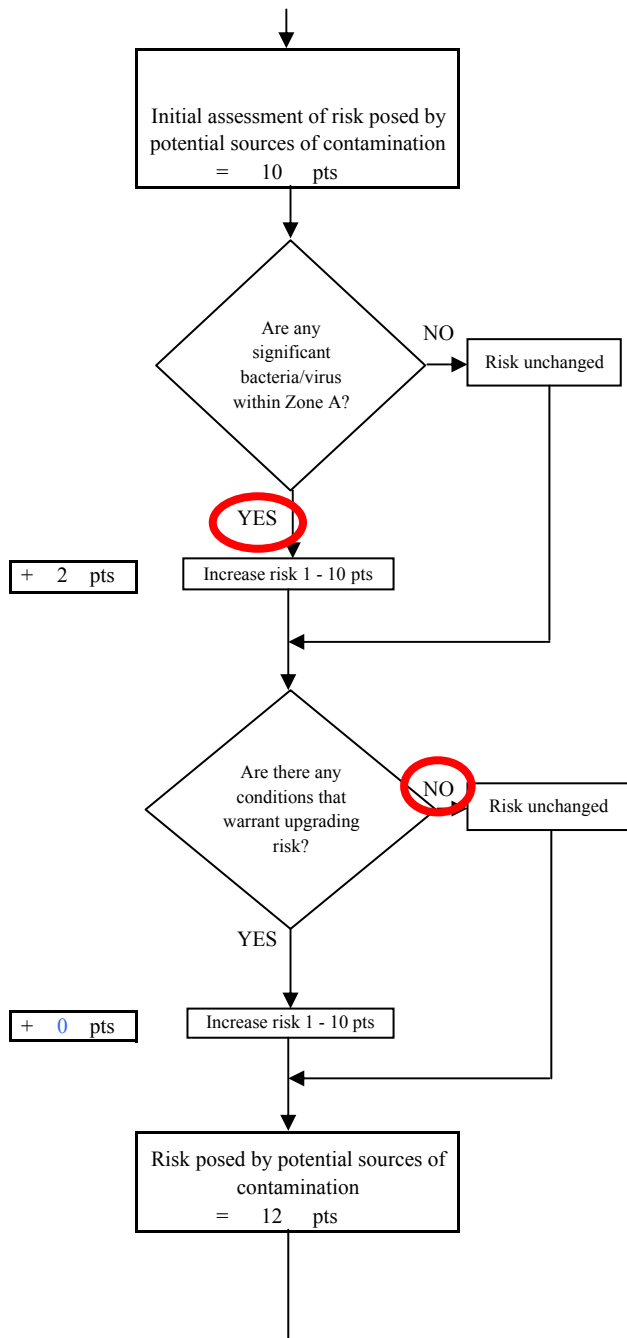


Chart 3. Vulnerability analysis for ConocoPhillips, Alpine Oil Field - Bacteria & Viruses

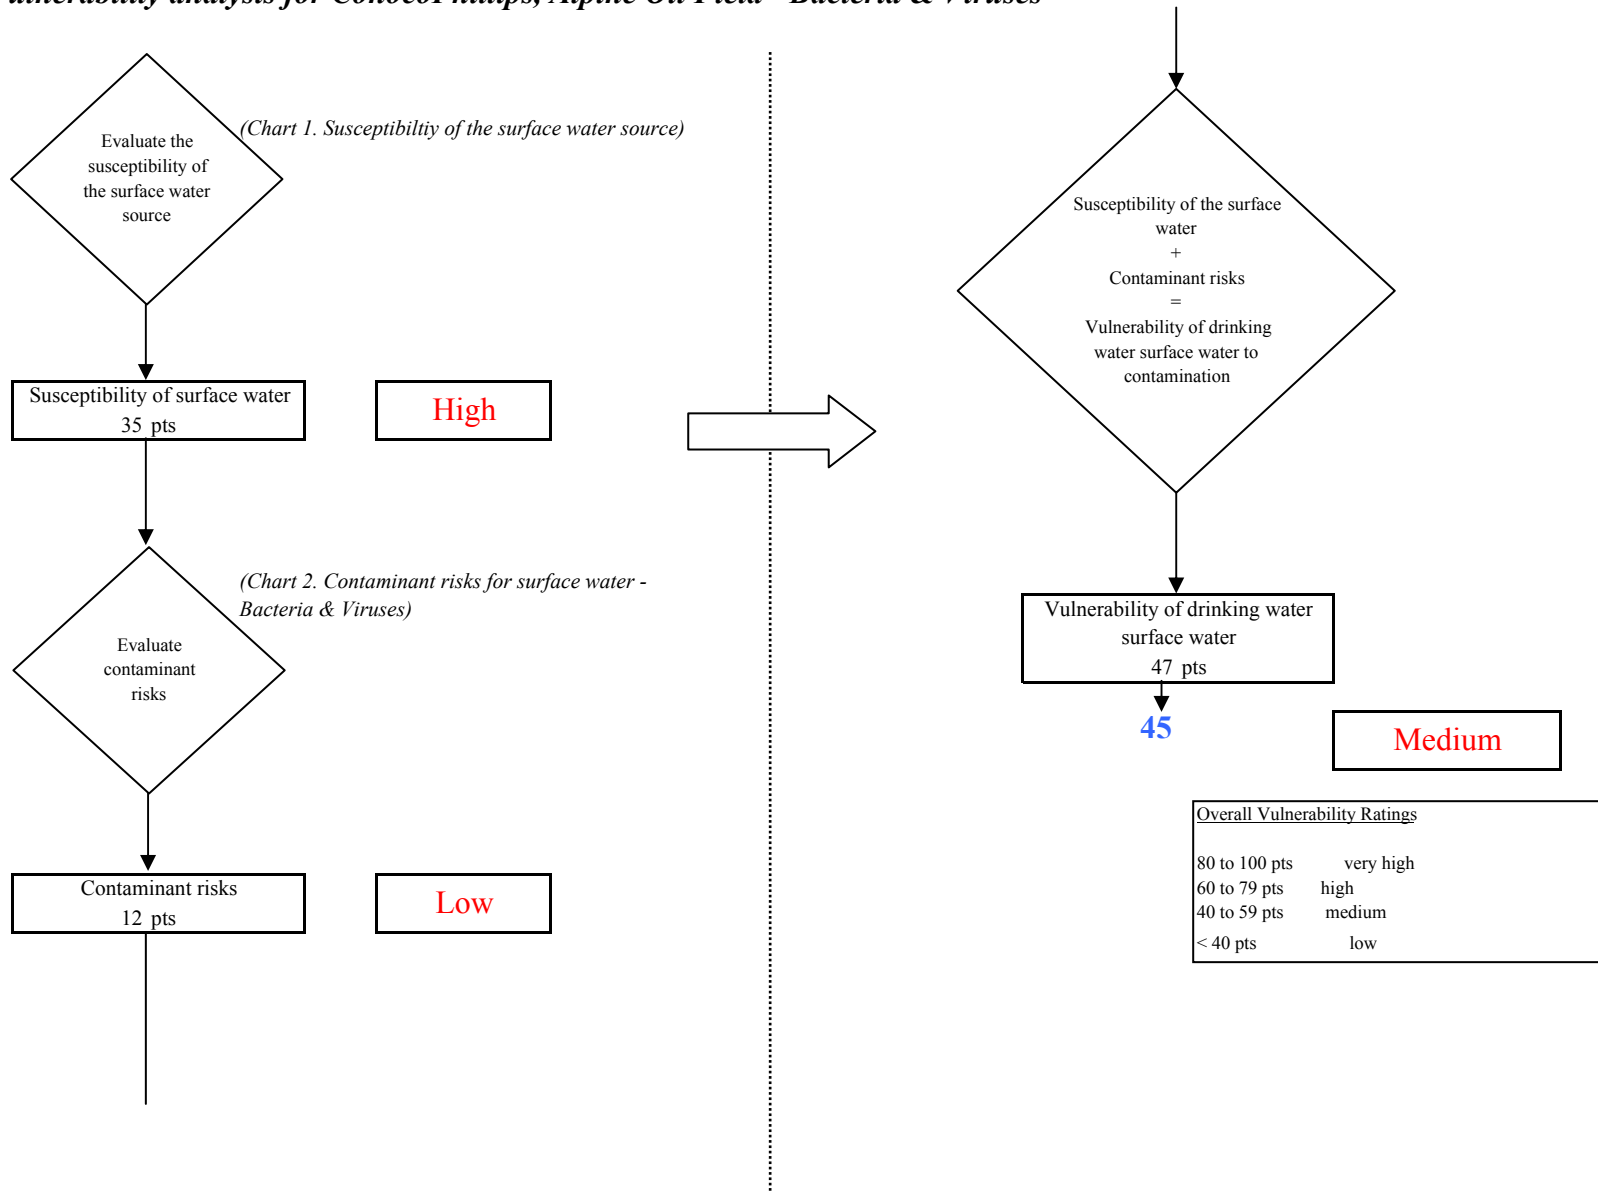


Chart 4. Contaminant risks for ConocoPhillips, Alpine Oil Field - Nitrates and Nitrites

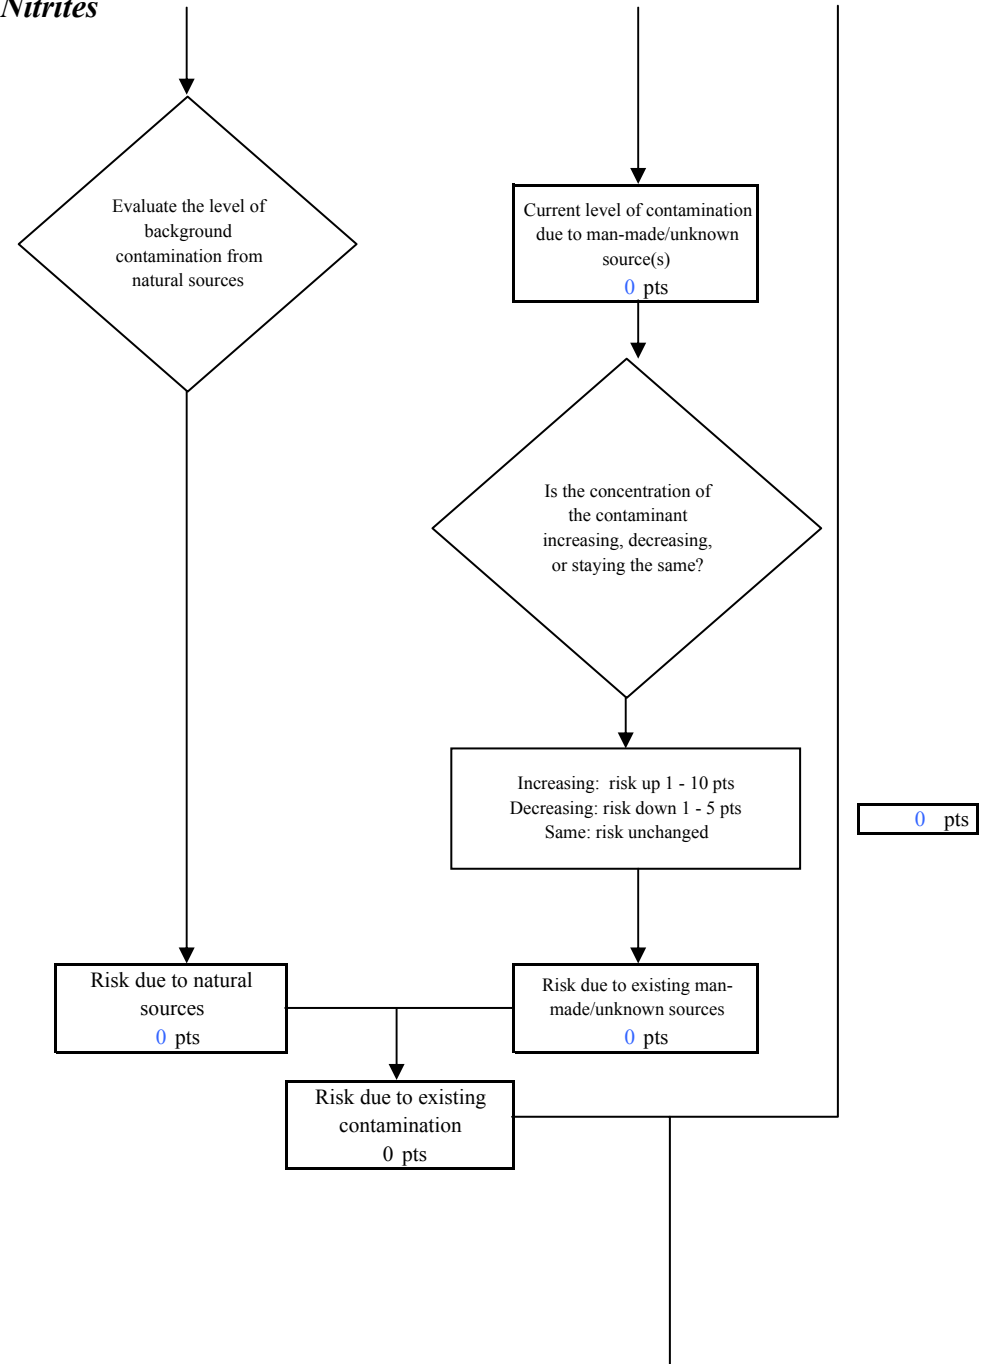
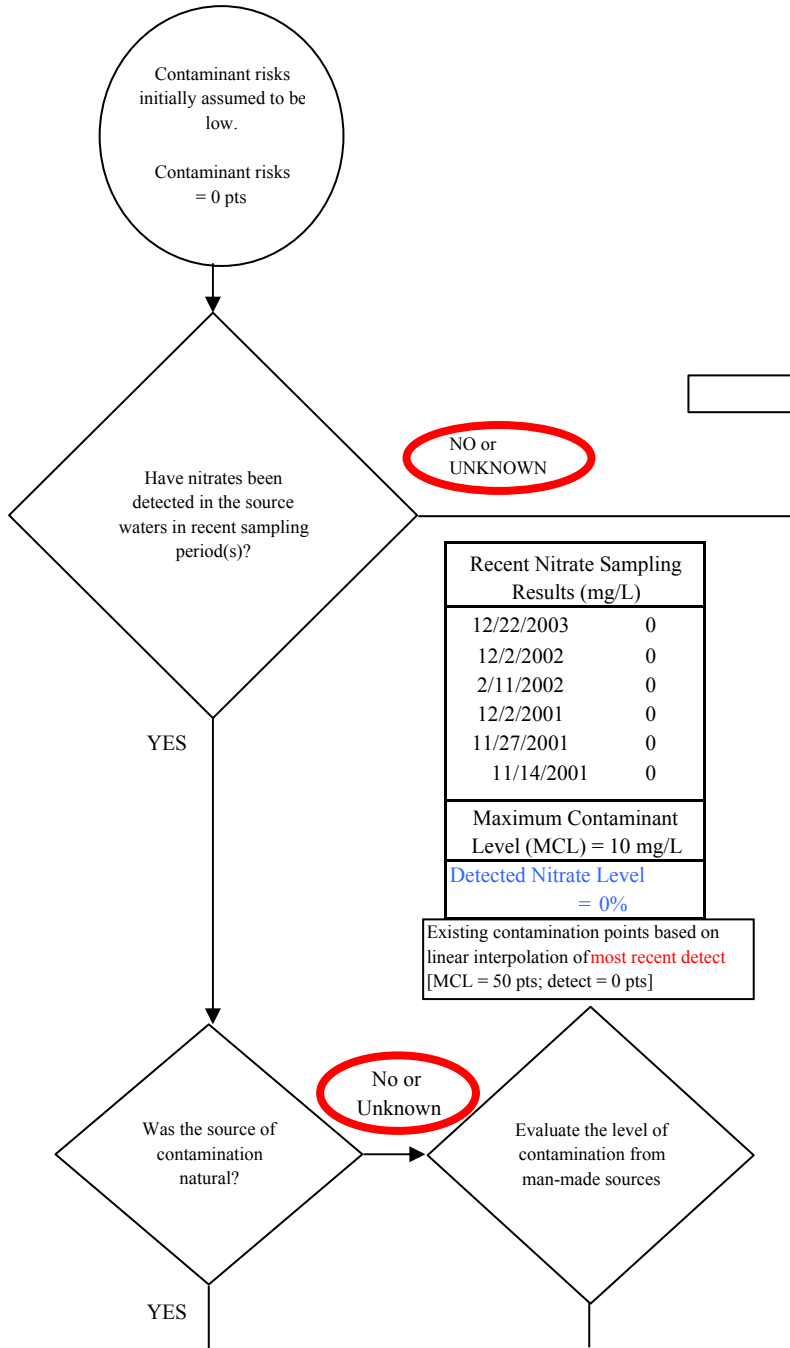


Chart 4. Contaminant risks for ConocoPhillips, Alpine Oil Field - Nitrates and Nitrites

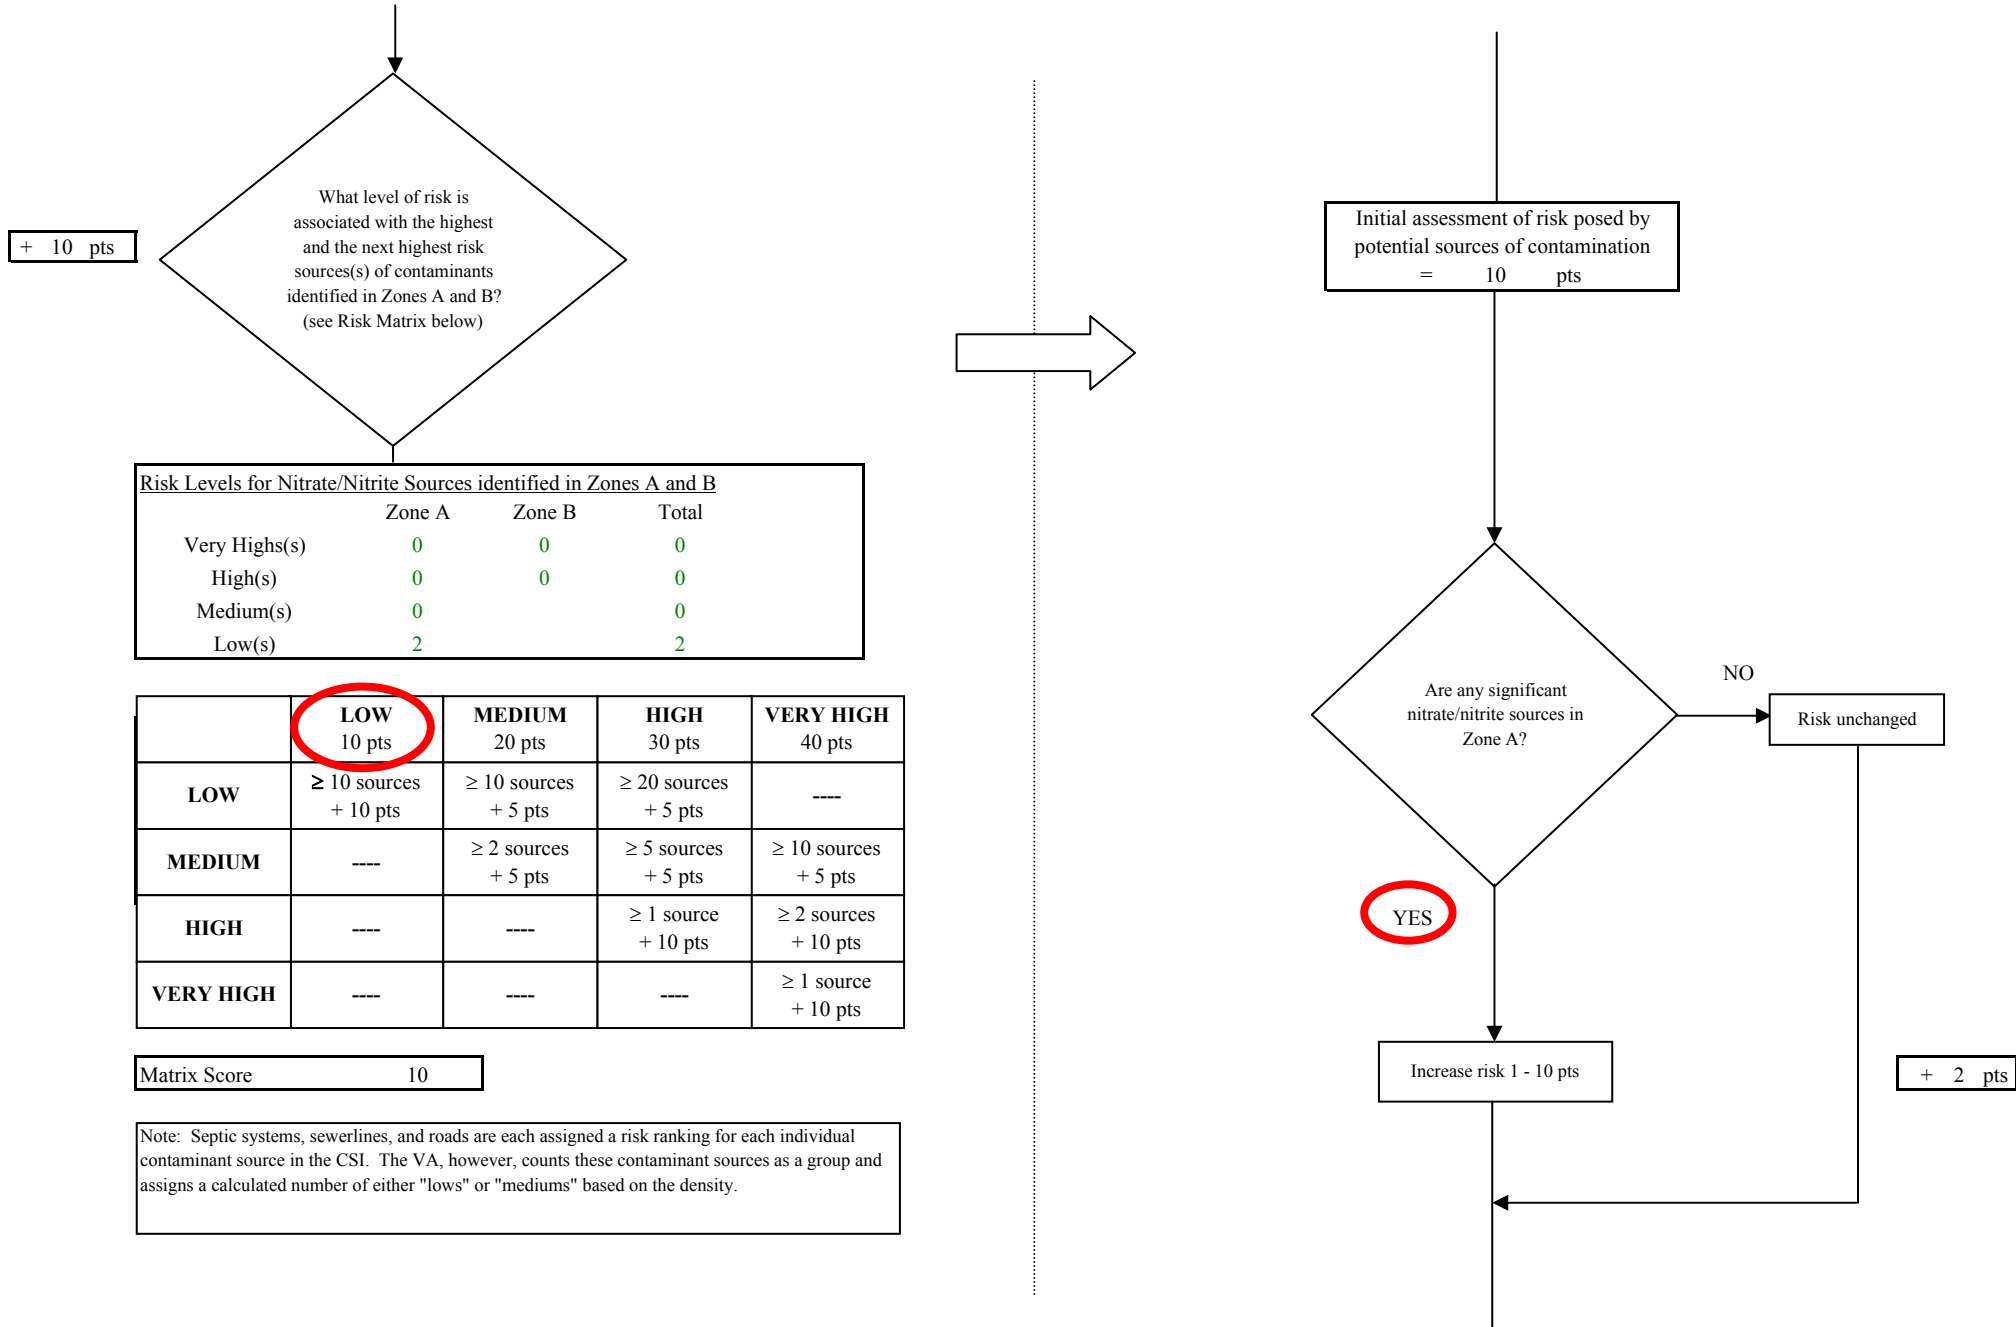


Chart 4. Contaminant risks for ConocoPhillips, Alpine Oil Field - Nitrates and Nitrites

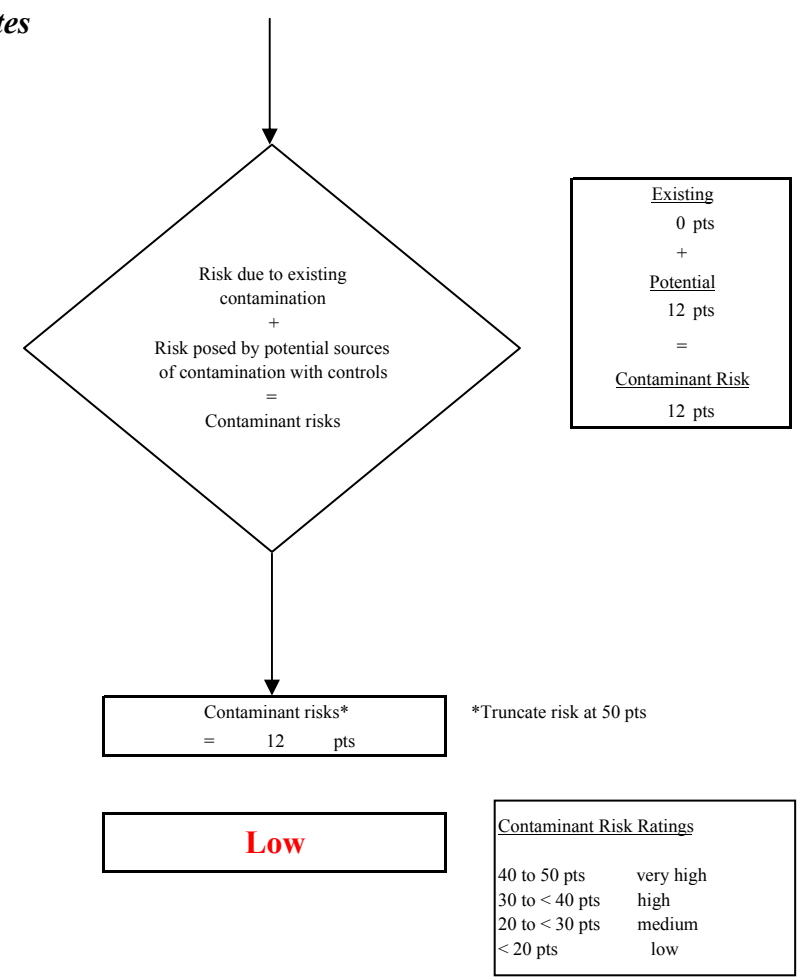

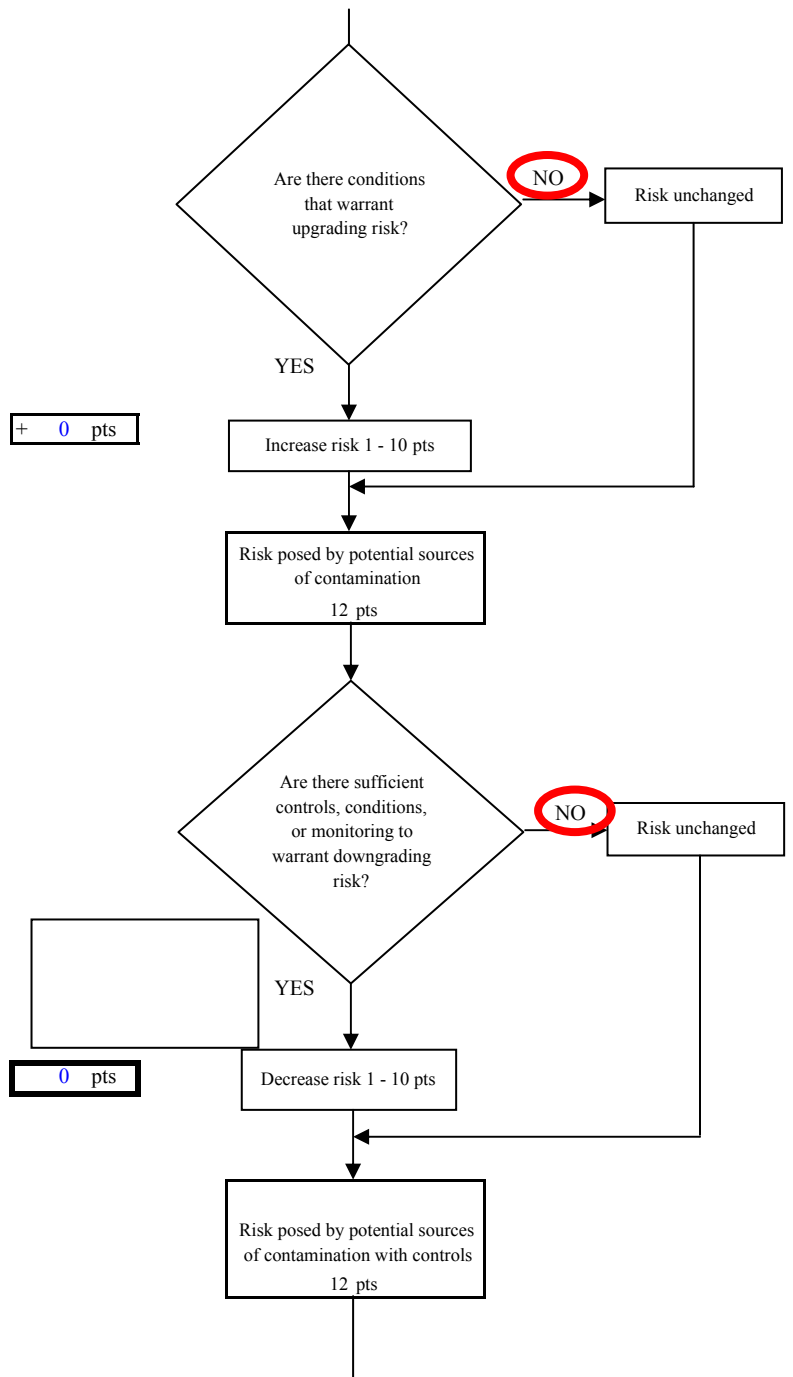


Chart 5. Vulnerability analysis for ConocoPhillips, Alpine Oil Field - Nitrates and Nitrites

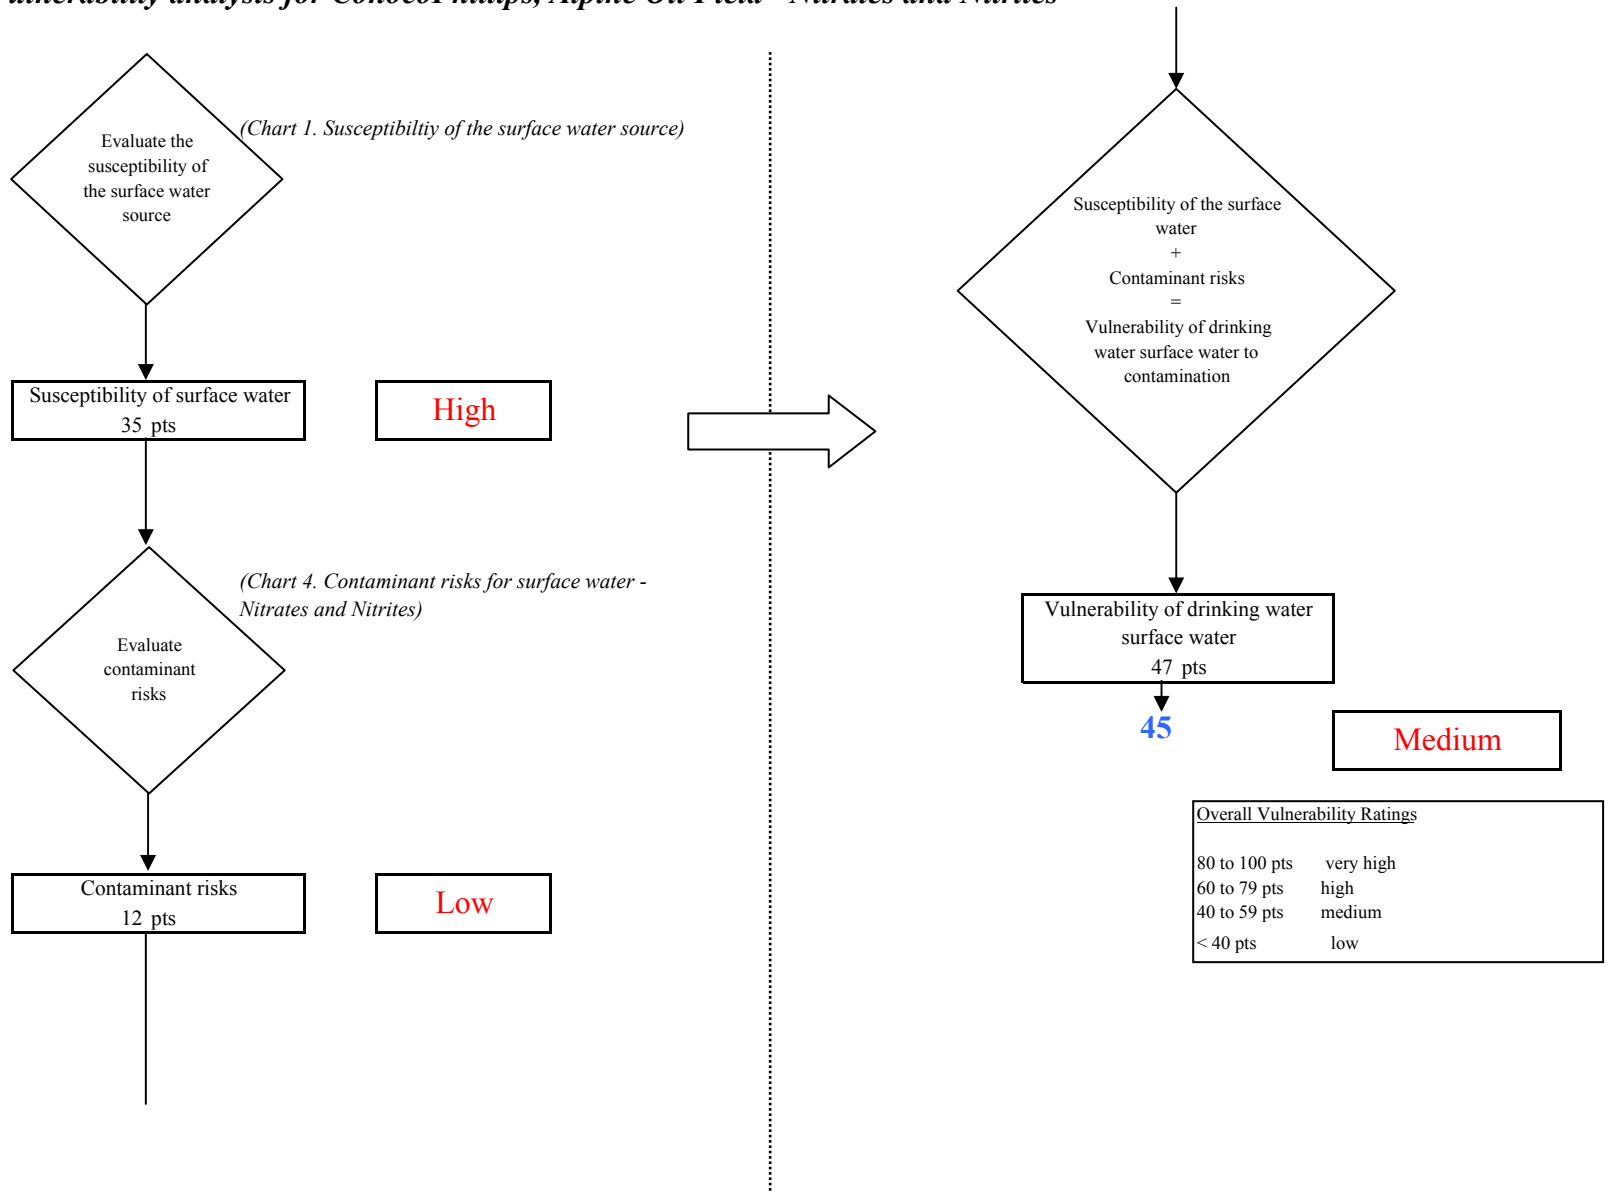


Chart 6. Contaminant risks for ConocoPhillips, Alpine Oil Field - Volatile Organic Chemicals


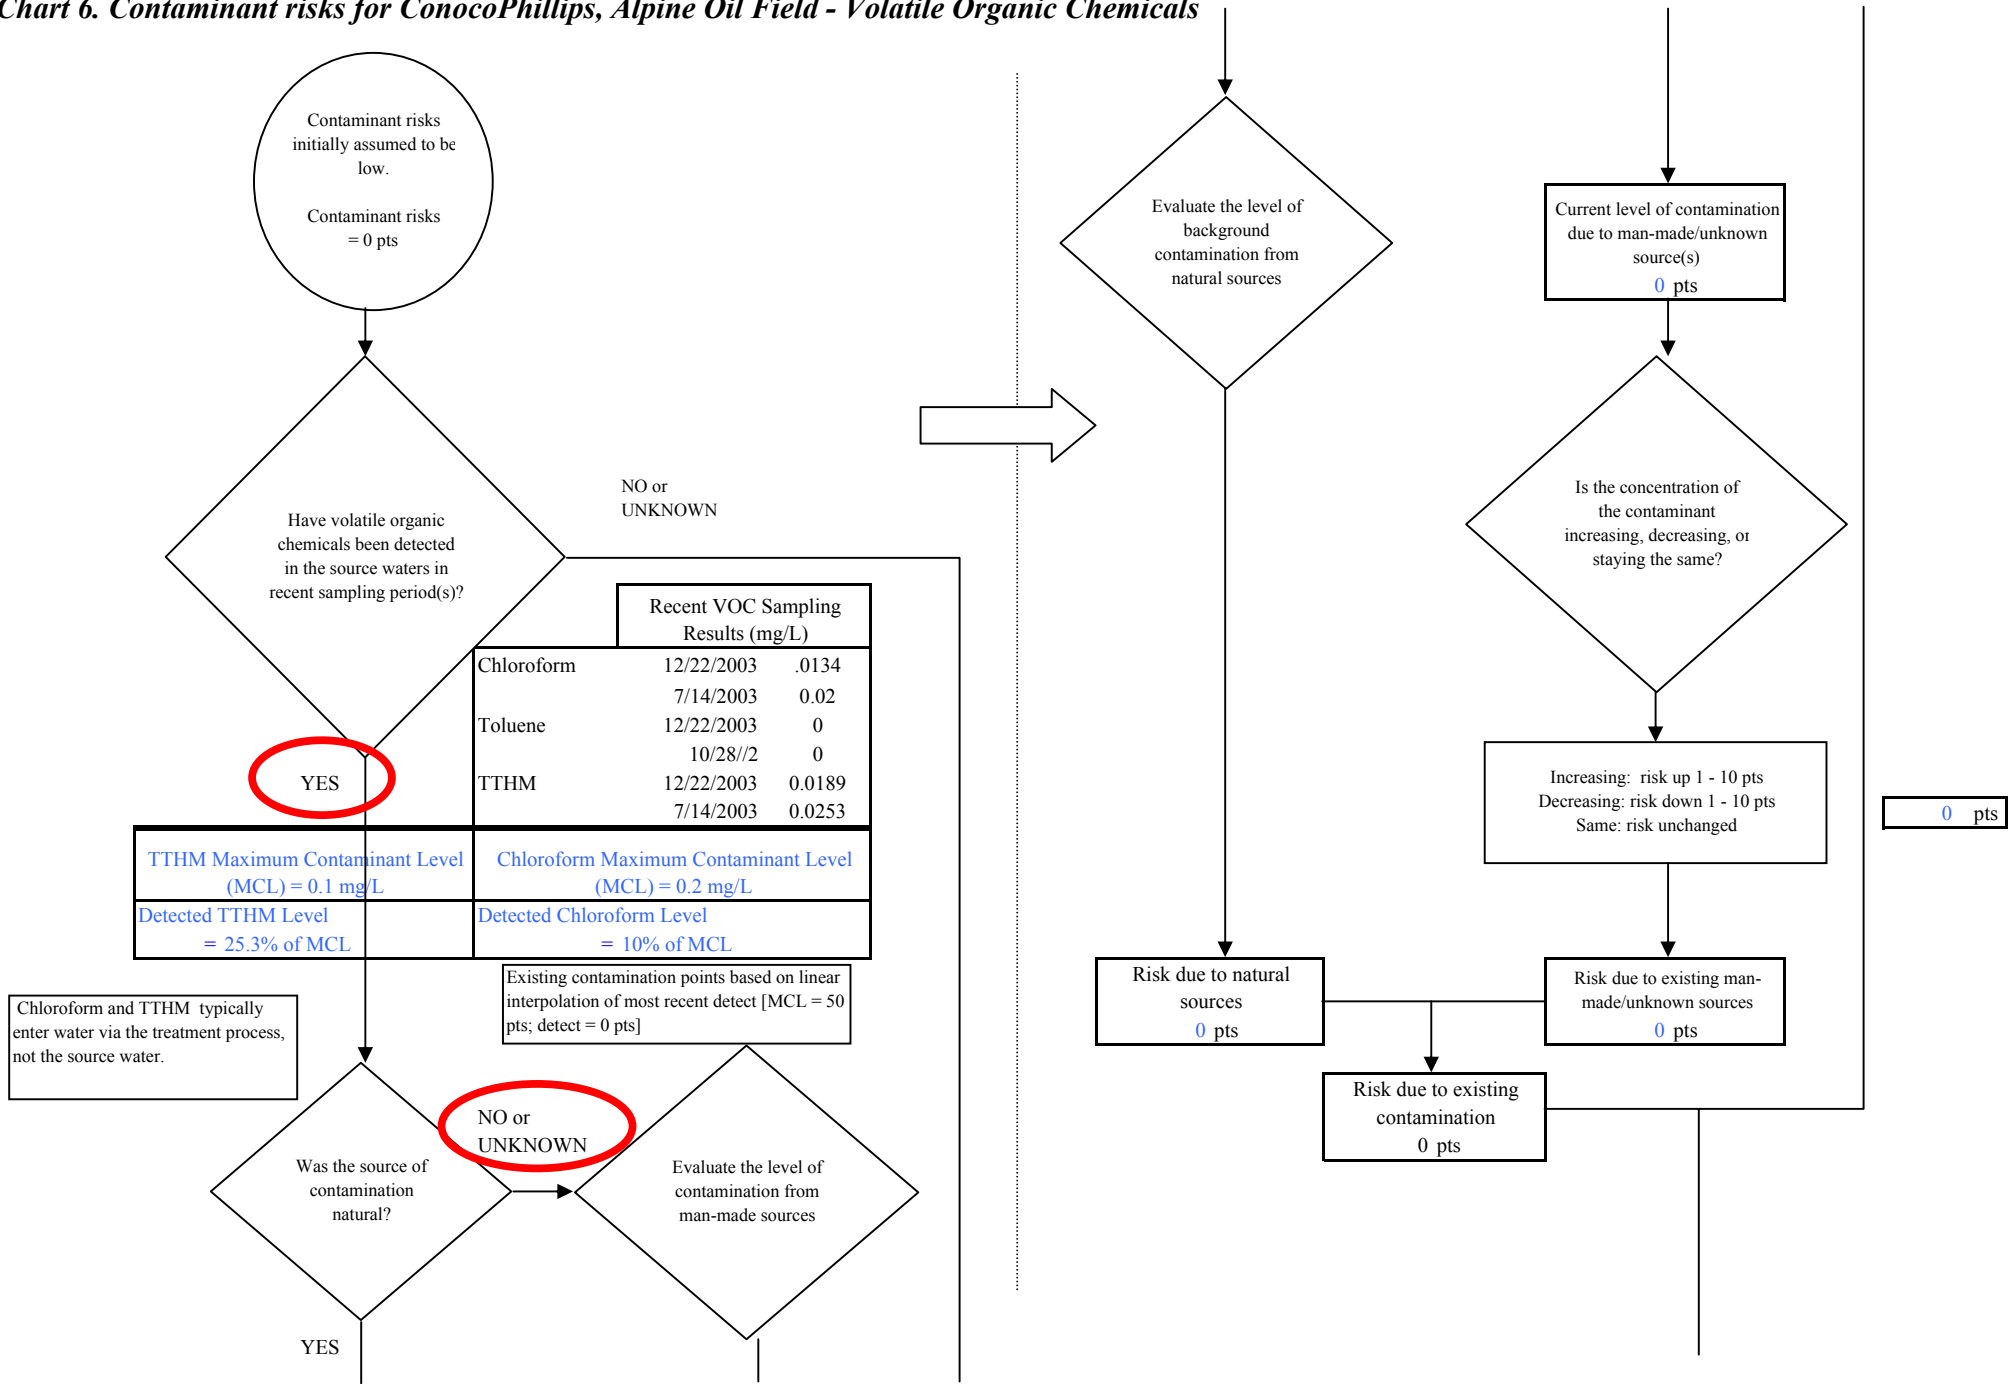


Chart 6. Contaminant risks for ConocoPhillips, Alpine Oil Field - Volatile Organic Chemicals

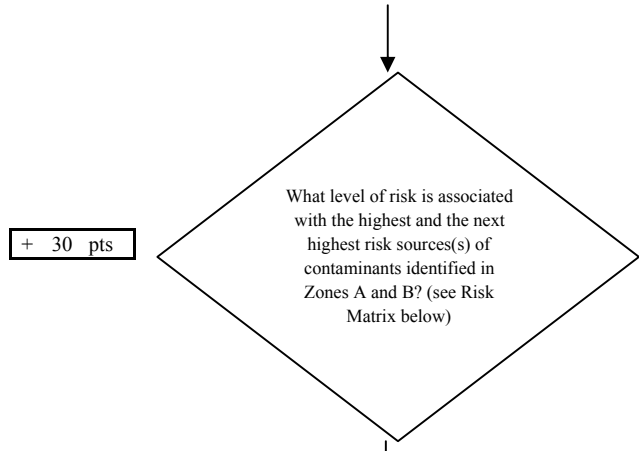

Risk Levels for VOC Sources identified in Zones A and B			
	Zone A	Zone B	Total
Very High(s)	0	0	0
High(s)	1	0	1
Medium(s)	2		2
Low(s)	2		2

	LOW 10 pts	MEDIUM 20 pts	HIGH 30 pts	VERY HIGH 40 pts
LOW	≥ 10 sources + 10 pts	≥ 10 sources + 5 pts	≥ 20 sources + 5 pts	---
MEDIUM	---	≥ 2 sources + 5 pts	≥ 5 sources + 5 pts	≥ 10 sources + 5 pts
HIGH	---	---	≥ 1 source + 10 pts	≥ 2 sources + 10 pts
VERY HIGH	---	---	---	≥ 1 source + 10 pts

Matrix Score 30

Note: Septic systems, sewerlines, and roads are each assigned a risk ranking for each individual contaminant source in the CSI. The VA, however, counts these contaminant sources as a group and assigns a calculated number of either "lows" or "mediums" based on the density.

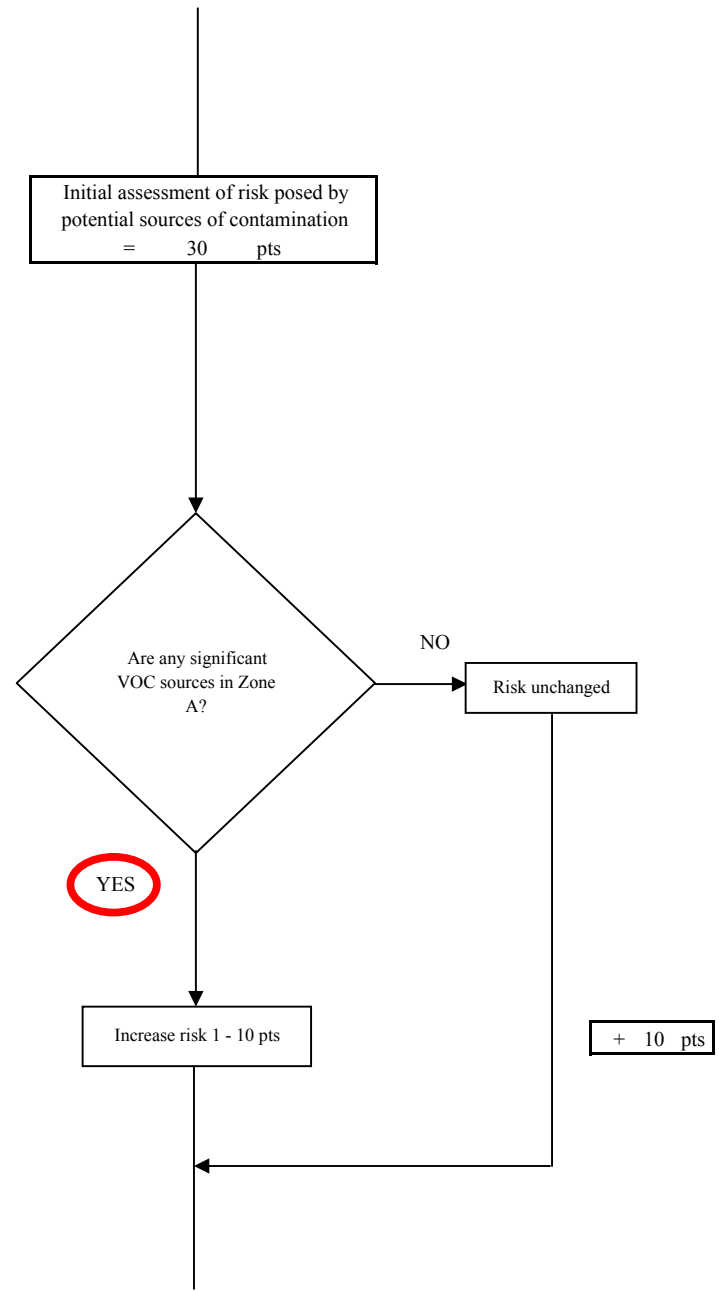



Chart 6. Contaminant risks for ConocoPhillips, Alpine Oil Field - Volatile Organic Chemicals

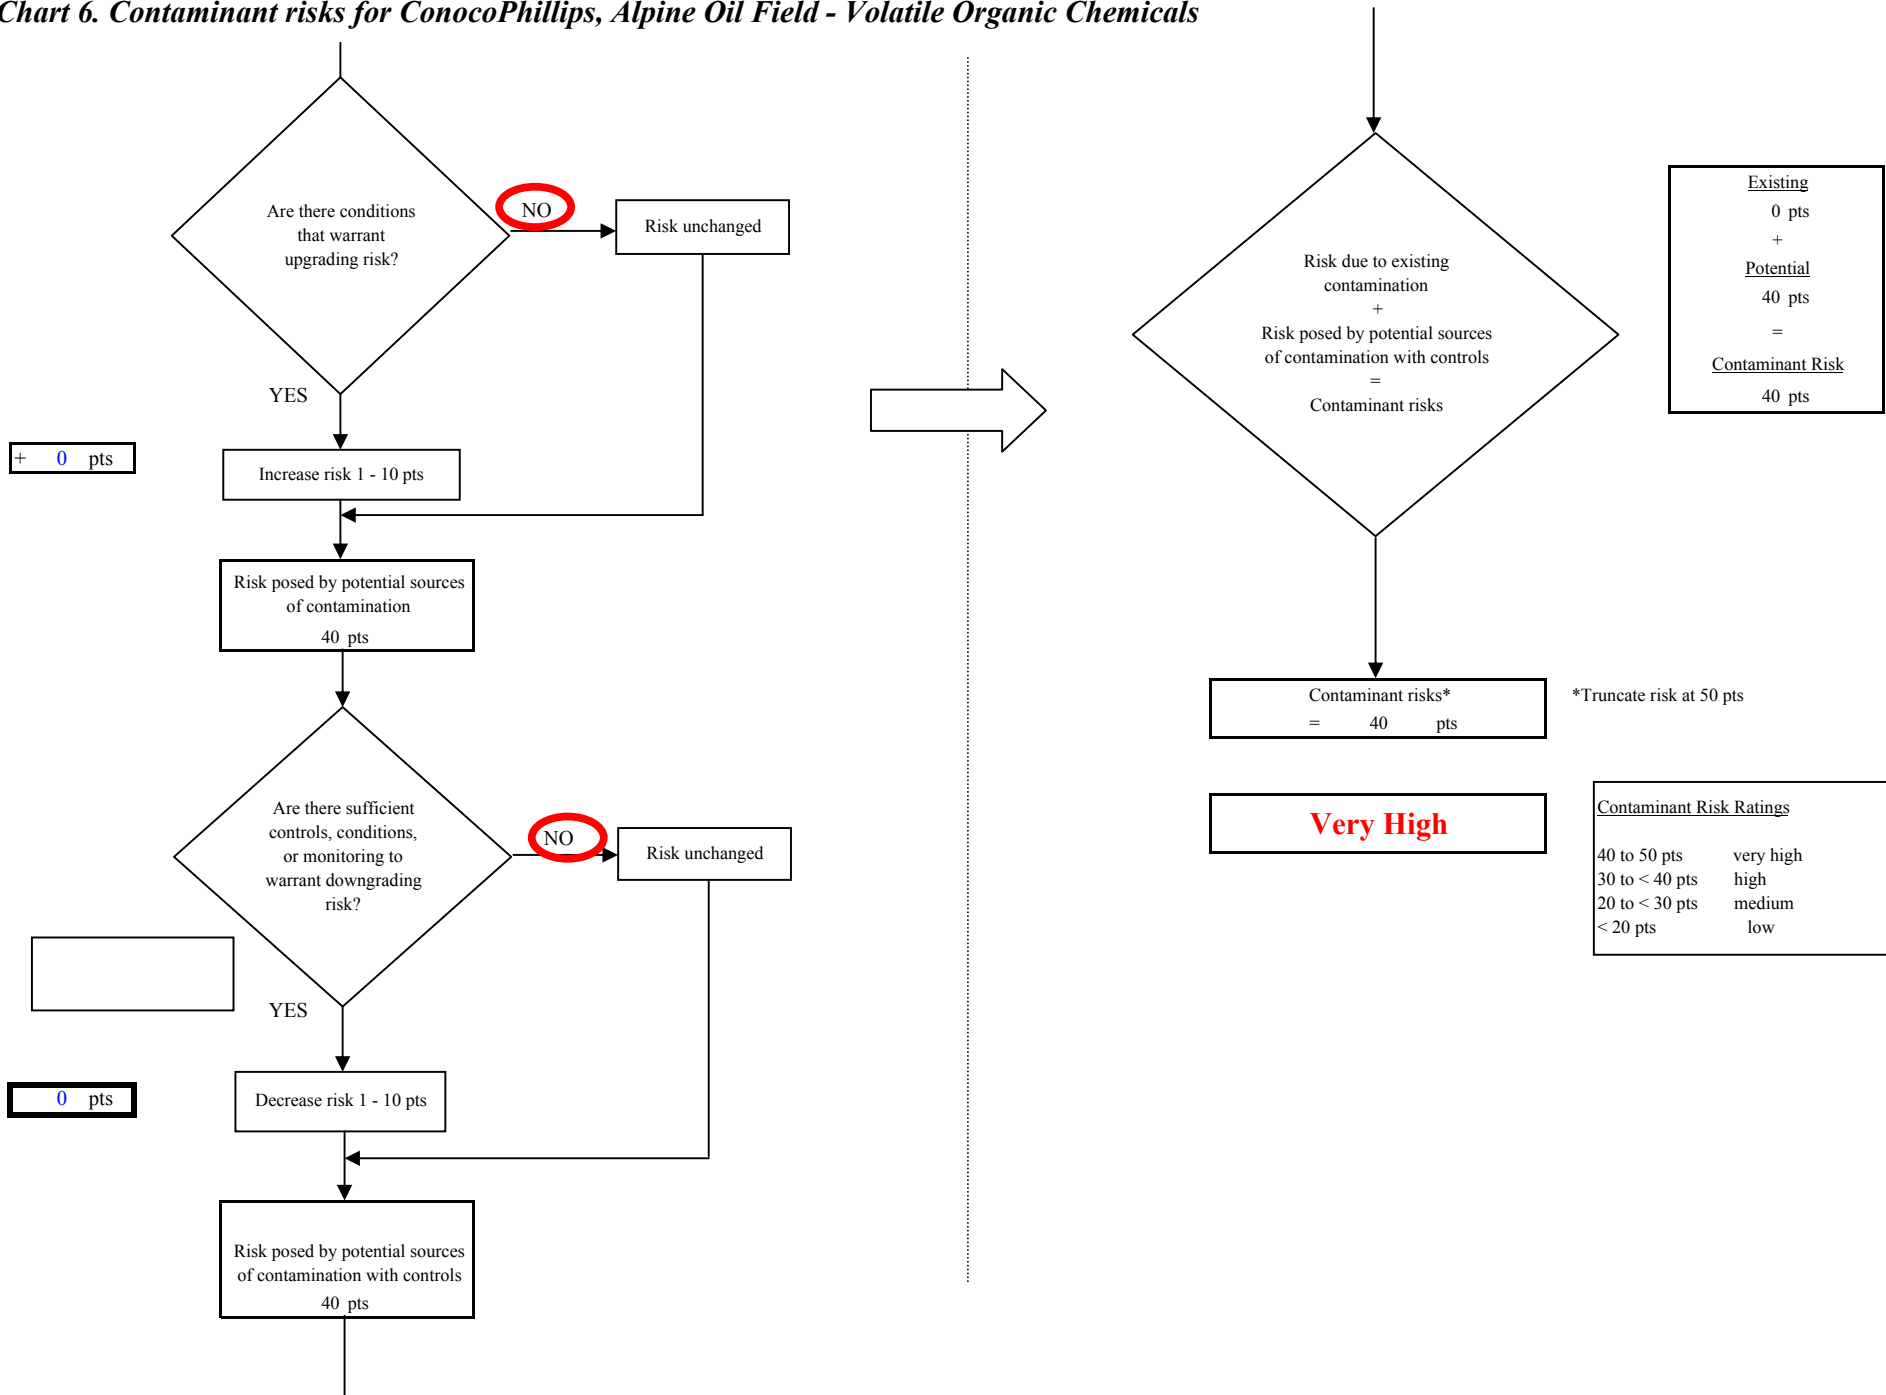


Chart 7. Vulnerability analysis for ConocoPhillips, Alpine Oil Field - Volatile Organic Chemicals

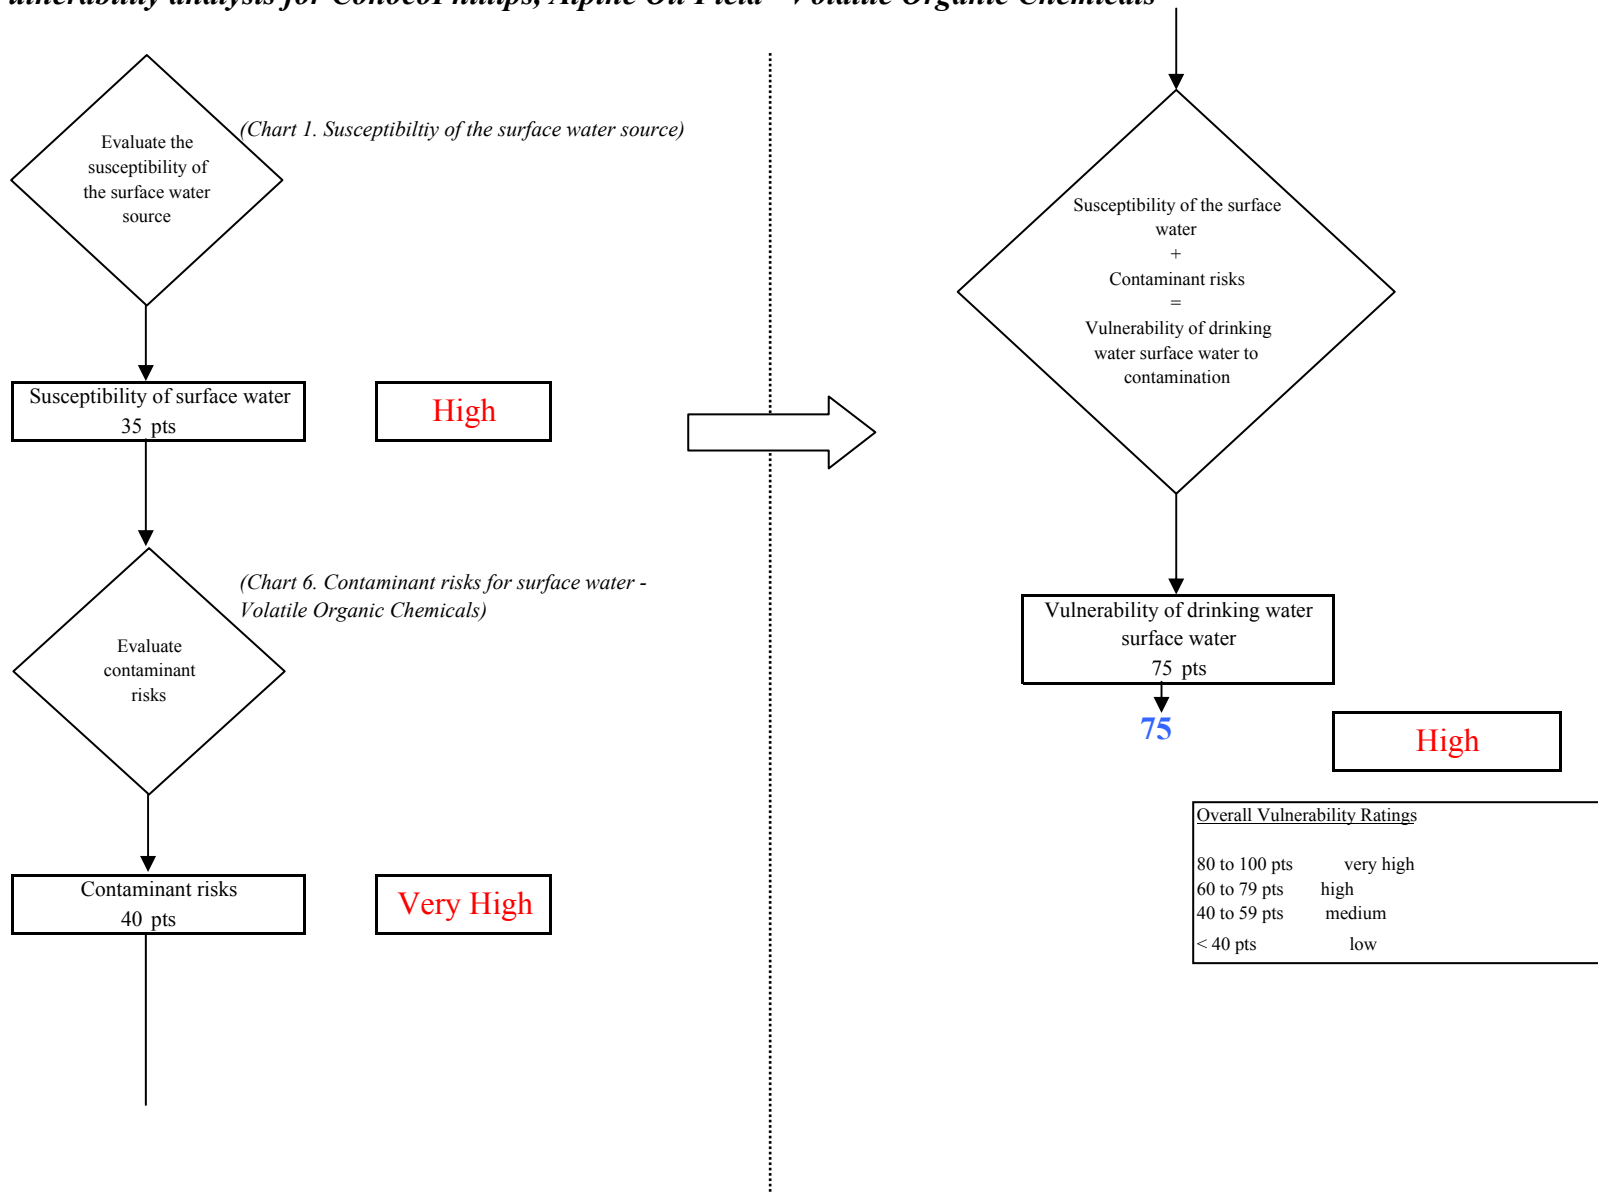


Chart 8. Contaminant risks for ConocoPhillips, Alpine Oil Field - Heavy Metals, Cyanide and Other Inorganic Chemicals


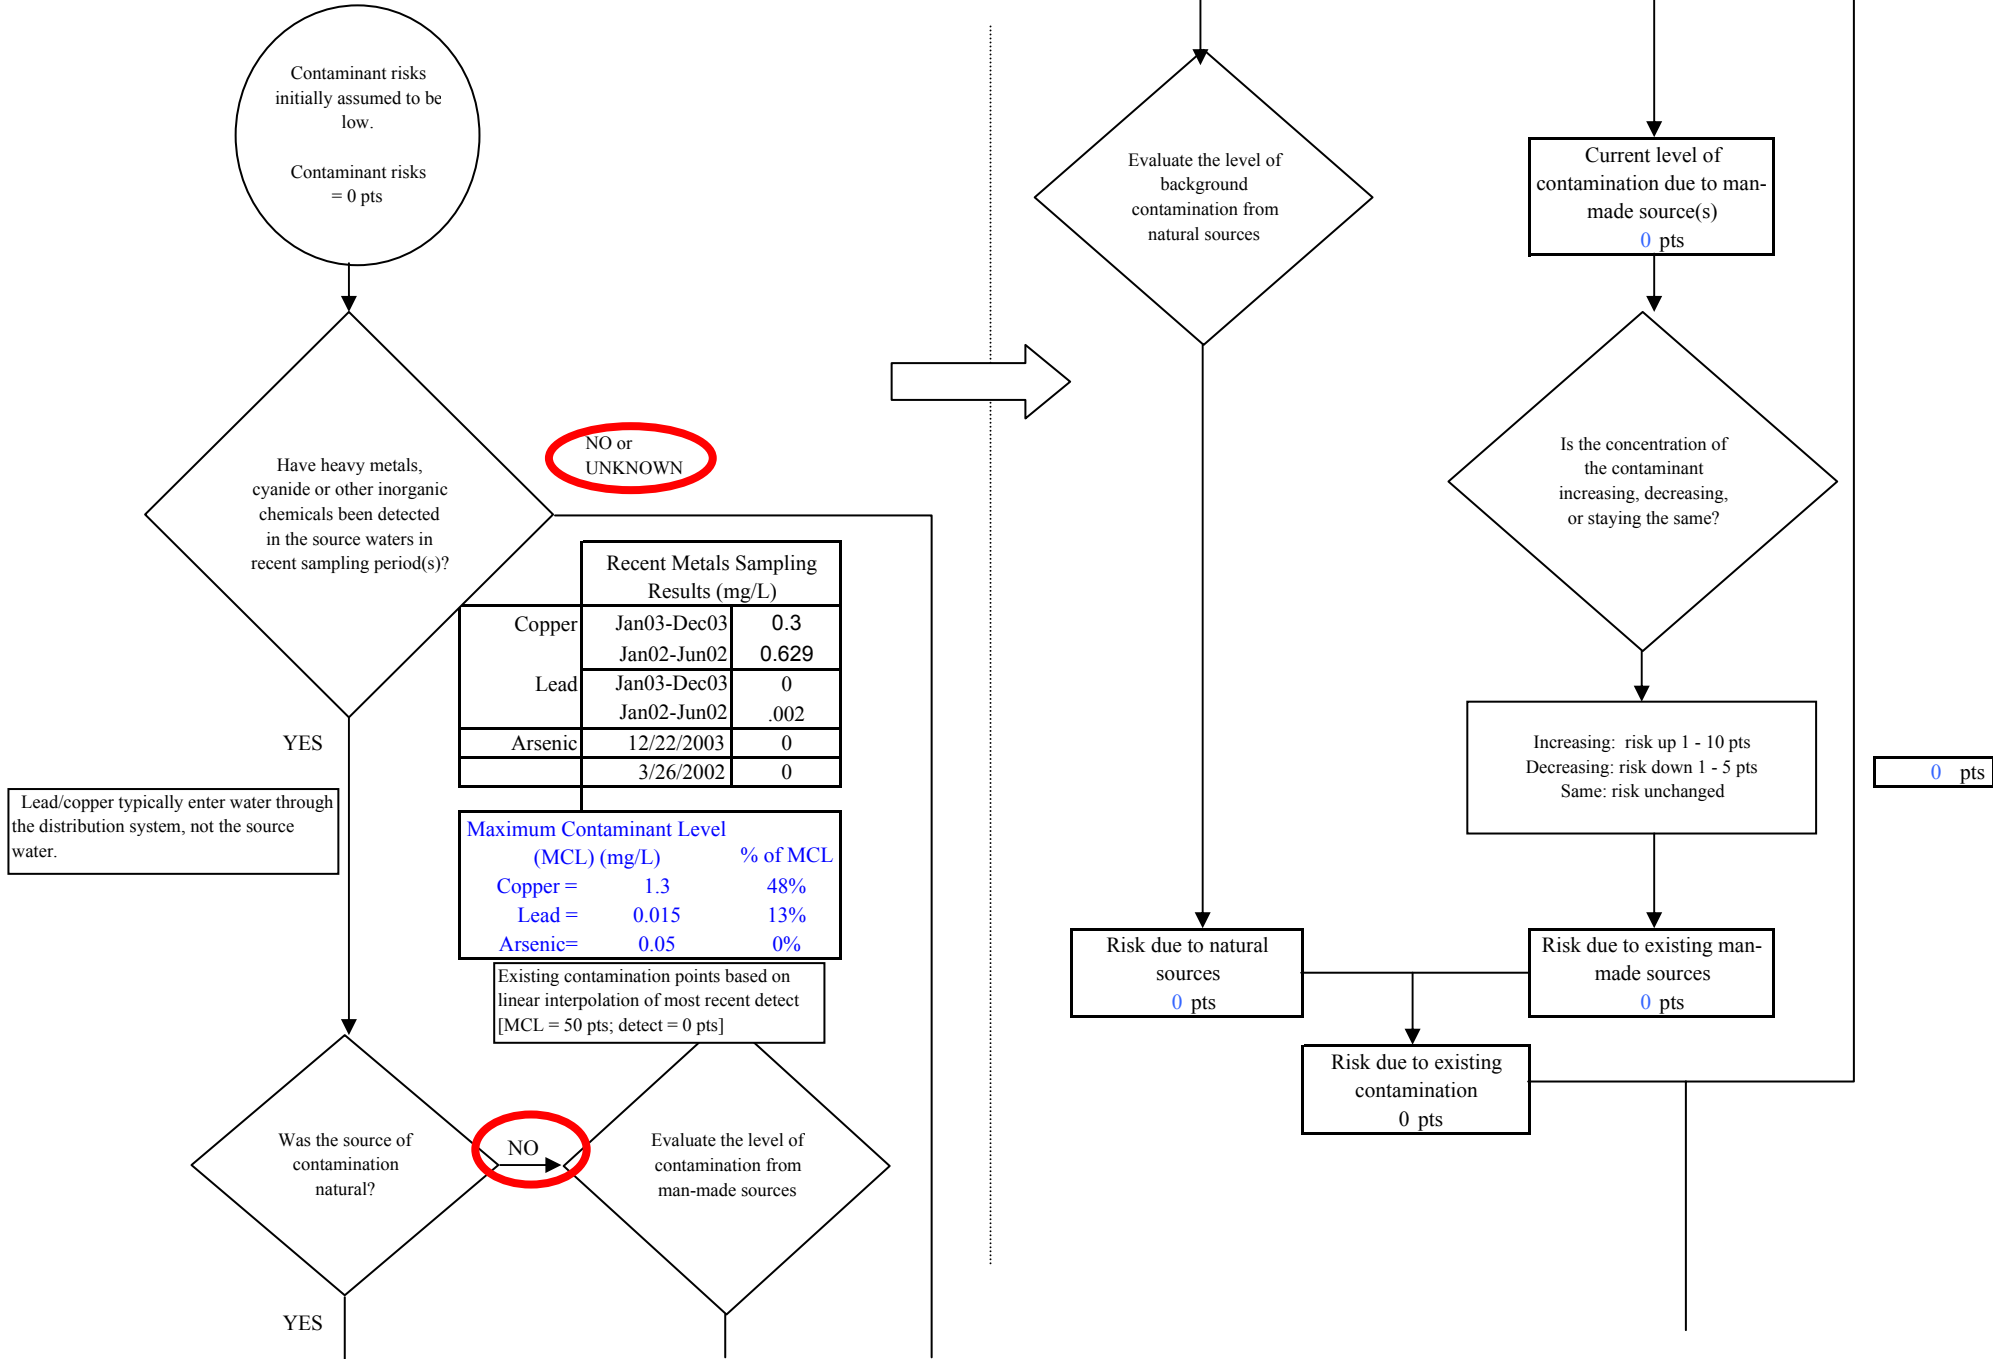


Chart 8. Contaminant risks for ConocoPhillips, Alpine Oil Field - Heavy Metals, Cyanide and Other Inorganic Chemicals

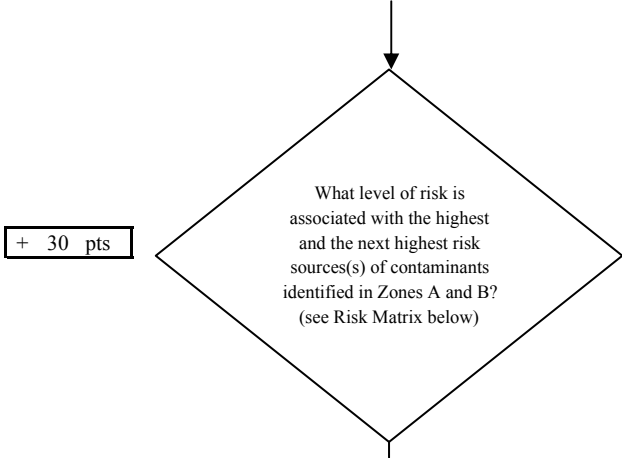

Risk Levels for HM, Cyanide, or OIC Sources identified in Zones A and B			
	Zone A	Zone B	Total
Very Highs(s)	0	0	0
High(s)	1	0	1
Medium(s)	0	0	0
Low(s)	3	0	3

	LOW 10 pts	MEDIUM 20 pts	HIGH 30 pts	VERY HIGH 40 pts
LOW	≥ 10 sources + 10 pts	≥ 10 sources 5 pts	≥ 20 sources + 5 pts	----
MEDIUM	----	≥ 2 sources + 5 pts	≥ 5 sources + 5 pts	≥ 10 sources + 5 pts
HIGH	----	----	≥ 1 source + 10 pts	≥ 2 sources + 10 pts
VERY HIGH	----	----	----	≥ 1 source + 10 pts

Matrix Score 30

Note: Septic systems, sewerlines, and roads are each assigned a risk ranking for each individual contaminant source in the CSI. The VA, however, counts these contaminant sources as a group and assigns a calculated number of either "lows" or "mediums" based on the density.

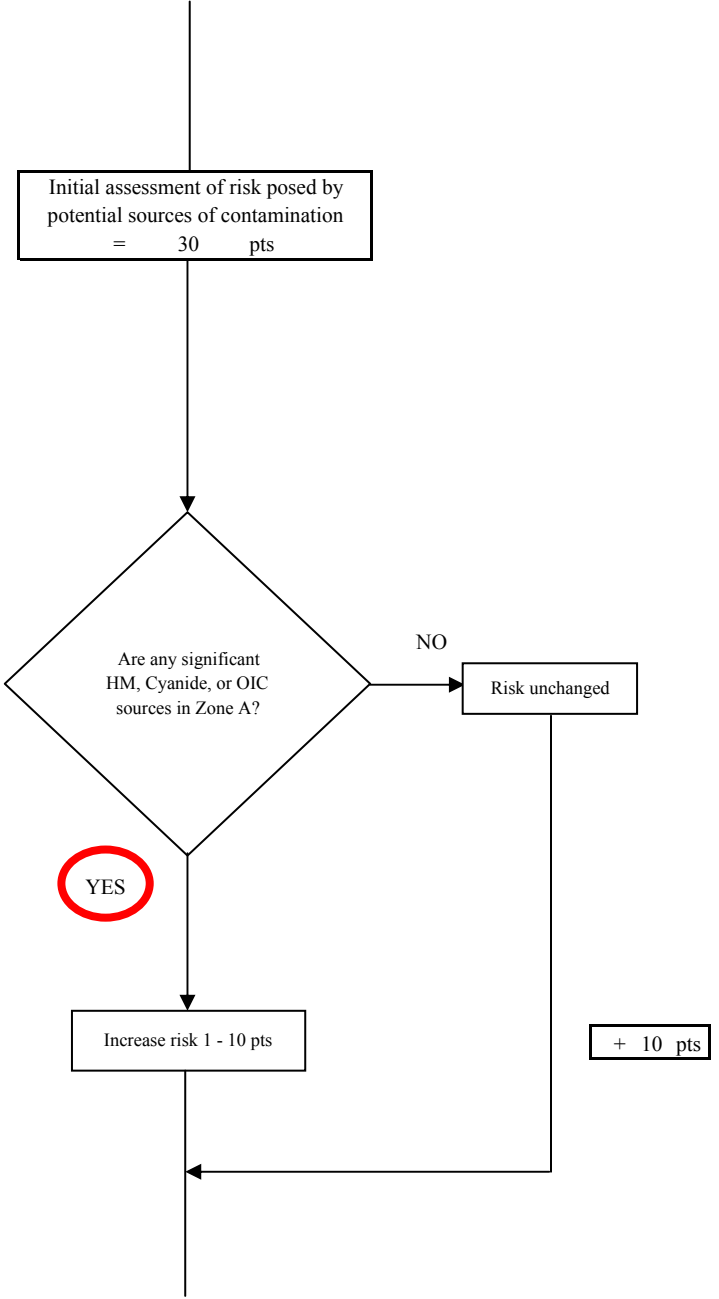



Chart 8. Contaminant risks for ConocoPhillips, Alpine Oil Field - Heavy Metals, Cyanide and Other Inorganic Chemicals

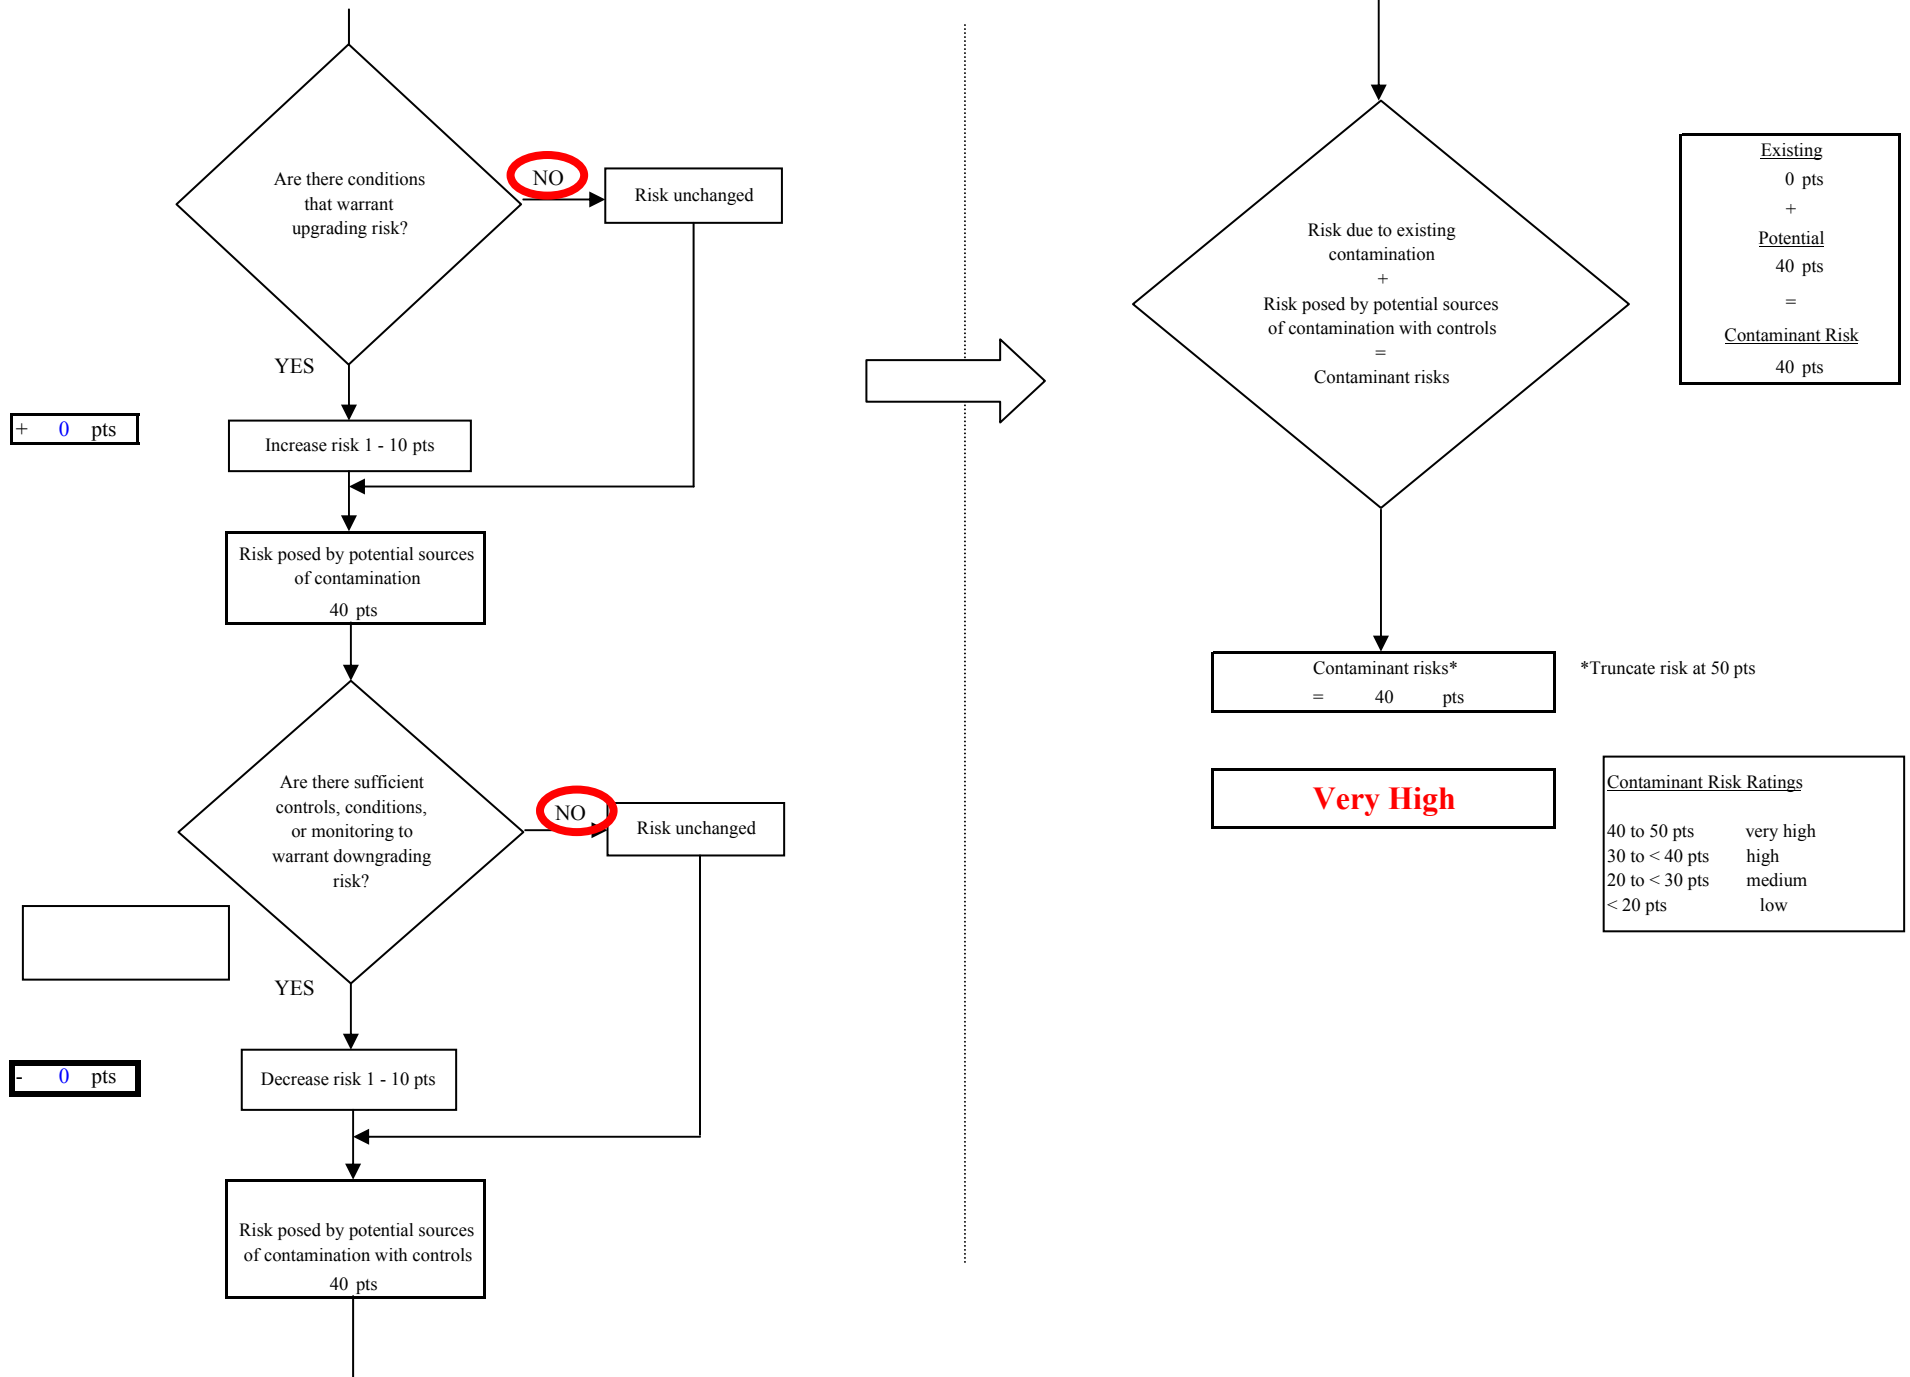


Chart 9. Vulnerability analysis for ConocoPhillips, Alpine Oil Field - Heavy Metals, Cyanide and Other Inorganic Chemicals

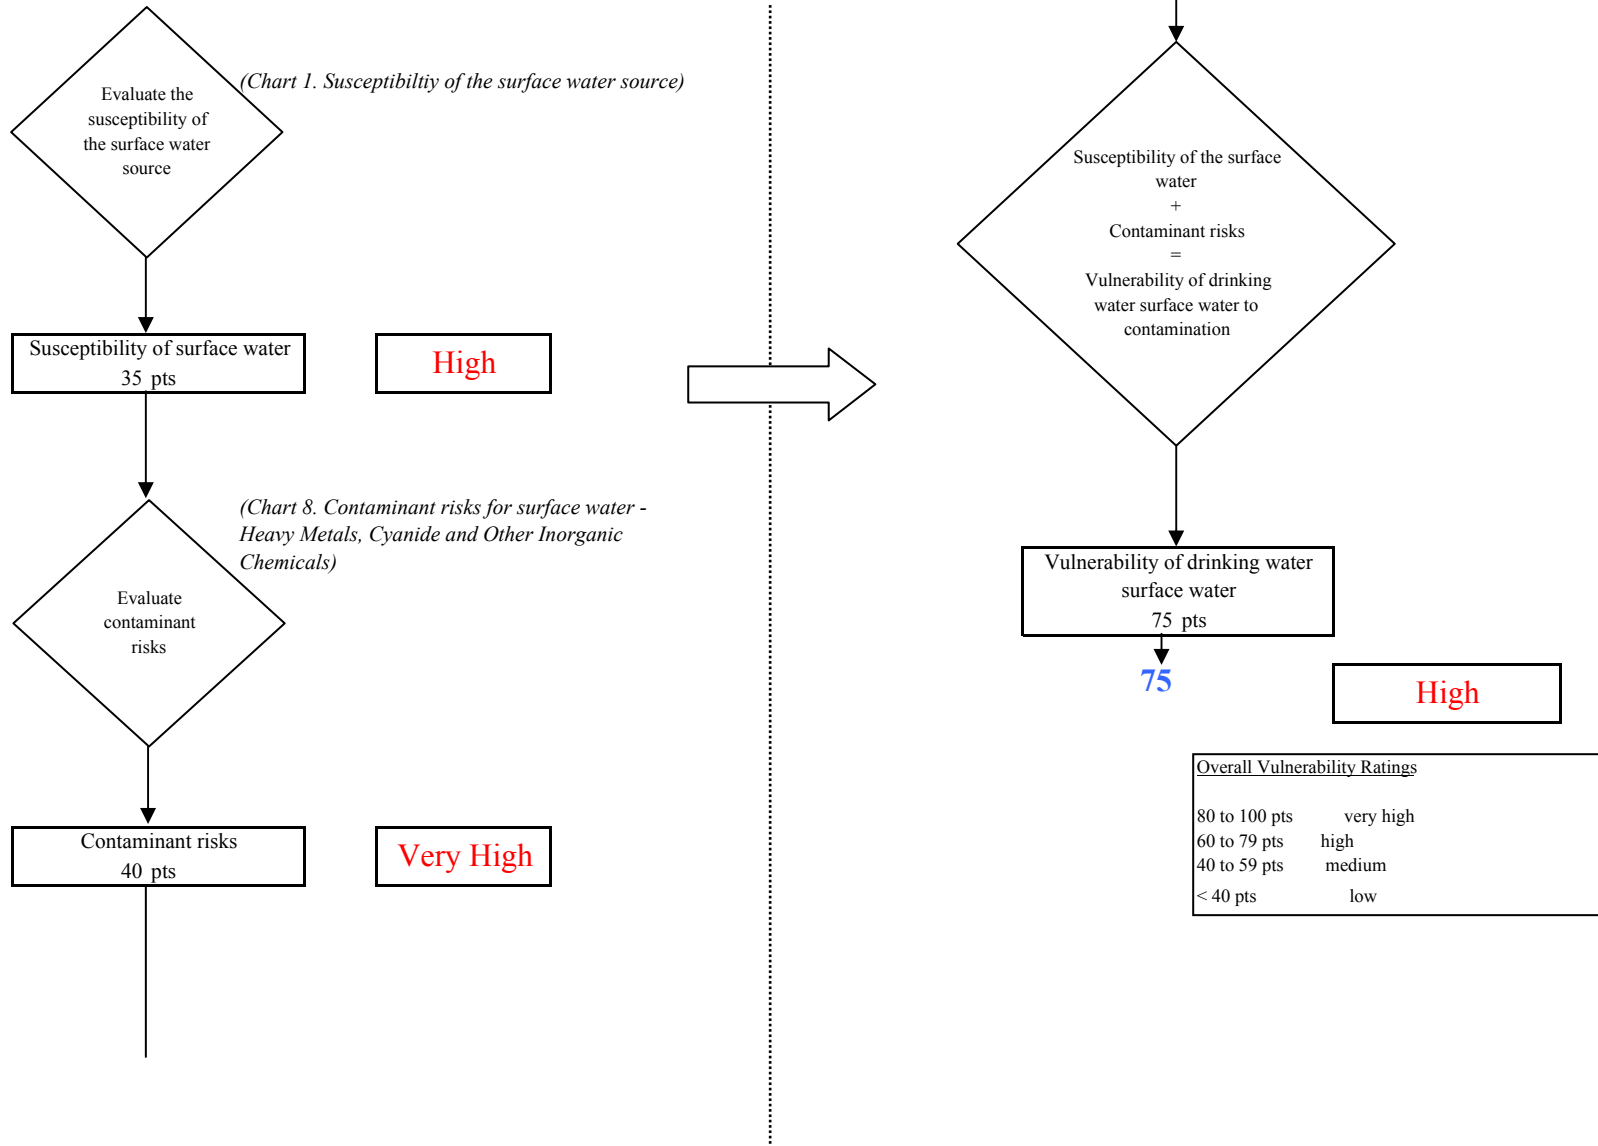


Chart 10. Contaminant risks for ConocoPhillips, Alpine Oil Field - Synthetic Organic Chemicals

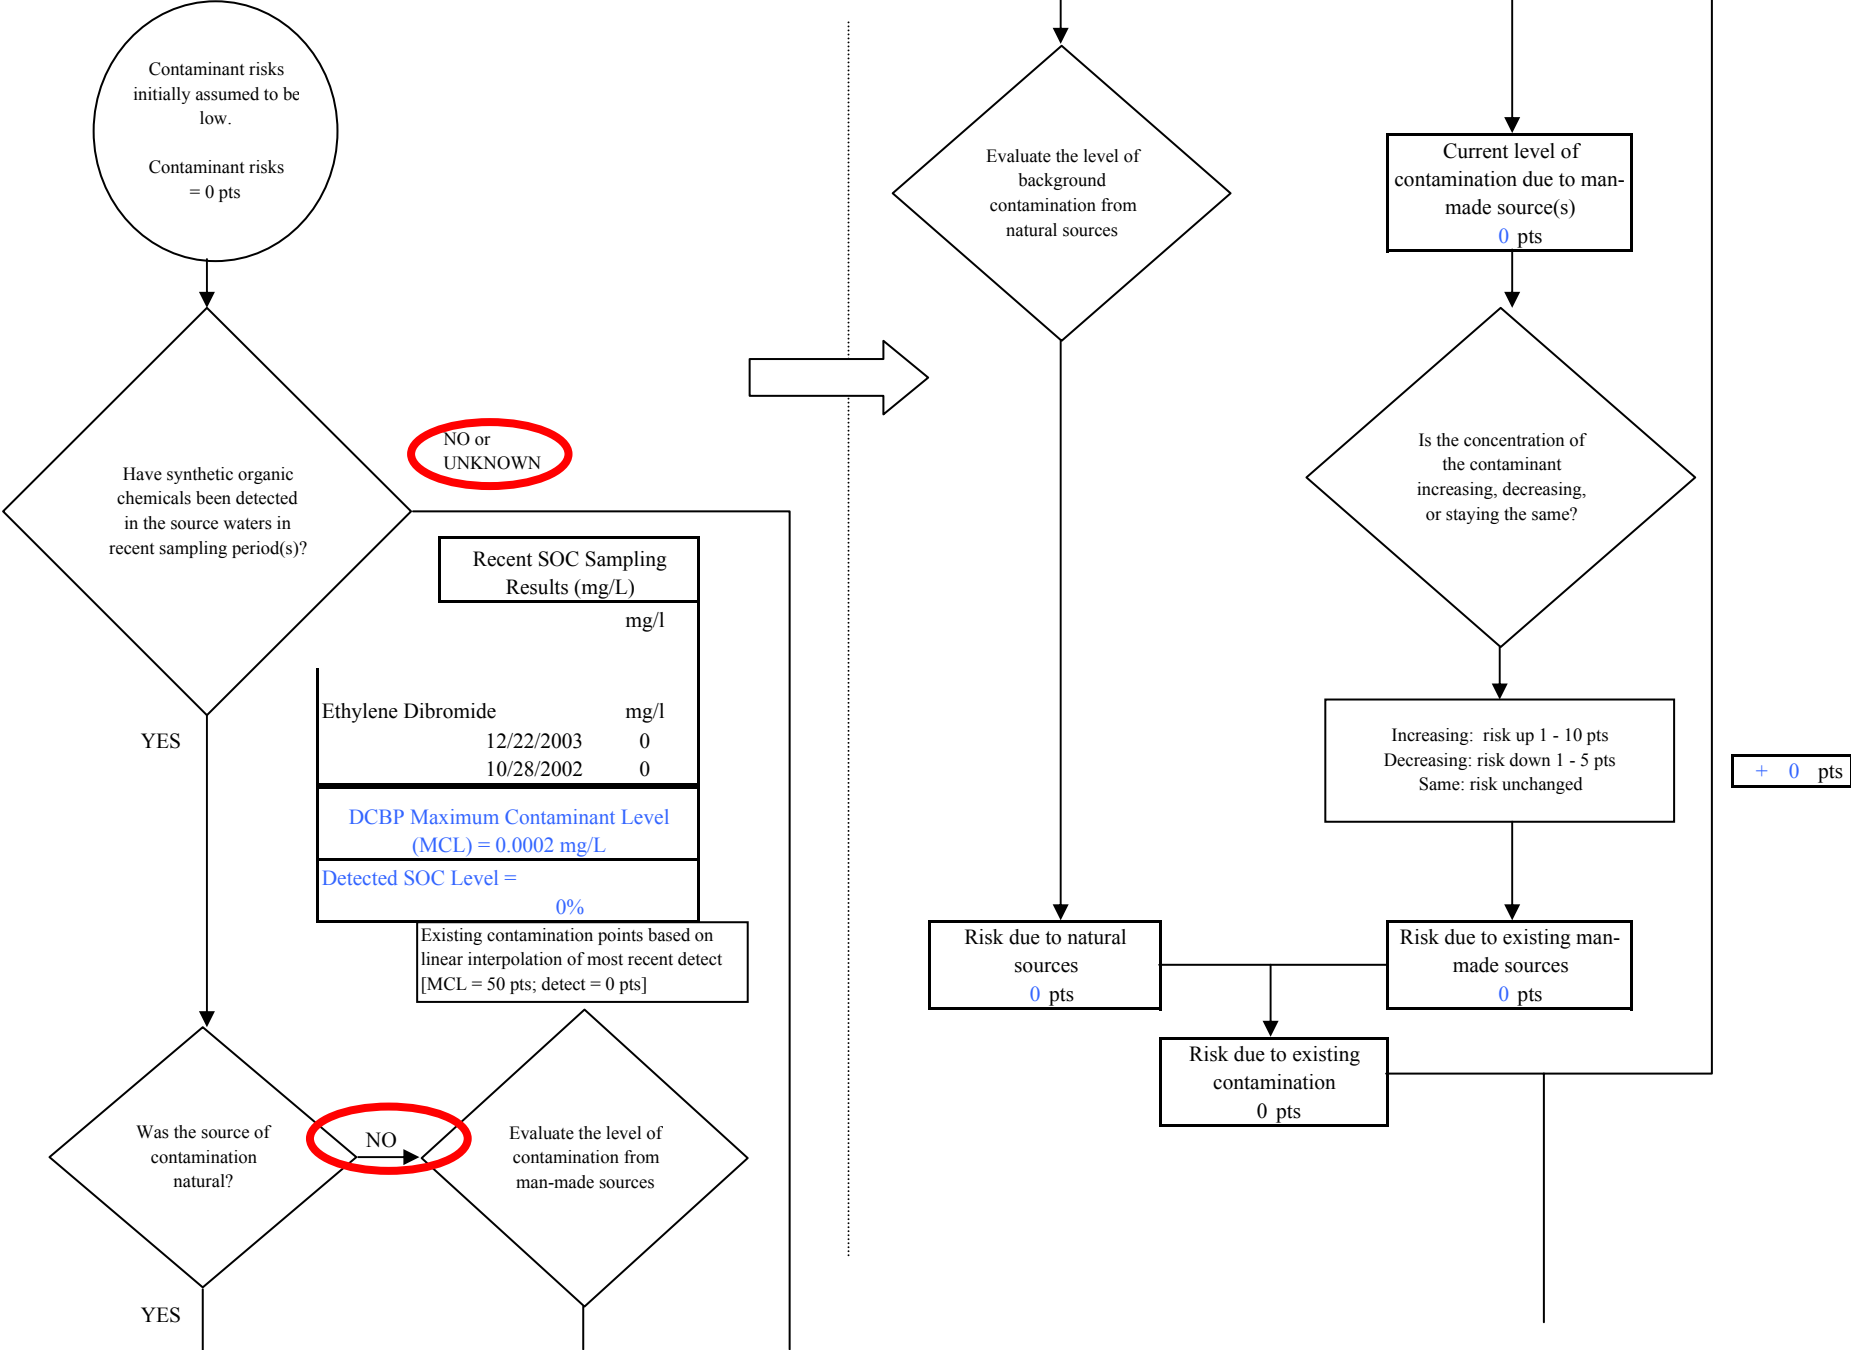


Chart 10. Contaminant risks for ConocoPhillips, Alpine Oil Field - Synthetic Organic Chemicals

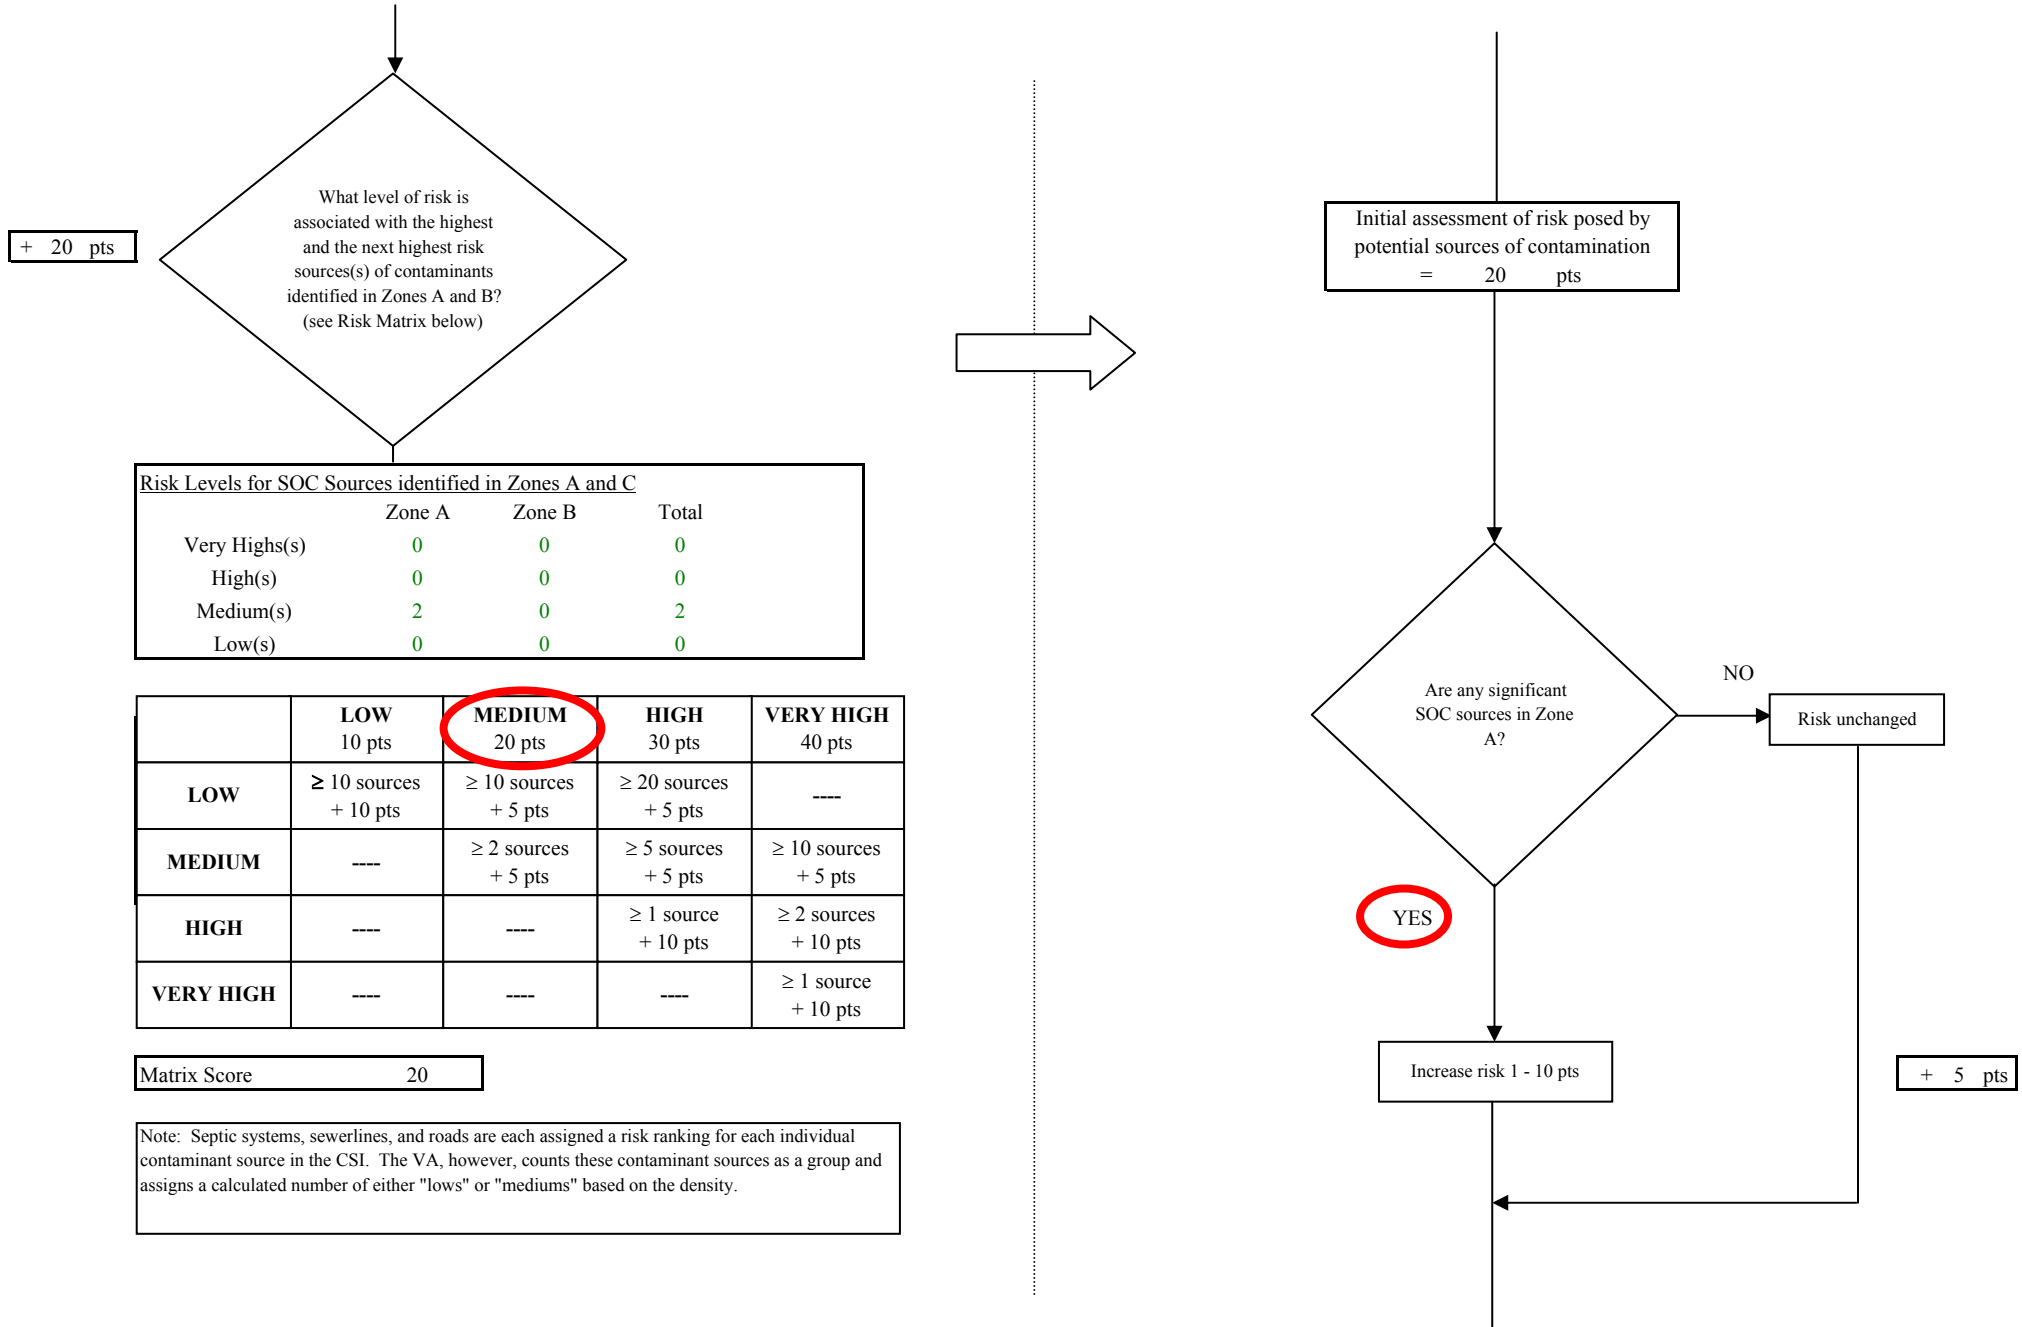


Chart 10. Contaminant risks for ConocoPhillips, Alpine Oil Field - Synthetic Organic Chemicals

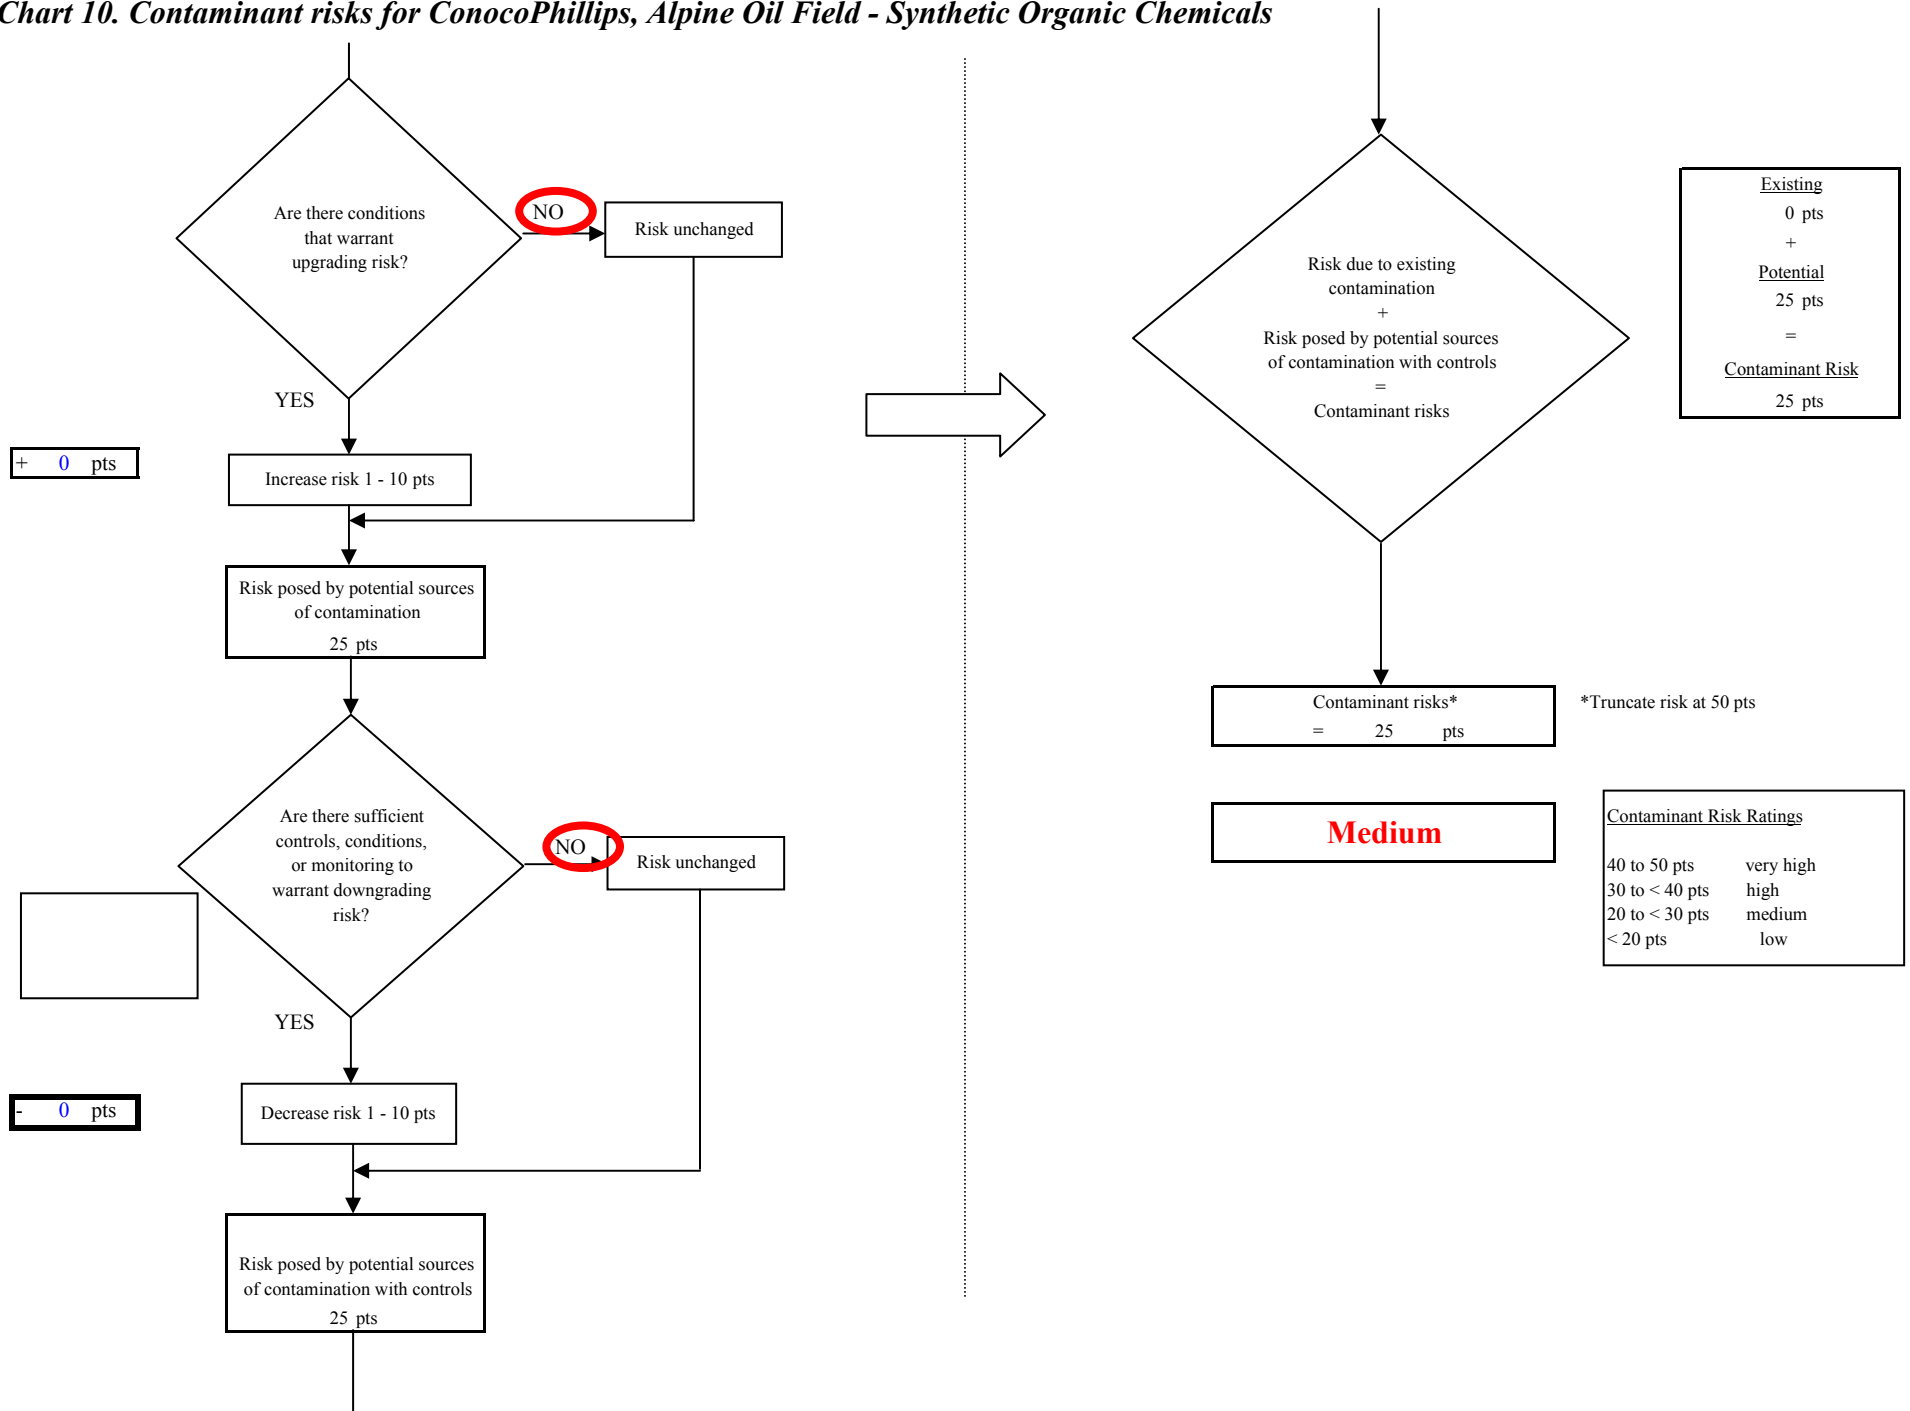


Chart 11. Vulnerability analysis for ConocoPhillips, Alpine Oil Field - Synthetic Organic Chemicals

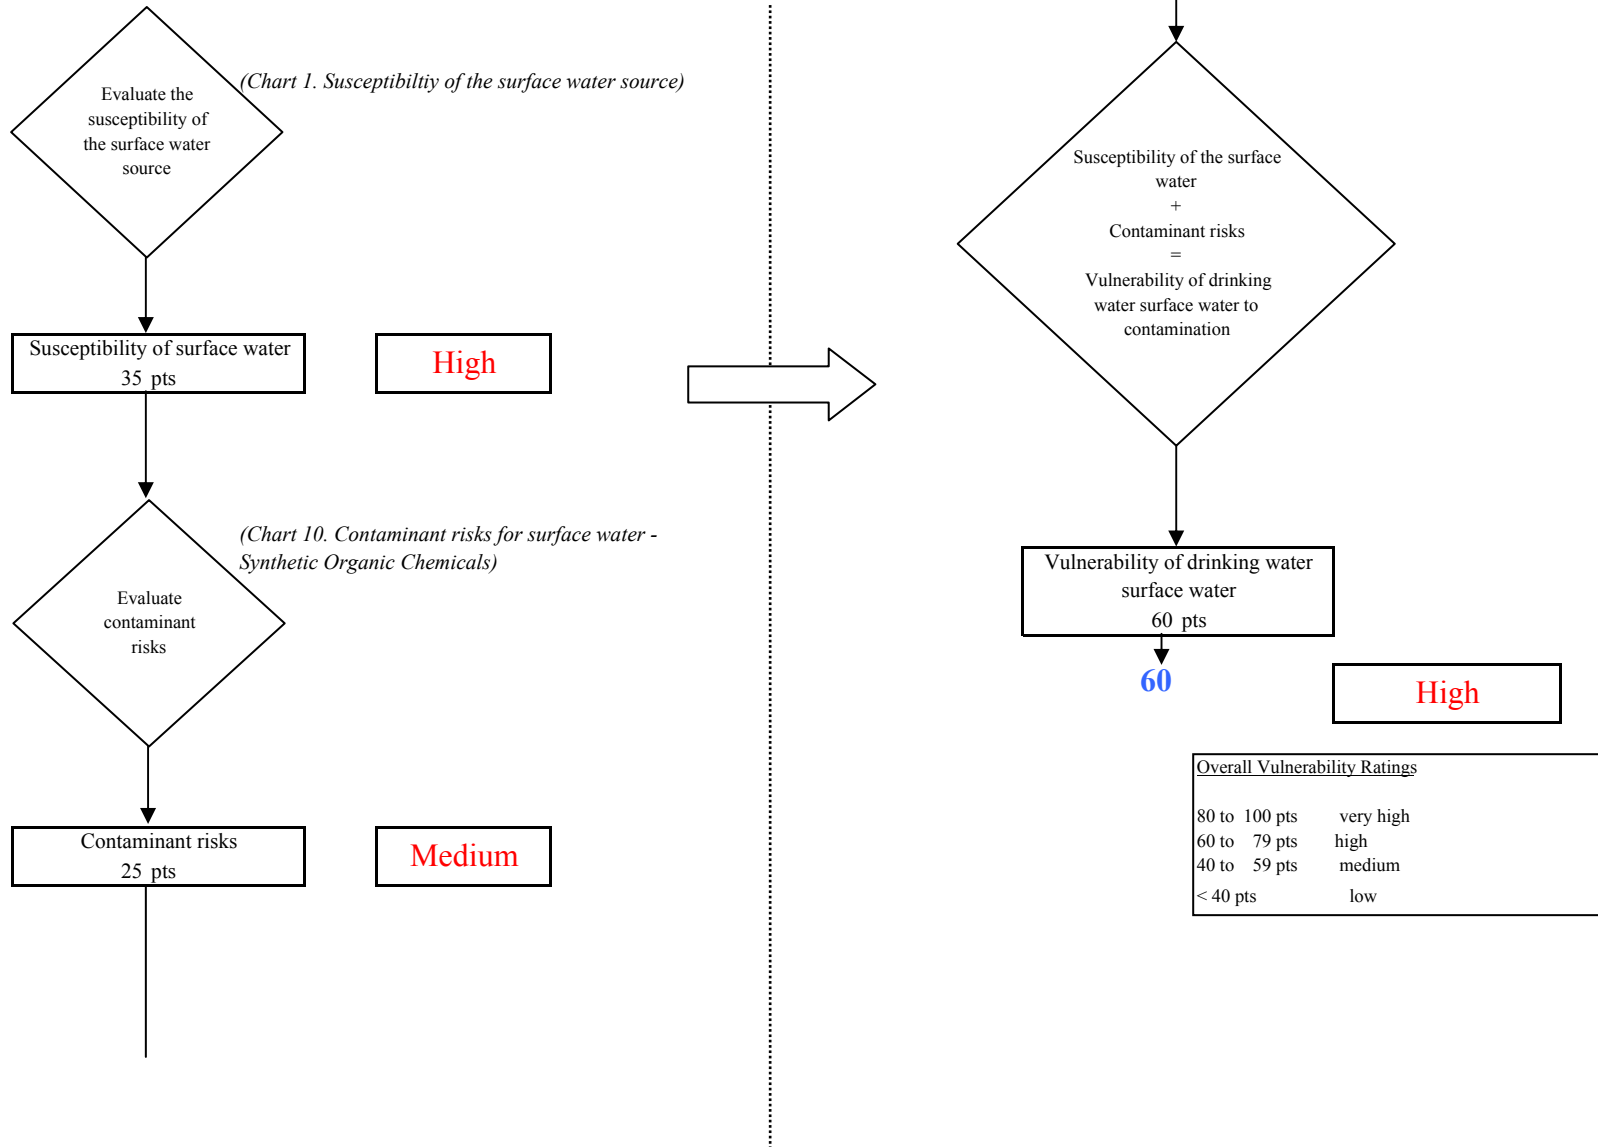


Chart 12. Contaminant risks for ConocoPhillips, Alpine Oil Field - Other Organic Chemicals

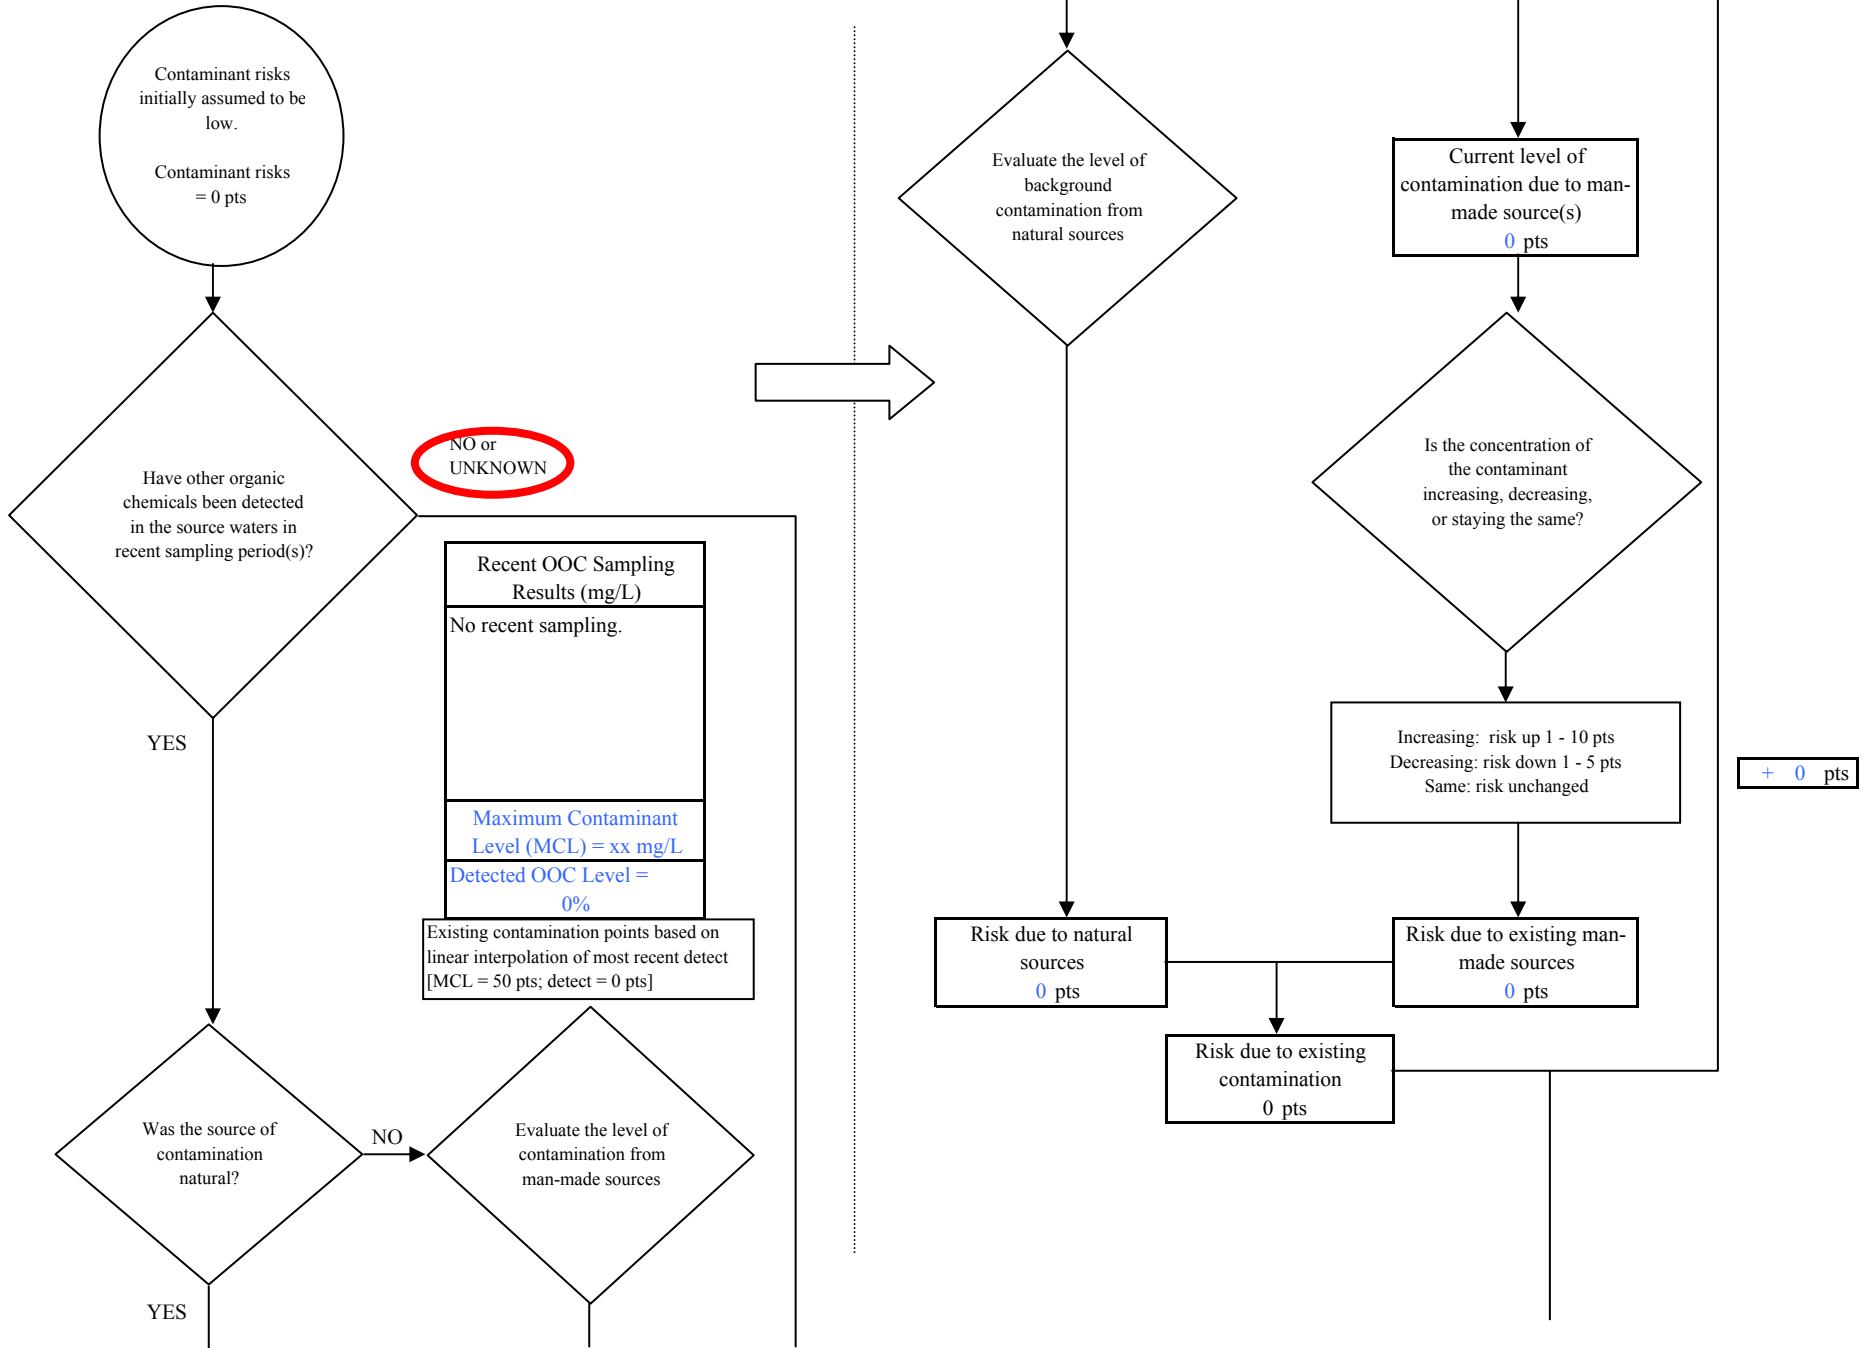


Chart 12. Contaminant risks for ConocoPhillips, Alpine Oil Field - Other Organic Chemicals

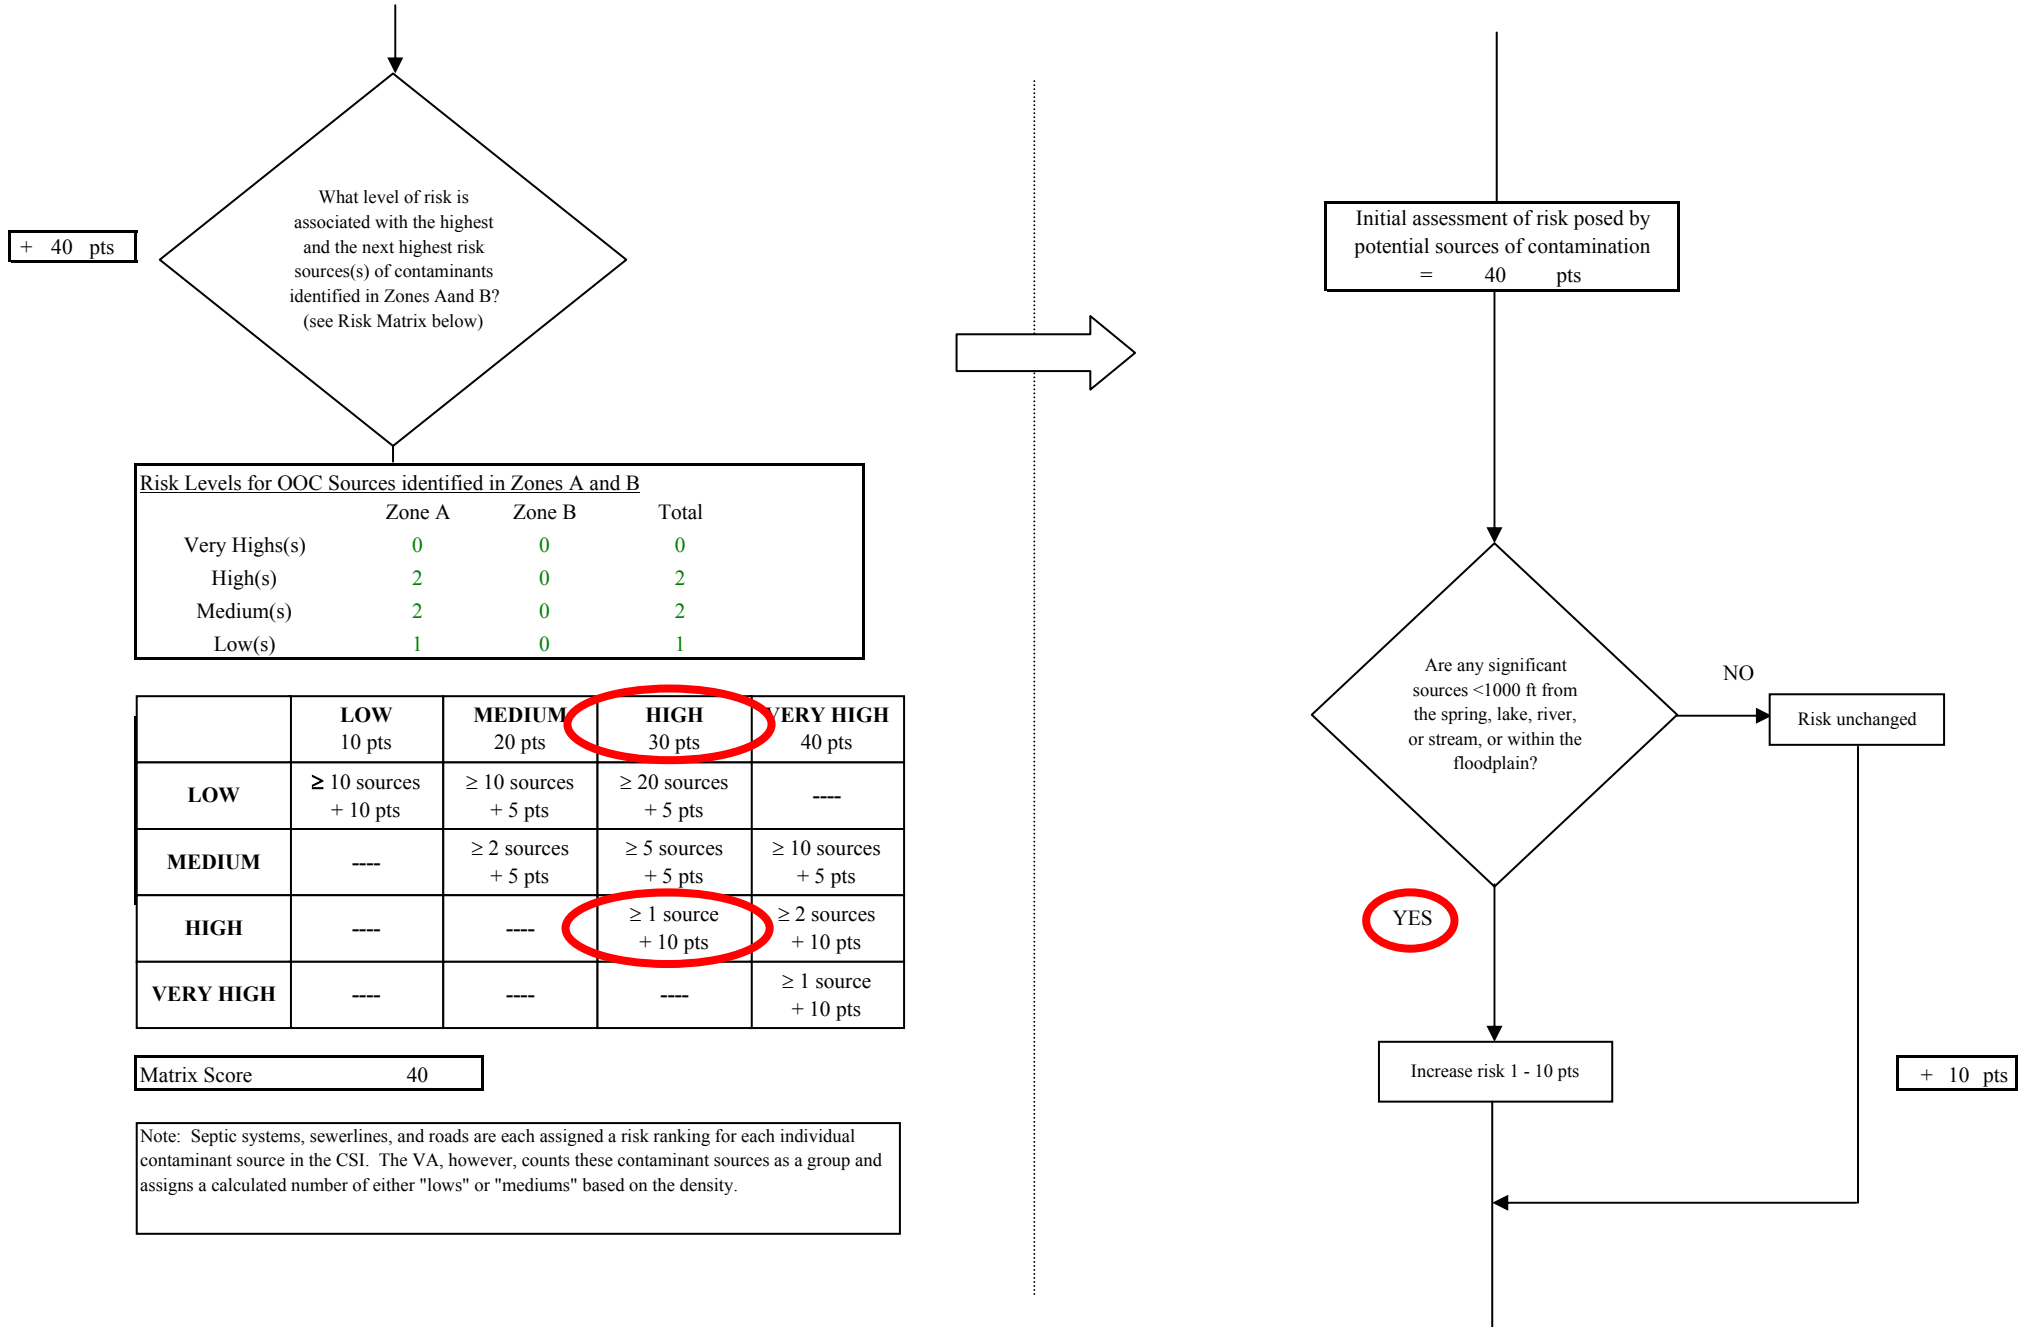


Chart 12. Contaminant risks for ConocoPhillips, Alpine Oil Field - Other Organic Chemicals

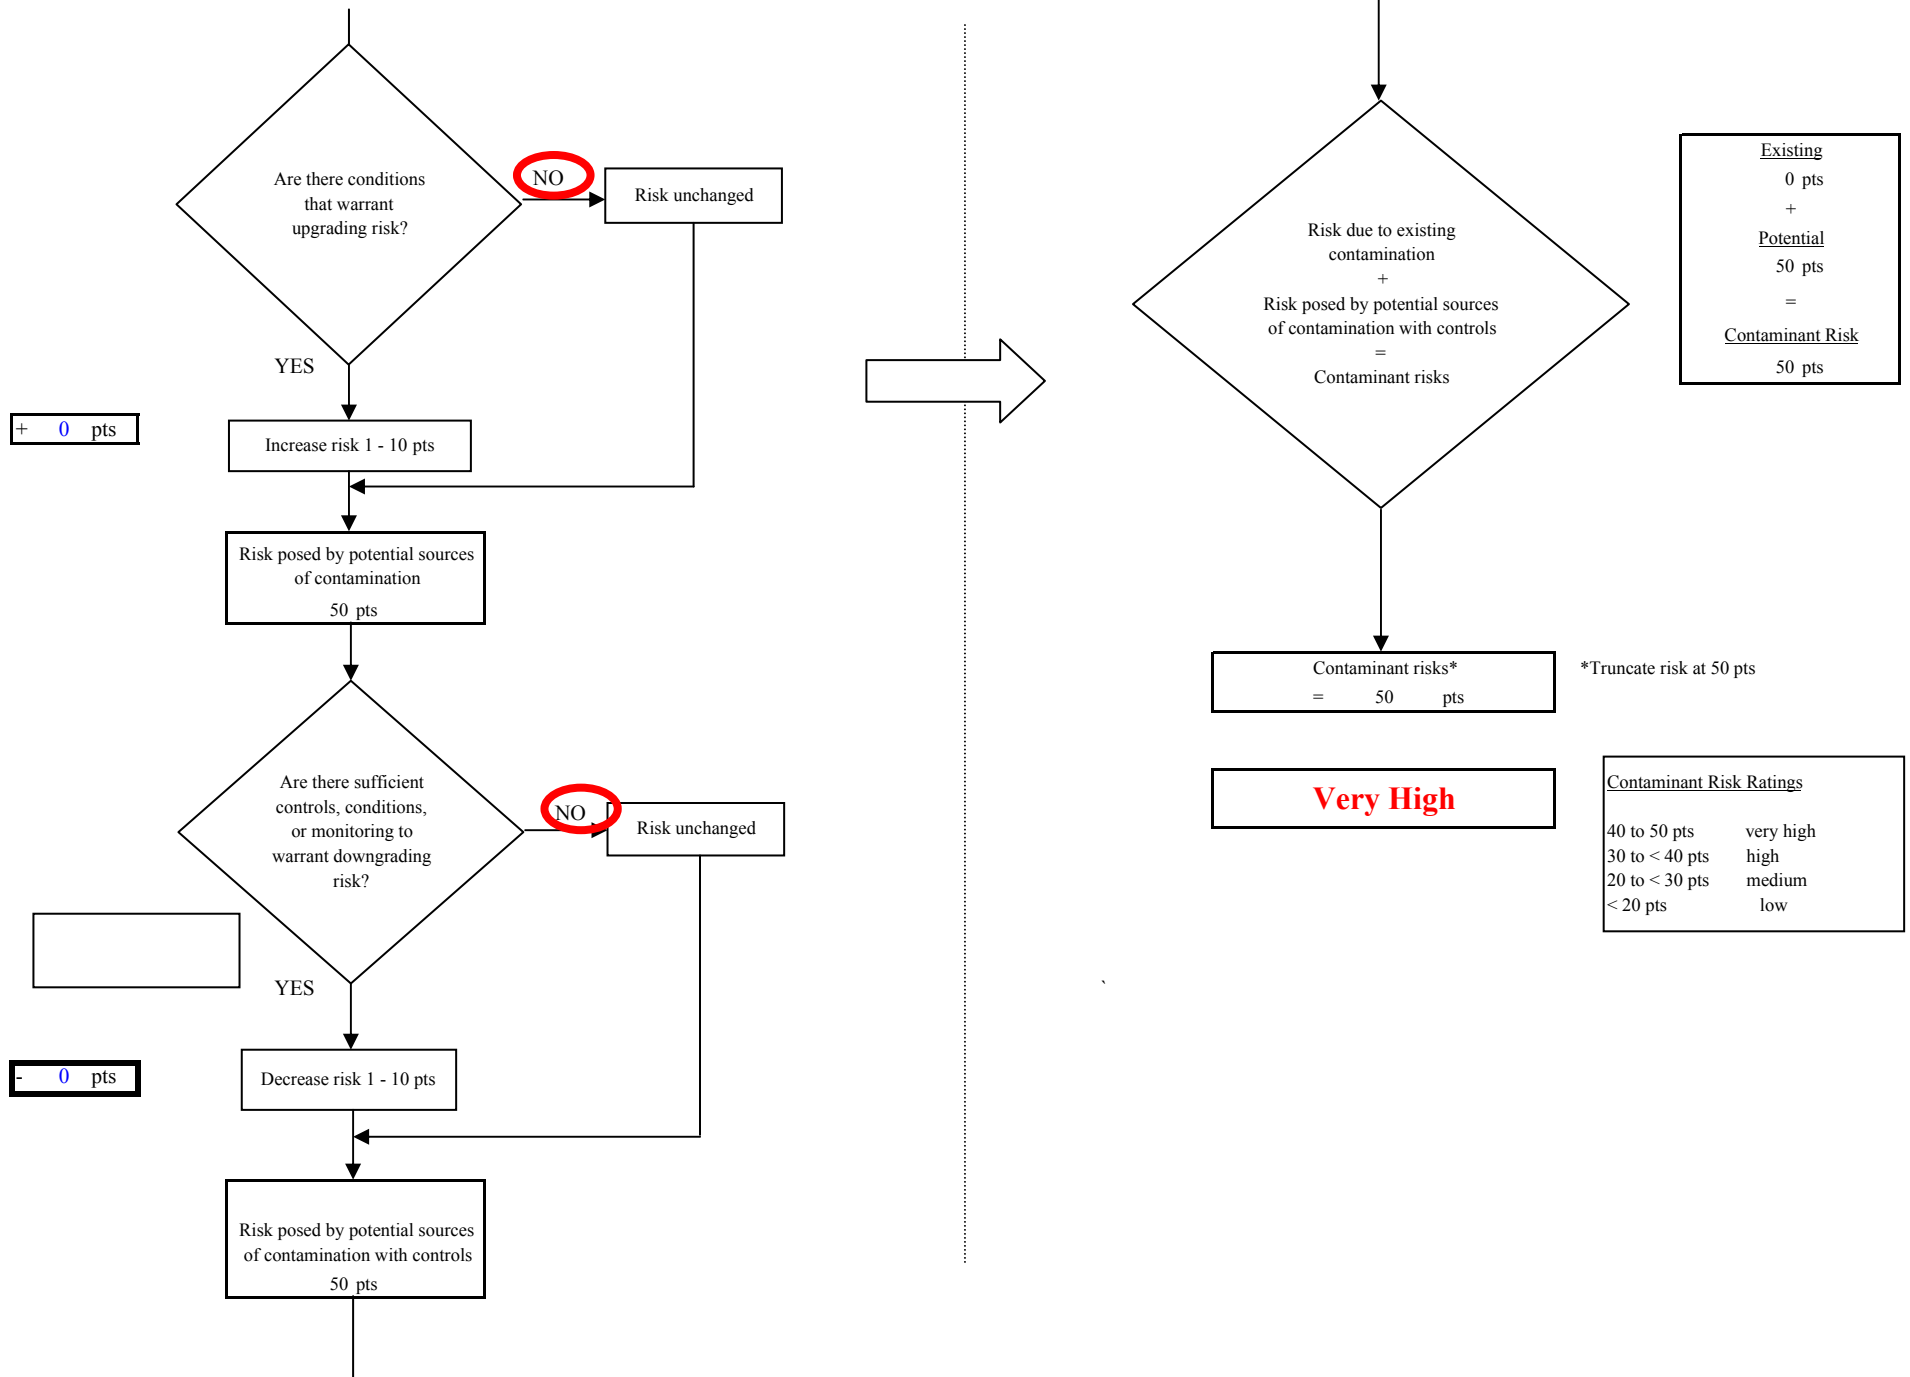


Chart 13. Vulnerability analysis for ConocoPhillips, Alpine Oil Field - Other Organic Chemicals

