

Source Water Assessment

A Hydrogeologic Susceptibility and
Vulnerability Assessment for
Kenny Lake Diner,
Copper Center, Alaska
PWSID #299012

DRINKING WATER PROTECTION PROGRAM REPORT NO. 888

Alaska Department of Environmental Conservation

Source Water Assessment for Kenny Lake Diner, Copper Center, Alaska PWSID #299012

DRINKING WATER PROTECTION PROGRAM REPORT NO. 888

The Drinking Water Protection Program (DWPP) is producing Source Water Assessments in compliance with the Safe Drinking Water Act Amendments of 1996. Each assessment includes a delineation of the source water area, an inventory of potential and existing contaminant sources that may impact the water, a risk ranking for each of these contaminants, and an evaluation of the potential vulnerability of these drinking water sources.

These assessments are intended to provide public water systems owners/operators, communities, and local governments with the best available information that may be used to protect the quality of their drinking water. The assessments combine information obtained from various sources, including the U.S. Environmental Protection Agency, Alaska Department of Environmental Conservation (ADEC), public water system owners/operators, and other public information sources. The results of this assessment are subject to change if additional data becomes available. It is anticipated this assessment will be updated every five years to reflect any changes in the vulnerability and/or susceptibility of public drinking water source. If you have any additional information that may affect the results of this assessment, please contact the Program Coordinator of DWPP, (907) 269-7521.

CONTENTS

SECTION		Page
	Executive Summary	1
	Kenny Lake Diner Public Drinking Water System	1
	Kenny Lake Diner Drinking Water Protection Area	1
	Inventory of Potential and Existing Contaminant Sources	2
	Ranking of Contaminant Risks	2
	Vulnerability of Kenny Lake Diner Drinking Water System	2
	References	5

TABLES

TABLE		
	1. Definition of Zones	2
	2. Susceptibility	3
	3. Contaminant Risks	3
	4. Overall Vulnerability	3

APPENDICES

APPENDIX		
	A. Kenny Lake Diner Drinking Water Protection Area (Map 1)	
	B. Contaminant Source Inventory for Kenny Lake Diner (Table 1)	
	Contaminant Source Inventory and Risk Ranking for Kenny Lake Diner – Bacteria and Viruses (Table 2)	
	Contaminant Source Inventory and Risk Ranking for Kenny Lake Diner - Nitrates/Nitrites (Table 3)	
	Contaminant Source Inventory and Risk Ranking for Kenny Lake Diner – Volatile Organic Chemicals (Table 4)	
	C. Kenny Lake Diner Drinking Water Protection Area and Potential and Existing Contaminant Sources (Map 2)	
	D. Vulnerability Analysis for Contaminant Source Inventory and Risk Ranking for Kenny Lake Diner Public Drinking Water Source (Charts 1 – 8)	

Source Water Assessment for Kenny Lake Diner, Copper Center, Alaska

Drinking Water Protection Program Alaska Department of Environmental Conservation

EXECUTIVE SUMMARY

The public water system for Kenny Lake Diner is a Class B (transient/non-community) water system consisting of one well. Kenny Lake Diner is located at Mile 7.2 of the Edgerton Highway, southeast of Copper Center, Alaska. The wellhead received a susceptibility rating of **Low** and the aquifer received a susceptibility rating of **Medium**. Combining these two ratings produces a **Low** rating for the natural susceptibility of the well. Identified potential and current sources of contaminants for Kenny Lake Diner public drinking water source include paved highways and roads; single-family septic systems; aboveground heating oil tanks; and cemeteries. These identified potential and existing sources of contamination are considered sources of bacteria and viruses, nitrates and/or nitrites, and volatile organic chemicals. Overall, the public water sources for Kenny Lake Diner received a vulnerability rating of **Low** for bacteria and viruses and nitrates and nitrites; and **Medium** for volatile organic chemicals.

KENNY LAKE DINER PUBLIC DRINKING WATER SYSTEM

Kenny Lake Diner public water system is a Class B (transient/non-community) water system. The system consists of one well located at Mile 7.2 of the Edgerton Highway, southeast of Copper Center, Alaska (See Map 1 of Appendix A). Copper Center is located on the Old Richardson Highway, 105 miles north of Valdez, on the west bank of the Copper River at the confluence of the Klutina River. Copper Center lies just west of the Wrangell-St. Elias National Park. The population of Copper Center is approximately 450.

Copper Center averages about 9 inches of precipitation per year, including 39 inches of snow. Although the quality of the groundwater can vary significantly in a short distance, groundwater supplies are generally abundant in the area.

The elevation for Kenny Lake Diner is approximately 1,300 feet below the ground surface.

According to a Sanitary Survey dated June 25, 1999, the existing well was installed in 1992 with 6-inch diameter casing to a depth of 303 feet below ground surface. It is assumed that the length of the well screen is 10 feet. The Survey indicates that the land surface is sloped away from the well, providing adequate surface

water drainage. Because the well was installed in 1992, it is assumed it is not grouted according to ADEC standards. Proper grouting provides added protection against contaminants traveling along the well casing and into source waters.

This system operates seasonally from May to September and serves approximately 25 non-residents through one service connection.

KENNY LAKE DINER DRINKING WATER PROTECTION AREA

In order to evaluate whether a drinking water source is at risk, we must first evaluate what are the most likely pathways for surface contamination to reach the groundwater. These areas are determined by looking at the characteristics of the soil, groundwater, aquifer, and well.

The most probable area for contamination to reach the drinking water well is the area that contributes water to the well, the groundwater recharge area. This area is designated as the Drinking Water Protection Area (DWPA). Because releases of contaminants within the DWPA are most likely to impact the drinking water well, this area will serve as the focus for voluntary protection efforts.

An analytical calculation was used to determine the size and shape of the DWPA. The input parameters describing the attributes of the aquifer in this calculation were estimated from information contained in the well logs and/or the Sanitary Survey. Additional methods were also used to take into account any uncertainties in groundwater flow and aquifer characteristics to arrive at a meaningful DWPA (Please refer to the Guidance Manual for Class B Public Water Systems for additional information).

The DWPAs established for wells by the ADEC are usually separated into four zones. These zones correspond to differences in the time-of-travel (TOT) of the water moving through the aquifer to the well.

The TOT for contaminants within the water varies and is dependent on the physical and chemical characteristics of each contaminant. The following is a summary of the four protection area zones for wells and the calculated time-of-travel for each:

A ranking is assigned for the Natural Susceptibility according to the point score:

Natural Susceptibility Ratings

40 to 50 pts	Very High
30 to < 40 pts	High
20 to < 30 pts	Medium
< 20 pts	Low

The well for Kenny Lake Diner is assumed to be completed in a confined aquifer. Because aquifers are recharged by surface water and precipitation that migrates downward from the surface, contaminants at the surface have the potential to adversely impact this aquifer. Table 2 shows the Susceptibility scores and ratings for Kenny Lake Diner.

Table 2. Susceptibility

	Score	Rating
Susceptibility of the Wellhead	5	Low
Susceptibility of the Aquifer	10	Medium
Natural Susceptibility	15	Low

Contaminant risks to a drinking water source depend on the type, number or density, and distribution of contaminant sources. This score has been derived from an examination of existing and historical contamination that has been detected at the drinking water source through routine sampling. It also evaluates potential sources of contamination. Flow charts are used to assign a point score, and ratings are assigned in the same way as for the natural susceptibility:

Contaminant Risk Ratings

40 to 50 pts	Very High
30 to < 40 pts	High
20 to < 30 pts	Medium
< 20 pts	Low

Table 3 summarizes the Contaminant Risks for each category of drinking water contaminants.

Table 3. Contaminant Risks

Category	Score	Rating
Bacteria and Viruses	12	Low
Nitrates and/or Nitrites	24	Medium
Volatile Organic Chemicals	27	Medium

Finally, an overall vulnerability score is assigned for each water system by combining each of the contaminant risk scores with the natural susceptibility score:

$$\begin{aligned}
 &\text{Natural Susceptibility (0 – 50 points)} \\
 &\quad + \\
 &\text{Contaminant Risks (0 – 50 points)} \\
 &= \\
 &\text{Vulnerability of the} \\
 &\text{Drinking Water Source to Contamination (0 – 100).}
 \end{aligned}$$

Again, rankings are assigned according to a point score:

Overall Vulnerability Ratings

80 to 100 pts	Very High
60 to < 80 pts	High
40 to < 60 pts	Medium
< 40 pts	Low

Table 4 contains the overall vulnerability scores (0 - 100) and ratings for each of the three categories of drinking water contaminants. Note: scores are rounded off to the nearest five.

Table 4. Overall Vulnerability

Category	Score	Rating
Bacteria and Viruses	25	Low
Nitrates and Nitrites	35	Low
Volatile Organic Chemicals	40	Medium

Bacteria and Viruses

The contaminant risk for bacteria and viruses is **Low** with paved highways and roads and single-family septic systems representing the risks to the drinking water well (See Chart 3 – Contaminant Risks for Bacteria and Viruses in Appendix D).

Only a small amount of bacteria and viruses are required to endanger public health. Recent sampling events indicated no recent positive results were detected for bacteria and viruses. However, after combining the contaminant risks with the overall natural susceptibility of the well, the vulnerability of the well to contamination by bacteria and viruses is **Low**.

Nitrates and Nitrites

The contaminant risk for nitrates and nitrites is **Medium** with paved highways and roads; single-family septic systems; and cemeteries representing the risks to this source of public drinking water (See Chart 5 - Contaminant Risks for Nitrates and/or Nitrites in Appendix D).

Sampling history for Kenny Lake Diner indicates that nitrates have been detected in the water, but only in very low concentrations (at 0.395 mg/L on 3/26/02) or 4% of the Maximum Contaminant Level (MCL). The MCL is the maximum level of contaminant that is allowed to exist in drinking water and still be consumed by humans without harmful health effects. Due to the high solubility and weak retention by soil, nitrates are very mobile, moving at approximately the same rate as water.

After combining the contaminant risk for nitrates and nitrites with the natural susceptibility of the well, the overall vulnerability of the well to contamination by nitrates and nitrites is **Low**.

Volatile Organic Chemicals

The contaminant risk for volatile organic chemicals is **Medium** with paved highways and roads; single-family septic systems; and aboveground heating oil tanks the only known risks for volatile organic chemicals (See Chart 7 – Contaminant Risks for Volatile Organic Chemicals in Appendix D).



Recent sample data for the drinking water at Kenny Lake Diner indicates that volatile organic chemicals have not been detected in the water. However, after combining the contaminant risk for volatile organic chemicals with the natural susceptibility of the well, the overall vulnerability of the well to contamination by volatile organic chemicals is **Medium**.

REFERENCES

- Alaska Department of Community and Economic Development, Alaska Community Database, Detailed Community Information (2002). <http://www.dced.state.ak.us/mra/CF_BLOCK.cfm> (2003, September 1).
- Alaska Department of Natural Resources, Well Log Tracking System (2002). <<http://info.dec.state.ak.us/welts/Default.asp>> (2003, September 1)
- Alaska Geospatial Data Clearinghouse (2003). <<http://agdc.usgs.gov/data/datasets.html>> (2003, September 1)
- Freeze, R. Allen, and John A. Cherry, Groundwater. Englewood Cliffs: Prentice-Hall 1979.
- King, P.B., compiler, 1969, Tectonic map of North America: US Geological Survey Map (Scale 1:5,000,000) 2 sheets.
- United States Environmental Protection Agency (2002). <<http://www.epa.gov/safewater/mcl.html#mcls>> (2003, September 1)

APPENDIX A

Kenny Lake Diner Drinking Water Protection Area Location Map (Map 1)

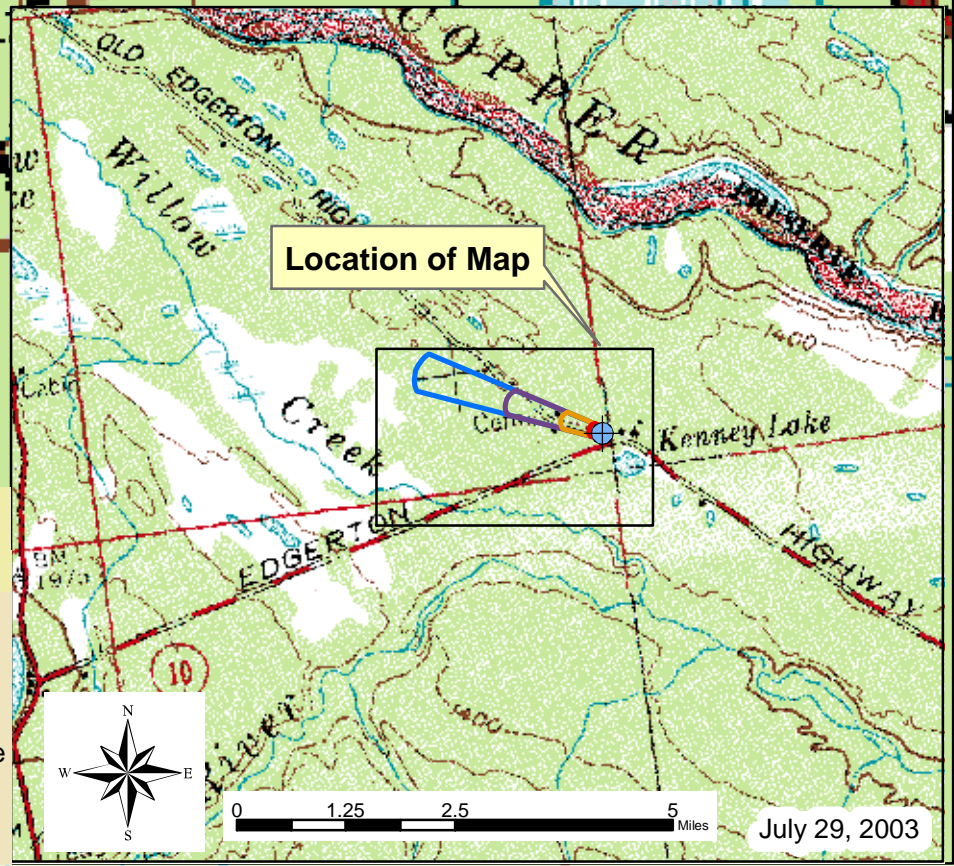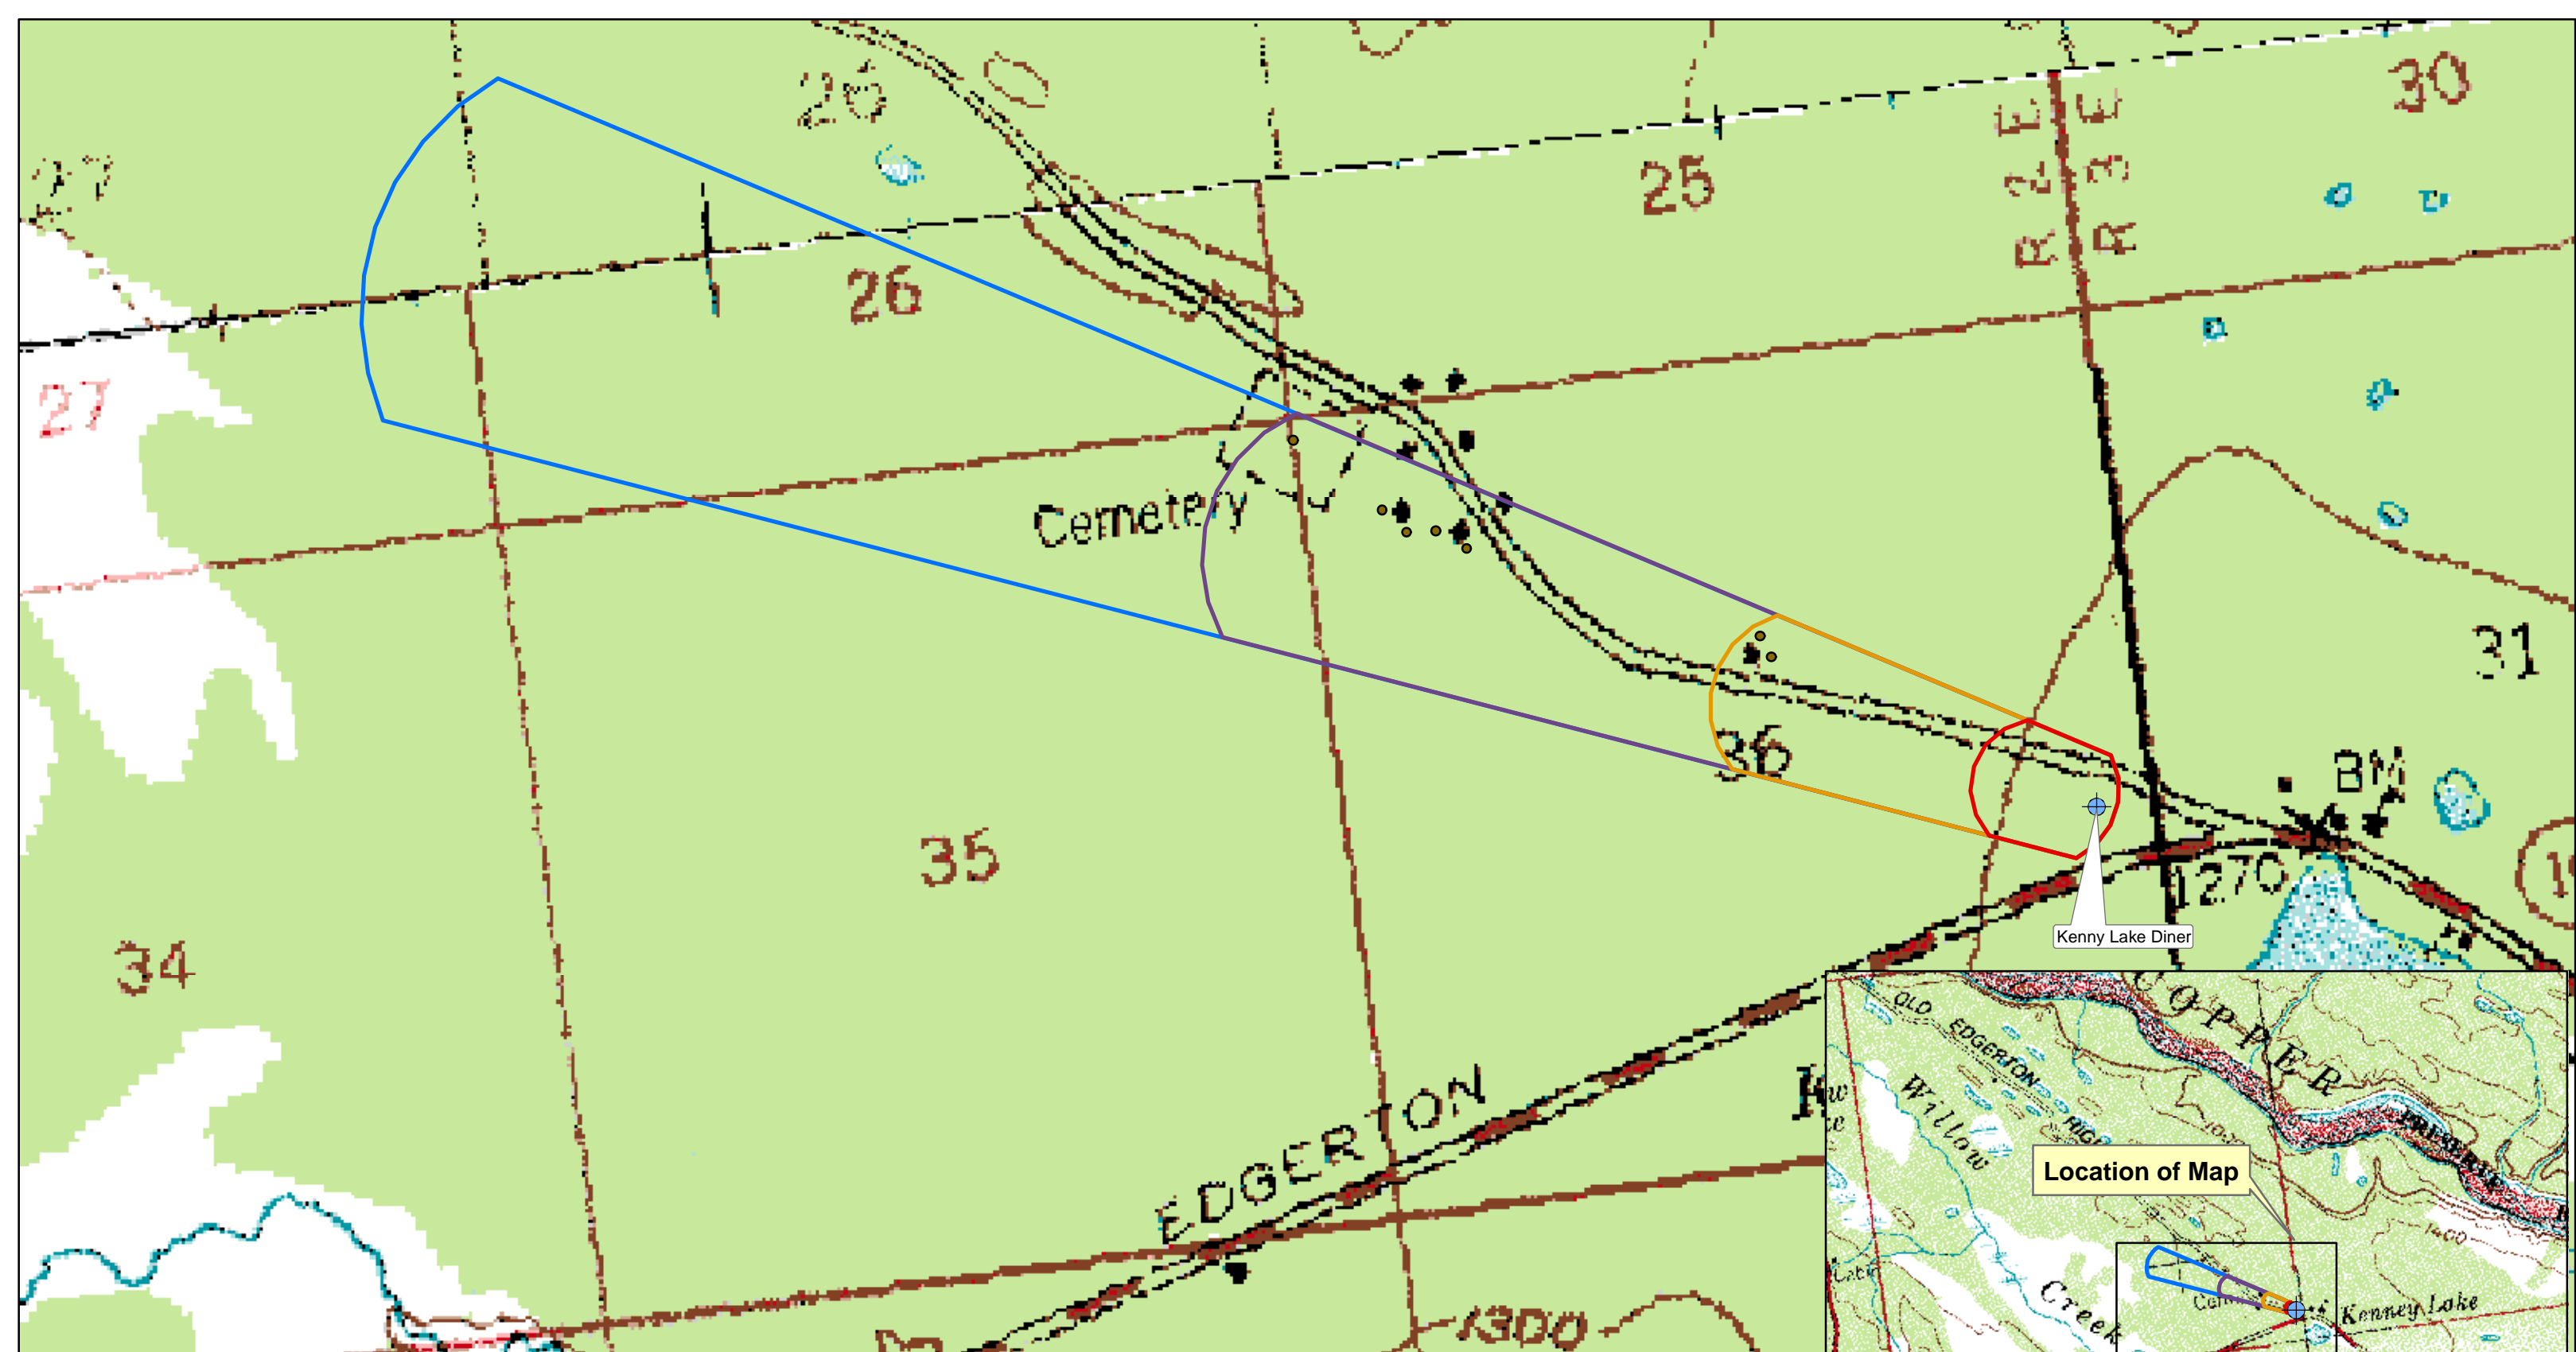

Kenny Lake Diner

Location of Map

Map 1: Kenny Lake Diner Drinking Water Protection Areas


PWSID: 299012.001



1:12,062

Data Sources:
Background image - USGS 1:63,000 mapping

- Legend**
- Public Drinking Water Systems
 - DWPA Zone A**
 Several Months Travel Time
 - DWPA Zone B**
 Less than 2 Years Travel Time
 - DWPA Zone C**
 Less than 5 Years Travel Time
 - DWPA Zone D**
 Less than 10 Years Travel Time



July 29, 2003

APPENDIX B

Contaminant Source Inventory and Risk Ranking for Kenny Lake Diner

(Tables 1-4)

Table 1**Contaminant Source Inventory for
Kenny Lake Diner****PWSID 299012.001**

Contaminant Source Type	Contaminant Source ID	CS ID tag	Zone	Map Number	Comments
Highways and roads, paved (cement or asphalt)	X20	X20-1	A	2	Road Northwest of Kenny Lake Diner
Septic systems (serves one single-family home)	R02	R02-1	B	2	Residence Northwest of Kenny Lake Diner
Tanks, heating oil, residential (above ground)	R08	R08-1	B	2	Residence Northwest of Kenny Lake Diner
Septic systems (serves one single-family home)	R02	R02-2	C	2	Residence Northwest of Kenny Lake Diner
Septic systems (serves one single-family home)	R02	R02-3	C	2	Residence Northwest of Kenny Lake Diner
Tanks, heating oil, residential (above ground)	R08	R08-2	C	2	Residence Northwest of Kenny Lake Diner
Tanks, heating oil, residential (above ground)	R08	R08-3	C	2	Residence Northwest of Kenny Lake Diner
Cemeteries	X01	X01-1	C	2	Lincoln Family Cemetery Northwest of Kenny Lake Diner

**Contaminant Source Inventory and Risk Ranking for
Kenny Lake Diner
Sources of Bacteria and Viruses**

PWSID 299012.001

Table 2

Contaminant Source Type	Contaminant Source ID	CS ID tag	Zone	Risk Ranking for Analysis	Map Number	Comments
Highways and roads, paved (cement or asphalt)	X20	X20-1	A	Low	2	Road Northwest of Kenny Lake Diner
Septic systems (serves one single-family home)	R02	R02-1	B	Low	2	Residence Northwest of Kenny Lake Diner
Septic systems (serves one single-family home)	R02	R02-2	C	Low	2	Residence Northwest of Kenny Lake Diner
Septic systems (serves one single-family home)	R02	R02-3	C	Low	2	Residence Northwest of Kenny Lake Diner

**Contaminant Source Inventory and Risk Ranking for
Kenny Lake Diner
Sources of Nitrates/Nitrites**

PWSID 299012.001

Table 3

Contaminant Source Type	Contaminant Source ID	CS ID tag	Zone	Risk Ranking for Analysis	Map Number	Comments
Highways and roads, paved (cement or asphalt)	X20	X20-1	A	Low	2	Road Northwest of Kenny Lake Diner
Septic systems (serves one single-family home)	R02	R02-1	B	Low	2	Residence Northwest of Kenny Lake Diner
Septic systems (serves one single-family home)	R02	R02-2	C	Low	2	Residence Northwest of Kenny Lake Diner
Septic systems (serves one single-family home)	R02	R02-3	C	Low	2	Residence Northwest of Kenny Lake Diner
Cemeteries	X01	X01-1	C	Medium	2	Lincoln Family Cemetery Northwest of Kenny Lake Diner

**Contaminant Source Inventory and Risk Ranking for
Kenny Lake Diner
Sources of Volatile Organic Chemicals**



PWSID 299012.001

Table 4

Contaminant Source Type	Contaminant Source ID	CS ID tag	Zone	Risk Ranking for Analysis	Map Number	Comments
Highways and roads, paved (cement or asphalt)	X20	X20-1	A	Low	2	Road Northwest of Kenny Lake Diner
Septic systems (serves one single-family home)	R02	R02-1	B	Low	2	Residence Northwest of Kenny Lake Diner
Tanks, heating oil, residential (above ground)	R08	R08-1	B	Medium	2	Residence Northwest of Kenny Lake Diner
Septic systems (serves one single-family home)	R02	R02-2	C	Low	2	Residence Northwest of Kenny Lake Diner
Septic systems (serves one single-family home)	R02	R02-3	C	Low	2	Residence Northwest of Kenny Lake Diner
Tanks, heating oil, residential (above ground)	R08	R08-2	C	Medium	2	Residence Northwest of Kenny Lake Diner
Tanks, heating oil, residential (above ground)	R08	R08-3	C	Medium	2	Residence Northwest of Kenny Lake Diner


APPENDIX C

Kenny Lake Diner Drinking Water Protection Area and Potential and Existing Contaminant Sources (Map 2)

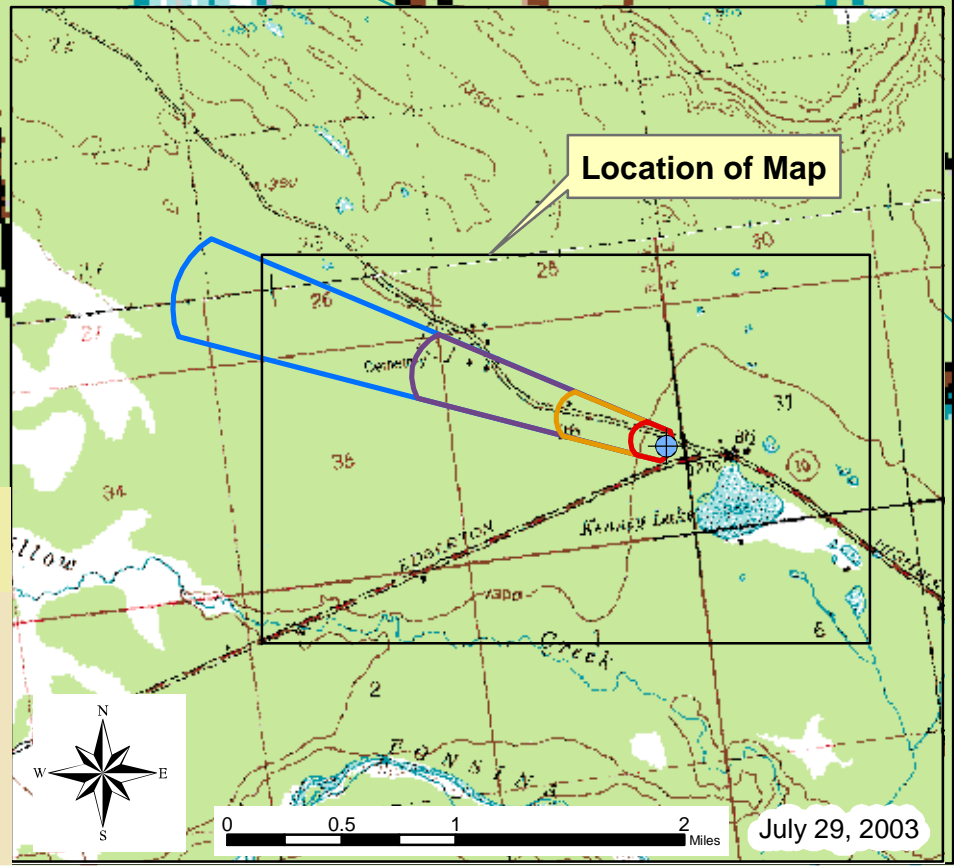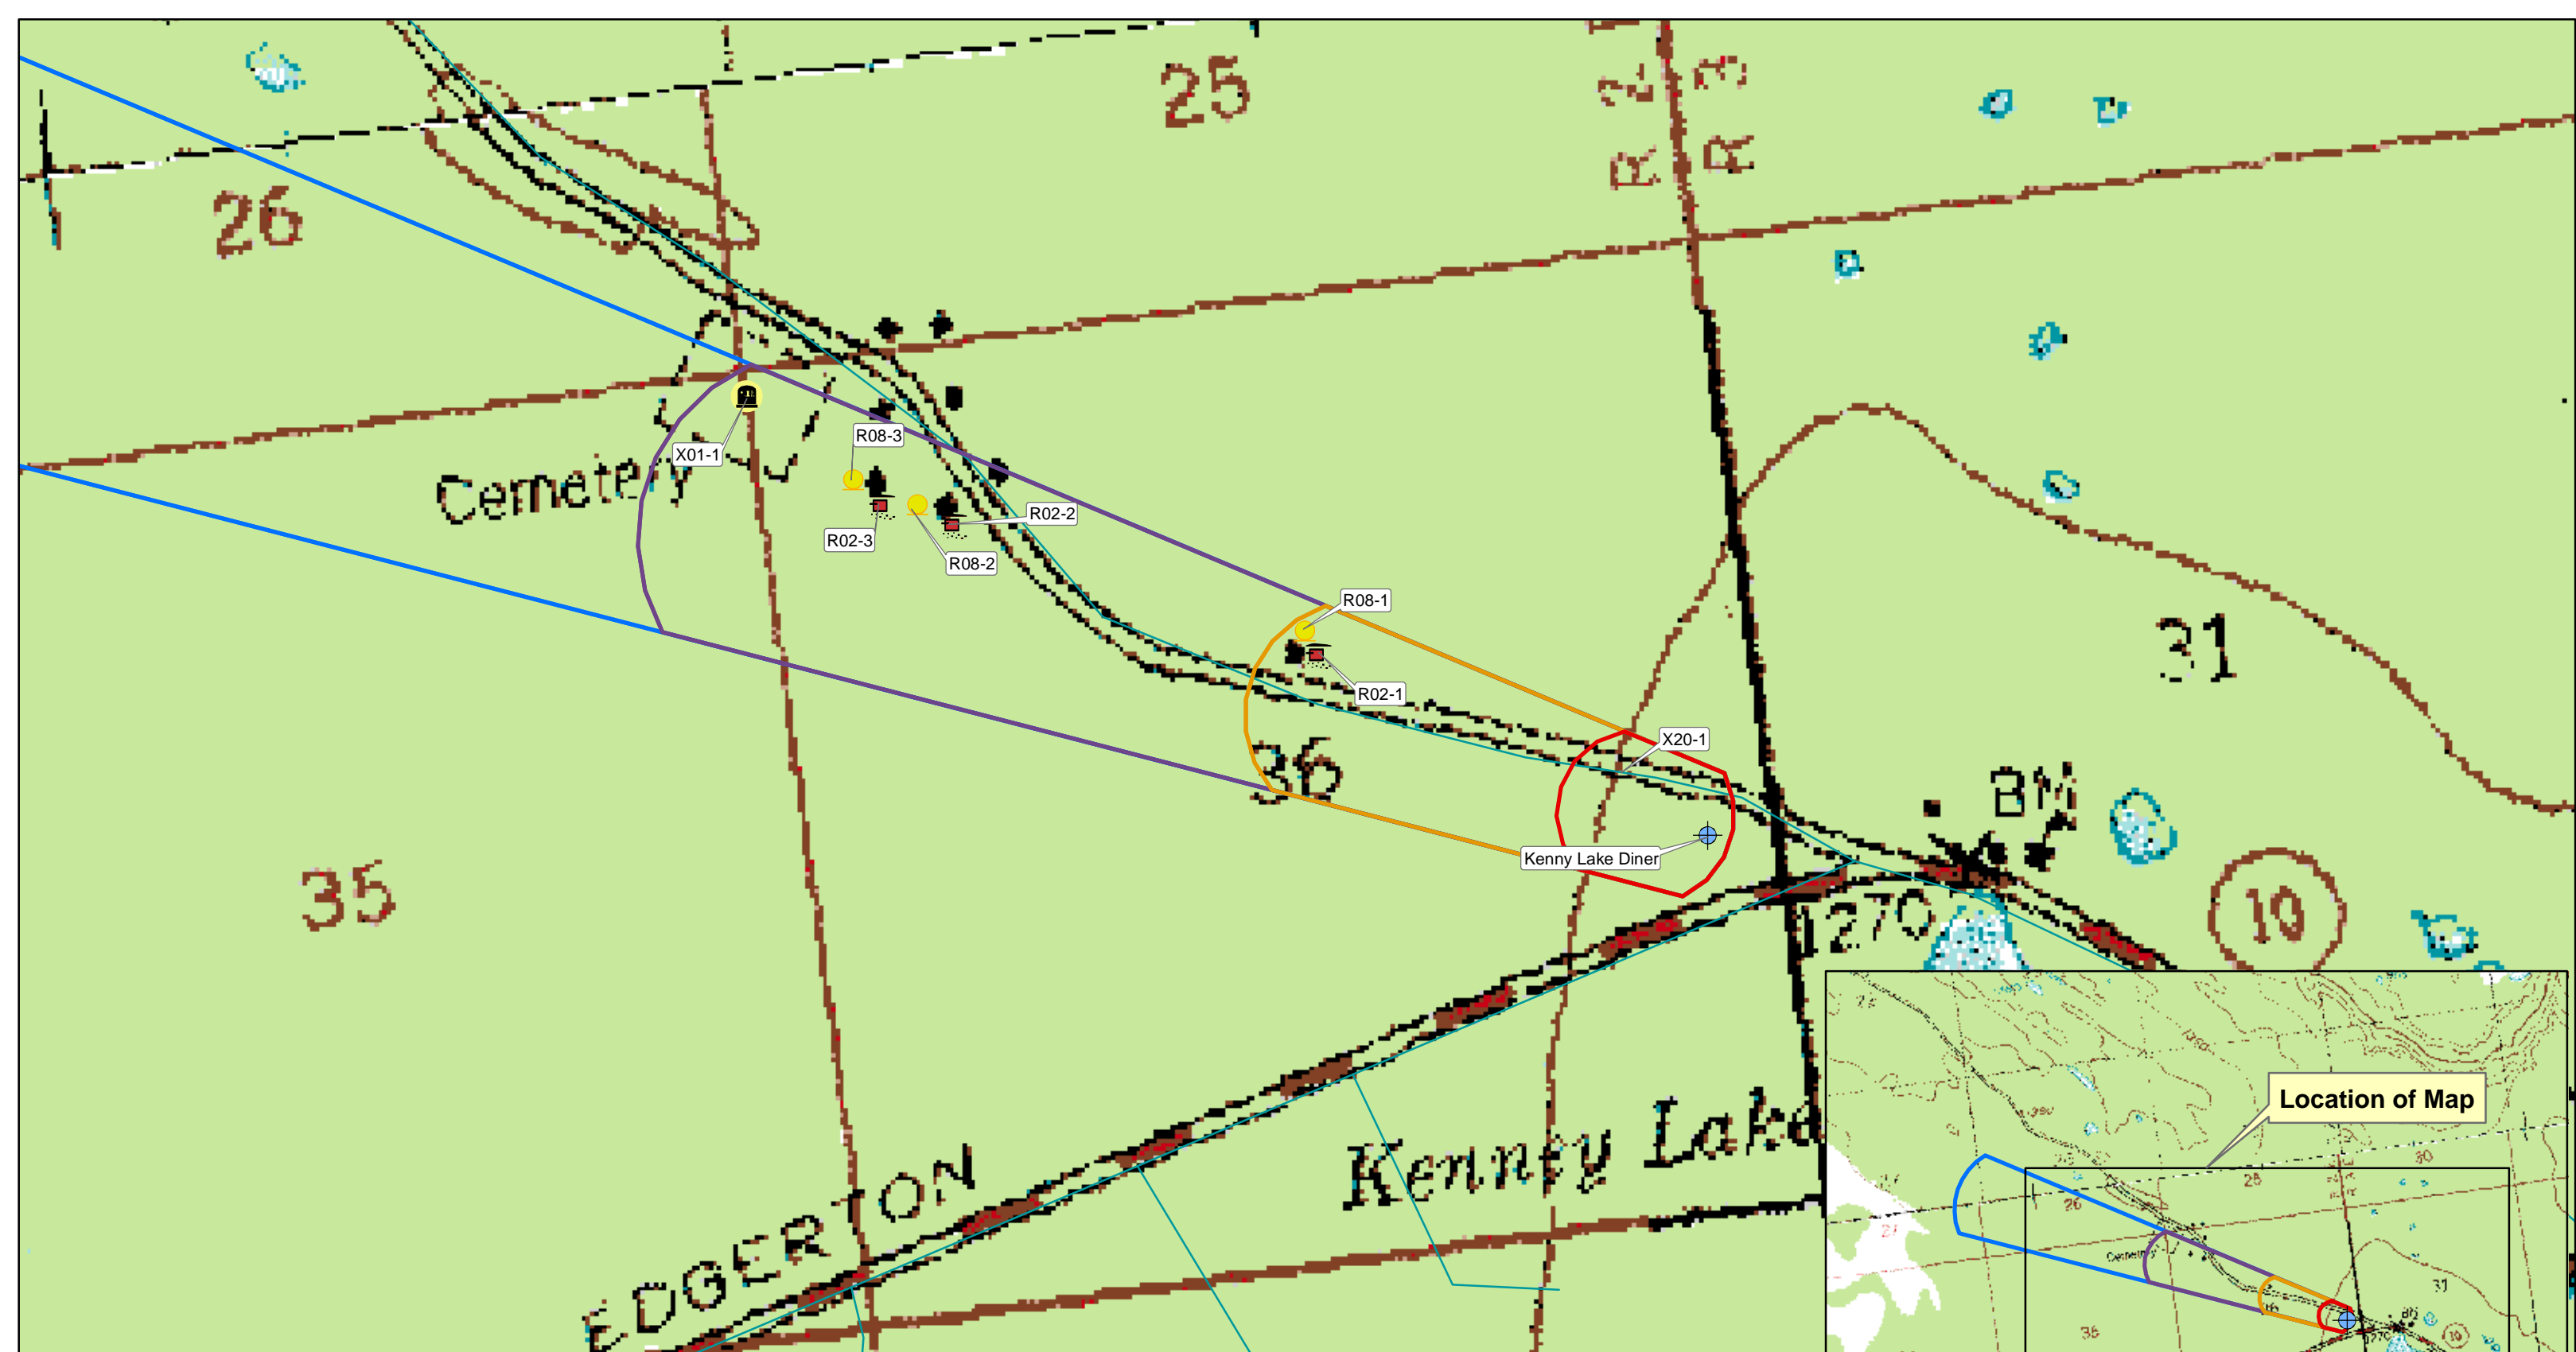

Map 2: Drinking Water Protection Areas for Kenny Lake Diner and Potential and Existing Sources of Contamination

PWSID: 299012.001



Data Sources:
Background image - USGS 1:63,000 mapping

- Legend**
- Public Drinking Water Systems
 - Single Family Septic System (R02)
 - Single Family Heating Oil Tank (R08)
 - Lincoln Family Cemetery (X01)
 - Roads (X20)
- DWPA Zone A**
 Several Months Travel Time
- DWPA Zone B**
 Less than 2 Years Travel Time
- DWPA Zone C**
 Less than 5 Years Travel Time
- DWPA Zone D**
 Less than 10 Years Travel Time

APPENDIX D

Vulnerability Analysis for Kenny Lake Diner Public Drinking Water Source (Charts 1-8)

Chart 1. Susceptibility of the wellhead - Kenny Lake Diner

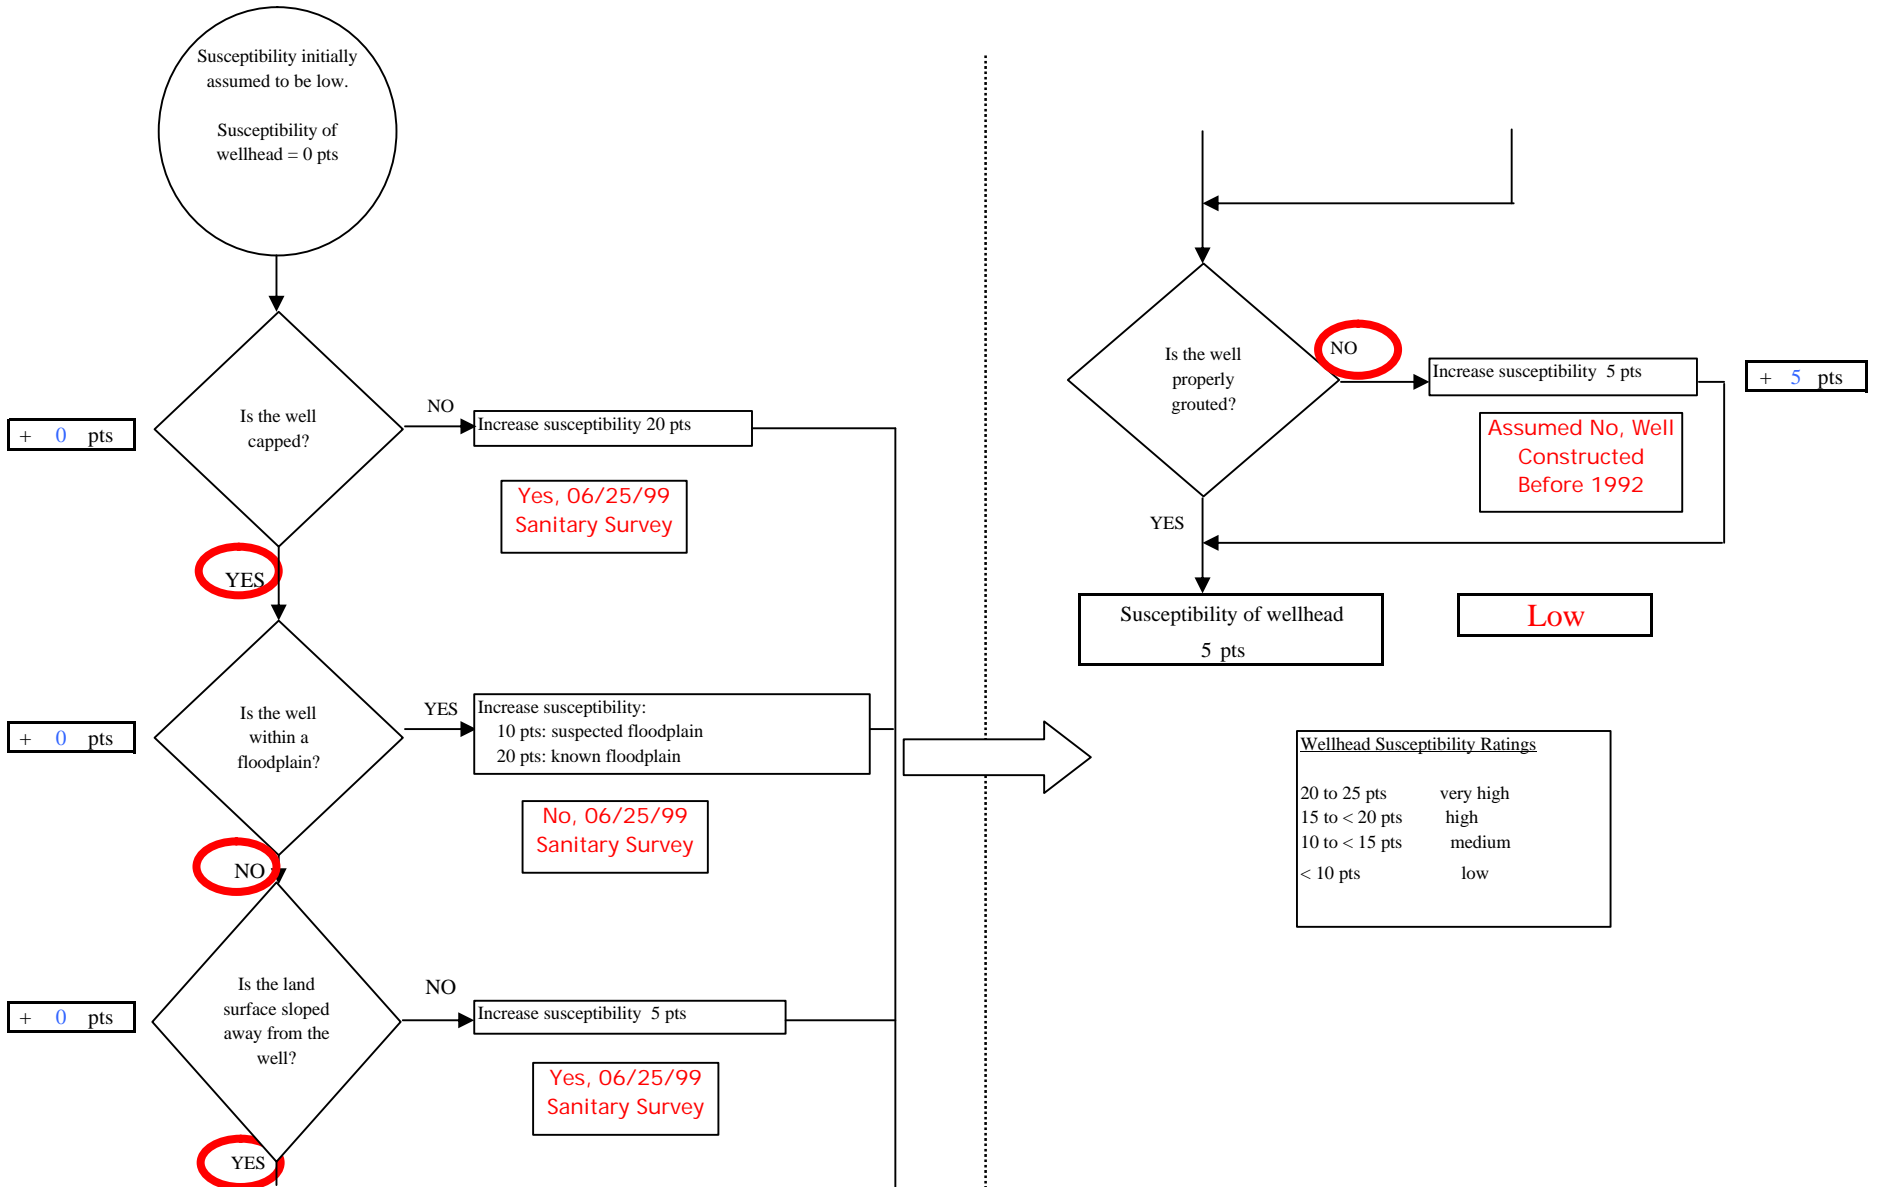


Chart 2. Susceptibility of the aquifer - Kenny Lake Diner

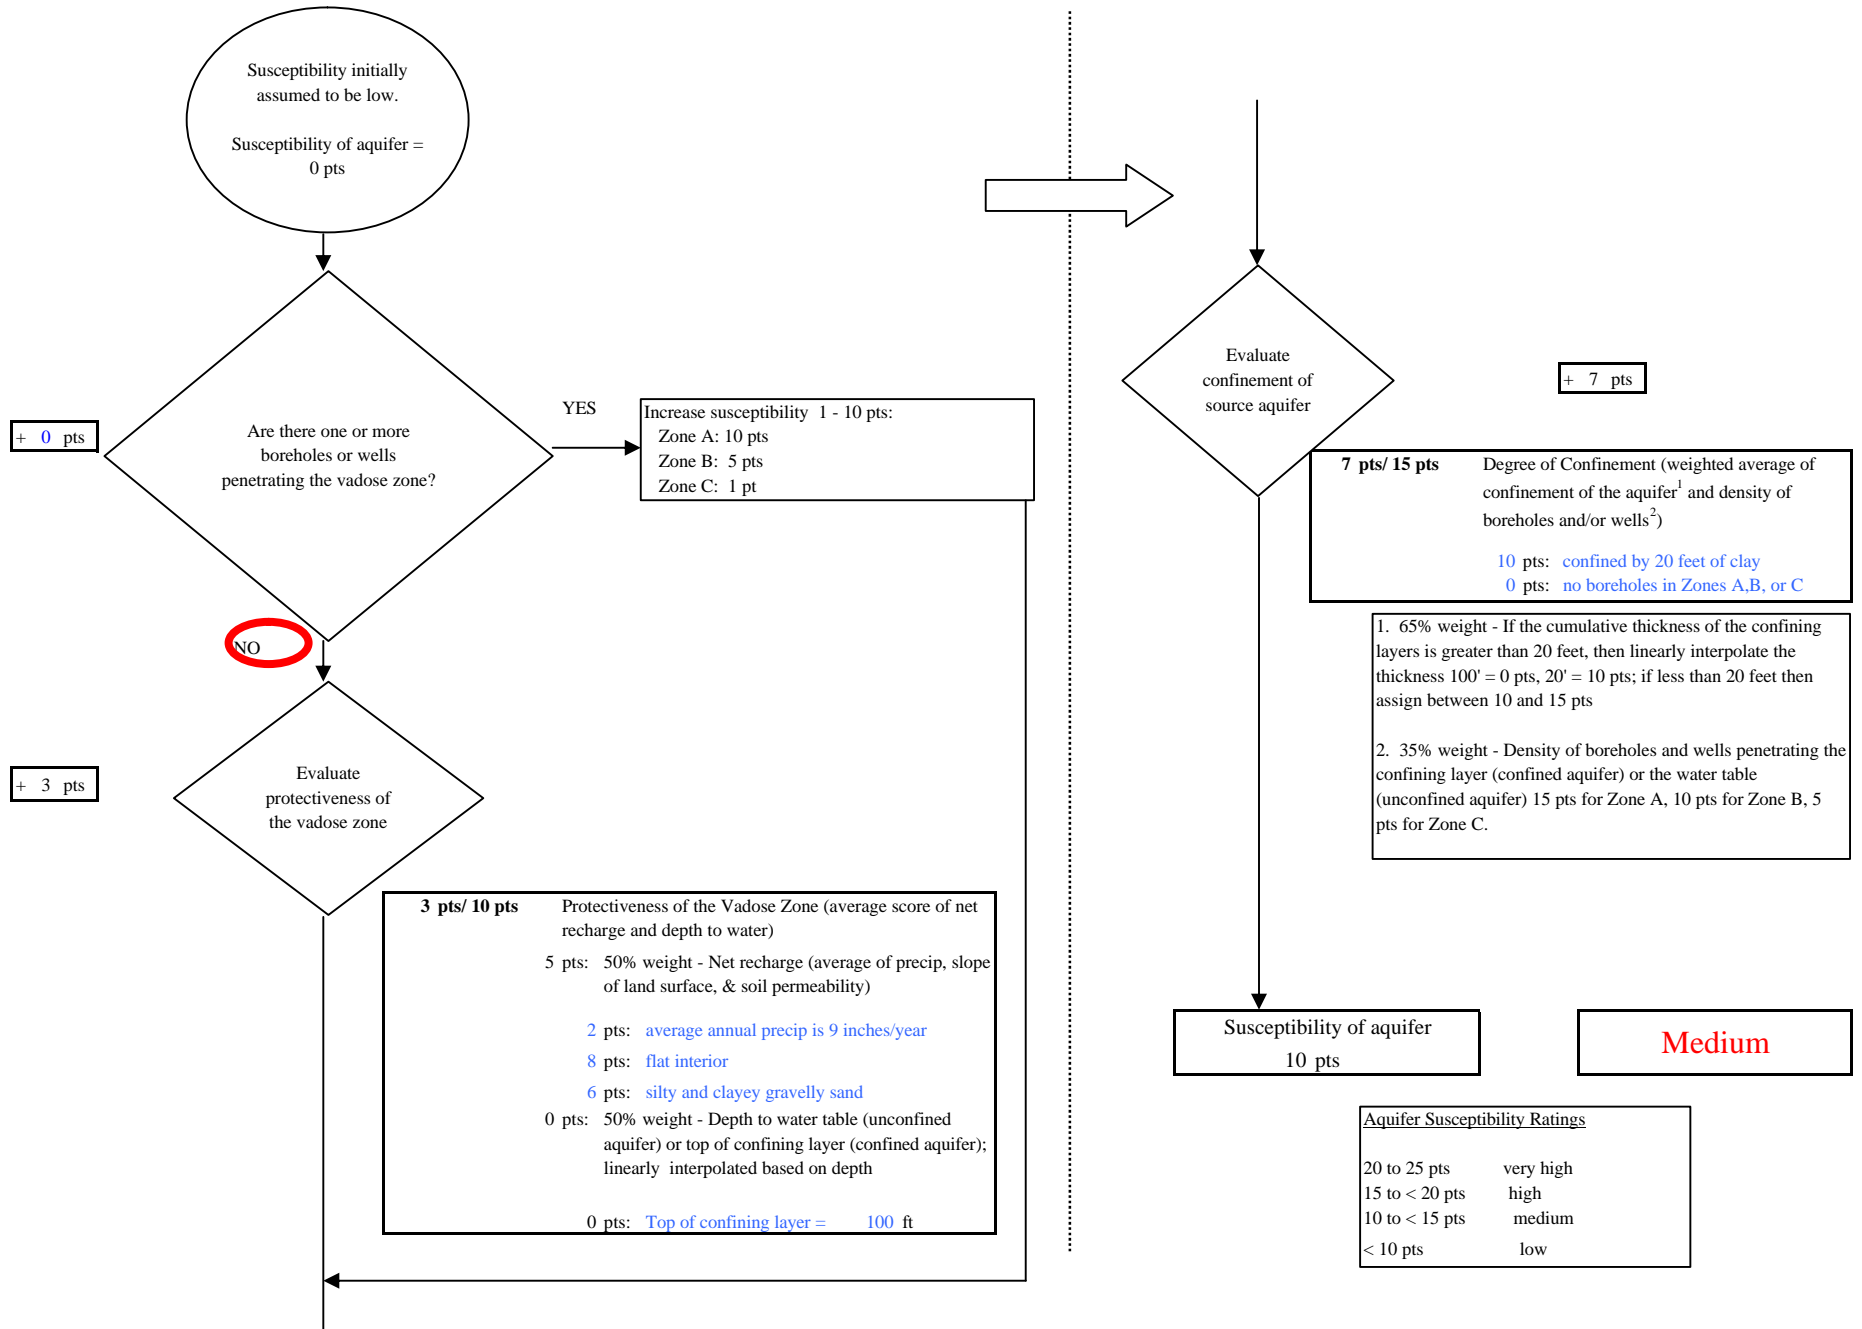


Chart 3. Contaminant risks for Kenny Lake Diner - Bacteria & Viruses




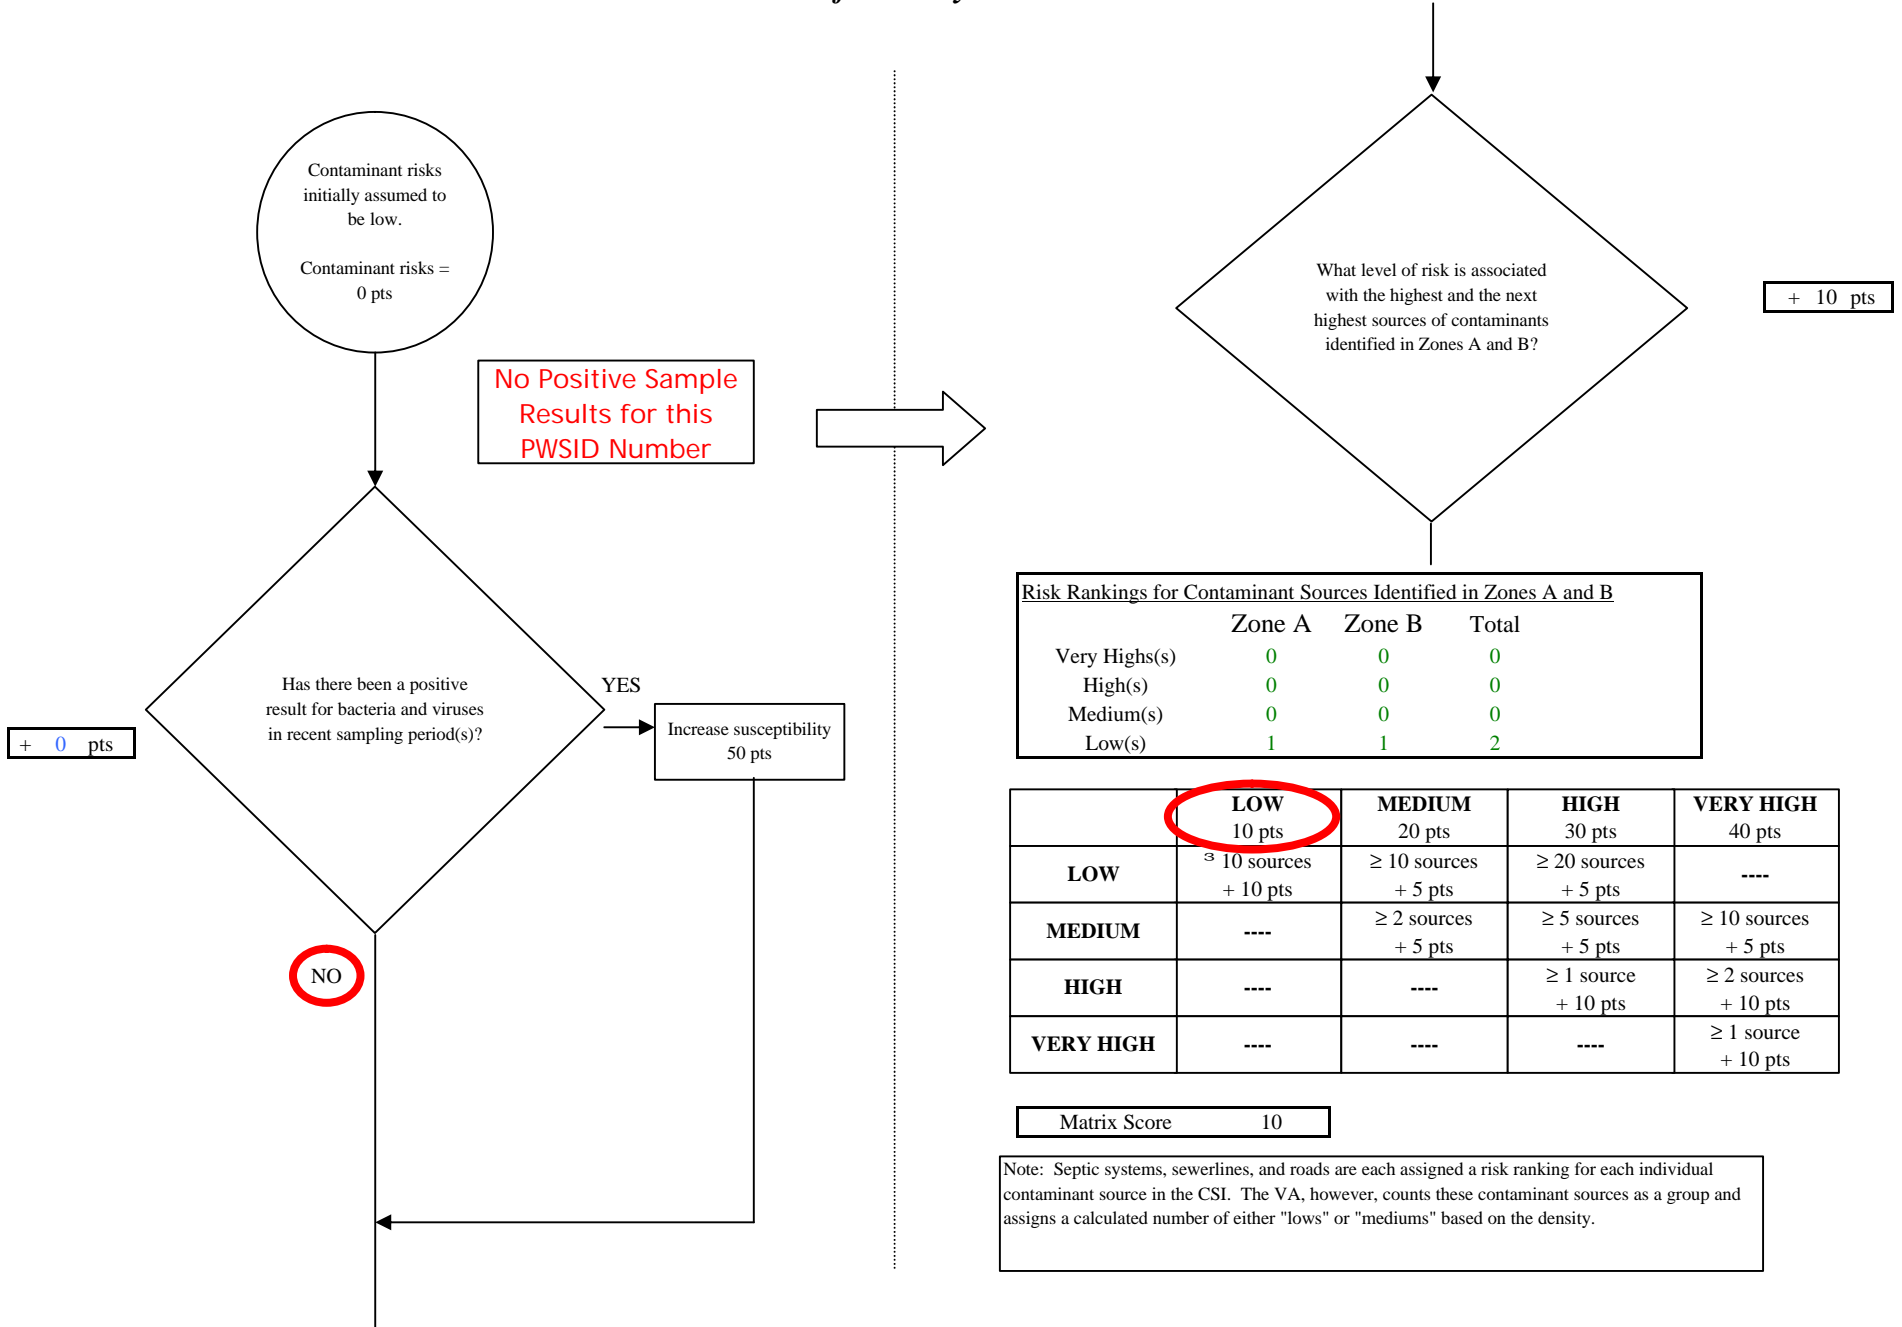


Chart 3. Contaminant risks for Kenny Lake Diner - Bacteria & Viruses

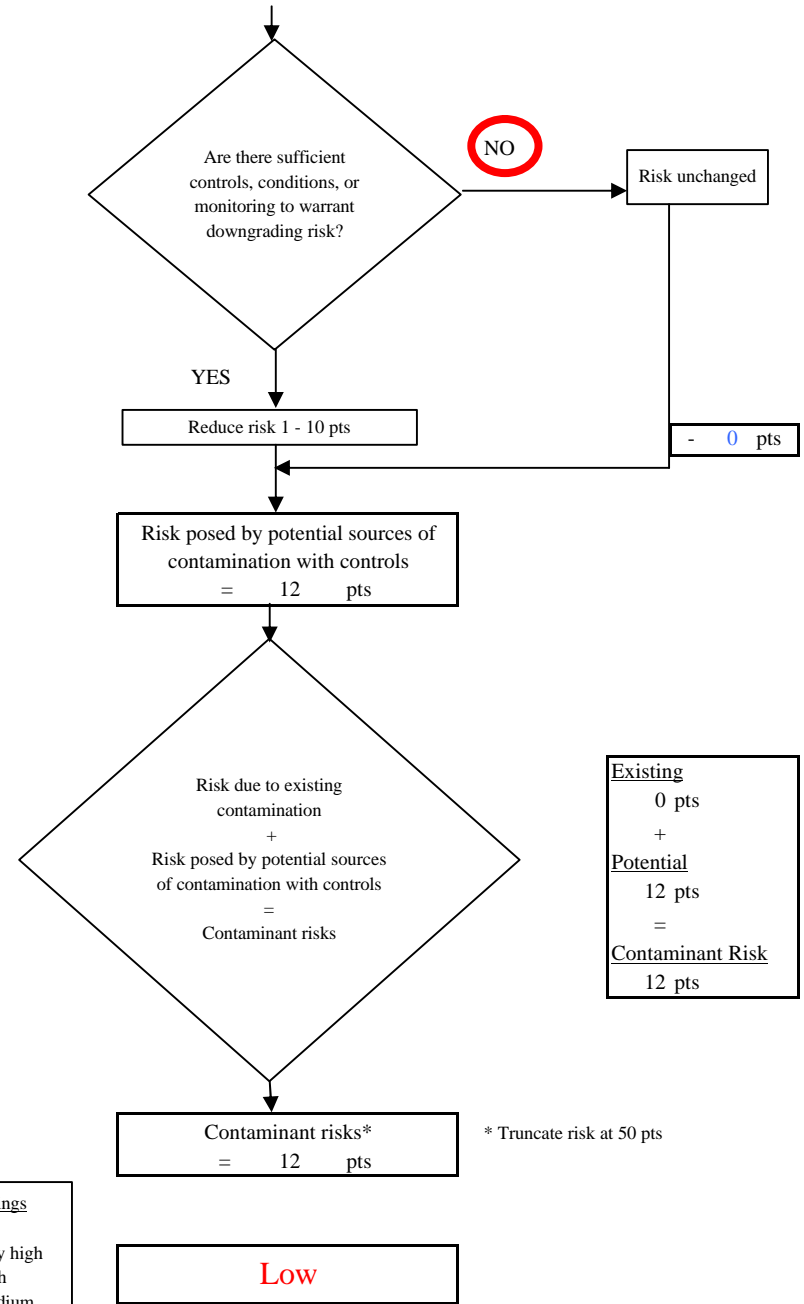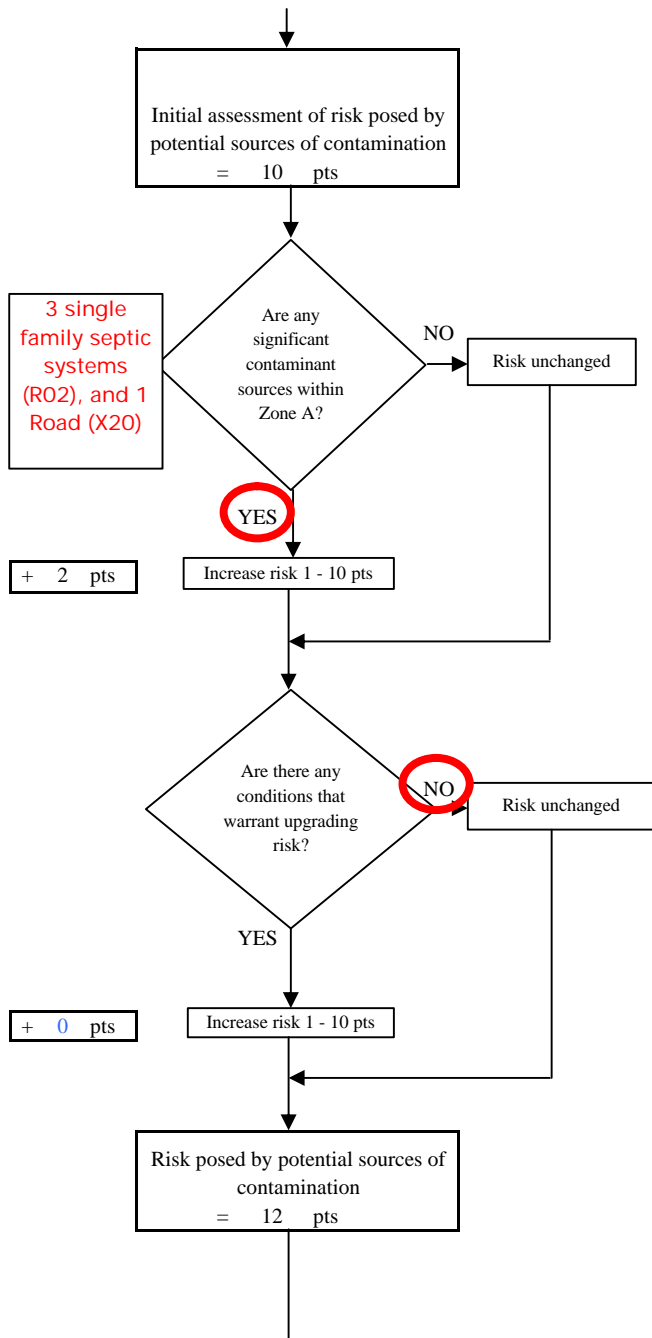

Contaminant Risk Ratings	
40 to 50 pts	very high
30 to < 40 pts	high
20 to < 30 pts	medium
< 20 pts	low

Chart 4. Vulnerability analysis for Kenny Lake Diner - Bacteria & Viruses

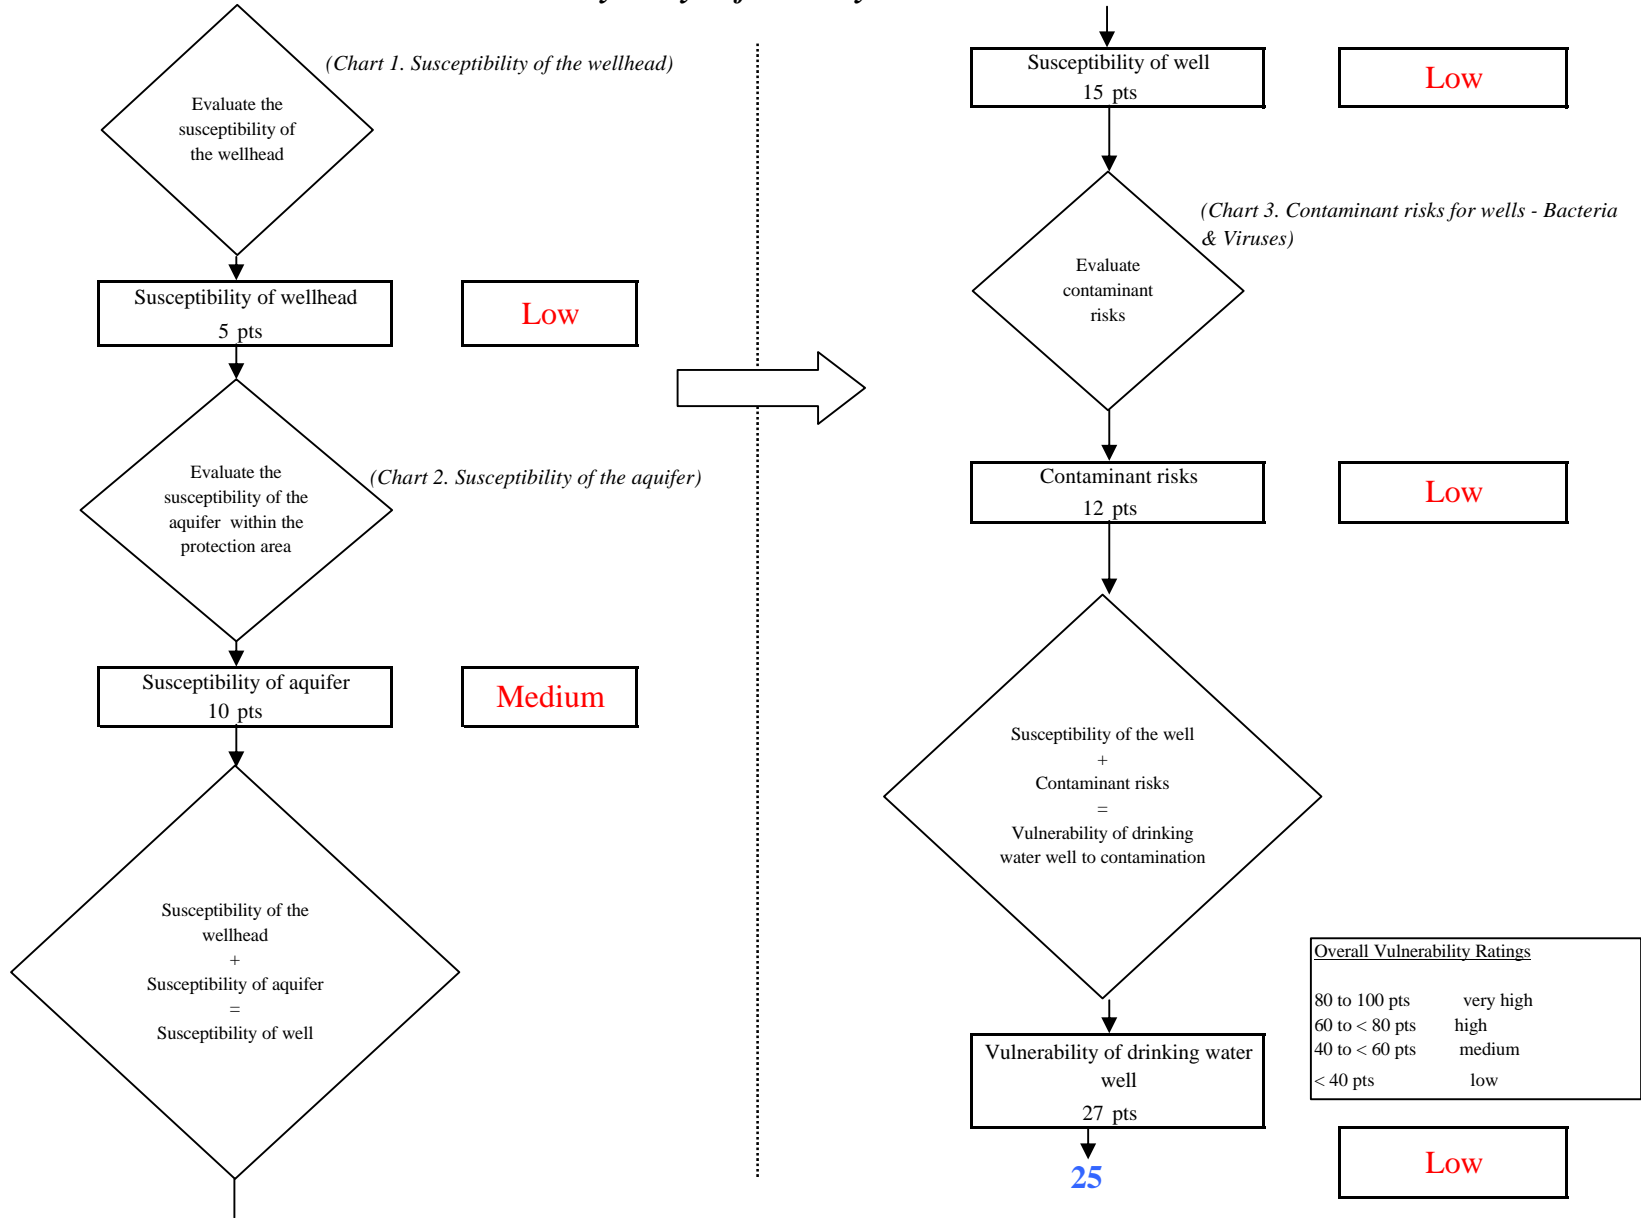


Chart 5. Contaminant risks for Kenny Lake Diner - Nitrates and Nitrites

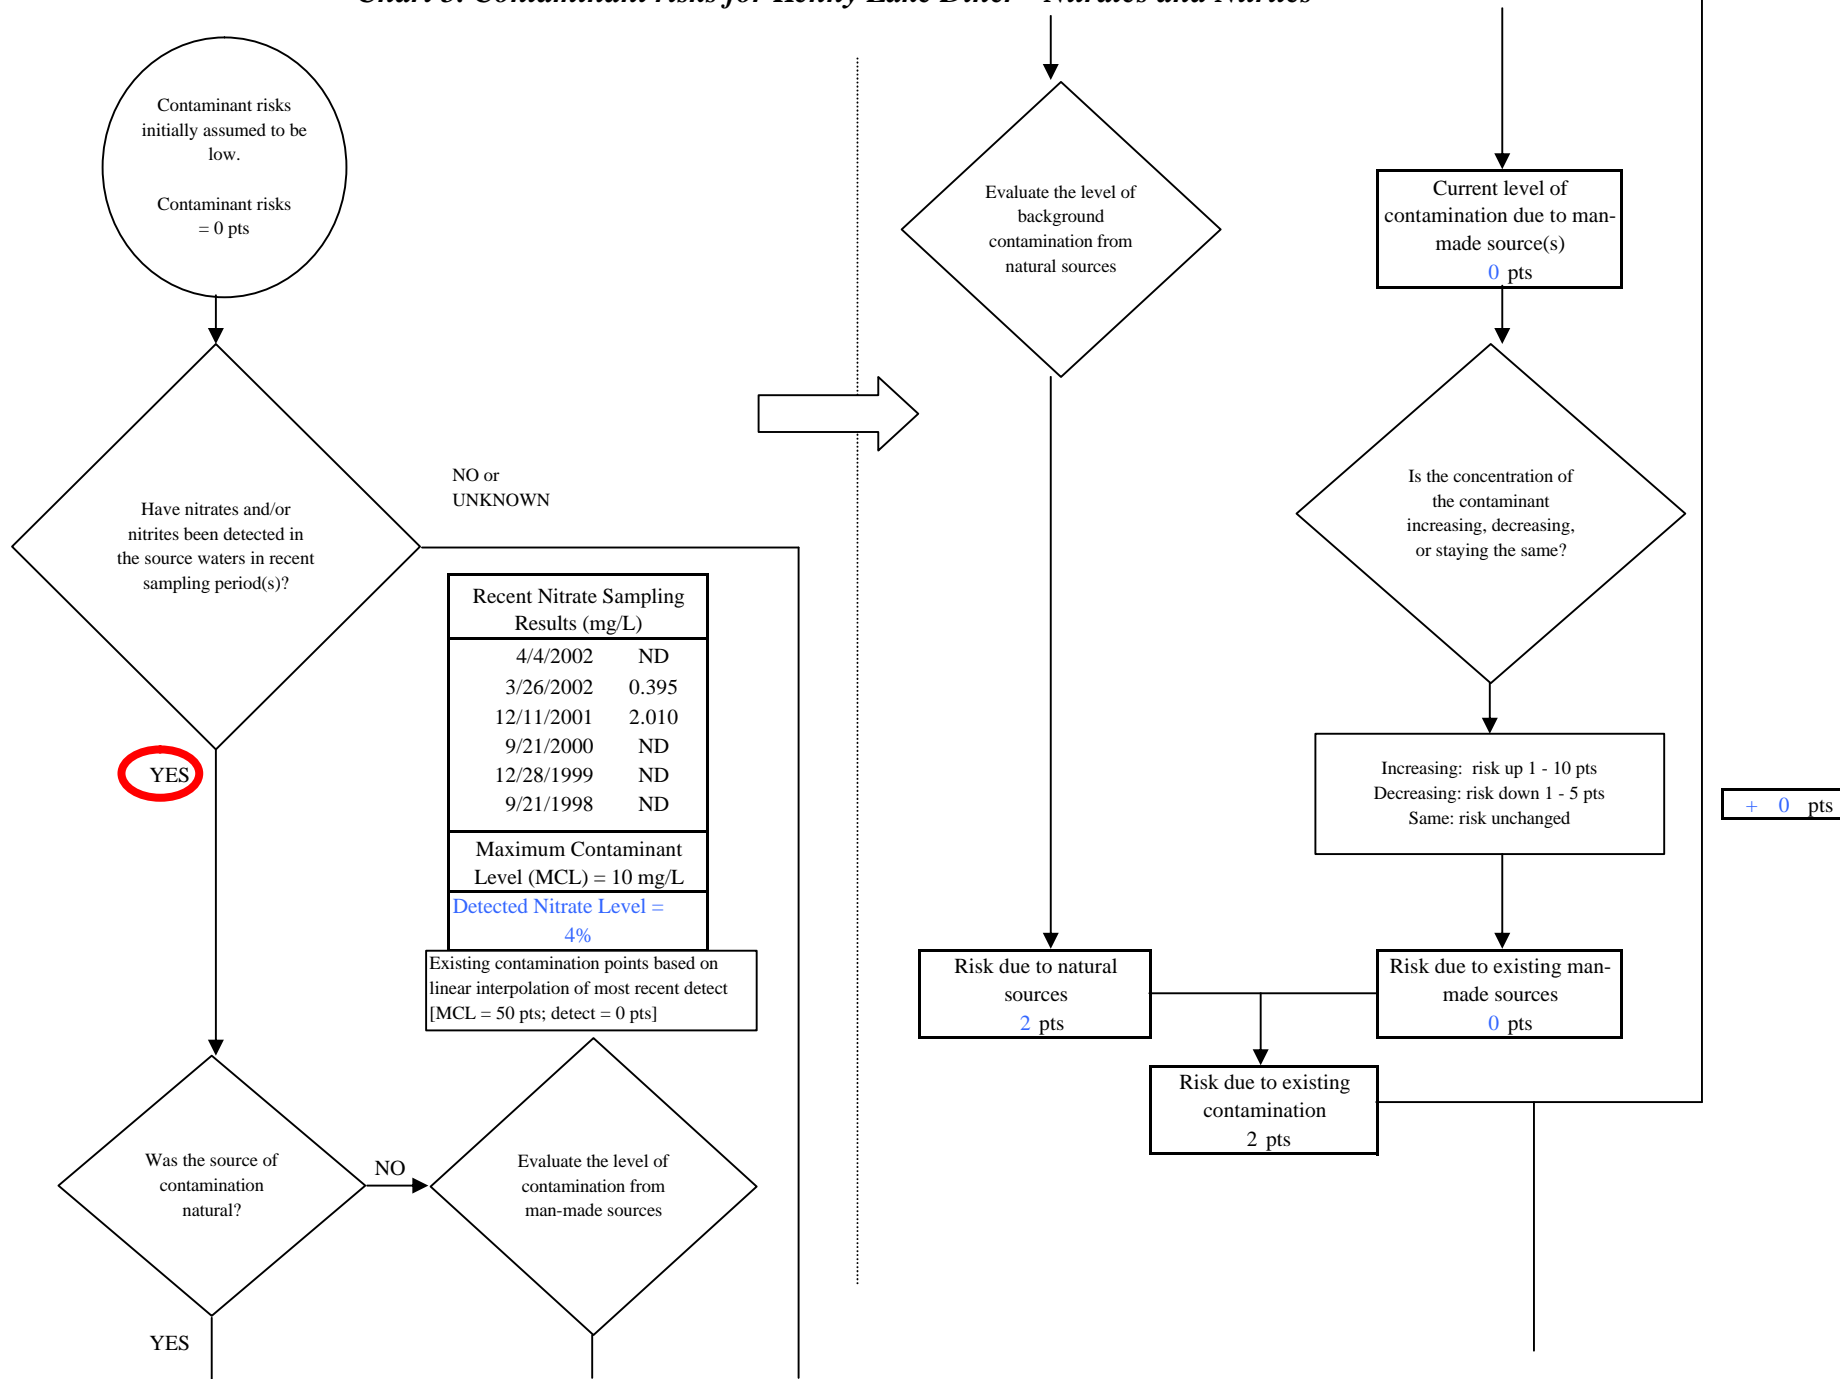


Chart 5. Contaminant risks for Kenny Lake Diner - Nitrates and Nitrites

+ 20 pts

What level of risk is associated with the highest and the next highest risk sources(s) of contaminants identified in Zones A, B and C?

Risk Levels for Contaminant Sources identified in Zones A, B and C			
	Zone A	Zones B&C	Total
Very Highs(s)	0	0	0
High(s)	0	0	0
Medium(s)	0	1	1
Low(s)	1	1	2

	LOW 10 pts	MEDIUM 20 pts	HIGH 30 pts	VERY HIGH 40 pts
LOW	≥ 10 sources + 10 pts	≥ 10 sources + 5 pts	≥ 20 sources + 5 pts	----
MEDIUM	----	≥ 2 sources + 5 pts	≥ 5 sources + 5 pts	≥ 10 sources + 5 pts
HIGH	----	----	≥ 1 source + 10 pts	≥ 2 sources + 10 pts
VERY HIGH	----	----	----	≥ 1 source + 10 pts

Matrix Score 20

Note: Septic systems, sewerlines, and roads are each assigned a risk ranking for each individual contaminant source in the CSI. The VA, however, counts these contaminant sources as a group and assigns a calculated number of either "lows" or "mediums" based on the density.

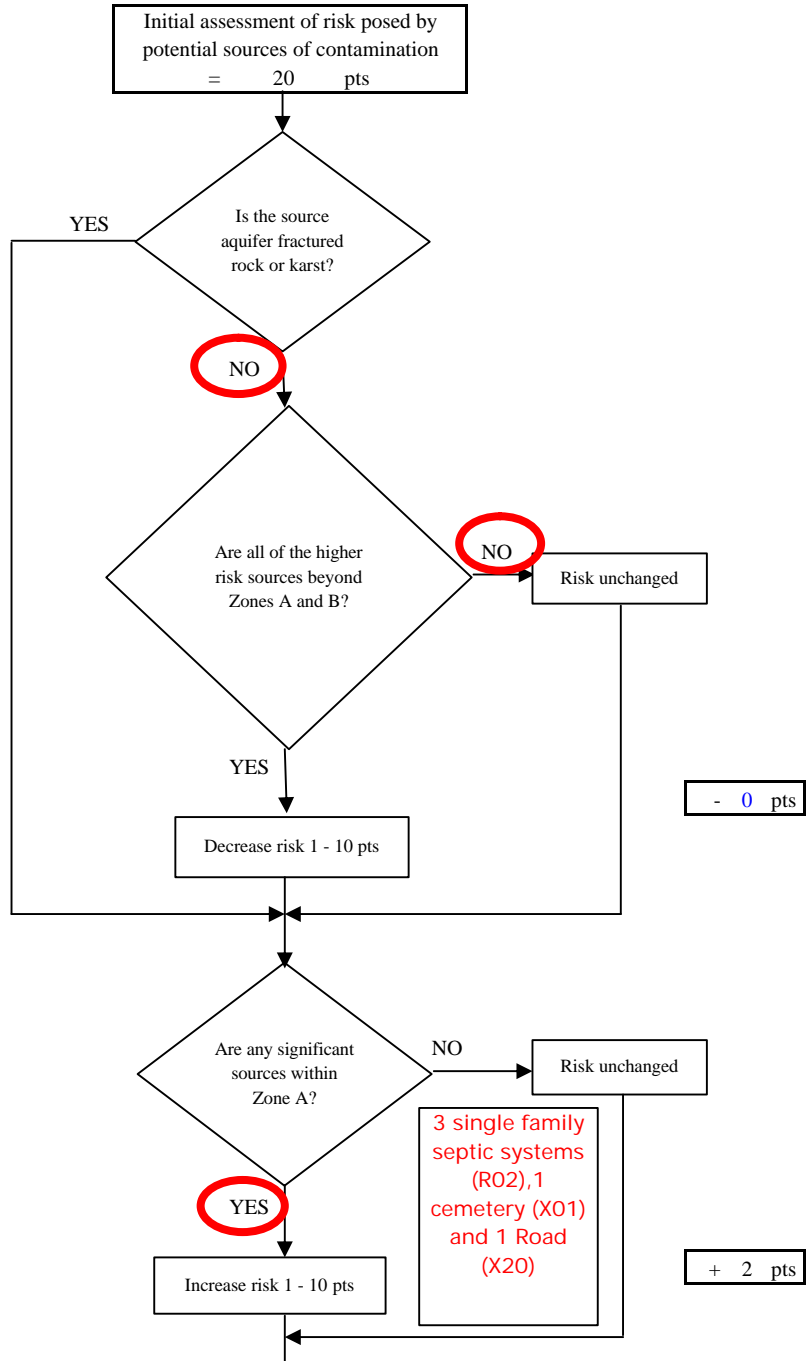


Chart 5. Contaminant risks for Kenny Lake Diner - Nitrates and Nitrites

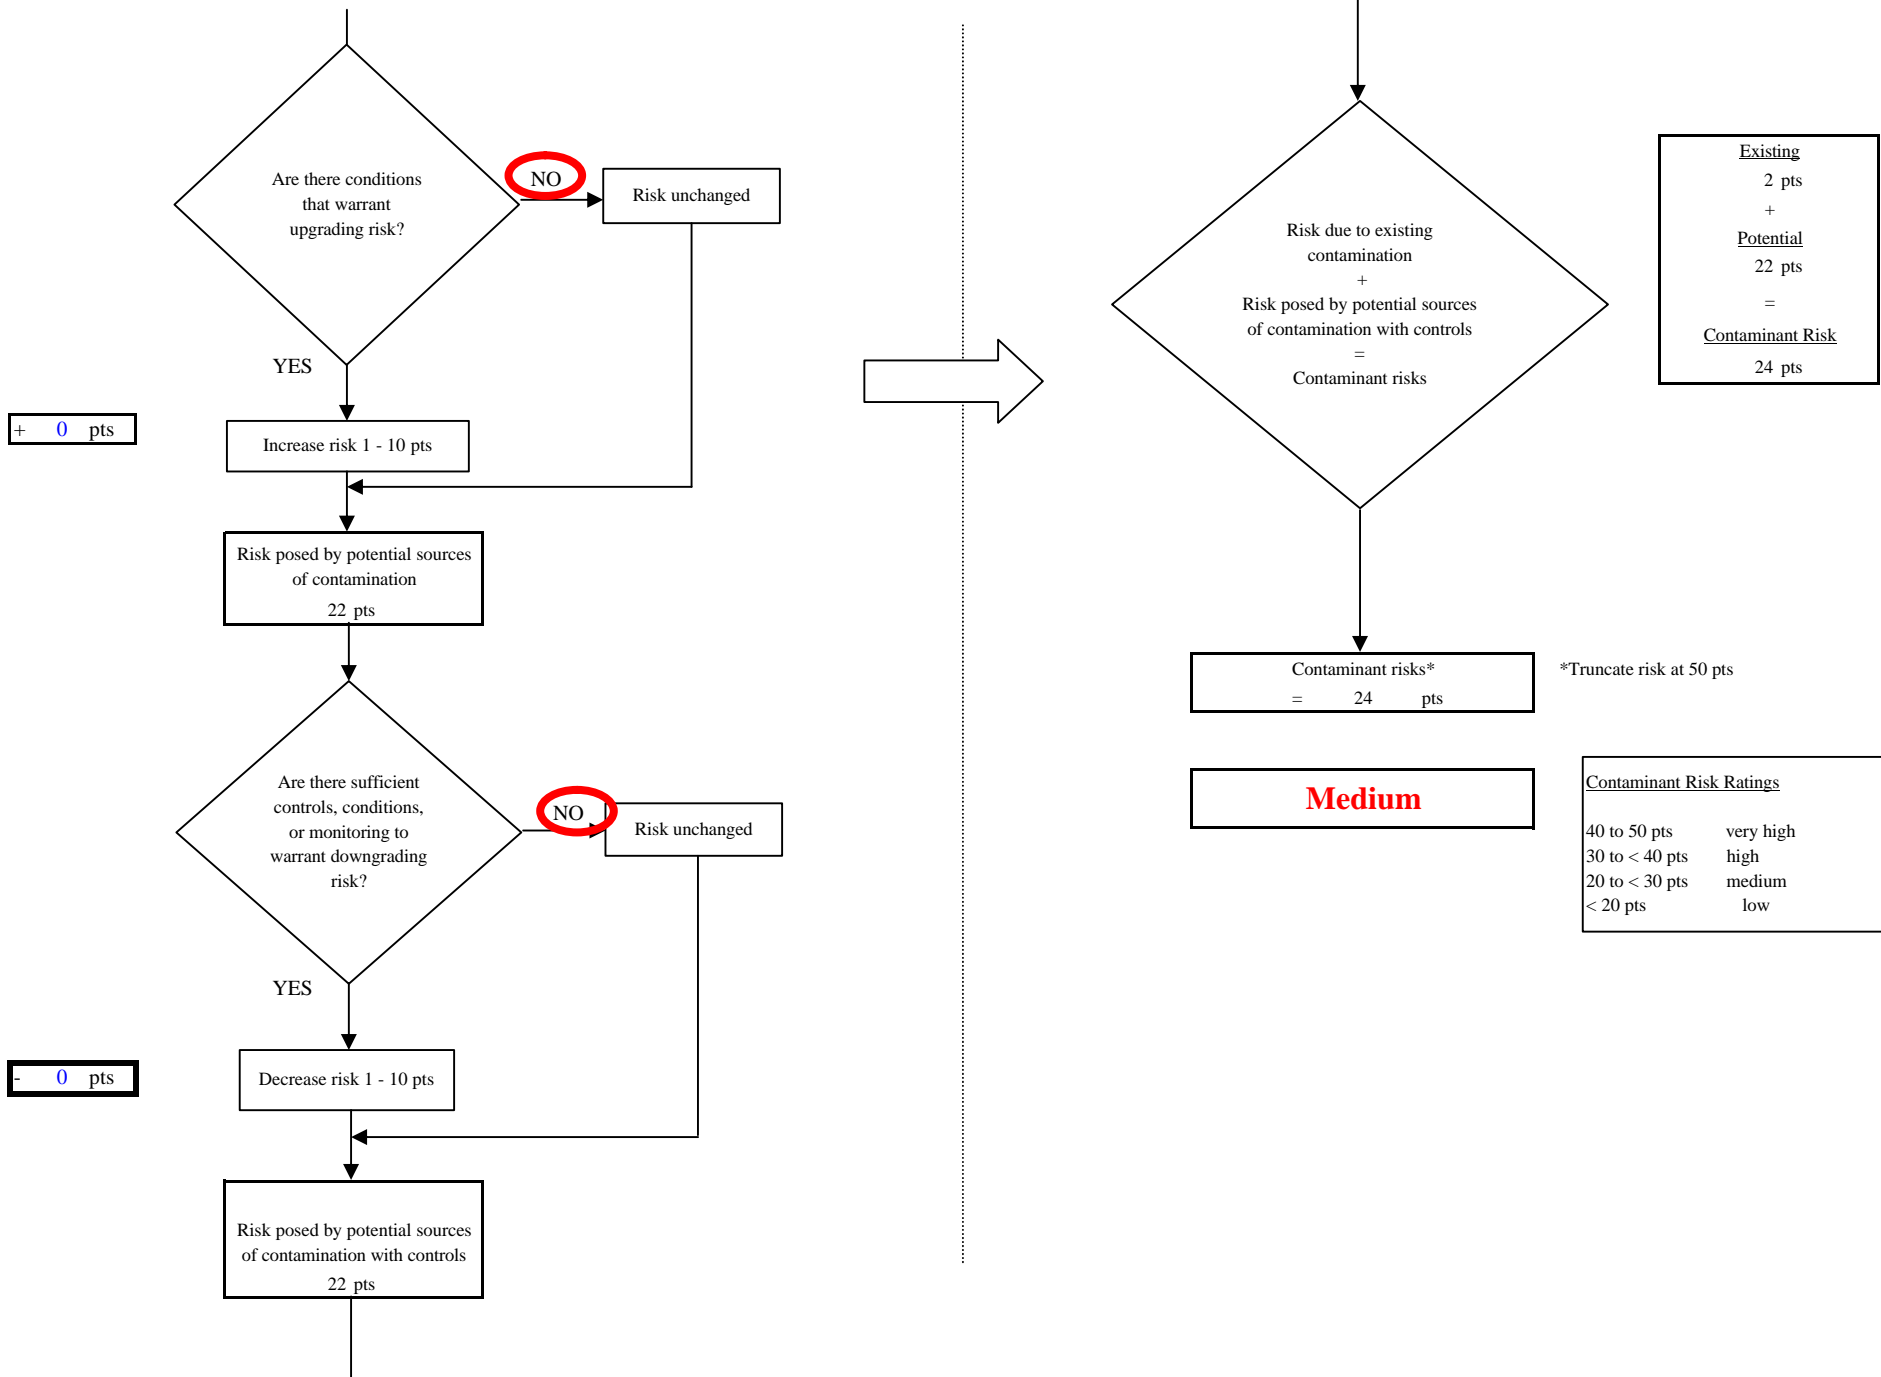


Chart 6. Vulnerability analysis for Kenny Lake Diner - Nitrates and Nitrites

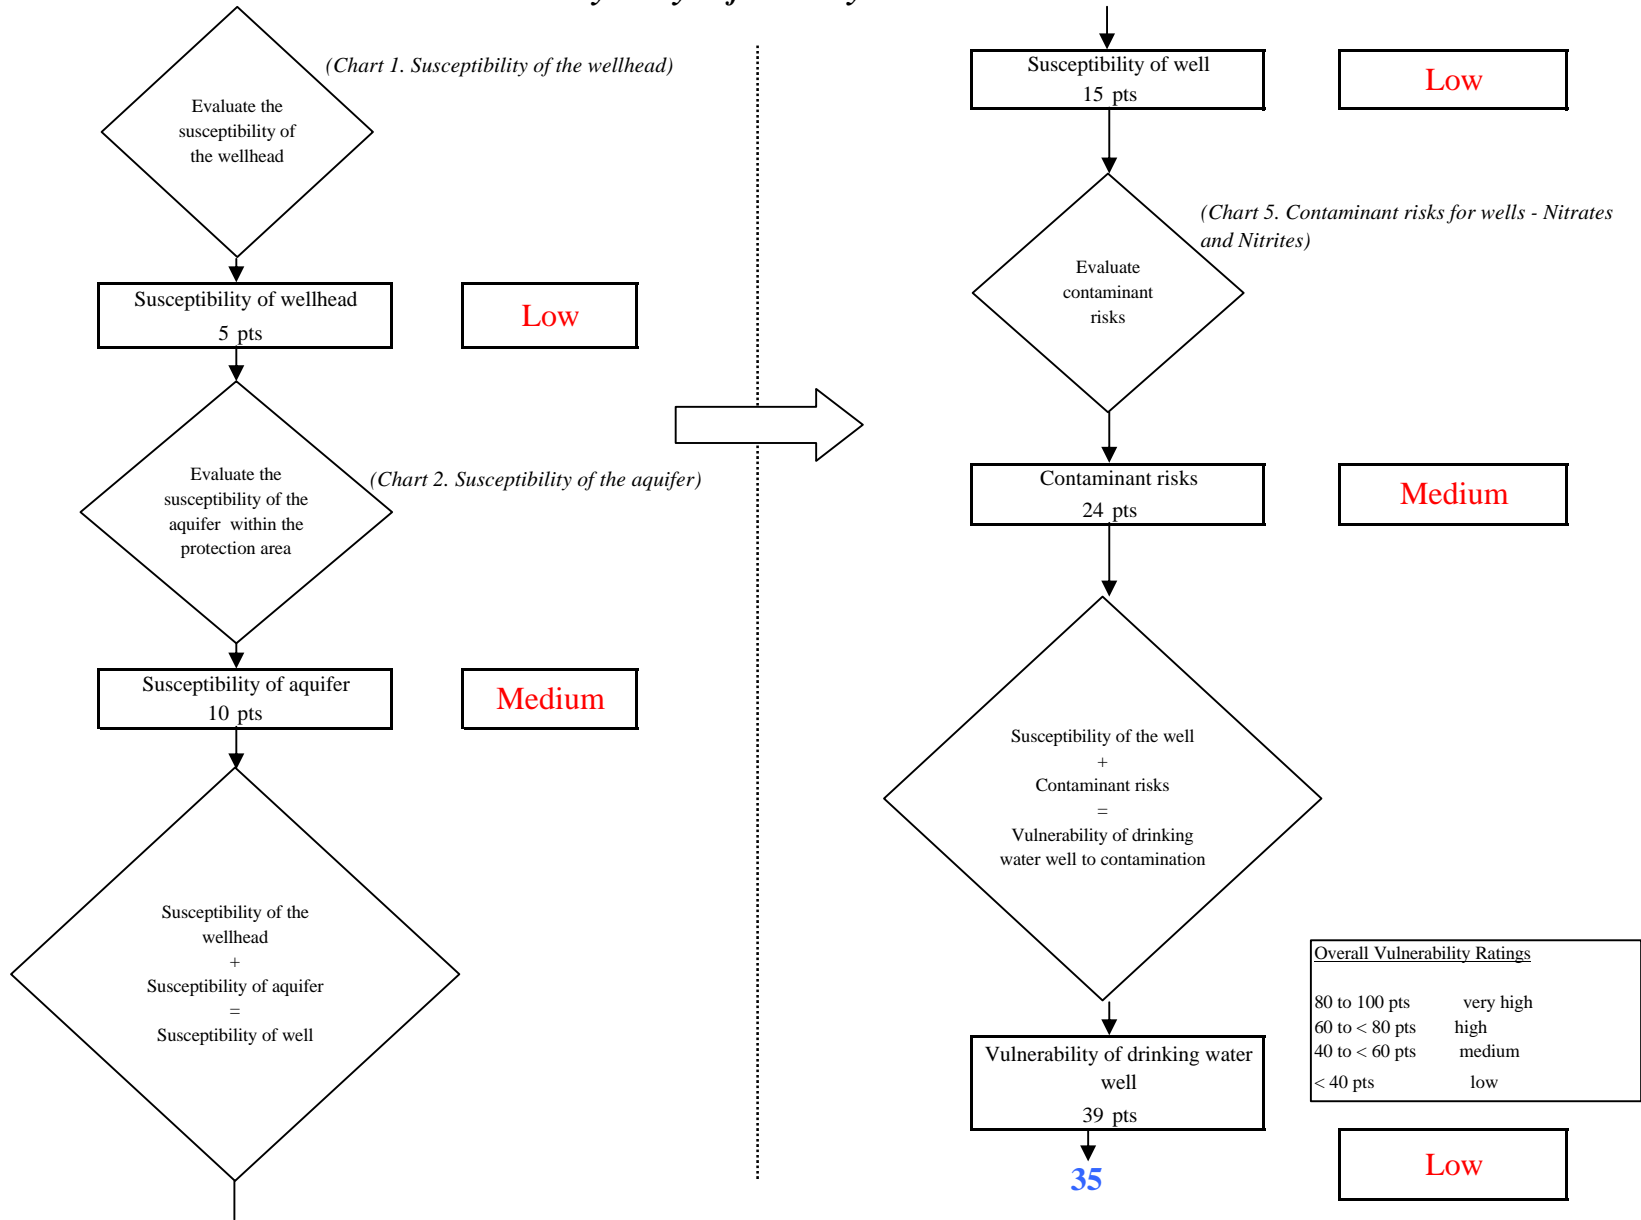


Chart 7. Contaminant risks for Kenny Lake Diner - Volatile Organic Chemicals


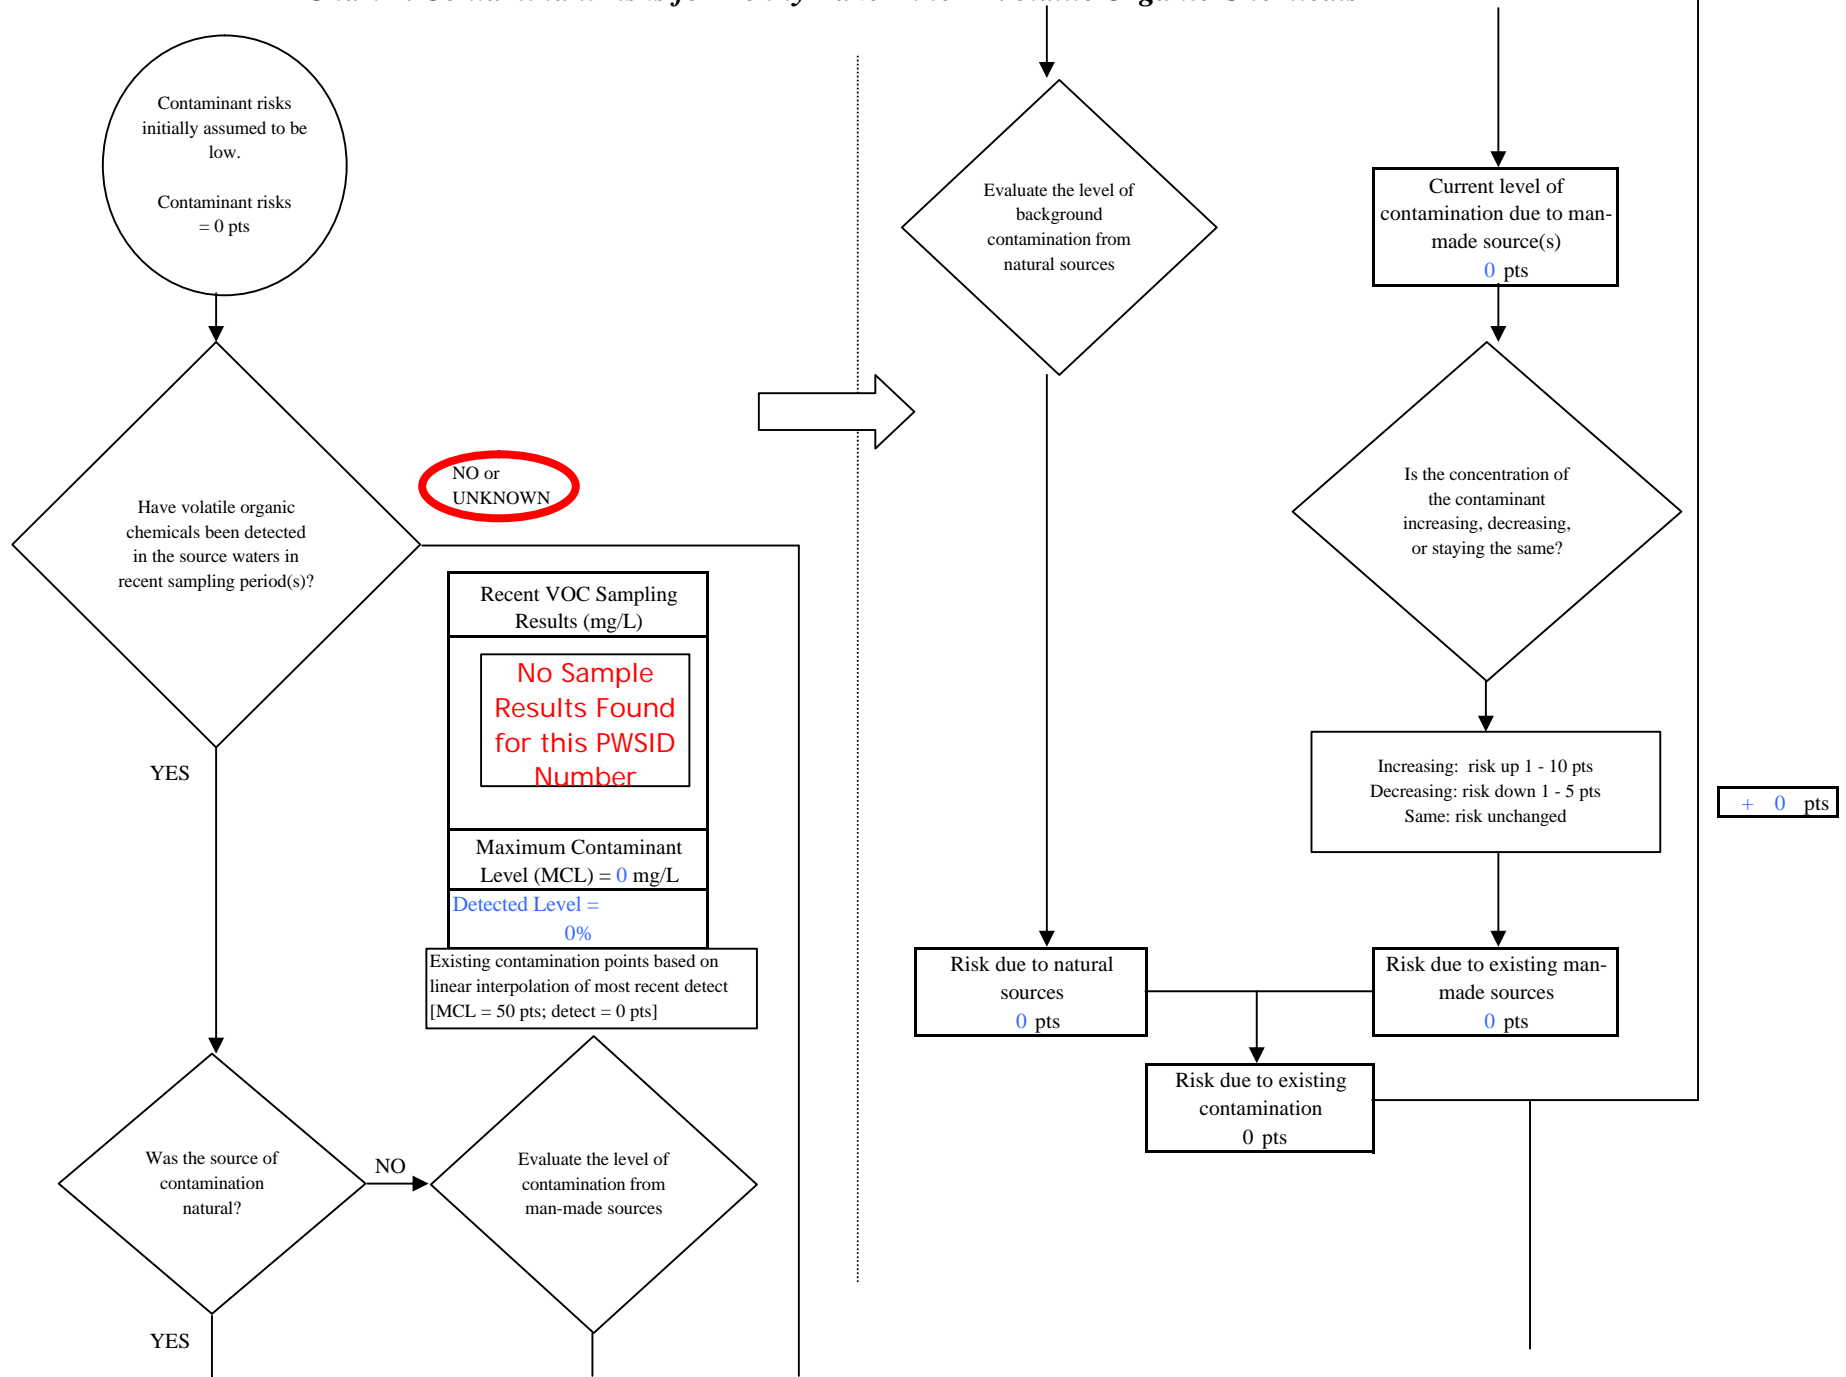


Chart 7. Contaminant risks for Kenny Lake Diner - Volatile Organic Chemicals

+ 25 pts

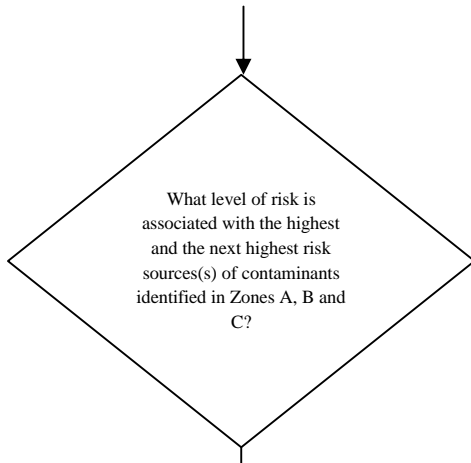

Risk Levels for Contaminant Sources identified in Zones A, B and C			
	Zone A	Zones B&C	Total
Very Highs(s)	0	0	0
High(s)	0	0	0
Medium(s)	0	3	3
Low(s)	1	1	2

	LOW 10 pts	MEDIUM 20 pts	HIGH 30 pts	VERY HIGH 40 pts
LOW	≥ 10 sources + 10 pts	≥ 10 sources + 5 pts	≥ 20 sources + 5 pts	----
MEDIUM	----	≥ 2 sources + 5 pts	≥ 5 sources + 5 pts	≥ 10 sources + 5 pts
HIGH	----	----	≥ 1 source + 10 pts	≥ 2 sources + 10 pts
VERY HIGH	----	----	----	≥ 1 source + 10 pts

Matrix Score 25

Note: Septic systems, sewerlines, and roads are each assigned a risk ranking for each individual contaminant source in the CSI. The VA, however, counts these contaminant sources as a group and assigns a calculated number of either "lows" or "mediums" based on the density.

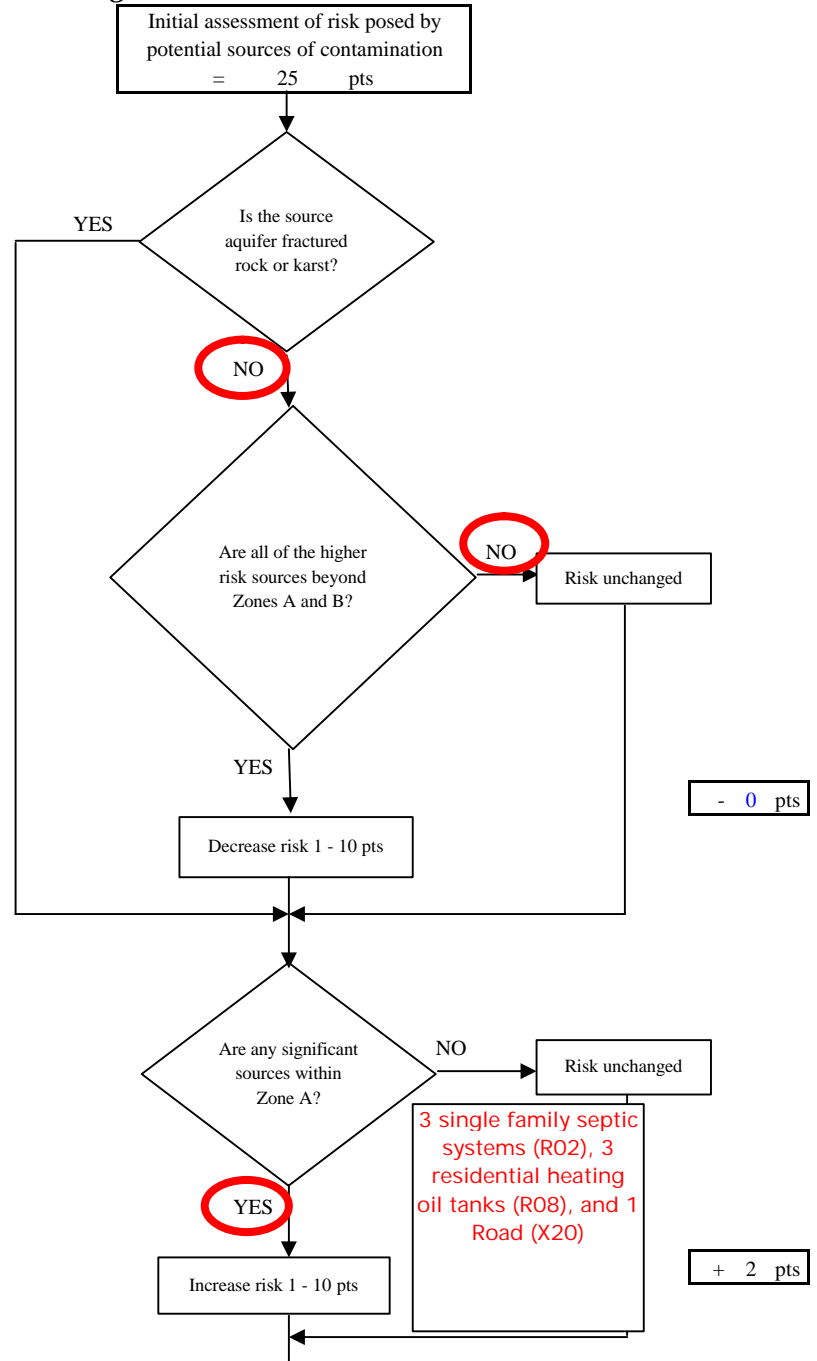



Chart 7. Contaminant risks for Kenny Lake Diner - Volatile Organic Chemicals

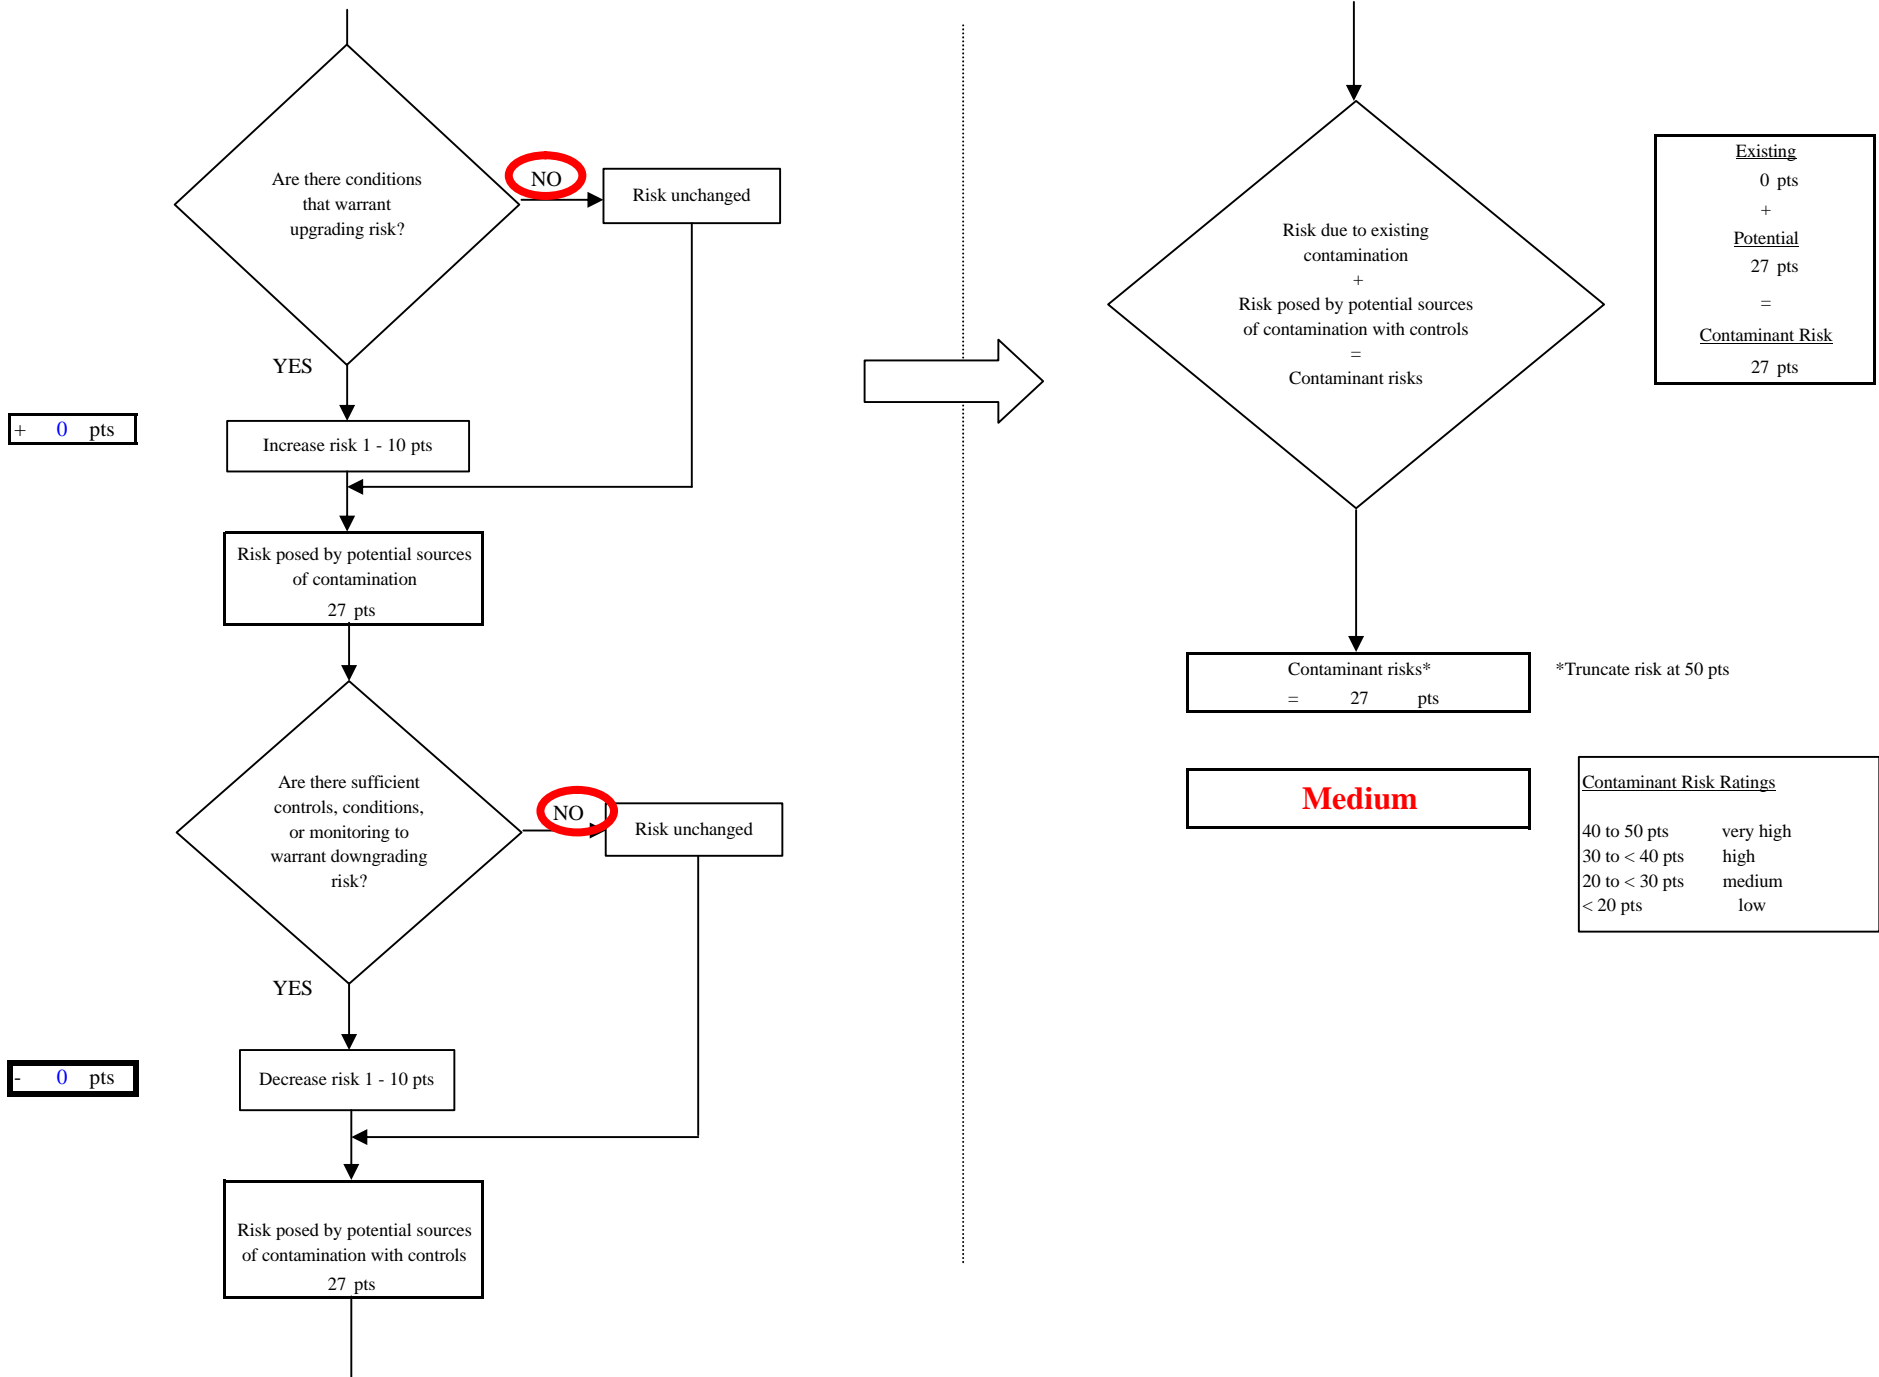


Chart 8. Vulnerability analysis for Kenny Lake Diner - Volatile Organic Chemicals

