



Source Water Assessment

A Hydrogeologic Susceptibility and
Vulnerability Assessment for
Bay View Terrace
Drinking Water System,
Dillingham, Alaska

PWSID # 261460.001

April 2004

DRINKING WATER PROTECTION PROGRAM REPORT 1062
Alaska Department of Environmental Conservation

Source Water Assessment for Bay View Terrace Drinking Water System Dillingham, Alaska

PWSID # 261460.001

DRINKING WATER PROTECTION PROGRAM REPORT 1062

The Drinking Water Protection Program (DWPP) is producing Source Water Assessments in compliance with the Safe Drinking Water Act Amendments of 1996. Each assessment includes a delineation of the source water area, an inventory of potential and existing contaminant sources that may impact the water, a risk ranking for each of these contaminants, and an evaluation of the potential vulnerability of these drinking water sources.

These assessments are intended to provide public water systems owners/operators, communities, and local governments with the best available information that may be used to protect the quality of their drinking water. The assessments combine information obtained from various sources, including the U.S. Environmental Protection Agency, Alaska Department of Environmental Conservation (ADEC), public water system owners/operators, and other public information sources. The results of this assessment are subject to change if additional data becomes available. It is anticipated this assessment will be updated every five years to reflect any changes in the vulnerability and/or susceptibility of public drinking water source. If you have any additional information that may affect the results of this assessment, please contact the Program Coordinator of DWPP, (907) 269-7521.

CONTENTS

EXECUTIVE SUMMARY.....	1	INVENTORY OF POTENTIAL AND EXISTING	
PUBLIC DRINKING WATER SYSTEM	1	CONTAMINANT SOURCES	2
DRINKING WATER PROTECTION AREA	2	RANKING OF CONTAMINANT RISKS	2
		VULNERABILITY OF DRINKING WATER	
		SYSTEM	3

TABLES

Table 1. Definition of Zones.....	2
Table 2. Susceptibility	3
Table 3. Contaminant Risks.....	4
Table 4. Overall Vulnerability.....	4

APPENDICES

APPENDIX	A. Bay View Terrace Drinking Water Protection Area (Map A)
	B. Contaminant Source Inventory for Bay View Terrace (Table 1)
	Contaminant Source Inventory and Risk Ranking for Bay View Terrace –
	Bacteria and Viruses (Table 2)
	Contaminant Source Inventory and Risk Ranking for Bay View Terrace –
	Nitrates/Nitrites (Table 3)
	Contaminant Source Inventory and Risk Ranking for Bay View Terrace –
	Volatile Organic Chemicals (Table 4)
	Contaminant Source Inventory and Risk Ranking for Bay View Terrace –
	Heavy Metals, Cyanide and Other Inorganic Chemicals (Table 5)
	Contaminant Source Inventory and Risk Ranking for Bay View Terrace –
	Synthetic Organic Chemicals (Table 6)
	Contaminant Source Inventory and Risk Ranking for Bay View Terrace –
	Other Organic Chemicals (Table 7)
	C. Bay View Terrace Drinking Water Protection Area and Potential
	and Existing Contaminant Sources (Map C)
	D. Vulnerability Analysis for Contaminant Source Inventory and Risk Ranking for
	Bay View Terrace Public Drinking Water Source (Charts 1 – 14)

Source Water Assessment for Bay View Terrace Source of Public Drinking Water, Dillingham, Alaska

Drinking Water Protection Program Alaska Department of Environmental Conservation

EXECUTIVE SUMMARY

The Bay View Terrace has one Public Water System (PWS) well. The date of well construction is unknown; however it is assumed that the well (PWS No. 261460.001) has been used as a drinking water source since that time.

The well is a Class A (community and non-transient non-community) water system located on Fairview Drive, near the airport, in Dillingham, Alaska. Available records indicate that there is no secondary storage of drinking water, other than the pressure tank, and that the untreated drinking water source is derived directly from the wellhead. This system operates year round and serves approximately 120 residents through ten service connections. The wellhead received a susceptibility rating of **Very High** and the aquifer received a susceptibility rating of **Very High**. Combining these two ratings produce a **Very High** rating for the natural susceptibility of the well.

Identified potential and current sources of contaminants for the public drinking water source include: large capacity septic systems, meat processing, seafood processing, aboveground fuel tanks, underground fuel tanks, wastewater holding tanks, ADEC recognized contaminated sites and leaking underground storage tank (LUST) sites, water supply wells, an airport, motor vehicle/general storage yards/facilities, Laundromats, a cemetery, a firehouse, a motor/motor vehicle repair shop, and an injection well. These identified potential and existing sources of contamination are considered as sources of bacteria and viruses, nitrates and/or nitrites, volatile organic chemicals, heavy metals, cyanide and other inorganic chemicals, synthetic organic chemicals, and other organic chemicals contaminant categories.

Overall, the water well received a vulnerability rating of **Very High** for bacteria and viruses, nitrates and nitrites, volatile organic chemicals, heavy metals, cyanide and other inorganic chemicals, and other organic chemicals, and a vulnerability rating of **High** for synthetic organic chemicals.

PUBLIC DRINKING WATER SYSTEM

The Bay View Terrace well is a Class A (community/non-transient/non-community) public water system. The system is located on Fairview Drive, near the airport, in Dillingham, Alaska (Sec. 20, T13S, R55W, Seward Meridian; see Map A of Appendix A). Dillingham is located at the extreme northern end of Nushagak Bay in northern Bristol Bay, at the confluence of the Wood and Nushagak Rivers. The city is located 327 miles southwest of Anchorage and 175 miles southeast of Bethel. The community has a population of 2,475 (ADCED, 2003). Average annual precipitation in Dillingham is 26 inches, including approximately 65 inches of snowfall. Temperatures range from 37 to 66°F in summer and 4 to 30°F in winter.

The community of Dillingham obtains most of their water supply from three City wells. Approximately 60% of the community uses individual wells. The core town-site is served by a piped sewage collection system and the remaining households have individual septic tanks (ADCED, 2003). Dillingham receives electrical power from Nushagak Electric. Power generating facilities are fueled by diesel. Refuse is collected by Dillingham Refuse, Inc., a private firm, and transported to the landfill (ADCED, 2003).

According to information supplied by the well owner for the Bay View Terrace PWS, the depth of the primary water well is 32 feet below the ground surface. Well construction details are unknown; however it is assumed that the well is screened in an unconfined aquifer based on available construction details for surrounding wells. The well is not located within a floodplain.

Information acquired from a June 2001 sanitary survey for the public water system indicated that the land surface was not sloped away from the well. Generally, land surfaces that slope away from the wellhead promote surface water drainage, which reduces the potential of contaminant migration down the well casing annulus. The sanitary survey indicates that the well is not grouted according to

ADEC regulations. Proper grouting provides added protection against contaminants traveling along the well casing annulus and into source waters.

The entire Bristol Bay area was formerly covered by glaciers and the topography is representative of a postglacial area. Soils information is limited. Generally, the soils consist of silty sand overlying relatively clean sand. The silty soils are slightly frost-susceptible. Isolated pockets of permafrost are scattered throughout the area (DOWL, 1982).

DRINKING WATER PROTECTION AREA

In order to evaluate whether a drinking water source is at risk, we must first evaluate what are the most likely pathways for surface contamination to reach the groundwater. These areas are determined by looking at the characteristics of the soil, groundwater, aquifer, and well.

The most probable area for contamination to reach the drinking water well is the area that contributes water to the well, the groundwater recharge area. This area is designated as the drinking water protection area (DWPA). Because releases of contaminants within the protection area are most likely to impact the drinking water well, this area will serve as the focus for voluntary protection efforts. An analytical calculation was used to determine the size and shape of the DWPA for the Bay View Terrace PWS. The input parameters describing the attributes of the aquifer in this calculation were adopted from Groundwater (Freeze and Cherry, 1979). Available geology and groundwater contours were also considered to take into account any uncertainties in groundwater flow and aquifer characteristics to arrive at a meaningful protection area.

The protection areas established for wells by the ADEC are usually separated into four zones, limited by the watershed. These zones correspond to differences in the time-of-travel (TOT) of the water moving through the aquifer to the well (Please refer to the Guidance Manual for Class A Public Water Systems for additional information).

The time of travel for contaminants within the water varies and is dependent on the physical and chemical characteristics of each contaminant. The following is a summary of the four protection area zones for wells and the calculated time -of-travel for each:

Table 1. Definition of Zones

Zone	Definition
A	¼ the distance for the 2-yr. time -of-travel
B	Less than the 2 year time-of-travel
C	Less Than the 5 year time -of-travel
D	Less than the 10 year time -of-travel

The DWPA for the Bay View Terrace PWS was determined using an analytical calculation and includes Zones A, B, C, and D (See Map A of Appendix A).

INVENTORY OF POTENTIAL AND EXISTING CONTAMINANT SOURCES

The Drinking Water Protection Program has completed an inventory of potential and existing sources of contamination within the Bay View Terrace DWPA. This inventory was completed through a search of agency records and other publicly available information. Potential sources of contamination to the drinking water aquifer include a wide range of categories and types. Potential drinking water contaminants are found within agricultural, residential, commercial, and industrial areas, but can also occur within areas that have little or no development.

For the basis of all Class A public water system assessments, six categories of drinking water contaminants were inventoried. They include:

- Bacteria and viruses,
- Nitrates and/or nitrites,
- Volatile organic chemicals,
- Heavy metals, cyanide and other inorganic chemicals,
- Synthetic organic chemicals,
- Other organic chemicals.

The sources are displayed on Map C of Appendix C and summarized in Table 1 of Appendix B.

RANKING OF CONTAMINANT RISKS

Once the potential and existing sources of contamination have been identified, they are assigned a ranking according to what type and level of risk they represent. Ranking of contaminant risks for a “potential” or “existing” source of contamination is a function of toxicity and volumes of specific contaminants associated with that source. Rankings include:

- Low,
- Medium,
- High, and
- Very High.

The time-of-travel for contaminants within the water varies and is dependent on the physical and chemical characteristics of each contaminant. Bacteria and Viruses are only inventoried in Zones A and B because of their short life span. Only “Very High” and “High” rankings are inventoried within the outer Zone D due to the probability of contaminant dilution by the time the contaminants get to the well. Tables 2 through 4 in Appendix B contain the ranking of potential and existing sources of contamination with respect to bacteria and viruses, nitrates and/or nitrites, volatile organic chemicals, heavy metals, cyanide and other inorganic chemicals, synthetic organic chemicals, and other organic chemicals.

VULNERABILITY OF THE DRINKING WATER SYSTEM

Vulnerability of a drinking water source to contamination is a combination of two factors:

- Natural susceptibility, and
- Contaminant risks.

Appendix D contains fourteen charts, which together form the ‘Vulnerability Analysis’ for a source water assessment for a public drinking water source. Chart 1 analyzes the ‘Susceptibility of the Wellhead’ to contamination by looking at the construction of the well and its surrounding area. Chart 2 analyzes the ‘Susceptibility of the Aquifer’ to contamination by looking at the naturally occurring attributes of the water source and influences on the groundwater system that might lead to contamination. Chart 3 analyzes ‘Contaminant Risks’ for the drinking water source with respect to bacteria and viruses. The ‘Contaminant Risks’ portion of the analysis considers potential sources of contaminants as well as a review of contamination that has or may have occurred, but has not arrived or been detected at the well. Chart 4 contains the ‘Vulnerability Analysis for Bacteria and Viruses’. Charts 5 through 14 contain the Contaminant Risks and Vulnerability Analyses for nitrates and nitrites, volatile organic chemicals, heavy metals, cyanide and other inorganic chemicals, synthetic organic chemicals, and other organic chemicals, respectively.

A score for the Natural Susceptibility is reached by considering the properties of the well and the aquifer.

Susceptibility of the Wellhead (0 – 25 Points)
(Chart 1 of Appendix D)

+

Susceptibility of the Aquifer (0 – 25 Points)
(Chart 2 of Appendix D)

=

Natural Susceptibility (Susceptibility of the Well)
(0 – 50 Points)

A ranking is assigned for the Natural Susceptibility according to the point score:

Natural Susceptibility Ratings	
40 to 50 pts	Very High
30 to < 40 pts	High
20 to < 30 pts	Medium
< 20 pts	Low

The Bay View Terrace’s water well is in an unconfined aquifer. Unconfined aquifers are more susceptible to potential groundwater quality impacts posed by the migration of surface water contaminants downward from the surface. Table 2 shows the susceptibility scores and ratings for this PWS.

Table 2. Susceptibility

	Score	Rating
Susceptibility of the Wellhead	25	Very High
Susceptibility of the Aquifer	23	Very High
Natural Susceptibility	48	Very High

Contaminant risks to a drinking water source depend on the type, number or density, and distribution of contaminant sources. This score has been derived from an examination of existing and historical contamination that has been detected at the drinking water source through routine sampling. It also evaluates potential sources of contamination. Flow charts are used to assign a point score, and ratings are assigned in the same way as for the natural susceptibility:

Contaminant Risk Ratings	
40 to 50 pts	Very High
30 to < 40 pts	High
20 to < 30 pts	Medium
< 20 pts	Low

Table 3 summarizes the Contaminant Risks for each category of drinking water contaminants.

Table 3. Contaminant Risks

Category	Score	Rating
Bacteria and Viruses	40	Very High
Nitrates and/or Nitrites	50	Very High
Volatile Organic Chemicals	50	Very High
Heavy Metals, Cyanide and		
Other Inorganic Chemicals	36	High
Synthetic Organic Chemicals	25	Medium
Other Organic Chemicals	35	High

Finally, an overall vulnerability score is assigned for each water system by combining each of the contaminant risk scores with the natural susceptibility score:

$$\begin{array}{r}
 \text{Natural Susceptibility (0 – 50 points)} \\
 + \\
 \text{Contaminant Risks (0 – 50 points)} \\
 = \\
 \text{Vulnerability of the} \\
 \text{Drinking Water Source to Contamination (0 – 100).}
 \end{array}$$

Again, rankings are assigned according to a point score:

Overall Vulnerability Ratings	
80 to 100 pts	Very High
60 to < 80 pts	High
40 to < 60 pts	Medium
< 40 pts	Low

Table 4 contains the overall vulnerability scores (0 – 100) and ratings for each of the six categories of drinking water contaminants. Note: scores are rounded off to the nearest five.

Table 4. Overall Vulnerability

Category	Score	Rating
Bacteria and Viruses	90	Very High
Nitrates and Nitrites	100	Very High
Volatile Organic Chemicals	100	Very High
Heavy Metals, Cyanide and		
Other Inorganic Chemicals	85	Very High
Synthetic Organic Chemicals	75	High

Other Organic Chemicals 85 Very High

Bacteria and Viruses

The contaminant risk for bacteria and viruses is **Very High**. The risk is primarily attributed to the presence of a large capacity septic system in Zone A (see Table 2 – Appendix B).

No positive bacteria counts have been reported in recent (within five years) sampling events (See Chart 3 – Contaminant Risks for Bacteria and Viruses in Appendix D). Only a small amount of bacteria and viruses are required to endanger public health.

After combining the contaminant risk for bacteria and viruses with the natural susceptibility of the well, the overall vulnerability of the well to contamination is **Very High**.

Nitrates and Nitrites

The contaminant risk for nitrates and nitrites is **Very High**. The risk to this source of public drinking water is primarily attributed to the presence of a large capacity septic system in Zone A (see Table 3 – Appendix B).

Nitrates are very mobile, moving at approximately the same rate as water. The sampling history for this well indicates that moderate levels of nitrates have been detected in recent sampling events. However, the reported concentrations of nitrates do not exceed the maximum contaminant level (MCL) of 10 mg/L. Nitrate concentrations in uncontaminated groundwater are typically less than 2 mg/L; therefore, nitrate concentrations above 2 mg/L may be indicative of man-made sources (See Chart 5 - Contaminant Risks for Nitrates and/or Nitrites in Appendix D).

Nitrate levels are often derived from the decomposition of organic matter in soils. Although the nitrate source is unknown, such occurrences may be attributed to septic systems or other sources. After combining the contaminant risk for nitrates and nitrites with the natural susceptibility of the well, the overall vulnerability of the well to nitrate and nitrite contamination is **Very High**.

Volatile Organic Chemicals

The contaminant risk for volatile organic chemicals is **Very High**. The risk is primarily attributed to the presence of ADEC contaminated sites and LUST sites, underground fuel tanks, an injection well, and an airport located in Zones A, B, and D. Numerous other potential contaminant sources are also found

within the protection area (see Table 4 – Appendix B).

No recent sampling data was available in ADEC records for Bay View Terrace (See Chart 7 – Contaminant Risks for Volatile Organic Chemicals in Appendix D).

After combining the contaminant risk for volatile organic chemicals with the natural susceptibility of the well, the overall vulnerability of the well to contamination is **Very High**.

Heavy Metals, Cyanide and Other Inorganic Chemicals

The contaminant risk for heavy metals, cyanide and other inorganic chemicals is **High**. The risk is primarily attributed to the presence of an injection well located in Zone D. Numerous other potential contaminant sources are also found within the protection area (see Table 5 – Appendix B).

Based on review of recent sampling records for this public water system, moderate levels of copper and lead have been detected, but have not exceeded their respective MCLs of 1.3 mg/L and 0.015 mg/L (see Chart 9 – Contaminant Risks for Heavy Metals, Cyanide, and Other Inorganic Chemicals in Appendix D).

The reported concentrations of copper and lead in recent sampling events are not likely to be representative of source water conditions. These two analytes are likely attributed to either the water treatment process or water distribution network; therefore, no risk points were assigned based on the presence of these analytes.

After combining the contaminant risk for heavy metals, cyanide and other inorganic chemicals with the natural susceptibility of the well, the overall vulnerability of the well to contamination is **Very High**.

Synthetic Organic Chemicals

The contaminant risk for synthetic organic chemicals is **Medium**. The risk is primarily attributed to the presence of a cemetery and an airport in Zones A and B. Numerous potential contaminant sources are found within the protection area (see Table 6 – Appendix B).

No recent sampling data was available in ADEC records for Bay View Terrace (See Chart 11 – Contaminant Risks for Synthetic Organic Chemicals in Appendix D).

After combining the contaminant risk for synthetic organic chemicals with the natural susceptibility of the well, the overall vulnerability of the well to contamination is **High**.

Other Organic Chemicals

The contaminant risk for other organic chemicals is **High**. The risk is primarily attributed to the presence of wastewater holding tanks and an airport located in Zones A and B. Numerous other potential contaminant sources are also found within the protection area (see Table 7 – Appendix B).

No recent sampling data was available in ADEC records for the Bay View Terrace (See Chart 13 – Contaminant Risks for Other Organic Chemicals in Appendix D).

After combining the contaminant risk for other organic chemicals with the natural susceptibility of the well, the overall vulnerability of the well to contamination is **Very High**.

Using the Source Water Assessment

This assessment of contaminant risks can be used as a foundation for local voluntary protection efforts as well as a basis for the continuous efforts on the part of Bay View Terrace and the community of Dillingham to protect public health. It is anticipated that Source Water Assessments will be updated every five years to reflect any changes in the vulnerability and/or susceptibility of the drinking water source.


REFERENCES

- Alaska Department of Community and Economic Development (ADCED), 2003 [WWW document]. URL: http://www.dced.state.ak.us/cbd/commdb/CF_COMDB.htm
- Alaska Department of Environmental Conservation, Contaminated Sites Database, 2003 [WWW database], URL http://www.state.ak.us/dec/dspar/csites/cs_search.htm
- Alaska Department of Environmental Conservation, Leaking Underground Storage Tank Database, 2003 [WWW database], URL http://www.dec.state.ak.us/spar/stp/ust/search/fac_search.asp
- DOWL Engineers (DOWL), 1982, Upper Bristol Bay Region Community Planning Profiles.
- Freeze, R. A., and Cherry, J.A. 1979, Groundwater, Prentice-Hall, Englewood Cliffs, New Jersey
- United States Environmental Protection Agency (EPA), 2002 [WWW document]. URL <http://www.epa.gov/safewater/mcl.html>.

APPENDIX A

Drinking Water Protection Area Location Map (Map A)

Public Water Well System for PWS #261460.001 Bayview Terrace

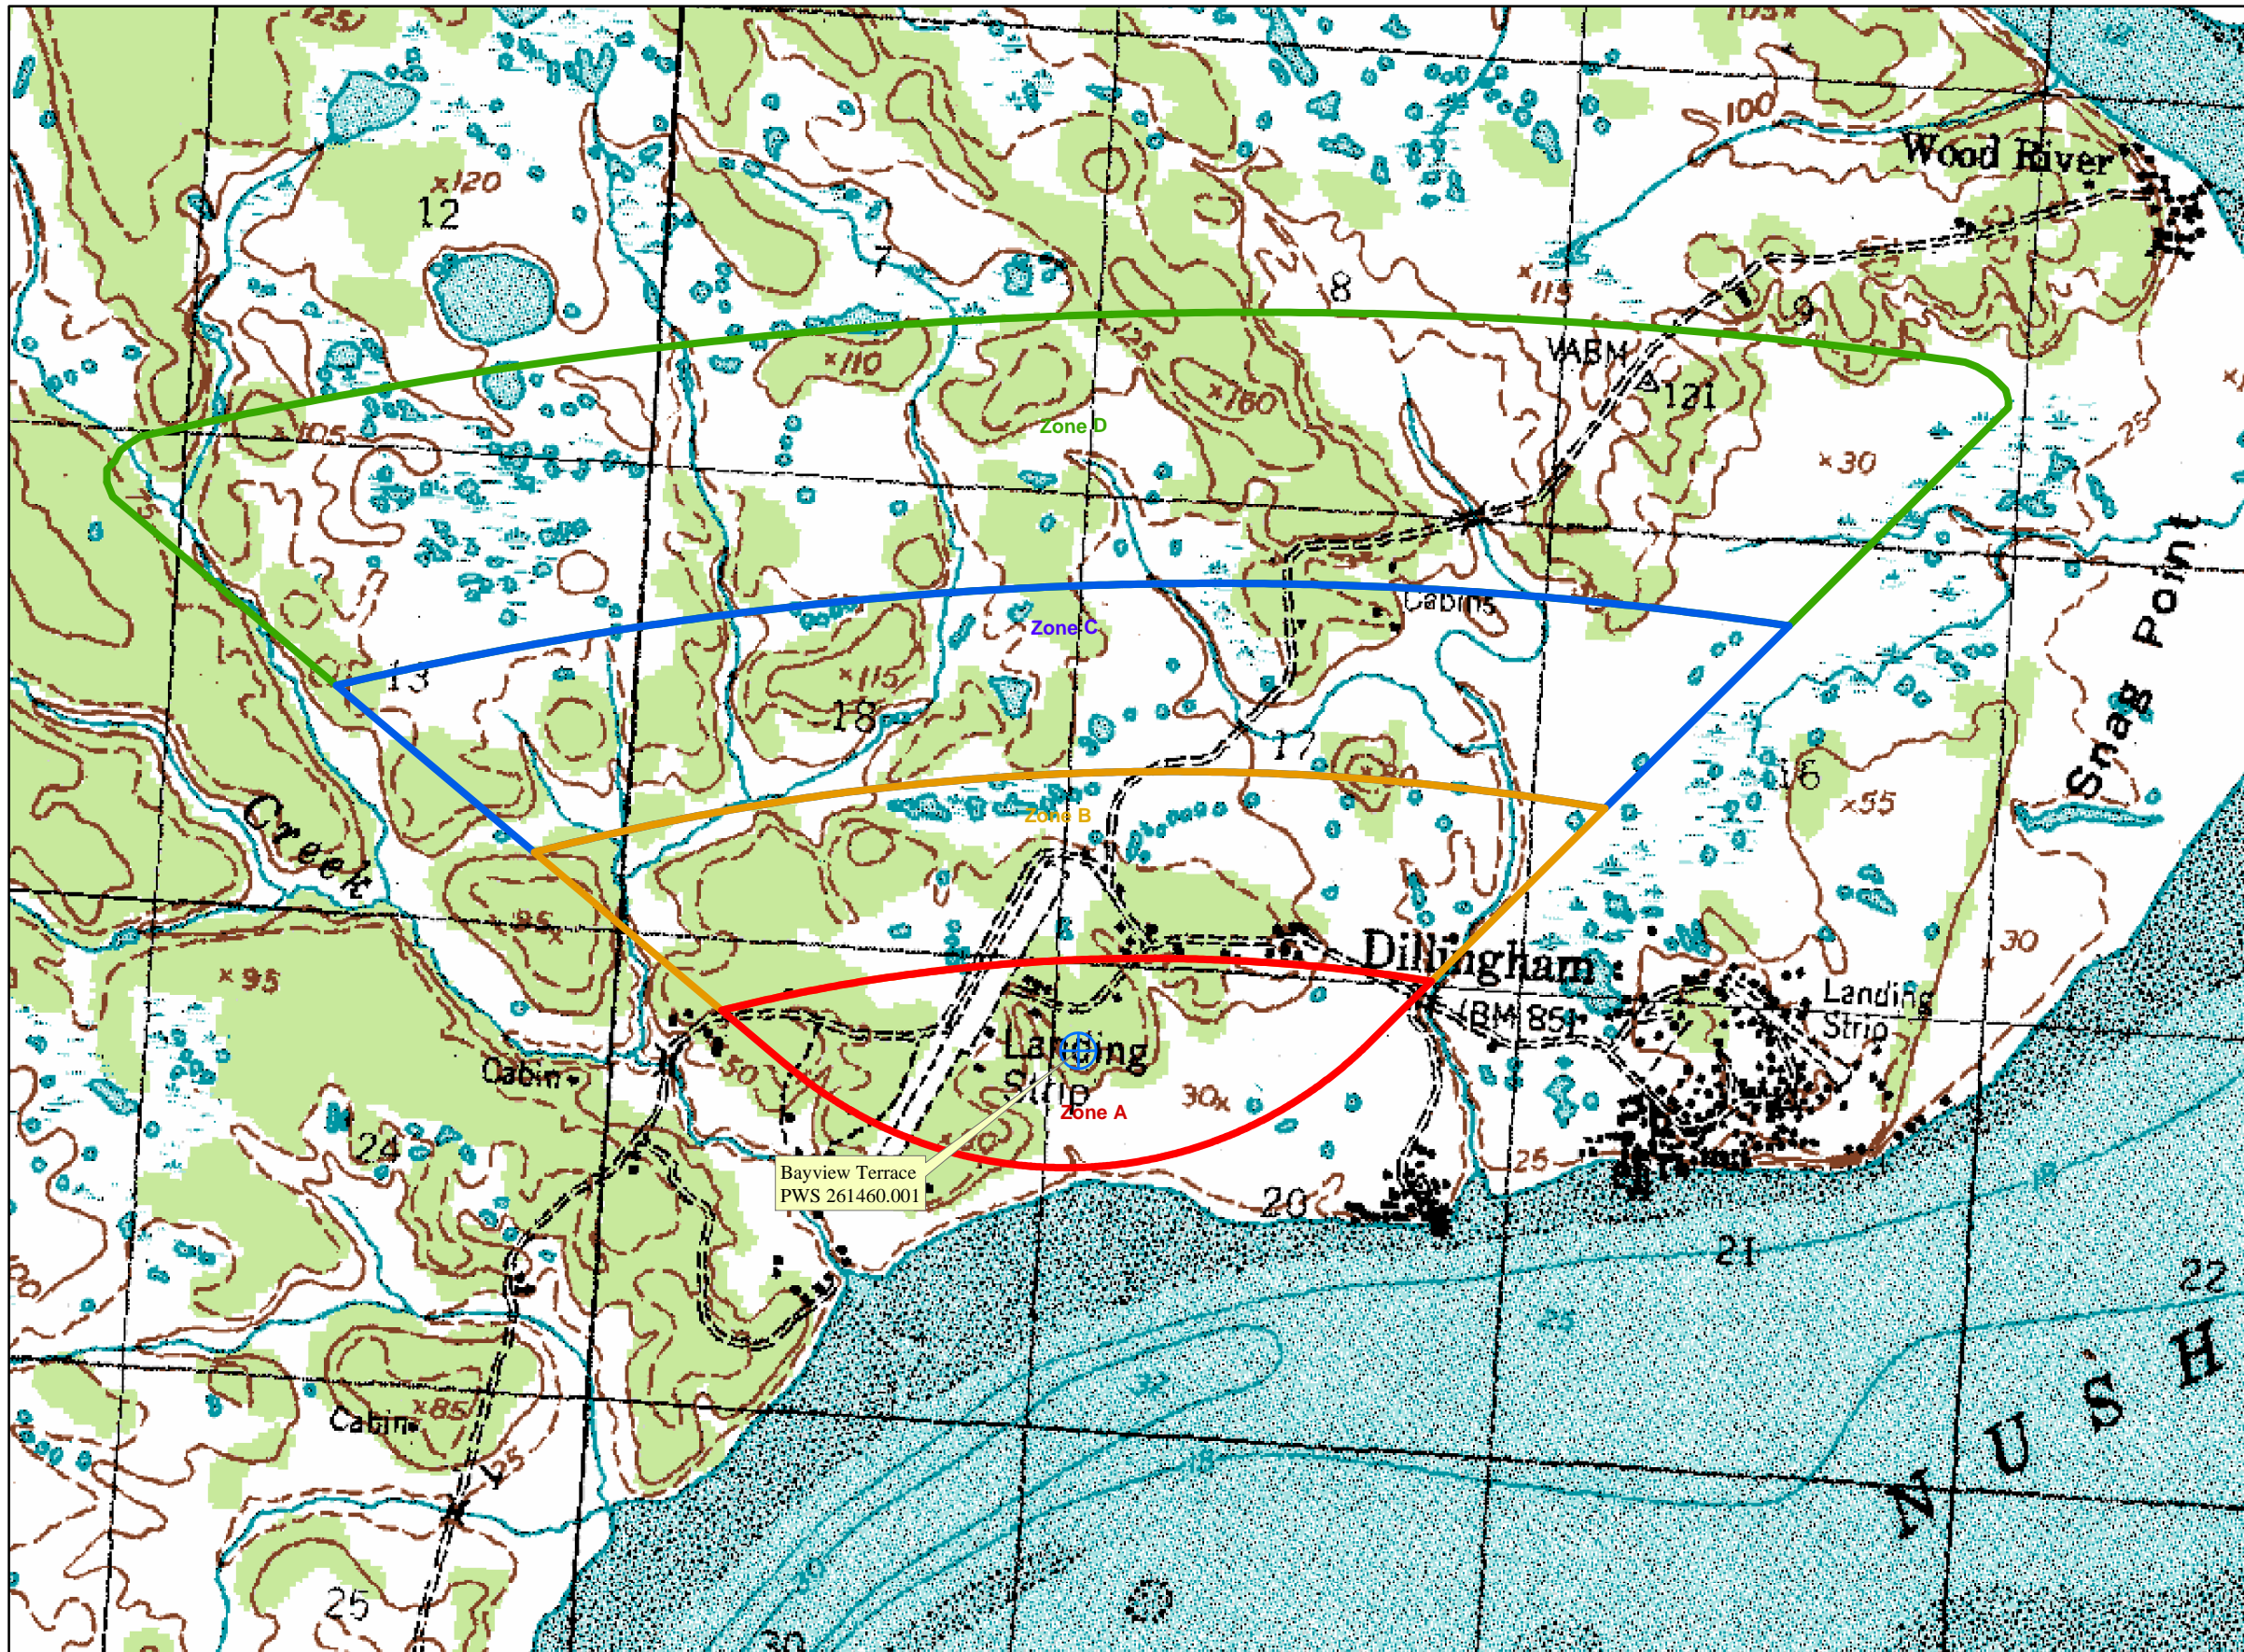

LEGEND

- Public Water System Well
- Hydrography/Physical**
 - Parcels
 - Stream
 - Lake or Pond
 - Contours
- Transportation**
 - Primary Route (Class 1)
 - Secondary Route (Class 2)
 - Road (Class 3)
 - Road (Class 4)
 - Road (Class 5, Four-wheel drive)
- Groundwater Protection Zones**
 - Zone A Protection Area- Several Months Travel Time
 - Zone B Protection Area- 2 Years Travel Time
 - Zone C Protection Area- 5 Years Travel Time
 - Zone D Protection Area- 10 Years Travel Time




Data Sources:
 Contaminant Sources, Public Water System Wells, Contours
 Alaska Department of Environmental Conservation (ADEC)

Critical Facilities, Federal Emergency Management Agency (FEMA)

All other data:
 United States Geological Survey (USGS)

Drinking Water Protection Areas based on "Alaska Drinking Water Protection Program - Guidance Manual for Class B Public Water Systems" published by ADEC

URS Corporation does not guarantee the accuracy or validity of the data provided.

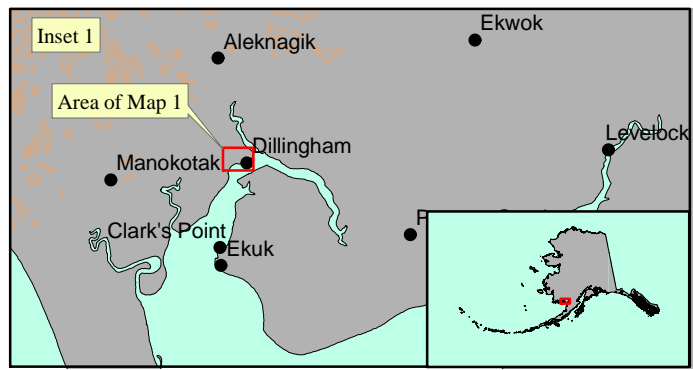

APPENDIX B

Contaminant Source Inventory and Risk Ranking (Tables 1-7)

Table 1

**Contaminant Source Inventory for
Bayview Terrace**

PWSID 261460.001

Contaminant Source Type	Contaminant Source ID	CS ID tag	Zone	Map Number	Comments
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-01	A	C	
Meat processing	N05	N05-01	A	C	
Seafood processing	N10	N10-01	A	C	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-01	A	C	
Tanks, heating oil, nonresidential (underground)	T16	T16-01	A	C	
Wastewater Holding Tank	T22	T22-01	A	C	
Wastewater Holding Tank	T22	T22-02	A	C	
Wastewater Holding Tank	T22	T22-03	A	C	
Wastewater Holding Tank	T22	T22-04	A	C	
Wastewater Holding Tank	T22	T22-05	A	C	
Wastewater Holding Tank	T22	T22-06	A	C	
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-01	A	C	Armstrong/Penn Air Hangar. ADED Reckey # 1992250133902. Site is active with high priority. Groundwater is impacted with petroleum hydrocarbons from 1,200 Av-Gas spill.
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-01	A	C	Yute Air Term. - ADOT&PF Lease. ADEC Reckey# 1993250132201. Site is active with a high priority. Soil and groundwater are contaminated with hydrocarbons from 2,000 gallon Av-Gas spill.
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-02	A	C	MarkAir - Dillingham Facilities. ADEC Reckey # 1992310135701. Site is active with low priority. Former heating oil UST. Groundwater issues were not investigated.
Water supply wells	W09	W09-01	A	C	
Airports	X14	X14-01	A	C	
Motor vehicle/general storage yards/facilities	X27	X27-01	A	C	
Laundromats without dry cleaning	C22	C22-01	B	C	
Tanks, gasoline (underground)	T12	T12-01	B	C	
Tanks, gasoline (underground)	T12	T12-02	B	C	

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Map Number</i>	<i>Comments</i>
Tanks, gasoline (underground)	T12	T12-03	B	C	
Closed tanks, gasoline (underground)	T13	T13-01	B	C	
Closed tanks, gasoline (underground)	T13	T13-02	B	C	
Closed tanks, gasoline (underground)	T13	T13-03	B	C	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-02	B	C	
Tanks, heating oil, nonresidential (underground)	T16	T16-01	B	C	
Wastewater Holding Tank	T22	T22-07	B	C	
Wastewater Holding Tank	T22	T22-08	B	C	
Wastewater Holding Tank	T22	T22-09	B	C	
Wastewater Holding Tank	T22	T22-10	B	C	
Open Leaking Underground Fuel Storage Tank (LUST) Sites	U07	U07-01	B	C	Armstrong Air. ADEC Reckey # 1992250026601. Gasoline contaminated soil was identified in test pits adjacent to Av-Gas UST's.
Closed Leaking Underground Fuel Storage Tank (LUST) Sites	U08	U08-01	B	C	Wren-Air. ADEC Reckey # 1991250026103. Site closed. Petroleum contaminated soil discovered during UST closure assessment.
Water supply wells	W09	W09-02	B	C	
Cemeteries	X01	X01-01	B	C	
Motor vehicle/general storage yards/facilities	X27	X27-02	B	C	
Firehouses	X38	X38-01	B	C	
Motor /motor vehicle repair shops	C31	C31-01	D	C	
Injection wells (Class V) Motor Vehicle Waste Disposal Well	D42	D42-01	D	C	

*Contaminant Source Inventory and Risk Ranking for
Bayview Terrace
Sources of Bacteria and Viruses*

PWSID 261460.001

Table 2

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-01	A	High	C	
Meat processing	N05	N05-01	A	Medium	C	
Seafood processing	N10	N10-01	A	Medium	C	
Wastewater Holding Tank	T22	T22-01	A	Low	C	
Wastewater Holding Tank	T22	T22-02	A	Low	C	
Wastewater Holding Tank	T22	T22-03	A	Low	C	
Wastewater Holding Tank	T22	T22-04	A	Low	C	
Wastewater Holding Tank	T22	T22-05	A	Low	C	
Wastewater Holding Tank	T22	T22-06	A	Low	C	
Laundromats without dry cleaning	C22	C22-01	B	Low	C	
Wastewater Holding Tank	T22	T22-07	B	Low	C	
Wastewater Holding Tank	T22	T22-08	B	Low	C	
Wastewater Holding Tank	T22	T22-09	B	Low	C	
Wastewater Holding Tank	T22	T22-10	B	Low	C	
Closed Leaking Underground Fuel Storage Tank (LUST) Sites	U08	U08-01	B	Low	C	Wren-Air. ADEC Reckey # 1991250026103. Site closed. Petroleum contaminated soil discovered during UST closure assessment.

*Contaminant Source Inventory and Risk Ranking for
Bayview Terrace
Sources of Nitrates/Nitrites*

PWSID 261460.001

Table 3

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-01	A	High	C	
Meat processing	N05	N05-01	A	Low	C	
Seafood processing	N10	N10-01	A	Low	C	
Wastewater Holding Tank	T22	T22-01	A	Low	C	
Wastewater Holding Tank	T22	T22-02	A	Low	C	
Wastewater Holding Tank	T22	T22-03	A	Low	C	
Wastewater Holding Tank	T22	T22-04	A	Low	C	
Wastewater Holding Tank	T22	T22-05	A	Low	C	
Wastewater Holding Tank	T22	T22-06	A	Low	C	
Airports	X14	X14-01	A	Low	C	
Laundromats without dry cleaning	C22	C22-01	B	Low	C	
Wastewater Holding Tank	T22	T22-07	B	Low	C	
Wastewater Holding Tank	T22	T22-08	B	Low	C	
Wastewater Holding Tank	T22	T22-09	B	Low	C	
Wastewater Holding Tank	T22	T22-10	B	Low	C	
Closed Leaking Underground Fuel Storage Tank (LUST) Sites	U08	U08-01	B	Low	C	Wren-Air. ADEC Reckey # 1991250026103. Site closed. Petroleum contaminated soil discovered during UST closure assessment.
Cemeteries	X01	X01-01	B	Medium	C	

*Contaminant Source Inventory and Risk Ranking for
Bayview Terrace
Sources of Volatile Organic Chemicals*

PWSID 261460.001

Table 4

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-01	A	Low	C	
Meat processing	N05	N05-01	A	Medium	C	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-01	A	Low	C	
Tanks, heating oil, nonresidential (underground)	T16	T16-01	A	Low	C	
Wastewater Holding Tank	T22	T22-01	A	Medium	C	
Wastewater Holding Tank	T22	T22-02	A	Medium	C	
Wastewater Holding Tank	T22	T22-03	A	Medium	C	
Wastewater Holding Tank	T22	T22-04	A	Medium	C	
Wastewater Holding Tank	T22	T22-05	A	Medium	C	
Wastewater Holding Tank	T22	T22-06	A	Medium	C	
Contaminated sites, DEC recognized, non-Superfund non-RCRA	U04	U04-01	A	High	C	Armstrong/Penn Air Hangar. ADED Reckey # 1992250133902. Site is active with high priority. Groundwater is impacted with petroleum hydrocarbons from 1,200 Av-Gas spill.
Contaminated sites, DEC recognized, non-Superfund non-RCRA	U04	U04-01	A	High	C	Yute Air Term. - ADOT&PF Lease. ADEC Reckey# 1993250132201. Site is active with a high priority. Soil and groundwater are contaminated with hydrocarbons from 2,000 gallon Av-Gas spill.
Contaminated sites, DEC recognized, non-Superfund non-RCRA	U04	U04-02	A	High	C	MarkAir - Dillingham Facilities. ADEC Reckey # 1992310135701. Site is active with low priority. Former heating oil UST. Groundwater issues were not investigated.
Airports	X14	X14-01	A	High	C	
Motor vehicle/general storage yards/facilities	X27	X27-01	A	Low	C	
Laundromats without dry cleaning	C22	C22-01	B	Low	C	
Tanks, gasoline (underground)	T12	T12-01	B	High	C	
Tanks, gasoline (underground)	T12	T12-02	B	High	C	
Tanks, gasoline (underground)	T12	T12-03	B	High	C	
Closed tanks, gasoline (underground)	T13	T13-01	B	Medium	C	

*Contaminant Source Inventory and Risk Ranking for
Bayview Terrace
Sources of Volatile Organic Chemicals*

PWSID 261460.001

Table 4 (continued)

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Closed tanks, gasoline (underground)	T13	T13-02	B	Medium	C	
Closed tanks, gasoline (underground)	T13	T13-03	B	Medium	C	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-02	B	Low	C	
Tanks, heating oil, nonresidential (underground)	T16	T16-01	B	Low	C	
Wastewater Holding Tank	T22	T22-07	B	Medium	C	
Wastewater Holding Tank	T22	T22-08	B	Medium	C	
Wastewater Holding Tank	T22	T22-09	B	Medium	C	
Wastewater Holding Tank	T22	T22-10	B	Medium	C	
Open Leaking Underground Fuel Storage Tank (LUST) Sites	U07	U07-01	B	High	C	Armstrong Air. ADEC Reckey # 1992250026601. Gasoline contaminated was identified in test pits adjacent to Av-Gas UST's.
Closed Leaking Underground Fuel Storage Tank (LUST) Sites	U08	U08-01	B	High	C	Wren-Air. ADEC Reckey # 1991250026103. Site closed. Petroleum contaminated soil discovered during UST closure assessment.
Motor vehicle/general storage yards/facilities	X27	X27-02	B	Low	C	
Firehouses	X38	X38-01	B	Low	C	
Injection wells (Class V) Motor Vehicle Waste Disposal Well	D42	D42-01	D	High	C	

*Contaminant Source Inventory and Risk Ranking for
Bayview Terrace*

PWSID 261460.001

Table 5

Sources of Heavy Metals, Cyanide and Other Inorganic Chemicals

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-01	A	Low	C	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-01	A	Low	C	
Tanks, heating oil, nonresidential (underground)	T16	T16-01	A	Low	C	
Wastewater Holding Tank	T22	T22-01	A	Medium	C	
Wastewater Holding Tank	T22	T22-02	A	Medium	C	
Wastewater Holding Tank	T22	T22-03	A	Medium	C	
Wastewater Holding Tank	T22	T22-04	A	Medium	C	
Wastewater Holding Tank	T22	T22-05	A	Medium	C	
Wastewater Holding Tank	T22	T22-06	A	Medium	C	
Contaminated sites, DEC recognized, non-Superfun non-RCRA	U04	U04-01	A	Low	C	Yute Air Term. - ADOT&PF Lease. ADEC Reckey# 1993250132201. Site active with a high priority. Soil and groundwater are contaminated with hydrocarbons from 2,000 gallon Av-Gas spill.
Contaminated sites, DEC recognized, non-Superfun non-RCRA	U04	U04-01	A	Low	C	Armstrong/Penn Air Hangar. ADED Reckey # 1992250133902. Site is active with high priority. Groundwater is impacted with petroleum hydrocarbons from 1,200 Av-Gas spill.
Contaminated sites, DEC recognized, non-Superfun non-RCRA	U04	U04-02	A	Low	C	MarkAir - Dillingham Facilities. ADEC Reckey # 1992310135701. Site is active with low priority. Former heating oil UST. Groundwater issues were not investigated.
Airports	X14	X14-01	A	Low	C	
Tanks, gasoline (underground)	T12	T12-01	B	Medium	C	
Tanks, gasoline (underground)	T12	T12-02	B	Medium	C	
Tanks, gasoline (underground)	T12	T12-03	B	Medium	C	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-02	B	Low	C	
Tanks, heating oil, nonresidential (underground)	T16	T16-01	B	Low	C	
Wastewater Holding Tank	T22	T22-07	B	Medium	C	
Wastewater Holding Tank	T22	T22-08	B	Medium	C	

*Contaminant Source Inventory and Risk Ranking for
Bayview Terrace*

PWSID 261460.001

Table 5 (continued)

Sources of Heavy Metals, Cyanide and Other Inorganic Chemicals

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Wastewater Holding Tank	T22	T22-09	B	Medium	C	
Wastewater Holding Tank	T22	T22-10	B	Medium	C	
Closed Leaking Underground Fuel Storage Tank (LUST) Sites	U08	U08-01	B	Low	C	Wren-Air. ADEC Reckey # 1991250026103. Site closed. Petroleum contaminated soil discovered during UST closure assessment.
Cemeteries	X01	X01-01	B	Low	C	
Firehouses	X38	X38-01	B	Low	C	
Injection wells (Class V) Motor Vehicle Waste Disposal Well	D42	D42-01	D	High	C	

*Contaminant Source Inventory and Risk Ranking for
Bayview Terrace
Sources of Synthetic Organic Chemicals*

PWSID 261460.001

Table 6

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-01	A	Low	C	
Contaminated sites, DEC recognized, non-Superfund non-RCRA	U04	U04-01	A	Low	C	Yute Air Term. - ADOT&PF Lease. ADEC Reckey# 1993250132201. Site active with a high priority. Soil and groundwater are contaminated with hydrocarbons from 2,000 gallon Av-Gas spill.
Contaminated sites, DEC recognized, non-Superfund non-RCRA	U04	U04-01	A	Low	C	Armstrong/Penn Air Hangar. ADED Reckey # 1992250133902. Site is active with high priority. Groundwater is impacted with petroleum hydrocarbons from 1,200 Av-Gas spill.
Contaminated sites, DEC recognized, non-Superfund non-RCRA	U04	U04-02	A	Low	C	MarkAir - Dillingham Facilities. ADEC Reckey # 1992310135701. Site is active with low priority. Former heating oil UST. Groundwater issues were not investigated.
Airports	X14	X14-01	A	Medium	C	
Open Leaking Underground Fuel Storage Tank (LUST) Sites	U07	U07-01	B	Low	C	Armstrong Air. ADEC Reckey # 1992250026601. Gasoline contaminated was identified in test pits adjacent to Av-Gas UST's.
Closed Leaking Underground Fuel Storage Tank (LUST) Sites	U08	U08-01	B	Low	C	Wren-Air. ADEC Reckey # 1991250026103. Site closed. Petroleum contaminated soil discovered during UST closure assessment.
Cemeteries	X01	X01-01	B	Medium	C	

*Contaminant Source Inventory and Risk Ranking for
Bayview Terrace
Sources of Other Organic Chemicals*

PWSID 261460.001

Table 7

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-01	A	Low	C	
Meat processing	N05	N05-01	A	Low	C	
Wastewater Holding Tank	T22	T22-01	A	Medium	C	
Wastewater Holding Tank	T22	T22-02	A	Medium	C	
Wastewater Holding Tank	T22	T22-03	A	Medium	C	
Wastewater Holding Tank	T22	T22-04	A	Medium	C	
Wastewater Holding Tank	T22	T22-05	A	Medium	C	
Wastewater Holding Tank	T22	T22-06	A	Medium	C	
Contaminated sites, DEC recognized, non-Superfund non-RCRA	U04	U04-01	A	Low	C	Armstrong/Penn Air Hangar. ADED Reckey # 1992250133902. Site is active with high priority. Groundwater is impacted with petroleum hydrocarbons from 1,200 Av-Gas spill.
Contaminated sites, DEC recognized, non-Superfund non-RCRA	U04	U04-01	A	Low	C	Yute Air Term. - ADOT&PF Lease. ADEC Reckey# 1993250132201. Site is active with a high priority. Soil and groundwater are contaminated with hydrocarbons from 2,000 gallon Av-Gas spill.
Contaminated sites, DEC recognized, non-Superfund non-RCRA	U04	U04-02	A	Low	C	MarkAir - Dillingham Facilities. ADEC Reckey # 1992310135701. Site is active with low priority. Former heating oil UST. Groundwater issues were not investigated.
Airports	X14	X14-01	A	Medium	C	
Motor vehicle/general storage yards/facilities	X27	X27-01	A	Low	C	
Wastewater Holding Tank	T22	T22-07	B	Medium	C	
Wastewater Holding Tank	T22	T22-08	B	Medium	C	
Wastewater Holding Tank	T22	T22-09	B	Medium	C	
Wastewater Holding Tank	T22	T22-10	B	Medium	C	
Open Leaking Underground Fuel Storage Tank (LUST) Sites	U07	U07-01	B	Low	C	Armstrong Air. ADEC Reckey # 1992250026601. Gasoline contaminated was identified in test pits adjacent to Av-Gas UST's.
Closed Leaking Underground Fuel Storage Tank (LUST) Sites	U08	U08-01	B	Low	C	Wren-Air. ADEC Reckey # 1991250026103. Site closed. Petroleum contaminated soil discovered during UST closure assessment.

Table 7 (continued)

*Contaminant Source Inventory and Risk Ranking for
Bayview Terrace
Sources of Other Organic Chemicals*


PWSID 261460.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Motor vehicle/general storage yards/facilities	X27	X27-02	B	Low	C	

APPENDIX C

Drinking Water Protection Area and Potential and Existing Contaminant Sources (Map C)

**Public Water Well System for PWS #261460.001 Bayview Terrace
Showing Potential and Existing Sources of Contamination**

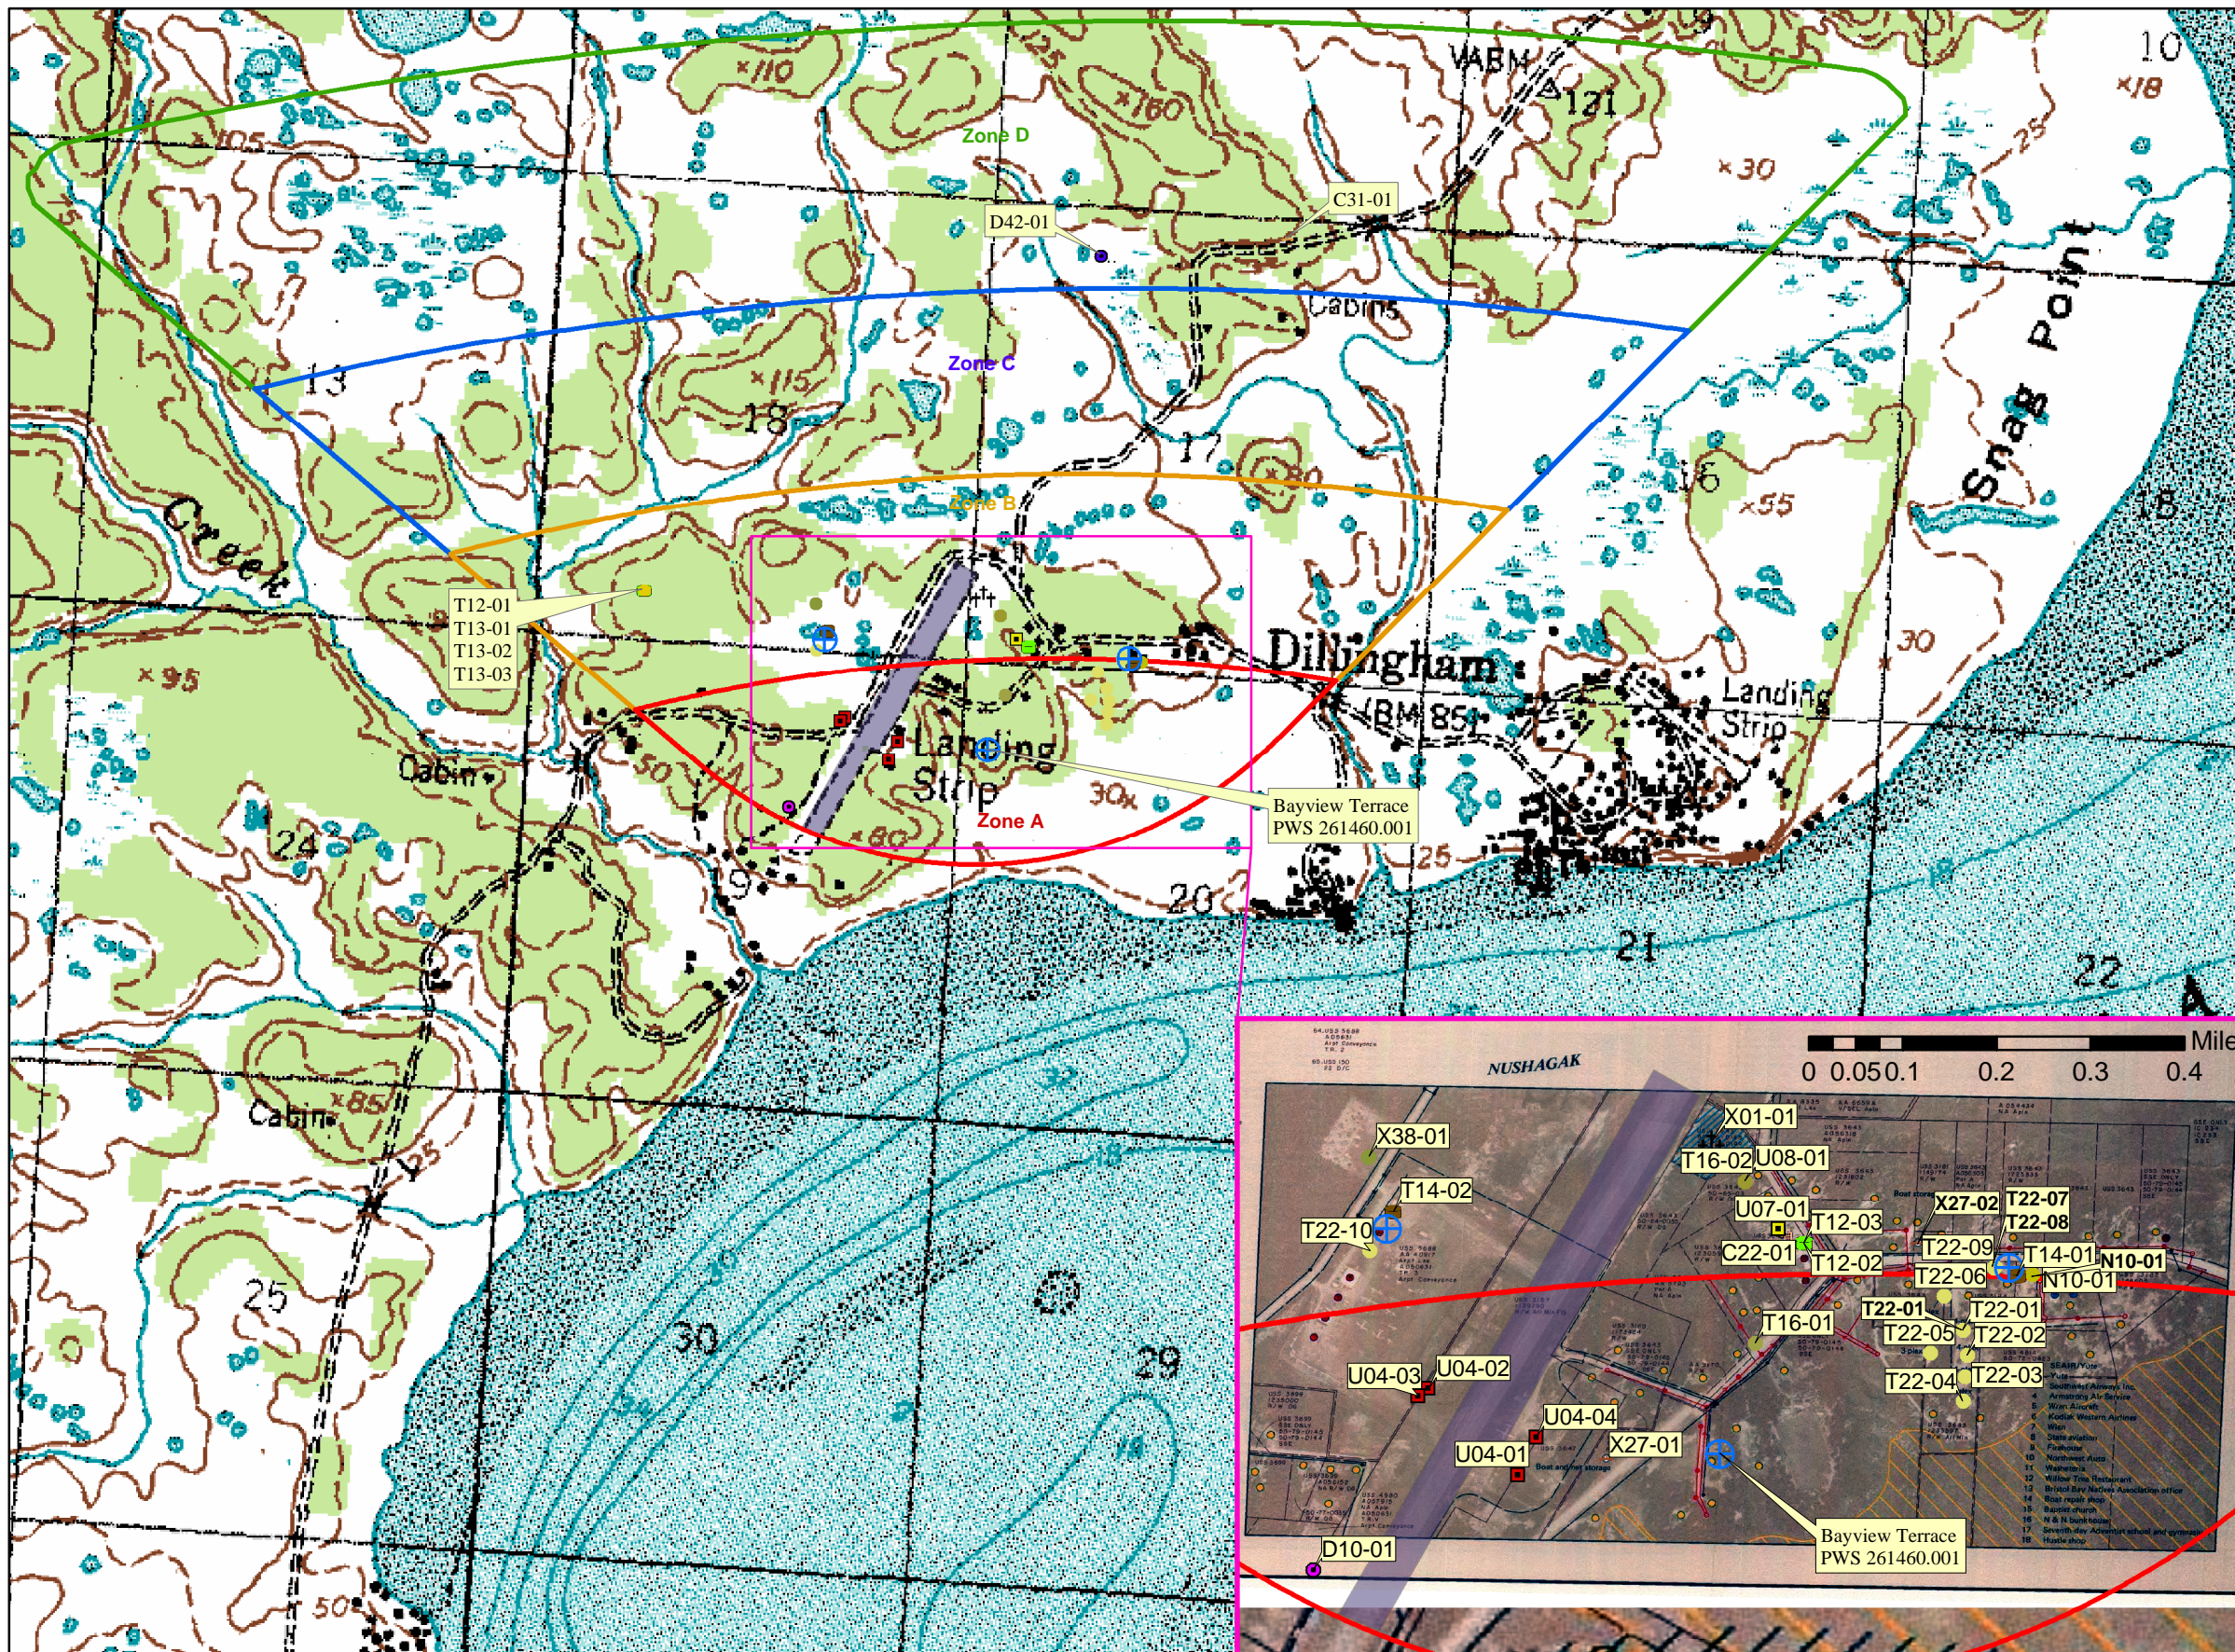

LEGEND

Public Water System Well

Hydrography/Physical

- Parcels
- Stream
- Lake or Pond
- Contours

Transportation

- Primary Route (Class 1)
- Secondary Route (Class 2)
- Road (Class 3)
- Road (Class 4)
- Road (Class 5, Four-wheel drive)

Groundwater Protection Zones

- Zone A Protection Area- Several Months Travel Time
- Zone B Protection Area- 2 Years Travel Time
- Zone C Protection Area- 5 Years Travel Time
- Zone D Protection Area- 10 Years Travel Time



Existing or Potential Contaminant Sources

- Washeteria (C22)
- Motor vehicle repair shop (C31)
- Injection well (Class V) Large Capacity Septic System (D10)
- Injection well (Class V) Motor Vehicle Waste Disposal Well (D42)
- Meat processing (N05)
- Seafood processing (N10)
- Underground gasoline tank (T12)
- Closed underground gasoline tank (T13)
- Nonresidential aboveground heating oil tank (T14)
- Nonresidential underground heating oil tank (T16)
- Wastewater holding tank (T22)
- Contam. sites, DEC recog., non-Superfund, non-RCRA (U04)
- Open leaking underground fuel storage tank (LUST) (U07)
- Closed leaking underground fuel storage tank (U08)
- Cemetery (X01)
- General storage yards/facilities (X27)
- Firehouse (X38)
- Airport (X14)

Data Sources:
 Contaminant Sources, Public Water System Wells, Contours
 Alaska Department of Environmental Conservation (ADEC)
 Critical Facilities, Federal Emergency Management Agency (FEMA)

All other data:
 United States Geological Survey (USGS)
 Drinking Water Protection Areas based on "Alaska Drinking Water Protection Program - Guidance Manual for Class B Public Water Systems" published by ADEC

URS Corporation does not guarantee the accuracy or validity of the data provided.

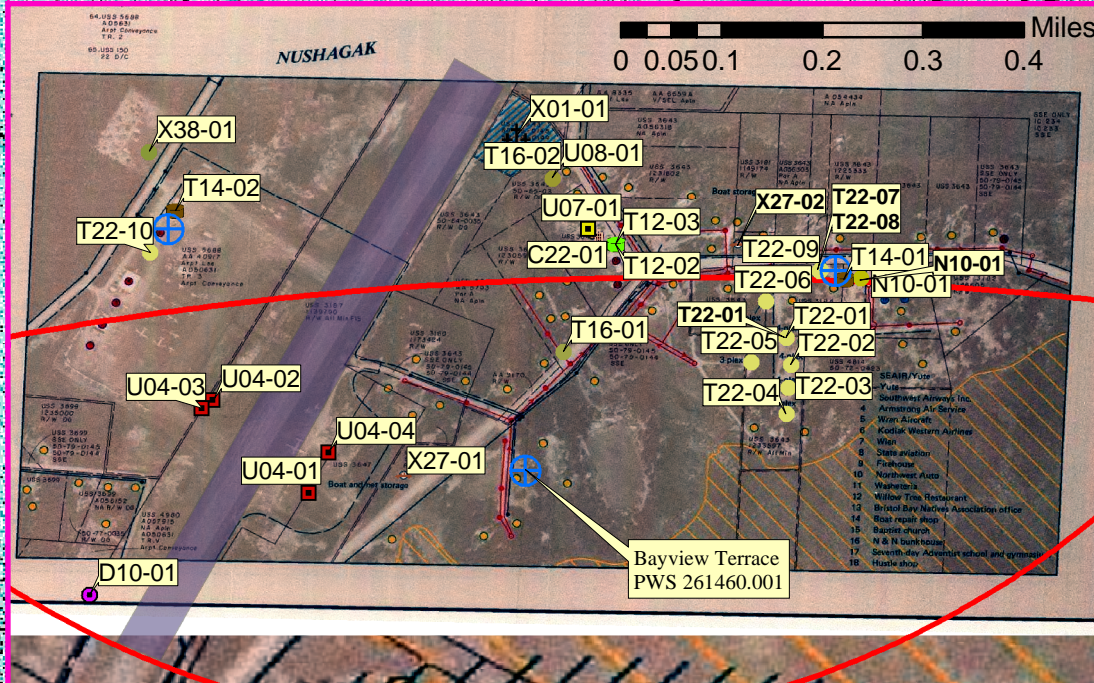

Bayview Terrace
PWS 261460.001
Appendix C Map C

APPENDIX D

Vulnerability Analysis for Public Drinking Water Source (Charts 1-14)

Chart 1. Susceptibility of the wellhead - Bay View Terrace (PWS No. 261460.001)

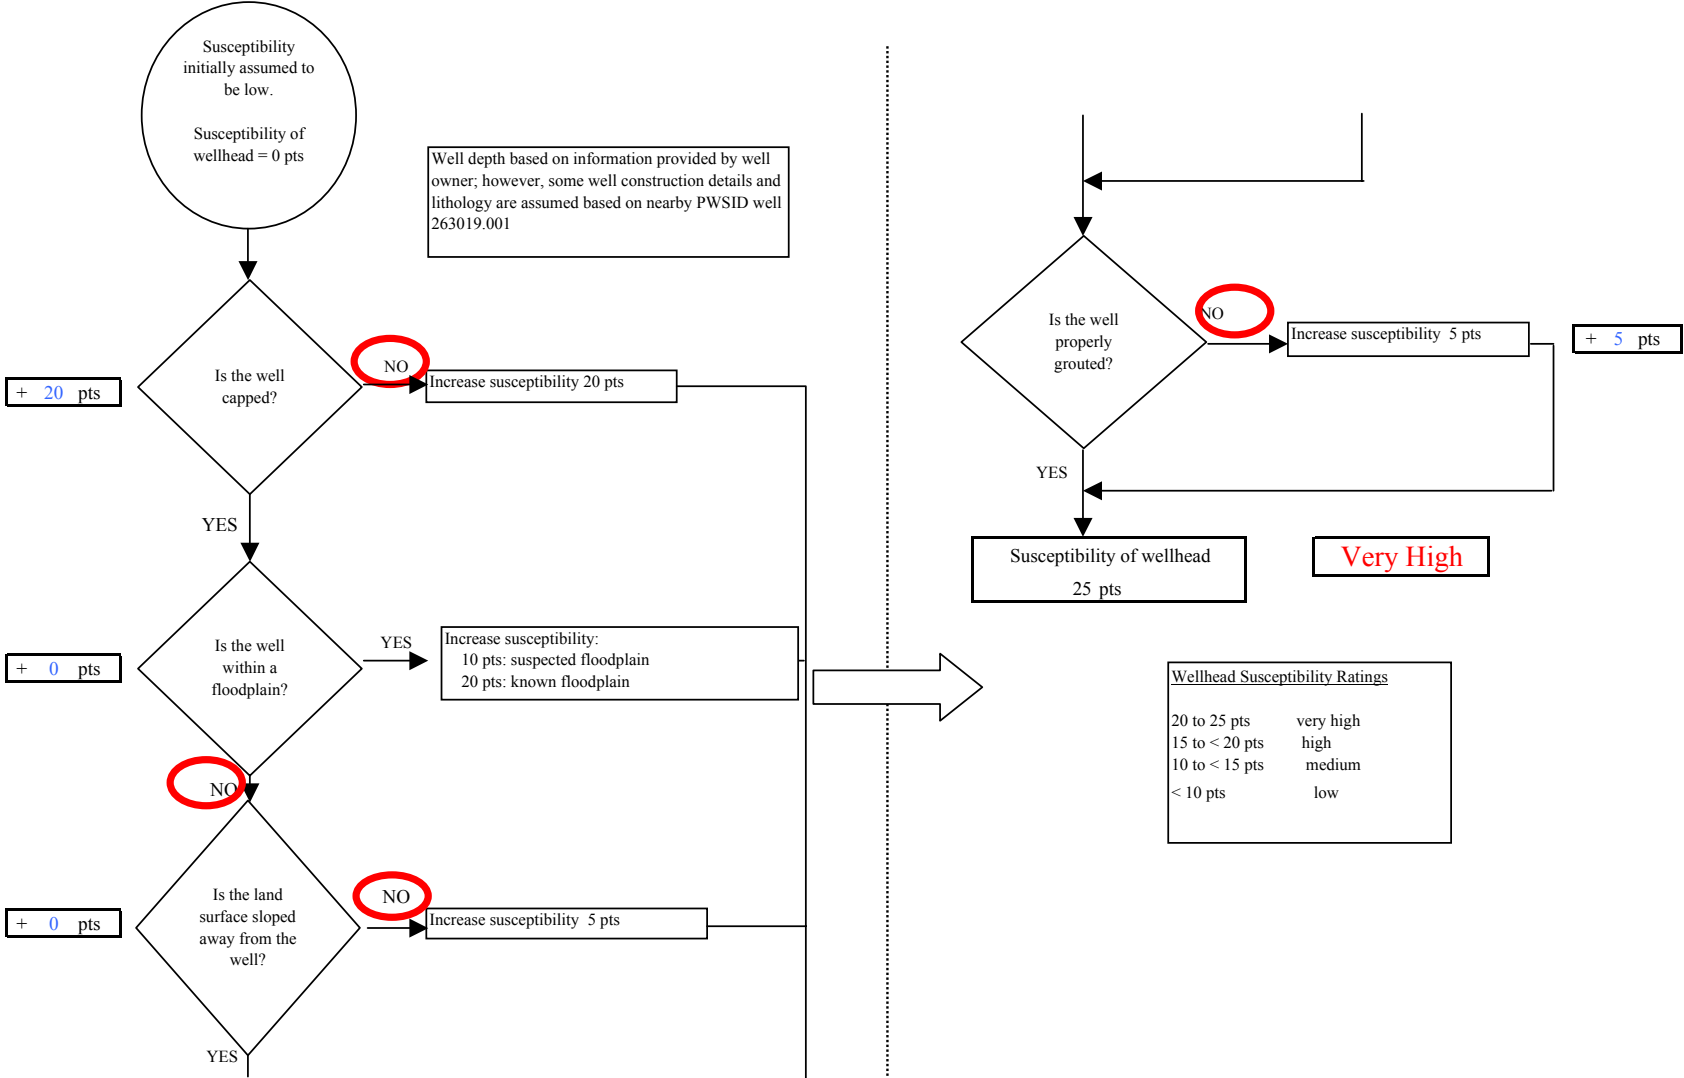


Chart 2. Susceptibility of the aquifer Bay View Terrace (PWS No. 261460.001)

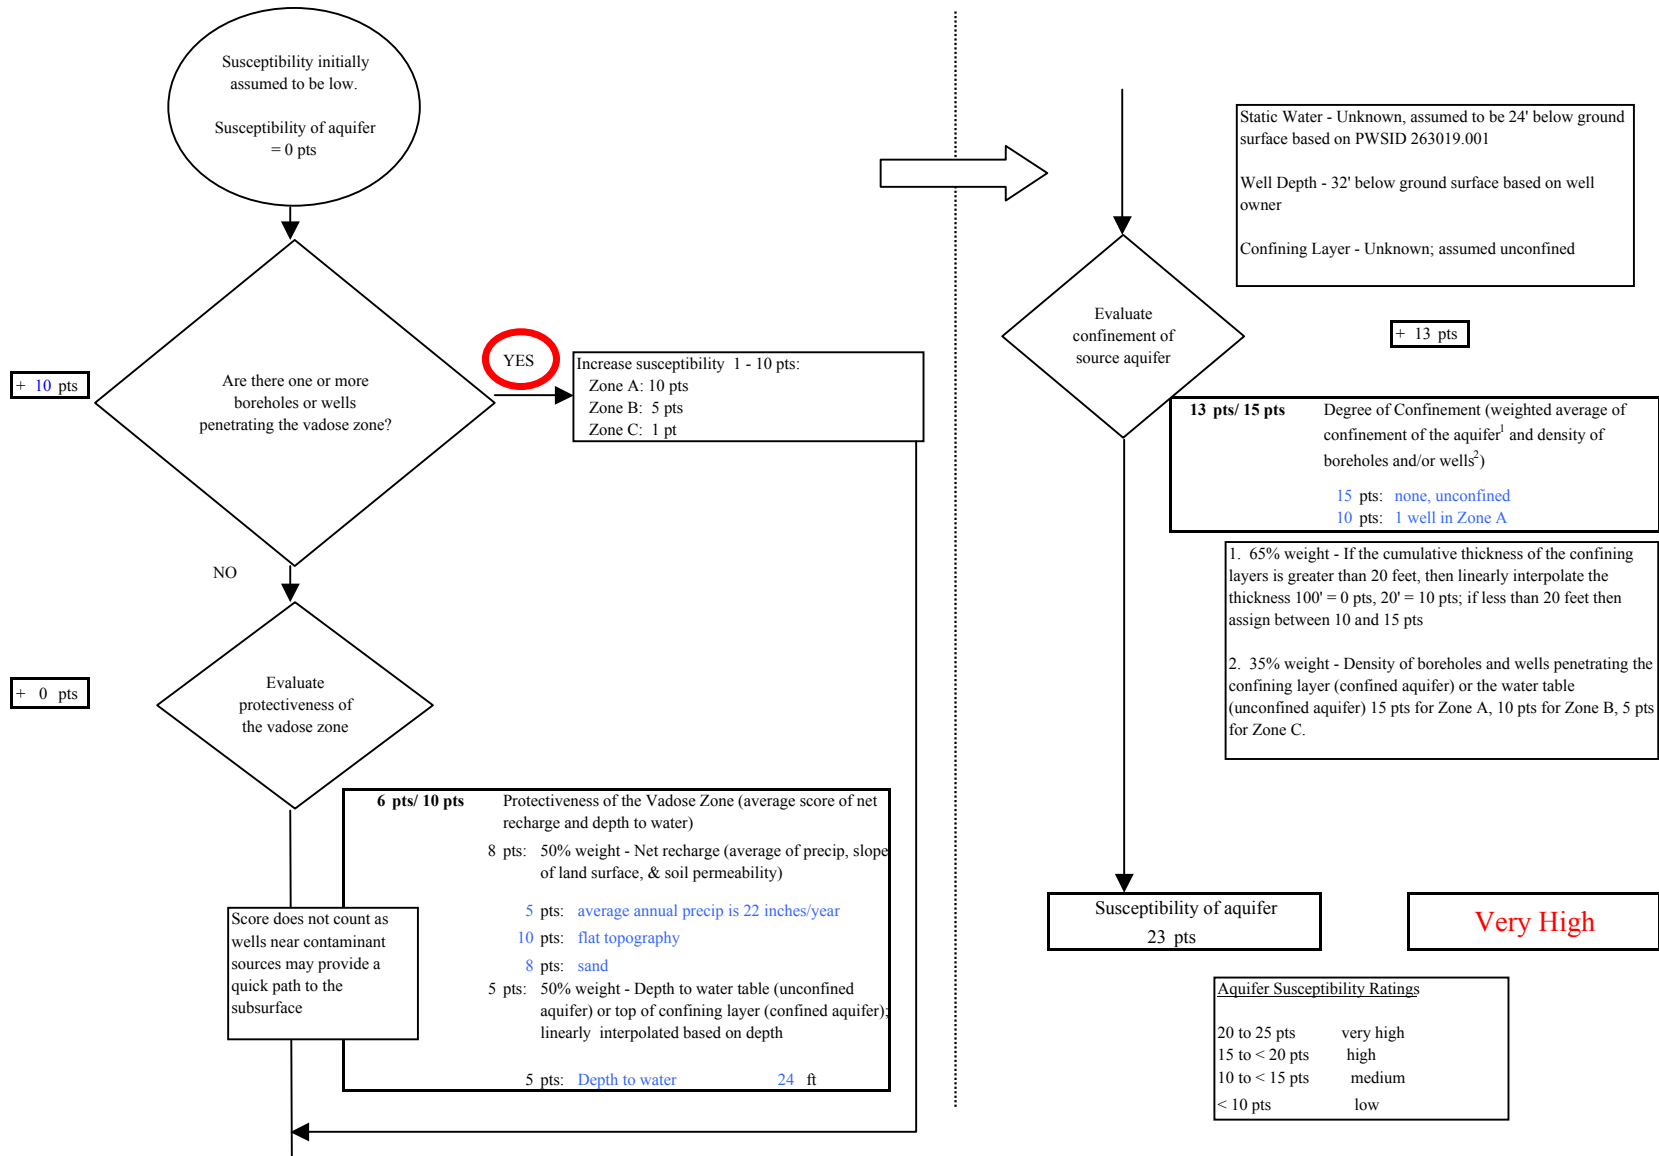


Chart 3. Contaminant risks for Bay View Terrace (PWS No. 261460.001) - Bacteria & Viruses

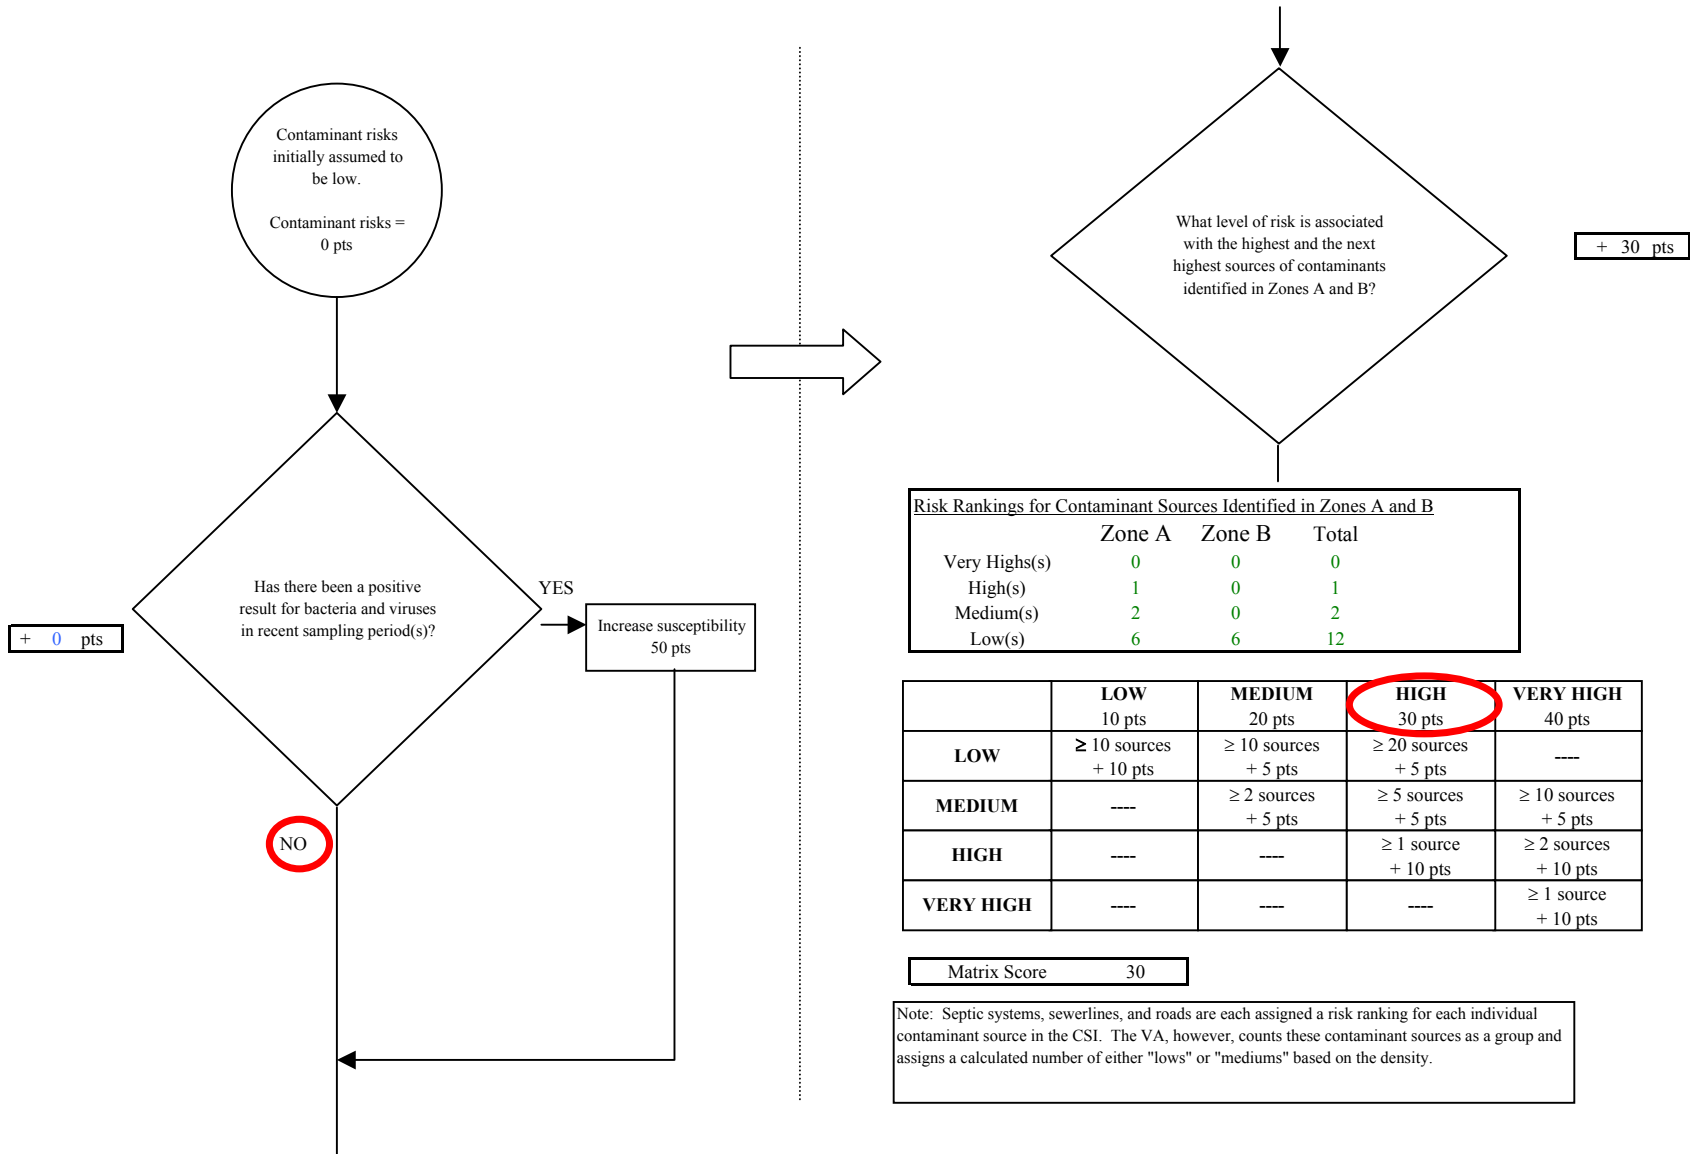


Chart 3. Contaminant risks for Bay View Terrace (PWS No. 261460.001) - Bacteria & Viruses

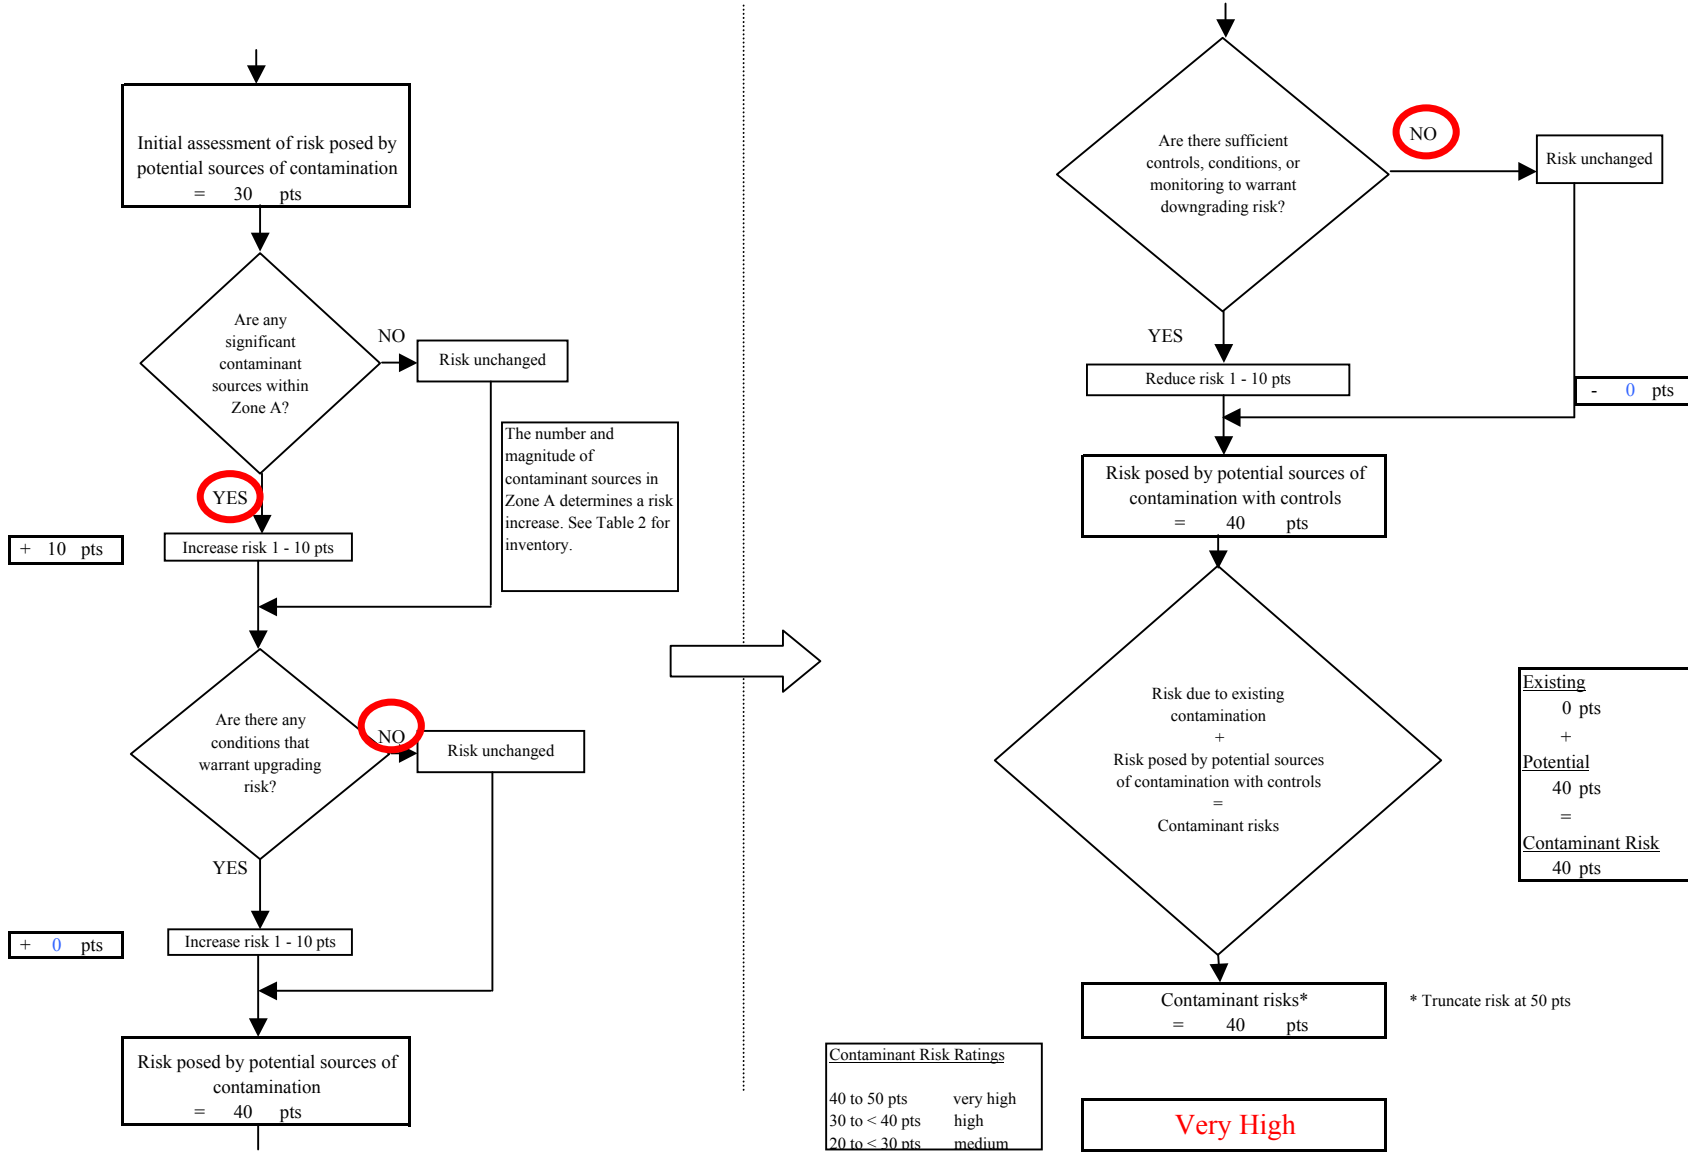


Chart 4. Vulnerability analysis for Bay View Terrace (PWS No. 261460.001) - Bacteria & Viruses

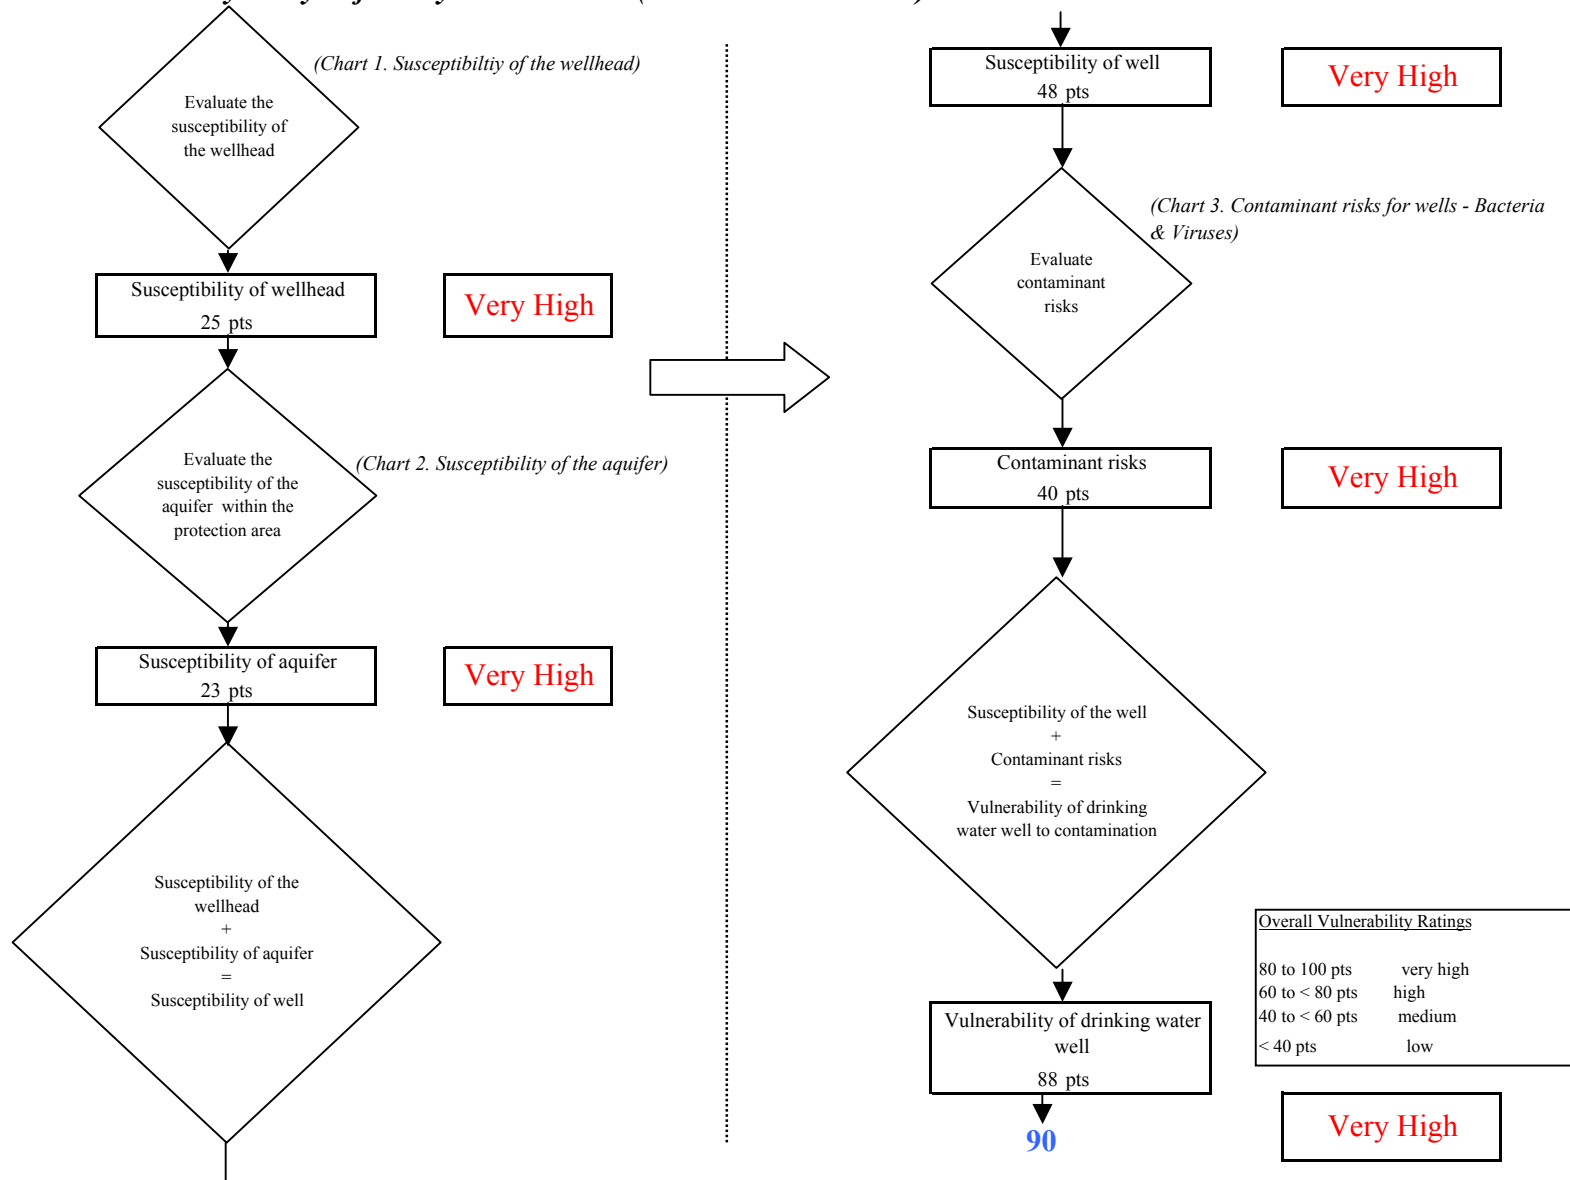


Chart 5. Contaminant risks for Bay View Terrace (PWS No. 261460.001) - Nitrates and Nitrites

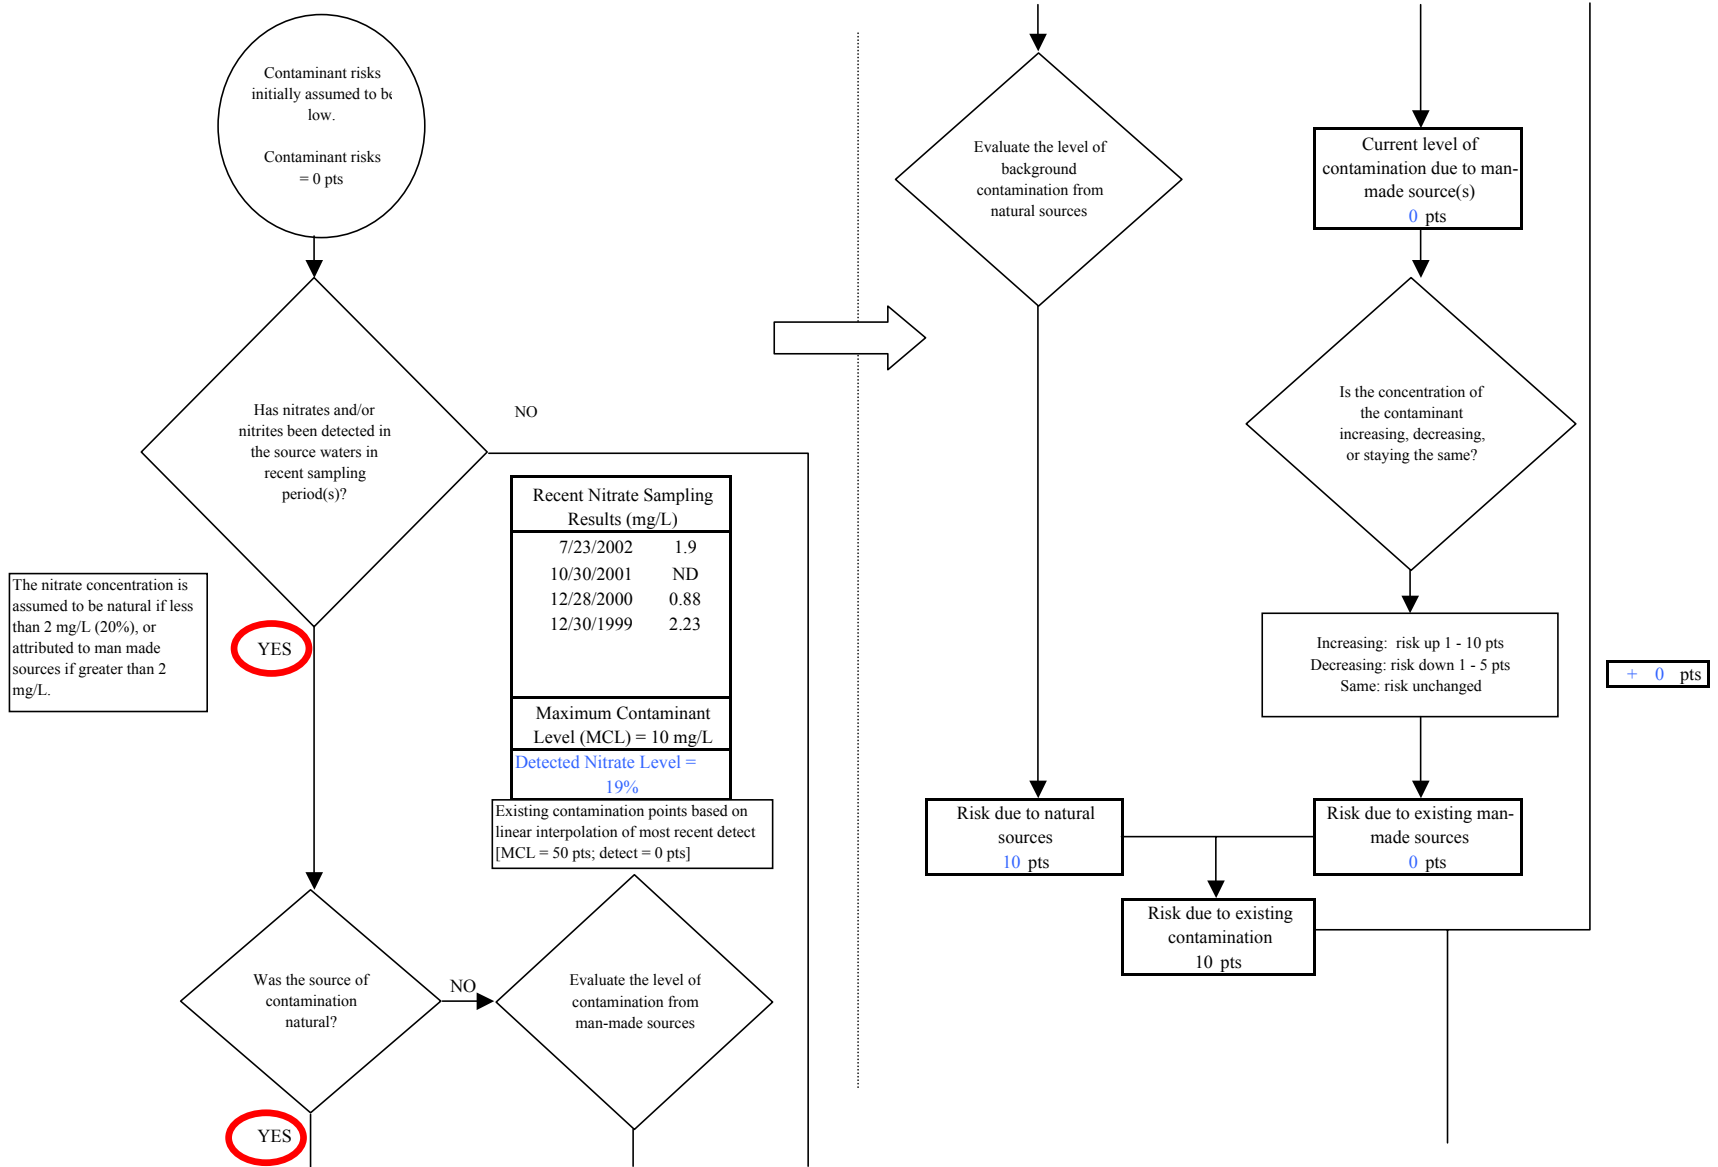


Chart 5. Contaminant risks for Bay View Terrace (PWS No. 261460.001) - Nitrates and Nitrites

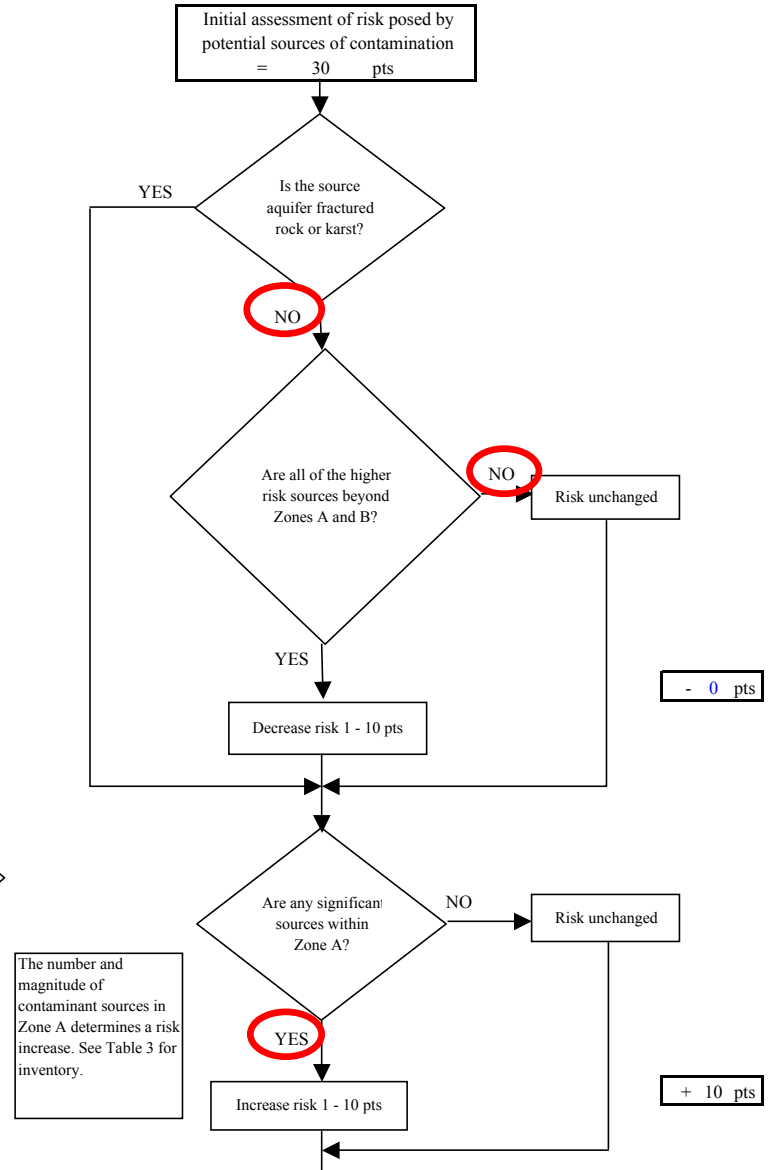
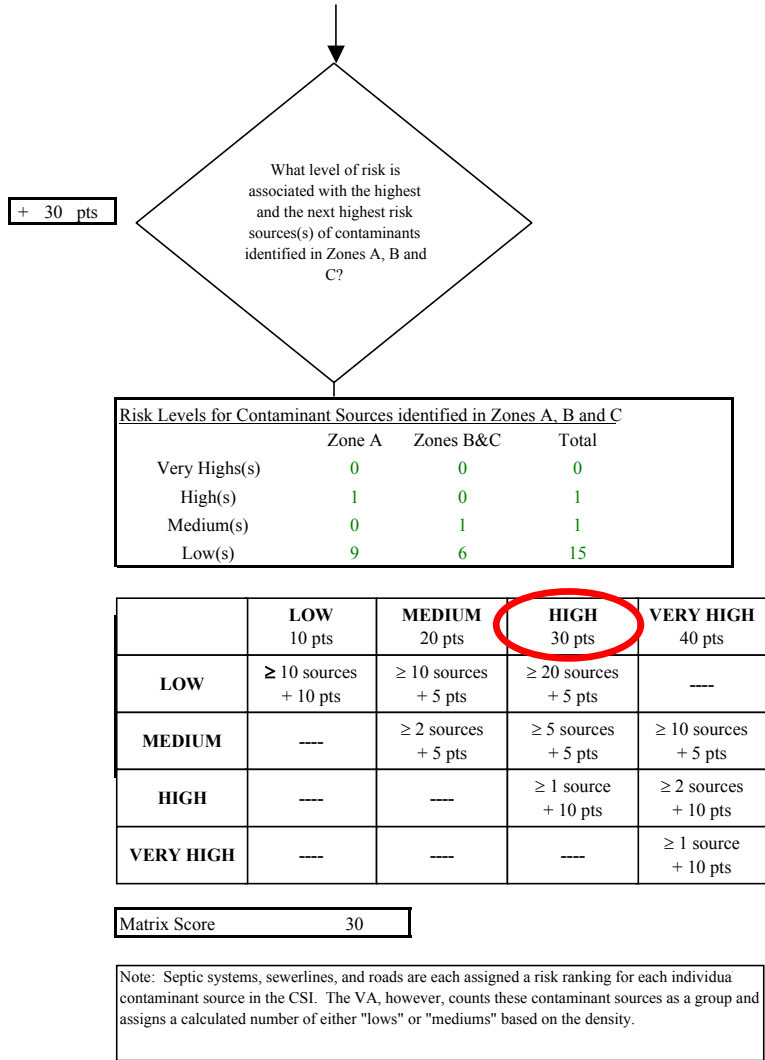


Chart 5. Contaminant risks for Bay View Terrace (PWS No. 261460.001) - Nitrates and Nitrites

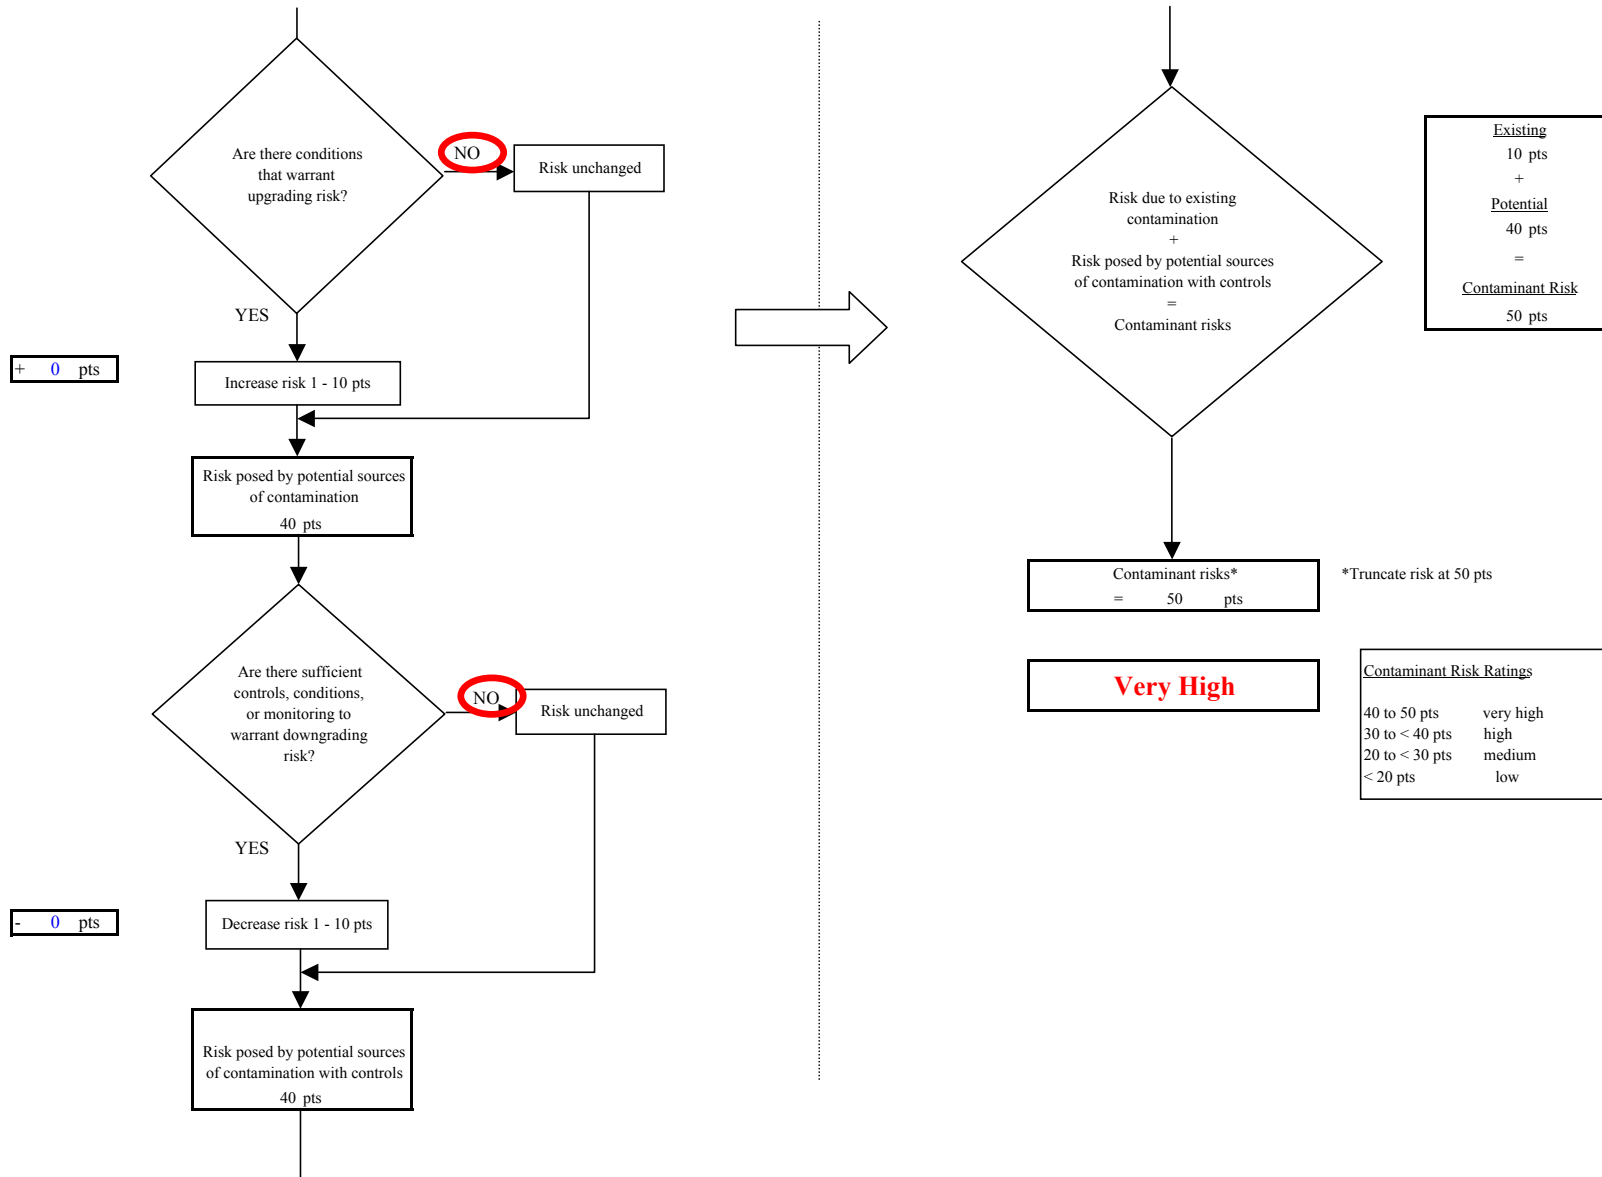


Chart 6. Vulnerability analysis for Bay View Terrace (PWS No. 261460.001) - Nitrates and Nitrites

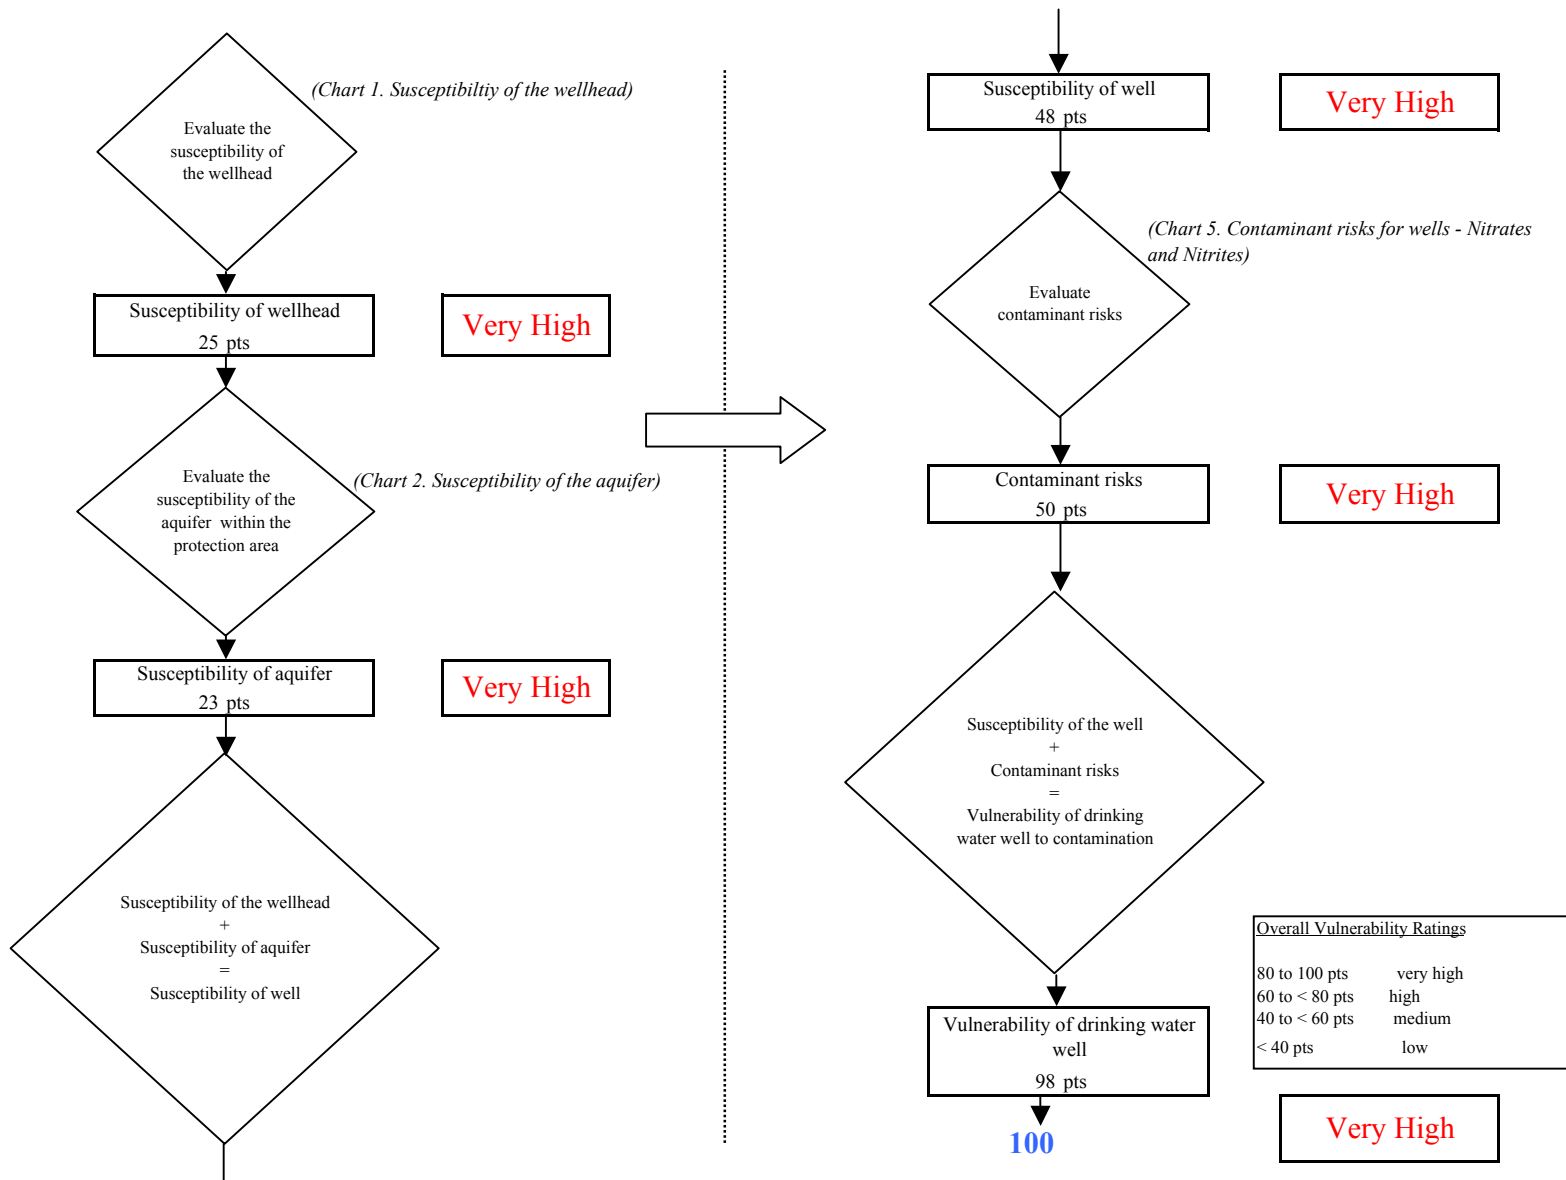


Chart 7. Contaminant risks for Bay View Terrace (PWS No. 261460.001) - Volatile Organic Chemicals

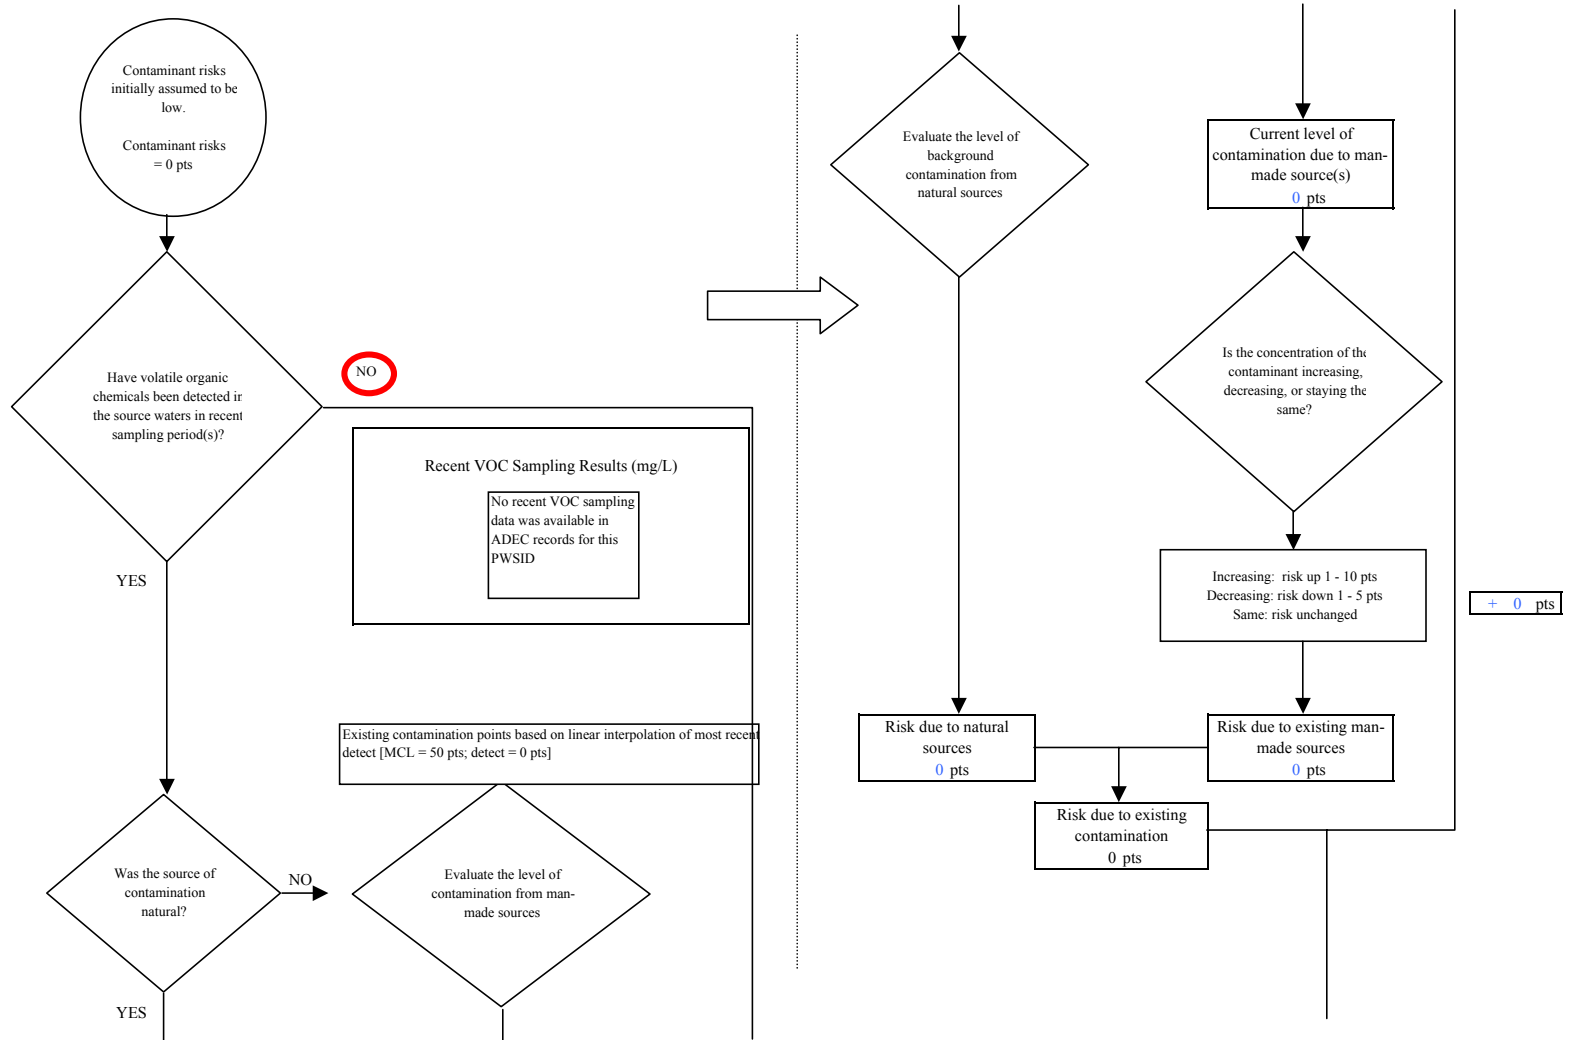


Chart 7. Contaminant risks for Bay View Terrace (PWS No. 261460.001) - Volatile Organic Chemicals

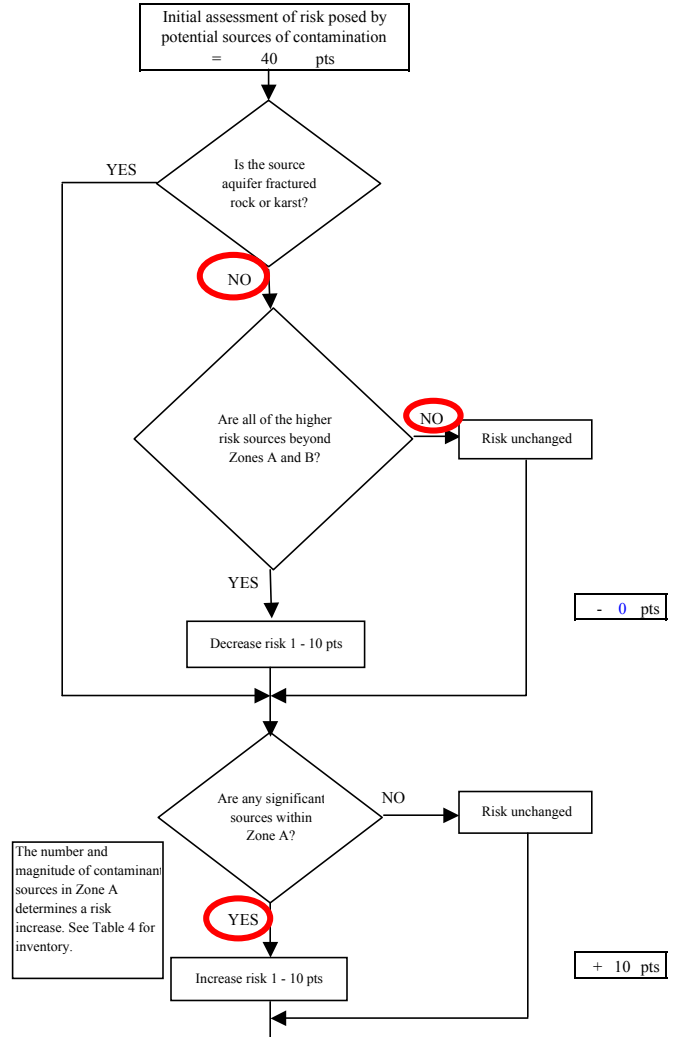

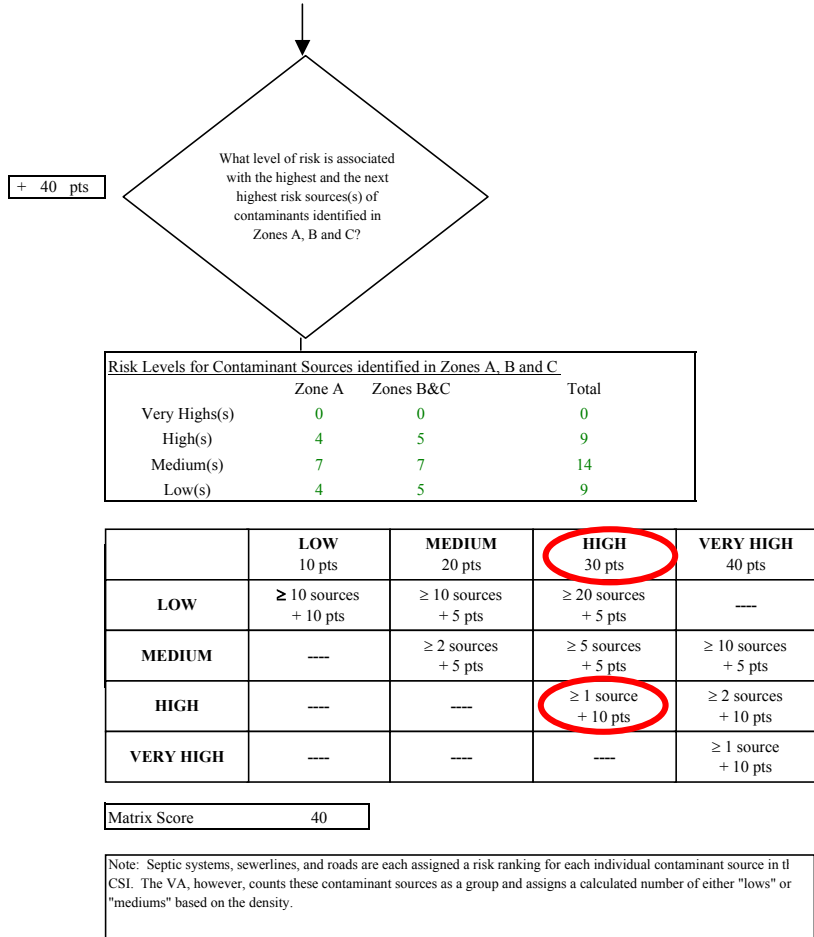


Chart 7. Contaminant risks for Bay View Terrace (PWS No. 261460.001) - Volatile Organic Chemicals

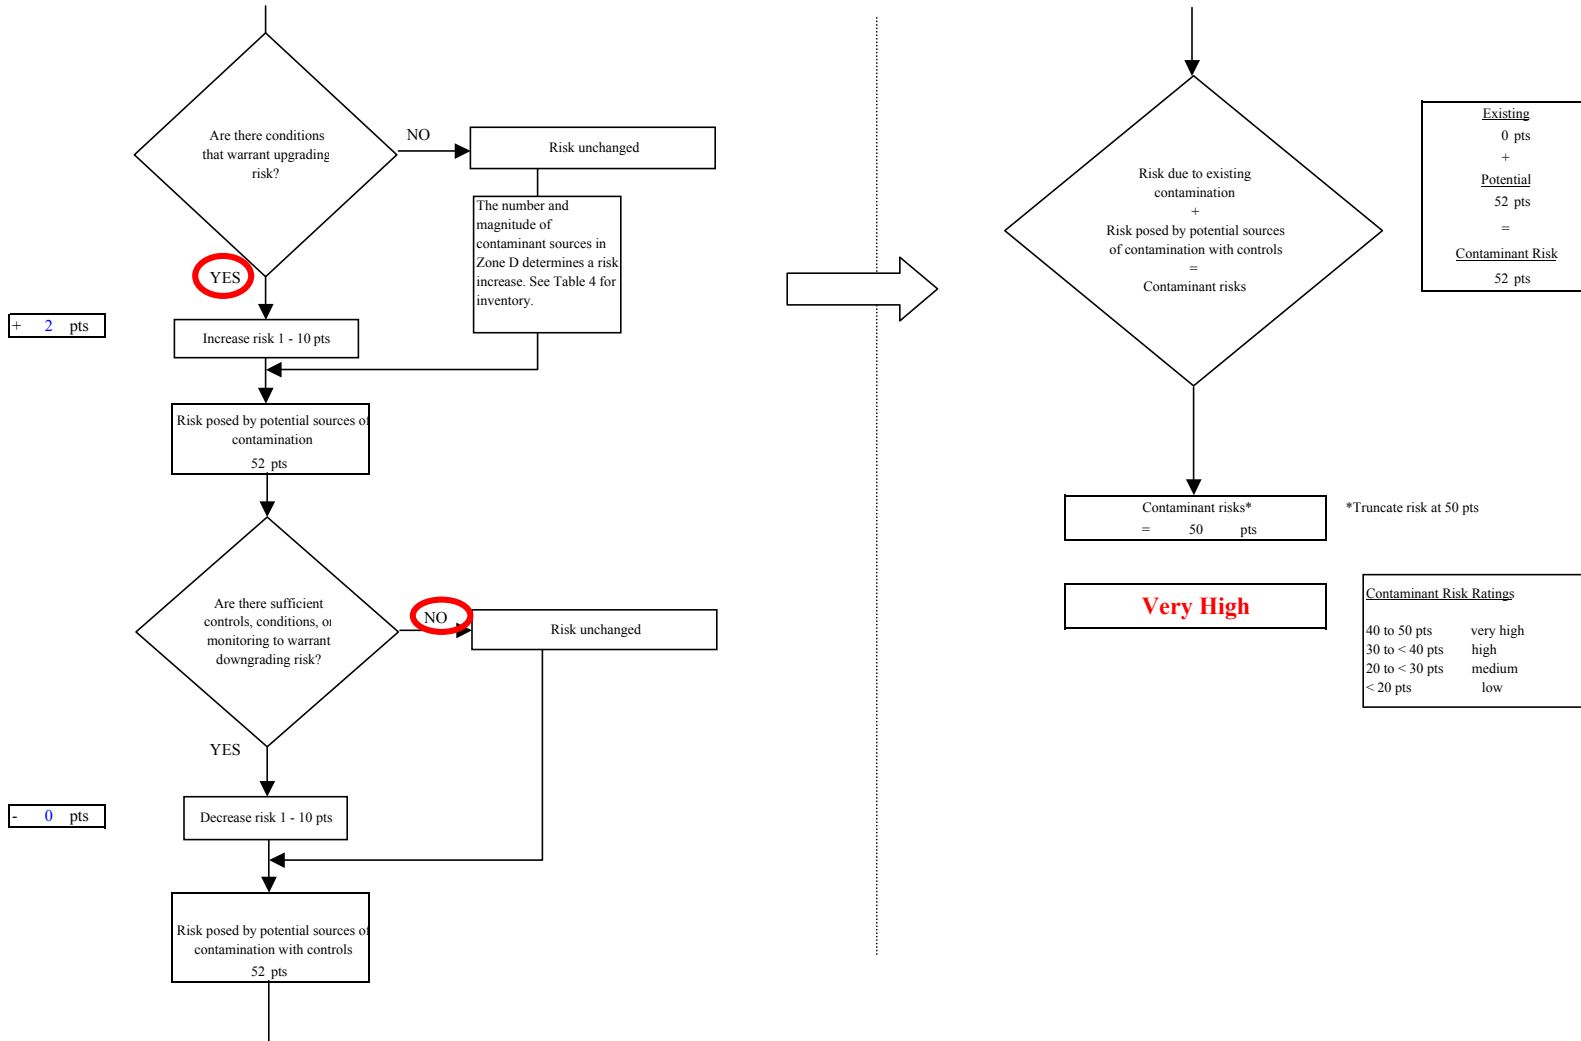


Chart 8. Vulnerability analysis for Bay View Terrace (PWS No. 261460.001) - Volatile Organic Chemicals

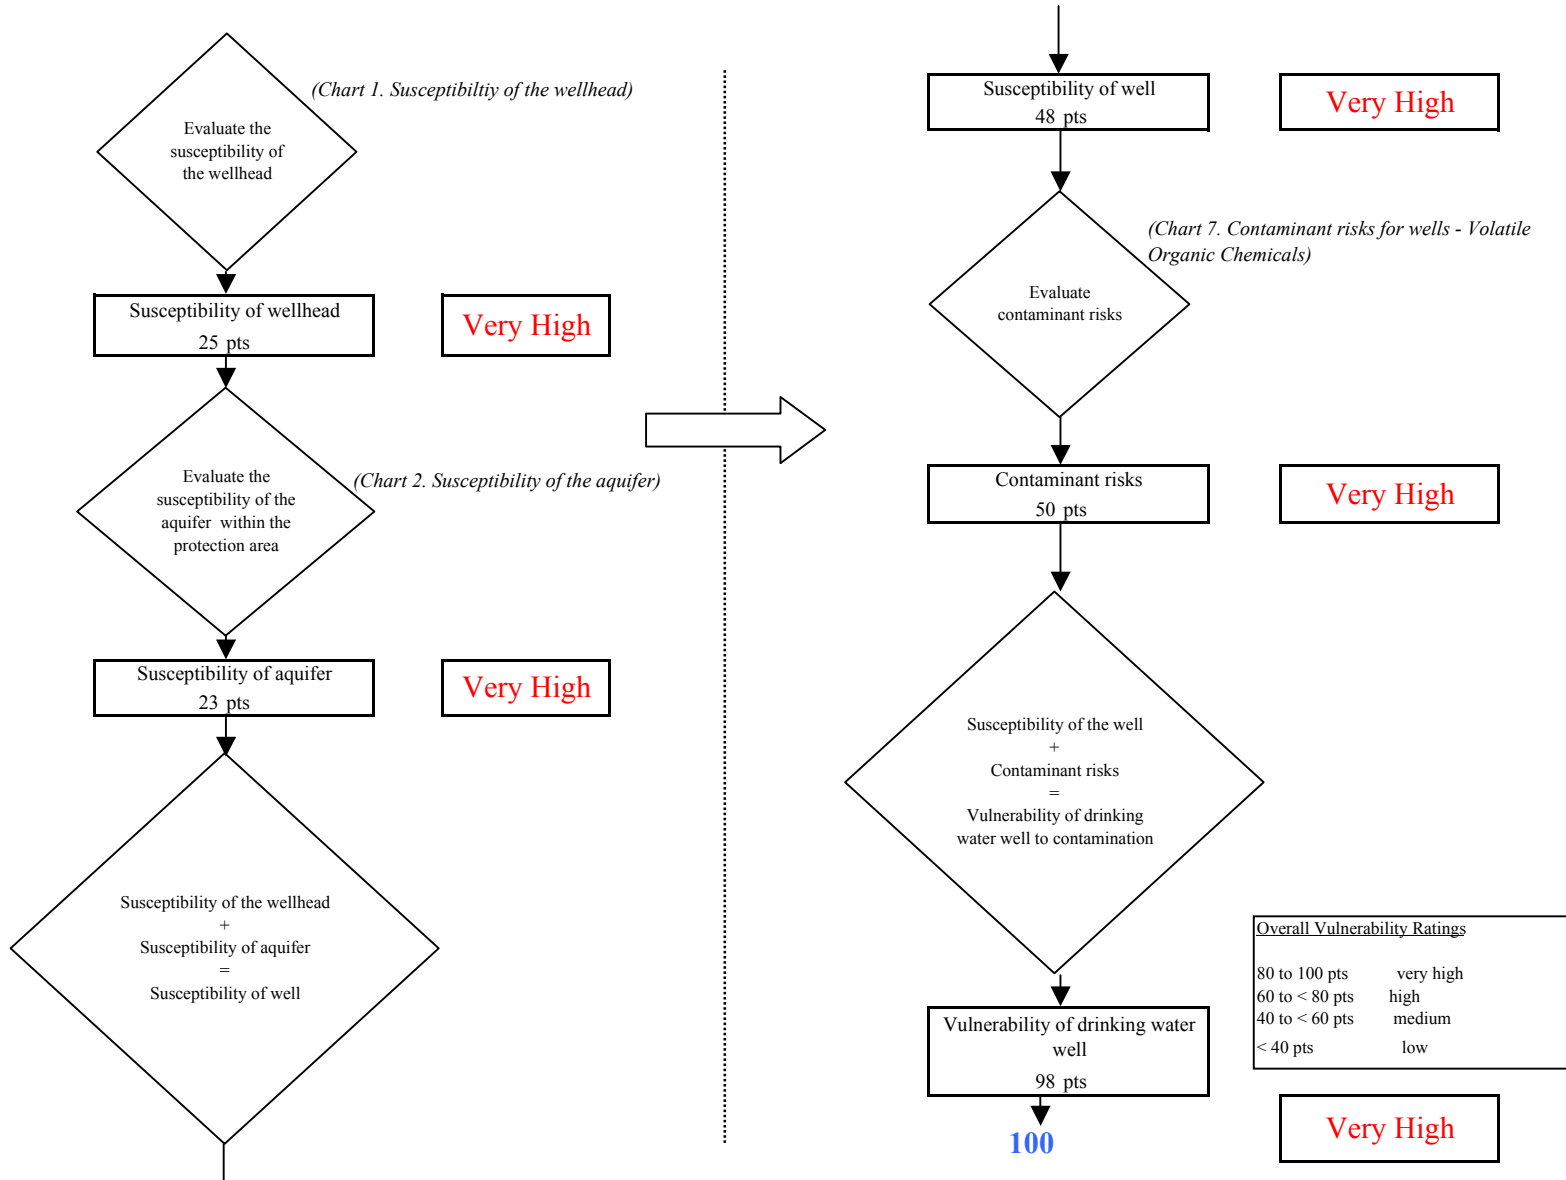


Chart 9. Contaminant risks for Bay View Terrace (PWS No. 261460.001) - Heavy Metals, Cyanide and Other Inorganic Chemicals

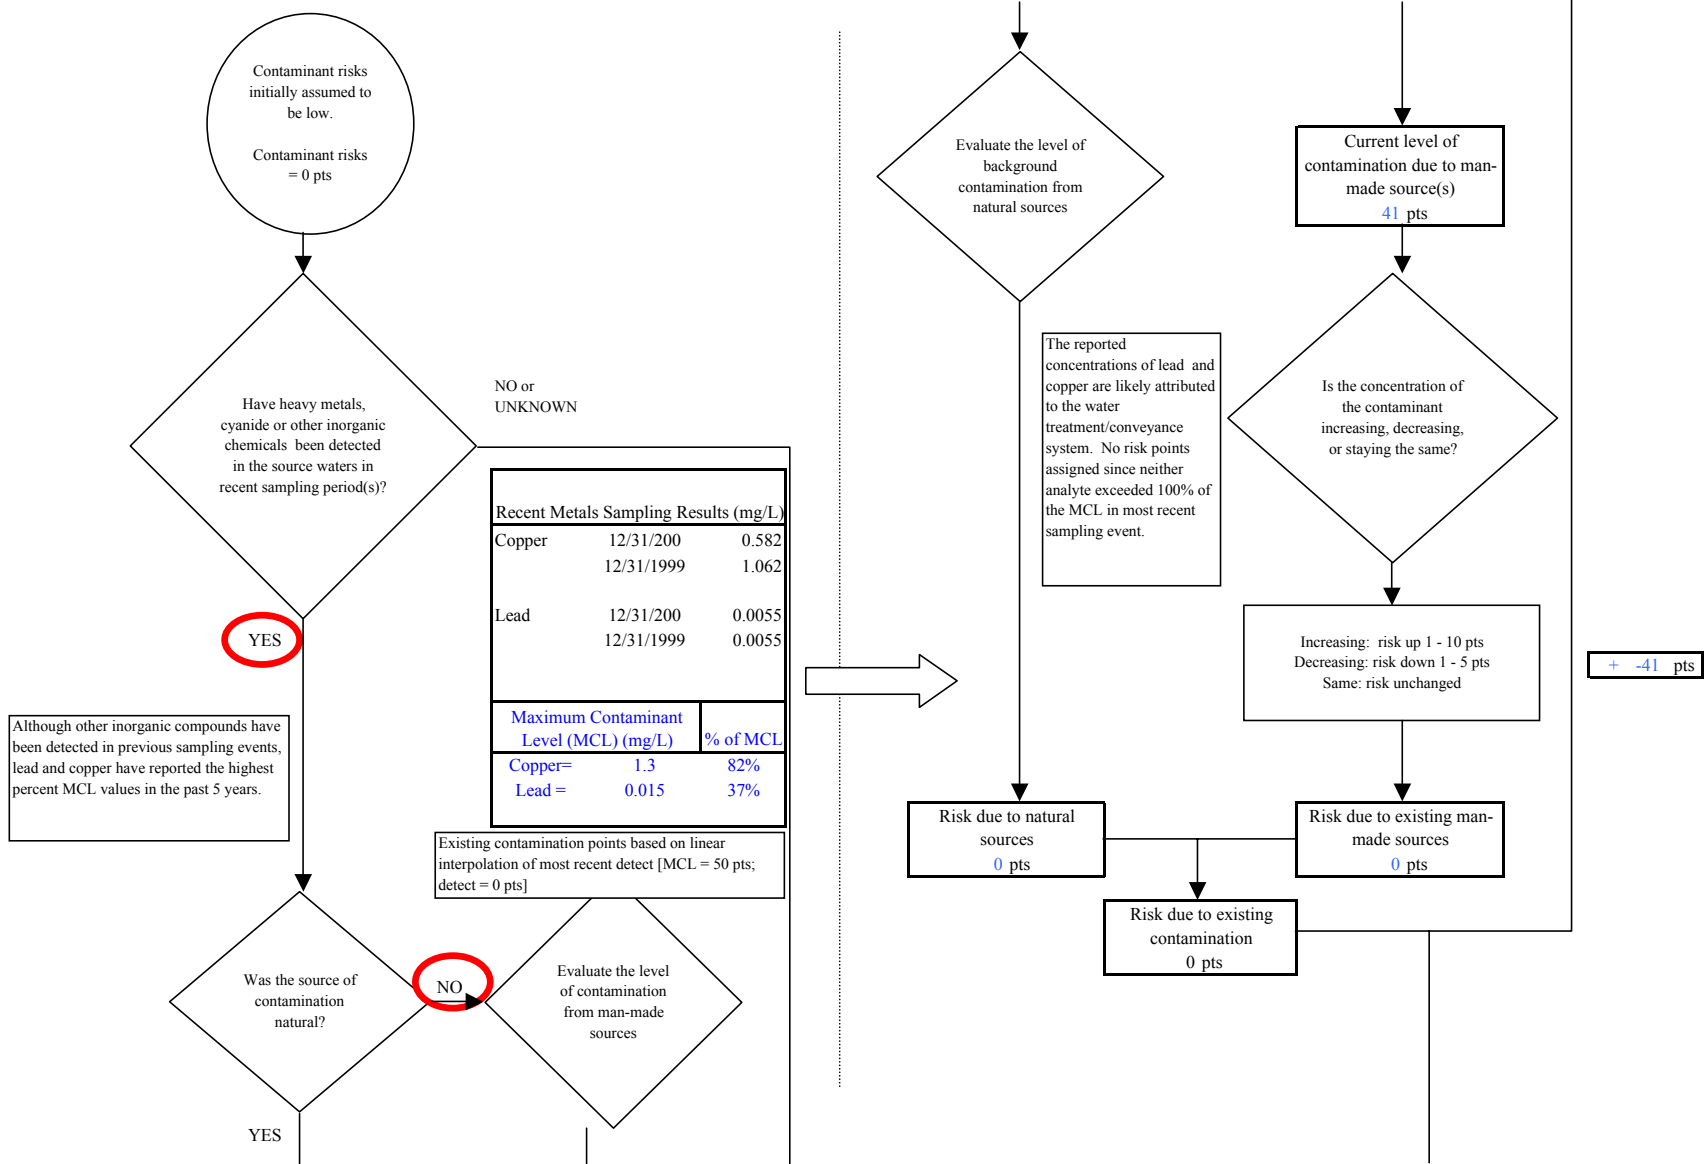


Chart 9. Contaminant risks for Bay View Terrace (PWS No. 261460.001) - Heavy Metals, Cyanide and Other Inorganic Chemicals

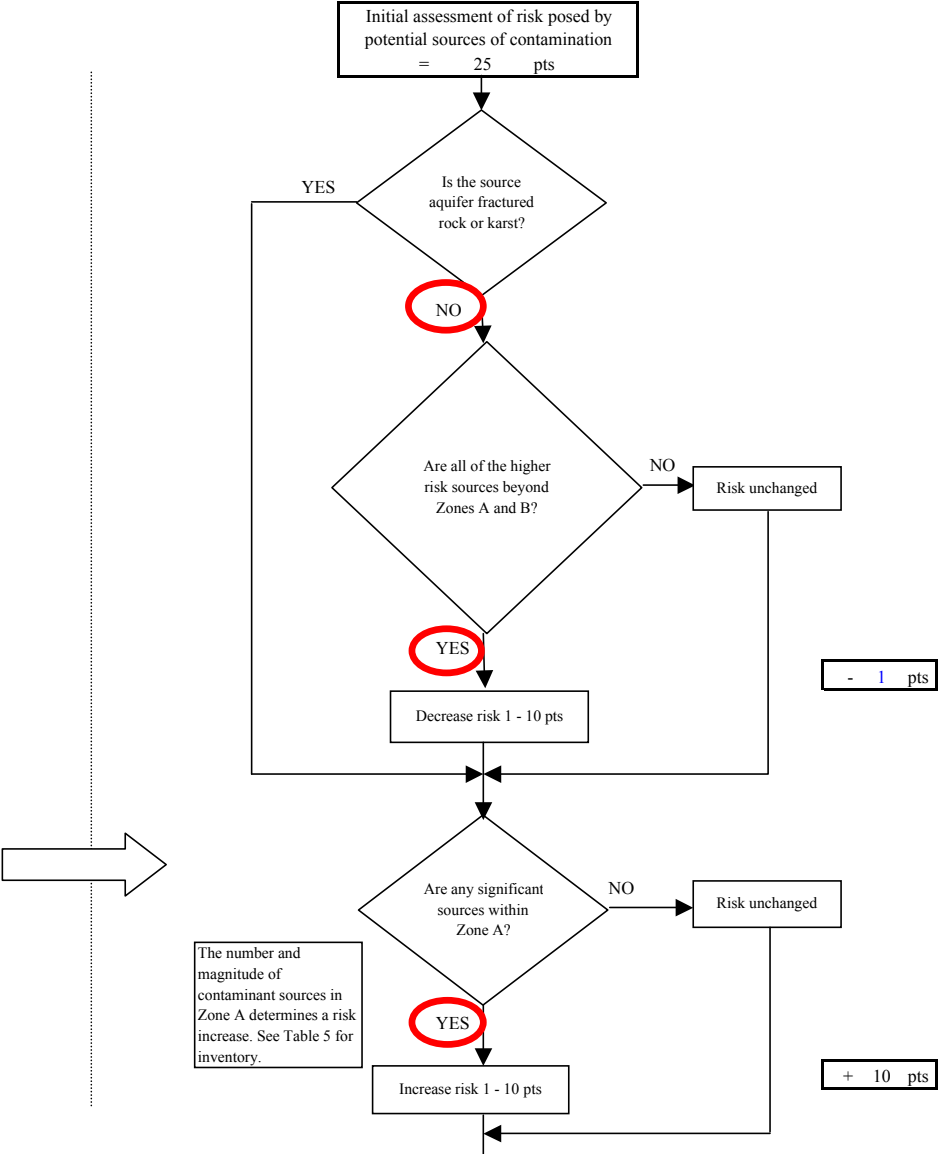
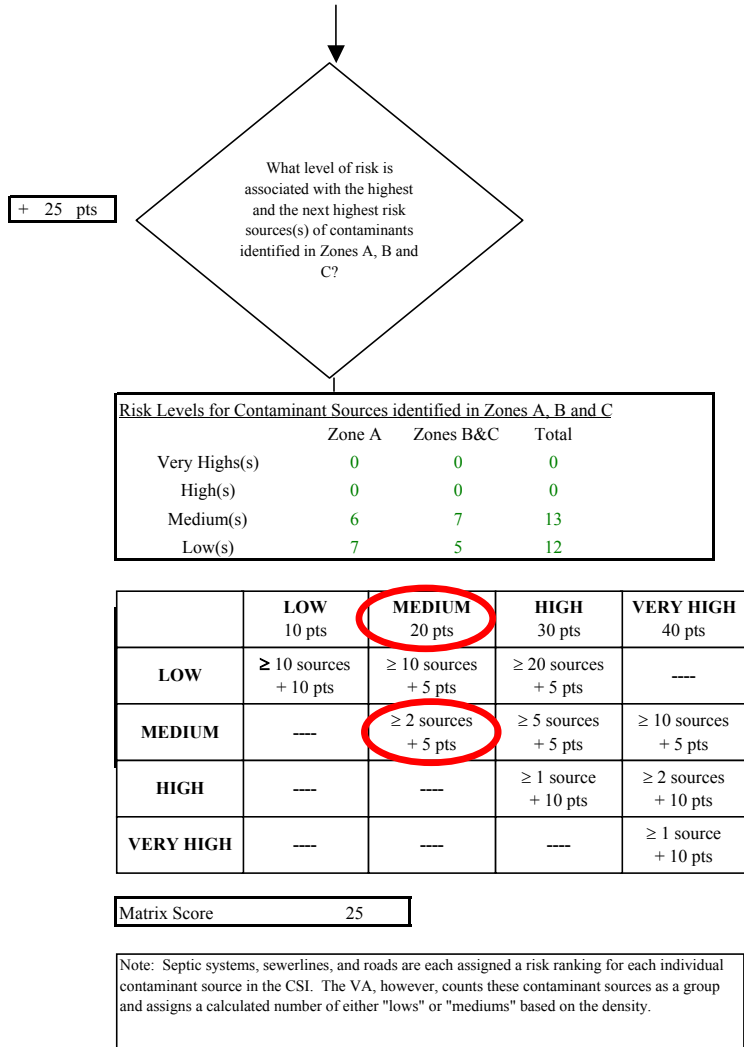


Chart 9. Contaminant risks for Bay View Terrace (PWS No. 261460.001) - Heavy Metals, Cyanide and Other Inorganic Chemicals

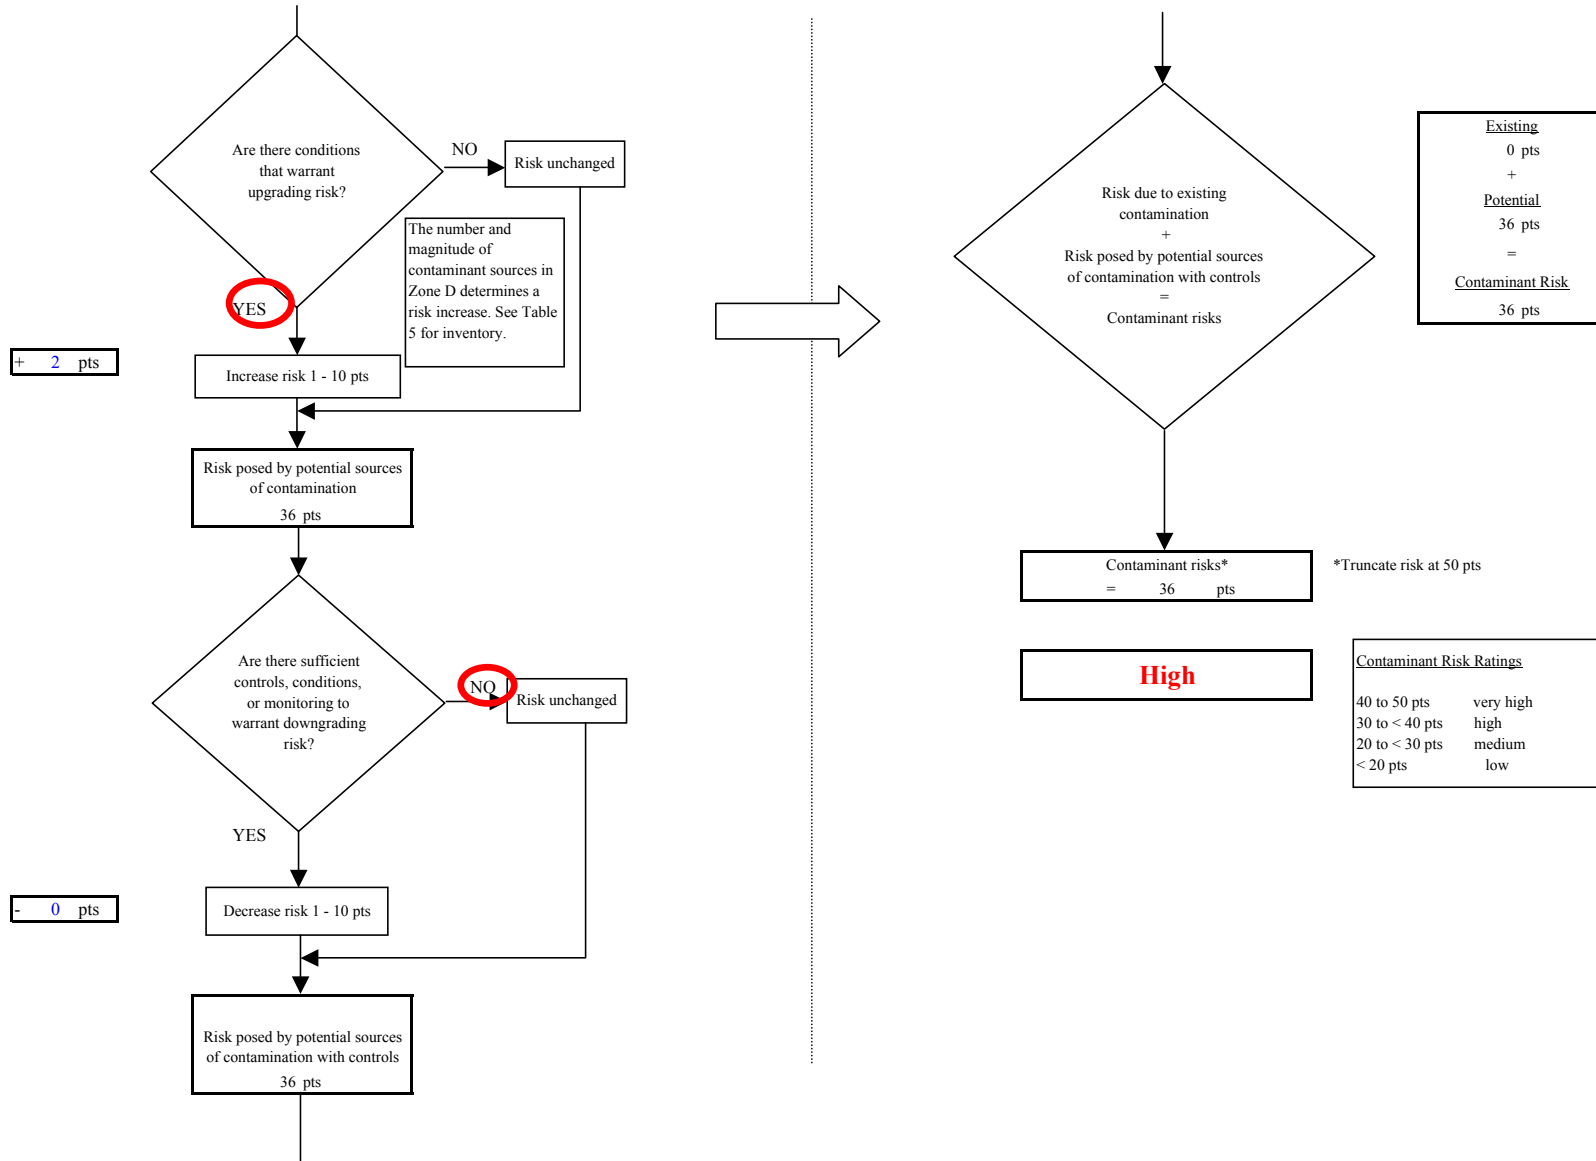


Chart 10. Vulnerability analysis for Bay View Terrace (PWS No. 261460.001) - Heavy Metals, Cyanide and Other Inorganic Chemicals

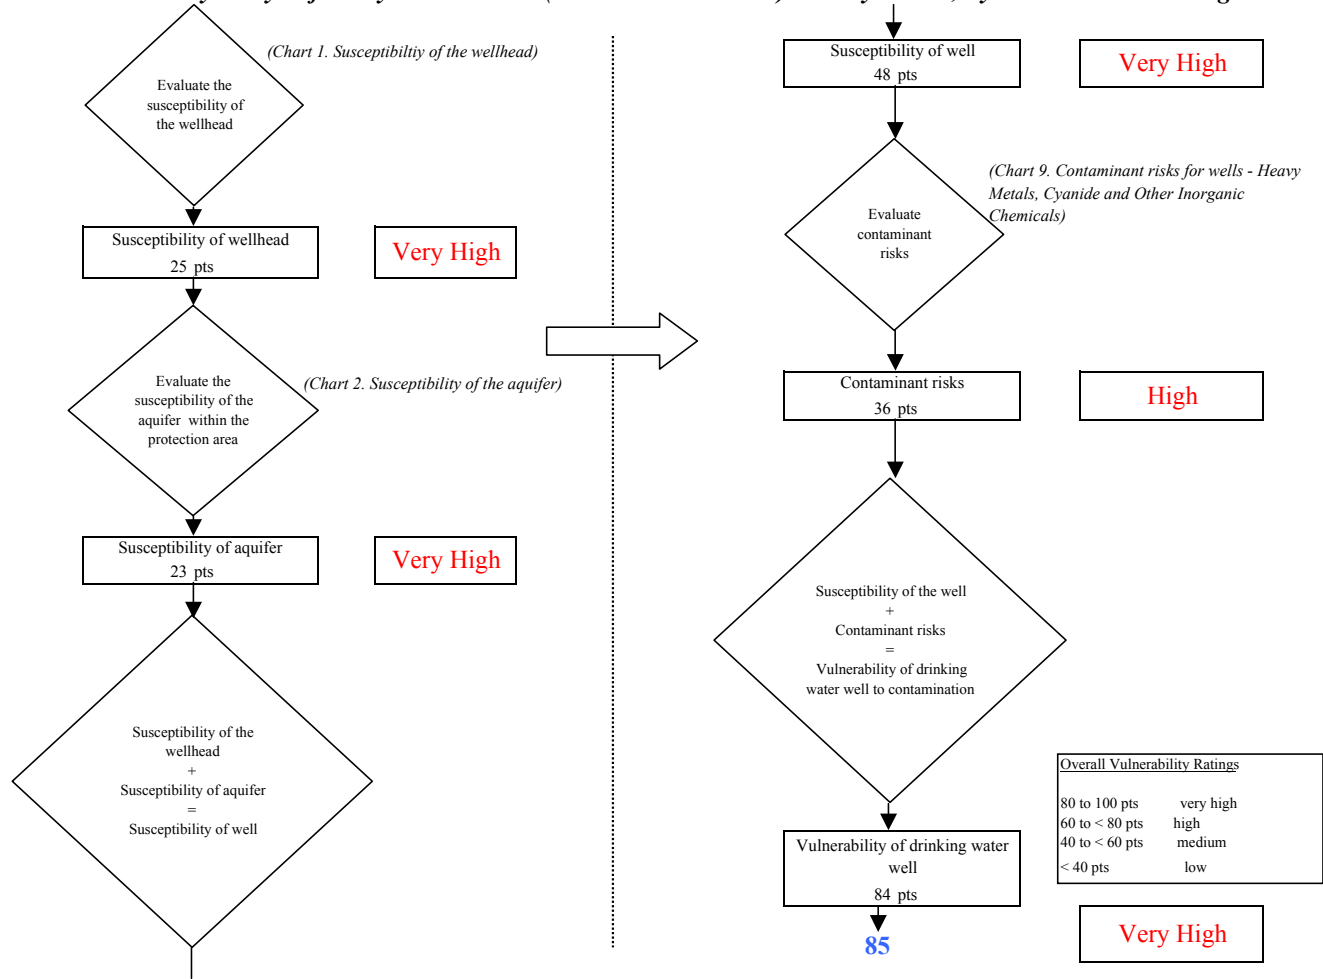


Chart 11. Contaminant risks for Bay View Terrace (PWS No. 261460.001) - Synthetic Organic Chemicals

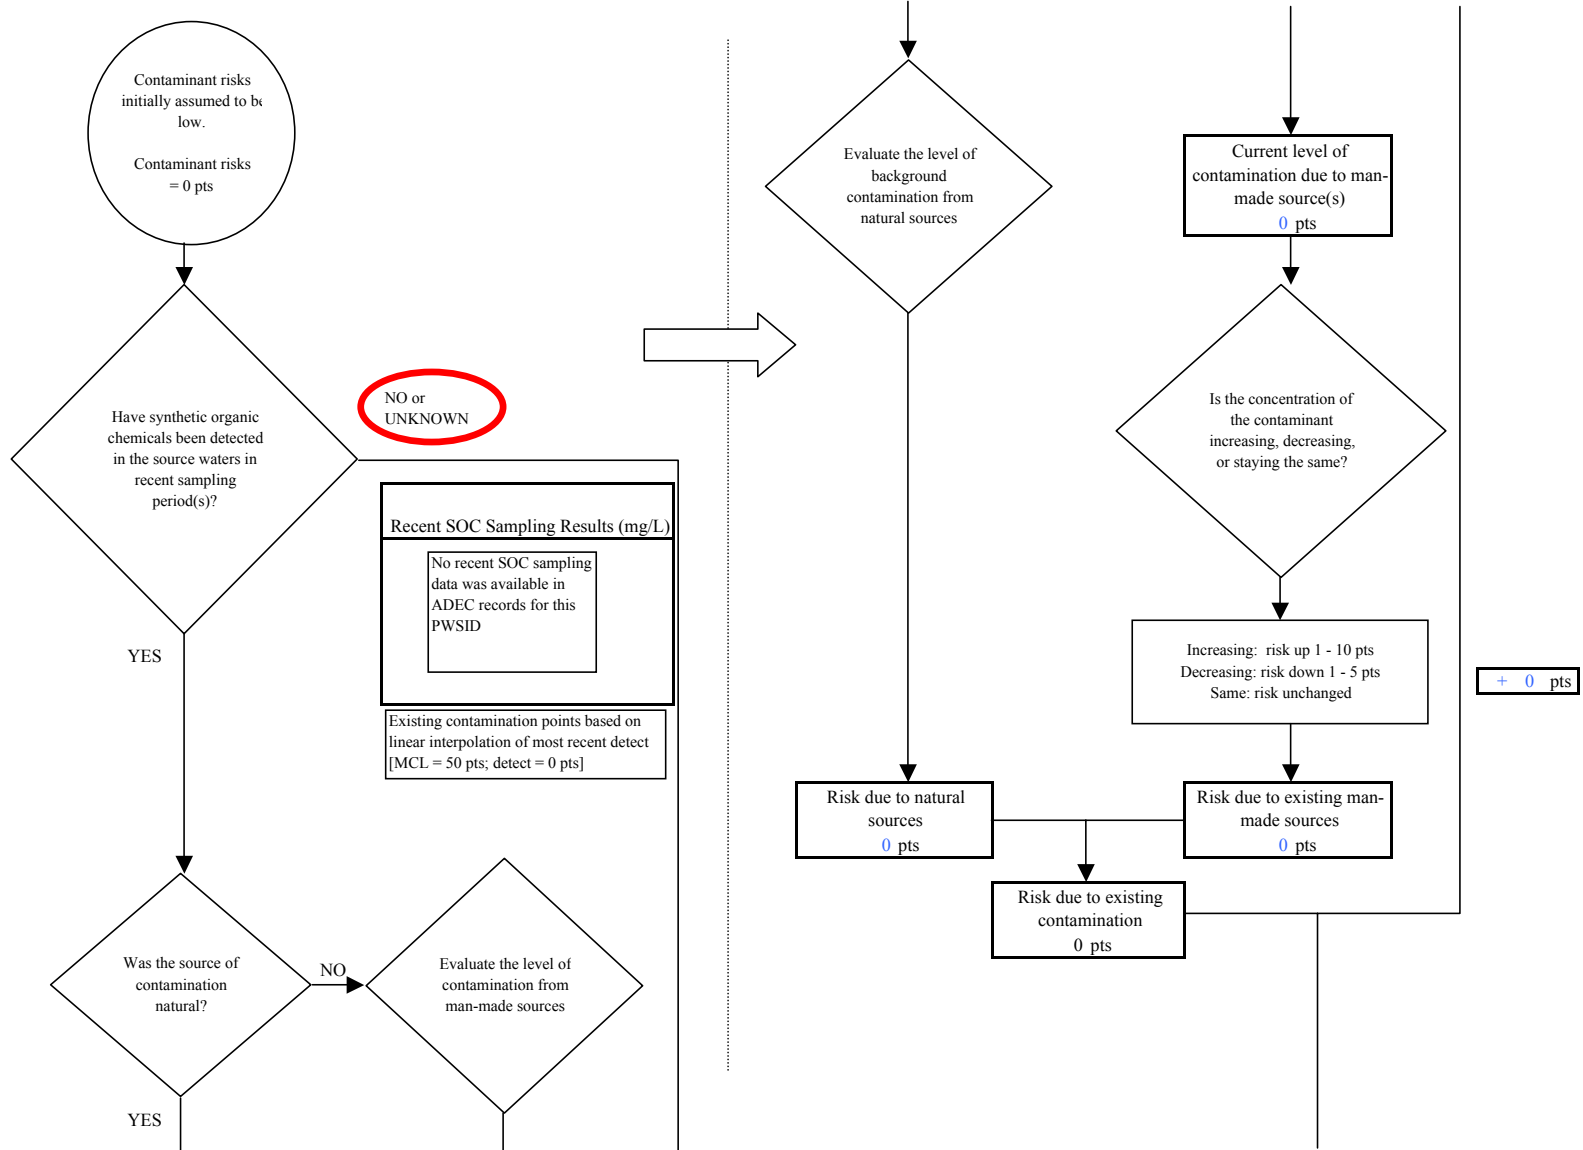


Chart 11. Contaminant risks for Bay View Terrace (PWS No. 261460.001) - Synthetic Organic Chemicals

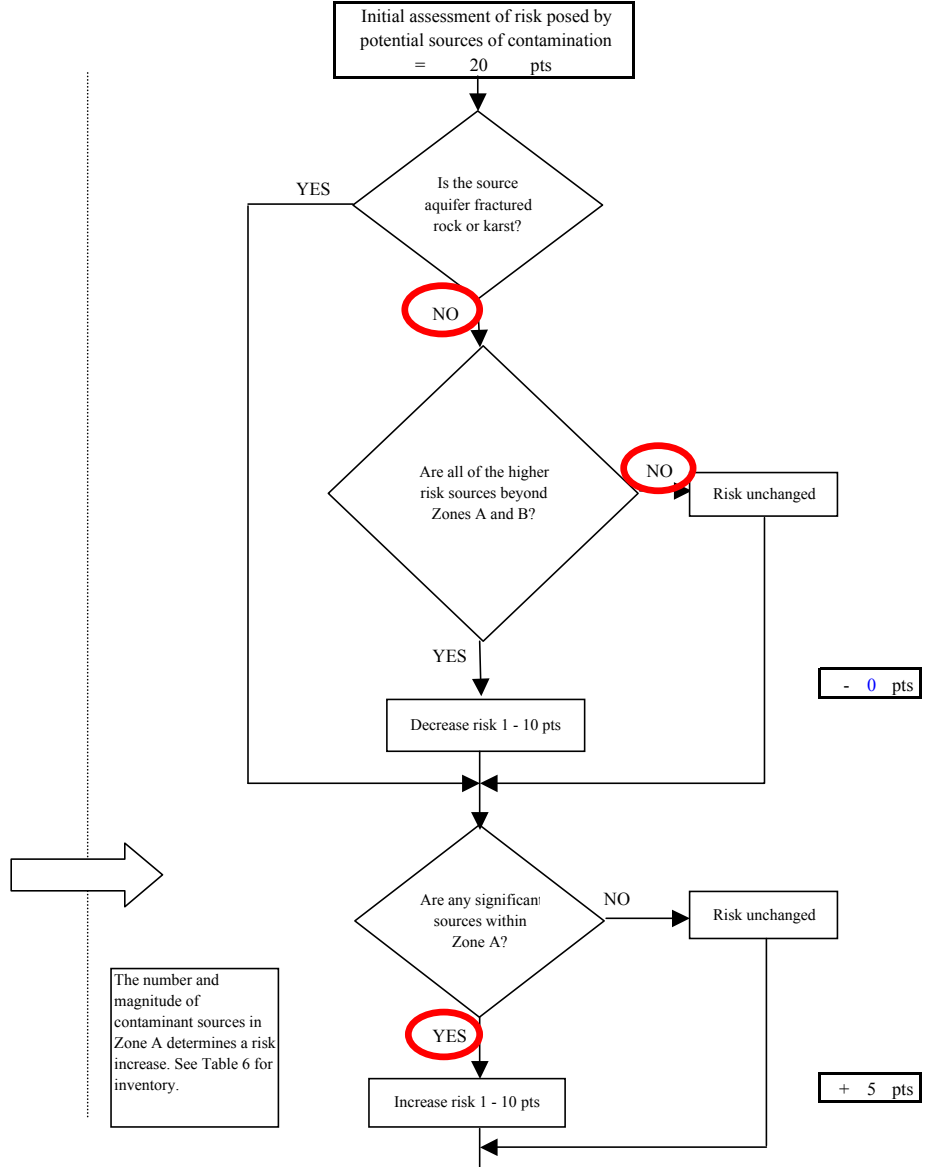
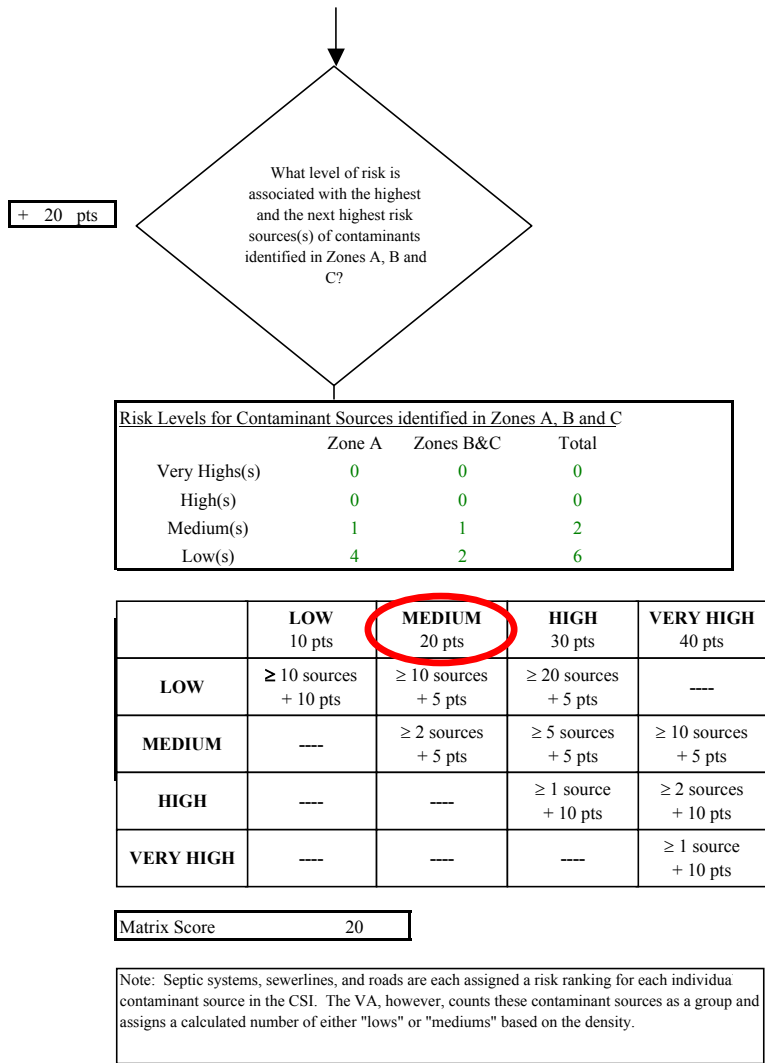


Chart 11. Contaminant risks for Bay View Terrace (PWS No. 261460.001) - Synthetic Organic Chemicals

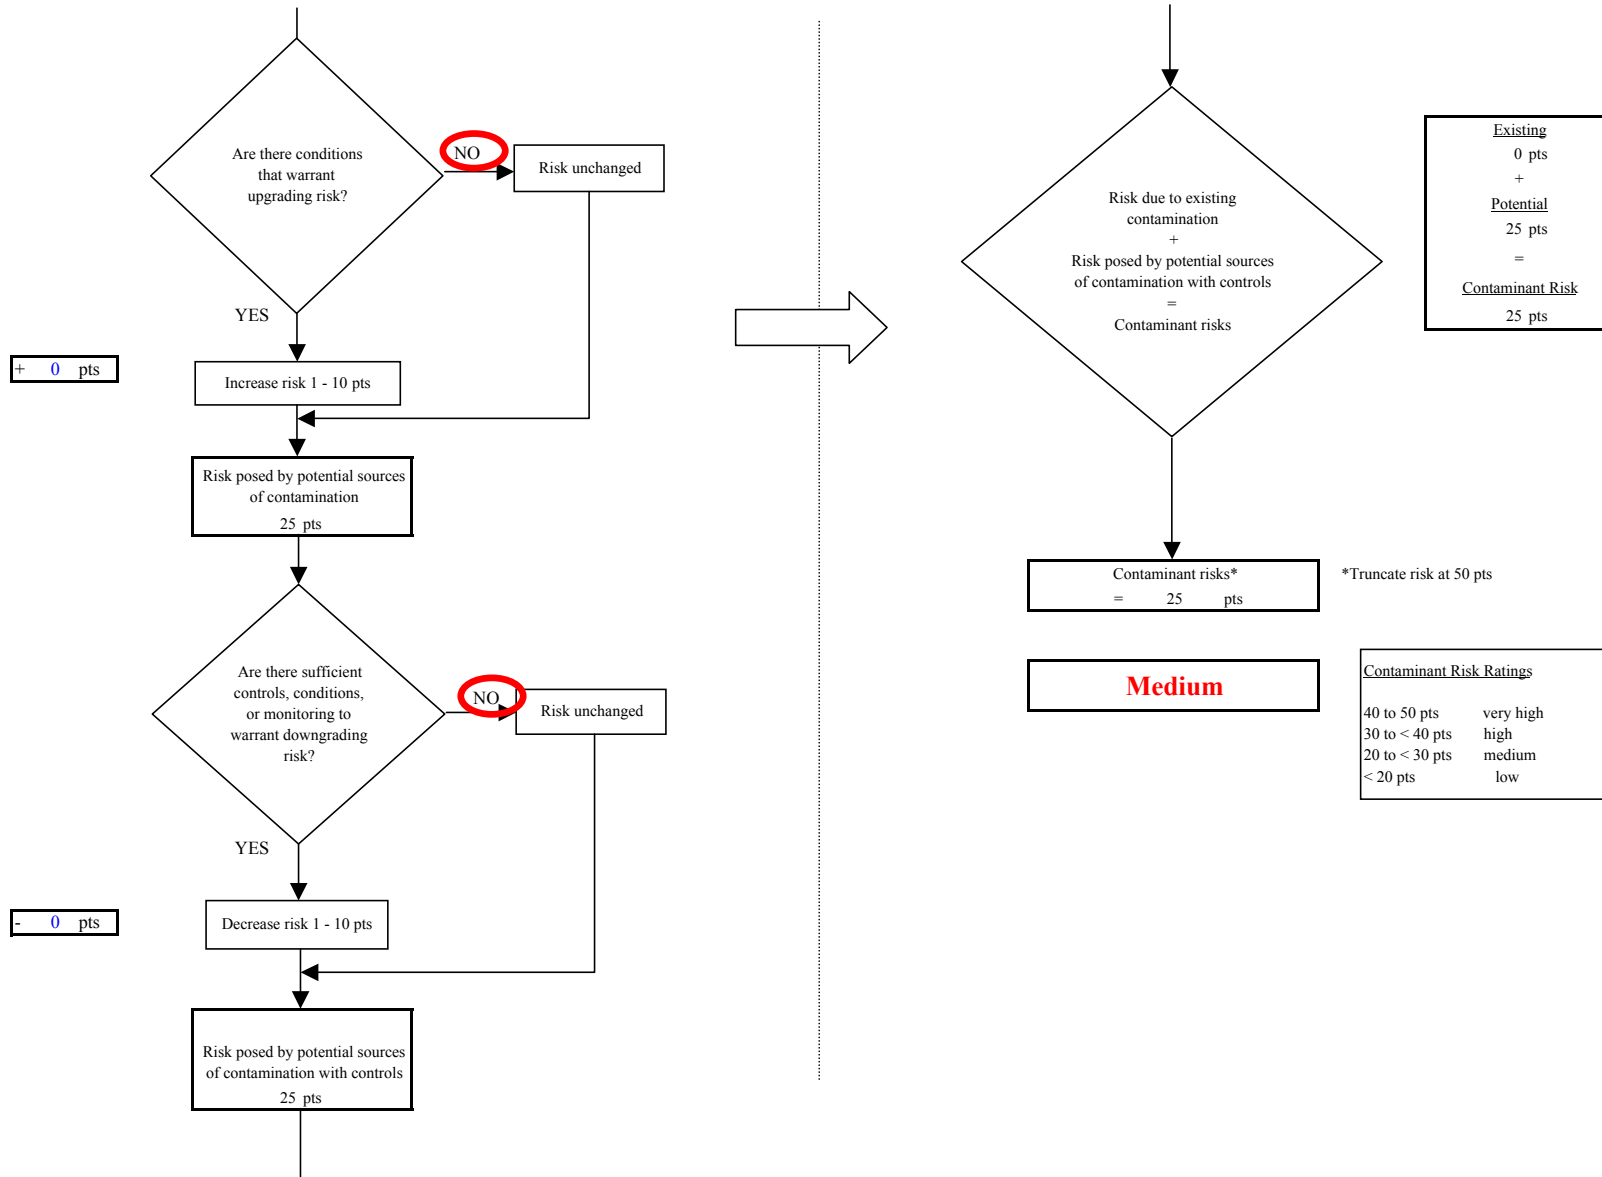


Chart 12. Vulnerability analysis for Bay View Terrace (PWS No. 261460.001) - Synthetic Organic Chemicals

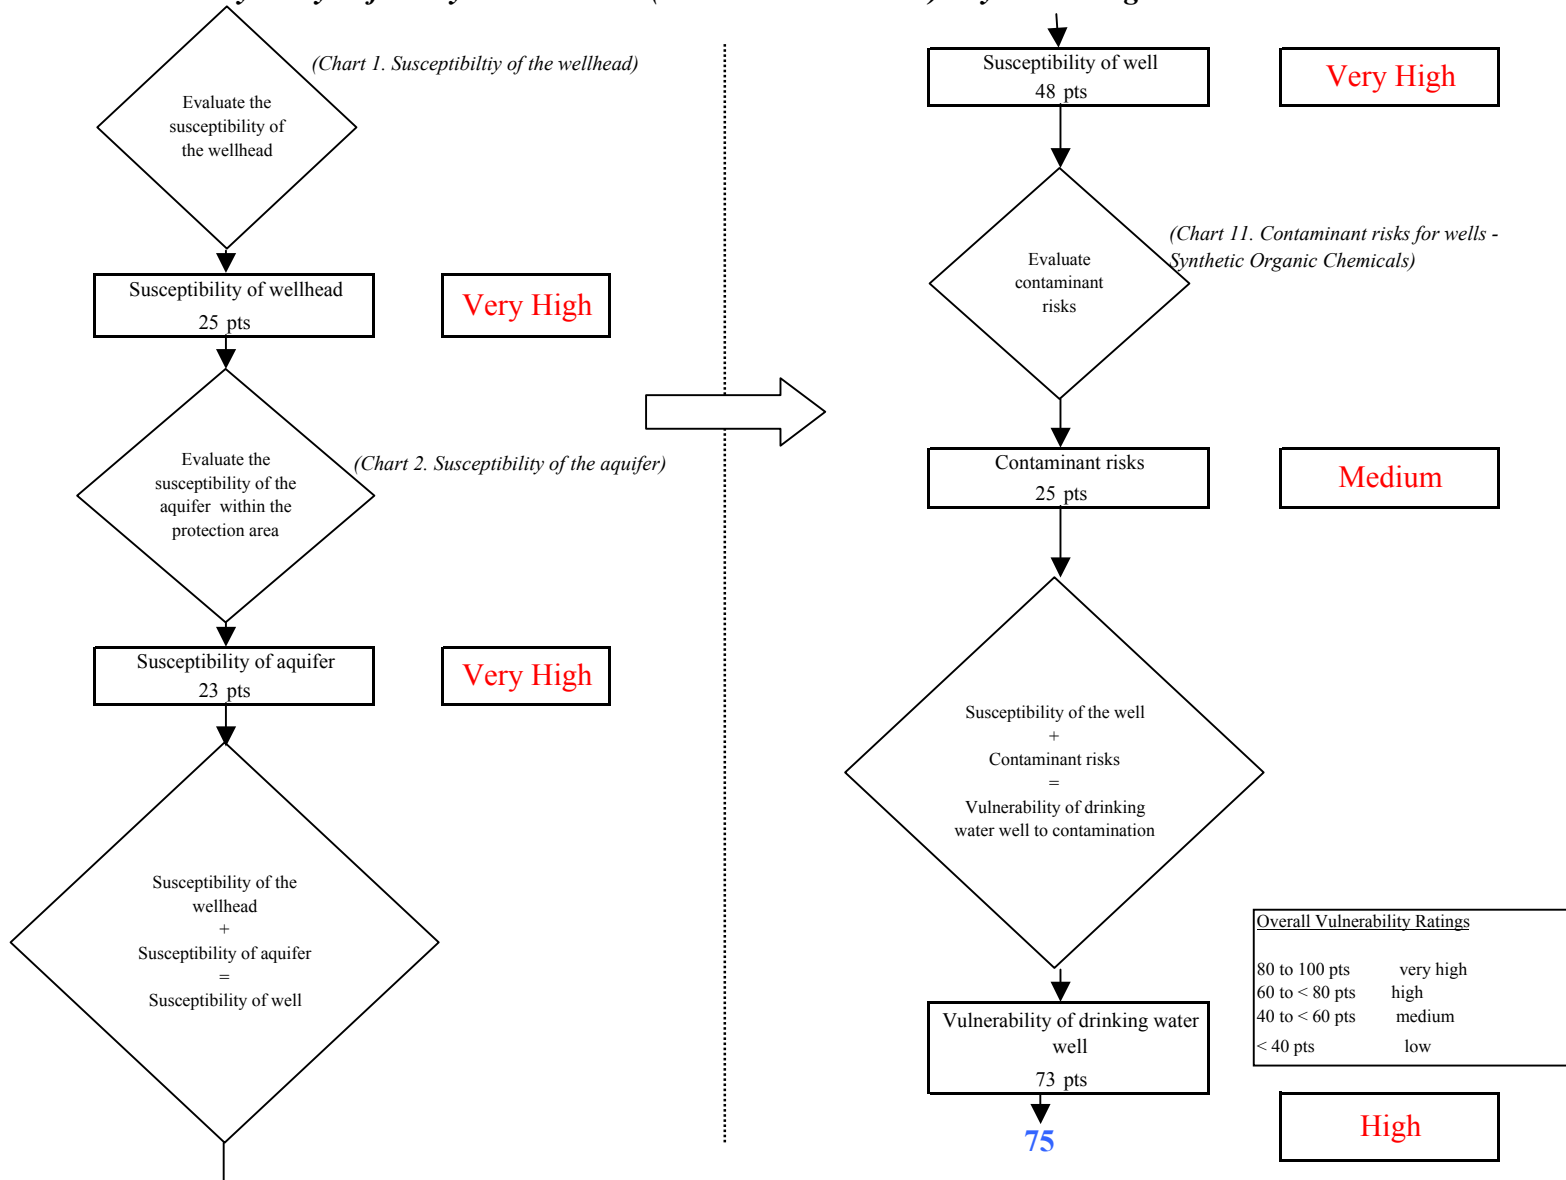


Chart 13. Contaminant risks for Bay View Terrace (PWS No. 261460.001) - Other Organic Chemicals

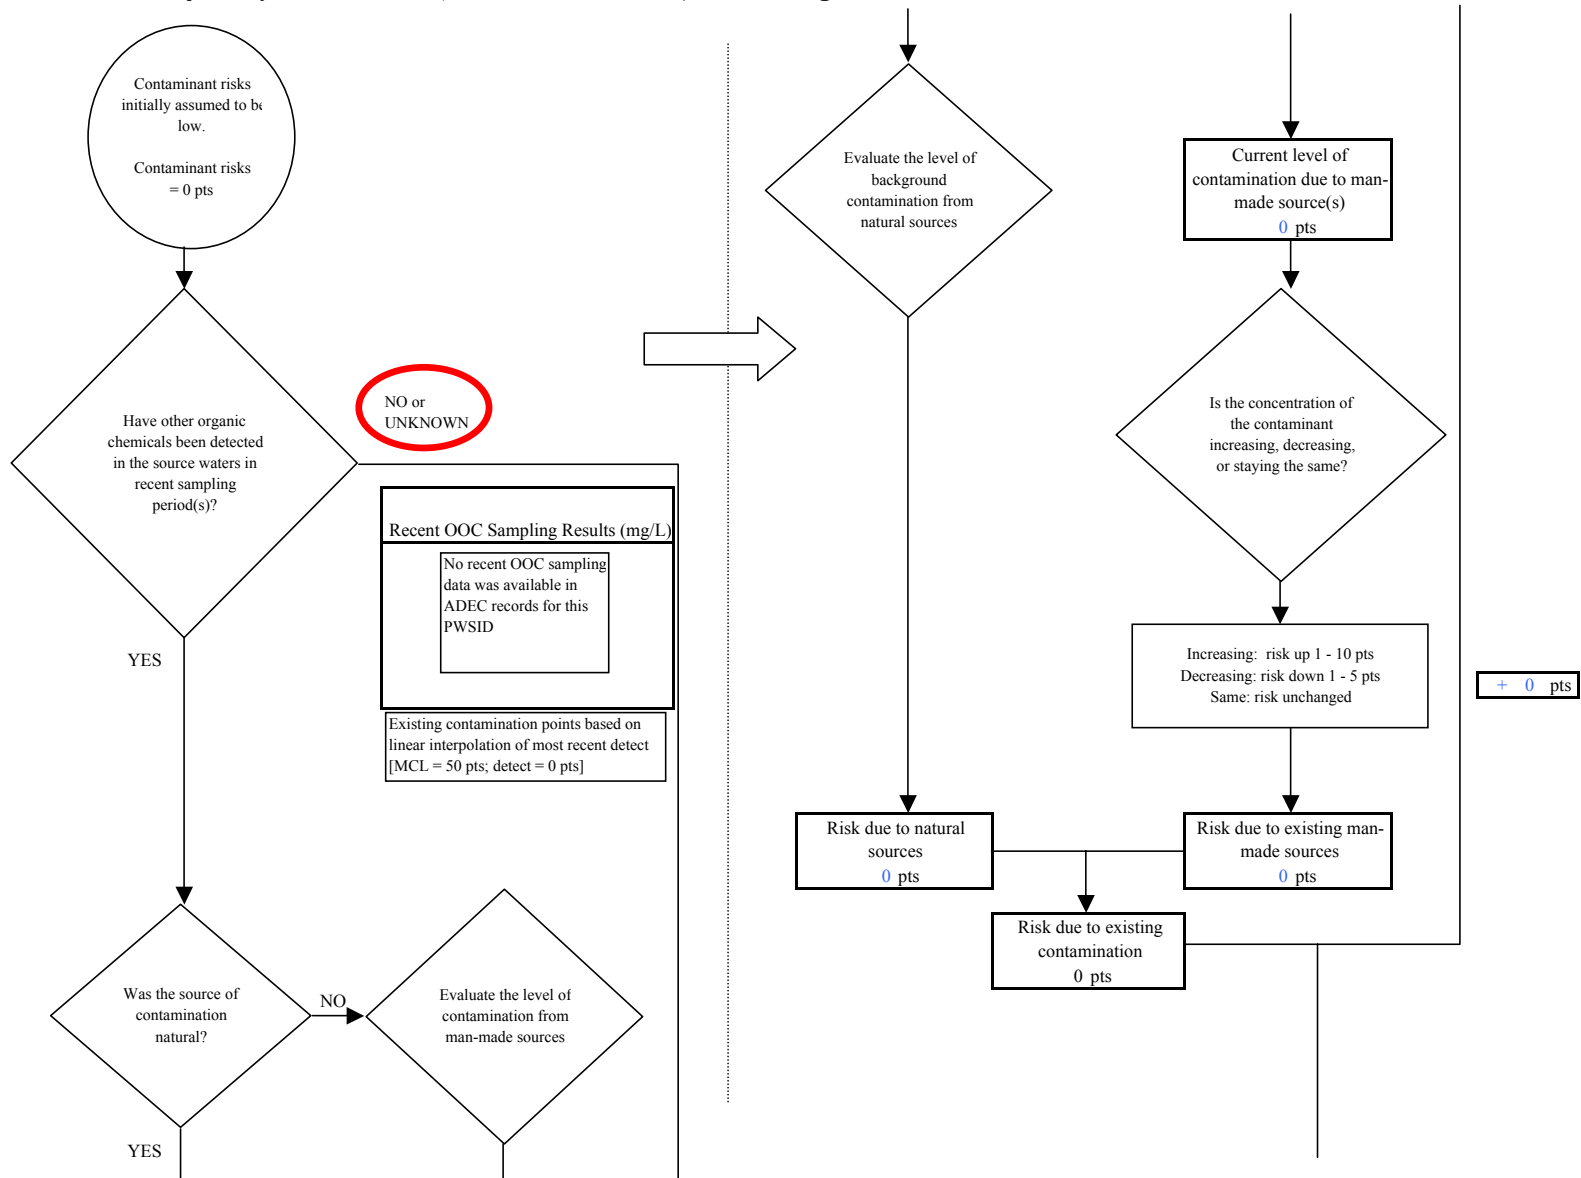


Chart 13. Contaminant risks for Bay View Terrace (PWS No. 261460.001) - Other Organic Chemicals

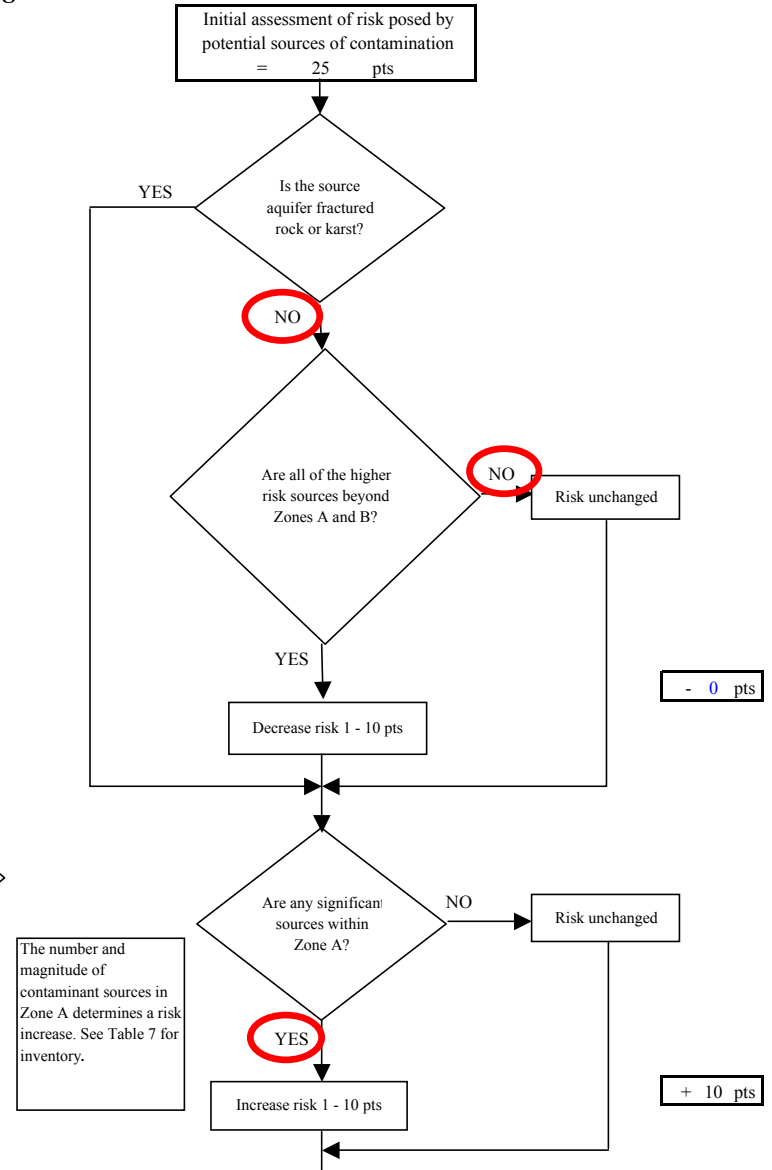

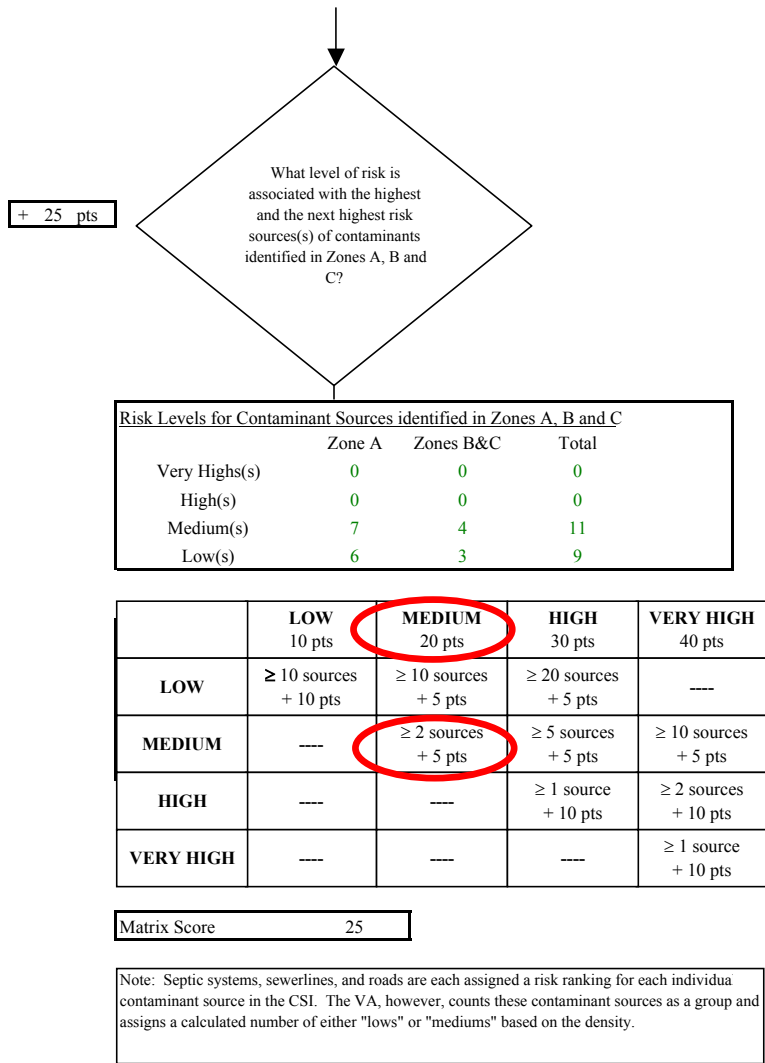


Chart 13. Contaminant risks for Bay View Terrace (PWS No. 261460.001) - Other Organic Chemicals

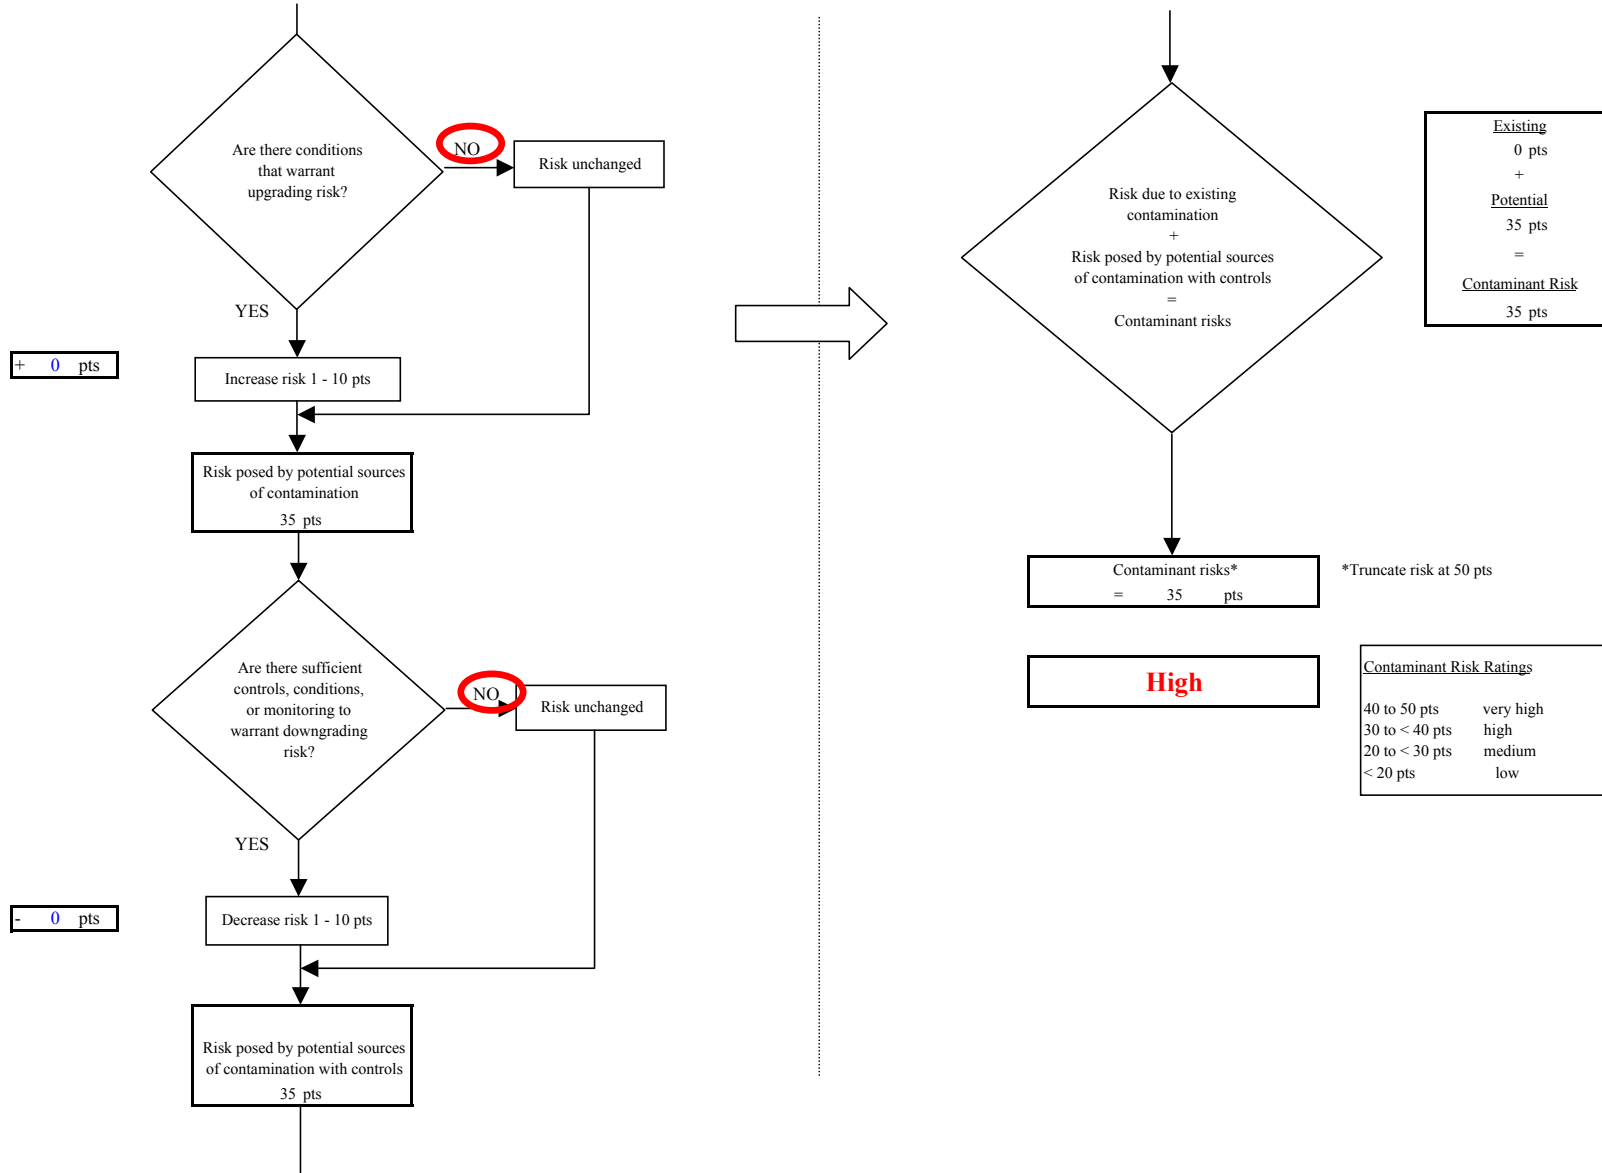


Chart 14. Vulnerability analysis for Bay View Terrace (PWS No. 261460.001) - Other Organic Chemicals

