



Source Water Assessment

A Hydrogeologic Susceptibility and Vulnerability Assessment for Rainbow Valley Mobile Home Park Drinking Water System, Fairbanks area, Alaska PWSID # 310879

DECEMBER 2002

DRINKING WATER PROTECTION PROGRAM REPORT Report 808
Alaska Department of Environmental Conservation

Source Water Assessment for Rainbow Valley Mobile Home Park Drinking Water System Fairbanks area, Alaska PWSID# 310879

DECEMBER 2002

DRINKING WATER PROTECTION PROGRAM REPORT Report 808

The Drinking Water Protection Program (DWPP) is producing Source Water Assessments in compliance with the Safe Drinking Water Act Amendments of 1996. Each assessment includes a delineation of the source water area, an inventory of potential and existing contaminant sources that may impact the water, a risk ranking for each of these contaminants, and an evaluation of the potential vulnerability of these drinking water sources.

These assessments are intended to provide public water systems owners/operators, communities, and local governments with the best available information that may be used to protect the quality of their drinking water. The assessments combine information obtained from various sources, including the U.S. Environmental Protection Agency, Alaska Department of Environmental Conservation (ADEC), public water system owners/operators, and other public information sources. The results of this assessment are subject to change if additional data becomes available. It is anticipated this assessment will be updated every five years to reflect any changes in the vulnerability and/or susceptibility of public drinking water source. If you have any additional information that may affect the results of this assessment, please contact the Program Coordinator of DWPP, (907) 269-7521.

CONTENTS

| | | CONTI | LIN 1 S | Page | |
|--|-------------------|--|--|------|--|
| Executive Summ Rainbow Valley Public Drink Rainbow Valley Protection A | Mol ing Mol | Water System 1 | Inventory of Potential and Existing Contaminant Sources Ranking of Contaminant Risks Vulnerability of Rainbow Valley Mobile Home Pa Drinking Water System References | | |
| | | TAB | LES | | |
| TABLE | 1. | Definition of Zones | 2 | | |
| | 2. 3. 3. | Susceptibility Contaminant Risks Overall Vulnerability | 3 4 4 | | |
| | | APPEN | DICES | | |
| APPENDIX | A. | Rainbow Valley Mobile Home Park | Orinking Water Protection Area (Map 1) | | |
| | | B. Contaminant Source Inventory for Rainbow Valley Mobile Home Park (Table 1) Contaminant Source Inventory and Risk Ranking for Rainbow Valley Mobile Home Park - Bacteria and Viruses (Table 2) Contaminant Source Inventory and Risk Ranking for Rainbow Valley Mobile Home Park - Nitrates/Nitrites (Table 3) Contaminant Source Inventory and Risk Ranking for Rainbow Valley Mobile Home Park - Volatile Organic Chemicals (Table 4) Contaminant Source Inventory and Risk Ranking for Rainbow Valley Mobile Home Park - Heavy Metals, Cyanide, and Other Inorganic Chemicals (Table 5) Contaminant Source Inventory and Risk Ranking for Rainbow Valley Mobile Home Park - Synthetic Organic Chemicals (Table 6) Contaminant Source Inventory and Risk Ranking for Rainbow Valley Mobile Home Park - Other Organic Chemicals (Table 7) | | | |
| | C. | Rainbow Valley Mobile Home Park I and Existing Contaminant Source | Orinking Water Protection Area and Potential es (Map 2) | | |
| | D. | | ant Source Inventory and Risk Ranking for Park Public Drinking Water Source | | |

Source Water Assessment for Rainbow Valley Mobile Home Park Source of Public Drinking Water,

Fairbanks Area, Alaska

Drinking Water Protection Program Alaska Department of Environmental Conservation

EXECUTIVE SUMMARY

The public water system for Rainbow Valley Mobile Home Park is a Class A (community) water system consisting of three wells along Bridge Drive near the intersection of the New Steese Highway and Chena Hot Springs Road approximately 4 miles northeast of Fairbanks, Alaska. The wellhead received a susceptibility rating of Low and the aquifer received a susceptibility rating of **High**. Combining these two ratings produces a Medium risk rating for the natural susceptibility of the well. Identified potential and current sources of contaminants for Rainbow Valley Mobile Home Park public drinking water source include: a construction trade shop, residential septic systems, residential heating oil tanks, roads, and residential area. These identified potential and existing sources of contamination are considered as sources of bacteria and viruses, nitrates and/or nitrites, volatile organic chemicals, heavy metals, cyanide, and other inorganic chemicals, synthetic organic chemicals, and other organic chemicals. Combining the natural susceptibility of the well with the contaminant risk, the public water source for Rainbow Valley Mobile Home Park received a vulnerability rating of **High** for bacteria and viruses, and nitrates and/or nitrites, and a Medium for volatile organic chemicals, and a Low for heavy metals, synthetic organic chemicals and other organic chemicals.

RAINBOW VALLEY MOBILE HOME PARK PUBLIC DRINKING WATER SYSTEM

Rainbow Valley Mobile Home Park public water system is a Class A (community) water system. The system consists of three wells along Bridge Drive near the intersection of the Steese Highway and Chena Hot Springs Road approximately 4 miles northeast of Fairbanks, Alaska (T1N, R1E, Section 30) (See Map 1 of Appendix A). Fairbanks and its surrounding communities are located in the Fairbanks North Star Borough which is near the center of Alaska (Please see the inset of Map 1 in Appendix A for location). The Borough's current population is 82,840 making it the second-largest population center in the state (ADCED, 2002). Communities located within the Borough include: College, Eielson Air Force Base, Ester,

Fairbanks, Fox, Harding Lake, Moose Creek, North Pole, Pleasant Valley, Salcha, and Two Rivers.

The majority of residents in the Fairbanks area use individual wells or hauled water, and septic systems (ADCED, 2002). Heating oil (commonly stored in both above and below ground 275 to 500-gallon tanks) is most commonly used for heating homes and buildings (ADCED, 2002). Refuse is transported to the Fairbanks North Star Borough landfill.

The Fairbanks area includes two distinct topographic areas: the floodplain of the Tanana River and the Chena River, and the uplands north of this floodplain. The wells for Rainbow Valley Mobile Home Park are located in the uplands at an elevation of approximately 750 feet above sea level.

According to the well log for each well, the depth of well number one is 120 feet below ground surface (bgs) and for well numbers two and three is about 175 feet bgs. All three wells are screened in bedrock. Bedrock in this area is predominantly a metamorphosed marine mud deposit, called a pelitic schist. The schist is locally intruded by granitic rocks – granite and quartz diorite. Groundwater in the bedrock is principally contained in fractures. The water wells in this area with the greatest well recharge appear to be in quartz veins, quartzite, and siliceous schist (Nelson, 1978).

Groundwater in the uplands is recharged by local precipitation. Outflow of ground water in the uplands primarily occurs two ways. In areas under artesian pressure (pressure caused by overlying permafrost), water can flow to the surface through thawed conduits within the permafrost. Otherwise groundwater will flow under the permafrost (if present) and out to the groundwater beneath the adjacent flood plain or creek valley (Nelson, 1978).

The most recent Sanitary Survey (6/22/01) indicates all three wells were installed with a cap providing a sanitary seal. A properly installed sanitary seal may provide protection against contaminants from entering the source waters at the well casing. The land surface is also appropriately sloped away from each of the wells allowing surface water and contaminants to drain away

from the wells. It is not known if the wells are grouted according to ADEC regulations. Proper grouting provides added protection against contaminants travelling along the well casing and into source waters. The wells are not located in a known floodplain.

This system operates year-round and serves approximately 200 residents through 98 service connections.

DRINKING WATER PROTECTION AREA

The pathways most likely for surface contamination to reach the groundwater are identified as the first step in determining a drinking water system's risk. These areas are determined by looking at the characteristics of the soil, groundwater, aquifer, and well.

The most probable area for contamination to reach the drinking water well is the area that contributes water to the well, the groundwater recharge area. This area is designated as the drinking water protection area, and will serve as the focus for voluntary protection efforts.

An outline of the immediate watershed was used to determine the size and shape of the protection area for Rainbow Valley Mobile Home Park. Available geology was also considered to take into account any uncertainties in groundwater flow and aquifer characteristics to arrive at a meaningful protection area (Please refer to the Guidance Manual for Class A Public Water Systems for additional information).

The protection areas established for wells by the ADEC are usually separated into four zones, limited by the watershed. These zones correspond to differences in the time-of-travel (TOT) of the water moving through the aquifer to the well. The protection area for Rainbow Valley Mobile Home Park is limited by its immediate watershed and includes only Zone A (See Map 1 of Appendix A). The input parameters describing the attributes of the aquifer in this calculation were adopted from the U.S. Geological Survey (*Patrick, Brabets, and Glass, 1989*), and State of Alaska Department of Water Resources (*Jokela et. al., 1991*).

The time of travel for contaminants within the water varies and is dependent on the physical and chemical characteristics of each contaminant. The following is a summary of the four protection area zones for wells and the calculated time-of-travel for each:

Table 1. Definition of Zones

| Zone Definition | | | | | | | | |
|------------------------|---|--|--|--|--|--|--|--|
| A | ½ the distance for the 2-yr. time-of-travel | | | | | | | |
| В | Less than the 2 year time-of-travel | | | | | | | |
| C | Less than the 5 year time-of-travel | | | | | | | |
| D | Less than the 10 year time-of-travel | | | | | | | |
| | | | | | | | | |

INVENTORY OF POTENTIAL AND EXISTING CONTAMINANT SOURCES

The Drinking Water Protection Program has completed an inventory of potential and existing sources of contamination within the Rainbow Valley Mobile Home Park protection area. This inventory was completed through a search of agency records and other publicly available information. Potential sources of contamination to the drinking water aquifer include a wide range of categories and types. Potential drinking water contaminants are found within agricultural, residential, commercial, and industrial areas, but can also occur within areas that have little or no development.

For the basis of all Class A public water system assessments, six categories of drinking water contaminants were inventoried. They include:

- Bacteria and viruses;
- Nitrates and/or nitrites:
- Volatile organic chemicals;
- Heavy metals, cyanide, and other inorganic chemicals;
- Synthetic organic chemicals
- Other organic chemicals.

•

The sources are displayed on Map 2 of Appendix C and summarized in Table 1 of Appendix B.

RANKING OF CONTAMINANT RISKS

Once the potential and existing sources of contamination have been identified, they are assigned a ranking according to what type and level of risk they represent. Ranking of contaminant risks for a "potential" or "existing" source of contamination is a function of toxicity and volumes of specific contaminants associated with that source. Rankings include:

- Low;
- Medium:
- High; and
- Very High.

The time-of-travel for contaminants within the water varies and is dependent on the physical and chemical characteristics of each contaminant. Bacteria and Viruses are only inventoried in Zones A and B because of their short life span. Only "Very High" and "High" rankings are inventoried within the outer Zone D due to the probability of contaminant dilution by the time the contaminants get to the well.

Tables 2 through 7 in Appendix B contain the ranking of potential and existing sources of contamination with respect to all six contaminant categories.

VULNERABILITY OF RAINBOW VALLEY MOBILE HOME PARK DRINKING WATER SYSTEM

Vulnerability of a drinking water source to contamination is a combination of two factors:

- Natural susceptibility; and
- Contaminant risks.

Appendix D contains fourteen charts, which together form the 'Vulnerability Analysis' for a source water assessment for a public drinking water source. Chart 1 analyzes the 'Susceptibility of the Wellhead' to contamination by looking at the construction of the well and its surrounding area. Chart 2 analyzes the 'Susceptibility of the Aquifer' to contamination by looking at the naturally occurring attributes of the water source and influences on the groundwater system that might lead to contamination. Chart 3 analyzes 'Contaminant Risks' for the drinking water source with respect to bacteria and viruses. The 'Contaminant Risks' portion of the analysis considers potential sources of contaminants as well as a review of contamination that has or may have occurred, but has not arrived or been detected at the well. Lastly, Chart 4 contains the 'Vulnerability Analysis for Bacteria and Viruses'. Charts 5 through 14 contain the Contaminant Risks and Vulnerability Analyses for nitrates and nitrites, volatile organic chemicals, heavy metals, synthetic organic chemicals, and other organic chemicals, respectively.

A score for the Natural Susceptibility is reached by considering the properties of the well and the aquifer.

Susceptibility of the Wellhead (0 – 25 Points) (Chart 1 of Appendix D)

Susceptibility of the Aquifer (0 – 25 Points) (Chart 2 of Appendix D)

Natural Susceptibility (Susceptibility of the Well) (0-50 Points)

A ranking is assigned for the Natural Susceptibility according to the point score:

| Natural Susceptibility Ratings | | | | | | | |
|--------------------------------|-----------|--|--|--|--|--|--|
| 40 to 50 pts | Very High | | | | | | |
| 30 to < 40 pts | High | | | | | | |
| 20 to < 30 pts | Medium | | | | | | |
| < 20 pts | Low | | | | | | |

The wells for the Rainbow Valley Mobile Home Park are completed in a fractured bedrock aquifer confined in the area of the wells by an 80 to 100-foot layer of silt. This silt layer thins as it nears the hilltops. The silt layer and the thickness of the bedrock above the screened portion of the well can provide protection from contaminants traveling downward from the surface with the precipitation and surface water runoff. Ground water can move extremely quickly through fractures within the bedrock, depending on their width, density, connectivity, and direction in the area. The water supply wells upgradient of the well also offer an easy pathway for contaminants to travel down into the aguifer and potentially towards the well. Table 2 shows the Susceptibility scores and ratings for Rainbow Valley Mobile Home Park.

Table 2. Susceptibility

| | Score | Rating |
|------------------------|-------|--------|
| Susceptibility of the | 5 | Low |
| Wellhead | | |
| Susceptibility of the | 18 | High |
| Aquifer | | |
| Natural Susceptibility | 23 | Medium |

Contaminant risks to a drinking water source depend on the type, number or density, and distribution of contaminant sources. This score has been derived from an examination of existing and historical contamination that has been detected at the drinking water source through routine sampling. It also evaluates potential sources of contamination. Flow charts are used to assign a point score, and ratings are assigned in the same way as for the natural susceptibility:

| Contaminant Risk Ratings | | | | | | | |
|--------------------------|-----------|--|--|--|--|--|--|
| 40 to 50 pts | Very High | | | | | | |
| 30 to < 40 pts | High | | | | | | |
| 20 to < 30 pts | Medium | | | | | | |
| < 20 pts | Low | | | | | | |

Table 3 summarizes the Contaminant Risks for each category of drinking water contaminants.

Table 3. Contaminant Risks

| Category | Score | Rating |
|-----------------------------|-------|-----------|
| Bacteria and Viruses | 50 | Very High |
| Nitrates and/or Nitrites | 38 | High |
| Volatile Organic Chemicals | 30 | High |
| Heavy Metals, Cyanide and | | |
| Other Inorganic Chemicals | 10 | Low |
| Synthetic Organic Chemicals | 10 | Low |
| Other Organic Chemicals | 10 | Low |
| | | |

Finally, an overall vulnerability score is assigned for each water system by combining each of the contaminant risk scores with the natural susceptibility score:

Natural Susceptibility (0 - 50 points)

+

Contaminant Risks (0 - 50 points)

=

Vulnerability of the Drinking Water Source to Contamination (0 - 100).

Again, rankings are assigned according to a point score:

| Overall Vulnerability Ratings | | | | | | | | |
|-------------------------------|-----------|--|--|--|--|--|--|--|
| 80 to 100 pts | Very High | | | | | | | |
| 60 to < 80 pts | High | | | | | | | |
| 40 to < 60 pts | Medium | | | | | | | |
| < 40 pts | Low | | | | | | | |

Table 4 contains the overall vulnerability scores (0 – 100) and ratings for each of the six categories of drinking water contaminants. Note: scores are rounded off to the nearest five.

Table 4. Overall Vulnerability

| Category | Score | Rating |
|-----------------------------|-------|--------|
| Bacteria and Viruses | 75 | High |
| Nitrates and Nitrites | 60 | High |
| Volatile Organic Chemicals | 55 | Medium |
| Heavy Metals, Cyanide, and | | |
| Other Inorganic Chemicals | 35 | Low |
| Synthetic Organic Chemicals | 35 | Low |
| Other Organic Chemicals | 35 | Low |

Bacteria and Viruses

The contaminant risk for bacteria and viruses is very high with the density of residential septic systems nearest to the well representing the greatest risk to the drinking water well (See Chart 3 – Contaminant Risks for Bacteria and Viruses in Appendix D).

Only a small amount of bacteria and viruses are required to endanger public health. Monitoring samples collected on 7/22/99 were positive for total coliform (an additional sample collected on 7/26/99 confirmed the positive result). Coliforms are found naturally in the environment and although it isn't necessarily a health threat, it is an indicator of other potentially harmful bacteria in the water, more specifically, fecal coliforms and *E. coli* which only come from human and animal fecal waste (EPA, 2002). Harmful bacteria can cause diarrhea, cramps, nausea, headaches, or other symptoms (EPA, 2002).

The positive samples increase the overall vulnerability of the drinking water souce, indicating that the source is susceptable to bacteria and viruses contamination. The source of the positive result is unknown. More recent samples taken in 2001 and 2002 all had negative results for total coliform. After combining the contaminant risk for bacteria and viruses with the natural susceptibility of the well, the overall vulnerability of the well to contamination is high.

Nitrates and Nitrites

The contaminant risk for nitrates and nitrites is very high with the septic systems nearest the well representing the greatest risk to this source of public drinking water (See Chart 5 - Contaminant Risks for Nitrates and/or Nitrites in Appendix D). Nitrates are very mobile, moving at approximately the same rate as water.

Sampling history for the Rainbow Valley Mobile Home Park well indicates that concentrations of nitrate have consistently been detected in the drinking water. Recent nitrate concentrations have ranged from 2.110mg/L to 3.450 mg/L or about 21 to 35% of the Maximum Contaminant Level (MCL) of 10 mg/L. The MCL is the maximum level of contaminant that is allowed to exist in drinking water by the Environmental Protection Agency (EPA). Because naturally occurring nitrate levels are typically less than 2 mg/l (Wang, Strelakos, Jokela, 2000), it is suspected that the increase in nitrates may be from human-made sources.

After combining the contaminant risk for nitrates and nitrites with the natural susceptibility of the well, the overall vulnerability of the well to contamination is high.

Volatile Organic Chemicals

The contaminant risk for volatile organic chemicals is high with the density of heating oil storage tanks creating the greatest risk for volatile organic chemicals (See Chart 7 – Contaminant Risks for Volatile Organic Chemicals in Appendix D).

Both underground and above ground heating oil storage tanks are the standard way of heating homes and businesses in the area surrounding Fairbanks. The most common causes of fuel leaks of these heating oil systems are overfilling the tank, ruptured fuel lines, leaking storage tanks, damaged or faulty valves and vandalism. Regular system maintenance can help prevent many of these harmful fuel leaks.

Volatile organic chemicals have not been detected in significant concentrations during recent sampling. After combining the contaminant risk for volatile organic chemicals with the natural susceptibility of the well, the overall vulnerability of the well to contamination is medium.

Heavy Metals, Cyanide, and Other Inorganic Chemicals

The contaminant risk for heavy metals is low with the density of septic systems and residential area in the protection area creating risk (See Chart 9 – Contaminant Risks for Heavy Metals, Cyanide, and Other Inorganic Chemicals in Appendix D).

Copper was detected but in a very low concentration (0.205 mg/L) during the most recent sample on 1/1/00. Points were not awarded in the vulnerability analysis for this detection because copper is usually associated with the water system's distribution system.

Other heavy metals were not detected in significant concentrations in their most recent sample on 10/11/01. After combining the contaminant risk for heavy metals with the natural susceptibility of the well, the overall vulnerability of the well to contamination is low.

Synthetic Organic Chemicals

The contaminant risk for synthetic organic chemicals is low with the residential activities creating risk. Synthetic Organic Chemicals have never been sampled for in this water system. After combining the contaminant risk with the natural susceptibility of the well, the overall vulnerability to synthetic organic chemicals of the well is low (See Chart 11 – Contaminant Risks for Synthetic Organic Chemicals in Appendix D).

Other Organic Chemicals

The contaminant risk for other organic chemicals is low with the residential activities within the protection area creating the risk. After combining the contaminant risk with the natural susceptibility of the well, the overall vulnerability to other organic chemicals of the well is medium (See Chart 13 – Contaminant Risks for Other Organic Chemicals in Appendix D). Other organic chemicals have not been sampled for in Rainbow Valley Mobile Home Park's drinking water system.

REFERENCES

- Alaska Department of Community and Economic Development (ADCED), 2002 [WWW document]. URL http://www.dced.state.ak,us/mra/CF_BLOCK.cfm.
- Forbes, R.B. and Weber, F.R., 1981. Bedrock Geologic Map of the Fairbanks Mining District, Alaska. Funded by the State of Alaska, US Geological Survey, and The National Science Foundation.
- Freeze, R.A. and Cherry, J.A., 1979. Groundwater. Prentice-Hall, Englewood Cliffs, NJ.
- Jokela, J.B., Munter, J.A., and Evans, J.G., 1991, Ground-water resources of the Palmer-Big Lake area, Alaska: a conceptual model. Division of Geological &Geophysical Surveys Reports of Investigations 90-4, State of Alaska Department of Natural Resources, Fairbanks, AK.
- King, P.B., compiler, 1969, Tectonic map of North America: US Geological Survey Map, (scale 1:5,000,000) 2 sheets.
- Nelson, Gordon L., 1978, Hydrologic Information for Land-Use Planning, Fairbanks Vicinity, Alaska. US Department of the Interior Geological Survey Open File Report 78-959, 47p.
- Patrick, L.D., Brabets, T.P., and Glass, R.L., 1989, Simulation of ground-water flow at Anchorage, Alaska: US Geological Survey Water-Resources Investigations Report 88-4139, 41p.
- United States Environmental Protection Agency (EPA), 2002 [WWW document]. URL http://www.epa.gov/safewater/mcl.html.
- Wang, B., Strelakos, P.M., Jokela, B., 2000, Nitrate Source Indicators in Groundwater of the Scimitar Subdivision, Peters Creek Area, Anchorage Alaska; U.S. Geological Survey Water Resources Investigations Report 00-4137, 25p.

APPENDIX A

Rainbow Valley Mobile Home Park
Drinking Water Protection Area Location Map
(Map 1)

Rainbow Valley Mobile Home Park Drinking Water Protection Area SUMMER STREET WINTER AVENUE WINTER STREET BENNETTROAD OLD STEESE HIGHWAY NORTH Legend GOLD CLAIM DRIVE GOLD CLAIM AVENUE WOUNT VISTA DRIVE PAY STREAK DRIVE Rainbow Valley Mobile Home Park Wells MORANDRUVI Zone A Protection Area DEADHORSE WAY **Parcels** EASTVIEW DRIVE Roads Rivers and streams Elevation Contours (20 m) HAPPY HORSE WAL ISABELLA CREEK RUTH ESTATES ROAD HILL CREST DRIVE DAVENNY DRIVE Rainbow Valley Mobile Home Park Drinking Water Protection Area DIVISION STREET W DRIVE OLD CHIEF A HOLS PRINCS ROAD HAGAMAN RU CHENA HOT SPRINGS ROAD SWAN LANE OLD STEESE HIGHWAY NORTH BIAS DRIVE EAST PEREGRINE DRIVE Map 1 0.5 1 Miles PWSID 310879

APPENDIX B

Contaminant Source Inventory and Risk Ranking for Rainbow Valley Mobile Home Park (Tables 1-7)

Table 1

Contaminant Source Inventory for FNSB - Weller Elementary

| Contaminant Source Type | Contaminant Source ID | CS ID tag | Zone | Map Number | Comments |
|---|--------------------------|-----------|------|------------|---|
| Construction trade areas and materials | C09 | C09-1 | A | 2 | 935 Highland Street |
| Residential Areas | R01 | | A | 2 | Approximately 400 acres of residential area |
| Septic systems (serves one single-family home) | R02 | | A | 2 | Approximately 137 septic systems (approximated by number of parcels designated as residential) |
| Tanks, heating oil, residential (above ground) | R08 | | A | 2 | Approximately 137 heating oil tanks (approximated by number of parcels designated as residential) |
| Open Leaking Underground Fuel Storage Tank (LUST) Sites | U07 | U07-1 | A | 2 | Waste oil tank at the Firehouse |
| Highways and roads, dirt/gravel | X24 | | A | 2 | Approximately 11 roads located within the protection area |
| Firehouses | X38 | X38-1 | A | 2 | 585 Steele Creek Road |

PWSID 310251.001

Table 2

Contaminant Source Inventory and Risk Ranking for FNSB - Weller Elementary Sources of Bacteria and Viruses

| Contaminant Source Type | Contaminant Source ID | CS ID tag | Zone | Risk Ranking for Analysis | Map Number | Comments |
|--|--------------------------|-----------|------|------------------------------|---------------|--|
| Septic systems (serves one single-family home) | R02 | | A | Low | 2 | Approximately 137 septic systems (approximated by number of parcels designated as residential) |
| Highways and roads, dirt/gravel | X24 | | A | Low | 2 | Approximately 11 roads located within the protection area |
| Residential Areas | R01 | | A | Low | 2 | Approximately 400 acres of residential area |

PWSID 310251.001

Table 3

Contaminant Source Inventory and Risk Ranking for FNSB - Weller Elementary Sources of Nitrates/Nitrites

| Contaminant Source Type | Contaminant Source ID | CS ID tag | Zone | Risk Ranking for Analysis | Map Number | Comments |
|--|--------------------------|-----------|------|------------------------------|---------------|--|
| Septic systems (serves one single-family home) | R02 | | A | Low | 2 | Approximately 137 septic systems (approximated by number of parcels designated as residential) |
| Highways and roads, dirt/gravel | X24 | | A | Low | 2 | Approximately 11 roads located within the protection area |
| Residential Areas | R01 | | A | Low | 2 | Approximately 400 acres of residential area |

Table 4

Contaminant Source Inventory and Risk Ranking for FNSB - Weller Elementary Sources of Volatile Organic Chemicals

| Contaminant Source Type | Contaminant Source ID | CS ID tag | Zone | Risk Ranking for Analysis | Map Number | Comments |
|---|--------------------------|-----------|------|------------------------------|---------------|---|
| Highways and roads, dirt/gravel | X24 | | A | Low | 2 | Approximately 11 roads located within the protection area |
| Septic systems (serves one single-family home) | R02 | | A | Low | 2 | Approximately 137 septic systems (approximated by number of parcels designated as residential) |
| Residential Areas | R01 | | A | Low | 2 | Approximately 400 acres of residential area |
| Tanks, heating oil, residential (above ground) | R08 | | A | Medium | 2 | Approximately 137 heating oil tanks (approximated by number of parcels designated as residential) |
| Construction trade areas and materials | C09 | C09-1 | A | Low | 2 | 935 Highland Street |
| Open Leaking Underground Fuel Storage Tank (LUST) Sites | U07 | U07-1 | A | Low | 2 | Waste oil tank at the Firehouse |
| Firehouses | X38 | X38-1 | A | Low | 2 | 585 Steele Creek Road |

PWSID 310251.001

Table 5

Contaminant Source Inventory and Risk Ranking for FNSB - Weller Elementary Sources of Heavy Metals, Cyanide and Other Inorganic Chemicals

| Contaminant Source Type | Contaminant Source ID | CS ID tag | Zone | Risk Ranking for Analysis | Map Number | Comments |
|--|--------------------------|-----------|------|------------------------------|---------------|--|
| Septic systems (serves one single-family home) | R02 | | A | Low | 2 | Approximately 137 septic systems (approximated by number of parcels designated as residential) |
| Highways and roads, dirt/gravel | X24 | | A | Low | 2 | Approximately 11 roads located within the protection area |
| Residential Areas | R01 | | A | Low | 2 | Approximately 400 acres of residential area |
| Construction trade areas and materials | C09 | C09-1 | A | Low | 2 | 935 Highland Street |
| Firehouses | X38 | X38-1 | A | Low | 2 | 585 Steele Creek Road |

Table 6

Contaminant Source Inventory and Risk Ranking for FNSB - Weller Elementary Sources of Synthetic Organic Chemicals

PWSID 310251.001

| Contaminant Source Type | Contaminant Source ID | CS ID tag | Zone | Risk Ranking for Analysis | Map Number | Comments |
|--|--------------------------|-----------|------|------------------------------|---------------|--|
| Residential Areas | R01 | | A | Low | 2 | Approximately 400 acres of residential area |
| Septic systems (serves one single-family home) | R02 | | A | Low | 2 | Approximately 137 septic systems (approximated by number of parcels designated as residential) |

PWSID 310251.001

Table 7


Contaminant Source Inventory and Risk Ranking for FNSB - Weller Elementary Sources of Other Organic Chemicals


| Contaminant Source Type | Contaminant Source ID | CS ID tag | Zone | Risk Ranking for Analysis | Map Number | Comments |
|--|--------------------------|-----------|------|------------------------------|---------------|--|
| Highways and roads, dirt/gravel | X24 | | A | Low | 2 | Approximately 11 roads located within the protection area |
| Septic systems (serves one single-family home) | R02 | | A | Low | 2 | Approximately 137 septic systems (approximated by number of parcels designated as residential) |
| Residential Areas | R01 | | A | Low | 2 | Approximately 400 acres of residential area |
| Construction trade areas and materials | C09 | C09-1 | Α | Low | 2 | 935 Highland Street |

APPENDIX C

Rainbow Valley Mobile Home Park
Drinking Water Protection Area
and Potential and Existing Contaminant Sources
(Map 2)

Rainbow Valley Mobile Home Park Drinking Water Protection Area with Potential and Existing Contaminant Sources

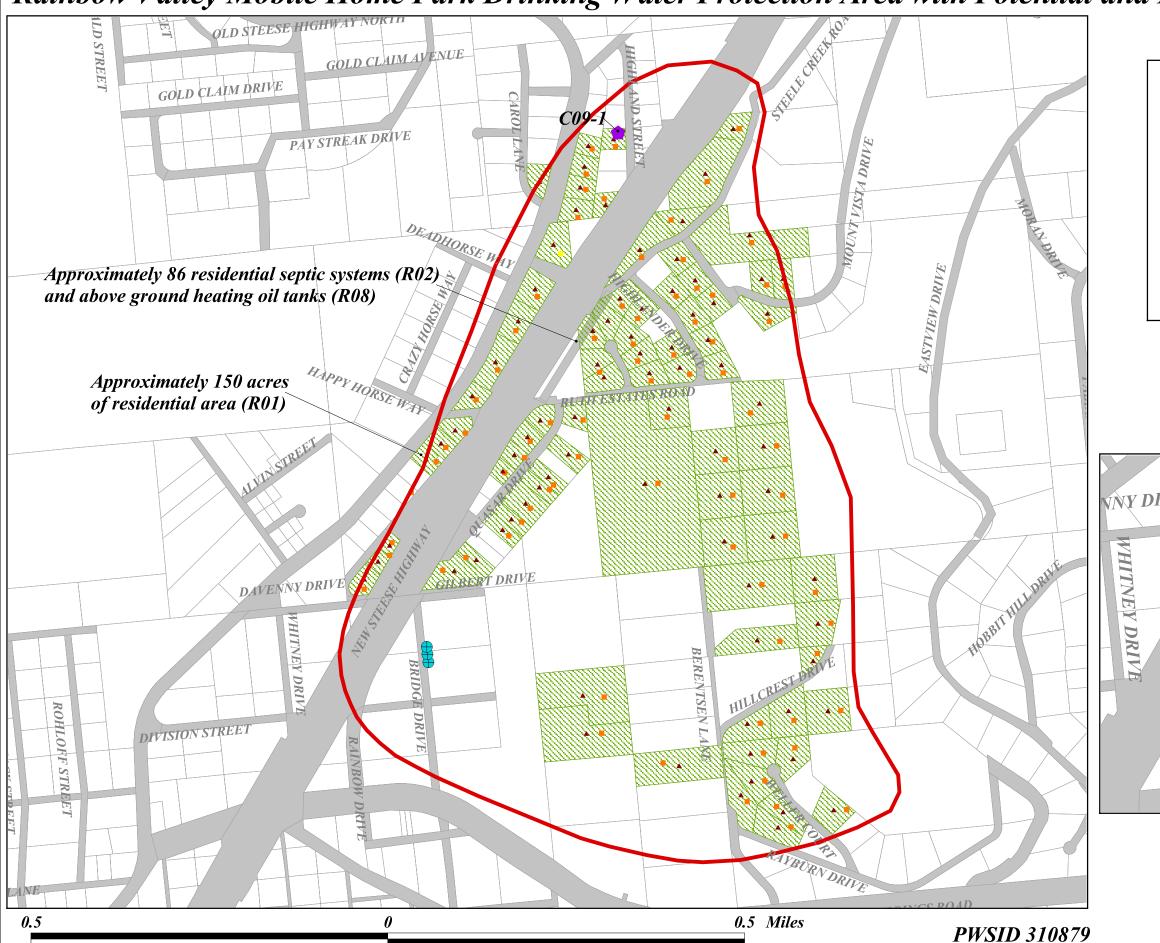

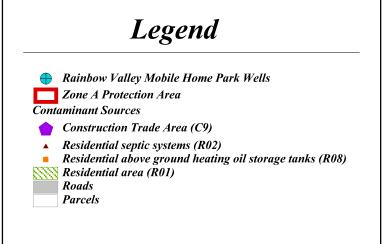





Map 2


APPENDIX D


Vulnerability Analysis for Rainbow Valley Mobile Home Park Public Drinking Water Source (Charts 1-14)


Chart 1. Susceptibility of the wellhead - Rainbow Valley Mobile Home Park Susceptibility initially assumed to be low. Susceptibility of wellhead = 0 pts The most recent sanitary survey indicates it is unknown whether or not the wells are grouted. NO Are the wells Increase susceptibility 5 pts + 5 pts properly grouted? Are the wells Increase susceptibility 20 pts 0 pts capped? YES YES Susceptibility of wellhead Low 5 pts YES Increase susceptibility: Are the wells 10 pts: suspected floodplain 0 pts within a Wellhead Susceptibility Ratings 20 pts: known floodplain floodplain? 20 to 25 pts very high 15 to < 20 pts high 10 to < 15 pts medium < 10 pts low Is the land surface sloped Increase susceptibility 5 pts 0 pts away from each of the wells?

Page 1 of 25


Chart 2. Susceptibility of the aquifer - Rainbow Valley Mobile Home Park

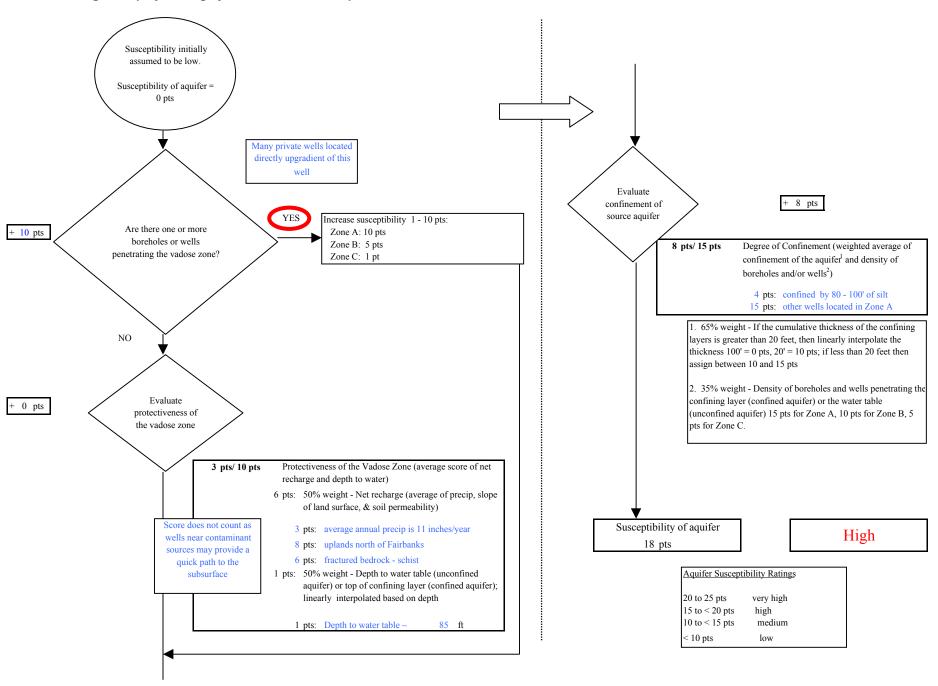


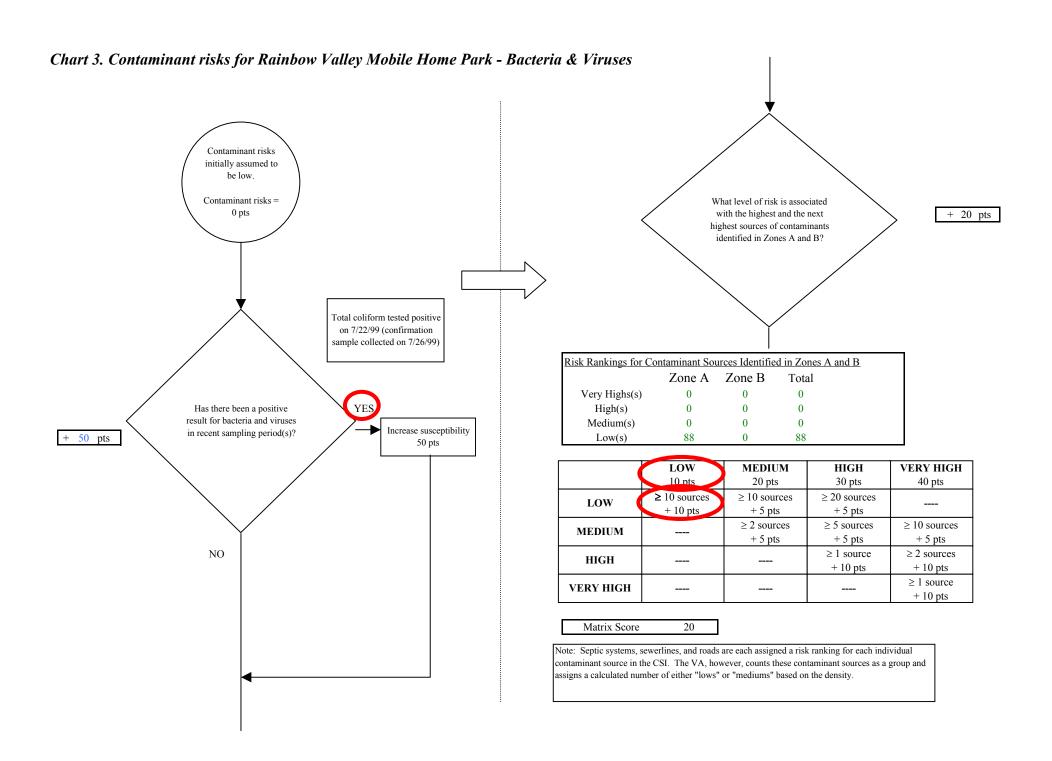

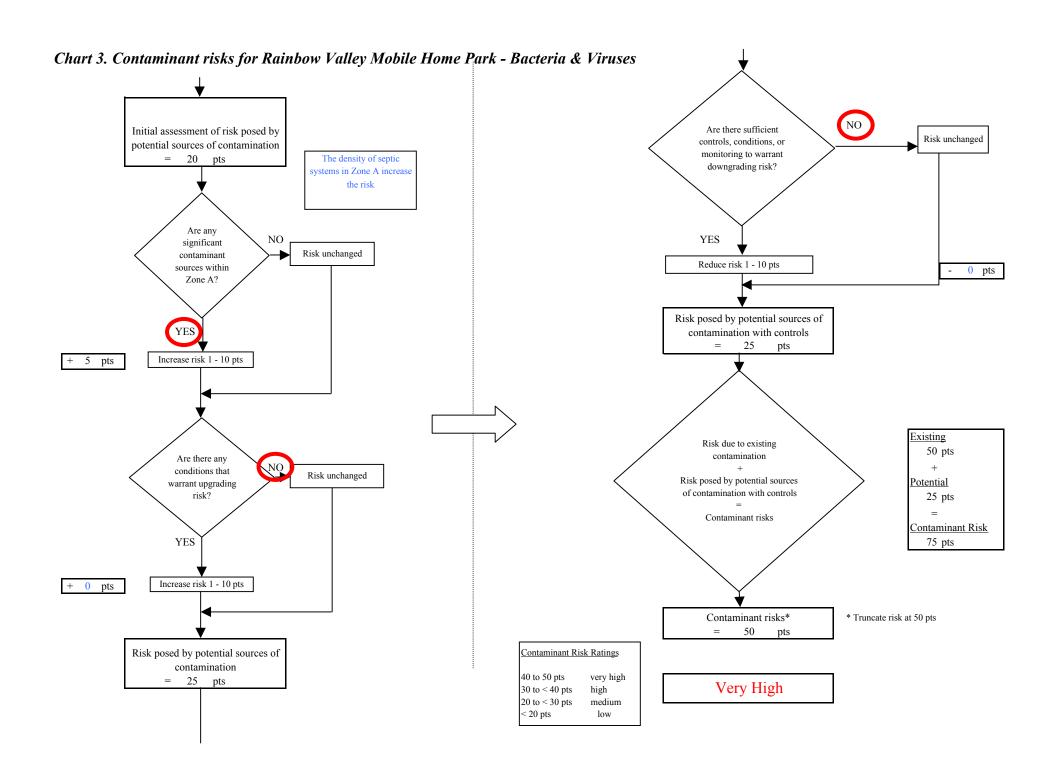



Page 4 of 25

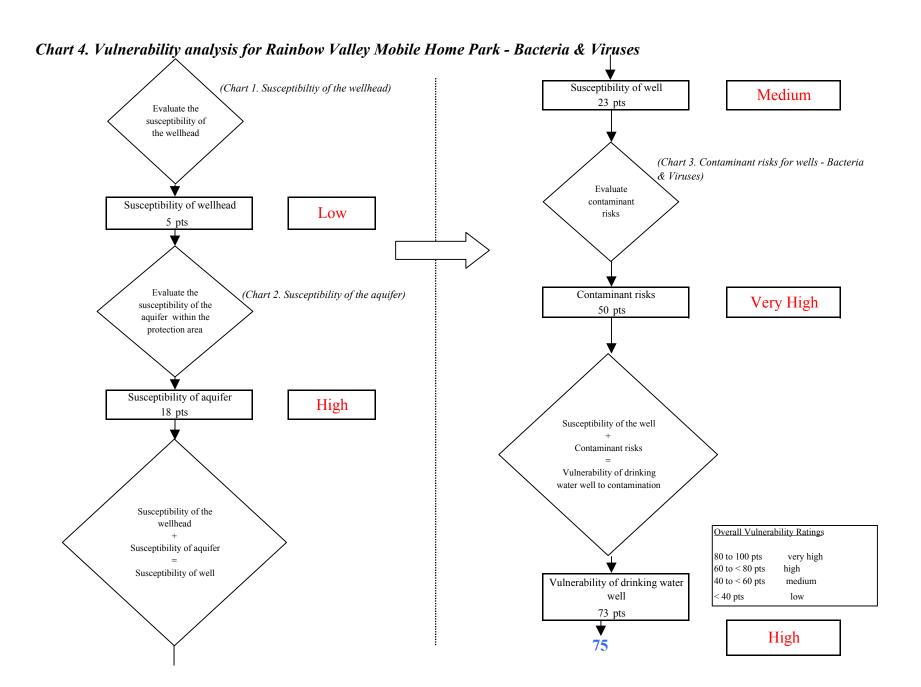


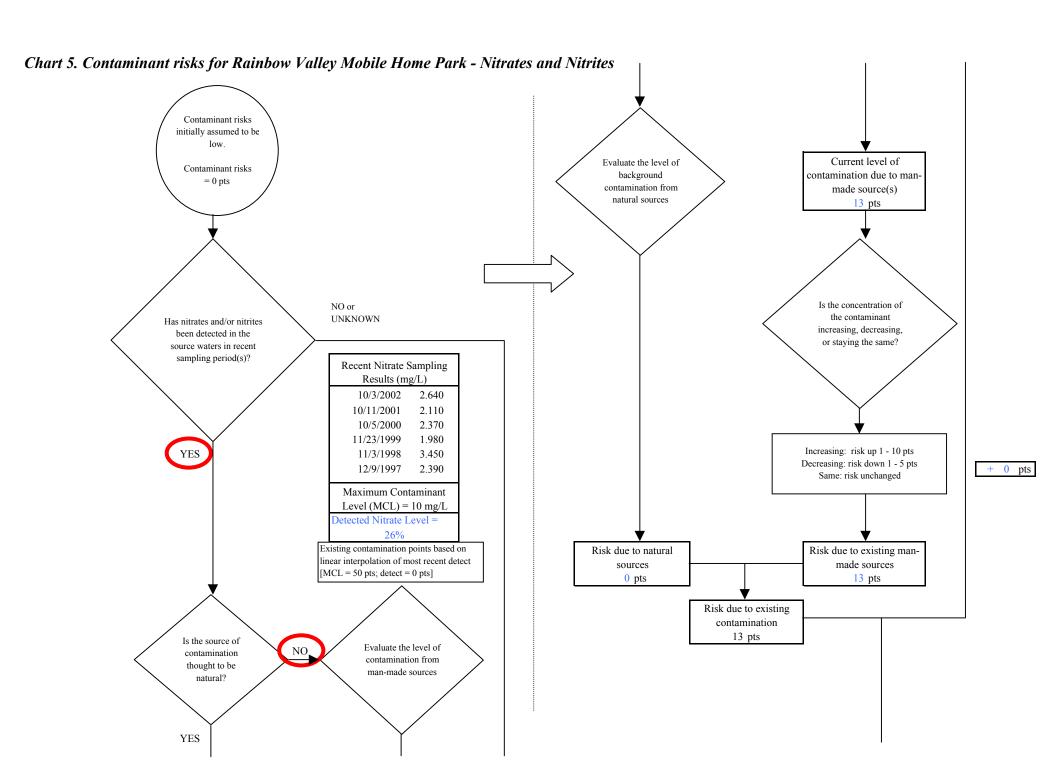


Page 6 of 25

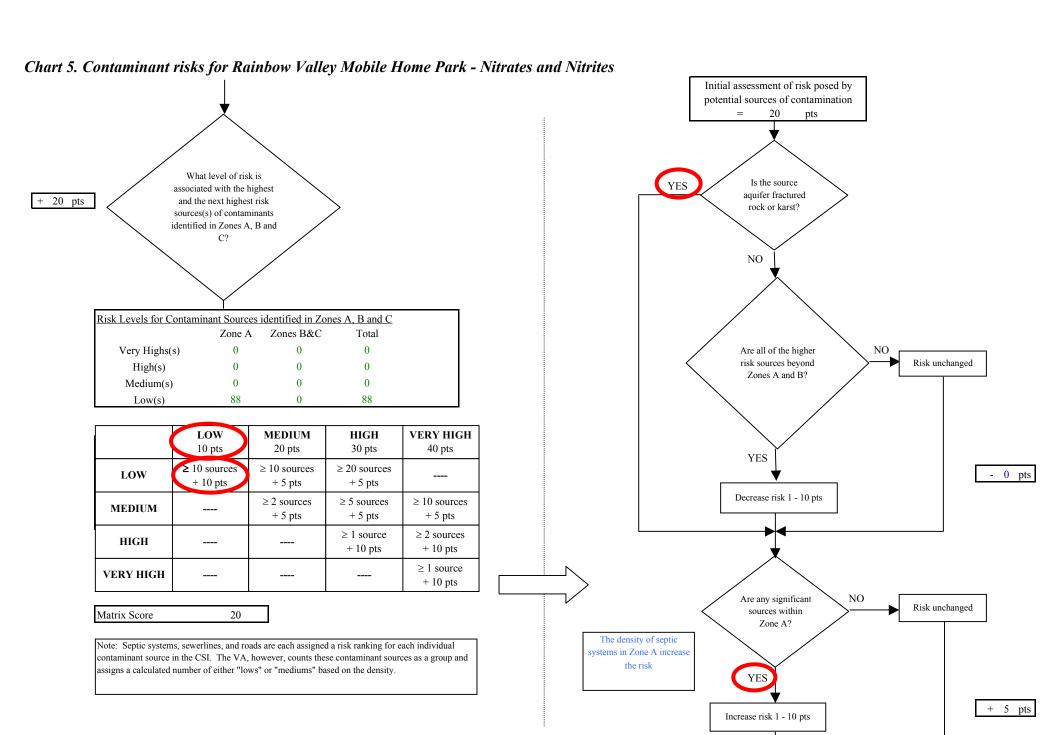


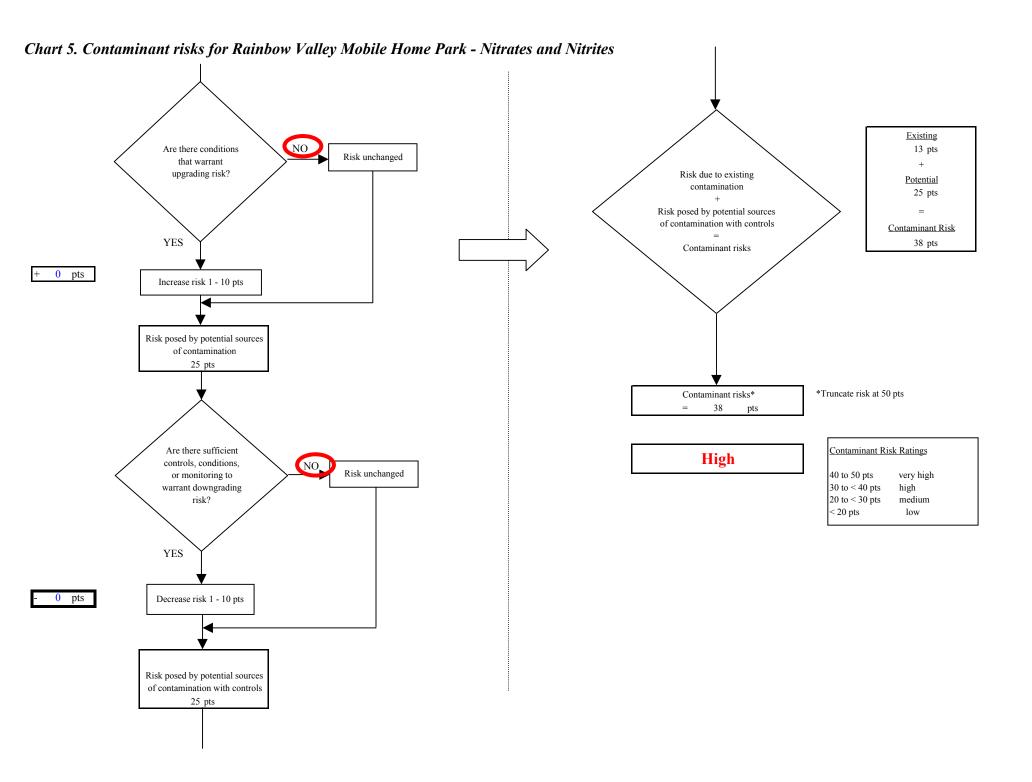


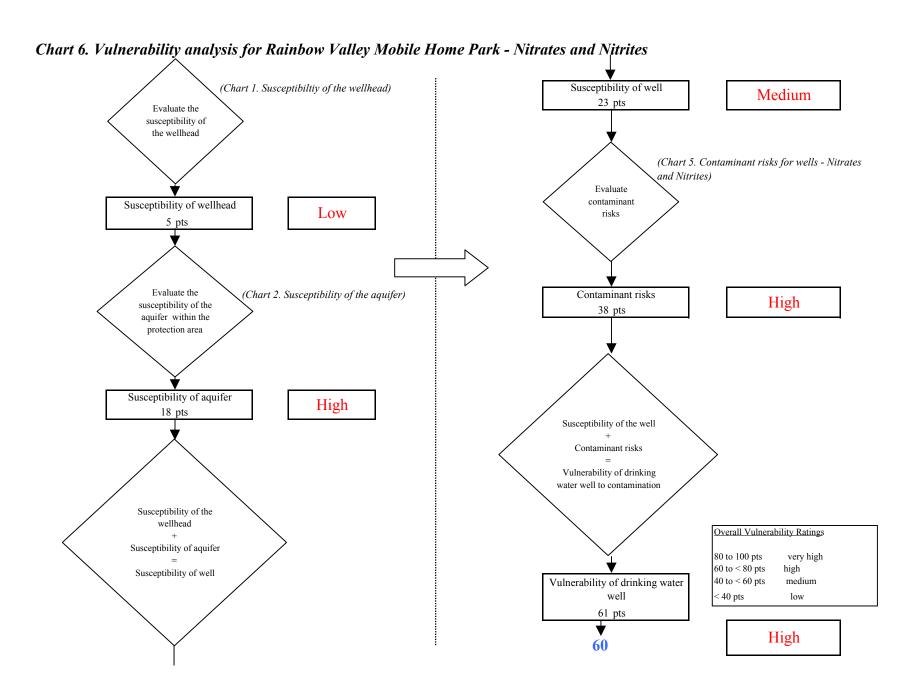

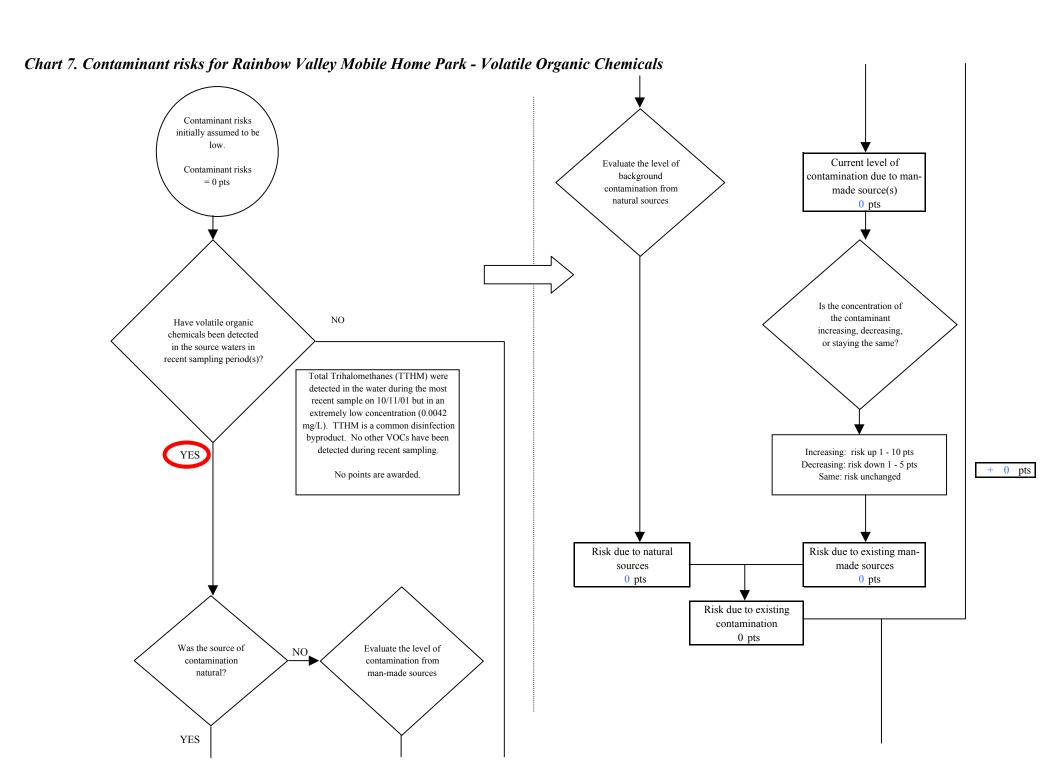



Page 10 of 25

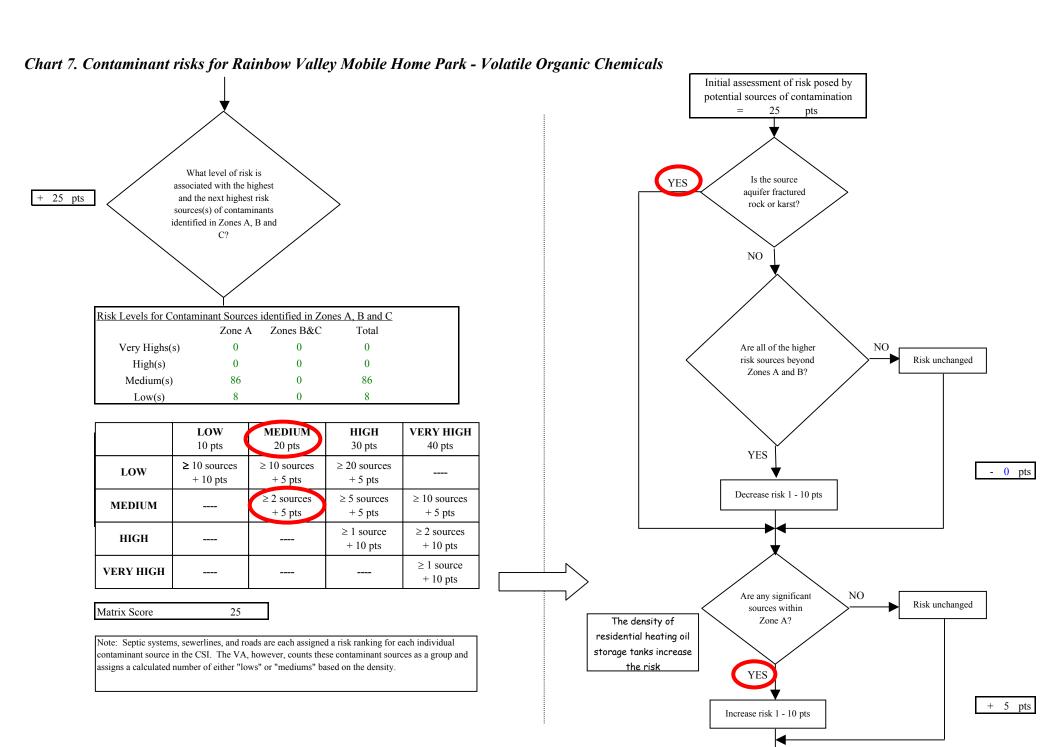

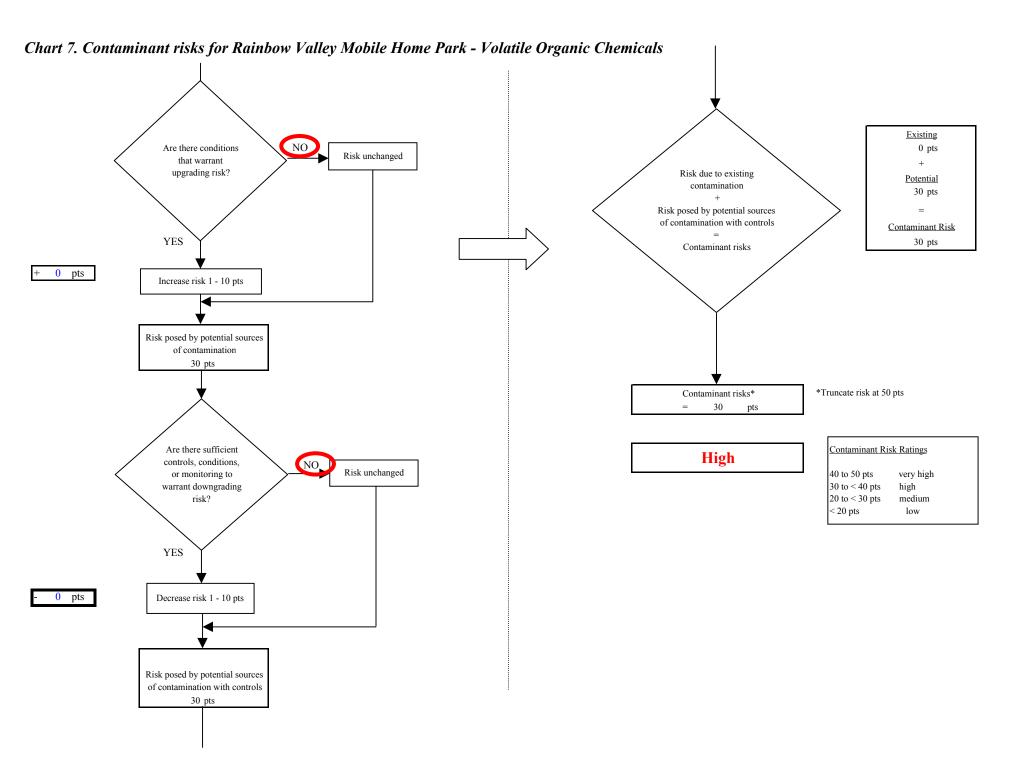


Page 12 of 25

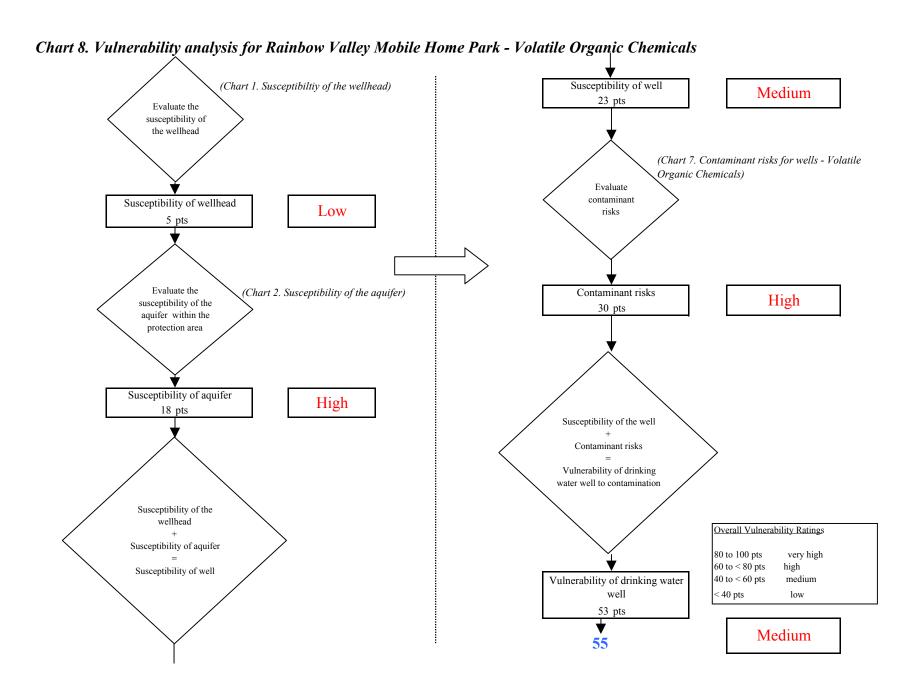

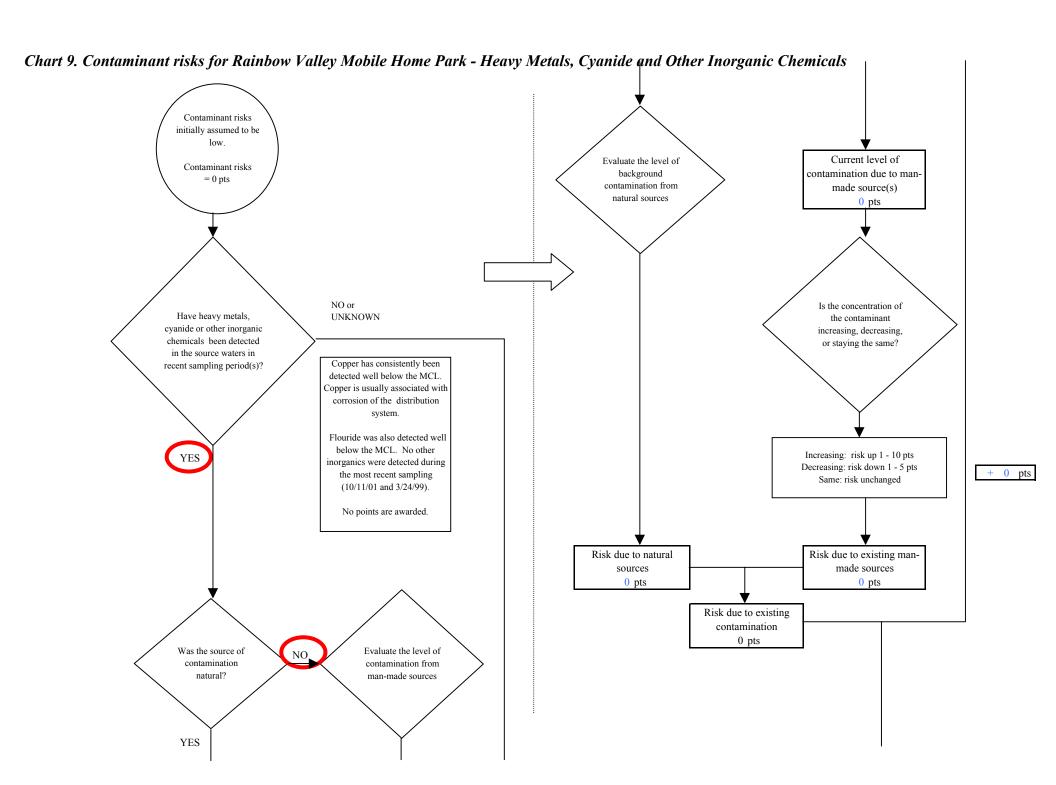

Page 14 of 25

Chart 9. Contaminant risks for Rainbow Valley Mobile Home Park - Heavy Metals, Cyanide and Other Inorganic Chemicals

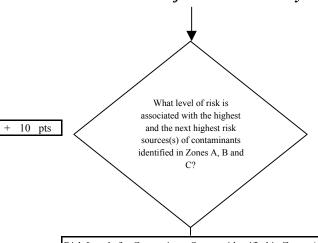



| Risk Levels for Contaminant Sources identified in Zones A, B and C | | | | | |
|--|--------|-----------|-------|--|--|
| | Zone A | Zones B&C | Total | | |
| Very Highs(s) | 0 | 0 | 0 | | |
| High(s) | 0 | 0 | 0 | | |
| Medium(s) | 0 | 0 | 0 | | |
| Low(s) | 3 | 0 | 3 | | |

| | LOW 10 pts | MEDIUM 20 pts | HIGH 30 pts | VERY HIGH 40 pts |
|-----------|--------------------------|-------------------------|-------------------------|-------------------------|
| LOW | ≥ 10 sources + 10 pts | ≥ 10 sources + 5 pts | ≥ 20 sources + 5 pts | |
| MEDIUM | | ≥ 2 sources + 5 pts | ≥ 5 sources + 5 pts | ≥ 10 sources + 5 pts |
| HIGH | | | ≥ 1 source + 10 pts | ≥ 2 sources + 10 pts |
| VERY HIGH | | | | ≥ 1 source + 10 pts |


|--|


Note: Septic systems, sewerlines, and roads are each assigned a risk ranking for each individual contaminant source in the CSI. The VA, however, counts these contaminant sources as a group and assigns a calculated number of either "lows" or "mediums" based on the density.

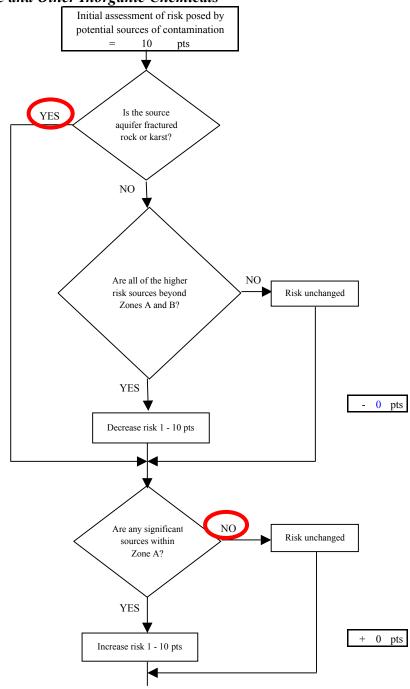

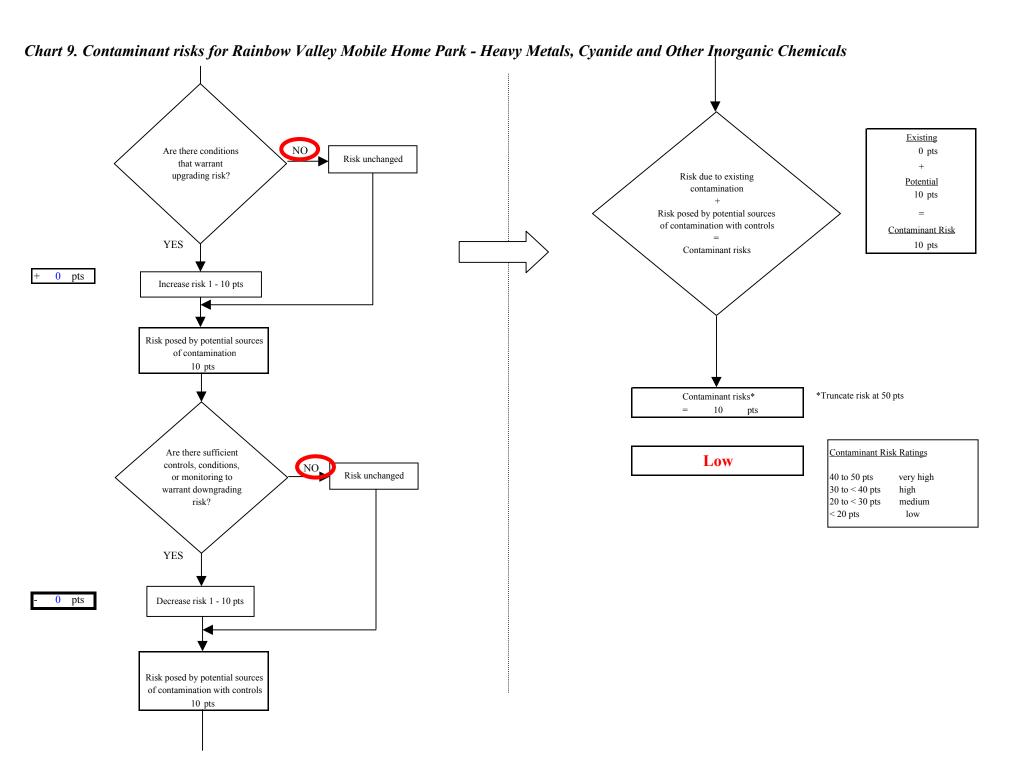


Page 16 of 25

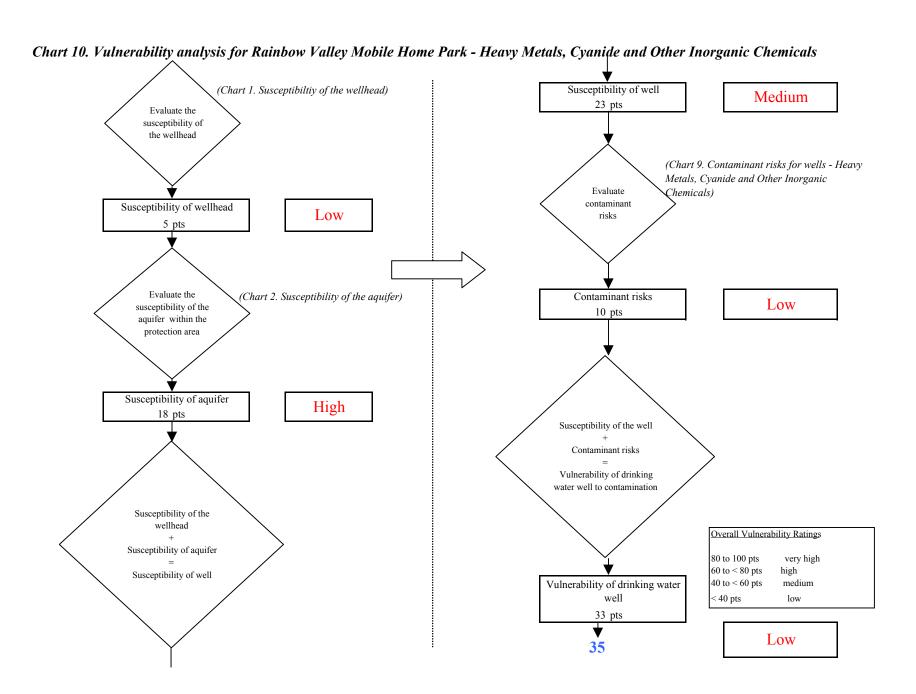

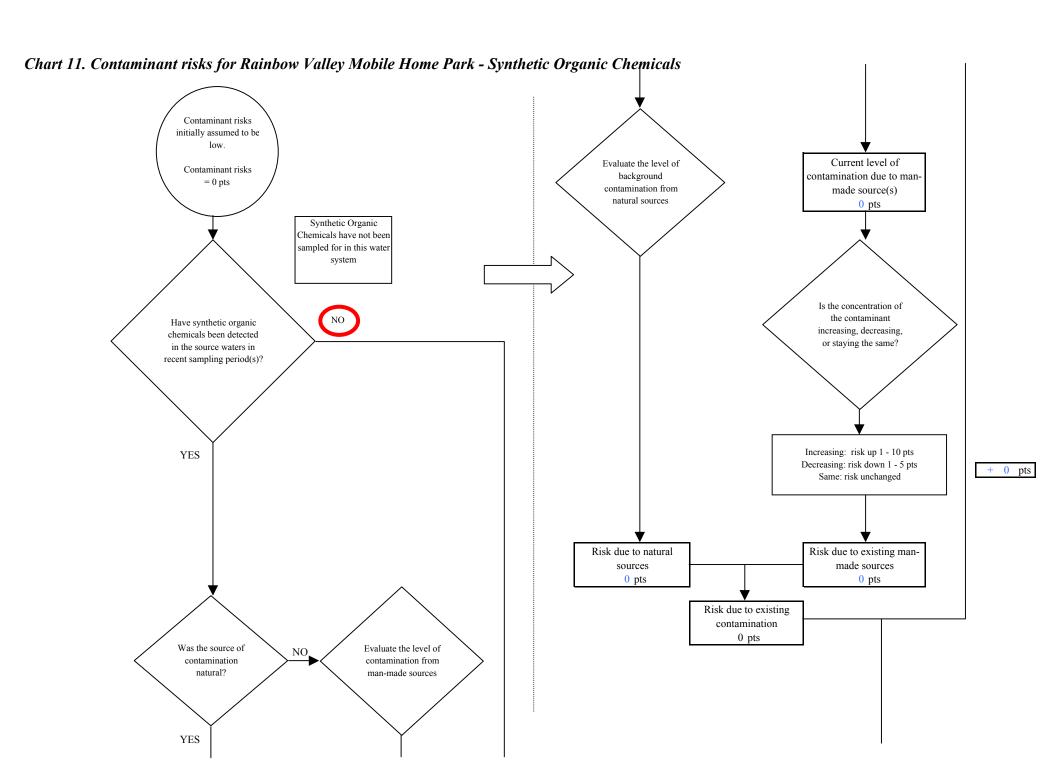

Page 18 of 25



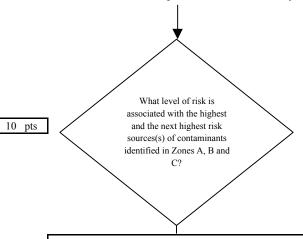



| Risk Levels for Contaminant Sources identified in Zones A, B and C | | | | | | |
|--|-----------|-------|---|--|--|--|
| Zone A | Zones B&C | Total | | | | |
| 0 | 0 | 0 | | | | |
| 0 | 0 | 0 | | | | |
| 0 | 0 | 0 | | | | |
| 1 | 0 | 1 | | | | |
| | | | • | | | |


| | LOW 10 pts | MEDIUM 20 pts | HIGH 30 pts | VERY HIGH 40 pts |
|-----------|--------------------------|-------------------------|-------------------------|-------------------------|
| LOW | ≥ 10 sources + 10 pts | ≥ 10 sources + 5 pts | ≥ 20 sources + 5 pts | |
| MEDIUM | | ≥ 2 sources + 5 pts | ≥ 5 sources + 5 pts | ≥ 10 sources + 5 pts |
| HIGH | | | ≥ 1 source + 10 pts | ≥ 2 sources + 10 pts |
| VERY HIGH | | | | ≥ 1 source + 10 pts |


Matrix Score 10

Note: Septic systems, sewerlines, and roads are each assigned a risk ranking for each individual contaminant source in the CSI. The VA, however, counts these contaminant sources as a group and assigns a calculated number of either "lows" or "mediums" based on the density.

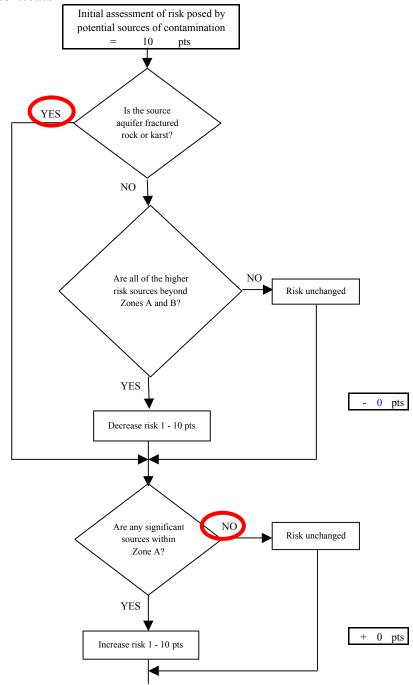


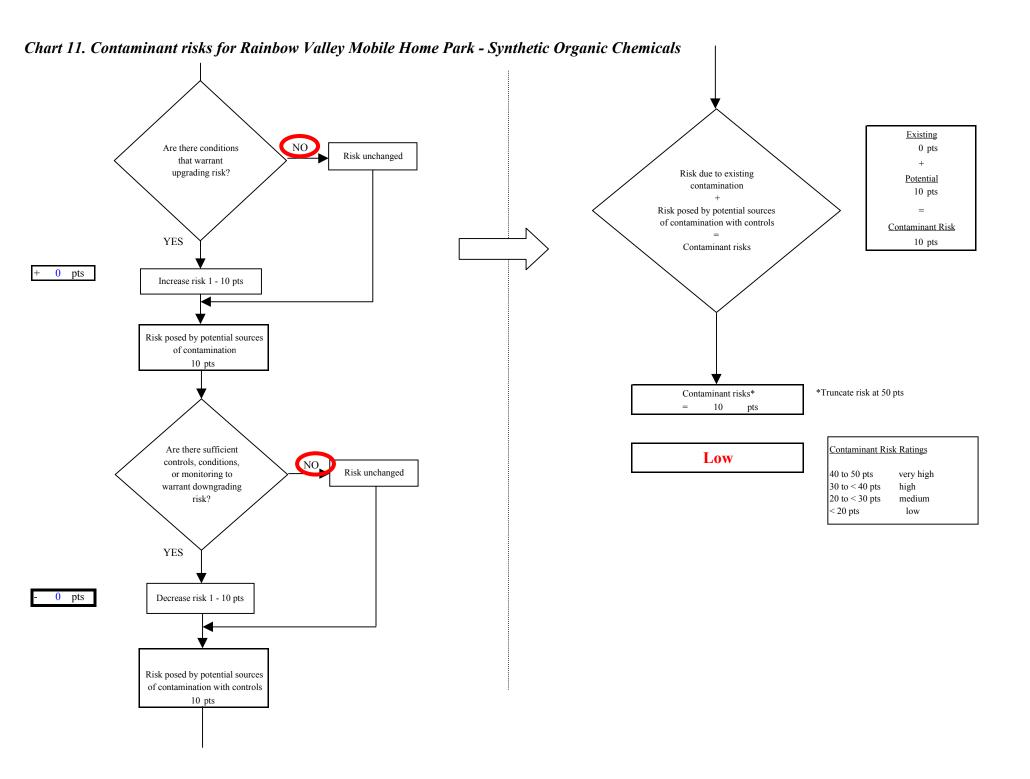


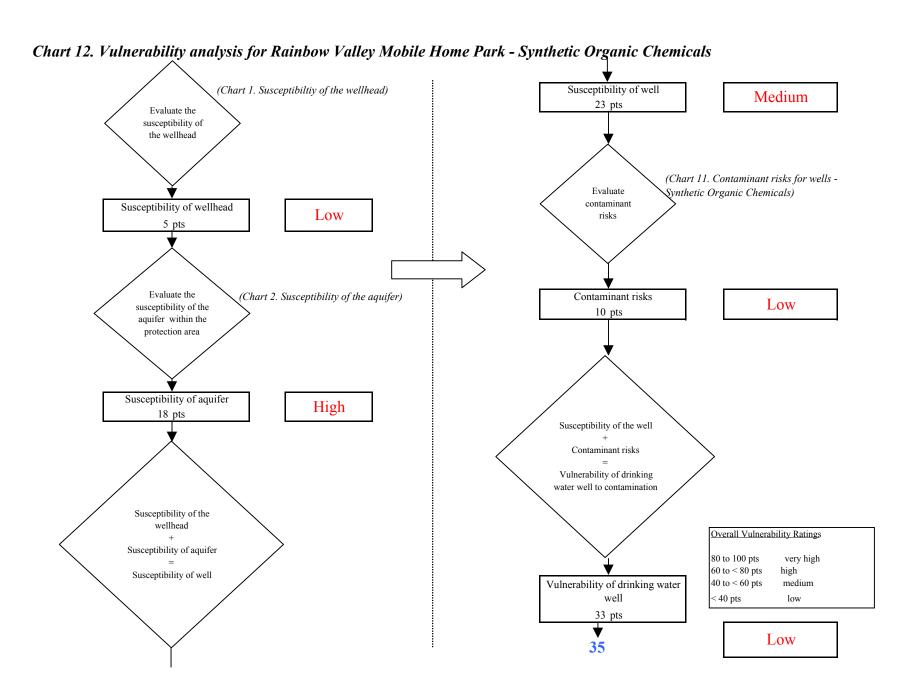

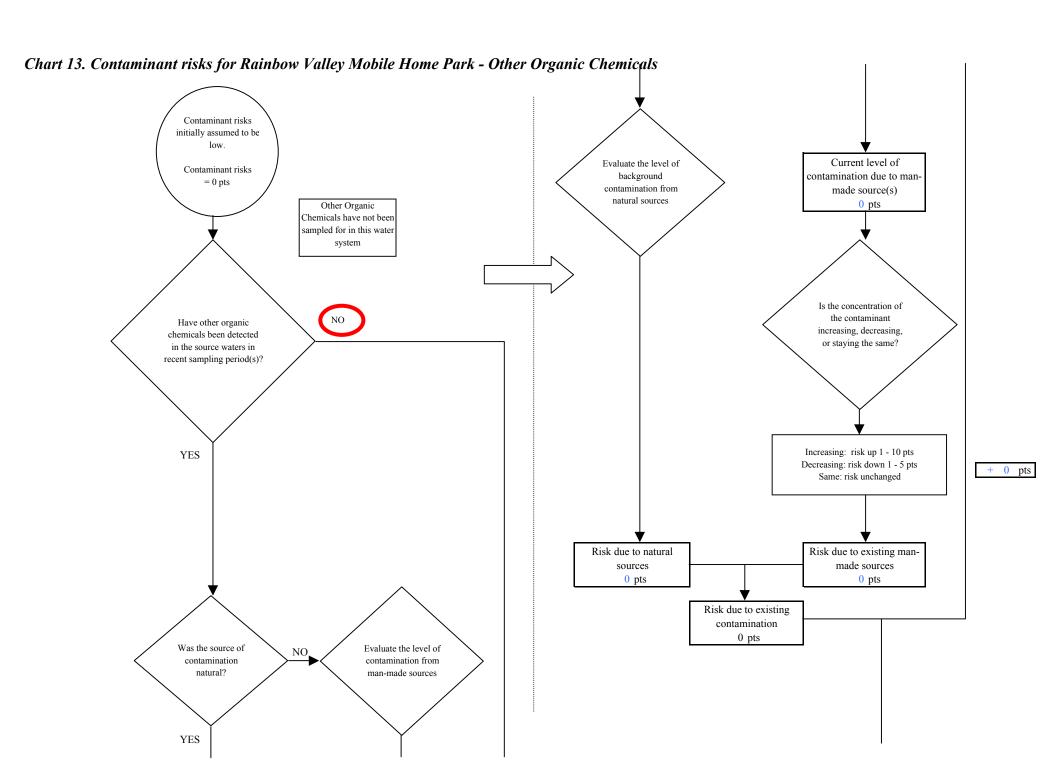

Page 22 of 25






10 pts


| Risk Levels for Contaminant Sources identified in Zones A, B and C | | | | | | |
|--|--------|-----------|-------|--|--|--|
| | Zone A | Zones B&C | Total | | | |
| Very Highs(s) | 0 | 0 | 0 | | | |
| High(s) | 0 | 0 | 0 | | | |
| Medium(s) | 0 | 0 | 0 | | | |
| Low(s) | 2 | 0 | 2 | | | |

| | LOW 10 pts | MEDIUM 20 pts | HIGH 30 pts | VERY HIGH 40 pts |
|-----------|--------------------------|-------------------------|-------------------------|-------------------------|
| LOW | ≥ 10 sources + 10 pts | ≥ 10 sources + 5 pts | ≥ 20 sources + 5 pts | |
| MEDIUM | | ≥ 2 sources + 5 pts | ≥ 5 sources + 5 pts | ≥ 10 sources + 5 pts |
| HIGH | | | ≥ 1 source + 10 pts | ≥ 2 sources + 10 pts |
| VERY HIGH | | | | ≥ 1 source + 10 pts |

Matrix Score 10

Note: Septic systems, sewerlines, and roads are each assigned a risk ranking for each individual contaminant source in the CSI. The VA, however, counts these contaminant sources as a group and assigns a calculated number of either "lows" or "mediums" based on the density.

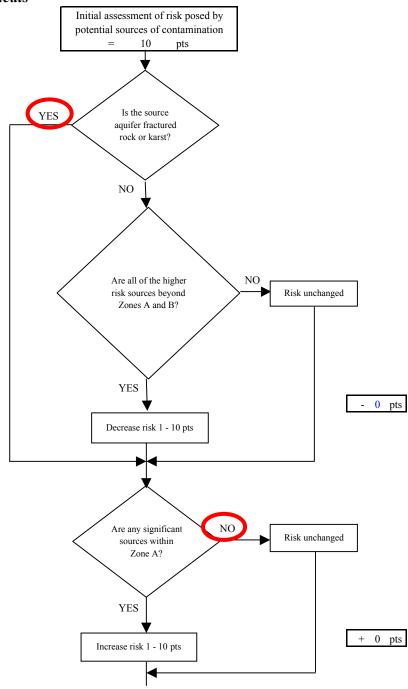

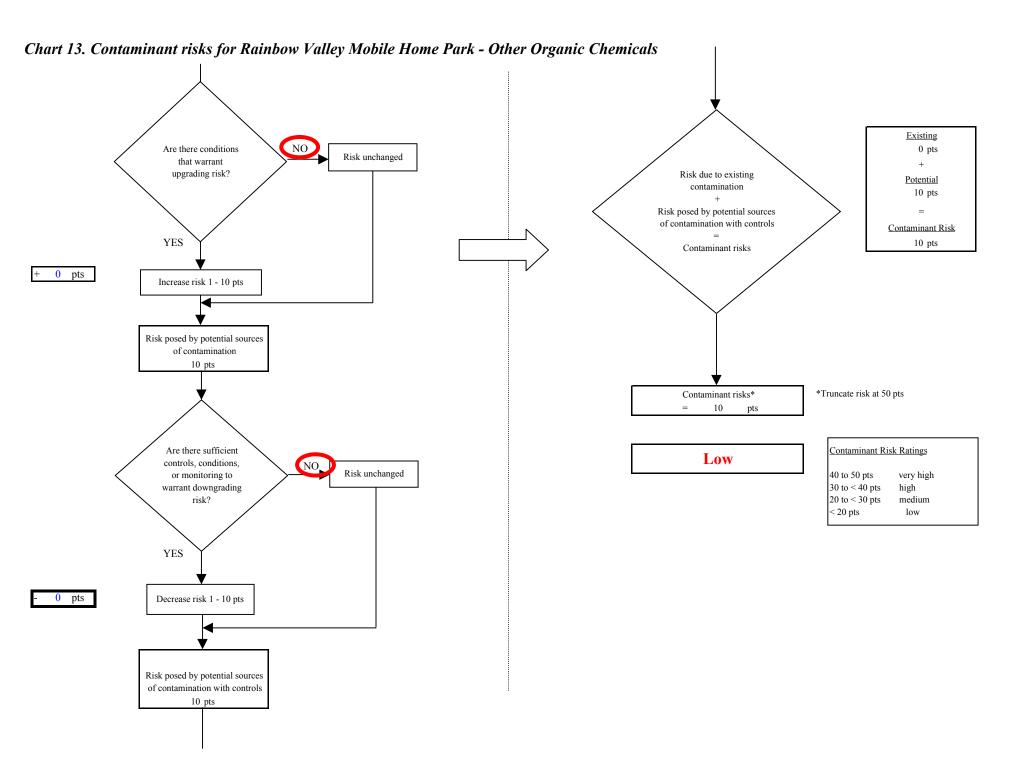

Page 24 of 25

