



Source Water Assessment

A Hydrogeologic Susceptibility and
Vulnerability Assessment for
Alaska Division of Parks - Twin Bears Camp
Public Drinking Water System,
Fairbanks, Alaska
PWSID # 311689.002

DRINKING WATER PROTECTION REPORT 1783

Alaska Department of Environmental Conservation

December, 2008

Source Water Assessment for
Alaska Division of Parks - Twin Bears Camp
Public Drinking Water System
Fairbanks, Alaska
PWSID# 311689.002

DRINKING WATER PROTECTION REPORT 1783

The Drinking Water Protection (DWP) section of the Drinking Water Program is producing Source Water Assessments in compliance with the Safe Drinking Water Act Amendments of 1996. Each assessment includes a delineation of the source water area, an inventory of potential and existing contaminant sources that may impact the water, a risk ranking for each of these contaminants, and an evaluation of the potential vulnerability of these drinking water sources.

These assessments are intended to provide public water systems owners/operators, communities, and local governments with the best available information that may be used to protect the quality of their drinking water. The assessments combine information obtained from various sources, including the U.S. Environmental Protection Agency, Alaska Department of Environmental Conservation (DEC), public water system owners/operators, and other public information sources. The results of this assessment are subject to change if additional data becomes available. It is anticipated this assessment will be updated every five years to reflect any changes in the vulnerability and/or susceptibility of public drinking water source. If you have any additional information that may affect the results of this assessment, please contact the DWP staff at the following number: 1-866-956-7656.

December, 2008

CONTENTS

	Page		Page
Executive Summary.....	1	Vulnerability of Twin Bears Camp Drinking Water	
Twin Bears Camp Public Drinking Water System	1	System.....	2
Twin Bears Camp Drinking Water Protection Area	1	References	5
Inventory of Potential and Existing Contaminant		Appendix A	7
Sources	2	Appendix B.....	9
Ranking of Contaminant Risks	2	Appendix C.....	11

TABLES

Table 1. Definition of Zones.....	2
Table 2. Susceptibility	3
Table 3. Contaminant Risks.....	3
Table 4. Overall Vulnerability	3

APPENDICES

- APPENDIX
- A. Twin Bears Camp Drinking Water Protection Area (Map A)
 - B. Contaminant Source Inventory for Twin Bears Camp (Table 1)
Contaminant Source Inventory and Risk Ranking for Twin Bears Camp – Bacteria and Viruses (Table 2)
Contaminant Source Inventory and Risk Ranking for Twin Bears Camp – Nitrates/Nitrites (Table 3)
Contaminant Source Inventory and Risk Ranking for Twin Bears Camp – Volatile Organic Chemicals (Table 4)
 - C. Twin Bears Camp Drinking Water Protection Area and Potential and Existing Contaminant Sources (Map C)

Source Water Assessment for Twin Bears Camp Source of Public Drinking Water, Fairbanks area, Alaska

Drinking Water Protection Alaska Department of Environmental Conservation

EXECUTIVE SUMMARY

The public water system for Alaska Division of Parks - Twin Bears Camp is a Class B (transient/non-community) water system consisting of two wells at Twin Bears Camp, located off the Chena Hot Springs Road, approximately 35 miles east of Fairbanks, Alaska. This report only applies to the new well, PWSID 311689.002. The wellhead received a susceptibility rating of **Very High** and the aquifer received a susceptibility rating of **High**. Combining these two ratings produces a **High** rating for the natural susceptibility of the well. The identified potential and current source of contaminants for Twin Bears Camp public drinking water source is the Chena River State Recreation Area. This identified potential and existing source of contamination is considered as a source of bacteria and viruses, and nitrates and/or nitrites. Overall, the public water sources for Twin Bears Camp received a vulnerability rating of **High** for bacteria and viruses and nitrates and/or nitrites, and **Low** for volatile organic chemicals. This assessment of contaminant risks can be used as a foundation for local voluntary protection efforts as well as a basis for the continuous efforts on the part of the Alaska Division of Parks to protect public health.

TWIN BEARS CAMP PUBLIC DRINKING WATER SYSTEM

The Alaska Division of Parks - Twin Bears Camp public water system is a Class B (transient/non-community) water system. The system consists of two wells located at Twin Bears Camp, off the Chena Hot Springs Road, approximately 35 miles east of Fairbanks, Alaska (see Map A of Appendix A). This report only applies to the new well, PWSID 311689.002. The new well is replacing an existing well that is no longer being used.

The Twin Bears Camp is a state park available for rent to groups or individuals and is operated by the Fairbanks Rescue Mission. The camp features cabins and handicap-accessible buildings. Hot and cold running water and electricity are available in the summer for use in the kitchen or shower houses. In the winter, woodstoves and propane are used for heating and cooking. Water is supplied to the RV utility post,

the showers, and the kitchen through waterlines. (DPOR, 2008).

The Fairbanks area includes two distinct topographic areas: the floodplain of the Tanana River and the Chena River, and the uplands north of this floodplain. This water system is located in the uplands at an elevation of approximately 800 feet above sea level.

According to the sanitary survey (05/18/07), the well extends approximately 40 feet below the ground surface and is completed in an unconfined aquifer. This system operates from May to September and serves approximately 50 non-residents through three service connections.

TWIN BEARS CAMP DRINKING WATER PROTECTION AREA

In order to evaluate whether a drinking water source is at risk, we must first evaluate what are the most likely pathways for surface contamination to reach the groundwater. These areas are determined by looking at the characteristics of the soil, groundwater, aquifer, and well.

The most probable area for contamination to reach the drinking water well is the drinking water protection area. The drinking water protection area is the area circling the well (the area influenced by pumping) and also the area upgradient of the well, usually forming a parabola shape. Because releases of contaminants within the protection area are most likely to impact the well, this area will serve as the focus for voluntary protection efforts.

There are many different methods for calculating the size of protection areas. Drinking Water Protection (DWP) uses a combination of two simple groundwater flow equations, the Thiem and uniform flow equations for all groundwater wells screened in unconsolidated material. The orientation of the protection zone is then drawn using a water table elevation map (if available) or a land surface elevation map of the area. The protection zone calculated by the DWP is an estimate using the available information and resources, and may differ slightly from the actual capture zone. Because of uncertainties and changing site conditions, a factor of safety is added to the protection zone to form the drinking water protection area for the well.

The parameters used to calculate the shape of this protection zone are general for the whole alluvial plain and were obtained from various United States Geological Survey (USGS) reports, area well logs, and the Groundwater textbook by Freeze and Cherry (Freeze and Cherry, 1979).

The protection areas established for wells by the DEC are usually separated into two zones, limited by the watershed. These zones correspond to differences in the time-of-travel (TOT) of the water moving through the aquifer to the well. An analytical calculation was used to determine the size and shape of the protection area.

The time-of-travel for contaminants within the water varies and is dependent on the physical and chemical characteristics of each contaminant. The following is a summary of the two protection area zones for wells and the calculated time-of-travel for each:

Table 1. Definition of Zones

Zone	Definition
A	Several months time-of-travel
B	Less than the 2 year time-of-travel

The drinking water protection area for Twin Bears Camp was determined using an analytical calculation and includes Zones A and B (see Map A of Appendix A).

INVENTORY OF POTENTIAL AND EXISTING CONTAMINANT SOURCES

DWP has completed an inventory of potential and existing sources of contamination within the Twin Bears Camp drinking water protection area. This inventory was completed through a search of agency records and other publicly available information. Potential sources of contamination to the drinking water aquifer include a wide range of categories and types. Potential drinking water contaminants are found within agricultural, residential, commercial, and industrial areas, but can also occur within areas that have little or no development.

For the basis of all Class B public water system assessments, the following three categories of drinking water contaminants were inventoried:

- Bacteria and viruses;
- Nitrates and/or nitrites;
- Volatile organic chemicals

The sources are displayed on Map C of Appendix C and summarized in Table 1 of Appendix B.

RANKING OF CONTAMINANT RISKS

Once the potential and existing sources of contamination have been identified, they are assigned a ranking according to what type and level of risk they represent. Ranking of contaminant risks for a “potential” or “existing” source of contamination is a function of toxicity and volumes of specific contaminants associated with that source. Rankings include:

- Low;
- Medium;
- High; and
- Very High.

Tables 2 through 3 in Appendix B contain the ranking of potential and existing sources of contamination with respect to bacteria and viruses and nitrates and/or nitrites.

VULNERABILITY OF TWIN BEARS CAMP DRINKING WATER SYSTEM

Vulnerability of a drinking water source to contamination is a combination of two factors:

- Natural Susceptibility; and
- Contaminant Risks.

A score for the Natural Susceptibility of the well is reached by considering the properties of the well and the aquifer.

$$\begin{aligned}
 &\text{Susceptibility of the Wellhead (0-25 Points)} \\
 &\quad + \\
 &\text{Susceptibility of the Aquifer (0-25 Points)} \\
 &\quad = \\
 &\text{Natural Susceptibility of the Well (0-50 Points)}
 \end{aligned}$$

A ranking is assigned for the Natural Susceptibility according to the point score:

Natural Susceptibility Ratings	
40-50 pts	Very High
30 to < 40 pts	High
20 to < 30 pts	Medium
< 20 pts	Low

Factors contributing to the susceptibility of the wellhead are: whether the sanitary seal is in place, protection from flooding, and if the well casing is properly grouted.

The wellhead for the Twin Bears Camp received a **Very High** susceptibility rating. The sanitary survey (05/18/07) indicates that the well is surrounded by a concrete pad and the land surface is appropriately

sloped away from the well, however, the well is not capped with a sanitary seal. Sanitary seals prevent potential contaminants from entering the well, while sloping of the land surface away from the wellhead provides adequate surface water drainage, and concrete or grouting around the wellhead helps to prevent potential contaminants from traveling down the outside of the well casing.

Factors contributing to the susceptibility of the aquifer are: whether the aquifer is confined or unconfined, whether the well is completed in unconsolidated or fractured bedrock, whether wells and bore holes are penetrating the aquifer and, if applicable, the confining layer.

The Twin Bears Camp system draws water from an unconfined aquifer consisting of sand and gravel. It received a **High** susceptibility rating because of its unconfined and relatively shallow nature. Because an unconfined aquifer is recharged by surface water and precipitation that migrates downward from the surface, it is susceptible to contamination from outside sources. Shallow aquifers provide less protection from this downward migration.

Table 2 summarizes the Susceptibility scores and ratings for the Twin Bears Camp system.

Table 2. Susceptibility

	Score	Rating
Susceptibility of the Wellhead	20	Very High
Susceptibility of the Aquifer	17	High
Natural Susceptibility	37	High

Contaminant risks are derived from an evaluation of the routine sampling results of the water system and the presence of potential sources of contamination. Contaminant risks to a drinking water source depend on the type and distribution of contaminant sources. Flow charts are used to assign a point score, and ratings are assigned in the same way as for the natural susceptibility:

Contaminant Risk Ratings	
40-50 pts	Very High
30 to < 40 pts	High
20 to < 30 pts	Medium
< 20 pts	Low

Table 3 summarizes the Contaminant Risks for each category of drinking water contaminants for the Twin Bears Camp system.

Table 3. Contaminant Risks

Category	Score	Rating
Bacteria and Viruses	25	Medium
Nitrates and/or Nitrites	25	Medium
Volatile Organic Chemicals	0	Low

Finally, an overall vulnerability score is assigned for each water system by combining each of the contaminant risk scores with the natural susceptibility score:

$$\begin{aligned}
 &\text{Natural Susceptibility (0-50 Points)} \\
 &+ \\
 &\text{Contaminant Risks (0-50 Points)} \\
 &= \\
 &\text{Vulnerability of the Drinking Water Source to} \\
 &\text{Contamination (0-100 Points)}
 \end{aligned}$$

Again, rankings are assigned according to a point score:

Overall Vulnerability Ratings	
80-100 pts	Very High
60 to < 80 pts	High
40 to < 60 pts	Medium
< 40 pts	Low

Table 4 contains the overall vulnerability scores (0-100) and ratings for each of the three categories of drinking water contaminants for the Twin Bears Camp system. Note: scores are rounded off to the nearest five.

Table 4. Overall Vulnerability

Category	Score	Rating
Bacteria and Viruses	60	High
Nitrates and/or Nitrites	60	High
Volatile Organic Chemicals	35	Low

Bacteria and Viruses

The contaminant risk for bacteria and viruses is **Medium** with the Chena River State Recreation Area contributing the only risk to the drinking water well.

Coliforms (a bacteria) are found naturally in the environment and although they aren't necessarily a health threat, they are an indicator of other potentially harmful bacteria in the water, more specifically, fecal

coliforms and E. coli, which only come from human and animal fecal waste. Harmful bacteria can cause diarrhea, cramps, nausea, headaches, or other symptoms (EPA, 2008).

Only a small amount of bacteria and viruses are required to endanger public health. Positive samples increase the overall vulnerability of the drinking water source, indicating that the source is susceptible to bacteria and virus contamination. Bacteria and viruses have not been detected during recent water sampling of the system at Twin Bears Camp (data reviewed in April, 2008).

After combining the contaminant risk for bacteria and viruses with the natural susceptibility of the well, the overall vulnerability of the well to contamination is **High**.

Nitrates and Nitrites

The contaminant risk for nitrates and nitrites is **Medium** with the Chena River State Recreation Area contributing the only risk to the drinking water well.

The sampling history for the Twin Bears Camp well indicates that nitrates have been detected in the water during the last 5 years of sampling, with the highest concentration of 0.180 mg/l detected on 06/07/2001 (data reviewed in April, 2008).

After combining the contaminant risk for nitrates and nitrites with the natural susceptibility of the well, the overall vulnerability of the well to contamination is **High**.

Volatile Organic Chemicals

The contaminant risk for volatile organic chemicals is **Low** with no factors creating risk to the drinking water well.

The drinking water at Twin Bears Camp has not been recently sampled for volatile organic chemicals (data reviewed in April, 2008).

After combining the contaminant risk for volatile organic chemicals with the natural susceptibility of the well, the overall vulnerability of the well to contamination is **Low**.

Using the Source Water Assessment

This assessment of contaminant risks can be used as a foundation for local voluntary protection efforts as well as a basis for the continuous efforts on the part of the Alaska Division of Parks to protect public health. It is anticipated that Source Water Assessments will be updated every five years to reflect any changes in the vulnerability and/or susceptibility of Twin Bears Camp drinking water source.

REFERENCES

Division of Parks and Outdoor Recreation (DPOR), Accessed 2008 [WWW document].

URL: <http://www.dnr.state.ak.us/parks/cabins/north.htm#tbc>

Freeze, R.A. and Cherry, J.A., 1979. Groundwater. Prentice-Hall, Englewood Cliffs, NJ.

United States Environmental Protection Agency (EPA), Accessed 2008 [WWW document]. URL:

<http://www.epa.gov/safewater/contaminants/index.html>.

APPENDIX A

Twin Bears Camp Drinking Water Protection Area Location Map (Map A)

Public Water Well System for PWS #311689.002 AK Div. Parks - Twin Bears



Legend

● Class B Public Water System

Groundwater Protection Zones

□ Zone A Protection Area - Several Months Travel Time




□ Zone B Protection Area - 2 Years Travel Time

Data Sources:
Contaminant Sources, Public Water System Wells, Alaska Department of Environmental Conservation (ADEC)

All other data:
Alaska Statewide Digital Mapping Initiative (SDMI)

Drinking Water Protection Areas based on "Alaska Drinking Water Protection Program - Guidance Manual for Class B Public Water Systems" published by ADEC

URS Corporation does not guarantee the accuracy or validity of the data provided.

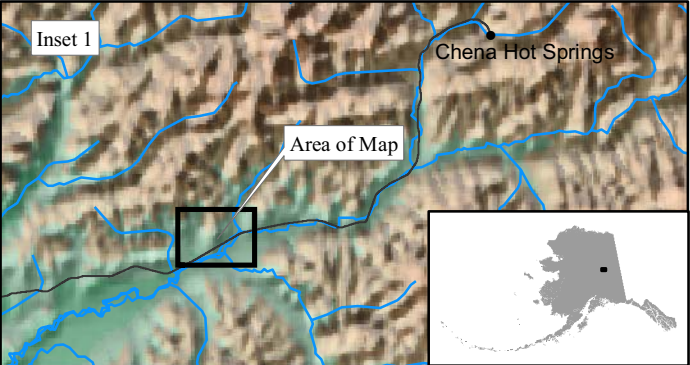

AK Div. Parks - Twin Bears
PWS 311689.002
Appendix A Map A

APPENDIX B

Contaminant Source Inventory and Risk Ranking for Twin Bears Camp (Tables 1-4)

Table 1

*Contaminant Source Inventory for
AK DIV PARKS - TWIN BEARS*

PWSID 311689.002

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Map Number</i>	<i>Comments</i>
Municipal or city parks (with green areas)	X04	X04	A	C	Chena River State Recreation Area
Municipal or city parks (with green areas)	X04	X04	B	C	Chena River State Recreation Area

Table 2

*Contaminant Source Inventory and Risk Ranking for
AK DIV PARKS - TWIN BEARS
Sources of Bacteria and Viruses*

PWSID 311689.002

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Municipal or city parks (with green areas)	X04	X04	A	Medium	C	Chena River State Recreation Area
Municipal or city parks (with green areas)	X04	X04	B	Medium	C	Chena River State Recreation Area

Table 3

*Contaminant Source Inventory and Risk Ranking for
AK DIV PARKS - TWIN BEARS
Sources of Nitrates/Nitrites*


PWSID 311689.002

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Municipal or city parks (with green areas)	X04	X04	A	Medium	C	Chena River State Recreation Area
Municipal or city parks (with green areas)	X04	X04	B	Medium	C	Chena River State Recreation Area

APPENDIX C

Twin Bears Camp Drinking Water Protection Area and Potential and Existing Contaminant Sources (Map C)

**Public Water Well System for PWS #311689.002 AK Div. Parks - Twin Bears
Showing Potential and Existing Sources of Contamination**

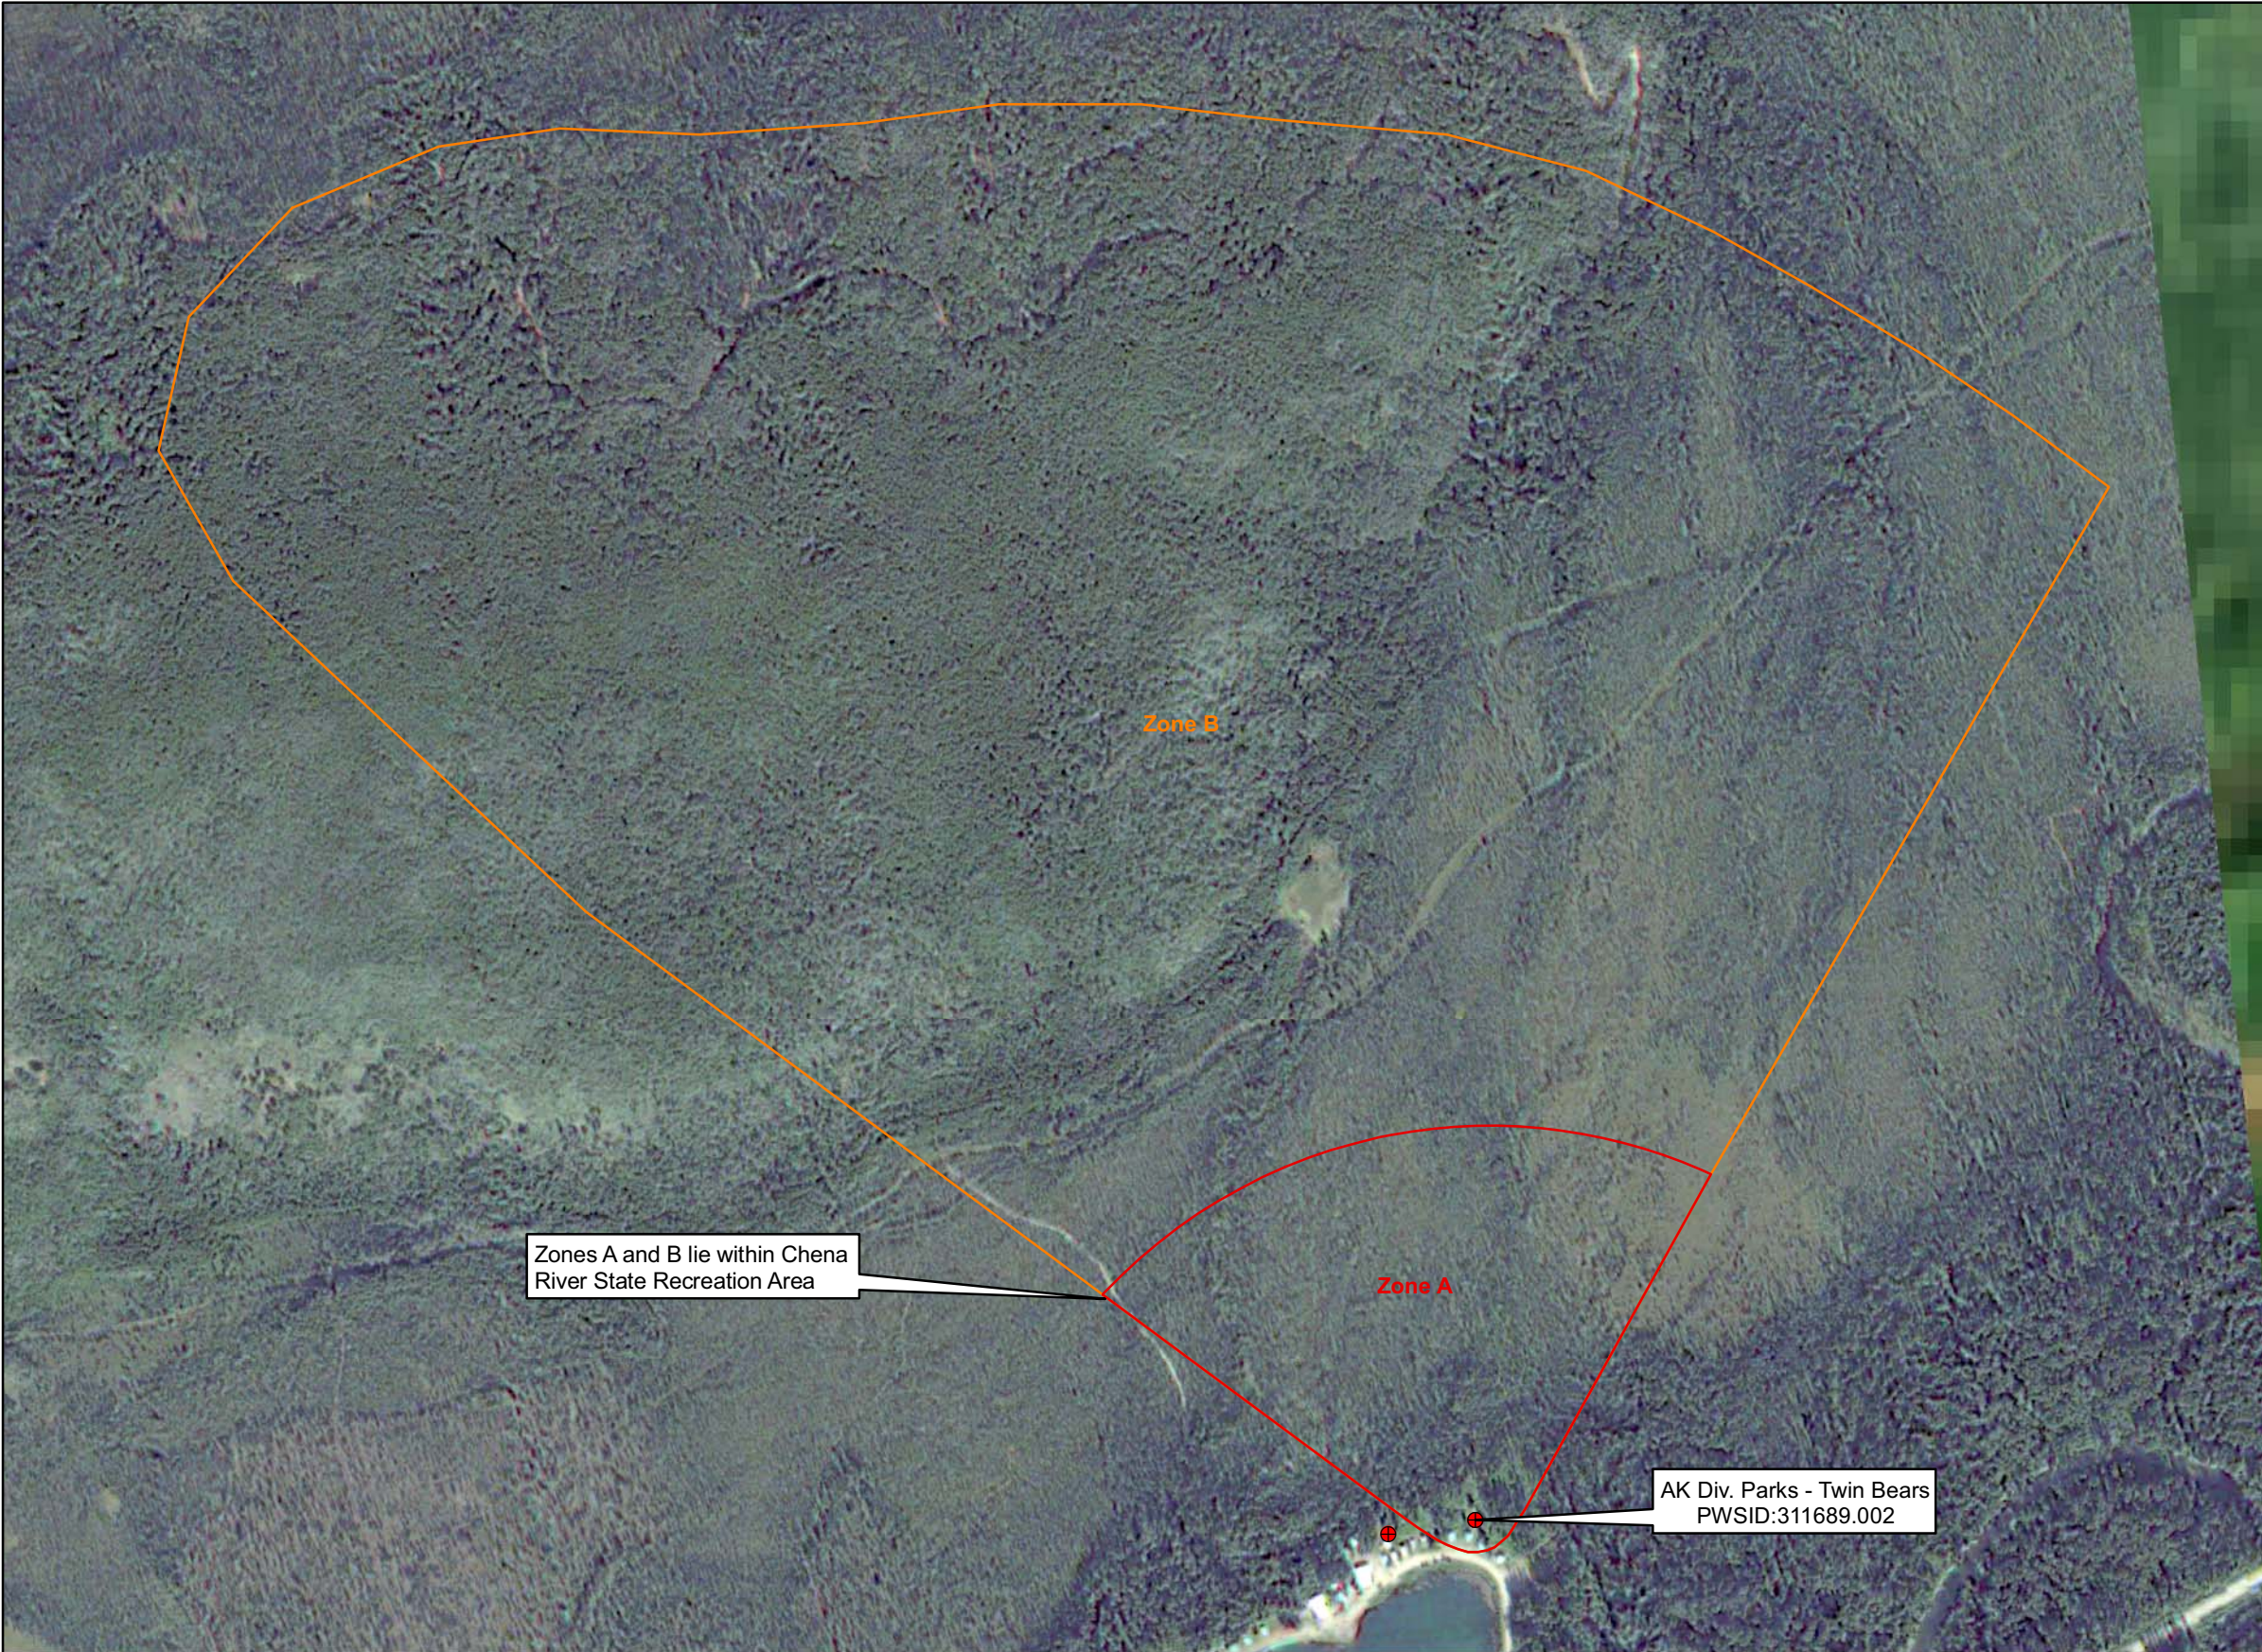

Legend

- Class B Public Water System
- Groundwater Protection Zones**
- Zone A Protection Area - Several Months Travel Time
 - Zone B Protection Area - 2 Years Travel Time

Data Sources:
Contaminant Sources, Public Water System Wells, Alaska Department of Environmental Conservation (ADEC)

All other data:
Alaska Statewide Digital Mapping Initiative (SDMI)

Drinking Water Protection Areas based on "Alaska Drinking Water Protection Program - Guidance Manual for Class B Public Water Systems" published by ADEC

URS Corporation does not guarantee the accuracy or validity of the data provided.

