



Source Water Assessment

A Hydrogeologic Susceptibility and
Vulnerability Assessment for
Ft. Greely Vehicle Inspection and
Visitor Control Facilities
Public Drinking Water System,
Fort Greely, Alaska
PWSID # 372805.001

DRINKING WATER PROTECTION REPORT 1825

Alaska Department of Environmental Conservation

January, 2009

Source Water Assessment for
Ft. Greely Vehicle Inspection and
Visitor Control Facilities
Public Drinking Water System
Fort Greely, Alaska
PWSID# 327805.001

DRINKING WATER PROTECTION REPORT 1825

The Drinking Water Protection (DWP) section of the Drinking Water Program is producing Source Water Assessments in compliance with the Safe Drinking Water Act Amendments of 1996. Each assessment includes a delineation of the source water area, an inventory of potential and existing contaminant sources that may impact the water, a risk ranking for each of these contaminants, and an evaluation of the potential vulnerability of these drinking water sources.

These assessments are intended to provide public water systems owners/operators, communities, and local governments with the best available information that may be used to protect the quality of their drinking water. The assessments combine information obtained from various sources, including the U.S. Environmental Protection Agency, Alaska Department of Environmental Conservation (DEC), public water system owners/operators, and other public information sources. The results of this assessment are subject to change if additional data becomes available. It is anticipated this assessment will be updated every five years to reflect any changes in the vulnerability and/or susceptibility of public drinking water source. If you have any additional information that may affect the results of this assessment, please contact the DWP staff at the following number: 1-866-956-7656.

January, 2009

CONTENTS

	Page		Page
Executive Summary.....	1	Ranking of Contaminant Risks	2
Ft. Greely Vehicle Inspection and Visitor Control Facilities Public Drinking Water System.....	1	Vulnerability of Ft. Greely Vehicle Inspection and Visitor Control Facilities Drinking Water System	2
Ft. Greely Vehicle Inspection and Visitor Control Facilities Drinking Water Protection Area	1	References	5
Inventory of Potential and Existing Contaminant Sources	2	Appendix A	7
		Appendix B.....	9
		Appendix C.....	11

TABLES

Table 1. Definition of Zones.....	2
Table 2. Susceptibility	3
Table 3. Contaminant Risks.....	3
Table 4. Overall Vulnerability	4

APPENDICES

- APPENDIX
- A. Ft. Greely Vehicle Inspection and Visitor Control Facilities Drinking Water Protection Area (Map A)
 - B. Contaminant Source Inventory for Ft. Greely Vehicle Inspection and Visitor Control Facilities (Table 1)
 - Contaminant Source Inventory and Risk Ranking for Ft. Greely Vehicle Inspection and Visitor Control Facilities – Bacteria and Viruses (Table 2)
 - Contaminant Source Inventory and Risk Ranking for Ft. Greely Vehicle Inspection and Visitor Control Facilities – Nitrates/Nitrites (Table 3)
 - Contaminant Source Inventory and Risk Ranking for Ft. Greely Vehicle Inspection and Visitor Control Facilities – Volatile Organic Chemicals (Table 4)
 - C. Ft. Greely Vehicle Inspection and Visitor Control Facilities Drinking Water Protection Area and Potential and Existing Contaminant Sources (Map C)

Source Water Assessment for Ft. Greely Vehicle Inspection and Visitor Control Facilities Source of Public Drinking Water, Fort Greely, Alaska

Drinking Water Protection Alaska Department of Environmental Conservation

EXECUTIVE SUMMARY

The public water system for Ft. Greely Vehicle Inspection and Visitor Control Facilities is a Class B (transient/non-community) water system consisting of one well on the Richardson Highway at mile post 261, approximately 100 miles southeast of Fairbanks, Alaska. The wellhead received a susceptibility rating of **Low** and the aquifer received a susceptibility rating of **Medium**. Combining these two ratings produces a **Low** rating for the natural susceptibility of the well. The identified potential and current source of contaminants for Ft. Greely Vehicle Inspection and Visitor Control Facilities public drinking water source is a road. This identified potential and existing source of contamination is considered as a source of bacteria and viruses, nitrates and/or nitrites, and volatile organic chemicals. Overall, the public water sources for Ft. Greely Vehicle Inspection and Visitor Control Facilities received a vulnerability rating of **Low** for all three contaminant categories. This assessment of contaminant risks can be used as a foundation for local voluntary protection efforts as well as a basis for the continuous efforts on the part of Ft. Greely Vehicle Inspection and Visitor Control Facilities to protect public health.

FT. GREELY VEHICLE INSPECTION AND VISITOR CONTROL FACILITIES PUBLIC DRINKING WATER SYSTEM

Ft. Greely Vehicle Inspection and Visitor Control Facilities public water system is a Class B (transient/non-community) water system. The system consists of one well on the Richardson Highway at mile post 261, approximately 100 miles southeast of Fairbanks, Alaska. Fort Greely is classified as a highway village, and has a population of 766. Treated well water is the water source for the community, and all residences are plumbed. Waste disposal, roads, police, and fire protection are all maintained by Fort Greely. Average annual precipitation is 11.3 inches, and average temperatures range from -22 to 72 degrees Fahrenheit (ADCCED, 2008).

The Fort Greely area borders the Alaska Range in the Tanana-Kuskokwim Lowland. The primary surficial deposits in the area are composed of moderately well sorted silt, sand, and gravel. The five major soil types in the area are Salchaket, Jarvis, Nenana, Chena, and Tanana (Nelson, 1995).

According to the well log, the well extends 300 feet below the ground surface and is completed in an unconfined aquifer and screened in gravel. The most recent sanitary survey (12/27/2005) for the system indicates a sanitary seal is installed, the land surface is appropriately sloped away from the well, and the well is grouted according to DEC regulations.

This system operates year-round and serves approximately 50 non-residents through one service connection.

FT. GREELY VEHICLE INSPECTION AND VISITOR CONTROL FACILITIES DRINKING WATER PROTECTION AREA

In order to evaluate whether a drinking water source is at risk, we must first evaluate what are the most likely pathways for surface contamination to reach the groundwater. These areas are determined by looking at the characteristics of the soil, groundwater, aquifer, and well.

The most probable area for contamination to reach the drinking water well is the drinking water protection area. The drinking water protection area is the area circling the well (the area influenced by pumping) and also the area upgradient of the well, usually forming a parabola shape. Because releases of contaminants within the protection area are most likely to impact the well, this area will serve as the focus for voluntary protection efforts.

There are many different methods for calculating the size of protection areas. Drinking Water Protection (DWP) uses a combination of two simple groundwater flow equations, the Thiem and uniform flow equations for all groundwater wells screened in unconsolidated material. The orientation of the protection zone is then drawn using a water table elevation map (if available) or a land surface elevation map of the area. The protection zone calculated by the DWP is an estimate using the available information and resources, and may

differ slightly from the actual capture zone. Because of uncertainties and changing site conditions, a factor of safety is added to the protection zone to form the drinking water protection area for the well.

The parameters used to calculate the shape of this protection zone are general for the whole alluvial plain and were obtained from various United States Geological Survey (USGS) reports, area well logs, and the Groundwater textbook by Freeze and Cherry (Freeze and Cherry, 1979).

The protection areas established for wells by the DEC are usually separated into two zones, limited by the watershed. These zones correspond to differences in the time-of-travel (TOT) of the water moving through the aquifer to the well. An analytical calculation was used to determine the size and shape of the protection area.

The time-of-travel for contaminants within the water varies and is dependent on the physical and chemical characteristics of each contaminant. The following is a summary of the two protection area zones for wells and the calculated time-of-travel for each:

Table 1. Definition of Zones

Zone	Definition
A	Several months time-of-travel
B	Less than the 2 year time-of-travel

The drinking water protection area for Ft. Greely Vehicle Inspection and Visitor Control Facilities was determined using an analytical calculation and includes Zones A and B (see Map A of Appendix A).

INVENTORY OF POTENTIAL AND EXISTING CONTAMINANT SOURCES

DWP has completed an inventory of potential and existing sources of contamination within the Ft. Greely Vehicle Inspection and Visitor Control Facilities drinking water protection area. This inventory was completed through a search of agency records and other publicly available information. Potential sources of contamination to the drinking water aquifer include a wide range of categories and types. Potential drinking water contaminants are found within agricultural, residential, commercial, and industrial areas, but can also occur within areas that have little or no development.

For the basis of all Class B public water system assessments, the following three categories of drinking water contaminants were inventoried:

- Bacteria and viruses;
- Nitrates and/or nitrites;
- Volatile organic chemicals

The sources are displayed on Map C of Appendix C and summarized in Table 1 of Appendix B.

RANKING OF CONTAMINANT RISKS

Once the potential and existing sources of contamination have been identified, they are assigned a ranking according to what type and level of risk they represent. Ranking of contaminant risks for a “potential” or “existing” source of contamination is a function of toxicity and volumes of specific contaminants associated with that source. Rankings include:

- Low;
- Medium;
- High; and
- Very High.

Tables 2 through 4 in Appendix B contain the ranking of potential and existing sources of contamination with respect to bacteria and viruses, nitrates and/or nitrites, and volatile organic chemicals.

VULNERABILITY OF FT. GREELY VEHICLE INSPECTION AND VISITOR CONTROL FACILITIES DRINKING WATER SYSTEM

Vulnerability of a drinking water source to contamination is a combination of two factors:

- Natural Susceptibility; and
- Contaminant Risks.

A score for the Natural Susceptibility of the well is reached by considering the properties of the well and the aquifer.

$$\begin{aligned}
 &\text{Susceptibility of the Wellhead (0-25 Points)} \\
 &\quad + \\
 &\text{Susceptibility of the Aquifer (0-25 Points)} \\
 &\quad = \\
 &\text{Natural Susceptibility of the Well (0-50 Points)}
 \end{aligned}$$

A ranking is assigned for the Natural Susceptibility according to the point score:

Natural Susceptibility Ratings	
40-50 pts	Very High
30 to < 40 pts	High
20 to < 30 pts	Medium
< 20 pts	Low

Factors contributing to the susceptibility of the wellhead are: whether the sanitary seal is in place, protection from flooding, and if the well casing is properly grouted.

The wellhead for the Ft. Greely Vehicle Inspection and Visitor Control Facilities received a **Low** susceptibility rating. The most recent sanitary survey (12/27/2005) for the system indicates a sanitary seal is installed, the land surface is appropriately sloped away from the well, and the well is grouted according to DEC regulations. Sanitary seals prevent potential contaminants from entering the well, while sloping of the land surface away from the wellhead provides adequate surface water drainage, and concrete or grouting around the wellhead helps to prevent potential contaminants from traveling down the outside of the well casing.

Factors contributing to the susceptibility of the aquifer are: whether the aquifer is confined or unconfined, whether the well is completed in unconsolidated or fractured bedrock, whether wells and bore holes are penetrating the aquifer and, if applicable, the confining layer.

The Ft. Greely Vehicle Inspection and Visitor Control Facilities system draws water from an unconfined aquifer consisting of gravel. It received a **Medium** susceptibility rating due to its deep, unconfined nature. Because an unconfined aquifer is recharged by surface water and precipitation that migrates downward from the surface, it is susceptible to contamination from outside sources. However, the well is very deep which provides increased protection against this downward migration and mitigates the risk somewhat.

Table 2 summarizes the Susceptibility scores and ratings for the Ft. Greely Vehicle Inspection and Visitor Control Facilities system.

Table 2. Susceptibility

	Score	Rating
Susceptibility of the Wellhead	0	Low
Susceptibility of the Aquifer	14	Medium
Natural Susceptibility	14	Low

Contaminant risks are derived from an evaluation of the routine sampling results of the water system and the presence of potential sources of contamination. Contaminant risks to a drinking water source depend on the type and distribution of contaminant sources. Flow charts are used to assign a point score, and ratings are assigned in the same way as for the natural susceptibility:

Contaminant Risk Ratings	
40-50 pts	Very High
30 to < 40 pts	High
20 to < 30 pts	Medium
< 20 pts	Low

Table 3 summarizes the Contaminant Risks for each category of drinking water contaminants for the Ft. Greely Vehicle Inspection and Visitor Control Facilities system.

Table 3. Contaminant Risks

Category	Score	Rating
Bacteria and Viruses	12	Low
Nitrates and/or Nitrites	12	Low
Volatile Organic Chemicals	12	Low

Finally, an overall vulnerability score is assigned for each water system by combining each of the contaminant risk scores with the natural susceptibility score:

$$\begin{aligned}
 &\text{Natural Susceptibility (0-50 Points)} \\
 &\quad + \\
 &\quad \text{Contaminant Risks (0-50 Points)} \\
 &\quad = \\
 &\text{Vulnerability of the Drinking Water Source to} \\
 &\quad \text{Contamination (0-100 Points)}
 \end{aligned}$$

Again, rankings are assigned according to a point score:

Overall Vulnerability Ratings	
80-100 pts	Very High
60 to < 80 pts	High
40 to < 60 pts	Medium
< 40 pts	Low

Table 4 contains the overall vulnerability scores (0-100) and ratings for each of the three categories of drinking water contaminants for the Ft. Greely Vehicle Inspection and Visitor Control Facilities system. Note: scores are rounded off to the nearest five.

Table 4. Overall Vulnerability

Category	Score	Rating
Bacteria and Viruses	25	Low
Nitrates and/or Nitrites	25	Low
Volatile Organic Chemicals	25	Low

Bacteria and Viruses

The contaminant risk for bacteria and viruses is **Low** with a road contributing to the risk to the drinking water well.

Coliforms (a bacteria) are found naturally in the environment and although they aren't necessarily a health threat, they are an indicator of other potentially harmful bacteria in the water, more specifically, fecal coliforms and E. coli, which only come from human and animal fecal waste. Harmful bacteria can cause diarrhea, cramps, nausea, headaches, or other symptoms (EPA, 2008).

Only a small amount of bacteria and viruses are required to endanger public health. Positive samples increase the overall vulnerability of the drinking water source, indicating that the source is susceptible to bacteria and virus contamination. Bacteria and viruses have not been detected during recent sampling at Ft. Greely Vehicle Inspection and Visitor Control Facilities (data reviewed in April, 2008).

After combining the contaminant risk for bacteria and viruses with the natural susceptibility of the well, the overall vulnerability of the well to contamination is **Low**.

Nitrates and Nitrites

The contaminant risk for nitrates and nitrites is **Low** with a road contributing to the risk to this source of public drinking water. .

Nitrates are very mobile, moving at approximately the same rate as water. The sampling history for Ft. Greely Vehicle Inspection and Visitor Control Facilities indicates that nitrates have not been detected in the water in the past five years (data reviewed in April, 2008).

After combining the contaminant risk for nitrates and nitrites with the natural susceptibility of the well, the overall vulnerability of the well to contamination is **Low**.

Volatile Organic Chemicals

The contaminant risk for volatile organic chemicals is **Low** with a road contributing the only risk to the drinking water well.

The drinking water at Ft. Greely Vehicle Inspection and Visitor Control Facilities has not been recently sampled for volatile organic chemicals (data reviewed in April, 2008).

After combining the contaminant risk for volatile organic chemicals with the natural susceptibility of the well, the overall vulnerability of the well to contamination is **Low**.

Using the Source Water Assessment

This assessment of contaminant risks can be used as a foundation for local voluntary protection efforts as well as a basis for the continuous efforts on the part of Ft. Greely Vehicle Inspection and Visitor Control Facilities to protect public health. It is anticipated that Source Water Assessments will be updated every five years to reflect any changes in the vulnerability and/or susceptibility of Ft. Greely Vehicle Inspection and Visitor Control Facilities drinking water source.

REFERENCES

- Alaska Department of Commerce, Community and Economic Development (ADCCED), Accessed 2008 [WWW document]. URL: http://www.commerce.state.ak.us/dca/commdb/CF_COMDB.htm
- Freeze, R.A. and Cherry, J.A., 1979. Groundwater. Prentice-Hall, Englewood Cliffs, NJ.
- Nelson, G.L., 1995, Overview of Environmental and Hydrogeologic Conditions near Big Delta, Alaska, U.S. Geological Survey Open File Report 95-180, prepared in cooperation with the FAA.
- United States Environmental Protection Agency (EPA), Accessed 2008 [WWW document]. URL: <http://www.epa.gov/safewater/contaminants/index.html>.

APPENDIX A

Ft. Greely Vehicle Inspection and Visitor Control Facilities Drinking Water Protection Area Location Map (Map A)

Public Water Well System for PWS #372805.001 Ft. Greely - Vehicle Inspec./Gate Entry



Legend




- Class B Public Water System
- Groundwater Protection Zones**
- Zone A Protection Area - Several Months Travel Time
- Zone B Protection Area - 2 Years Travel Time

Data Sources:
Contaminant Sources, Public Water System Wells, Alaska Department of Environmental Conservation (ADEC)

All other data:
Alaska Statewide Digital Mapping Initiative (SDMI)

Drinking Water Protection Areas based on "Alaska Drinking Water Protection Program - Guidance Manual for Class B Public Water Systems" published by ADEC

URS Corporation does not guarantee the accuracy or validity of the data provided.

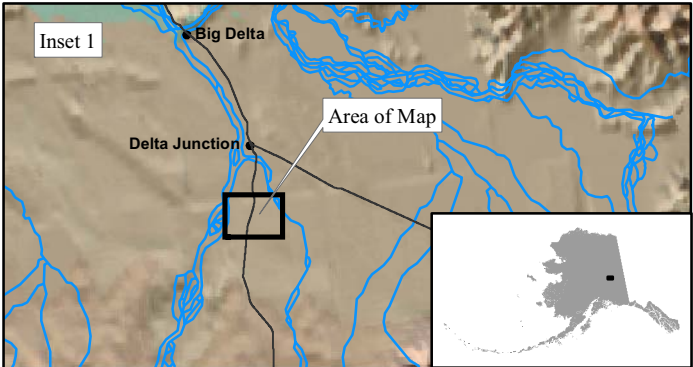

Ft. Greely - Vehicle Inspec./Gate Entry
PWS 372805.001

Appendix A Map A

APPENDIX B

Contaminant Source Inventory and Risk Ranking for Ft. Greely Vehicle Inspection and Visitor Control Facilities (Tables 1-4)

Table 1

*Contaminant Source Inventory for
FT. GREELY - VEHICLE INSPEC./GATE ENTRY*

PWSID 372805.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Map Number</i>	<i>Comments</i>
Highways and roads, paved (cement or asphalt)	X20	X20	A	C	

Table 2

*Contaminant Source Inventory and Risk Ranking for
FT. GREELY - VEHICLE INSPEC./GATE ENTRY
Sources of Bacteria and Viruses*

PWSID 372805.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Highways and roads, paved (cement or asphalt)	X20	X20	A	Low	C	

Table 3

*Contaminant Source Inventory and Risk Ranking for
FT. GREELY - VEHICLE INSPEC./GATE ENTRY
Sources of Nitrates/Nitrites*

PWSID 372805.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Highways and roads, paved (cement or asphalt)	X20	X20	A	Low	C	

Table 4

*Contaminant Source Inventory and Risk Ranking for
FT. GREELY - VEHICLE INSPEC./GATE ENTRY
Sources of Volatile Organic Chemicals*

PWSID 372805.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Highways and roads, paved (cement or asphalt)	X20	X20	A	Low	C	

APPENDIX C

Ft. Greely Vehicle Inspection and Visitor Control Facilities Drinking Water Protection Area and Potential and Existing Contaminant Sources (Map C)

**Public Water Well System for PWS #372805.001 Ft. Greely - Vehicle Inspec./Gate Entry
Showing Potential and Existing Sources of Contamination**



Legend

- Class B Public Water System
- Groundwater Protection Zones**
- Zone A Protection Area - Several Months Travel Time
- Zone B Protection Area - 2 Years Travel Time

Data Sources:
Contaminant Sources, Public Water System Wells, Alaska Department of Environmental Conservation (ADEC)

All other data:
Alaska Statewide Digital Mapping Initiative (SDMI)

Drinking Water Protection Areas based on "Alaska Drinking Water Protection Program - Guidance Manual for Class B Public Water Systems" published by ADEC

URS Corporation does not guarantee the accuracy or validity of the data provided.

