

Source Water Assessment

A Hydrogeologic Susceptibility and
Vulnerability Assessment for
Fort Wainwright Water Treatment Plant
Wells 1011 and 1032,
Fort Wainwright, Alaska
PWSID 310918

February 2004

DRINKING WATER PROTECTION PROGRAM REPORT Report 1286
Alaska Department of Environmental Conservation

Source Water Assessment for
Fort Wainwright Water Treatment Plant
Wells 1011 and 1032
Fort Wainwright, Alaska
PWSID 310918

February 2004

DRINKING WATER PROTECTION PROGRAM REPORT Report 1286

The Drinking Water Protection Program (DWPP) is producing Source Water Assessments in compliance with the Safe Drinking Water Act Amendments of 1996. Each assessment includes a delineation of the source water area, an inventory of potential and existing contaminant sources that may impact the water, a risk ranking for each of these contaminants, and an evaluation of the potential vulnerability of these drinking water sources.

These assessments are intended to provide public water systems owners/operators, communities, and local governments with the best available information that may be used to protect the quality of their drinking water. The assessments combine information obtained from various sources, including the U.S. Environmental Protection Agency, Alaska Department of Environmental Conservation (ADEC), public water system owners/operators, and other public information sources. The results of this assessment are subject to change if additional data becomes available. It is anticipated this assessment will be updated every five years to reflect any changes in the vulnerability and/or susceptibility of public drinking water source. If you have any additional information that may affect the results of this assessment, please contact the Program Coordinator of DWPP, (907) 269-7521.

CONTENTS

	Page		Page
Executive Summary	1	Inventory of Potential and Existing Contaminant Sources	2
Fort Wainwright Water Treatment Plant Public Drinking Water System	1	Ranking of Contaminant Risks	3
Fort Wainwright Water Treatment Plant Protection Area	1	Vulnerability of Fort Wainwright Water Treatment Plant Drinking Water System	3
		References	7

TABLES

TABLE	1. Definition of Zones	2
	2. Susceptibility	4
	3. Contaminant Risks	4
	3. Overall Vulnerability	4

APPENDICES

APPENDIX	A. Fort Wainwright Water Treatment Plant wells Drinking Water Protection Area (Map 1)	
	B. Contaminant Source Inventory for Fort Wainwright Water Treatment Plant wells (Table 1) Contaminant Source Inventory and Risk Ranking for Fort Wainwright Water Treatment Plant – Bacteria and Viruses (Table 2) Contaminant Source Inventory and Risk Ranking for Fort Wainwright Water Treatment Plant – Nitrates/Nitrites (Table 3) Contaminant Source Inventory and Risk Ranking for Fort Wainwright Water Treatment Plant – Volatile Organic Chemicals (Table 4) Contaminant Source Inventory and Risk Ranking for Fort Wainwright Water Treatment Plant – Heavy Metals, Cyanide, and Other Inorganic Chemicals (Table 5) Contaminant Source Inventory and Risk Ranking for Fort Wainwright Water Treatment Plant – Synthetic Organic Chemicals (Table 6) Contaminant Source Inventory and Risk Ranking for Fort Wainwright Water Treatment Plant – Other Organic Chemicals (Table 7)	
	C. Fort Wainwright Water Treatment Plant wells Drinking Water Protection Area and Potential and Existing Contaminant Sources (Maps 2 and 3)	
	D. Vulnerability Analysis for Contaminant Source Inventory and Risk Ranking for Fort Wainwright Water Treatment Plant wells Public Drinking Water Source (Charts 1 – 14)	

Source Water Assessment for Fort Wainwright Water Treatment Plant Wells 1011 and 1032

Fort Wainwright, Alaska

Drinking Water Protection Program Alaska Department of Environmental Conservation

EXECUTIVE SUMMARY

This source water assessment provides an evaluation of the vulnerability to potential contamination of two of the nine wells making up the public water system serving Fort Wainwright Water Treatment Plant. This Class A (community) water system consists of nine wells in Fort Wainwright, Alaska. This report is an assessment of wells 1011 (PWSID 310918.9) and 1032 (310918.1). These wells are used primarily for fire protection but also serve as backup wells for the public water system. The wells received a natural susceptibility rating of **Medium**. This rating is a combination of a susceptibility rating of **Low** for the actual wellheads and a **Very High** rating for the aquifer in which the wells are drawing water from. Identified potential and current sources of contamination for these Fort Wainwright Water Treatment Plant wells include: septic systems, fuel storage tanks, residential area, roads Class V injection wells, a medical facility, fireworks sales, an airport, construction trade areas, printers, motor vehicles sales and repair shops, a furniture shop, a taxidermist, and a firehouse. These are considered as sources of bacteria and viruses, nitrates and/or nitrites, volatile organic chemicals, heavy metals, cyanide and other inorganic chemicals, synthetic organic chemicals, and other organic chemicals. Combining the natural susceptibility of the well with the contaminant risk, the public water system for Fort Wainwright Water Treatment Plant wells received an overall vulnerability rating of **High** for bacteria and viruses, nitrates and/or nitrites, and volatile organic chemicals, and a **Medium** for heavy metals, cyanide, and other inorganic chemicals, synthetic organic chemicals, and other organic chemicals.

FORT WAINWRIGHT WATER TREATMENT PLANT WELLS PUBLIC DRINKING WATER SYSTEM

Fort Wainwright Water Treatment Plant public water system is a Class A (community) water system. This is an assessment of wells 1011 and 1032; two of the nine wells making up the public drinking water system serving Fort Wainwright. These wells are used primarily for fire protection but also serve as backup wells for the public water system. Well 1032 (PWSID 310918.1) is located just north of Dogwood Street and

Well 1011 (310918.9) is located just north of Chestnut Street in Fort Wainwright, Alaska (T1S, R1E, Section 8) (See Map 1 of Appendix A). Fort Wainwright is located on the southeast side of the town of Fairbanks which is located in the Fairbanks North Star Borough near the center of Alaska (Please see the inset of Map 1 in Appendix A for location). The Borough's current population is 82,840 making it the second-largest population center in the state (ADCED, 2002). Communities located within the Borough include : College, Eielson Air Force Base, Ester, Fairbanks, Fox, Harding Lake, Moose Creek, North Pole, Pleasant Valley, Salcha, and Two Rivers.

The Fairbanks area includes two distinct topographic areas: the alluvial plain between the Tanana River and the Chena River, and the uplands north of this alluvial plain. The Fort Wainwright Water Treatment Plant wells water system is located in the alluvial plain at an elevation of approximately 450 feet above sea level.

According to the 4/26/01 Sanitary Survey for this water system, the depths of these two wells is unknown. Most wells in this area are screened in a combination of sand and gravel, and it is assumed these are also. The alluvial plain consists of alternating layers of silt, sand and gravel up to over 500 feet thick, in some locations overlain by 1 to 10 feet of silt or sandy silt or a few feet of peat (Glass and others, 1996). Discontinuous permafrost (perennially frozen areas) is also common in the alluvial plain. The depth to permafrost in these areas ranges between 2 and 45 feet below the ground surface with the thickness of the permafrost ranging between 5 and 265 feet (Pewe, T.L. 1958. Geology of the Fairbanks (D-2) Quadrangle, Alaska. USGS). Areas with discontinuous permafrost may locally affect the ground water flow directions.

Primarily the Tanana River, but also the Chena River contribute water to this alluvial aquifer. The Chena River typically only contributes water when its stage is high and the Tanana is low (Nelson, 1978). The Tanana River gets approximately 85% of its water from snowmelt of the Alaska Range and 15% from the Yukon-Tanana uplands (Anderson, 1970).

This public drinking water system serves approximately 6,000 residents through approximately 600 service connections.

FORT WAINWRIGHT WATER TREATMENT PLANT WELLS DRINKING WATER PROTECTION AREA

The pathways most likely for surface contamination to reach the groundwater are identified as the first step in determining a drinking water system's risk. These areas are determined by looking at the characteristics of the soil, groundwater, aquifer, and well.

The most probable area for contamination to reach the drinking water wells is the area that contributes water to the well, the groundwater capture zone. The groundwater capture zone is located in the area circling the well (the area influenced by pumping) and also the area of the water table upgradient of the well, usually forming a parabola shape.

There are many different ways of calculating the size of capture zones. This assessment uses a combination of two simple groundwater flow equations, the Thiem and uniform flow equations for all groundwater wells screened in unconsolidated material. The orientation of the capture zone is then drawn using a water table elevation map (if available) or a land surface elevation map of the area. The capture zone calculated in this assessment is only a best guess using the information and resources available to us, and may differ slightly from the actual capture zone.

The parameters used to calculate the shape of this capture zone are general for the whole alluvial plain and were obtained from various United State Geological Survey (USGS) reports, well logs in the area, and the Groundwater textbook by Freeze and Cherry (Freeze and Cherry, 1979).

The water table in the area of these Fort Wainwright Water Treatment Plant wells, the area between the Tanana and the Chena Rivers, is primarily influenced by the level of water flow in each river. The capture zones were drawn based on three separate configurations of the water table during various stages of the rivers: a period of high stage in the Chena River (October 14-17, 1986), high stage in the Tanana River (July 16-17, 1987), and low stages in both rivers (March 30-April 3, 1988) (Glass and others, 1996). High water levels in the Chena usually occur in the spring due to runoff from the uplands and in late summer due to rainstorms (Nelson, 1978). The Tanana usually experiences high flow during the hot, dry periods of mid-summer when maximum snowmelt from the Alaska Range occurs (Nelson, 1978). Groundwater in this area generally flows toward the northwest, from the Tanana River to the Chena River, however flow is reversed very near the Chena River during its high stage periods (Glass and others, 1996). These flow reversals are of short duration (i.e. days versus months)

and of limited extent, generally within 1000 feet of the river (Nakanishi, et al, 1998).

Because of uncertainties and changing site conditions, a factor of safety is added to the groundwater capture zone to form the drinking water protection area for the well.

The protection areas established for wells are usually separated into four zones, limited by the watershed. These zones correspond to times-of-travel (TOT) of the water moving through the aquifer to the well (plus the factor of safety).

The following is a summary of the four zones for wells and the calculated time-of-travel for each:

Table 1. Definition of Zones

Zone	Definition
A	¼ the distance for the 2-yr. time-of-travel
B	Less than 2 years time-of-travel
C	Less than 5 years time-of-travel
D	Less than 10 years time-of-travel

The time of travel for *contaminants* within the water varies with their unique physical and chemical characteristics.

The drinking water protection area outlined for the Fort Wainwright Water Treatment Plant wells on Map 1 of Appendix A will serve as the focus for voluntary protection efforts.

INVENTORY OF POTENTIAL AND EXISTING CONTAMINANT SOURCES

The Drinking Water Protection Program (DWPP) has completed an inventory of potential and existing sources of contamination within these Fort Wainwright Water Treatment Plant wells protection area. This inventory was completed through a search of agency records and other publicly available information. Potential drinking water contaminants are found within agricultural, residential, commercial, and industrial areas, but can also occur within areas that have little or no development.

For the basis of all Class A public water system assessments, six categories of drinking water contaminants were inventoried. They include:

- Bacteria and viruses;
- Nitrates and/or nitrites;
- Volatile organic chemicals;
- Heavy metals, cyanide, and other inorganic chemicals;
- Synthetic organic chemicals; and
- Other inorganic chemicals.

The sources are displayed on Maps 2 and 3 of Appendix C and summarized in Table 1 of Appendix B.

RANKING OF CONTAMINANT RISKS

Once the potential and existing sources of contamination have been identified, they are each assigned a ranking according to what type and level of risk they represent. Ranking of contaminant risks for a “potential” or “existing” source of contamination is a combination of toxicity and volume associated with that source. Rankings include:

- Low;
- Medium;
- High; and
- Very High.

Bacteria and Viruses are only inventoried in Zones A and B because of their short life span. Only “Very High” and “High” rankings are inventoried within the outer Zone D due to the probability of contaminant dilution by the time the contaminants get to the well.

Tables 2 through 7 in Appendix B contain the ranking of inventoried potential and existing sources of contamination with respect to the six contaminant categories.

VULNERABILITY OF FORT WAINWRIGHT WATER TREATMENT PLANT WELLS DRINKING WATER SYSTEM

Vulnerability of a drinking water source to contamination is a combination of two factors:

- Natural susceptibility; and
- Contaminant risks.

Appendix D contains fourteen charts, which together form the ‘Vulnerability Analysis’ for a source water assessment for a public drinking water source. Chart 1 analyzes the ‘Susceptibility of the Wellhead’ to contamination by looking at the construction of the well and its surrounding area. Chart 2 analyzes the ‘Susceptibility of the Aquifer’ to contamination by looking at the properties of the aquifer and the presence of other wells or boreholes in the area. Chart 3 analyzes ‘Contaminant Risks’ for the drinking water source with respect to Bacteria and Viruses. The ‘Contaminant Risks’ portion of the analysis considers potential sources of contaminants as well as a review of the water system’s contaminant sample results. Lastly, Chart 4 combines the results of the first three charts to produce the ‘Vulnerability Analysis for Bacteria and Viruses’. Charts 5 through 14 contain the Contaminant Risks and Vulnerability Analyses for nitrates and nitrites, volatile organic chemicals, heavy metals, cyanide, and other inorganic chemicals, synthetic

organic chemicals, and other organic chemicals, respectively.

A score for the Natural Susceptibility is reached by considering the properties of the well and the aquifer.

$$\begin{array}{r}
 \text{Susceptibility of the Wellhead (0 – 25 Points)} \\
 \text{(Chart 1 of Appendix D)} \\
 + \\
 \text{Susceptibility of the Aquifer (0 – 25 Points)} \\
 \text{(Chart 2 of Appendix D)} \\
 = \\
 \text{Natural Susceptibility (Susceptibility of the Well)} \\
 \text{(0 – 50 Points)}
 \end{array}$$

A ranking is assigned for the Natural Susceptibility according to the point score:

Natural Susceptibility Ratings	
40 to 50 pts	Very High
30 to < 40 pts	High
20 to < 30 pts	Medium
< 20 pts	Low

These wellheads for the Fort Wainwright Water Treatment Plant received a Low Susceptibility rating. The 4/26/01 Sanitary Survey indicates it is unknown if the wells are capped with a sanitary seal, this assessment assumes a sanitary seal is correctly installed on each of the wells. The land surface is sloped away from each of the wells; and all four wells are grouted. A sanitary seal prevents potential contaminants from entering the well from the inside while sloping the land surface away from the well and grouting help to prevent potential contaminants from traveling down the outside of the well casing.

The aquifer in the area these Fort Wainwright Water Treatment Plant wells are completed in received a Very High Susceptibility rating. The highly transmissive aquifer material (sand and gravel) in the area allows contaminants to travel downward from the surface with the precipitation and surface water runoff. The shallow water table allows potential contaminants to come into contact with the water table with little natural filtering where they can disperse quickly. Additionally, wells in the area can provide a quick pathway for contaminants to reach the aquifer. Table 2 summarizes the Susceptibility scores and ratings for Fort Wainwright Water Treatment Plant wells.

Table 2. Susceptibility

	Score	Rating
Susceptibility of the Wellhead	0	Low
Susceptibility of the Aquifer	25	Very High
Natural Susceptibility	25	Medium

The Contaminant Risk has been derived from an evaluation of the routine sampling results of the water system and the presence of potential sources of contamination. Contaminant risks to a drinking water source depend on the type and distribution of contaminant sources. Flow charts are used to assign a point score, and ratings are assigned in the same way as for the natural susceptibility:

Contaminant Risk Ratings	
40 to 50 pts	Very High
30 to < 40 pts	High
20 to < 30 pts	Medium
< 20 pts	Low

Table 3 summarizes the Contaminant Risks for each category of drinking water contaminants.

Table 3. Contaminant Risks

Category	Score	Rating
Bacteria and Viruses	50	Very High
Nitrates and/or Nitrites	40	Very High
Volatile Organic Chemicals	50	Very High
Heavy Metals, Cyanide, and Other Inorganic Chemicals	20	Medium
Synthetic Organic Chemicals	20	Medium
Other Organic Chemicals	30	High

Finally, an overall vulnerability score is assigned for each water system by combining each of the contaminant risk scores with the natural susceptibility score:

$$\begin{array}{r}
 \text{Natural Susceptibility (0 – 50 points)} \\
 + \\
 \text{Contaminant Risks (0 – 50 points)} \\
 = \\
 \text{Vulnerability of the} \\
 \text{Drinking Water Source to Contamination (0 – 100).}
 \end{array}$$

Again, rankings are assigned according to a point score:

Overall Vulnerability Ratings	
80 to 100 pts	Very High
60 to < 80 pts	High
40 to < 60 pts	Medium
< 40 pts	Low

Table 4 contains the overall vulnerability scores (0 – 100) and ratings for each of the six categories of drinking water contaminants. Note: scores are rounded off to the nearest five.

Table 4. Overall Vulnerability

Category	Score	Rating
Bacteria and Viruses	75	High
Nitrates and/or Nitrites	65	High
Volatile Organic Chemicals	75	High
Heavy Metals, Cyanide, and Other Inorganic Chemicals	45	Medium
Synthetic Organic Chemicals	45	Medium
Other Organic Chemicals	55	Medium

Bacteria and Viruses

The Class V Large Capacity Septic Systems located in Zones A and C of the protection area represent the greatest identified risk of Bacteria and Viruses to this water system.

A Large Capacity Septic System Class V Injection well differs from a residential septic system when it receives sanitary waste from multiple family residences or a non-residential establishment and has the capacity to serve 20 or more persons per day.

Only a small amount of bacteria and viruses are required to endanger public health. Coliforms (a bacteria) are found naturally in the environment and although they aren't necessarily a health threat, it is an indicator of other potentially harmful bacteria in the water, more specifically, fecal coliforms and E. coli which only come from human and animal fecal waste (EPA, 2002). Harmful bacteria can cause diarrhea, cramps, nausea, headaches, or other symptoms (EPA, 2002). Routine sampling has most recently detected coliforms in this water system on 9/4/01 (verified on 9/6/01). Fecal coliform and E. Coli were not detected in the water.

After combining the contaminant risk for bacteria and viruses with the natural susceptibility of the well, the overall vulnerability of the well to contamination is high.

Nitrates and Nitrites

The Class V Large Capacity Septic Systems also represent the greatest risk of nitrates and nitrites for this source of public drinking water.

Nitrates are very mobile, moving at approximately the same rate as water. Nitrates have not been detected in significant concentrations during recent sampling history for the Fort Wainwright Water Treatment Plant water system.

After combining the contaminant risk for nitrates and nitrites with the natural susceptibility of the well, the overall vulnerability of the well to contamination is high.

Volatile Organic Chemicals

The airport in Zone A represents the greatest risk for volatile organic chemical contamination to the well.

Volatile Organic Chemicals have not been detected during routine sampling of this water system. After combining the contaminant risk for volatile organic chemicals with the natural susceptibility of the well, the overall vulnerability of the well to contamination is high.

Heavy Metals, Cyanide, and Other Inorganic Chemicals

The Class V Motor Vehicle Waste Disposal well in Zone C represents the greatest risk to heavy metals for this source of public drinking water.

Class V Injection wells are most commonly septic systems or dry wells. Motor vehicle waste Class V wells have been banned as of April 5, 2000 although existing disposal wells have until January 1, 2007 in most cases to either close or obtain a permit to operate.

Antimony and Beryllium have been detected in extremely small concentrations with respect to their Maximum Contaminant Levels (MCL). A MCL is the concentration of a contaminant allowed in the drinking water by the Environmental Protection Area (EPA). No other heavy metals were not detected during recent sampling of the Ft Wainwright Water Treatment Plant drinking water system.

After combining the contaminant risk for heavy metals, cyanide and other inorganic chemicals with the natural susceptibility of the well, the overall vulnerability of the well to contamination is medium.

Synthetic Organic Chemicals

The airport in Zone A represents the greatest risk for synthetic organic chemical contamination to the well.

Synthetic Organic Chemicals have not been detected during routine sampling of the Ft Wainwright Water Treatment Plant public drinking water system.

After combining the contaminant risk for synthetic organic chemicals with the natural susceptibility of the well, the overall vulnerability of the well to contamination is medium.

Other Organic Chemicals

Again, the airport in Zone A represents the greatest risk for other organic chemical contamination to the well.

Other Organic Chemicals have not been detected during routine sampling of the Ft Wainwright Water Treatment Plant public drinking water system.

After combining the contaminant risk for other organic chemicals with the natural susceptibility of the well, the overall vulnerability of the well to contamination is medium.

Existing Contaminated Sites


There are approximately 16 ADEC-recognized contaminated sites located within the protection area (displayed on Maps 2 and 3 of Appendix C). The locations of these sites are approximate and may be located at the center of the zipcode boundaries the actual site is located in. The ADEC Contaminated Sites program has identified, assessed, and is ensuring cleanup of these sites based on their prioritized order. Priority is based on risk to human health and the environment, including risk to public drinking water wells. Specific information on each site can be found on the internet at http://www.dec.state.ak.us/spar/cs/search/csites/csites_search.asp for contaminated sites or <http://info.dec.state.ak.us/SPAR/CSP/UST/Search/> for LUST sites or by calling the ADEC Contaminated Sites Program at (907) 269-7658.

REFERENCES

- Alaska Department of Community and Economic Development (ADCED), 2002 [WWW document]. URL http://www.dced.state.ak.us/mra/CF_BLOCK.cfm.
- Anderson, G.S., 1970, Hydrologic reconnaissance of the Tanana basin, central Alaska: U.S. Geological Survey Hydrologic Investigations Atlas HA-319.
- Forbes, R.B. and Weber, F.R., 1981. Bedrock Geologic Map of the Fairbanks Mining District, Alaska. Funded by the State of Alaska, US Geological Survey, and The National Science Foundation.
- Freeze, R.A. and Cherry, J.A., 1979. Groundwater. Prentice-Hall, Englewood Cliffs, NJ.
- Glass, Roy L., Lilly, Micheal R., and Meyer, David F., 1996. Ground-Water Levels in an Alluvial Plain Between the Tanana and Chena Rivers Near Fairbanks, Alaska 1986-93. US Geological Survey Water Resources Investigations Report 96-4060, 39p.
- Nakanishi, Allan S. and Lilly, Micheal R., 1998. Estimate of Aquifer Properties by Numerically Simulating Ground-Water/Surface-Water Interactions, Fort Wainwright, Alaska. US Geological Survey Water Resources Investigations Report 98-4088, 27p.
- Nelson, Gordon L., 1978, Hydrologic Information for Land-Use Planning, Fairbanks Vicinity, Alaska. US Department of the Interior Geological Survey Open File Report 78-959, 47p.
- Pewe, T. L., 1958, Geologic map of the Fairbanks D-2 quadrangle, Alaska: U.S. Geol. Survey Geol. Quad. Map GQ-110, scale 1:63,360.
- United States Environmental Protection Agency (EPA), 2002 [WWW document]. URL <http://www.epa.gov/safewater/mcl.html>.



APPENDIX A

Fort Wainwright Water Treatment Plant wells Drinking Water Protection Area Location Map (Map 1)

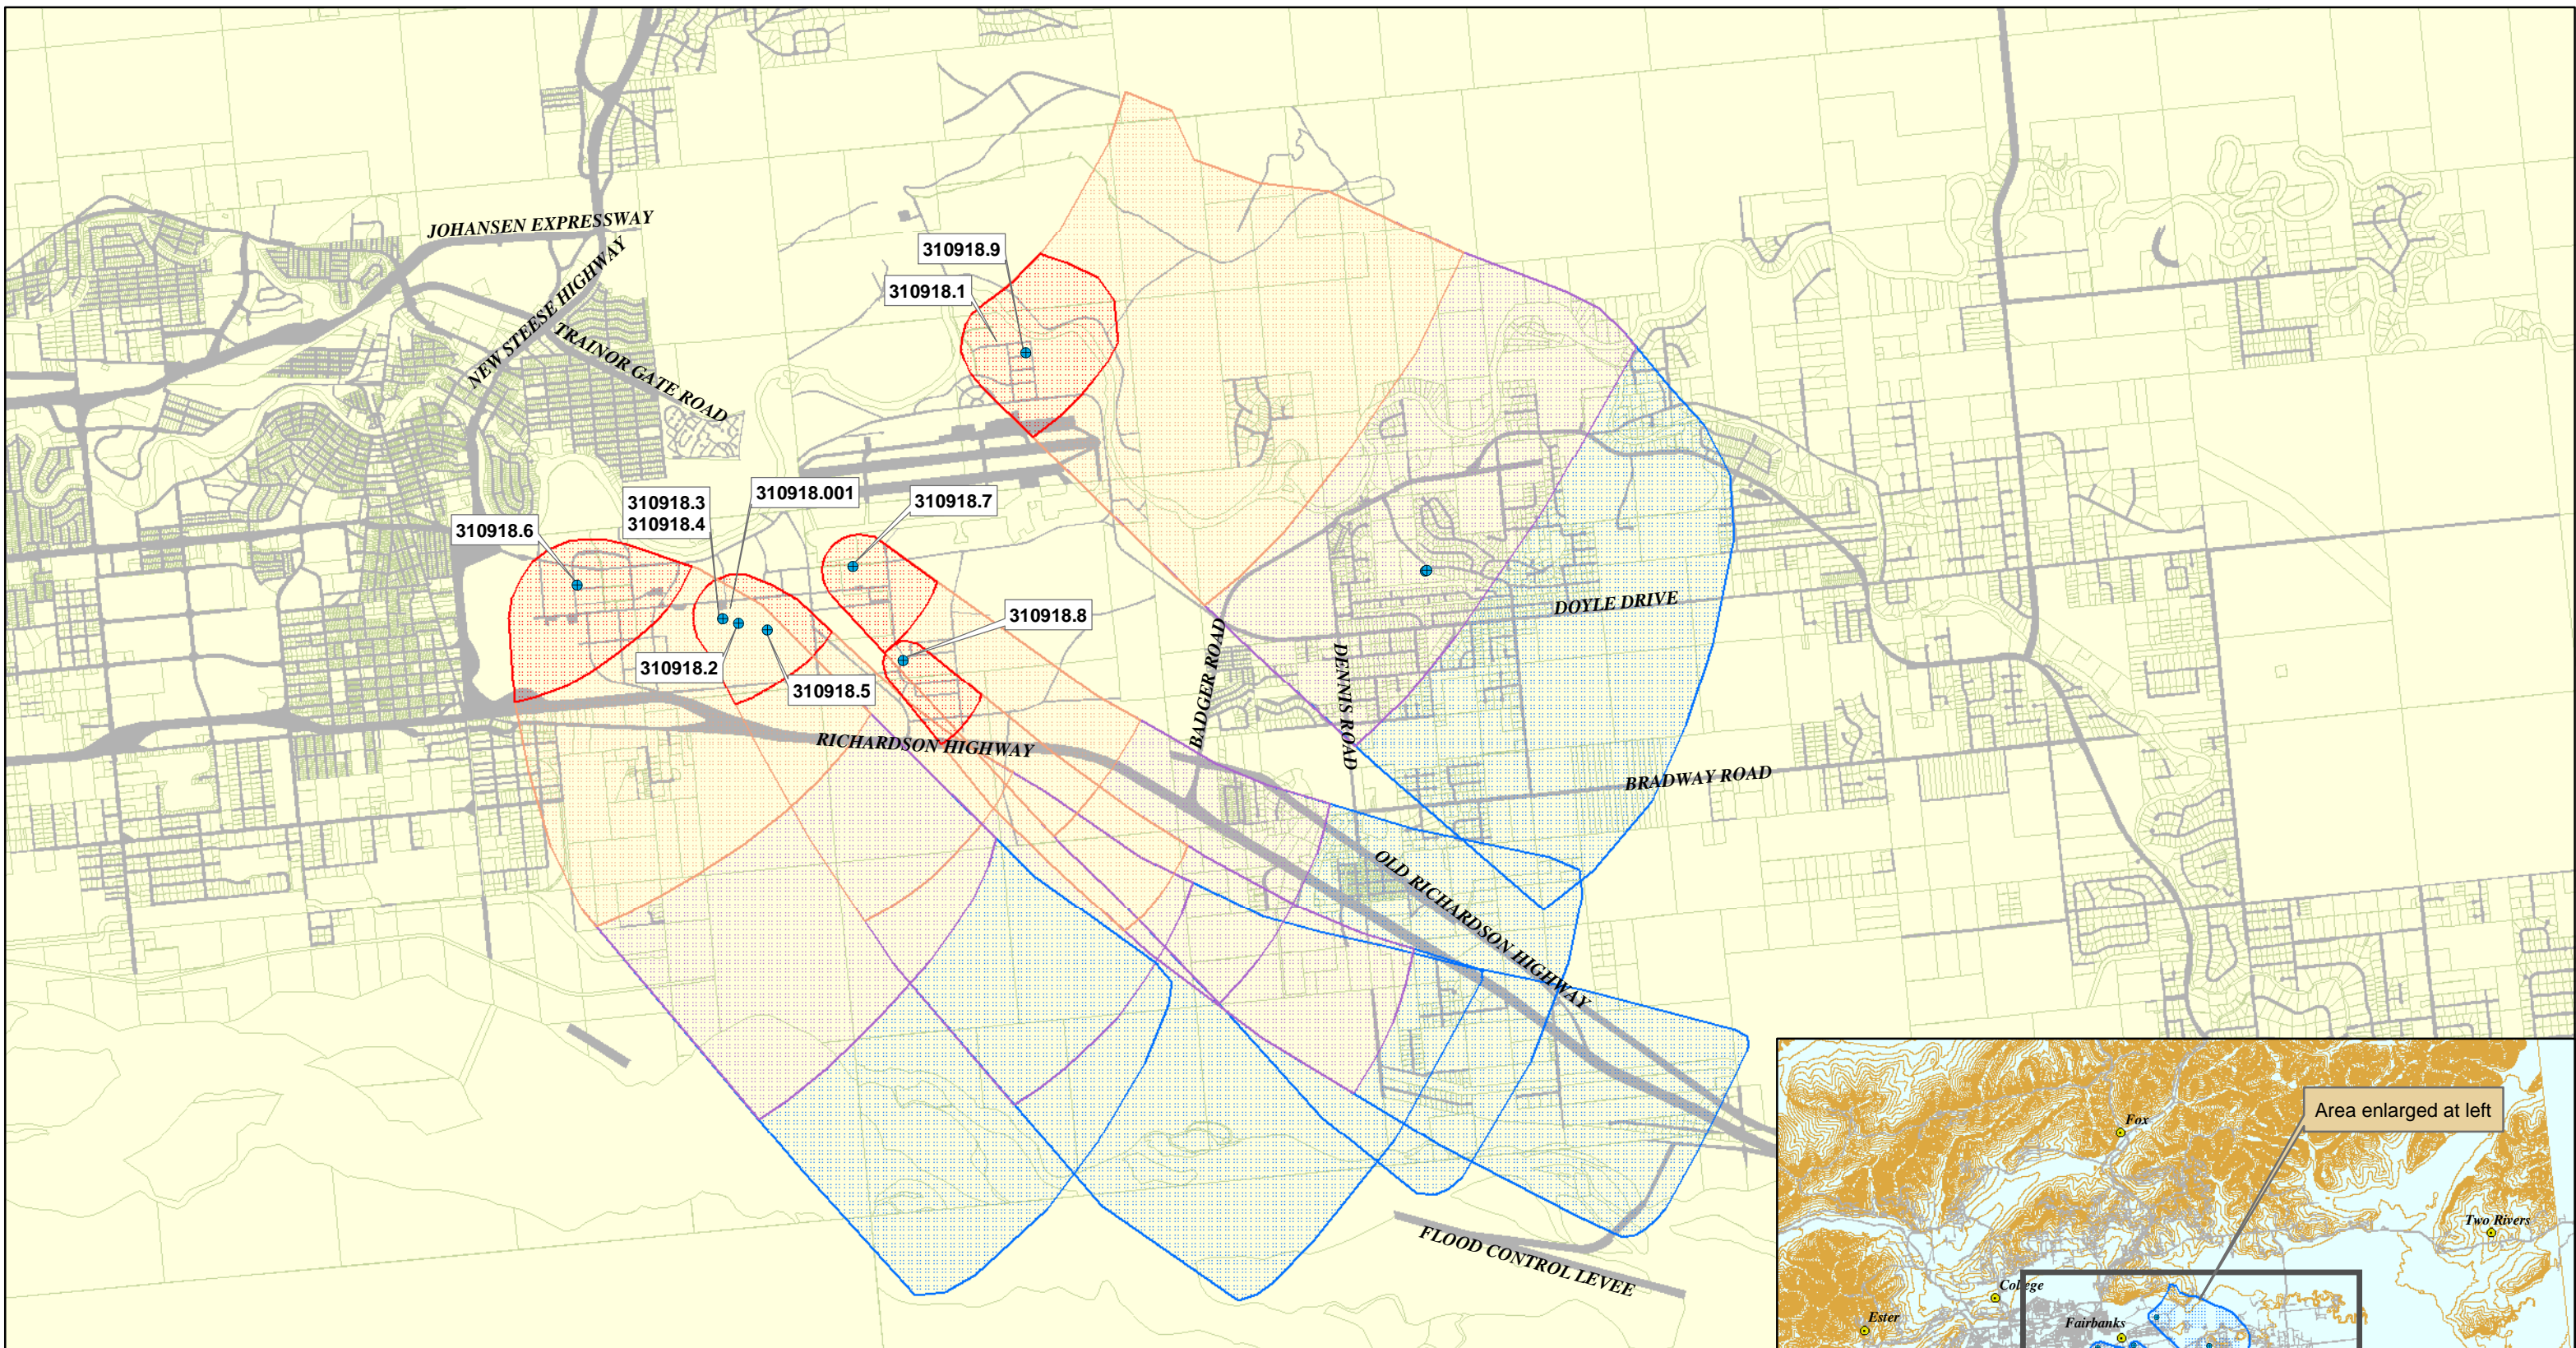

Map 1: Fort Wainwright Drinking Water Protection Areas

PWSID: 310918




Data Sources:

Parcel, roads - Fairbanks North Star Borough
 Water bodies, railroad - Geographic Data Technology
 Elevation contours - USGS digital elevation models (DEMs)

Legend

- Zone A Several months travel time
- Zone B Less than 2 years travel time
- Zone C Less than 5 years travel time
- Zone D Less than 10 years travel time
- Surface water
- Roads
- Parcels

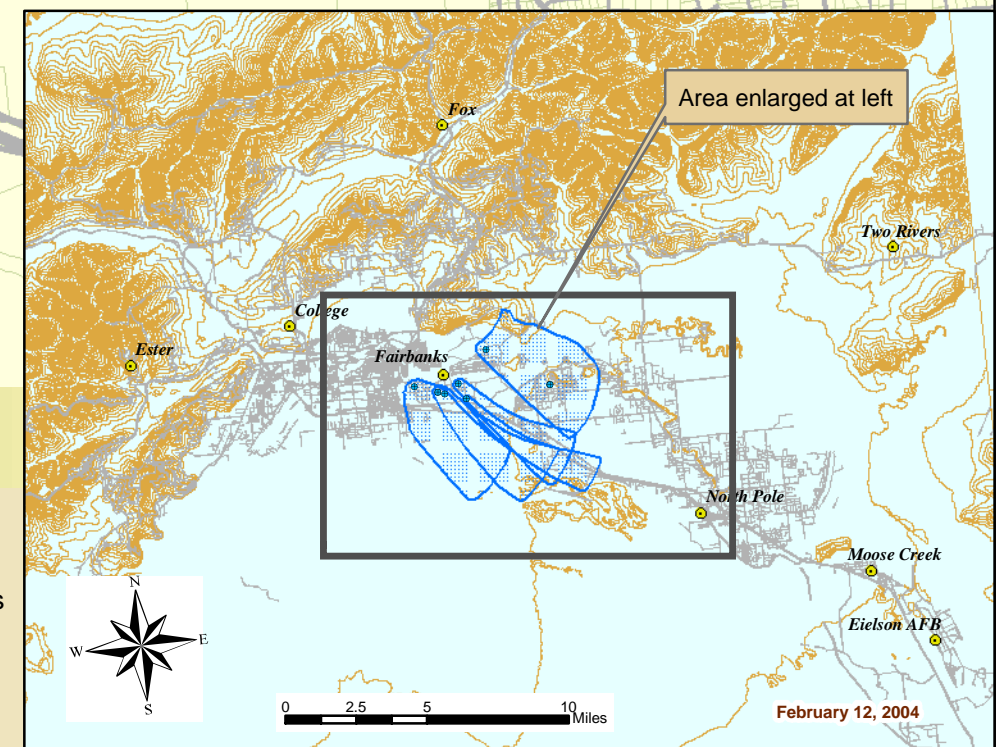

February 12, 2004

APPENDIX B

Contaminant Source Inventory and Risk Ranking for Fort Wainwright Water Treatment Plant wells (Tables 1-7)

Table 1

**Contaminant Source Inventory for
Ft Wainwright / Wtr Trtmt Plt**

PWSID 310918.010

Contaminant Source Type	Contaminant Source ID	CS ID tag	Zone	Map Number	Comments
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-1	A	2	1541 Gafney Road
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-1	A	2	102nd Street & Gaffney Road; BLM/AK Fire Service Ft. WW Mess Hall (File Number 108.38.064)
Airports	X14	X14-1	A	2	
Highways and roads, paved (cement or asphalt)	X20		A	2	8 roads in Zone A
Residential Areas	R01	R01-1	B	2	Approximately 80 acres of residential area
Septic systems (serves one single-family home)	R02		B	2	Assumed 42 septic systems based on number of parcels designated as residential
Tanks, heating oil, residential (above ground)	R08		B	2	Assumed 42 heating oil tanks based on number of parcels designated as residential
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-10	B	2	Int. Montgomery & Ketchum; FTWW (2P) Bldg. 2063 Vet Clinic; File Number 108.26.036
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-2	B	2	West of 1543; FTWW (2P) Bldg. W of 1543 (Briggs); File Number 108.26.009
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-3	B	2	Bldg. 1546, 3494; FTWW (2P) Cont. Soil Stockpile
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-4	B	2	Engineers Park Drum Field; FTWW (OU-1) Eng Park Drum FTWW-079; File Number 108.38.068
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-5	B	2	E end BLM area near Helipad; FTWW (2P) Bldg. 1514 Site 1; File Number 108.26.008
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-6	B	2	South of Gaffney Road; FTWW (2P) Neely Road POL; File Number 108.38.079
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-7	B	2	Birch Hill Road; FTWW (2P) Birch Hill USTs #345-350; File Number 108.26.002
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-8	B	2	Int. Montgomery & Ketchum; FTWW (2P) Bldg. 2062 Boat Shop; File Number 108.26.043
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-9	B	2	Int. Montgomery & Ketchum; FTWW (2P) Bldg. 2060 Cable TV Bldg.; File Number 108.26.042
Highways and roads, paved (cement or asphalt)	X20		B	2	6 roads in Zone B
Construction trade areas and materials	C09	C09-1	C	3	821 White Willow Way
Construction trade areas and materials	C09	C09-2	C	3	1109 Airline Drive
Construction trade areas and materials	C09	C09-3	C	3	1216 Range View Road
Construction trade areas and materials	C09	C09-4	C	3	649 Canoro Road

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Map Number</i>	<i>Comments</i>
Fireworks sales and distribution	C11	C11-1	C	3	1316 Cordelia Way
Furniture manufacturing, repair, and finishing shops	C14	C14-1	C	3	1096 Shoshone Drive
Motor vehicle dealerships - cars, trucks, motor cycles, ATV's, snow machines, boats (with service department)	C27	C27-1	C	3	1233 Range View Road
Motor vehicle dealerships - cars, trucks, motor cycles, ATV's, snow machines, boats (with service department)	C27	C27-2	C	3	1078 Aztec Road
Motor /motor vehicle repair shops	C31	C31-1	C	3	884 Dennis Road
Printers, publishers, copiers	C37	C37-1	C	3	1310 Fickes Loop
Taxidermists	C41	C41-1	C	3	1236 Still Valley Road
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-2	C	3	1041 Holmes Road
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-3	C	3	
Injection wells (Class V) Motor Vehicle Waste Disposal Well	D42	D42-1	C	3	1084 Shoshone Drive
Residential Areas	R01	R01-2	C	3	Approximately 250 acres of residential area in Zone C
Septic systems (serves one single-family home)	R02		C	3	Assumed 360 septic systems based on number of tax parcels designated as residential
Tanks, heating oil, residential (above ground)	R08		C	3	Assumed 360 heating oil tanks based on number of tax parcels designated as residential
Tanks, heating oil, nonresidential (underground)	T16	T16-1	C	3	1080 Dennis Road
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-11	C	3	Old Badger Rd & Dennis Manor; FTWW (OU-1) (RFA D-8) Dennis Manor; File Number 108.38.026
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-12	C	3	Mile 1 Dennis Road; Henson Subdivision; File Number100.38.033
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-13	C	3	1101 Vicki Lane; Vicki Lane Buried Drums; RecKey 1998310921101
Open Leaking Underground Fuel Storage Tank (LUST) Sites	U07	U07-1	C	3	1095 Dennis Road; Alaska Petroleum; File Number 100.26.161
Petroleum product bulk station/terminals	X11	X11-1	C	3	1095 Dennis Road
Highways and roads, paved (cement or asphalt)	X20		C	3	16 roads in Zone C
Firehouses	X38	X38-1	C	3	1080 Dennis Road
Medical/veterinary facilities (doctor or dentist offices, hospitals, nursing homes)	X40	X40-1	C	3	935 Stol Drive
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-14	D	3	1512 Calabash Drive; Lott Property; RecKey 1991310112801
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-15	D	3	End of Doyle Street; Doyle Street Property; RecKey 1991310119801

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Map Number</i>	<i>Comments</i>
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-16	D	3	1442 Holmes Road; GCI Holmes Road HOT; File Number 100.38.156

Table 2

*Contaminant Source Inventory and Risk Ranking for
Ft Wainwright / Wtr Trtmt Plt
Sources of Bacteria and Viruses*

PWSID 310918.010

Contaminant Source Type	Contaminant Source ID	CS ID tag	Zone	Risk Ranking for Analysis	Map Number	Comments
Highways and roads, paved (cement or asphalt)	X20		A	Low	2	8 roads in Zone A
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-1	A	High	2	1541 Gafney Road
Highways and roads, paved (cement or asphalt)	X20		B	Low	2	6 roads in Zone B
Septic systems (serves one single-family home)	R02		B	Low	2	Assumed 42 septic systems based on number of parcels designated as residential
Residential Areas	R01	R01-1	B	Low	2	Approximately 80 acres of residential area

Table 3

*Contaminant Source Inventory and Risk Ranking for
Ft Wainwright / Wtr Trtmt Plt
Sources of Nitrates/Nitrites*

PWSID 310918.010

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Highways and roads, paved (cement or asphalt)	X20		A	Low	2	8 roads in Zone A
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-1	A	High	2	1541 Gafney Road
Airports	X14	X14-1	A	Low	2	
Septic systems (serves one single-family home)	R02		B	Low	2	Assumed 42 septic systems based on number of parcels designated as residential
Highways and roads, paved (cement or asphalt)	X20		B	Low	2	6 roads in Zone B
Residential Areas	R01	R01-1	B	Low	2	Approximately 80 acres of residential area
Septic systems (serves one single-family home)	R02		C	Low	3	Assumed 360 septic systems based on number of tax parcels designated as residential
Highways and roads, paved (cement or asphalt)	X20		C	Low	3	16 roads in Zone C
Fireworks sales and distribution	C11	C11-1	C	Low	3	1316 Cordelia Way
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-2	C	High	3	1041 Holmes Road
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-3	C	High	3	
Residential Areas	R01	R01-2	C	Low	3	Approximately 250 acres of residential area in Zone C
Medical/veterinary facilities (doctor or dentist offices, hospitals, nursing homes)	X40	X40-1	C	Low	3	935 Stol Drive

Table 4

*Contaminant Source Inventory and Risk Ranking for
Ft Wainwright / Wtr Trtmt Plt
Sources of Volatile Organic Chemicals*

PWSID 310918.010

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Highways and roads, paved (cement or asphalt)	X20		A	Low	2	8 roads in Zone A
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-1	A	Low	2	1541 Gafney Road
Airports	X14	X14-1	A	High	2	
Highways and roads, paved (cement or asphalt)	X20		B	Low	2	6 roads in Zone B
Septic systems (serves one single-family home)	R02		B	Low	2	Assumed 42 septic systems based on number of parcels designated as residential
Tanks, heating oil, residential (above ground)	R08		B	Medium	2	Assumed 42 heating oil tanks based on number of parcels designated as residential
Residential Areas	R01	R01-1	B	Low	2	Approximately 80 acres of residential area
Tanks, heating oil, residential (above ground)	R08		C	Medium	3	Assumed 360 heating oil tanks based on number of tax parcels designated as residential
Septic systems (serves one single-family home)	R02		C	Low	3	Assumed 360 septic systems based on number of tax parcels designated as residential
Highways and roads, paved (cement or asphalt)	X20		C	Low	3	16 roads in Zone C
Construction trade areas and materials	C09	C09-1	C	Low	3	821 White Willow Way
Construction trade areas and materials	C09	C09-2	C	Low	3	1109 Airline Drive
Construction trade areas and materials	C09	C09-3	C	Low	3	1216 Range View Road
Construction trade areas and materials	C09	C09-4	C	Low	3	649 Canoro Road
Furniture manufacturing, repair, and finishing shops	C14	C14-1	C	Medium	3	1096 Shoshone Drive
Motor vehicle dealerships - cars, trucks, motor cycles, ATV's, snow machines, boats (with service department)	C27	C27-1	C	Medium	3	1233 Range View Road
Motor vehicle dealerships - cars, trucks, motor cycles, ATV's, snow machines, boats (with service department)	C27	C27-2	C	Medium	3	1078 Aztec Road

Table 4 (continued)

*Contaminant Source Inventory and Risk Ranking for
Ft Wainwright / Wtr Trtmt Plt
Sources of Volatile Organic Chemicals*

PWSID 310918.010

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Motor /motor vehicle repair shops	C31	C31-1	C	Medium	3	884 Dennis Road
Printers, publishers, copiers	C37	C37-1	C	High	3	1310 Fickes Loop
Taxidermists	C41	C41-1	C	Medium	3	1236 Still Valley Road
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-2	C	Low	3	1041 Holmes Road
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-3	C	Low	3	
Injection wells (Class V) Motor Vehicle Waste Disposal Well	D42	D42-1	C	High	3	1084 Shoshone Drive
Residential Areas	R01	R01-2	C	Low	3	Approximately 250 acres of residential area in Zone C
Tanks, heating oil, nonresidential (underground)	T16	T16-1	C	Low	3	1080 Dennis Road
Petroleum product bulk station/terminals	X11	X11-1	C	Very High	3	1095 Dennis Road
Firehouses	X38	X38-1	C	Low	3	1080 Dennis Road
Medical/veterinary facilities (doctor or dentist offices, hospitals, nursing homes)	X40	X40-1	C	Low	3	935 Stol Drive

Table 5

*Contaminant Source Inventory and Risk Ranking for
Ft Wainwright / Wtr Trtmt Plt
Sources of Heavy Metals, Cyanide and Other Inorganic Chemicals*

PWSID 310918.010

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Highways and roads, paved (cement or asphalt)	X20		A	Low	2	8 roads in Zone A
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-1	A	Low	2	1541 Gafney Road
Airports	X14	X14-1	A	Low	2	
Highways and roads, paved (cement or asphalt)	X20		B	Low	2	6 roads in Zone B
Septic systems (serves one single-family home)	R02		B	Low	2	Assumed 42 septic systems based on number of parcels designated as residential
Residential Areas	R01	R01-1	B	Low	2	Approximately 80 acres of residential area
Highways and roads, paved (cement or asphalt)	X20		C	Low	3	16 roads in Zone C
Septic systems (serves one single-family home)	R02		C	Low	3	Assumed 360 septic systems based on number of tax parcels designated as residential
Construction trade areas and materials	C09	C09-1	C	Low	3	821 White Willow Way
Construction trade areas and materials	C09	C09-2	C	Low	3	1109 Airline Drive
Construction trade areas and materials	C09	C09-3	C	Low	3	1216 Range View Road
Construction trade areas and materials	C09	C09-4	C	Low	3	649 Canoro Road
Fireworks sales and distribution	C11	C11-1	C	Low	3	1316 Cordelia Way
Furniture manufacturing, repair, and finishing shops	C14	C14-1	C	Low	3	1096 Shoshone Drive
Motor vehicle dealerships - cars, trucks, motor cycles, ATV's, snow machines, boats (with service department)	C27	C27-1	C	Low	3	1233 Range View Road
Motor vehicle dealerships - cars, trucks, motor cycles, ATV's, snow machines, boats (with service department)	C27	C27-2	C	Low	3	1078 Aztec Road
Motor /motor vehicle repair shops	C31	C31-1	C	Medium	3	884 Dennis Road
Printers, publishers, copiers	C37	C37-1	C	Medium	3	1310 Fickes Loop

Table 5 (continued)

Contaminant Source Inventory and Risk Ranking for

PWSID 310918.010

Ft Wainwright / Wtr Trtmt Plt

Sources of Heavy Metals, Cyanide and Other Inorganic Chemicals

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Taxidermists	C41	C41-1	C	Low	3	1236 Still Valley Road
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-2	C	Low	3	1041 Holmes Road
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-3	C	Low	3	
Injection wells (Class V) Motor Vehicle Waste Disposal Well	D42	D42-1	C	High	3	1084 Shoshone Drive
Residential Areas	R01	R01-2	C	Low	3	Approximately 250 acres of residential area in Zone C
Tanks, heating oil, nonresidential (underground)	T16	T16-1	C	Low	3	1080 Dennis Road
Petroleum product bulk station/terminals	X11	X11-1	C	Low	3	1095 Dennis Road
Firehouses	X38	X38-1	C	Low	3	1080 Dennis Road
Medical/veterinary facilities (doctor or dentist offices, hospitals, nursing homes)	X40	X40-1	C	Low	3	935 Stol Drive

Table 6

*Contaminant Source Inventory and Risk Ranking for
Ft Wainwright / Wtr Trtmt Plt
Sources of Synthetic Organic Chemicals*

PWSID 310918.010

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-1	A	Low	2	1541 Gafney Road
Airports	X14	X14-1	A	Medium	2	
Septic systems (serves one single-family home)	R02		B	Low	2	Assumed 42 septic systems based on number of parcels designated as residential
Residential Areas	R01	R01-1	B	Low	2	Approximately 80 acres of residential area
Septic systems (serves one single-family home)	R02		C	Low	3	Assumed 360 septic systems based on number of tax parcels designated as residential
Furniture manufacturing, repair, and finishing shops	C14	C14-1	C	Medium	3	1096 Shoshone Drive
Printers, publishers, copiers	C37	C37-1	C	Low	3	1310 Fickes Loop
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-2	C	Low	3	1041 Holmes Road
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-3	C	Low	3	
Injection wells (Class V) Motor Vehicle Waste Disposal Well	D42	D42-1	C	Low	3	1084 Shoshone Drive
Residential Areas	R01	R01-2	C	Low	3	Approximately 250 acres of residential area in Zone C
Petroleum product bulk station/terminals	X11	X11-1	C	Low	3	1095 Dennis Road
Medical/veterinary facilities (doctor or dentist offices, hospitals, nursing homes)	X40	X40-1	C	Low	3	935 Stol Drive

Table 7

*Contaminant Source Inventory and Risk Ranking for
Ft Wainwright / Wtr Trtmt Plt
Sources of Other Organic Chemicals*

PWSID 310918.010

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Highways and roads, paved (cement or asphalt)	X20		A	Low	2	8 roads in Zone A
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-1	A	Low	2	1541 Gafney Road
Airports	X14	X14-1	A	Medium	2	
Highways and roads, paved (cement or asphalt)	X20		B	Low	2	6 roads in Zone B
Septic systems (serves one single-family home)	R02		B	Low	2	Assumed 42 septic systems based on number of parcels designated as residential
Residential Areas	R01	R01-1	B	Low	2	Approximately 80 acres of residential area
Septic systems (serves one single-family home)	R02		C	Low	3	Assumed 360 septic systems based on number of tax parcels designated as residential
Highways and roads, paved (cement or asphalt)	X20		C	Low	3	16 roads in Zone C
Construction trade areas and materials	C09	C09-1	C	Low	3	821 White Willow Way
Construction trade areas and materials	C09	C09-2	C	Low	3	1109 Airline Drive
Construction trade areas and materials	C09	C09-3	C	Low	3	1216 Range View Road
Construction trade areas and materials	C09	C09-4	C	Low	3	649 Canoro Road
Furniture manufacturing, repair, and finishing shops	C14	C14-1	C	Medium	3	1096 Shoshone Drive
Motor vehicle dealerships - cars, trucks, motor cycles, ATV's, snow machines, boats (with service department)	C27	C27-1	C	Medium	3	1233 Range View Road
Motor vehicle dealerships - cars, trucks, motor cycles, ATV's, snow machines, boats (with service department)	C27	C27-2	C	Medium	3	1078 Aztec Road
Motor /motor vehicle repair shops	C31	C31-1	C	Medium	3	884 Dennis Road
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-2	C	Low	3	1041 Holmes Road

Table 7 (continued)

*Contaminant Source Inventory and Risk Ranking for
Ft Wainwright / Wtr Trtmt Plt
Sources of Other Organic Chemicals*

PWSID 310918.010

Contaminant Source Type	Contaminant Source ID	CS ID tag	Zone	Risk Ranking for Analysis	Map Number	Comments
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-3	C	Low	3	
Injection wells (Class V) Motor Vehicle Waste Disposal Well	D42	D42-1	C	Medium	3	1084 Shoshone Drive
Residential Areas	R01	R01-2	C	Low	3	Approximately 250 acres of residential area in Zone C
Petroleum product bulk station/terminals	X11	X11-1	C	High	3	1095 Dennis Road


APPENDIX C

Fort Wainwright Water Treatment Plant wells Drinking Water Protection Area and Potential and Existing Contaminant Sources (Maps 2 and 3)



Map 2: Ft. Wainwright Wells 1032 and 1011 Potential Contaminant Sources


PWSID: 310918.1 and 310918.9



NOTE: Locations of DEC-contaminated sites are approximate
Data Sources:
 Parcel, roads - Fairbanks North Star Borough
 Water bodies - US Tiger2000 Census Data
 Elevation contours - USGS digital elevation models (DEMs)

Legend

- C09, Construction trade areas
- C11, Fireworks
- C14, Furniture shops
- C27, Motor vehicle dealerships (with service department)
- C31, Motor vehicle repair shops
- C37, Printers, publishers, copiers
- C41, Taxidermists
- D10, Large-Capacity Septic System
- D42, Injection wells (Class V) Motor Vehicle Waste Disposal Well
- T16, Tanks, heating oil, (underground)
- U04, Contaminated sites, DEC recognized
- U07, Open Leaking Underground Storage Tank (LUST) Sites
- X11, Petroleum product bulk station
- X38, Firehouses
- X40, Medical/veterinary facilities
- R01, Residential area
- R08, Residential heating oil tanks
- R02, Residential septic systems
- X14, Airport

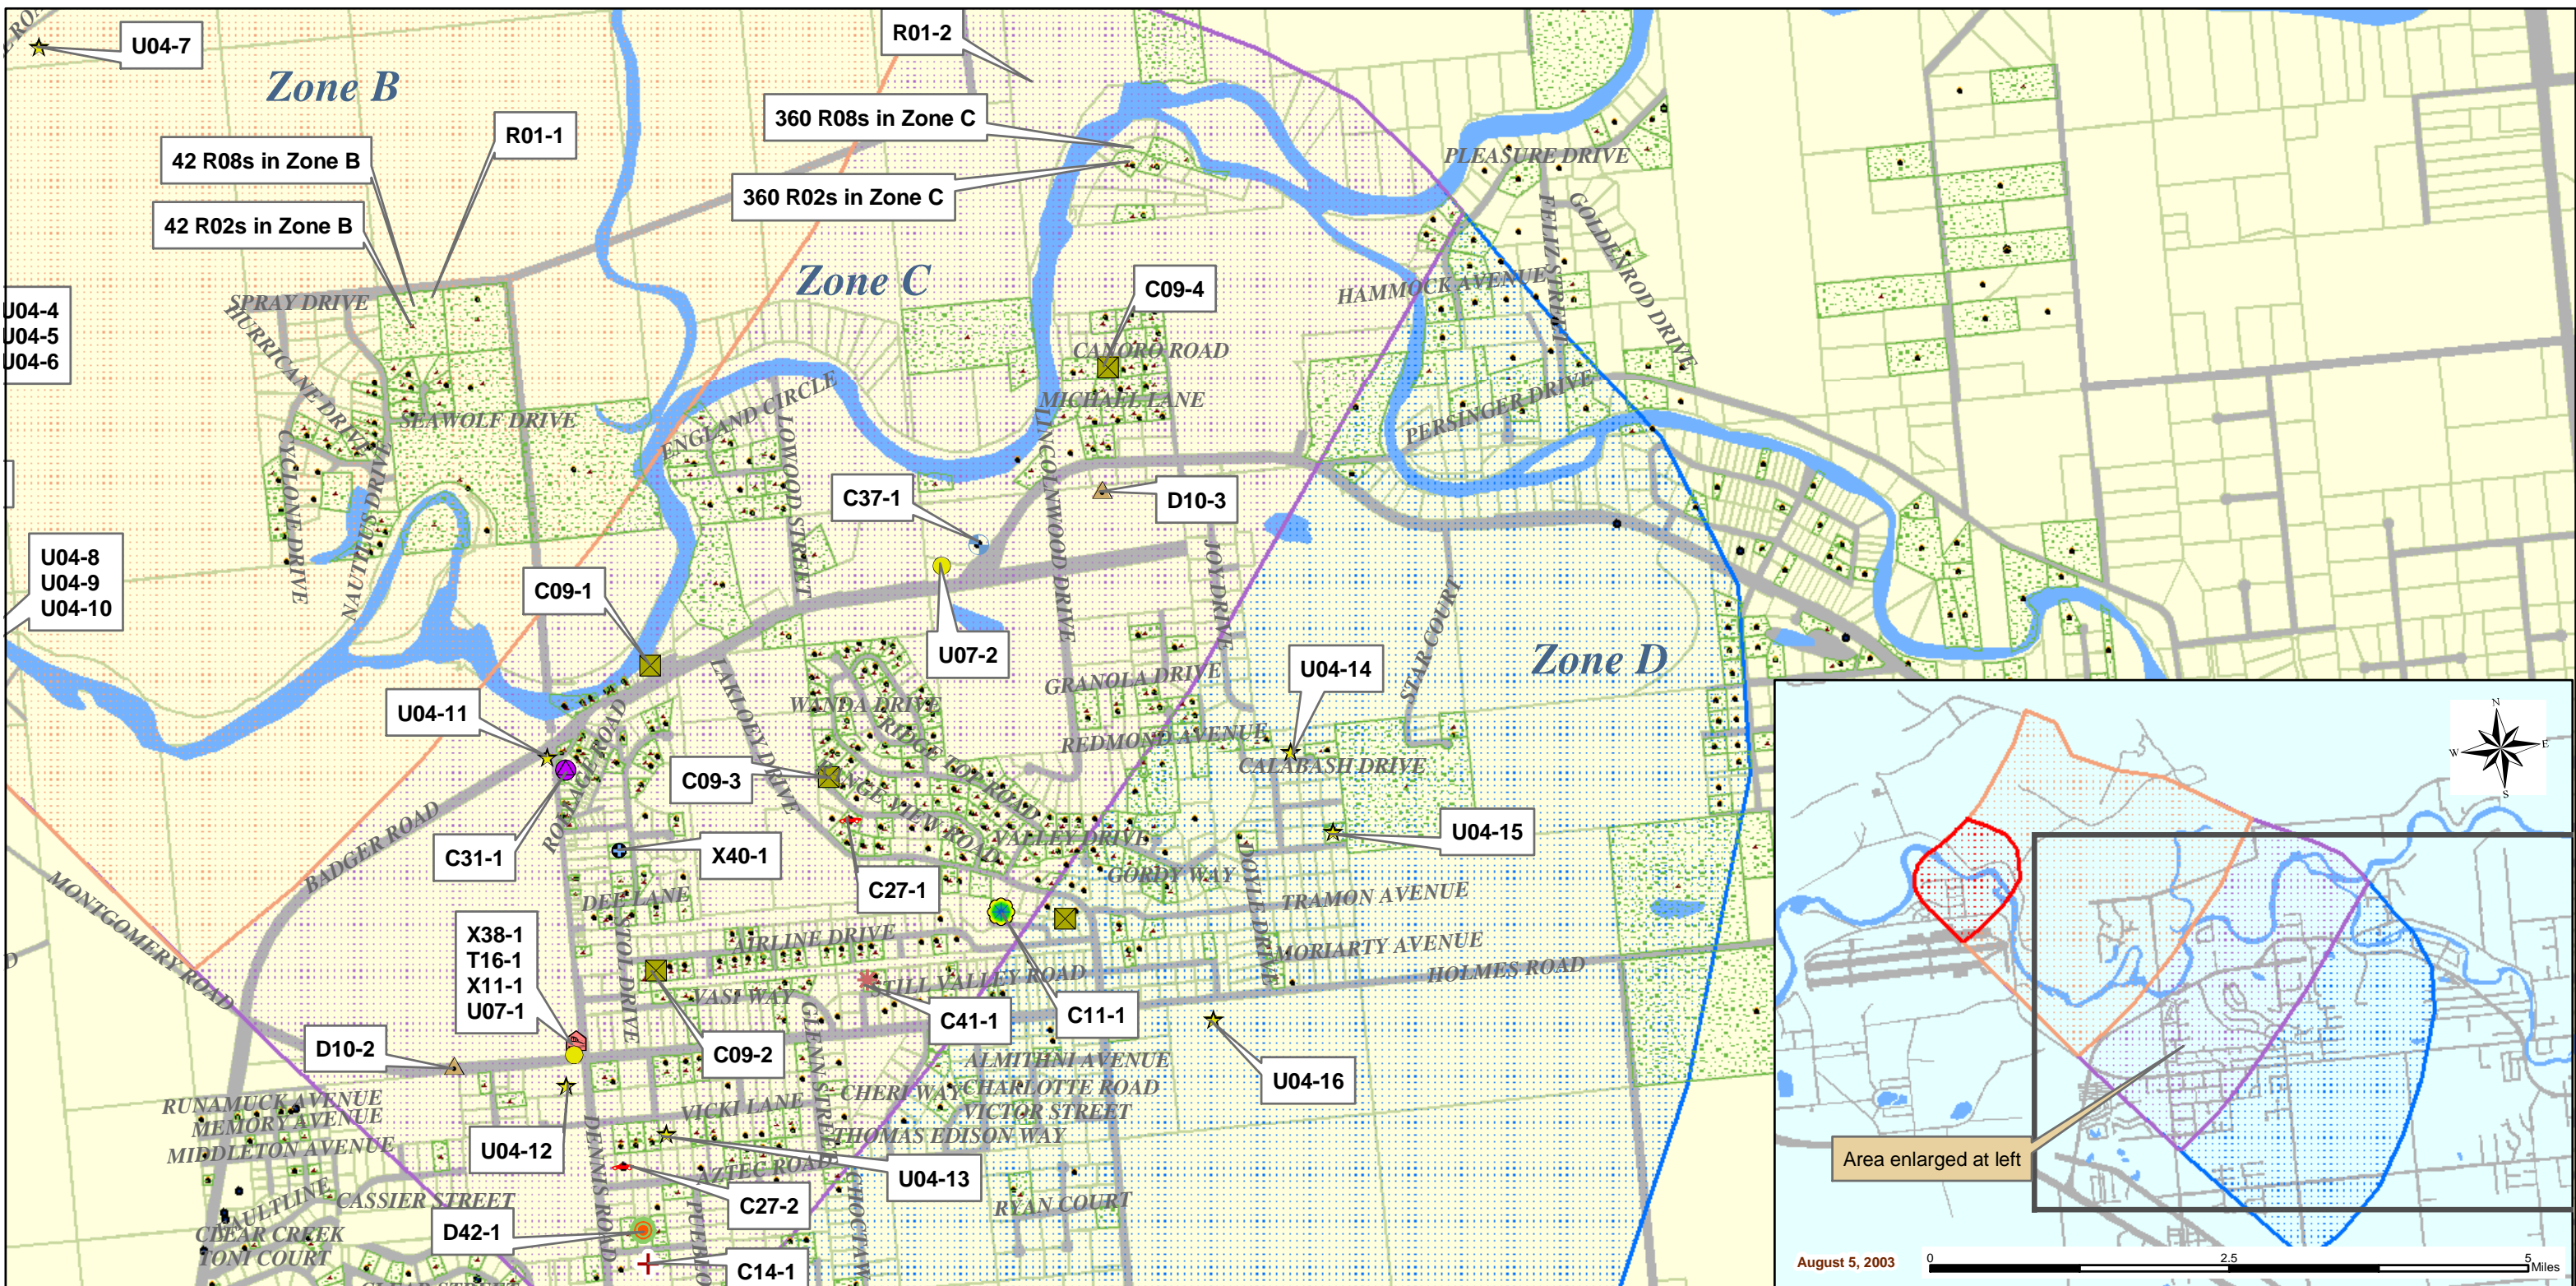


Map 3: Ft. Wainwright Wells 1032 and 1011 Potential Contaminant Sources

PWSID: 310918.1 and 310918.9



NOTE: Locations of DEC-contaminated sites are approximate Data Sources:
 Parcel, roads - Fairbanks North Star Borough
 Water bodies - US Tiger2000 Census Data
 Elevation contours - USGS digital elevation models (DEMs)

- Legend**
- C09, Construction trade areas
 - C11, Fireworks
 - C14, Furniture shops
 - C27, Motor vehicle dealerships (with service department)
 - C31, Motor vehicle repair shops
 - C37, Printers, publishers, copiers
 - C41, Taxidermists
 - D10, Large-Capacity Septic System
 - D42, Injection wells (Class V) Motor Vehicle Waste Disposal Well
 - T16, Tanks, heating oil, (underground)
 - U04, Contaminated sites, DEC recognized
 - U07, Open Leaking Underground Storage Tank (LUST) Sites
 - X11, Petroleum product bulk station
 - X38, Firehouses
 - X40, Medical/veterinary facilities
 - R01, Residential area
 - R08, Residential heating oil tanks
 - R02, Residential septic systems
 - X14, Airport

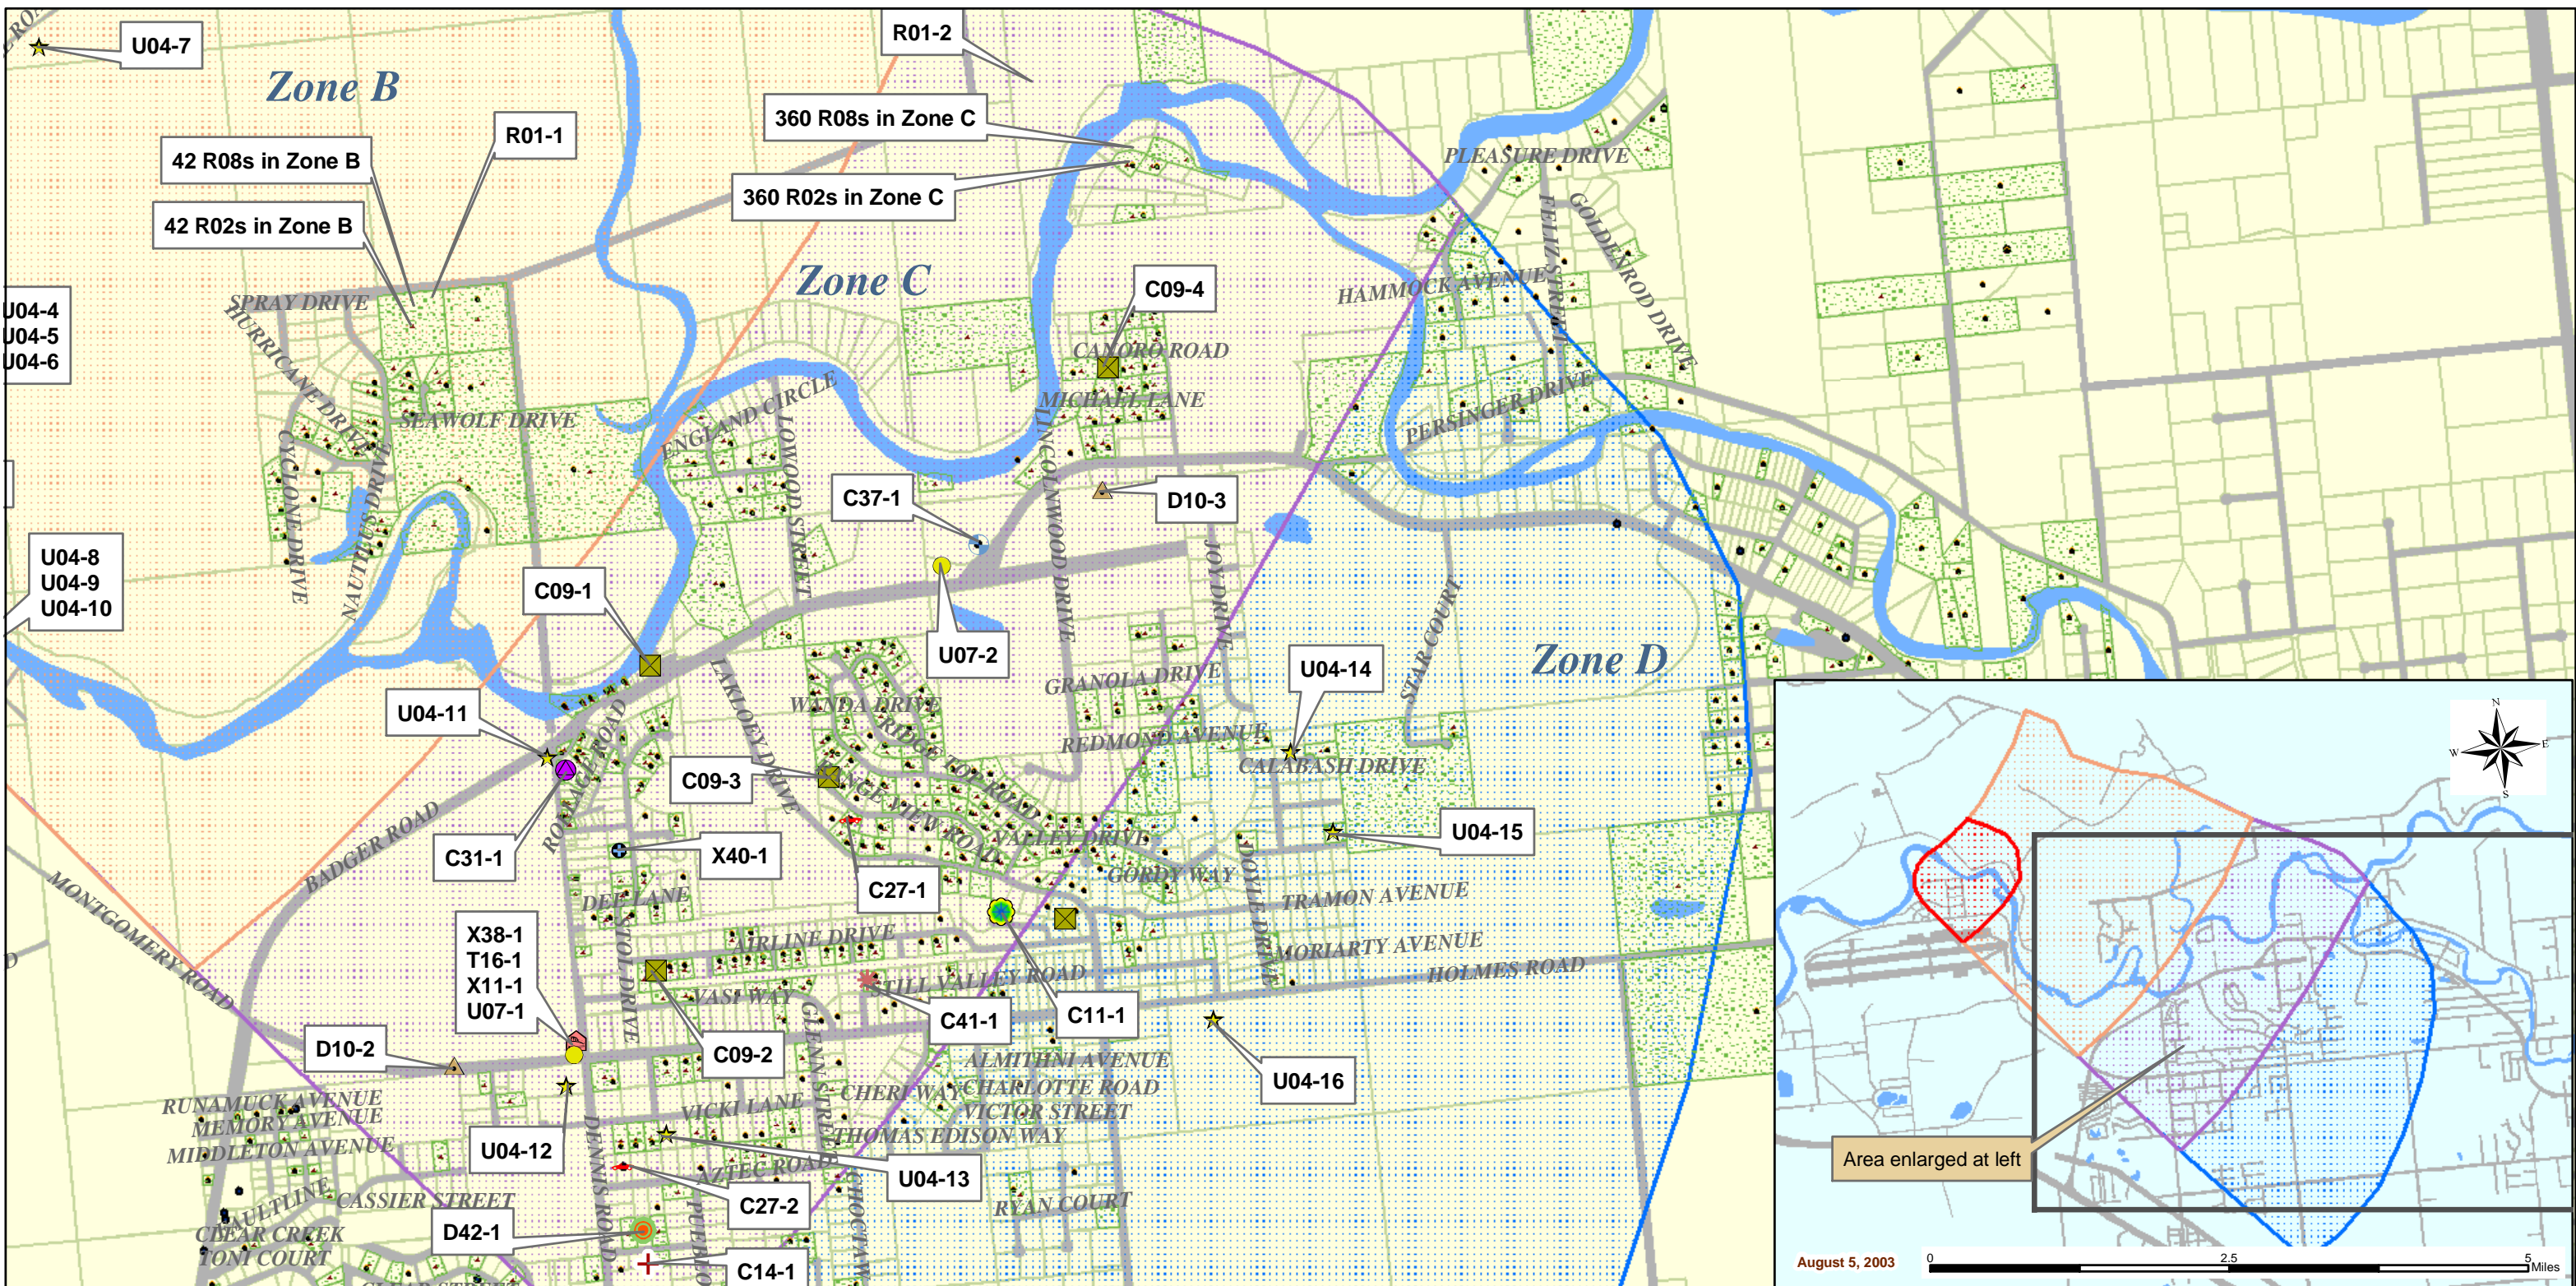

Map 3: Ft. Wainwright Wells 1032 and 1011 Potential Contaminant Sources

PWSID: 310918.1 and 310918.9



NOTE: Locations of DEC-contaminated sites are approximate Data Sources:
 Parcel, roads - Fairbanks North Star Borough
 Water bodies - US Tiger2000 Census Data
 Elevation contours - USGS digital elevation models (DEMs)

- Legend**
- C09, Construction trade areas
 - C11, Fireworks
 - C14, Furniture shops
 - C27, Motor vehicle dealerships (with service department)
 - C31, Motor vehicle repair shops
 - C37, Printers, publishers, copiers
 - C41, Taxidermists
 - D10, Large-Capacity Septic System
 - D42, Injection wells (Class V) Motor Vehicle Waste Disposal Well
 - T16, Tanks, heating oil, (underground)
 - U04, Contaminated sites, DEC recognized
 - U07, Open Leaking Underground Storage Tank (LUST) Sites
 - X11, Petroleum product bulk station
 - X38, Firehouses
 - X40, Medical/veterinary facilities
 - R01, Residential area
 - R08, Residential heating oil tanks
 - R02, Residential septic systems
 - X14, Airport

APPENDIX D

Vulnerability Analysis for Fort Wainwright Water Treatment Plant wells Public Drinking Water Source (Charts 1-14)

Chart 1. Susceptibility of the wellhead - Ft Wainwright Wells 1032 and 1011

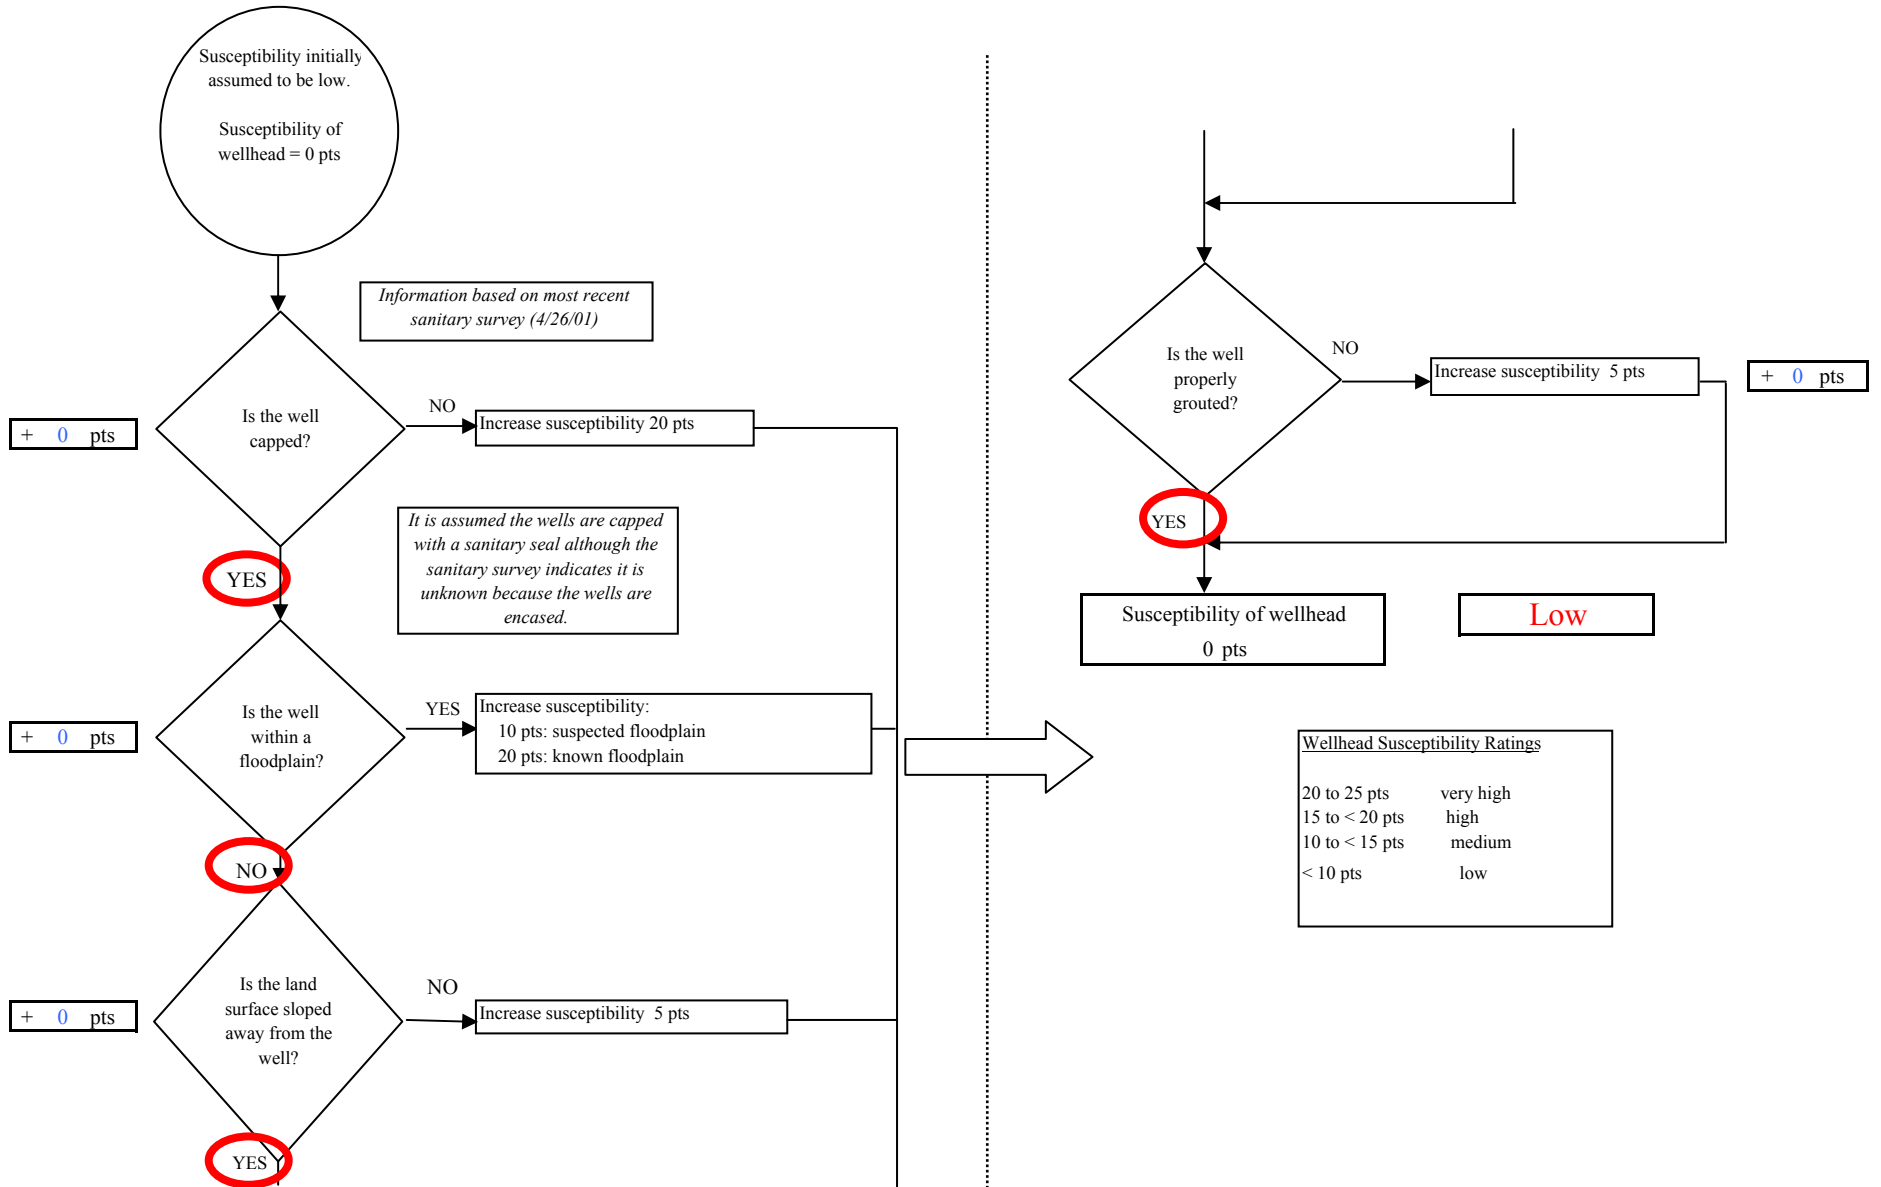


Chart 2. Susceptibility of the aquifer - Ft Wainwright Wells 1032 and 1011



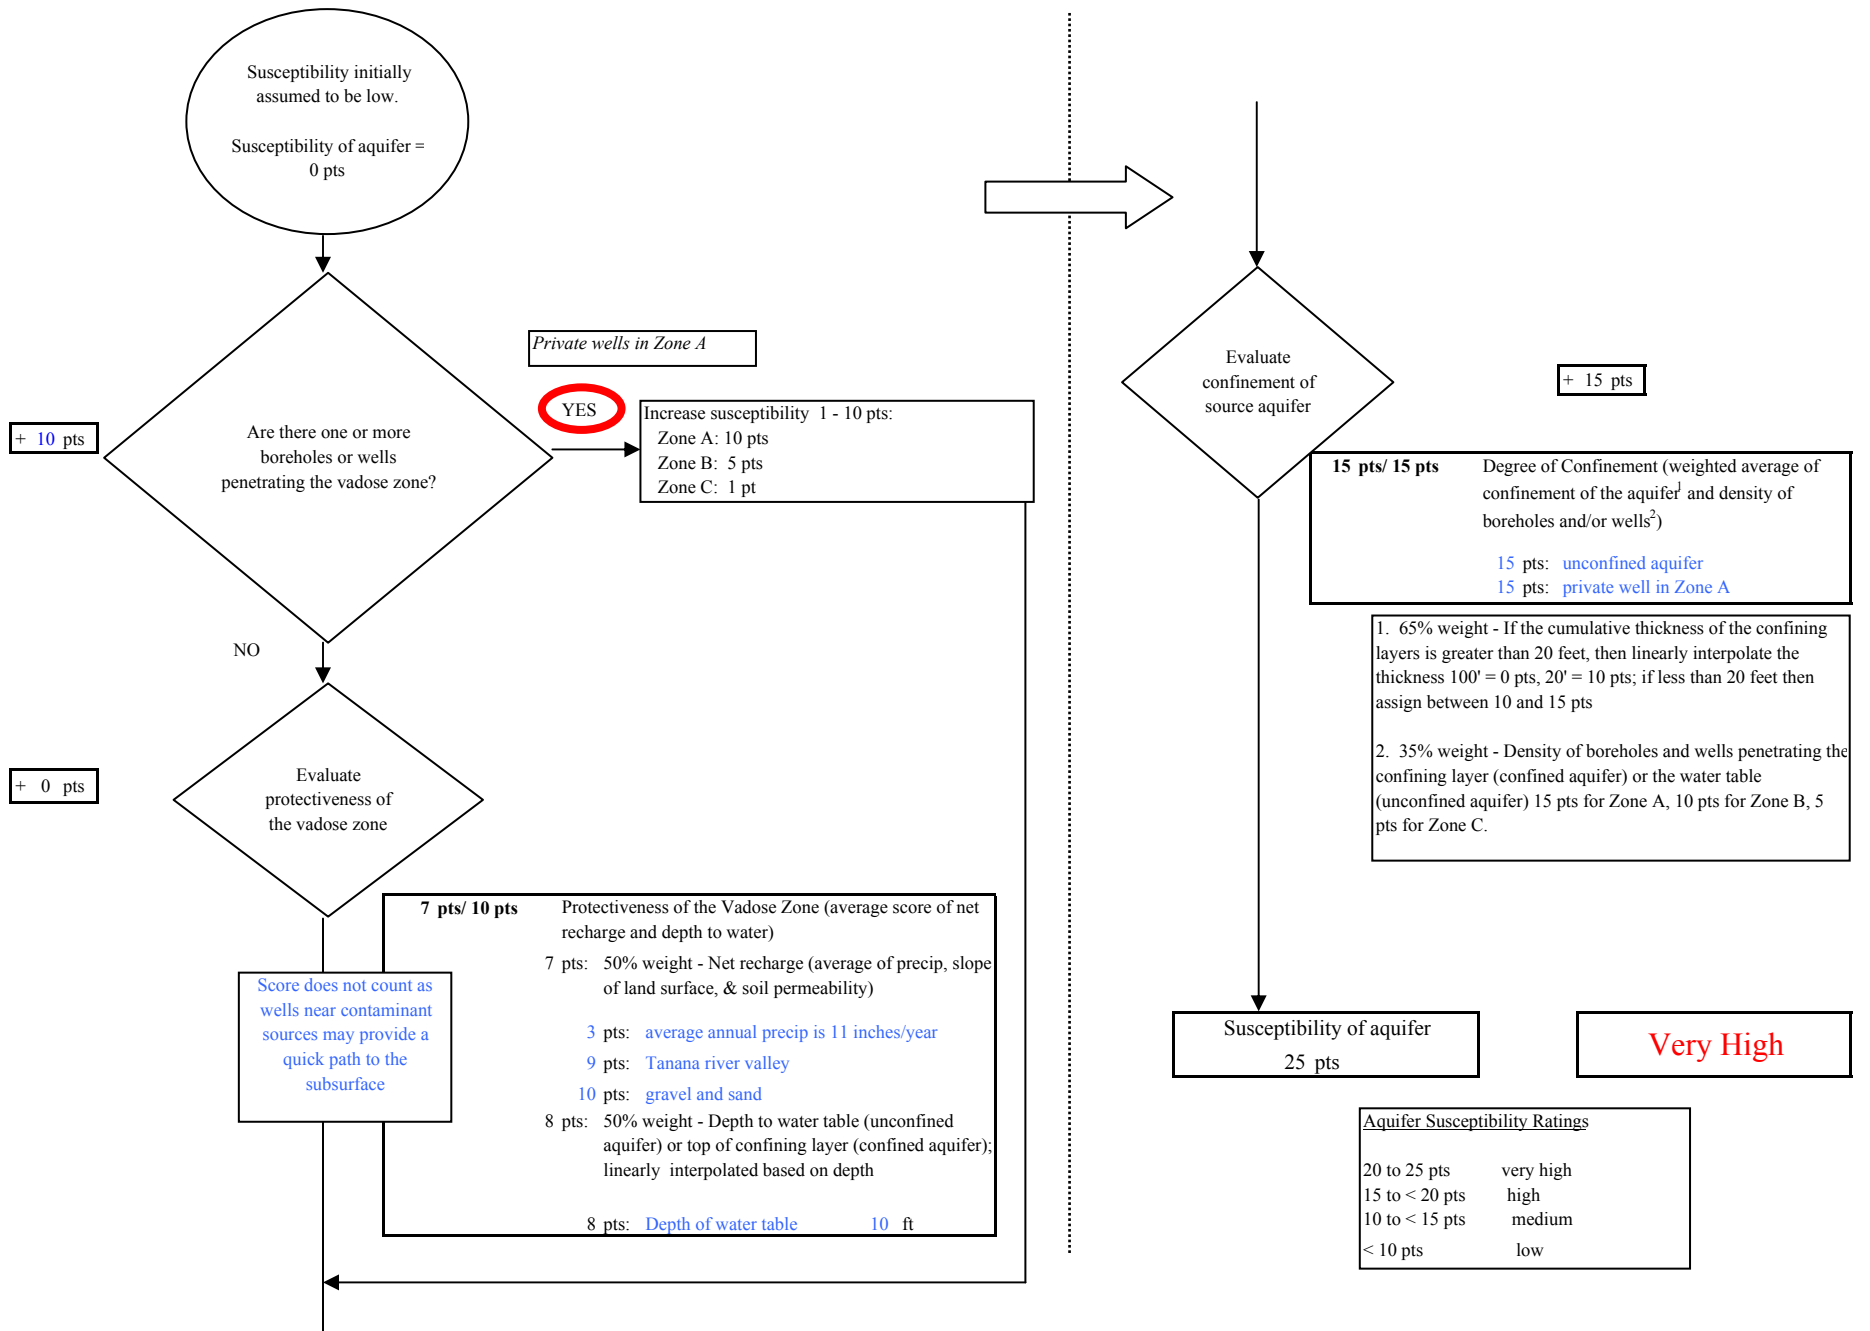


Chart 3. Contaminant risks for Ft Wainwright Wells 1032 and 1011 - Bacteria & Viruses

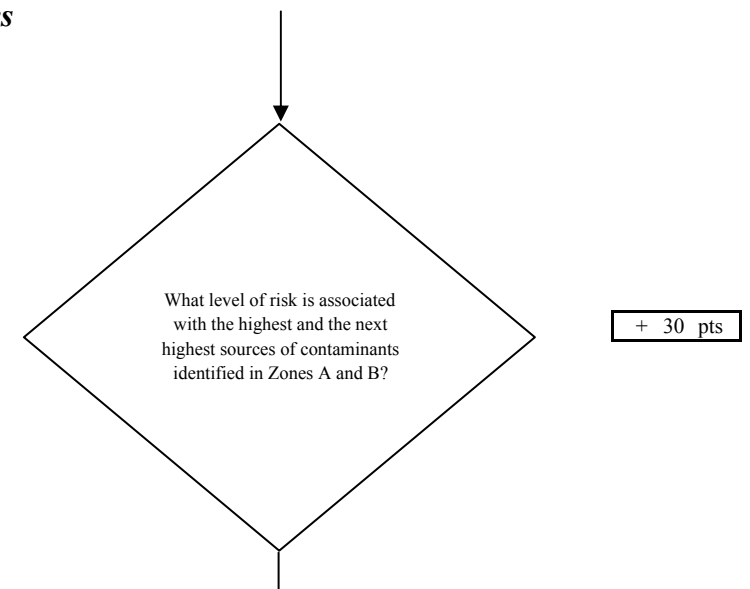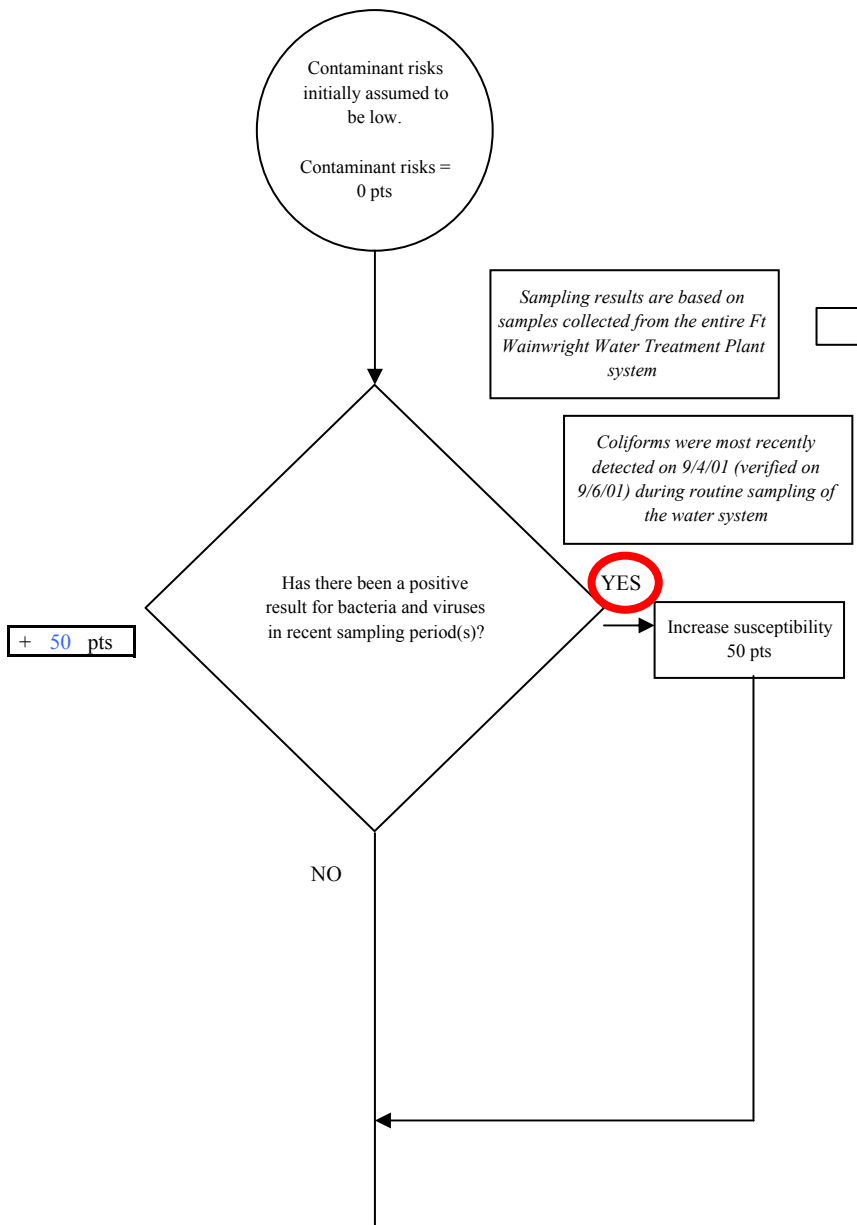

Risk Rankings for Contaminant Sources Identified in Zones A and B




	Zone A	Zone B	Total
Very High(s)	0	0	0
High(s)	1	0	1
Medium(s)	0	0	0
Low(s)	1	7	8

	LOW 10 pts	MEDIUM 20 pts	HIGH 30 pts	VERY HIGH 40 pts
LOW	≥ 10 sources + 10 pts	≥ 10 sources + 5 pts	≥ 20 sources + 5 pts	----
MEDIUM	----	≥ 2 sources + 5 pts	≥ 5 sources + 5 pts	≥ 10 sources + 5 pts
HIGH	----	----	≥ 1 source + 10 pts	≥ 2 sources + 10 pts
VERY HIGH	----	----	----	≥ 1 source + 10 pts

Matrix Score 30

Note: Septic systems, sewerlines, and roads are each assigned a risk ranking for each individual contaminant source in the CSI. The VA, however, counts these contaminant sources as a group and assigns a calculated number of either "lows" or "mediums" based on the density.

Chart 3. Contaminant risks for Ft Wainwright Wells 1032 and 1011 - Bacteria & Viruses

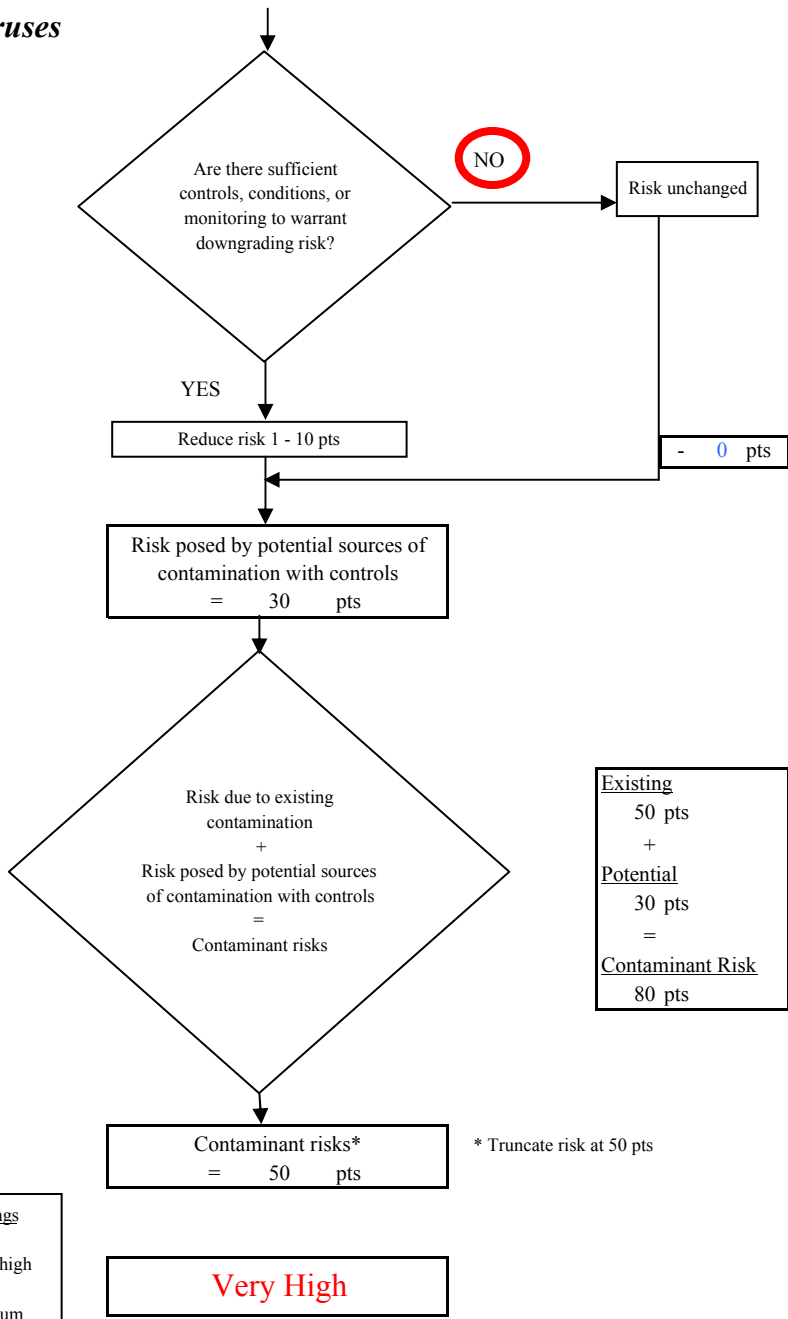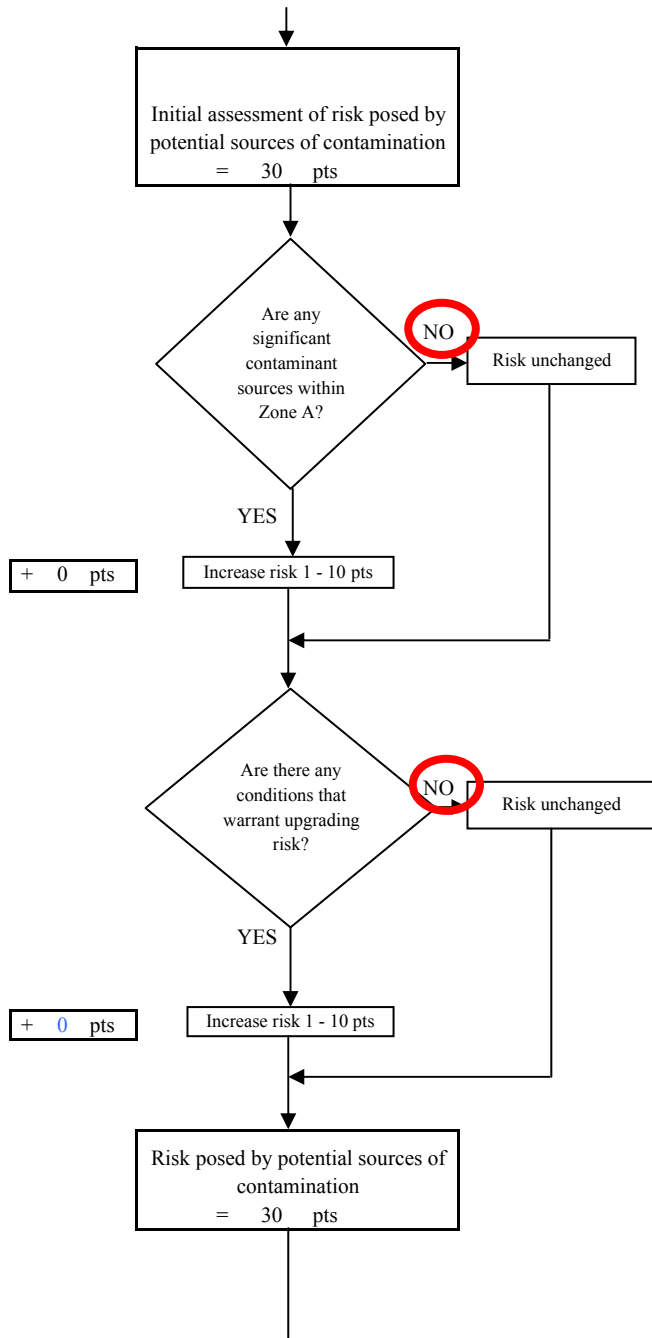

Existing
50 pts
+
Potential
30 pts
=
Contaminant Risk
80 pts

Contaminant Risk Ratings	
40 to 50 pts	very high
30 to < 40 pts	high
20 to < 30 pts	medium
< 20 pts	low

* Truncate risk at 50 pts

Chart 4. Vulnerability analysis for Ft Wainwright Wells 1032 and 1011 - Bacteria & Viruses

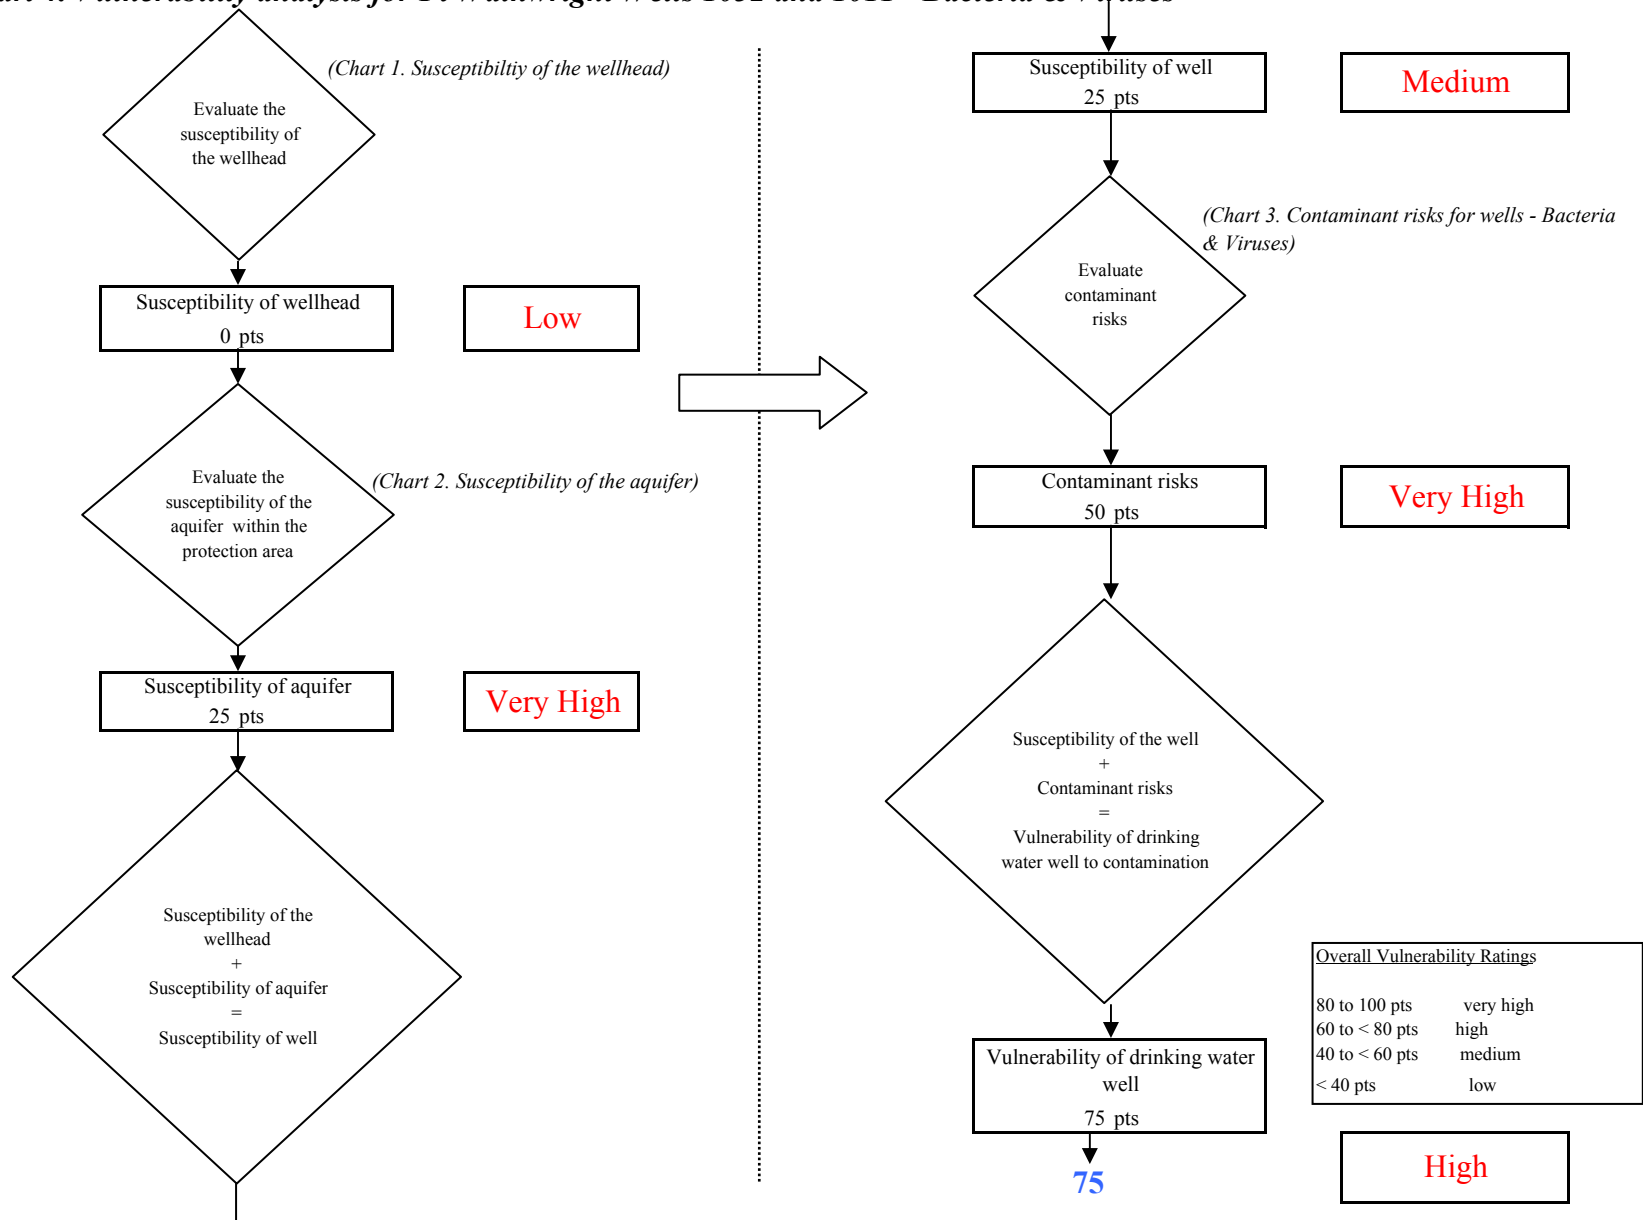


Chart 5. Contaminant risks for Ft Wainwright Wells 1032 and 1011 - Nitrates and Nitrites


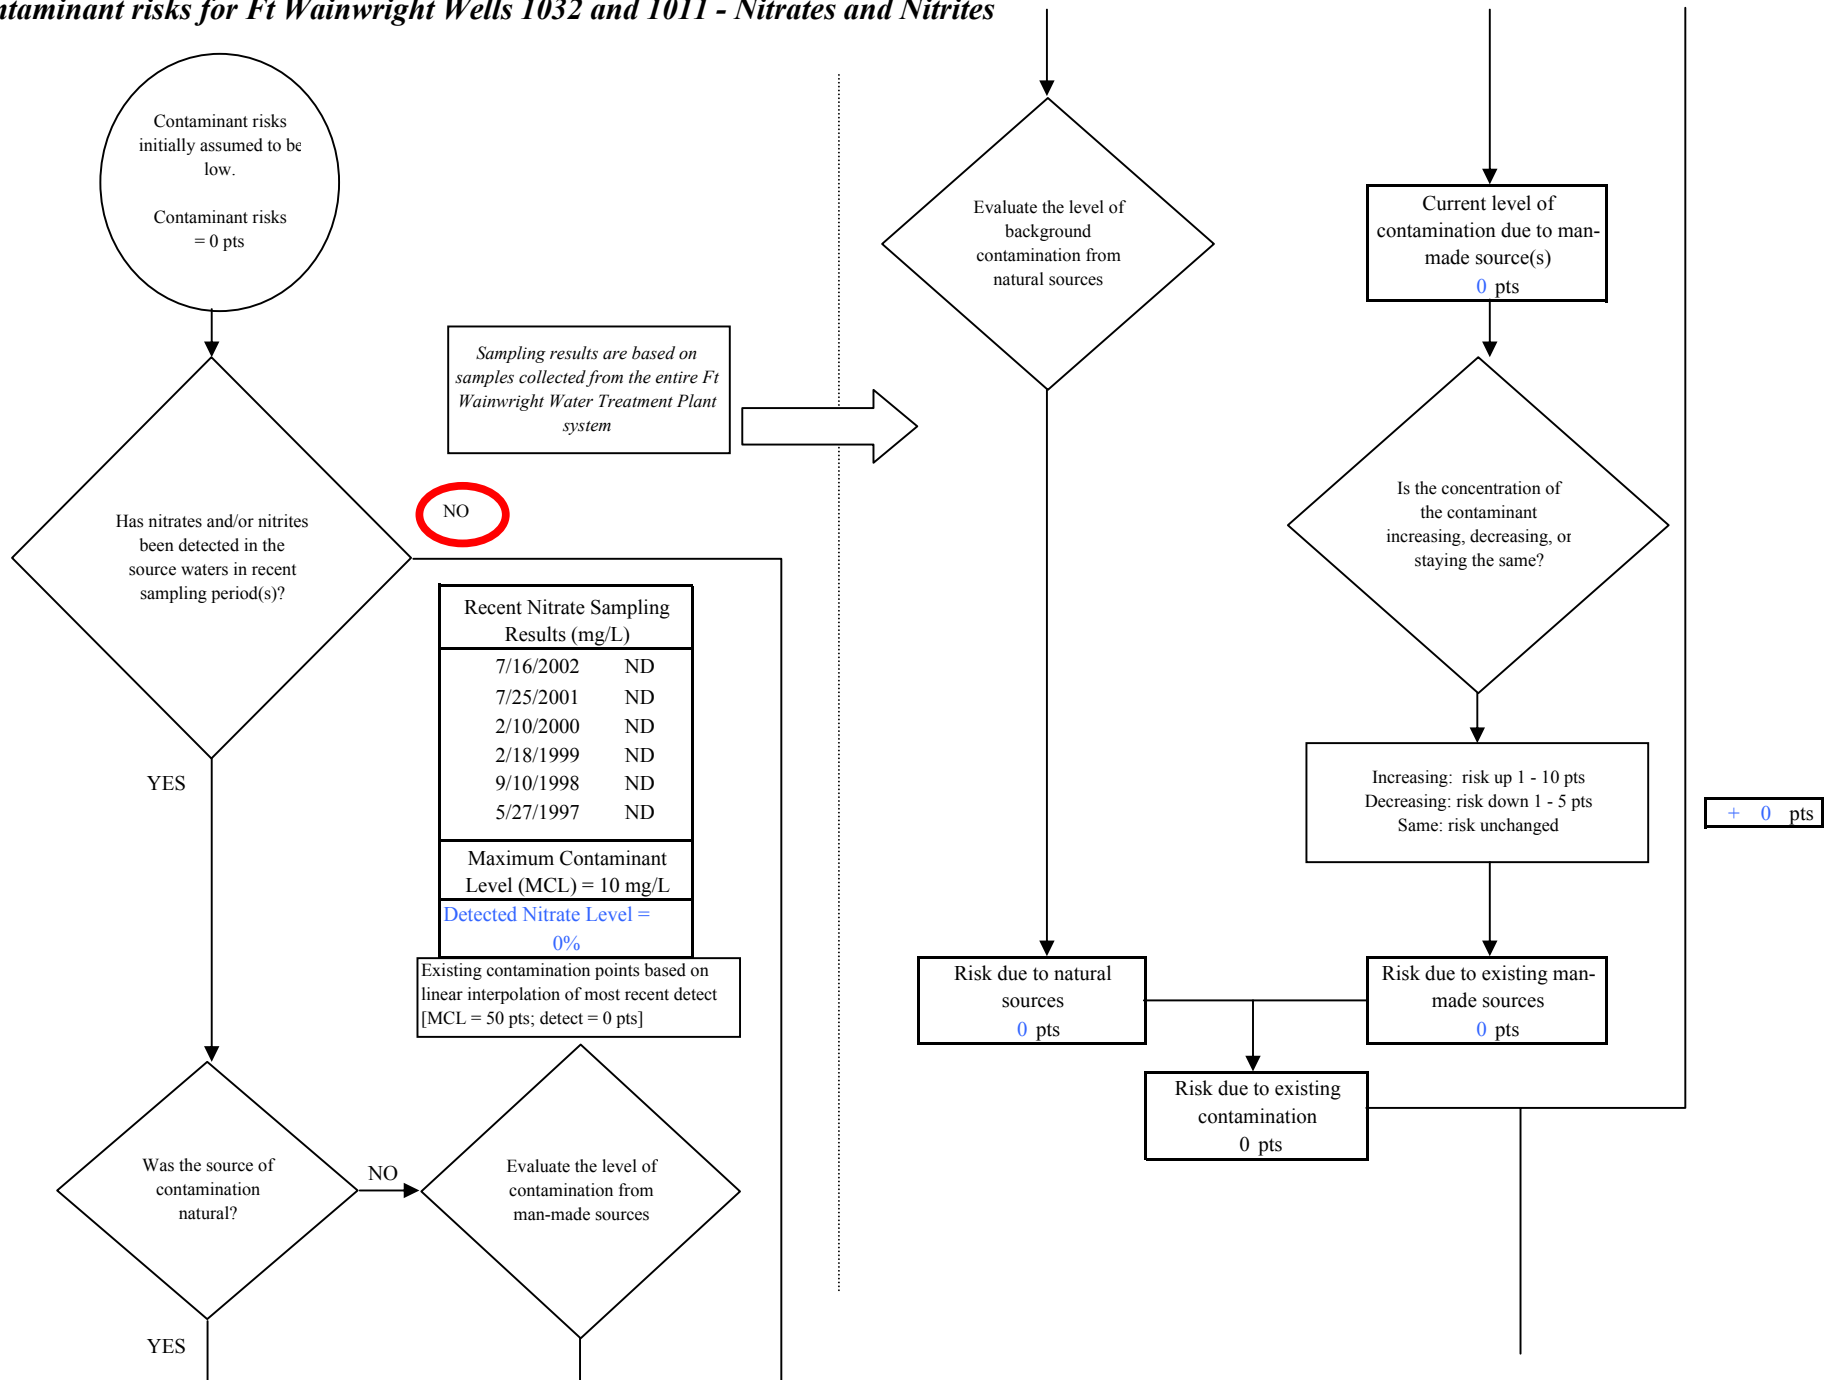


Chart 5. Contaminant risks for Ft Wainwright Wells 1032 and 1011 - Nitrates and Nitrites

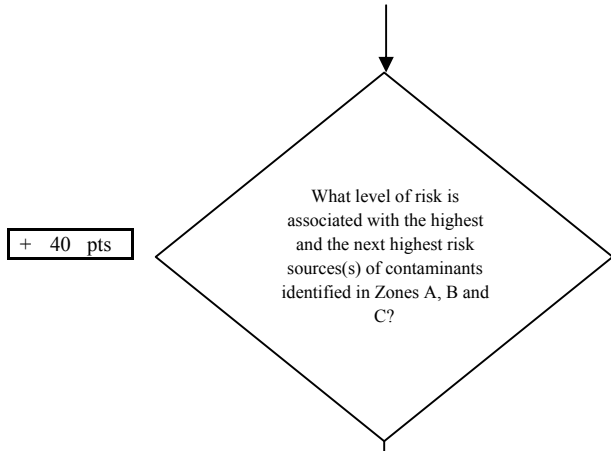

+ 40 pts

Risk Levels for Contaminant Sources identified in Zones A, B and C			
	Zone A	Zones B&C	Total
Very Highs(s)	0	0	0
High(s)	1	2	3
Medium(s)	0	0	0
Low(s)	2	48	50

	LOW 10 pts	MEDIUM 20 pts	HIGH 30 pts	VERY HIGH 40 pts
LOW	≥ 10 sources + 10 pts	≥ 10 sources + 5 pts	≥ 20 sources + 5 pts	----
MEDIUM	----	≥ 2 sources + 5 pts	≥ 5 sources + 5 pts	≥ 10 sources + 5 pts
HIGH	----	----	≥ 1 source + 10 pts	≥ 2 sources + 10 pts
VERY HIGH	----	----	----	≥ 1 source + 10 pts

Matrix Score 40

Note: Septic systems, sewerlines, and roads are each assigned a risk ranking for each individual contaminant source in the CSI. The VA, however, counts these contaminant sources as a group and assigns a calculated number of either "lows" or "mediums" based on the density.

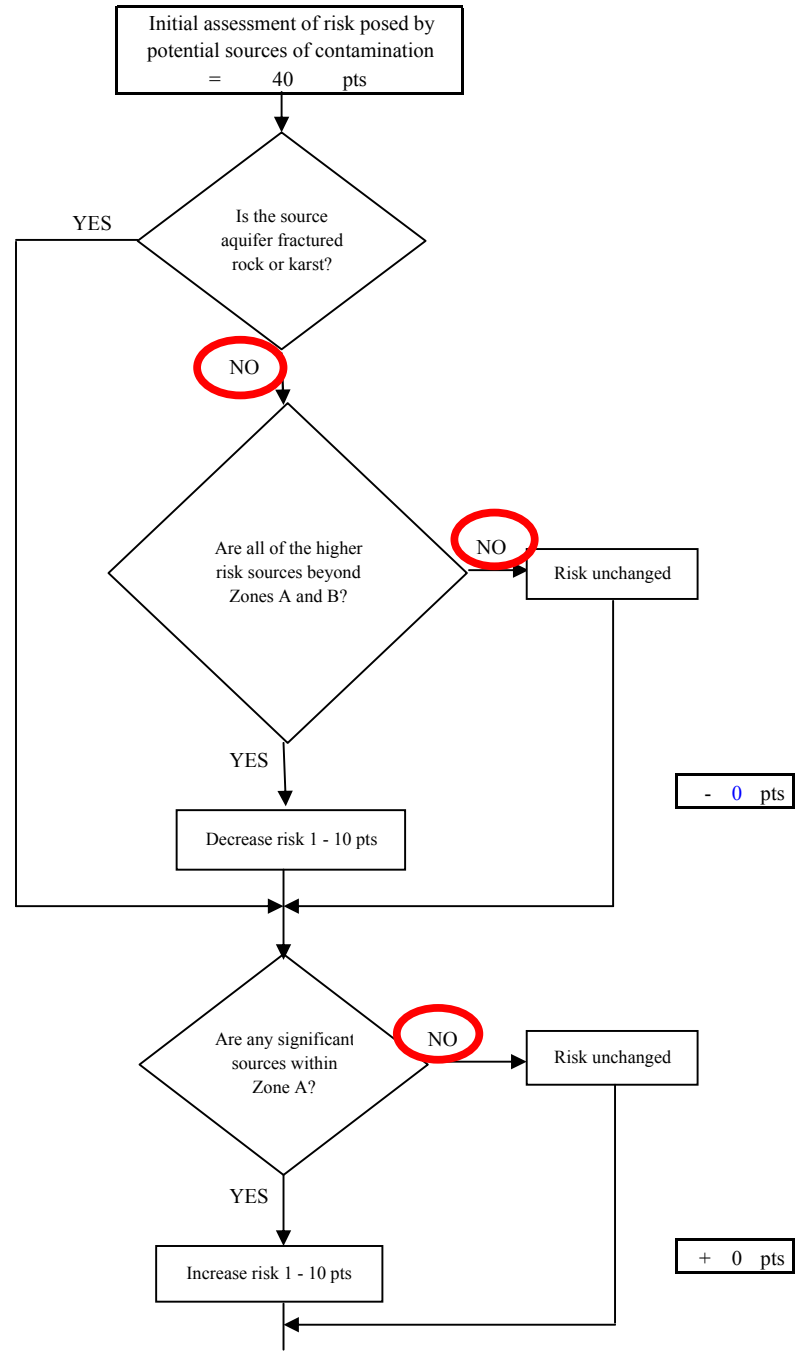



Chart 5. Contaminant risks for Ft Wainwright Wells 1032 and 1011 - Nitrates and Nitrites

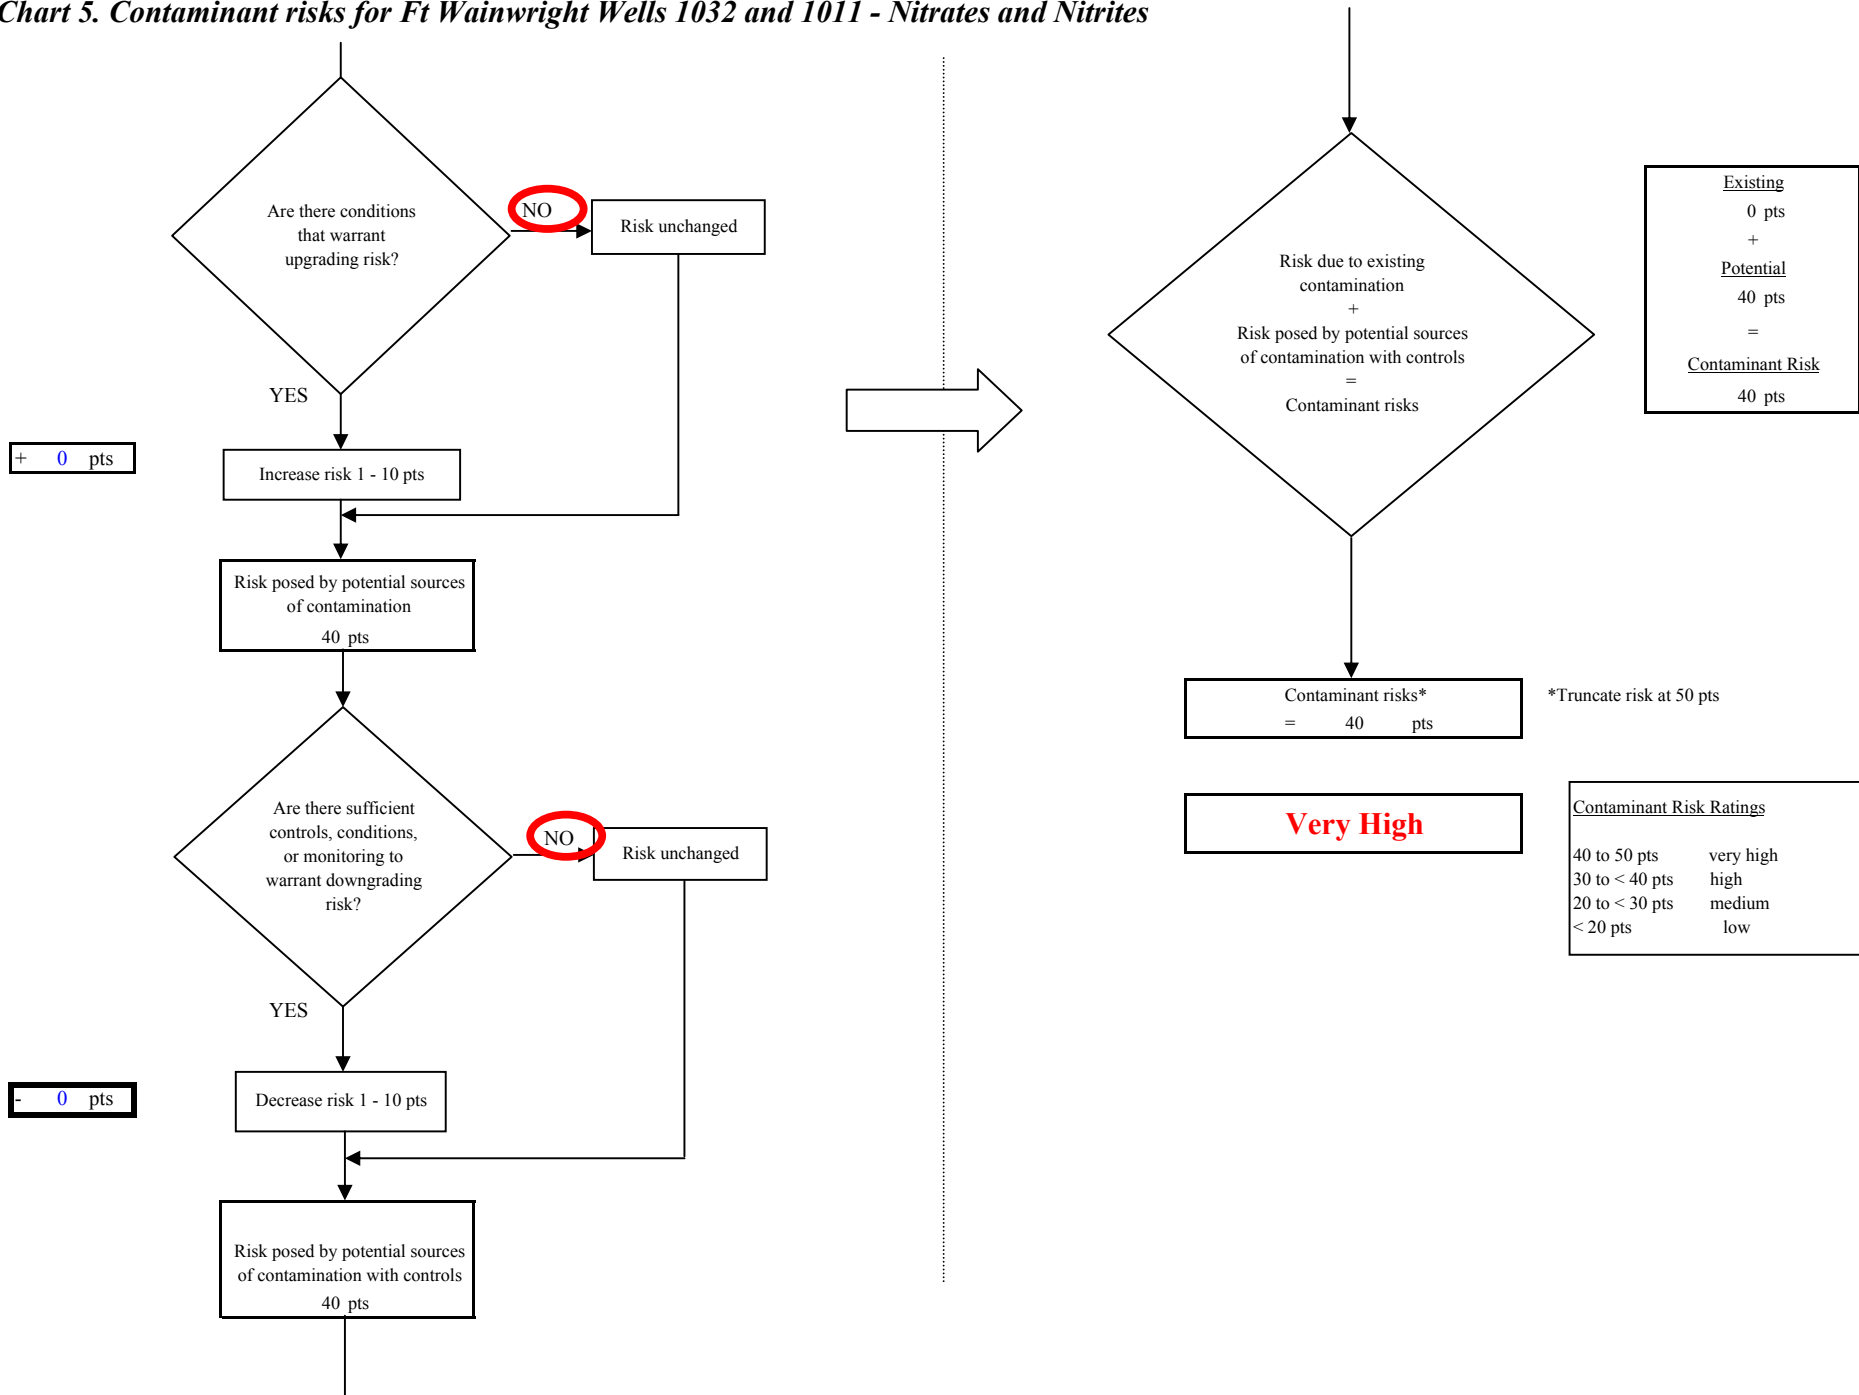


Chart 6. Vulnerability analysis for Ft Wainwright Wells 1032 and 1011 - Nitrates and Nitrites

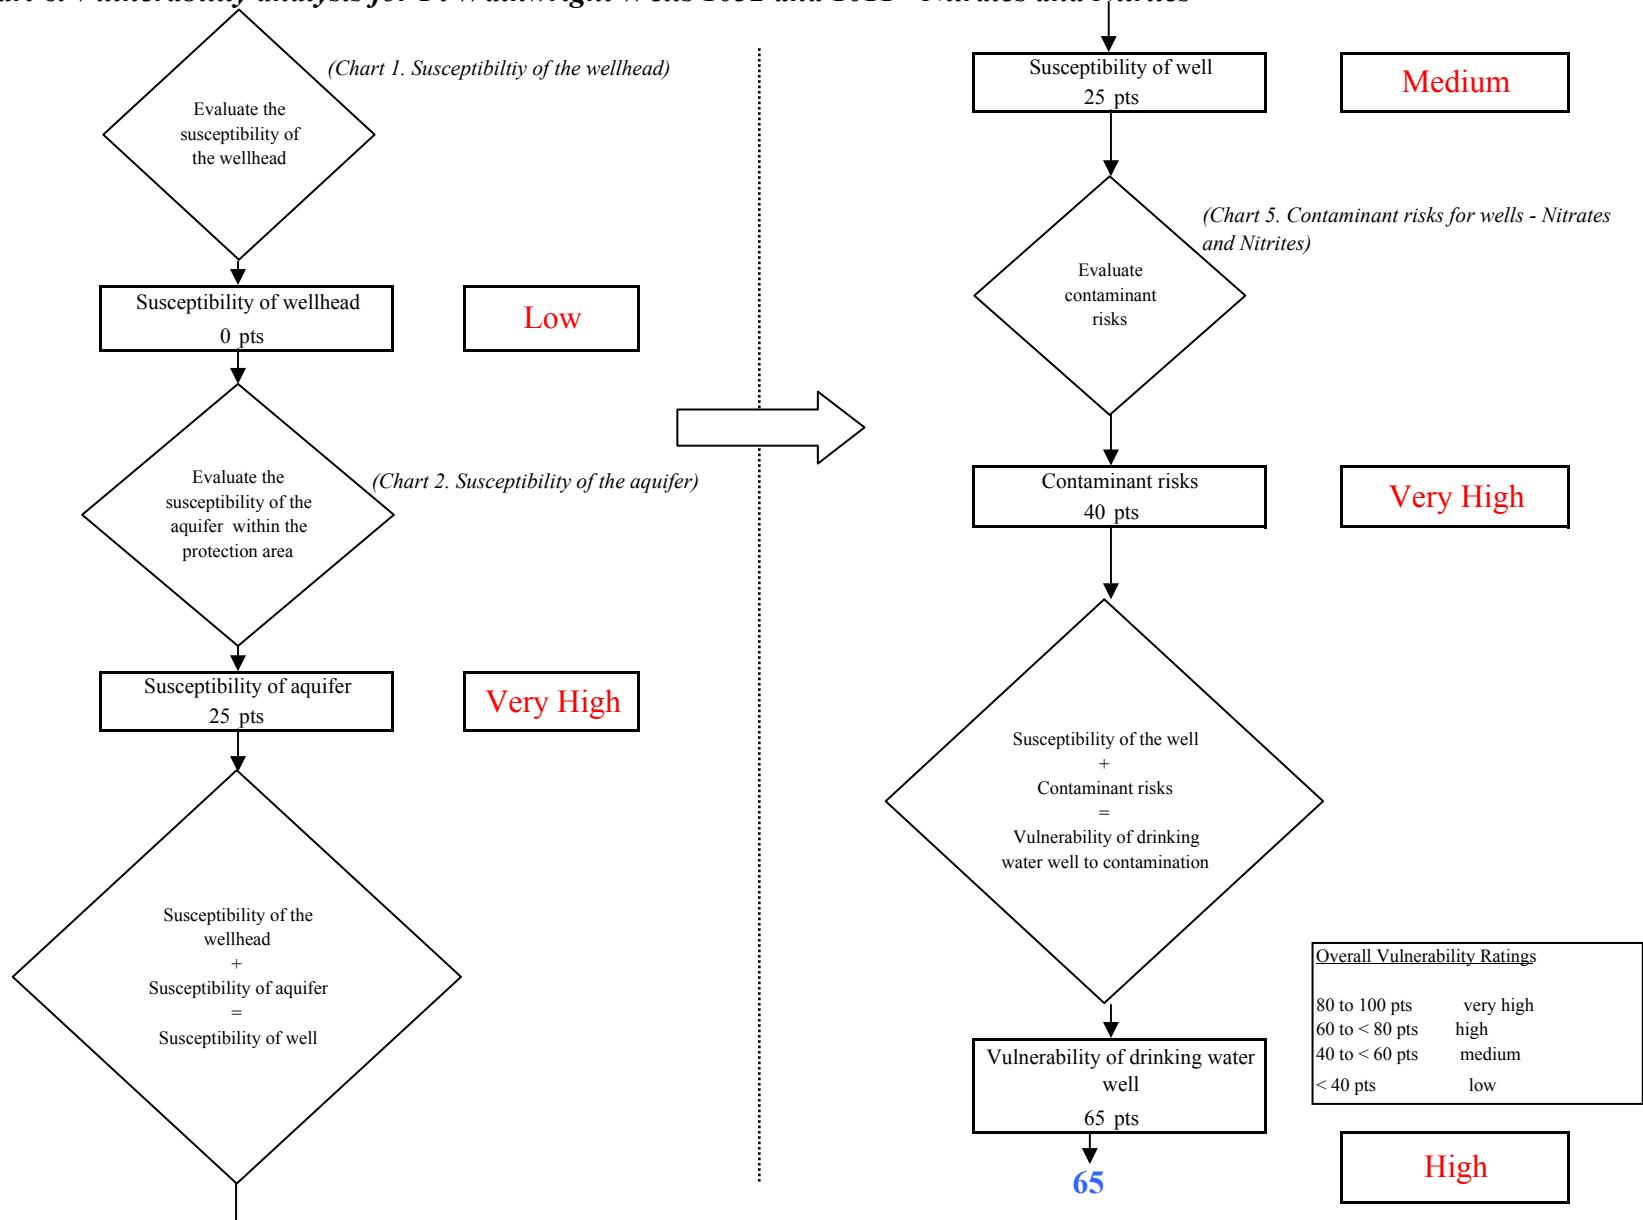


Chart 7. Contaminant risks for Ft Wainwright Wells 1032 and 1011 - Volatile Organic Chemicals

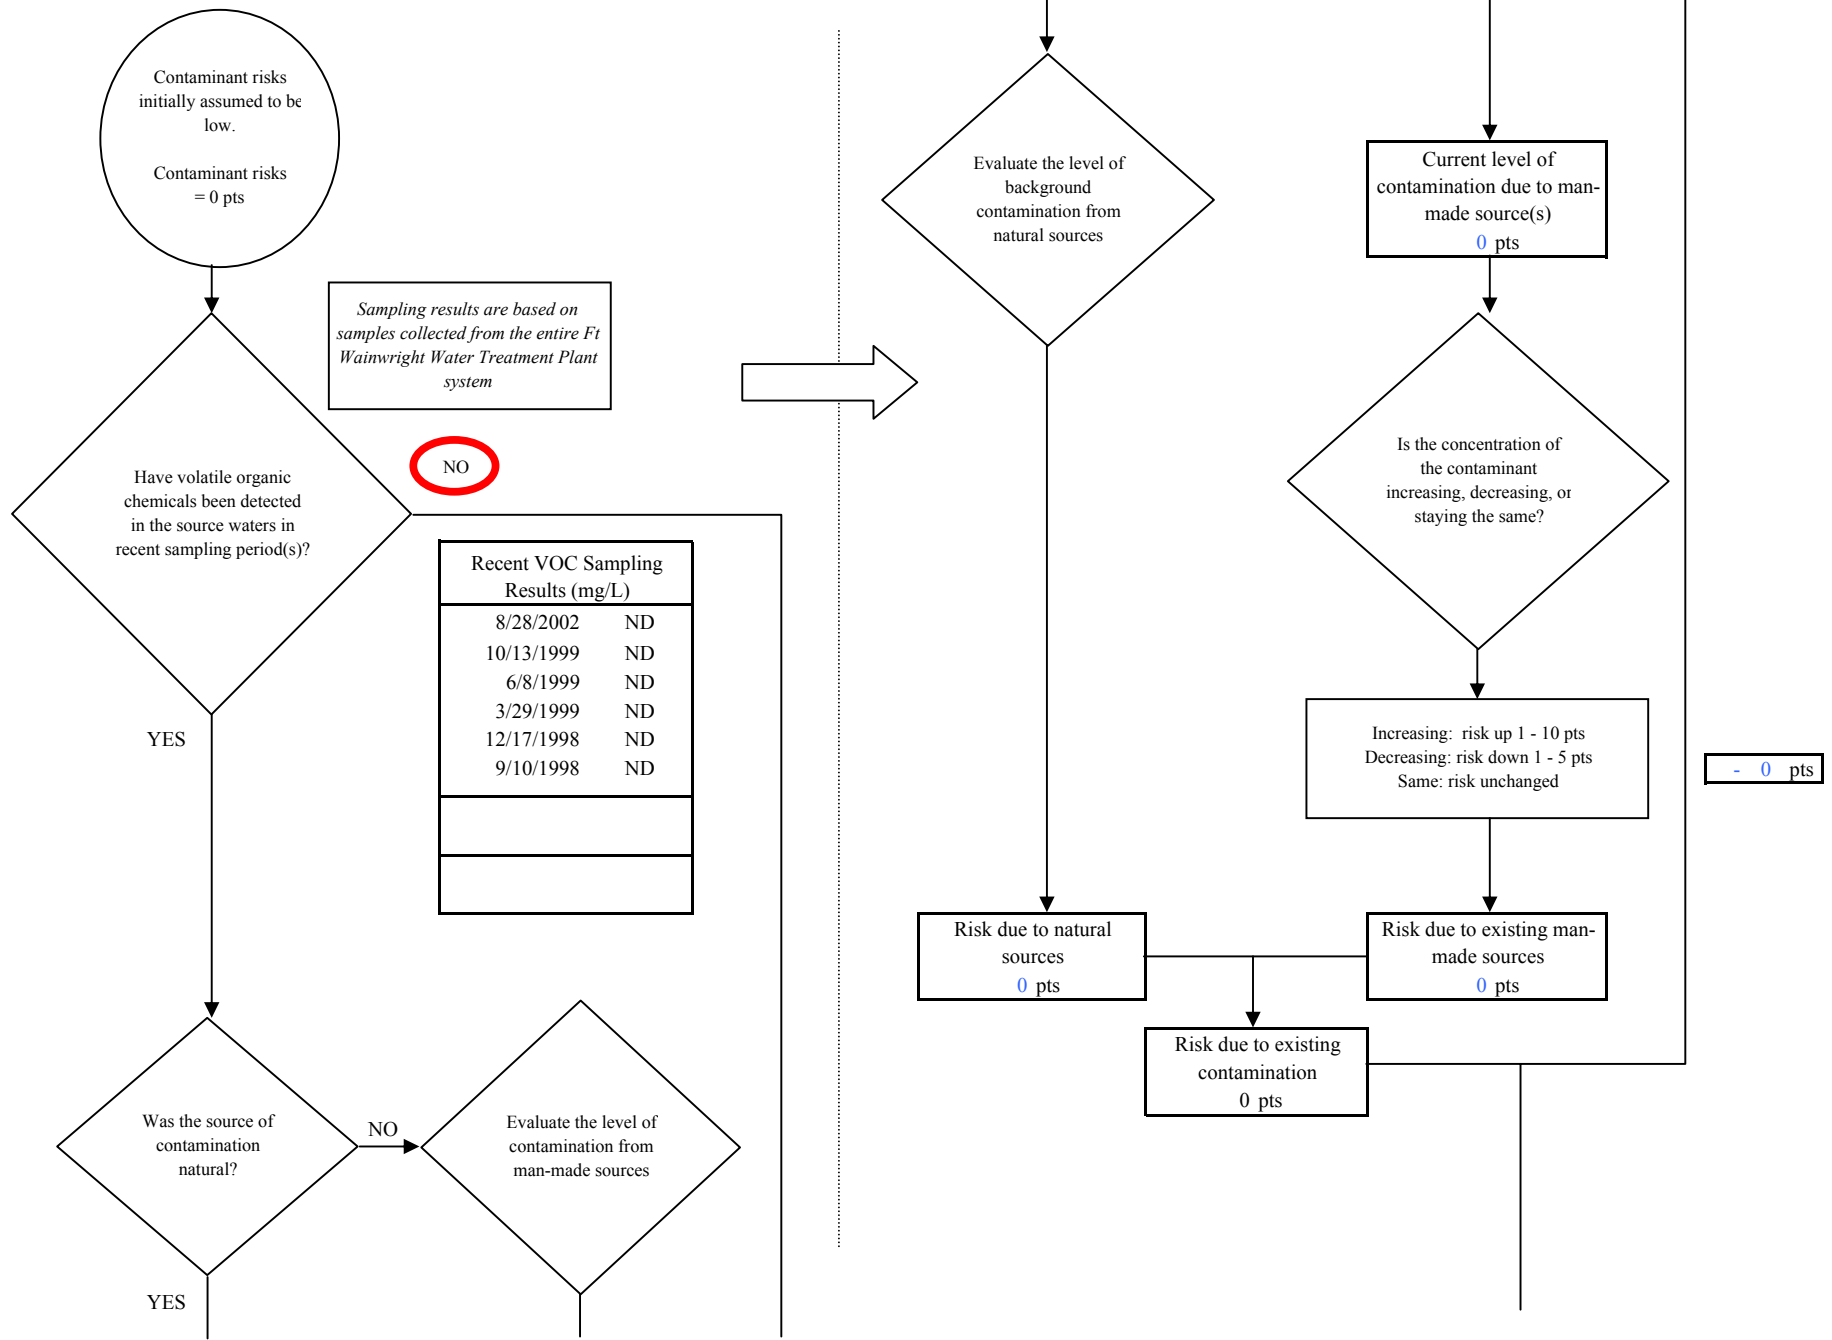


Chart 7. Contaminant risks for Ft Wainwright Wells 1032 and 1011 - Volatile Organic Chemicals

What level of risk is associated with the highest and the next highest risk sources(s) of contaminants identified in Zones A, B and C?

+ 50 pts

Risk Levels for Contaminant Sources identified in Zones A, B and C			
	Zone A	Zones B&C	Total
Very High(s)	0	1	1
High(s)	1	2	3
Medium(s)	0	409	409
Low(s)	2	17	19

	LOW 10 pts	MEDIUM 20 pts	HIGH 30 pts	VERY HIGH 40 pts
LOW	≥ 10 sources + 10 pts	≥ 10 sources + 5 pts	≥ 20 sources + 5 pts	----
MEDIUM	----	≥ 2 sources + 5 pts	≥ 5 sources + 5 pts	≥ 10 sources + 5 pts
HIGH	----	----	≥ 1 source + 10 pts	≥ 2 sources + 10 pts
VERY HIGH	----	----	----	≥ 1 source + 10 pts

Matrix Score 50

Note: Septic systems, sewerlines, and roads are each assigned a risk ranking for each individual contaminant source in the CSI. The VA, however, counts these contaminant sources as a group and assigns a calculated number of either "lows" or "mediums" based on the density.

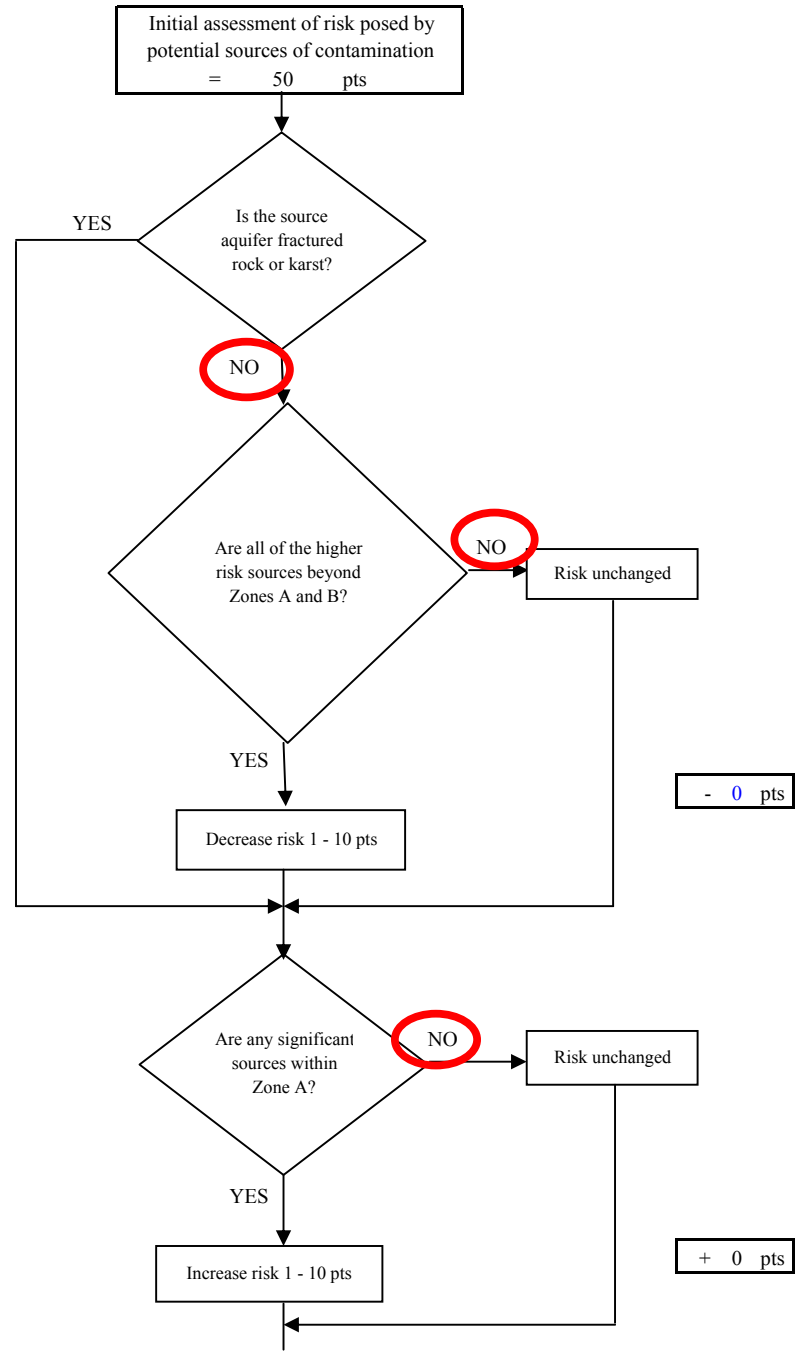


Chart 7. Contaminant risks for Ft Wainwright Wells 1032 and 1011 - Volatile Organic Chemicals

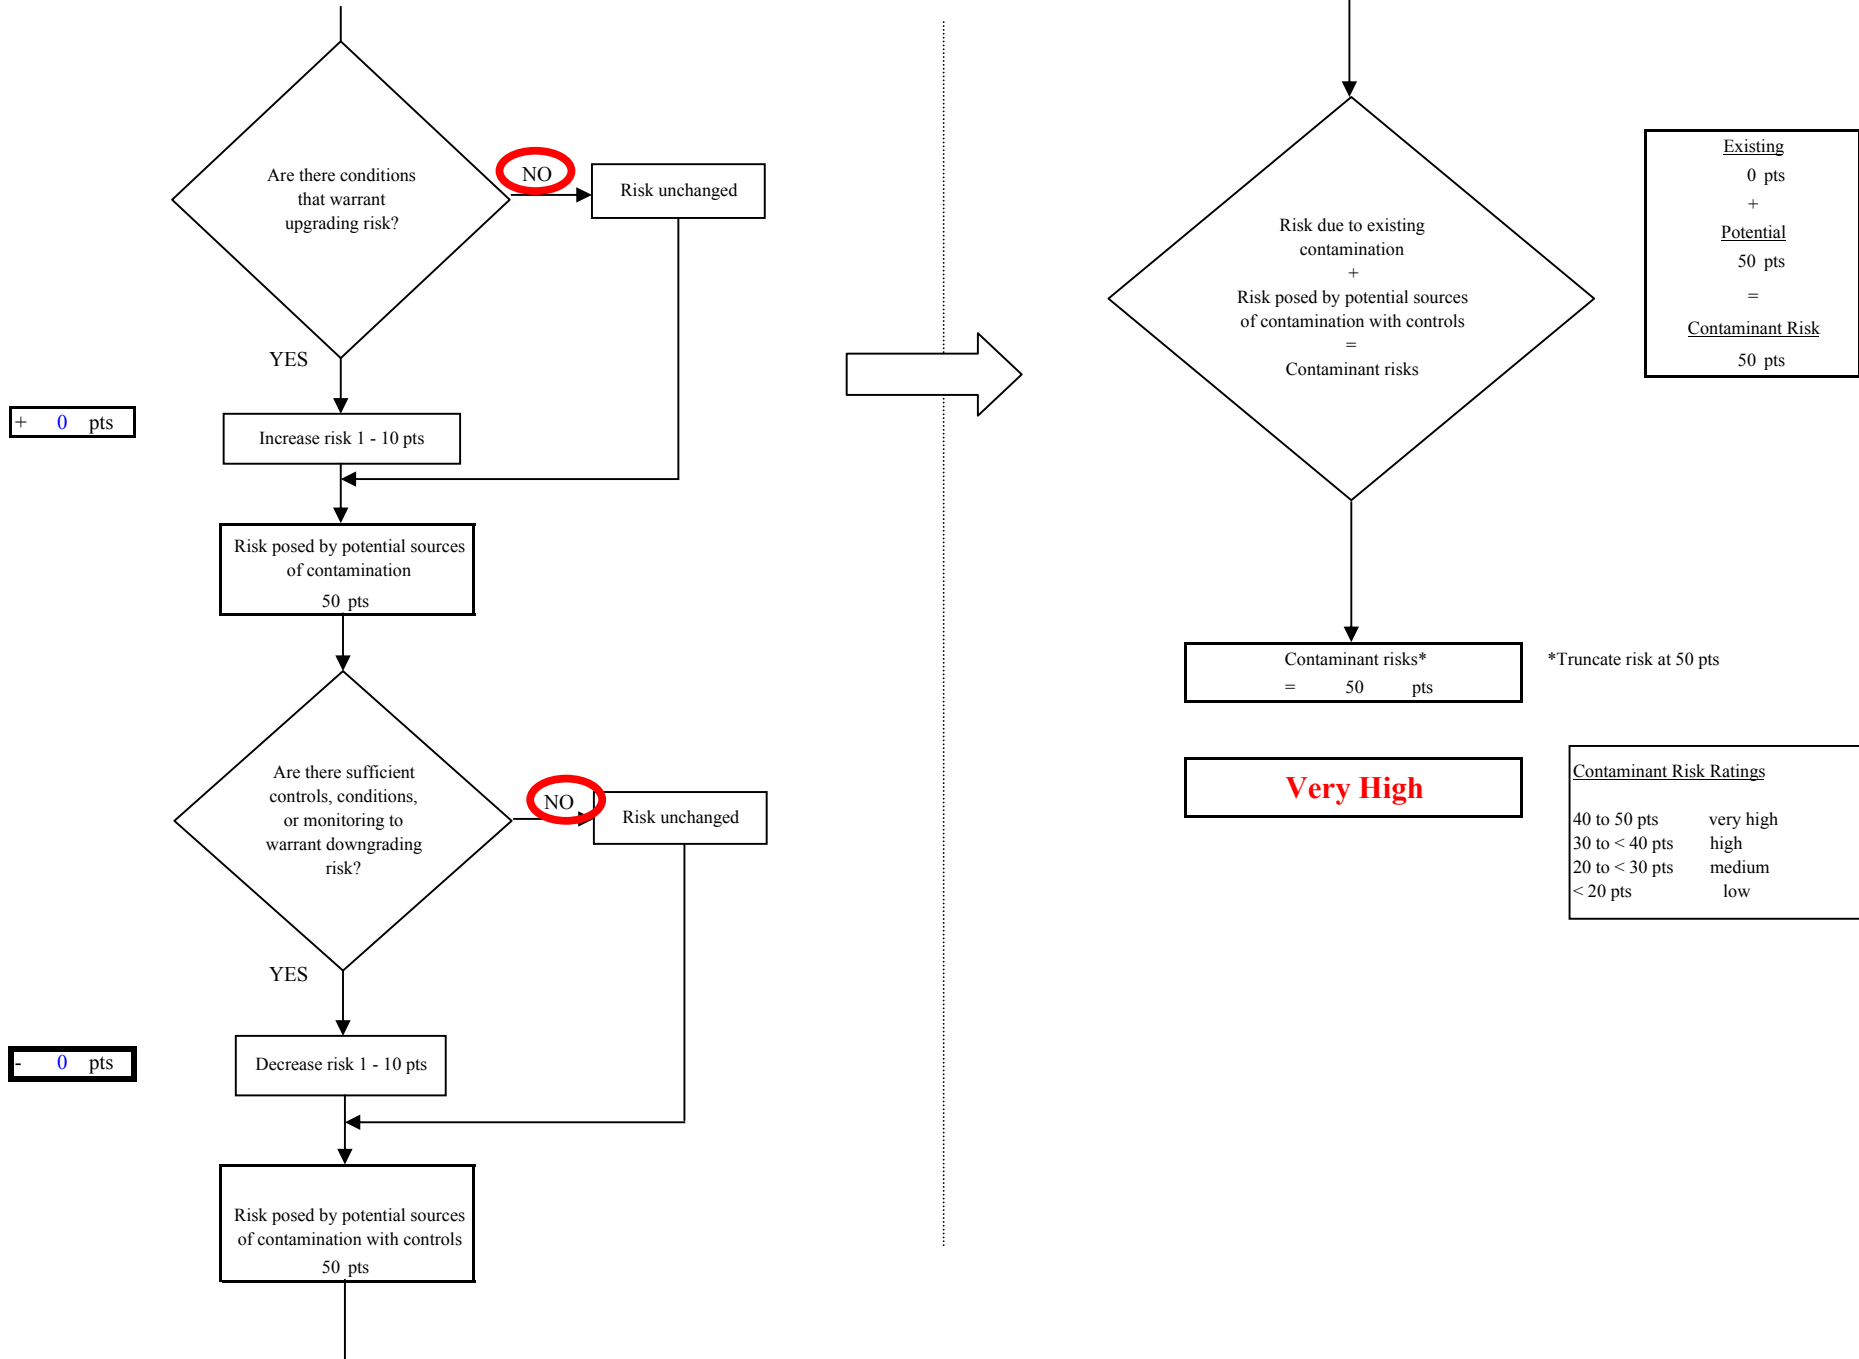


Chart 8. Vulnerability analysis for Ft Wainwright Wells 1032 and 1011 - Volatile Organic Chemicals

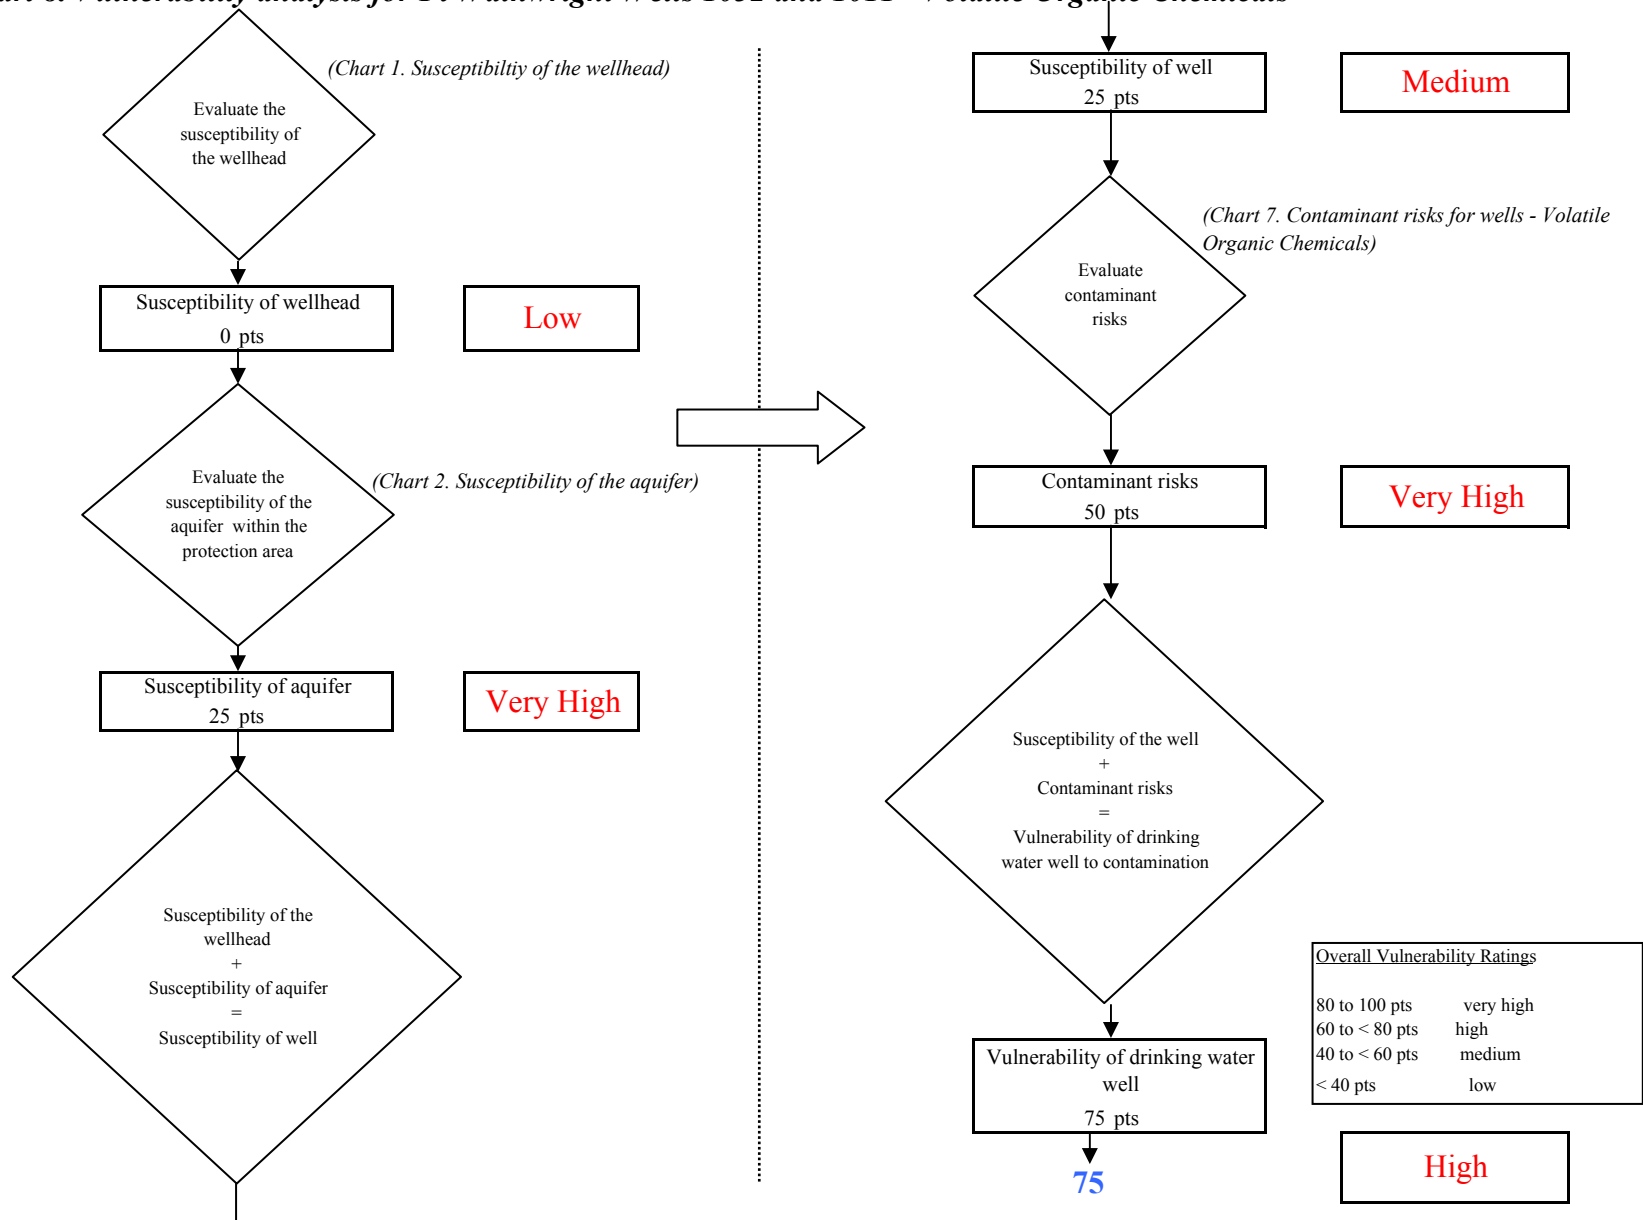


Chart 9. Contaminant risks for Ft Wainwright Wells 1032 and 1011 - Heavy Metals, Cyanide and Other Inorganic Chemicals


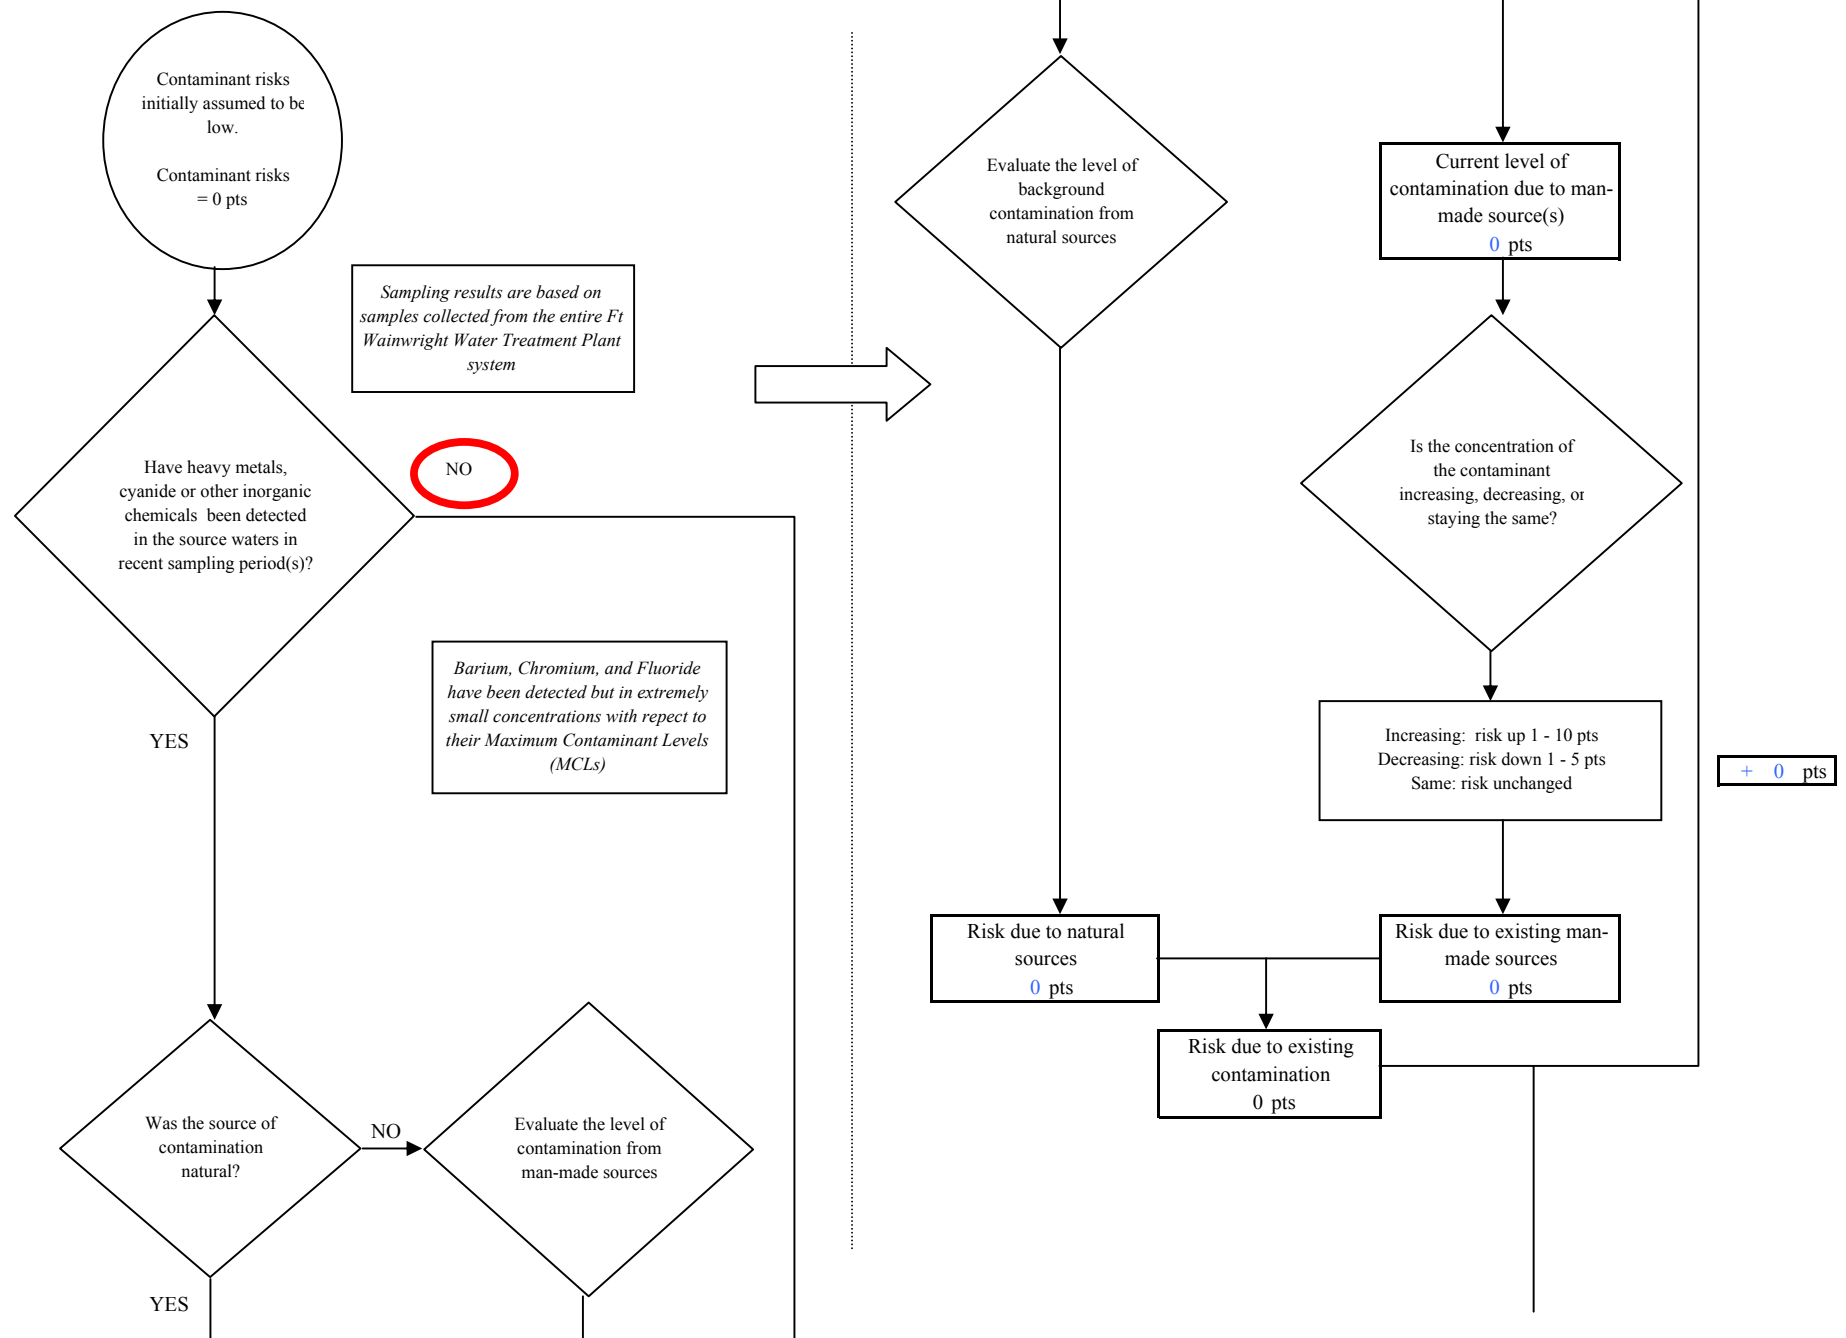


Chart 9. Contaminant risks for Ft Wainwright Wells 1032 and 1011 - Heavy Metals, Cyanide and Other Inorganic Chemicals

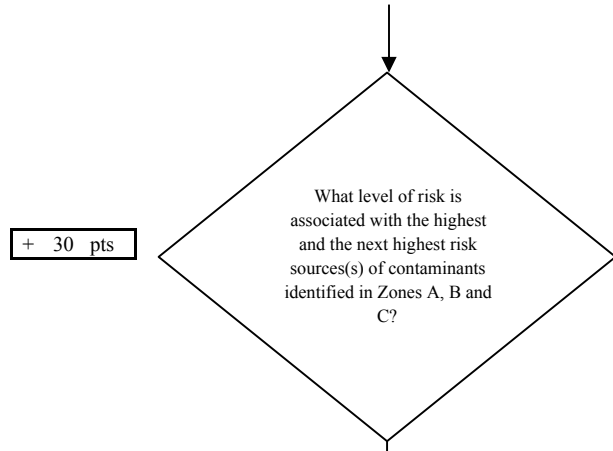

Risk Levels for Contaminant Sources identified in Zones A, B and C			
	Zone A	Zones B&C	Total
Very High(s)	0	0	0
High(s)	0	1	1
Medium(s)	0	2	2
Low(s)	3	20	23

	LOW 10 pts	MEDIUM 20 pts	HIGH 30 pts	VERY HIGH 40 pts
LOW	≥ 10 sources + 10 pts	≥ 10 sources + 5 pts	≥ 20 sources + 5 pts	----
MEDIUM	----	≥ 2 sources + 5 pts	≥ 5 sources + 5 pts	≥ 10 sources + 5 pts
HIGH	----	----	≥ 1 source + 10 pts	≥ 2 sources + 10 pts
VERY HIGH	----	----	----	≥ 1 source + 10 pts

Matrix Score 30

Note: Septic systems, sewerlines, and roads are each assigned a risk ranking for each individual contaminant source in the CSI. The VA, however, counts these contaminant sources as a group and assigns a calculated number of either "lows" or "mediums" based on the density.

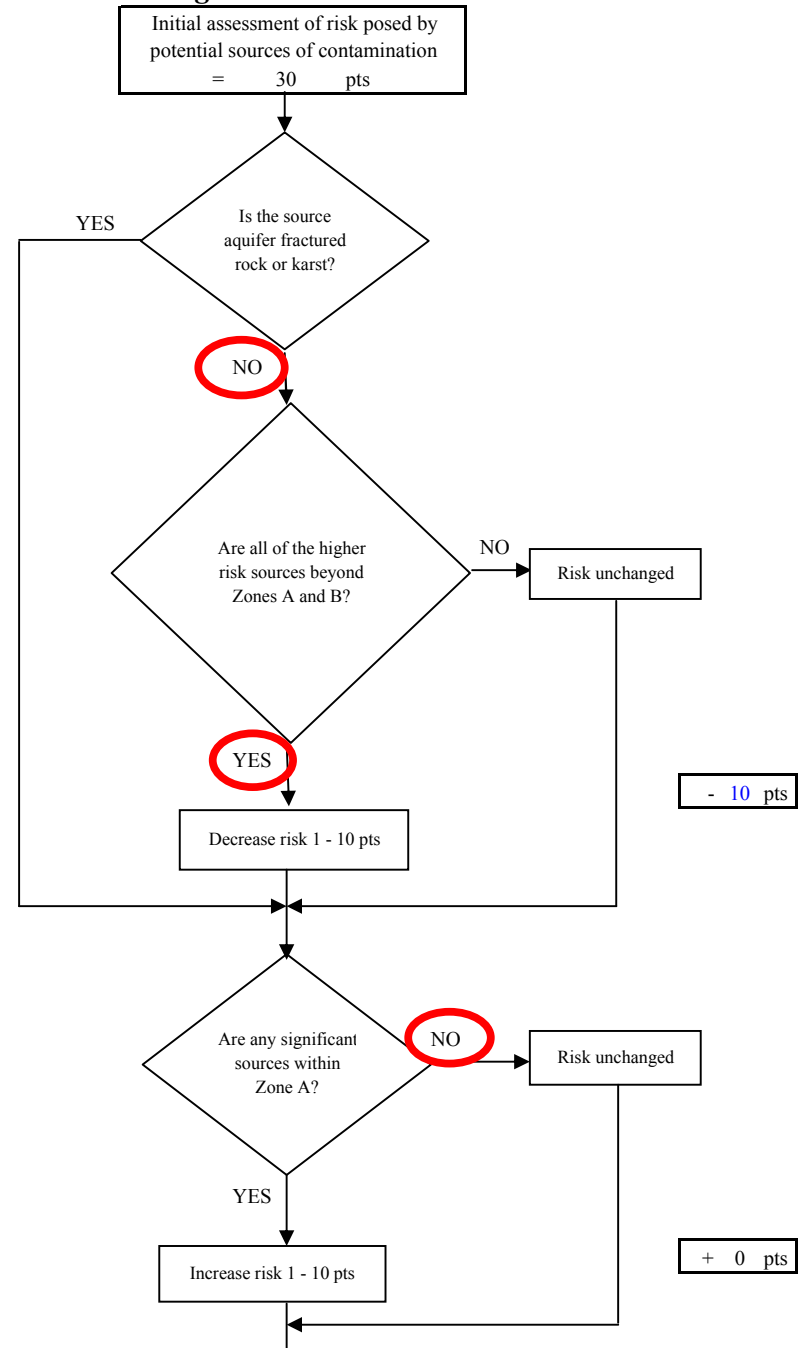


Chart 9. Contaminant risks for Ft Wainwright Wells 1032 and 1011 - Heavy Metals, Cyanide and Other Inorganic Chemicals

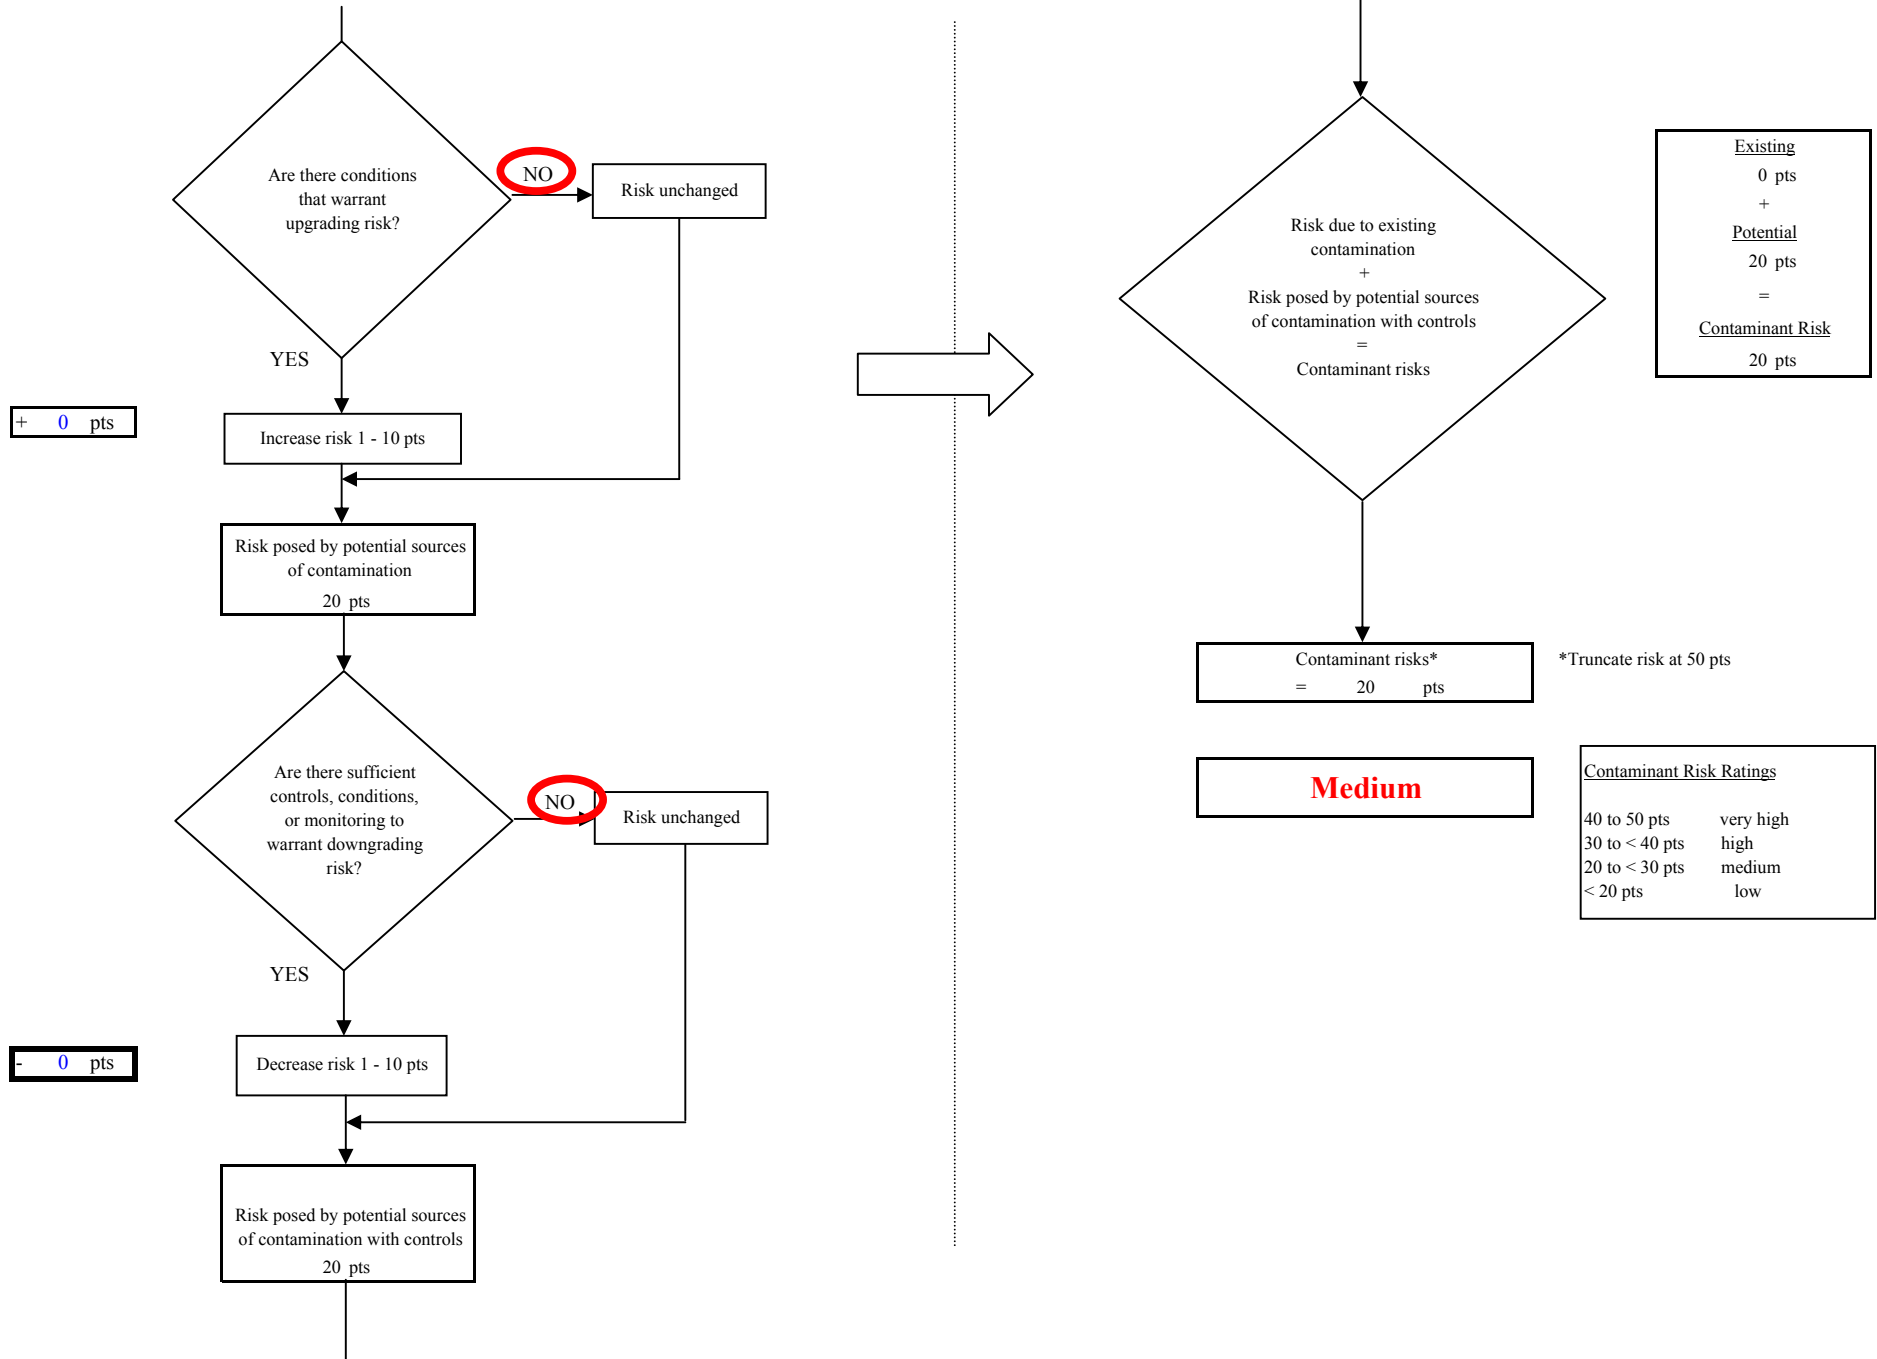


Chart 10. Vulnerability analysis for Ft Wainwright Wells 1032 and 1011 - Heavy Metals, Cyanide and Other Inorganic Chemicals

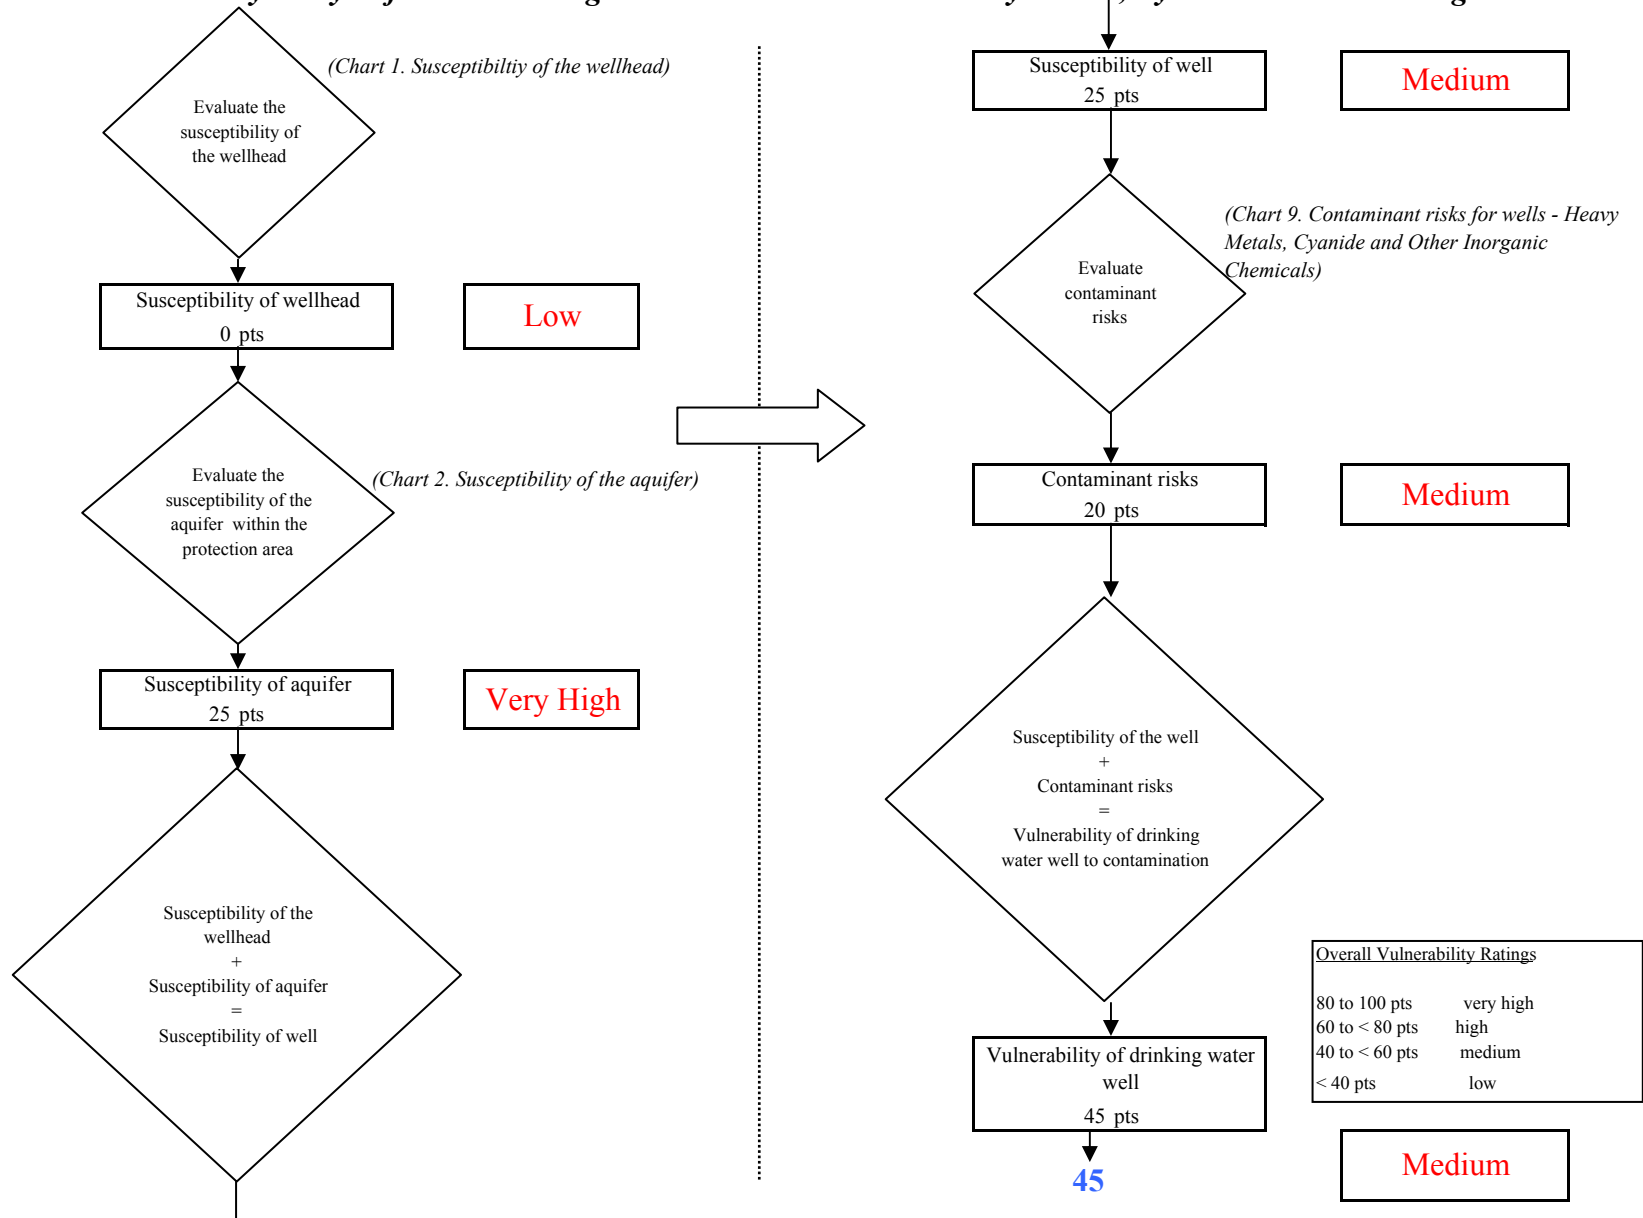


Chart 11. Contaminant risks for Ft Wainwright Wells 1032 and 1011 - Synthetic Organic Chemicals


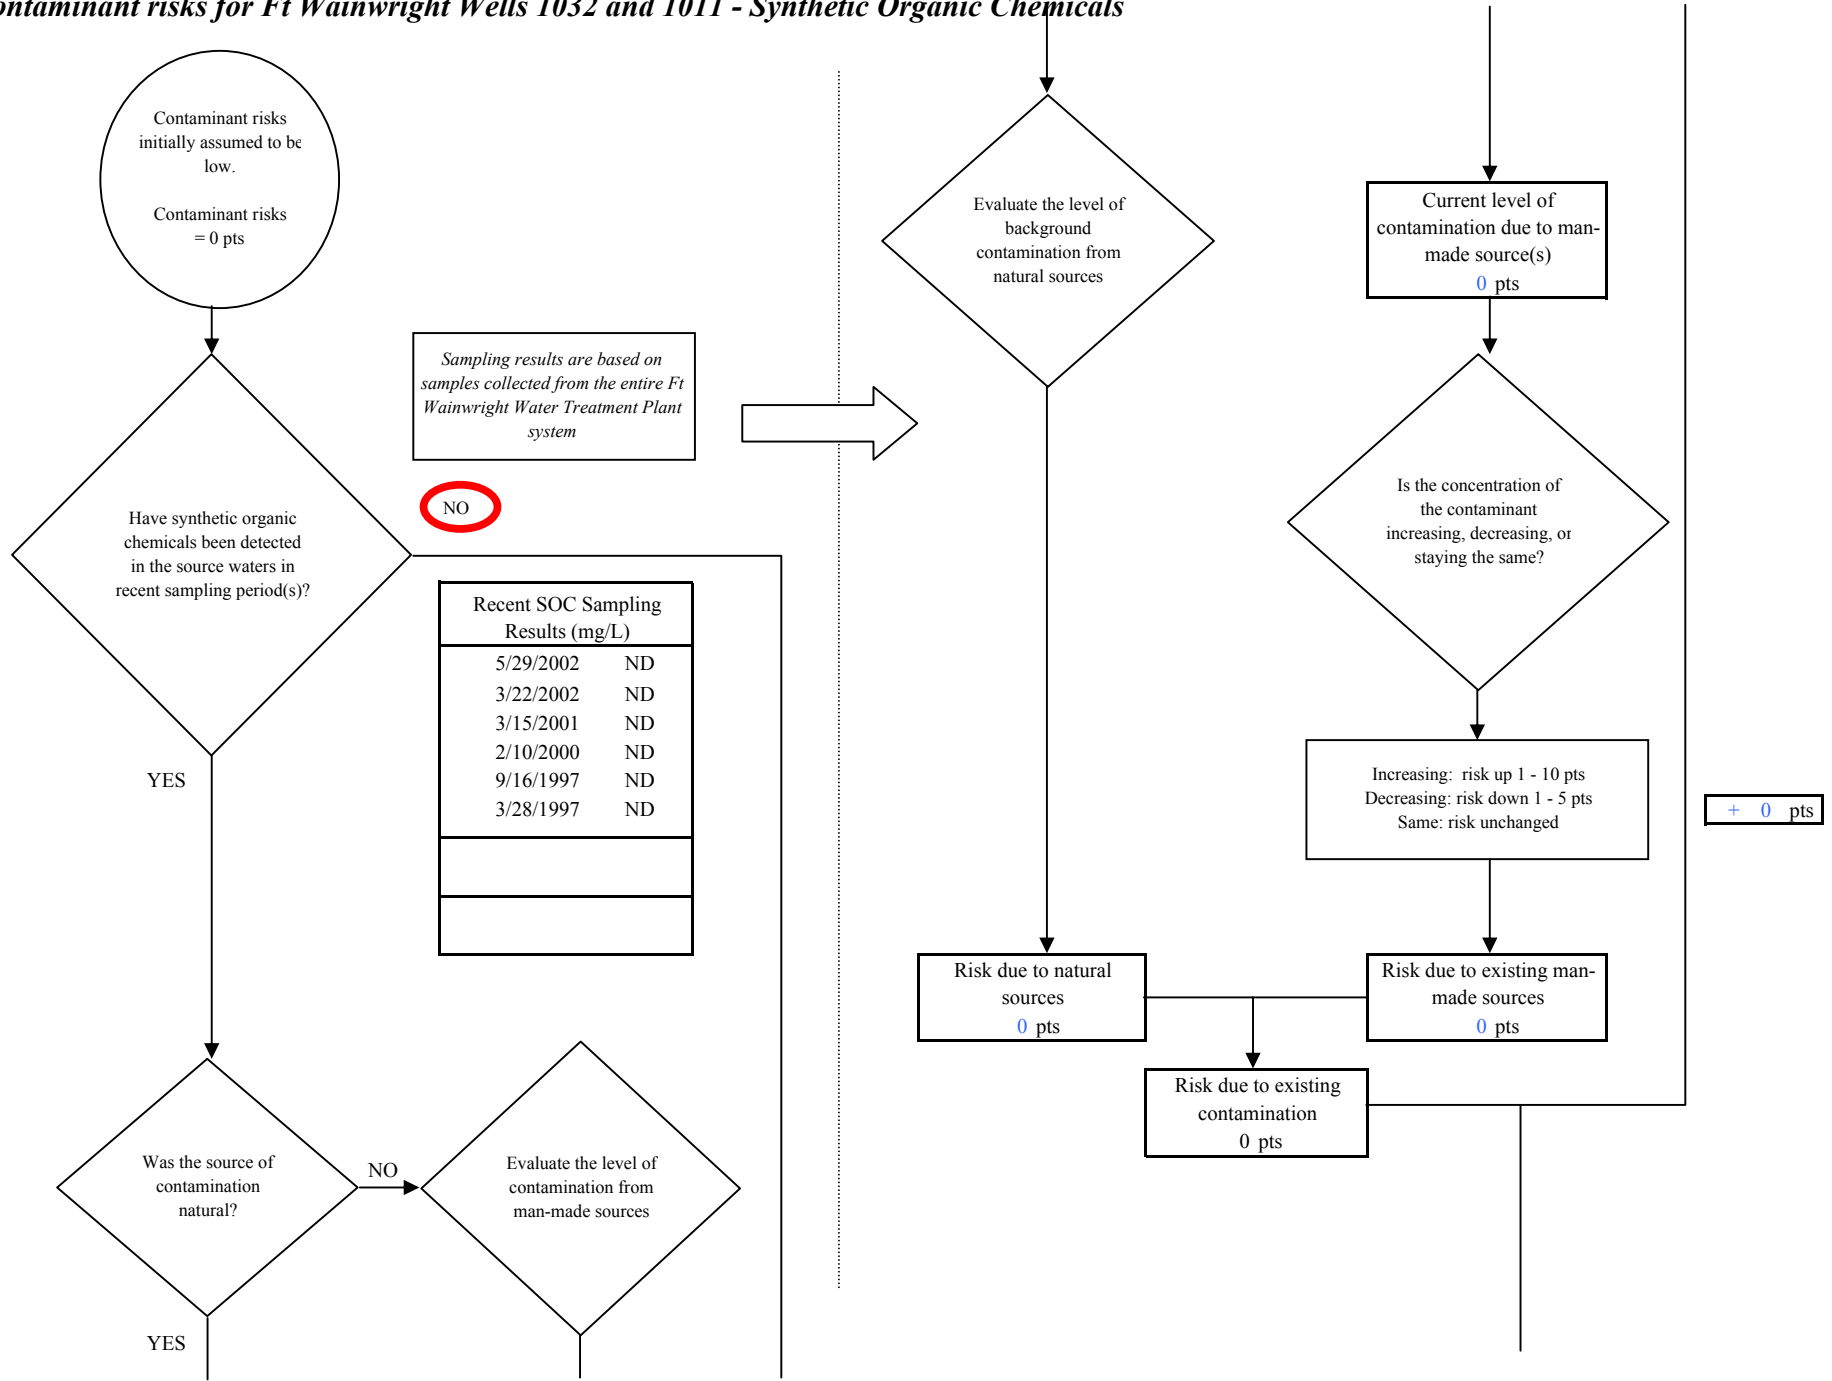


Chart 11. Contaminant risks for Ft Wainwright Wells 1032 and 1011 - Synthetic Organic Chemicals

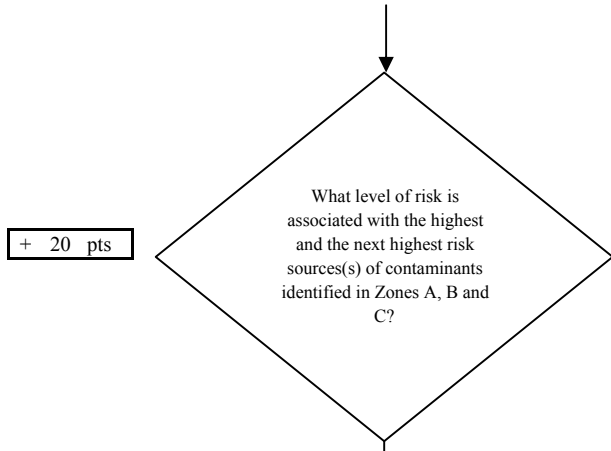

Risk Levels for Contaminant Sources identified in Zones A, B and C			
	Zone A	Zones B&C	Total
Very High(s)	0	0	0
High(s)	0	0	0
Medium(s)	1	1	2
Low(s)	1	10	11

	LOW 10 pts	MEDIUM 20 pts	HIGH 30 pts	VERY HIGH 40 pts
LOW	≥ 10 sources + 10 pts	≥ 10 sources + 5 pts	≥ 20 sources + 5 pts	----
MEDIUM	----	≥ 2 sources + 5 pts	≥ 5 sources + 5 pts	≥ 10 sources + 5 pts
HIGH	----	----	≥ 1 source + 10 pts	≥ 2 sources + 10 pts
VERY HIGH	----	----	----	≥ 1 source + 10 pts

Matrix Score 20

Note: Septic systems, sewerlines, and roads are each assigned a risk ranking for each individual contaminant source in the CSI. The VA, however, counts these contaminant sources as a group and assigns a calculated number of either "lows" or "mediums" based on the density.

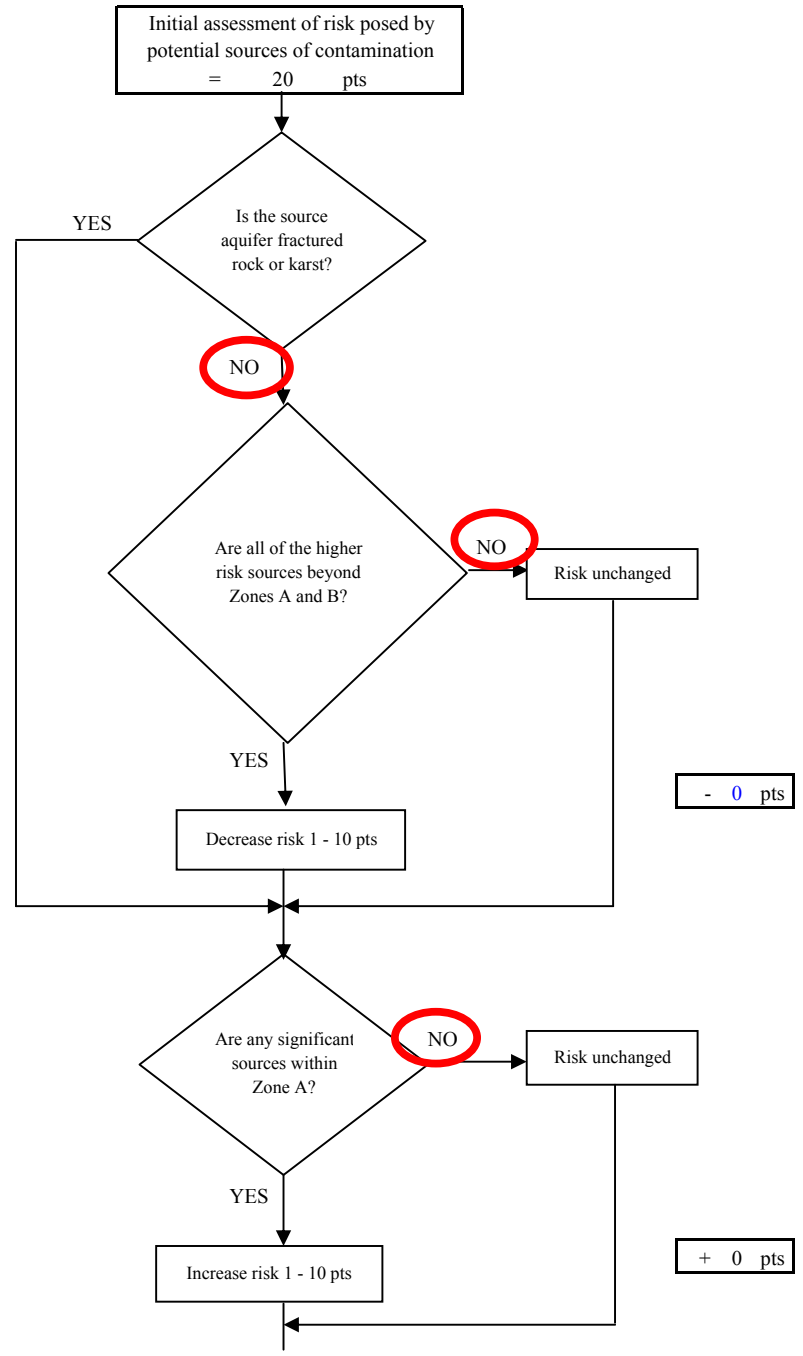



Chart 11. Contaminant risks for Ft Wainwright Wells 1032 and 1011 - Synthetic Organic Chemicals

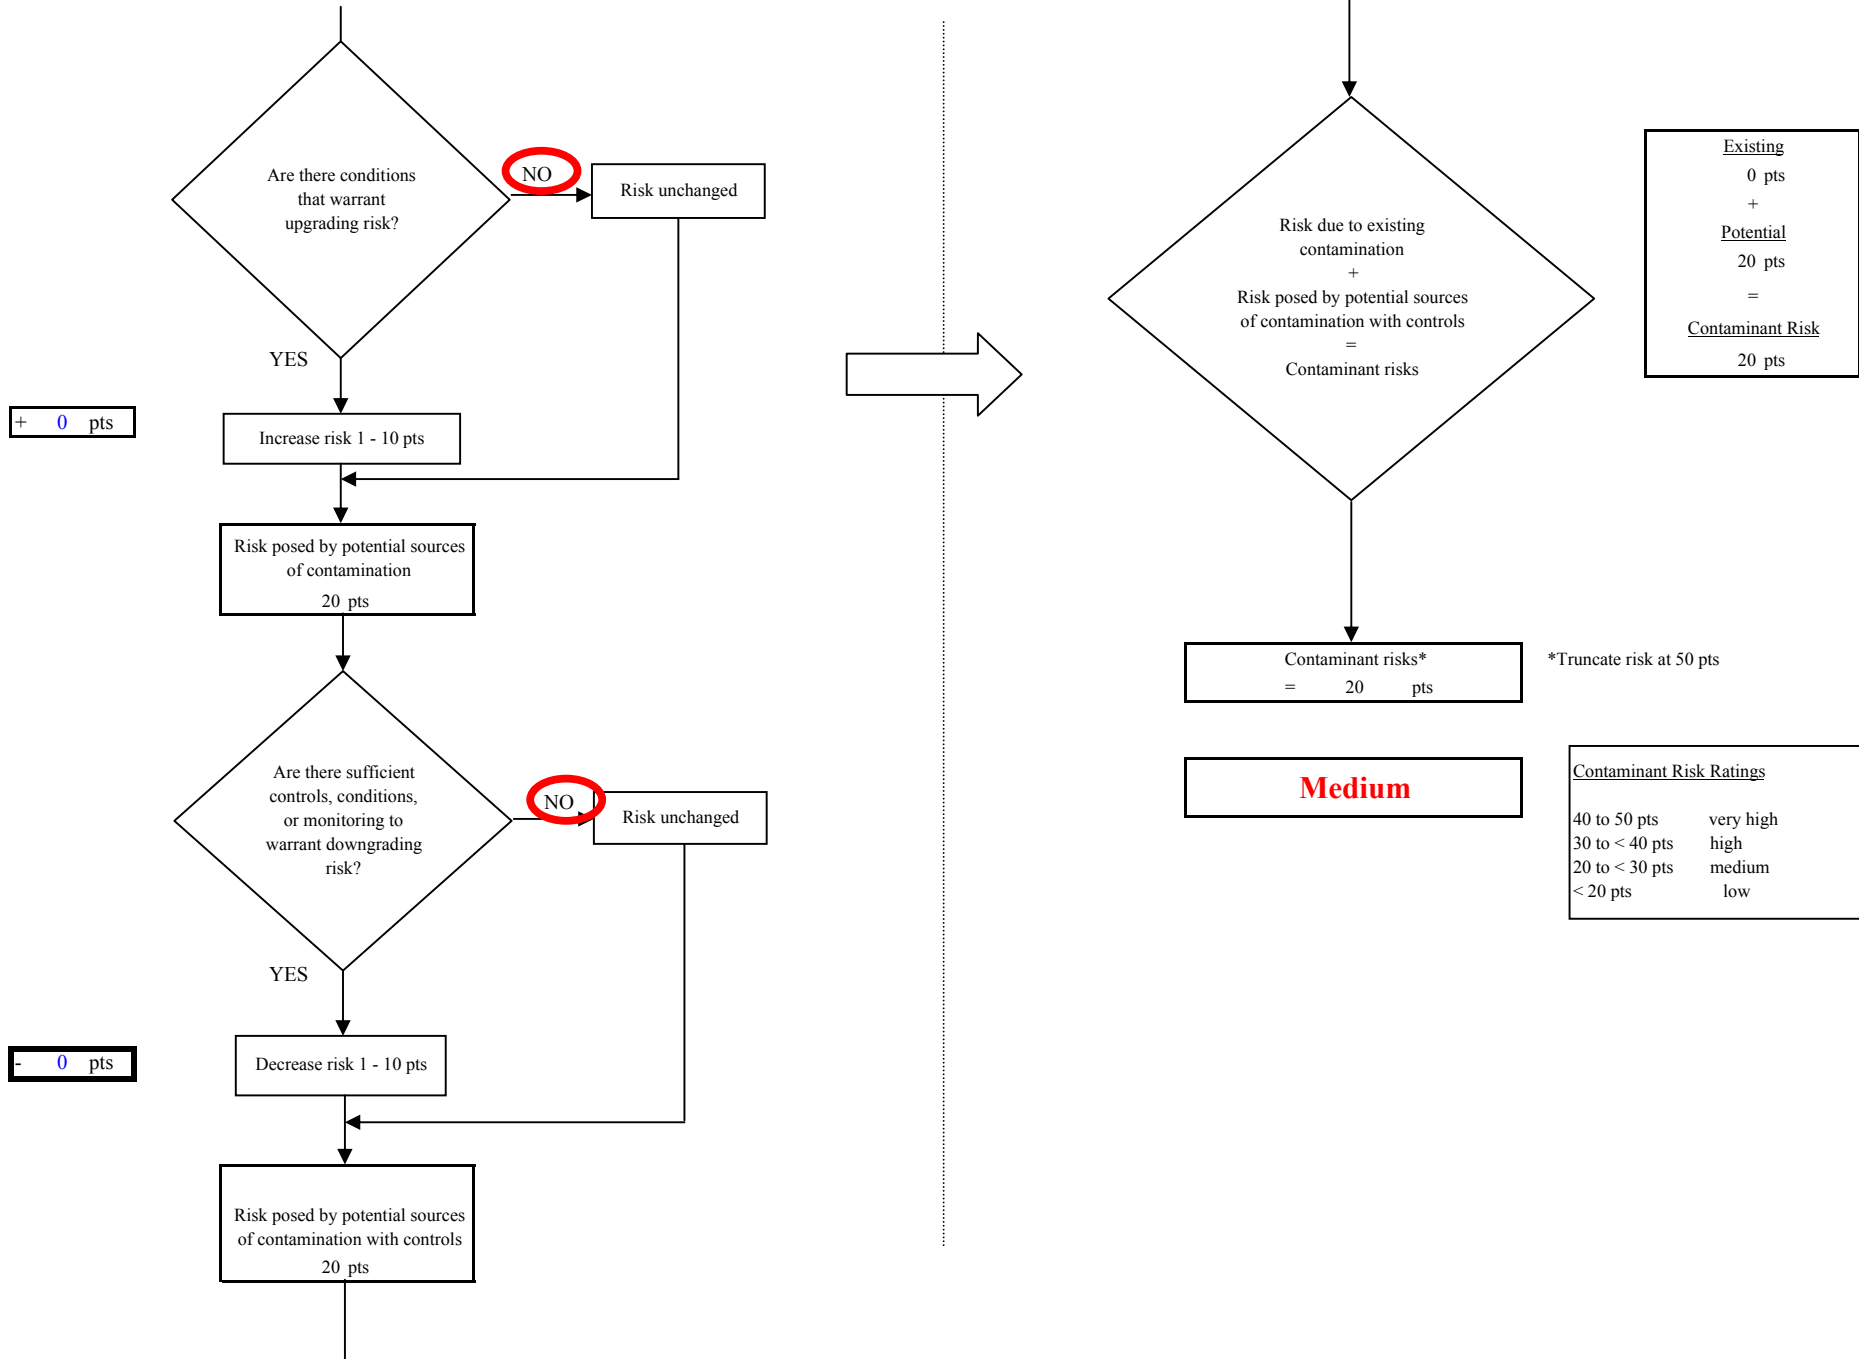


Chart 12. Vulnerability analysis for Ft Wainwright Wells 1032 and 1011 - Synthetic Organic Chemicals

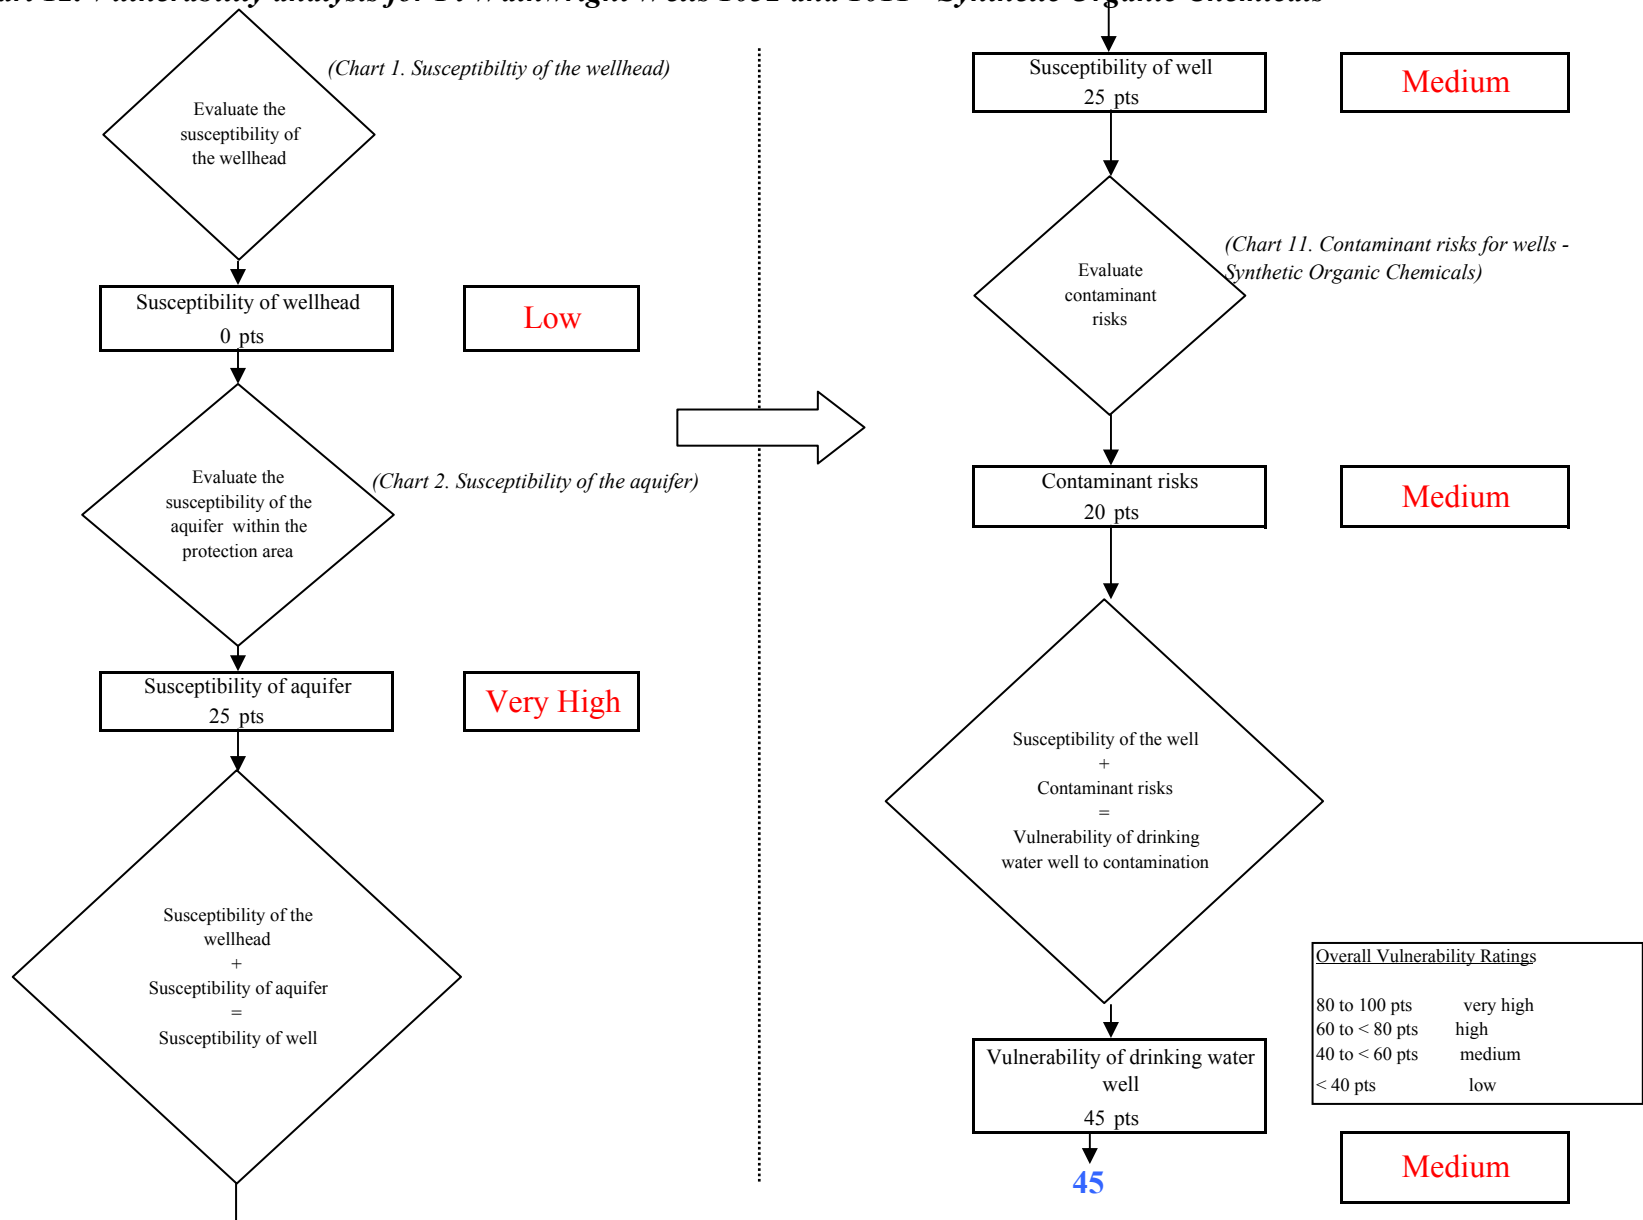


Chart 13. Contaminant risks for Ft Wainwright Wells 1032 and 1011 - Other Organic Chemicals

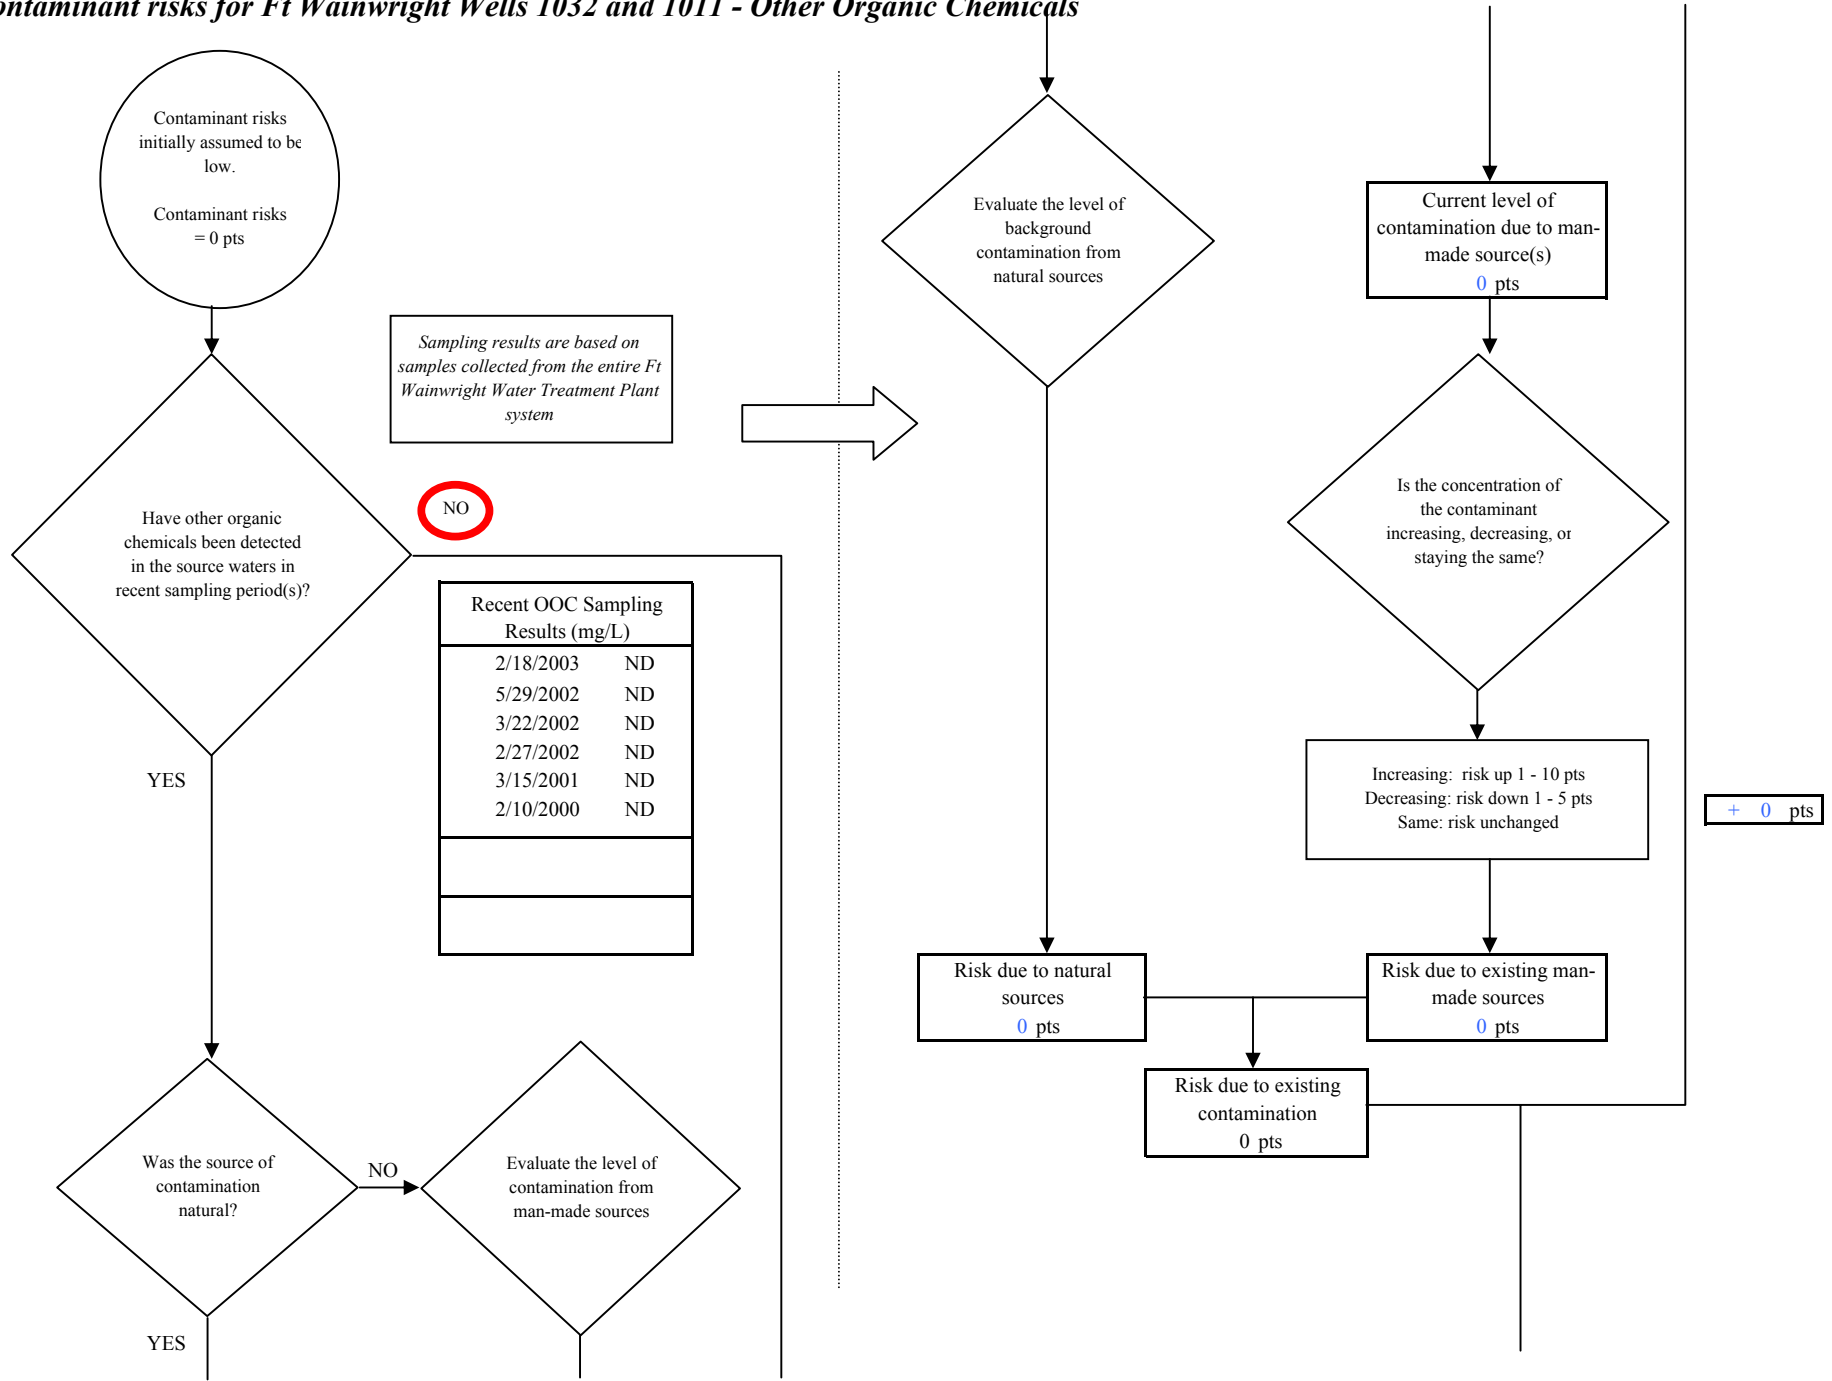


Chart 13. Contaminant risks for Ft Wainwright Wells 1032 and 1011 - Other Organic Chemicals

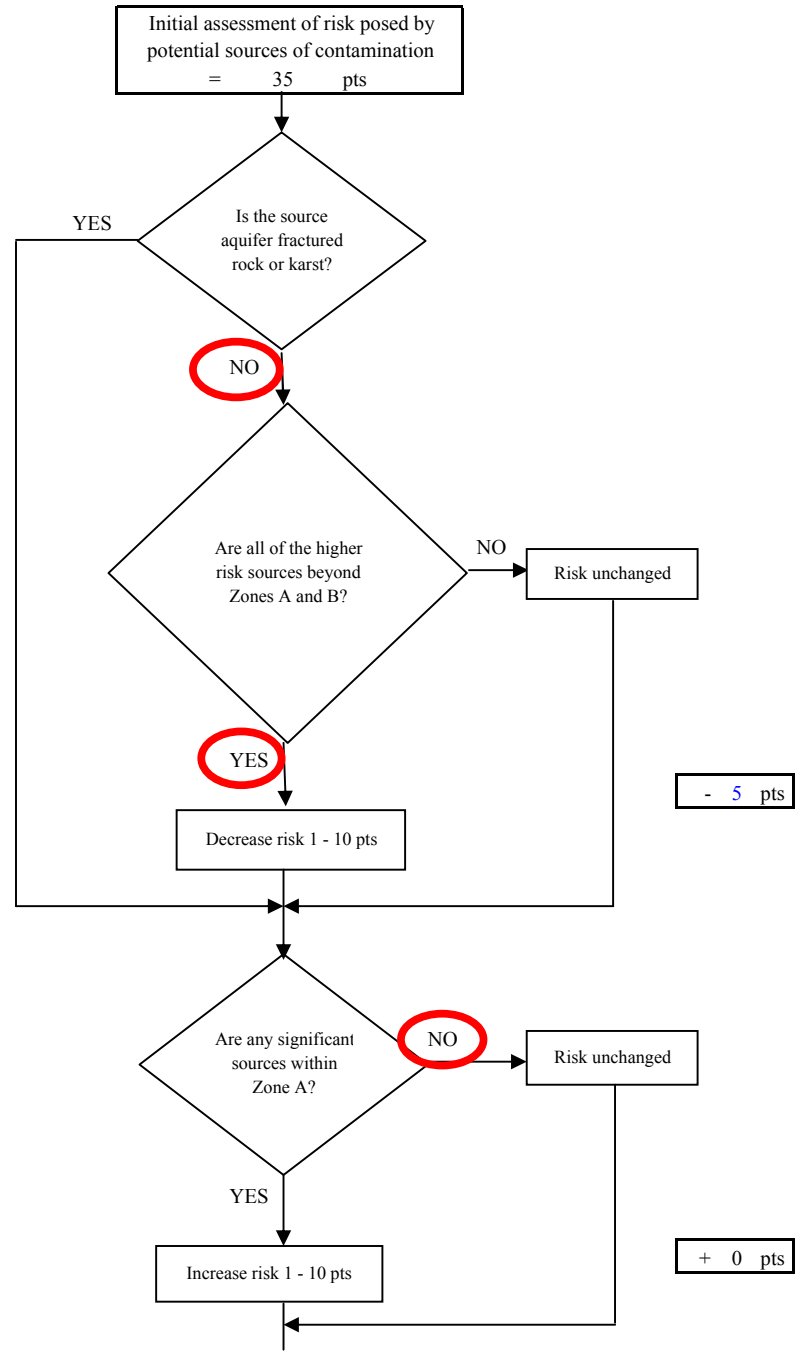
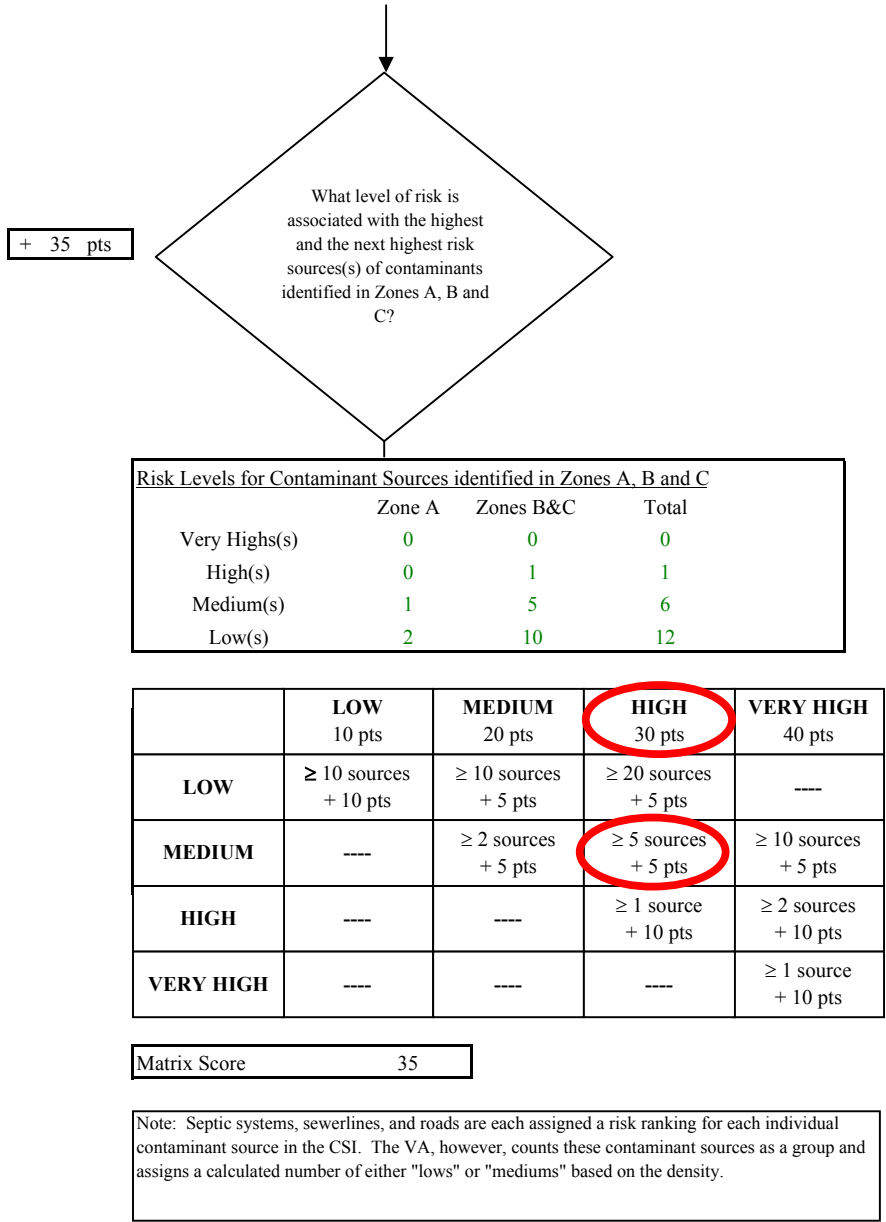


Chart 13. Contaminant risks for Ft Wainwright Wells 1032 and 1011 - Other Organic Chemicals

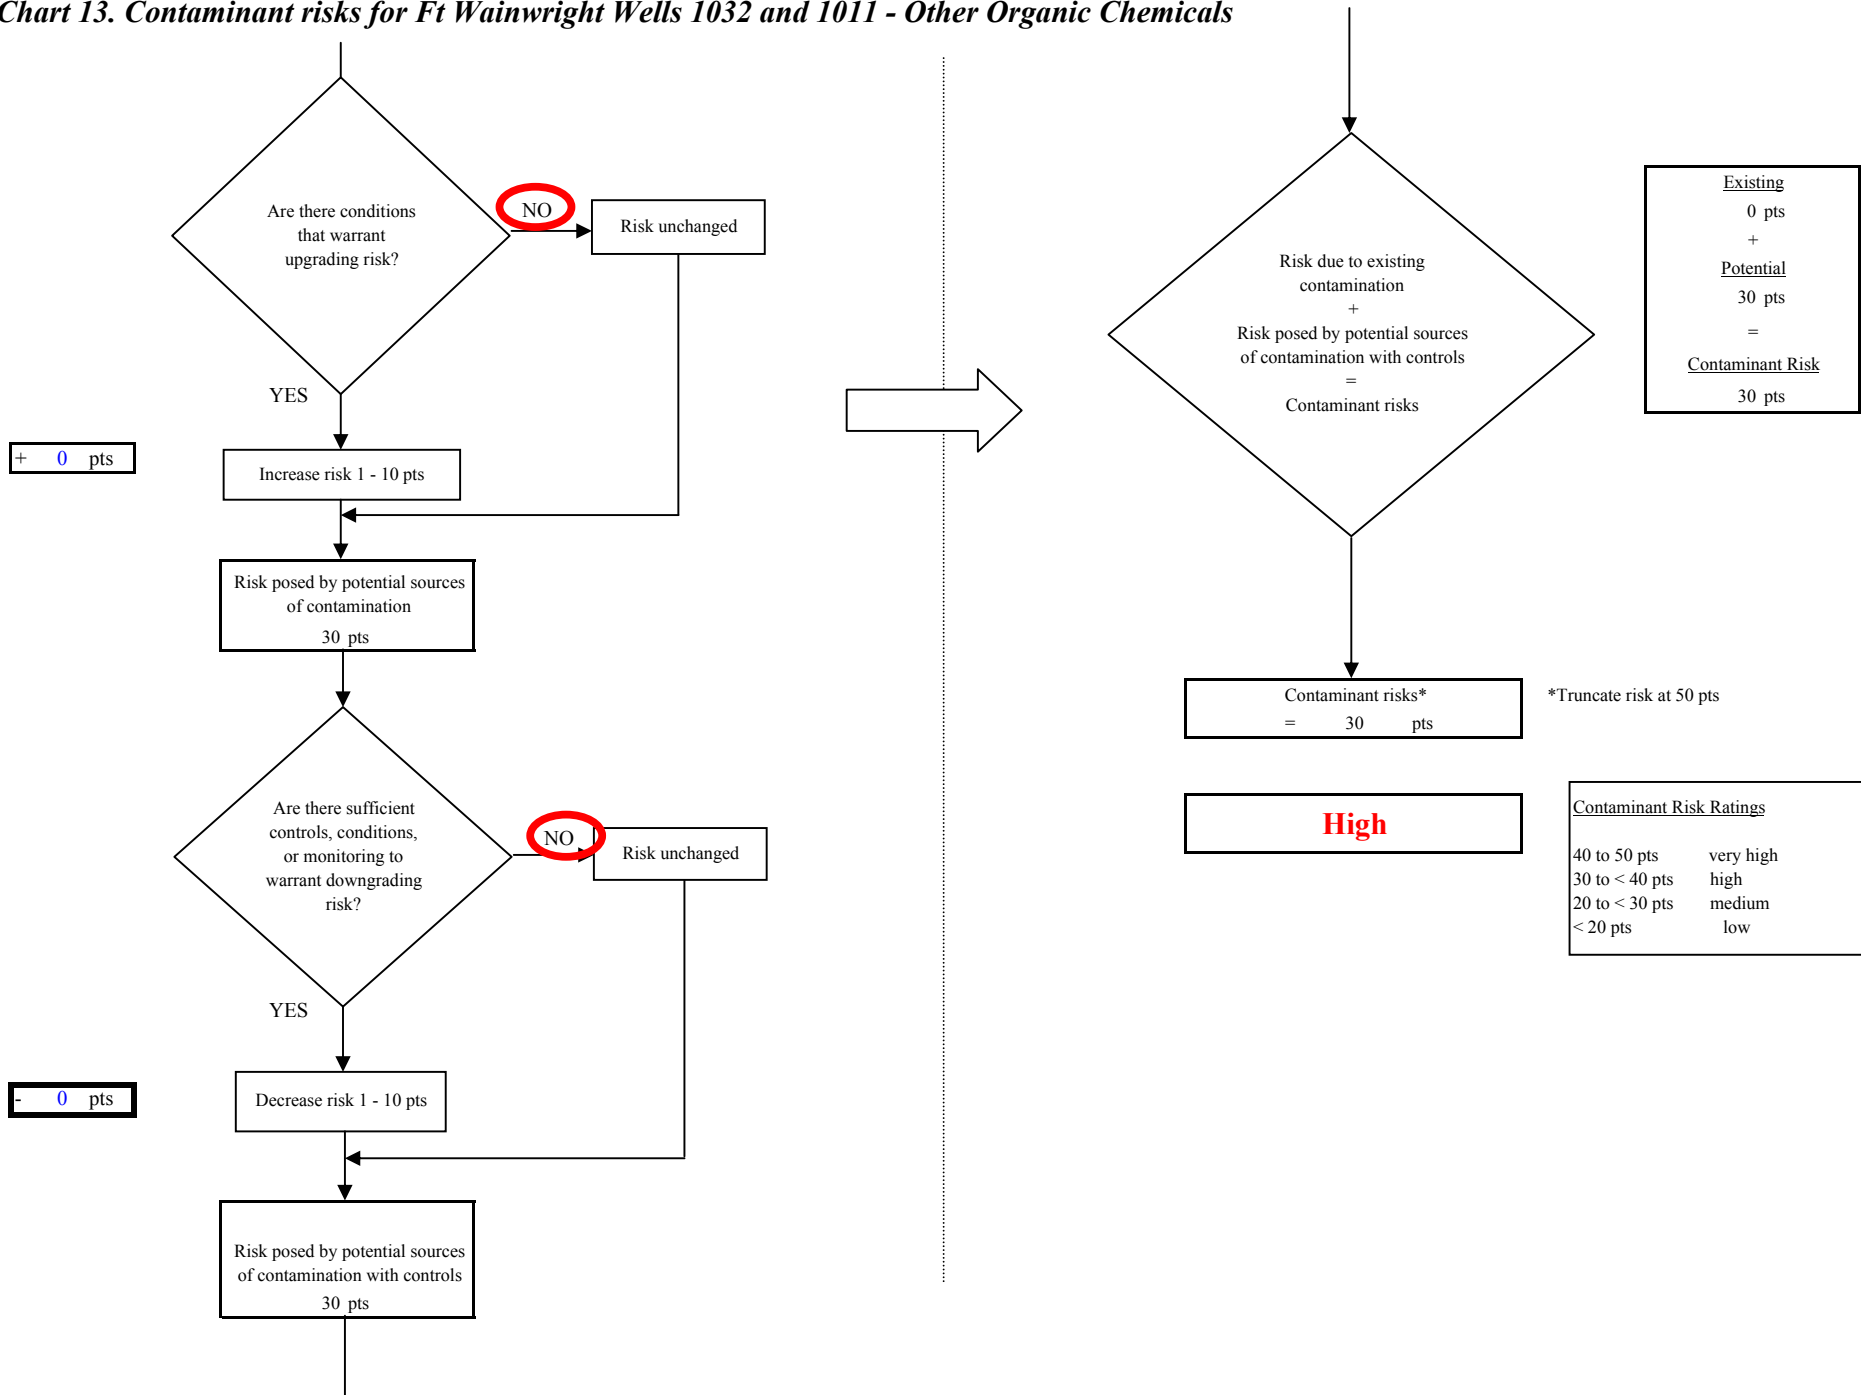


Chart 14. Vulnerability analysis for Ft Wainwright Wells 1032 and 1011 - Other Organic Chemicals

