



Source Water Assessment

A Hydrogeologic Susceptibility and Vulnerability Assessment for the CRSD Glennallen High School Drinking Water System, Glennallen, Alaska

PWSID # 291407.001

June 2004

DRINKING WATER PROTECTION PROGRAM REPORT 1358 Alaska Department of Environmental Conservation

Source Water Assessment for the CRSD Glennallen High School Drinking Water System Glennallen, Alaska

PWSID # 291407.001

DRINKING WATER PROTECTION PROGRAM REPORT 1358

The Drinking Water Protection Program (DWPP) is producing Source Water Assessments in compliance with the Safe Drinking Water Act Amendments of 1996. Each assessment includes a delineation of the source water area, an inventory of potential and existing contaminant sources that may impact the water, a risk ranking for each of these contaminants, and an evaluation of the potential vulnerability of these drinking water sources.

These assessments are intended to provide public water systems owners/operators, communities, and local governments with the best available information that may be used to protect the quality of their drinking water. The assessments combine information obtained from various sources, including the U.S. Environmental Protection Agency, Alaska Department of Environmental Conservation (ADEC), public water system owners/operators, and other public information sources. The results of this assessment are subject to change if additional data becomes available. It is anticipated this assessment will be updated every five years to reflect any changes in the vulnerability and/or susceptibility of public drinking water source. If you have any additional information that may affect the results of this assessment, please contact the Program Coordinator of DWPP, (907) 269-7521.

CONTENTS

| PUBLIC DRIN | KINC | MARY1 B WATER SYSTEM1 R PROTECTION AREA2 | INVENTORY OF POTENTIAL AND EXISTING CONTAMINANT SOURCES | | |
|----------------------------------|------------------|---|--|--|--|
| | | TABI | LES | | |
| Table 2. Susce Table 3. Conta | eptibil amina | itynt Risks | | | |
| | | APPENI | DICES | | |
| APPENDIX A) | A. | CRSD Glennallen High School Publi | c Water System Drinking Water Protection Area (Map | | |
| | В. | Water System – Bacteria and Viruses Contaminant Source Inventory and R Water System – Nitrates/Nitrites (Tak Contaminant Source Inventory and R Water System – Volatile Organic Che Contaminant Source Inventory and R Water System – Heavy Metals, Cyan Contaminant Source Inventory and R Water System – Synthetic Organic Cl | isk Ranking for CRSD Glennallen High School Public (Table 2) isk Ranking for CRSD Glennallen High School Public ole 3) isk Ranking for CRSD Glennallen High School Public emicals (Table 4) isk Ranking for CRSD Glennallen High School Public olde and Other Inorganic Chemicals (Table 5) isk Ranking for CRSD Glennallen High School Public olde isk Ranking for CRSD Glenn | | |
| | C. | CRSD Glennallen High School Publi Potential and Existing Contaminant S | c Water System Drinking Water Protection Area and Sources (Map C) | | |
| | D. | | ant Source Inventory and Risk Ranking for CRSD r System Public Drinking Water Source (Charts 1 – 14) | | |

Source Water Assessment for CRSD Glennallen High School Public Water System Source of Public Drinking Water, Glennallen, Alaska

Drinking Water Protection Program Alaska Department of Environmental Conservation

EXECUTIVE SUMMARY

The Copper River School District (CRSD) Glennallen High School Public Water System (PWS) has one well. The well (PWS No. 291407.001) has been used as a drinking water source since it was drilled in June of 1976.

The well is a Class A (community and non-transient non-community) water system located at Glennallen High School in Glennallen, Alaska. Available records indicate that the system has a 520 gallon storage tank and the water is not treated. This system operates seasonally and serves approximately 208 non-residents through two service connections. The wellhead received a susceptibility rating of **Low** and the aquifer received a susceptibility rating of **Low**. Combining these two ratings produce a **Low** rating for the natural susceptibility of the well.

Identified potential and current sources of contaminants for the public drinking water source include: fuel tanks, a sewage lagoon and a motor vehicle repair shop. A detailed inventory can be found in Table 1 of Appendix B. These identified potential and existing sources of contamination are considered sources of bacteria and viruses, nitrates and/or nitrites, volatile organic chemicals, heavy metals, cyanide and other inorganic chemicals, synthetic organic chemicals, and other organic chemicals contaminant categories.

Overall, the well received a vulnerability rating of **Low** for bacteria and viruses, volatile organic chemicals, heavy metals, cyanide and other inorganic chemicals, synthetic organic chemicals, and other organic chemicals; and **Medium** for nitrates and nitrites.

PUBLIC DRINKING WATER SYSTEM

The CRSD Glennallen High School PWS well is a Class A (community/non-transient/non-community) public water system. The system is located at Glennallen High School in Glennallen, Alaska (Sec. 23, T004N, R002W, Copper River Meridian, see Map A of Appendix A). The community of

Glennallen is located along the Glenn Highway at its junction with the Richardson Highway, 189 road miles east of Anchorage. The community has a population of 574 (ADCED, 2003). Total annual precipitation in Glennallen is 9 inches, including approximately 39 inches of snowfall. Glennallen is located in the continental climate zone, with long, cold winters, and relatively warm summers.

The community of Glennallen obtains most of their water supply from the community water system. Some households have their own wells, but the water if often of poor quality. The majority of households are fully plumbed. Most residents have individual septic tanks, but many are connected to the piped sewage system (ADCED, 2003). Glennallen residents rely on the Copper Valley Electric for electricity, which is hydro-power with diesel as a backup. Refuse collection and the landfill are operated by Copper Basin Sanitation.

According to information supplied by ADEC for the CRSD Glennallen High School PWS, the depth of the well is 188 feet below the ground surface. Based on available well construction details, the well is screened in a confined aquifer. The well is not located within a floodplain.

Information acquired from a December 2002 sanitary survey for the PWS indicated that the land surface was sloped away from the well. Generally, land surfaces that slope away from the wellhead promote surface water drainage, which reduces the potential of contaminant migration down the well casing annulus. The sanitary survey indicates that the well is not grouted according to ADEC regulations. Proper grouting provides added protection against contaminants traveling along the well casing annulus and into source waters.

The Glennallen area is in the southeastern portion of the Copper River basin, in southeastern Interior Alaska. The Copper River basin, ranging from 500 to over 4,000 feet above sea level, is an intermontane basin rimmed by peaks of the Chugach, Alaska, Talkeetna, and Wrangell mountains. The terrain of the basin can be divided into two physiographic sub-

units: the rolling, hummocky Copper River basin piedmont surface, and the Copper River basin trough. The Copper River basin trough is generally flat and lacks the hummocky, rolling character of the piedmont surface (Nichols, 1956).

The terrain, geology of the unconsolidated deposits, and foundation materials of the Copper River basin are related to Pliestocene and recent events. Glaciers from the Chugach, Wrangell, Talkeetna, and Alaska Ranges repeatedly invaded the basin, perhaps at times filling it and flowing across the divides to the north, west, east, and south. Such extensive glaciation has resulted in the deposition o large thicknesses of coarse glacial boulder clays (till) and coarse outwash gravel and sand on the piedmont surface, with finer till and outwash interbedded with lake deposits in the basin trough (Nichols, 1956).

The Glennallen area is within the discontinuous permafrost zone (Nichols, 1956).

Surface soils in the area generally consist of silt and clay with pebbles underlain by boulder clay with till, underlain by glacial outwash sand and gravel, underlain by boulder clay or till (Nichols, 1956).

DRINKING WATER PROTECTION AREA

In order to evaluate whether a drinking water source is at risk, we must first evaluate what are the most likely pathways for surface contamination to reach the groundwater. These areas are determined by looking at the characteristics of the soil, groundwater, aquifer, and well.

The most probable area for contamination to reach the drinking water well is the area that contributes water to the well, the groundwater recharge area. This area is designated as the drinking water protection area (DWPA). Because releases of contaminants within the protection area are most likely to impact the drinking water well, this area will serve as the focus for voluntary protection efforts. An analytical calculation was used to determine the size and shape of the DWPA for the CRSD Glennallen High School PWS. The input parameters describing the attributes of the aquifer in this calculation were adopted from Groundwater (Freeze and Cherry, 1979). Available geology and groundwater contours were also considered to take into account any uncertainties in groundwater flow and aquifer characteristics to arrive at a meaningful protection area.

The protection areas established for wells by the ADEC are usually separated into four zones, limited by the watershed. These zones correspond to differences in the time-of-travel (TOT) of the water moving through the aquifer to the well (Please refer to the Guidance Manual for Class A Public Water Systems for additional information).

The time of travel for contaminants within the water varies and is dependent on the physical and chemical characteristics of each contaminant. The following is a summary of the four protection area zones for wells and the calculated time -of-travel for each:

Table 1. Definition of Zones

| Zone | Definition |
|------|--|
| A | ¹ / ₄ the distance for the 2-yr. time -of-travel |
| В | Less than the 2 year time-of-travel |
| C | Less Than the 5 year time -of-travel |
| D | Less than the 10 year time-of-travel |

The DWPA for the CRSD Glennallen High School PWS was determined using an analytical calculation and includes Zones A, B, C, and D (See Map A of Appendix A).

INVENTORY OF POTENTIAL AND EXISTING CONTAMINANT SOURCES

The Drinking Water Protection Program has completed an inventory of potential and existing sources of contamination within the CRSD Glennallen High School PWS DWPA. This inventory was completed through a search of agency records and other publicly available information. Potential sources of contamination to the drinking water aquifer include a wide range of categories and types. Potential drinking water contaminants are found within agricultural, residential, commercial, and industrial areas, but can also occur within areas that have little or no development.

For the basis of all Class A public water system assessments, six categories of drinking water contaminants were inventoried. They include:

- Bacteria and viruses.
- Nitrates and/or nitrites,
- Volatile organic chemicals,
- Heavy metals, cyanide and other inorganic chemicals.
- Synthetic organic chemicals, and
- Other organic chemicals.

The sources are displayed on Map C of Appendix C and summarized in Table 1 of Appendix B.

RANKING OF CONTAMINANT RISKS

Once the potential and existing sources of contamination have been identified, they are assigned a ranking according to what type and level of risk they represent. Ranking of contaminant risks for a "potential" or "existing" source of contamination is a function of toxicity and volumes of specific contaminants associated with that source. Rankings include:

- Low.
- Medium.
- High, and
- Very High.

The time-of-travel for contaminants within the water varies and is dependent on the physical and chemical characteristics of each contaminant. Bacteria and Viruses are only inventoried in Zones A and B because of their short life span. Only "Very High" and "High" rankings are inventoried within the outer Zone D due to the probability of contaminant dilution by the time the contaminants get to the well. Tables 2 through 7 in Appendix B contain the ranking of potential and existing sources of contamination with respect to bacteria and viruses, nitrates and/or nitrites, volatile organic chemicals, heavy metals, cyanide and other inorganic chemicals, synthetic organic chemicals, and other organic chemicals.

VULNERABILITY OF THE DRINKING WATER SYSTEM

Vulnerability of a drinking water source to contamination is a combination of two factors:

- Natural susceptibility, and
- Contaminant risks.

Appendix D contains fourteen charts, which together form the 'Vulnerability Analysis' for a source water assessment for a public drinking water source. Chart 1 analyzes the 'Susceptibility of the Wellhead' to contamination by looking at the construction of the well and its surrounding area. Chart 2 analyzes the 'Susceptibility of the Aquifer' to contamination by looking at the naturally occurring attributes of the water source and influences on the groundwater system that might lead to contamination. Chart 3 analyzes 'Contaminant Risks' for the drinking water source with respect to bacteria and viruses. The

'Contaminant Risks' portion of the analysis considers potential sources of contaminants as well as a review of contamination that has or may have occurred, but has not arrived or been detected at the well. Chart 4 contains the 'Vulnerability Analysis for Bacteria and Viruses'. Charts 5 through 14 contain the Contaminant Risks and Vulnerability Analyses for nitrates and nitrites, volatile organic chemicals, heavy metals, cyanide and other inorganic chemicals, synthetic organic chemicals, and other organic chemicals, respectively.

A score for the Natural Susceptibility is reached by considering the properties of the well and the aquifer.

Susceptibility of the Wellhead (0 – 25 Points) (Chart 1 of Appendix D)

+

Susceptibility of the Aquifer (0 – 25 Points) (Chart 2 of Appendix D)

=

Natural Susceptibility (Susceptibility of the Well) (0 – 50 Points)

A ranking is assigned for the Natural Susceptibility according to the point score:

| Natural Susceptibility Ratings | | | | | | | | |
|--------------------------------|-----------|--|--|--|--|--|--|--|
| 40 to 50 pts | Very High | | | | | | | |
| 30 to < 40 pts | High | | | | | | | |
| 20 to < 30 pts | Medium | | | | | | | |
| < 20 pts | Low | | | | | | | |

The CRSD Glennallen High School PWS's water well is completed in a confined aquifer. Confined aquifers are less susceptible to potential groundwater quality impacts posed by the migration of surface water contaminants downward from the surface. Table 2 shows the susceptibility scores and ratings for this PWS.

Table 2. Susceptibility

| | Score | Rating |
|------------------------|-------|--------|
| Susceptibility of the | 5 | Low |
| Wellhead | | |
| Susceptibility of the | 8 | Low |
| Aquifer | | |
| Natural Susceptibility | 13 | Low |
| | | |

Contaminant risks to a drinking water source depend on the type, number or density, and distribution of contaminant sources. This score has been derived from an examination of existing and historical contamination that has been detected at the drinking water source through routine sampling. It also evaluates potential sources of contamination. Flow charts are used to assign a point score, and ratings are assigned in the same way as for the natural susceptibility:

| Contaminant Risk Ratings | | | | | | | |
|--------------------------|-----------|--|--|--|--|--|--|
| 40 to 50 pts | Very High | | | | | | |
| 30 to < 40 pts | High | | | | | | |
| 20 to < 30 pts | Medium | | | | | | |
| < 20 pts | Low | | | | | | |

Table 3 summarizes the Contaminant Risks for each category of drinking water contaminants.

Table 3. Contaminant Risks

| Category | Score | Rating |
|--------------------------|---------|--------|
| Bacteria and Viruses | 25 | Medium |
| Nitrates and/or Nitrites | 35 | High |
| Volatile Organic Chemica | ls 25 | Medium |
| Heavy Metals, Cyanide ar | nd | |
| Other Inorganic Chemical | s 12 | Low |
| Synthetic Organic Chemic | cals 12 | Low |
| Other Organic Chemicals | 12 | Low |
| | | |

Finally, an overall vulnerability score is assigned for each water system by combining each of the contaminant risk scores with the natural susceptibility score:

Natural Susceptibility (0 – 50 points)

+

Contaminant Risks (0 – 50 points)

=

Vulnerability of the Drinking Water Source to Contamination (0 – 100).

Again, rankings are assigned according to a point score:

| Overall Vulnerability Ratings | | | | | | | |
|-------------------------------|-----------|--|--|--|--|--|--|
| 80 to 100 pts | Very High | | | | | | |
| 60 to < 80 pts | High | | | | | | |
| 40 to < 60 pts | Medium | | | | | | |
| < 40 pts | Low | | | | | | |

Table 4 contains the overall vulnerability scores (0 – 100) and ratings for each of the six categories of drinking water contaminants. Note: scores are rounded off to the nearest five.

Table 4. Overall Vulnerability

| Category | Score | Rating |
|-----------------------------|-------|--------|
| Bacteria and Viruses | 35 | Low |
| Nitrates and Nitrites | 50 | Medium |
| Volatile Organic Chemicals | 35 | Low |
| Heavy Metals, Cyanide and | | |
| Other Inorganic Chemicals | 25 | Low |
| Synthetic Organic Chemicals | 25 | Low |
| Other Organic Chemicals | 25 | Low |
| | | |

Bacteria and Viruses

The contaminant risk for bacteria and viruses is **Medium**. The risk is primarily attributed to the presence of sewer lines in Zone A. Numerous other potential contaminant sources are also found within the protection area (see Table 2 – Appendix B).

Coliforms (a bacteria) are found naturally in the environment and although they aren't necessarily a health threat, they are an indicator of other potentially harmful bacteria in the water, more specifically, fecal coliforms and E. coli, which only come from human and animal fecal waste. Harmful bacteria can cause diarrhea, cramps, nausea, headaches, or other symptoms (EPA, 2002). Positive samples increase the overall vulnerability of the drinking water source, indicating that the source is susceptible to bacteria and virus contamination.

No positive bacteria counts have been reported in recent (within five years) sampling events (See Chart 3 – Contaminant Risks for Bacteria and Viruses in Appendix D). Only a small amount of bacteria and viruses are required to endanger public health.

After combining the contaminant risk for bacteria and viruses with the natural susceptibility of the well, the overall vulnerability of the well to contamination is **Low**.

Nitrates and Nitrites

The contaminant risk for nitrates and nitrites is **High**. The risk to this source of public drinking water is primarily attributed to the presence of a large capacity sewage system in Zone C. Numerous other potential contaminant sources are also found within the protection area (see Table 3 – Appendix B).

Nitrates are very mobile, moving at approximately the same rate as water. The sampling history for this well indicates that low levels of nitrates have been detected in recent sampling events; however they have not exceeded its MCL of 10 mg/L. Nitrate concentrations in uncontaminated groundwater are typically less than 2 mg/L; therefore, nitrate concentrations above 2 mg/L may be indicative of man-made sources (See Chart 5 - Contaminant Risks for Nitrates and/or Nitrites in Appendix D).

Nitrate levels are often derived from the decomposition of organic matter in soils. Consequently, the presence of nitrate may be attributed to the large-capacity septic system within the vicinity.

After combining the contaminant risk for nitrates and nitrites with the natural susceptibility of the well, the overall vulnerability of the well to nitrate and nitrite contamination is **Medium**.

Volatile Organic Chemicals

The contaminant risk for volatile organic chemicals is **Medium**. The risk is primarily attributed to the presence of diesel tanks in Zone A. Numerous other potential contaminant sources are also found within the protection area (see Table 4 – Appendix B).

No VOCs have been reported in recent (within five years) sampling events (See Chart 7 – Contaminant Risks for Volatile Organic Chemicals in Appendix D).

After combining the contaminant risk for volatile organic chemicals with the natural susceptibility of the well, the overall vulnerability of the well to contamination is **Low**.

Heavy Metals, Cyanide and Other Inorganic Chemicals

The contaminant risk for heavy metals, cyanide and other inorganic chemicals is Low. The risk is primarily attributed to several potential contaminant sources with a low risk ranking in Zone A. Numerous other potential contaminant sources are also found within the protection area (see Table 5 – Appendix B).

Based on review of recent sampling records for this PWS, low levels of lead and copper have been detected, however they have not exceeded their MCLs of .015, and 1.3 mg/L, respectively (see Chart 9 – Contaminant Risks for Heavy Metals, Cyanide, and Other Inorganic Chemicals in Appendix D).

The reported concentrations of copper and lead are likely attributed to the water treatment/conveyance system.

After combining the contaminant risk for heavy metals, cyanide and other inorganic chemicals with the natural susceptibility of the well, the overall vulnerability of the well to contamination is **Low**.

Synthetic Organic Chemicals

The contaminant risk for synthetic organic chemicals is **Low**. The risk is primarily attributed only one known potential contaminant with a low risk ranking (see Table 6 – Appendix B).

No recent sampling data was available in ADEC records for the CRSD Glennallen High School PWS (See Chart 11 – Contaminant Risks for Synthetic Organic Chemicals in Appendix D).

After combining the contaminant risk for synthetic organic chemicals with the natural susceptibility of the well, the overall vulnerability of the well to contamination is **Low**.

Other Organic Chemicals

The contaminant risk for other organic chemicals is **Low**. The risk is primarily attributed to the presence several potential contaminant sources with only a low risk ranking (see Table 7 – Appendix B).

No recent sampling data was available in ADEC records for the CRSD Glennallen High School PWS (See Chart 13 – Contaminant Risks for Other Organic Chemicals in Appendix D).

After combining the contaminant risk for other organic chemicals with the natural susceptibility of the well, the overall vulnerability of the well to contamination is **Low**.

Using the Source Water Assessment

This assessment of contaminant risks can be used as a foundation for local voluntary protection efforts as well as a basis for the continuous efforts on the part of the community of Glennallen to protect public health. It is anticipated that Source Water Assessments will be updated every five years to reflect any changes in the vulnerability and/or susceptibility of the drinking water source.

REFERENCES

- Alaska Department of Community and Economic Development (ADCED), 2003 [WWW document]. URL: http://www.dced.state.ak.us/cbd/commdb/CF COMDB.htm
- Alaska Department of Environmental Conservation, Contaminated Sites Database, 2003 [WWW database], URL http://www.state.ak.us/dec/dspar/csites/cs_search.htm
- Alaska Department of Environmental Conservation, Leaking Underground Storage Tank Database, 2003 [WWW database], URL http://www.dec.state.ak.us/spar/stp/ust/search/fac_search.asp
- Freeze, R. A., and Cherry, J.A. 1979, Groundwater, Prentice-Hall, Englewood Cliffs, New Jersey
- Nichols, Donald R, 1956. Information from Permafrost and Groundwater Conditions in the Glennallen area, Alaska, Open File Report 56-91, U.S. Geological Survey.
- United States Environmental Protection Agency (EPA), 2002 [WWW document]. URL http://www.epa.gov/safewater/mcl.html.
- United States Environmental Protection Agency, Office of Water. Retrieved February 2002. [WWW document]. URL http://www.epa.gov/safewater/hfacts.html

APPENDIX A

Drinking Water Protection Area Location Map (Map A)

APPENDIX B


Contaminant Source Inventory and Risk Ranking (Tables 1-7)

APPENDIX C

Drinking Water Protection Area and Potential and Existing Contaminant Sources (Map C)

APPENDIX D

Vulnerability Analysis for Public Drinking Water Source (Charts 1-14)

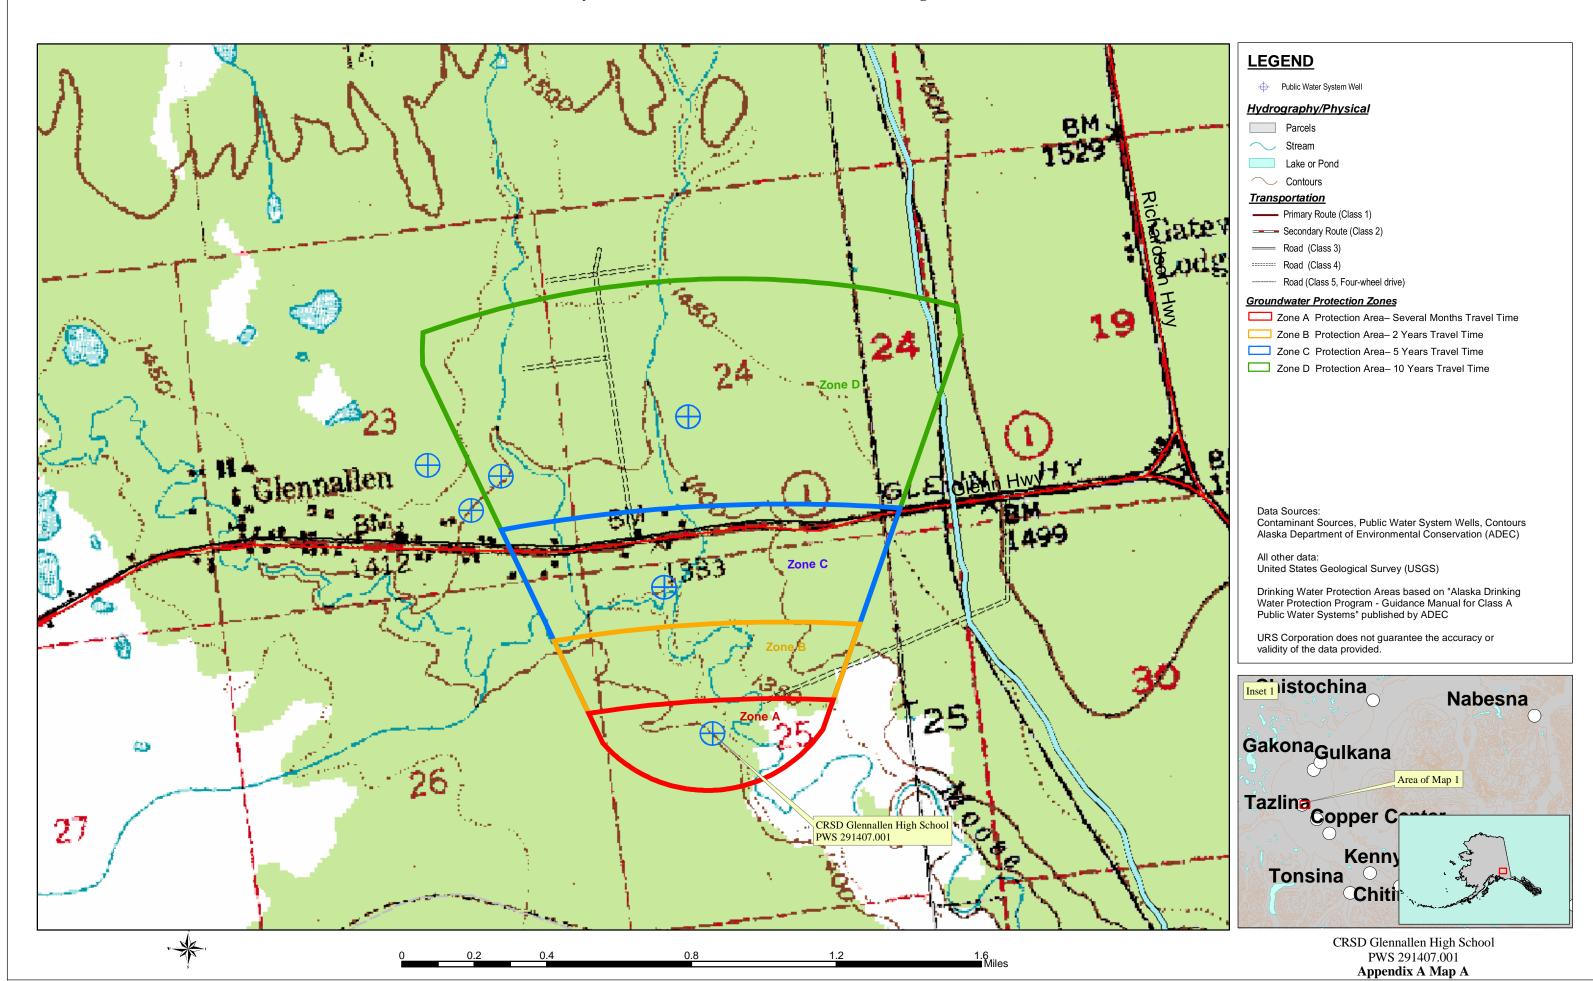

Contaminant Source Inventory for CRSD Glennallen High School

PWSID 291407.001

| Contaminant Source Type | Contaminant Source ID | CS ID tag | Zone | Map Number | Comments |
|---|--------------------------|-----------|------|------------|--|
| Motor/motor vehicle supplies stores | C28 | C28-01 | A | С | Auto supply store assumed in Zone A (indicated through communication with well owner) $$ |
| Domestic wastewater collection systems (sewer lines or lift stations) | D01 | D01-01 | A | С | Assume wastewater collection in Zone A |
| Tanks, diesel (above ground) | T06 | T06-01 | A | С | $2,\!000$ gallon diesel tank in Zone A (indicated through communication with well owner) |
| Tanks, heating oil, nonresidential (aboveground) | T14 | T14-02 | A | С | Assume nonresidential heating oil tank in Zone A |
| Highways and roads, dirt/gravel | X24 | X24-01 | A | С | Assume 1-20 roads in Zone A |
| Highways and roads, dirt/gravel | X24 | X24-02 | В | С | Assume 1-20 roads in Zone B |
| Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method) | D10 | D10-01 | С | С | SEPTIC SYSTEM (DRAINFIELD DISPOSAL) |
| Highways and roads, dirt/gravel | X24 | X24-03 | C | С | Assume 1-20 roads in Zone C |
| Tanks, heating oil, nonresidential (aboveground) | T14 | T14-01 | D | С | |
| Pipelines (oil and gas) | X28 | X28-01 | D | С | Pipeline (oil and gas) |

Table 2

Contaminant Source Inventory and Risk Ranking for CRSD Glennallen High School Sources of Bacteria and Viruses

| Contaminant Source Type | Contaminant Source ID | CS ID tag | Zone | Risk Ranking for Analysis | Map Number | Comments |
|---|--------------------------|-----------|------|------------------------------|---------------|--|
| Domestic wastewater collection systems (sewer lines or lift stations) | D01 | D01-01 | A | Medium | С | Assume wastewater collection in Zone A |
| Highways and roads, dirt/gravel | X24 | X24-01 | A | Low | С | Assume 1-20 roads in Zone A |
| Highways and roads, dirt/gravel | X24 | X24-02 | В | Low | С | Assume 1-20 roads in Zone B |

Table 3

Contaminant Source Inventory and Risk Ranking for CRSD Glennallen High School Sources of Nitrates/Nitrites

| Contaminant Source Type | Contaminant Source ID | CS ID tag | Zone | Risk Ranking for Analysis | Map Number | Comments |
|--|--------------------------|-----------|------|------------------------------|---------------|--|
| Domestic wastewater collection systems (sewer lines or lift stations) | D01 | D01-01 | A | Medium | С | Assume wastewater collection in Zone A |
| Highways and roads, dirt/gravel | X24 | X24-01 | A | Low | С | Assume 1-20 roads in Zone A |
| Highways and roads, dirt/gravel | X24 | X24-02 | В | Low | С | Assume 1-20 roads in Zone B |
| Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method) | D10 | D10-01 | С | High | С | SEPTIC SYSTEM (DRAINFIELD DISPOSAL) |
| Highways and roads, dirt/gravel | X24 | X24-03 | С | Low | С | Assume 1-20 roads in Zone C |

PWSID 291407.001

Table 4

Contaminant Source Inventory and Risk Ranking for CRSD Glennallen High School Sources of Volatile Organic Chemicals

| Contaminant Source Type | Contaminant Source ID | CS ID tag | Zone | Risk Ranking for Analysis | Map Number | Comments |
|---|--------------------------|-----------|------|------------------------------|---------------|---|
| Motor/motor vehicle supplies stores | C28 | C28-01 | A | Low | С | Auto supply store assumed in Zone A (indicated through communication with well owner) |
| Domestic wastewater collection systems (sewer lines or lift stations) | D01 | D01-01 | A | Low | С | Assume wastewater collection in Zone A |
| Tanks, diesel (above ground) | T06 | T06-01 | A | Medium | С | 2,000 gallon diesel tank in Zone A (indicated through communication with well owner) |
| Tanks, heating oil, nonresidential (aboveground) | T14 | T14-02 | A | Low | С | Assume nonresidential heating oil tank in Zone A |
| Highways and roads, dirt/gravel | X24 | X24-01 | A | Low | С | Assume 1-20 roads in Zone A |
| Highways and roads, dirt/gravel | X24 | X24-02 | В | Low | С | Assume 1-20 roads in Zone B |
| Highways and roads, dirt/gravel | X24 | X24-03 | С | Low | С | Assume 1-20 roads in Zone C |
| Pipelines (oil and gas) | X28 | X28-01 | D | Medium | С | Pipeline (oil and gas) |

Table 5

Contaminant Source Inventory and Risk Ranking for CRSD Glennallen High School Sources of Heavy Metals, Cyanide and Other Inorganic Chemicals

| Contaminant Source Type | Contaminant Source ID | CS ID tag | Zone | Risk Ranking for Analysis | Map Number | Comments |
|---|--------------------------|-----------|------|------------------------------|---------------|---|
| Motor/motor vehicle supplies stores | C28 | C28-01 | A | Low | С | Auto supply store assumed in Zone A (indicated through communication with well owner) |
| Domestic wastewater collection systems (sewer lines or lift stations) | D01 | D01-01 | A | Low | С | Assume wastewater collection in Zone A |
| Tanks, heating oil, nonresidential (aboveground) | T14 | T14-02 | A | Low | С | Assume nonresidential heating oil tank in Zone A |
| Highways and roads, dirt/gravel | X24 | X24-01 | A | Low | С | Assume 1-20 roads in Zone A |
| Highways and roads, dirt/gravel | X24 | X24-02 | В | Low | С | Assume 1-20 roads in Zone B |
| Highways and roads, dirt/gravel | X24 | X24-03 | С | Low | С | Assume 1-20 roads in Zone C |
| Pipelines (oil and gas) | X28 | X28-01 | D | Low | С | Pipeline (oil and gas) |

PWSID 291407.001

Table 6

Contaminant Source Inventory and Risk Ranking for CRSD Glennallen High School Sources of Synthetic Organic Chemicals


| Contaminant Source Type | Contaminant Source ID | CS ID tag | Zone | Risk Ranking for Analysis | Map Number | Comments |
|---|--------------------------|-----------|------|------------------------------|---------------|--|
| Domestic wastewater collection systems (sewer lines or lift stations) | D01 | D01-01 | A | Low | С | Assume wastewater collection in Zone A |

Table 7

Contaminant Source Inventory and Risk Ranking for CRSD Glennallen High School Sources of Other Organic Chemicals

| Contaminant Source Type | Contaminant Source ID | CS ID tag | Zone | Risk Ranking for Analysis | Map Number | Comments |
|---|--------------------------|-----------|------|------------------------------|---------------|--|
| Domestic wastewater collection systems (sewer lines or lift stations) | D01 | D01-01 | A | Low | С | Assume wastewater collection in Zone A |
| Highways and roads, dirt/gravel | X24 | X24-01 | A | Low | С | Assume 1-20 roads in Zone A |
| Highways and roads, dirt/gravel | X24 | X24-02 | В | Low | С | Assume 1-20 roads in Zone B |
| Highways and roads, dirt/gravel | X24 | X24-03 | С | Low | С | Assume 1-20 roads in Zone C |
| Pipelines (oil and gas) | X28 | X28-01 | D | High | С | Pipeline (oil and gas) |

Public Water Well System for PWS #291407.001 CRSD Glennallen High School Potential and Existing Sources of Contamination

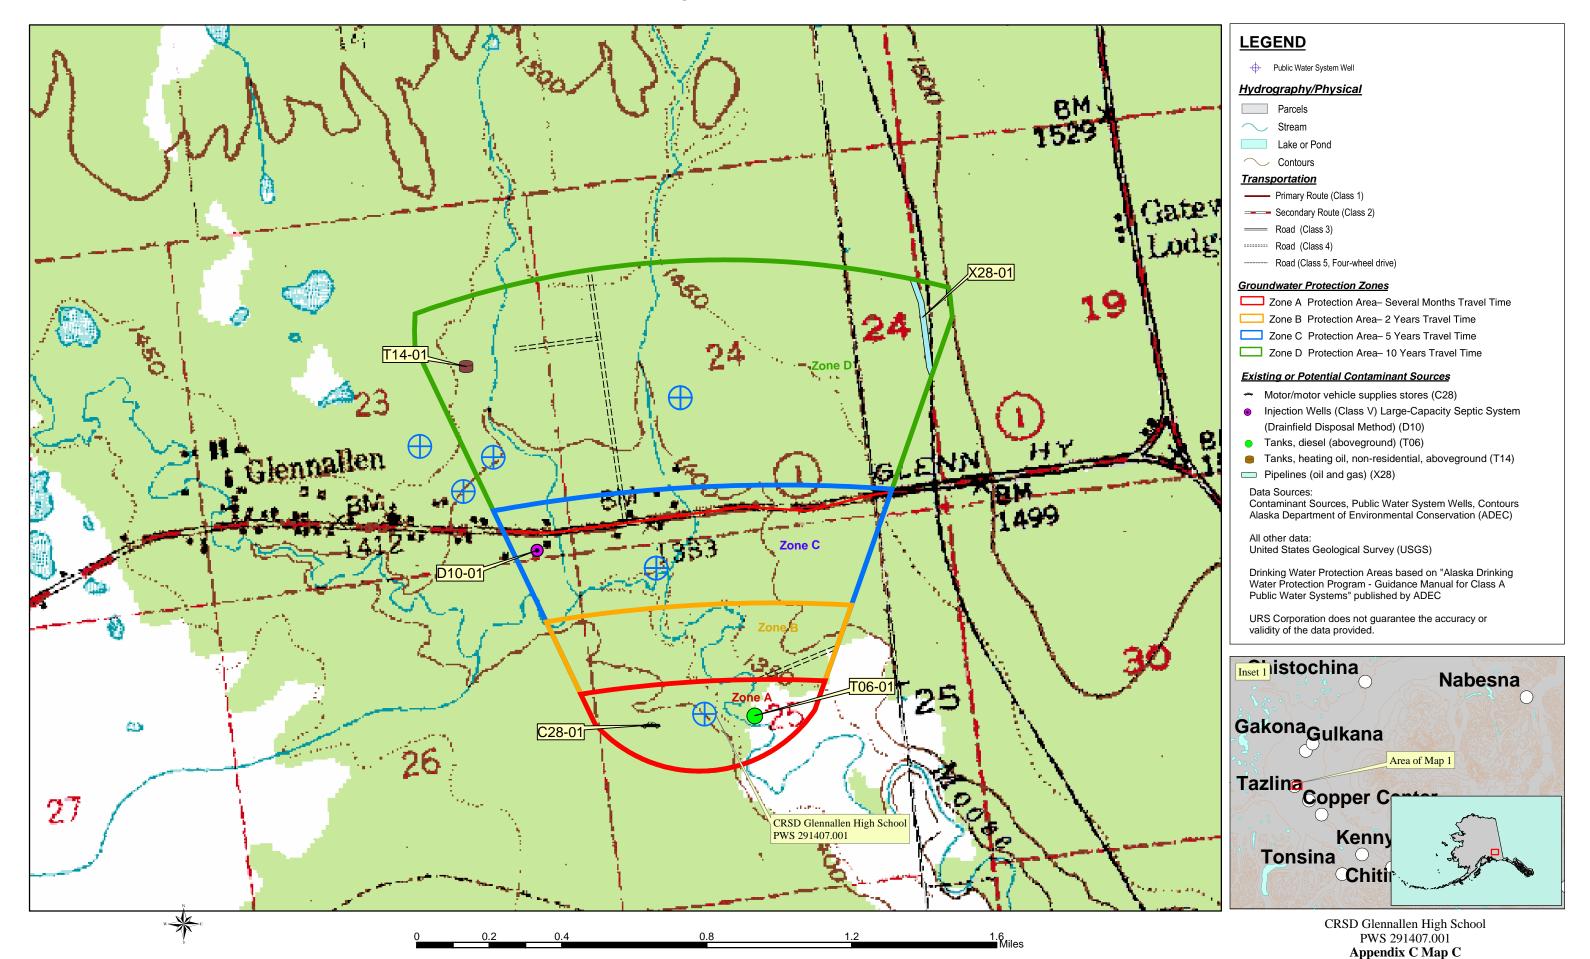

Susceptibility initially assumed to be low. Susceptibility of wellhead = 0 ptsUnknown if well is properly grouted; however, it is assumed well is not grouted based on date of well construction (1976). NO Is the well Increase susceptibility 5 pts + 5 pts properly grouted? Is the well Increase susceptibility 20 pts + 0 pts capped? YES YES Susceptibility of wellhead Low 5 pts Increase susceptibility: YES Is the well 10 pts: suspected floodplain 0 pts within a Wellhead Susceptibility Ratings 20 pts: known floodplain floodplain? 20 to 25 pts very high 15 to < 20 pts high 10 to < 15 pts medium NO < 10 pts Is the land surface sloped Increase susceptibility 5 pts 0 pts away from the well?

Chart 1. Susceptibility of the wellhead - CRSD Glennallen High School (PWS No. 291407.001)

Chart 2. Susceptibility of the aquifer CRSD Glennallen High School (PWS No. 291407.001)

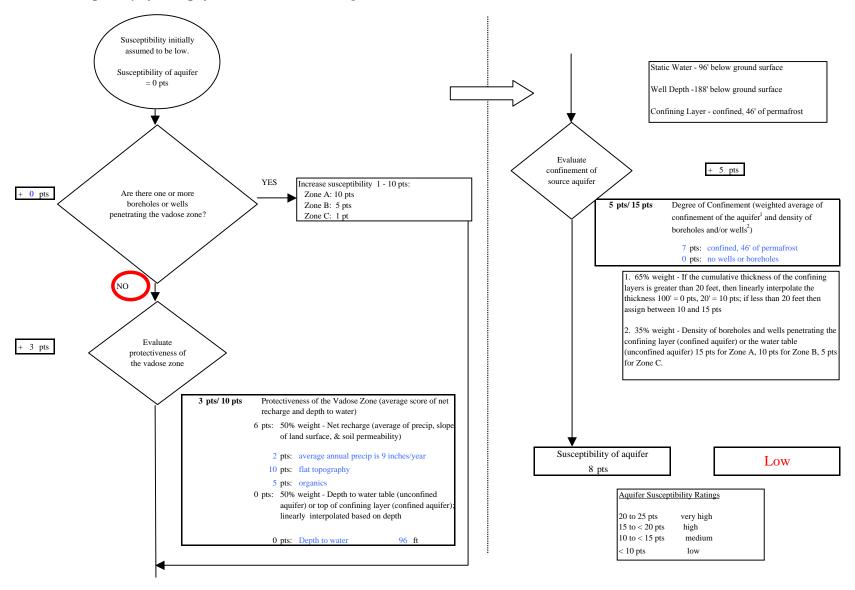


Chart 3. Contaminant risks for CRSD Glennallen High School (PWS No. 291407.001) - Bacteria & Viruses

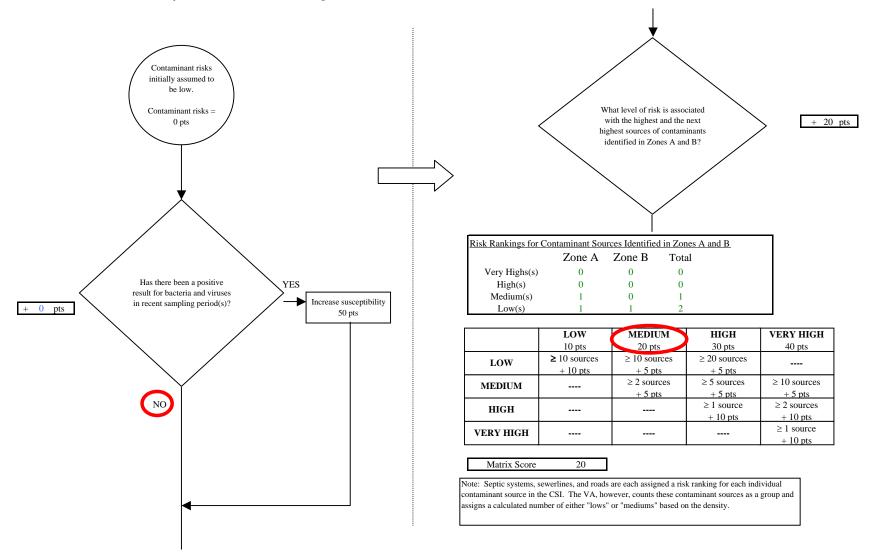


Chart 3. Contaminant risks for CRSD Glennallen High School (PWS No. 291407.001) - Bacteria & Viruses NO Are there sufficient Initial assessment of risk posed by Risk unchanged controls, conditions, or potential sources of contamination monitoring to warrant = 20 pts downgrading risk? Are any YES significant contaminant Risk unchanged Reduce risk 1 - 10 pts sources within 0 pts Zone A? The number and magnitude of Risk posed by potential sources of contaminant sources in YES contamination with controls Zone A determines a risk increase. See Table 2 for Increase risk 1 - 10 pts + 5 pts inventory. Existing Risk due to existing 0 pts contamination Are there any conditions that Risk unchanged Risk posed by potential sources warrant upgrading Potential Potential of contamination with controls 25 pts Contaminant risks Contaminant Risk YES 25 pts Increase risk 1 - 10 pts + 0 pts Contaminant risks* * Truncate risk at 50 pts 25 Contaminant Risk Ratings Risk posed by potential sources of contamination 40 to 50 pts very high 30 to < 40 pts high Medium 20 to < 30 pts

Page 4 of 25

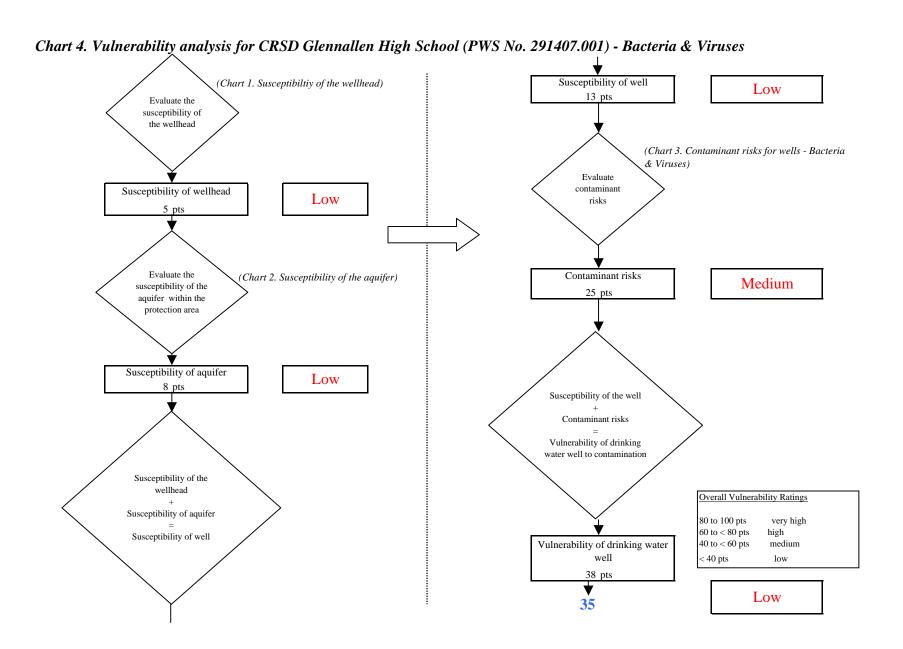
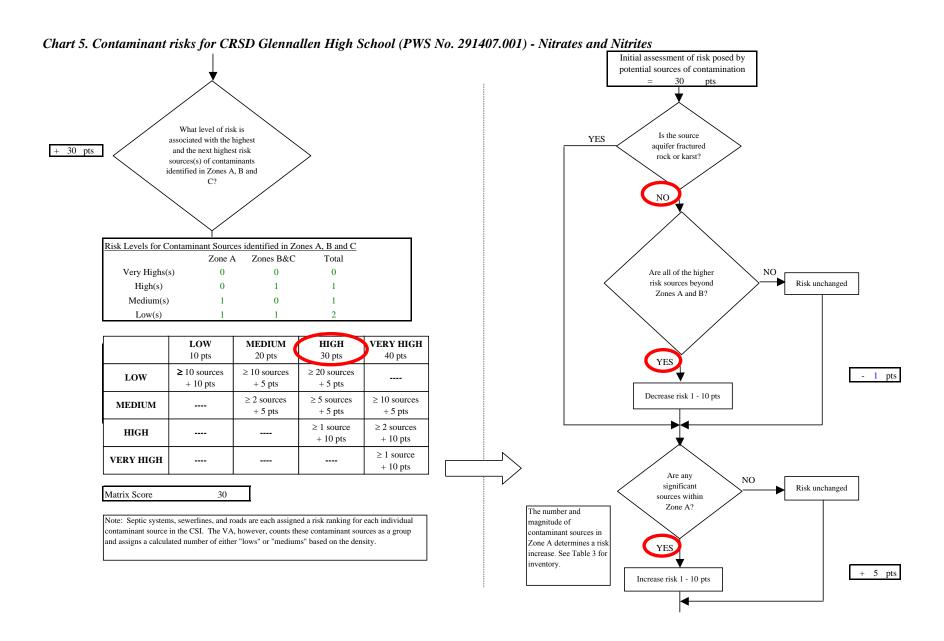


Chart 5. Contaminant risks for CRSD Glennallen High School (PWS No. 291407.001) - Nitrates and Nitrites Contaminant risks initially assumed to be low. Current level of Evaluate the level of Contaminant risks contamination due to manbackground = 0 ptscontamination from made source(s) natural sources 0 pts Is the concentration of Has nitrates and/or the contaminant NO nitrites been detected in increasing, decreasing, the source waters in or staying the same? recent sampling period(s)? Recent Nitrate Sampling Results (mg/L) 8/26/2003 12/17/2001 0 The nitrate concentration is 10/19/2001 0.273 assumed to be natural if less 9/19/2000 0 than 2 mg/L (20%), or YES Increasing: risk up 1 - 10 pts 8/31/1999 0 attributed to man made Decreasing: risk down 1 - 5 pts sources if greater than 2 10/26/1998 0 + 0 pts Same: risk unchanged mg/L. Maximum Contaminant Level (MCL) = 10 mg/LDetected Nitrate Level = Existing contamination points based on Risk due to existing man-Risk due to natural linear interpolation of most recent detect made sources sources [MCL = 50 pts; detect = 0 pts]1 pts 0 pts Risk due to existing contamination 1 pts Was the source of Evaluate the level of NO. contamination contamination from natural? man-made sources YES





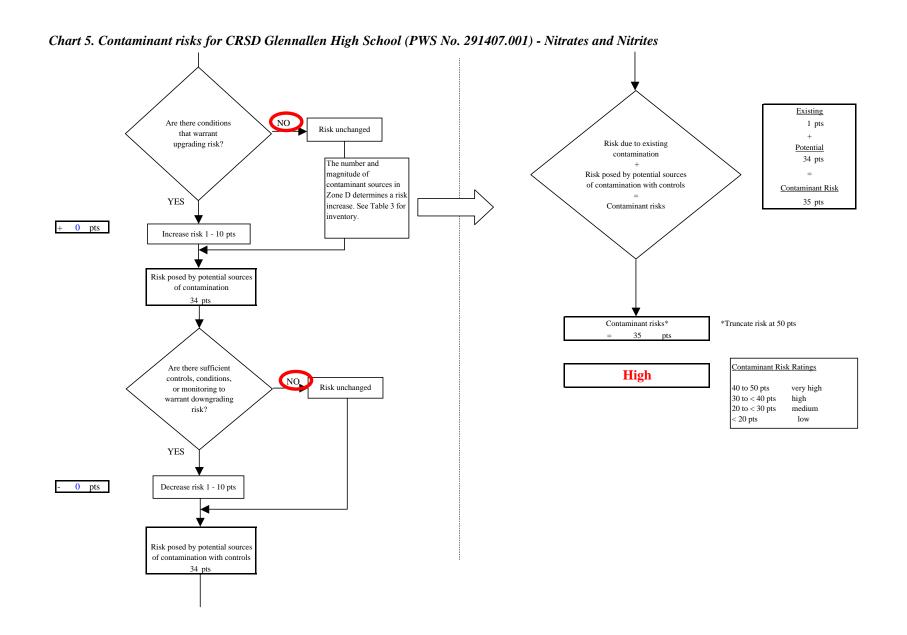


Chart 6. Vulnerability analysis for CRSD Glennallen High School (PWS No. 291407.001) - Nitrates and Nitrites Susceptibility of well (Chart 1. Susceptibiltiy of the wellhead) Low 13 pts Evaluate the susceptibility of the wellhead (Chart 5. Contaminant risks for wells - Nitrates and Nitrites) Evaluate contaminant Susceptibility of wellhead Low risks 5 pts Evaluate the Contaminant risks (Chart 2. Susceptibility of the aquifer) High susceptibility of the 35 pts aquifer within the protection area Susceptibility of aquifer Low Susceptibility of the well Contaminant risks Vulnerability of drinking water well to contamination Susceptibility of the wellhead Overall Vulnerability Ratings Susceptibility of aquifer 80 to 100 pts very high 60 to < 80 pts high Susceptibility of well Vulnerability of drinking water 40 to < 60 pts medium well < 40 pts low 48 pts Medium **50**



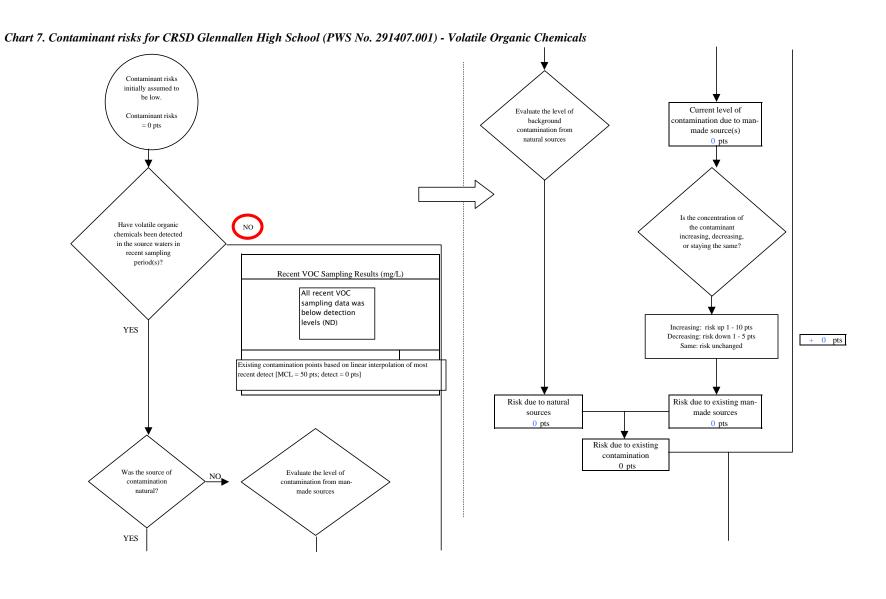




| | Zone A | Zones B&C | Total |
|--------------|--------|-----------|-------|
| ery Highs(s) | 0 | 0 | 0 |
| High(s) | 0 | 0 | 0 |
| Medium(s) | 1 | 0 | 1 |
| Low(s) | 4 | 1 | 5 |

| | LOW 10 pts | MEDIUM 20 pts | HIGH 30 pts | VERY HIGH 40 pts |
|-----------|--------------------------|-------------------------|-------------------------|-------------------------|
| LOW | ≥ 10 sources + 10 pts | ≥ 10 sources + 5 pts | ≥ 20 sources + 5 pts | |
| MEDIUM | | ≥ 2 sources + 5 pts | ≥ 5 sources + 5 pts | ≥ 10 sources + 5 pts |
| HIGH | | | ≥ 1 source + 10 pts | ≥ 2 sources + 10 pts |
| VERY HIGH | | | | ≥ 1 source + 10 pts |

Matrix Score 20

Note: Septic systems, sewerlines, and roads are each assigned a risk ranking for each individual contaminant source in the CSI. The VA, however, counts these contaminant sources as a group and assigns a calculated number of either "lows" or "mediums" based on the density.

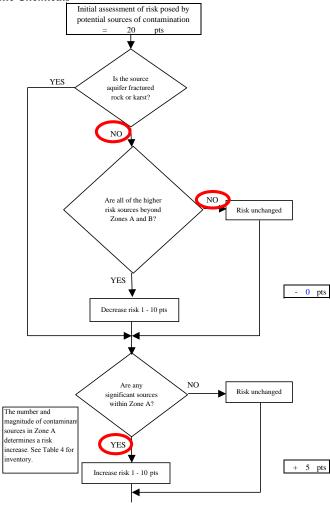


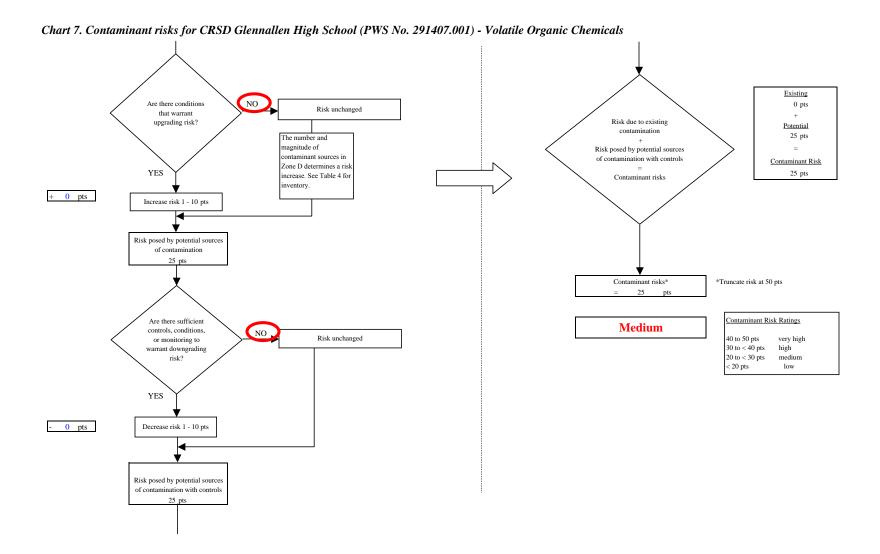


Chart 8. Vulnerability analysis for CRSD Glennallen High School (PWS No. 291407.001) - Volatile Organic Chemicals Susceptibility of well (Chart 1. Susceptibiltiy of the wellhead) Low 13 pts Evaluate the susceptibility of the wellhead (Chart 7. Contaminant risks for wells - Volatile Organic Chemicals) Evaluate contaminant Susceptibility of wellhead Low risks Evaluate the Contaminant risks (Chart 2. Susceptibility of the aquifer) Medium susceptibility of the 25 pts aquifer within the protection area Susceptibility of aquifer Low Susceptibility of the well Contaminant risks Vulnerability of drinking water well to contamination Susceptibility of the wellhead Overall Vulnerability Ratings Susceptibility of aquifer 80 to 100 pts very high 60 to < 80 pts high Susceptibility of well Vulnerability of drinking water 40 to < 60 pts medium well < 40 pts low 38 pts Low **35**

Page 13 of 25

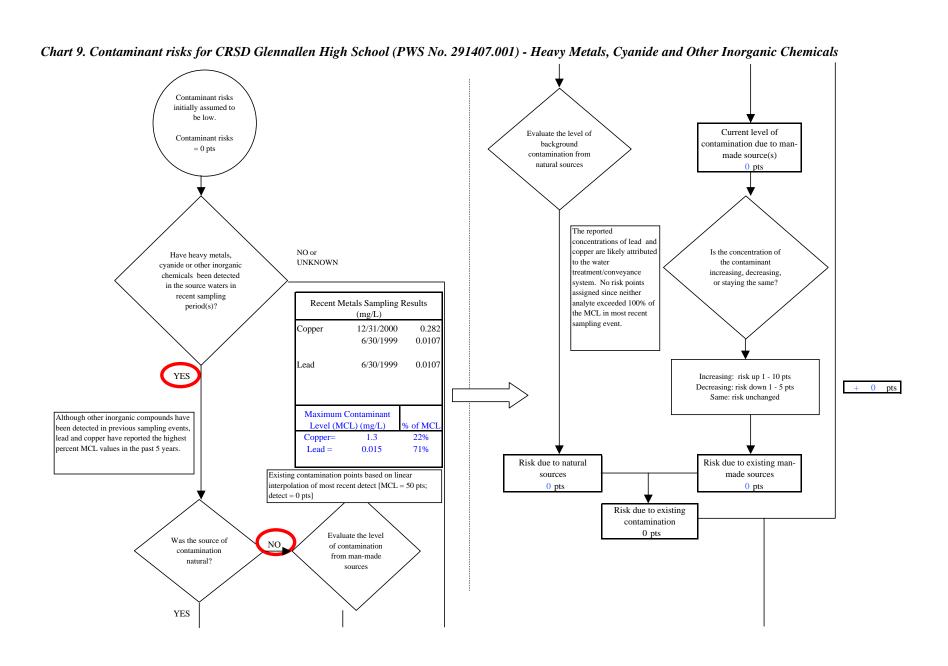

Page 14 of 25




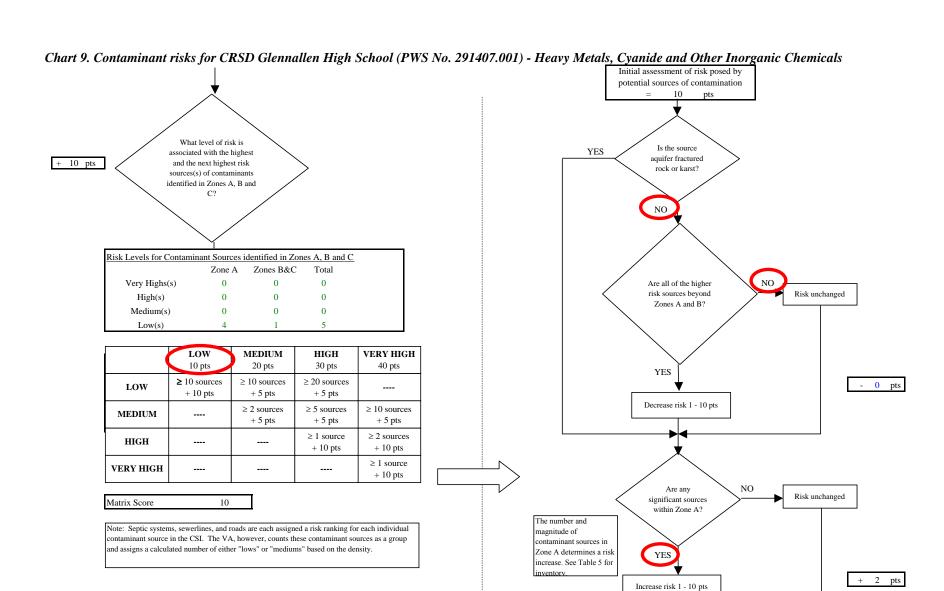



Chart 9. Contaminant risks for CRSD Glennallen High School (PWS No. 291407.001) - Heavy Metals, Cyanide and Other Inorganic Chemicals Existing NO Are there conditions 0 pts Risk unchanged that warrant upgrading risk? Risk due to existing Potential contamination 12 pts The number and magnitude of Risk posed by potential sources contaminant sources in of contamination with controls Contaminant Risk Zone D determines a YES 12 pts risk increase. See Table Contaminant risks 5 for inventory. 0 pts Increase risk 1 - 10 pts Risk posed by potential sources of contamination Contaminant risks* *Truncate risk at 50 pts 12 Are there sufficient Contaminant Risk Ratings NQ Risk unchanged Low controls, conditions, or monitoring to 40 to 50 pts 30 to < 40 pts high warrant downgrading 20 to < 30 pts medium risk? < 20 pts YES 0 pts Decrease risk 1 - 10 pts Risk posed by potential sources of contamination with controls 12 pts

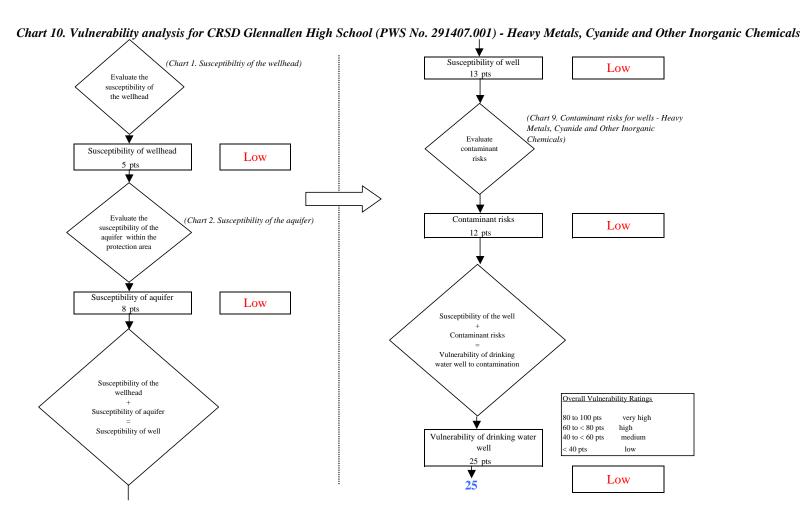


Page 17 of 25

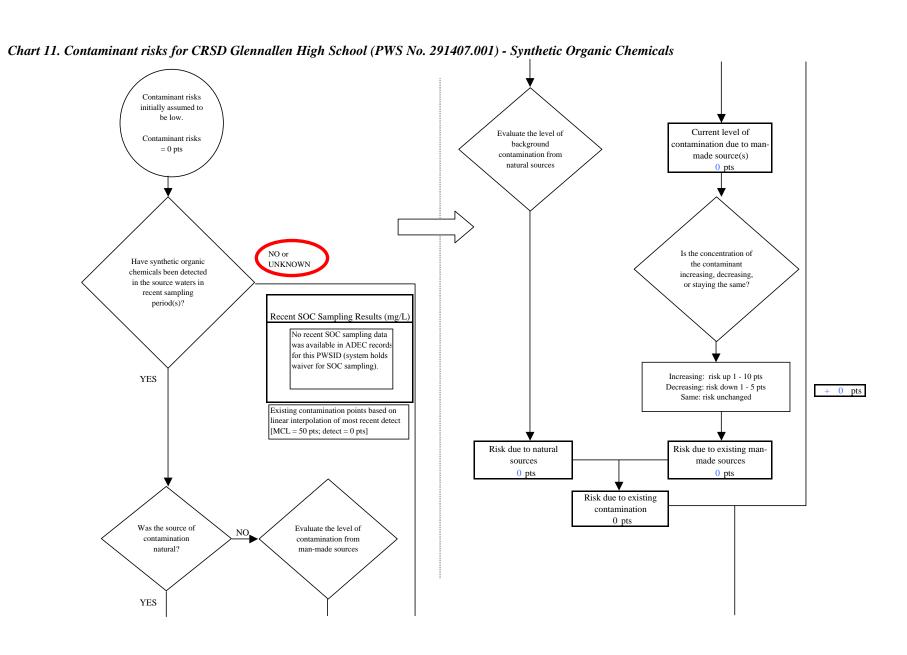

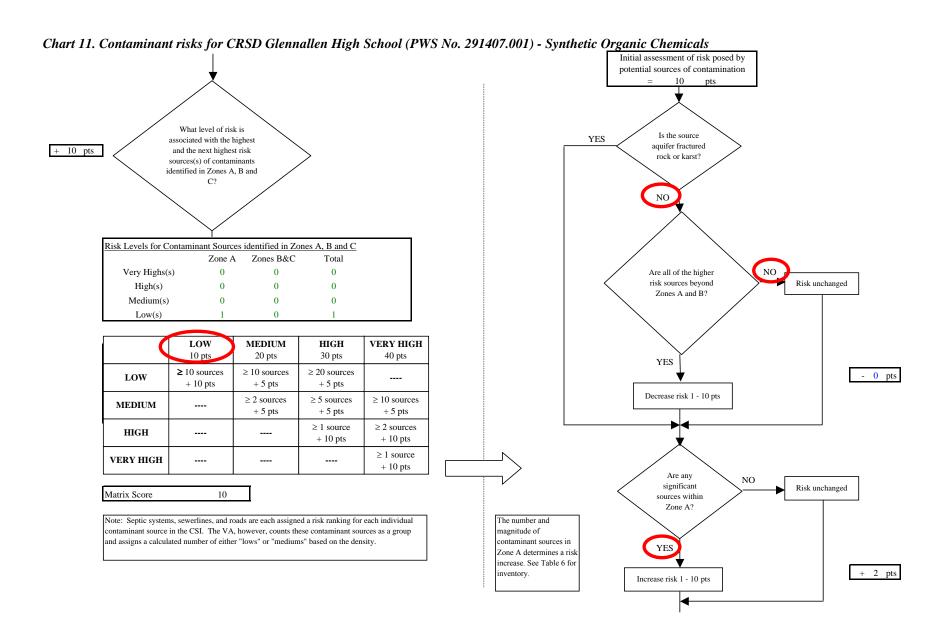


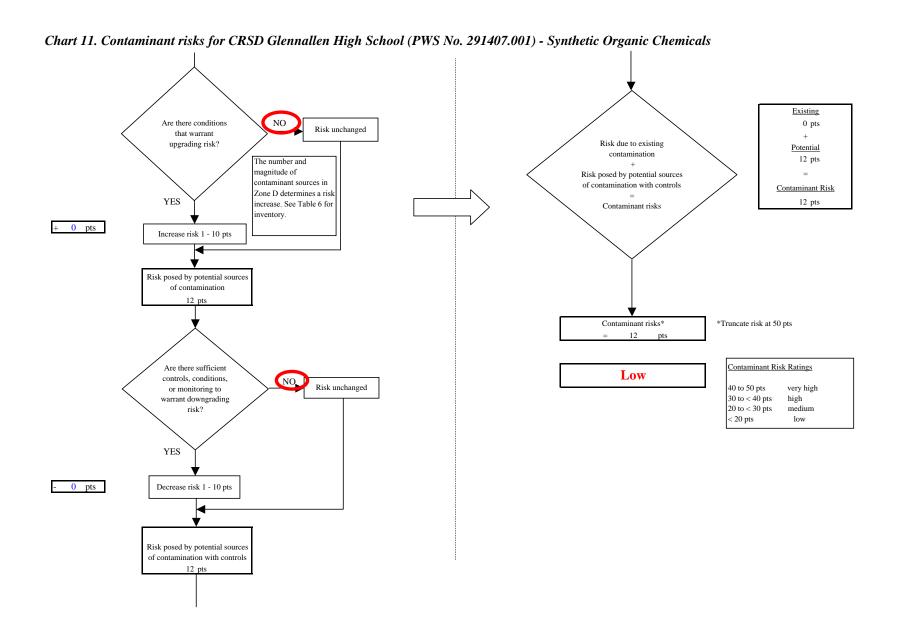

Page 20 of 25

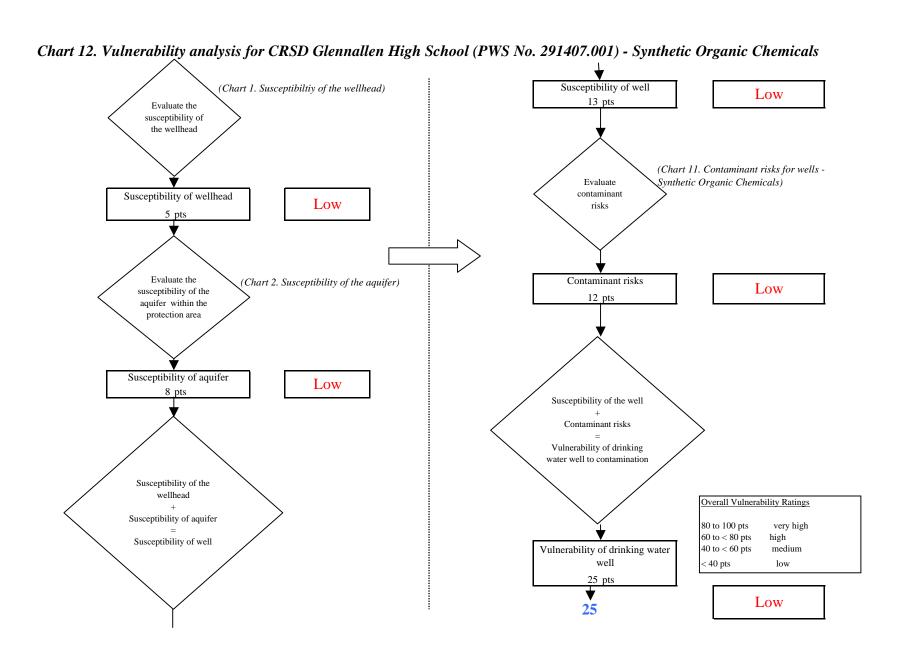

Page 21 of 25

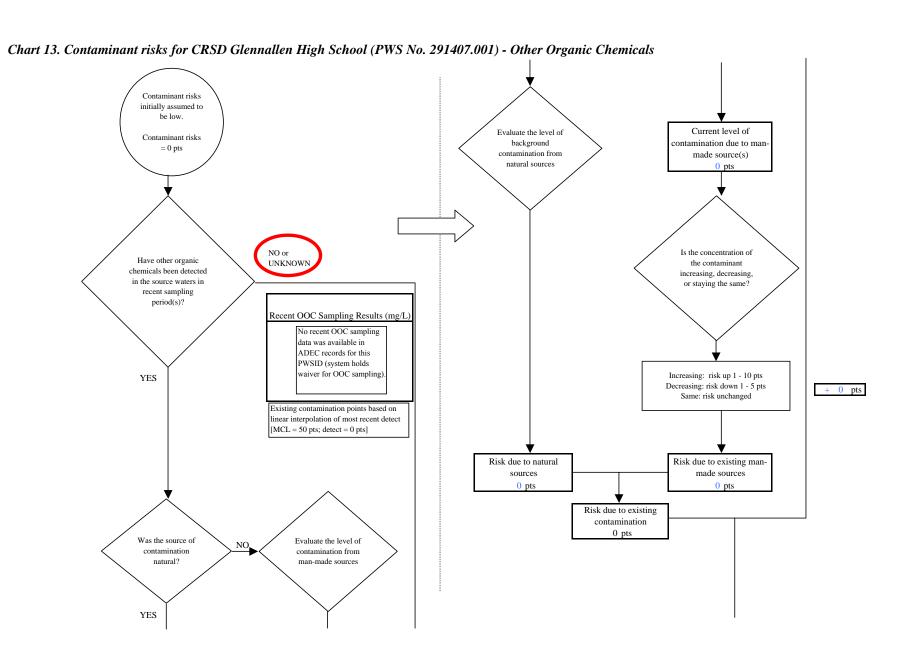

Page 22 of 25

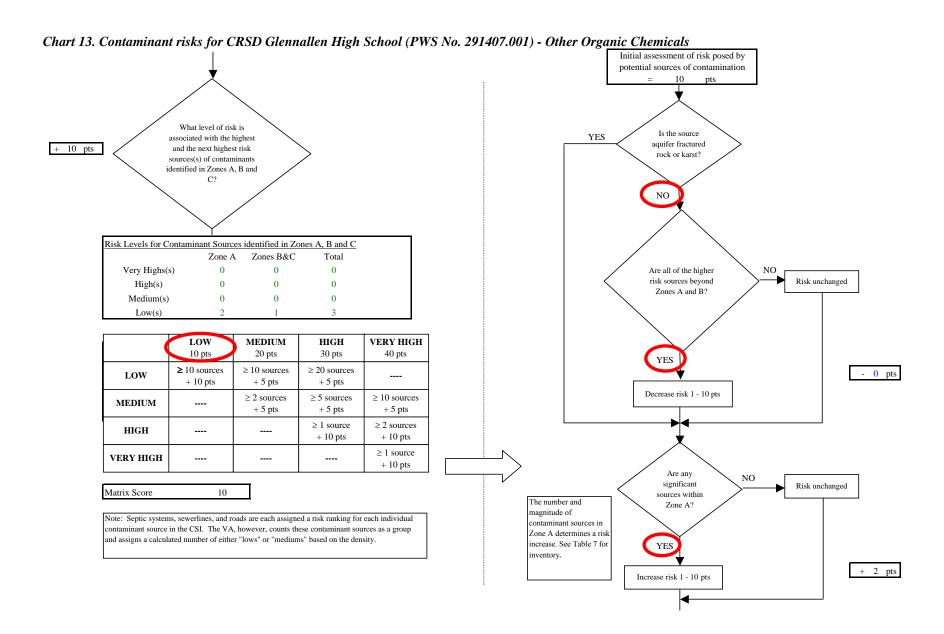


Chart 13. Contaminant risks for CRSD Glennallen High School (PWS No. 291407.001) - Other Organic Chemicals Existing NO Are there conditions 0 pts Risk unchanged that warrant upgrading risk? Risk due to existing Potential contamination 14 pts The number and magnitude of Risk posed by potential sources contaminant sources in of contamination with controls Contaminant Risk Zone D determines a risk YES 14 pts increase. See Table 7 for Contaminant risks inventory. 2 pts Increase risk 1 - 10 pts Risk posed by potential sources of contamination Contaminant risks* *Truncate risk at 50 pts 14 Contaminant Risk Ratings Are there sufficient Low controls, conditions, NO. Risk unchanged 40 to 50 pts very high or monitoring to 30 to < 40 pts high warrant downgrading risk? 20 to < 30 pts medium < 20 pts YES 0 pts Decrease risk 1 - 10 pts Risk posed by potential sources of contamination with controls 14 pts

Page 24 of 25

