



Source Water Assessment

A Hydrogeologic Susceptibility and
Vulnerability Assessment for the
Thunder Mountain Mobile Park

Juneau, Alaska

PWSID #110449.001

June 2004

DRINKING WATER PROTECTION PROGRAM REPORT #1555

Alaska Department of Environmental Conservation

Source Water Assessment for the Thunder Mountain Mobile Park Juneau, Alaska

PWSID #110449.001

June 2004

DRINKING WATER PROTECTION PROGRAM REPORT #1555

The Drinking Water Protection Program (DWPP) is producing Source Water Assessments in compliance with the Safe Drinking Water Act Amendments of 1996. Each assessment includes a delineation of the source water area, an inventory of potential and existing contaminant sources that may impact the water, a risk ranking for each of these contaminants, and an evaluation of the potential vulnerability of these drinking water sources.

These assessments are intended to provide public water systems owners/operators, communities, and local governments with the best available information that may be used to protect the quality of their drinking water. The assessments combine information obtained from various sources, including the U.S. Environmental Protection Agency, Alaska Department of Environmental Conservation (ADEC), public water system owners/operators, and other public information sources. The results of this assessment are subject to change if additional data becomes available. It is anticipated this assessment will be updated every five years to reflect any changes in the vulnerability and/or susceptibility of public drinking water source. If you have any additional information that may affect the results of this assessment, please contact the Program Coordinator of DWPP, (907) 269-7521.

CONTENTS

	Page
SECTION	
Executive Summary	1
Drinking Water System and Area Overview	1
Thunder Mountain Mobile Park Protection Area	1
Inventory of Potential and Existing Contaminant Sources	2
Ranking of Contaminant Risks	2
Vulnerability of the Drinking Water System	2
References	5

TABLES

TABLE	1. Definition of Zones	2
	2. Susceptibility of the Wells	3
	3. Contaminant Risks	3
	4. Overall Vulnerability	3

APPENDICES

APPENDIX	A. Thunder Mountain Drinking Water Protection Area (Map 1)	
	B. Contaminant Source Inventory (Table 1)	
	Contaminant Source Inventory and Risk Ranking	
	– Bacteria and Viruses (Table 2)	
	Contaminant Source Inventory and Risk Ranking	
	– Nitrates/Nitrites (Table 3)	
	Contaminant Source Inventory and Risk Ranking	
	– Volatile Organic Chemicals (Table 4)	
	Contaminant Source Inventory and Risk Ranking	
	– Heavy Metals, Cyanide, and Other Inorganic Chemicals (Table 5)	
	Contaminant Source Inventory and Risk Ranking	
	– Synthetic Organic Chemicals (Table 6)	
	Contaminant Source Inventory and Risk Ranking	
	– Other Organic Chemicals (Table 7)	
	C. Thunder Mountain Drinking Water Protection Area and Potential and Existing Contaminant Sources (Map 2)	
	D. Vulnerability Analysis (Charts 1 – 14)	

Source Water Assessment for the Thunder Mountain Mobile Park Drinking Water System Juneau, Alaska

Drinking Water Protection Program Alaska Department of Environmental Conservation

EXECUTIVE SUMMARY

The Thunder Mountain Mobile Park in Juneau is located near the end of Thunder Mountain Road in Mendenhall Valley, approximately 7-miles northwest of downtown Juneau. The Park operates a Class A water system that obtains water from two locations. The first location is the laundry facility of the Park, which has two wells. The second location is a wellhouse at the southern end of the Park, which has one operating well and a backup well. The wells received a susceptibility rating of **Low**. The aquifer received a susceptibility rating of **High**. Combining these two produces a rating of **Low** for the natural susceptibility of the wells. Potential and existing sources of the following contaminants were evaluated for the Source Water Assessment: bacteria and viruses, nitrates and/or nitrites, heavy metals, cyanide, and other inorganic chemicals, synthetic organic chemicals, volatile organic chemicals, and other organic chemicals. Identified potential and current sources of contaminants for the well intake area include: residential areas and roads. This evaluation included all available water sampling data submitted to ADEC by the system operator. The samples may have been collected from either raw water or post-treated water. Combining the natural susceptibility of the well with the contaminant risks, the wells received a vulnerability rating of “**low**” for all contaminant categories except heavy metals, which received a vulnerability rating of “**high**”. This assessment can be used as a foundation for local voluntary protection efforts as well as a basis for the continuous efforts on the part of Thunder Mountain Mobile Park to protect public health.

DRINKING WATER SYSTEM AND AREA OVERVIEW

Thunder Mountain Mobile Park (Sec. 17, T040S, R066E, Copper River Meridian) is located on Thunder Mountain Road in the Mendenhall Valley, approximately 7-miles northwest of downtown Juneau (Please see the inset of Map 1 in Appendix A for location). The system serves a population of approximately 150 and receives water from two pumping locations. The first location has two wells and is located at the laundry facility of the Park. The second

location is a wellhouse at the south end of the Park, which has one pumping well and a backup well (See Map 2 of Appendix C).

Downtown Juneau averages about 92 inches of precipitation per year, while 10 miles northwest at the airport averages about 54 inches per year; with an annual average of approximately 101 inches of snow. The groundwater aquifers underlying the area are recharged through the infiltration of precipitation and surface water. Groundwater aquifers in the region generally occur in the fractured bedrock and unconsolidated sediments deposited by glaciers and/or rivers.

According to the 2002 sanitary survey, the wells are approximately 60 feet in depth and are screened from 55-60 feet.

THUNDER MOUNTAIN MOBILE HOME PARK DRINKING WATER PROTECTION AREA

In order to evaluate whether a drinking water source is at risk, we must first evaluate what are the most likely pathways for surface contamination to reach the groundwater. These areas are determined by looking at the characteristics of the soil, groundwater, aquifer, and well.

The most probable area for contamination to reach the drinking water well is the area that contributes water to the well, the groundwater recharge area. This area is designated as the drinking water protection area. Because releases of contaminants within the protection area are most likely to impact the drinking water well, this area will serve as the focus for voluntary protection efforts.

An outline of the immediate and adjacent watershed was used to determine the size and shape of the protection area for the system’s wells. Available geology was also considered in accounting for uncertainties in groundwater flow and aquifer characteristics to arrive at a meaningful protection area (Please refer to the Guidance Manual for Class A Public Water Systems for additional information).

The protection areas established for wells by the ADEC are usually separated into four zones, limited by the watershed. These zones correspond to differences in the time-of-travel (TOT) of the water moving through the aquifer to the well. An analytical calculation was used to determine the size and shape of the protection area. The input parameters describing the attributes of the aquifer in this calculation were adopted from a 1979 groundwater publication by Allan Freeze and John A. Cherry.

The time of travel for contaminants (TOT) within the water varies and is dependent on the physical and chemical characteristics of each contaminant. The following is a summary of the four protection area zones for wells and the calculated TOT of the water for each:

Table 1. Definition of Zones

Zone	Definition
A	¼ the distance for the 2-yr. TOT
B	Less than the 2 year TOT
C	Less Than the 5 year TOT
D	Less than the 10 year TOT

The protection area for the Thunder Mountain Mobile Park water system is limited by its immediate watershed and the presence of fractured bedrock and does not include Zones C and D (See Appendix C).

INVENTORY OF POTENTIAL AND EXISTING CONTAMINANT SOURCES

The Drinking Water Protection Program has completed an inventory of potential and existing sources of contamination within the protection area. This inventory was completed through a search of agency records and other publicly available information. Potential sources of contamination to the drinking water aquifer include a wide range of categories and types. Potential drinking water contaminants are found within agricultural, residential, commercial, and industrial areas, but can also occur within areas that have little or no development.

For the basis of all Class A public water system assessments, six categories of drinking water contaminants were inventoried. They include:

- Bacteria and Viruses;
- Nitrates and/or Nitrites;
- Volatile Organic Chemicals;
- Heavy metals, cyanide, and other inorganic chemicals;
- Synthetic Organic Chemicals; and
- Other Organic Chemicals.

The sources are displayed on Map 2 of Appendix C and summarized in Table 1 of Appendix B.

RANKING OF CONTAMINANT RISKS

Once the potential and existing sources of contamination have been identified, they are assigned a ranking according to what type and level of risk they represent. Ranking of contaminant risks for a “potential” or “existing” source of contamination is a function of toxicity and volumes of specific contaminants associated with that source. Rankings include:

- Low;
- Medium;
- High; and
- Very High.

The TOT for contaminants within the water varies and is dependent on the physical and chemical characteristics of each contaminant. Bacteria and Viruses are only inventoried in Zones A and B because of their short life span. Only “Very High” and “High” rankings are inventoried within the outer Zone D due to the probability of contaminant dilution by the time the contaminants travel to the well.

Tables 2 through 7 (if necessary) in Appendix B contain the ranking of potential and existing sources of contamination with respect each contaminant source.

VULNERABILITY OF THE DRINKING WATER SYSTEM

Appendix D contains fourteen charts, which together form the ‘Vulnerability Analysis’ for a source water assessment for a public drinking water source. Chart 1 analyzes the ‘Susceptibility of the Wellhead’ to contamination by looking at the construction of the well and its surrounding area. Chart 2 analyzes the ‘Susceptibility of the Aquifer’ to contamination by looking at the naturally occurring attributes of the water source and influences on the groundwater system that might lead to contamination. Chart 3 analyzes ‘Contaminant Risks’ for the drinking water source with respect to bacteria and viruses. The ‘Contaminant Risks’ portion of the analysis considers potential sources of contaminants as well as a review of contamination that has or may have occurred, but has not arrived or been detected at the well. Chart 4 contains the ‘Vulnerability Analysis for Bacteria & Viruses’. Charts 5 through 14 contain the Contaminant Risks and Vulnerability Analyses for nitrates and nitrites, volatile organic chemicals, heavy metals, cyanide, and other inorganic chemicals, synthetic organic chemicals, and other organic chemicals, respectively.

Vulnerability of a drinking water source to contamination is a combination of two factors:

- Natural susceptibility; and
- Contaminant risks.

A score for the Natural Susceptibility is reached by considering the properties of the well and the aquifer.

Susceptibility of the Wellhead (0 – 25 Points)
(Chart 1 of Appendix D)

+

Susceptibility of the Aquifer (0 – 25 Points)
(Chart 2 of Appendix D)

=

Natural Susceptibility (Susceptibility of the Well)
(0 – 50 Points)

A ranking is assigned for the Natural Susceptibility according to the point score:

Natural Susceptibility Ratings	
40 to 50 pts	Very High
30 to < 40 pts	High
20 to < 30 pts	Medium
< 20 pts	Low

Table 2 shows the Susceptibility scores and ratings for the basin.

Table 2. Susceptibility of the Wells

	Score	Rating
Susceptibility of the Wellhead	0	Low
Susceptibility of the Aquifer	18	High
Natural Susceptibility	18	Low

Contaminant risks to a drinking water source depend on the type, number or density, and distribution of contaminant sources. This score has been derived from an examination of existing and historical contamination that has been detected at the drinking water source through routine sampling. It also evaluates potential sources of contamination. Flow charts are used to assign a point score, and ratings are assigned in the same way as for the natural susceptibility:

Contaminant Risk Ratings	
40 to 50 pts	Very High
30 to < 40 pts	High
20 to < 30 pts	Medium
< 20 pts	Low

Table 3 summarizes the Contaminant Risks for each category of drinking water contaminants.

Table 3. Contaminant Risks

Category	Score	Rating
Bacteria and Viruses	12	Low
Nitrates and/or Nitrites	14	Low
Volatile Organic Chemicals	12	Low
Heavy Metals, Cyanide, and Other Inorganic Chemicals	50	Very High
Synthetic Organic Chemicals	12	Low
Other Organic Chemicals	12	Low

Finally, an overall vulnerability score is assigned for each water system by combining each of the contaminant risk scores with the natural susceptibility score:

Natural Susceptibility (0 – 50 points)

+

Contaminant Risks (0 – 50 points)

=

Vulnerability of the
Drinking Water Source to Contamination (0 – 100).

Again, rankings are assigned according to a point score:

Overall Vulnerability Ratings	
80 to 100 pts	Very High
60 to < 80 pts	High
40 to < 60 pts	Medium
< 40 pts	Low

Table 4 contains the overall vulnerability scores (0 – 100) and ratings for each of the six categories of drinking water contaminants. Note: scores are rounded off to the nearest five.

Table 4. Overall Vulnerability

Category	Score	Rating
Bacteria and Viruses	30	Low
Nitrates and Nitrites	30	Low
Volatile Organic Chemicals	30	Low
Heavy Metals, Cyanide, and Other Inorganic Chemicals	70	High
Synthetic Organic Chemicals	30	Low
Other Organic Chemicals	30	Low

Bacteria and Viruses

The contaminant risk for bacteria and viruses is “low” with residential areas and roads presenting the most significant risk to the wells (See Chart 3 – Contaminant Risks for Bacteria and Viruses in Appendix D).

Only a small amount of bacteria and viruses are required to endanger public health. Bacteria and viruses have not been detected during recent water sampling of the system. After combining the contaminant risk for bacteria and viruses with the natural susceptibility of the well, the overall vulnerability of the well to contamination is “low”.

Nitrates and Nitrites

The contaminant risk for nitrates and nitrites is “low” with residential areas and roads posing the most significant contaminant risk to this source of public drinking water (See Chart 5 - Contaminant Risks for Nitrates and/or Nitrites in Appendix D). Nitrates are very mobile, moving at approximately the same rate as water.

Sampling history indicates that nitrates have not been detected in samples collected in 2000-2003. The Maximum Contaminant Level (MCL) for nitrate is 10 milligrams per liter (mg/L). The MCL is the maximum level of contaminant that is allowed to exist in drinking water and still be consumed by humans without harmful health effects.

It is unknown how much of the existing nitrate concentration can be attributed to natural or human-made sources. Nitrate concentrations in uncontaminated groundwater are typically less than 2 mg/L, or 20% of the MCL, and are derived primarily from the decomposition of organic matter in soils [Wang, Strelakos, Jokela, 2000].

After combining the contaminant risk for nitrates and nitrites with the natural susceptibility of the well, the overall vulnerability of the well to contamination is “low”.

Volatile Organic Chemicals

The contaminant risk for volatile organic chemicals is “low” with residential areas and roads creating the most significant risk for volatile organic chemicals (See Chart 7 – Contaminant Risks for Volatile Organic Chemicals in Appendix D).

Volatile organic chemicals have not been detected in significant levels during recent sampling. After combining the contaminant risk for volatile organic chemicals with the natural susceptibility of the well, the

overall vulnerability of the well to contamination is “low”.

Heavy Metals, Cyanide, and Other Inorganic Chemicals

The contaminant risk for heavy metals is “very high” with residential areas and roads creating the greatest risk of contamination (See Chart 9 – Contaminant Risks for Heavy Metals, Cyanide, and Other Inorganic Chemicals in Appendix D).

Lead has been detected in levels above the MCL in sampling performed during 2000 – 2002. After combining the contaminant risk for heavy metals with the natural susceptibility of the well, the overall vulnerability of the well to contamination is “high”.

Synthetic Organic Chemicals

The contaminant risk for synthetic organic chemicals is “low”. After combining the contaminant risk with the natural susceptibility of the well, the overall vulnerability to synthetic organic chemicals of the well remains “low” (See Chart 11 – Contaminant Risks for Synthetic Organic Chemicals in Appendix D).

Review of the historical sampling data indicates that no synthetic organic chemicals have been detected in amounts exceeding the MCL within the past 5 years.

Other Organic Chemicals

The contaminant risk for other organic chemicals is “low”. After combining the contaminant risk with the natural susceptibility of the well, the overall vulnerability to other organic chemicals of the well is “low” (See Chart 13 – Contaminant Risks for Other Organic Chemicals in Appendix D).

Review of the historical sampling data indicates that no other organic chemicals have been detected in amounts exceeding the MCL within the past 5 years.

Using the Source Water Assessment


This assessment of contaminant risks can be used as a foundation for local voluntary protection efforts as well as a basis for the continuous efforts on the part of the Thunder Mountain Mobile Park to protect public health. It is anticipated that Source Water Assessments will be updated every five years to reflect any changes in the vulnerability and/or susceptibility of this drinking water source.

REFERENCES

- Alaska Department of Community and Economic Development (ADCED), 2004 [WWW document]. URL:
http://www.dced.state.ak.us/mra/CF_BLOCK.cfm
- Freeze, R.A. and Cherry, J.A., 1979. Groundwater. Prentice-Hall, Englewood Cliffs, NJ.
- Jokela, J.B., Munter, J.A., and Evans, J.G., 1991, Ground-water resources of the Palmer-Big Lake area, Alaska: a conceptual model. Division of Geological & Geophysical Surveys Reports of Investigations 90-4, State of Alaska Department of Natural Resources, Fairbanks, AK.
- King, P.B., compiler, 1969, Tectonic map of North America: US Geological Survey Map, (scale 1:5,000,000) 2 sheets.
- United States Environmental Protection Agency (EPA), 2004 [WWW document]. URL:
<http://www.epa.gov/safewater/mcl.html>

APPENDIX A


Thunder Mountain Drinking Water Protection Area Location Map (Map 1)

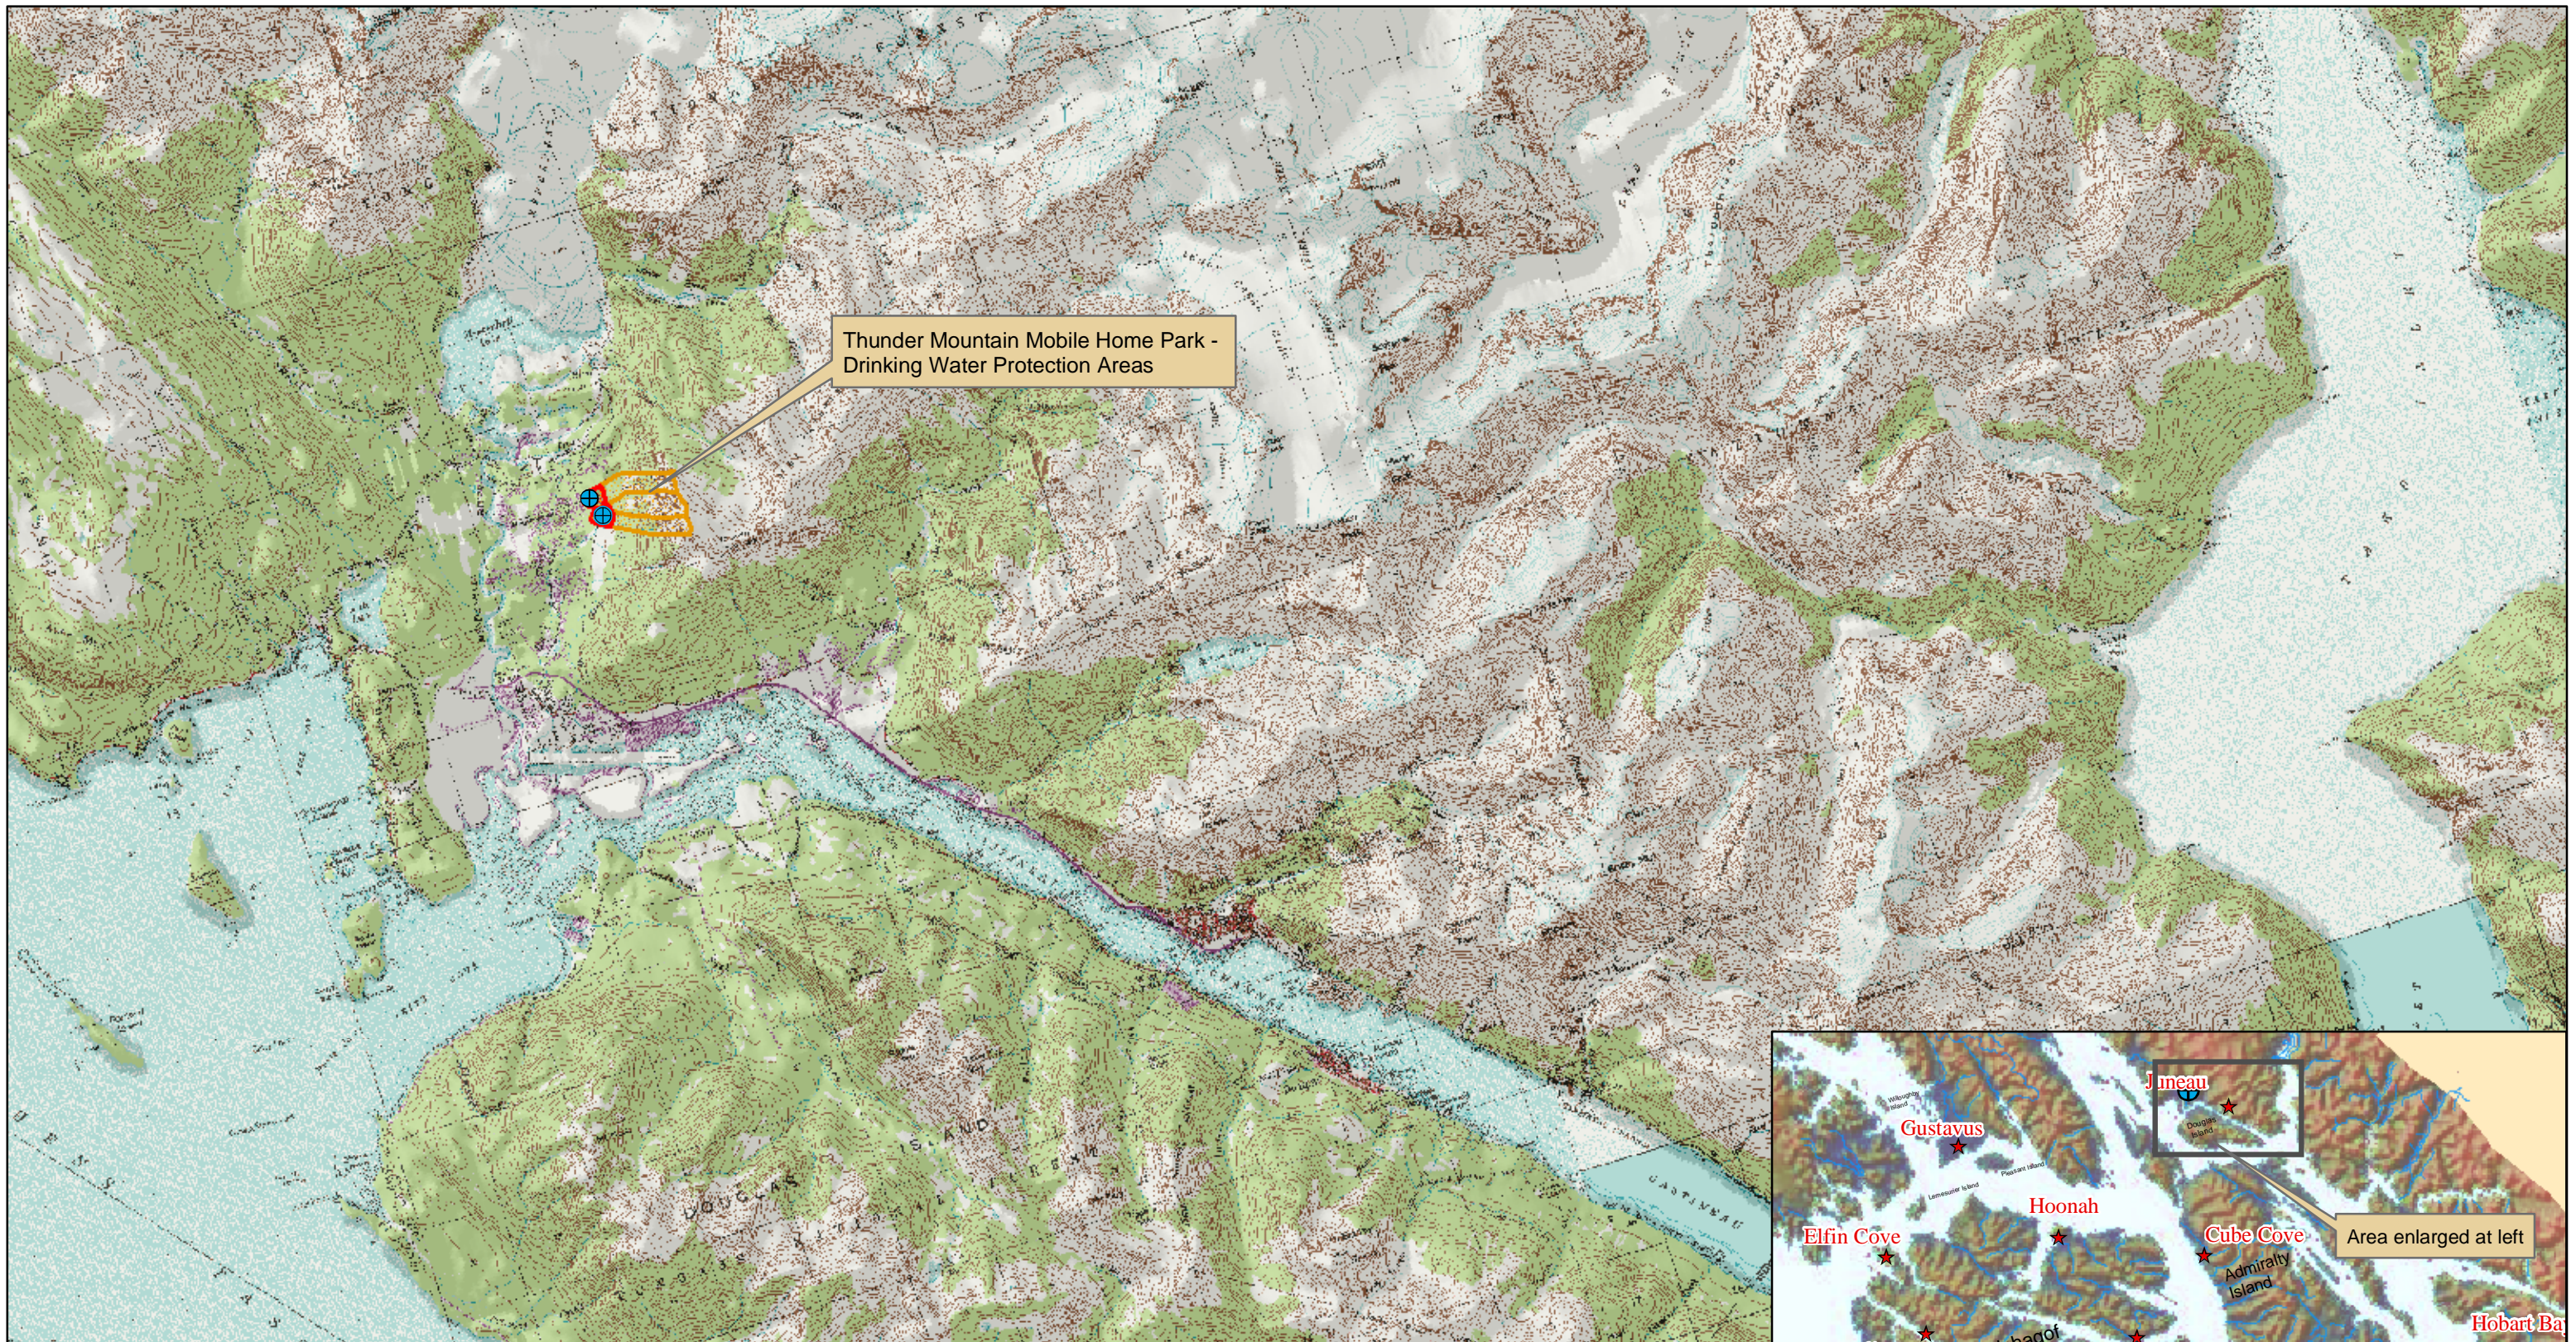

Thunder Mountain Mobile Home Park -
Drinking Water Protection Areas

Map 1: Thunder Mountain Mobile Home Park - Drinking Water Protection Areas

PWSID: 110449.001




0 4,500 9,000 18,000 27,000 Feet
1:108,417

Data Sources:
Background image
- USGS 1:63,000 mapping
Lakes, streams, & roads
- U.S. Forest Service, Tongass

Protection Zones for the Thunder Mountain Mobile Home Park were delineated based upon watershed area and groundwater flow information.

Legend

- Thunder Mountain Mobile Park Well
- Zone A Protection Area
- Zone B Protection Area
- Roads
- Lake

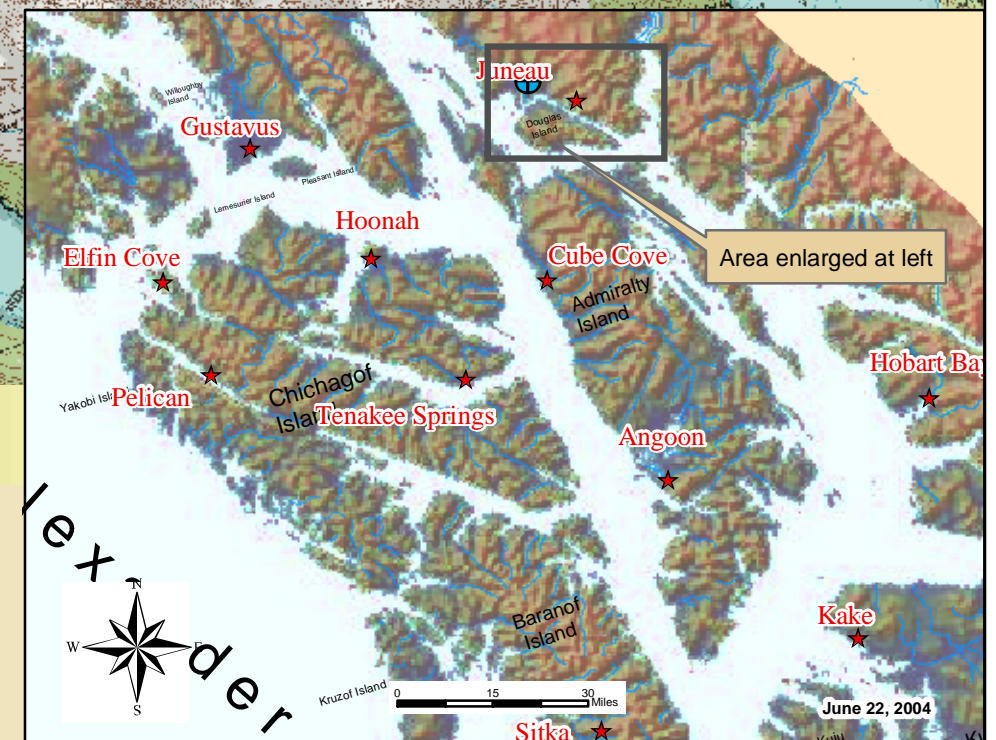

Area enlarged at left



0 15 30 Miles

June 22, 2004

APPENDIX B

Contaminant Source Inventory and Risk Ranking

(Tables 1-7)

Table 1

***Contaminant Source Inventory for
Thunder Mountain Mobile Park***

PWSID 110449.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Map Number</i>	<i>Comments</i>
Construction trade areas and materials	C09	C09-1	A	2	From operator information.
Residential Areas	R01	R01	A	2	From USGS 1:24k mapping.
Highways and roads, paved (cement or asphalt)	X20	X20 1-2	A	2	From USGS 1:24k mapping.

Table 2

*Contaminant Source Inventory and Risk Ranking for
Thunder Mountain Mobile Park
Sources of Bacteria and Viruses*

PWSID 110449.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Residential Areas	R01	R01	A	Low	2	From USGS 1:24k mapping.
Highways and roads, paved (cement or asphalt)	X20	X20 1-2	A	Low	2	From USGS 1:24k mapping.

Table 3

*Contaminant Source Inventory and Risk Ranking for
Thunder Mountain Mobile Park
Sources of Nitrates/Nitrites*

PWSID 110449.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Residential Areas	R01	R01	A	Low	2	From USGS 1:24k mapping.
Highways and roads, paved (cement or asphalt)	X20	X20 1-2	A	Low	2	From USGS 1:24k mapping.

Table 4

*Contaminant Source Inventory and Risk Ranking for
Thunder Mountain Mobile Park
Sources of Volatile Organic Chemicals*

PWSID 110449.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Construction trade areas and materials	C09	C09-1	A	Low	2	From operator information.
Residential Areas	R01	R01	A	Low	2	From USGS 1:24k mapping.
Highways and roads, paved (cement or asphalt)	X20	X20 1-2	A	Low	2	From USGS 1:24k mapping.

Table 5

*Contaminant Source Inventory and Risk Ranking for
Thunder Mountain Mobile Park
Sources of Heavy Metals, Cyanide and Other Inorganic Chemicals*

PWSID 110449.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Construction trade areas and materials	C09	C09-1	A	Low	2	From operator information.
Residential Areas	R01	R01	A	Low	2	From USGS 1:24k mapping.
Highways and roads, paved (cement or asphalt)	X20	X20 1-2	A	Low	2	From USGS 1:24k mapping.

Table 6

*Contaminant Source Inventory and Risk Ranking for
Thunder Mountain Mobile Park
Sources of Synthetic Organic Chemicals*

PWSID 110449.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Residential Areas	R01	R01	A	Low	2	From USGS 1:24k mapping.

Table 7



*Contaminant Source Inventory and Risk Ranking for
Thunder Mountain Mobile Park
Sources of Other Organic Chemicals*

PWSID 110449.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Construction trade areas and materials	C09	C09-1	A	Low	2	From operator information.
Residential Areas	R01	R01	A	Low	2	From USGS 1:24k mapping.
Highways and roads, paved (cement or asphalt)	X20	X20 1-2	A	Low	2	From USGS 1:24k mapping.


APPENDIX C

Thunder Mountain Drinking Water Protection Area and Potential and Existing Contaminant Sources (Map 2)

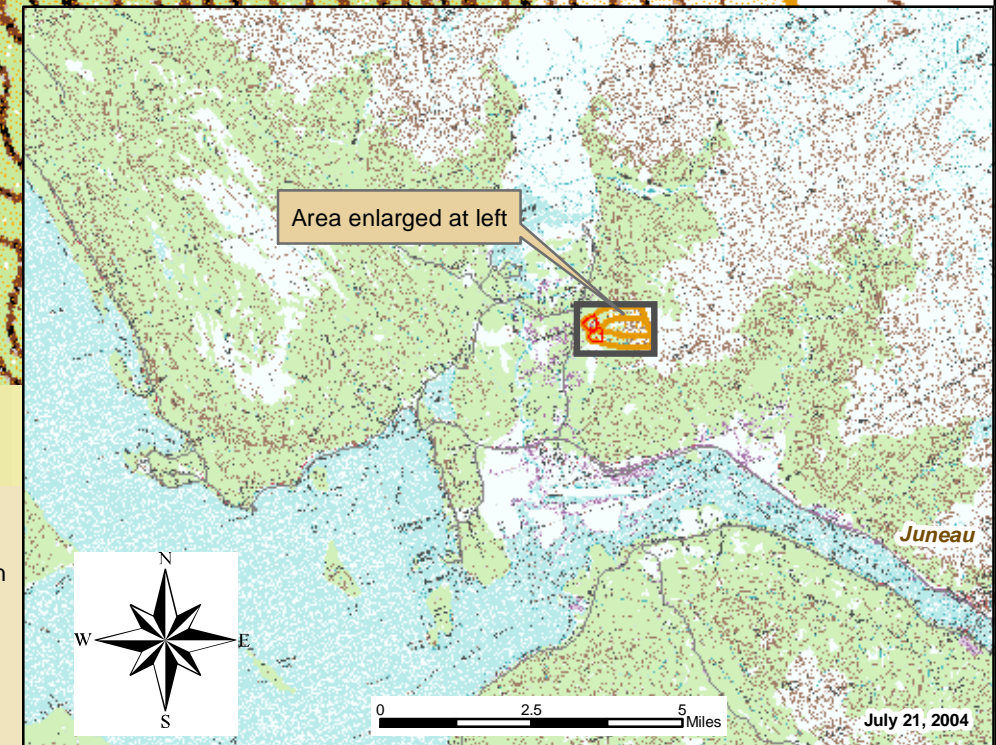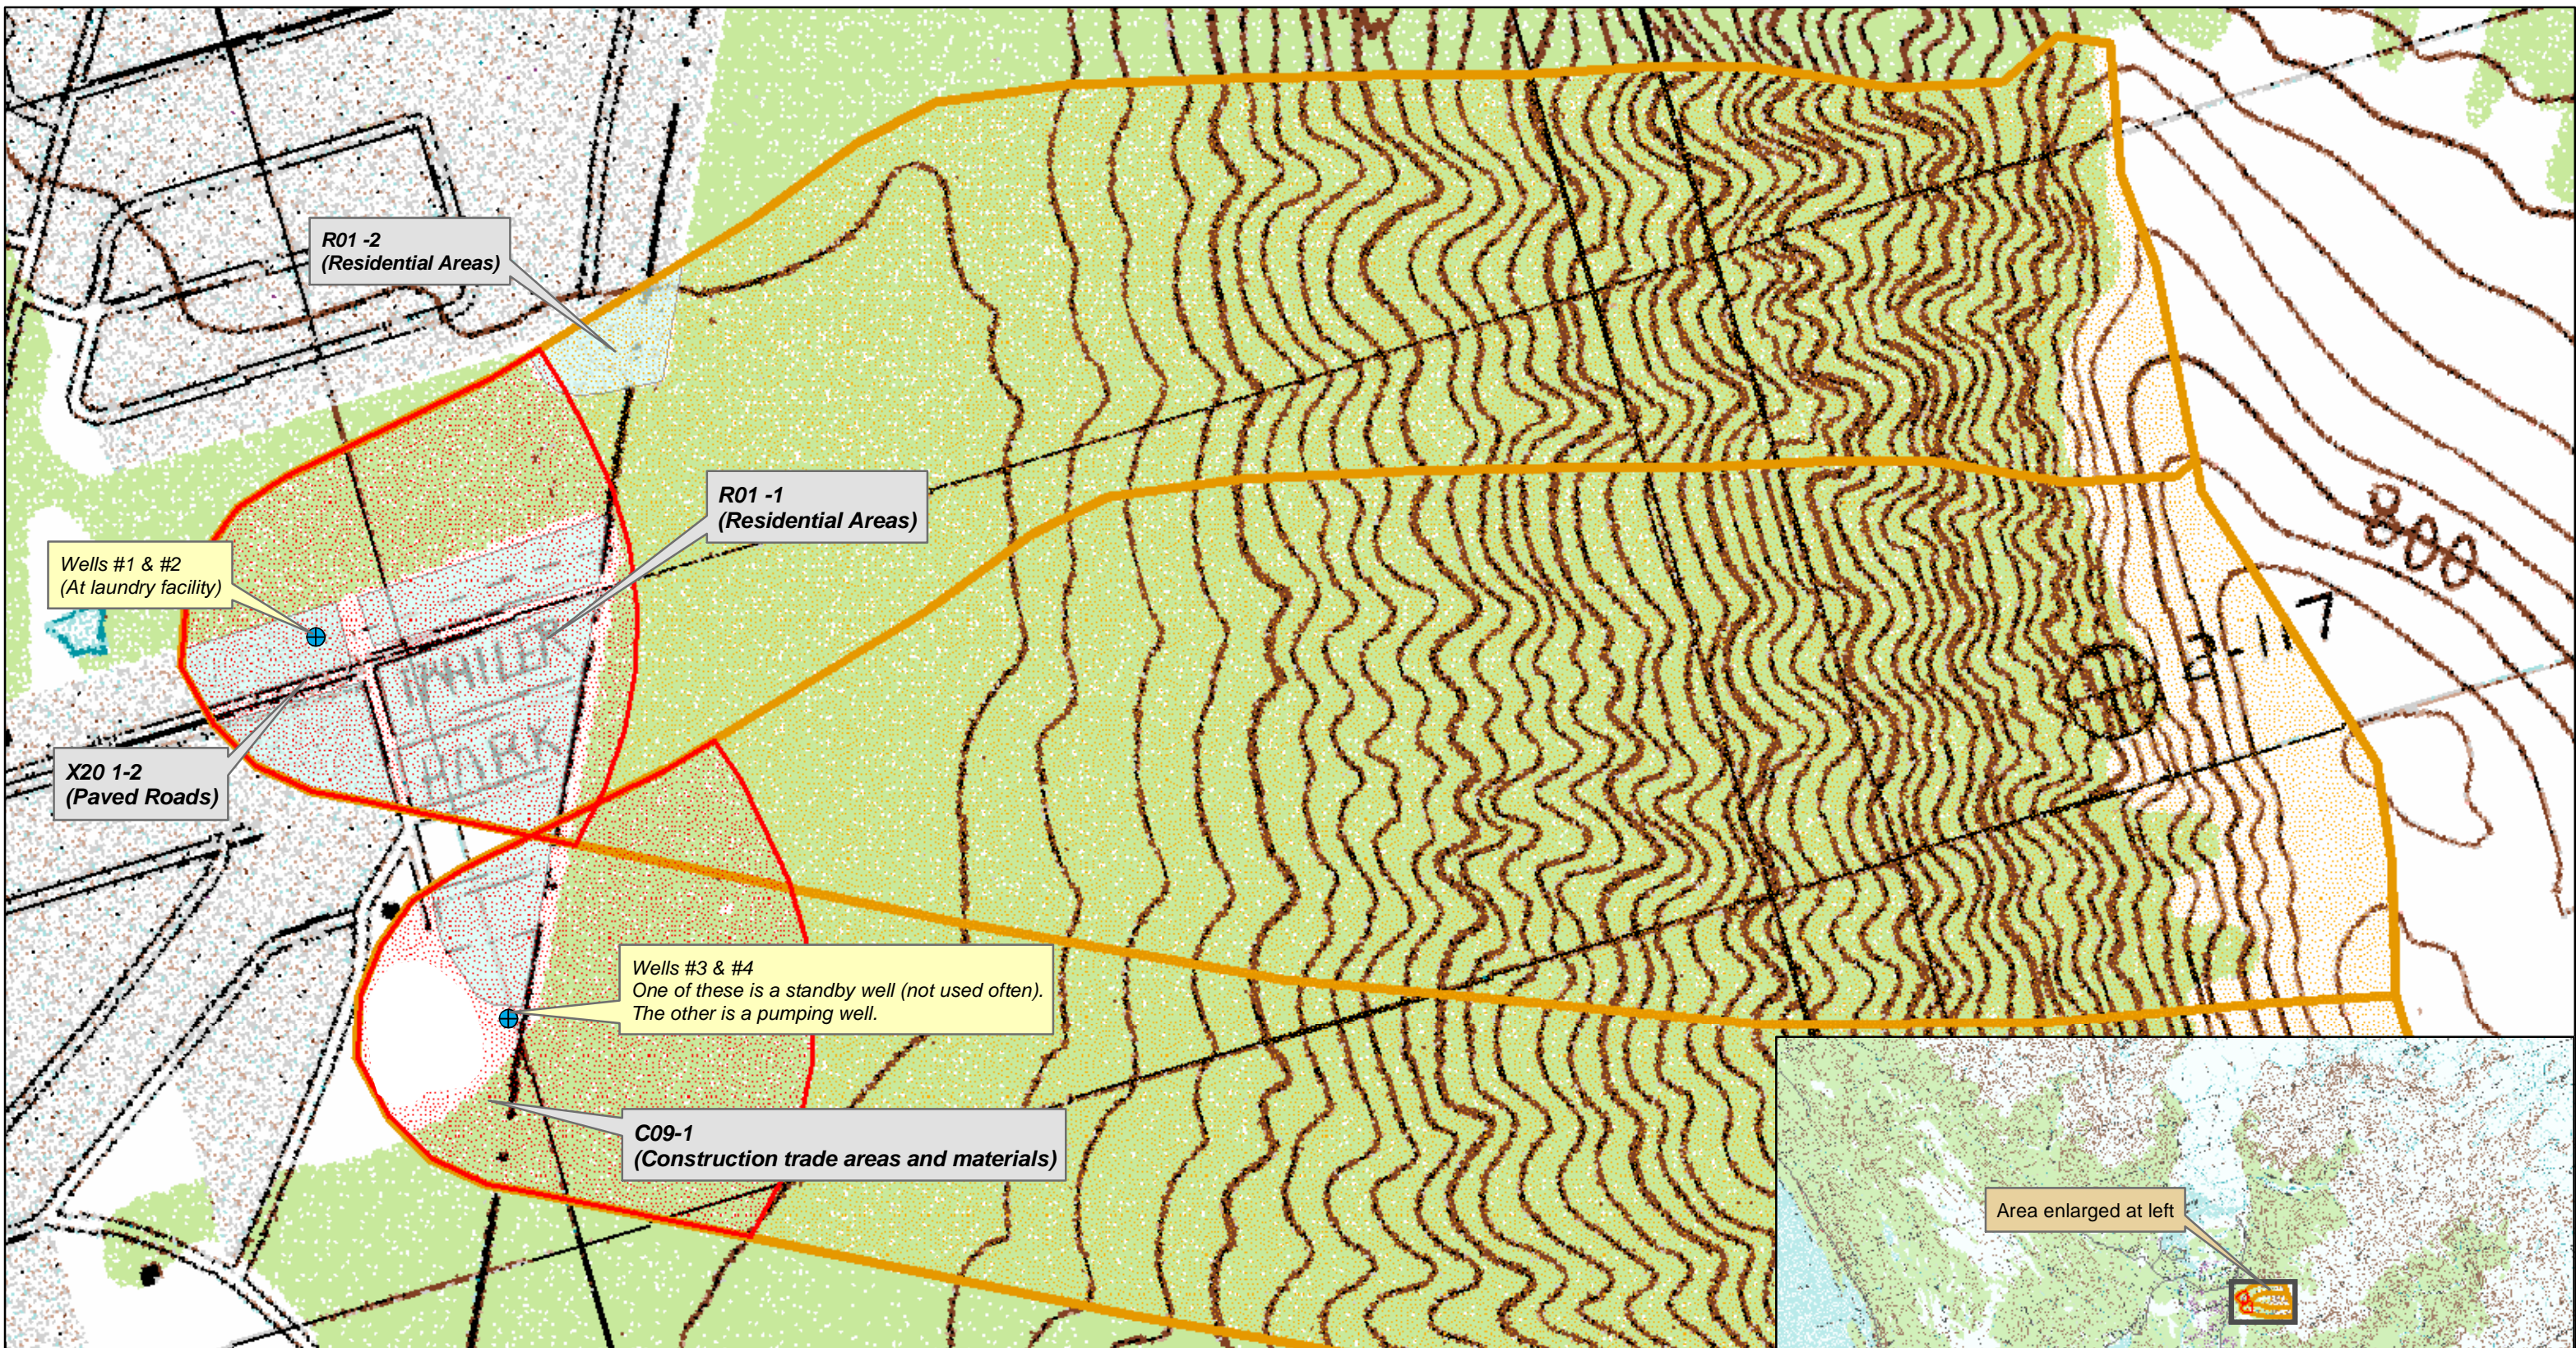

Map 2: Potential and Existing Contaminant Sources

PWSID: 110449.001




Data Sources:

Background image - USGS 1:63,000 mapping
Lakes, streams, & roads - U.S. Forest Service

Protection zones were delineated based upon streams noted on USGS 1:63,000 mapping.

Legend

- Thunder Mountain Mobile Park - Well Location
- Zone A Protection Area
- Zone B Protection Area
- Residential Areas




July 21, 2004

APPENDIX D

Vulnerability Analysis

(Charts 1-14)

Chart 1. Susceptibility of the Wellhead - Thunder Mountain Mobile Home Park

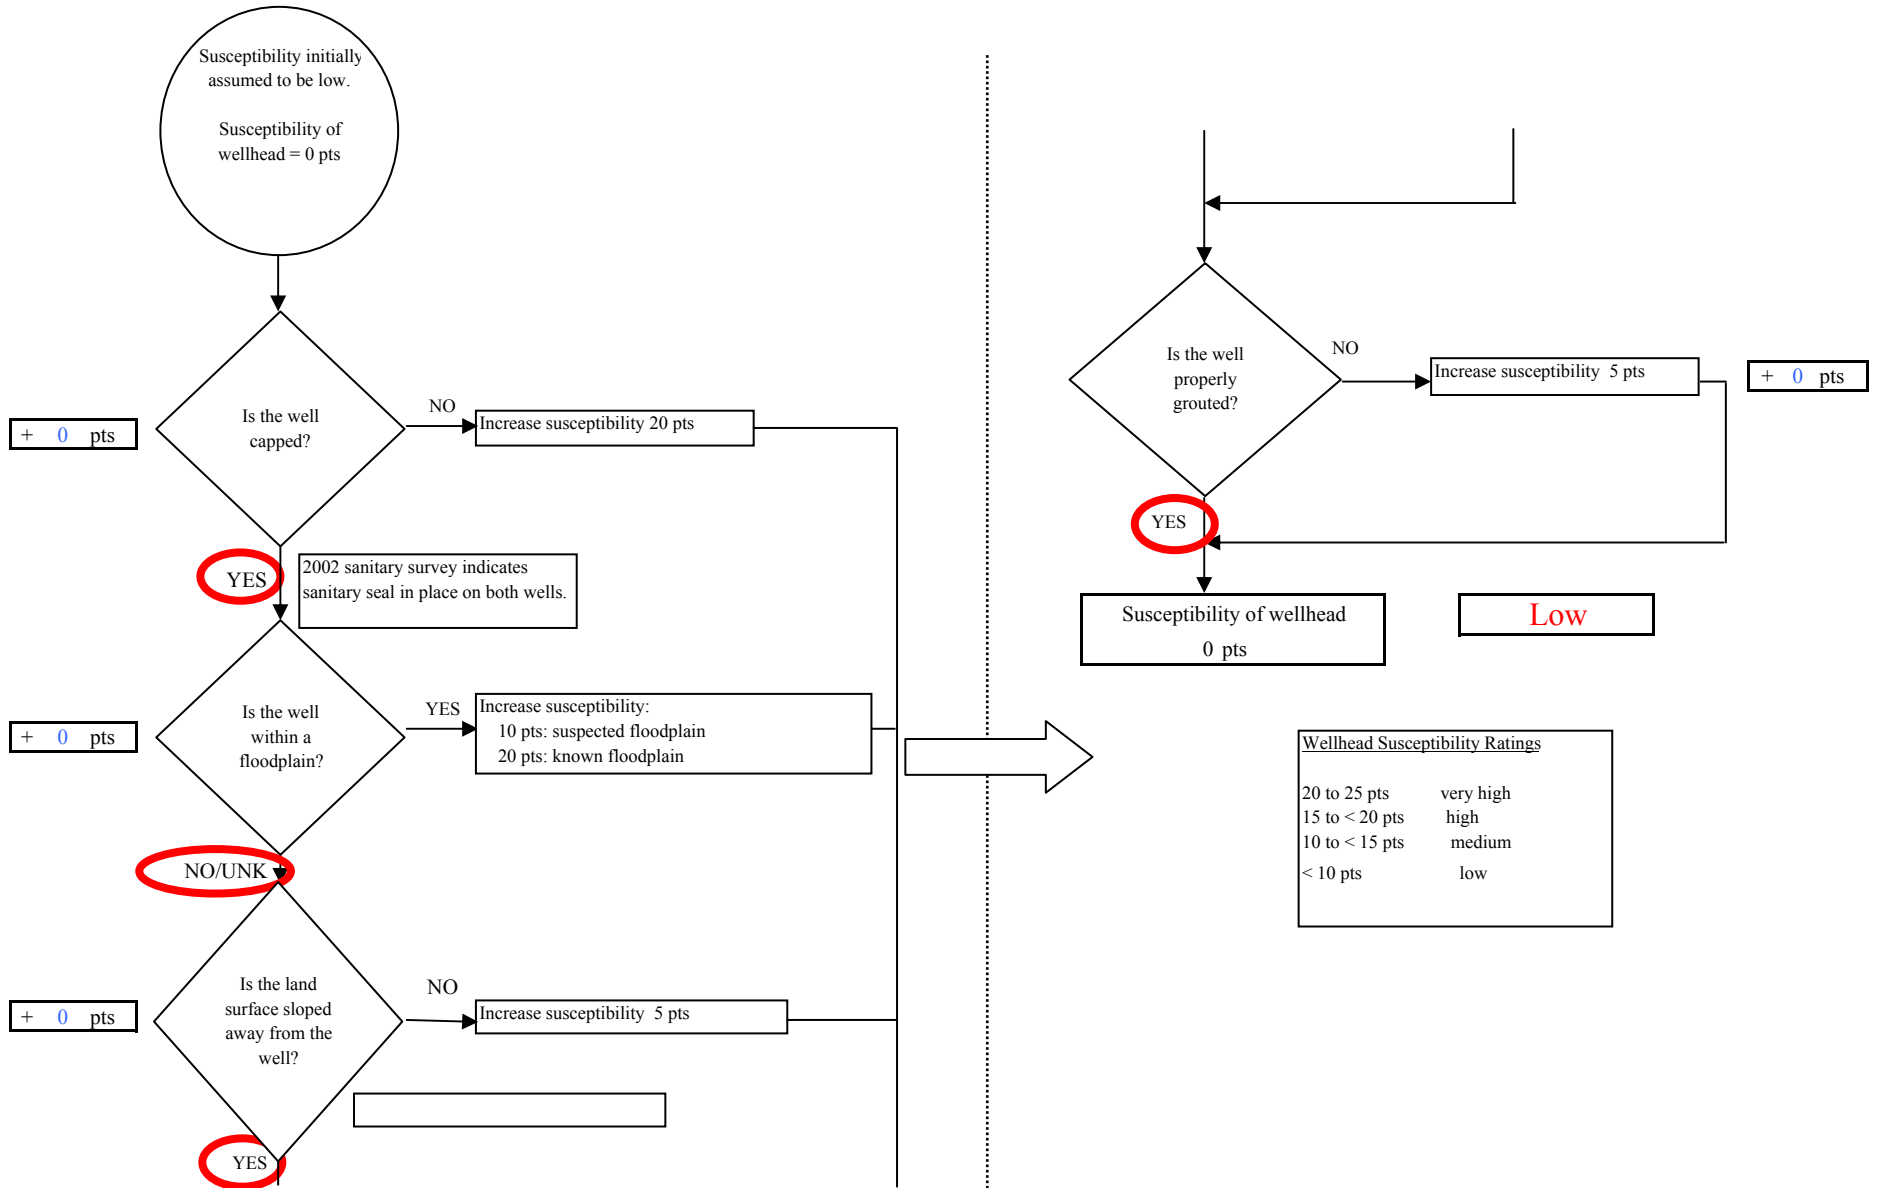

Wellhead Susceptibility Ratings	
20 to 25 pts	very high
15 to < 20 pts	high
10 to < 15 pts	medium
< 10 pts	low

Chart 2. Susceptibility of the Aquifer - Thunder Mountain Mobile Home Park




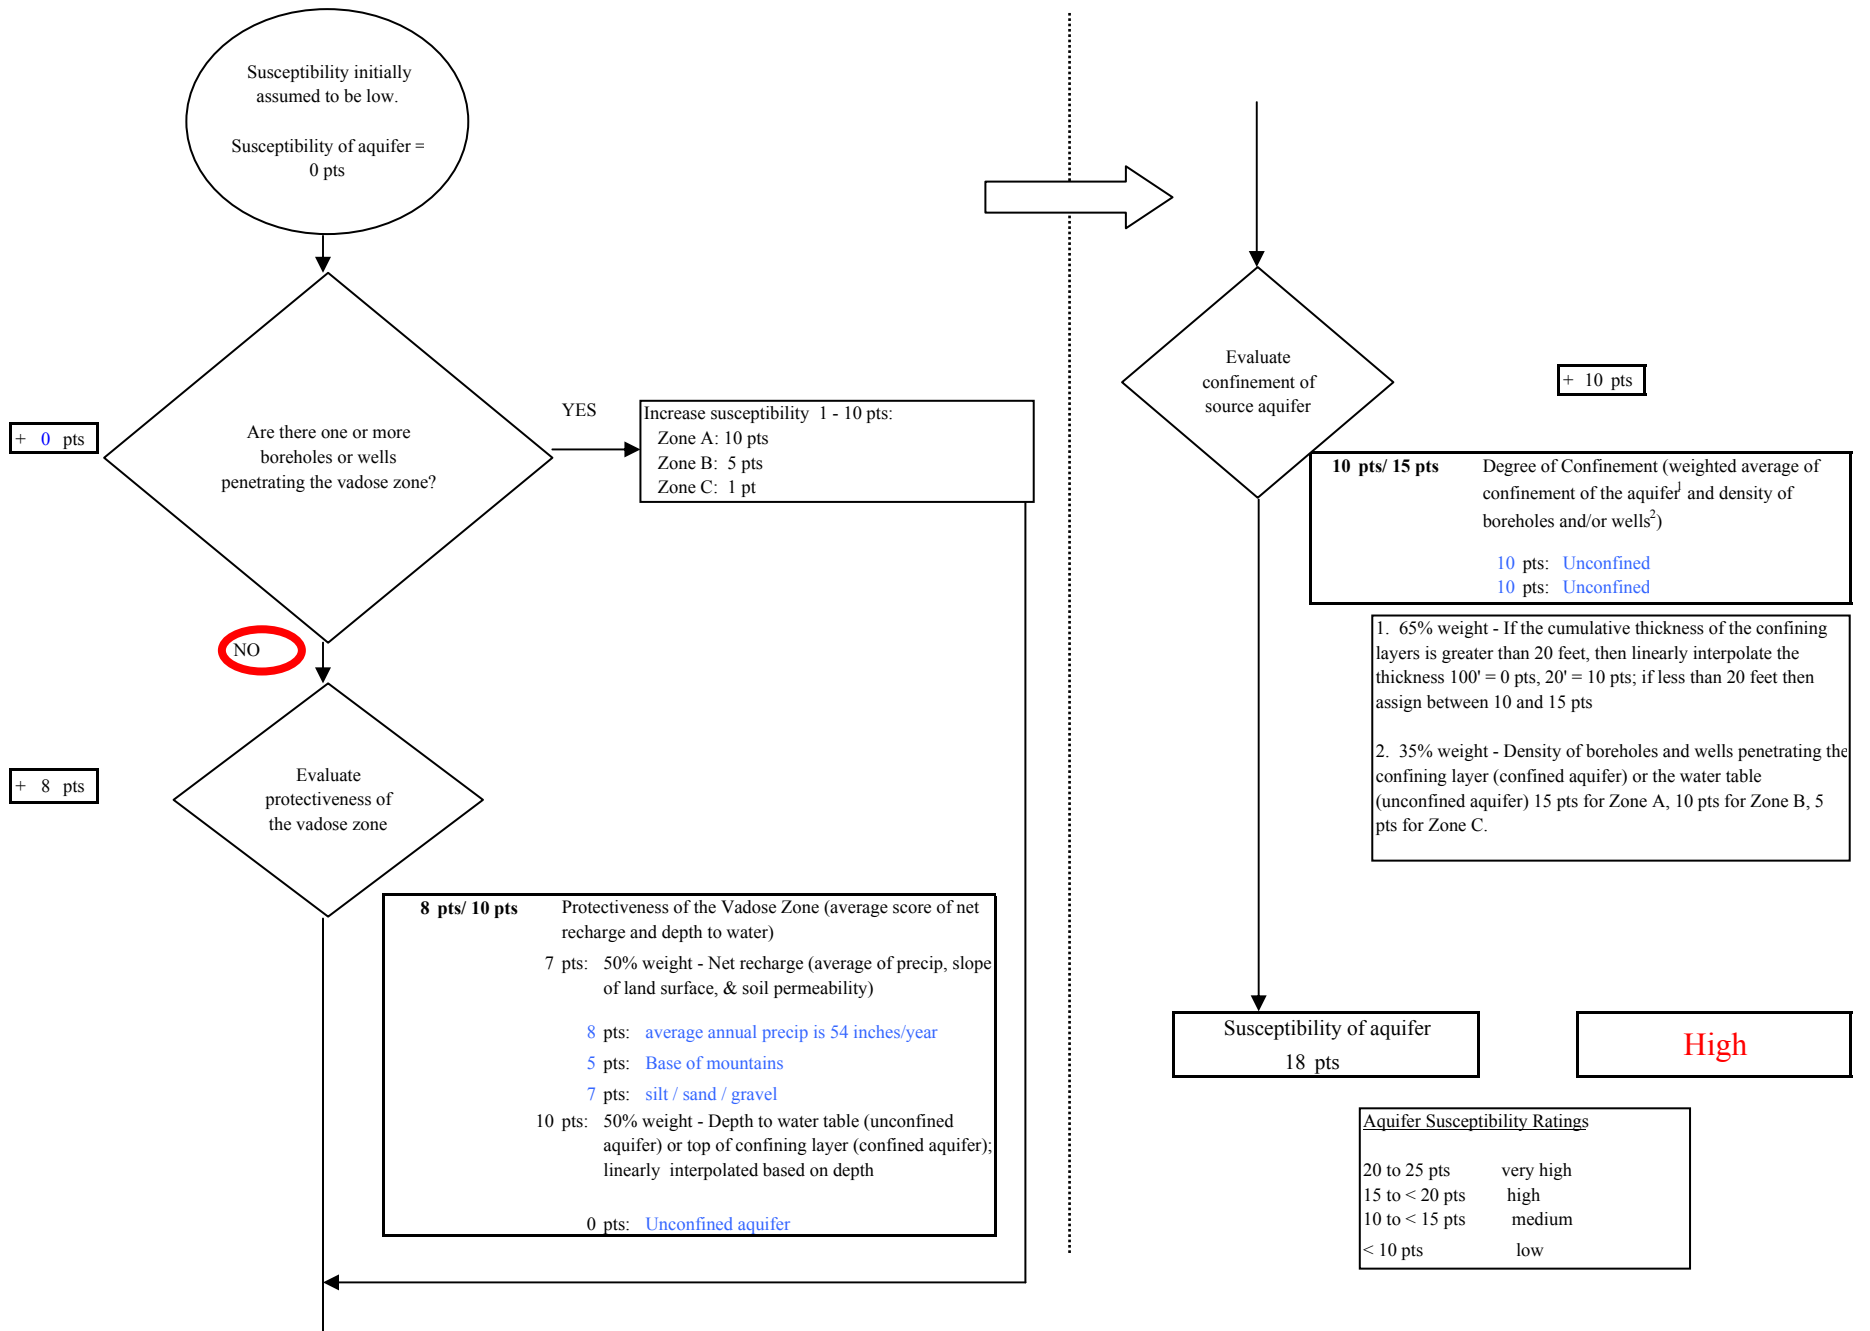


Chart 3. Contaminant Risks for Thunder Mountain Mobile Home Park - Bacteria & Viruses

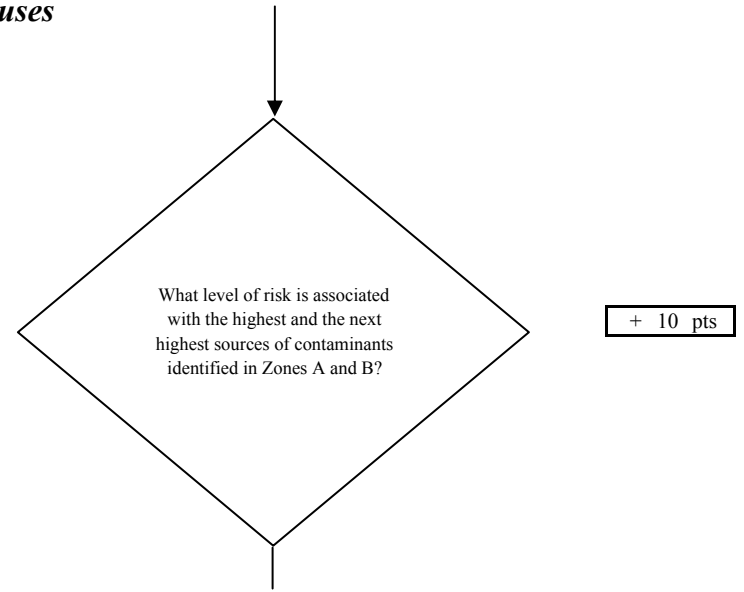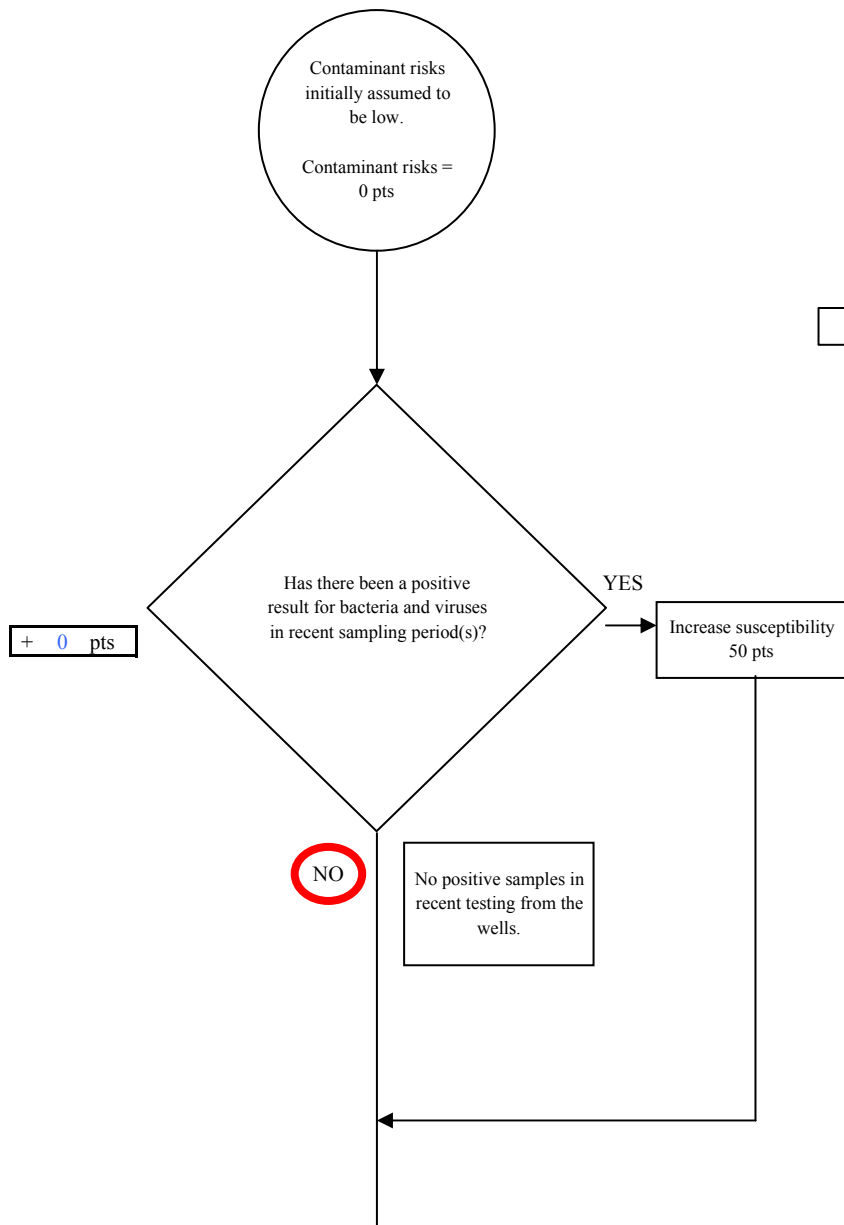

Risk Rankings for Contaminant Sources Identified in Zones A and B




	Zone A	Zone B	Total
Very High(s)	0	0	0
High(s)	0	0	0
Medium(s)	0	0	0
Low(s)	2	0	2

	LOW 10 pts	MEDIUM 20 pts	HIGH 30 pts	VERY HIGH 40 pts
LOW	≥ 10 sources + 10 pts	≥ 10 sources + 5 pts	≥ 20 sources + 5 pts	----
MEDIUM	----	≥ 2 sources + 5 pts	≥ 5 sources + 5 pts	≥ 10 sources + 5 pts
HIGH	----	----	≥ 1 source + 10 pts	≥ 2 sources + 10 pts
VERY HIGH	----	----	----	≥ 1 source + 10 pts

Matrix Score 10

Note: Septic systems, sewerlines, and roads are each assigned a risk ranking for each individual contaminant source in the CSI. The VA, however, counts these contaminant sources as a group and assigns a calculated number of either "lows" or "mediums" based on the density.

Chart 3. Contaminant Risks for Thunder Mountain Mobile Home Park - Bacteria & Viruses

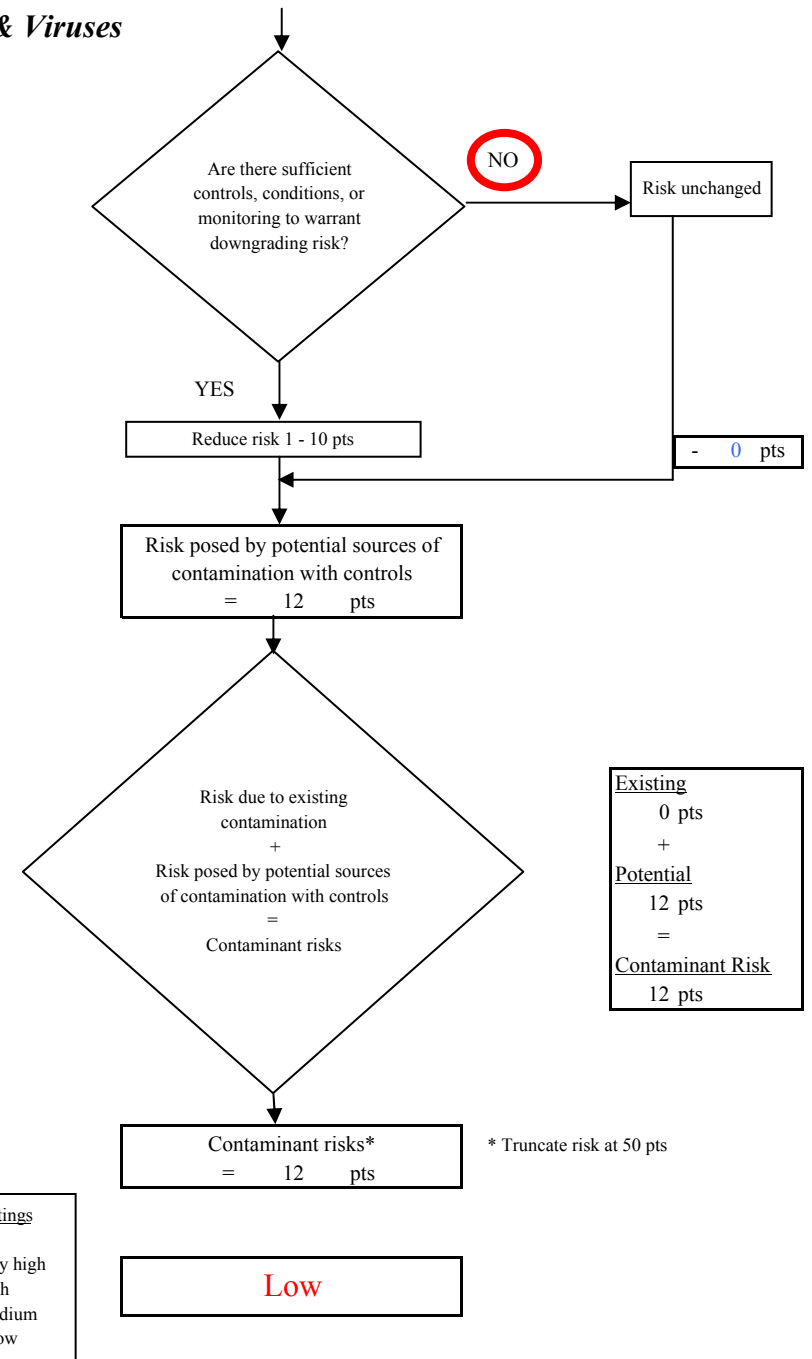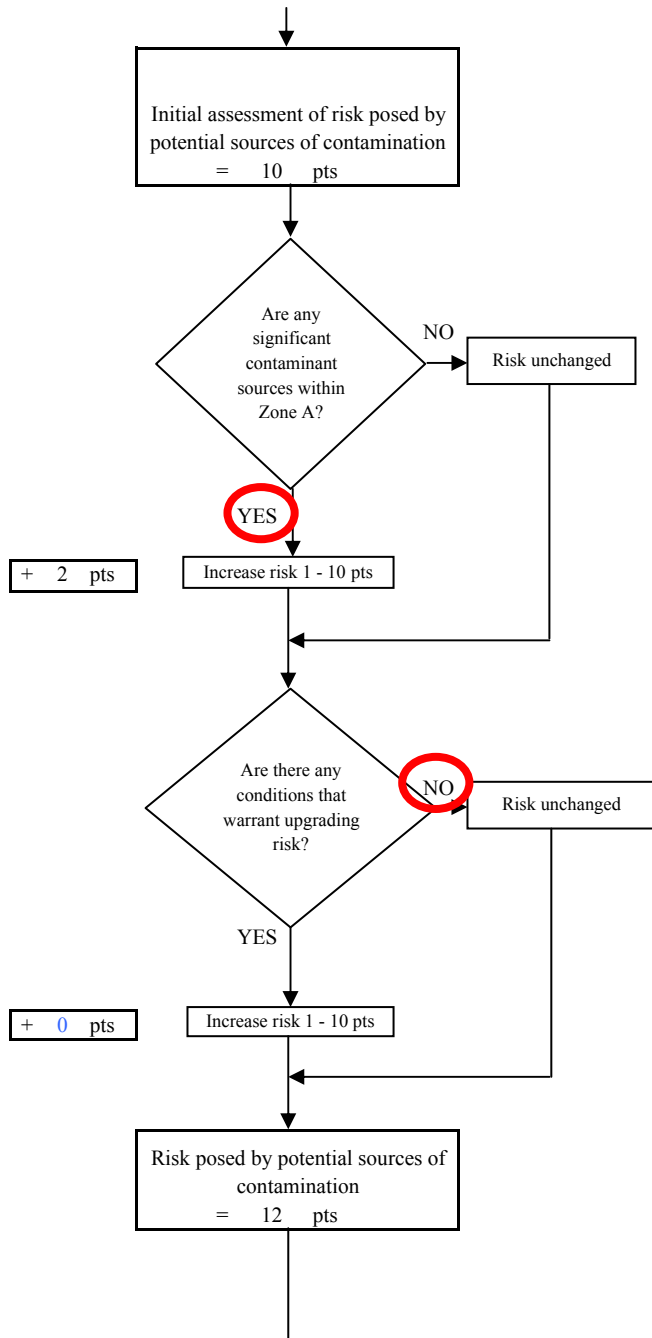

Existing
0 pts
+
Potential
12 pts
=
Contaminant Risk
12 pts

Contaminant Risk Ratings	
40 to 50 pts	very high
30 to < 40 pts	high
20 to < 30 pts	medium
< 20 pts	low

* Truncate risk at 50 pts

Chart 4. Vulnerability Analysis for Thunder Mountain Mobile Home Park - Bacteria & Viruses

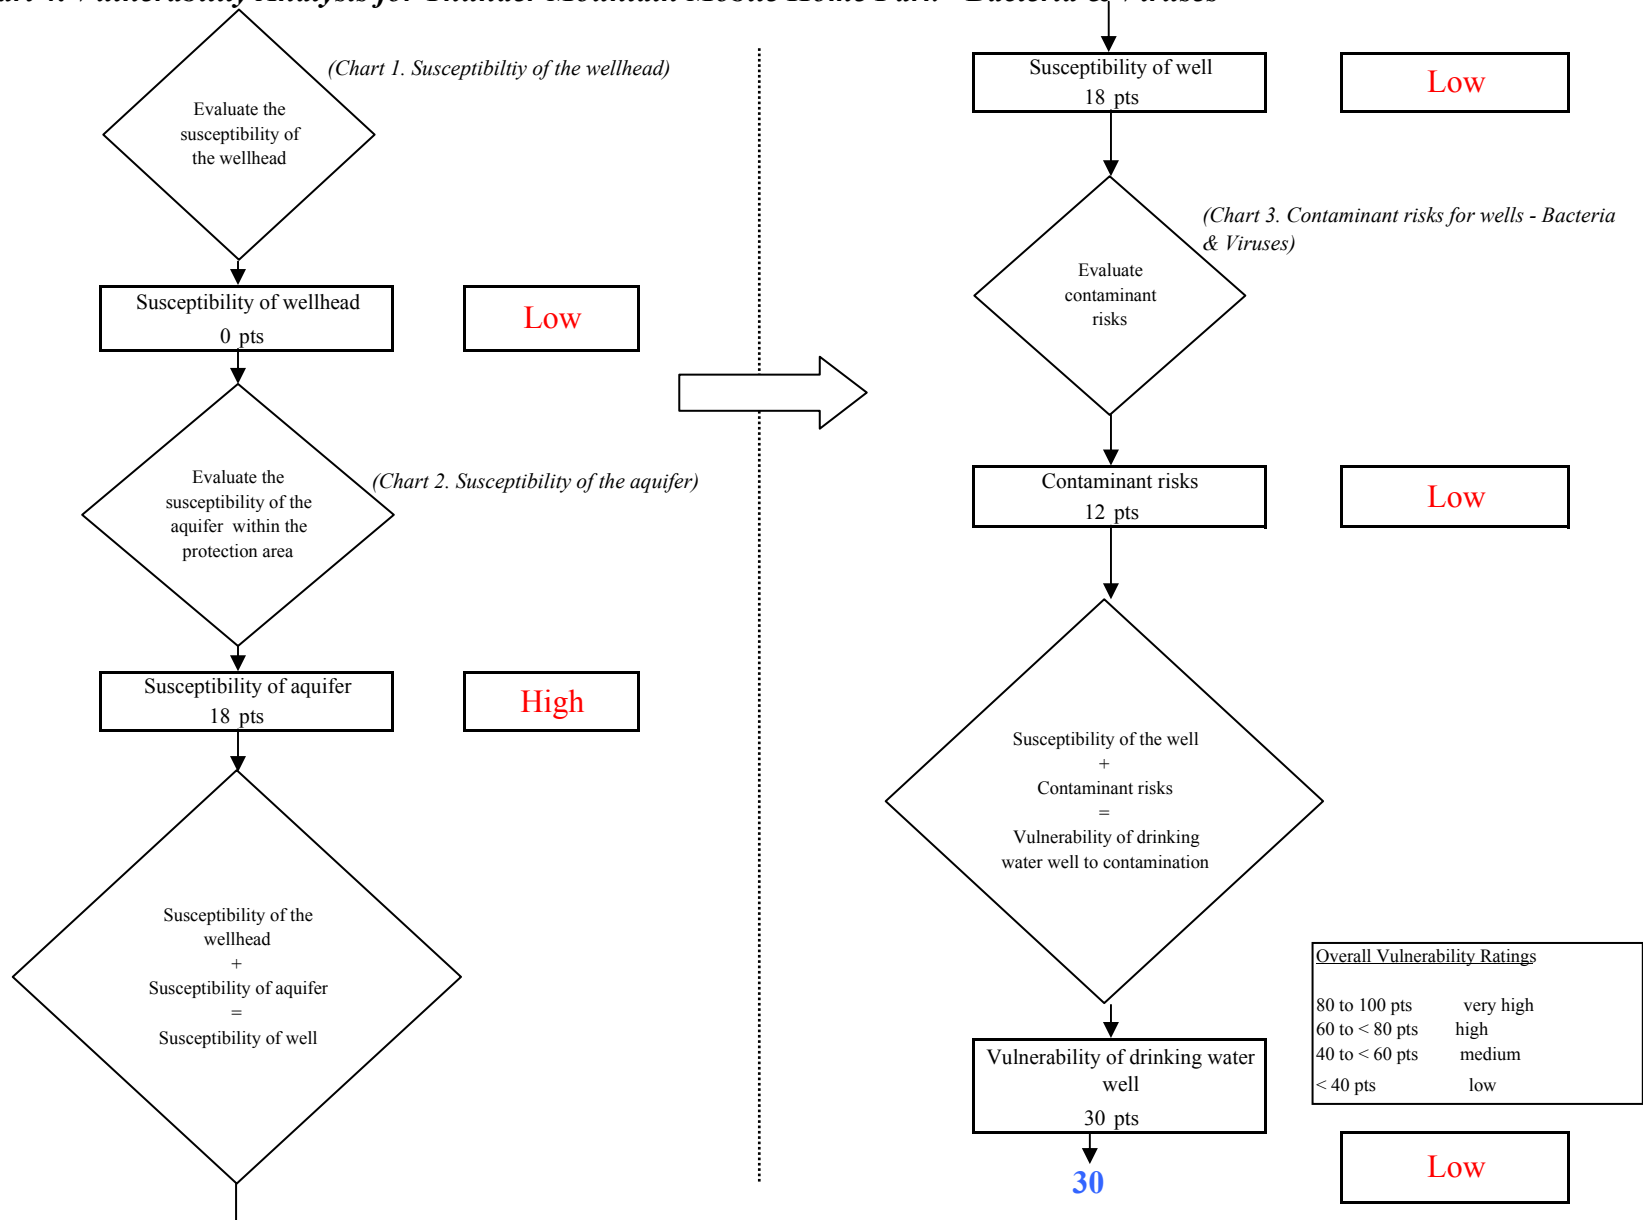


Chart 5. Contaminant Risks for Thunder Mountain Mobile Home Park - Nitrates and Nitrites


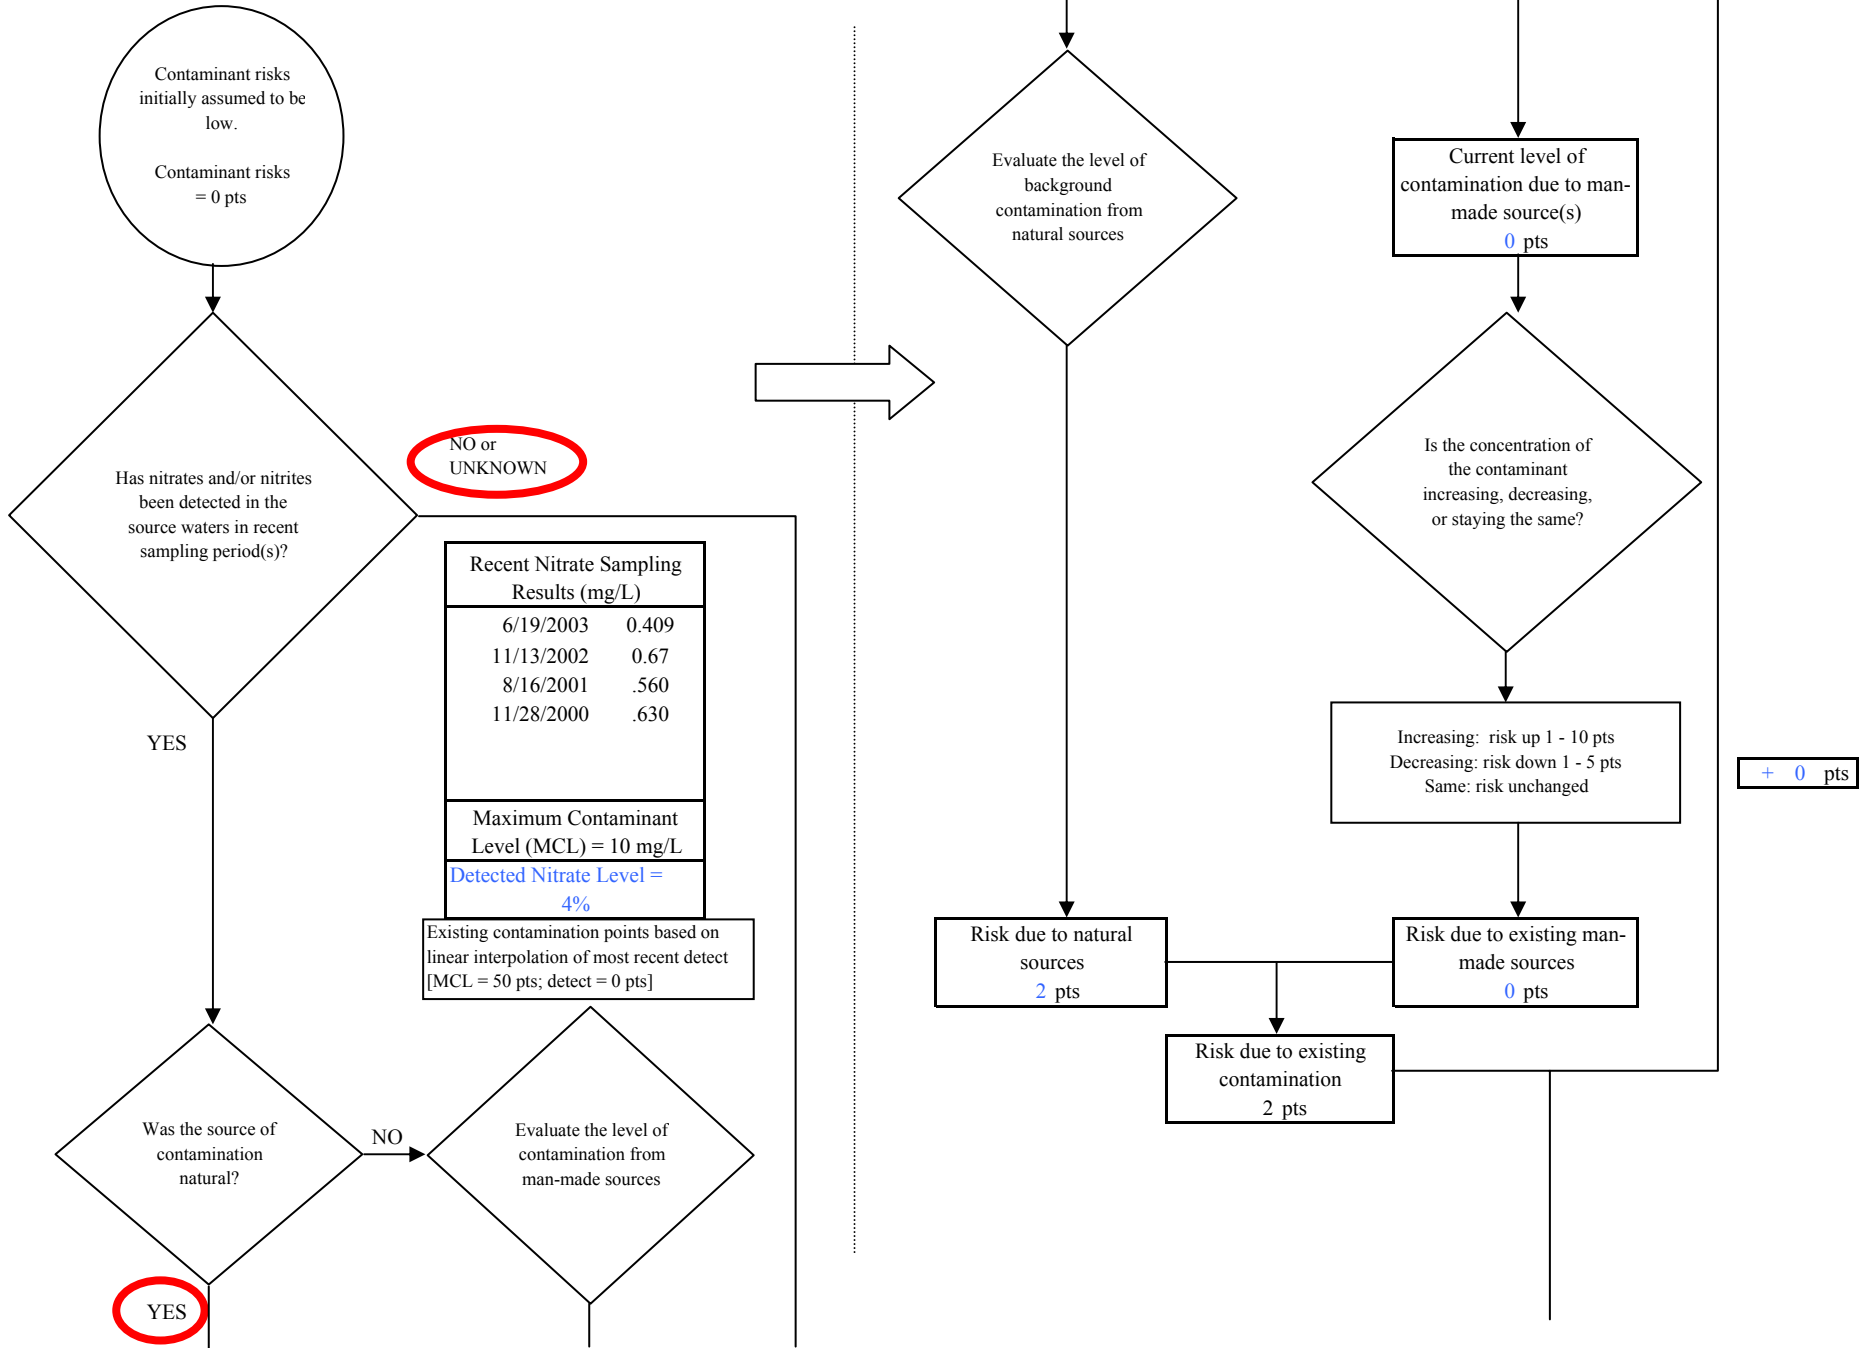


Chart 5. Contaminant Risks for Thunder Mountain Mobile Home Park - Nitrates and Nitrites

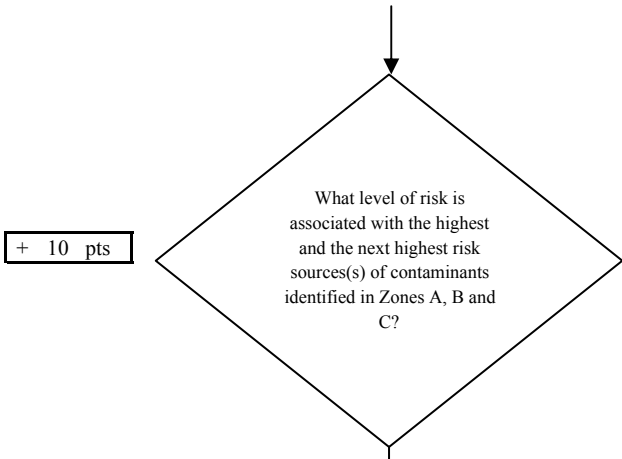



+ 10 pts

Risk Levels for Contaminant Sources identified in Zones A, B and C			
	Zone A	Zones B&C	Total
Very Highs(s)	0	0	0
High(s)	0	0	0
Medium(s)	0	0	0
Low(s)	2	0	2

	LOW 10 pts	MEDIUM 20 pts	HIGH 30 pts	VERY HIGH 40 pts
LOW	≥ 10 sources + 10 pts	≥ 10 sources + 5 pts	≥ 20 sources + 5 pts	----
MEDIUM	----	≥ 2 sources + 5 pts	≥ 5 sources + 5 pts	≥ 10 sources + 5 pts
HIGH	----	----	≥ 1 source + 10 pts	≥ 2 sources + 10 pts
VERY HIGH	----	----	----	≥ 1 source + 10 pts

Matrix Score 10

Note: Septic systems, sewerlines, and roads are each assigned a risk ranking for each individual contaminant source in the CSI. The VA, however, counts these contaminant sources as a group and assigns a calculated number of either "lows" or "mediums" based on the density.

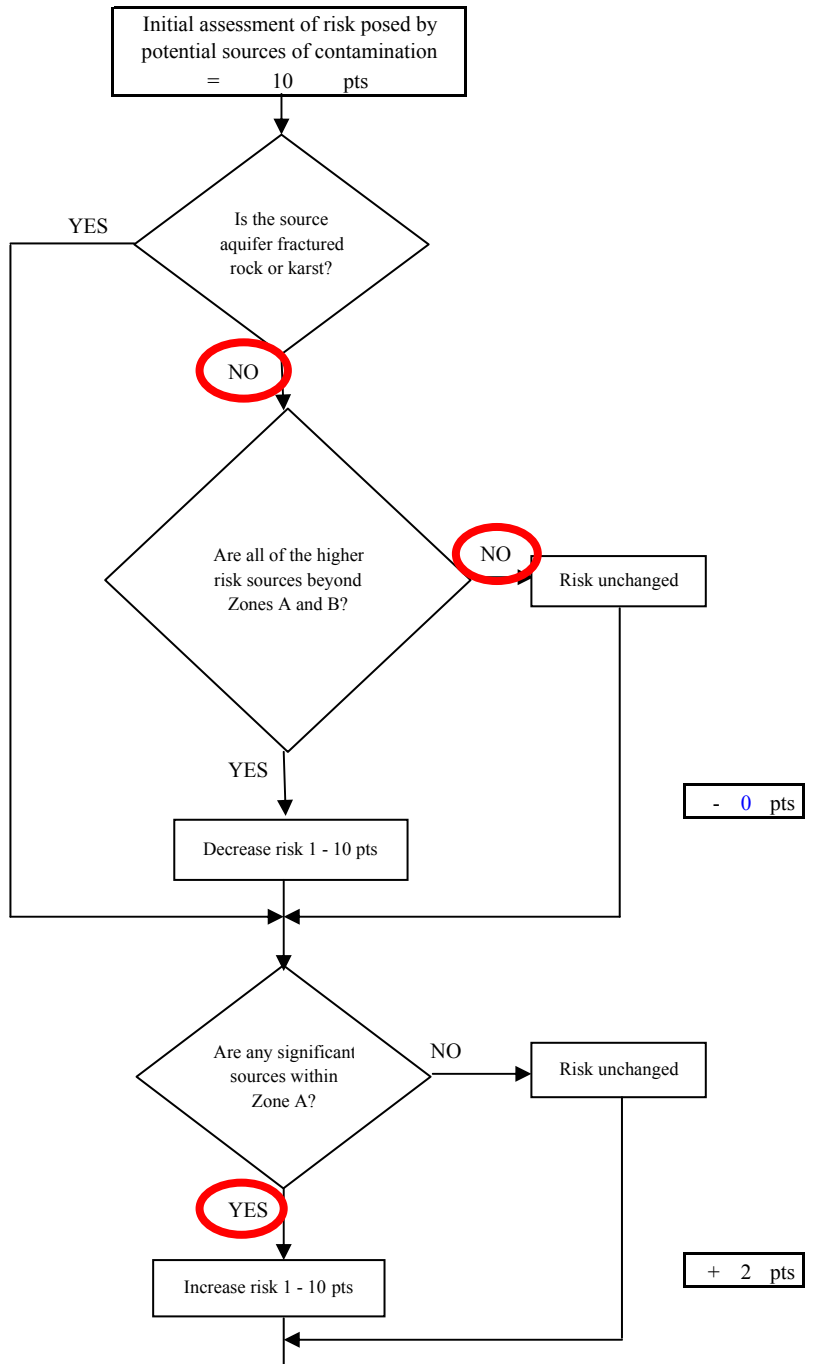

- 0 pts

+ 2 pts

Chart 5. Contaminant Risks for Thunder Mountain Mobile Home Park - Nitrates and Nitrites

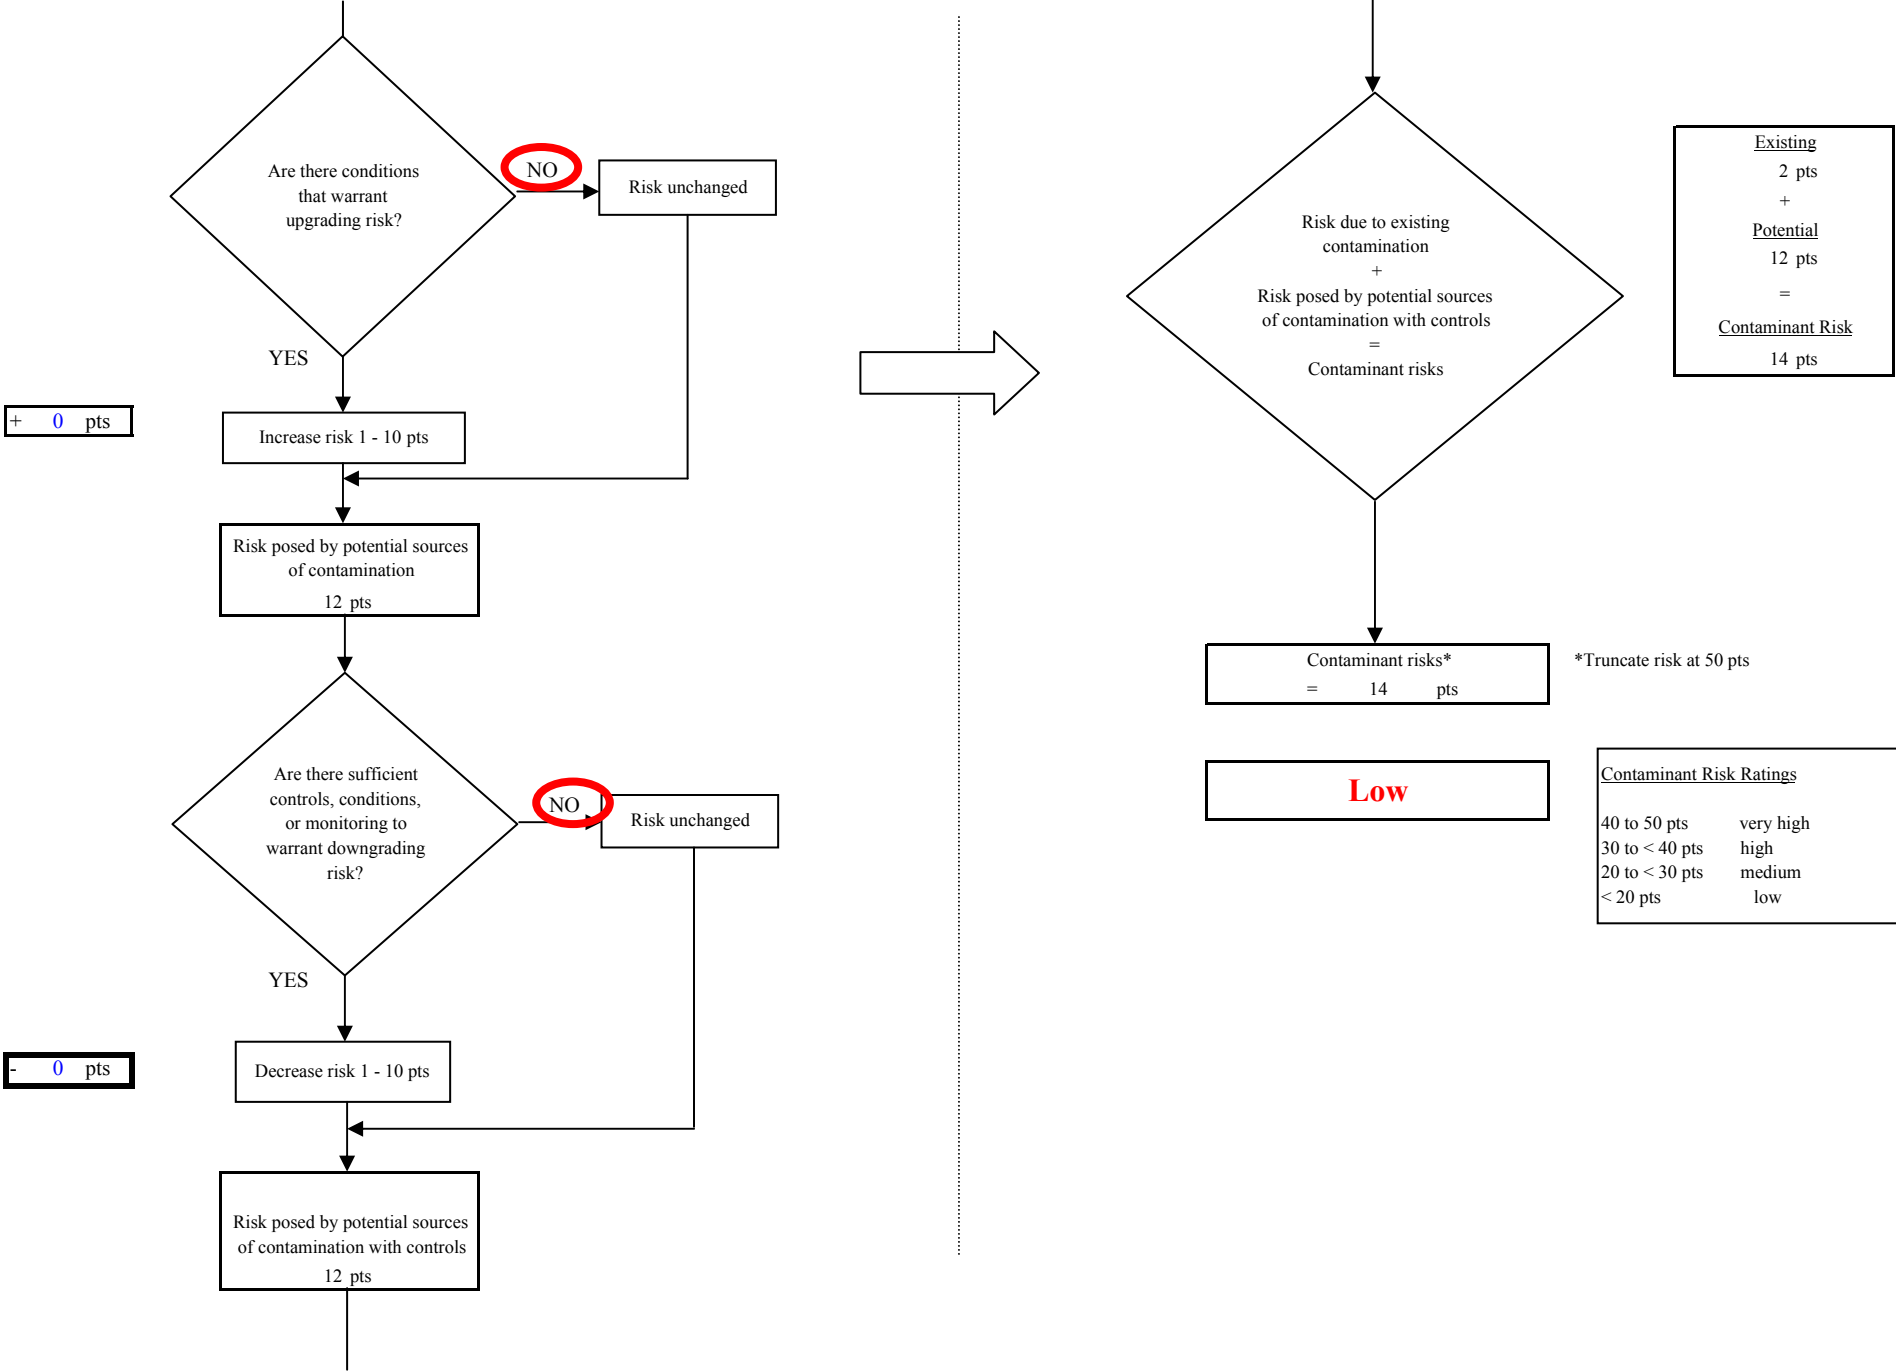


Chart 6. Vulnerability Analysis for Thunder Mountain Mobile Home Park - Nitrates and Nitrites

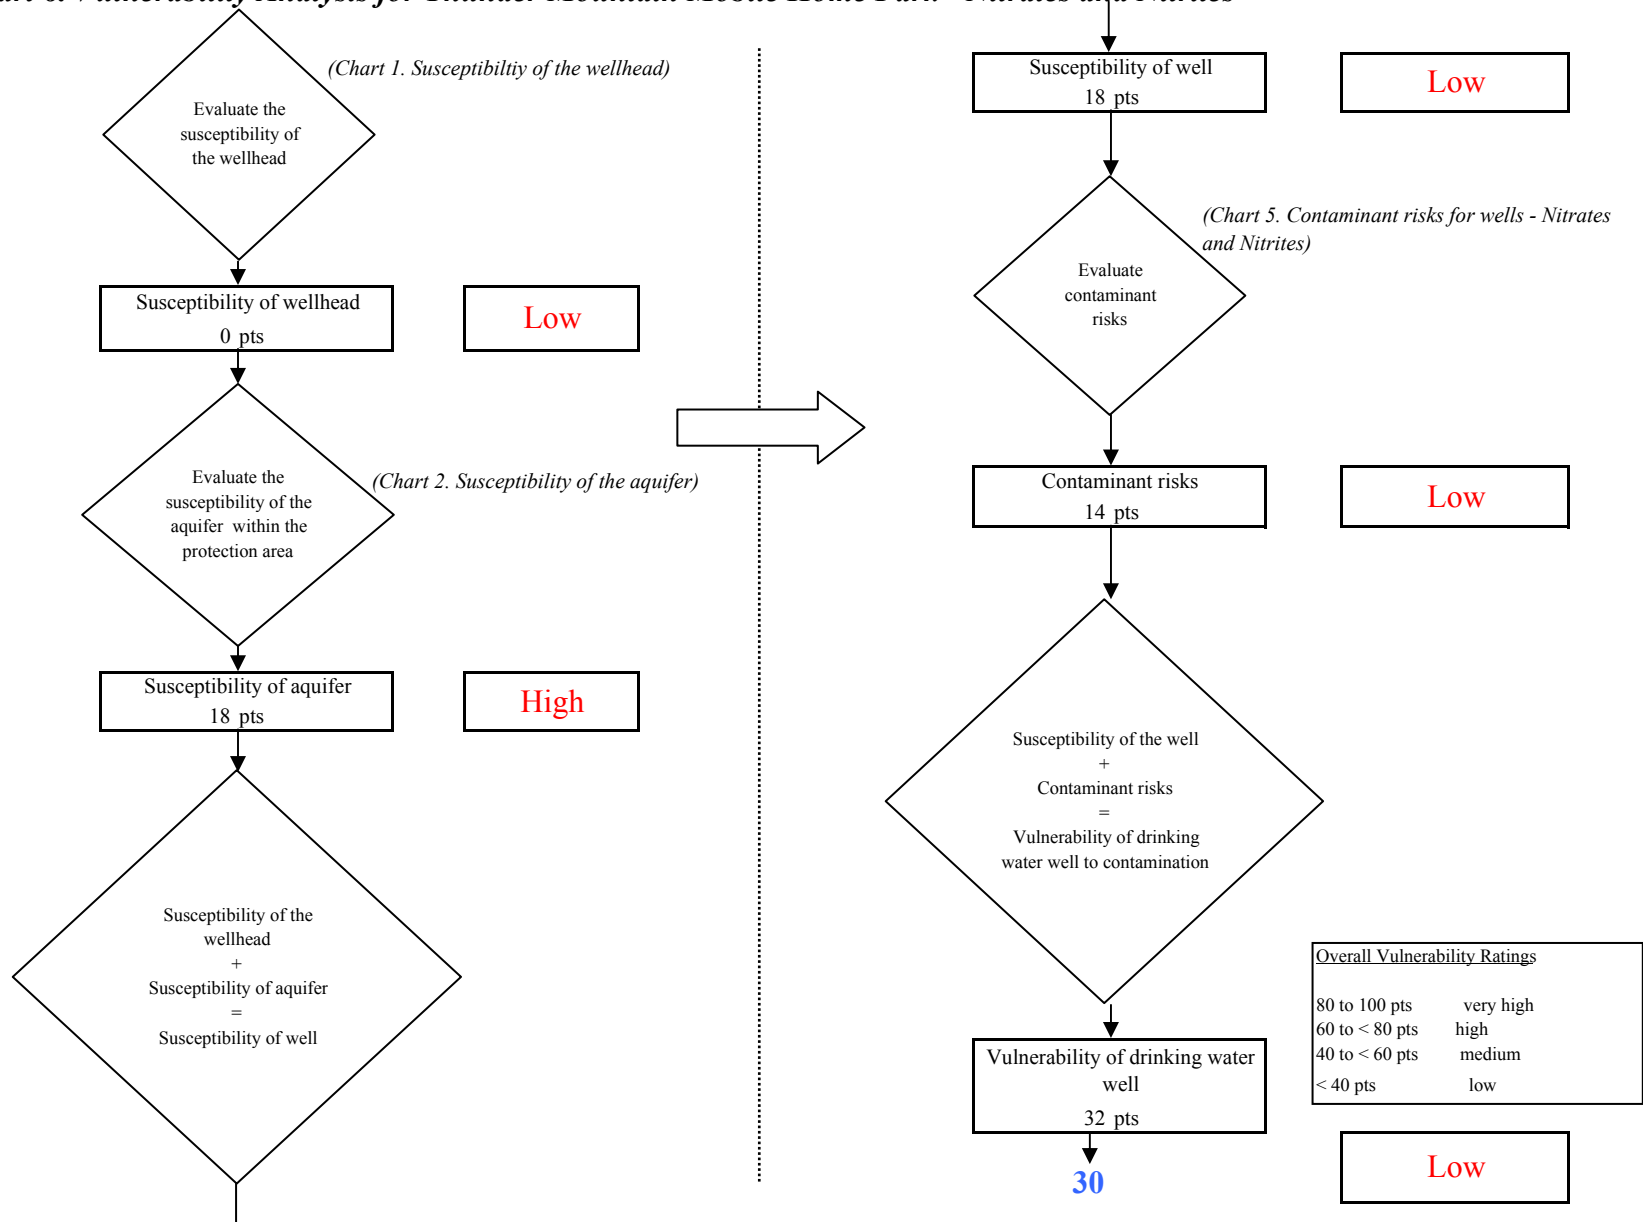


Chart 7. Contaminant Risks for Thunder Mountain Mobile Home Park - Volatile Organic Chemicals


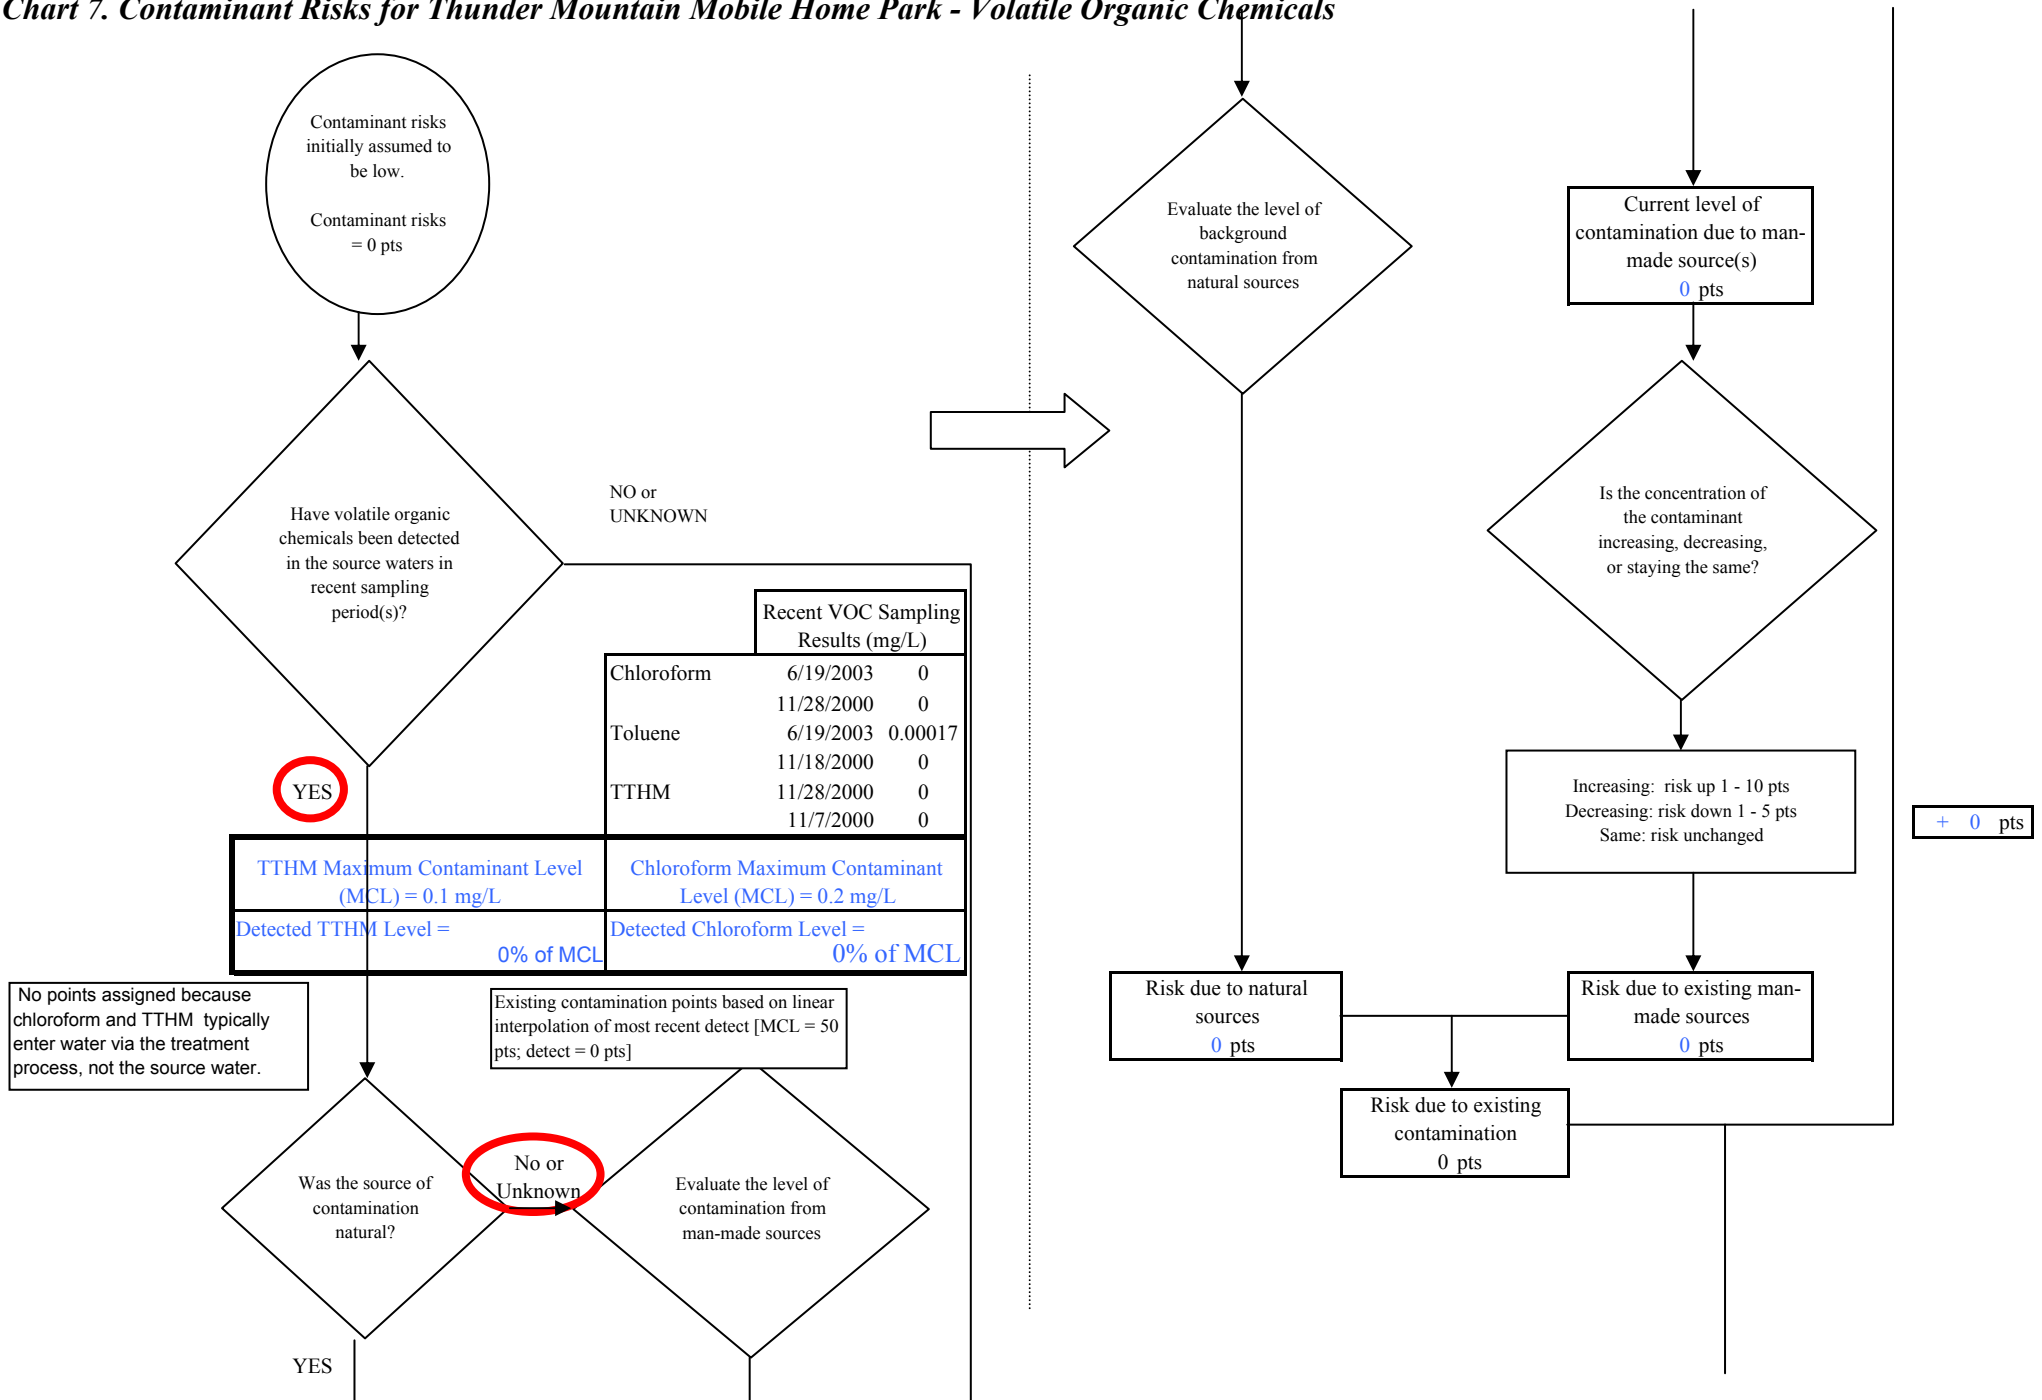


Chart 7. Contaminant Risks for Thunder Mountain Mobile Home Park - Volatile Organic Chemicals

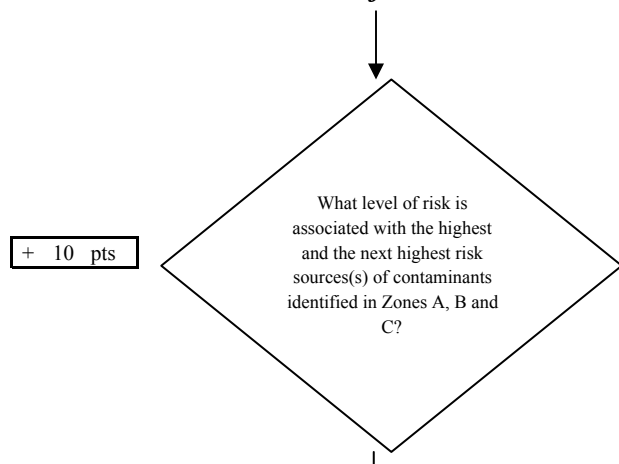

Risk Levels for Contaminant Sources identified in Zones A, B and C			
	Zone A	Zones B&C	Total
Very High(s)	0	0	0
High(s)	0	0	0
Medium(s)	0	0	0
Low(s)	3	0	3

	LOW 10 pts	MEDIUM 20 pts	HIGH 30 pts	VERY HIGH 40 pts
LOW	≥ 10 sources + 10 pts	≥ 10 sources + 5 pts	≥ 20 sources + 5 pts	----
MEDIUM	----	≥ 2 sources + 5 pts	≥ 5 sources + 5 pts	≥ 10 sources + 5 pts
HIGH	----	----	≥ 1 source + 10 pts	≥ 2 sources + 10 pts
VERY HIGH	----	----	----	≥ 1 source + 10 pts

Matrix Score 10

Note: Septic systems, sewerlines, and roads are each assigned a risk ranking for each individual contaminant source in the CSI. The VA, however, counts these contaminant sources as a group and assigns a calculated number of either "lows" or "mediums" based on the density.

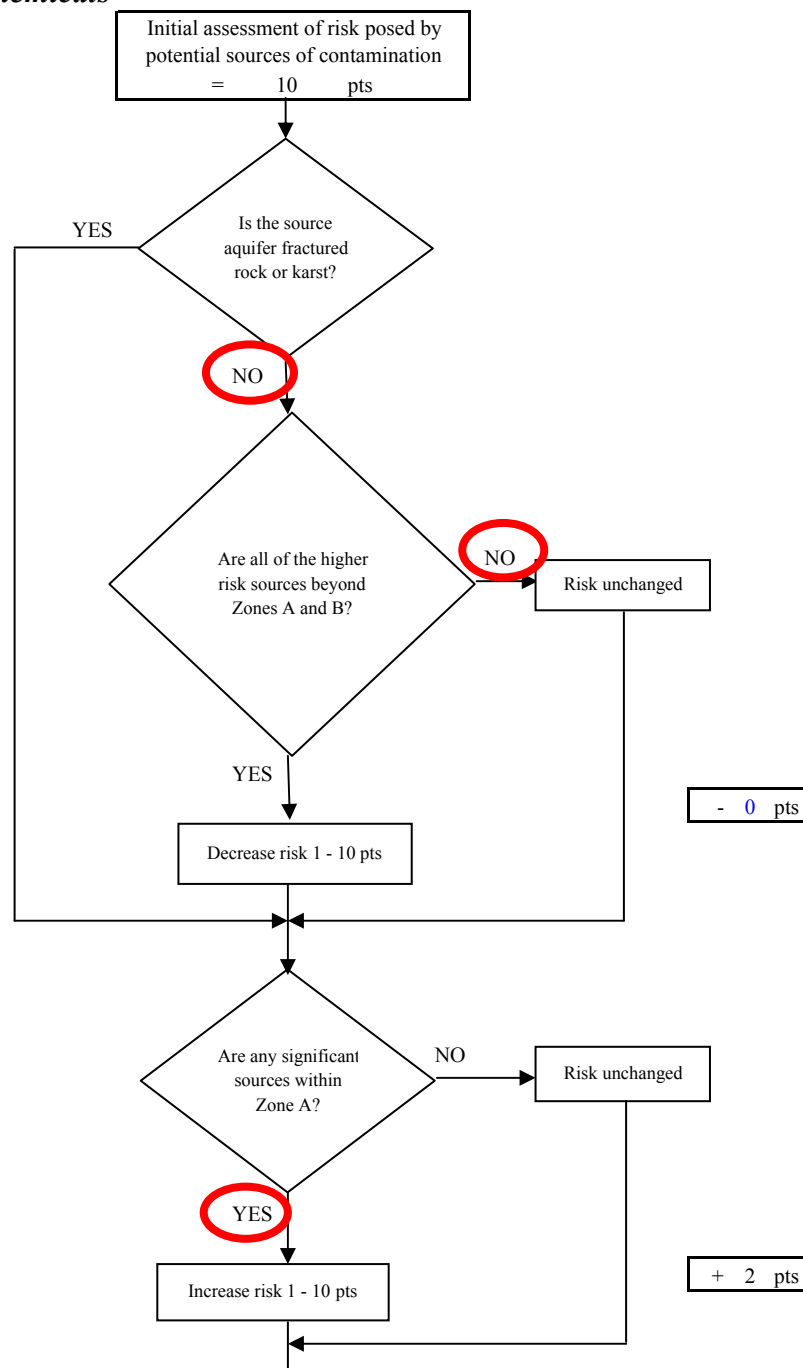



Chart 7. Contaminant Risks for Thunder Mountain Mobile Home Park - Volatile Organic Chemicals

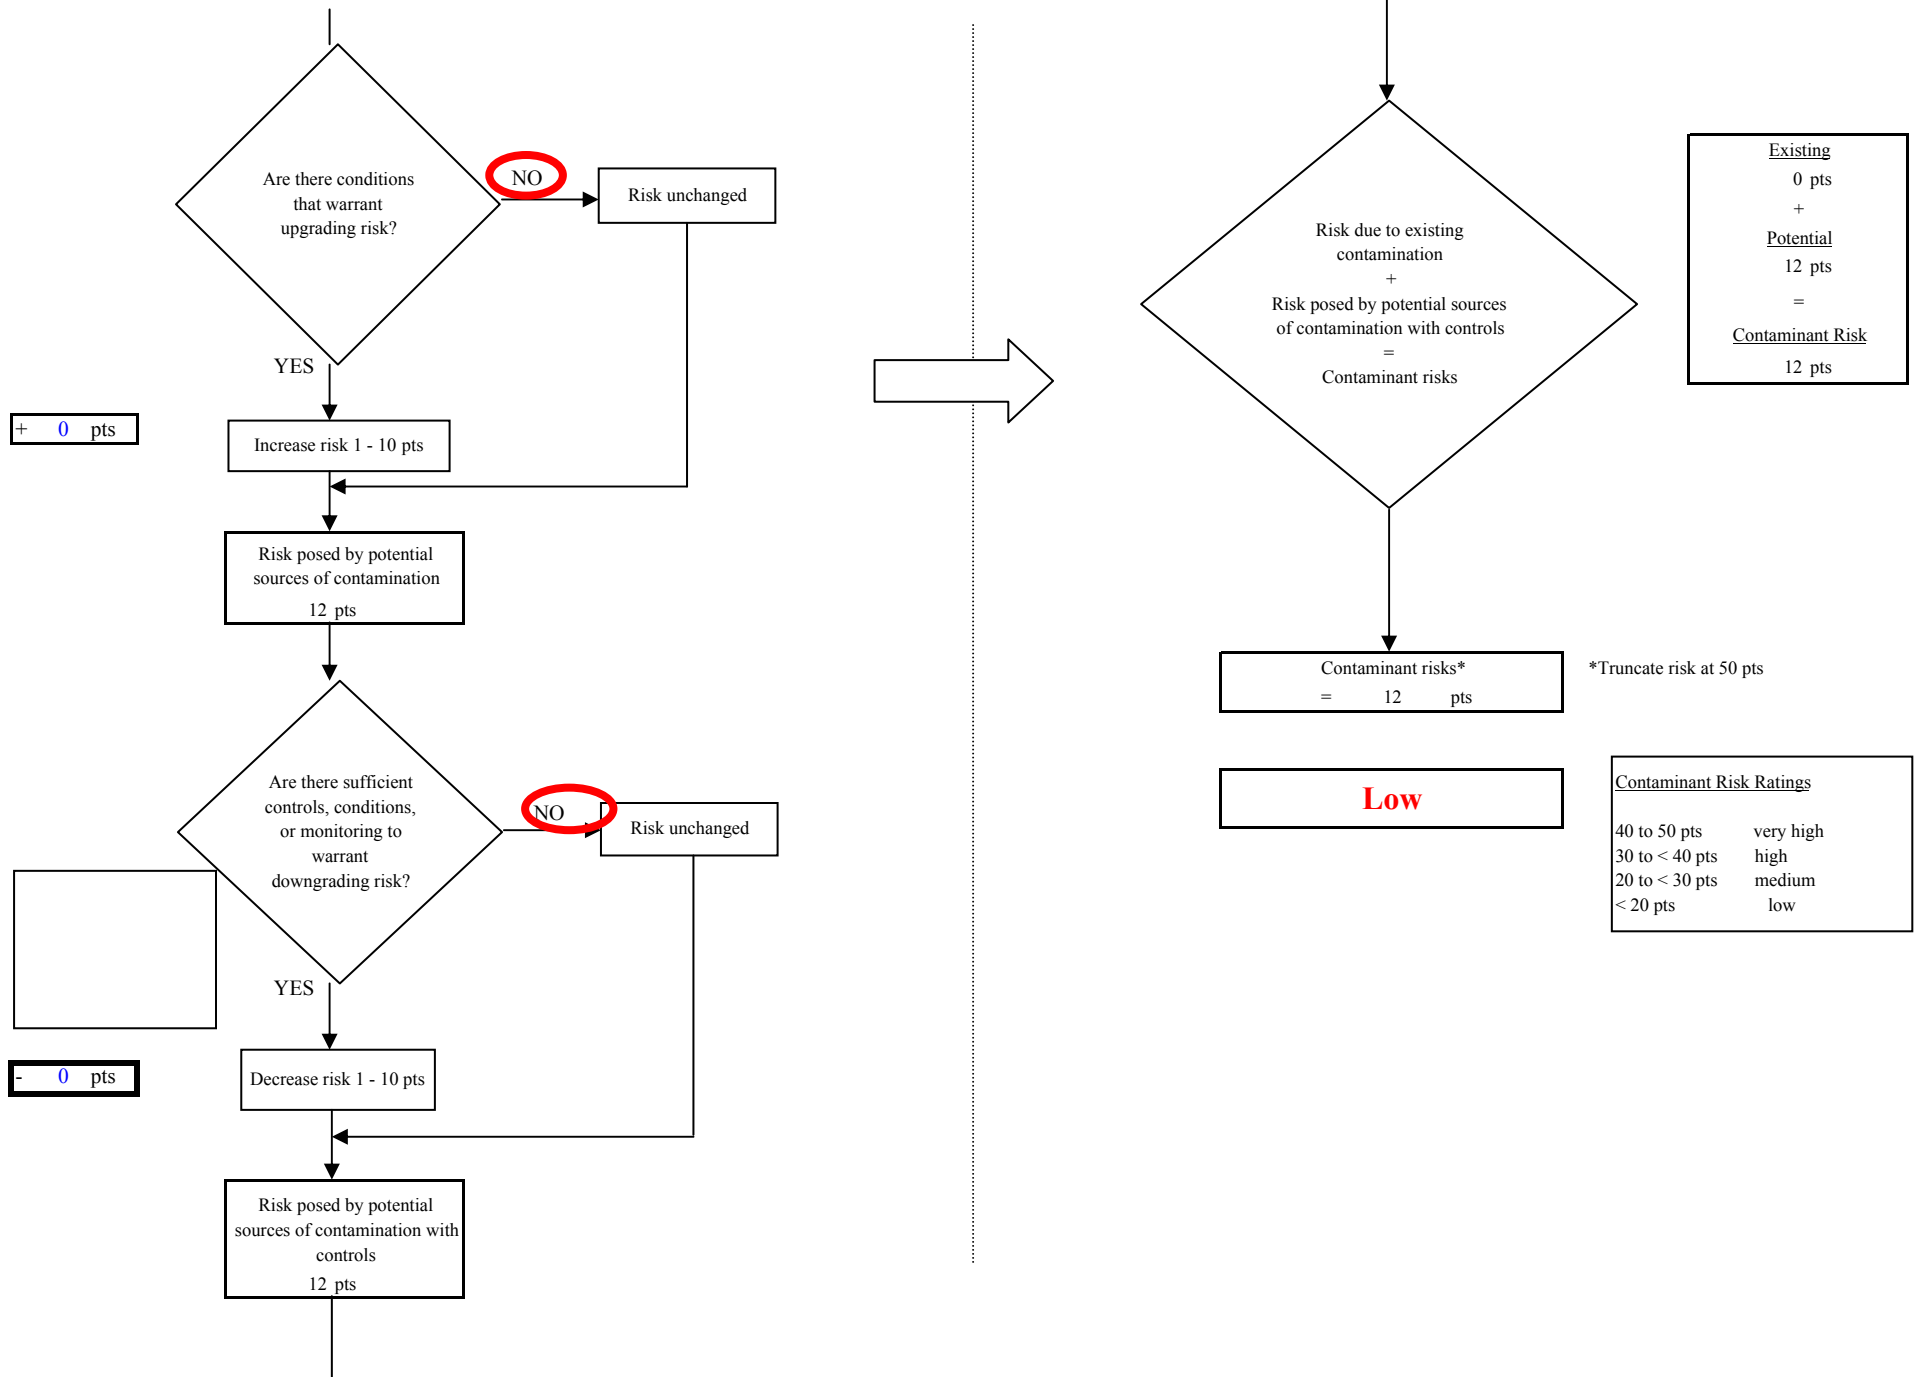


Chart 8. Vulnerability Analysis for Thunder Mountain Mobile Home Park - Volatile Organic Chemicals

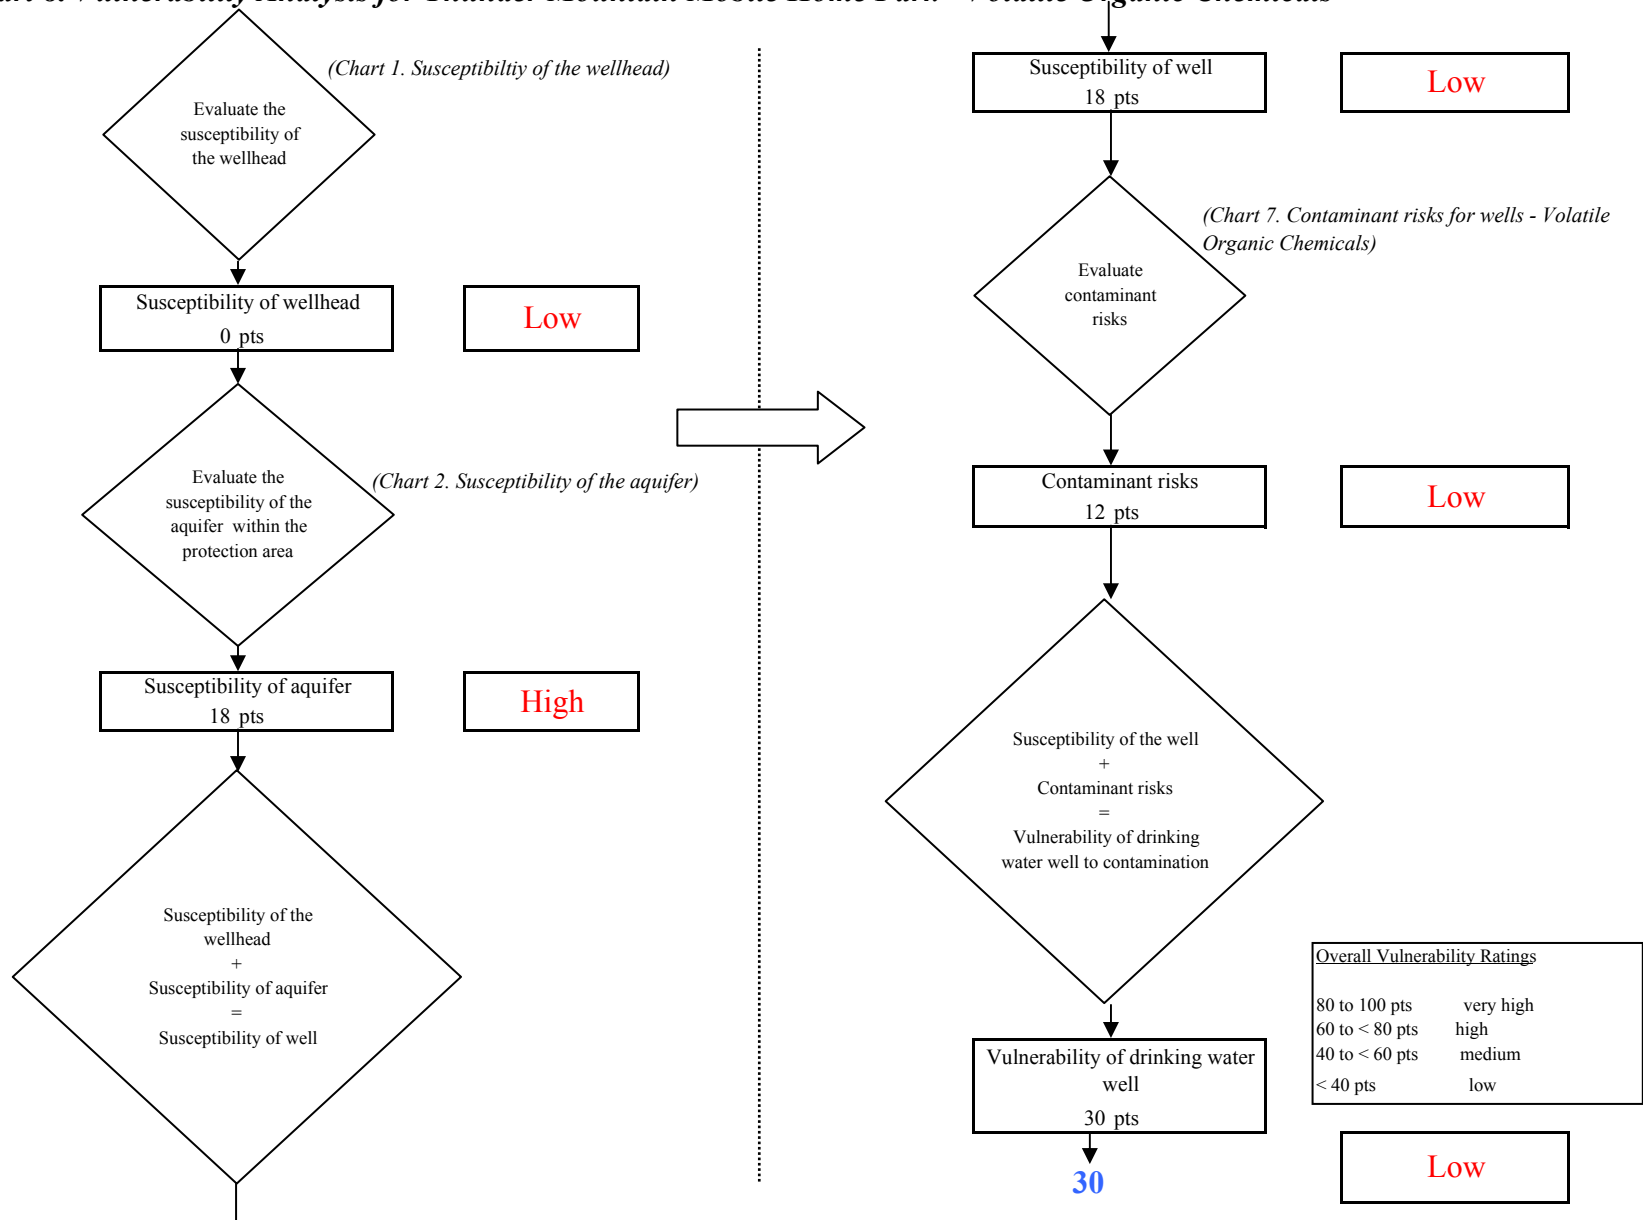


Chart 9. Contaminant Risks for Thunder Mountain Mobile Home Park - Heavy Metals, Cyanide and Other Inorganic Chemicals


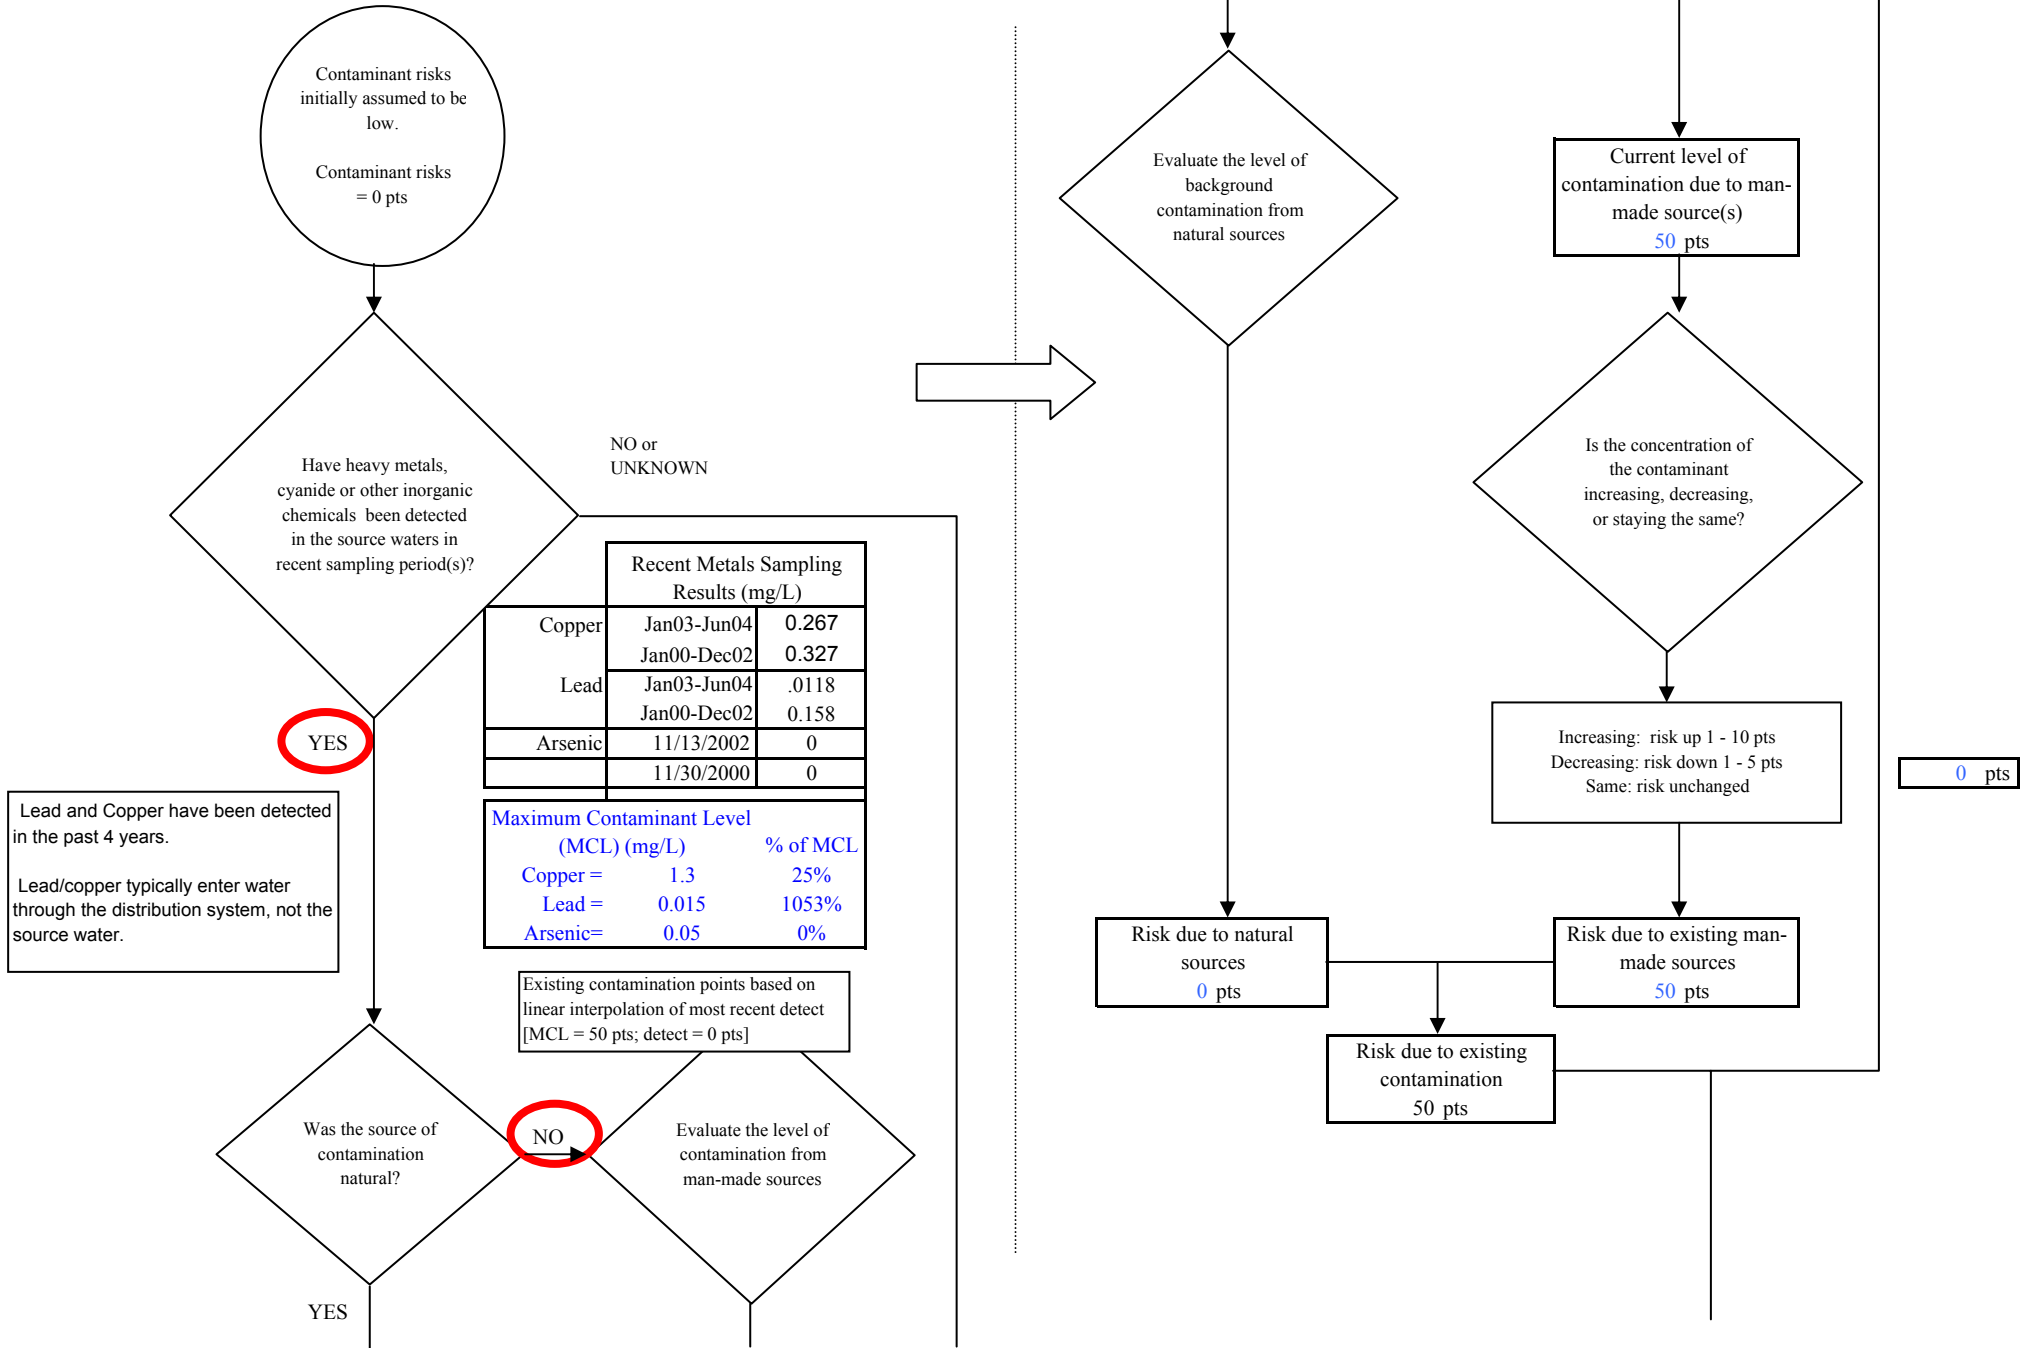


Chart 9. Contaminant Risks for Thunder Mountain Mobile Home Park - Heavy Metals, Cyanide and Other Inorganic Chemicals

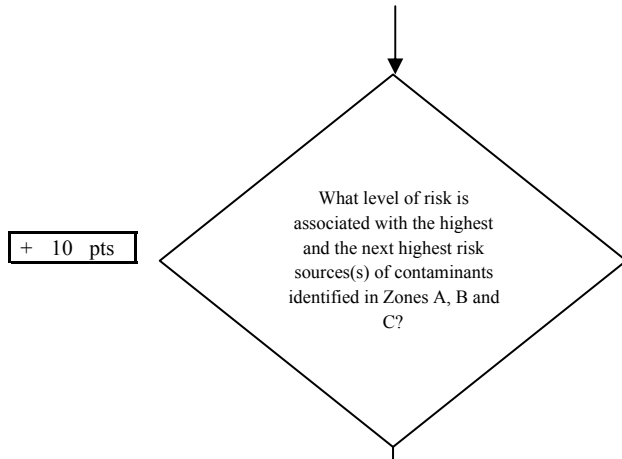

+ 10 pts

Risk Levels for Contaminant Sources identified in Zones A, B and C			
	Zone A	Zones B&C	Total
Very High(s)	0	0	0
High(s)	0	0	0
Medium(s)	0	0	0
Low(s)	3	0	3

	LOW 10 pts	MEDIUM 20 pts	HIGH 30 pts	VERY HIGH 40 pts
LOW	≥ 10 sources + 10 pts	≥ 10 sources + 5 pts	≥ 20 sources + 5 pts	----
MEDIUM	----	≥ 2 sources + 5 pts	≥ 5 sources + 5 pts	≥ 10 sources + 5 pts
HIGH	----	----	≥ 1 source + 10 pts	≥ 2 sources + 10 pts
VERY HIGH	----	----	----	≥ 1 source + 10 pts

Matrix Score 10

Note: Septic systems, sewerlines, and roads are each assigned a risk ranking for each individual contaminant source in the CSI. The VA, however, counts these contaminant sources as a group and assigns a calculated number of either "lows" or "mediums" based on the density.

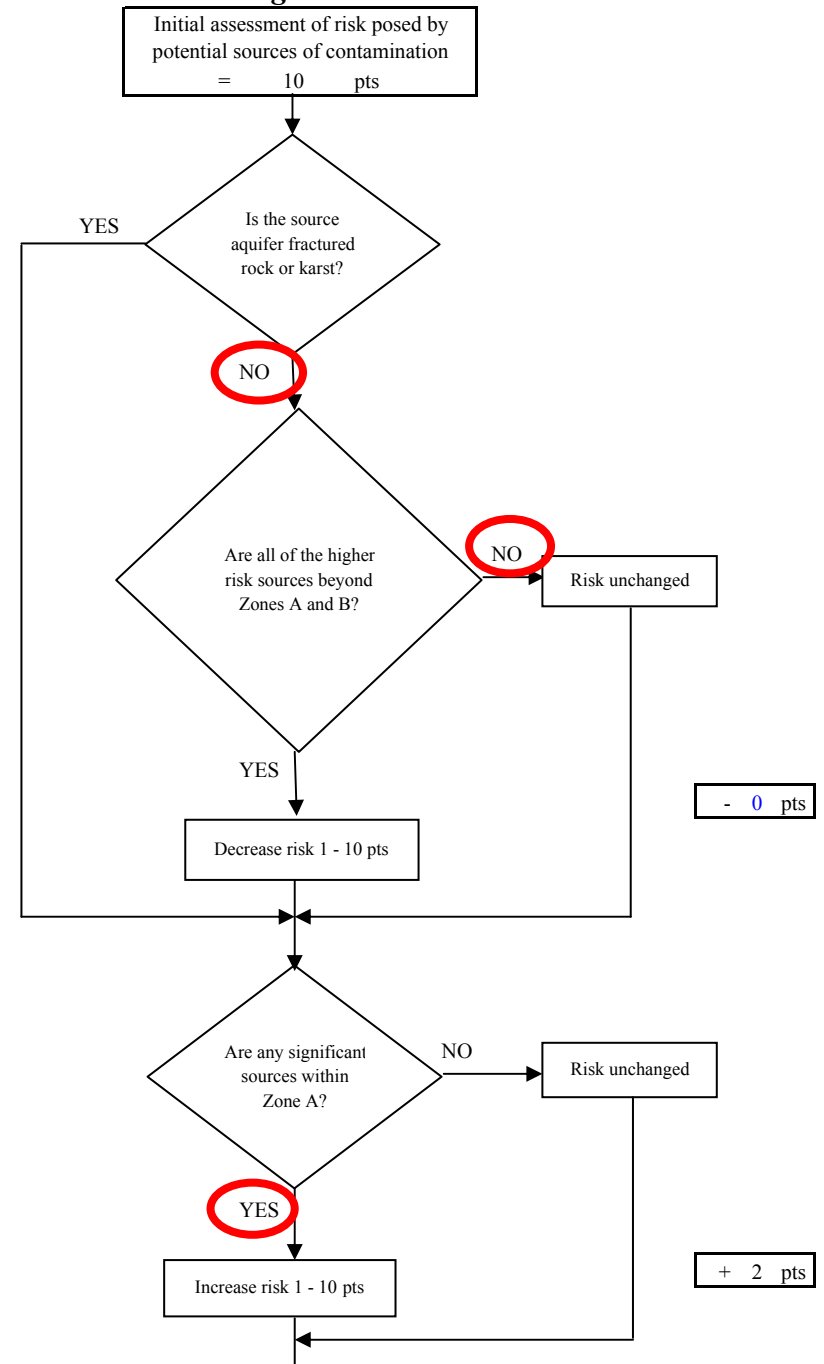



Chart 9. Contaminant Risks for Thunder Mountain Mobile Home Park - Heavy Metals, Cyanide and Other Inorganic Chemicals

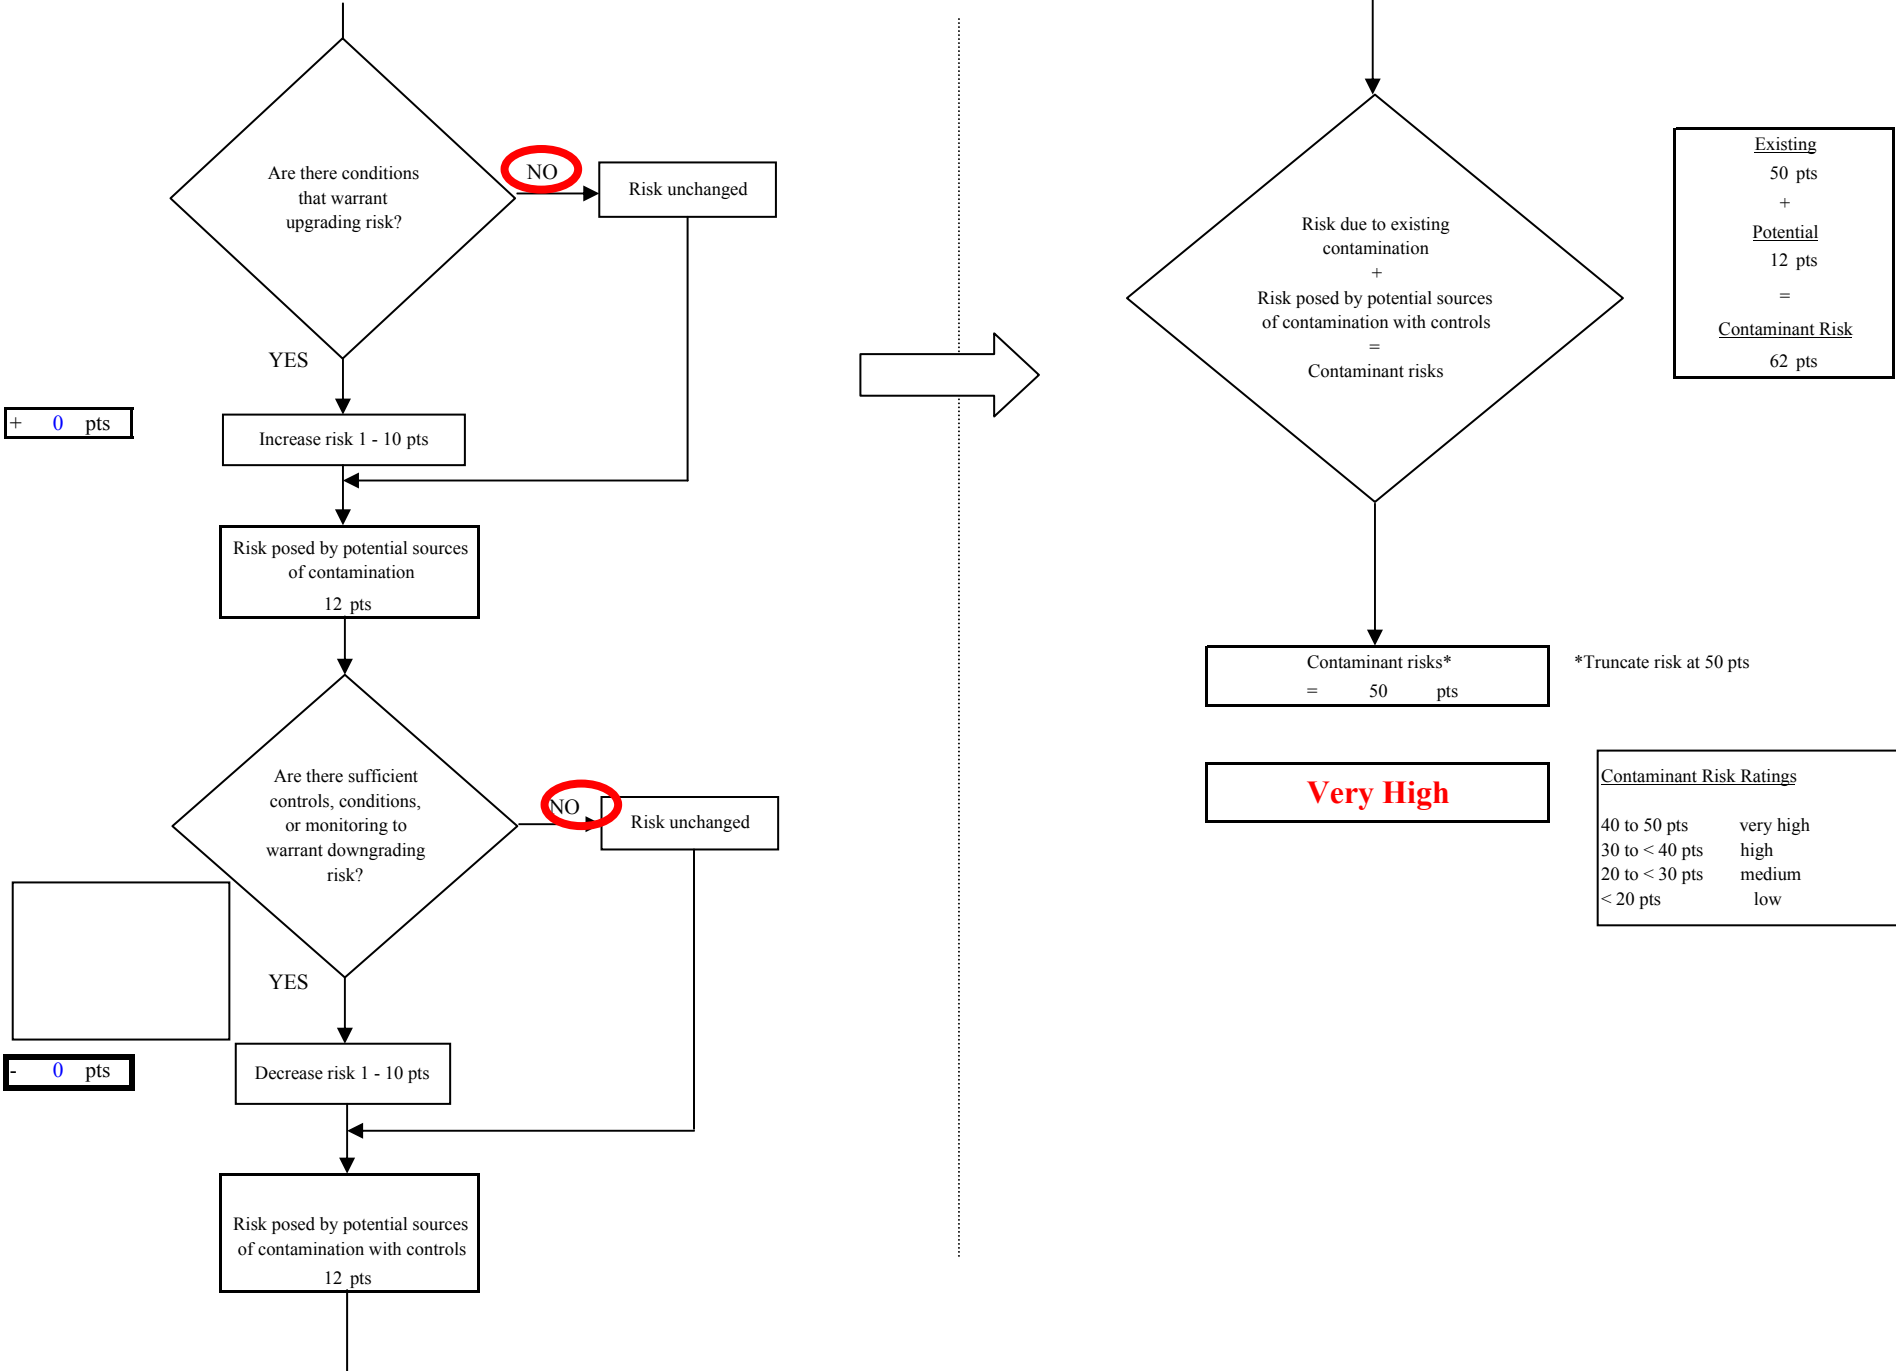


Chart 10. Vulnerability Analysis for Thunder Mountain Mobile Home Park - Heavy Metals, Cyanide and Other Inorganic Chemicals

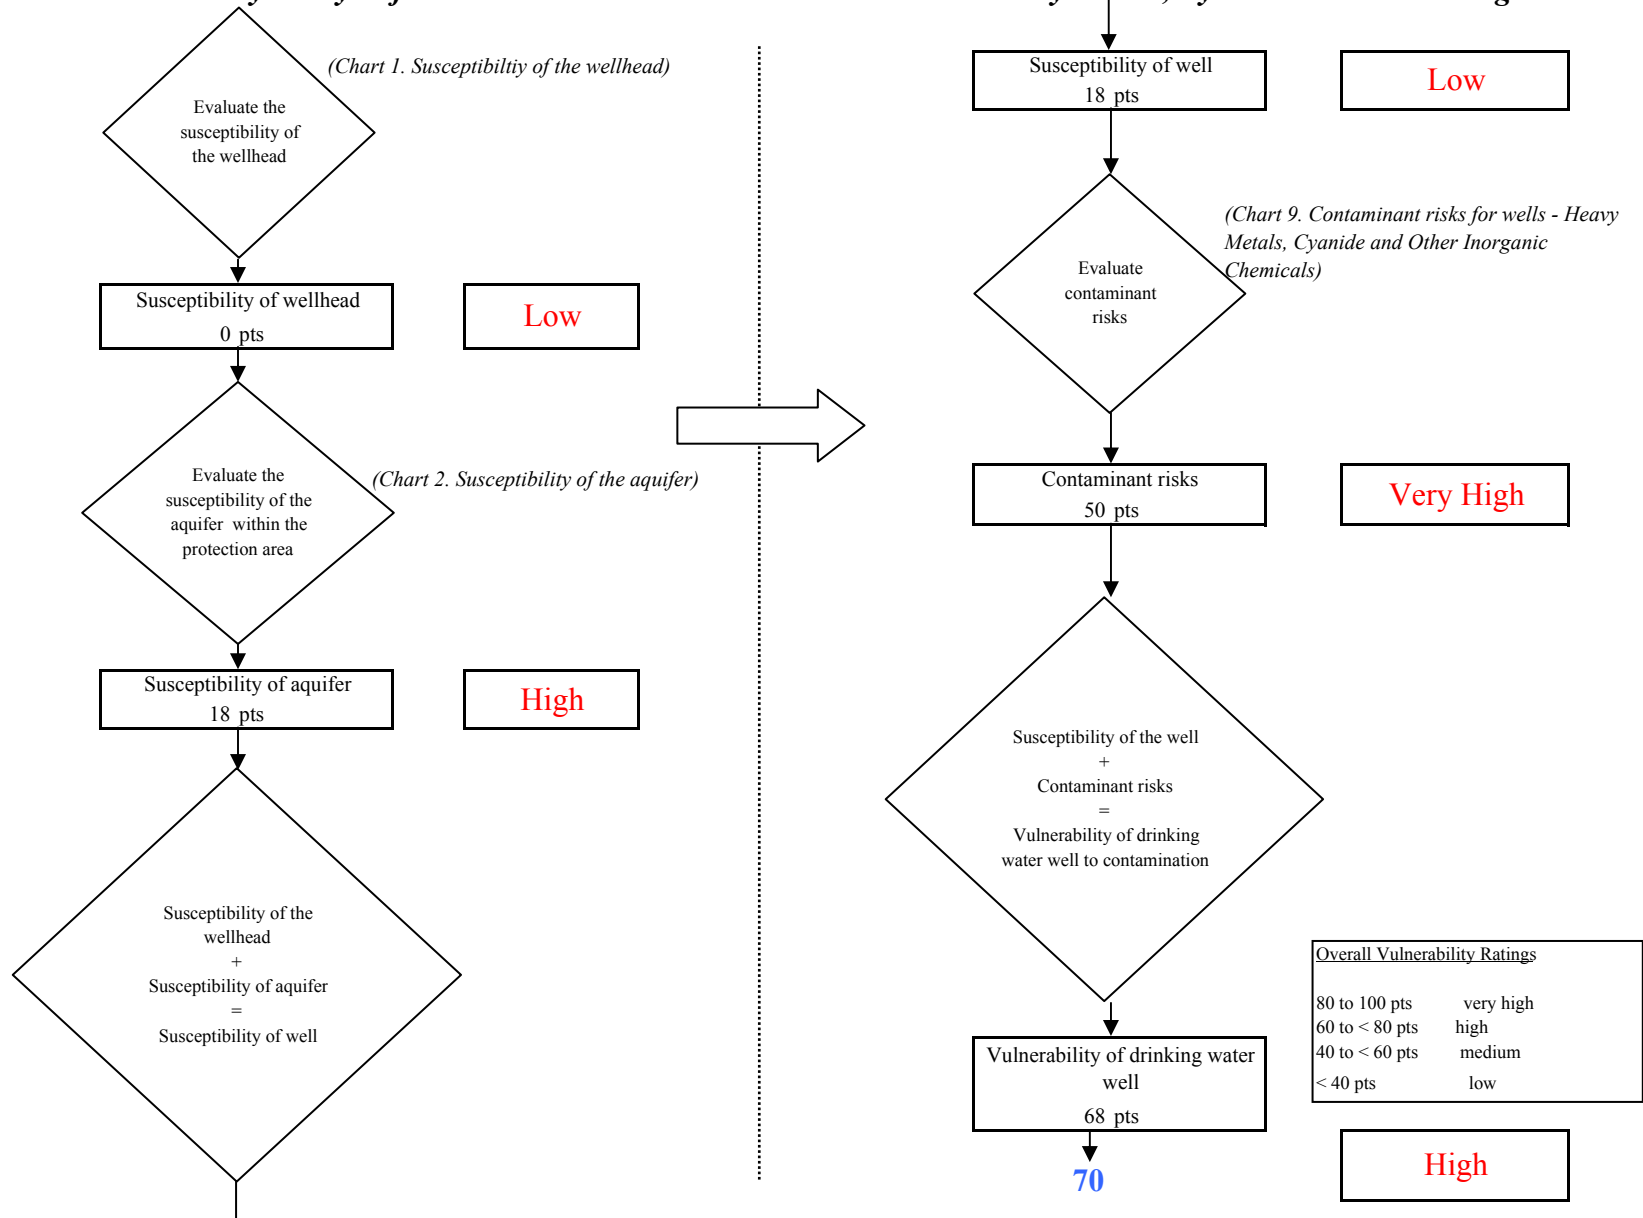


Chart 11. Contaminant Risks for Thunder Mountain Mobile Home Park - Synthetic Organic Chemicals


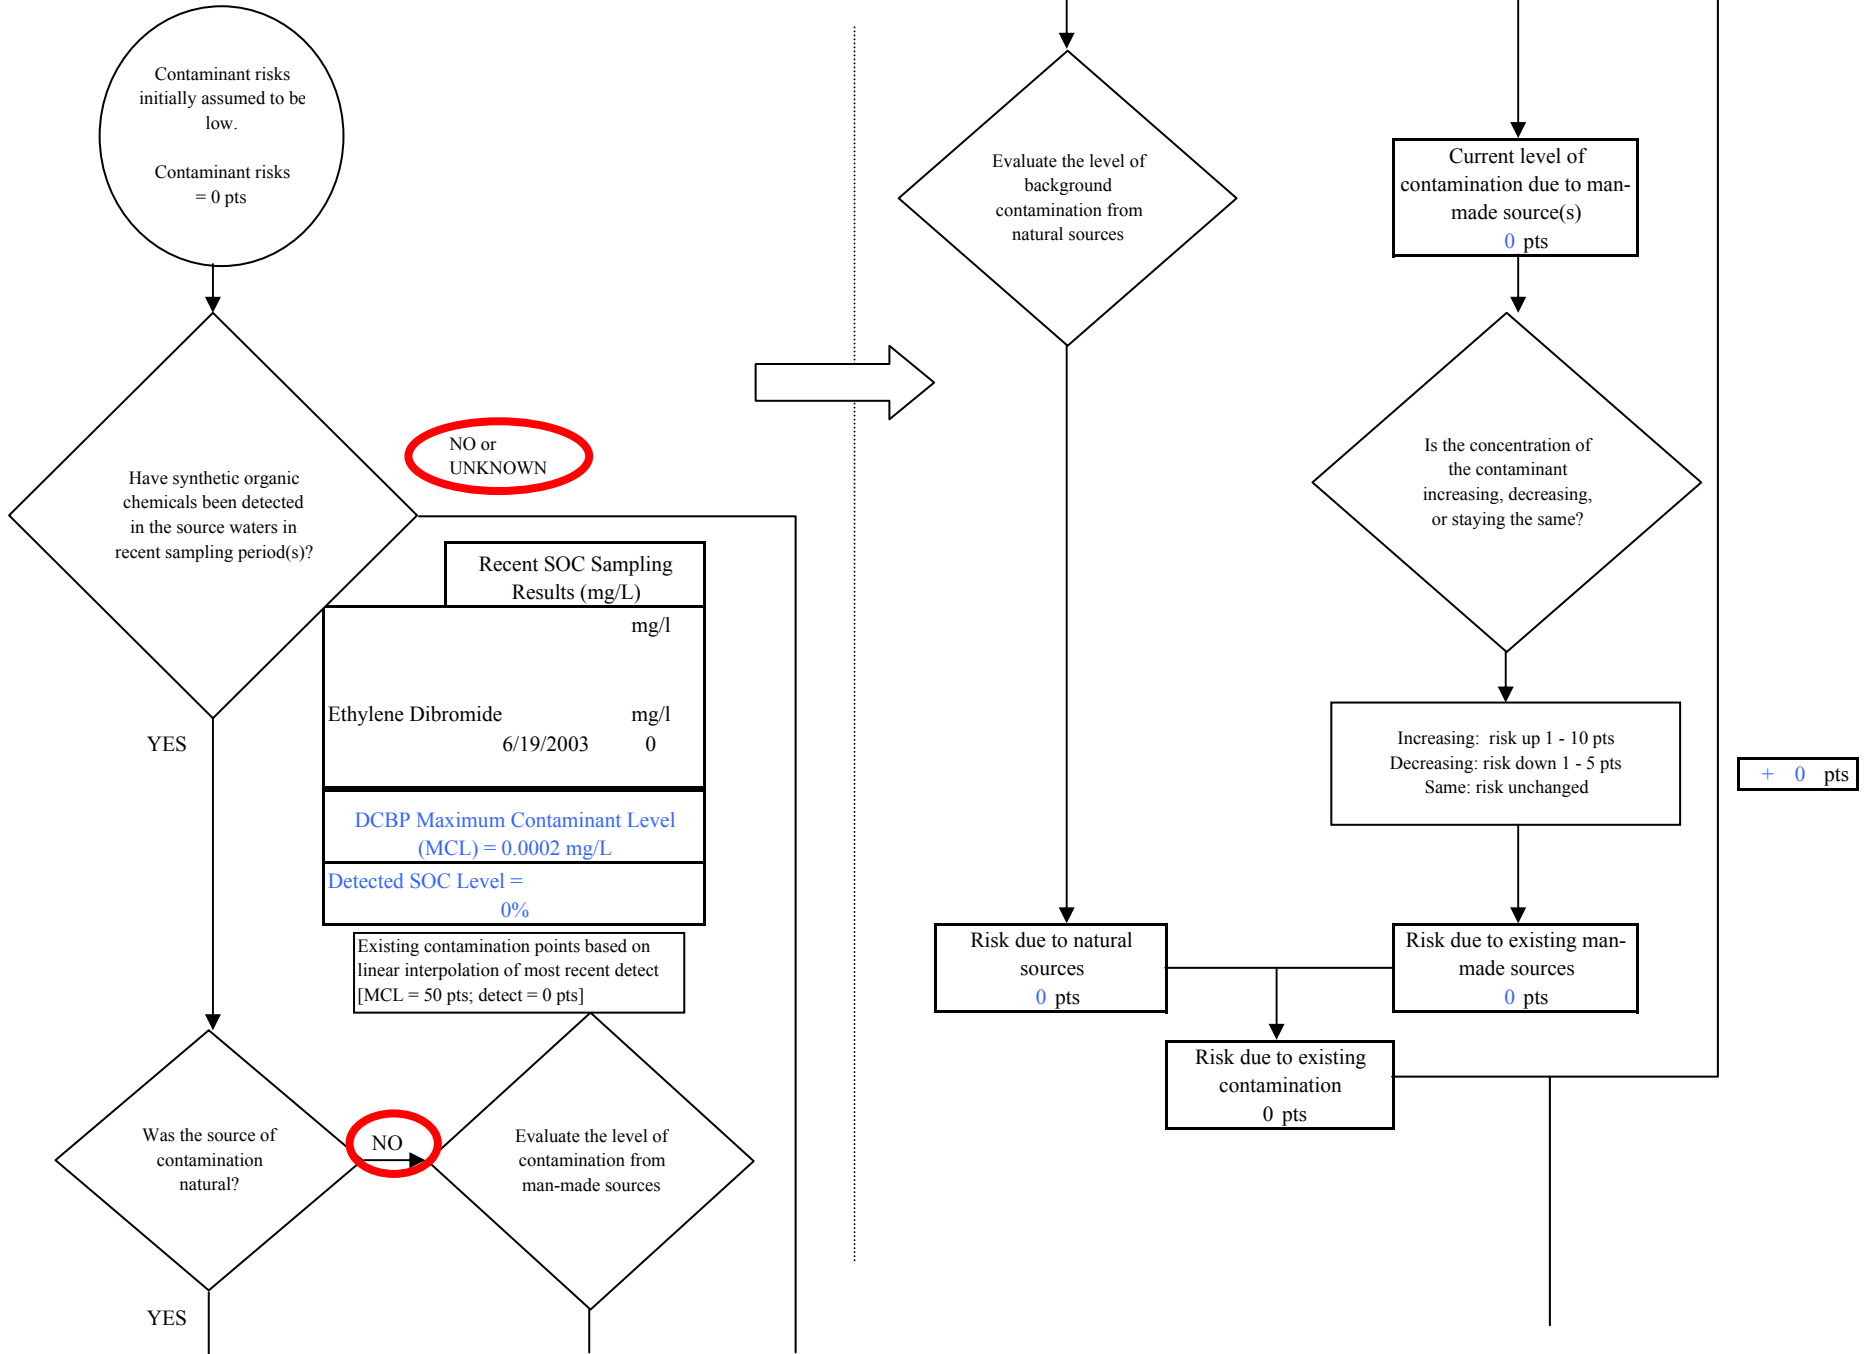


Chart 11. Contaminant Risks for Thunder Mountain Mobile Home Park - Synthetic Organic Chemicals

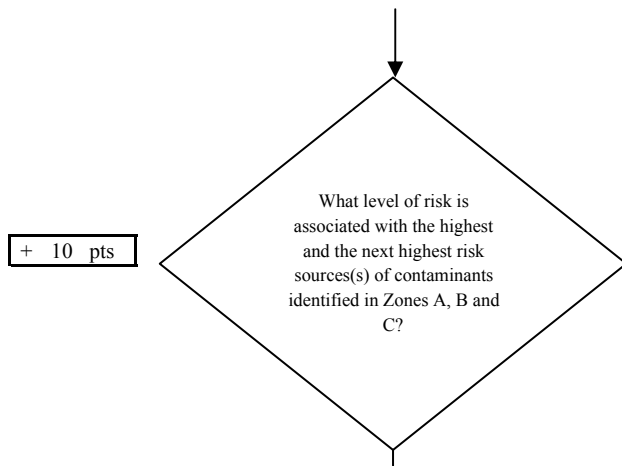

Risk Levels for Contaminant Sources identified in Zones A, B and C			
	Zone A	Zones B&C	Total
Very High(s)	0	0	0
High(s)	0	0	0
Medium(s)	0	0	0
Low(s)	1	0	1

	LOW 10 pts	MEDIUM 20 pts	HIGH 30 pts	VERY HIGH 40 pts
LOW	≥ 10 sources + 10 pts	≥ 10 sources + 5 pts	≥ 20 sources + 5 pts	----
MEDIUM	----	≥ 2 sources + 5 pts	≥ 5 sources + 5 pts	≥ 10 sources + 5 pts
HIGH	----	----	≥ 1 source + 10 pts	≥ 2 sources + 10 pts
VERY HIGH	----	----	----	≥ 1 source + 10 pts

Matrix Score 10

Note: Septic systems, sewerlines, and roads are each assigned a risk ranking for each individual contaminant source in the CSI. The VA, however, counts these contaminant sources as a group and assigns a calculated number of either "lows" or "mediums" based on the density.

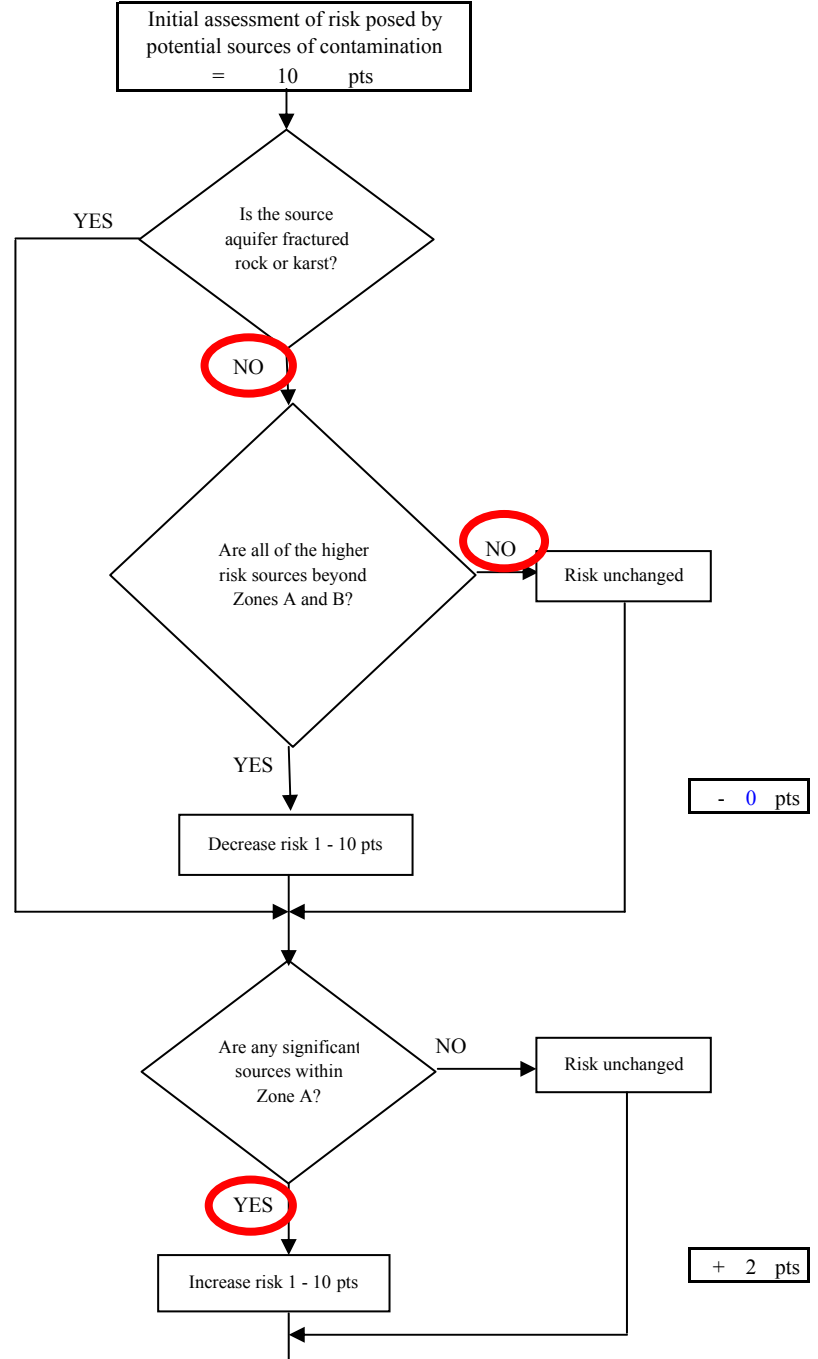



Chart 11. Contaminant Risks for Thunder Mountain Mobile Home Park - Synthetic Organic Chemicals

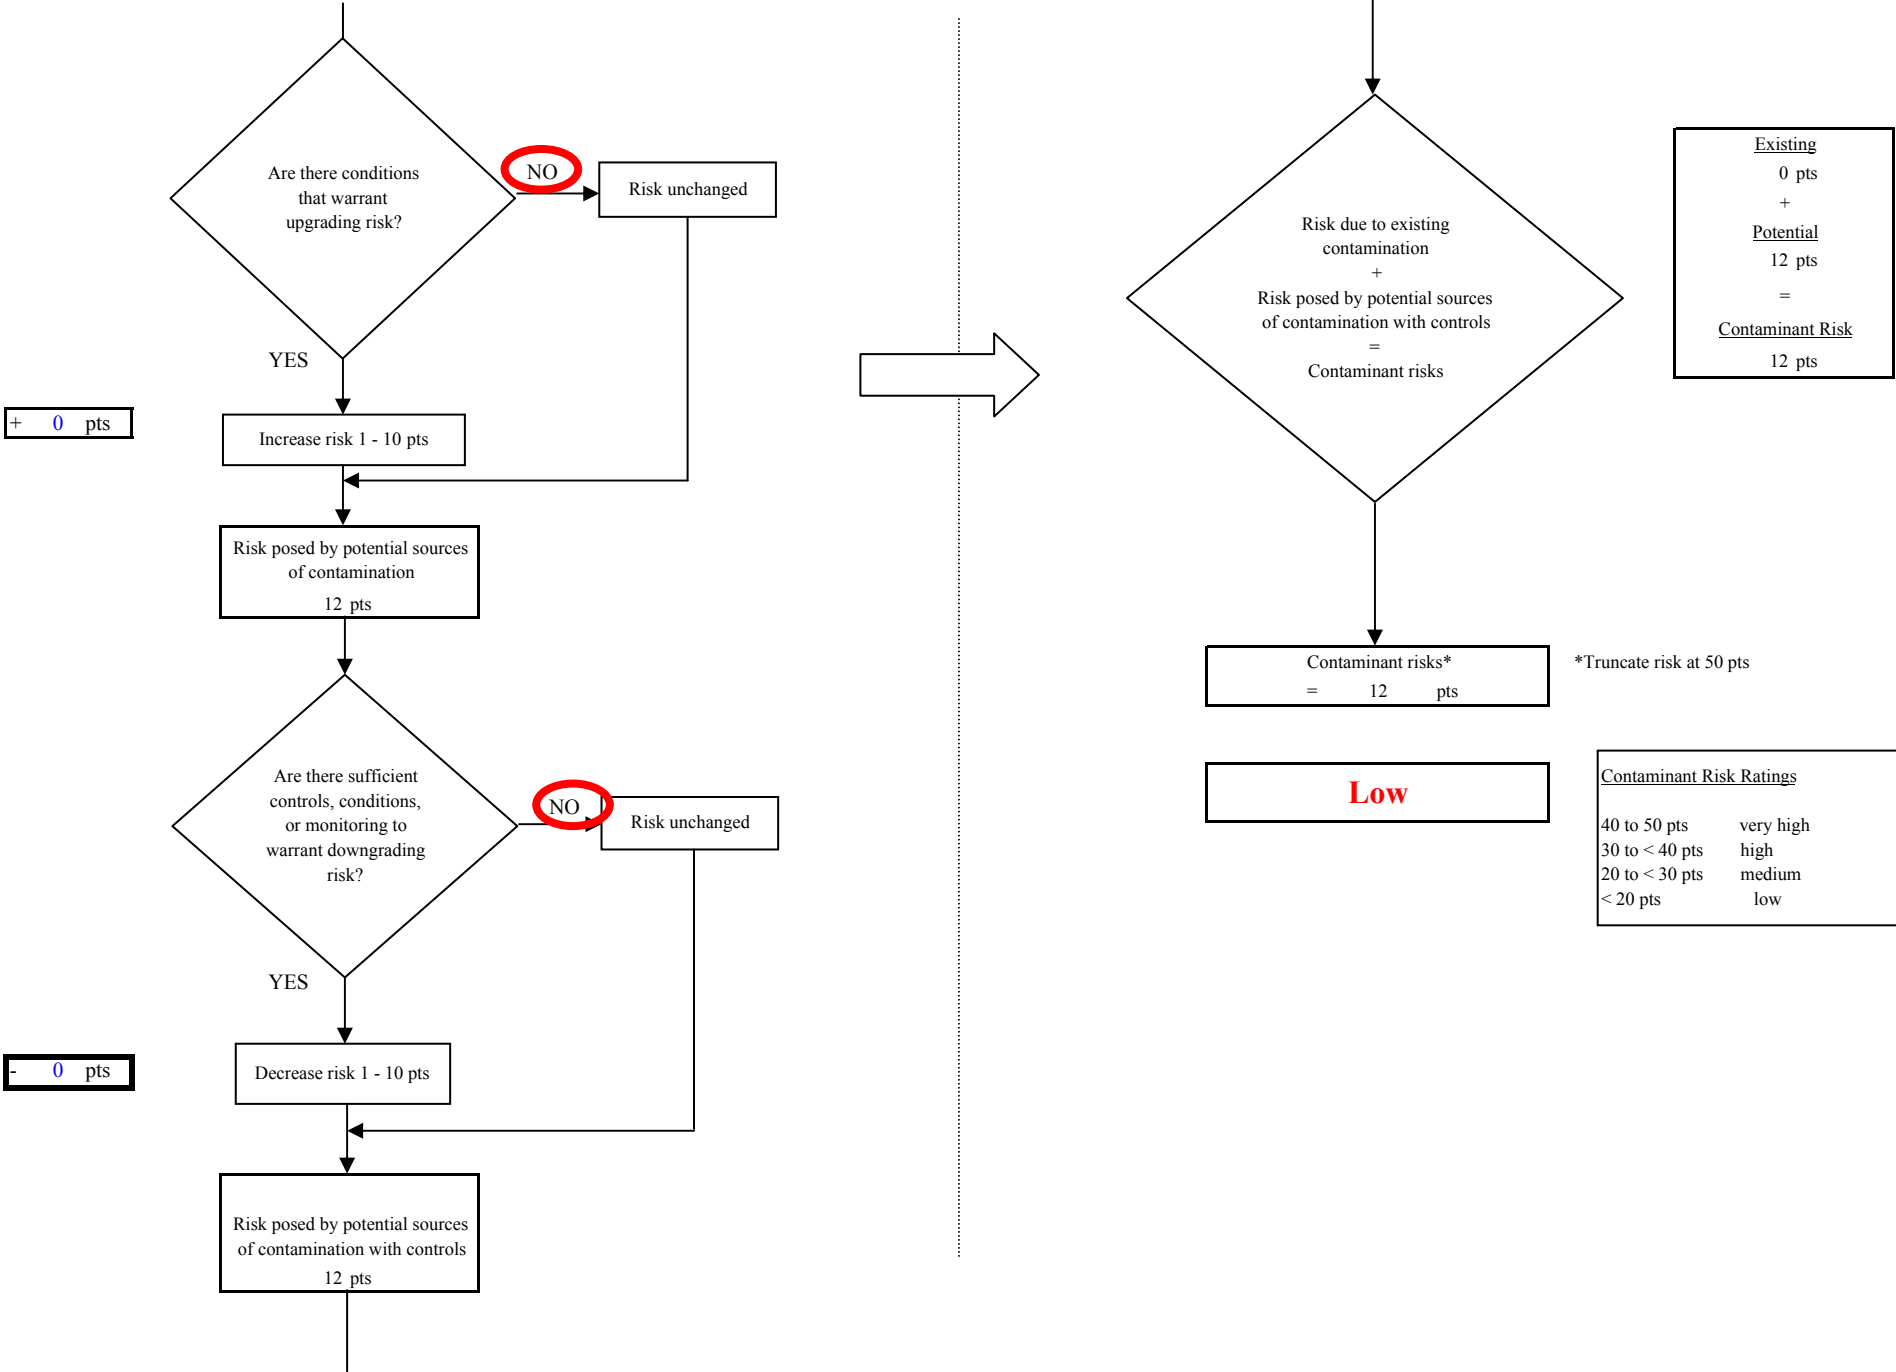


Chart 12. Vulnerability Analysis for Thunder Mountain Mobile Home Park - Synthetic Organic Chemicals

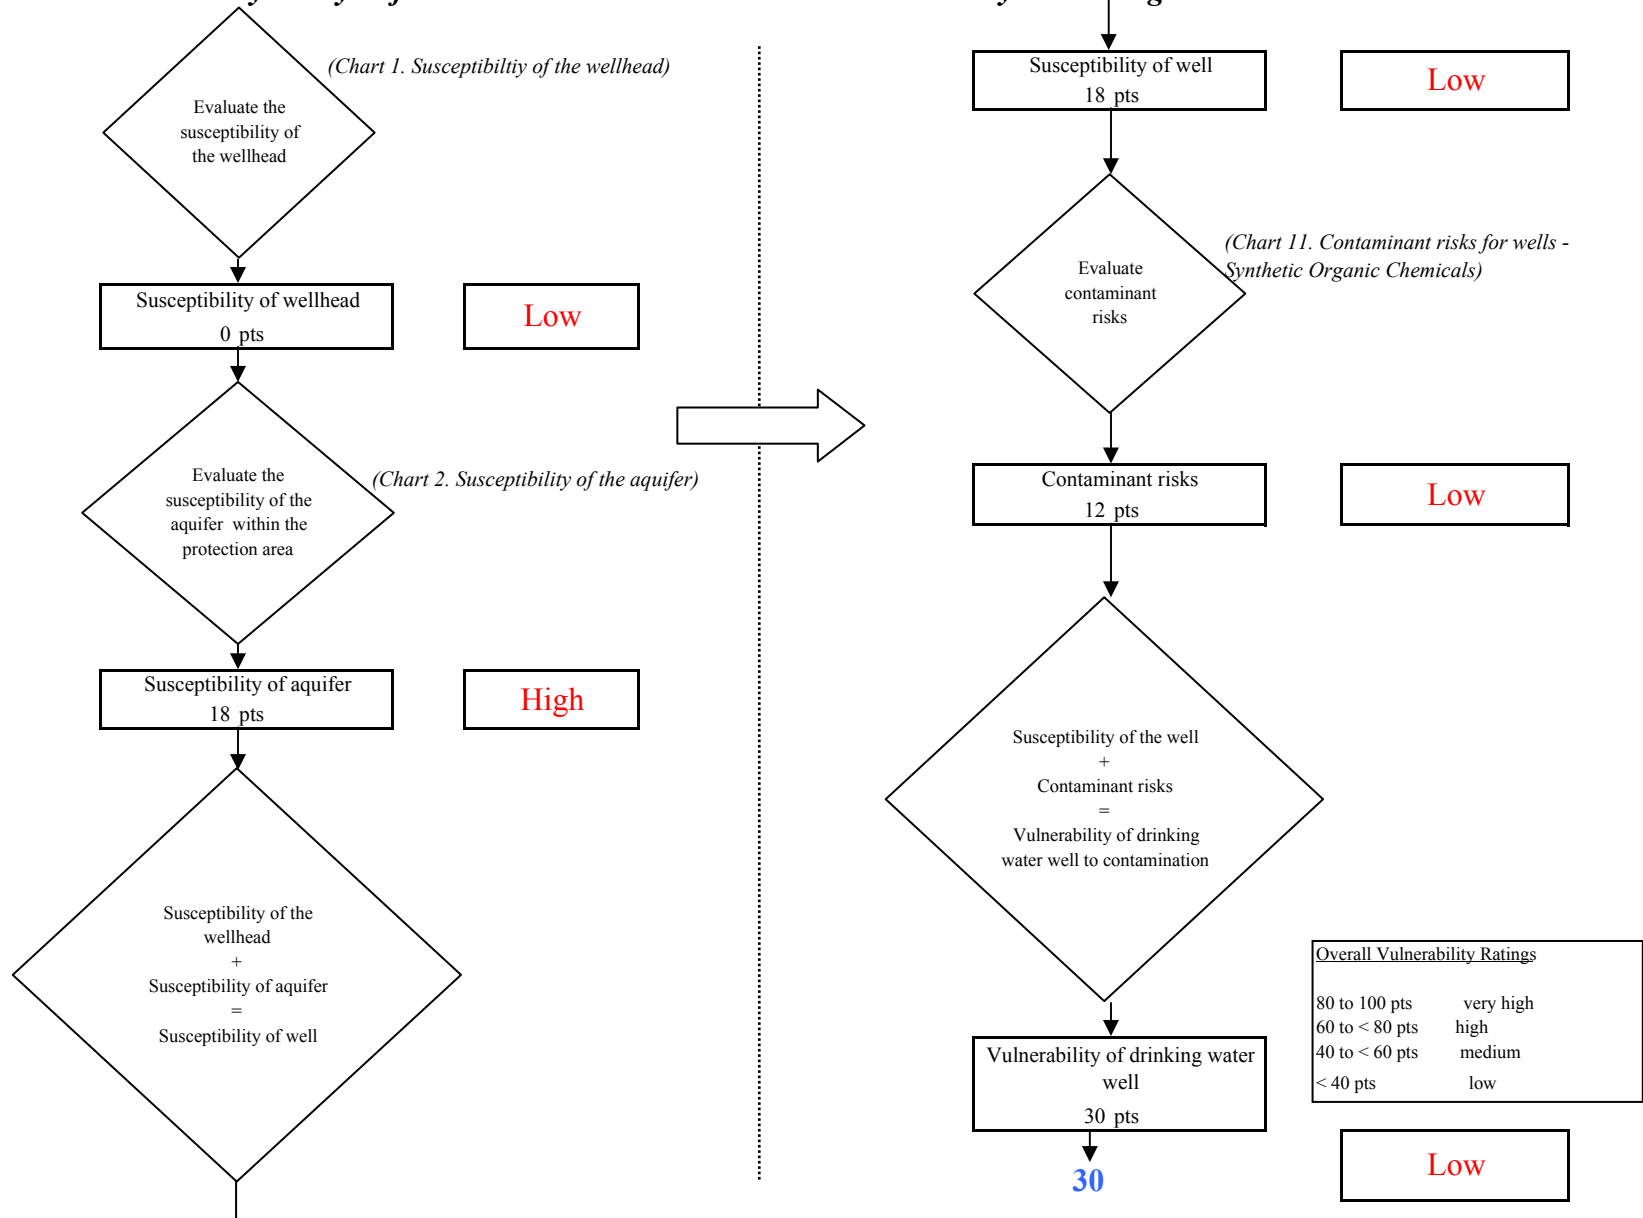


Chart 13. Contaminant Risks for Thunder Mountain Mobile Home Park - Other Organic Chemicals


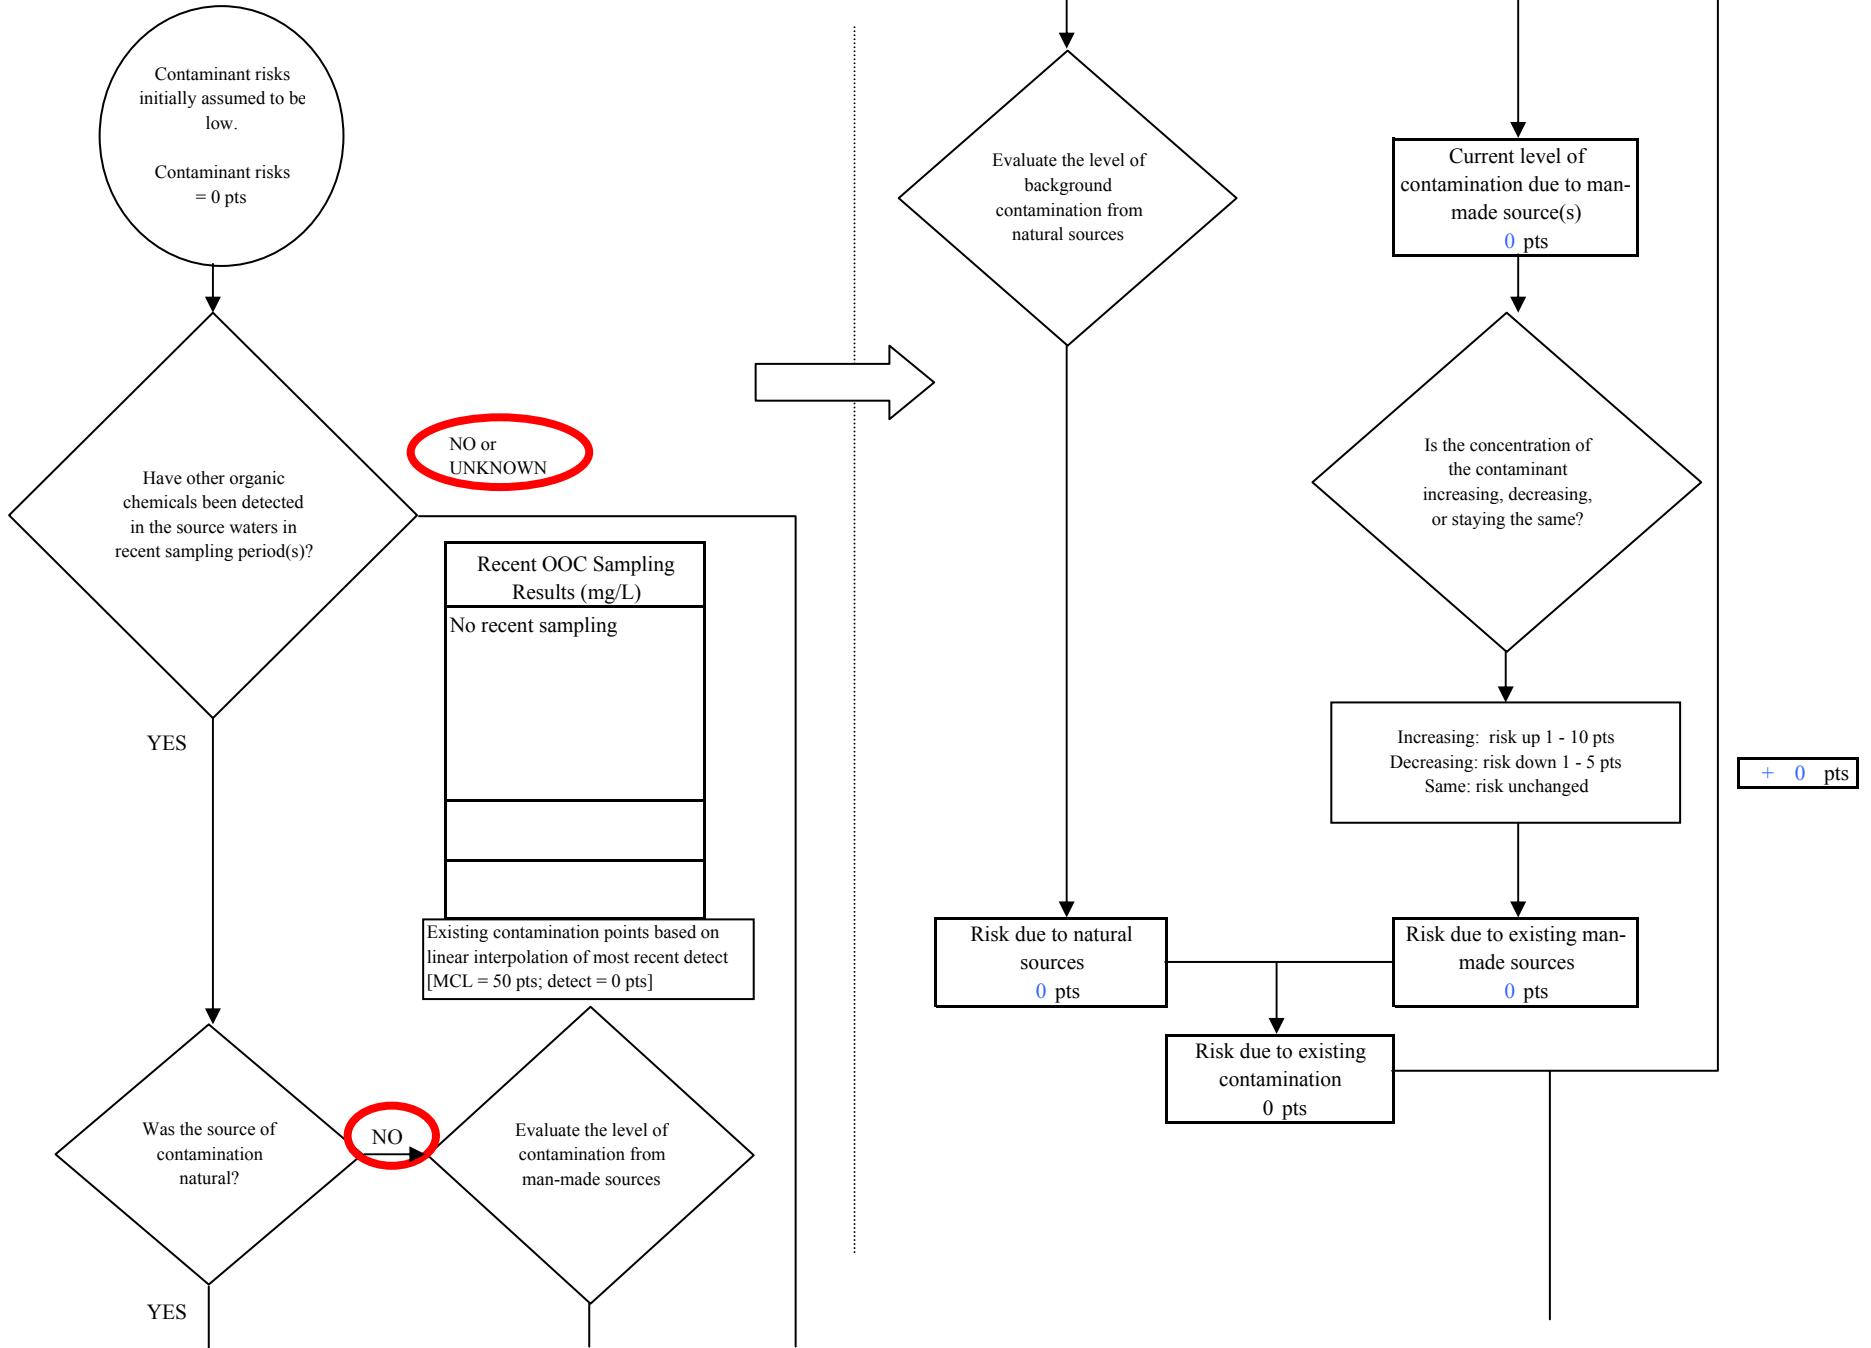


Chart 13. Contaminant Risks for Thunder Mountain Mobile Home Park - Other Organic Chemicals

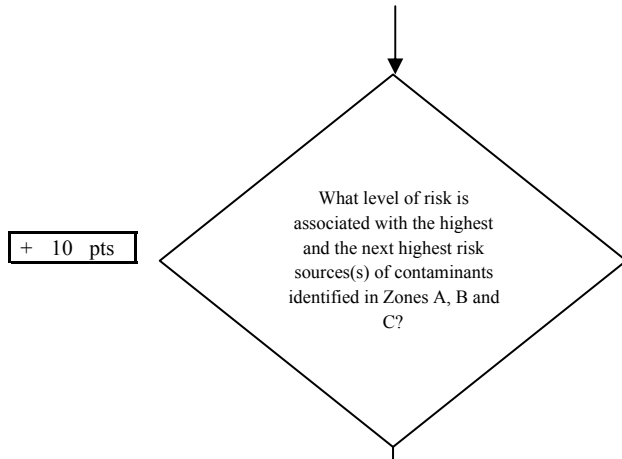



+ 10 pts

Risk Levels for Contaminant Sources identified in Zones A, B and C			
	Zone A	Zones B&C	Total
Very High(s)	0	0	0
High(s)	0	0	0
Medium(s)	0	0	0
Low(s)	3	0	3

	LOW 10 pts	MEDIUM 20 pts	HIGH 30 pts	VERY HIGH 40 pts
LOW	≥ 10 sources + 10 pts	≥ 10 sources + 5 pts	≥ 20 sources + 5 pts	----
MEDIUM	----	≥ 2 sources + 5 pts	≥ 5 sources + 5 pts	≥ 10 sources + 5 pts
HIGH	----	----	≥ 1 source + 10 pts	≥ 2 sources + 10 pts
VERY HIGH	----	----	----	≥ 1 source + 10 pts

Matrix Score 10

Note: Septic systems, sewerlines, and roads are each assigned a risk ranking for each individual contaminant source in the CSI. The VA, however, counts these contaminant sources as a group and assigns a calculated number of either "lows" or "mediums" based on the density.

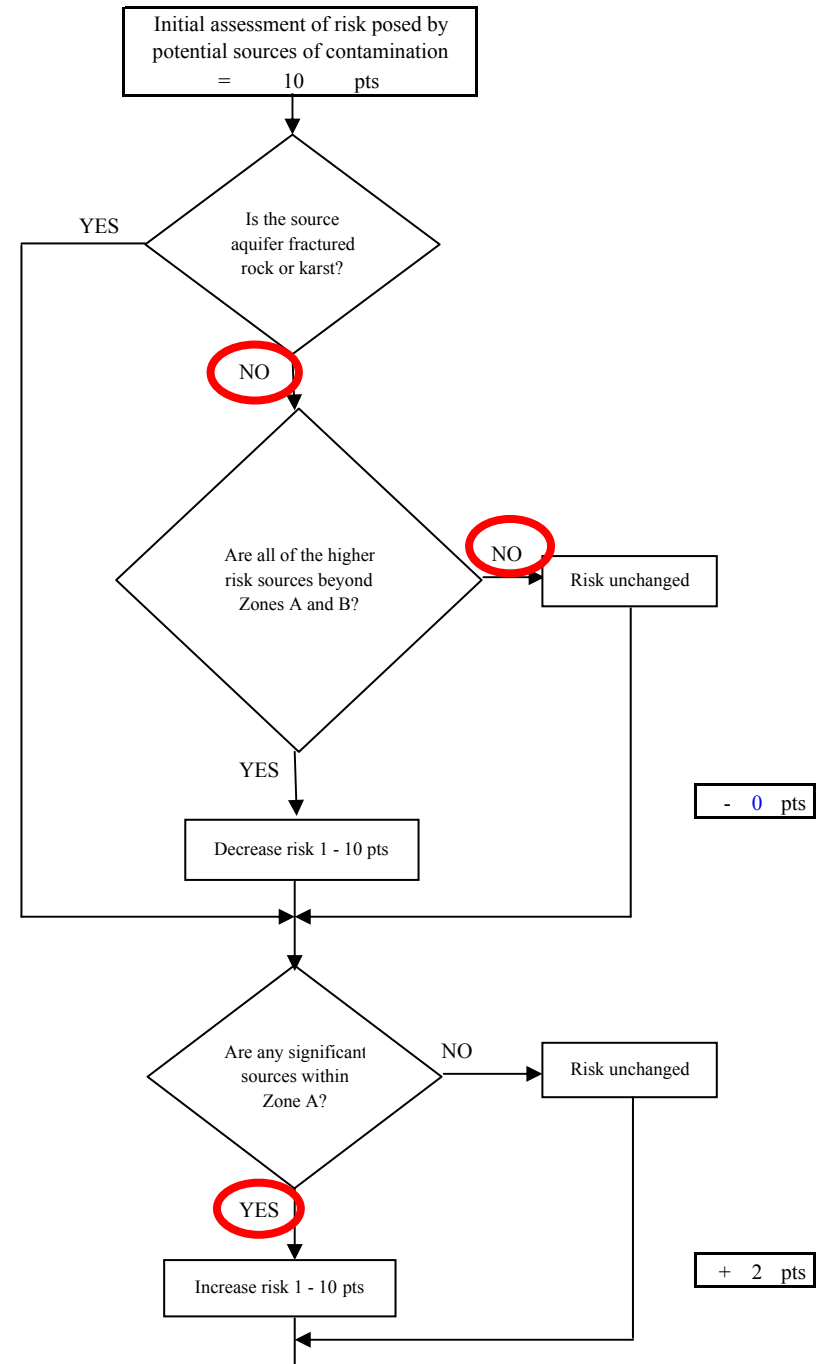

- 0 pts

+ 2 pts

Chart 13. Contaminant Risks for Thunder Mountain Mobile Home Park - Other Organic Chemicals

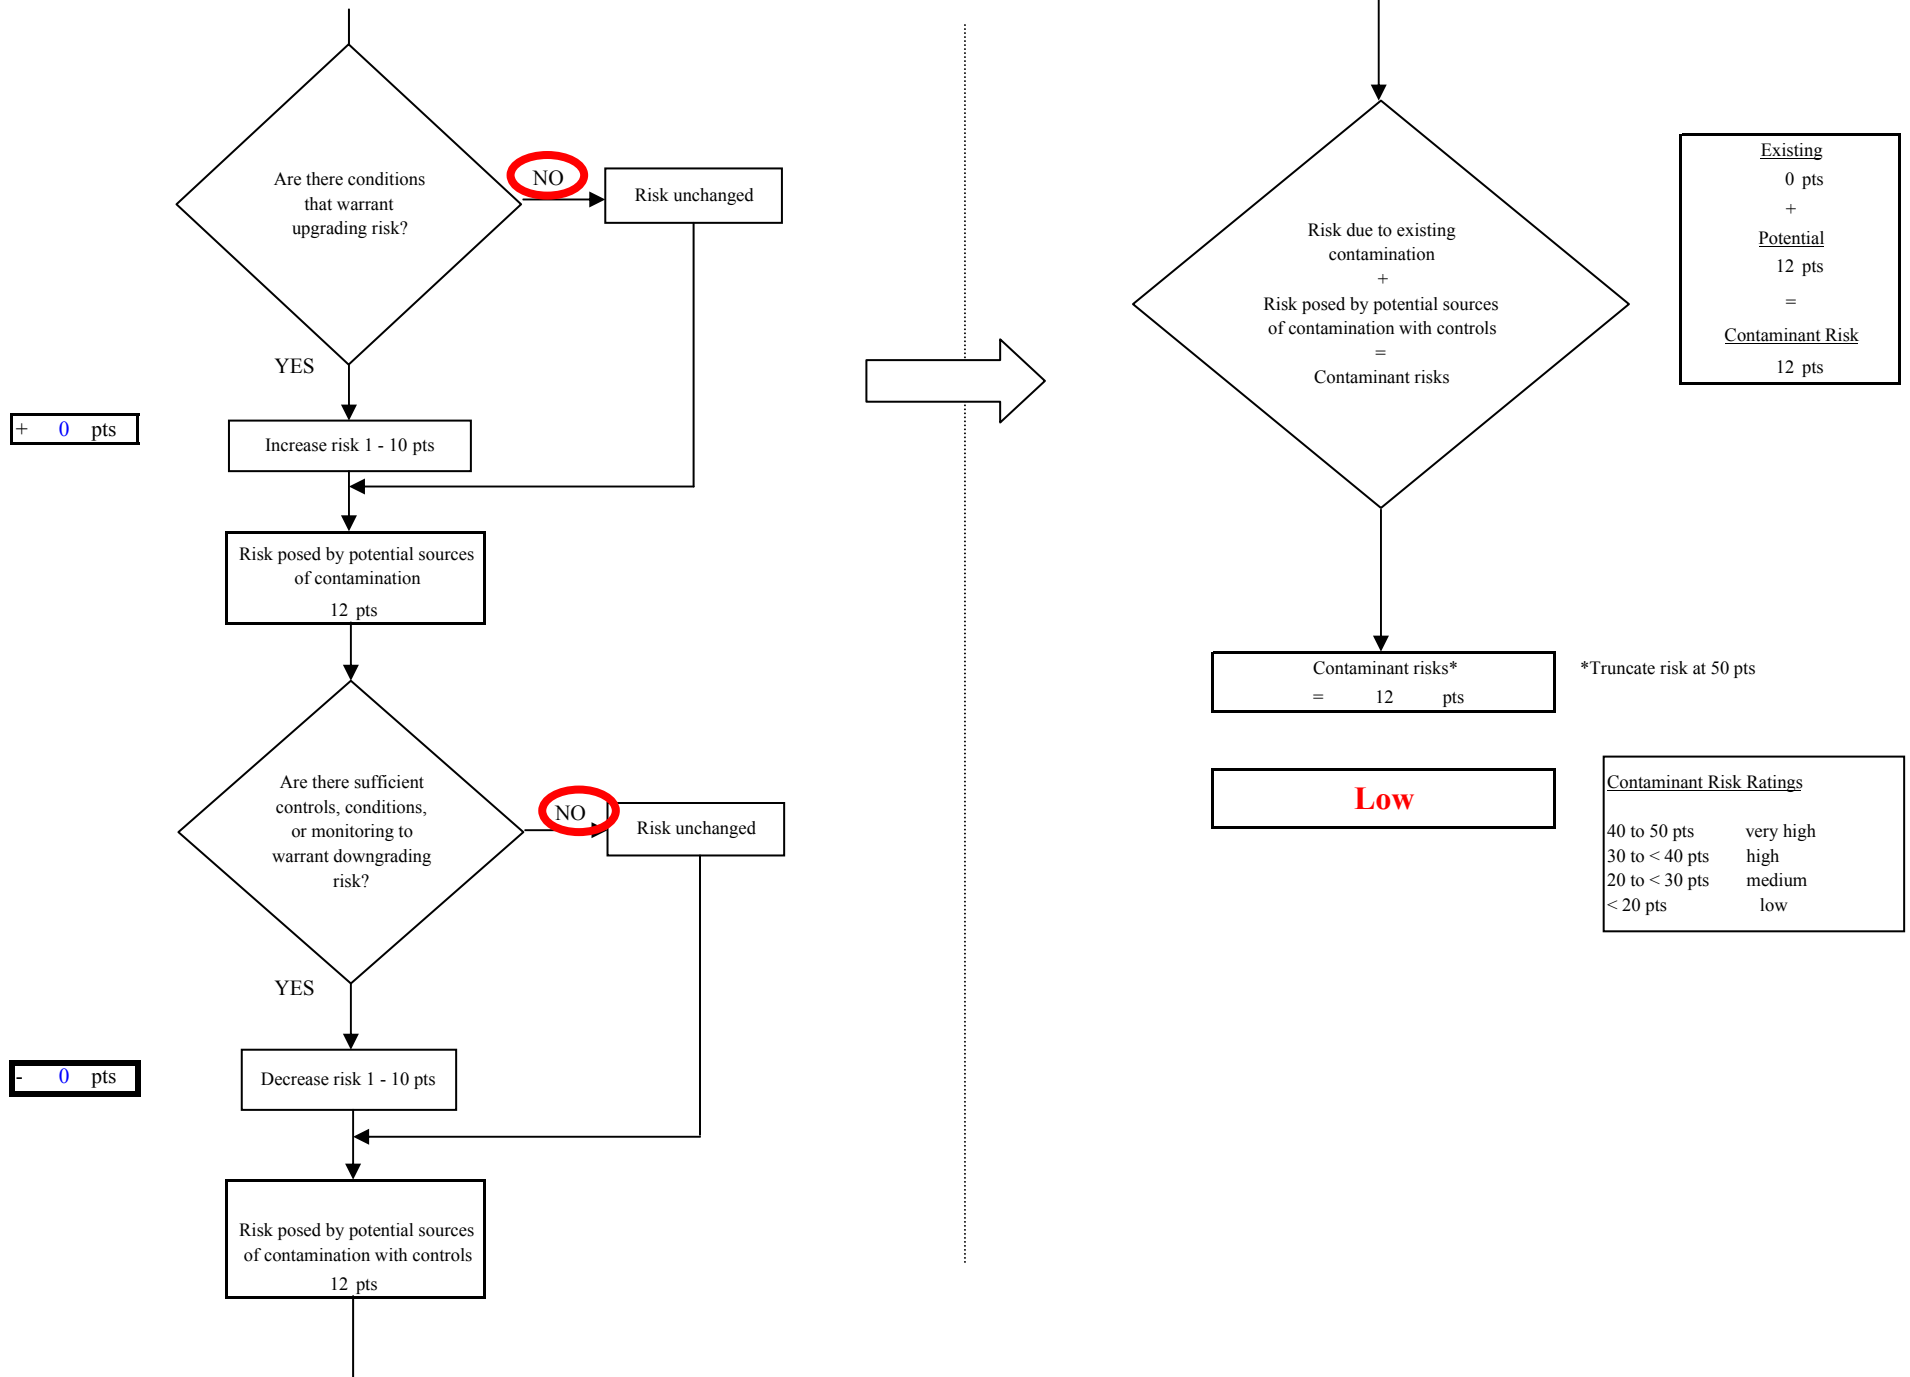


Chart 14. Vulnerability Analysis for Thunder Mountain Mobile Home Park - Other Organic Chemicals

