



Source Water Assessment

A Hydrogeologic Susceptibility and
Vulnerability Assessment for
Tustumena Elementary School

Kasilof, Alaska

PWSID 240618

June 2004

DRINKING WATER PROTECTION PROGRAM REPORT Report 1546
Alaska Department of Environmental Conservation

Source Water Assessment for Tustumena Elementary School Kasilof, Alaska PWSID 240618

June 2004

DRINKING WATER PROTECTION PROGRAM REPORT Report 1546

The Drinking Water Protection Program (DWPP) is producing Source Water Assessments in compliance with the Safe Drinking Water Act Amendments of 1996. Each assessment includes a delineation of the source water area, an inventory of potential and existing contaminant sources that may impact the water, a risk ranking for each of these contaminants, and an evaluation of the potential vulnerability of these drinking water sources.

These assessments are intended to provide public water systems owners/operators, communities, and local governments with the best available information that may be used to protect the quality of their drinking water. The assessments combine information obtained from various sources, including the U.S. Environmental Protection Agency, Alaska Department of Environmental Conservation (ADEC), public water system owners/operators, and other public information sources. The results of this assessment are subject to change if additional data becomes available. It is anticipated this assessment will be updated every five years to reflect any changes in the vulnerability and/or susceptibility of public drinking water source. If you have any additional information that may affect the results of this assessment, please contact the Program Coordinator of DWPP, (907) 269-7521.

CONTENTS

	Page		Page
Executive Summary	1	Inventory of Potential and Existing Contaminant Sources	2
Tustumena Elementary School Public Drinking Water System	1	Ranking of Contaminant Risks	2
Tustumena Elementary School Protection Area	1	Vulnerability of Tustumena Elementary School Drinking Water System	3
		References	7

TABLES

TABLE	1. Definition of Zones	2
	2. Susceptibility	3
	3. Contaminant Risks	4
	3. Overall Vulnerability	4

APPENDICES

APPENDIX	<p>A. Tustumena Elementary School Drinking Water Protection Area (Map 1)</p> <p>B. Contaminant Source Inventory for Tustumena Elementary School (Table 1) Contaminant Source Inventory and Risk Ranking for Tustumena Elementary School – Bacteria and Viruses (Table 2) Contaminant Source Inventory and Risk Ranking for Tustumena Elementary School – Nitrates/Nitrites (Table 3) Contaminant Source Inventory and Risk Ranking for Tustumena Elementary School – Volatile Organic Chemicals (Table 4) Contaminant Source Inventory and Risk Ranking for Tustumena Elementary School – Heavy Metals, Cyanide, and Other Inorganic Chemicals (Table 5) Contaminant Source Inventory and Risk Ranking for Tustumena Elementary School – Other Organic Chemicals (Table 6)</p> <p>C. Tustumena Elementary School Drinking Water Protection Area and Potential and Existing Contaminant Sources (Map 2)</p> <p>D. Vulnerability Analysis for Contaminant Source Inventory and Risk Ranking for Tustumena Elementary School Public Drinking Water Source (Charts 1 – 14)</p>
----------	---

Source Water Assessment for Tustumena Elementary School Kasilof, Alaska

Drinking Water Protection Program Alaska Department of Environmental Conservation

EXECUTIVE SUMMARY

This source water assessment provides an evaluation of the vulnerability to potential contamination of the public water system serving Tustumena Elementary School. This Class A (non-transient non-community) water system consists of one well located along the Sterling Highway near its intersection with Burton Road in Kasilof, Alaska. The well received a natural susceptibility rating of **Low**. This rating is a combination of a susceptibility rating of **Low** for the actual wellhead and a **Low** rating for the aquifer in which the well is drawing water from. Identified potential and current sources of contamination for the Tustumena Elementary School public water system include: residential areas, septic systems, fuel storage tanks, roads, and a DEC-recognized contaminated site. These are considered as sources of bacteria and viruses, nitrates and/or nitrites, volatile organic chemicals, heavy metals, cyanide and other inorganic chemicals, synthetic organic chemicals, and other organic chemicals. Combining the natural susceptibility of the well with the contaminant risk, the public water system for Tustumena Elementary School received an overall vulnerability rating of **Medium** for heavy metals, cyanide, and other inorganic chemicals, and a **Low** for bacteria and viruses, nitrates and/or nitrites, volatile organic chemicals, synthetic organic chemicals, and other organic chemicals.

TUSTUMENA ELEMENTARY SCHOOL PUBLIC DRINKING WATER SYSTEM

The Tustumena Elementary public water system is a Class A (non-transient non-community) water system. Its well is located along the Sterling Highway near its intersection with Burton Road in Kasilof, Alaska (T3N, R11W, Section 31) (See Map 1 of Appendix A). Kasilof is located within the Kenai Peninsula Borough which is located in south-central Alaska (Please see the inset of Map 1 in Appendix A for location). The Kenai Peninsula Borough is comprised of the Kenai Peninsula, Cook Inlet and a large unpopulated area northeast of the Alaska Peninsula. The Borough's current population is almost 50,000 (ADCED, 2002). Communities located within the Borough include: Anchor Point, Grouse Creek Group, Beluga, Clam Gulch, Cohoe, Cooper Landing, Crown Point, Diamond Ridge, Fox River, Fritz Creek, Funny River, Halibut

Cove, Happy Valley, Homer, Hope, Kachemak, Kalifornsky, Kasilof, Kenai, Lowell Point, Miller Landing, Moose Pass, Nanwalek, Nikiski, Nikolaevsk, Ninilchik, Port Graham, Primrose, Ridgeway, Salmatof, Seldovia, Seldovia Village, Seward, Soldotna, Sterling, Sunrise and Tyonek.

Residents of Kasilof primarily use individual water wells and septic systems. Residents primarily use heating oil (typically stored in both above and below ground 275 to 500-gallon tanks) or wood to heat homes and buildings (ADCED, 2002). A refuse transfer site is available at mile 110.4 of the Sterling Highway in Kasilof.

The Tustumena Elementary School well lies in the coastal plain on the east shore of Cook Inlet at an elevation of approximately 150 feet above sea level.

According to the well log, the depth of the well is 189 feet below the ground surface and is screened in sandstone. Sediments in the area generally consist of a combination of sand, gravel, silt, and clay and were deposited by glacially-fed streams, abandoned-channel deposits, glacial moraines and alluvium from existing streams (Glass, 1996). There can be a significant variation in the composition of sediment layers over relatively small areas. Consequently, confinement of the aquifers in the area can vary over short distances (Glass, 1996). The aquifer in the area of the Tustumena Elementary School well is confined by a 70-foot layer of clay.

The Tustumena Elementary School public drinking water system serves approximately 283 residents through one service connection.

TUSTUMENA ELEMENTARY SCHOOL DRINKING WATER PROTECTION AREA

The pathways most likely for surface contamination to reach the groundwater are identified as the first step in determining a drinking water system's risk. These areas are determined by looking at the characteristics of the soil, groundwater, aquifer, and well.

The most probable area for contamination to reach the drinking water wells is the area that contributes water to the well, the groundwater capture zone. The groundwater capture zone is located in the area circling the well (the area influenced by pumping) and also the area of the water table upgradient of the well, usually forming a parabola shape.

There are many different ways of calculating the size of capture zones. This assessment uses a combination of two simple groundwater flow equations, the Thiem and uniform flow equations for all groundwater wells screened in unconsolidated material. The orientation of the capture zone is then drawn using a water table elevation map (if available) or a land surface elevation map of the area. The capture zone calculated in this assessment is only a best guess using the information and resources available to us, and may differ slightly from the actual capture zone.

The parameters used to calculate the shape of this capture zone are general for the area and were obtained from area well logs in the area and the Groundwater textbook by Freeze and Cherry (Freeze and Cherry, 1979).

Only limited information is available for the aquifer Tustumena Elementary School’s public water system well draws its water from. The orientation of the capture zone was drawn based on the assumption that groundwater flow direction is generally the same direction as the topography.

Because of uncertainties and changing site conditions, a factor of safety is added to the groundwater capture zone to form the drinking water protection area for the well.

The protection areas established for wells are usually separated into four zones, limited by the watershed. These zones correspond to times-of-travel (TOT) of the water moving through the aquifer to the well (plus the factor of safety).

The following is a summary of the four zones for wells and the calculated time-of-travel for each:

Table 1. Definition of Zones

Zone	Definition
A	¼ the distance for the 2-yr. time-of-travel
B	Less than 2 years time-of-travel
C	Less than 5 years time-of-travel
D	Less than 10 years time-of-travel

The time of travel for *contaminants* within the water varies with their unique physical and chemical characteristics.

The drinking water protection area outlined for the Tustumena Elementary School on Map 1 of Appendix A will serve as the focus for voluntary protection efforts.

INVENTORY OF POTENTIAL AND EXISTING CONTAMINANT SOURCES

The Drinking Water Protection Program (DWPP) has completed an inventory of potential and existing sources of contamination within the Tustumena Elementary School protection area. This inventory was completed through a search of agency records and other publicly available information. Potential drinking water contaminants are found within agricultural, residential, commercial, and industrial areas, but can also occur within areas that have little or no development.

For the basis of all Class A public water system assessments, six categories of drinking water contaminants were inventoried. They include:

- Bacteria and viruses;
- Nitrates and/or nitrites;
- Volatile organic chemicals;
- Heavy metals, cyanide, and other inorganic chemicals;
- Synthetic organic chemicals; and
- Other inorganic chemicals.

The sources are displayed on Map 2 of Appendix C and summarized in Table 1 of Appendix B.

RANKING OF CONTAMINANT RISKS

Once the potential and existing sources of contamination have been identified, they are each assigned a ranking according to what type and level of risk they represent. Ranking of contaminant risks for a “potential” or “existing” source of contamination is a combination of toxicity and volume associated with that source. Rankings include:

- Low;
- Medium;
- High; and
- Very High.

Bacteria and Viruses are only inventoried in Zones A and B because of their short life span. Only “Very High” and “High” rankings are inventoried within the outer Zone D due to the probability of contaminant dilution by the time the contaminants get to the well.

Tables 2 through 7 in Appendix B contain the ranking of inventoried potential and existing sources of contamination with respect to the six contaminant categories.

VULNERABILITY OF TUSTUMENA ELEMENTARY SCHOOL DRINKING WATER SYSTEM

Vulnerability of a drinking water source to contamination is a combination of two factors:

- Natural susceptibility; and
- Contaminant risks.

Appendix D contains fourteen charts, which together form the ‘Vulnerability Analysis’ for a source water assessment for a public drinking water source. Chart 1 analyzes the ‘Susceptibility of the Wellhead’ to contamination by looking at the construction of the well and its surrounding area. Chart 2 analyzes the ‘Susceptibility of the Aquifer’ to contamination by looking at the properties of the aquifer and the presence of other wells or boreholes in the area. Chart 3 analyzes ‘Contaminant Risks’ for the drinking water source with respect to Bacteria and Viruses. The ‘Contaminant Risks’ portion of the analysis considers potential sources of contaminants as well as a review of the water system’s contaminant sample results. Lastly, Chart 4 combines the results of the first three charts to produce the ‘Vulnerability Analysis for Bacteria and Viruses’. Charts 5 through 14 contain the Contaminant Risks and Vulnerability Analyses for nitrates and nitrites, volatile organic chemicals, heavy metals, cyanide, and other inorganic chemicals, synthetic organic chemicals, and other organic chemicals, respectively.

A score for the Natural Susceptibility is reached by considering the properties of the well and the aquifer.

Susceptibility of the Wellhead (0 – 25 Points)
(Chart 1 of Appendix D)

+

Susceptibility of the Aquifer (0 – 25 Points)
(Chart 2 of Appendix D)

=

Natural Susceptibility (Susceptibility of the Well)
(0 – 50 Points)

A ranking is assigned for the Natural Susceptibility according to the point score:

Natural Susceptibility Ratings	
40 to 50 pts	Very High
30 to < 40 pts	High
20 to < 30 pts	Medium
< 20 pts	Low

The wellhead for the Tustumena Elementary School received a Low Susceptibility rating. The 11/20/01 Sanitary Survey indicates the well is capped with a sanitary seal, the land surface is sloped away from the well; and the well is grouted. A sanitary seal prevents potential contaminants from entering the well from the inside while sloping the land surface away from the well and grouting help to prevent potential contaminants from traveling down the outside of the well casing.

The aquifer the Tustumena Elementary School well is completed in received a Low Susceptibility rating. The aquifer in this area is confined with about 70 feet of low-permeability clay. This clay layer inhibits surface contaminants from migrating down to the aquifer where they can disperse quickly. However, private residential wells in the area can provide a quick pathway for contaminants to travel down into the aquifer if they are not grouted correctly. Table 2 summarizes the Susceptibility scores and ratings for Tustumena Elementary School.

Table 2. Susceptibility

	Score	Rating
Susceptibility of the Wellhead	0	Low
Susceptibility of the Aquifer	9	Low
Natural Susceptibility	9	Low

The Contaminant Risk has been derived from an evaluation of the routine sampling results of the water system and the presence of potential sources of contamination. Contaminant risks to a drinking water source depend on the type and distribution of contaminant sources. Flow charts are used to assign a point score, and ratings are assigned in the same way as for the natural susceptibility:

Contaminant Risk Ratings	
40 to 50 pts	Very High
30 to < 40 pts	High
20 to < 30 pts	Medium
< 20 pts	Low

Table 3 summarizes the Contaminant Risks for each category of drinking water contaminants.

Table 3. Contaminant Risks

Category	Score	Rating
Bacteria and Viruses	10	Low
Nitrates and/or Nitrites	10	Low
Volatile Organic Chemicals	30	High
Heavy Metals, Cyanide, and Other Inorganic Chemicals	50	Very High
Synthetic Organic Chemicals	10	Low
Other Organic Chemicals	10	Low

Finally, an overall vulnerability score is assigned for each water system by combining each of the contaminant risk scores with the natural susceptibility score:

$$\begin{array}{r}
 \text{Natural Susceptibility (0 – 50 points)} \\
 + \\
 \text{Contaminant Risks (0 – 50 points)} \\
 = \\
 \text{Vulnerability of the} \\
 \text{Drinking Water Source to Contamination (0 – 100).}
 \end{array}$$

Again, rankings are assigned according to a point score:

Overall Vulnerability Ratings	
80 to 100 pts	Very High
60 to < 80 pts	High
40 to < 60 pts	Medium
< 40 pts	Low

Table 4 contains the overall vulnerability scores (0 – 100) and ratings for each of the six categories of drinking water contaminants. Note: scores are rounded off to the nearest five.

Table 4. Overall Vulnerability

Category	Score	Rating
Bacteria and Viruses	20	Low
Nitrates and/or Nitrites	20	Low
Volatile Organic Chemicals	35	Low
Heavy Metals, Cyanide, and Other Inorganic Chemicals	55	Medium
Synthetic Organic Chemicals	20	Low
Other Organic Chemicals	20	Low

Bacteria and Viruses

The septic systems nearest the well represent the greatest risk of Bacteria and Viruses to this water system.

Only a small amount of bacteria and viruses are required to endanger public health. Coliforms (a bacteria) are found naturally in the environment and although they aren't necessarily a health threat, it is an indicator of other potentially harmful bacteria in the water, more specifically, fecal coliforms and E. coli which only come from human and animal fecal waste (EPA, 2002). Harmful bacteria can cause diarrhea, cramps, nausea, headaches, or other symptoms (EPA, 2002). Routine sampling has not recently detected coliforms in the water.

After combining the contaminant risk for bacteria and viruses with the natural susceptibility of the well, the overall vulnerability of the well to contamination is low.

Nitrates and Nitrites

The septic systems also represent the greatest risk of nitrates and nitrites for this source of public drinking water.

Nitrates are very mobile, moving at approximately the same rate as water. Nitrates have not been detected in in recent sampling history for the Tustumena Elementary School well.

After combining the contaminant risk for nitrates and nitrites with the natural susceptibility of the well, the overall vulnerability of the well to contamination is low.

Volatile Organic Chemicals

The fuel storage tanks and their associated DEC-recognized site represent the greatest risk for volatile organic chemical contamination to the well.

Both underground and above ground heating oil storage tanks are the standard way of heating homes and businesses in this area. The most common causes of

fuel leaks of these heating oil systems are overfilling the tank, ruptured fuel lines, leaking storage tanks, damaged or faulty valves and vandalism. Regular system maintenance can help prevent many of these harmful fuel leaks.

The DEC-recognized contaminated site (RecKey 1991230134301) is located on Tustumena Elementary School property and within Zone A of the protection area. In 1992, a fuel line leaked 1,500 gallons of diesel under the school building. Subsequent monitoring has not detected fuel contamination in the groundwater. Remediation and monitoring are now complete.

Volatile Organic Chemicals have not been detected during routine sampling of this water system. After combining the contaminant risk for volatile organic chemicals with the natural susceptibility of the well, the overall vulnerability of the well to contamination is low.

Heavy Metals, Cyanide, and Other Inorganic Chemicals

The underground heating oil tanks represent the greatest risk to heavy metals for this source of public drinking water.

Arsenic was detected most recently (12/6/01) at a concentration of 0.040 mg/L, or 80% with respect to its current Maximum Contaminant Level (MCL) of 0.05 mg/L. An MCL is the highest concentration of a contaminant allowed in drinking water by the Environmental Protection Agency (EPA). In concentrations above the MCL, prolonged ingestion of arsenic is known to cause skin damage, problems with circulatory systems, and may create an increased risk of developing cancer (EPA, 2002). No other heavy metals were detected during routine sampling.

After combining the contaminant risk for heavy metals, cyanide and other inorganic chemicals with the natural susceptibility of the well, the overall vulnerability of the well to contamination is medium.

Synthetic Organic Chemicals

The residential area and septic systems combine to represent the risk of synthetic organic chemicals for this source of public drinking water.

Synthetic Organic Chemicals have not recently been sampled for in this water system.

After combining the contaminant risk for synthetic organic chemicals with the natural susceptibility of the well, the overall vulnerability of the well to contamination is low.

Other Organic Chemicals

The residential septic systems, roads, and residential area combine to represent the risk of other organic chemicals for this source of public drinking water.

Other Organic Chemicals have not recently been sampled for in this water system.

After combining the contaminant risk for other organic chemicals with the natural susceptibility of the well, the overall vulnerability of the well to contamination is low.

REFERENCES

Alaska Department of Community and Economic Development (ADCED), 2002 [WWW document]. URL http://www.dced.state.ak.us/mra/CF_BLOCK.cfm.


Freeze, R.A. and Cherry, J.A., 1979. Groundwater. Prentice-Hall, Englewood Cliffs, NJ.

Glass, R.L., 1996, Ground-water conditions and quality in the western part of Kenai Peninsula, southcentral Alaska, Prepared in cooperation with the Alaska Department of Natural Resources, Kenai Peninsula Borough, Kenai Soil and Water Conservation District, U.S. Geological Survey, Anchorage, AK, and Branch of Information Services, Denver, CO.

United States Environmental Protection Agency (EPA), 2002 [WWW document]. URL <http://www.epa.gov/safewater/mcl.html>.


APPENDIX A

Tustumena Elementary School Drinking Water Protection Area Location Map (Map 1)

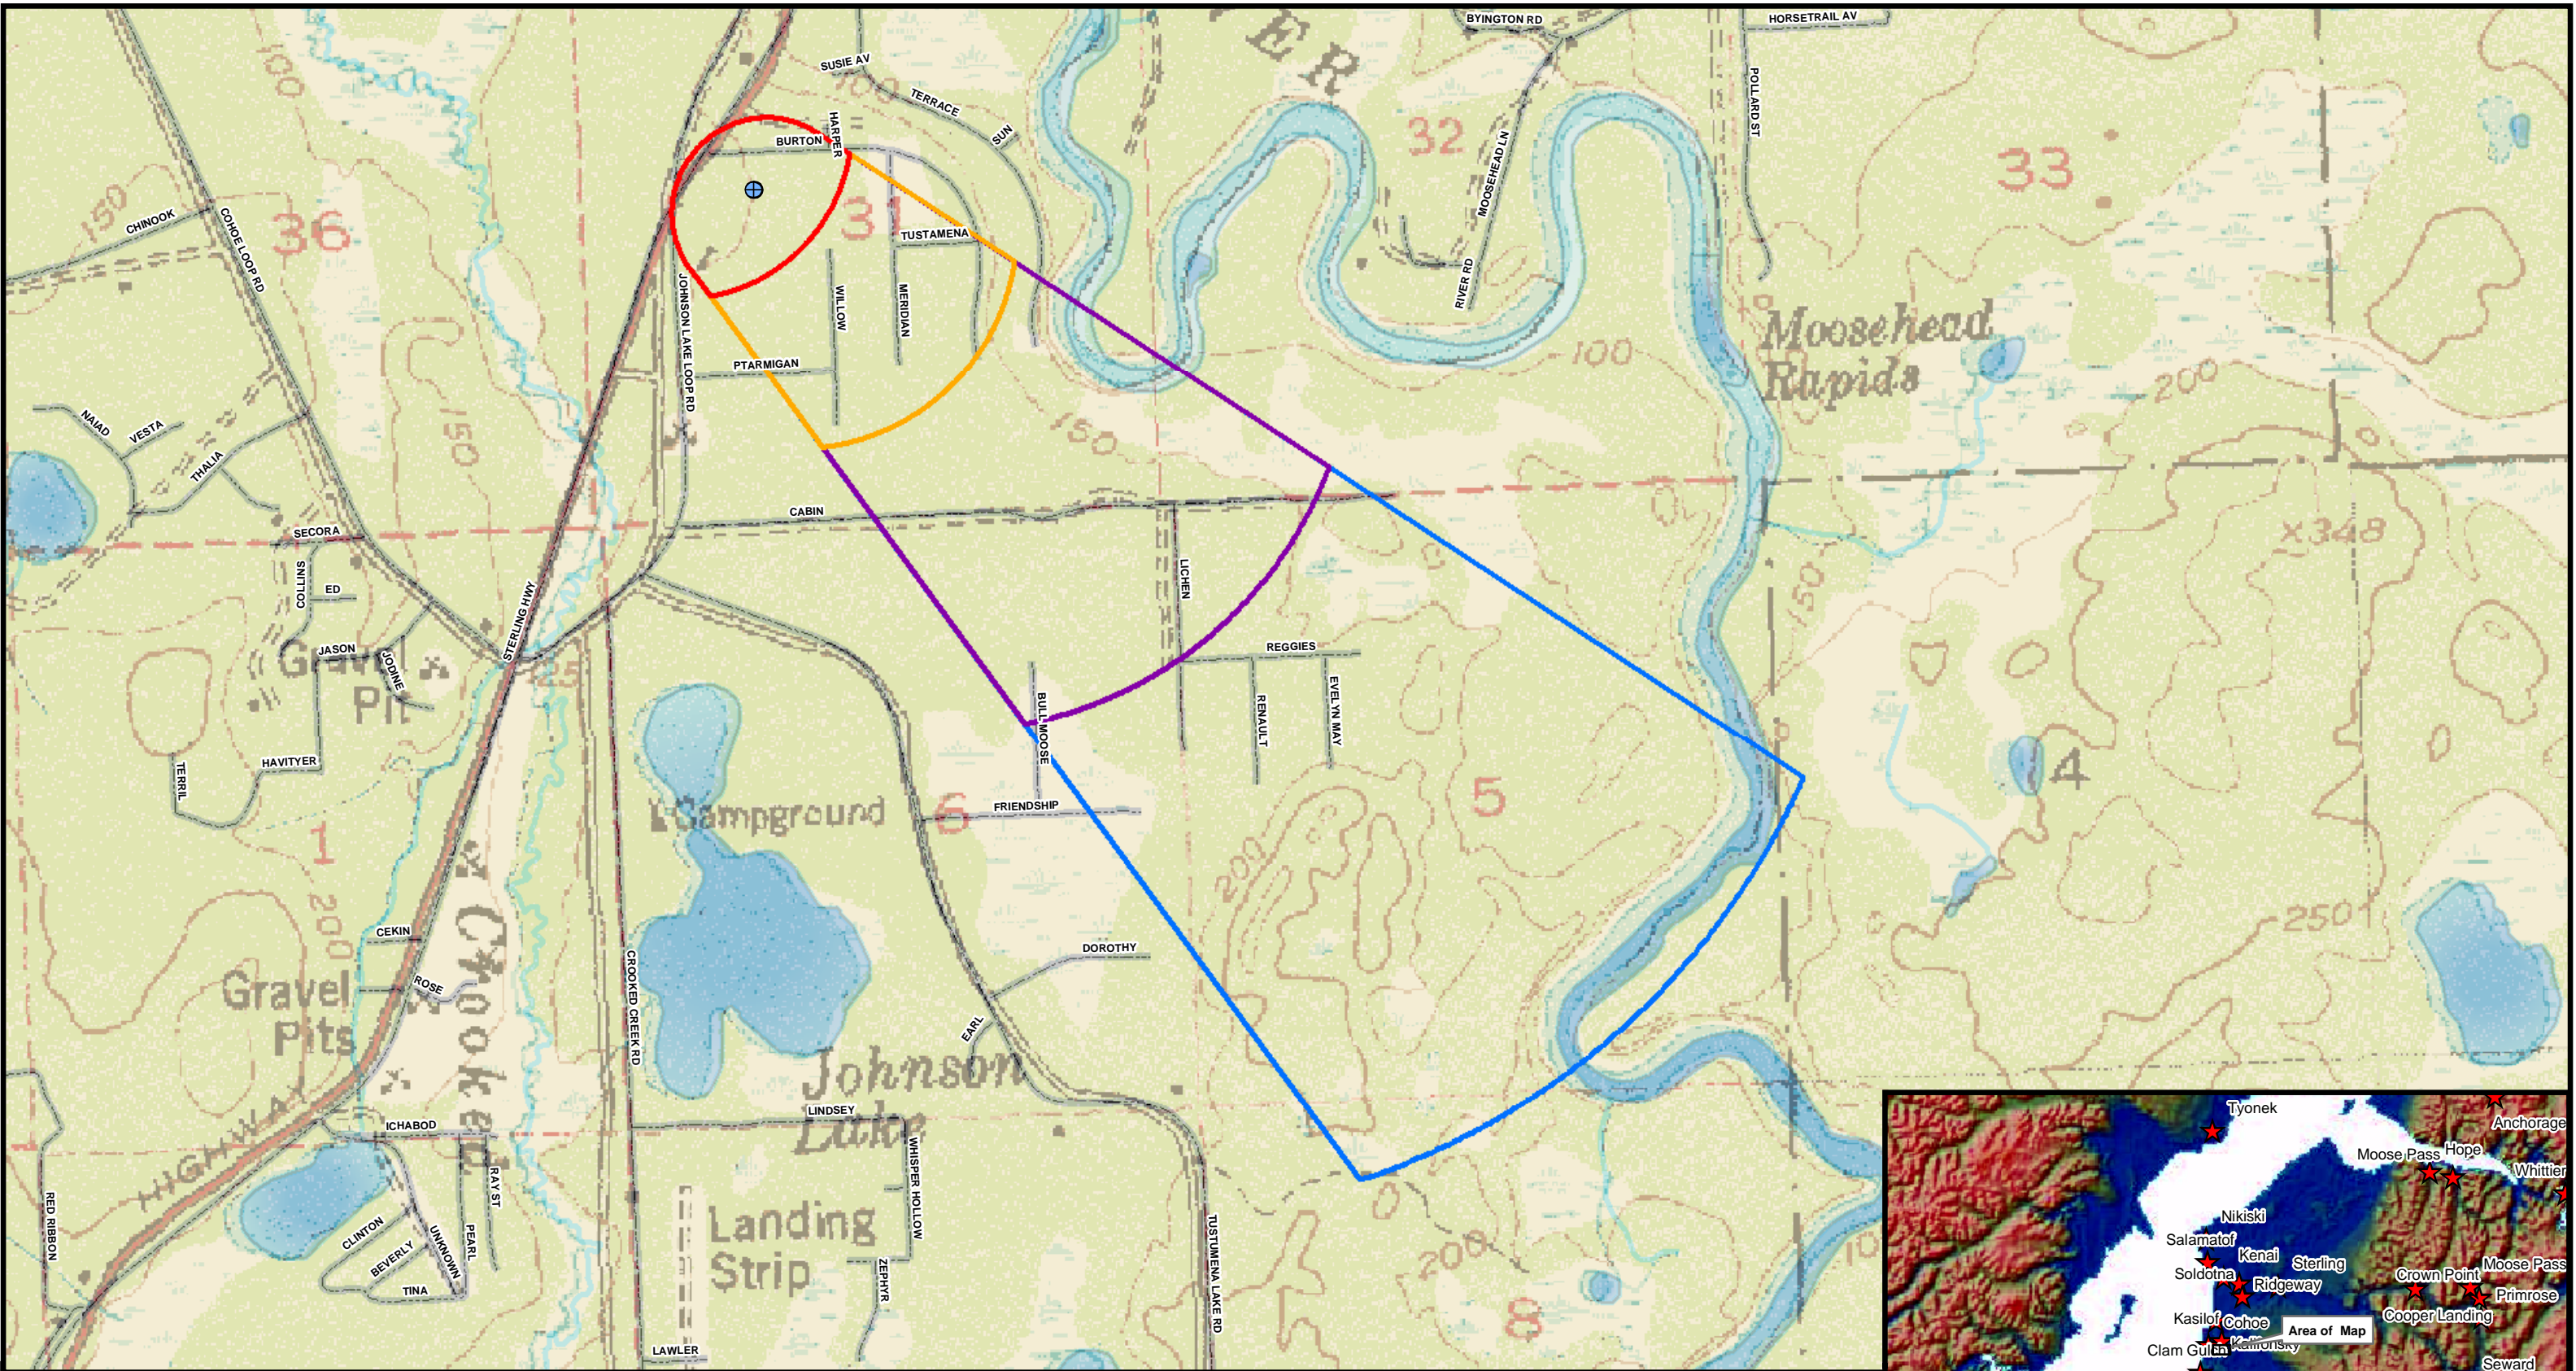

Map 1-KPBSD Tustumena Elementary School-Drinking Water Protection Area



PWSID: 240618.001



1:16,751

Data Sources:
 Kenai Borough: Roads and parcels
 63,000 Topographic map:USGS
 Potential Sources of Contamination: ADEC

	Class A Public Water System		Roads
	Zone A Protection Area		Rivers and Streams
	Zone B Protection Area		Water
	Zone C Protection Area		
	Zone D Protection Area		

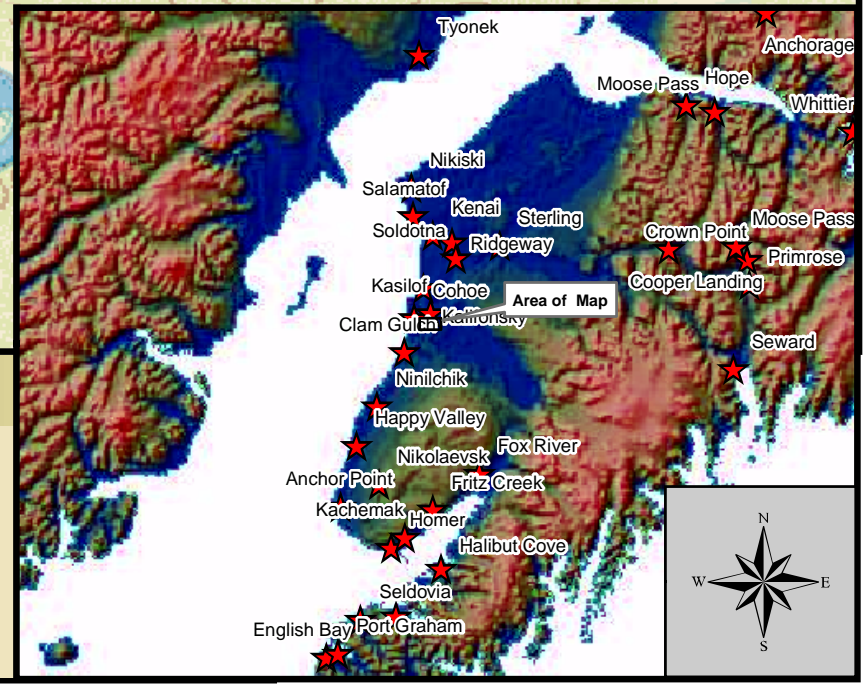

APPENDIX B

Contaminant Source Inventory and Risk Ranking for Tustumena Elementary School (Tables 1-7)

Table 1

**Contaminant Source Inventory for
KPBSD Tustumena Elementary**

PWSID 240618.001

Contaminant Source Type	Contaminant Source ID	CS ID tag	Zone	Map Number	Comments
Residential Areas	R01	R01	A	2	Zone A has 6 residential acres identified.
Septic systems (serves one single-family home)	R02	R02	A	2	Zone A has 2 residential septic systems identified.
Tanks, heating oil, nonresidential (underground)	T16	T16-1	A	2	Tustumena Elementary School
Tanks, heating oil, nonresidential (underground)	T16	T16-2	A	2	Tustumena Elementary School
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-1	A	2	CS File 2319.38.001. The fuel line for a 2,500 gallon diesel tank leaked 1,500 gallons under the school building. A finger-sized corrosion hole was determined to be the source of the leak under the floor of the mechanical room. Priority: High
Highways and roads, paved (cement or asphalt)	X20	X20-1-2	A	2	Zone A has 2 roads identified. Assumed to be paved.
Residential Areas	R01	R01-2	B	2	Zone B has 24 residential acre identified.
Septic systems (serves one single-family home)	R02	R02-3-14	B	2	Zone B has 12 residential septic systems identified.
Highways and roads, paved (cement or asphalt)	X20	X20-3-6	B	2	Zone B has 4 roads identified. Assumed to be paved.
Residential Areas	R01	R01-3	C	2	Zone C has 44 residential acres identified.
Septic systems (serves one single-family home)	R02	R02-15-20	C	2	Zone C has 6 residential septic systems identified.
Highways and roads, paved (cement or asphalt)	X20	X20-7-8	C	2	Zone C has 2 roads identified. Assumed to be paved.

Table 2

*Contaminant Source Inventory and Risk Ranking for
KPBSD Tustumena Elementary
Sources of Bacteria and Viruses*

PWSID 240618.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Residential Areas	R01	R01	A	Low	2	Zone A has 6 residential acres identified.
Septic systems (serves one single-family home)	R02	R02	A	Low	2	Zone A has 2 residential septic systems identified.
Highways and roads, paved (cement or asphalt)	X20	X20-1-2	A	Low	2	Zone A has 2 roads identified. Assumed to be paved.
Residential Areas	R01	R01-2	B	Low	2	Zone B has 24 residential acre identified.
Septic systems (serves one single-family home)	R02	R02-3-14	B	Low	2	Zone B has 12 residential septic systems identified.
Highways and roads, paved (cement or asphalt)	X20	X20-3-6	B	Low	2	Zone B has 4 roads identified. Assumed to be paved.
Residential Areas	R01	R01-3	C	Low	2	Zone C has 44 residential acres identified.
Septic systems (serves one single-family home)	R02	R02-15-20	C	Low	2	Zone C has 6 residential septic systems identified.
Highways and roads, paved (cement or asphalt)	X20	X20-7-8	C	Low	2	Zone C has 2 roads identified. Assumed to be paved.

Table 3

Contaminant Source Inventory and Risk Ranking for
KPBSD Tustumena Elementary
Sources of Nitrates/Nitrites

PWSID 240618.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Residential Areas	R01	R01	A	Low	2	Zone A has 6 residential acres identified.
Septic systems (serves one single-family home)	R02	R02	A	Low	2	Zone A has 2 residential septic systems identified.
Highways and roads, paved (cement or asphalt)	X20	X20-1-2	A	Low	2	Zone A has 2 roads identified. Assumed to be paved.
Residential Areas	R01	R01-2	B	Low	2	Zone B has 24 residential acre identified.
Septic systems (serves one single-family home)	R02	R02-3-14	B	Low	2	Zone B has 12 residential septic systems identified.
Highways and roads, paved (cement or asphalt)	X20	X20-3-6	B	Low	2	Zone B has 4 roads identified. Assumed to be paved.
Residential Areas	R01	R01-3	C	Low	2	Zone C has 44 residential acres identified.
Septic systems (serves one single-family home)	R02	R02-15-20	C	Low	2	Zone C has 6 residential septic systems identified.
Highways and roads, paved (cement or asphalt)	X20	X20-7-8	C	Low	2	Zone C has 2 roads identified. Assumed to be paved.

Table 4

*Contaminant Source Inventory and Risk Ranking for
 KPBSD Tustumena Elementary
 Sources of Volatile Organic Chemicals*

PWSID 240618.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Residential Areas	R01	R01	A	Low	2	Zone A has 6 residential acres identified.
Septic systems (serves one single-family home)	R02	R02	A	Low	2	Zone A has 2 residential septic systems identified.
Tanks, heating oil, nonresidential (underground)	T16	T16-1	A	Low	2	Tustumena Elementary School
Tanks, heating oil, nonresidential (underground)	T16	T16-2	A	Low	2	Tustumena Elementary School
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-1	A	High	2	CS File 2319.38.001. The fuel line for a 2,500 gallon diesel tank leaked 1,500 gallons under the school building. A finger-sized corrosion hole was determined to be the source of the leak under the floor of the mechanical room. Priority: High
Highways and roads, paved (cement or asphalt)	X20	X20-1-2	A	Low	2	Zone A has 2 roads identified. Assumed to be paved.
Residential Areas	R01	R01-2	B	Low	2	Zone B has 24 residential acre identified.
Septic systems (serves one single-family home)	R02	R02-3-14	B	Low	2	Zone B has 12 residential septic systems identified.
Highways and roads, paved (cement or asphalt)	X20	X20-3-6	B	Low	2	Zone B has 4 roads identified. Assumed to be paved.
Residential Areas	R01	R01-3	C	Low	2	Zone C has 44 residential acres identified.
Septic systems (serves one single-family home)	R02	R02-15-20	C	Low	2	Zone C has 6 residential septic systems identified.
Highways and roads, paved (cement or asphalt)	X20	X20-7-8	C	Low	2	Zone C has 2 roads identified. Assumed to be paved.

Table 5

*Contaminant Source Inventory and Risk Ranking for
 KPBSD Tustumena Elementary
 Sources of Heavy Metals, Cyanide and Other Inorganic Chemicals*

PWSID 240618.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Residential Areas	R01	R01	A	Low	2	Zone A has 6 residential acres identified.
Septic systems (serves one single-family home)	R02	R02	A	Low	2	Zone A has 2 residential septic systems identified.
Tanks, heating oil, nonresidential (underground)	T16	T16-1	A	Low	2	Tustumena Elementary School
Tanks, heating oil, nonresidential (underground)	T16	T16-2	A	Low	2	Tustumena Elementary School
Highways and roads, paved (cement or asphalt)	X20	X20-1-2	A	Low	2	Zone A has 2 roads identified. Assumed to be paved.
Residential Areas	R01	R01-2	B	Low	2	Zone B has 24 residential acre identified.
Septic systems (serves one single-family home)	R02	R02-3-14	B	Low	2	Zone B has 12 residential septic systems identified.
Highways and roads, paved (cement or asphalt)	X20	X20-3-6	B	Low	2	Zone B has 4 roads identified. Assumed to be paved.
Residential Areas	R01	R01-3	C	Low	2	Zone C has 44 residential acres identified.
Septic systems (serves one single-family home)	R02	R02-15-20	C	Low	2	Zone C has 6 residential septic systems identified.
Highways and roads, paved (cement or asphalt)	X20	X20-7-8	C	Low	2	Zone C has 2 roads identified. Assumed to be paved.

Table 6

*Contaminant Source Inventory and Risk Ranking for
KPBSD Tustumena Elementary
Sources of Synthetic Organic Chemicals*

PWSID 240618.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Residential Areas	R01	R01	A	Low	2	Zone A has 6 residential acres identified.
Septic systems (serves one single-family home)	R02	R02	A	Low	2	Zone A has 2 residential septic systems identified.
Residential Areas	R01	R01-2	B	Low	2	Zone B has 24 residential acre identified.
Septic systems (serves one single-family home)	R02	R02-3-14	B	Low	2	Zone B has 12 residential septic systems identified.
Residential Areas	R01	R01-3	C	Low	2	Zone C has 44 residential acres identified.
Septic systems (serves one single-family home)	R02	R02-15-20	C	Low	2	Zone C has 6 residential septic systems identified.

Table 7


*Contaminant Source Inventory and Risk Ranking for
 KPBSD Tustumena Elementary
 Sources of Other Organic Chemicals*

PWSID 240618.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Residential Areas	R01	R01	A	Low	2	Zone A has 6 residential acres identified.
Septic systems (serves one single-family home)	R02	R02	A	Low	2	Zone A has 2 residential septic systems identified.
Highways and roads, paved (cement or asphalt)	X20	X20-1-2	A	Low	2	Zone A has 2 roads identified. Assumed to be paved.
Residential Areas	R01	R01-2	B	Low	2	Zone B has 24 residential acre identified.
Septic systems (serves one single-family home)	R02	R02-3-14	B	Low	2	Zone B has 12 residential septic systems identified.
Highways and roads, paved (cement or asphalt)	X20	X20-3-6	B	Low	2	Zone B has 4 roads identified. Assumed to be paved.
Residential Areas	R01	R01-3	C	Low	2	Zone C has 44 residential acres identified.
Septic systems (serves one single-family home)	R02	R02-15-20	C	Low	2	Zone C has 6 residential septic systems identified.
Highways and roads, paved (cement or asphalt)	X20	X20-7-8	C	Low	2	Zone C has 2 roads identified. Assumed to be paved.

APPENDIX C

Tustumena Elementary School Drinking Water Protection Area and Potential and Existing Contaminant Sources (Map 2)

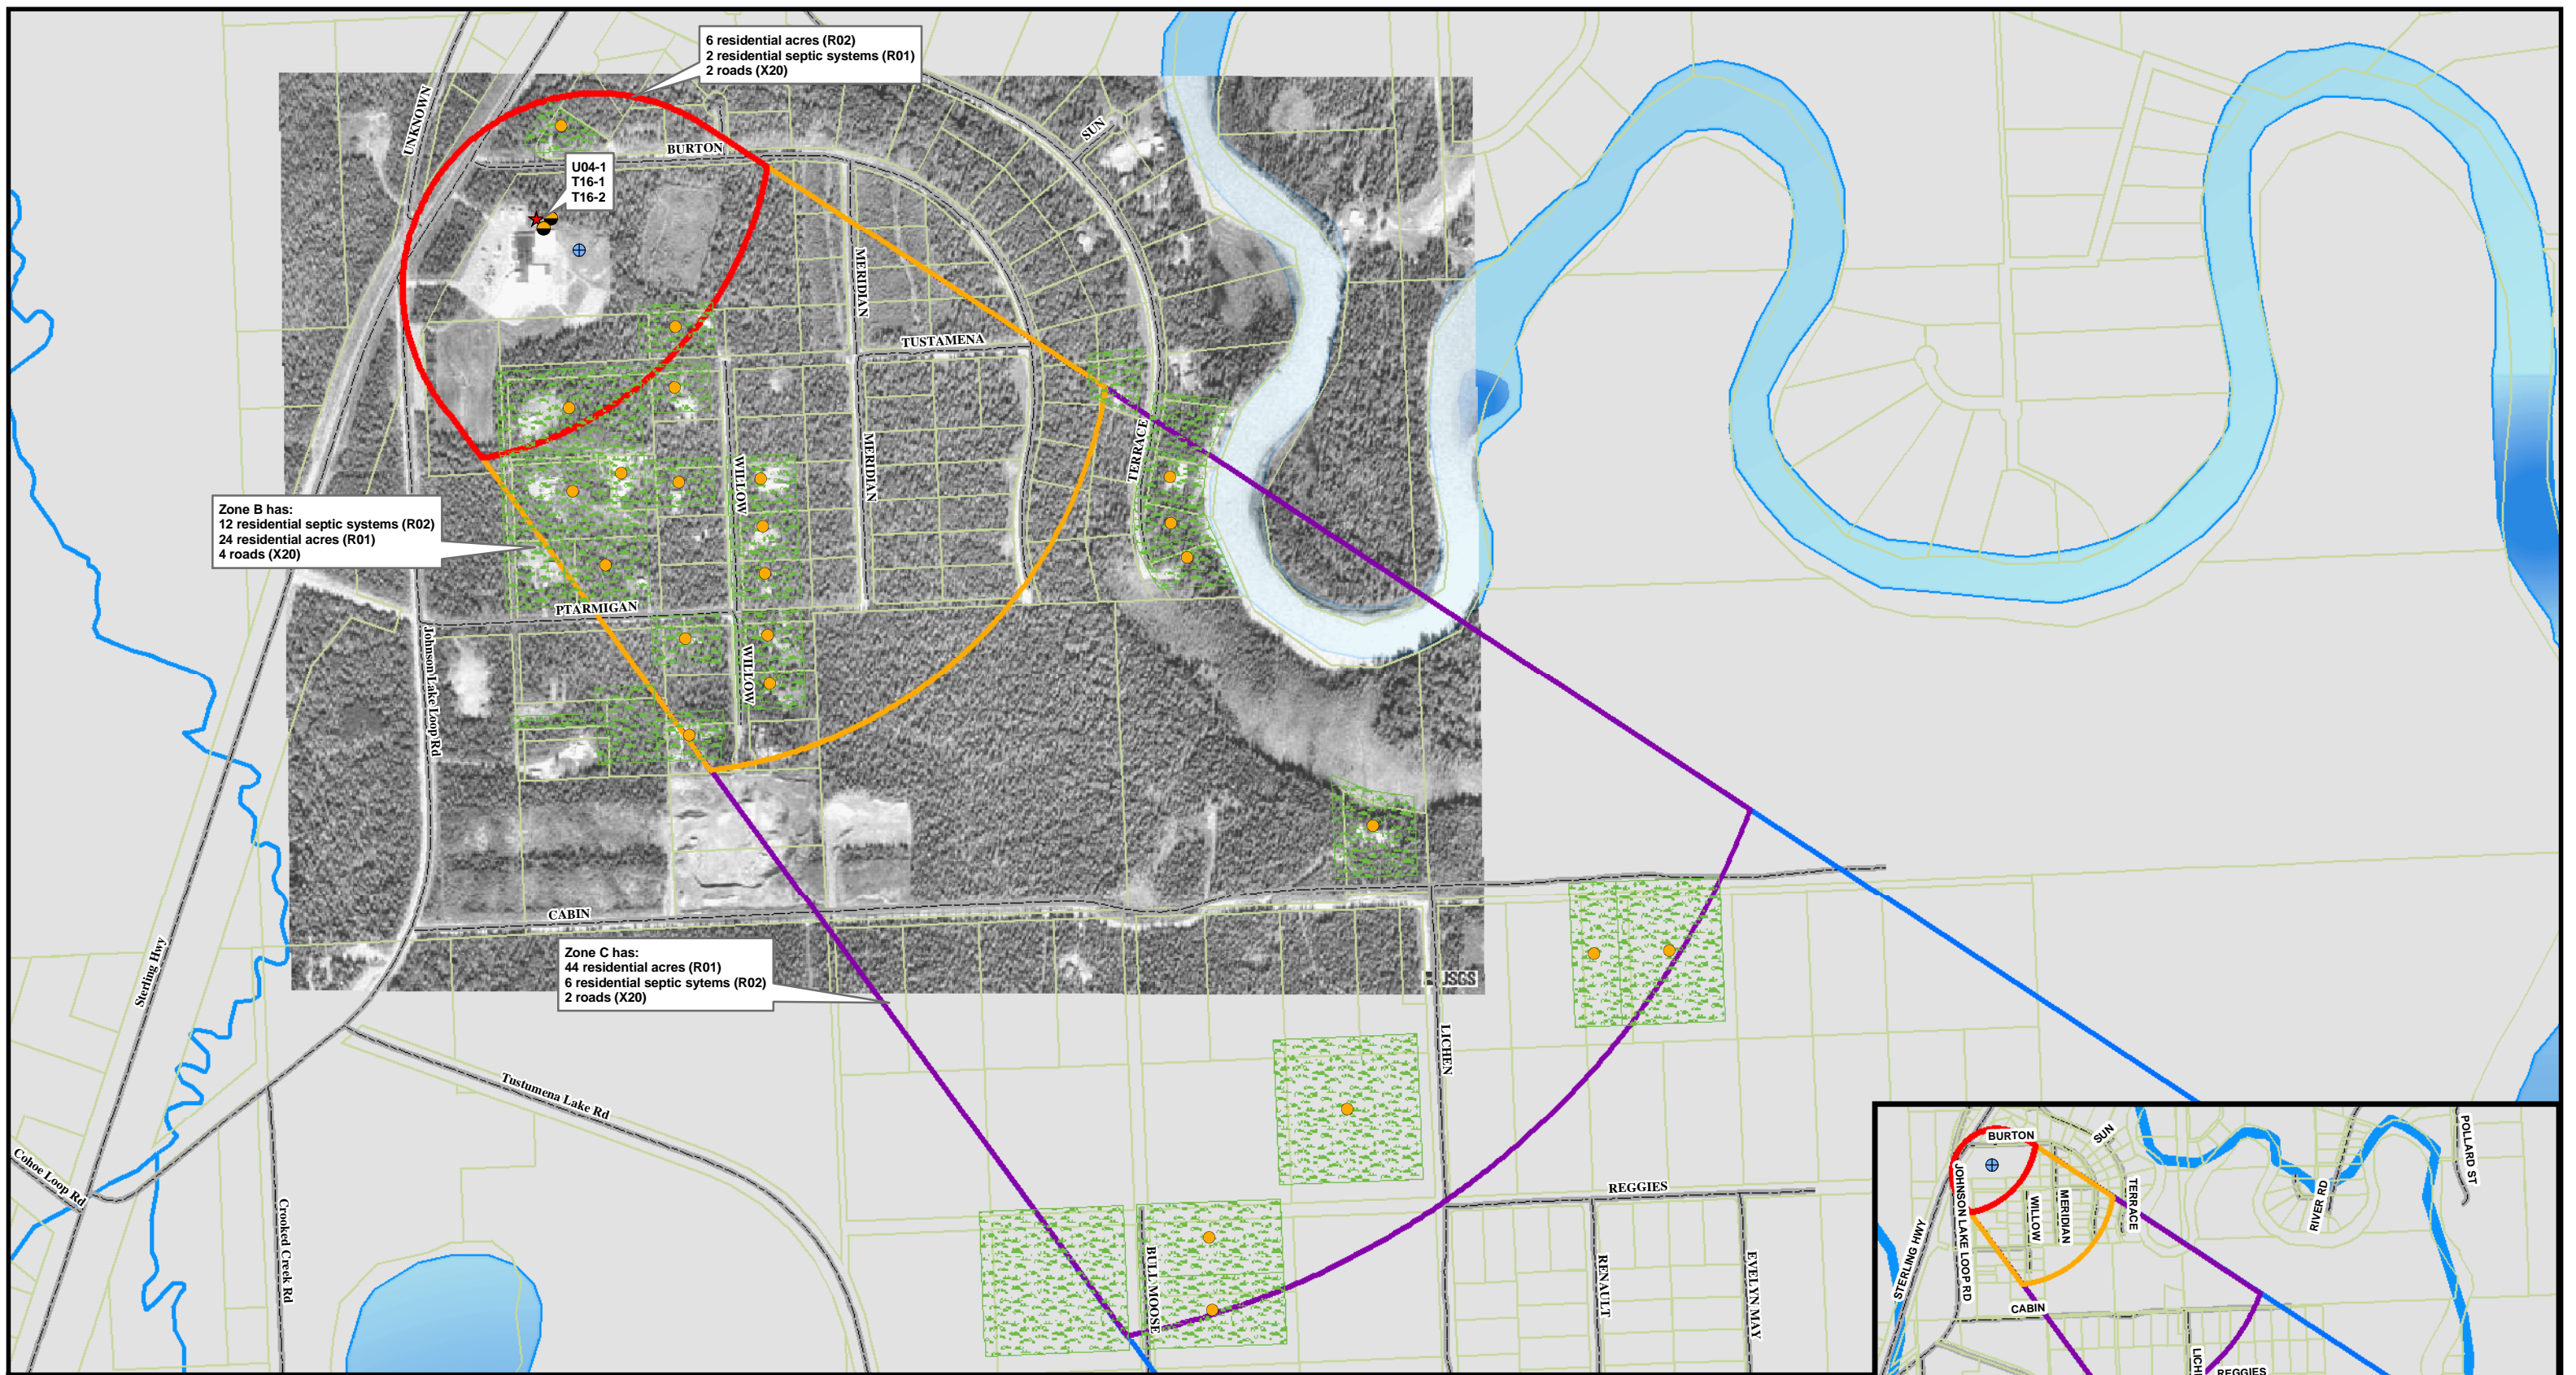

Map 2-Tustumena Elementary : Potential and Existing Sources of Contamination

PWSID: 240618.001


Alaska Department of Environmental Conservation

Alaska Drinking Water Protection Program

Scale: 0 to 680 Feet, 1:8,160

Data Sources:
 Roads and parcels: Kenai Borough
 Aerial Photo: Terraserver and USGS
 Potential Sources of Contamination: ADEC

Legend	
⊕ Class A Public Water System	Water
Zone A Protection Area	Rivers and Streams
Zone B Protection Area	Roads
Zone C Protection Area	Logging Area (E02)
Zone D Protection Area	Residential Area (R02)
● Septic systems(R02)	● Underground fuel tank
★ ADEC Contaminated Site	★ Parking Lot

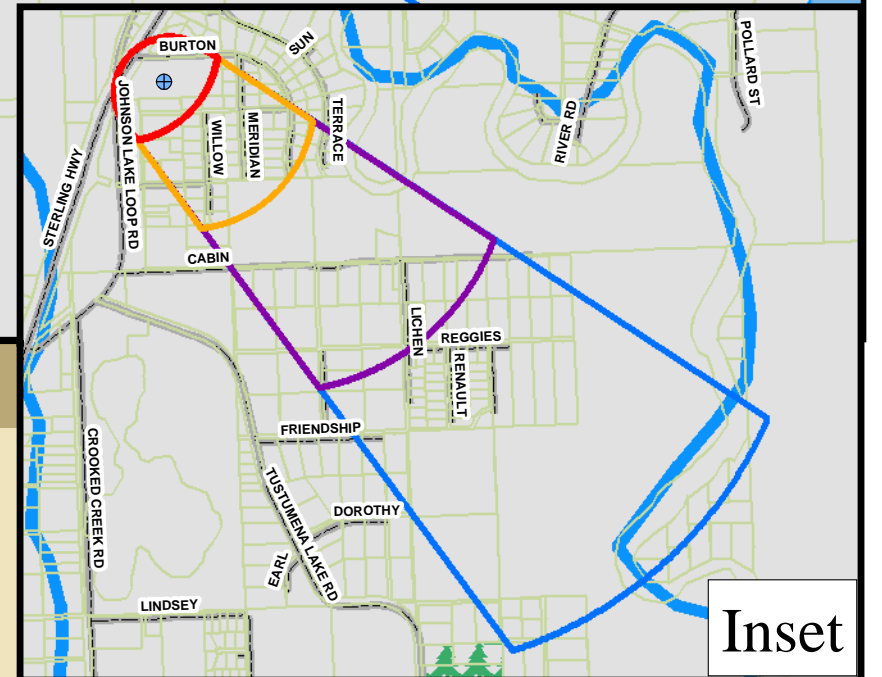

APPENDIX D

Vulnerability Analysis for Tustumena Elementary School Public Drinking Water Source (Charts 1-14)

Chart 1. Susceptibility of the wellhead - Tustumena Elementary School

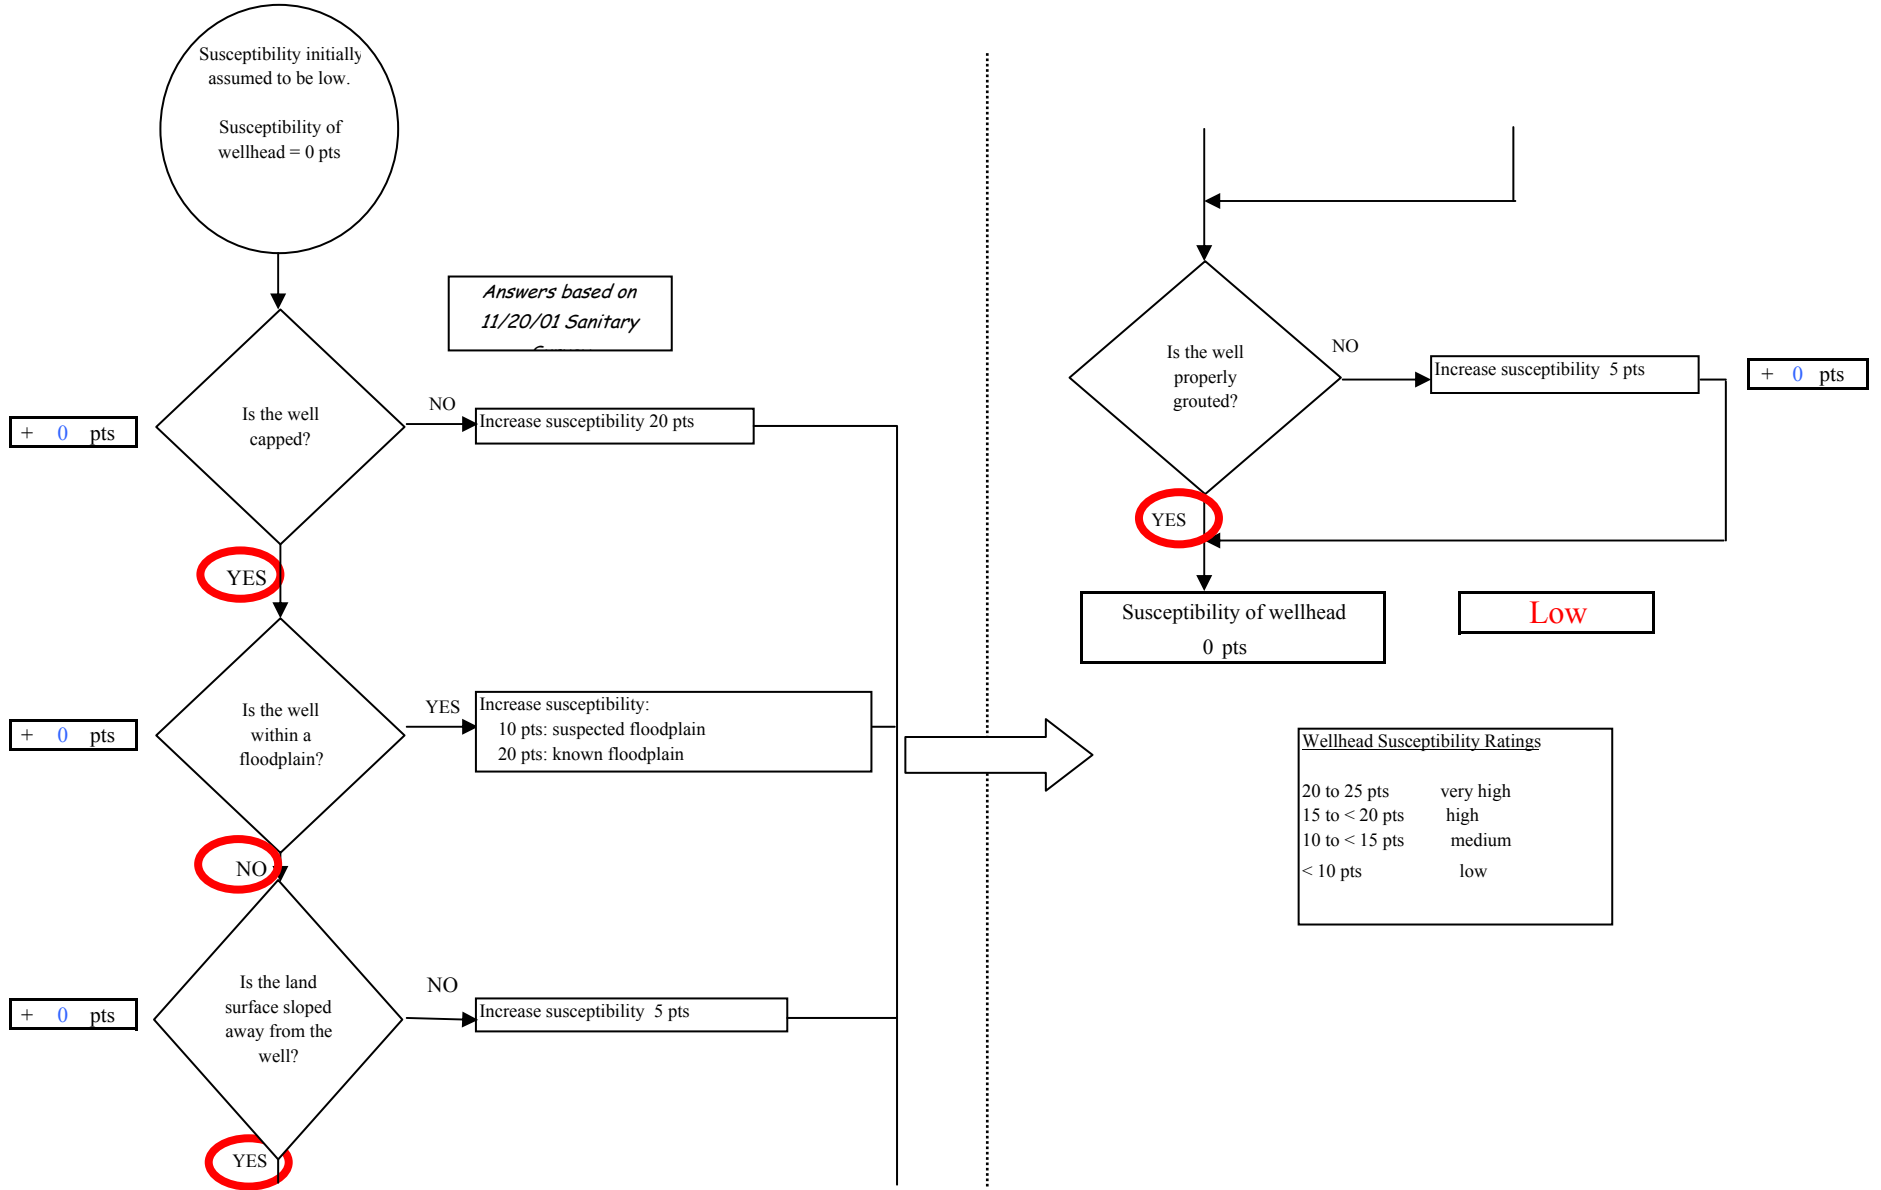


Chart 2. Susceptibility of the aquifer - Tustumena Elementary School

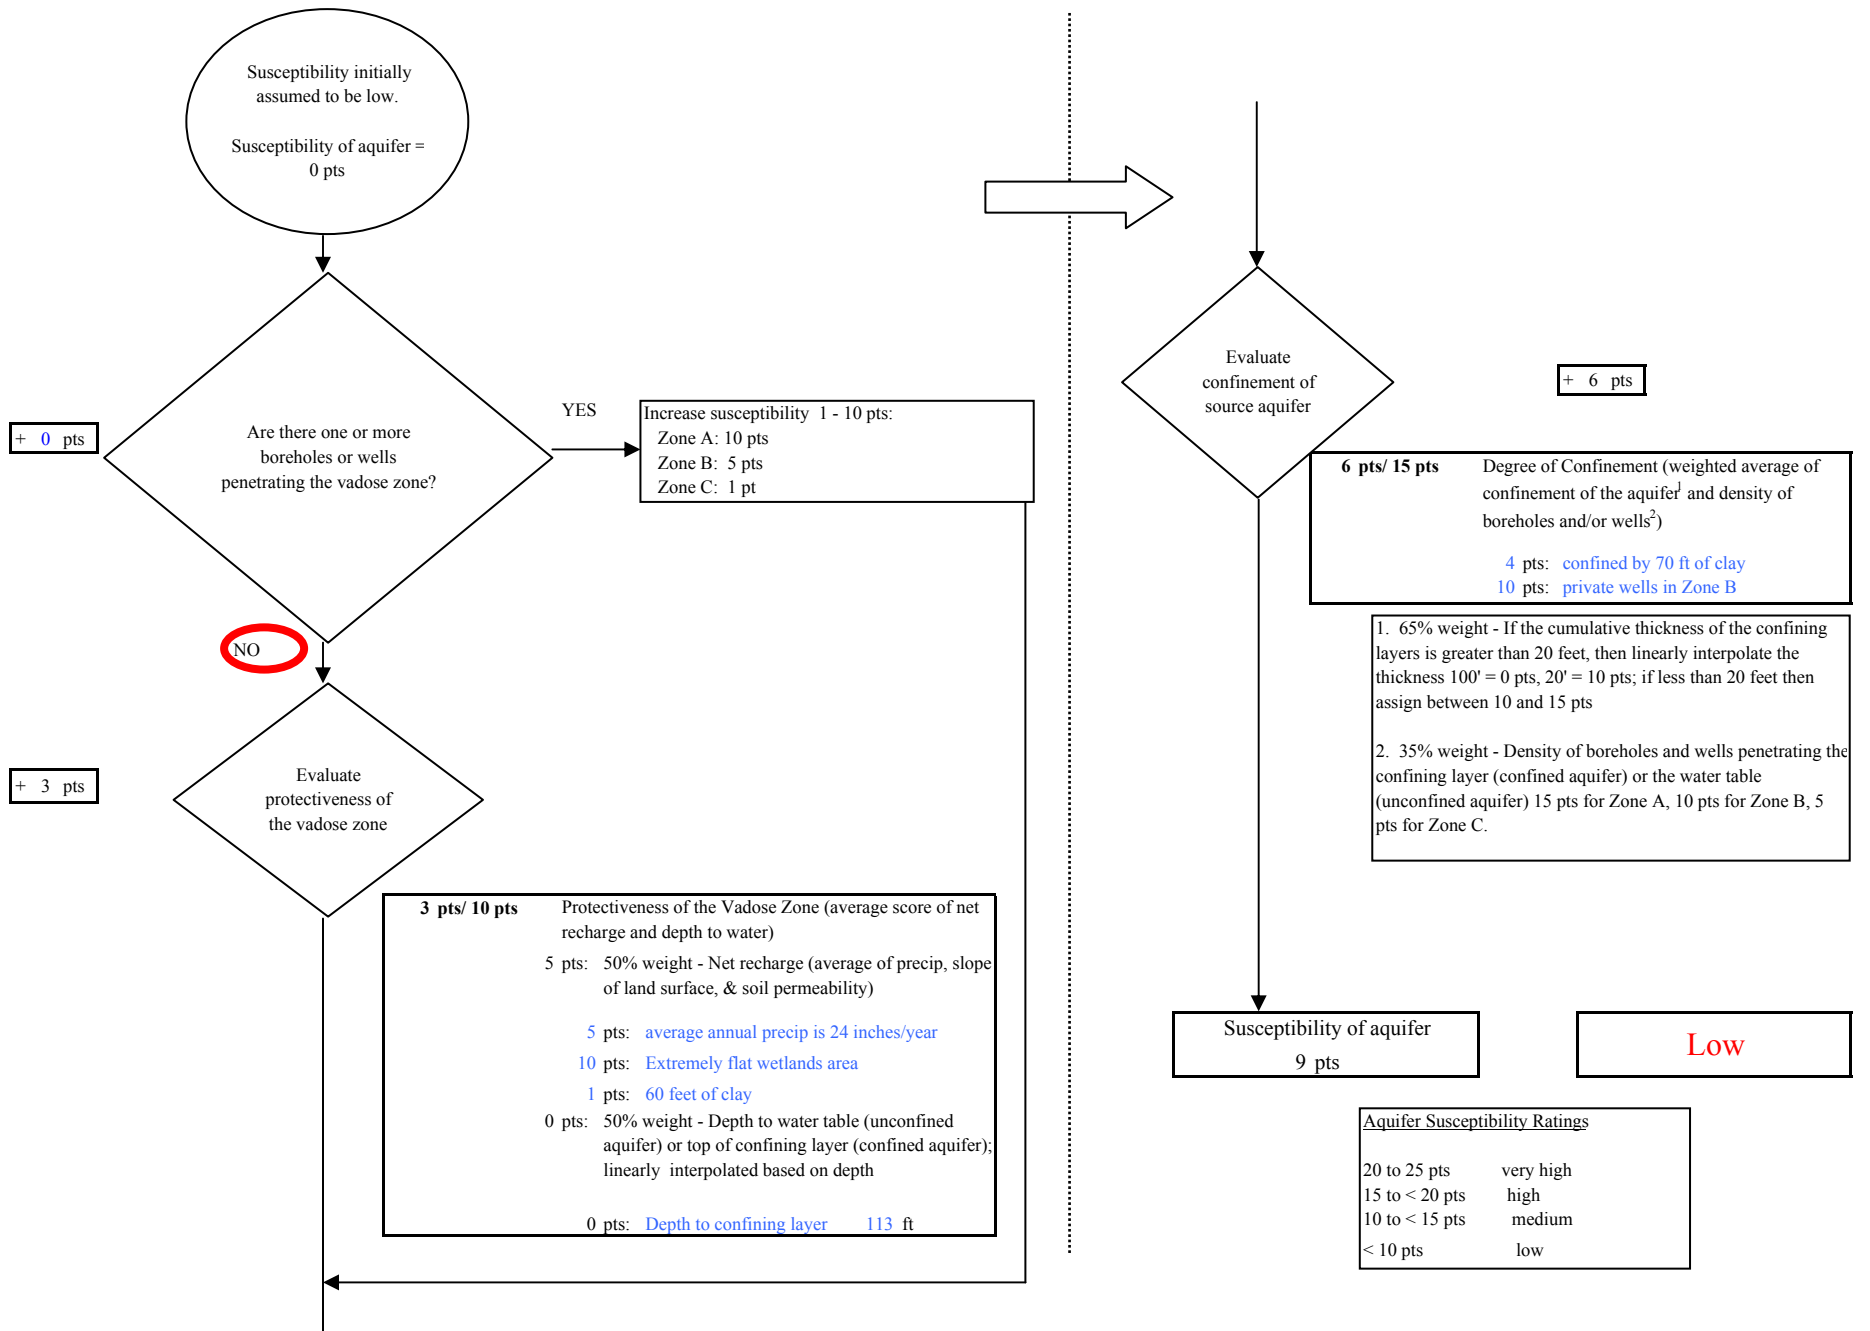


Chart 3. Contaminant risks for Tustumena Elementary School - Bacteria & Viruses

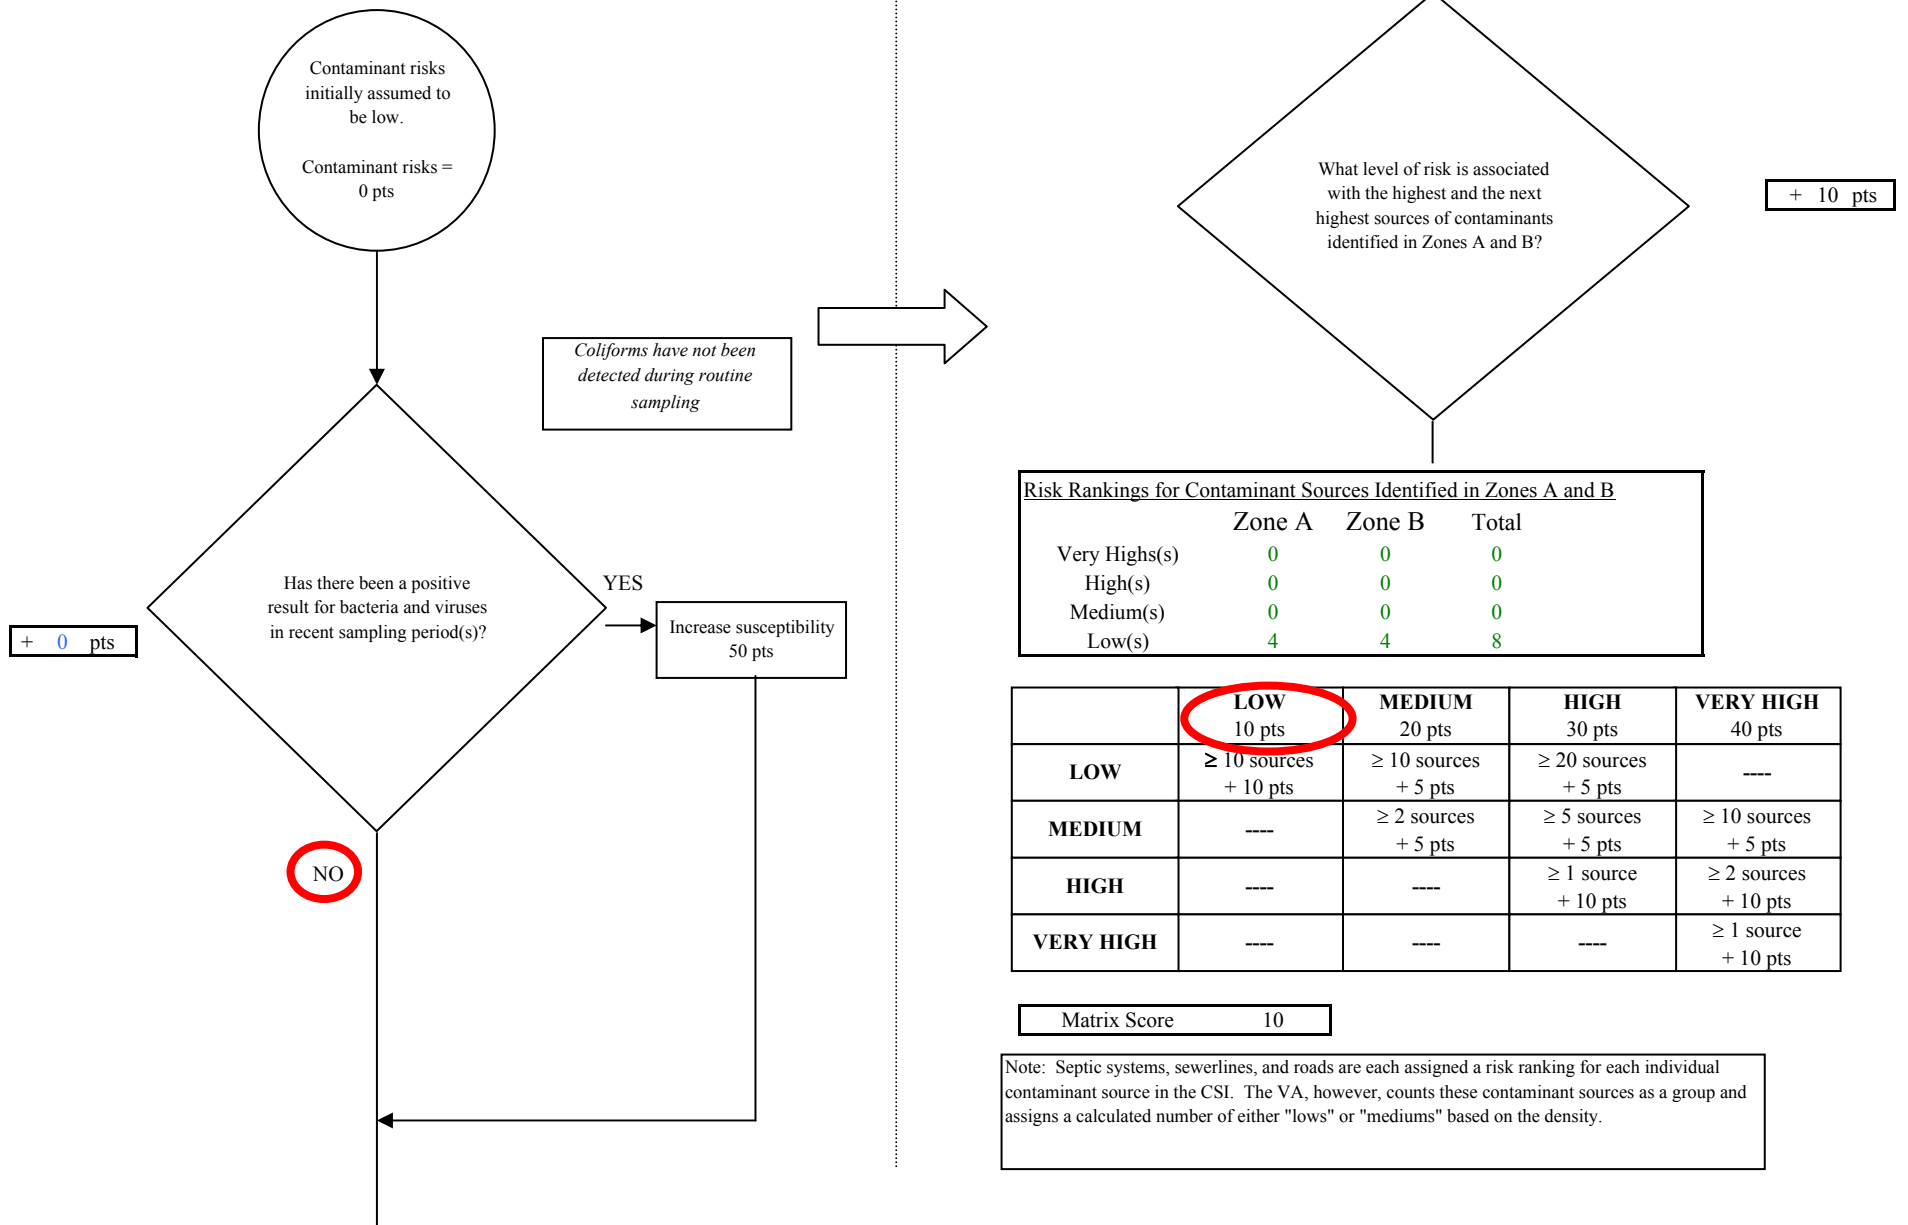


Chart 3. Contaminant risks for Tustumena Elementary School - Bacteria & Viruses

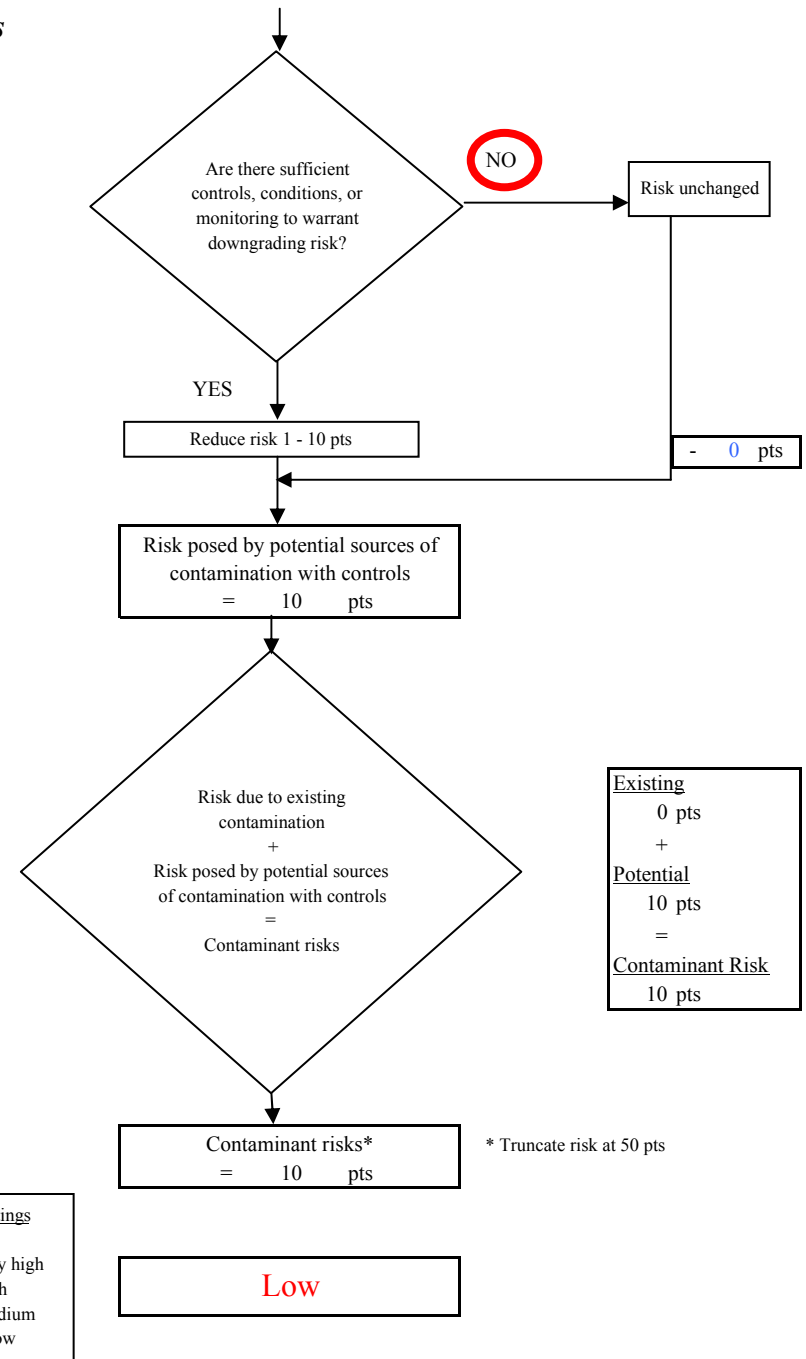

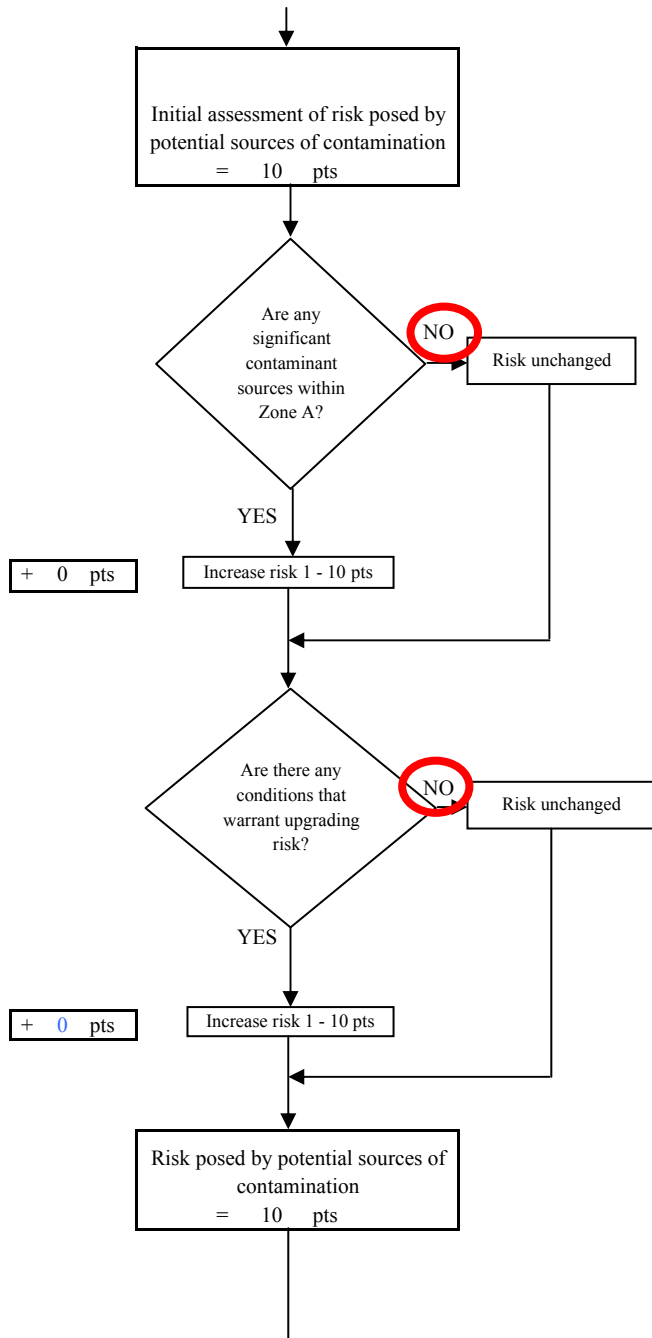


Chart 4. Vulnerability analysis for Tustumena Elementary School - Bacteria & Viruses

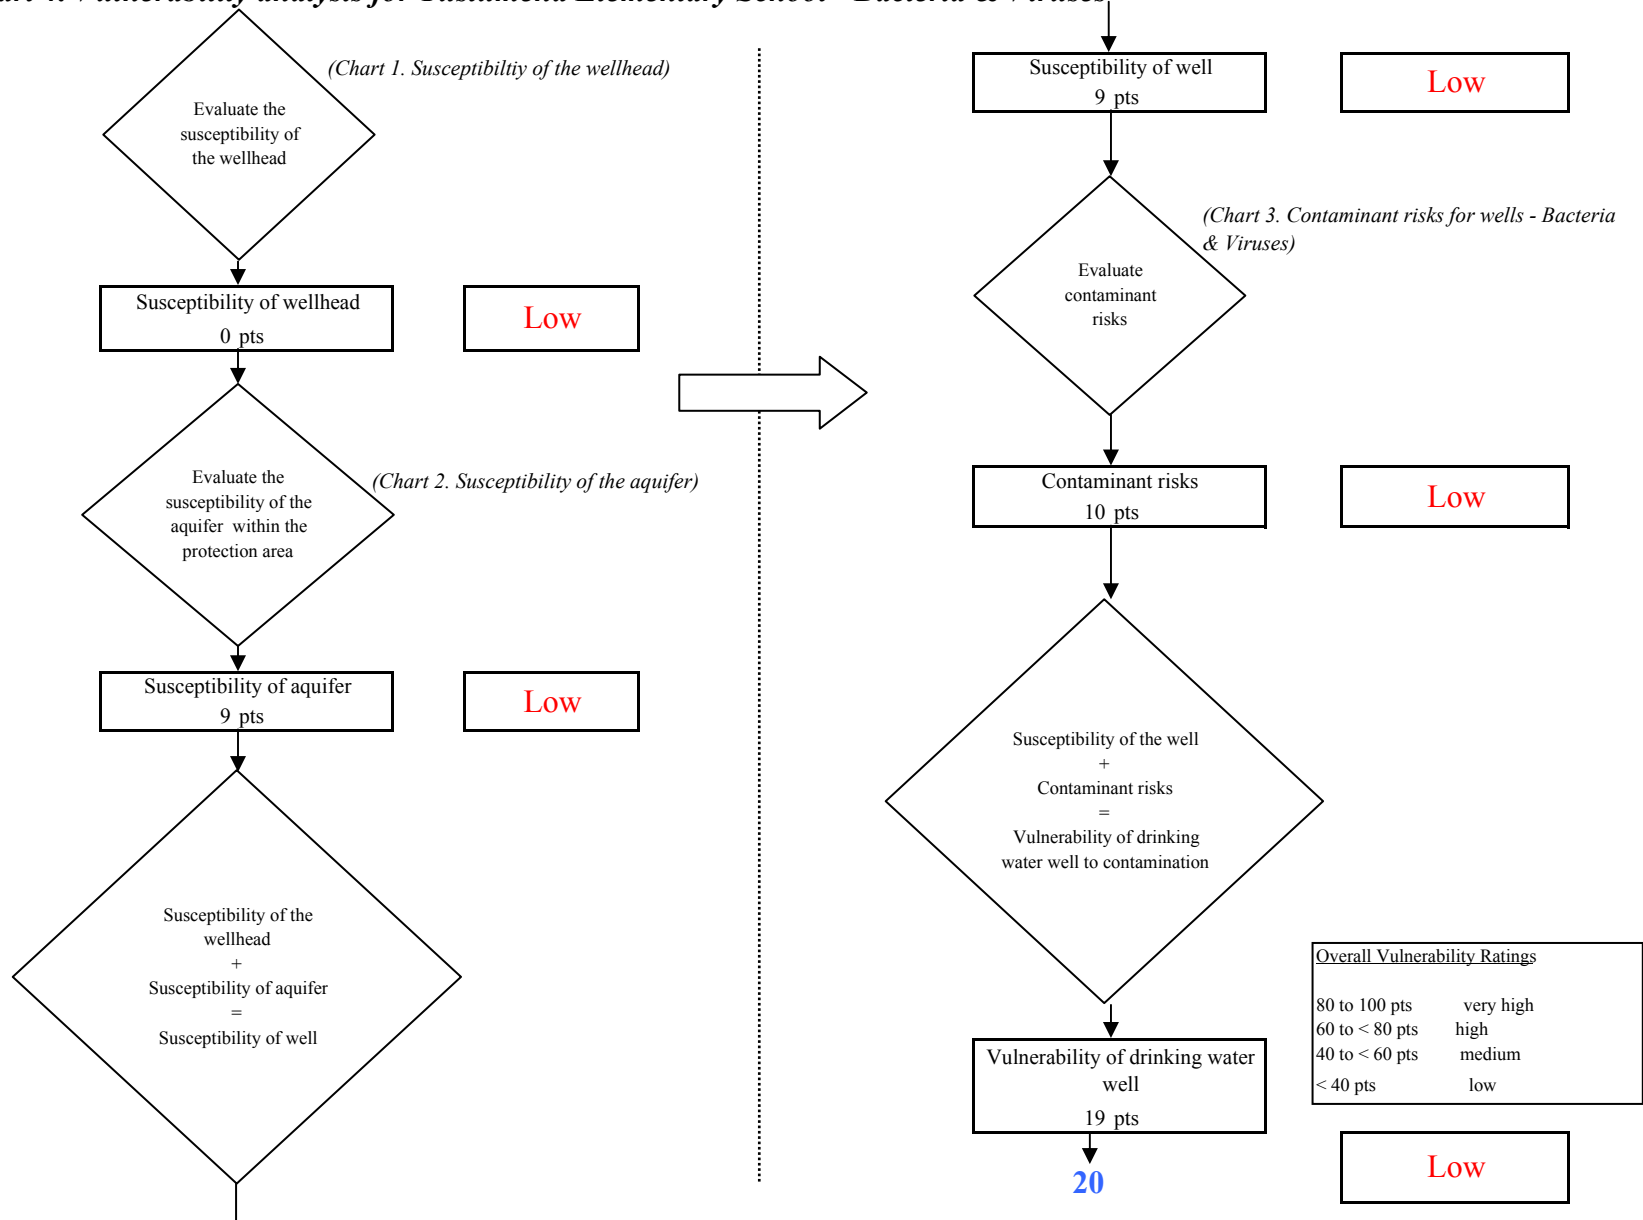


Chart 5. Contaminant risks for Tustumena Elementary School - Nitrates and Nitrites


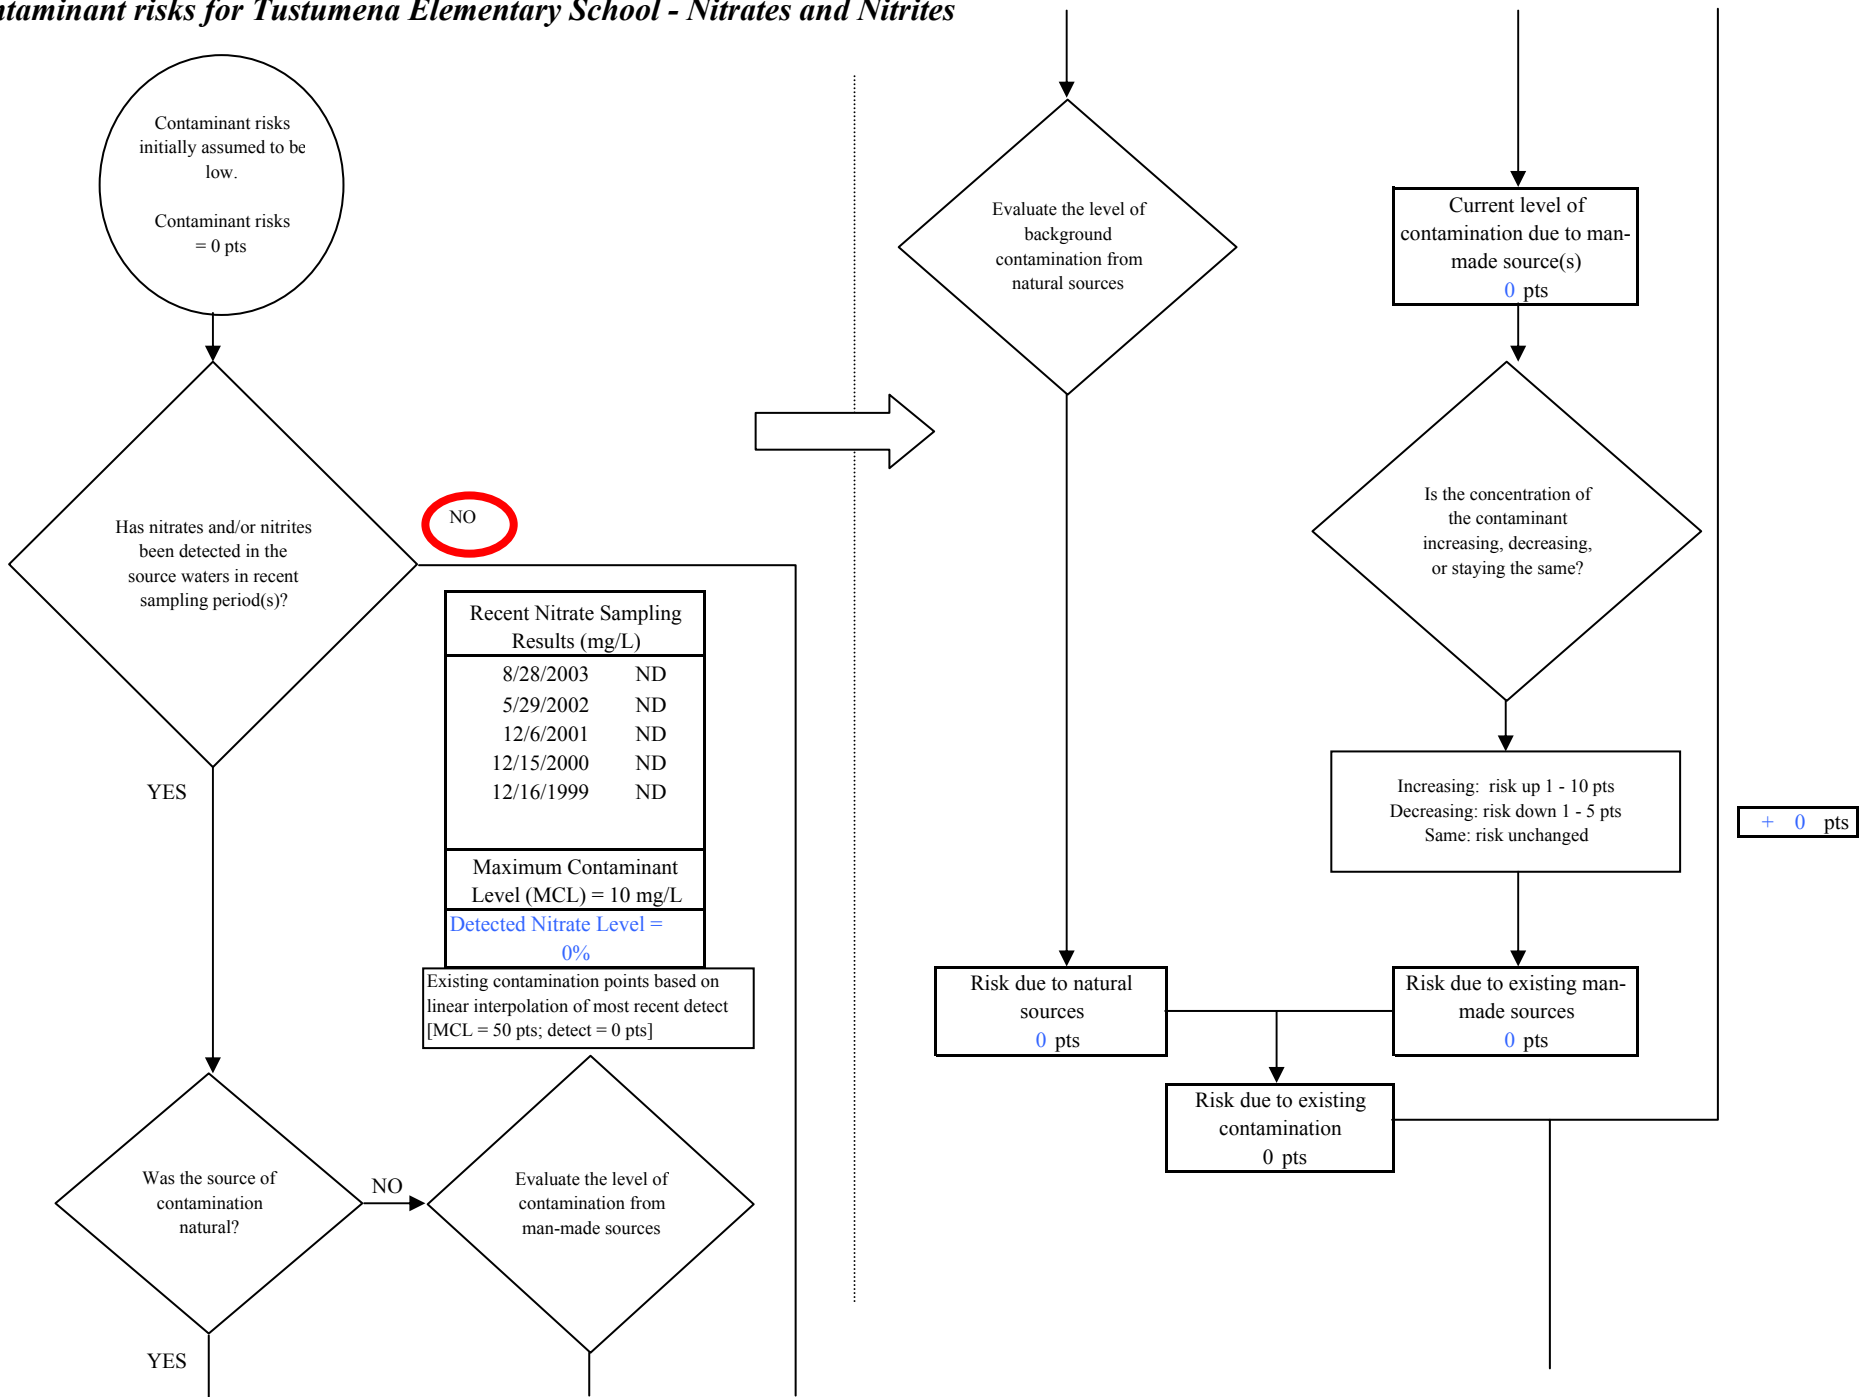


Chart 5. Contaminant risks for Tustumena Elementary School - Nitrates and Nitrites

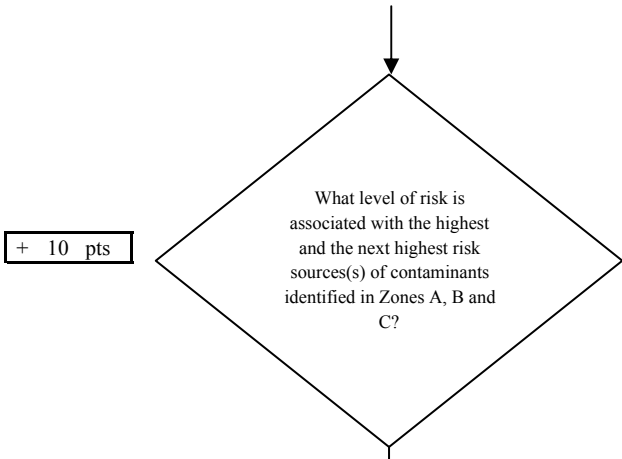



+ 10 pts

Risk Levels for Contaminant Sources identified in Zones A, B and C			
	Zone A	Zones B&C	Total
Very High(s)	0	0	0
High(s)	0	0	0
Medium(s)	0	0	0
Low(s)	4	4	8

	LOW 10 pts	MEDIUM 20 pts	HIGH 30 pts	VERY HIGH 40 pts
LOW	≥ 10 sources + 10 pts	≥ 10 sources + 5 pts	≥ 20 sources + 5 pts	----
MEDIUM	----	≥ 2 sources + 5 pts	≥ 5 sources + 5 pts	≥ 10 sources + 5 pts
HIGH	----	----	≥ 1 source + 10 pts	≥ 2 sources + 10 pts
VERY HIGH	----	----	----	≥ 1 source + 10 pts

Matrix Score 10

Note: Septic systems, sewerlines, and roads are each assigned a risk ranking for each individual contaminant source in the CSI. The VA, however, counts these contaminant sources as a group and assigns a calculated number of either "lows" or "mediums" based on the density.

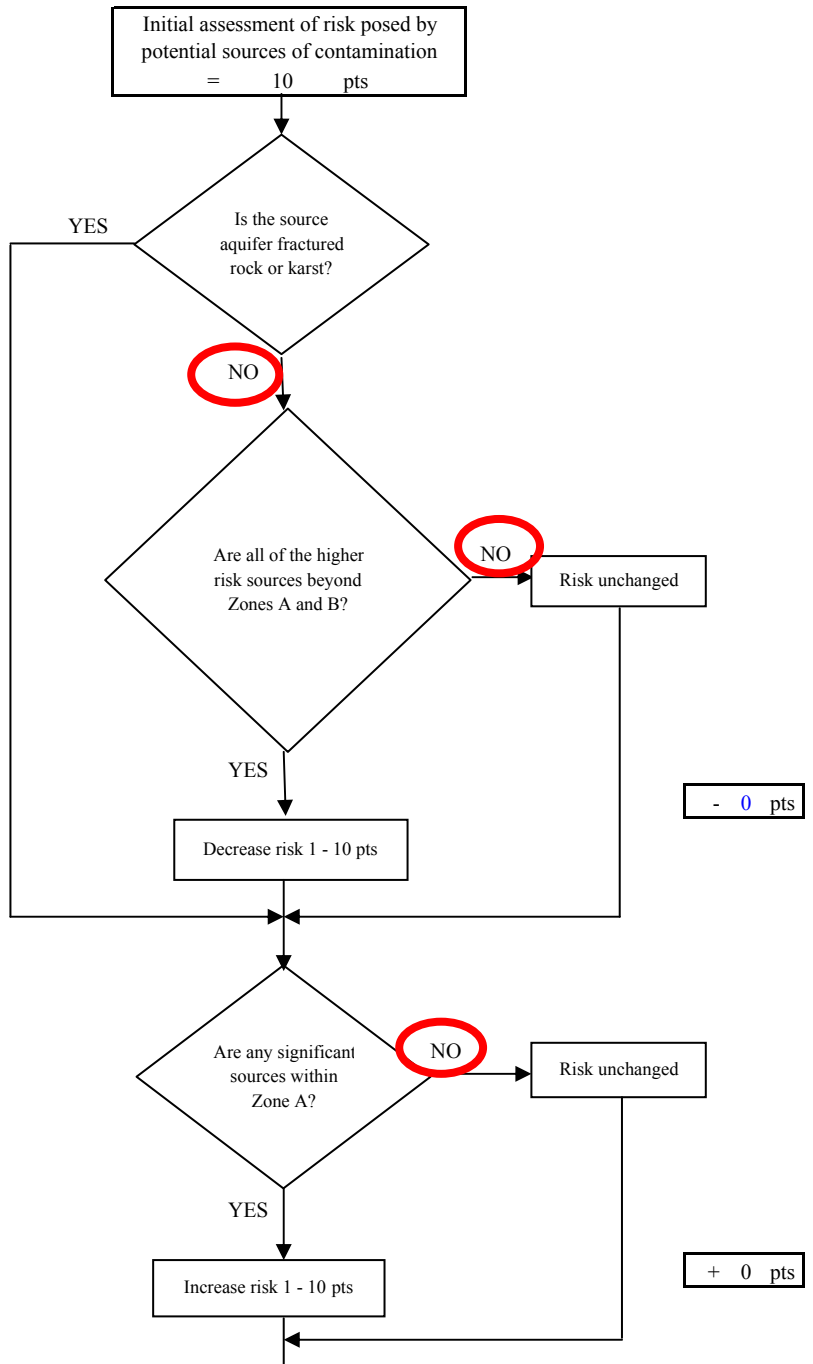

- 0 pts

+ 0 pts

Chart 5. Contaminant risks for Tustumena Elementary School - Nitrates and Nitrites

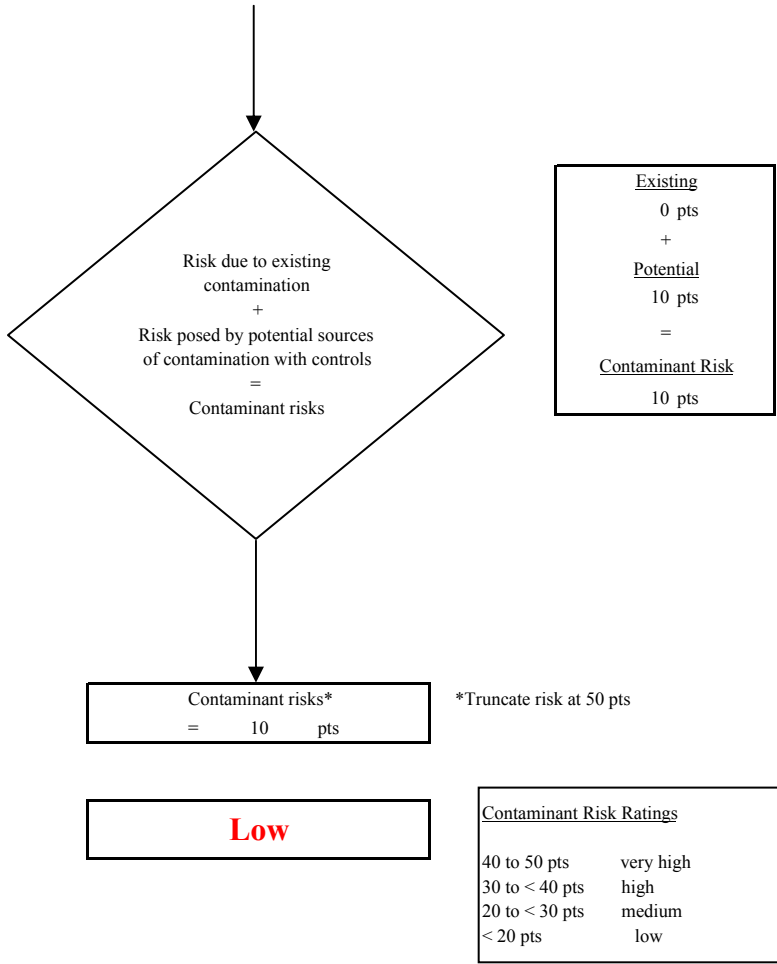

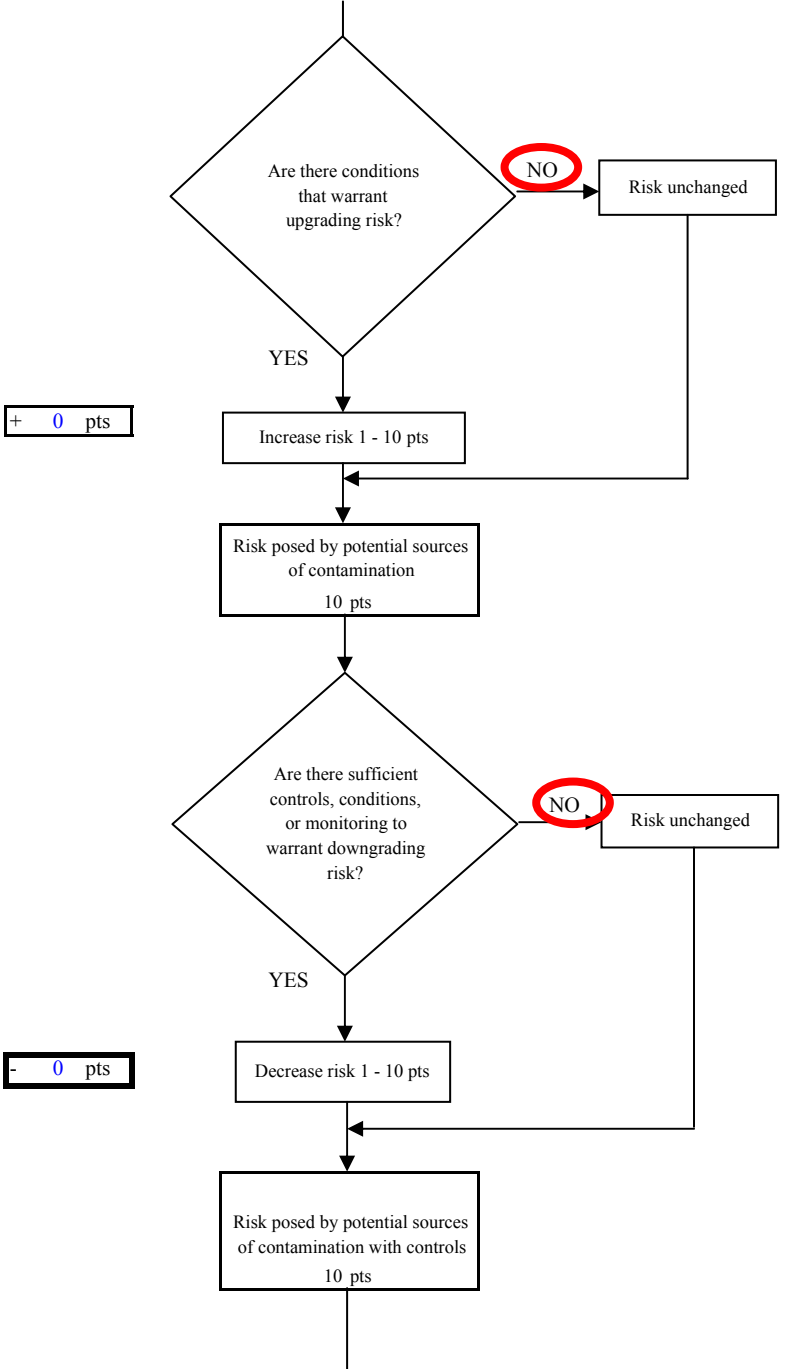


Chart 6. Vulnerability analysis for Tustumena Elementary School - Nitrates and Nitrites

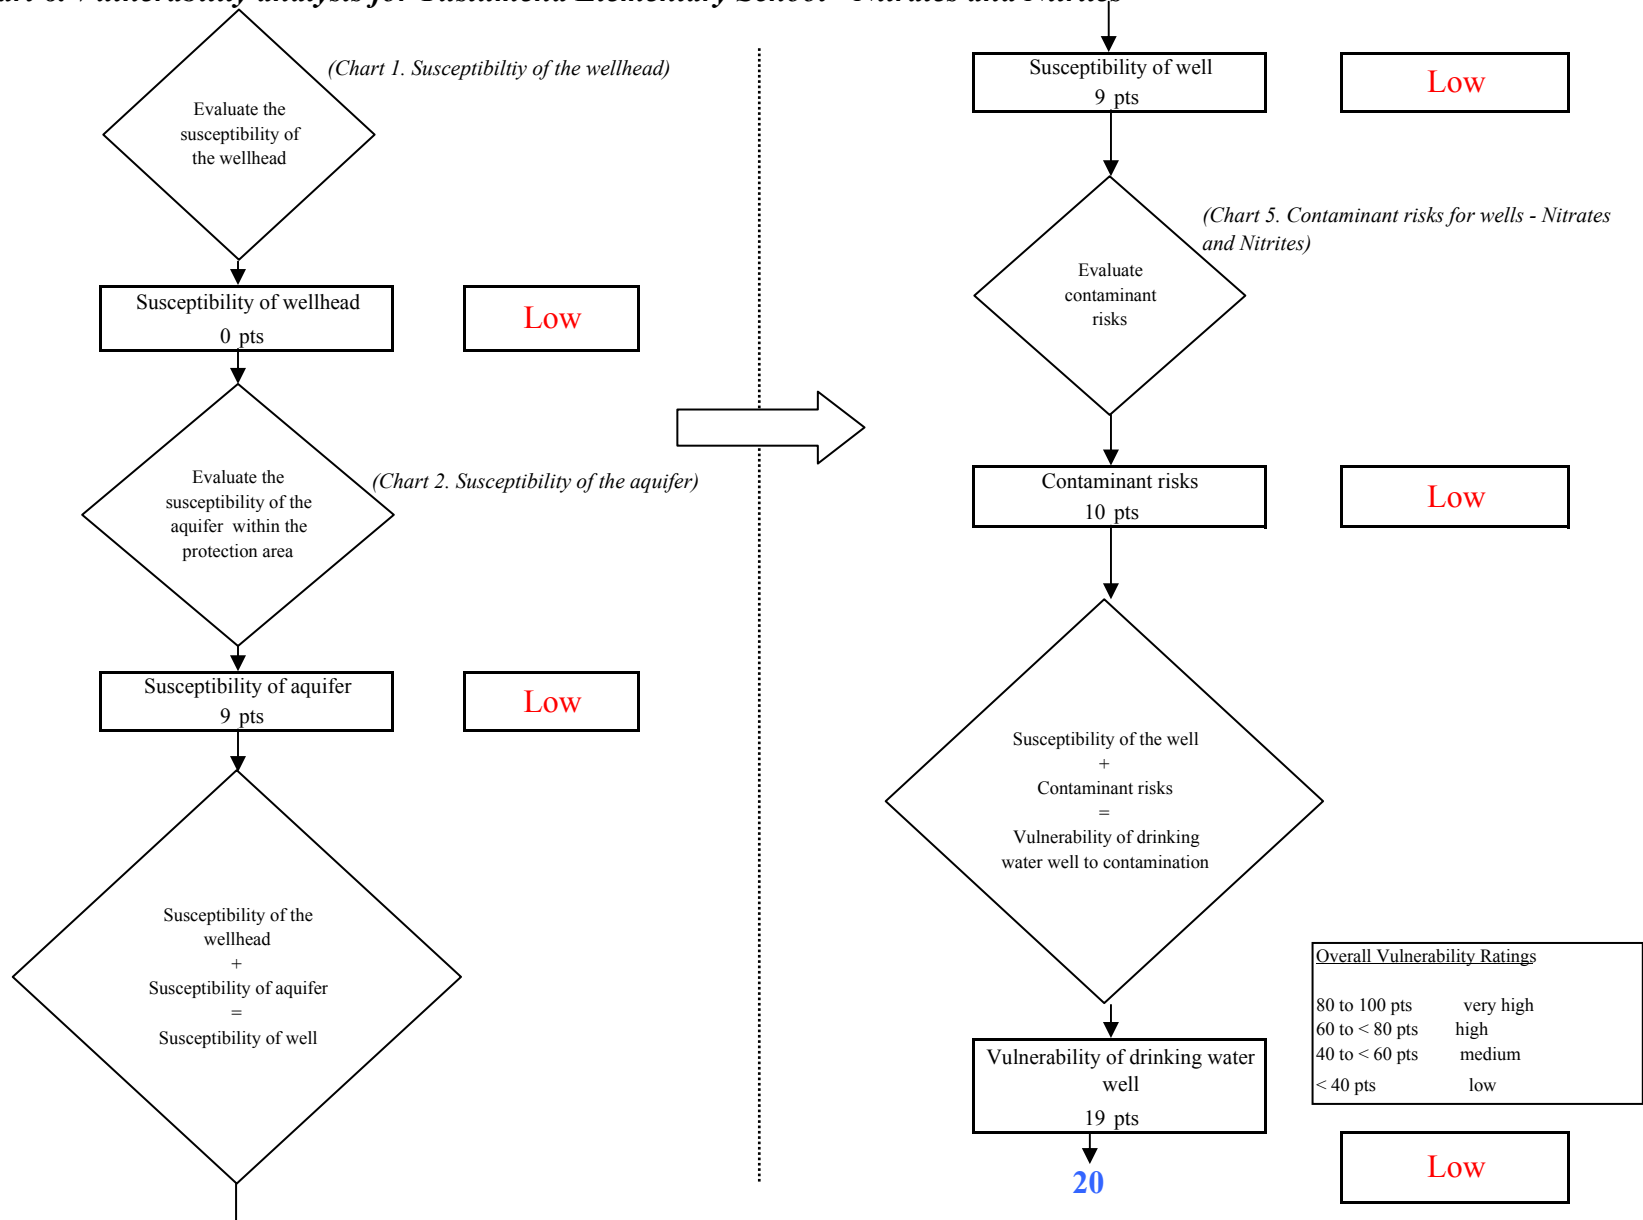


Chart 7. Contaminant risks for Tustumena Elementary School - Volatile Organic Chemicals


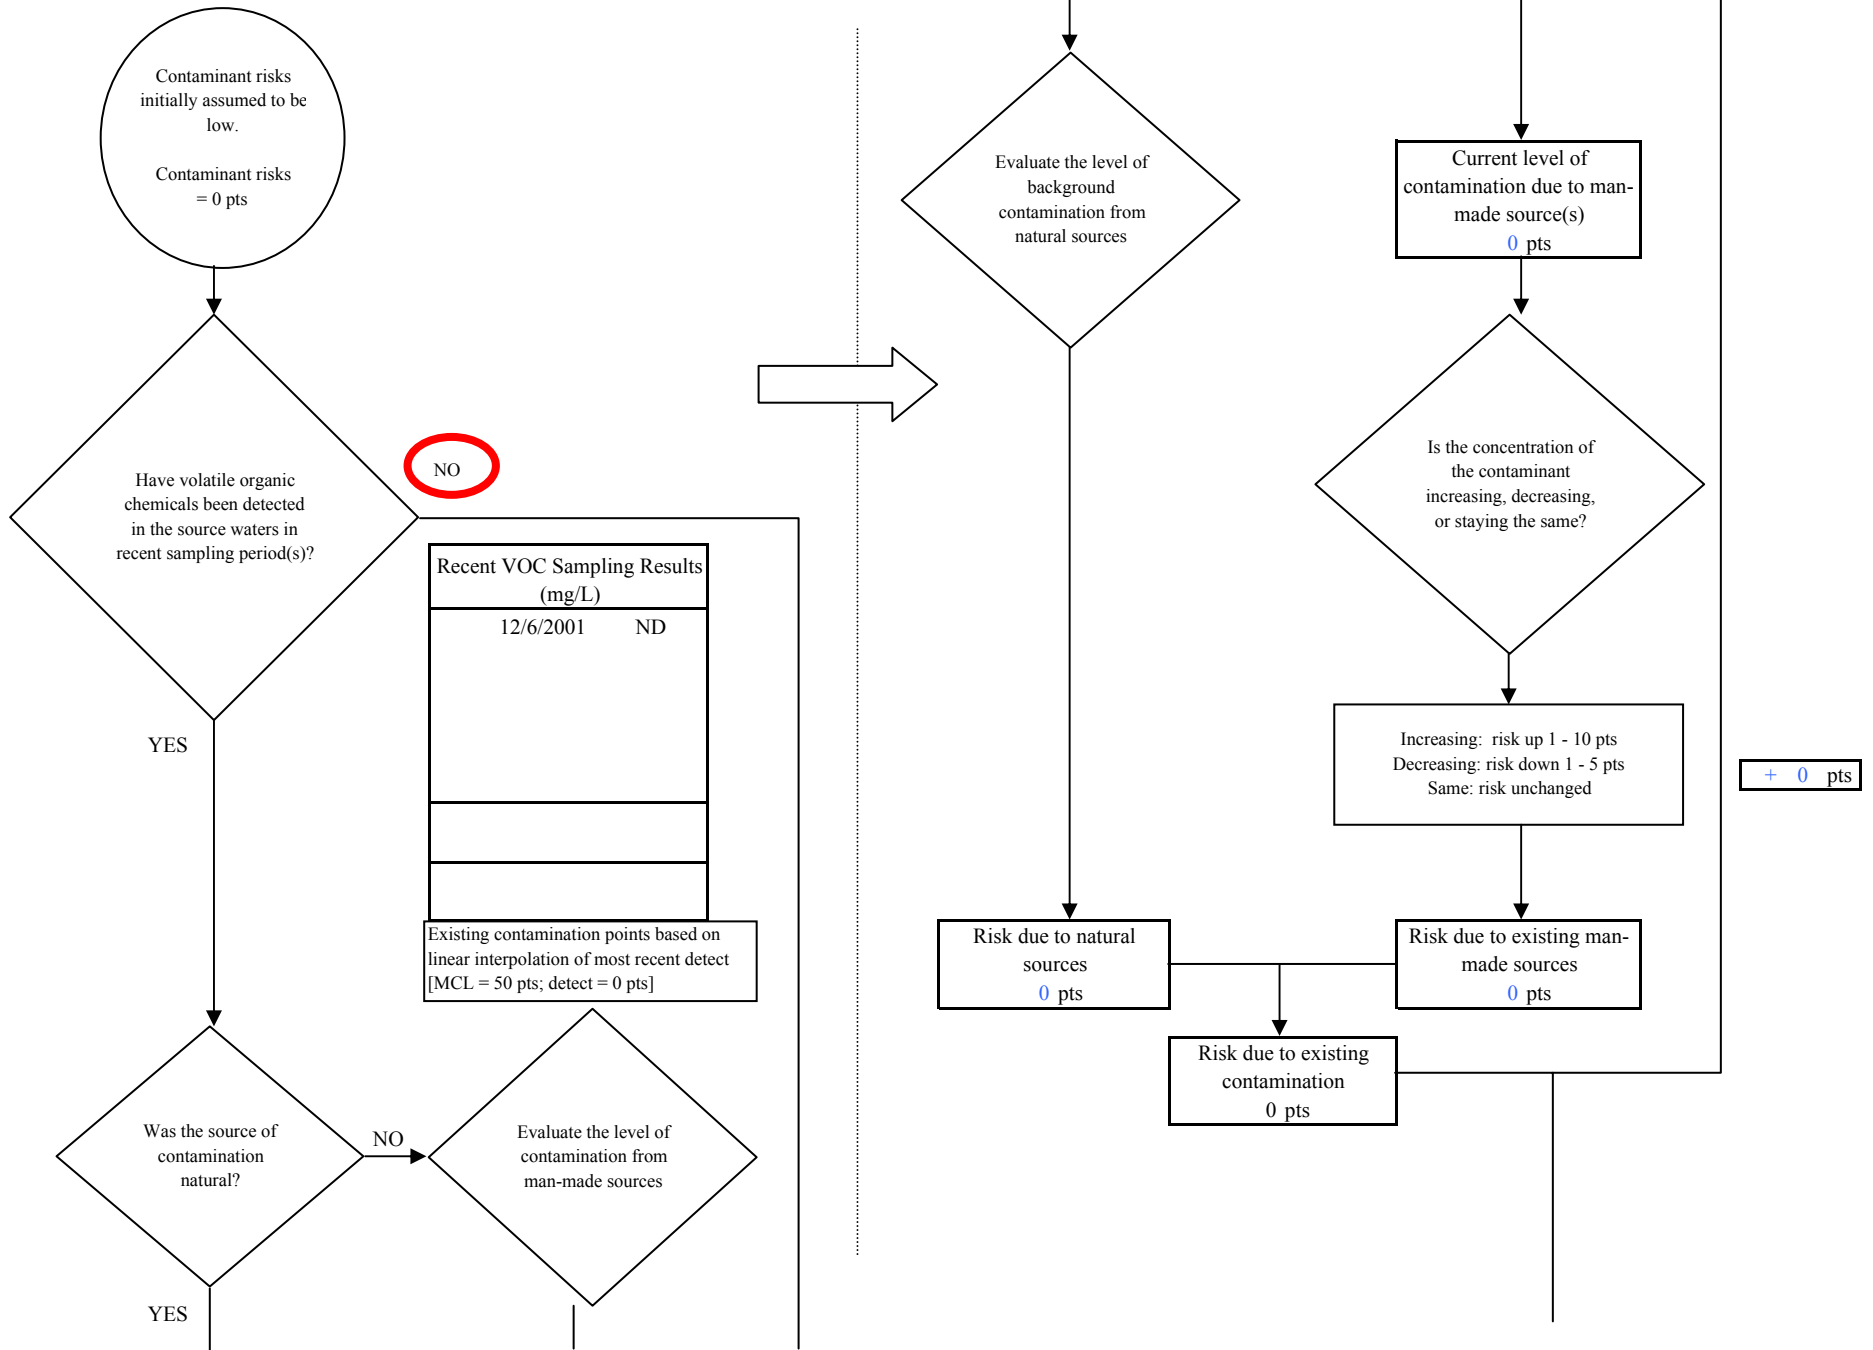


Chart 7. Contaminant risks for Tustumena Elementary School - Volatile Organic Chemicals

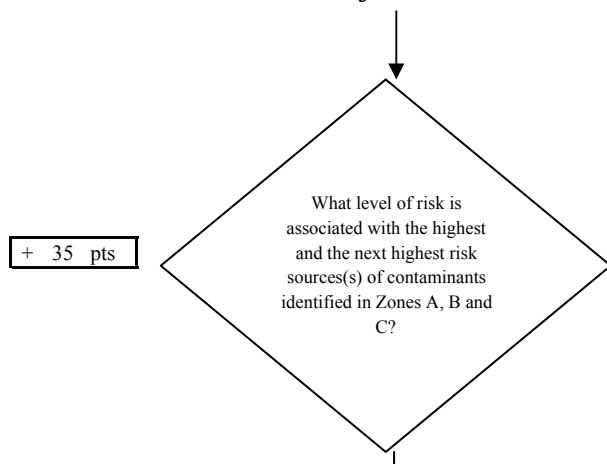

+ 35 pts

Risk Levels for Contaminant Sources identified in Zones A, B and C			
	Zone A	Zones B&C	Total
Very High(s)	0	0	0
High(s)	1	0	1
Medium(s)	0	11	11
Low(s)	5	3	8

	LOW 10 pts	MEDIUM 20 pts	HIGH 30 pts	VERY HIGH 40 pts
LOW	≥ 10 sources + 10 pts	≥ 10 sources + 5 pts	≥ 20 sources + 5 pts	----
MEDIUM	----	≥ 2 sources + 5 pts	≥ 5 sources + 5 pts	≥ 10 sources + 5 pts
HIGH	----	----	≥ 1 source + 10 pts	≥ 2 sources + 10 pts
VERY HIGH	----	----	----	≥ 1 source + 10 pts

Matrix Score 35

Note: Septic systems, sewerlines, and roads are each assigned a risk ranking for each individual contaminant source in the CSI. The VA, however, counts these contaminant sources as a group and assigns a calculated number of either "lows" or "mediums" based on the density.

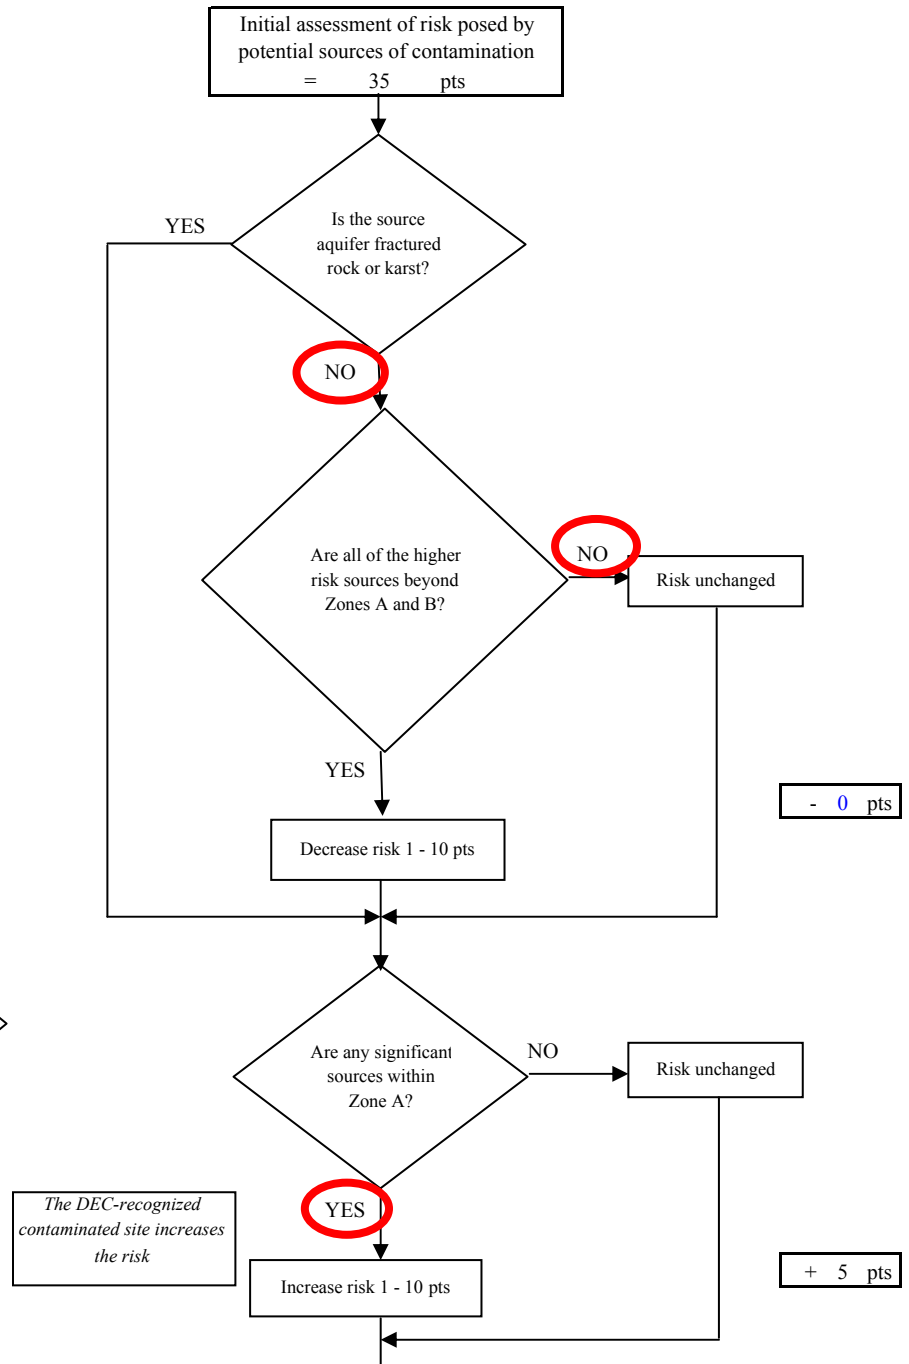



Chart 7. Contaminant risks for Tustumena Elementary School - Volatile Organic Chemicals

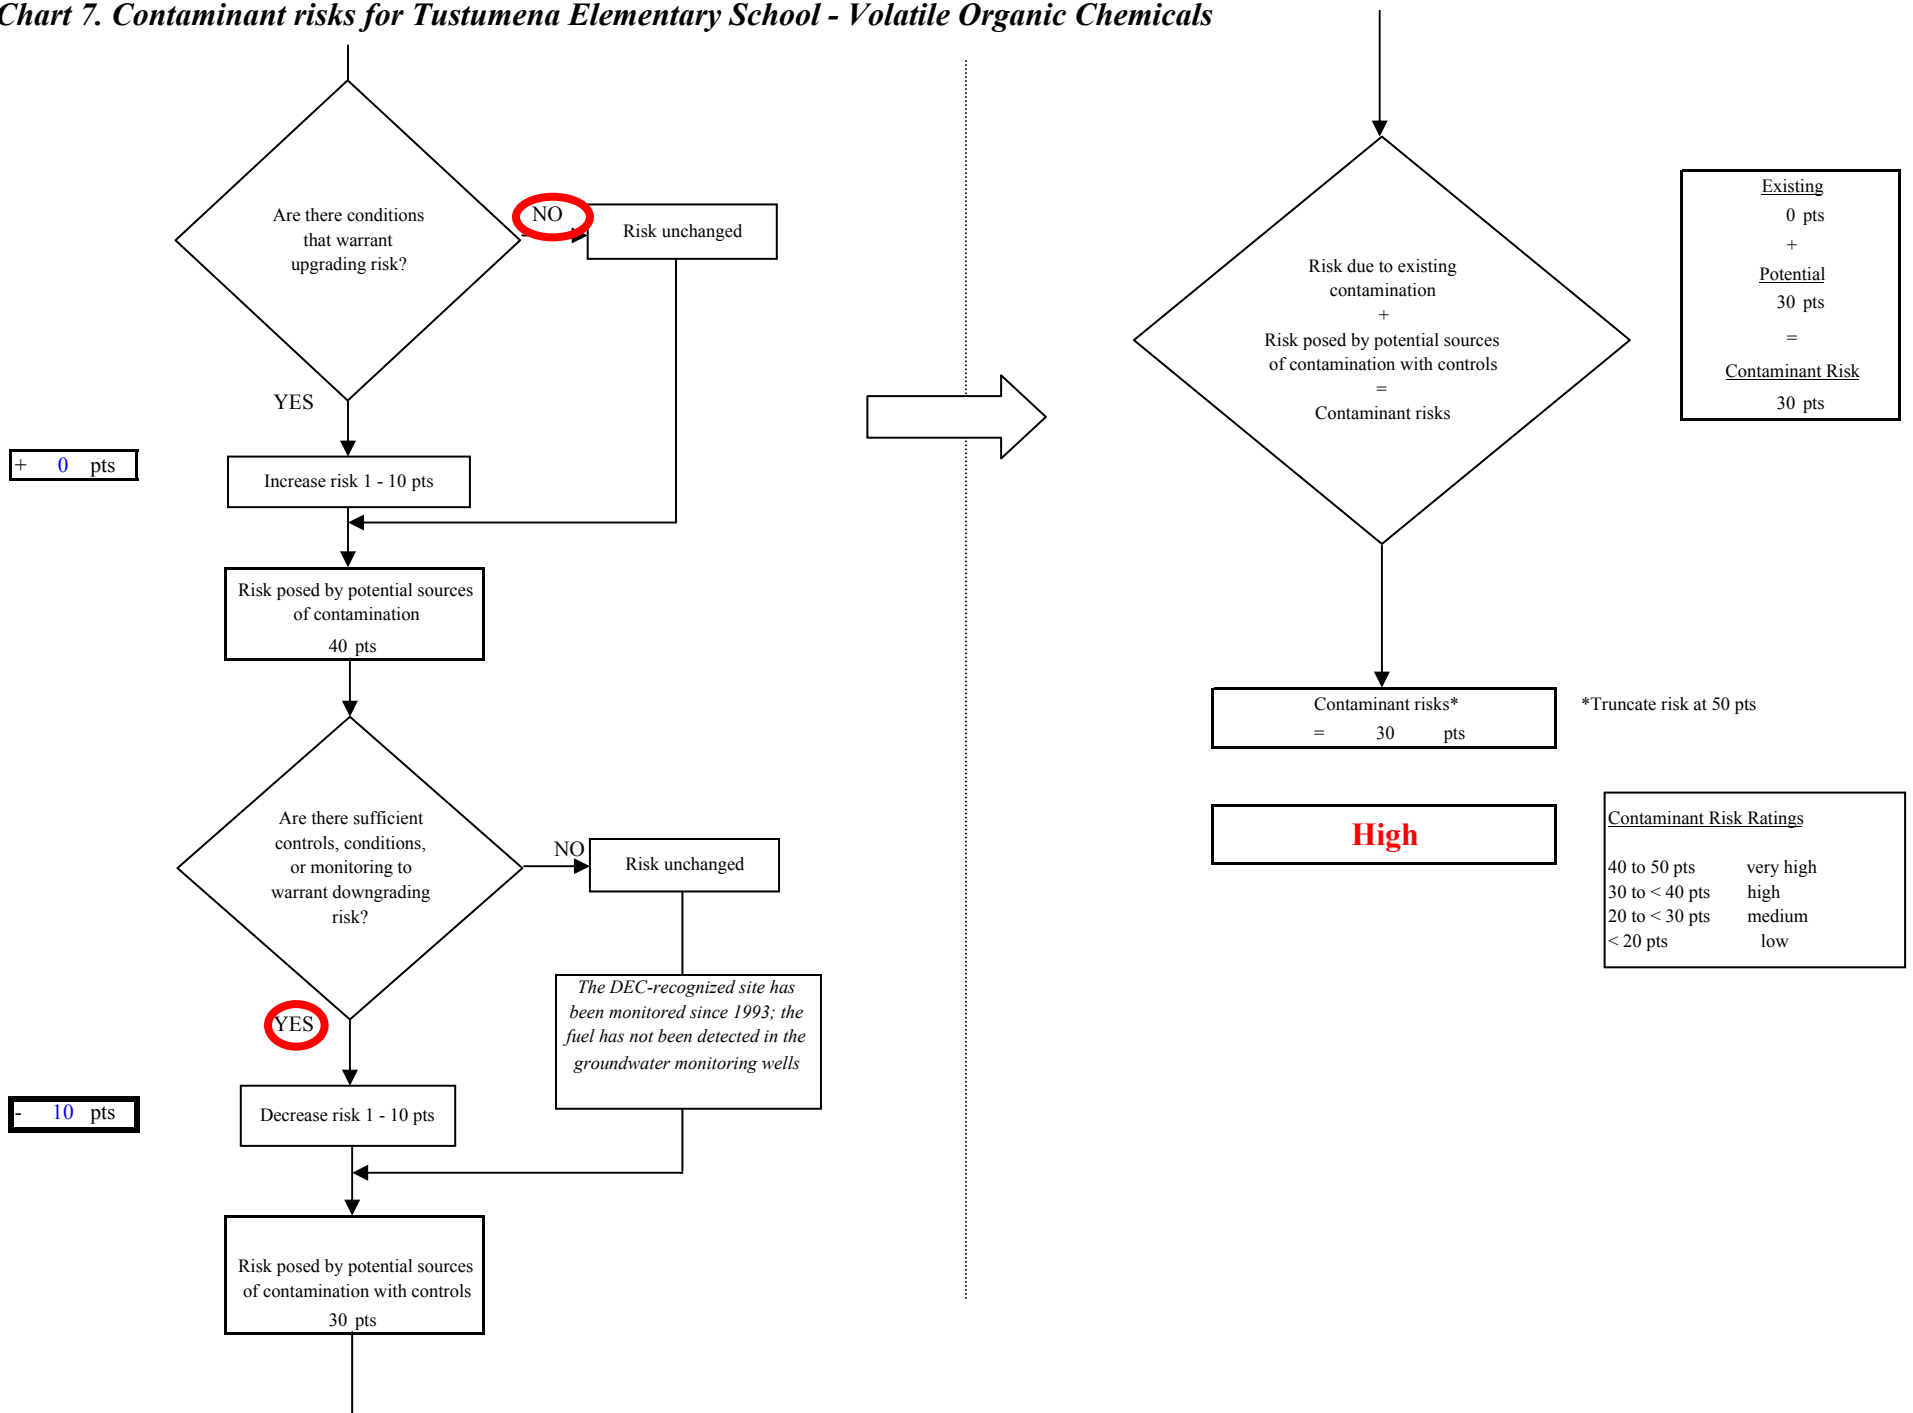


Chart 8. Vulnerability analysis for Tustumena Elementary School - Volatile Organic Chemicals

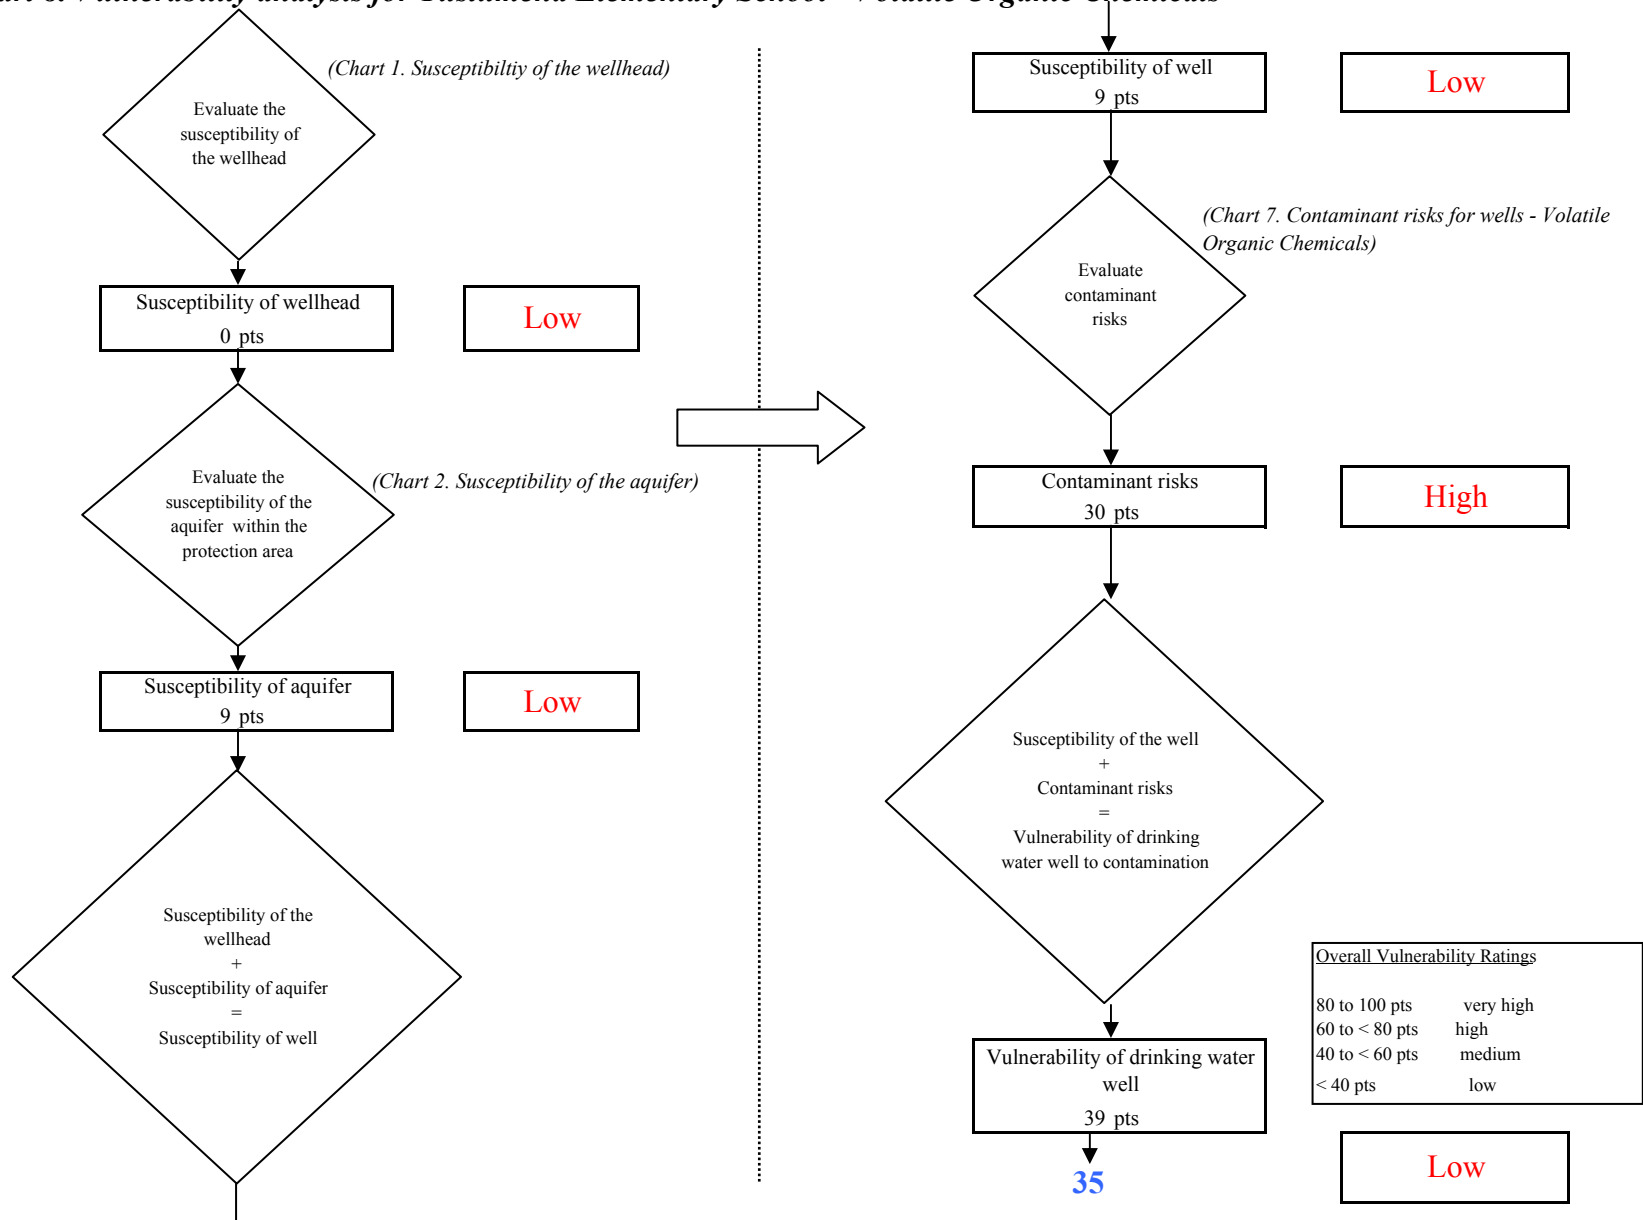


Chart 9. Contaminant risks for Tustumena Elementary School - Heavy Metals, Cyanide and Other Inorganic Chemicals


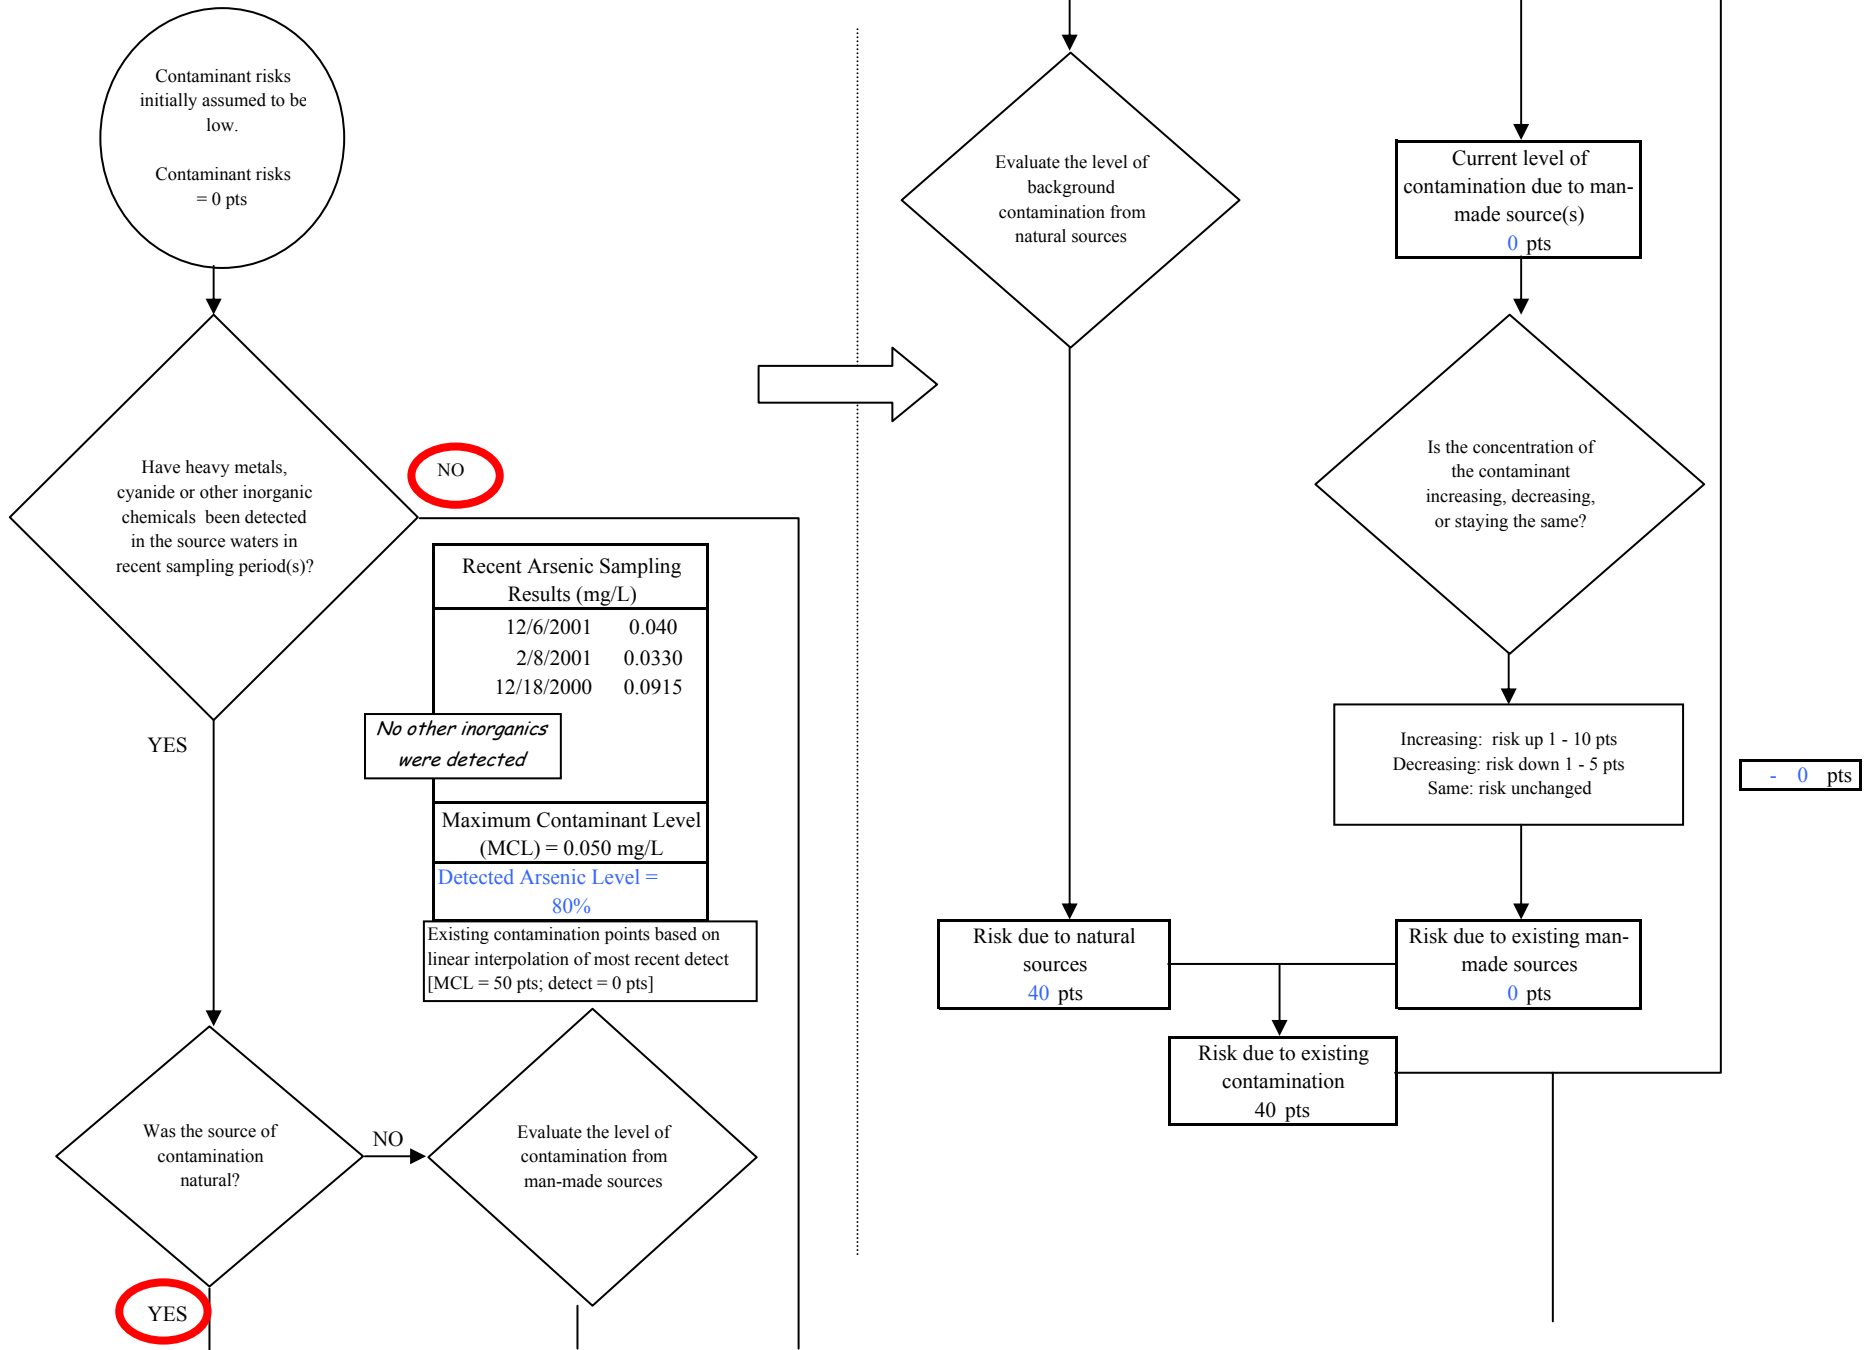


Chart 9. Contaminant risks for Tustumena Elementary School - Heavy Metals, Cyanide and Other Inorganic Chemicals

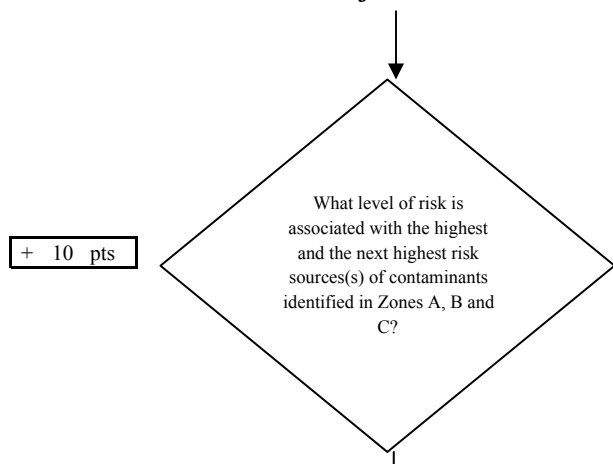

+ 10 pts

Risk Levels for Contaminant Sources identified in Zones A, B and C			
	Zone A	Zones B&C	Total
Very High(s)	0	0	0
High(s)	0	0	0
Medium(s)	0	0	0
Low(s)	5	3	8

	LOW 10 pts	MEDIUM 20 pts	HIGH 30 pts	VERY HIGH 40 pts
LOW	≥ 10 sources + 10 pts	≥ 10 sources + 5 pts	≥ 20 sources + 5 pts	----
MEDIUM	----	≥ 2 sources + 5 pts	≥ 5 sources + 5 pts	≥ 10 sources + 5 pts
HIGH	----	----	≥ 1 source + 10 pts	≥ 2 sources + 10 pts
VERY HIGH	----	----	----	≥ 1 source + 10 pts

Matrix Score 10

Note: Septic systems, sewerlines, and roads are each assigned a risk ranking for each individual contaminant source in the CSI. The VA, however, counts these contaminant sources as a group and assigns a calculated number of either "lows" or "mediums" based on the density.

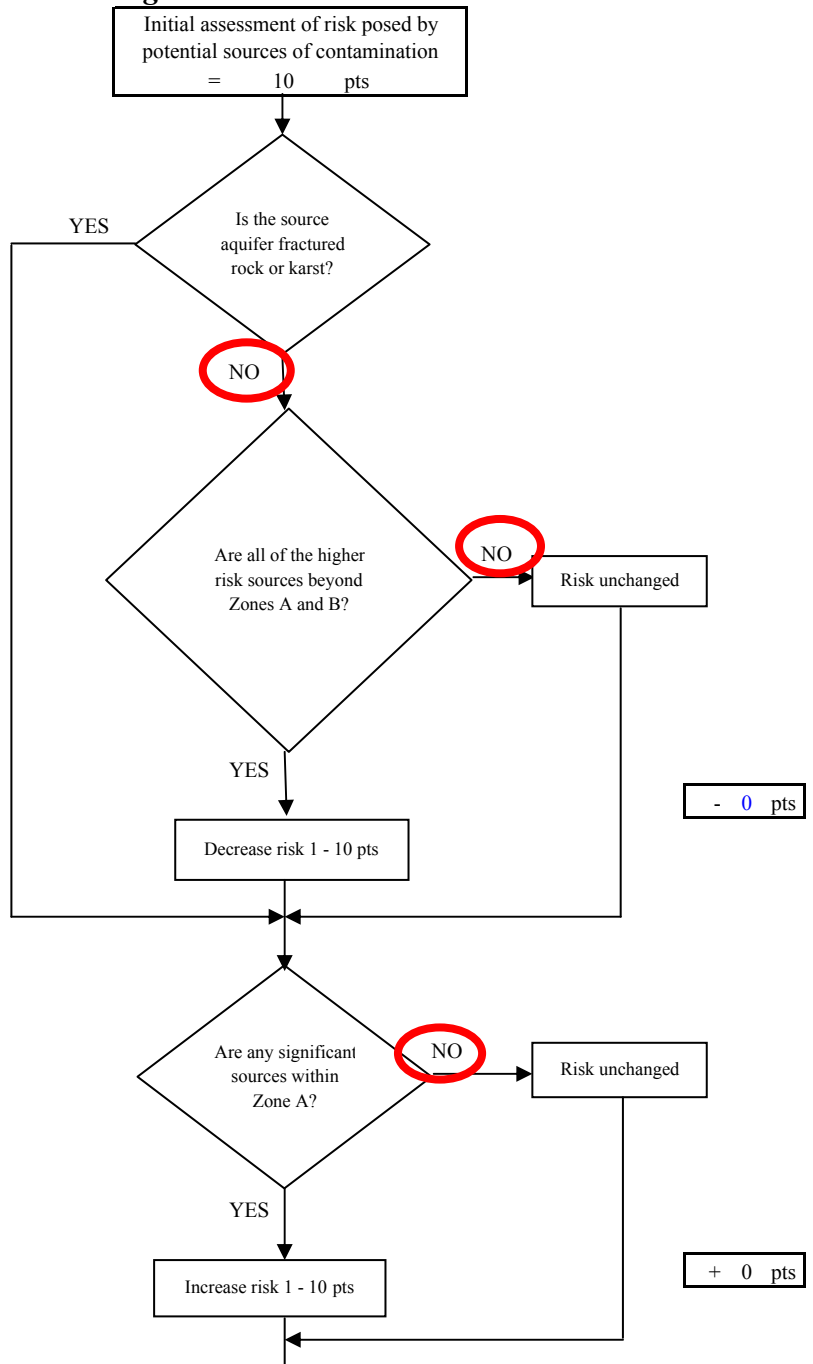



Chart 9. Contaminant risks for Tustumena Elementary School - Heavy Metals, Cyanide and Other Inorganic Chemicals

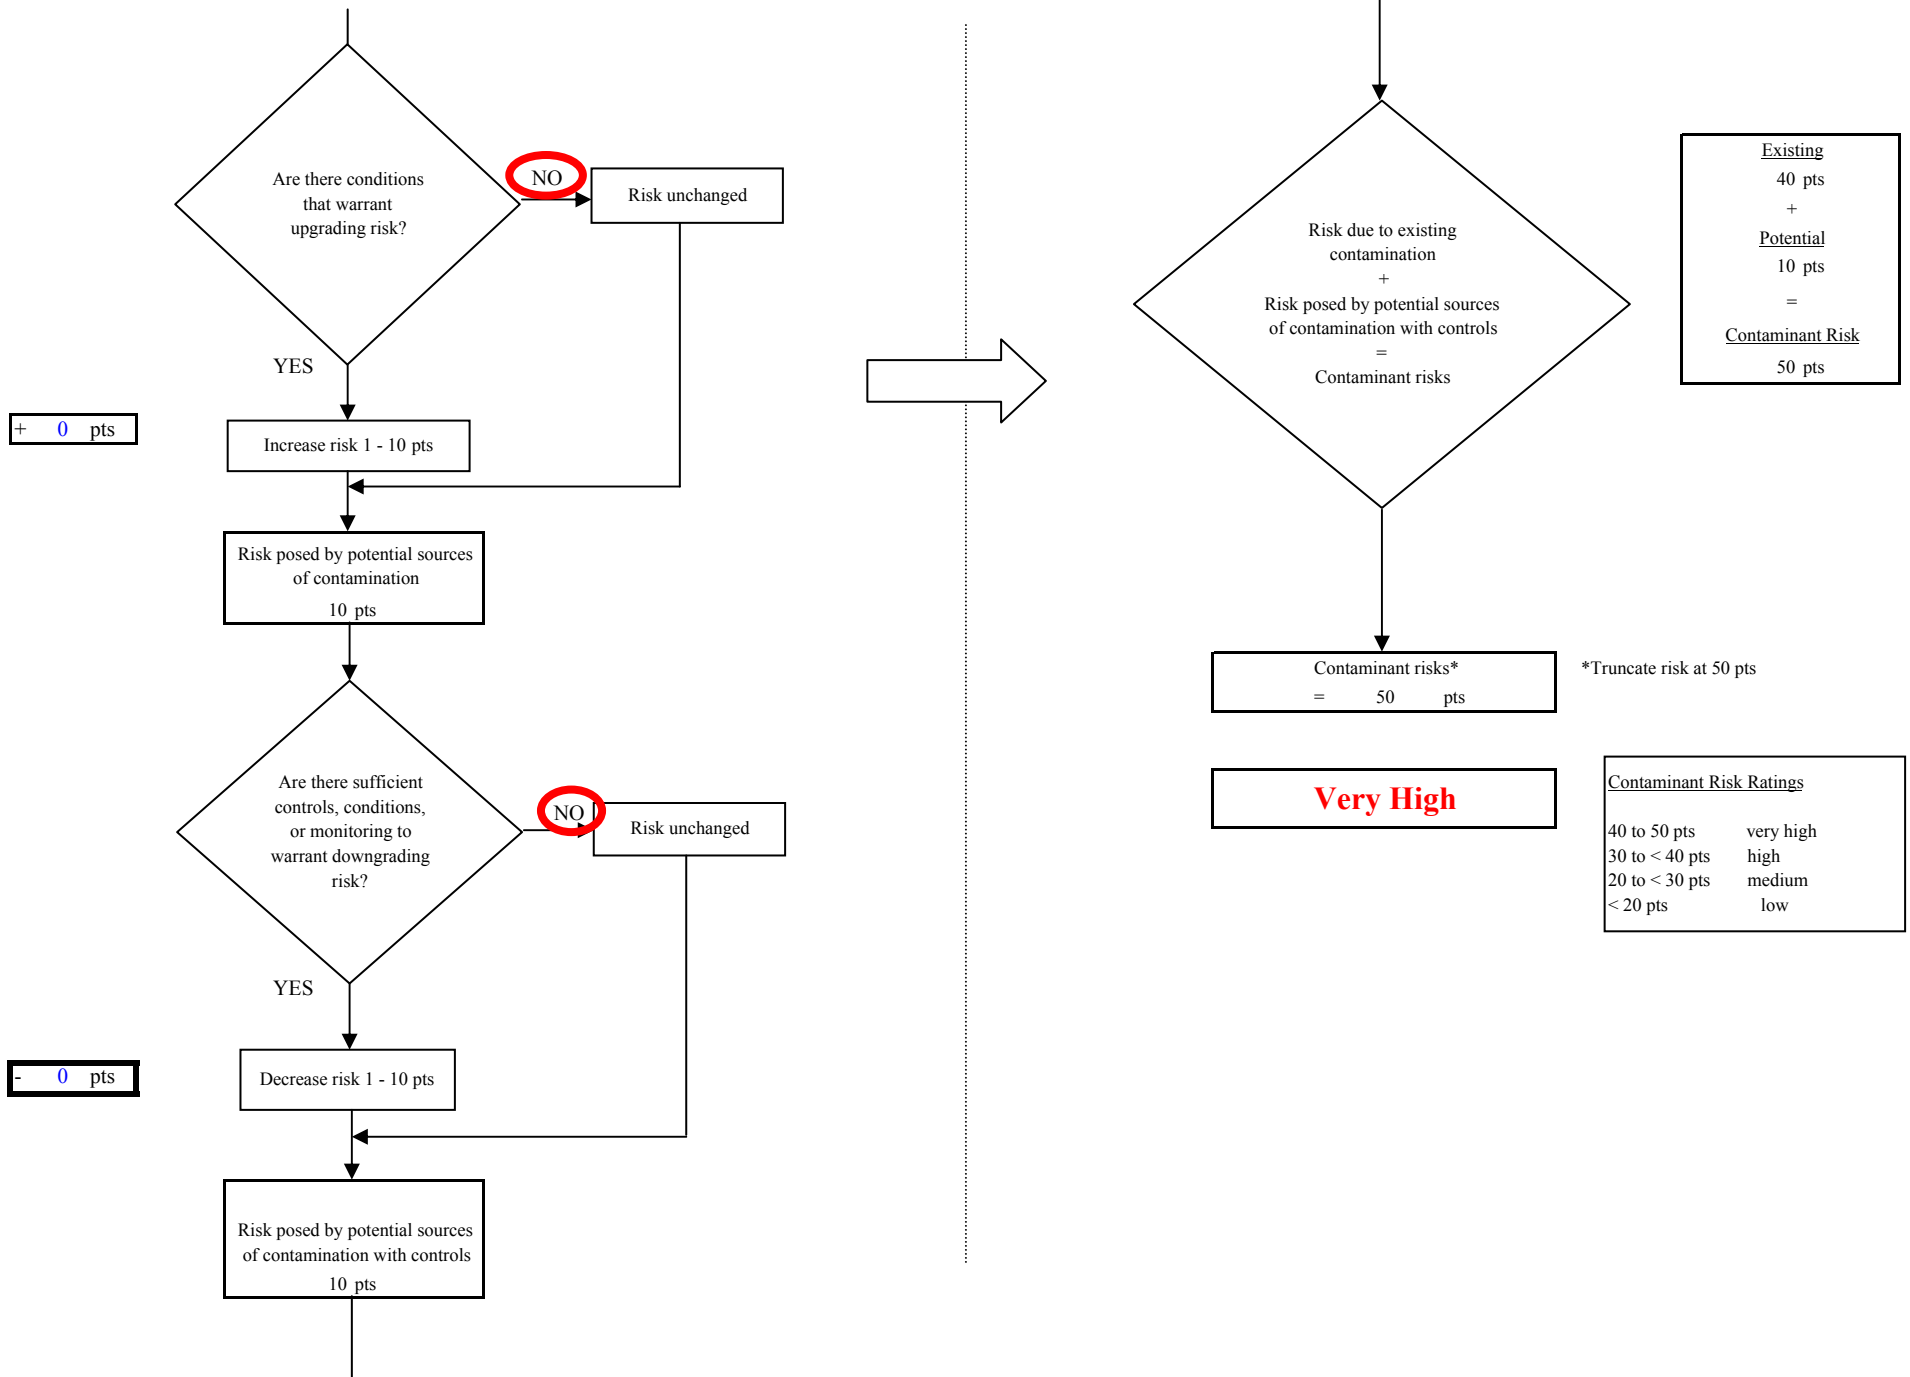


Chart 10. Vulnerability analysis for Tustumena Elementary School - Heavy Metals, Cyanide and Other Inorganic Chemicals

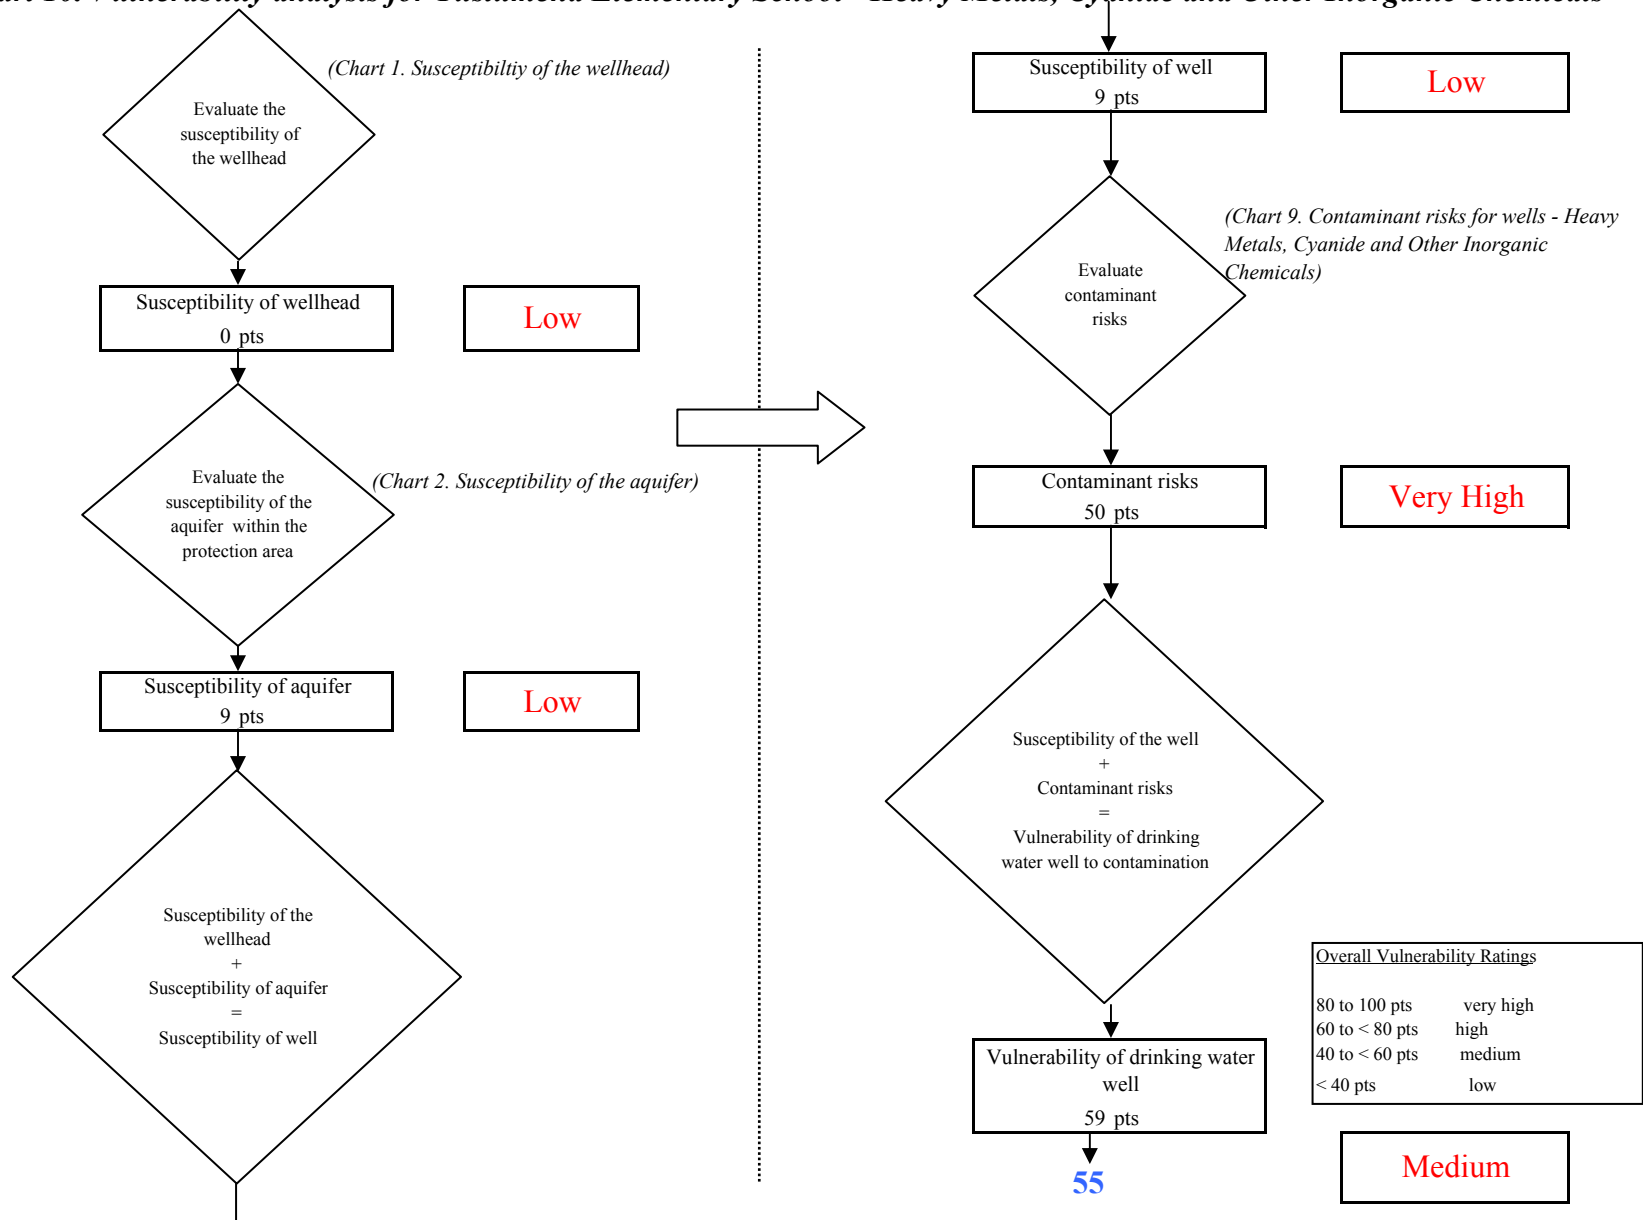


Chart 11. Contaminant risks for Tustumena Elementary School - Synthetic Organic Chemicals


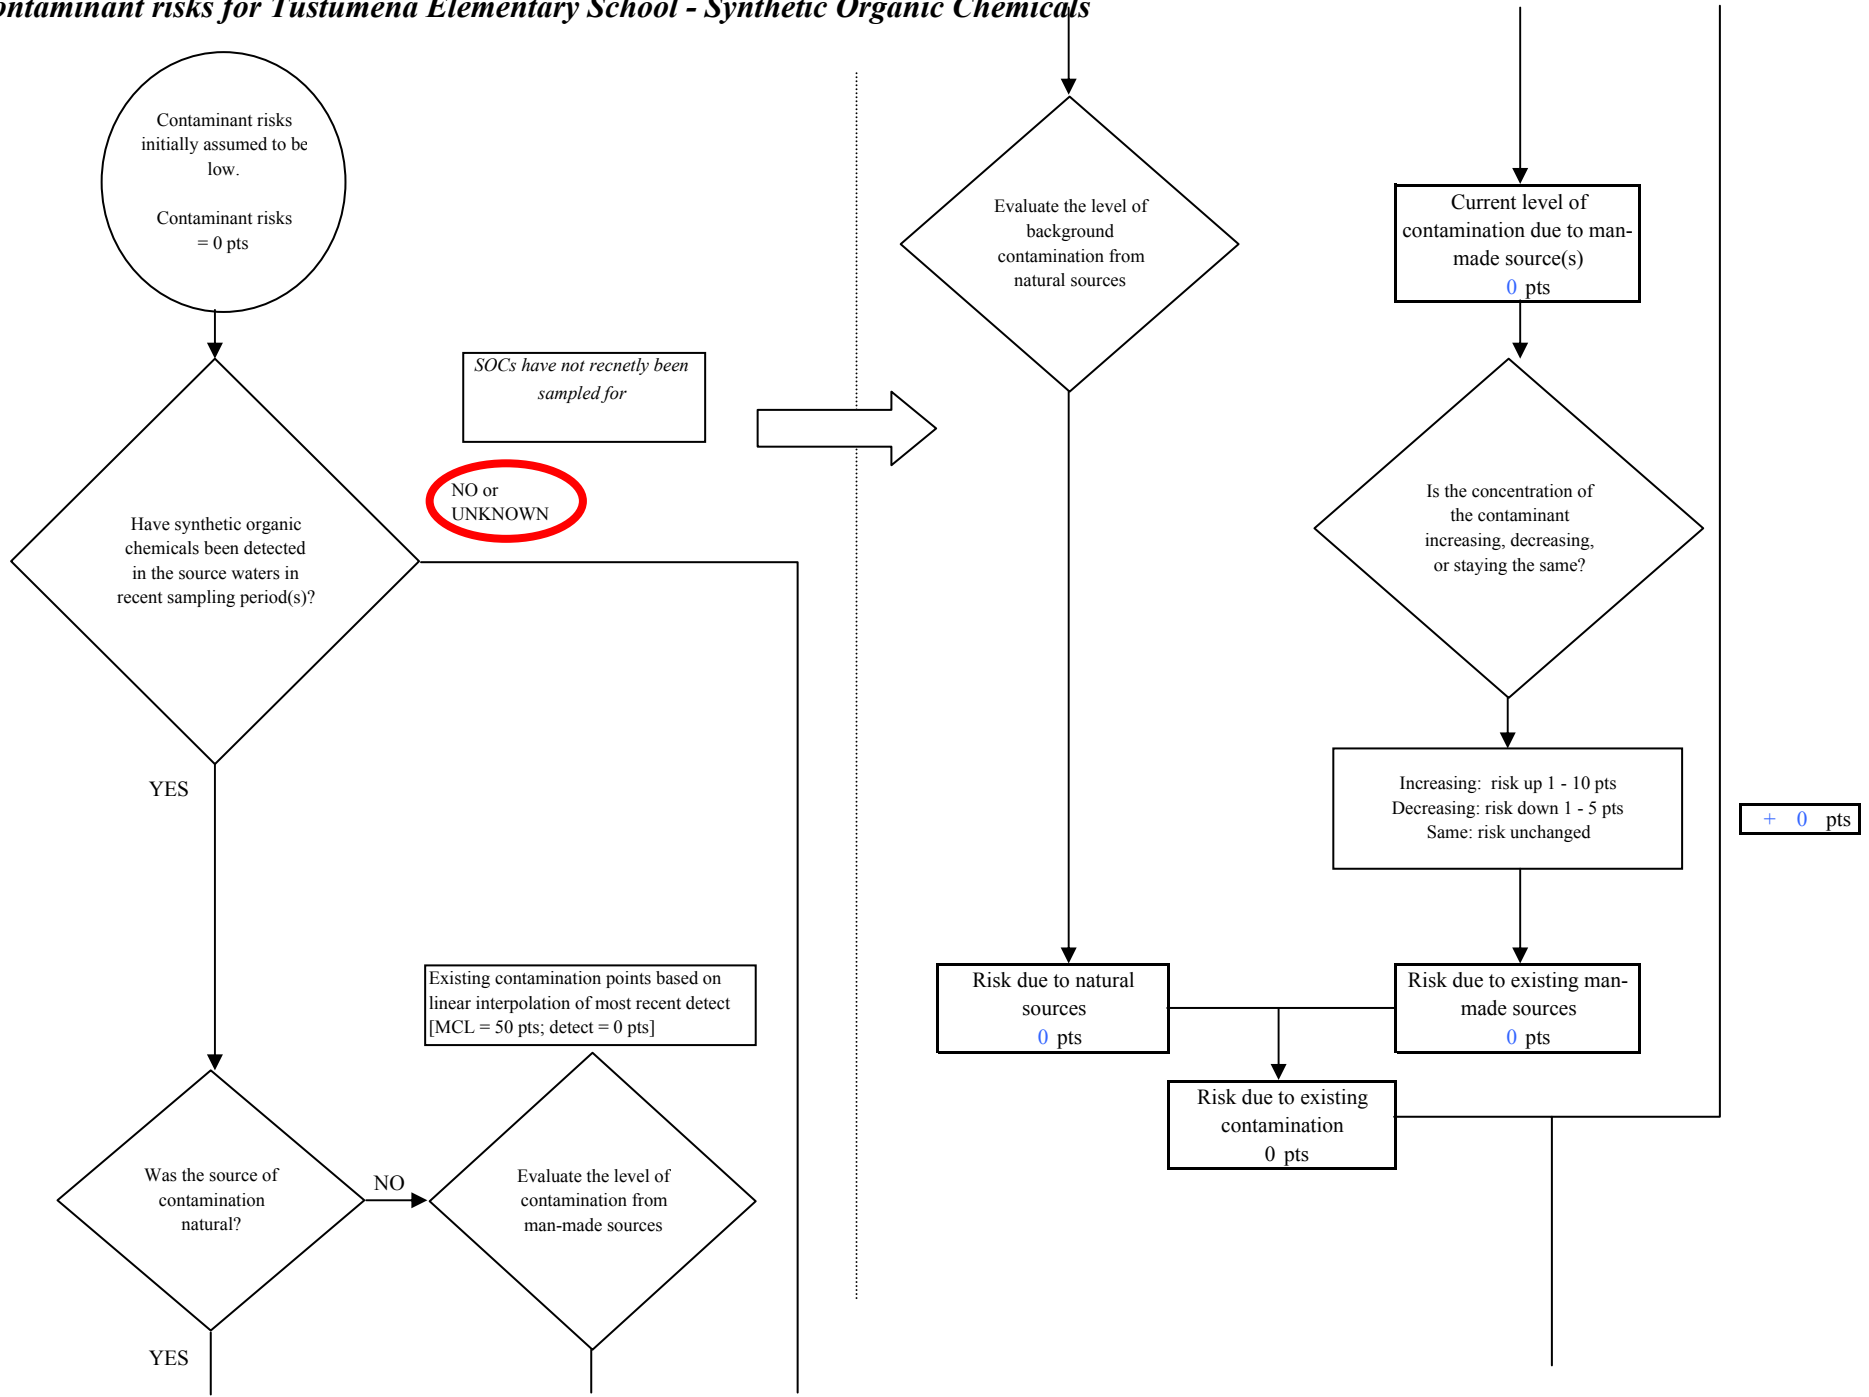


Chart 11. Contaminant risks for Tustumena Elementary School - Synthetic Organic Chemicals

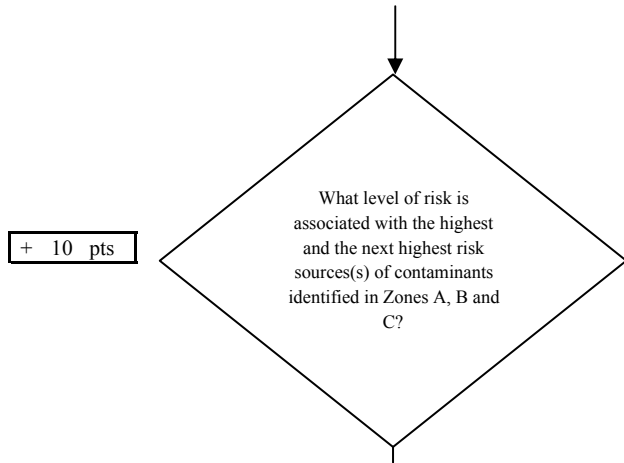



+ 10 pts

Risk Levels for Contaminant Sources identified in Zones A, B and C			
	Zone A	Zones B&C	Total
Very High(s)	0	0	0
High(s)	0	0	0
Medium(s)	0	0	0
Low(s)	2	2	4

	LOW 10 pts	MEDIUM 20 pts	HIGH 30 pts	VERY HIGH 40 pts
LOW	≥ 10 sources + 10 pts	≥ 10 sources + 5 pts	≥ 20 sources + 5 pts	----
MEDIUM	----	≥ 2 sources + 5 pts	≥ 5 sources + 5 pts	≥ 10 sources + 5 pts
HIGH	----	----	≥ 1 source + 10 pts	≥ 2 sources + 10 pts
VERY HIGH	----	----	----	≥ 1 source + 10 pts

Matrix Score 10

Note: Septic systems, sewerlines, and roads are each assigned a risk ranking for each individual contaminant source in the CSI. The VA, however, counts these contaminant sources as a group and assigns a calculated number of either "lows" or "mediums" based on the density.

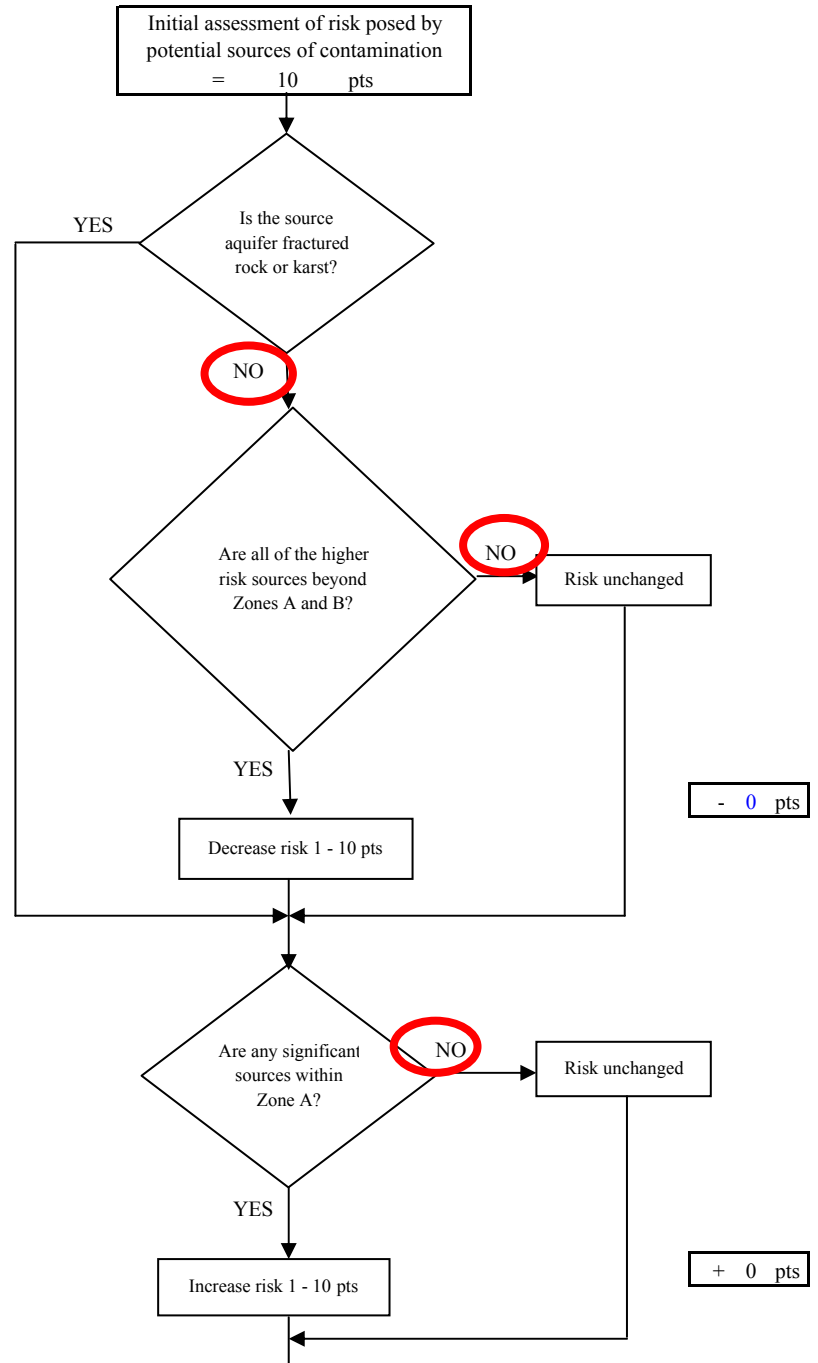

- 0 pts

+ 0 pts

Chart 11. Contaminant risks for Tustumena Elementary School - Synthetic Organic Chemicals

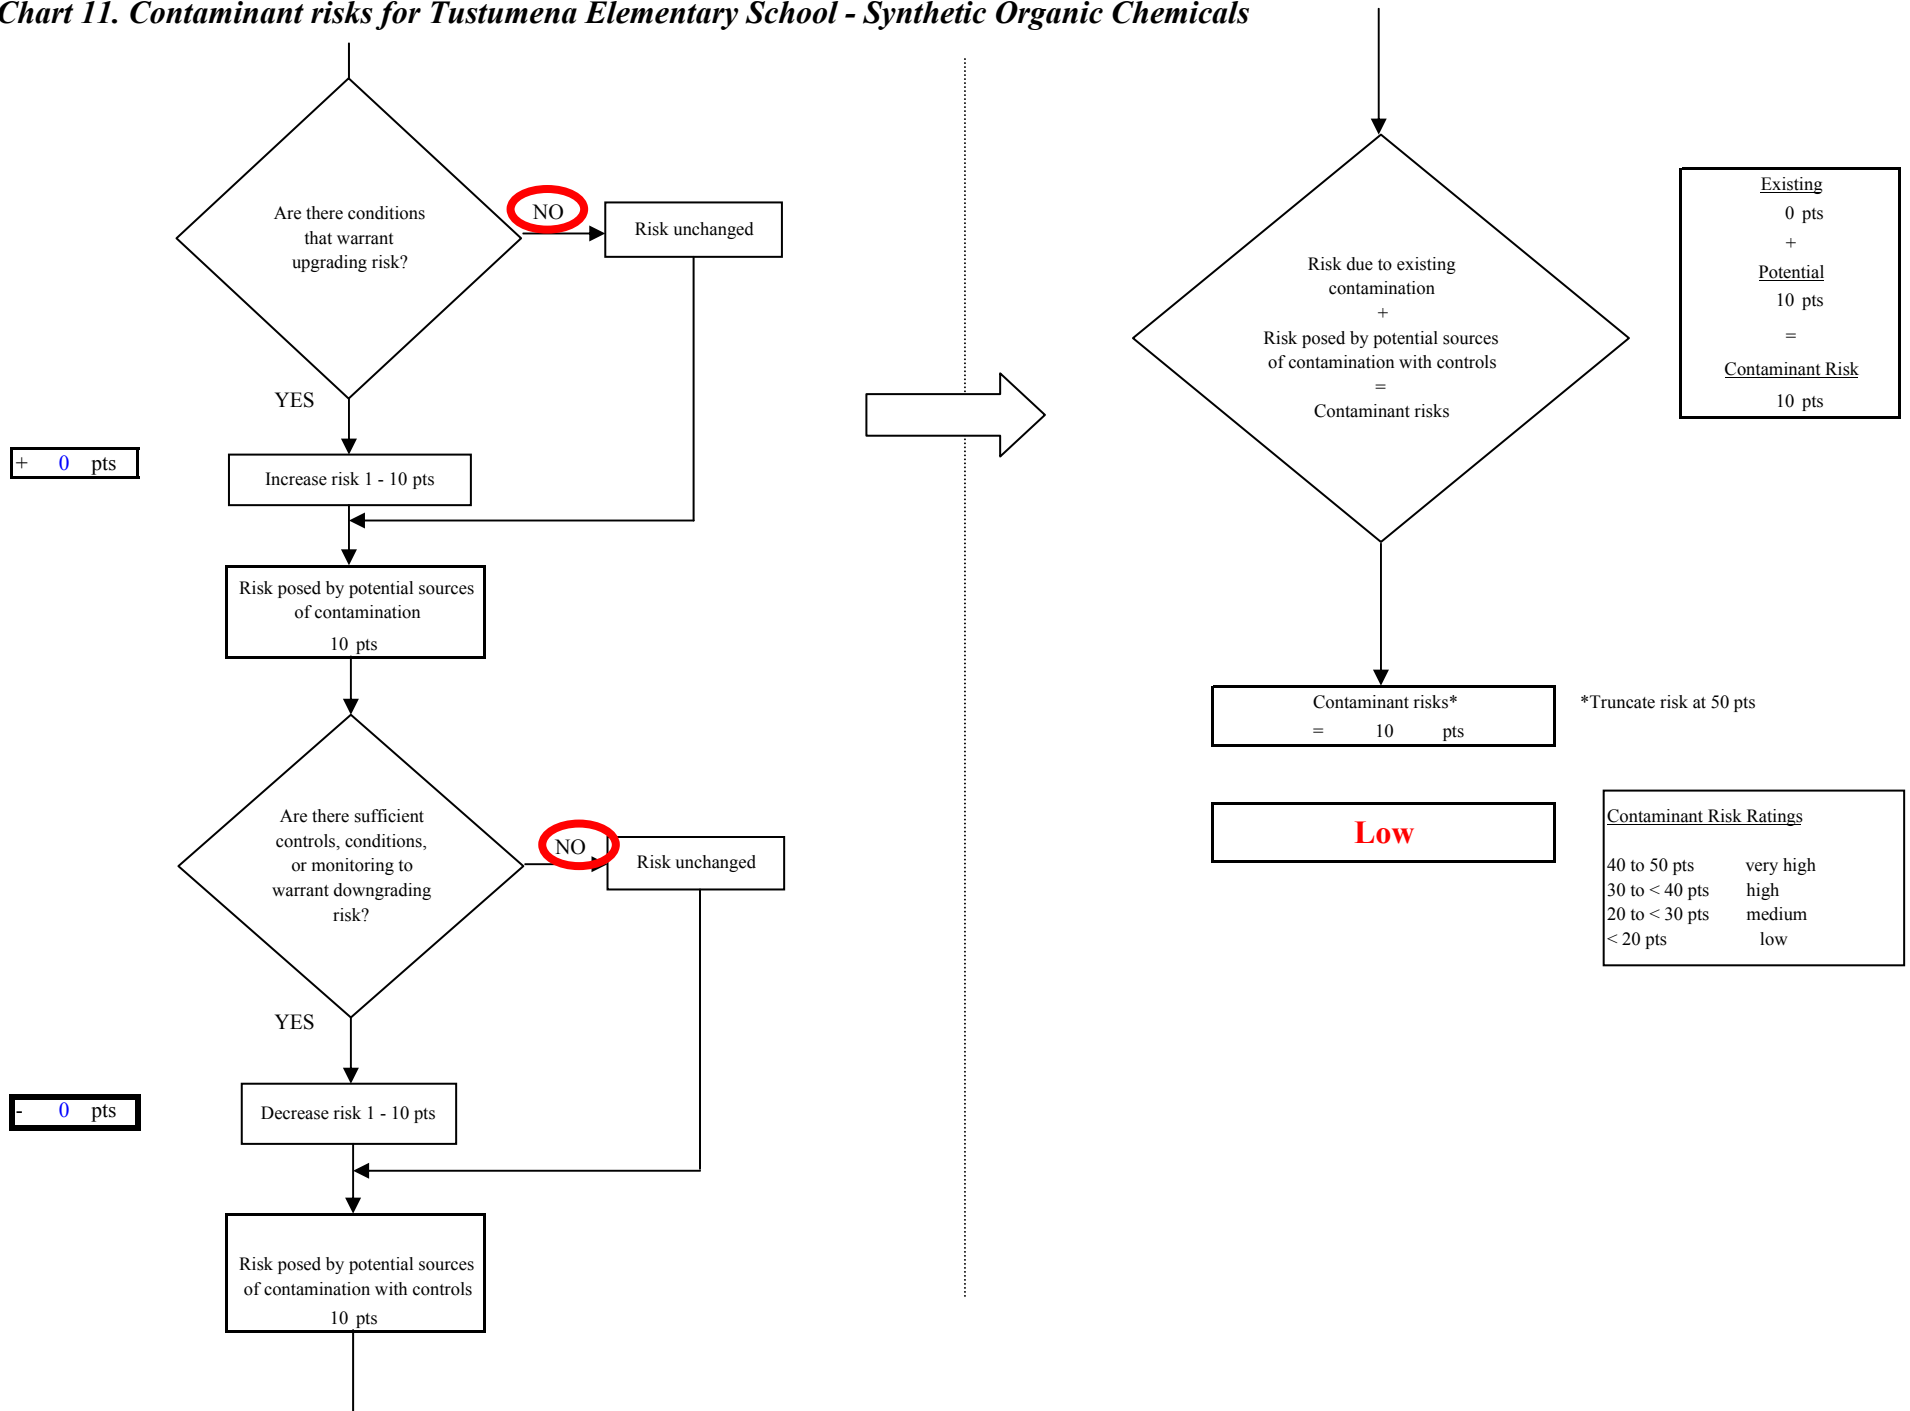


Chart 12. Vulnerability analysis for Tustumena Elementary School - Synthetic Organic Chemicals

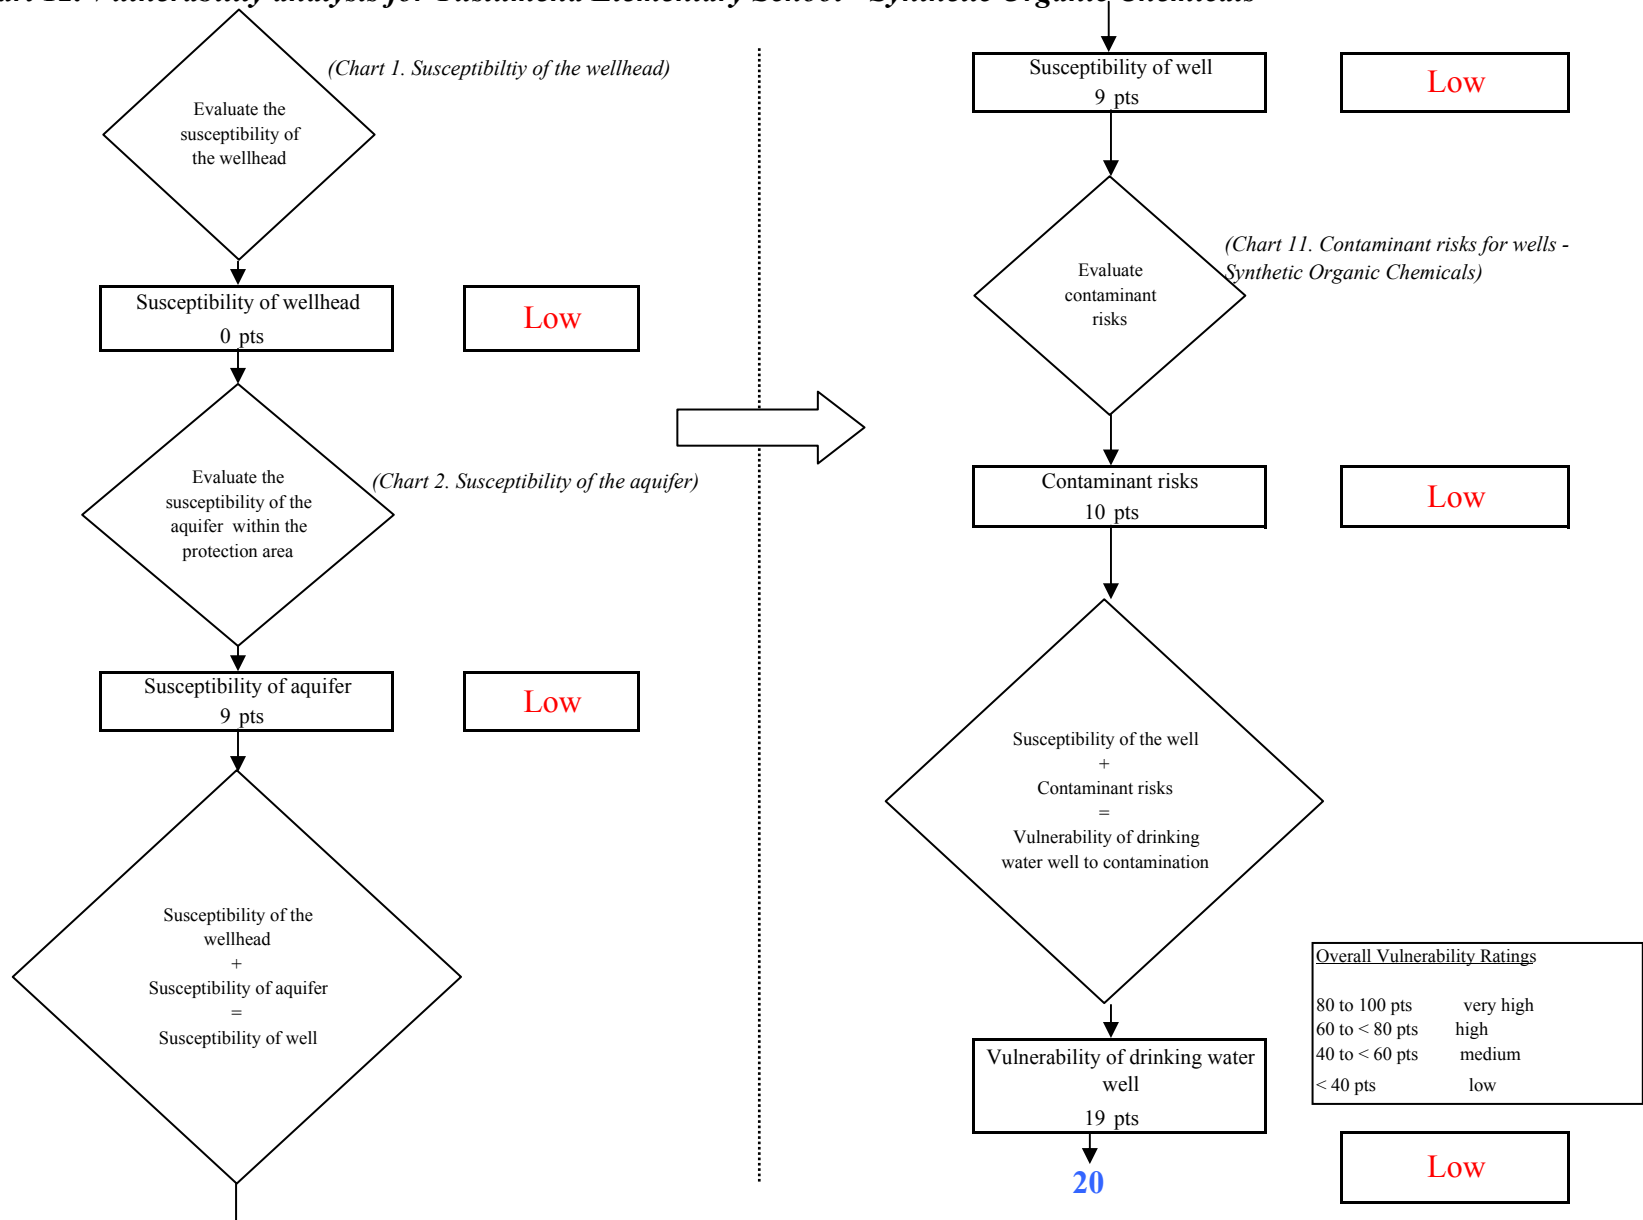


Chart 13. Contaminant risks for Tustumena Elementary School - Other Organic Chemicals


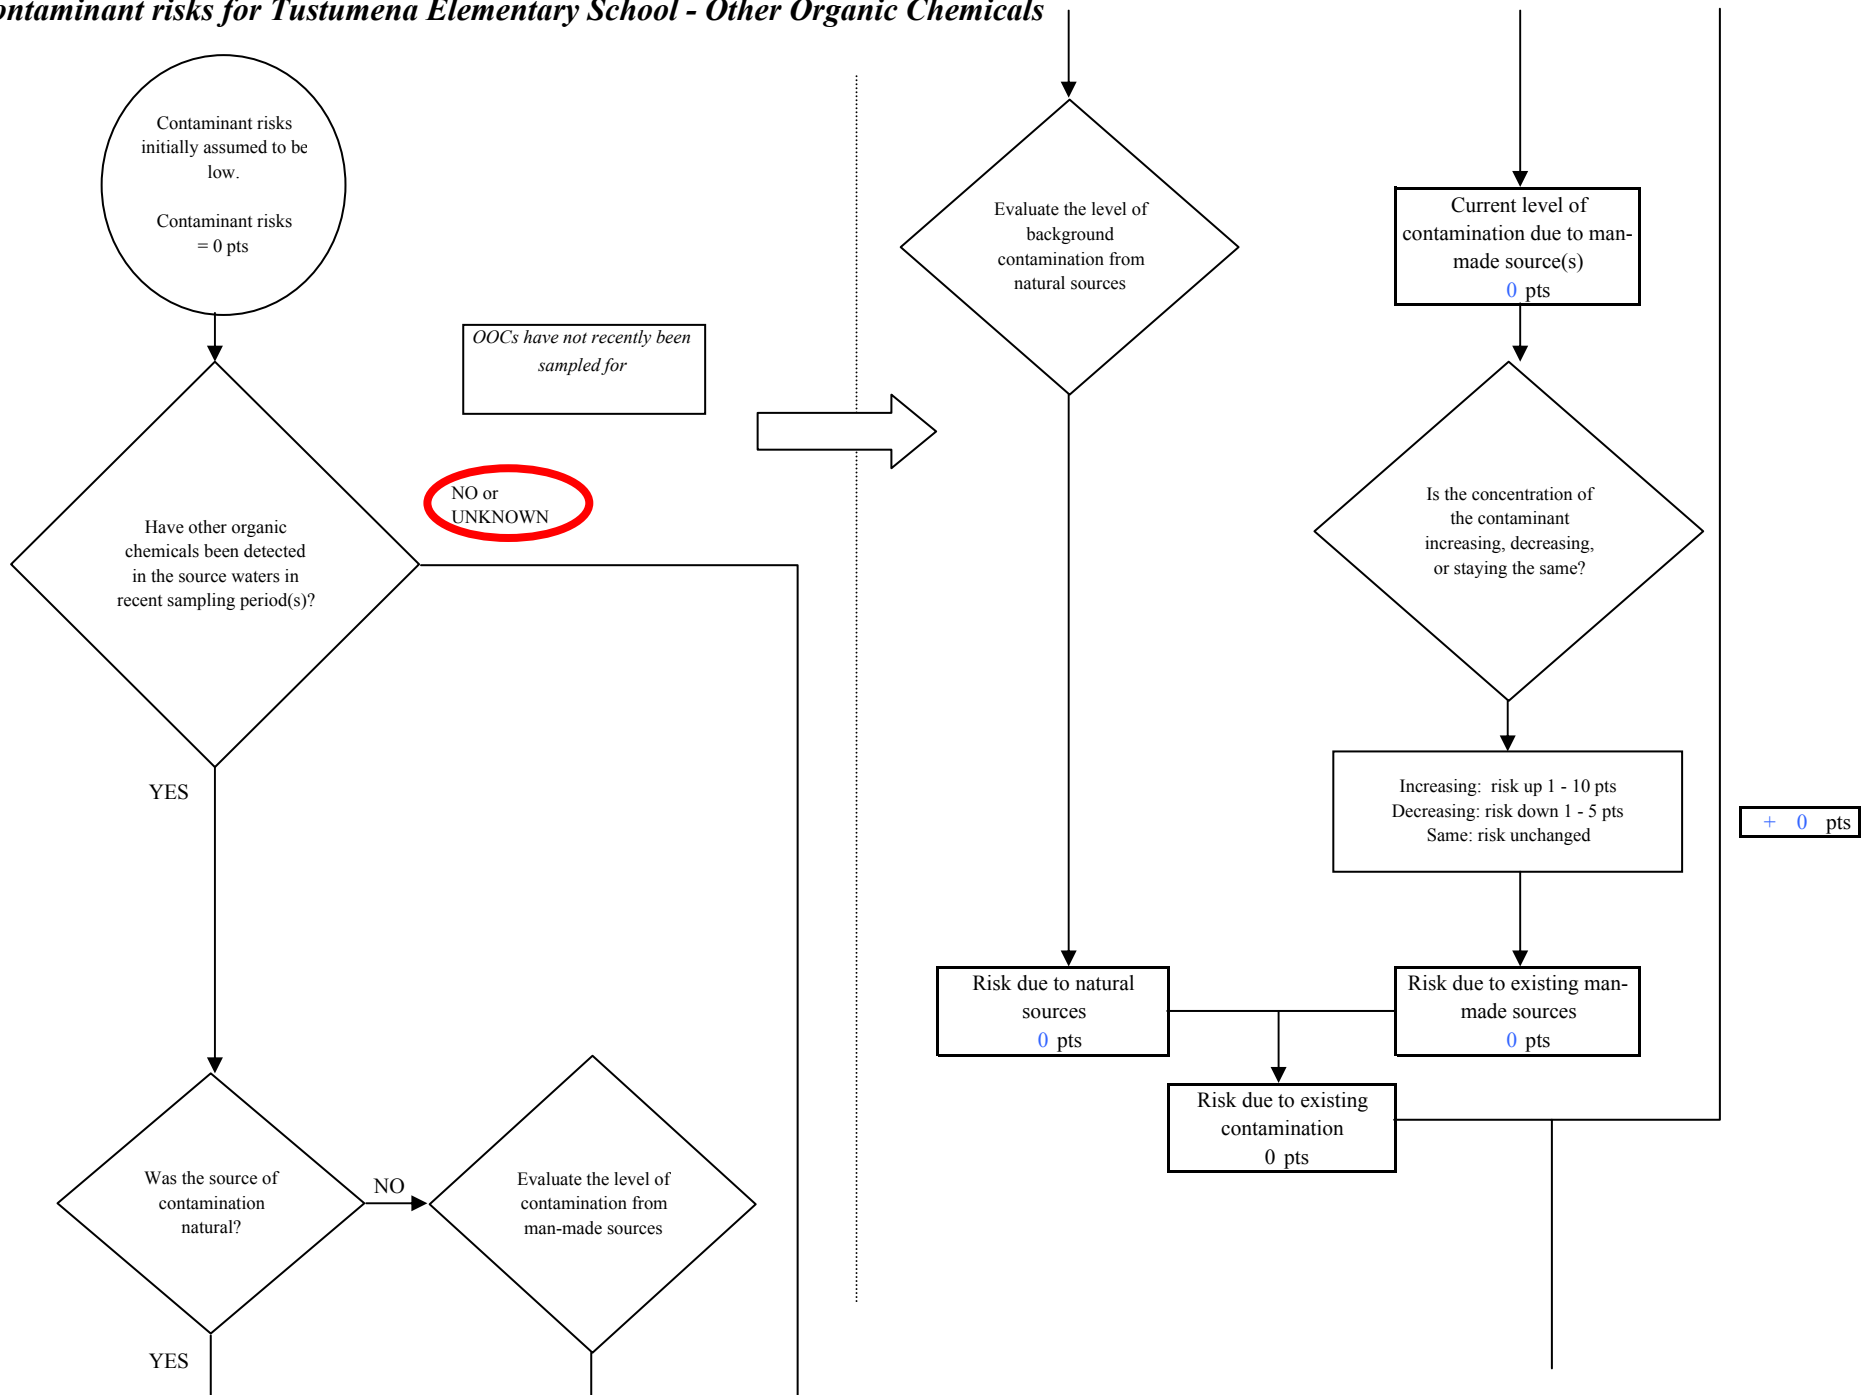


Chart 13. Contaminant risks for Tustumena Elementary School - Other Organic Chemicals

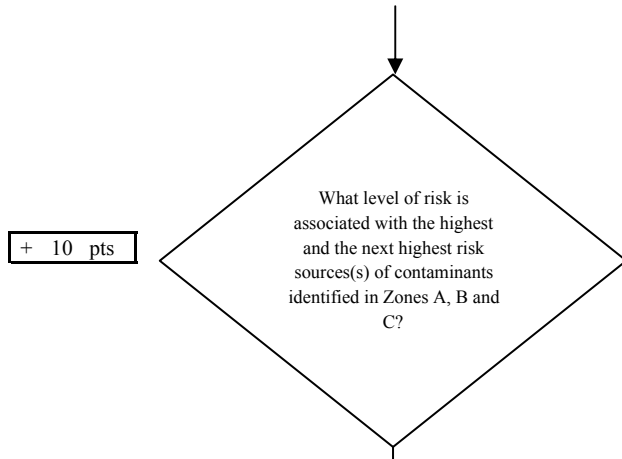

Risk Levels for Contaminant Sources identified in Zones A, B and C			
	Zone A	Zones B&C	Total
Very High(s)	0	0	0
High(s)	0	0	0
Medium(s)	0	0	0
Low(s)	3	3	6

	LOW 10 pts	MEDIUM 20 pts	HIGH 30 pts	VERY HIGH 40 pts
LOW	≥ 10 sources + 10 pts	≥ 10 sources + 5 pts	≥ 20 sources + 5 pts	----
MEDIUM	----	≥ 2 sources + 5 pts	≥ 5 sources + 5 pts	≥ 10 sources + 5 pts
HIGH	----	----	≥ 1 source + 10 pts	≥ 2 sources + 10 pts
VERY HIGH	----	----	----	≥ 1 source + 10 pts

Matrix Score 10

Note: Septic systems, sewerlines, and roads are each assigned a risk ranking for each individual contaminant source in the CSI. The VA, however, counts these contaminant sources as a group and assigns a calculated number of either "lows" or "mediums" based on the density.

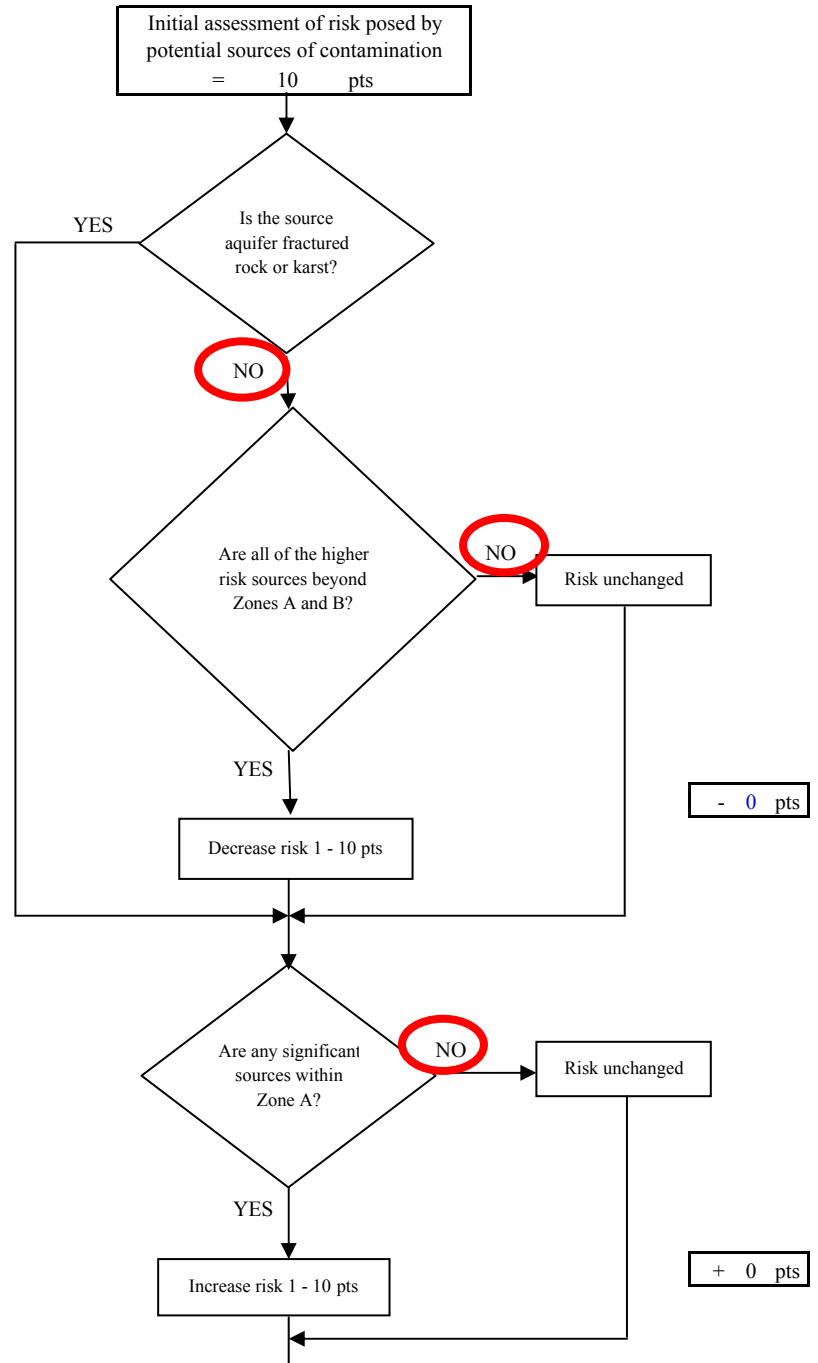



Chart 13. Contaminant risks for Tustumena Elementary School - Other Organic Chemicals

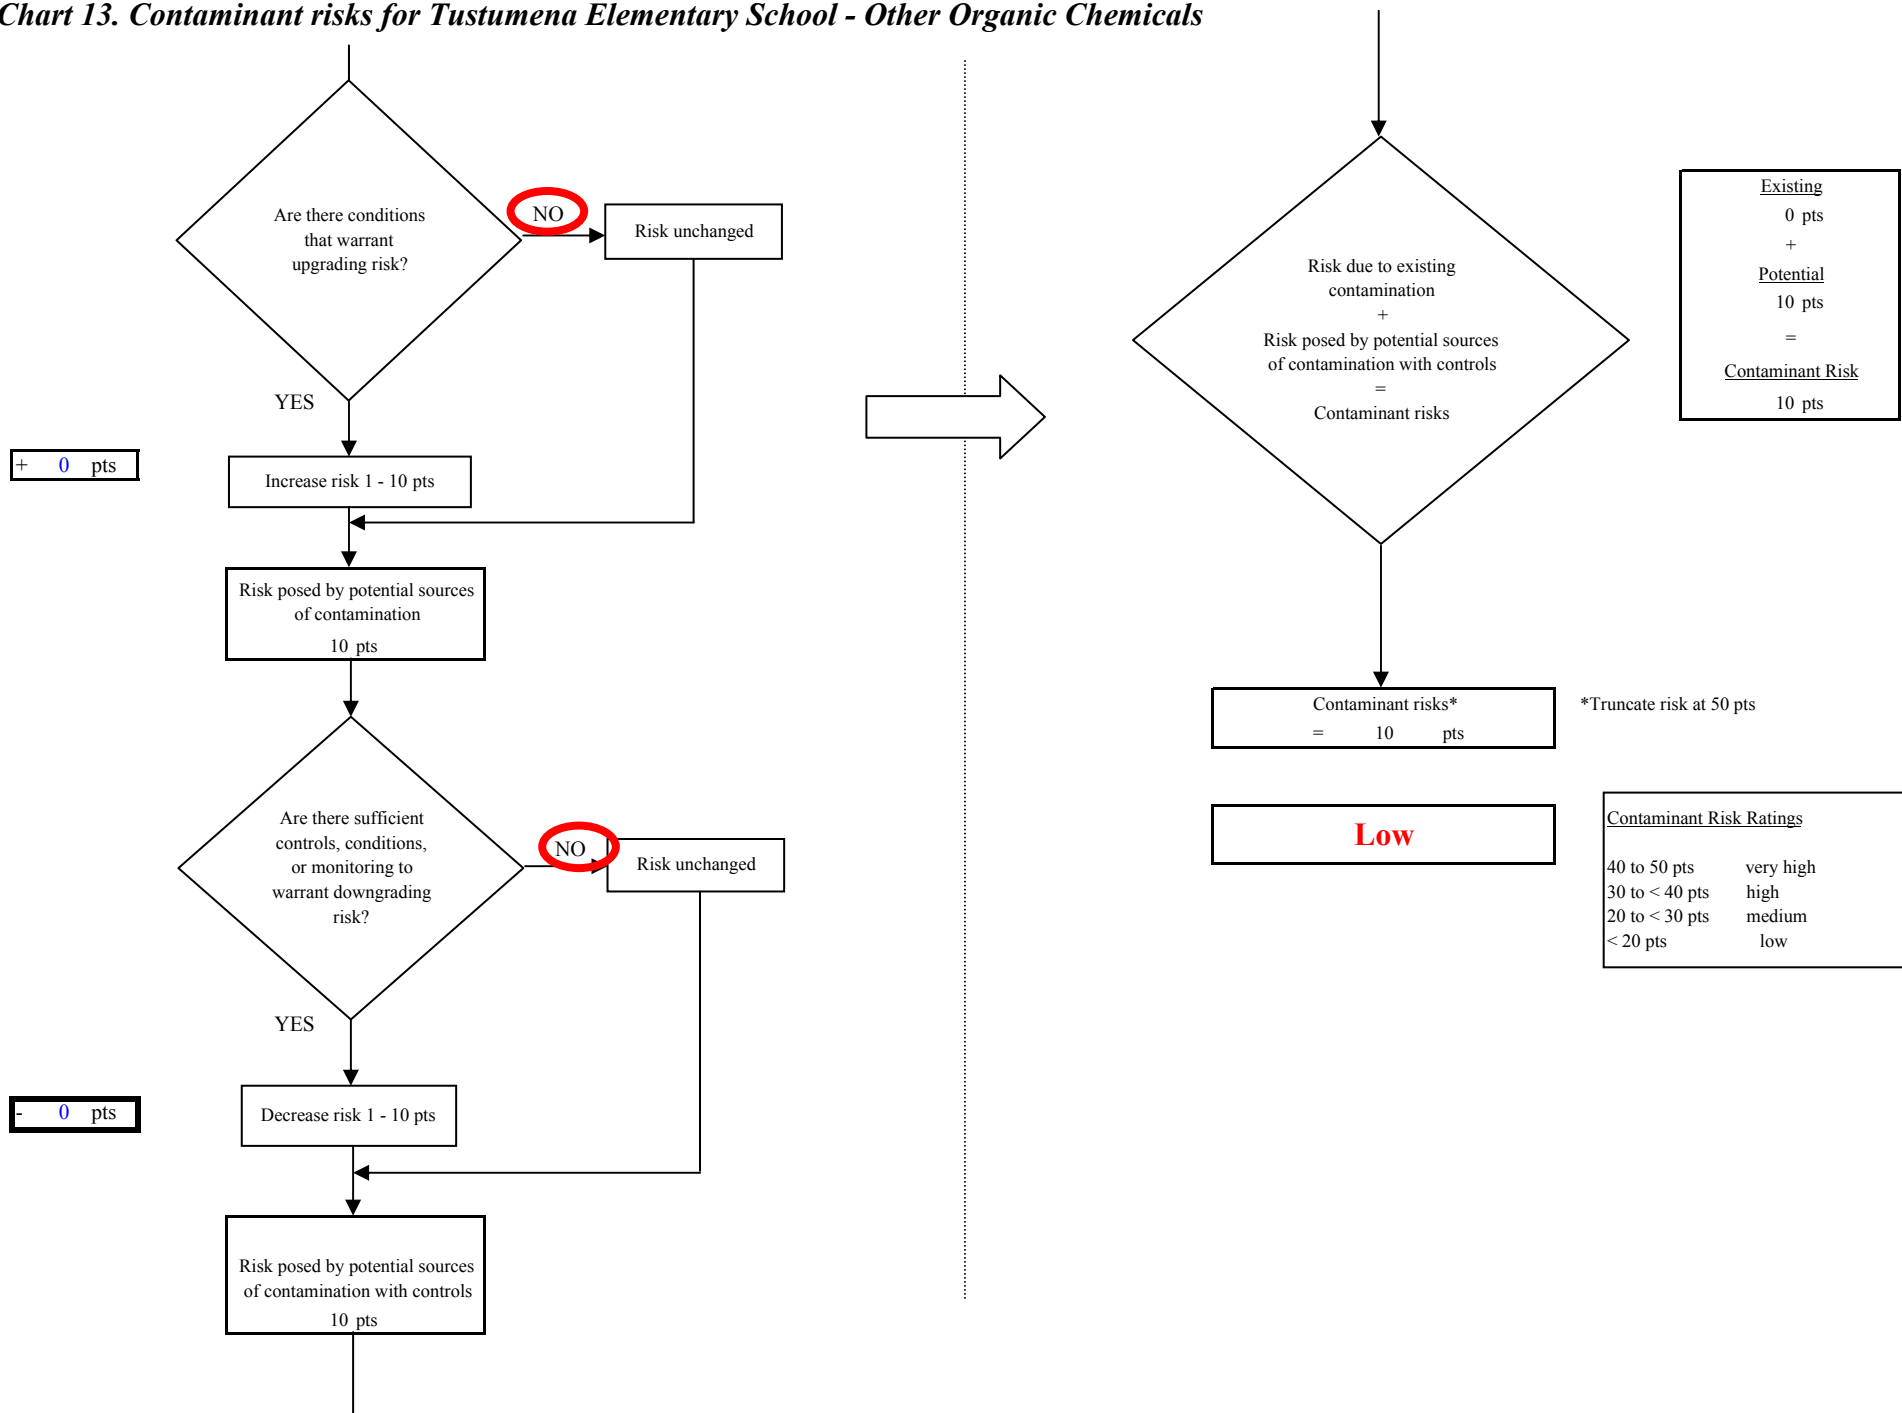


Chart 14. Vulnerability analysis for Tustumena Elementary School - Other Organic Chemicals

