



Source Water Assessment

A Hydrogeologic Susceptibility and Vulnerability Assessment for the CRSD Kenny Lake High School Drinking Water System, Kenny Lake, Alaska

PWSID # 294002.001

June 2004

DRINKING WATER PROTECTION PROGRAM REPORT 1368
Alaska Department of Environmental Conservation

Source Water Assessment for the CRSD Kenny Lake High School Drinking Water System Kenny Lake, Alaska

PWSID # 294002.001

DRINKING WATER PROTECTION PROGRAM REPORT 1368

The Drinking Water Protection Program (DWPP) is producing Source Water Assessments in compliance with the Safe Drinking Water Act Amendments of 1996. Each assessment includes a delineation of the source water area, an inventory of potential and existing contaminant sources that may impact the water, a risk ranking for each of these contaminants, and an evaluation of the potential vulnerability of these drinking water sources.

These assessments are intended to provide public water systems owners/operators, communities, and local governments with the best available information that may be used to protect the quality of their drinking water. The assessments combine information obtained from various sources, including the U.S. Environmental Protection Agency, Alaska Department of Environmental Conservation (ADEC), public water system owners/operators, and other public information sources. The results of this assessment are subject to change if additional data becomes available. It is anticipated this assessment will be updated every five years to reflect any changes in the vulnerability and/or susceptibility of public drinking water source. If you have any additional information that may affect the results of this assessment, please contact the Program Coordinator of DWPP, (907) 269-7521.

CONTENTS

PUBLIC DRIN	IKINC	MARY	INVENTORY OF POTENTIAL AND EXISTING CONTAMINANT SOURCES
		TABI	LES
Table 2. Susce Table 3. Conta	eptibil amina	itynt Risks	
		APPENI	DICES
APPENDIX A)	A.	CRSD Kenny Lake High School Pub	lic Water System Drinking Water Protection Area (Map
		Water System – Bacteria and Viruses Contaminant Source Inventory and R Water System – Nitrates/Nitrites (Tab Contaminant Source Inventory and R Water System – Volatile Organic Che Contaminant Source Inventory and R Water System – Heavy Metals, Cyani Contaminant Source Inventory and R Water System – Synthetic Organic Cl Contaminant Source Inventory and R Water System – Other Organic Chem	isk Ranking for CRSD Kenny Lake High School Public (Table 2) isk Ranking for CRSD Kenny Lake High School Public ole 3) isk Ranking for CRSD Kenny Lake High School Public emicals (Table 4) isk Ranking for CRSD Kenny Lake High School Public old and Other Inorganic Chemicals (Table 5) isk Ranking for CRSD Kenny Lake High School Public hemicals (Table 6) isk Ranking for CRSD Kenny Lake High School Public hemicals (Table 6) isk Ranking for CRSD Kenny Lake High School Public old (Table 7)
	C.	CRSD Kenny Lake High School Pub Potential and Existing Contaminant S	lic Water System Drinking Water Protection Area and Sources (Map C)
	D.		ant Source Inventory and Risk Ranking for CRSD Kenny em Public Drinking Water Source (Charts 1 – 14)

Source Water Assessment for CRSD Kenny Lake High School Public Water System Source of Public Drinking Water, Kenny Lake, Alaska

Drinking Water Protection Program Alaska Department of Environmental Conservation

EXECUTIVE SUMMARY

The CRSD Kenny Lake High School Public Water System has one Public Water System (PWS) well. The well (PWS No. 294002.001) has been used as a drinking water source since it was drilled in March 1976.

The well is a Class A (community and non-transient non-community) water system located inside the school building in Kenny Lake, Alaska. Available records indicate that there is no secondary storage of drinking water, other than two pressure tanks. This system operates seasonally and serves seventy non-residents through one service connection. Records also indicate that the drinking water source is untreated. The wellhead received a susceptibility rating of **Low** and the aquifer received a susceptibility rating of **Very High**. Combining these two ratings produce a **Medium** rating for the natural susceptibility of the well.

Identified potential and current sources of contaminants for the public drinking water source include: domestic wastewater collections systems, residential septic systems, fuel storage tanks, highways and roads, fire houses and quarries. These identified potential and existing sources of contamination are considered sources of bacteria and viruses, nitrates and/or nitrites, volatile organic chemicals, heavy metals, cyanide and other inorganic chemicals, synthetic organic chemicals, and other organic chemicals contaminant categories.

Overall, the well received a vulnerability rating of **High** for bacteria and viruses, nitrates and nitrites, volatile organic chemicals, a vulnerability rating of **Medium** for heavy metals, cyanide and other inorganic chemicals, and a vulnerability rating of **Low** for synthetic organic chemicals and other organic chemicals.

PUBLIC DRINKING WATER SYSTEM

The CRSD Kenny Lake High School Public Water System well is a Class A (community/non-transient/non-community) public water system. The

system is located outside the school building in Kenny Lake, Alaska (Sec. 31, T001S, R003E, Copper River Meridian, see Map A of Appendix A). The community of Kenny Lake is located off the Richardson Highway, between mile 1 and 22 on the Edgerton Highway, and between mil 1 and 11 of the Old Edgerton Highway. The community has a population of 369 (ADCED, 2003). Average annual precipitation in Kenny Lake is 12 inches, including approximately 52 inches of snowfall. Temperatures can be as extreme as -58 to 91°F.

The community of Kenny Lake obtains most of their water supply from two central watering points or water delivered by truck from Glennallen. The schools use their own well water systems. The majority of the occupied households use individual septic tank systems and are fully plumbed (ADCED, 2003). Kenny Lake receives electrical power from Copper Valley Electric Association; powergenerating facilities are hydro powered with diesel backups. Refuse dumpsters are available from Copper Basin Sanitation, who provide disposal at the Glennallen landfill (ADCED, 2003).

According to information supplied by ADEC for the CRSD Kenny Lake High School Public Water System PWS, the depth of the well is 235 feet below the ground surface. Based on available well construction details, it is assumed that the well is screened in a confined aquifer. The well is not located within a floodplain.

Information acquired from an April 2002 sanitary survey for the public water system indicated that the land surface was sloped away from the well. Generally, land surfaces that slope away from the wellhead promote surface water drainage, which reduces the potential of contaminant migration down the well casing annulus. The sanitary survey indicates that the well is grouted according to ADEC regulations. Proper grouting provides added protection against contaminants traveling along the well casing annulus and into source waters.

The Glennallen area is in the southeastern portion of the Copper River basin, in southeastern Interior Alaska. The Copper River basin, ranging from 500 to over 4,000 feet above sea level, is an intermontane basin rimmed by peaks of the Chugach, Alaska, Talkeetna, and Wrangell mountains. The terrain of the basin can be divided into two physiographic subunits: the rolling, hummocky Copper River basin piedmont surface, and the Copper River basin trough. The Copper River basin trough is generally flat and lacks the hummocky, rolling character of the piedmont surface.

The terrain, geology of the unconsolidated deposits, and foundation materials of the Copper River basin are related to Pliestocene and recent events. Glaciers from the Chugach, Wrangell, Talkeetna, and Alaska Ranges repeatedly invaded the basin, perhaps at times filling it and flowing across the divides to the north, west, east, and south. Such extensive glaciation has resulted in the deposition o large thicknesses of coarse glacial boulder clays (till) and coarse outwash gravel and sand on the piedmont surface, with finer till and outwash interbedded with lake deposits in the basin trough.

The Glennallen area is within the discontinuous permafrost zone. Surface soils in the area generally consist of silt and clay with pebbles underlain by boulder clay with till, underlain by glacial outwash sand and gravel, underlain by boulder clay or till.

DRINKING WATER PROTECTION AREA

In order to evaluate whether a drinking water source is at risk, we must first evaluate what are the most likely pathways for surface contamination to reach the groundwater. These areas are determined by looking at the characteristics of the soil, groundwater, aquifer, and well.

The most probable area for contamination to reach the drinking water well is the area that contributes water to the well, the groundwater recharge area. This area is designated as the drinking water protection area (DWPA). Because releases of contaminants within the protection area are most likely to impact the drinking water well, this area will serve as the focus for voluntary protection efforts. An analytical calculation was used to determine the size and shape of the DWPA for the CRSD Kenny Lake High School Public Water System PWS. The input parameters describing the attributes of the aguifer in this calculation were adopted from Groundwater (Freeze and Cherry, 1979). Available geology and groundwater contours were also considered to take into account any uncertainties in

groundwater flow and aquifer characteristics to arrive at a meaningful protection area.

The protection areas established for wells by the ADEC are usually separated into four zones, limited by the watershed. These zones correspond to differences in the time-of-travel (TOT) of the water moving through the aquifer to the well (Please refer to the Guidance Manual for Class A Public Water Systems for additional information).

The time of travel for contaminants within the water varies and is dependent on the physical and chemical characteristics of each contaminant. The following is a summary of the four protection area zones for wells and the calculated time-of-travel for each:

Table 1. Definition of Zones

Zone	Definition
A	¹ / ₄ the distance for the 2-yr. time-of-travel
В	Less than the 2 year time-of-travel
C	Less Than the 5 year time-of-travel
D	Less than the 10 year time-of-travel

The DWPA for the CRSD Kenny Lake High School Public Water System PWS was determined using an analytical calculation and includes Zones A, B, C, and D (See Map A of Appendix A).

INVENTORY OF POTENTIAL AND EXISTING CONTAMINANT SOURCES

The Drinking Water Protection Program has completed an inventory of potential and existing sources of contamination within the CRSD Kenny Lake High School Public Water System DWPA. This inventory was completed through a search of agency records and other publicly available information. Potential sources of contamination to the drinking water aquifer include a wide range of categories and types. Potential drinking water contaminants are found within agricultural, residential, commercial, and industrial areas, but can also occur within areas that have little or no development.

For the basis of all Class A public water system assessments, six categories of drinking water contaminants were inventoried. They include:

- Bacteria and viruses,
- Nitrates and/or nitrites.
- Volatile organic chemicals,
- Heavy metals, cyanide and other inorganic chemicals,
- Synthetic organic chemicals, and

• Other organic chemicals.

The sources are displayed on Map C of Appendix C and summarized in Table 1 of Appendix B.

RANKING OF CONTAMINANT RISKS

Once the potential and existing sources of contamination have been identified, they are assigned a ranking according to what type and level of risk they represent. Ranking of contaminant risks for a "potential" or "existing" source of contamination is a function of toxicity and volumes of specific contaminants associated with that source. Rankings include:

- Low,
- Medium,
- High, and
- Very High.

The time-of-travel for contaminants within the water varies and is dependent on the physical and chemical characteristics of each contaminant. Bacteria and Viruses are only inventoried in Zones A and B because of their short life span. Only "Very High" and "High" rankings are inventoried within the outer Zone D due to the probability of contaminant dilution by the time the contaminants get to the well. Tables 2 through 4 in Appendix B contain the ranking of potential and existing sources of contamination with respect to bacteria and viruses, nitrates and/or nitrites, volatile organic chemicals, heavy metals, cyanide and other inorganic chemicals, synthetic organic chemicals, and other organic chemicals.

VULNERABILITY OF THE DRINKING WATER SYSTEM

Vulnerability of a drinking water source to contamination is a combination of two factors:

- Natural susceptibility, and
- Contaminant risks.

Appendix D contains fourteen charts, which together form the 'Vulnerability Analysis' for a source water assessment for a public drinking water source. Chart 1 analyzes the 'Susceptibility of the Wellhead' to contamination by looking at the construction of the well and its surrounding area. Chart 2 analyzes the 'Susceptibility of the Aquifer' to contamination by looking at the naturally occurring attributes of the water source and influences on the groundwater system that might lead to contamination. Chart 3 analyzes 'Contaminant Risks' for the drinking water

source with respect to bacteria and viruses. The 'Contaminant Risks' portion of the analysis considers potential sources of contaminants as well as a review of contamination that has or may have occurred, but has not arrived or been detected at the well. Chart 4 contains the 'Vulnerability Analysis for Bacteria and Viruses'. Charts 5 through 14 contain the Contaminant Risks and Vulnerability Analyses for nitrates and nitrites, volatile organic chemicals, heavy metals, cyanide and other inorganic chemicals, synthetic organic chemicals, and other organic chemicals, respectively.

A score for the Natural Susceptibility is reached by considering the properties of the well and the aquifer.

Susceptibility of the Wellhead (0 – 25 Points) (Chart 1 of Appendix D)

+

Susceptibility of the Aquifer (0 – 25 Points) (Chart 2 of Appendix D)

=

Natural Susceptibility (Susceptibility of the Well) (0-50 Points)

A ranking is assigned for the Natural Susceptibility according to the point score:

Natural Susceptibility Ratings							
40 to 50 pts	Very High						
30 to < 40 pts	High						
20 to < 30 pts	Medium						
< 20 pts	Low						

The CRSD Kenny Lake High School Public Water System's water well is in a confined aquifer. Confined aquifers are less susceptible to potential groundwater quality impacts posed by the migration of surface water contaminants downward from the surface. Table 2 shows the susceptibility scores and ratings for this PWS.

Table 2. Susceptibility

	Score	Rating
Susceptibility of the	0	Low
Wellhead Susceptibility of the	20	Very High
Aquifer Natural Susceptibility	20	Medium
	20	Wicarani

Contaminant risks to a drinking water source depend on the type, number or density, and distribution of contaminant sources. This score has been derived from an examination of existing and historical contamination that has been detected at the drinking water source through routine sampling. It also evaluates potential sources of contamination. Flow charts are used to assign a point score, and ratings are assigned in the same way as for the natural susceptibility:

Contaminant Risk Ratings							
40 to 50 pts	Very High						
30 to < 40 pts	High						
20 to < 30 pts	Medium						
< 20 pts	Low						

Table 3 summarizes the Contaminant Risks for each category of drinking water contaminants.

Table 3. Contaminant Risks

Category	Score	Rating
Bacteria and Viruses	40	Very High
Nitrates and/or Nitrites	45	Very High
Volatile Organic Chemical	s 50	Very High
Heavy Metals, Cyanide and	d	
Other Inorganic Chemicals	28	Medium
Synthetic Organic Chemica	als 12	Low
Other Organic Chemicals	12	Low

Finally, an overall vulnerability score is assigned for each water system by combining each of the contaminant risk scores with the natural susceptibility score:

Vulnerability of the Drinking Water Source to Contamination (0 - 100).

Again, rankings are assigned according to a point score:

Overall Vulnerability Ratings							
80 to 100 pts	Very High						
60 to < 80 pts	High						
40 to < 60 pts	Medium						
< 40 pts	Low						

Table 4 contains the overall vulnerability scores (0 – 100) and ratings for each of the six categories of drinking water contaminants. Note: scores are rounded off to the nearest five.

Table 4. Overall Vulnerability

Category	Score	Rating
Bacteria and Viruses	60	High
Nitrates and Nitrites	65	High
Volatile Organic Chemicals	70	High
Heavy Metals, Cyanide and		
Other Inorganic Chemicals	50	Medium
Synthetic Organic Chemicals	30	Low
Other Organic Chemicals	30	Low

Bacteria and Viruses

The contaminant risk for bacteria and viruses is **Very High**. The risk is primarily attributed to the presence of a domestic wastewater collection system in Zone A. Numerous other potential contaminant sources are also found within the protection area (see Table 2 – Appendix B).

No positive bacteria counts have been reported in recent (within five years) sampling events (See Chart 3 – Contaminant Risks for Bacteria and Viruses in Appendix D). Only a small amount of bacteria and viruses are required to endanger public health.

After combining the contaminant risk for bacteria and viruses with the natural susceptibility of the well, the overall vulnerability of the well to contamination is **High**.

Nitrates and Nitrites

The contaminant risk for nitrates and nitrites is **Very High**. The risk to this source of public drinking water is primarily attributed to the presence of a domestic wastewater collection system in Zone A. Numerous other potential contaminant sources are also found within the protection area (see Table 3 – Appendix B).

Nitrates are very mobile, moving at approximately the same rate as water. The sampling history for this well indicates that nitrates have been detected in recent sampling events, however they did not exceed the MCL of 10mg/L. Nitrate concentrations in uncontaminated groundwater are typically less than 2 mg/L; therefore, nitrate concentrations above 2 mg/L may be indicative of man-made sources (See Chart 5 - Contaminant Risks for Nitrates and/or Nitrites in Appendix D).

After combining the contaminant risk for nitrates and nitrites with the natural susceptibility of the well, the overall vulnerability of the well to nitrate and nitrite contamination is **High.**

Volatile Organic Chemicals

The contaminant risk for volatile organic chemicals is **Very High**. The risk is primarily attributed to the presence of underground gasoline and diesel fuel tanks in Zone A. Numerous other potential contaminant sources are also found within the protection area (see Table 4 – Appendix B).

Based on review of recent sampling records for this public water system, moderate levels of tetrachloroethylene have been detected, however has not exceeded its MCL's of 0.005 mg/L (See Chart 7 – Contaminant Risks for Volatile Organic Chemicals in Appendix D).

Possible sources of volatile organic chemicals include facilities with automobiles, residential areas, fuel tanks, and roads. See Table 4 in Appendix B for a complete listing.

After combining the contaminant risk for volatile organic chemicals with the natural susceptibility of the well, the overall vulnerability of the well to contamination is **High**.

Heavy Metals, Cyanide and Other Inorganic Chemicals

The contaminant risk for heavy metals, cyanide and other inorganic chemicals is **Medium**. The risk is primarily attributed to the presence of an underground gasoline fuel tank in Zone A (see Table 5 – Appendix B).

Based on review of recent sampling records for this public water system, moderate levels of arsenic have been detected, however has not exceeded its MCL's of 0.05 mg/L (see Chart 9 – Contaminant Risks for Heavy Metals, Cyanide, and Other Inorganic Chemicals in Appendix D).

The reported concentration of arsenic is likely attributed to natural sources. Arsenic is a non-metallic metalloid occurring naturally in the earth's crust and fossil fuels. It is a known human carcinogen and bio-accumulates to toxic levels. It is possibly teratogenic. Risk points were assigned based on the presence of this analyte.

After combining the contaminant risk for heavy metals, cyanide and other inorganic chemicals with the natural susceptibility of the well, the overall vulnerability of the well to contamination is **Medium**.

Synthetic Organic Chemicals

The contaminant risk for synthetic organic chemicals is **Low**. The risk is primarily attributed to a domestic wastewater collection system and residential septic systems in Zone A (see Table 6 – Appendix B).

No recent sampling data was available in ADEC records for the CRSD Kenny Lake High School Public Water System (See Chart 11 – Contaminant Risks for Synthetic Organic Chemicals in Appendix D).

After combining the contaminant risk for synthetic organic chemicals with the natural susceptibility of the well, the overall vulnerability of the well to contamination is **Low**.

Other Organic Chemicals

The contaminant risk for other organic chemicals is **Low**. The risk is primarily attributed to the presence of domestic wastewater collection systems, residential septic systems, and highways and roads in Zone A. Several other potential contaminant sources are also found within the protection area (see Table 7 – Appendix B).

No recent sampling data was available in ADEC records for the CRSD Kenny Lake High School Public Water System (See Chart 13 – Contaminant Risks for Other Organic Chemicals in Appendix D).

After combining the contaminant risk for other organic chemicals with the natural susceptibility of the well, the overall vulnerability of the well to contamination is **Low**.

Using the Source Water Assessment

This assessment of contaminant risks can be used as a foundation for local voluntary protection efforts as well as a basis for the continuous efforts on the part of the community of CRSD Kenny Lake High School to protect public health. It is anticipated that Source Water Assessments will be updated every five years to reflect any changes in the vulnerability and/or susceptibility of the drinking water source.


REFERENCES

- Agency for Toxic Substances and Disease Registry, 2004 [WWW document]. URL: http://www.atsdr.cdc.gov/tfacts18.html.
- Alaska Department of Community and Economic Development (ADCED), 2003 [WWW document]. URL: http://www.dced.state.ak.us/cbd/commdb/CF COMDB.htm
- Alaska Department of Environmental Conservation, Contaminated Sites Database, 2003 [WWW database], URL http://www.state.ak.us/dec/dspar/csites/cs search.htm
- Alaska Department of Environmental Conservation, Leaking Underground Storage Tank Database, 2003 [WWW database], URL http://www.dec.state.ak.us/spar/stp/ust/search/fac_search.asp
- Freeze, R. A., and Cherry, J.A. 1979, Groundwater, Prentice-Hall, Englewood Cliffs, New Jersey
- Information from Permafrost and Groundwater Conditions in the Glennallen area, Alaska by Donald R. Nichols, Open File Report 56-91, U.S. Geological Survey, dated January 1956.
- United States Environmental Protection Agency (EPA), 2002 [WWW document]. URL http://www.epa.gov/safewater/mcl.html.
- Naval Weapons Station Seal Beach www.sbeach.navy.mil/Programs/Environmental/IR/Reading Room/Glossary/G AB.htm
- University of Ottawa, Reference Database http://www.site.uottawa.ca:4321/astronomy/index.html

APPENDIX A

Drinking Water Protection Area Location Map (Map A)

Public Water System for PWS 294002.001 CRSD Kenny Lake High School

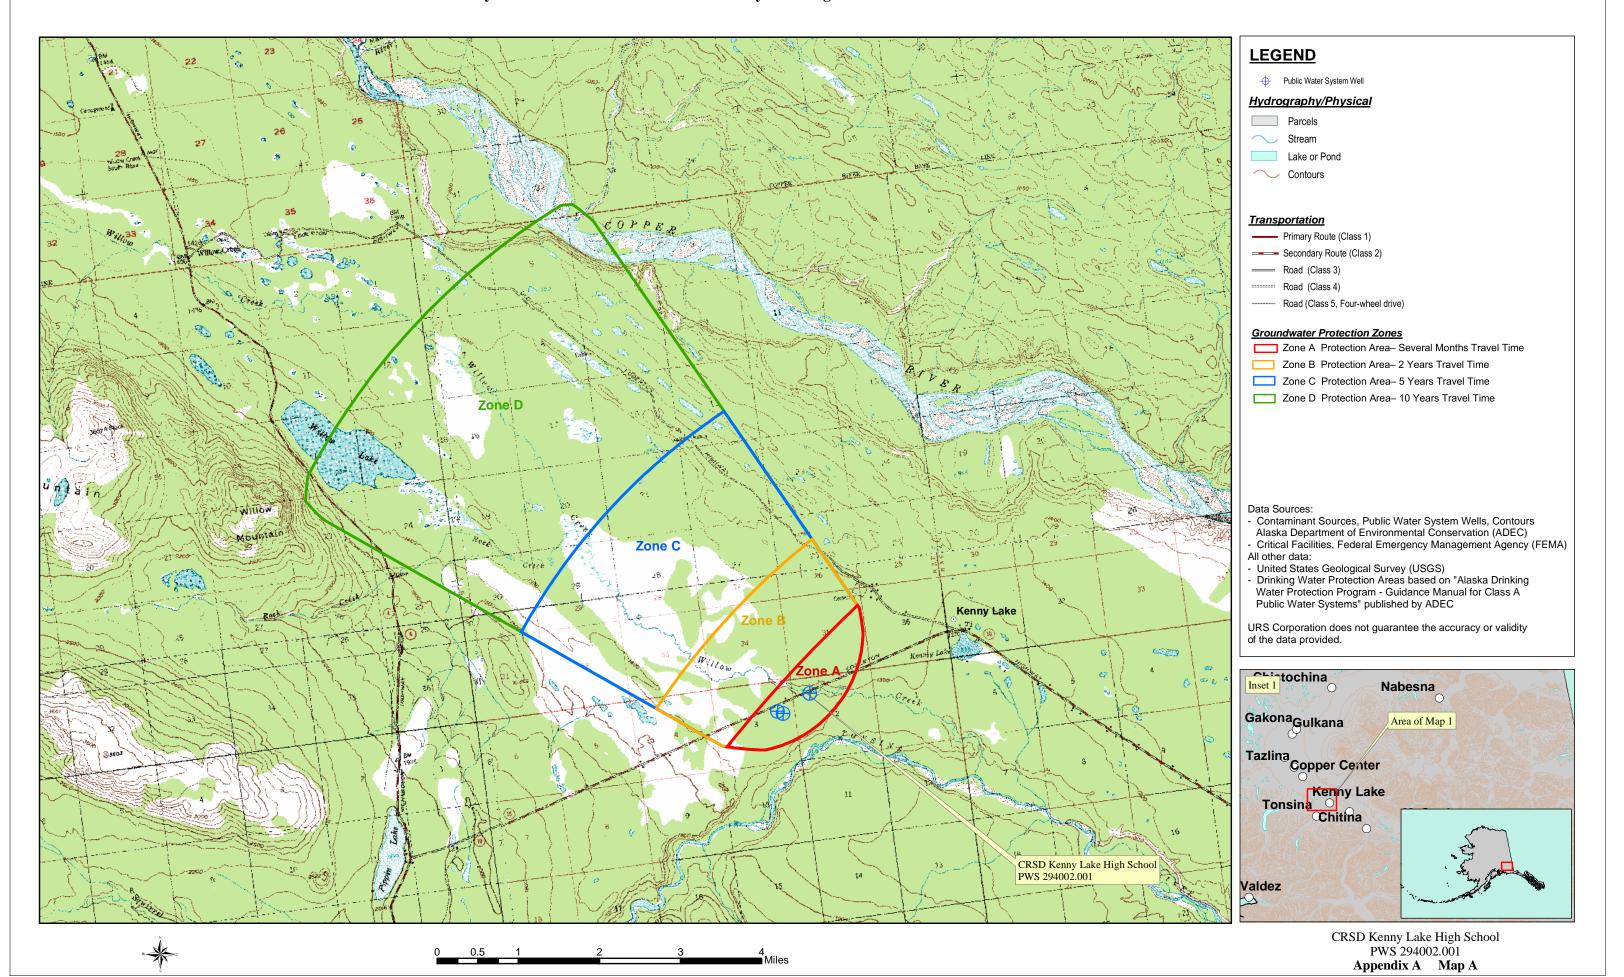

APPENDIX B

Contaminant Source Inventory and Risk Ranking (Tables 1-7)

Contaminant Source Inventory for CRSD Kenny Lake High School

PWSID 294002.00

Contaminant Source Type	Contaminant Source ID	CS ID tag	Zone	Map Number	Comments
Domestic wastewater collection systems (sewer lines or lift static	D01	D01-01	A	C	
Domestic wastewater collection systems (sewer lines or lift static	D01	D01-02	A	С	
Injection wells (Class V) Large-Capacity Septic System (Drainfie Disposal Method)	D10	D10-01	A	С	
Septic systems (serves one single-family home)	R02	R02-01	A	С	
Tanks, diesel (above ground)	T06	T06-01	A	С	
Tanks, diesel (above ground)	T06	T06-02	A	С	
Tanks, diesel (underground)	Т08	T08-01	A	С	
Tanks, diesel (underground)	Т08	T08-02	A	С	
Tanks, gasoline (underground)	T12	T12-01	A	С	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-01	A	С	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-02	A	С	
Highways and roads, paved (cement or asphalt)	X20	X20-01	A	С	Richardson Highway
Highways and roads, paved (cement or asphalt)	X20	X20-02	A	С	Edgerton Highway
Highways and roads, dirt/gravel	X24	X24-01	A	C	Assume 20 or less roads in Zone A
Firehouses	X38	X38-01	A	C	
Quarries (sand, gravel, rock, other?)	E10	E10-01	C	C	Kimball Pass

Table 2

Contaminant Source Inventory and Risk Ranking for CRSD Kenny Lake High School Sources of Bacteria and Viruses

Contaminant Source Type	Contaminant Source ID	CS ID tag	Zone	Risk Ranking for Analysis	Map Number	Comments
Domestic wastewater collection systems (sewer line or lift stations)	D01	D01-01	A	Medium	С	
Domestic wastewater collection systems (sewer line or lift stations)	D01	D01-02	A	Medium	C	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-01	A	High	C	
Septic systems (serves one single-family home)	R02	R02-01	A	Low	С	
Highways and roads, paved (cement or asphalt)	X20	X20-01	A	Low	С	Richardson Highway
Highways and roads, paved (cement or asphalt)	X20	X20-02	A	Low	С	Edgerton Highway
Highways and roads, dirt/gravel	X24	X24-01	A	Low	С	Assume 20 or less roads in Zone A

Table 3

Contaminant Source Inventory and Risk Ranking for CRSD Kenny Lake High School Sources of Nitrates/Nitrites

Contaminant Source Type	Contaminant Source ID	CS ID tag	Zone	Risk Ranking for Analysis	Map Number	Comments
Domestic wastewater collection systems (sewer line or lift stations)	D01	D01-01	A	Medium	С	
Domestic wastewater collection systems (sewer line or lift stations)	D01	D01-02	A	Medium	С	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-01	A	High	С	
Septic systems (serves one single-family home)	R02	R02-01	A	Low	С	
Highways and roads, paved (cement or asphalt)	X20	X20-01	A	Low	С	Richardson Highway
Highways and roads, paved (cement or asphalt)	X20	X20-02	A	Low	С	Edgerton Highway
Highways and roads, dirt/gravel	X24	X24-01	A	Low	С	Assume 20 or less roads in Zone A
Quarries (sand, gravel, rock, other?)	E10	E10-01	С	Low	С	Kimball Pass

Table 4

Contaminant Source Inventory and Risk Ranking for CRSD Kenny Lake High School Sources of Volatile Organic Chemicals

Contaminant Source Type	Contaminant Source ID	CS ID tag	Zone	Risk Ranking for Analysis	Map Number	Comments
Domestic wastewater collection systems (sewer line or lift stations)	D01	D01-01	A	Low	С	
Domestic wastewater collection systems (sewer line or lift stations)	D01	D01-02	A	Low	С	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-01	A	Low	С	
Septic systems (serves one single-family home)	R02	R02-01	A	Low	С	
Tanks, diesel (above ground)	T06	T06-01	A	Medium	С	
Tanks, diesel (above ground)	T06	T06-02	A	Medium	С	
Tanks, diesel (underground)	Т08	T08-01	A	High	С	
Tanks, diesel (underground)	Т08	T08-02	A	High	С	
Tanks, gasoline (underground)	T12	T12-01	A	High	С	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-01	A	Low	С	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-02	A	Low	С	
Highways and roads, paved (cement or asphalt)	X20	X20-01	A	Low	С	Richardson Highway
Highways and roads, paved (cement or asphalt)	X20	X20-02	A	Low	С	Edgerton Highway
Highways and roads, dirt/gravel	X24	X24-01	A	Low	С	Assume 20 or less roads in Zone A
Firehouses	X38	X38-01	A	Low	С	
Quarries (sand, gravel, rock, other?)	E10	E10-01	С	Low	С	Kimball Pass

Table 5

Contaminant Source Inventory and Risk Ranking for CRSD Kenny Lake High School Sources of Heavy Metals, Cyanide and Other Inorganic Chemicals

Contaminant Source Type	Contaminant Source ID	CS ID tag	Zone	Risk Ranking for Analysis	Map Number	Comments
Domestic wastewater collection systems (sewer line or lift stations)	D01	D01-01	A	Low	С	
Domestic wastewater collection systems (sewer line or lift stations)	D01	D01-02	A	Low	С	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-01	A	Low	С	
Septic systems (serves one single-family home)	R02	R02-01	A	Low	C	
Tanks, gasoline (underground)	T12	T12-01	A	Medium	С	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-01	A	Low	C	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-02	A	Low	C	
Highways and roads, paved (cement or asphalt)	X20	X20-01	A	Low	С	Richardson Highway
Highways and roads, paved (cement or asphalt)	X20	X20-02	A	Low	С	Edgerton Highway
Highways and roads, dirt/gravel	X24	X24-01	A	Low	С	Assume 20 or less roads in Zone A
Firehouses	X38	X38-01	A	Low	С	

Table 6

Contaminant Source Inventory and Risk Ranking for CRSD Kenny Lake High School Sources of Synthetic Organic Chemicals

Contaminant Source Type	Contaminant Source ID	CS ID tag	Zone	Risk Ranking for Analysis	Map Number	Comments
Domestic wastewater collection systems (sewer line or lift stations)	D01	D01-01	A	Low	С	
Domestic wastewater collection systems (sewer line or lift stations)	D01	D01-02	A	Low	С	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-01	A	Low	С	
Septic systems (serves one single-family home)	R02	R02-01	A	Low	С	

Table 7


Contaminant Source Inventory and Risk Ranking for CRSD Kenny Lake High School Sources of Other Organic Chemicals

Contaminant Source Type	Contaminant Source ID	CS ID tag	Zone	Risk Ranking for Analysis	Map Number	Comments
Domestic wastewater collection systems (sewer line or lift stations)	D01	D01-01	A	Low	С	
Domestic wastewater collection systems (sewer line or lift stations)	D01	D01-02	A	Low	С	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-01	A	Low	С	
Septic systems (serves one single-family home)	R02	R02-01	A	Low	С	
Highways and roads, paved (cement or asphalt)	X20	X20-01	A	Low	С	Richardson Highway
Highways and roads, paved (cement or asphalt)	X20	X20-02	A	Low	С	Edgerton Highway
Highways and roads, dirt/gravel	X24	X24-01	A	Low	С	Assume 20 or less roads in Zone A
Quarries (sand, gravel, rock, other?)	E10	E10-01	C	Low	С	Kimball Pass

APPENDIX C

Drinking Water Protection Area and Potential and Existing Contaminant Sources (Map C)

Public Water System for PWS 294002.001 CRSD Kenny Lake High School Sources of Existing and Potential Contamination

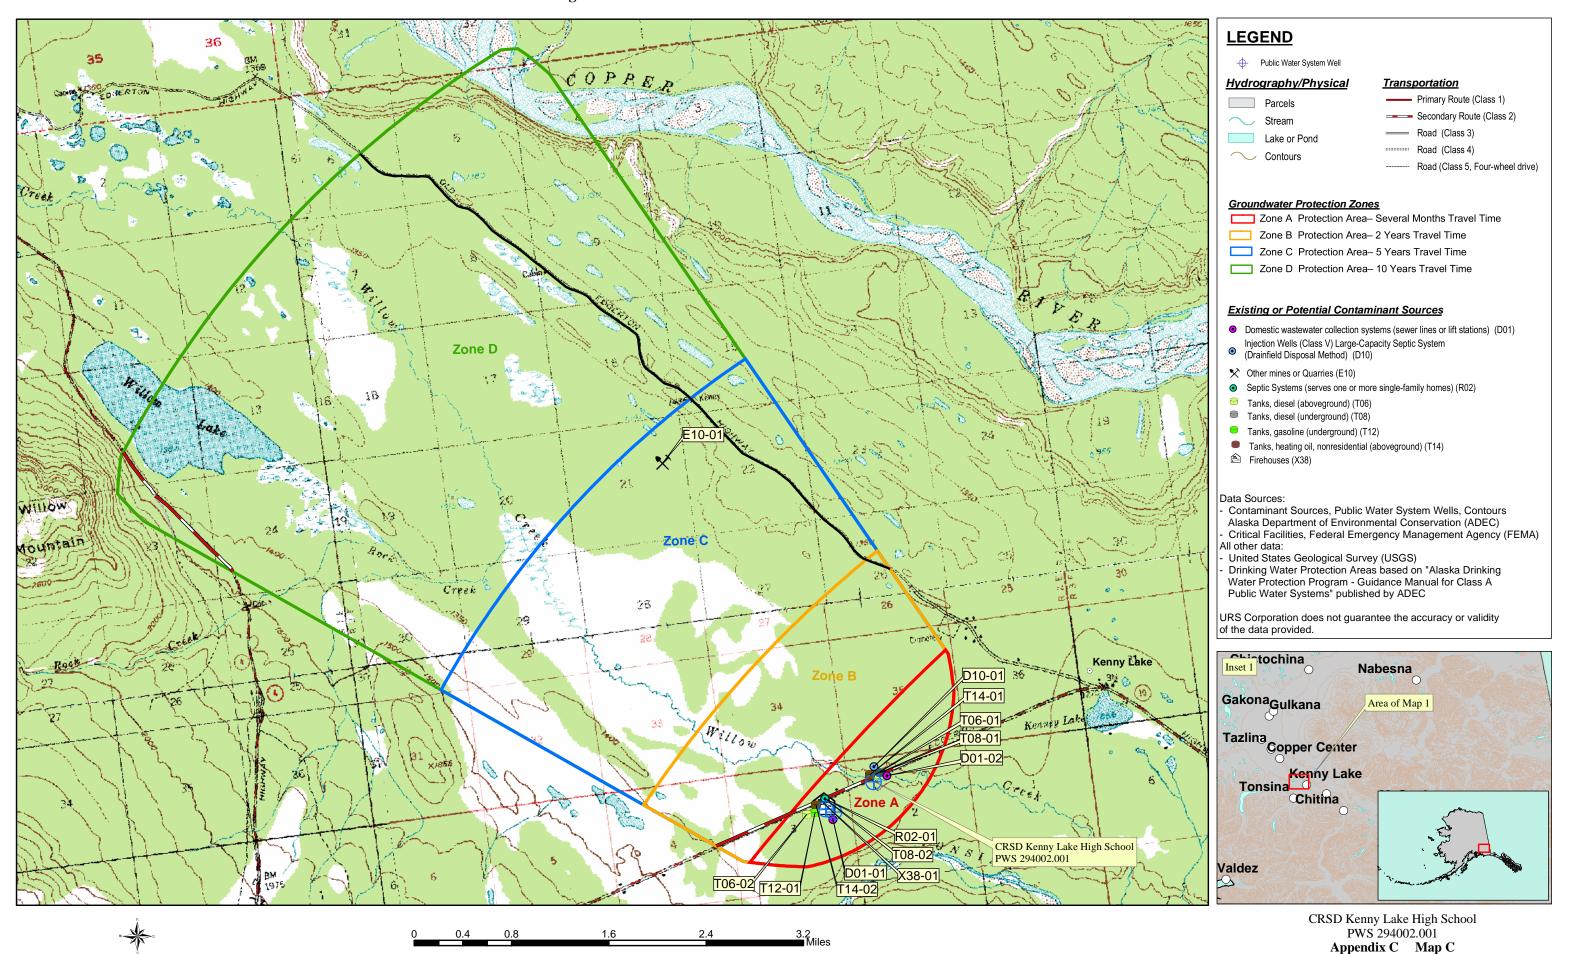

APPENDIX D

Vulnerability Analysis for Public Drinking Water Source (Charts 1-14)

Susceptibility initially assumed to be low. Susceptibility of wellhead = 0 pts Is the well Increase susceptibility 5 pts + <u>0</u> pts properly grouted? Is the well Increase susceptibility 20 pts 0 pts capped? YES YES Susceptibility of wellhead Low 0 pts Increase susceptibility: YES Is the well 10 pts: suspected floodplain + 0 pts within a Wellhead Susceptibility Ratings 20 pts: known floodplain floodplain? 20 to 25 pts very high 15 to < 20 pts 10 to < 15 pts medium NO < 10 pts low Is the land Increase susceptibility 5 pts surface sloped 0 pts away from the

Chart 1. Susceptibility of the wellhead - CRSD Kenny Lake High School (PWS No. 294002.001)

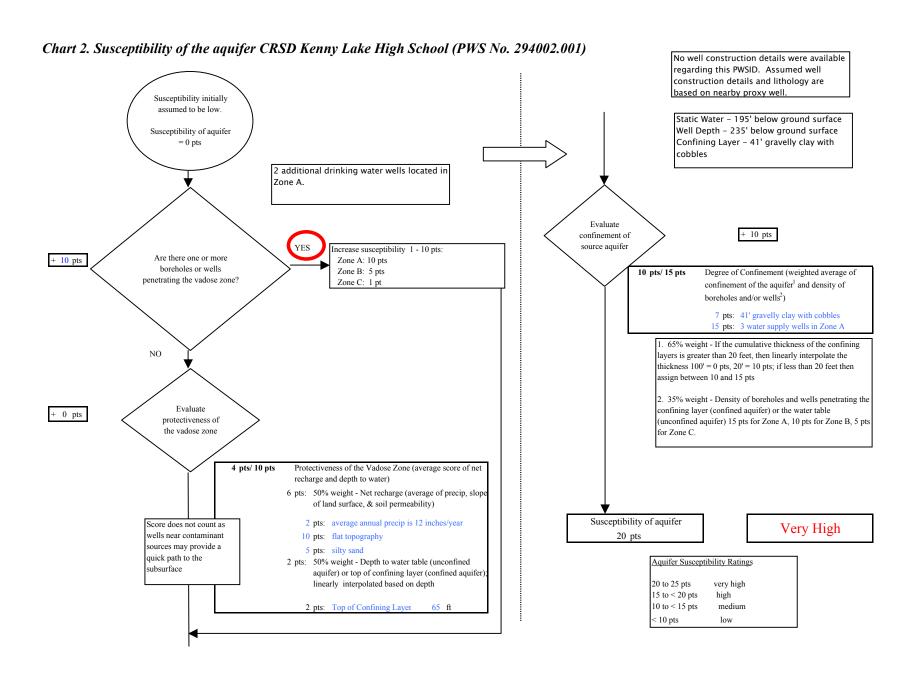


Chart 3. Contaminant risks for CRSD Kenny Lake High School (PWS No. 294002.001) - Bacteria & Viruses

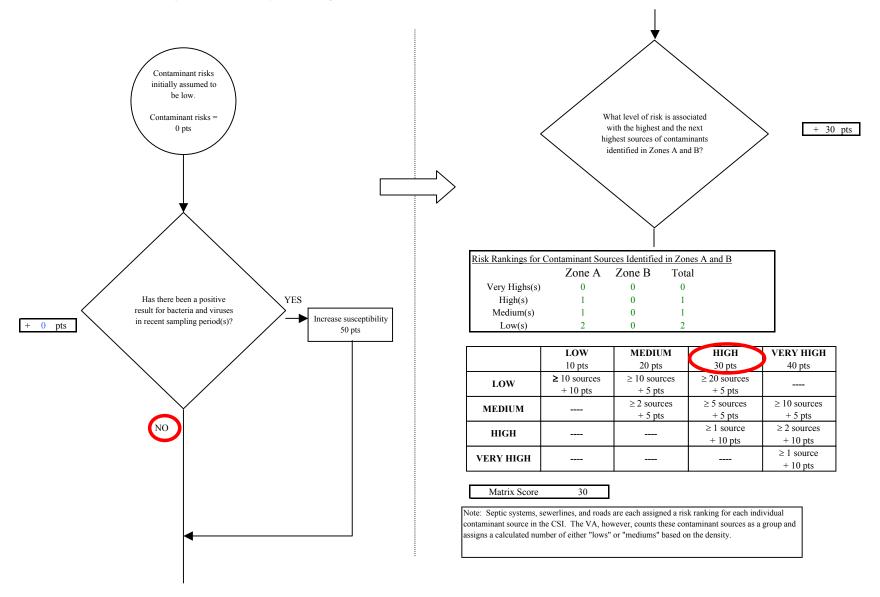


Chart 3. Contaminant risks for CRSD Kenny Lake High School (PWS No. 294002.001) - Bacteria & Viruses NO Are there sufficient Initial assessment of risk posed by Risk unchanged controls, conditions, or potential sources of contamination monitoring to warrant = 30 pts downgrading risk? Are any YES significant Risk unchanged contaminant Reduce risk 1 - 10 pts sources within - 0 pts Zone A? The number and magnitude of Risk posed by potential sources of contaminant sources in YES contamination with controls Zone A determines a risk increase. See Table 2 for + 10 pts Increase risk 1 - 10 pts inventory. Existing Risk due to existing 0 pts contamination Are there any conditions that Risk unchanged Risk posed by potential sources warrant upgrading Potential of contamination with controls risk? 40 pts Contaminant risks Contaminant Risk YES 40 pts Increase risk 1 - 10 pts + 0 pts Contaminant risks* * Truncate risk at 50 pts Contaminant Risk Ratings Risk posed by potential sources of contamination 40 to 50 pts very high 30 to < 40 ptshigh Very High $20 \text{ to} \le 30 \text{ pts}$

Page 4 of 25

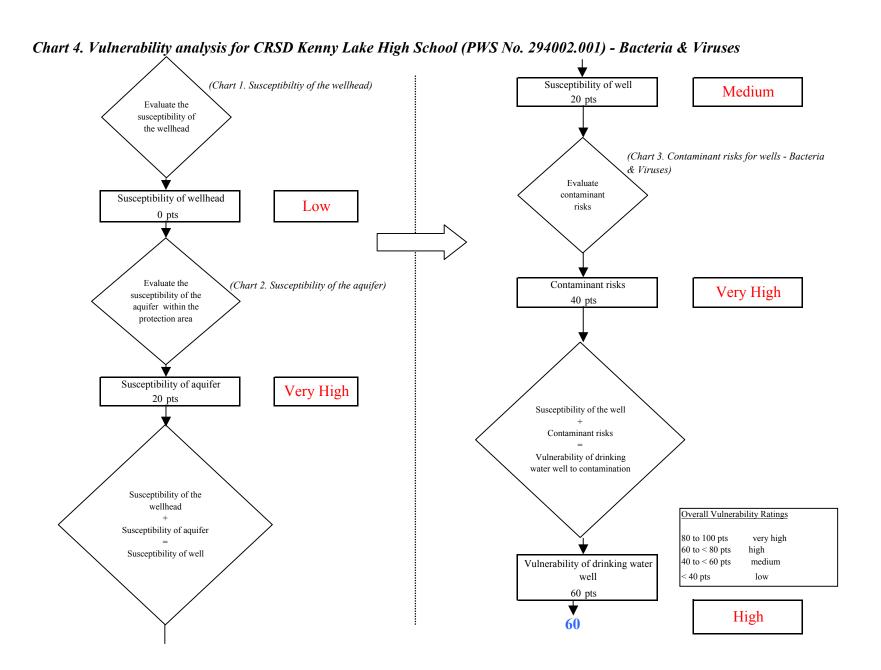


Chart 5. Contaminant risks for CRSD Kenny Lake High School (PWS No. 294002.001) - Nitrates and Nitrites Contaminant risks initially assumed to be low. Evaluate the level of Current level of Contaminant risks background contamination due to man-= 0 ptscontamination from made source(s) natural sources 0 pts Is the concentration of Has nitrates and/or NO the contaminant nitrites been detected in increasing, decreasing, the source waters in or staying the same? recent sampling period(s)? Recent Nitrate Sampling Results (mg/L) 8/26/2003 0.16 .978 12/19/2002 The nitrate concentration is 12/17/2001 .337 assumed to be natural if less 9/19/2000 0.13 than 2 mg/L (20%), or Increasing: risk up 1 - 10 pts YES attributed to man made 0.24 8/31/1999 Decreasing: risk down 1 - 5 pts sources if greater than 2 10/26/1998 0.11 + 0 pts Same: risk unchanged mg/L. Maximum Contaminant Level (MCL) = 10 mg/LDetected Nitrate Level = Existing contamination points based on Risk due to existing man-Risk due to natural linear interpolation of most recent detect sources made sources [MCL = 50 pts; detect = 0 pts]5 pts 0 pts Risk due to existing contamination 5 pts Was the source of Evaluate the level of NO. contamination contamination from natural? man-made sources YES

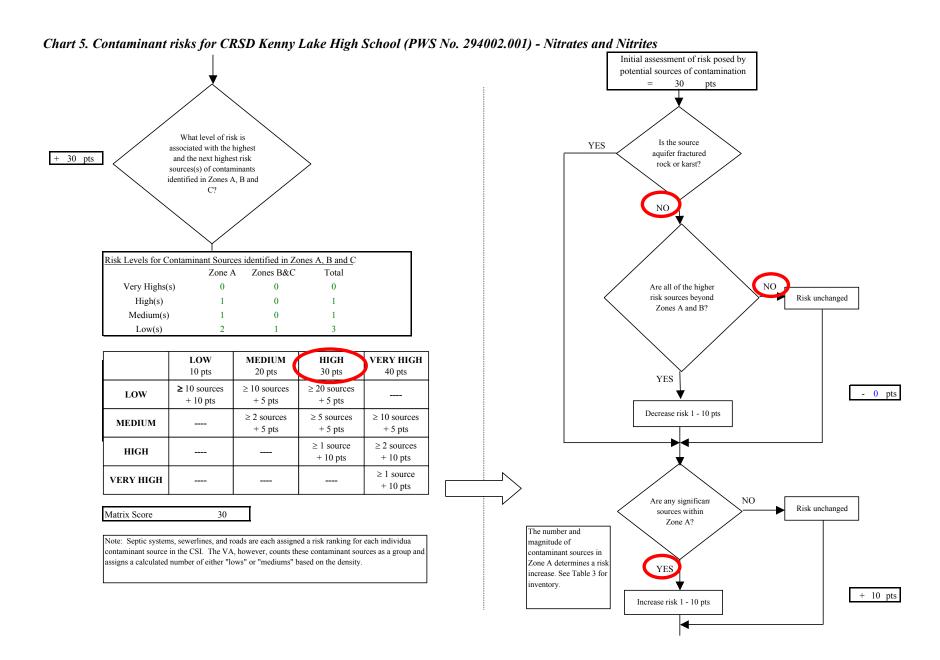
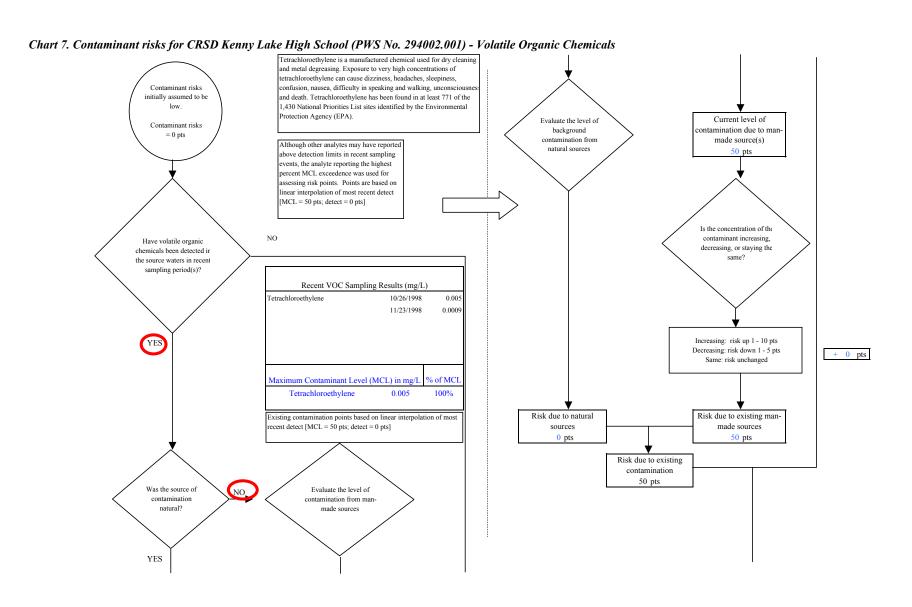


Chart 5. Contaminant risks for CRSD Kenny Lake High School (PWS No. 294002.001) - Nitrates and Nitrites Existing NO Are there conditions 5 pts Risk unchanged that warrant upgrading risk? Risk due to existing Potential contamination 40 pts The number and magnitude of Risk posed by potential sources contaminant sources in of contamination with controls Contaminant Risk Zone D determines a risk YES 45 pts increase. See Table 3 for Contaminant risks inventory. 0 pts Increase risk 1 - 10 pts Risk posed by potential sources of contamination 40 pts *Truncate risk at 50 pts Contaminant risks* 45 Contaminant Risk Ratings Are there sufficient Very High controls, conditions, NO. Risk unchanged or monitoring to 40 to 50 pts very high warrant downgrading 30 to < 40 pts high 20 to < 30 pts risk? medium < 20 pts low YES 0 pts Decrease risk 1 - 10 pts Risk posed by potential sources of contamination with controls

Page 8 of 25

(Chart 1. Susceptibiltiy of the wellhead) Susceptibility of well Medium 20 pts Evaluate the susceptibility of the wellhead (Chart 5. Contaminant risks for wells - Nitrates and Nitrites) Evaluate Susceptibility of wellhead contaminant risks Low 0 pts Evaluate the (Chart 2. Susceptibility of the aquifer) Contaminant risks Very High susceptibility of the 45 pts aquifer within the protection area Susceptibility of aquifer Very High 20 pts Susceptibility of the well Contaminant risks Vulnerability of drinking water well to contamination Susceptibility of the wellhead Overall Vulnerability Ratings Susceptibility of aquifer 80 to 100 pts very high Susceptibility of well 60 to < 80 pts high 40 to < 60 pts medium Vulnerability of drinking water well < 40 pts 65 pts High **65**

Chart 6. Vulnerability analysis for CRSD Kenny Lake High School (PWS No. 294002.001) - Nitrates and Nitrites



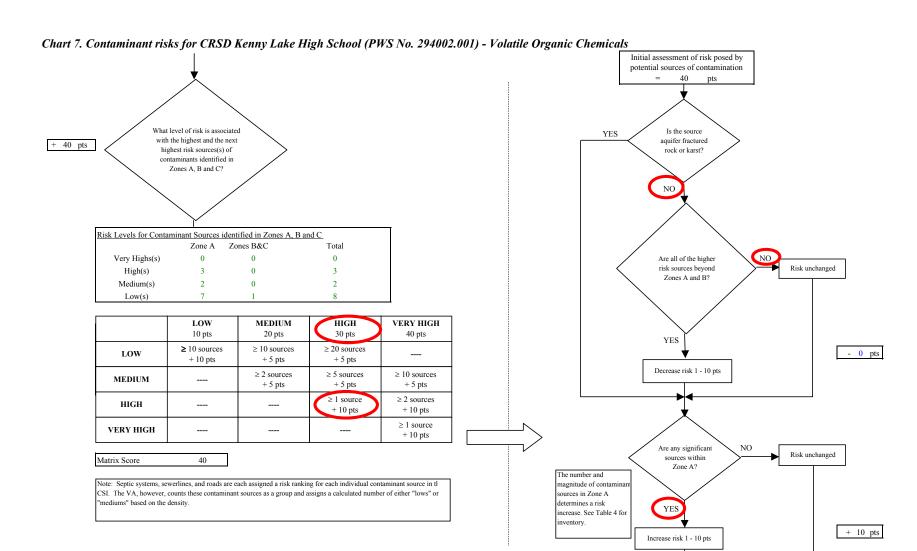


Chart 7. Contaminant risks for CRSD Kenny Lake High School (PWS No. 294002.001) - Volatile Organic Chemicals Existing NO Are there conditions 50 pts Risk unchanged that warrant upgrading Risk due to existing risk? Potential contamination 50 pts The number and magnitude of Risk posed by potential sources contaminant sources in of contamination with controls Contaminant Risk Zone D determines a risk YES increase. See Table 4 for 100 pts Contaminant risks inventory. + 0 pts Increase risk 1 - 10 pts Risk posed by potential sources of contamination 50 pts *Truncate risk at 50 pts Contaminant risks* Contaminant Risk Ratings Are there sufficient Very High NO , controls, conditions, or Risk unchanged 40 to 50 pts very high monitoring to warrant 30 to < 40 pts high downgrading risk? 20 to < 30 pts medium < 20 pts YES 0 pts Decrease risk 1 - 10 pts Risk posed by potential sources of contamination with controls 50 pts

Page 12 of 25


Chart 8. Vulnerability analysis for CRSD Kenny Lake High School (PWS No. 294002.001) - Volatile Organic Chemicals (Chart 1. Susceptibiltiy of the wellhead) Susceptibility of well Medium 20 pts Evaluate the susceptibility of the wellhead (Chart 7. Contaminant risks for wells - Volatile Organic Chemicals) Evaluate Susceptibility of wellhead contaminant risks Low 0 pts Evaluate the (Chart 2. Susceptibility of the aquifer) Contaminant risks Very High susceptibility of the 50 pts aquifer within the protection area Susceptibility of aquifer Very High 20 pts Susceptibility of the well Contaminant risks Vulnerability of drinking water well to contamination Susceptibility of the wellhead Overall Vulnerability Ratings Susceptibility of aquifer 80 to 100 pts very high Susceptibility of well 60 to < 80 pts high 40 to < 60 pts medium Vulnerability of drinking water well < 40 pts 70 pts High **70**

Page 13 of 25

Chart 9. Contaminant risks for CRSD Kenny Lake High School (PWS No. 294002.001) - Heavy Metals, Cyanide and Other Inorganic Chemicals Contaminant risks initially assumed to be low. Current level of Evaluate the level of Contaminant risks contamination due to manbackground = 0 ptscontamination from made source(s) natural sources 0 pts NO or Is the concentration of Have heavy metals, UNKNOWN the contaminant cyanide or other inorganic increasing, decreasing, The reported chemicals been detected or staying the same? concentrations of lead in the source waters in and copper are likely recent sampling period(s)? attributed to the water Recent Metals Sampling Results (mg/L treatment/conveyance 12/31/2000 0.0597 system. No risk points Although other inorganic 12/31/1999 0.115 assigned since neither compounds have been detected analyte exceeded 100% Lead 12/31/2000 0.002 in previous sampling events, of the MCL in most 12/31/1999 ND arsenic, copper and lead have recent sampling event. reported the highest percent YES Arsenic 12/19/2002 0.00327 Increasing: risk up 1 - 10 pts MCL values for potential Decreasing: risk down 1 - 5 pts 12/17/2001 0.00201 + 0 pts source water contaminants in Same: risk unchanged the past 5 years. Maximum Contaminant The reported concentrations of Level (MCL) (mg/L) % of MCI lead and copper are likely attributed to the water Copper= 1.3 treatment/conveyance system. 0.015 13% Lead = No risk points assigned since Arsenic= 0.05 7% Risk due to existing man-Risk due to natural neither analyte exceeded 100% Existing contamination points based on linear sources made sources of the MCL in most recent interpolation of most recent detect [MCL = 50 pts; 3 pts 0 pts sampling event. detect = 0 ptsRisk due to existing contamination 3 pts Evaluate the level Was the source of of contamination contamination from man-made natural? sources

Page 14 of 25

Chart 9. Contaminant risks for CRSD Kenny Lake High School (PWS No. 294002.001) - Heavy Metals, Cyanide and Other Inorganic Chemicals



tisk Levels for Contami	k Levels for Contaminant Sources identified in Zones A, B and C							
	Zone A	Zones B&C	Total					
Very Highs(s)	0	0	0					
High(s)	0	0	0					
Medium(s)	1	0	1					
Low(s)	7	0	7					

	LOW 10 pts	MEDIUM 20 pts	HIGH 30 pts	VERY HIGH 40 pts
LOW	≥ 10 sources + 10 pts	≥ 10 sources + 5 pts	≥ 20 sources + 5 pts	
MEDIUM		≥ 2 sources + 5 pts	≥ 5 sources + 5 pts	≥ 10 sources + 5 pts
HIGH			≥ 1 source + 10 pts	≥ 2 sources + 10 pts
VERY HIGH				≥ 1 source + 10 pts

Matrix Score 20

Note: Septic systems, sewerlines, and roads are each assigned a risk ranking for each individual contaminant source in the CSI. The VA, however, counts these contaminant sources as a group and assigns a calculated number of either "lows" or "mediums" based on the density.



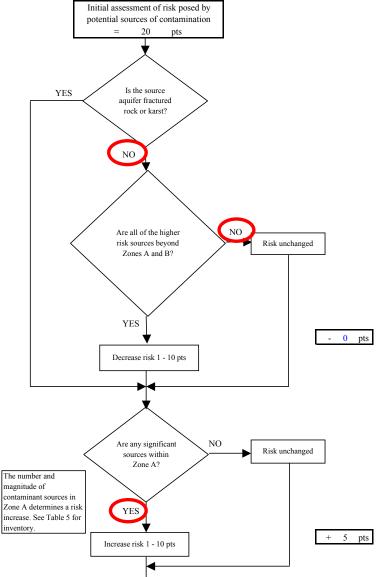



Chart 9. Contaminant risks for CRSD Kenny Lake High School (PWS No. 294002.001) - Heavy Metals, Cyanide and Other Inorganic Chemicals Existing Are there conditions 3 pts Risk unchanged upgrading risk? Risk due to existing Potential contamination 25 pts The number and magnitude of Risk posed by potential sources contaminant sources in of contamination with controls Contaminant Risk Zone D determines a YES 28 pts risk increase. See Table Contaminant risks 5 for inventory. 0 pts Increase risk 1 - 10 pts Risk posed by potential sources of contamination 25 pts Contaminant risks* *Truncate risk at 50 pts 28 Contaminant Risk Ratings Are there sufficient Medium NQ controls, conditions, Risk unchanged 40 to 50 pts very high or monitoring to 30 to < 40 pts warrant downgrading high risk? 20 to < 30 pts medium < 20 pts low YES 0 pts Decrease risk 1 - 10 pts Risk posed by potential sources of contamination with controls 25 pts

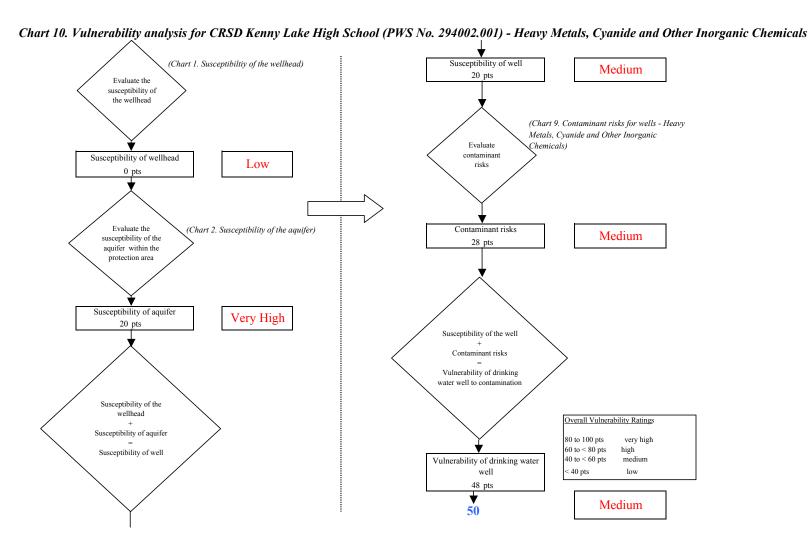


Page 17 of 25

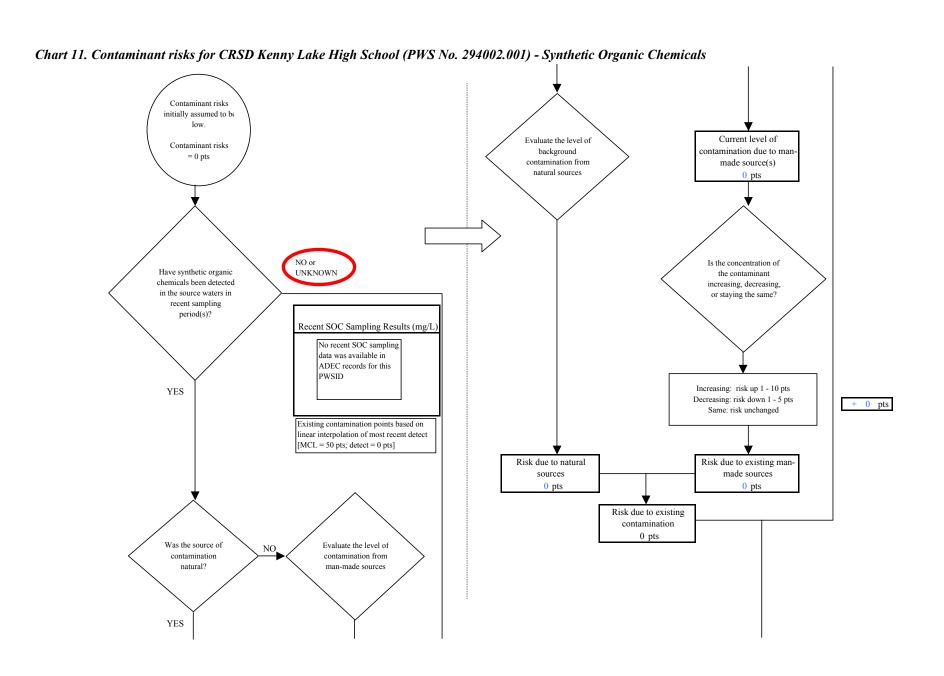

Page 18 of 25

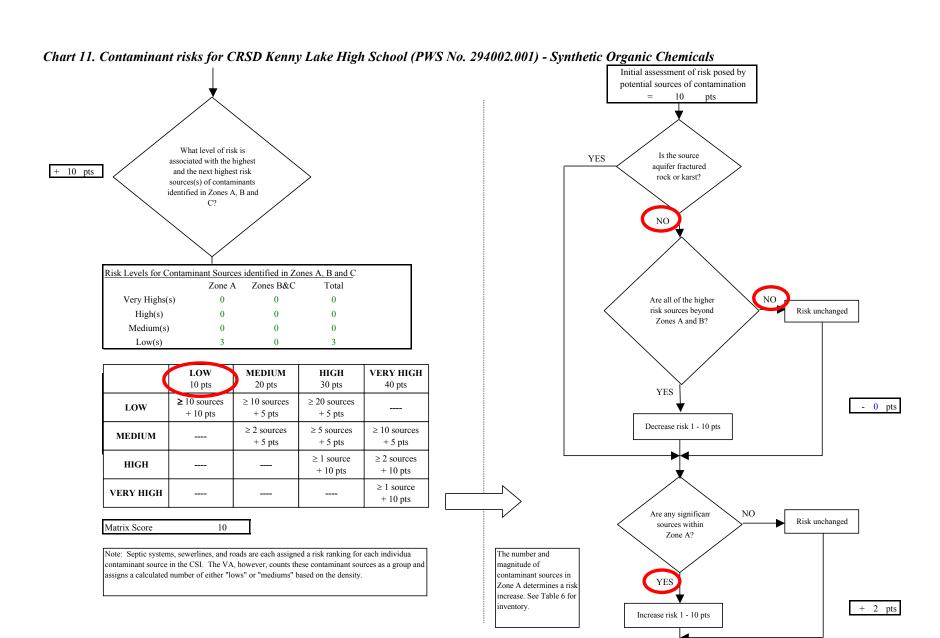

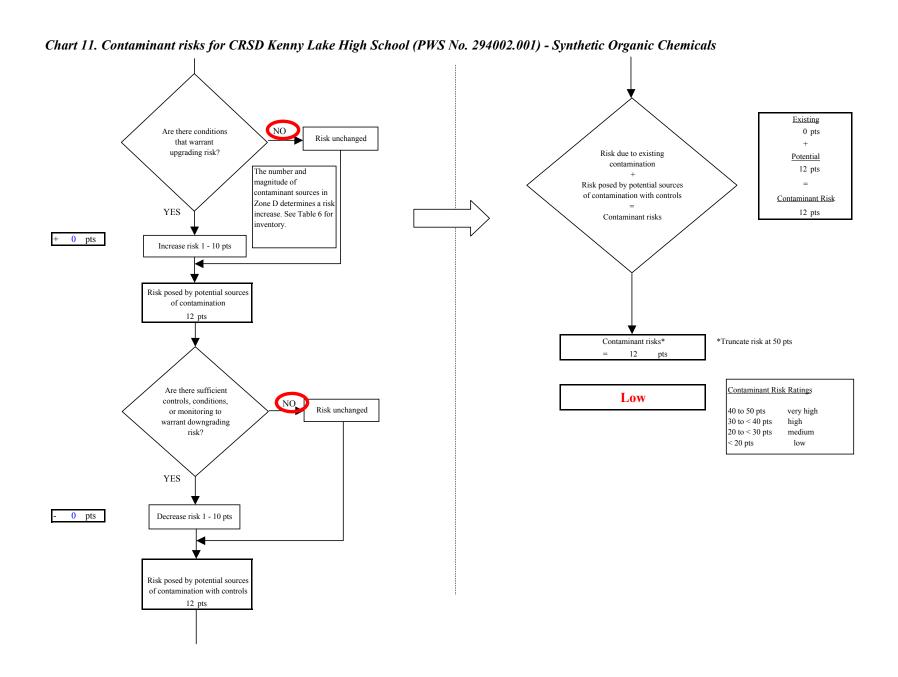

Page 20 of 25

Chart 12. Vulnerability analysis for CRSD Kenny Lake High School (PWS No. 294002.001) - Synthetic Organic Chemicals Susceptibility of well (Chart 1. Susceptibiltiy of the wellhead) Medium 20 pts Evaluate the susceptibility of the wellhead (Chart 11. Contaminant risks for wells -Synthetic Organic Chemicals) Evaluate contaminant Susceptibility of wellhead Low risks 0 pts Evaluate the (Chart 2. Susceptibility of the aquifer) Contaminant risks Low susceptibility of the 12 pts aquifer within the protection area Susceptibility of aquifer Very High 20 pts Susceptibility of the well Contaminant risks Vulnerability of drinking water well to contamination Susceptibility of the wellhead Overall Vulnerability Ratings Susceptibility of aquifer 80 to 100 pts very high 60 to < 80 pts high Susceptibility of well 40 to < 60 pts Vulnerability of drinking water medium < 40 pts low 32 pts Low **30**

Page 21 of 25

Chart 13. Contaminant risks for CRSD Kenny Lake High School (PWS No. 294002.001) - Other Organic Chemicals Contaminant risks initially assumed to be low. Current level of Evaluate the level of Contaminant risks background contamination due to man-= 0 ptscontamination from made source(s) natural sources NO or Is the concentration of Have other organic UNKNOWN the contaminant chemicals been detected increasing, decreasing, in the source waters in or staying the same? recent sampling period(s)? Recent OOC Sampling Results (mg/L) No recent OOC sampling data was available in ADEC records for this PWSID Increasing: risk up 1 - 10 pts YES Decreasing: risk down 1 - 5 pts + 0 pts Same: risk unchanged Existing contamination points based on linear interpolation of most recent detect [MCL = 50 pts; detect = 0 pts]Risk due to natural Risk due to existing mansources made sources 0 pts 0 pts Risk due to existing contamination 0 pts Was the source of Evaluate the level of NO. contamination from natural? man-made sources YES


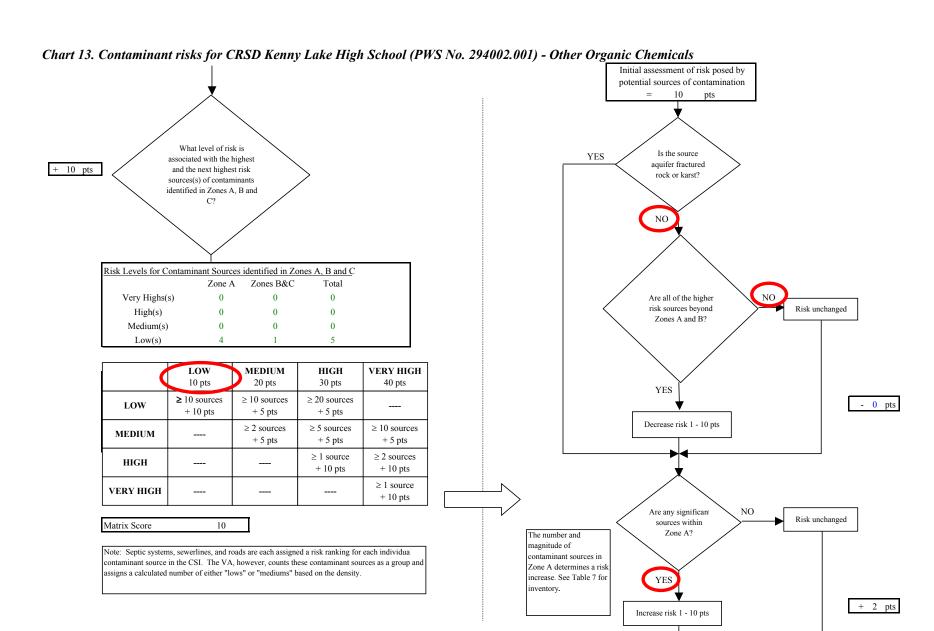


Chart 13. Contaminant risks for CRSD Kenny Lake High School (PWS No. 294002.001) - Other Organic Chemicals Existing Are there conditions 0 pts Risk unchanged that warrant upgrading risk? Risk due to existing Potential contamination 12 pts The number and magnitude of Risk posed by potential sources contaminant sources in of contamination with controls Contaminant Risk Zone D determines a risk YES 12 pts increase. See Table 7 for Contaminant risks inventory. 0 pts Increase risk 1 - 10 pts Risk posed by potential sources of contamination 12 pts *Truncate risk at 50 pts Contaminant risks* 12 Are there sufficient Contaminant Risk Ratings Low controls, conditions, NO. Risk unchanged or monitoring to 40 to 50 pts very high warrant downgrading 30 to < 40 pts high 20 to < 30 pts medium < 20 pts low YES 0 pts Decrease risk 1 - 10 pts Risk posed by potential sources of contamination with controls

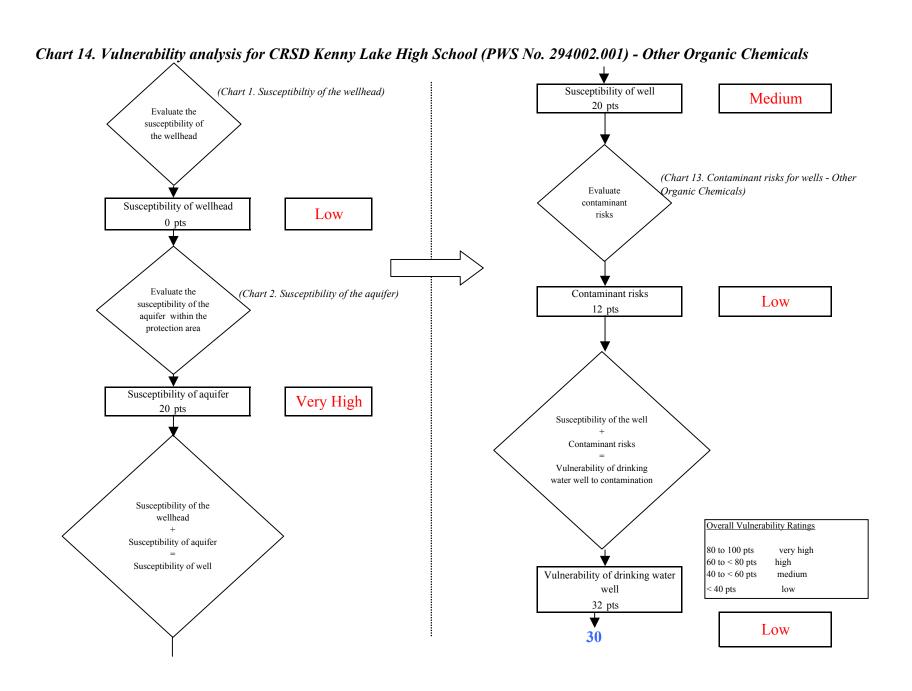

Page 25 of 25