



## **Source Water Assessment**

A Hydrogeologic Susceptibility and Vulnerability Assessment for the

## City of Kodiak Water System

(Pillar Creek Reservoir – Alternate Water Source)

Kodiak, Alaska

PWSID # 250011.004

March 2004

Drinking Water Protection Program Report #1466

Alaska Department of Environmental Conservation

## Source Water Assessment for the

## City of Kodiak Water System

(Pillar Creek Reservoir – Alternate Water Source)

Kodiak, Alaska

PWSID# 250011.004

March 2004

Drinking Water Protection Program Report #1466

The Drinking Water Protection Program (DWPP) is producing Source Water Assessments in compliance with the Safe Drinking Water Act Amendments of 1996. Each assessment includes a delineation of the source water area, an inventory of potential and existing contaminant sources that may impact the water, a risk ranking for each of these contaminants, and an evaluation of the potential vulnerability of these drinking water sources.

These assessments are intended to provide public water systems owners/operators, communities, and local governments with the best available information that may be used to protect the quality of their drinking water. The assessments combine information obtained from various sources, including the U.S. Environmental Protection Agency, Alaska Department of Environmental Conservation (ADEC), public water system owners/operators, and other public information sources. The results of this assessment are subject to change if additional data becomes available. It is anticipated this assessment will be updated every five years to reflect any changes in the vulnerability and/or susceptibility of public drinking water source. If you have any additional information that may affect the results of this assessment, please contact the Program Coordinator of DWPP, (907) 269-7521.

## **CONTENTS**

			Page				
SECTION  Executive Summary Drinking Water System And Area Overview City of Kodiak Drinking Water Protection Area Inventory of Potential and Existing Contaminant Sources Ranking of Contaminant Risks Vulnerability of the Drinking Water System References							
		TABLES					
TABLE		Definition of Zones Susceptibility of the Water Source Pillar Creek Reservoir Contaminant Risks Pillar Creek Reservoir Overall Vulnerability	1 3 3 3				
		APPENDICES					
APPENDIX	A.	City of Kodiak Drinking Water Protection Area (Map 1)					
	B.	Contaminant Source Inventory and Risk Rankings (Tables 1 - 6)					
	C.	Pillar Creek Reservoir Drinking Water Protection Area and Potential and Existing Contaminant Sources (Map 2)					
	D.	Vulnerability Analysis and Contaminant Risks (Charts 1 – 13)					

## Source Water Assessment for the City of Kodiak Drinking Water System (Pillar Creek Reservoir)

## **Drinking Water Protection Program Alaska Department of Environmental Conservation**

#### EXECUTIVE SUMMARY

The public water system for the City of Kodiak is a Class A water system that obtains water primarily from the Monashka Reservoir, approximately 5-miles north of Kodiak. Water collected at the Monashka Reservoir is piped to the Upper Reservoir, where it is stored before treatment and distribution. The Pillar Creek Reservoir is located approximately 1.5-miles northwest of Kodiak and is used as an alternative water source for the system. The Pillar Creek Reservoir drinking water protection area is approximately 4 square miles in size and received a susceptibility rating of "very high". A rating of high to very high is typical for all systems with surface water intakes. Potential and existing sources of the following contaminants were evaluated for the Source Water Assessment: bacteria and viruses, nitrates and/or nitrites, heavy metals, cyanide, and other inorganic chemicals, synthetic organic chemicals, volatile organic chemicals, and other organic chemicals. A gravel road crossing the southeast section of the protection area was identified as a potential source of contaminants for the drinking water source. This evaluation included all available water sampling data submitted to ADEC by the system operator. The samples may have been collected from either raw water or post-treated water. Combining the susceptibility of the surface water source with the contaminant risks, this water system has received a vulnerability rating of "medium" for all 6 contaminant categories. This assessment can be used as a foundation for local voluntary protection efforts as well as a basis for the continuous efforts on the part of the City of Kodiak to protect public health.

## DRINKING WATER SYSTEM AND AREA OVERVIEW

The City of Kodiak (Sec. 32, T027S, R019W, Seward Meridian), is located near the eastern tip of Kodiak Island in the Gulf of Alaska. It is 252 air miles south of Anchorage, a 45-minute flight, and is a 4-hour flight from Seattle. As of 2003, the current population of Kodiak is approximately 9,000 (8177 resident, 859 transient).

The City of Kodiak public water system is a Class A water system that operates year-round and obtains

water primarily from the Monashka Reservoir, approximately 5-miles north of Kodiak. The reservoir holds approximately 965 million gallons of water. Water from the reservoir is then pumped to the Upper Reservoir facility for storage before entering the City's water treatment process. Pillar Creek is used as an alternate backup source when needed.

Access to the Pillar Creek Reservoir area is restricted via gated maintenance roads. No development of any kind is known to have existed in either watershed area.

The climate of the Kodiak Islands has a strong marine influence. There is little or no freezing weather, moderate precipitation, occasional high winds, and frequent cloud cover and fog. Severe storms are common from December through February. Annual rainfall is 67 inches, and snowfall averages 78 inches. January temperatures range from 14 to 46; July temperatures vary from 39 to 76 (ADCED, 2003).

## CITY OF KODIAK DRINKING WATER PROTECTION AREA

Identifying the pathways most likely for surface contamination to reach water intake areas is the first step in determining the water system's risk. These are initially determined by looking at the drainage area contributing overland water flow to a surface water source intake. The entire drainage area is also known as the "drinking water protection area". Please refer to pages 10-11of the "Guidance Manual for Class A Public Water Systems" for additional information.

The protection area established for surface water sources by the ADEC is usually separated into three zones, limited by the watershed boundary. These zones correspond to the overland-flow distance that water travels to get to the source. The ADEC Drinking Water Protection Program's Technical Advisory Committee developed guidelines for derivation of these zones in 1998. The following is a summary of the three protection area zones:

#### Table 1. Definition of Zones

Zone	Definition
A	Areas within 1000-ft of lakes or streams
В	Areas within 1-mile of lakes or streams
C	The watershed boundary

The protection area for the Pillar Creek Reservoir and includes each of these Zones. Due to the small size of the overall protection area, Zones B and C cover the same region (See Map 1 of Appendix A).

## INVENTORY OF POTENTIAL AND EXISTING CONTAMINANT SOURCES

The Drinking Water Protection Program has completed an inventory of potential and existing sources of contamination within the Pillar Creek Reservoir protection area. This inventory was completed through a search of agency records and other publicly available information. There is a wide array of potential contamination sources to surface water. These contaminants are found within agricultural, residential, commercial, and industrial areas, but *can also occur within areas that have little or no development*.

For Class A public water system assessments, six categories of drinking water contaminants were inventoried. They include:

- Bacteria and viruses;
- Nitrates and/or nitrites;
- Volatile organic chemicals;
- Heavy metals, cyanide, and other inorganic chemicals;
- Synthetic Organic Chemicals; and
- Other Organic Chemicals.

Sources identified in the Pillar Creek Reservoir protection area are displayed on Map 2 of Appendix C and summarized in Table 1 of Appendix B.

#### RANKING OF CONTAMINANT RISKS

Once potential and existing sources of contamination have been identified, they are assigned a ranking according to what category and level of risk they represent. Ranking of contaminant risks for "potential" or "existing" sources of contamination is a function of the toxicity and the volume of specific contaminants associated with that source. Rankings include:

- Low;
- Medium;
- High; and
- Very High.

The time-of-travel for contaminants within the water is dependent on the physical and chemical characteristics

of each contaminant. Bacteria and Viruses are only inventoried in Zone A because of their short life span. Only "Very High" and "High" rankings are inventoried within Zones B and C due to the probability of contaminant dilution by the time the contaminants reach the water intake.

The remaining tables in Appendix B (if necessary) contain the ranking of potential and existing sources of contamination with respect to bacteria and viruses, nitrates and/or nitrites, volatile organic chemicals, heavy metals, cyanide, and other inorganic chemicals, synthetic organic chemicals, and other organic chemicals.

## VULNERABILITY OF THE DRINKING WATER SYSTEM

Vulnerability of a drinking water source to contamination is a combination of two factors:

- Surface Water Susceptibility; and
- Contaminant risks.

Appendix D contains 13 charts, which together form the 'Vulnerability Analysis' for the public drinking water Source Water Assessment. Chart 1 analyzes the 'Susceptibility of the Surface Water Source' to contamination by looking at the climate, terrain, and intake location. Chart 2 analyzes 'Contaminant Risks' for the drinking water source with respect to bacteria and viruses. The 'Contaminant Risks' portion of the analysis considers potential sources of contaminants as well as a review of contamination that has or may have occurred, but has not arrived or been detected at the intake area. Chart 3 contains the 'Vulnerability Analysis for Bacteria and Viruses', which is a composite score of the Vulnerability Analysis and the overall Susceptibility. Charts 4 through 13 repeat the Contaminant Risks and Vulnerability Analyses for nitrates and nitrites, volatile organic chemicals, heavy metals, cyanide, and other inorganic chemicals, synthetic organic chemicals, and other organic chemicals, respectively.

A score for the Surface Water Susceptibility of the source is reached by considering the properties of the water intake and the surrounding area. The derivation of this information is presented below and the data for this source is shown in Chart 1 of Appendix D.

Susceptibility of the Surface Water Source – always considered to be "high" (30 points)

+

Adequate Construction of the Intake (0 - 5 Points)

+

Runoff Potential Within Zone B (0 - 5 Points)

+

Dilution Capacity of the Surface Water (0 - 10 Points)

=

Natural Susceptibility (0 – 50 Points)

A ranking is assigned for the Surface Water Susceptibility according to the point score:

Surface Water Source Susceptibility Ratings

 $\begin{array}{ll} 40 \text{ to } 50 \text{ pts} & \text{Very High} \\ 30 \text{ to } < 40 \text{ pts} & \text{High} \end{array}$ 

Table 2. Susceptibility of the Water Source

	Score	Rating
Minimum Allowable	30	_
Susceptibility		
Intake Construction	0	
Adequate		
Runoff Potential	5	
Dilution Capacity	10	
Overall Susceptibility	45	Very High

For contaminants, risks to a drinking water source depend on the type, number or density, and distribution of the contaminant sources. The Contaminant Risk score has been derived from an examination of existing, and historical contamination sources that have been detected in the protection area through routine sampling. It also evaluates potential sources of contamination. Flow charts are used to assign a point score, and ratings are assigned in the same way as the susceptibility:

Contaminant Risk Ratings							
40 to 50 pts	Very High						
30 to < 40 pts	High						
20 to < 30 pts	Medium						
< 20 pts	Low						

Table 3 summarizes the Contaminant Risks for each category of drinking water contaminants.

Table 3. Pillar Creek Reservoir Contaminant Risks

Category	Score	Rating
Bacteria and Viruses	0	Low
Nitrates and/or Nitrites	0	Low
Volatile Organic Chemicals	0	Low
Heavy Metals, Cyanide, and		
Other Inorganic Chemicals	0	Low
Synthetic Organic Chemicals	0	Low
Other Organic Chemicals	0	Low

Finally, an overall vulnerability score is assigned for each contaminant type by combining each of the contaminant risk scores with the susceptibility score:

Susceptibility of the Surface Water Source

(0-50 points)

+

Contaminant Risks (0 - 50 points)

=

Vulnerability of the Drinking Water Source to Contamination (0 - 100).

Again, rankings are assigned according to a point score:

Overall Vulnerability Ratings								
80 to 100 pts	Very High							
60 to < 80 pts	High							
40 to < 60 pts	Medium							
< 40 pts	Low							

Table 4 contains the overall vulnerability scores and ratings for each of the six categories of drinking water contaminants. Note: scores are rounded off to the nearest five.

Table 4. Pillar Creek Reservoir Overall Vulnerability

Category	Score	Rating
Bacteria and Viruses	45	Medium
Nitrates and Nitrites	45	Medium
Volatile Organic Chemicals	45	Medium
Heavy Metals, Cyanide, and		
Other Inorganic Chemicals	45	Medium
Synthetic Organic Chemicals	45	Medium
Other Organic Chemicals	45	Medium

#### **Bacteria and Viruses**

The contaminant risk for bacteria and viruses is "low".

Coliforms (a bacteria) are found naturally in the environment and although they aren't necessarily a health threat, they are an indicator of other potentially harmful bacteria in the water, more specifically, fecal coliforms and E. coli which only come from human and animal fecal waste. Harmful bacteria can cause diarrhea, cramps, nausea, headaches, or other symptoms (EPA, 2003). Positive samples increase the overall vulnerability of the drinking water source, indicating that the source is susceptible to bacteria and virus contamination. Typically, coliform detection in raw water samples collected from surface water sources is normal. (See Chart 2 – Contaminant Risks for Bacteria and Viruses in Appendix D).

No recent bacteria sampling has been performed for the Pillar Creek Reservoir.

Roads could serve as possible sources of bacteria for the drinking water system. See Table 2 in Appendix D for a complete listing.

After combining the contaminant risk for bacteria and viruses with the natural susceptibility of the source, the overall vulnerability of the source to bacteria and virus contamination is considered "medium".

#### **Nitrates and Nitrites**

The contaminant risk for nitrates and nitrites is "low" (See Chart 4 - Contaminant Risks for Nitrates and/or Nitrites in Appendix D). Nitrates are very mobile, moving at approximately the same rate as water.

The Maximum Contaminant Level (MCL) for nitrates is 10 milligrams per liter (mg/L). The MCL is the maximum level of contaminant that is allowed to exist in drinking water and still be consumed by humans without harmful health effects (EPA, 2003).

No recent nitrate/nitrite sampling has been performed for the Pillar Creek Reservoir.

Possible sources of nitrate/nitrites are airfields or roads. See Table 3 in Appendix D for a complete listing.

After combining the contaminant risk for nitrates and nitrites with the natural susceptibility of the source, the overall vulnerability of the source to contamination is "medium".

#### **Volatile Organic Chemicals**

The contaminant risk for volatile organic chemicals is "very high" (See Chart 6 – Contaminant Risks for Volatile Organic Chemicals in Appendix D).

No recent VOC sampling has been performed for the Pillar Creek Reservoir.

Aside from being byproducts of the drinking water treatment process, possible sources of volatile organic chemicals include facilities with automobiles, fuel spills, roads, and airports. See Table 4 in Appendix D for a complete listing.

After combining the contaminant risk for volatile organic chemicals with the natural susceptibility of the source, the overall vulnerability of the source to contamination remains "high".

## Heavy Metals, Cyanide, and Other Inorganic Chemicals

The contaminant risk for heavy metals is "low".

No recent heavy metal sampling has been performed for the Pillar Creek Reservoir.

The most common source of these chemicals is the infrastructure of the distribution system following the treatment process.

After combining the contaminant risk for heavy metals with the natural susceptibility of the source, the overall vulnerability of the source to contamination is "medium".

See Table 5 in Appendix D for a listing of the identified possible sources of heavy metals, cyanide, and other organic chemicals in the Protection Area.

#### **Synthetic Organic Chemicals**

The contaminant risk for synthetic organic chemicals is "low". After combining the contaminant risk with the natural susceptibility of the source, the overall vulnerability to synthetic organic chemicals of the source is "low" (See Chart 11 – Contaminant Risks for Synthetic Organic Chemicals in Appendix D).

No recent SOC sampling has been performed for the Pillar Creek Reservoir.

See Table 6 in Appendix D for a listing of the identified possible sources of synthetic organic chemicals in the Protection Area.

#### **Other Organic Chemicals**

The contaminant risk for other organic chemicals is "low". After combining the contaminant risk with the natural susceptibility of the source, the overall vulnerability to other organic chemicals of the source is "medium" (See Chart 13 – Contaminant Risks for Other Organic Chemicals in Appendix D).

Review of the historical sampling data indicates that no other organic chemicals have been sampled recently.

See Table 7 in Appendix D for a listing of the identified possible sources of other organic chemicals in the Protection Area.

#### **Using the Source Water Assessment**

This assessment of contaminant risks can be used as a foundation for local voluntary protection efforts as well as a basis for the continuous efforts on the part of the City of Kodiak to protect public health. It is anticipated that Source Water Assessments will be updated every five years to reflect any changes in the vulnerability and/or susceptibility of the drinking water source.


#### **REFERENCES**

 $A lask a \ Department \ of \ Community \ and \ Economic \ Development \ (ADCED), \ 2003 \ [WWW \ document]. \ URL: \ http://www.dced.state.ak.us/cbd/commdb/CF\_COMDB.htm$ 

United States Environmental Protection Agency (EPA), 2003 [WWW document]. URL: http://www.epa.gov/safewater/mcl.html.

## **APPENDIX A**

City of Kodiak Drinking Water Protection Area Location Map (Map 1)

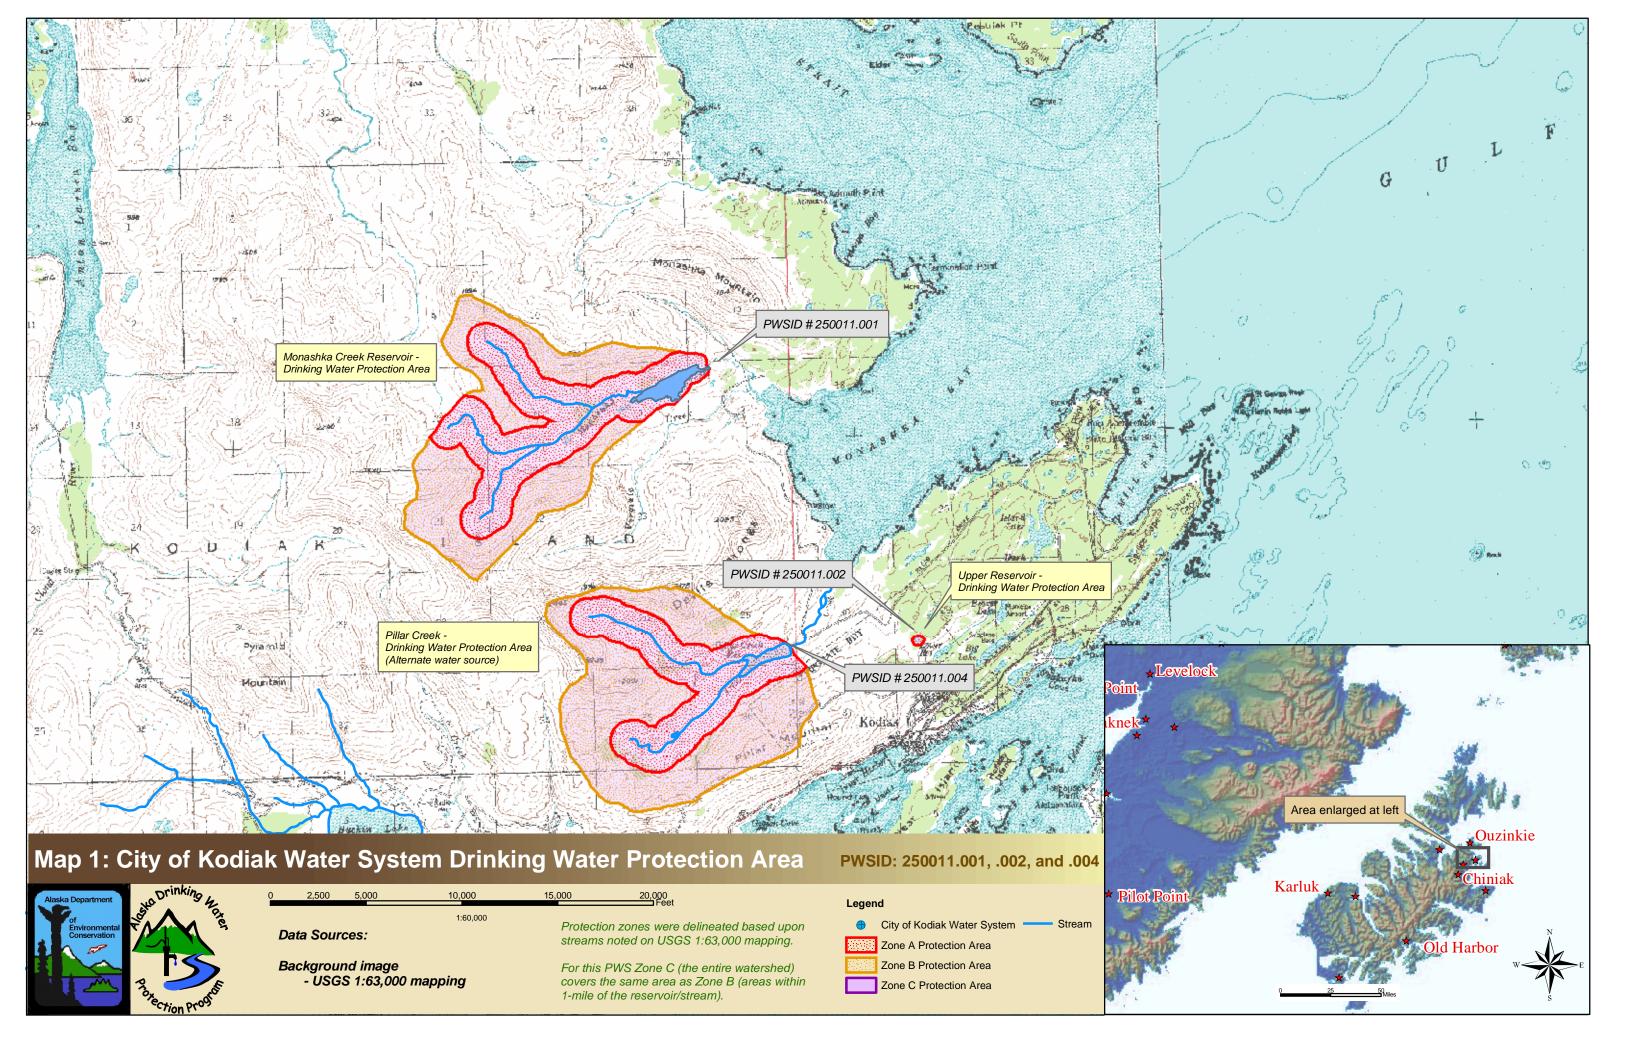

## APPENDIX B

Contaminant Source Inventory and Risk Rankings (Tables 1 - 6)

## Contaminant Source Inventory for City of Kodiak Water System - Pillar Creek

Contaminant Source Type	Contaminant Source ID	CS ID tag	Zone	Map Number	Comments
Highways and roads, dirt/gravel	X24	X24-1	В	2	From USGS 1:63,000 mapping

## Contaminant Source Inventory and Risk Ranking for City of Kodiak Water System - Pillar Creek Sources of Bacteria and Viruses

Contaminant Source Type	Contaminant Source ID	CS ID tag	Zone	Risk Ranking for Analysis	Map Number	Comments
Highways and roads, dirt/gravel	X24	X24-1	В	Low	2	From USGS 1:63,000 mapping

## Contaminant Source Inventory and Risk Ranking for City of Kodiak Water System - Pillar Creek Sources of Nitrates/Nitrites

Contaminant Source Type	Contaminant Source ID	CS ID tag	Zone	Risk Ranking for Analysis	Map Number	Comments
Highways and roads, dirt/gravel	X24	X24-1	В	Low	2	From USGS 1:63,000 mapping

## Contaminant Source Inventory and Risk Ranking for City of Kodiak Water System - Pillar Creek Sources of Volatile Organic Chemicals

Contaminant Source Type	Contaminant Source ID	CS ID tag	Zone	Risk Ranking for Analysis	Map Number	Comments
Highways and roads, dirt/gravel	X24	X24-1	В	Low	2	From USGS 1:63,000 mapping

## Contaminant Source Inventory and Risk Ranking for City of Kodiak Water System - Pillar Creek Sources of Heavy Metals, Cyanide and Other Inorganic Chemicals


Contaminant Source Type	Contaminant Source ID	CS ID tag	Zone	Risk Ranking for Analysis	Map Number	Comments
Highways and roads, dirt/gravel	X24	X24-1	В	Low	2	From USGS 1:63,000 mapping

## Contaminant Source Inventory and Risk Ranking for City of Kodiak Water System - Pillar Creek Sources of Other Organic Chemicals

Contaminant Source Type	Contaminant Source ID	CS ID tag	Zone	Risk Ranking for Analysis	Map Number	Comments
Highways and roads, dirt/gravel	X24	X24-1	В	Low	2	From USGS 1:63,000 mapping


### **APPENDIX C**


# Pillar Creek Reservoir Drinking Water Protection Area and Potential and Existing Contaminant Sources (Map 2)

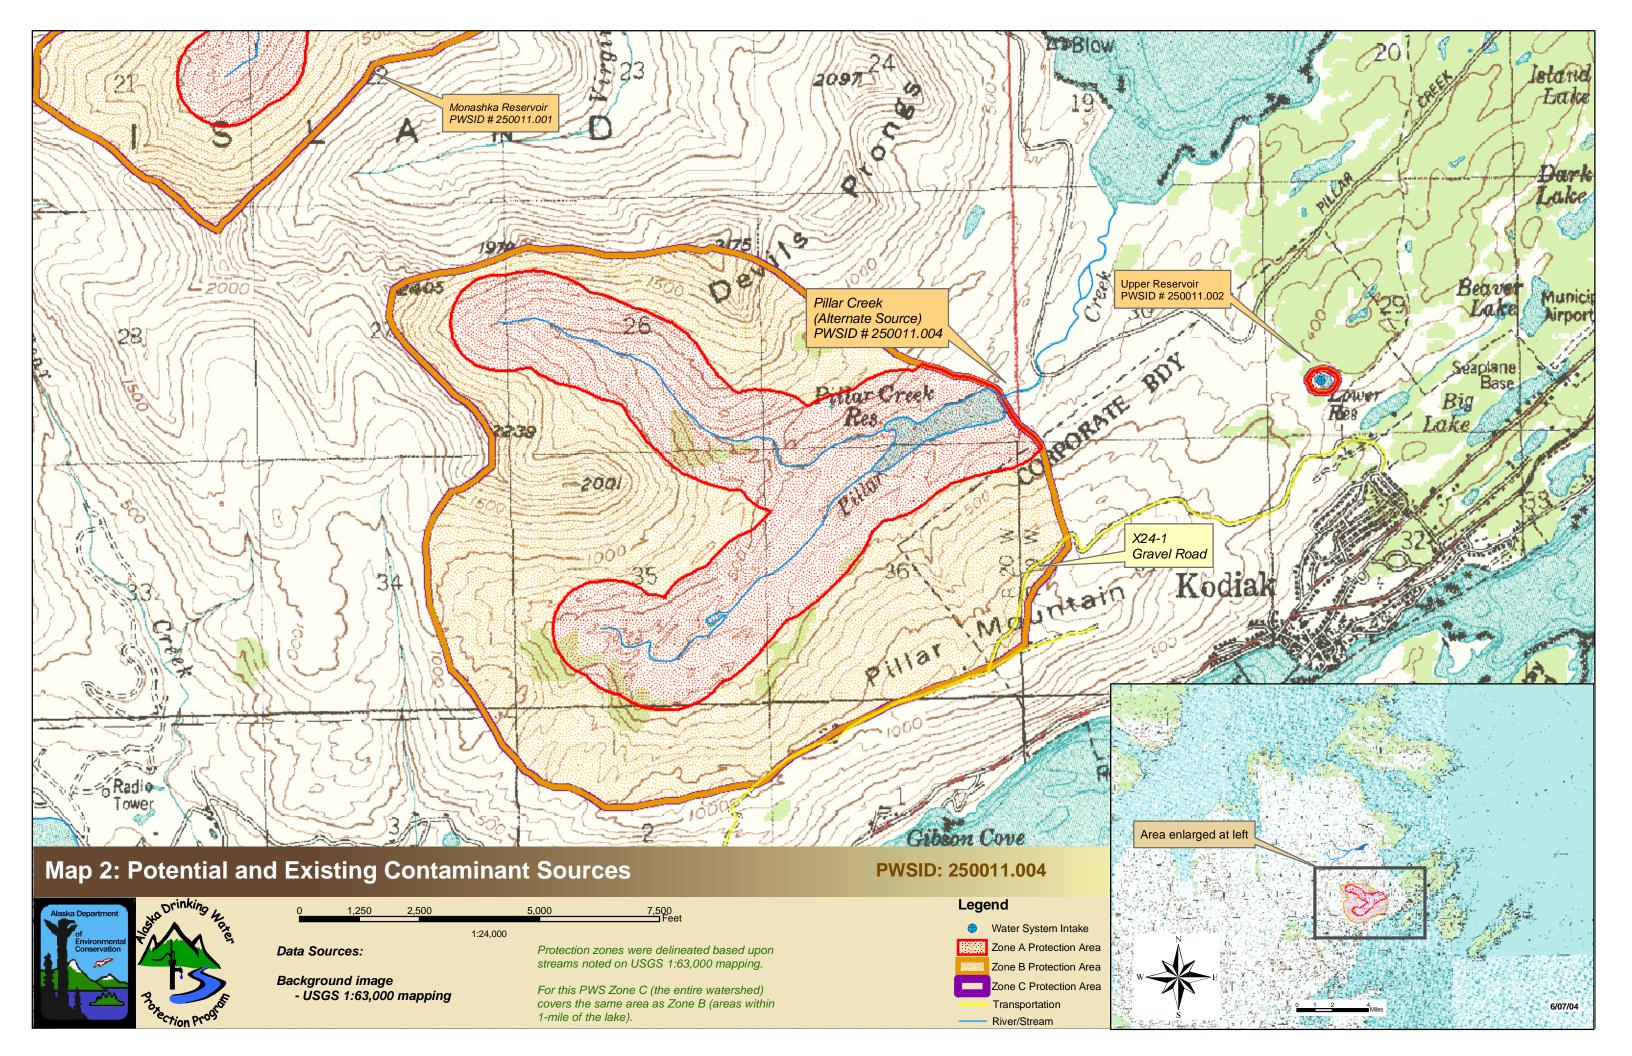


## APPENDIX D

# **Vulnerability Analysis and Contaminant Risks** (Charts 1-13)

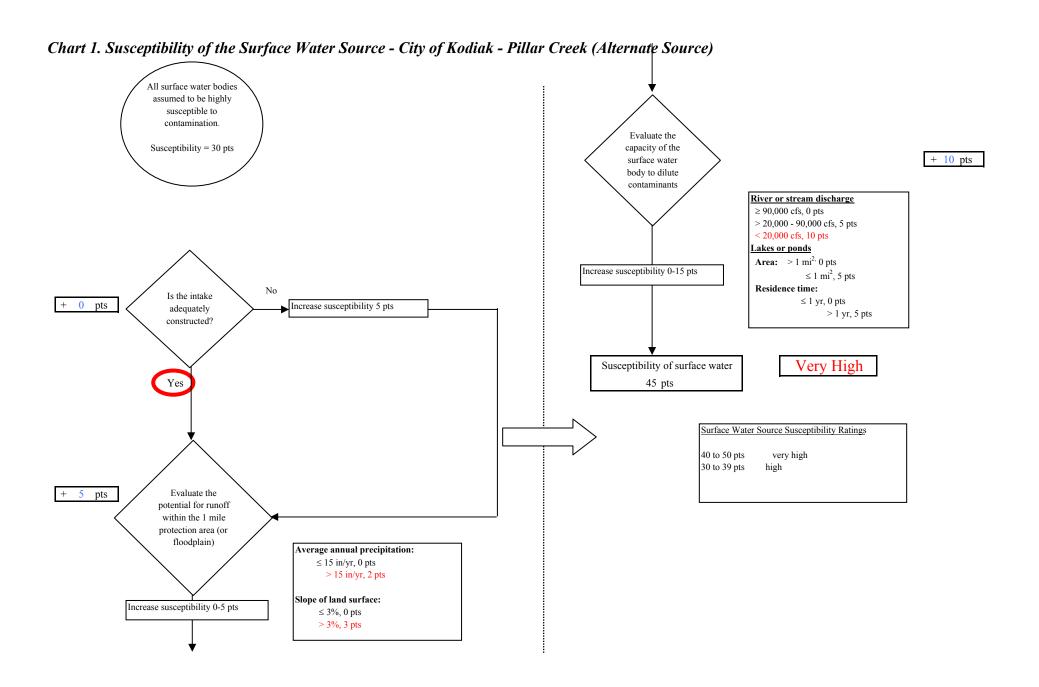


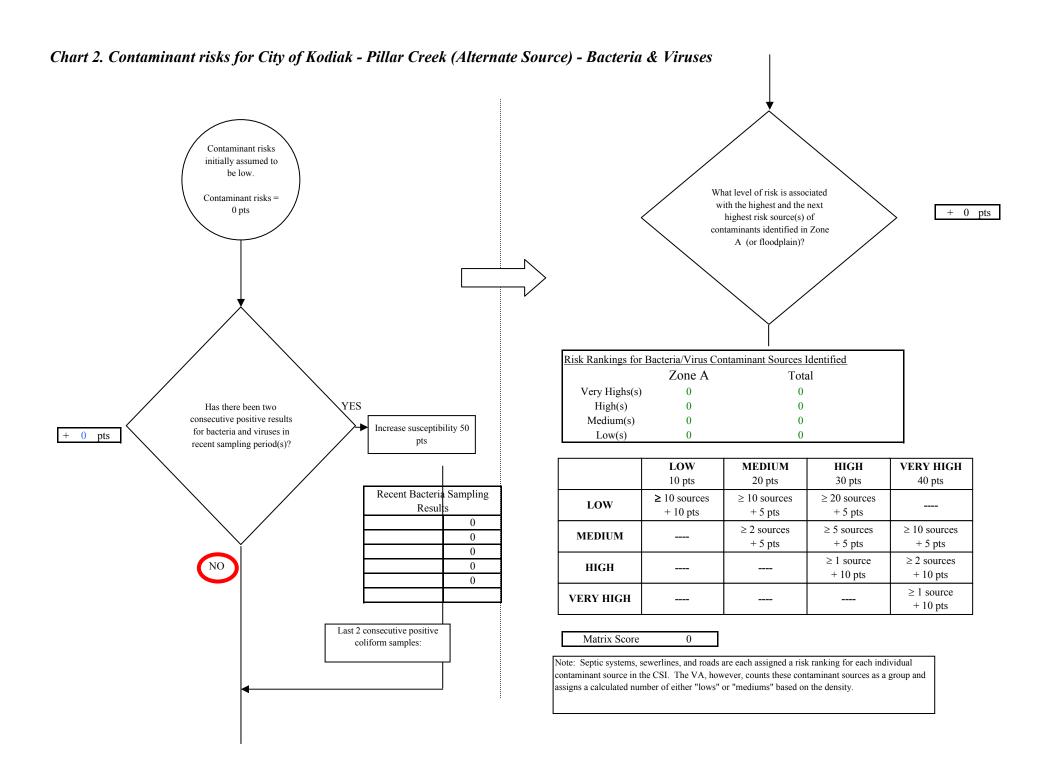

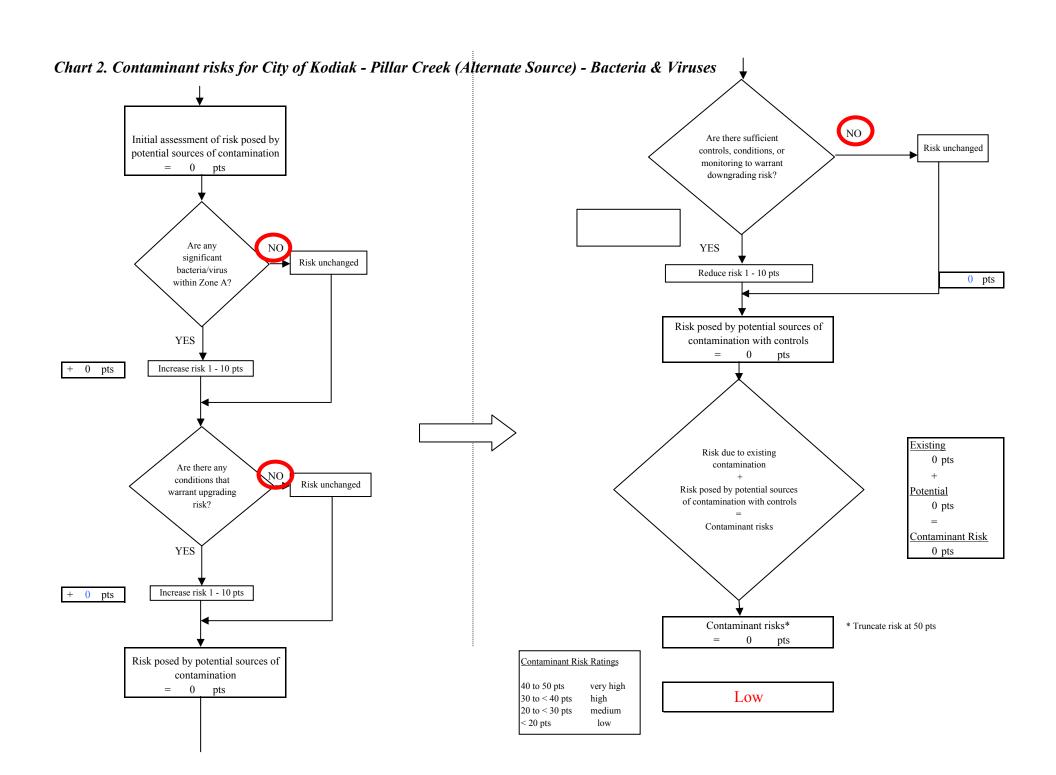


Page 3 of 27

Chart 3. Vulnerability analysis for City of Kodiak - Pillar Creek (Alternate Source) - Bacteria & Viruses (Chart 1. Susceptibiltiy of the surface water source) Evaluate the susceptibility of the surface water Susceptibility of the surface source water Contaminant risks Vulnerability of drinking water surface water to contamination Susceptibility of surface water Very High 45 pts (Chart 2. Contaminant risks for surface water -Vulnerability of drinking water Bacteria & Viruses) surface water Evaluate 45 pts contaminant risks **45** Medium Overall Vulnerability Ratings 80 to 100 pts very high Contaminant risks 60 to 79 pts high Low 40 to 59 pts medium 0 pts < 40 pts low

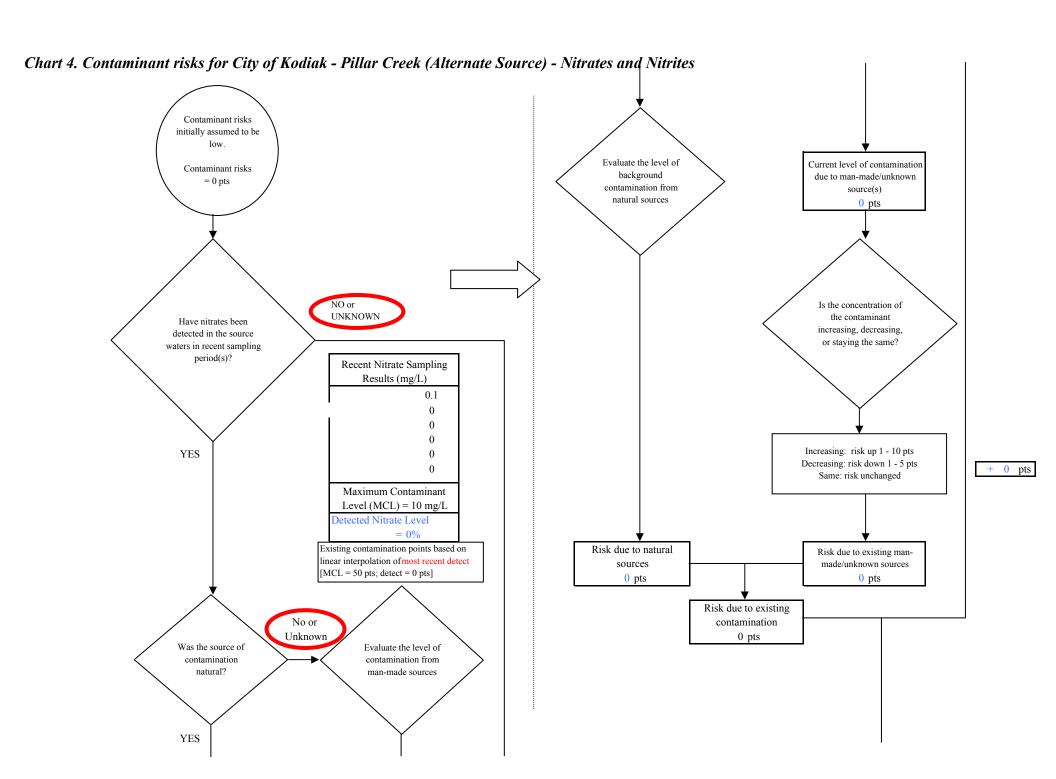

Page 5 of 27

Chart 4. Contaminant risks for City of Kodiak - Pillar Creek (Alternate Source) - Nitrates and Nitrites

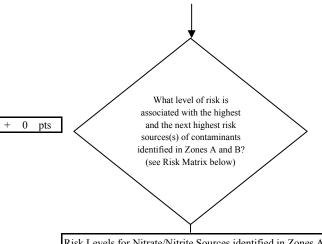


sk Levels for Nitrate/Nitrite Sources identified in Zones A and B				
	Zone A	Zone B	Total	
Very Highs(s)	0	0	0	
High(s)	0	0	0	
Medium(s)	0		0	
Low(s)	0		0	

	LOW 10 pts	MEDIUM 20 pts	HIGH 30 pts	VERY HIGH 40 pts
LOW	≥ 10 sources + 10 pts	≥ 10 sources + 5 pts	≥ 20 sources + 5 pts	
MEDIUM		≥ 2 sources + 5 pts	≥ 5 sources + 5 pts	≥ 10 sources + 5 pts
HIGH			≥ 1 source + 10 pts	≥ 2 sources + 10 pts
VERY HIGH				≥ 1 source + 10 pts

Matrix Score 0

Note: Septic systems, sewerlines, and roads are each assigned a risk ranking for each individual contaminant source in the CSI. The VA, however, counts these contaminant sources as a group and assigns a calculated number of either "lows" or "mediums" based on the density.

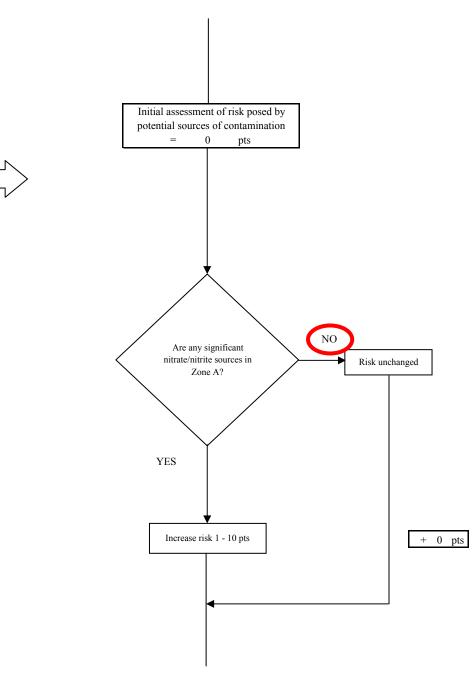



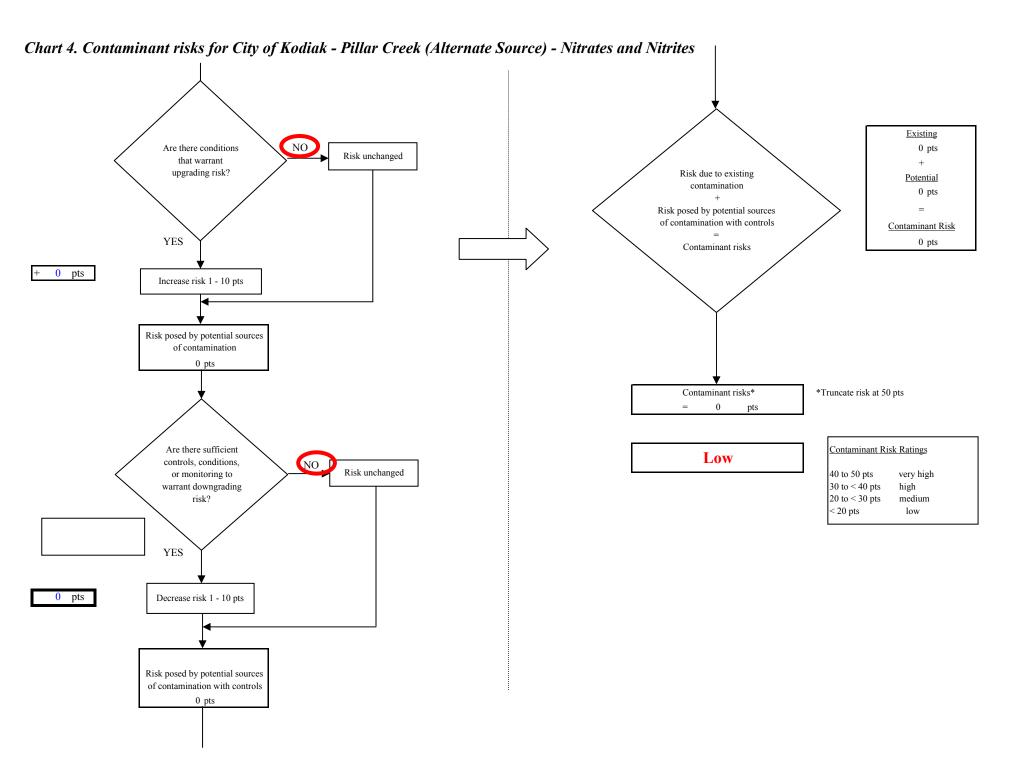


Chart 5. Vulnerability analysis for City of Kodiak - Pillar Creek (Alternate Source) - Nitrates and Nitrites (Chart 1. Susceptibiltiy of the surface water source) Evaluate the susceptibility of the surface water Susceptibility of the surface source water Contaminant risks Vulnerability of drinking water surface water to contamination Susceptibility of surface water Very High 45 pts (Chart 4. Contaminant risks for surface water -Vulnerability of drinking water Nitrates and Nitrites) surface water Evaluate 45 pts contaminant risks **45** Medium Overall Vulnerability Ratings 80 to 100 pts very high Contaminant risks 60 to 79 pts high Low 40 to 59 pts medium 0 pts < 40 pts low

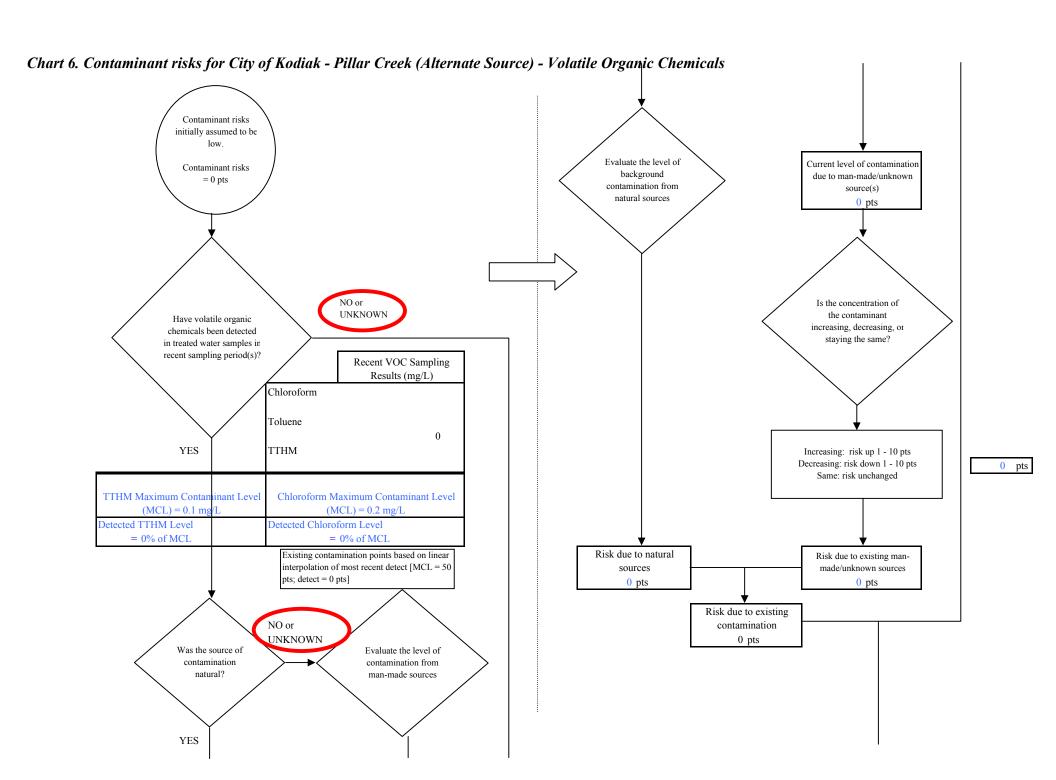


Page 9 of 27


Chart 6. Contaminant risks for City of Kodiak - Pillar Creek (Alternate Source) - Volatile Organic Chemicals

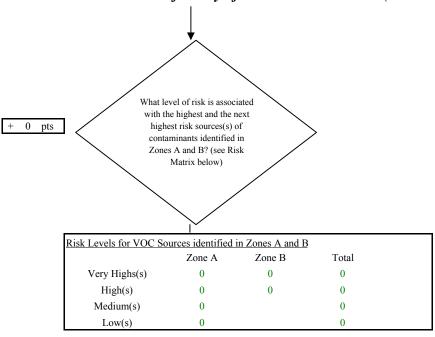

	LOW 10 pts	MEDIUM 20 pts	HIGH 30 pts	VERY HIGH 40 pts
LOW	≥ 10 sources + 10 pts	≥ 10 sources + 5 pts	≥ 20 sources + 5 pts	
MEDIUM		≥ 2 sources + 5 pts	≥ 5 sources + 5 pts	≥ 10 sources + 5 pts
HIGH			≥ 1 source + 10 pts	≥ 2 sources + 10 pts
VERY HIGH				≥ 1 source + 10 pts

Note: Septic systems, sewerlines, and roads are each assigned a risk ranking for each individual contaminant source in the CSI. The VA, however, counts these contaminant sources as a group and assigns a calculated number of either "lows" or "mediums" based on the density.

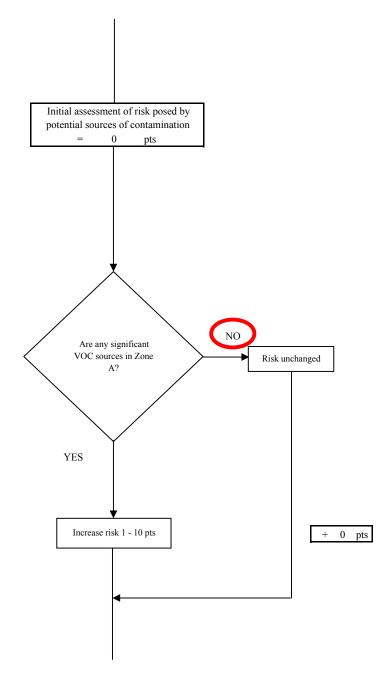

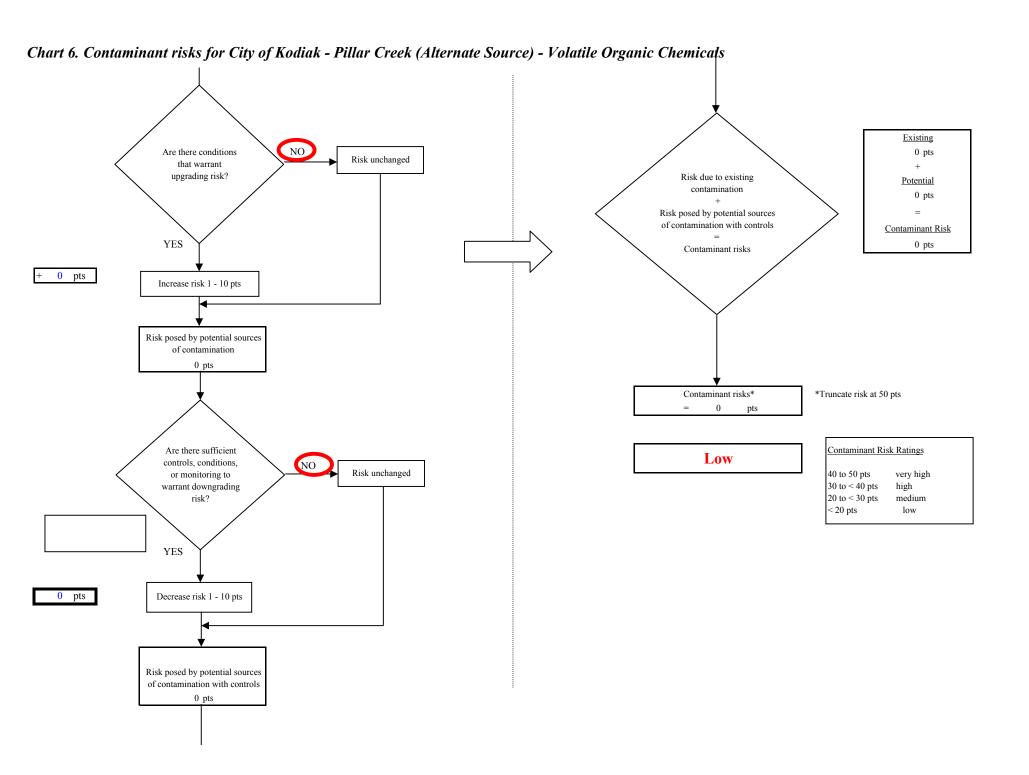


detect
%

> **MCL** 

List ~ past 5 years of sampling history.
Divide most recent detect by MCL to get "Detected ???? Level %".
This % is interpolated into points in the blue to the right of this page.

Need to move red circles to appropriate place. Formulas for calculating score are underneath the risk matrix.

Calculated by matrix shown in blue to the right.




Page 13 of 27

Risk matrix to the right of this page calculates points assigned for highs and very highs in zone C. Can also add points for other conditions.

Extra liners in landfills, extra leak protection for fuel storage tanks etc.....


Chart 7. Vulnerability analysis for City of Kodiak - Pillar Creek (Alternate Source) - Volatile Organic Chemicals (Chart 1. Susceptibiltiy of the surface water source) Evaluate the susceptibility of the surface water Susceptibility of the surface source water Contaminant risks Vulnerability of drinking water surface water to contamination Susceptibility of surface water Very High 45 pts (Chart 6. Contaminant risks for surface water -Volatile Organic Chemicals) Vulnerability of drinking water surface water Evaluate 45 pts contaminant risks **45** Medium Overall Vulnerability Ratings 80 to 100 pts very high Contaminant risks 60 to 79 pts high Low 40 to 59 pts medium 0 pts

< 40 pts low

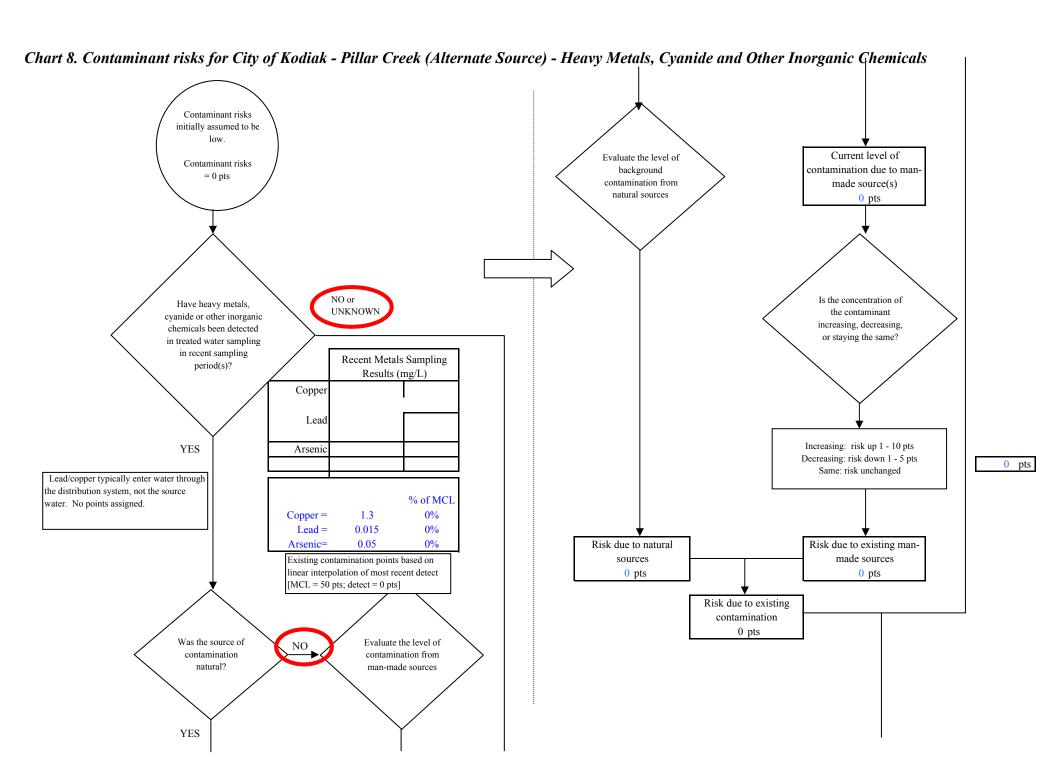

Page 16 of 27

Chart 8. Contaminant risks for City of Kodiak - Pillar Creek (Alternate Source) - Heavy Metals, Cyanide and Other Inorganic Chemicals

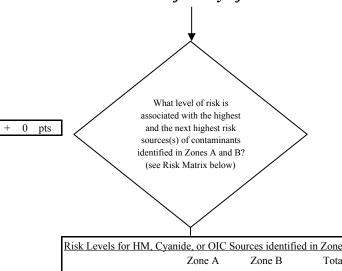



Risk Levels for HM, Cyanide, or OIC Sources identified in Zones A and B					
	Zone A	Zone B	Total		
Very Highs(s)	0	0	0		
High(s)	0	0	0		
Medium(s)	0		0		
Low(s)	0		0		

	LOW 10 pts	MEDIUM 20 pts	HIGH 30 pts	VERY HIGH 40 pts
LOW	≥ 10 sources + 10 pts	≥ 10 sources + 5 pts	≥ 20 sources + 5 pts	
MEDIUM		≥ 2 sources + 5 pts	≥ 5 sources + 5 pts	≥ 10 sources + 5 pts
HIGH			≥ 1 source + 10 pts	≥ 2 sources + 10 pts
VERY HIGH				≥ 1 source + 10 pts

Matrix Score	0


Note: Septic systems, sewerlines, and roads are each assigned a risk ranking for each individual contaminant source in the CSI. The VA, however, counts these contaminant sources as a group and assigns a calculated number of either "lows" or "mediums" based on the density.

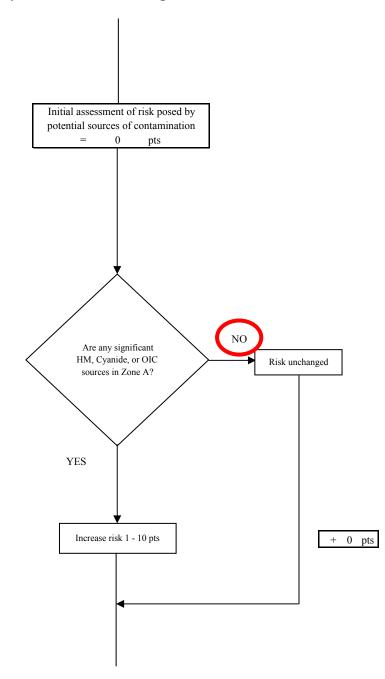


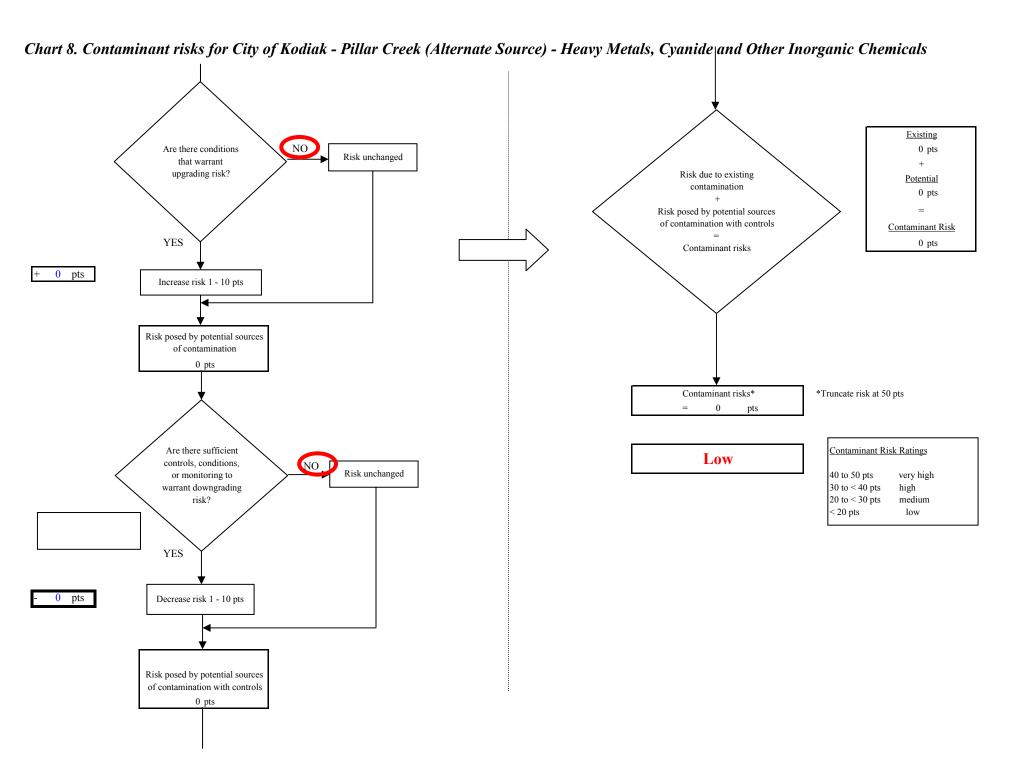

Page 18 of 27


Chart 9. Vulnerability analysis for City of Kodiak - Pillar Creek (Alternate Source) - Heavy Metals, Cyanide and Other Inorganic Chemic

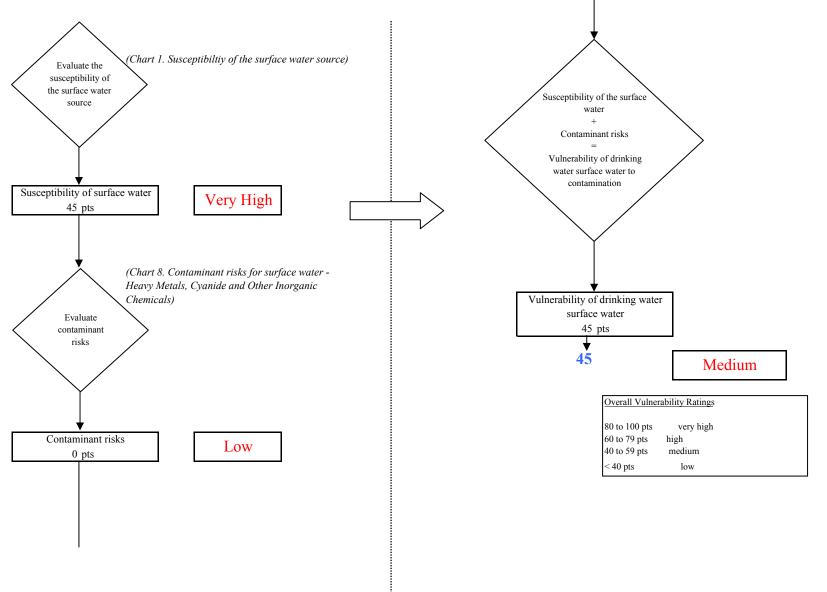

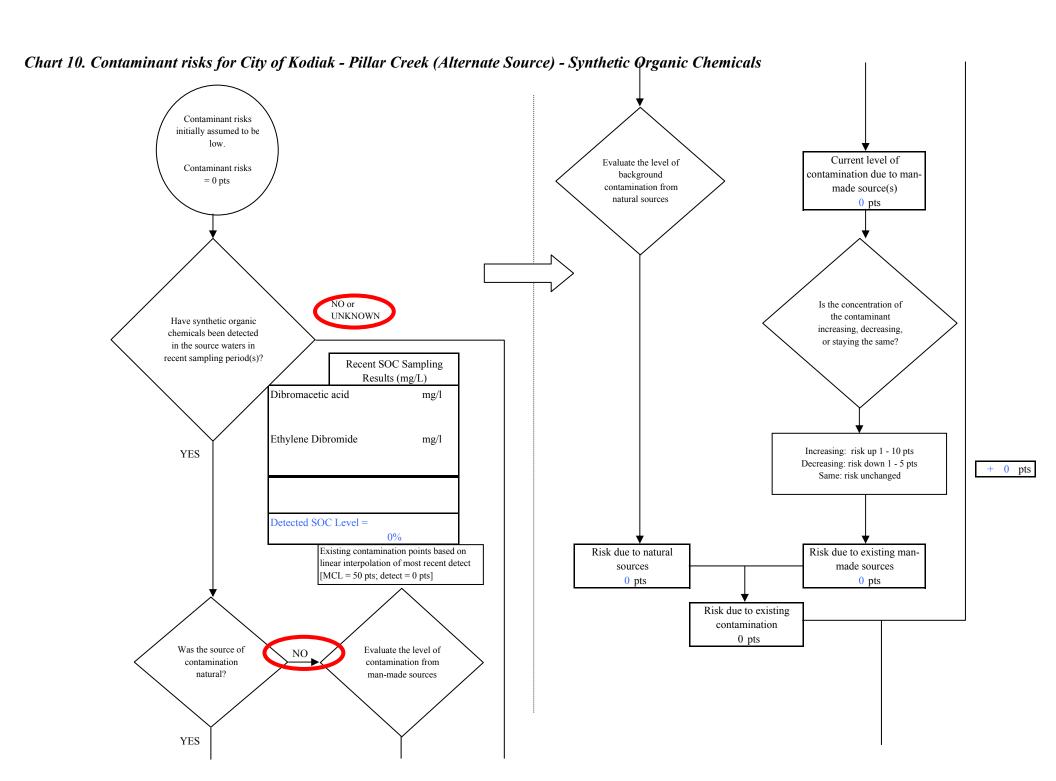

Page 20 of 27

Chart 10. Contaminant risks for City of Kodiak - Pillar Creek (Alternate Source) - Synthetic Organic Chemicals

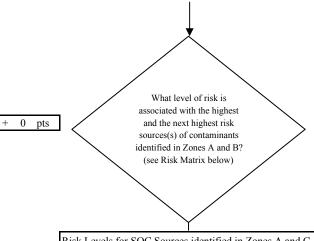



Risk Levels for SOC Sources identified in Zones A and C						
	Zone A	Zone B	Total			
Very Highs(s)	0	0	0			
High(s)	0	0	0			
Medium(s)	0	0	0			
Low(s)	0	0	0			

	LOW 10 pts	MEDIUM 20 pts	HIGH 30 pts	VERY HIGH 40 pts
LOW	≥ 10 sources + 10 pts	≥ 10 sources + 5 pts	≥ 20 sources + 5 pts	
MEDIUM		≥ 2 sources + 5 pts	≥ 5 sources + 5 pts	≥ 10 sources + 5 pts
HIGH			≥ 1 source + 10 pts	≥ 2 sources + 10 pts
VERY HIGH				≥ 1 source + 10 pts

Matrix Score 0
----------------


Note: Septic systems, sewerlines, and roads are each assigned a risk ranking for each individual contaminant source in the CSI. The VA, however, counts these contaminant sources as a group and assigns a calculated number of either "lows" or "mediums" based on the density.

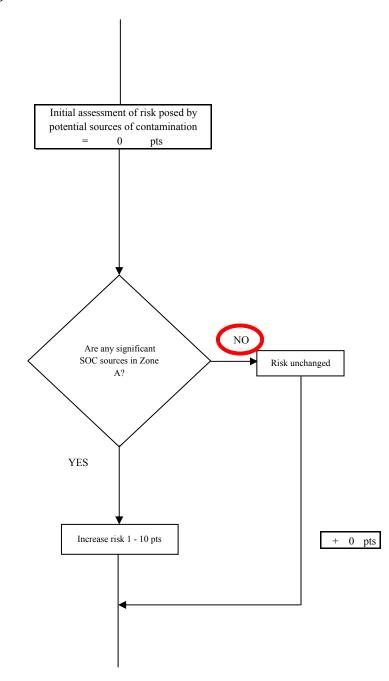

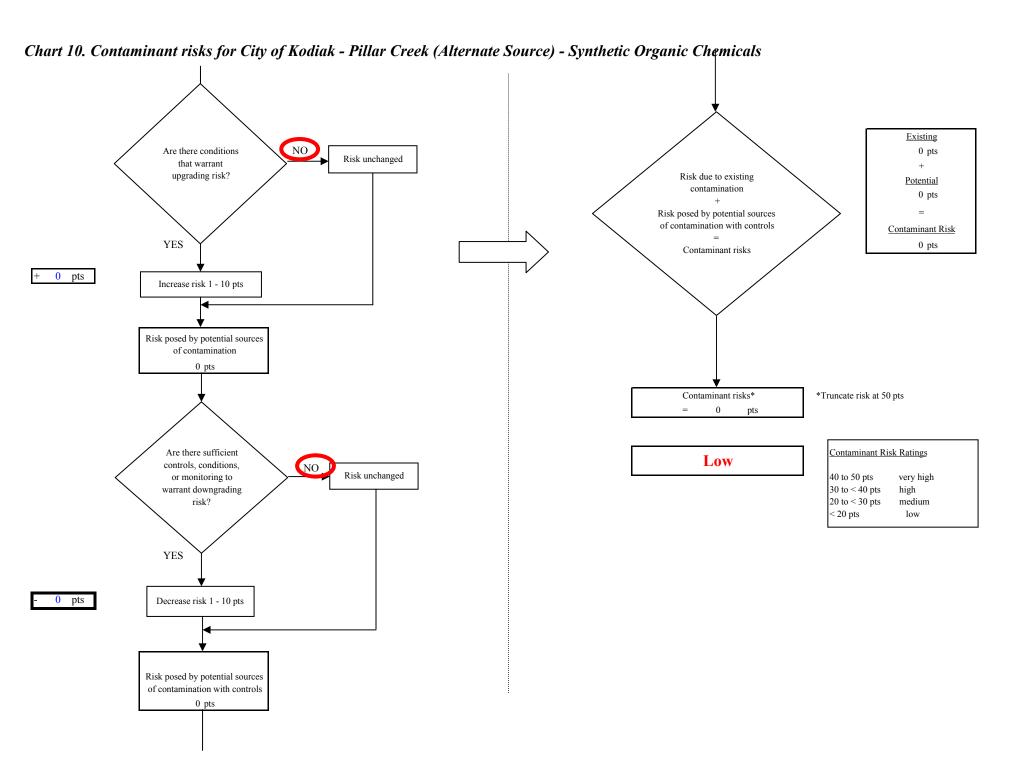


Page 22 of 27

Chart 11. Vulnerability analysis for City of Kodiak - Pillar Creek (Alternate Source) - Synthetic Organic Chemicals (Chart 1. Susceptibiltiy of the surface water source) Evaluate the susceptibility of the surface water Susceptibility of the surface source water Contaminant risks Vulnerability of drinking water surface water to contamination Susceptibility of surface water Very High 45 pts (Chart 10. Contaminant risks for surface water -Synthetic Organic Chemicals) Vulnerability of drinking water surface water Evaluate 45 pts contaminant risks **45** Medium Overall Vulnerability Ratings 80 to 100 pts very high Contaminant risks 60 to 79 pts high Low 40 to 59 pts medium 0 pts < 40 pts low

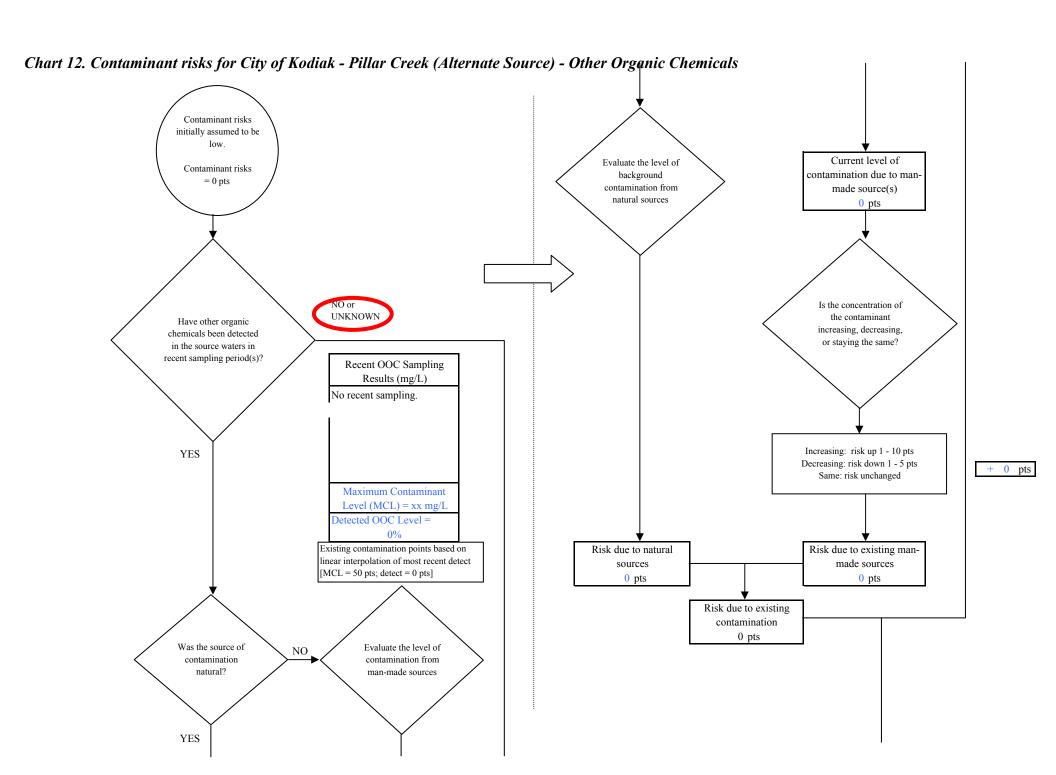

Page 24 of 27

Chart 12. Contaminant risks for City of Kodiak - Pillar Creek (Alternate Source) - Other Organic Chemicals

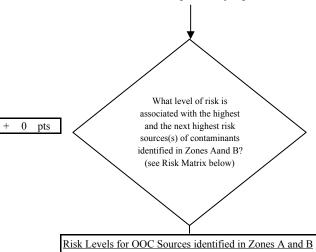



Risk Levels for OOC Sources identified in Zones A and B					
	Zone A	Zone B	Total		
Very Highs(s)	0	0	0		
High(s)	0	0	0		
Medium(s)	0	0	0		
Low(s)	0	0	0		

	LOW 10 pts	MEDIUM 20 pts	HIGH 30 pts	VERY HIGH 40 pts
LOW	≥ 10 sources + 10 pts	≥ 10 sources + 5 pts	≥ 20 sources + 5 pts	
MEDIUM		≥ 2 sources + 5 pts	≥ 5 sources + 5 pts	≥ 10 sources + 5 pts
HIGH			≥ 1 source + 10 pts	≥ 2 sources + 10 pts
VERY HIGH				≥ 1 source + 10 pts

Matrix Score 0

Note: Septic systems, sewerlines, and roads are each assigned a risk ranking for each individual contaminant source in the CSI. The VA, however, counts these contaminant sources as a group and assigns a calculated number of either "lows" or "mediums" based on the density.

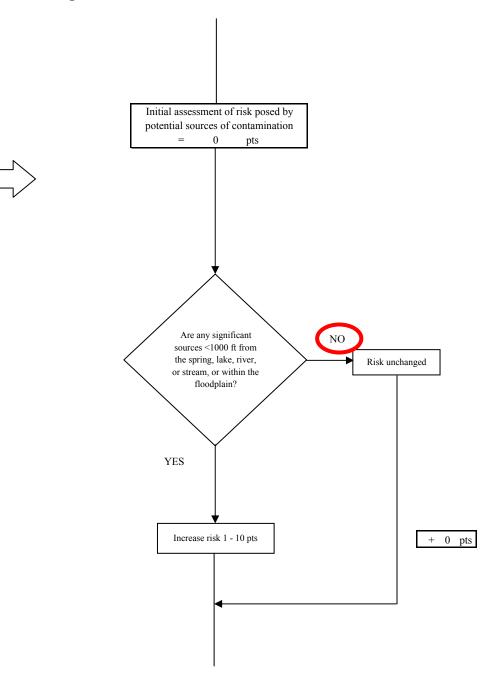

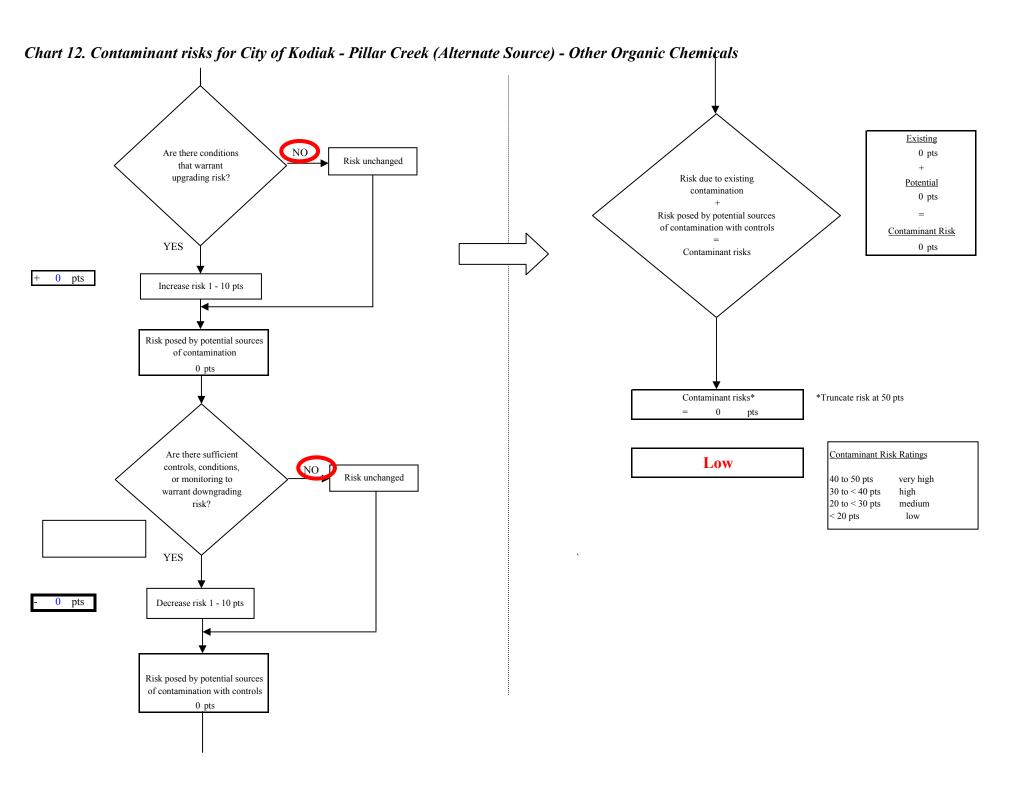

Page 26 of 27

Chart 13. Vulnerability analysis for City of Kodiak - Pillar Creek (Alternate Source) - Other Organic Chemicals (Chart 1. Susceptibiltiy of the surface water source) Evaluate the susceptibility of the surface water Susceptibility of the surface source water Contaminant risks Vulnerability of drinking water surface water to contamination Susceptibility of surface water Very High 45 pts (Chart 12. Contaminant risks for surface water -Other Organic Chemicals) Vulnerability of drinking water surface water Evaluate 45 pts contaminant risks **45** Medium Overall Vulnerability Ratings 80 to 100 pts very high Contaminant risks 60 to 79 pts high Low 40 to 59 pts medium 0 pts < 40 pts low