



---

# Source Water Assessment

A Hydrogeologic Susceptibility and  
Vulnerability Assessment for  
Lower Kuskokwim School District  
Kongiganak High School and Elementary  
Water System

Kongiganak, Alaska

PWSID #271245.001

February 2004

Drinking Water Protection Program Report #1127

Alaska Department of Environmental Conservation

# Source Water Assessment for Lower Kuskokwim School District Kongiganak High School and Elementary Water System

Kongiganak, Alaska

PWSID# 271245.001

January 2004

Drinking Water Protection Program Report #1127

The Drinking Water Protection Program (DWPP) is producing Source Water Assessments in compliance with the Safe Drinking Water Act Amendments of 1996. Each assessment includes a delineation of the source water area, an inventory of potential and existing contaminant sources that may impact the water, a risk ranking for each of these contaminants, and an evaluation of the potential vulnerability of these drinking water sources.

These assessments are intended to provide public water systems owners/operators, communities, and local governments with the best available information that may be used to protect the quality of their drinking water. The assessments combine information obtained from various sources, including the U.S. Environmental Protection Agency (EPA), the Alaska Department of Environmental Conservation (ADEC), public water system owners/operators, and other public information sources. The results of this assessment are subject to change if additional data becomes available. It is anticipated that this assessment will be updated every five years to reflect any changes in the vulnerability and/or susceptibility of public drinking water source. If you have any additional information that may affect the results of this assessment, please contact the Program Coordinator of DWPP, (907) 269-7521.

## CONTENTS

	Page
SECTION	
Executive Summary	1
Drinking Water System and Area Overview	1
Drinking Water Protection Area	2
Inventory of Potential and Existing Contaminant Sources	2
Ranking of Contaminant Risks	2
Vulnerability of the Drinking Water System	2
References	6

## TABLES

TABLE		2
	1. Definition of Zones	2
	2. Susceptibility of the Water Source	3
	3. Kongiganak School Water System Contaminant Risks	3
	4. Kongiganak School Water System Overall Vulnerability	4

## APPENDICES

APPENDIX	A.	Kongiganak School Drinking Water Protection Area (Map A)	
	B.	Contaminant Source Inventory and Risk Rankings (Table 1)	
	C.	Kongiganak School Drinking Water Protection Area and Potential and Existing Contaminant Sources (Map C)	
	D.	Vulnerability Analysis and Contaminant Risks (Charts 1 – 13)	

# Source Water Assessment for the Kongiganak High School & Elementary School Water System, Kongiganak, Alaska

---

## Drinking Water Protection Program Alaska Department of Environmental Conservation

### EXECUTIVE SUMMARY

The public water system for the Lower Kuskokwim School District (LKSD) Kongiganak High School and Elementary School, Kongiganak Alaska, is a Class A surface water system that obtains water from a rain catchment system located at the school. The untreated water is stored in a 100,000 storage tank. The water is filtered and chlorinated, stored in a 3,000 gallon tank, and then piped to the school. When the school's water supply runs short, they purchase raw water from the City of Kongiganak.

The Kongiganak School protection area is approximately three-tenths of a square mile in size and has received a susceptibility rating of **High**. *A rating of High to Very High is typical for all systems with surface water intakes.* Potential and existing sources of the following contaminants were evaluated for the Source Water Assessment: bacteria and viruses, nitrates and/or nitrites, heavy metals, cyanide, and other inorganic chemicals, synthetic organic chemicals, volatile organic chemicals, and other organic chemicals. No contaminant risk sources were identified in the protection area for this public water system.

This evaluation included all available water sampling data submitted to the Alaska Department of Environmental Conservation (ADEC) by the system operator. As stated previously, the samples were collected from post-treated water. Vulnerability ratings for the water system have been determined by combining the susceptibility of the surface water source with the contaminant risks. The system received a vulnerability rating of **Low** for all of the six contaminant categories: bacteria and viruses, nitrates and/or nitrites, volatile organic chemicals, heavy metals, cyanide, and other inorganic chemicals, synthetic organic chemicals, and other organic chemicals.

This assessment can be used as a foundation for local voluntary protection efforts as well as a basis for the continuous efforts on the part of the LKSD and

community surrounding Kongiganak School to protect public health.

### DRINKING WATER SYSTEM AND AREA OVERVIEW

Kongiganak School (Sec. 10, T003S, R086W, Seward Meridian) is located near the town of Kongiganak on the west shore of Kuskokwim Bay just west of the mouth of the Kuskokwim River. This Yup'ik Eskimo community is located approximately 70 miles southwest of Bethel and 450 miles west of Anchorage on the lower Yukon-Kuskokwim (Y-K) delta. Kongiganak School has seven teachers and 110 students enrolled in grades Kindergarten through 12<sup>th</sup>. The community of Kongiganak has a population of 368. Kongiganak's average annual precipitation is 22 inches, including approximately 43 inches of annual snowfall. Summer temperatures range from 41 to 57°F and winter temperatures range from 6 to 24°F.

The public water system is a Class A surface water system that obtains water from a rain catchment system located on the school's roof. The untreated water is stored in a 100,000 storage tank. The water is filtered and chlorinated, stored in a 3,000 gallon tank, and then piped to the school. When the school's water supply runs short, they purchase raw water from the City of Kongiganak.

The LKSD operates the school's water system and the Kongiganak Village Council operates the community water system and individuals haul water from the washeteria to their households. The residents use honeybuckets for sewage disposal (ADCED, 2003).

Puvurnaq Power Company provides electricity to the community and school. The facility is privately owned and operated. It is fueled by diesel. The Kongiganak Village Council provides honeybucket disposal services and operates the local landfill. (ADCED, 2003)

Information acquired from a September 1997 sanitary survey for the public water system indicated that the surface water intake (rain catchment system) is

adequately constructed. Average daily production for the system is unknown.

Kongiganak School is located on the Yukon-Kuskokwim (Y-K) Delta. The Y-K Delta is located on the southwest coast of Alaska and primarily consists of lowlands formed by the deposition of fluvial sediment from the Yukon and Kuskokwim Rivers.

The Y-K Delta topography is relatively flat and approximately 40% to 50% of the delta surface is wet (Alaska Geographic Society). The lower delta area generally receives about 20 inches of precipitation annually. Areas of both discontinuous and continuous permafrost are present on the Y-K Delta. Permafrost is often present within 10 feet of ground surface and varies in thickness from 15 feet to 600 feet thick (R&M, 1979b). Thaw bulbs generally persist around areas of standing and flowing water.

**KONGIGANAK SCHOOL DRINKING WATER PROTECTION AREA**

Identifying the pathways most likely for surface contamination to reach water intake areas is the first step in determining the water system’s risk. These pathways are initially determined by looking at the drainage area contributing overland water flow to a surface water source intake. The entire drainage area is also known as the “drinking water protection area.” Please refer to pages 10-11 of the “Guidance Manual for Class A Public Water Systems” for additional information.

The protection area established for surface water sources by the ADEC is usually separated into three zones. These zones correspond to the overland-flow distance that water travels to get to the source. The ADEC Drinking Water Protection Program’s Technical Advisory Committee developed guidelines for derivation of these zones in 1998. The following is a summary of the three protection area zones:

**Table 1. Definition of Zones**

<b>Zone</b>	<b>Definition</b>
A	Areas within 1000-ft of lakes or streams
B	Areas within 1-mile of lakes or streams
C	The watershed boundary

The protection area for the Kongiganak School water system is limited to the roof of the school and the holding tank (See Map A of Appendix A).

**INVENTORY OF POTENTIAL AND EXISTING CONTAMINANT SOURCES**

The Drinking Water Protection Program has completed an inventory of potential and existing sources of contamination within the Kongiganak School protection area. This inventory was completed through a search of agency records and other publicly available information. There is a wide array of potential contamination sources to surface water. These contaminants are found within agricultural, residential, commercial, and industrial areas, but can also occur within areas that have little or no development.

For Class A public water system assessments, six categories of drinking water contaminants were inventoried. They include:

- Bacteria and viruses;
- Nitrates and/or nitrites;
- Volatile organic chemicals;
- Heavy metals, cyanide, and other inorganic chemicals;
- Synthetic Organic Chemicals; and
- Other Organic Chemicals.

No potential contaminant sources were identified in the Kongiganak School protection area as displayed on Map C of Appendix C and in Table 1 of Appendix B.

**RANKING OF CONTAMINANT RISKS**

Once potential and existing sources of contamination have been identified, they are assigned a ranking according to what category and level of risk they represent. Ranking of contaminant risks for “potential” or “existing” sources of contamination is a function of the toxicity and the volume of specific contaminants associated with that source. Rankings include:

- Low;
- Medium;
- High; and
- Very High.

The time-of-travel for contaminants within the water is dependent on the physical and chemical characteristics of each contaminant. Bacteria and Viruses are only inventoried in Zone A because of their short life span. Only “Very High” and “High” rankings are inventoried within Zones B and C due to the probability of contaminant dilution by the time the contaminants reach the water intake.

As stated earlier, no potential contaminant sources were identified within the drinking water protection area for

this public water system (Table 1 of Appendix B). Due to the lack of potential contaminant sources, no additional Tables were included in Appendix B detailing potential contaminant sources for each of the six categories of drinking water contaminants.

**VULNERABILITY OF THE DRINKING WATER SYSTEM**

Vulnerability of a drinking water source to contamination is a combination of two factors:

- Surface Water Susceptibility and
- Contaminant risks.

Appendix D contains 13 charts, which together form the ‘Vulnerability Analysis’ for the public drinking water Source Water Assessment. Chart 1 analyzes the ‘Susceptibility of the Surface Water Source’ to contamination by looking at the climate, terrain, and intake location. Chart 2 analyzes ‘Contaminant Risks’ for the drinking water source with respect to bacteria and viruses. The ‘Contaminant Risks’ portion of the analysis considers potential sources of contaminants as well as a review of contamination that has or may have occurred, but has not arrived or been detected at the intake area. Chart 3 contains the ‘Vulnerability Analysis for Bacteria and Viruses,’ which is a composite score of the Vulnerability Analysis and the overall Susceptibility. Charts 4 through 13 repeat the Contaminant Risks and Vulnerability Analyses for nitrates and nitrites, volatile organic chemicals, heavy metals, cyanide, and other inorganic chemicals, synthetic organic chemicals, and other organic chemicals, respectively.

A score for the Surface Water Susceptibility of the source is reached by considering the properties of the water intake and the surrounding area. The derivation of this information is presented below and the data for this source is shown in Chart 1 of Appendix D.

$$\begin{array}{r}
 \text{Susceptibility of the Surface Water Source – always} \\
 \text{considered to be “high” (30 points)} \\
 + \\
 \text{Adequate Construction of the Intake (0 – 5 Points)} \\
 + \\
 \text{Runoff Potential Within Zone B (0 – 5 Points)} \\
 + \\
 \text{Dilution Capacity of the Surface Water (0 – 10 Points)} \\
 = \\
 \text{Natural Susceptibility} \\
 \text{(0 – 50 Points)}
 \end{array}$$

A ranking is assigned for the Surface Water Susceptibility according to the point score:

Surface Water Source Susceptibility Ratings	
40 to 50 pts	Very High
30 to < 40 pts	High

**Table 2. Susceptibility of the Water Source**

	Score	Rating
Minimum Allowable Susceptibility	30	
Intake Construction Adequate	0	
Runoff Potential	0	
Dilution Capacity	0	
<b>Overall Susceptibility</b>	<b>30</b>	<b>High</b>

For contaminants, risks to a drinking water source depend on the type, number or density, and distribution of the contaminant sources. The Contaminant Risk score has been derived from an examination of existing, and historical contamination sources that have been detected in the protection area through routine sampling. It also evaluates potential sources of contamination. Flow charts are used to assign a point score, and ratings are assigned in the same way as the susceptibility:

Contaminant Risk Ratings	
40 to 50 pts	Very High
30 to < 40 pts	High
20 to < 30 pts	Medium
< 20 pts	Low

Table 3 summarizes the Contaminant Risks for each category of drinking water contaminants.

**Table 3. Kongiganak School Contaminant Risks**

Category	Score	Rating
Bacteria and Viruses	0	Low
Nitrates and/or Nitrites	3	Low
Volatile Organic Chemicals	0	Low
Heavy Metals, Cyanide, and Other Inorganic Chemicals	0	Low
Synthetic Organic Chemicals	0	Low
Other Organic Chemicals	0	Low

Finally, an overall vulnerability score is assigned for each contaminant type by combining each of the contaminant risk scores with the susceptibility score:

$$\begin{array}{r}
 \text{Susceptibility of the Surface Water Source} \\
 (0 - 50 \text{ points}) \\
 + \\
 \text{Contaminant Risks (0 - 50 points)} \\
 = \\
 \text{Vulnerability of the} \\
 \text{Drinking Water Source to Contamination (0 - 100).}
 \end{array}$$

Again, rankings are assigned according to a point score:

Overall Vulnerability Ratings	
80 to 100 pts	Very High
60 to < 80 pts	High
40 to < 60 pts	Medium
< 40 pts	Low

Table 4 contains the overall vulnerability scores and ratings for each of the six categories of drinking water contaminants. Note: scores are rounded off to the nearest five.

**Table 4. Kongiganak School Overall Vulnerability**

Category	Score	Rating
Bacteria and Viruses	30	Low
Nitrates and Nitrites	35	Low
Volatile Organic Chemicals	30	Low
Heavy Metals, Cyanide, and Other Inorganic Chemicals	30	Low
Synthetic Organic Chemicals	30	Low
Other Organic Chemicals	30	Low

### Bacteria and Viruses

The contaminant risk for bacteria and viruses is **Low**. No contaminant risks sources for bacteria and viruses were identified in the protection area for this public water system.

Coliforms (a bacteria) are found naturally in the environment and although they aren't necessarily a health threat, they are an indicator of other potentially harmful bacteria in the water, more specifically, fecal coliforms and E. coli, which only come from human and animal fecal waste. Harmful bacteria can cause diarrhea, cramps, nausea, headaches, or other symptoms (EPA, 2003). Positive samples increase the overall

vulnerability of the drinking water source, indicating that the source is susceptible to bacteria and virus contamination. Typically, coliform detection in raw water samples collected from surface water sources is normal. (See Chart 2 – Contaminant Risks for Bacteria and Viruses in Appendix D).

Positive bacteria counts were detected in 1999 and 2001, however, both follow-up confirmation samples were negative.

After combining the contaminant risk for bacteria and viruses with the natural susceptibility of the source, the overall vulnerability of the source to bacteria and virus contamination remains **Low**.

### Nitrates and Nitrites

The contaminant risk for nitrates and nitrites is **Low** (See Chart 4 - Contaminant Risks for Nitrates and/or Nitrites in Appendix D). No contaminant risks sources for nitrates were identified in the protection area for this public water system. Nitrates are very mobile, moving at approximately the same rate as water.

The Maximum Contaminant Level (MCL) for nitrates is 10 milligrams per liter (mg/L). The MCL is the maximum level of contaminant that is allowed to exist in drinking water and still be consumed by humans without harmful health effects (EPA, 2003).

Sampling history for the water source indicates that low concentrations of nitrates (below the MCL) were detected in recent sampling events, but did not exceed the MCL. The low nitrate concentration is likely attributed to natural sources.

After combining the contaminant risk for nitrates and nitrites with the natural susceptibility of the source, the overall vulnerability of the source to contamination remains **Low**.

### Volatile Organic Chemicals

The contaminant risk for volatile organic chemicals is **Low** (See Chart 6 – Contaminant Risks for Volatile Organic Chemicals in Appendix D). No contaminant sources for volatile organic chemicals were identified in the protection area for this public water system.

Detectable concentrations of trihalomethane were reported in sampling events for this public water system. However, the detectable concentrations of trihalomethane reported were well below the MCL of 0.08 mg/L. Trihalomethanes are considered byproducts of the water treatment process and are not from the

source waters. Since the reported concentration of trihalomethane in the most recent sampling did not exceed the applicable MCLs, risk points were not retained.

After combining the contaminant risk for volatile organic chemicals with the natural susceptibility of the source, the overall vulnerability of the source to contamination remains **Low**.

### **Heavy Metals, Cyanide, and Other Inorganic Chemicals**

The contaminant risk for heavy metals is **Low**. No contaminant risks sources for heavy metals, cyanide, and other inorganic chemicals were identified in the protection area for this public water system.

Based on review of recent sampling records for this public water system, moderate levels of copper and cadmium have been detected. Copper and cadmium have been detected in recent sampling history, but have not exceeded their respective MCLs of 1.3 mg/L and 0.005 mg/L (see Chart 8 – Contaminant Risks for Heavy Metals, Cyanide, and Other Inorganic Chemicals in Appendix D).

The reported concentrations of copper and cadmium in recent sampling events are not likely to be representative of source water conditions. These two analytes are likely attributed to either the water treatment process or water distribution network; therefore, no risk points were assigned based on the presence of these analytes.

After combining the contaminant risk for heavy metals with the natural susceptibility of the source, the overall vulnerability of the source remains **Low**.

### **Synthetic Organic Chemicals**

The contaminant risk for synthetic organic chemicals is **Low**. No contaminant sources for synthetic organic

chemicals were identified in the protection area for this public water system.

Review of historical sampling data found no recent sampling results for synthetic organic chemical contaminants.

After combining the contaminant risk with the natural susceptibility of the source, the overall vulnerability to synthetic organic chemicals of the source remains **Low** (See Chart 11 – Contaminant Risks for Synthetic Organic Chemicals in Appendix D).

### **Other Organic Chemicals**

The contaminant risk for other organic chemicals is **Low**. No contaminant risks sources for other organic chemicals were identified in the protection area.

Review of the historical sampling data found no recent sampling results for other organic chemicals.

After combining the contaminant risk with the natural susceptibility of the source, the overall vulnerability to other organic chemicals of the source remains **Low** (See Chart 13 – Contaminant Risks for Other Organic Chemicals in Appendix D).

### **Using the Source Water Assessment**

This assessment of contaminant risks can be used as a foundation for local voluntary protection efforts as well as a basis for the continuous efforts on the part of LKSD and the community surrounding Kongiganak School to protect public health. It is anticipated that Source Water Assessments will be updated every five years to reflect any changes in the vulnerability and/or susceptibility of the drinking water source.



## REFERENCES

Alaska Department of Community and Economic Development (ADCED), 2003 [WWW document]. URL: [http://www.dced.state.ak.us/cbd/commdb/CF\\_COMDB.htm](http://www.dced.state.ak.us/cbd/commdb/CF_COMDB.htm)

Alaska Geographic Society, 1979, The Yukon Kuskokwim Delta. Alaska Geographic, v. 6, no. 1, 95 p.


R&M Consultants, Inc., 1979b, Lower Kuskokwim School District School Site Investigation for Tununak, Alaska.

United States Environmental Protection Agency (EPA), 2003 [WWW document]. URL: <http://www.epa.gov/safewater/mcl.html>.

## **APPENDIX A**

### **Drinking Water Protection Area Location Map (Map A)**

**Public Water Well System for PWS #271245.001 LKSD Kongiganak HS & Elem.  
Showing Potential and Existing Sources of Contamination**

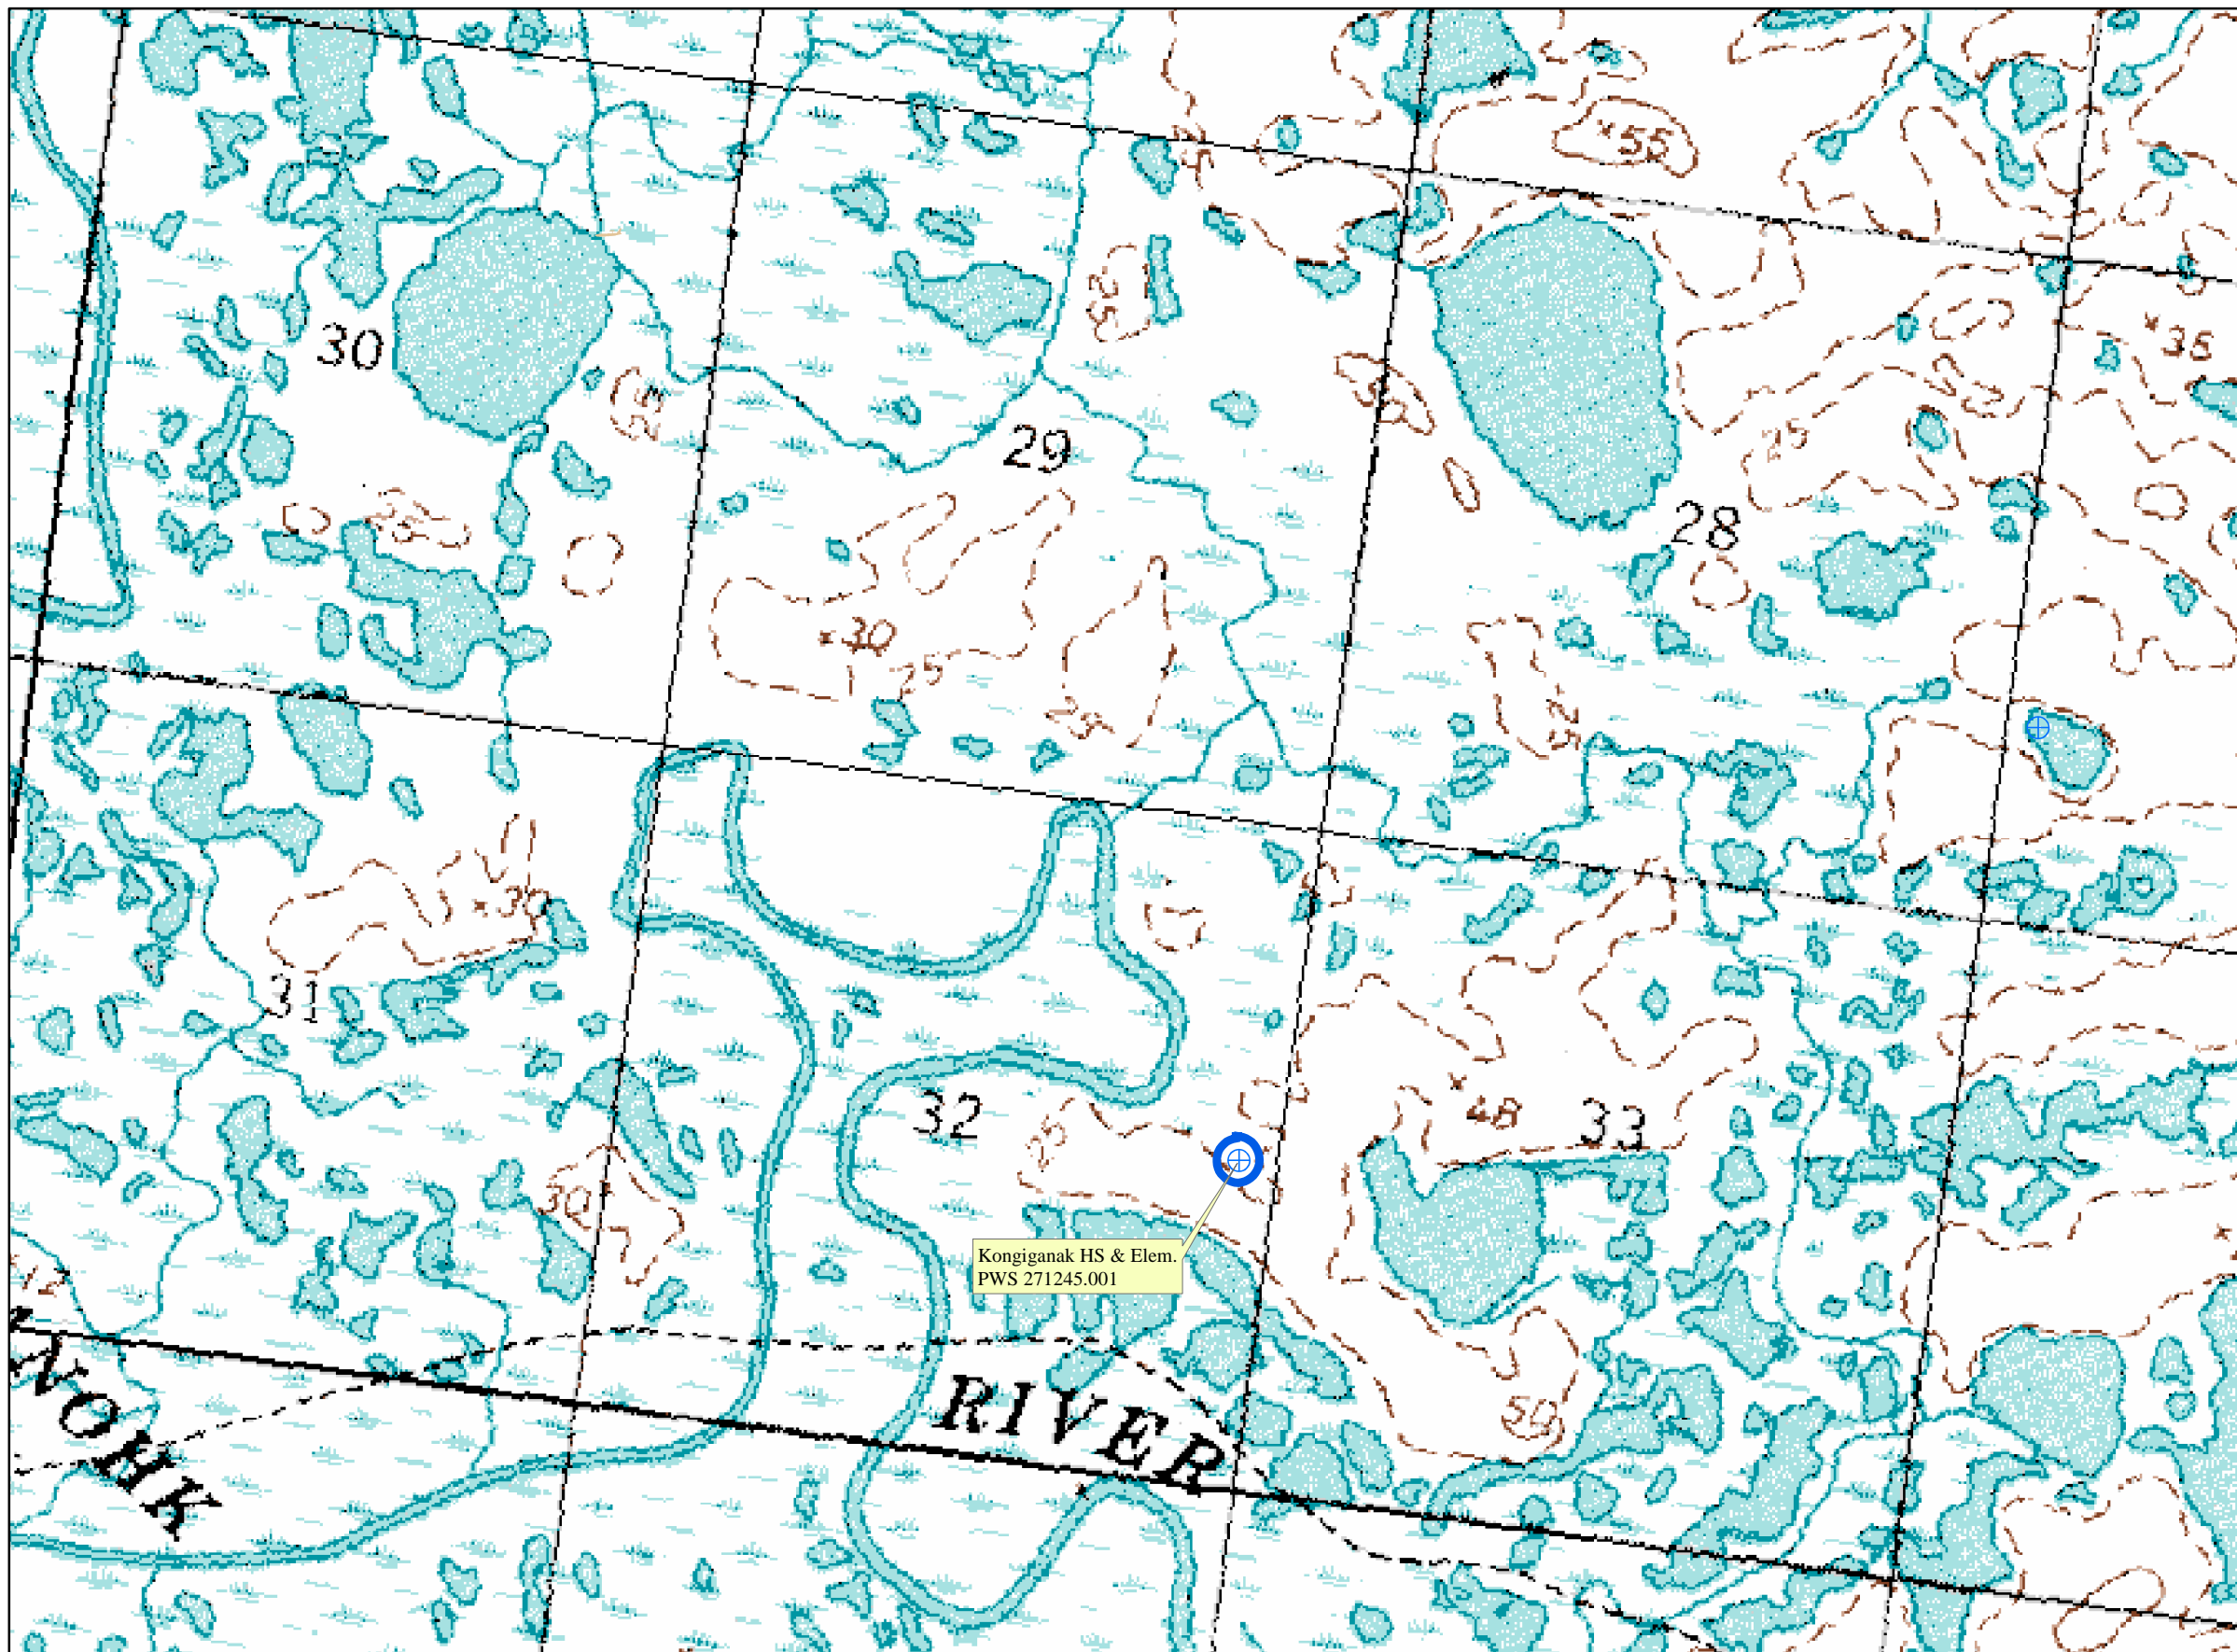

**LEGEND**

- Public Water System Well
  - Groundwater Protection Zones**
  - Zone C Protection Area—5 Years Travel Time
  - Hydrography/Physical**
  - Parcels
  - Stream
  - Lake or Pond
  - Contours
  - Transportation**
  - Primary Route (Class 1)
  - Secondary Route (Class 2)
  - Road (Class 3)
  - Road (Class 4)
  - Road (Class 5, Four-wheel drive)
- Rain runoff from school is primary water source. No reported existing or potential contaminant sources found within the Protection Zone.




Data Sources:  
Contaminant Sources, Public Water System Wells, Contours  
Alaska Department of Environmental Conservation (ADEC)

Critical Facilities, Federal Emergency Management Agency (FEMA)

All other data:  
United States Geological Survey (USGS)

Drinking Water Protection Areas based on "Alaska Drinking Water Protection Program - Guidance Manual for Class B Public Water Systems" published by ADEC

URS Corporation does not guarantee the accuracy or validity of the data provided.

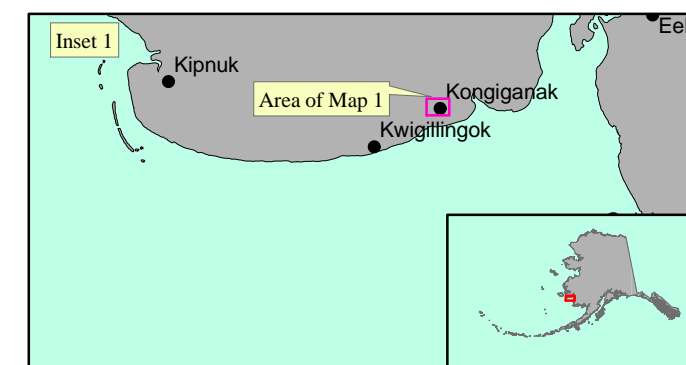

## **APPENDIX B**

### **Contaminant Source Inventory and Risk Rankings (Table 1)**

**Table 1**

***Contaminant Source Inventory for  
LKSD Kongiganak HS & Elem.***


***PWSID 271245.00.***

<b><i>Contaminant Source Type</i></b>	<b><i>Contaminant Source ID</i></b>	<b><i>CS ID tag</i></b>	<b><i>Zone</i></b>	<b><i>Map Number</i></b>	<b><i>Comments</i></b>
Water supply wells	W09	W09-01	A	C	Water supply







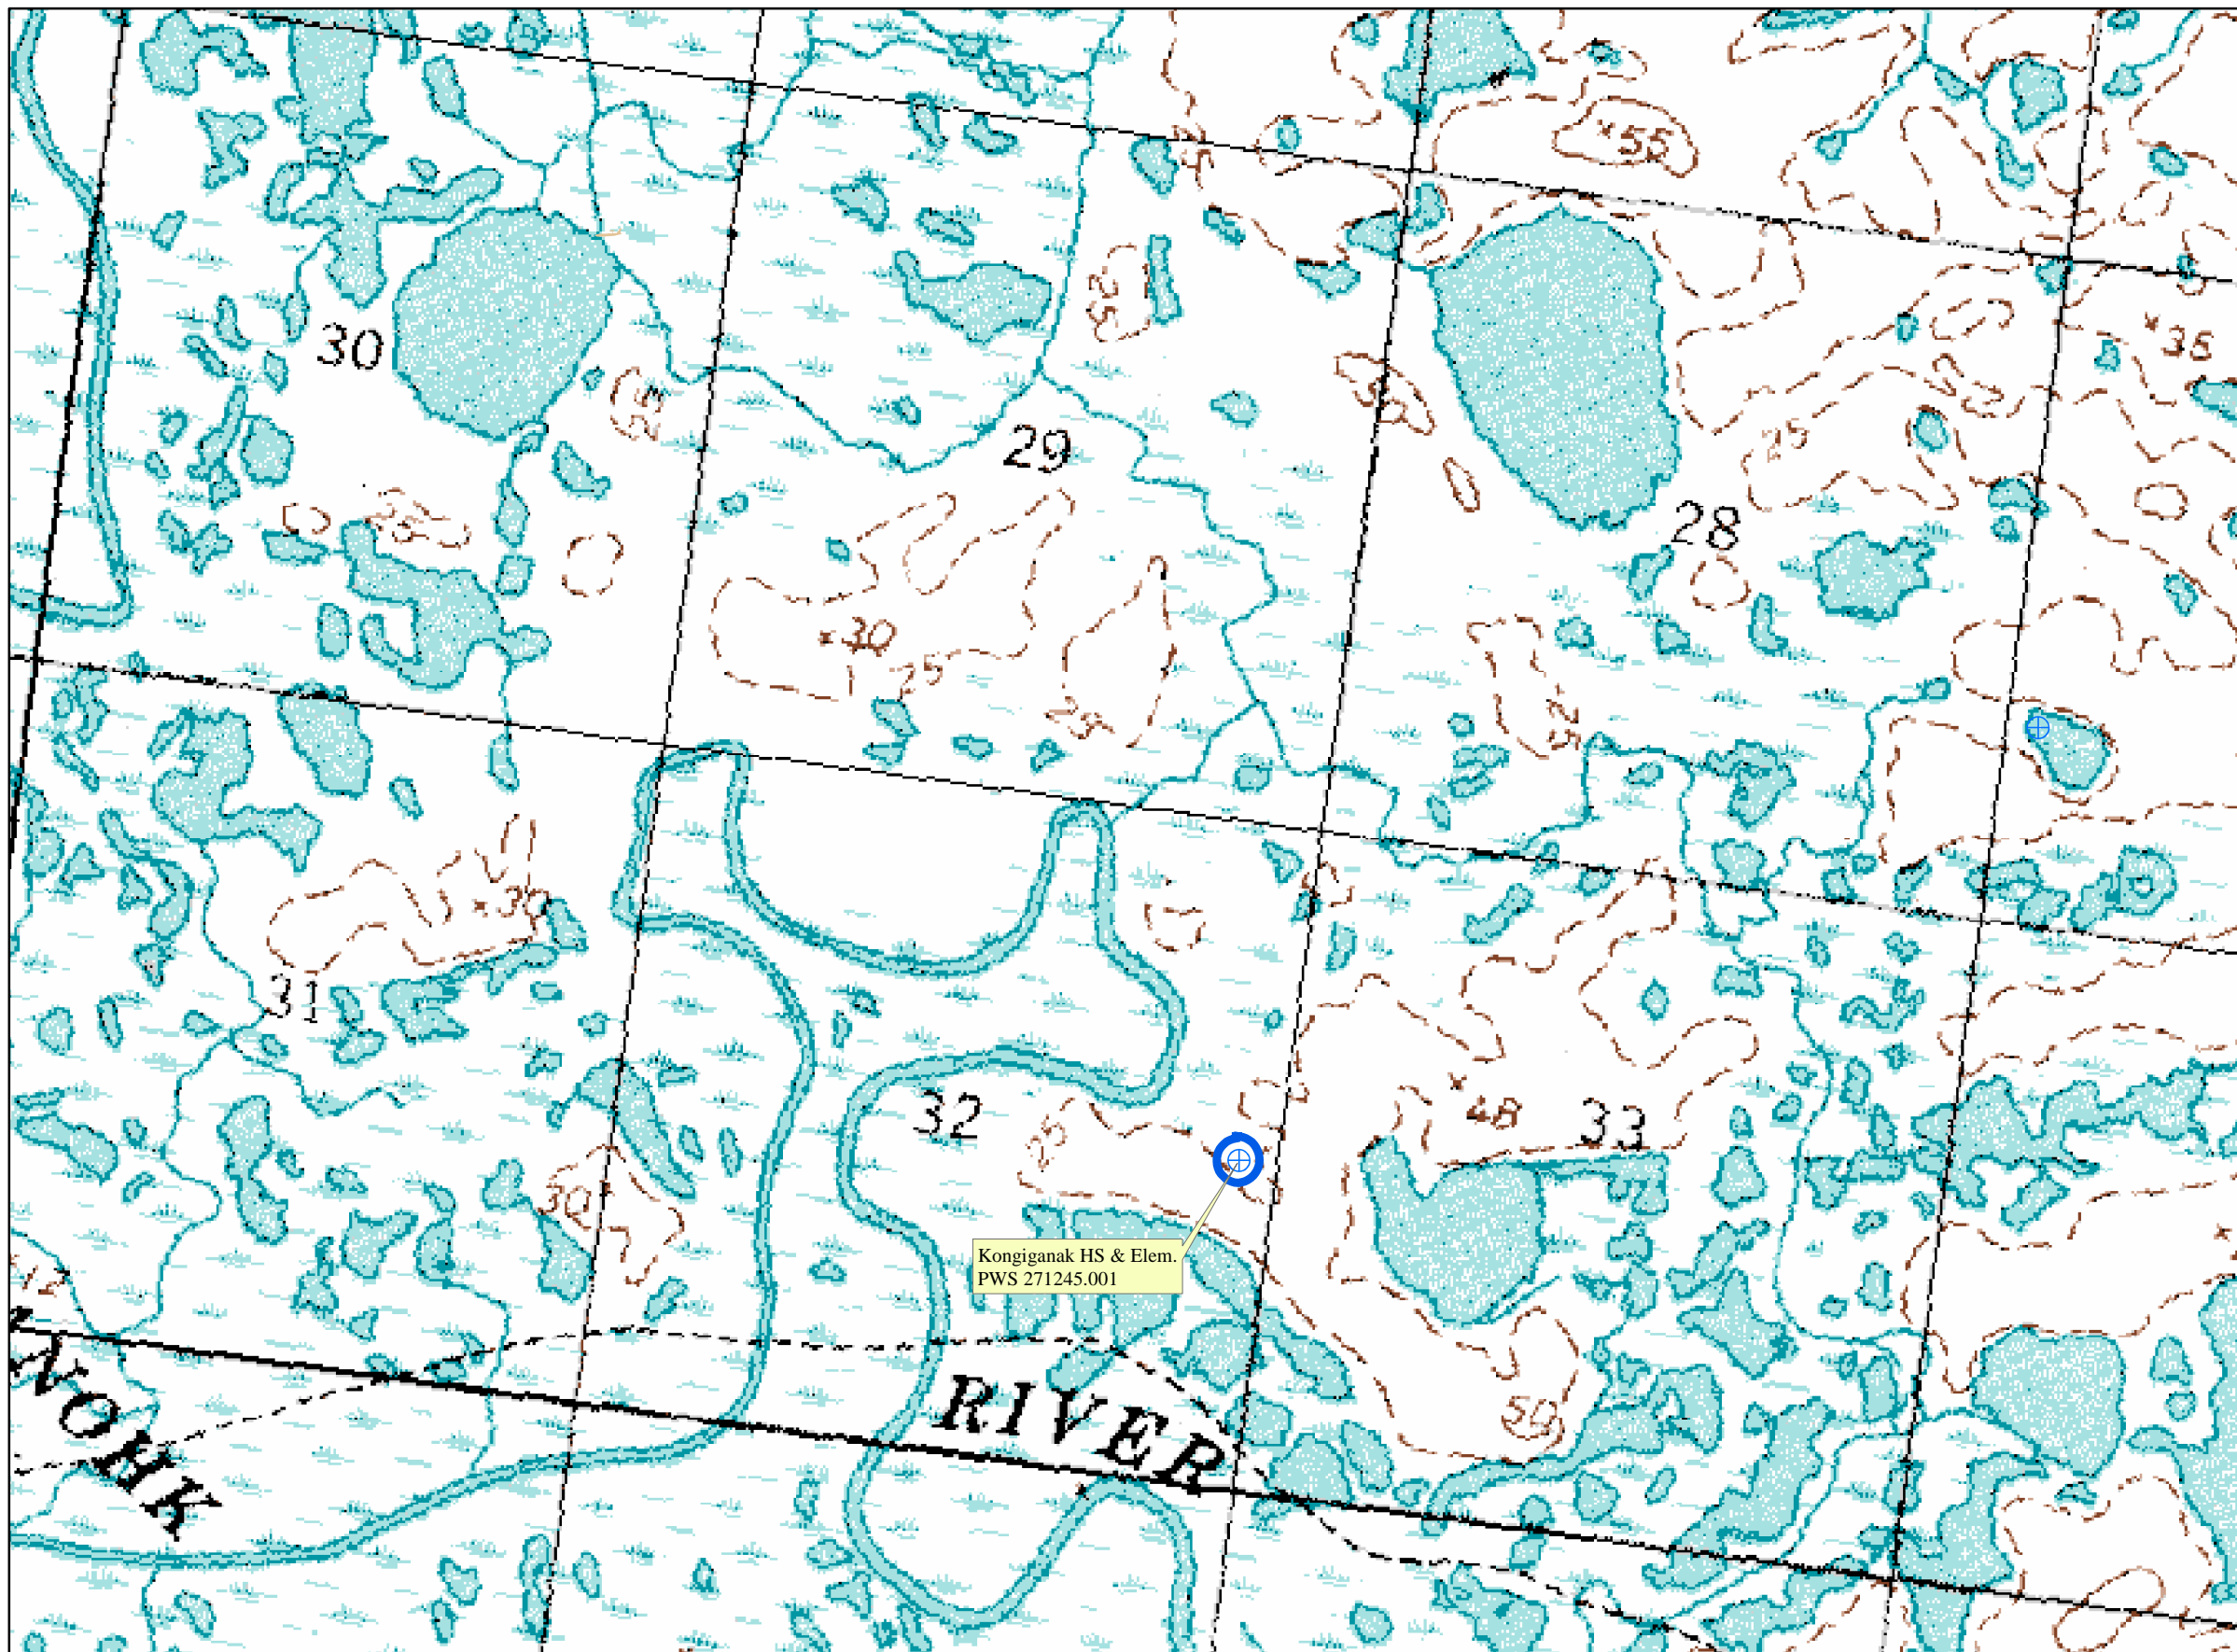




## **APPENDIX C**

### **Drinking Water Protection Area and Potential and Existing Contaminant Sources (Map C)**

**Public Water Well System for PWS #271245.001 LKSD Kongiganak HS & Elem.  
Showing Potential and Existing Sources of Contamination**



**LEGEND**

-  Public Water System Well
  - Groundwater Protection Zones**
  -  Zone C Protection Area—5 Years Travel Time
  - Hydrography/Physical**
  -  Parcels
  -  Stream
  -  Lake or Pond
  -  Contours
  - Transportation**
  -  Primary Route (Class 1)
  -  Secondary Route (Class 2)
  -  Road (Class 3)
  -  Road (Class 4)
  -  Road (Class 5, Four-wheel drive)
- Rain runoff from school is primary water source. No reported existing or potential contaminant sources found within the Protection Zone.




Data Sources:  
Contaminant Sources, Public Water System Wells, Contours  
Alaska Department of Environmental Conservation (ADEC)

Critical Facilities, Federal Emergency Management Agency (FEMA)

All other data:  
United States Geological Survey (USGS)

Drinking Water Protection Areas based on "Alaska Drinking Water Protection Program - Guidance Manual for Class B Public Water Systems" published by ADEC

URS Corporation does not guarantee the accuracy or validity of the data provided.

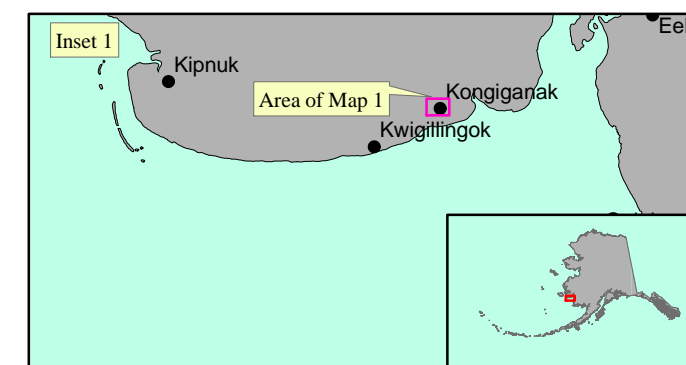


## **APPENDIX D**


### **Vulnerability Analysis and Contaminant Risks (Charts 1-13)**




**Chart 1. Susceptibility of the Surface Water Source - LKSD Kongiganak Water System (PWS No. 271245.001)**

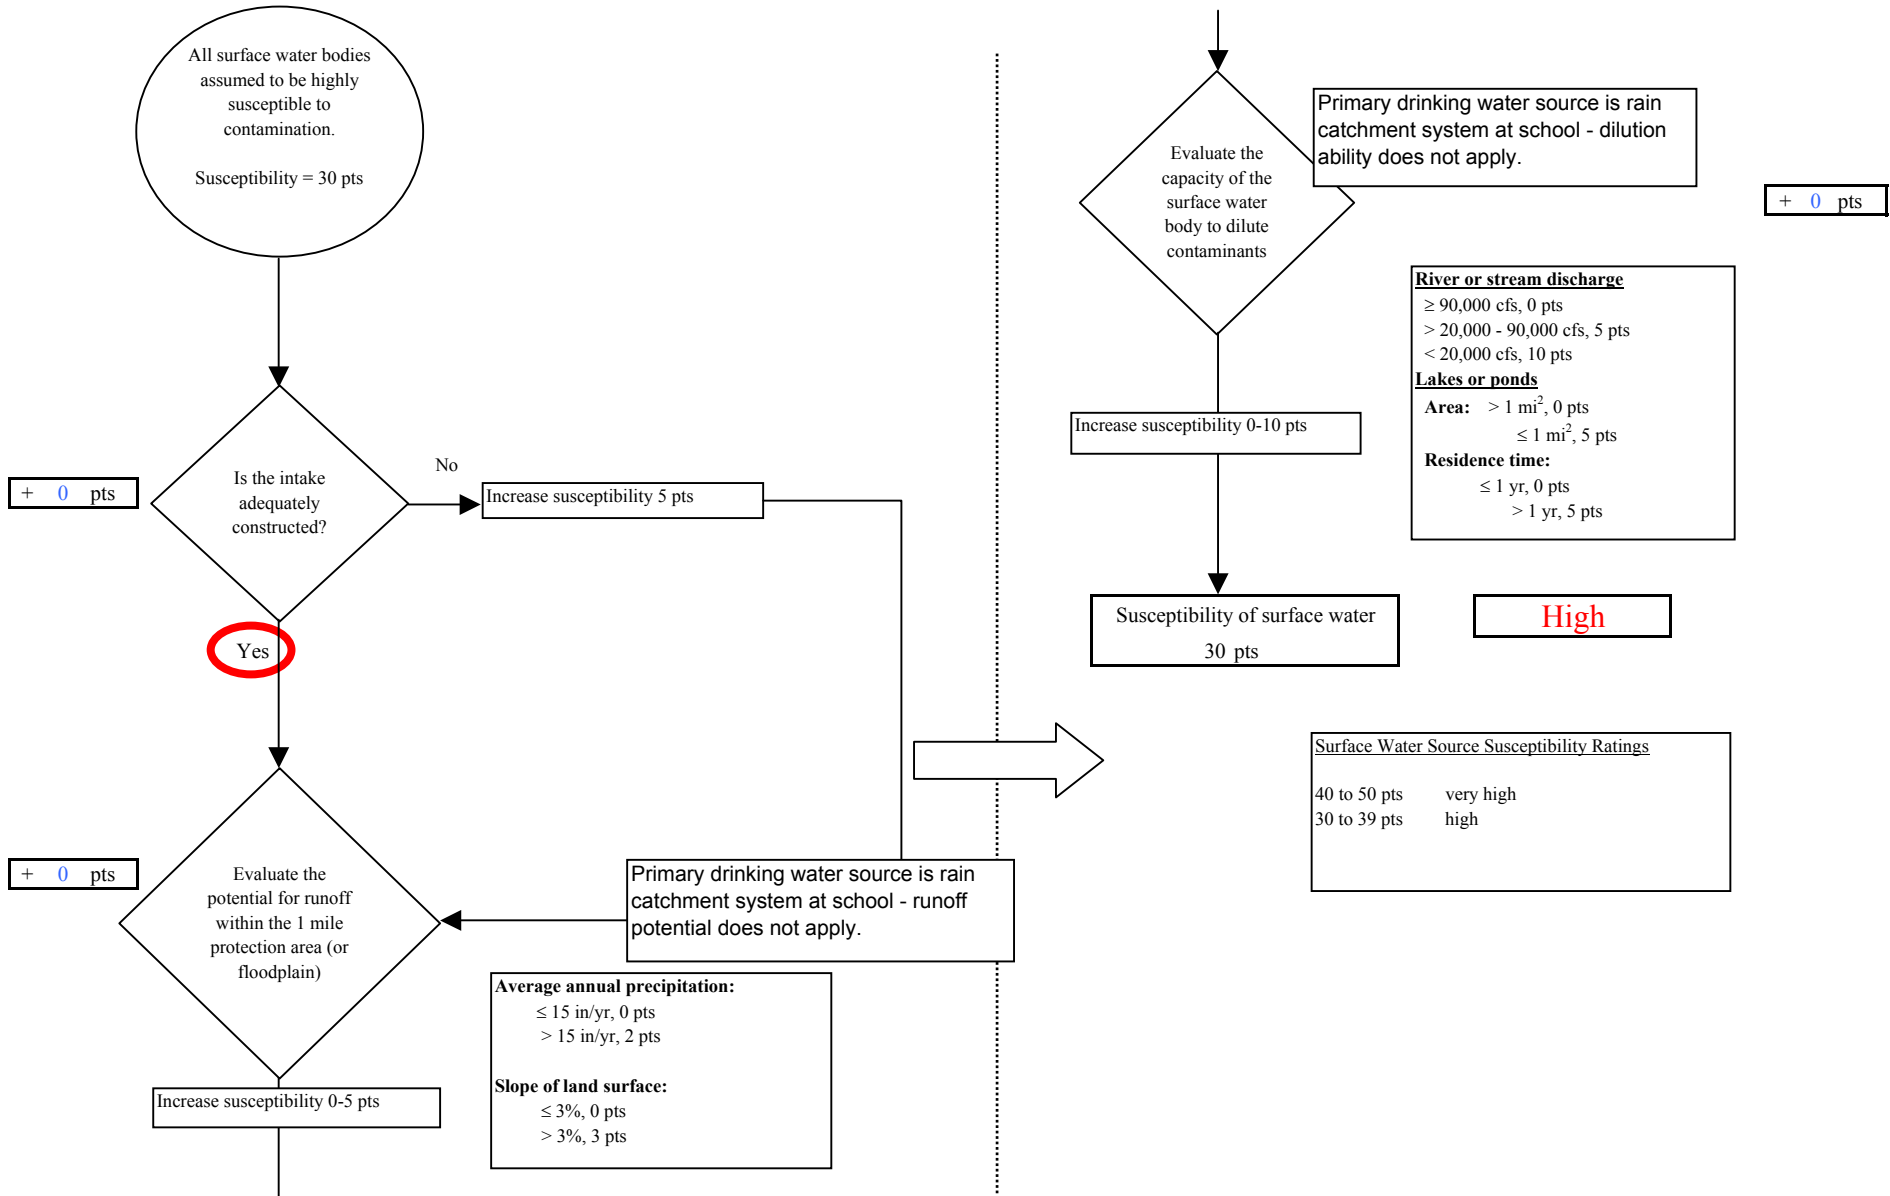

**Chart 2. Contaminant risks for LKSD Kongiganak Water System (PWS No. 271245.001) - Bacteria & Viruses**

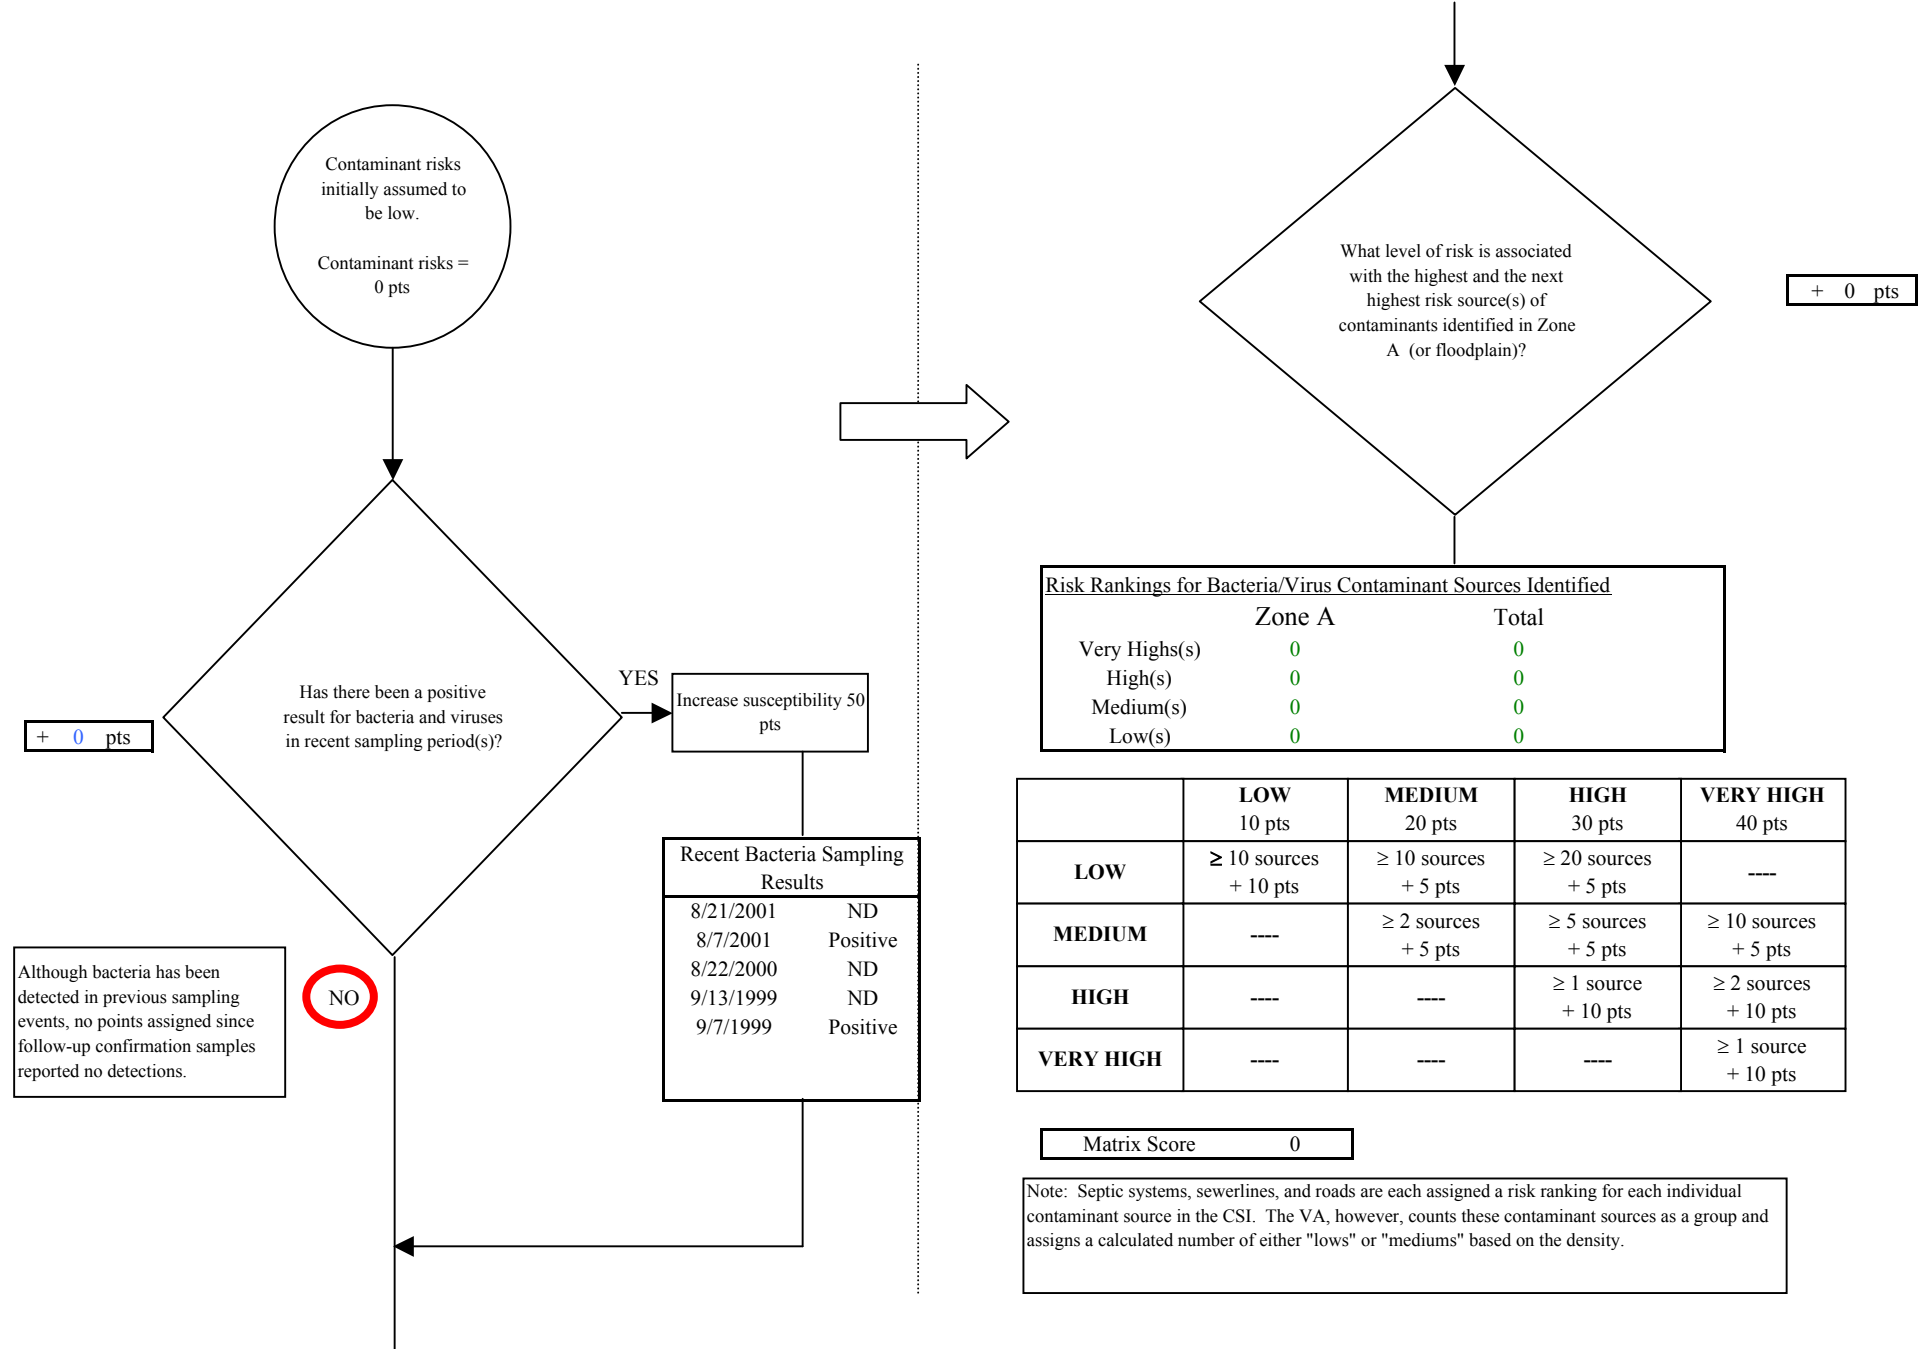

**Chart 2. Contaminant risks for LKSD Kongiganak Water System (PWS No. 271245.001) - Bacteria & Viruses**

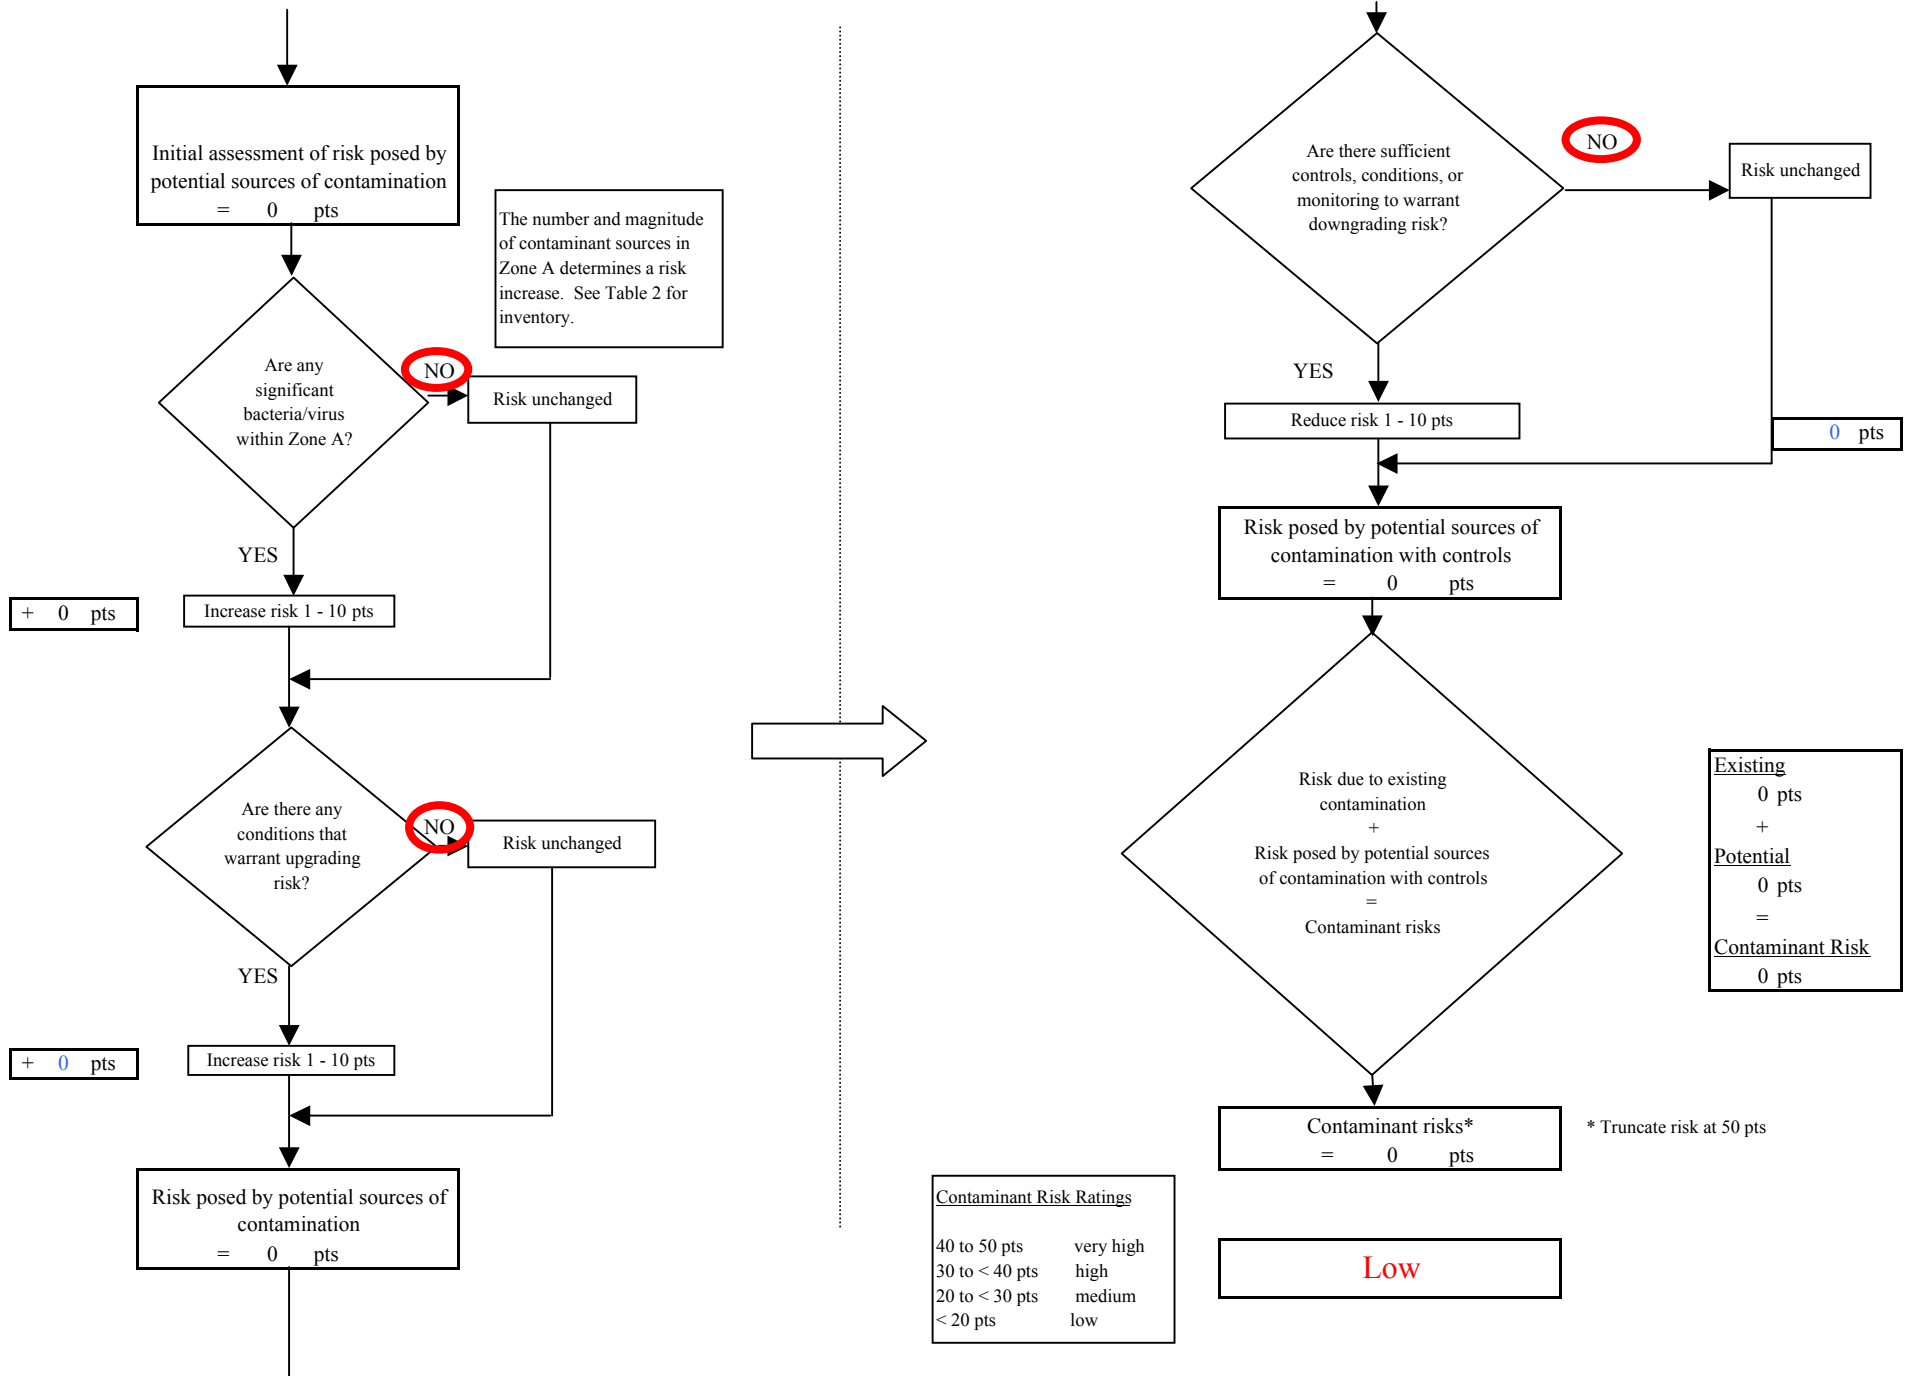

Contaminant Risk Ratings	
40 to 50 pts	very high
30 to < 40 pts	high
20 to < 30 pts	medium
< 20 pts	low

**Chart 3. Vulnerability analysis for LKSD Kongiganak Water System (PWS No. 271245.001) - Bacteria & Viruses**

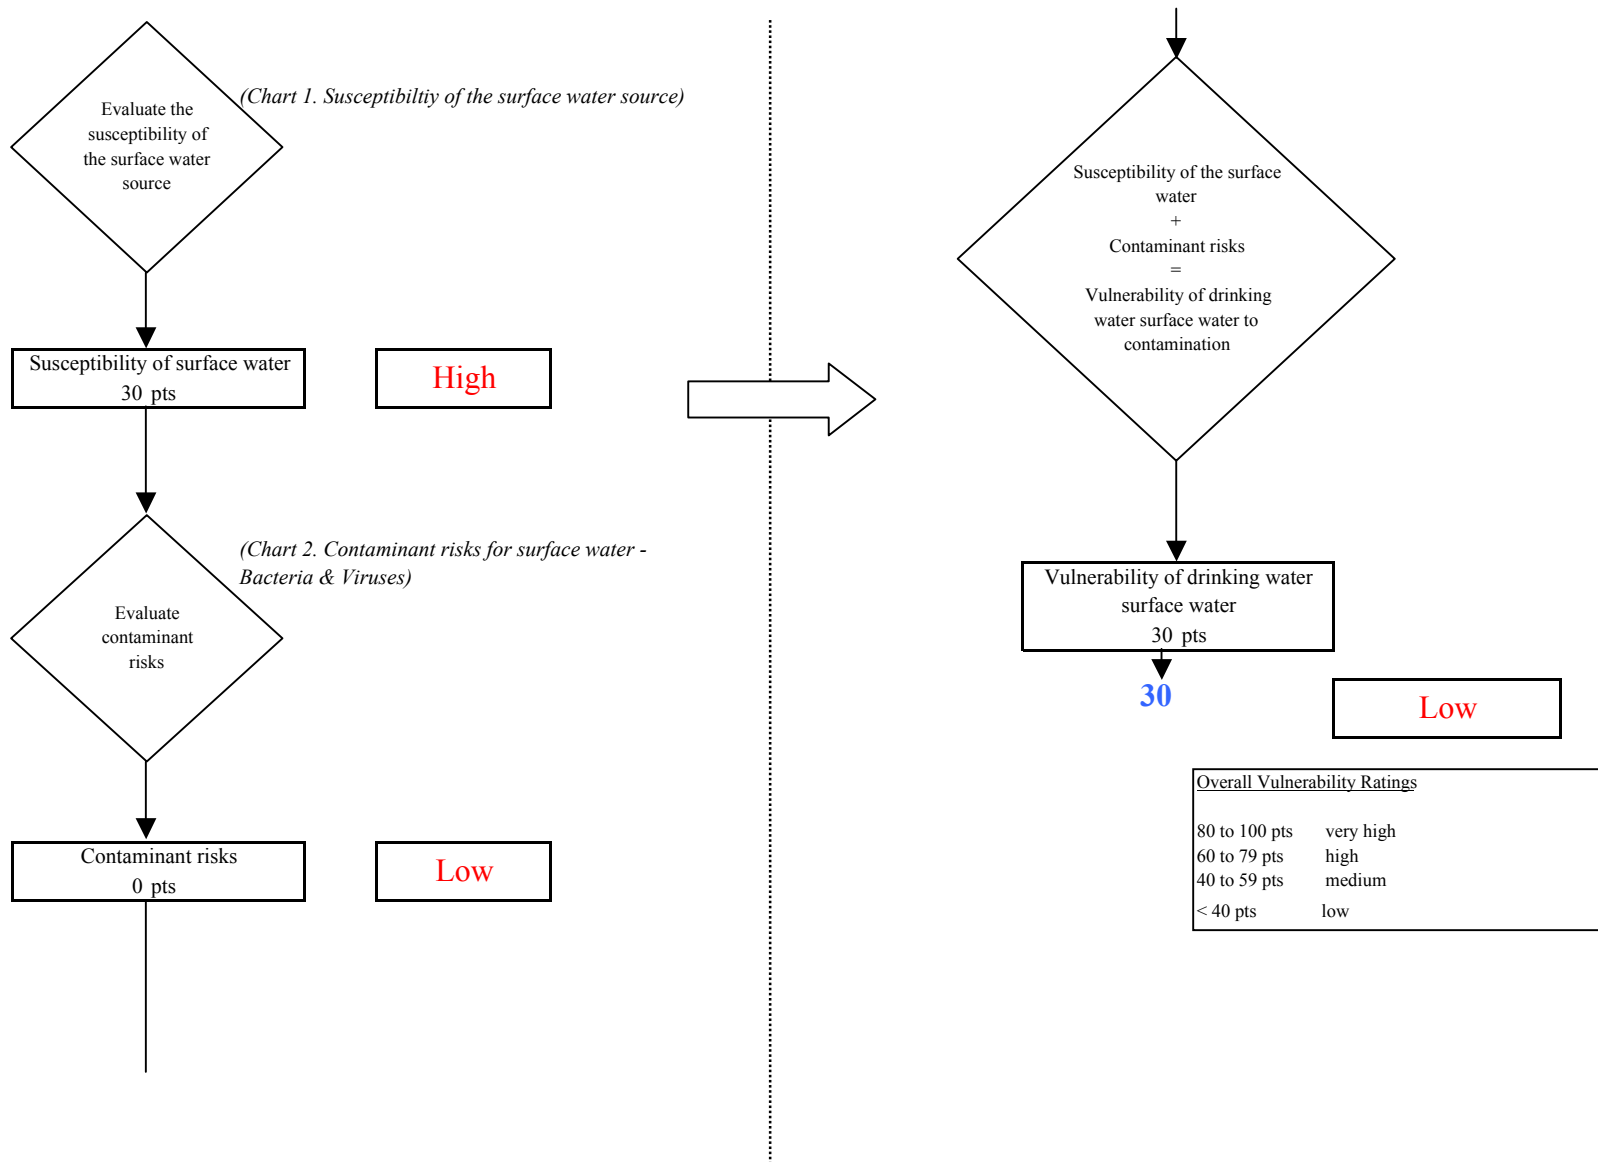


Chart 4. Contaminant risks for LKSD Kongiganak Water System (PWS No. 271245.001) - Nitrates and Nitrites


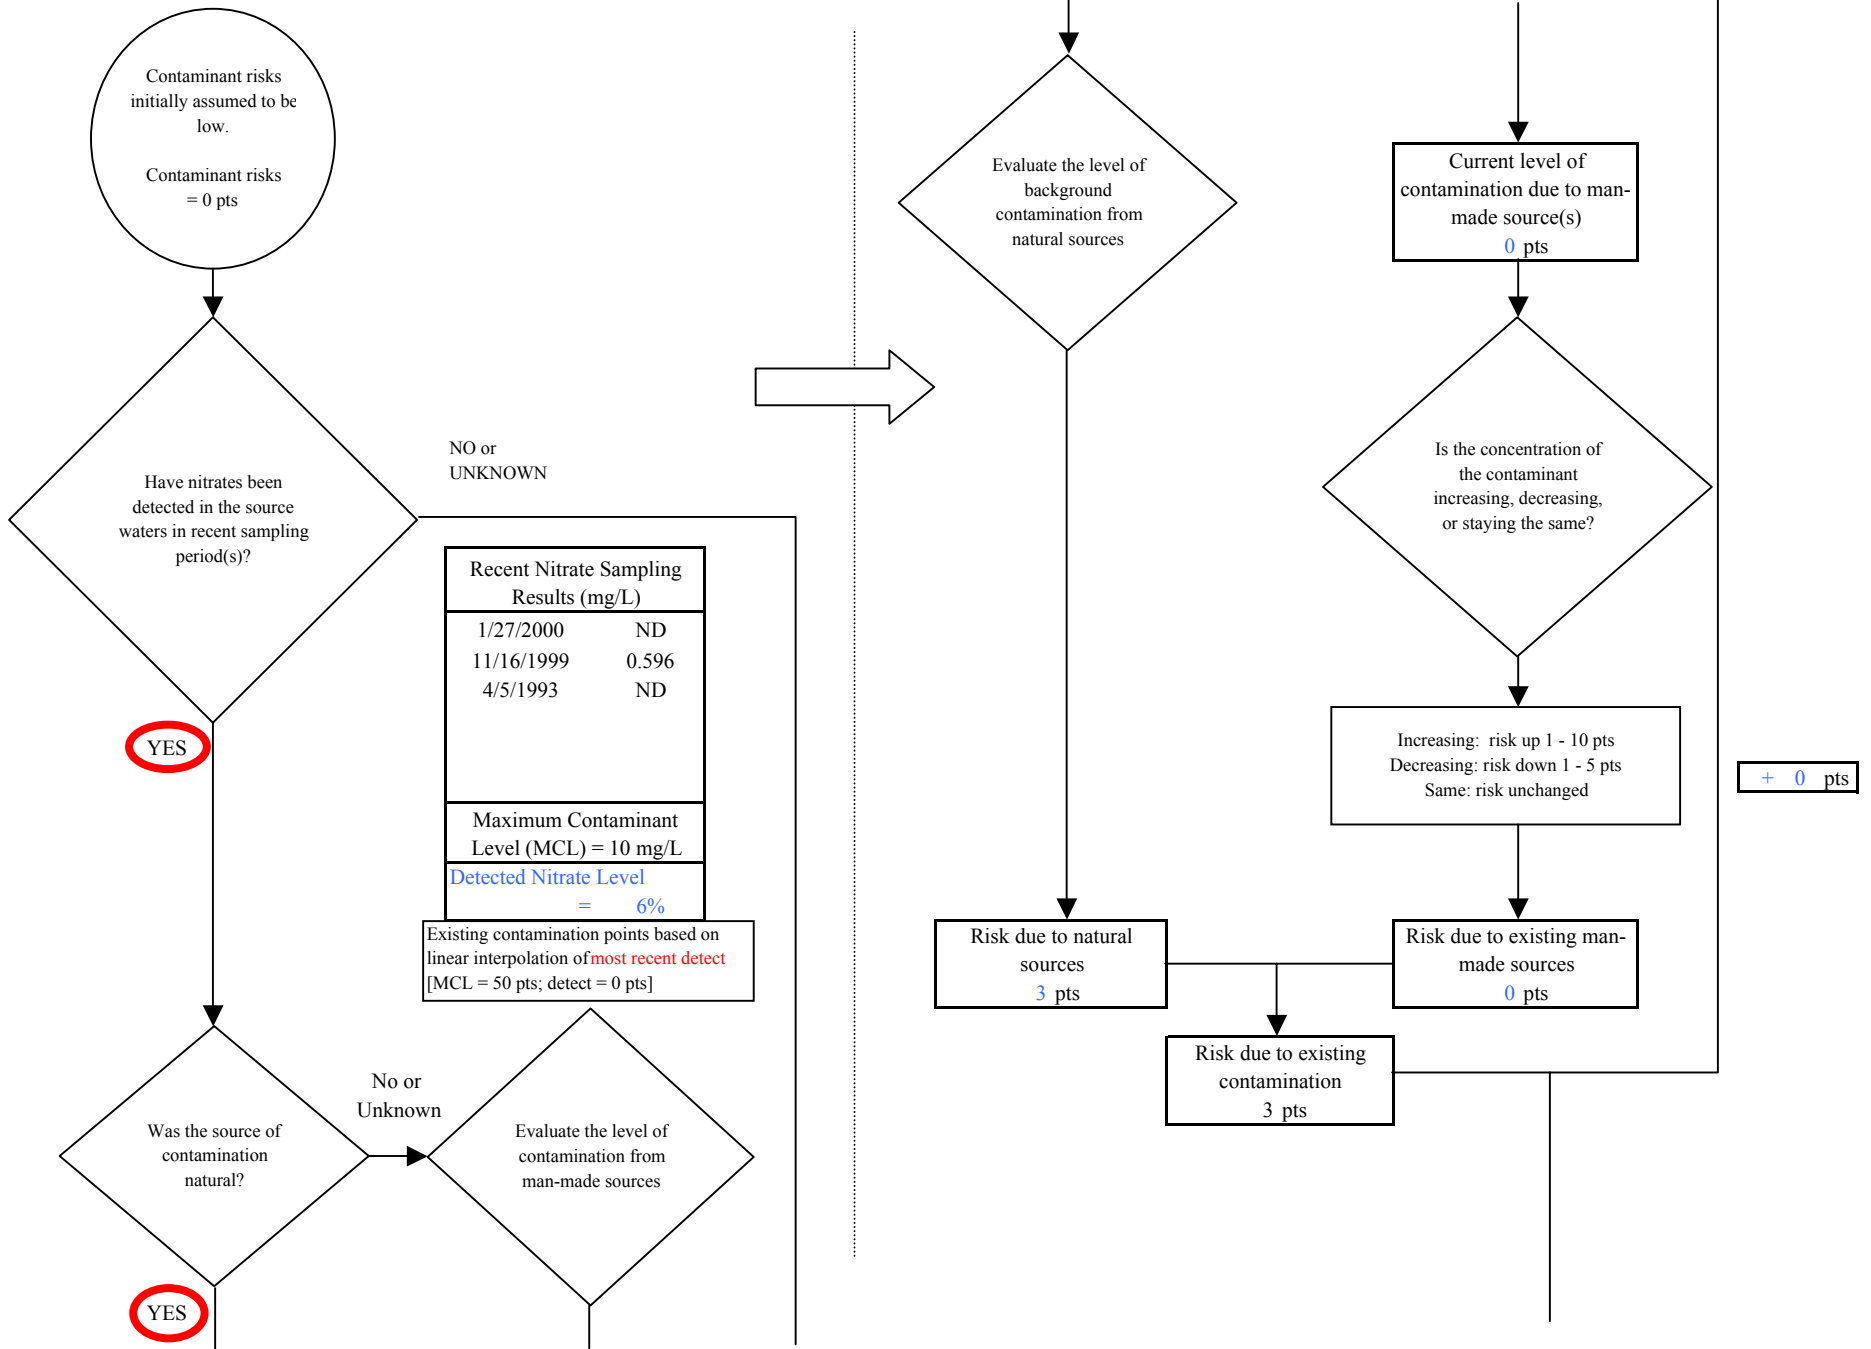


Chart 4. Contaminant risks for LKSD Kongiganak Water System (PWS No. 271245.001) - Nitrates and Nitrites

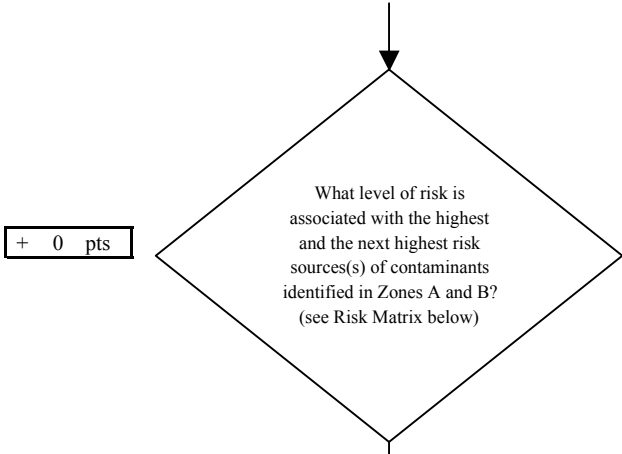



Risk Levels for Nitrate/Nitrite Sources identified in Zones A and B

	Zone A	Zone B	Total
Very Highs(s)	0	0	0
High(s)	0	0	0
Medium(s)	0	0	0
Low(s)	0	0	0


	LOW 10 pts	MEDIUM 20 pts	HIGH 30 pts	VERY HIGH 40 pts
LOW	≥ 10 sources + 10 pts	≥ 10 sources + 5 pts	≥ 20 sources + 5 pts	----
MEDIUM	----	≥ 2 sources + 5 pts	≥ 5 sources + 5 pts	≥ 10 sources + 5 pts
HIGH	----	----	≥ 1 source + 10 pts	≥ 2 sources + 10 pts
VERY HIGH	----	----	----	≥ 1 source + 10 pts

Matrix Score 0


Note: Septic systems, sewerlines, and roads are each assigned a risk ranking for each individual contaminant source in the CSI. The VA, however, counts these contaminant sources as a group and assigns a calculated number of either "lows" or "mediums" based on the density.

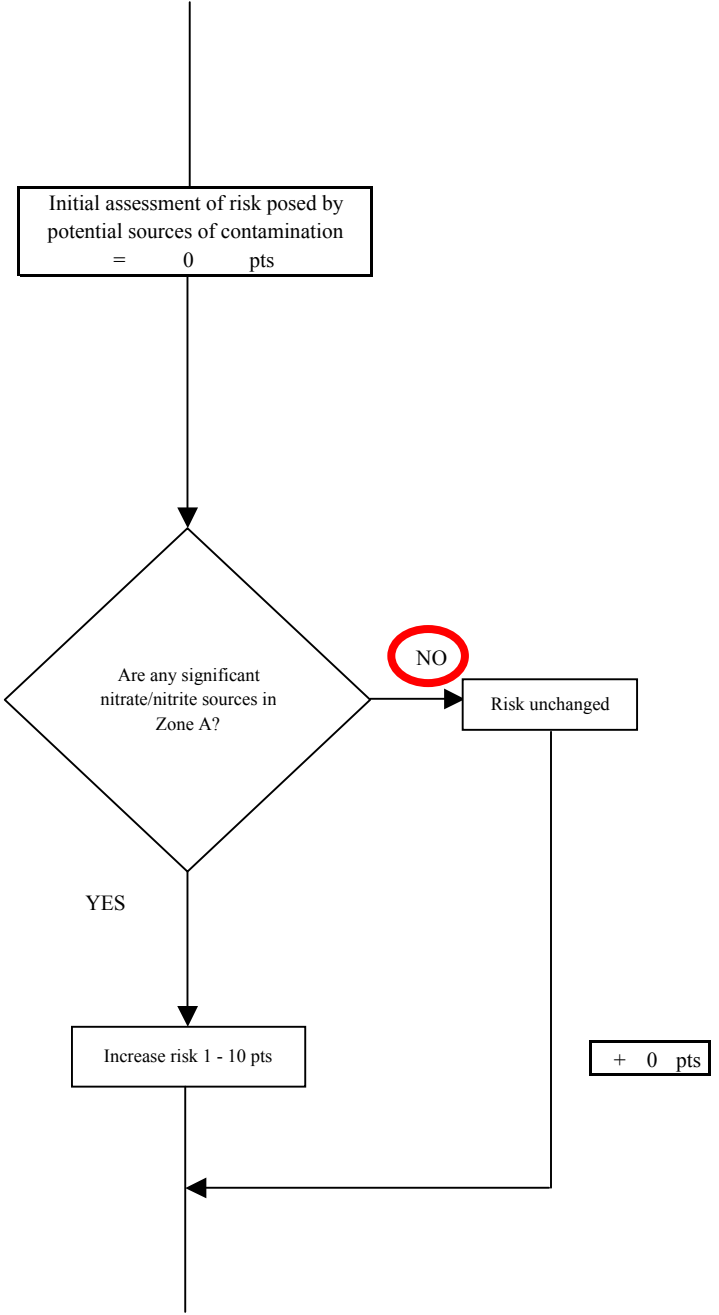

**Chart 4. Contaminant risks for LKSD Kongiganak Water System (PWS No. 271245.001) - Nitrates and Nitrites**

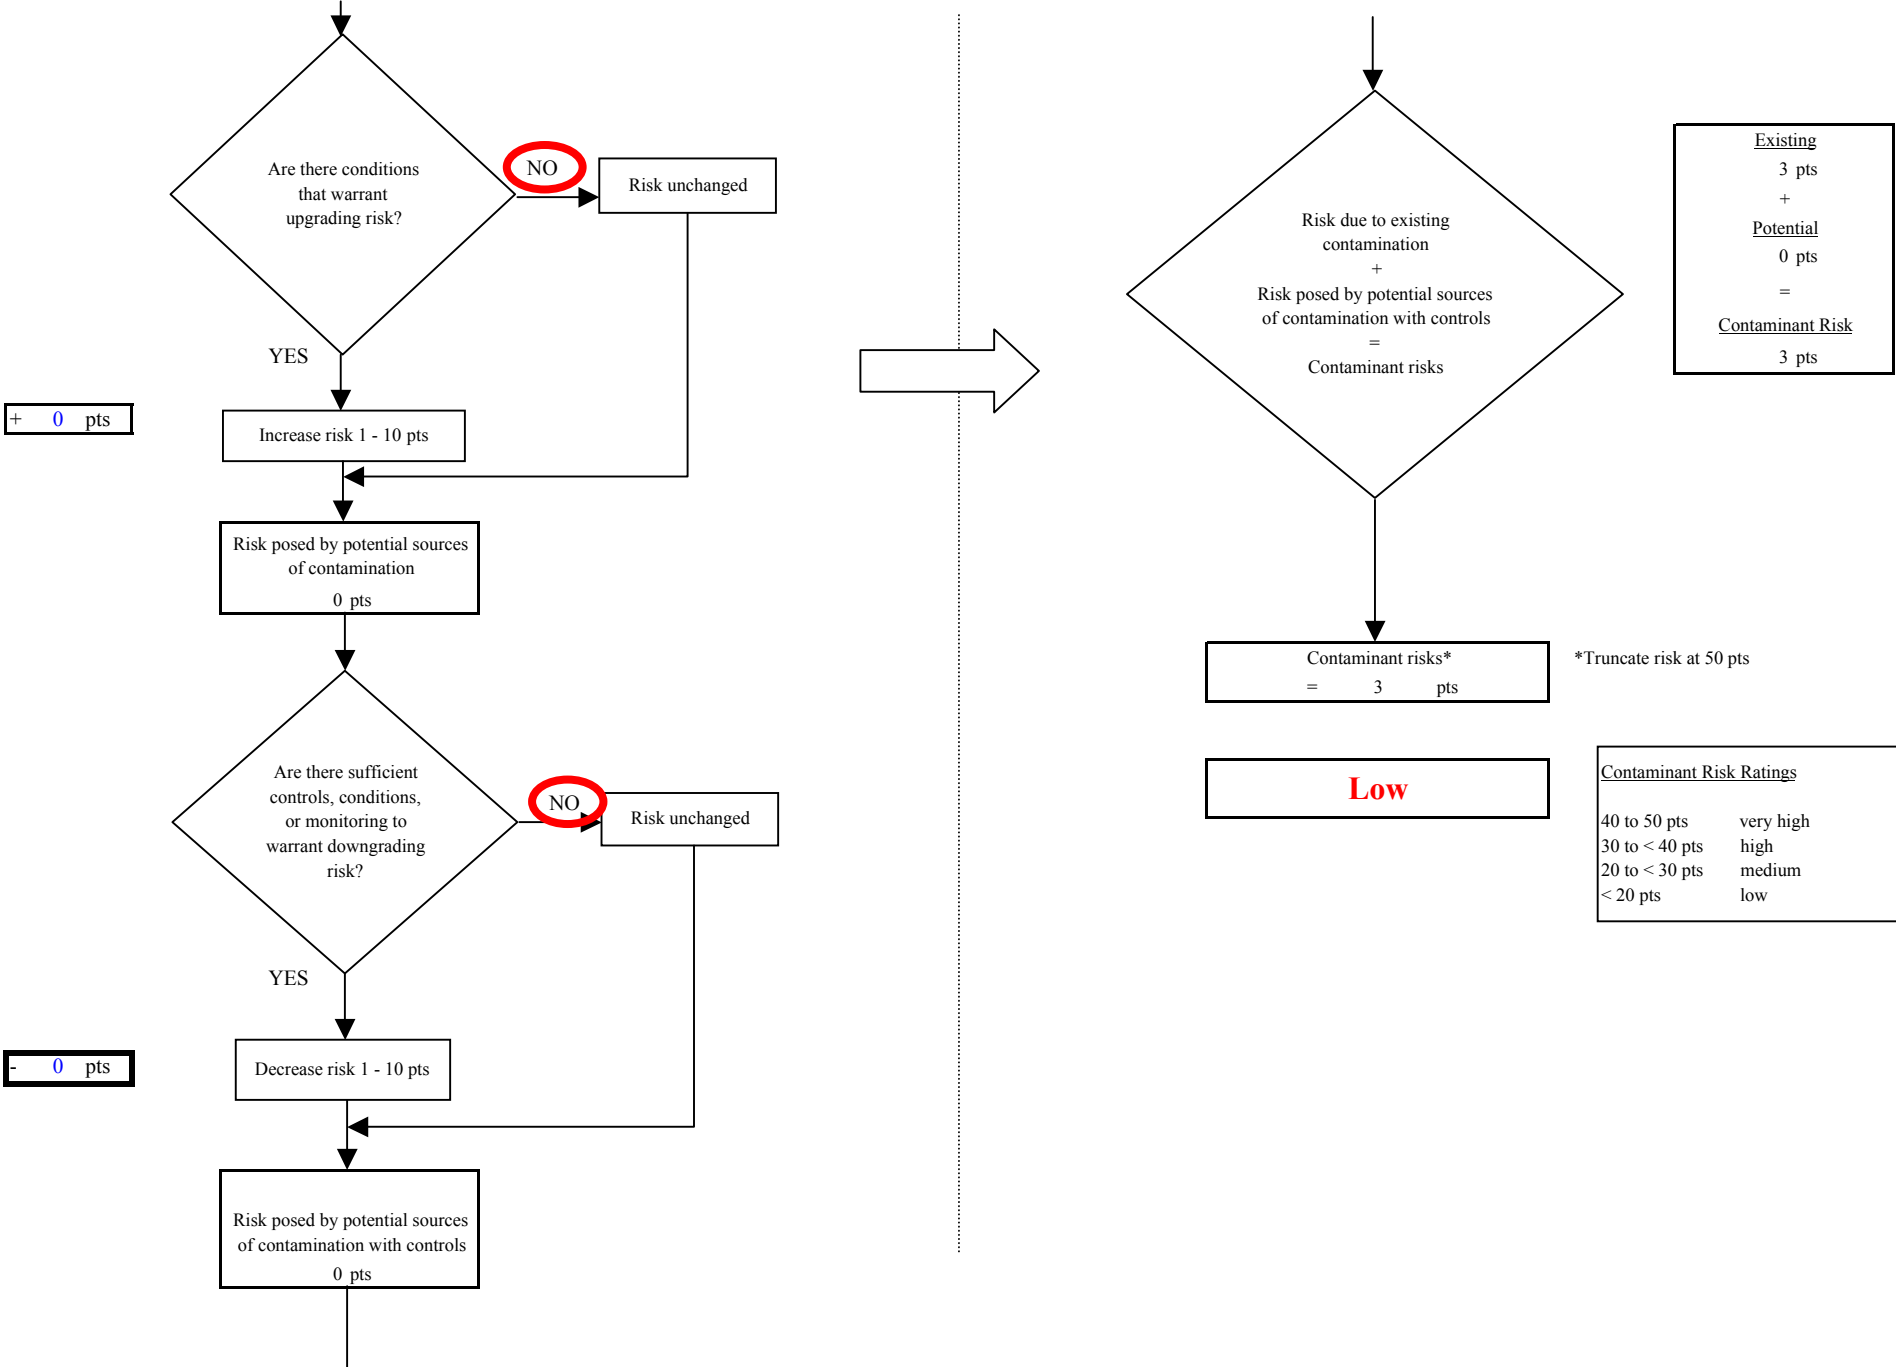


**Chart 5. Vulnerability analysis for LKSD Kongiganak Water System (PWS No. 271245.001) - Nitrates and Nitrites**


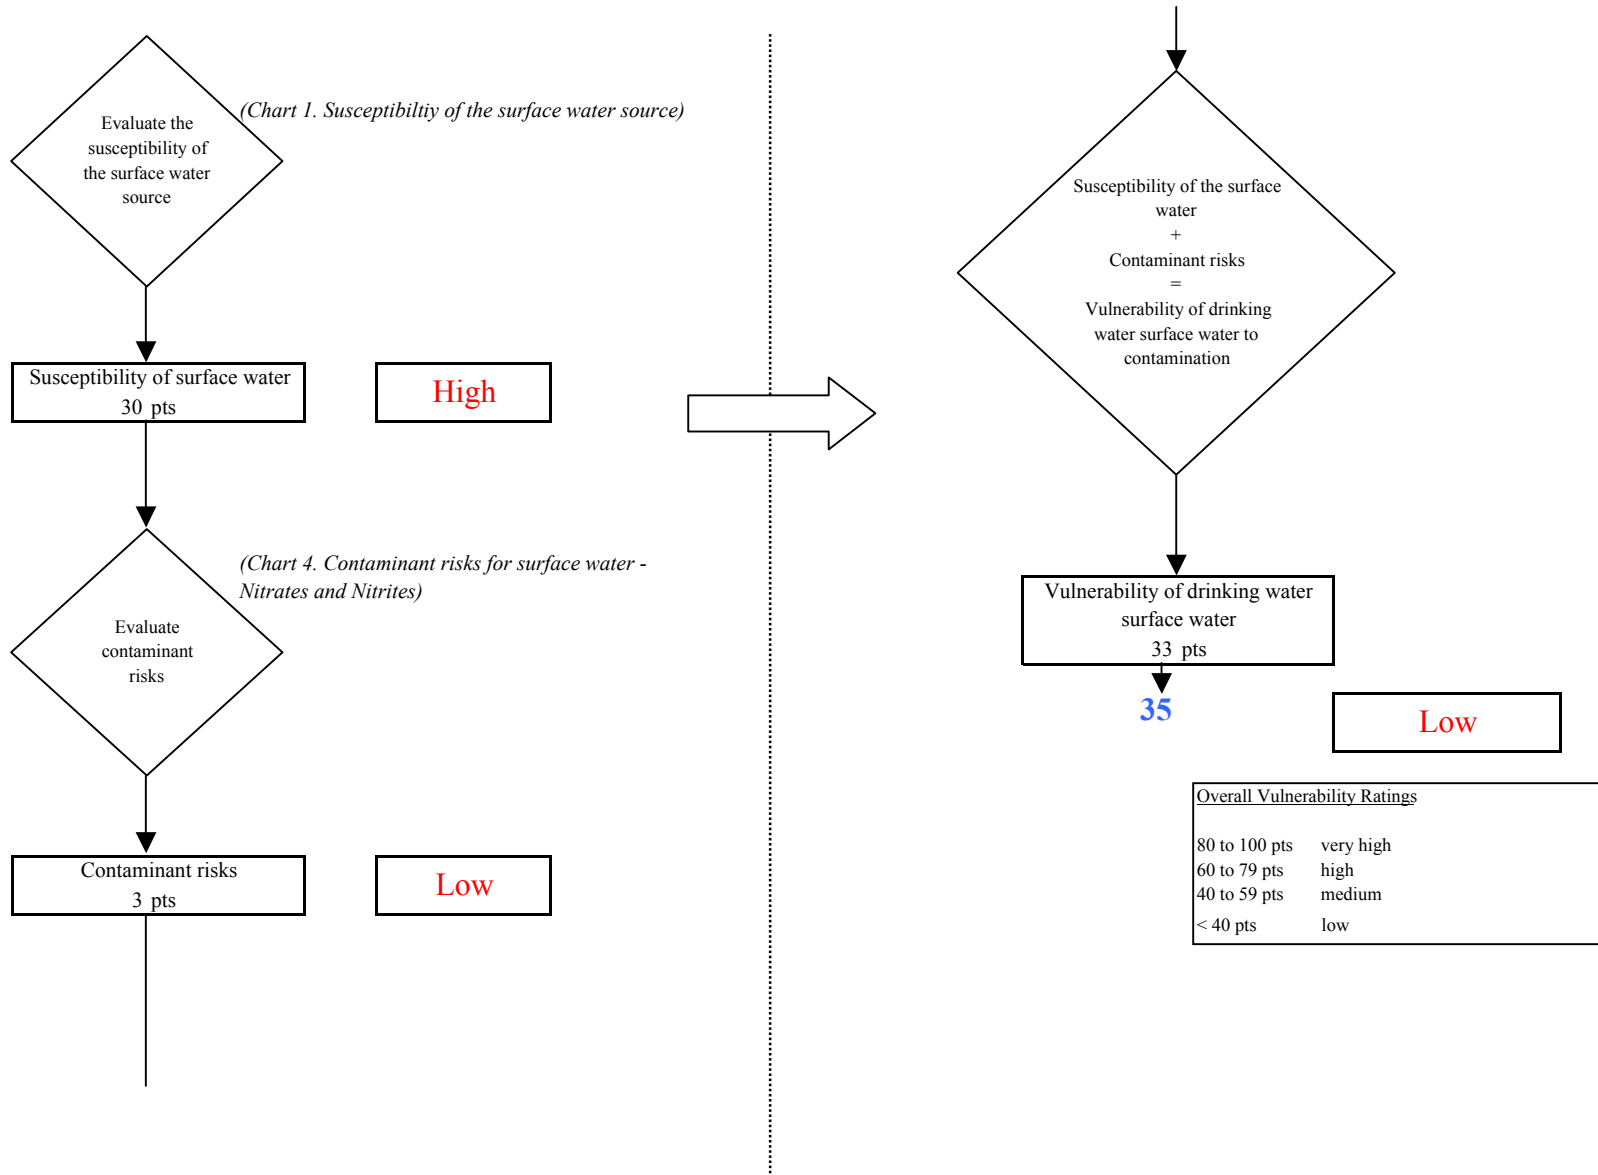





**Chart 6. Contaminant risks for LKSD Kongiganak Water System (PWS No. 271245.001) - Volatile Organic Chemicals**

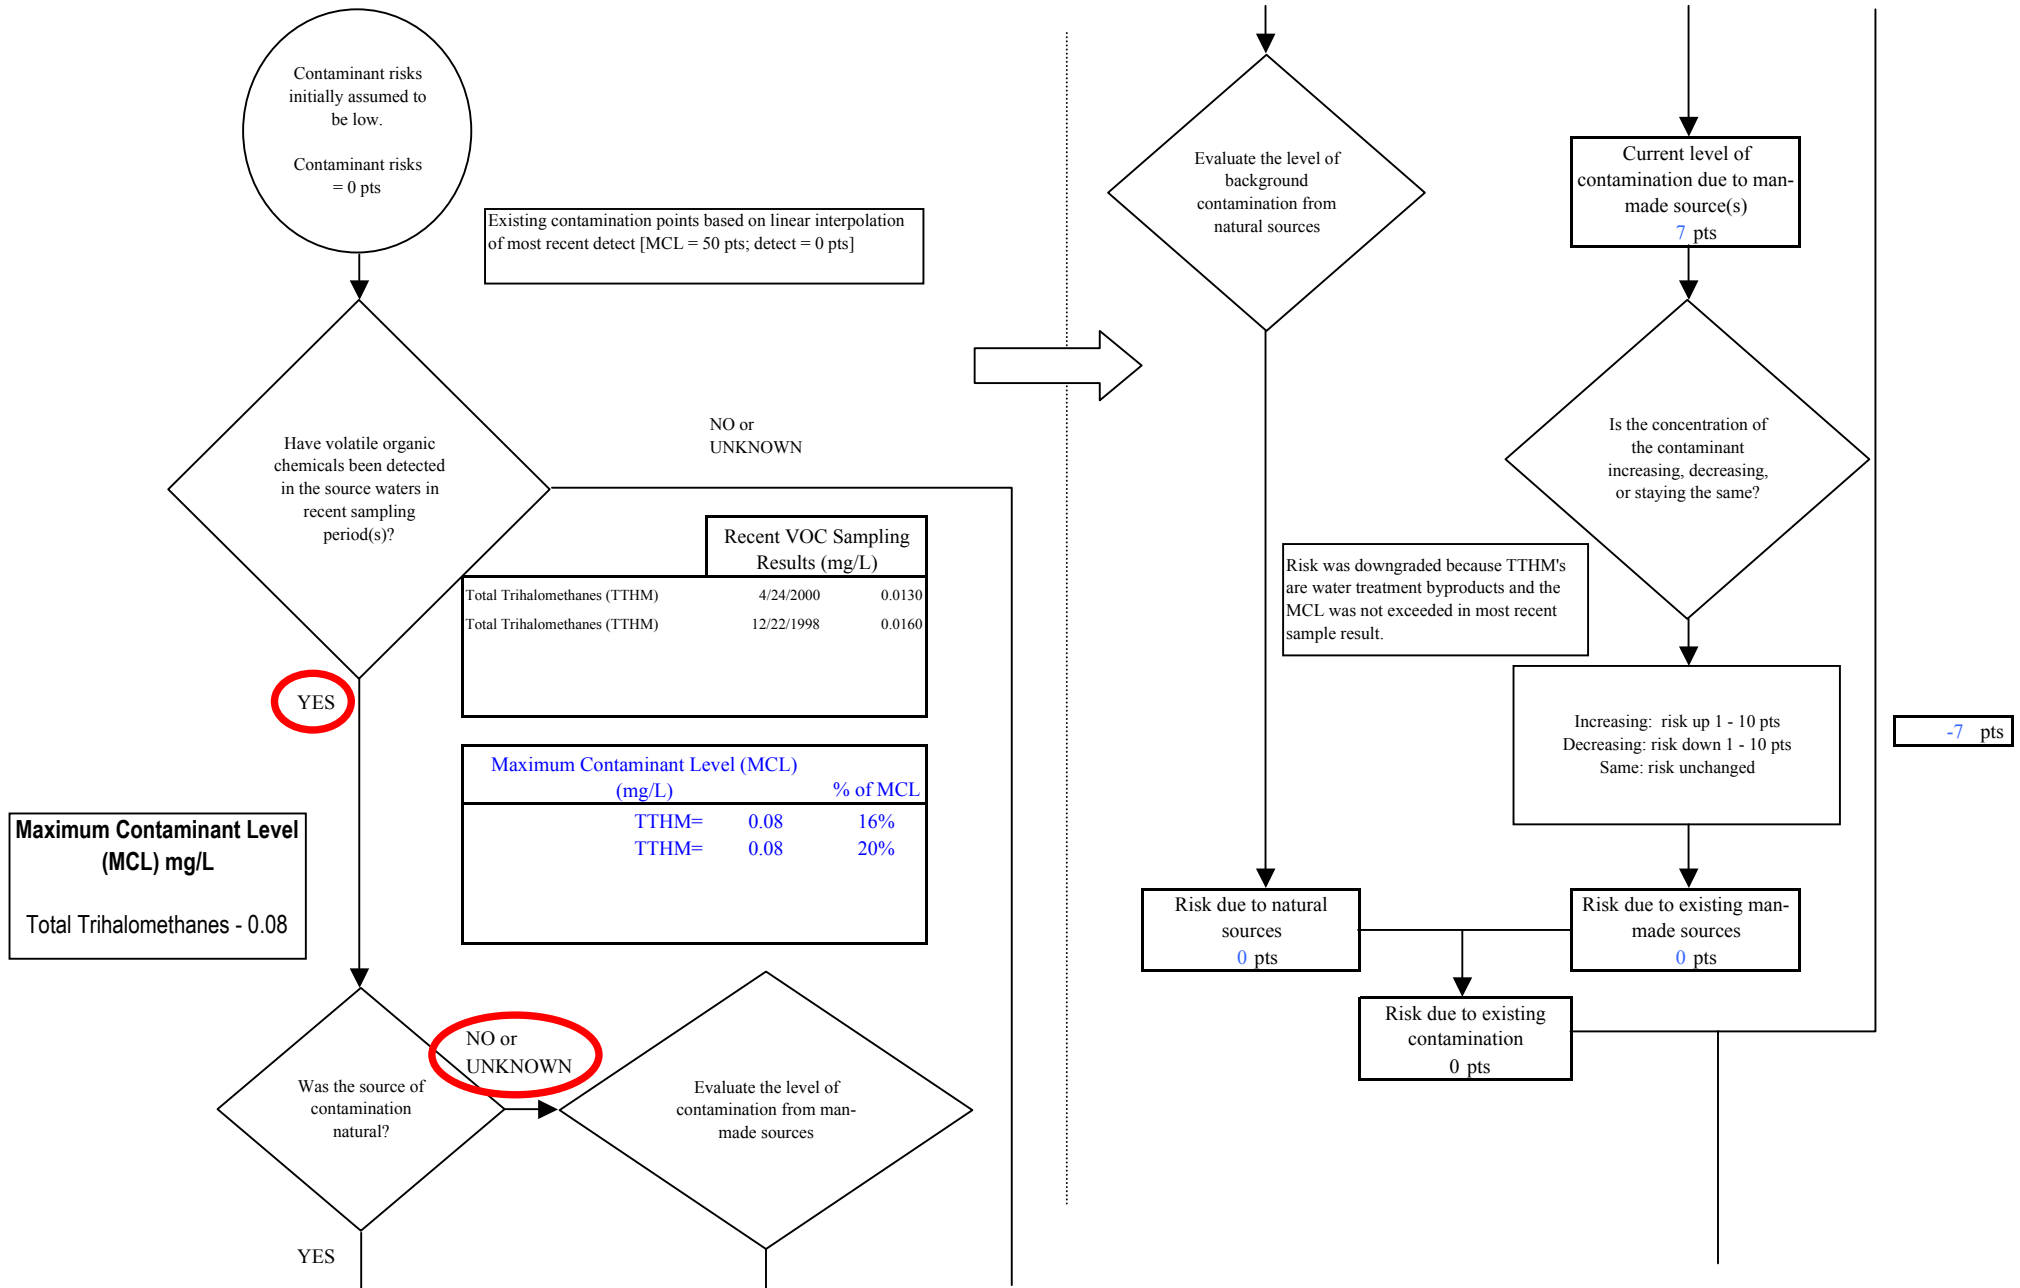


**Chart 6. Contaminant risks for LKSD Kongiganak Water System (PWS No. 271245.001) - Volatile Organic Chemicals**

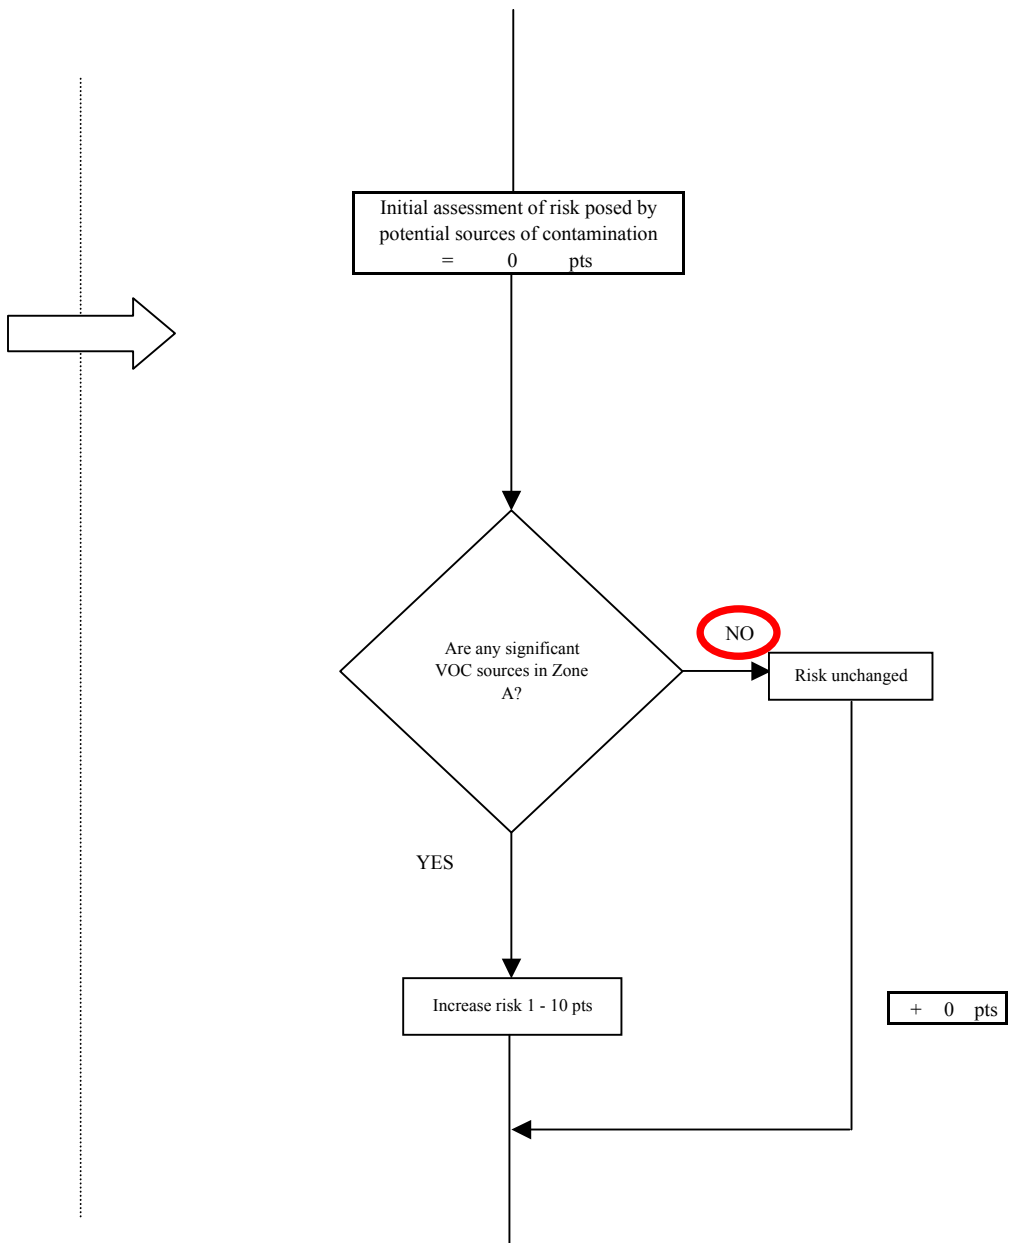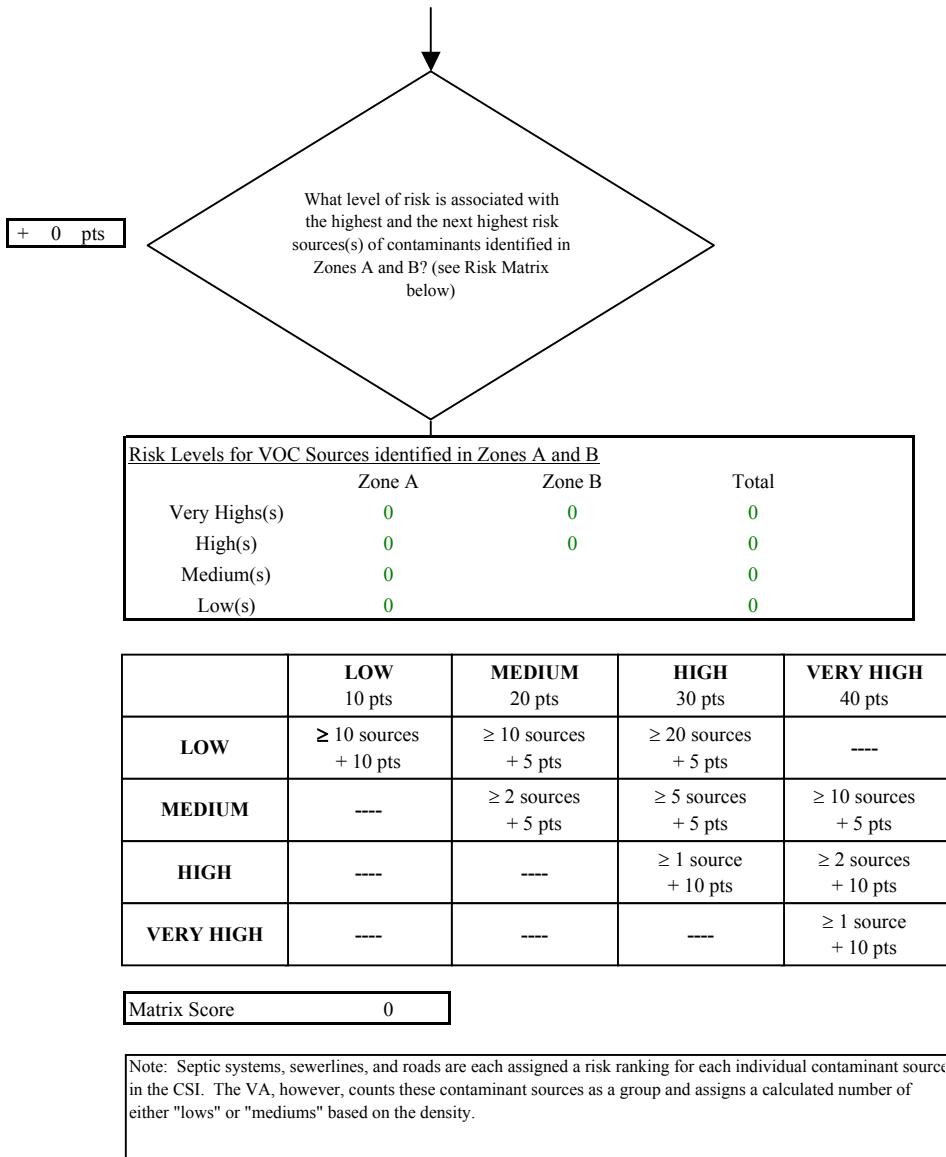


**Chart 6. Contaminant risks for LKSD Kongiganak Water System (PWS No. 271245.001) - Volatile Organic Chemicals**

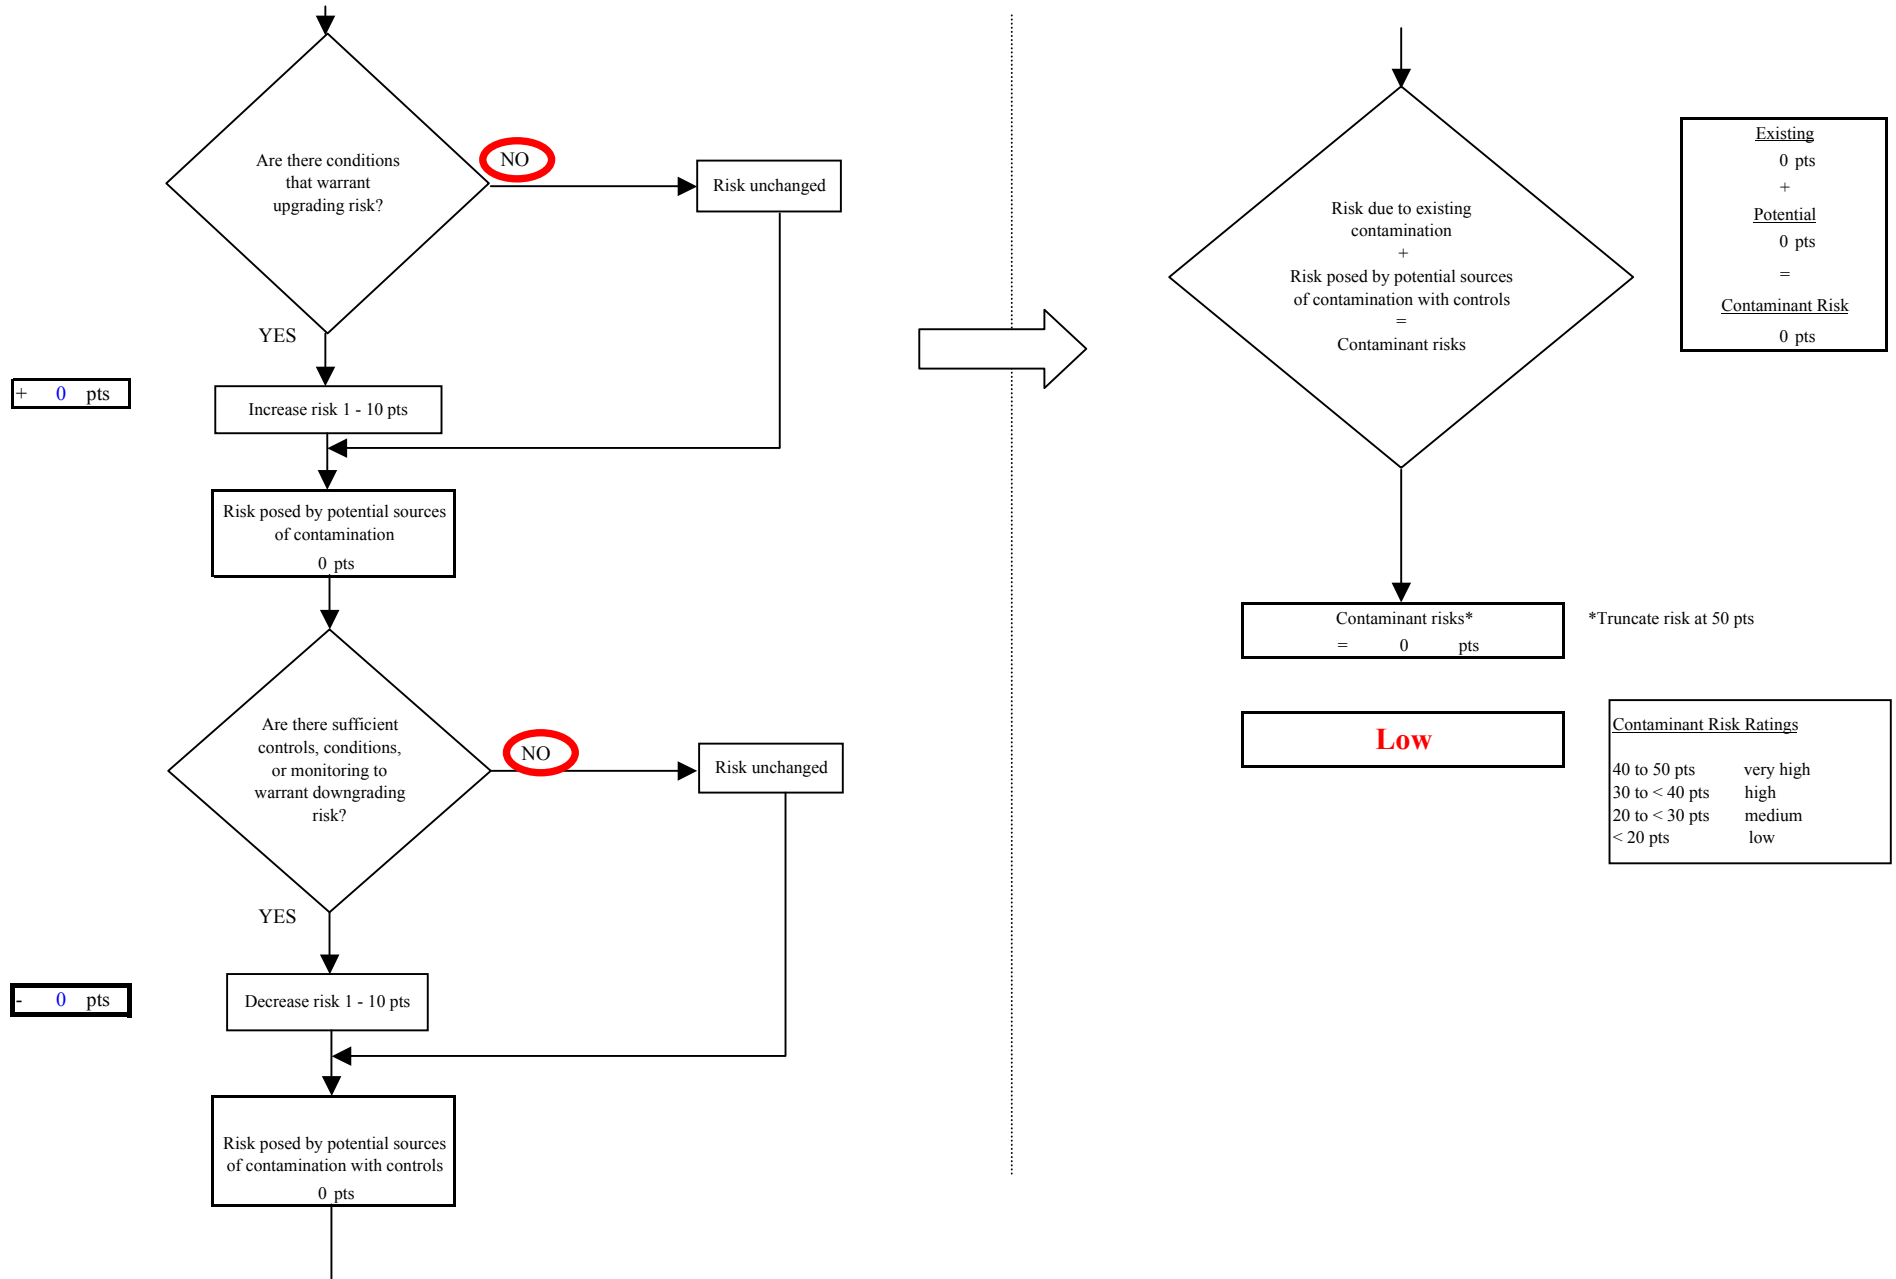


**Chart 7. Vulnerability analysis for LKSD Kongiganak Water System (PWS No. 271245.001) - Volatile Organic Chemicals**

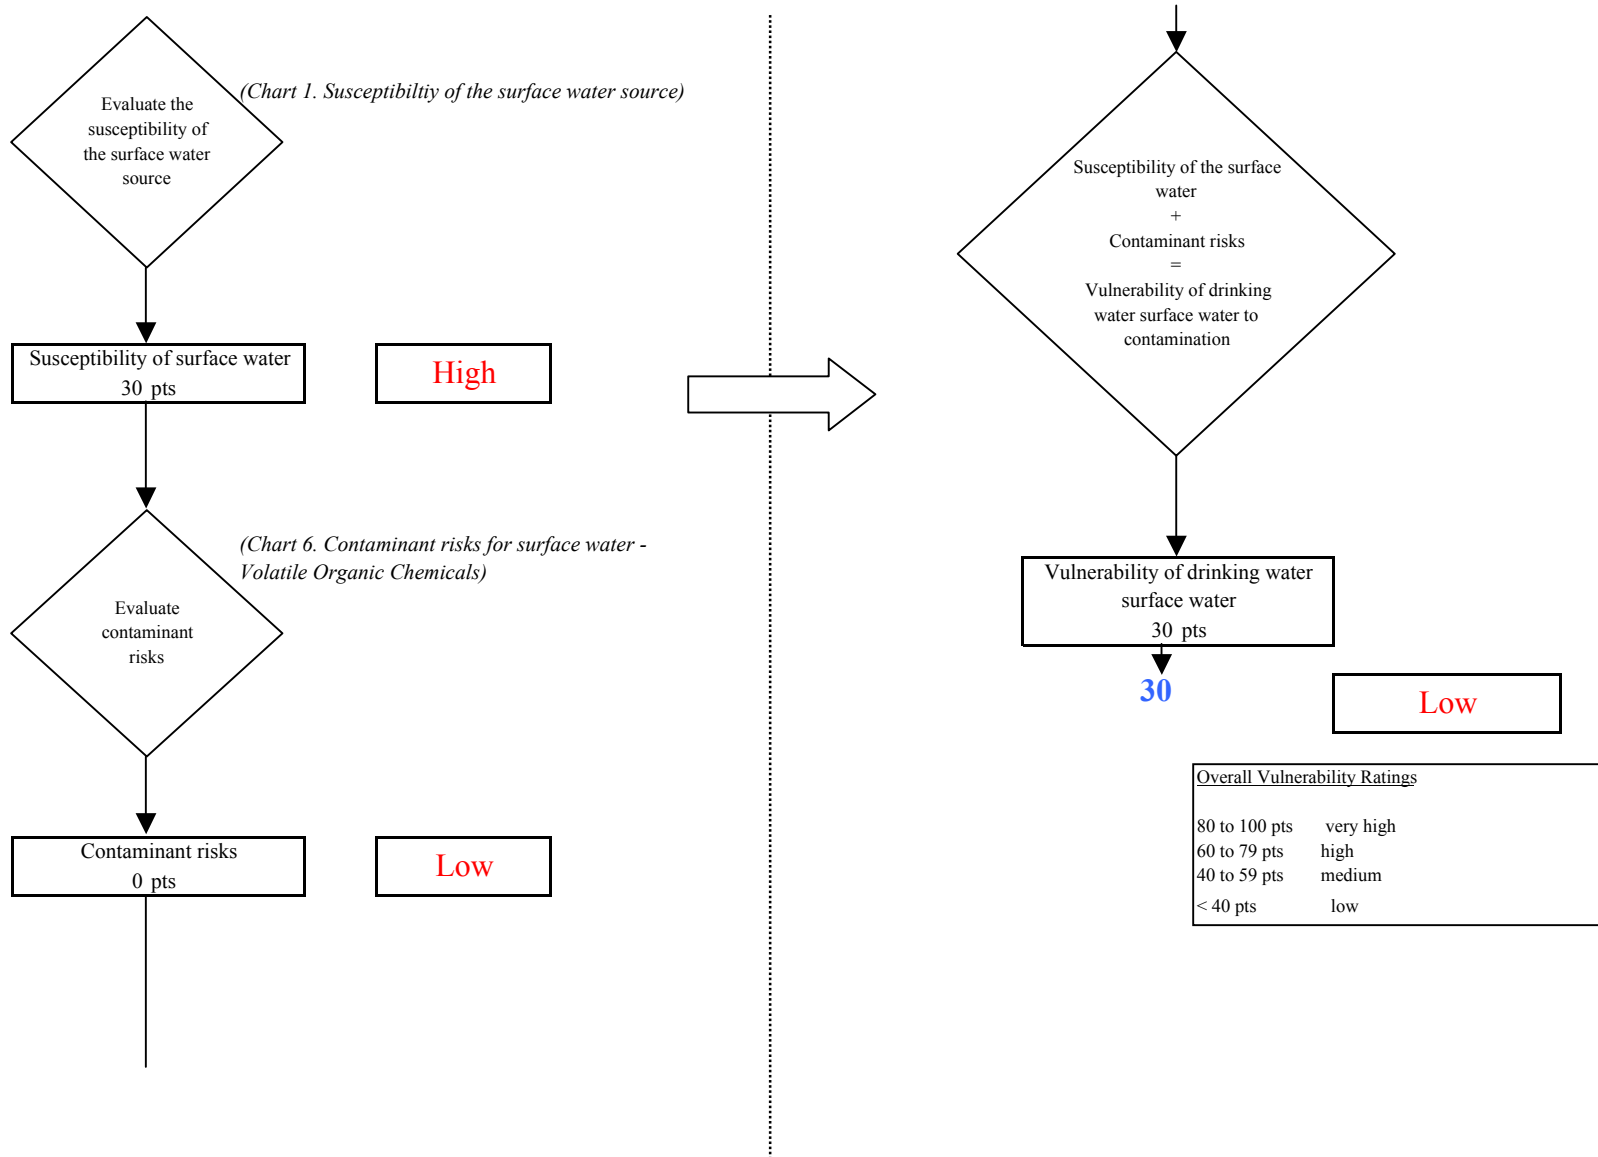


**Chart 8. Contaminant risks for LKSD Kongiganak Water System (PWS No. 271245.001) - Heavy Metals, Cyanide and Other Inorganic Chemicals**

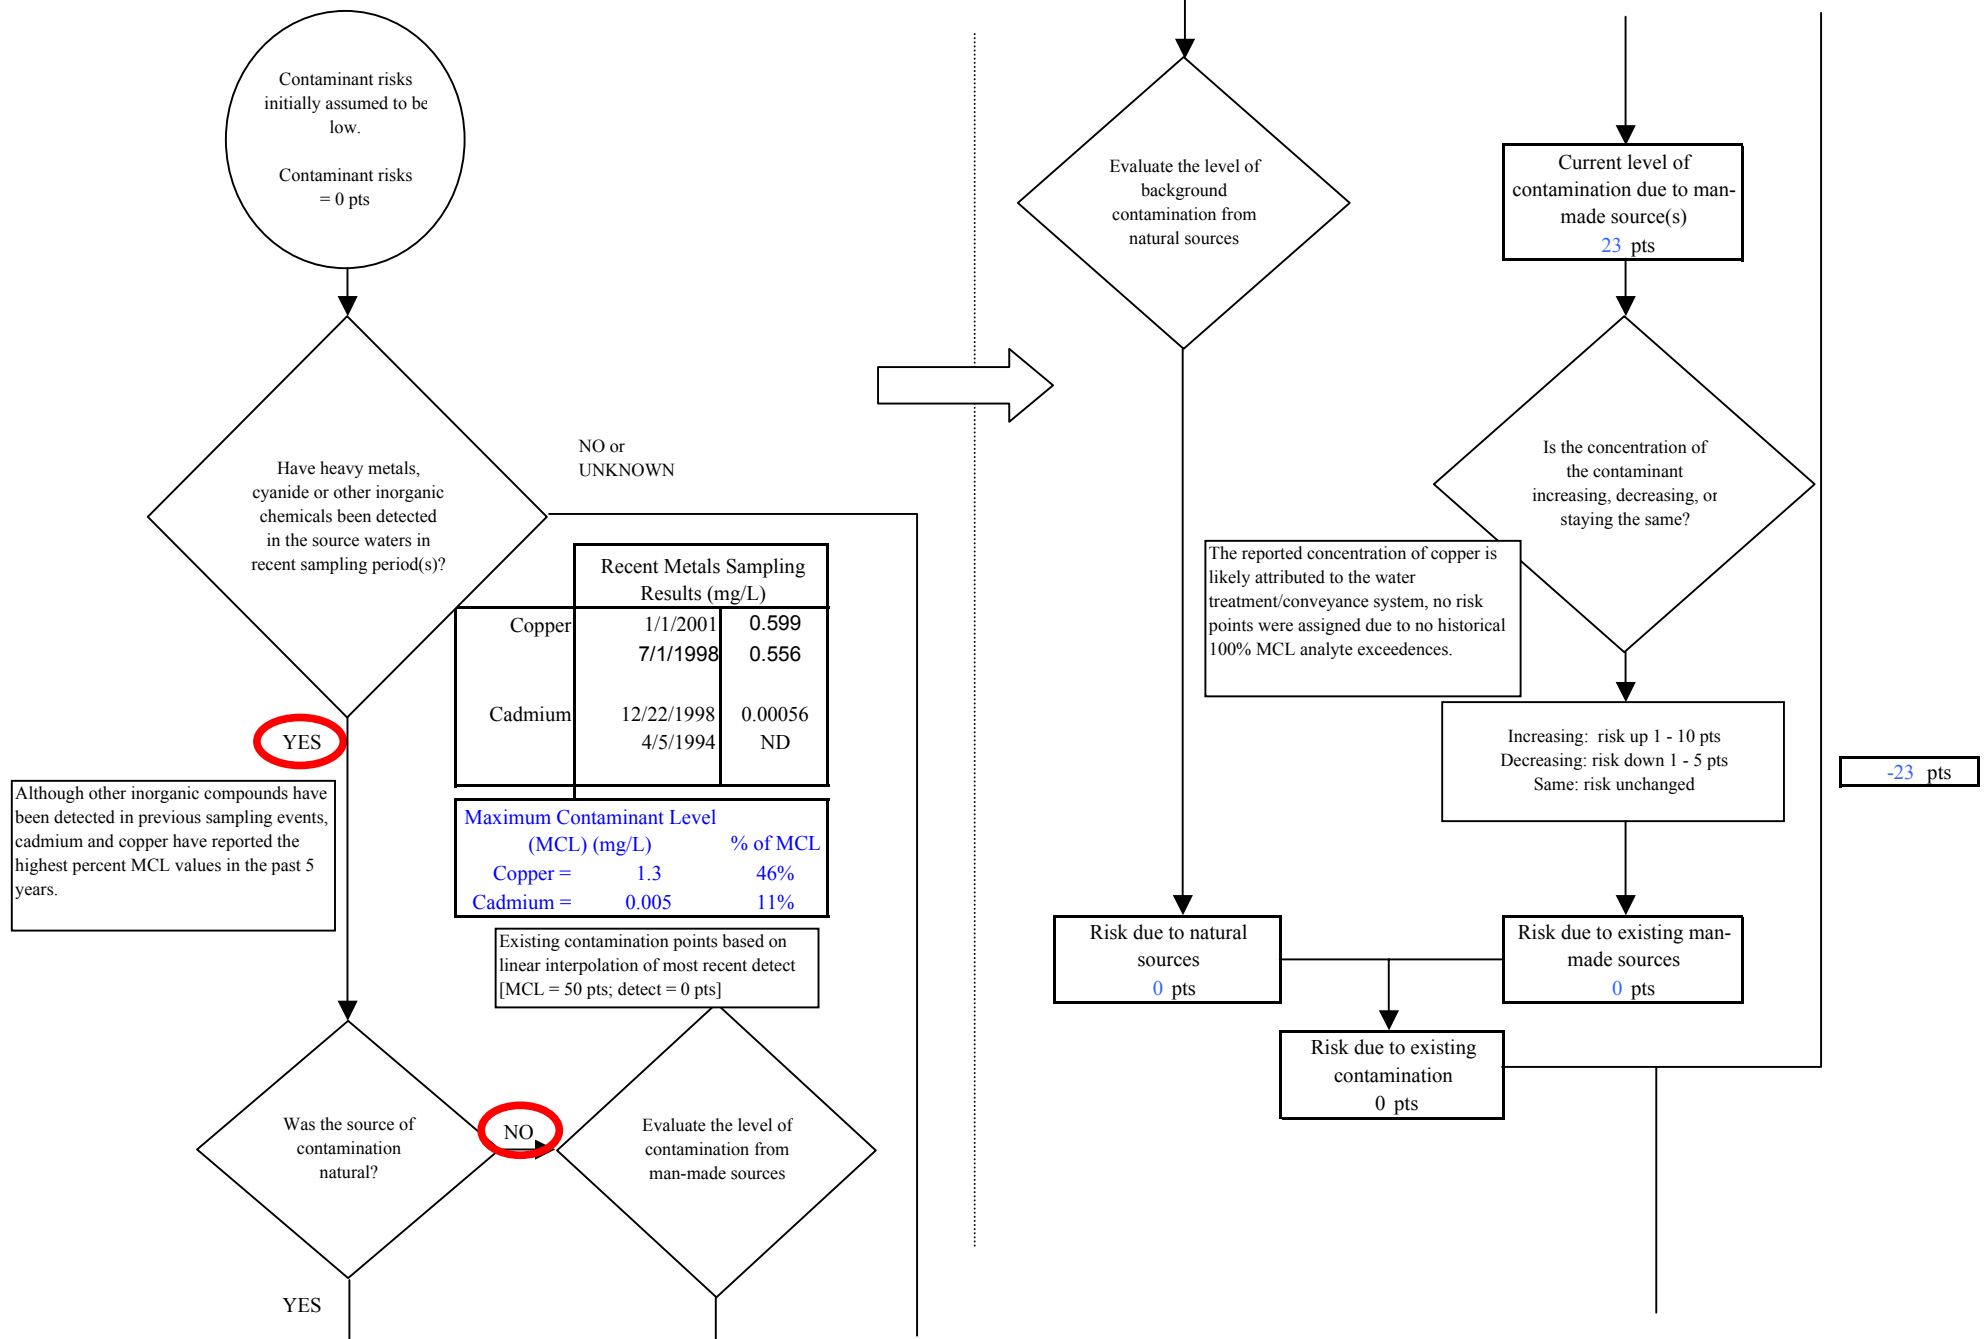

**Chart 8. Contaminant risks for LKSD Kongiganak Water System (PWS No. 271245.001) - Heavy Metals, Cyanide and Other Inorganic Chemicals**

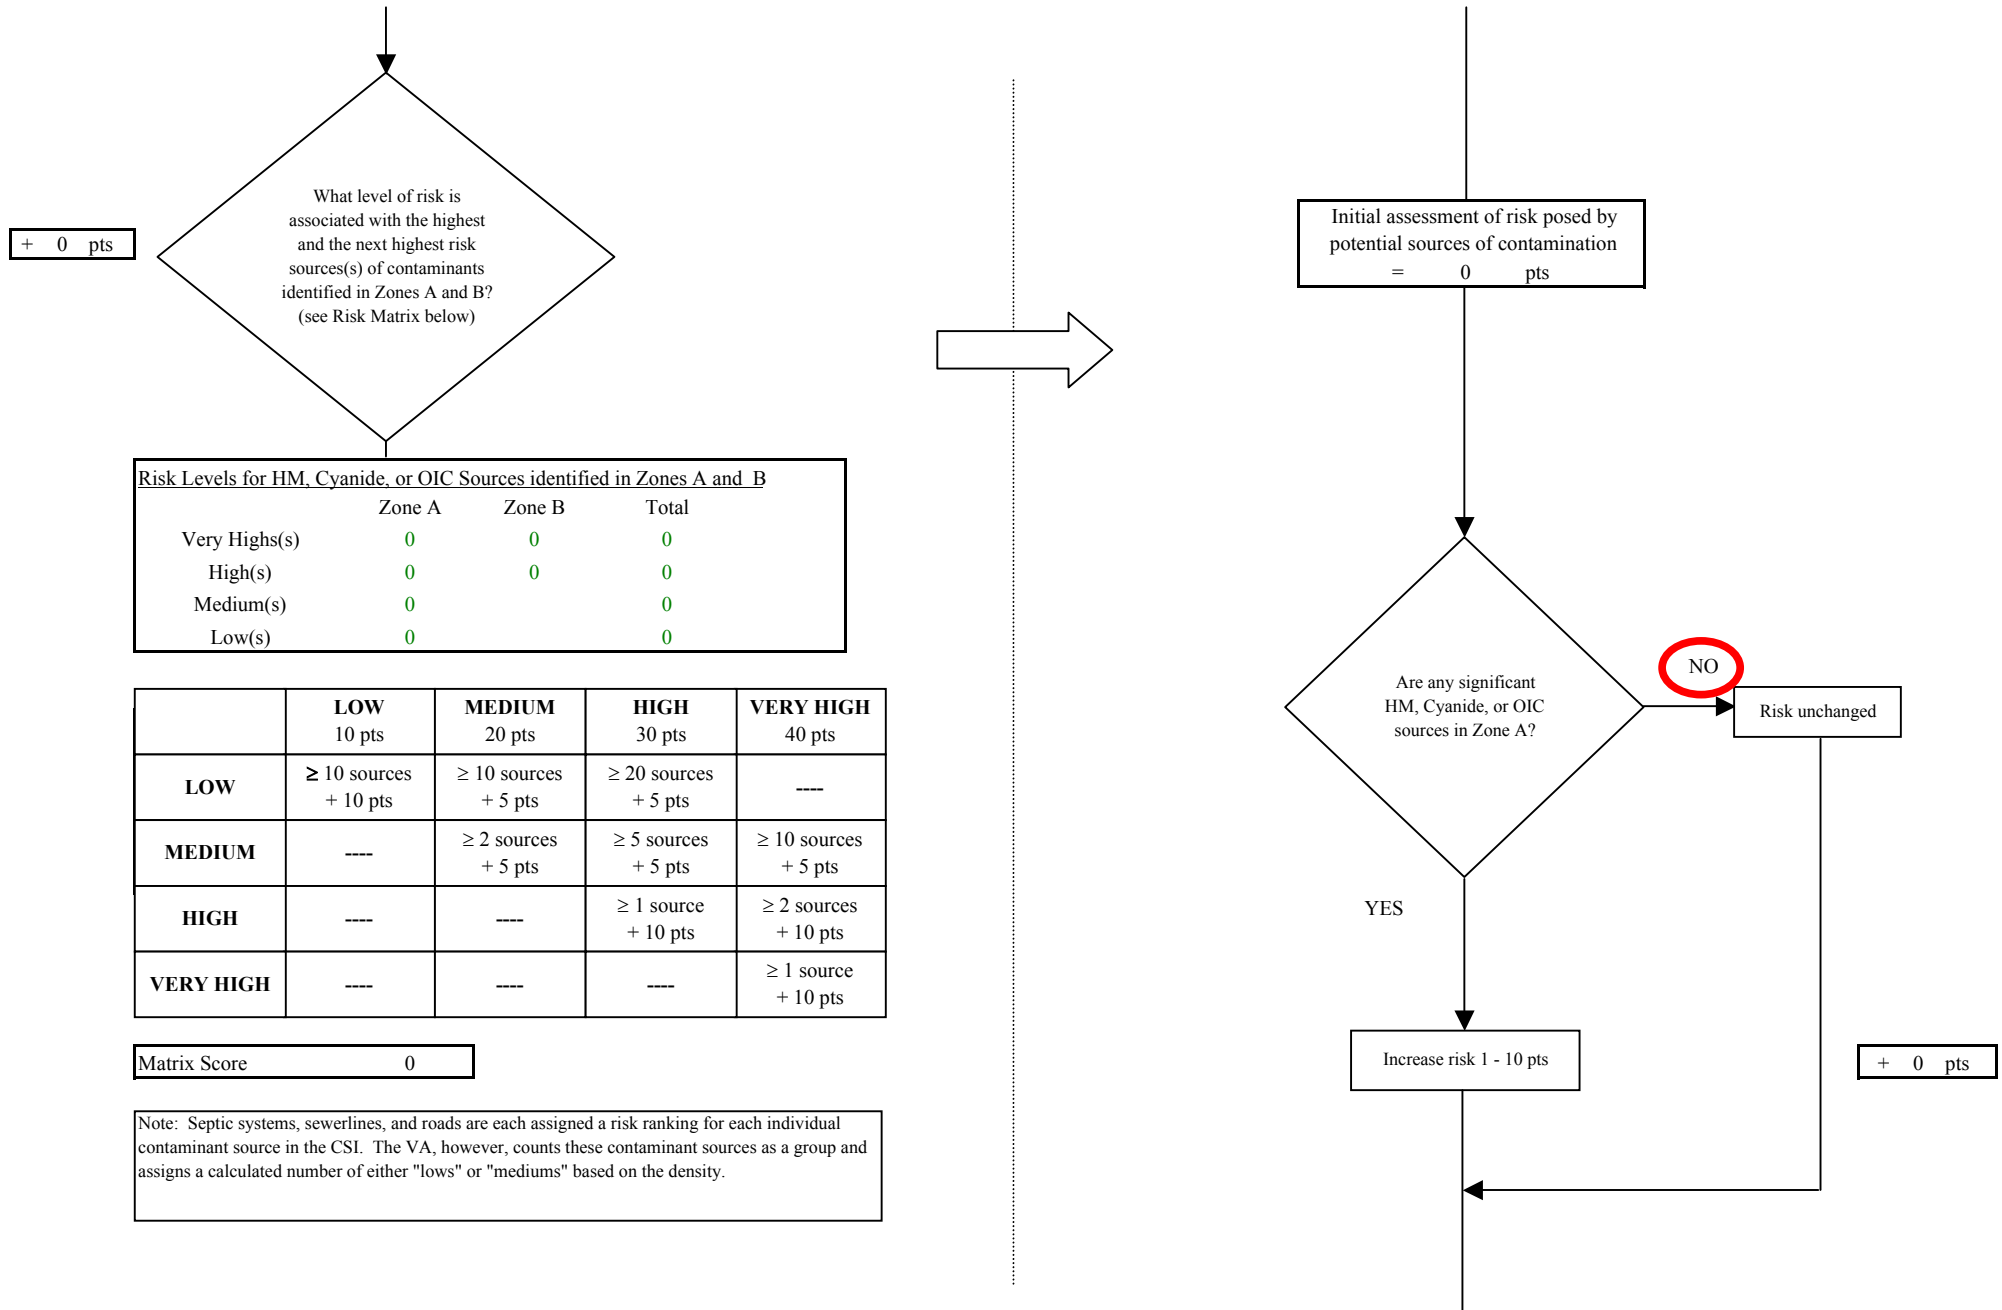

**Chart 8. Contaminant risks for LKSD Kongiganak Water System (PWS No. 271245.001) - Heavy Metals, Cyanide and Other Inorganic Chemicals**

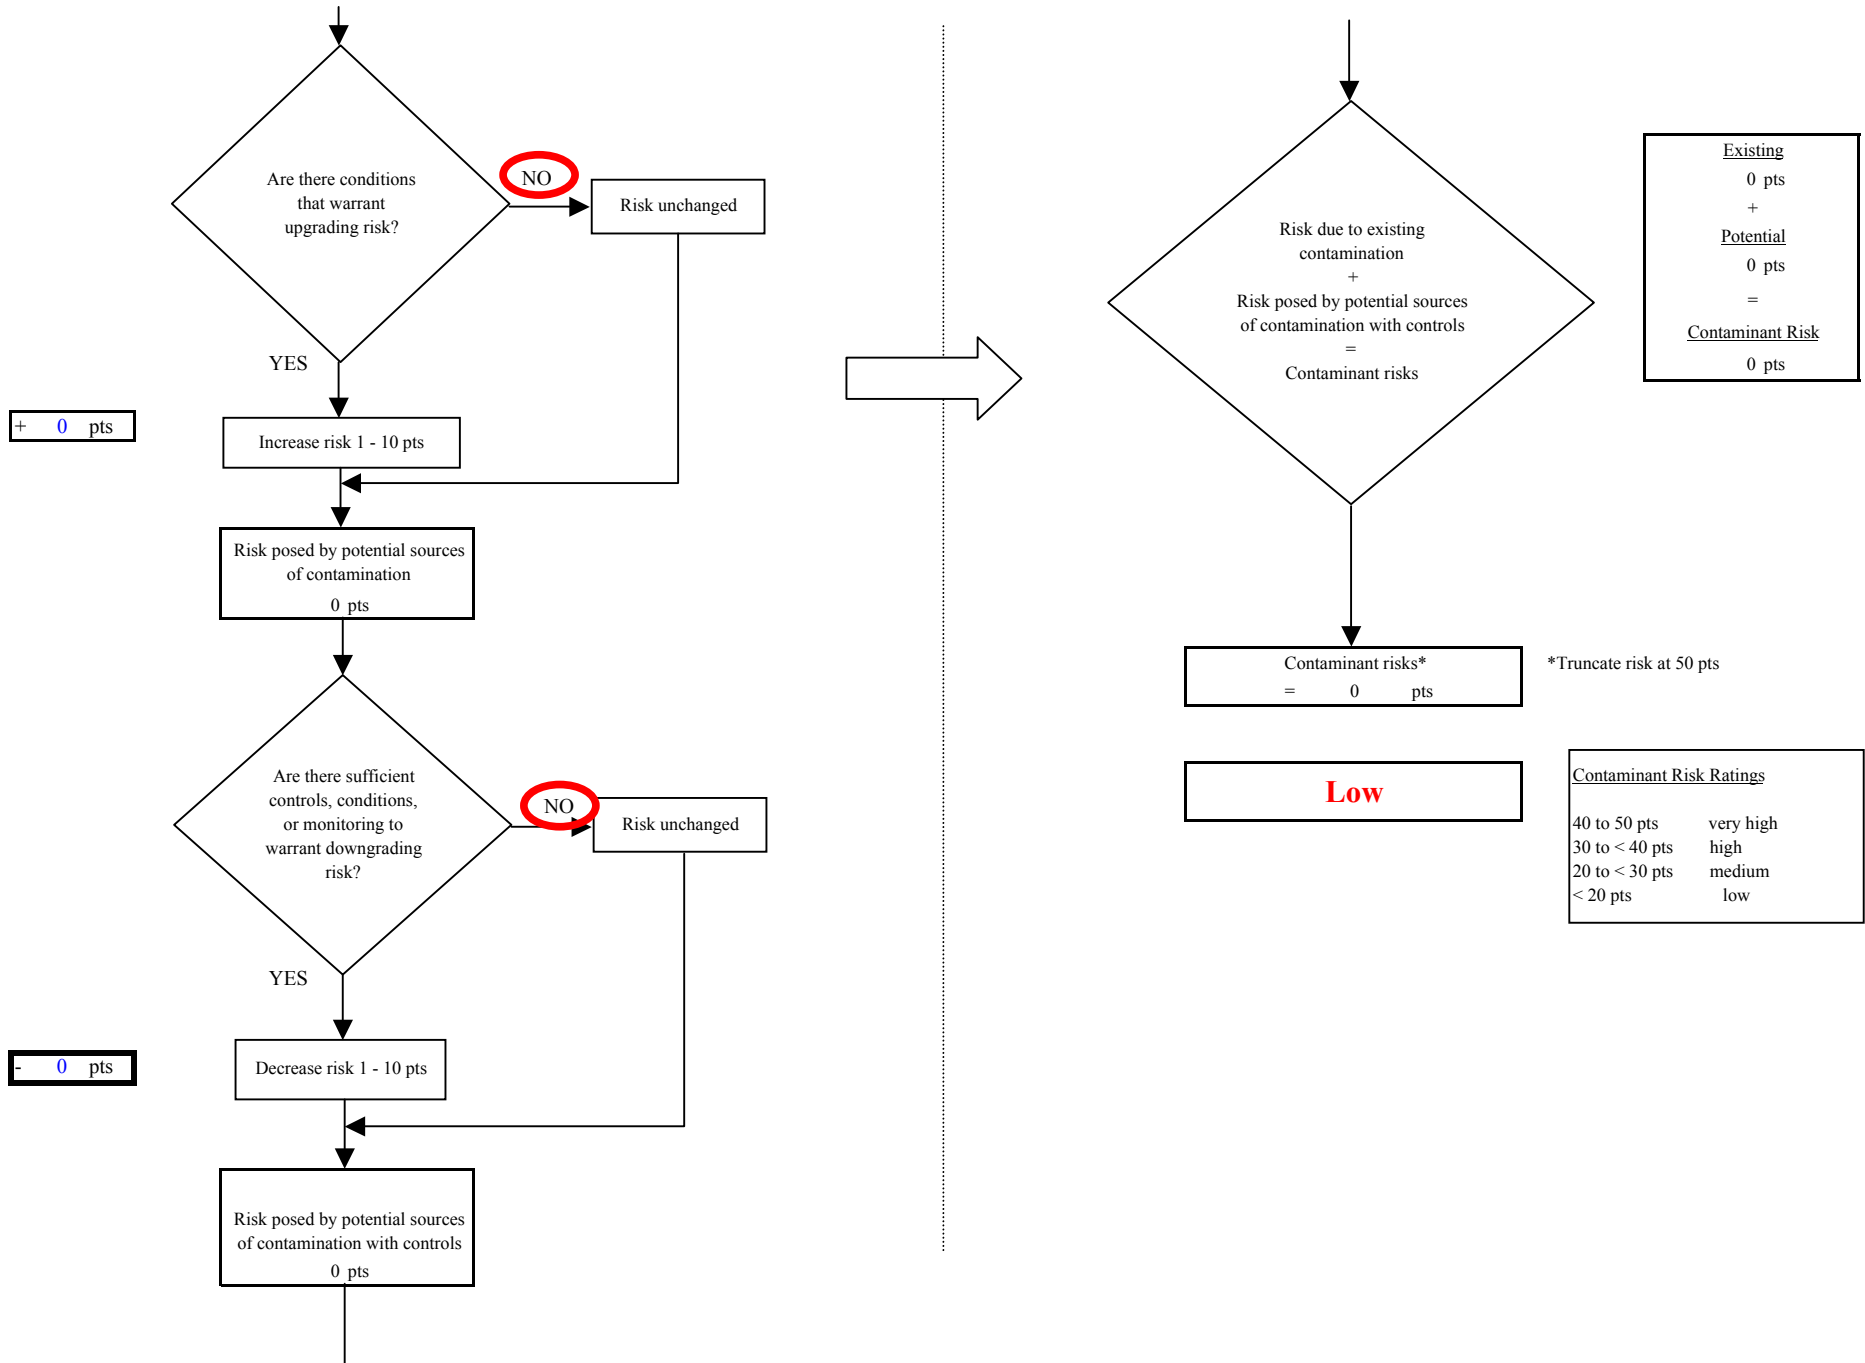

**Chart 9. Vulnerability analysis for LKSD Kongiganak Water System (PWS No. 271245.001) - Heavy Metals, Cyanide and Other Inorganic Chemicals**



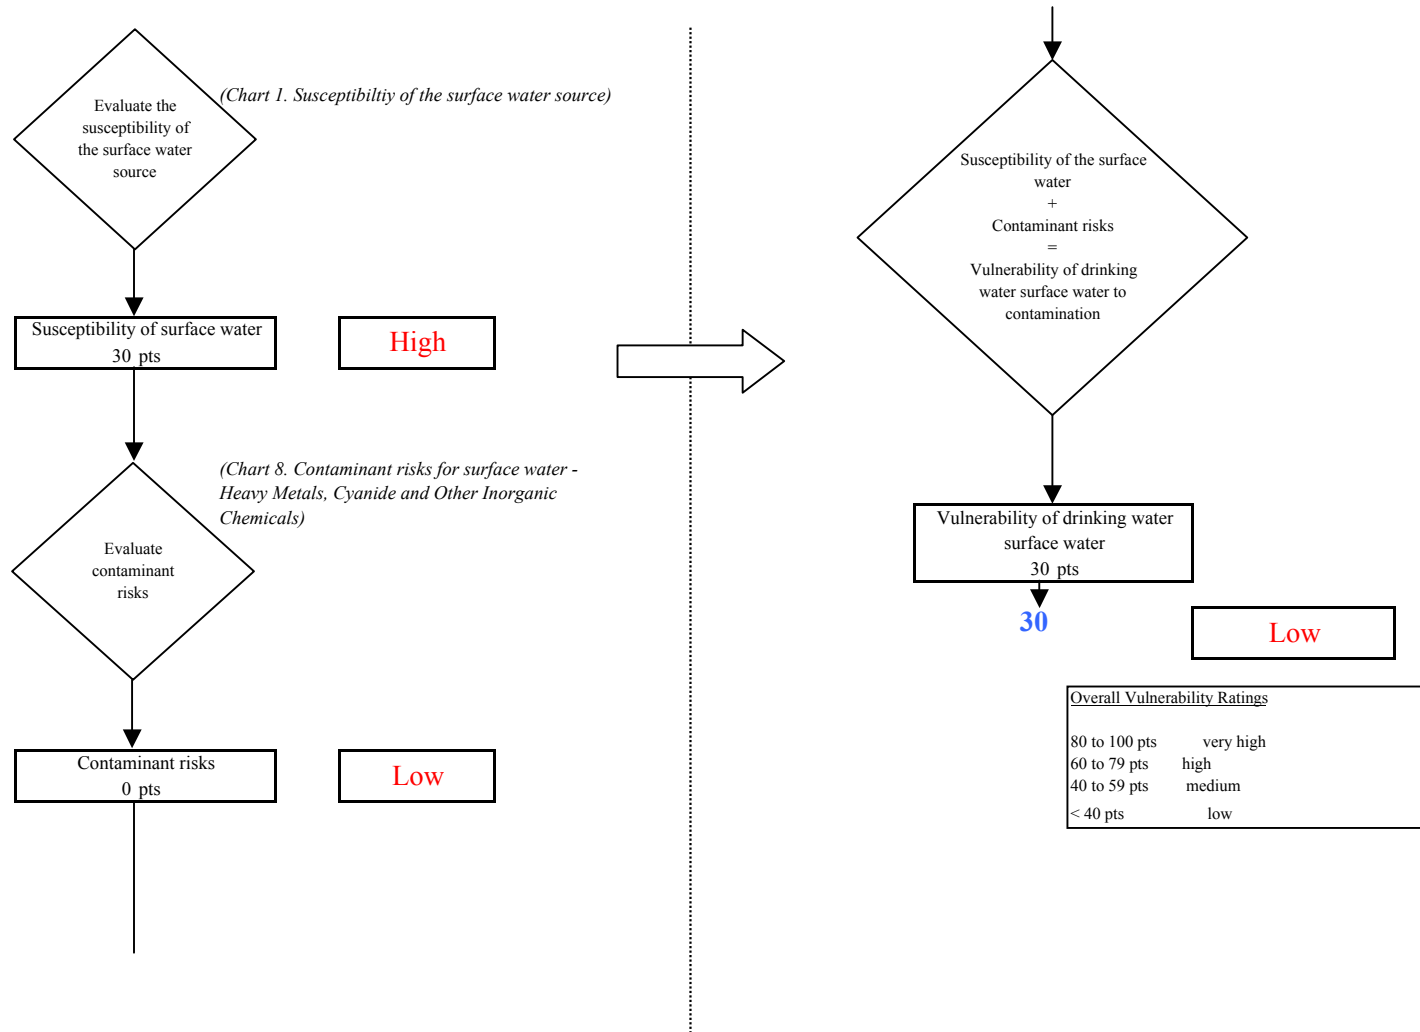




Chart 10. Contaminant risks for LKSD Kongiganak Water System (PWS No. 271245.001) - Synthetic Organic Chemicals

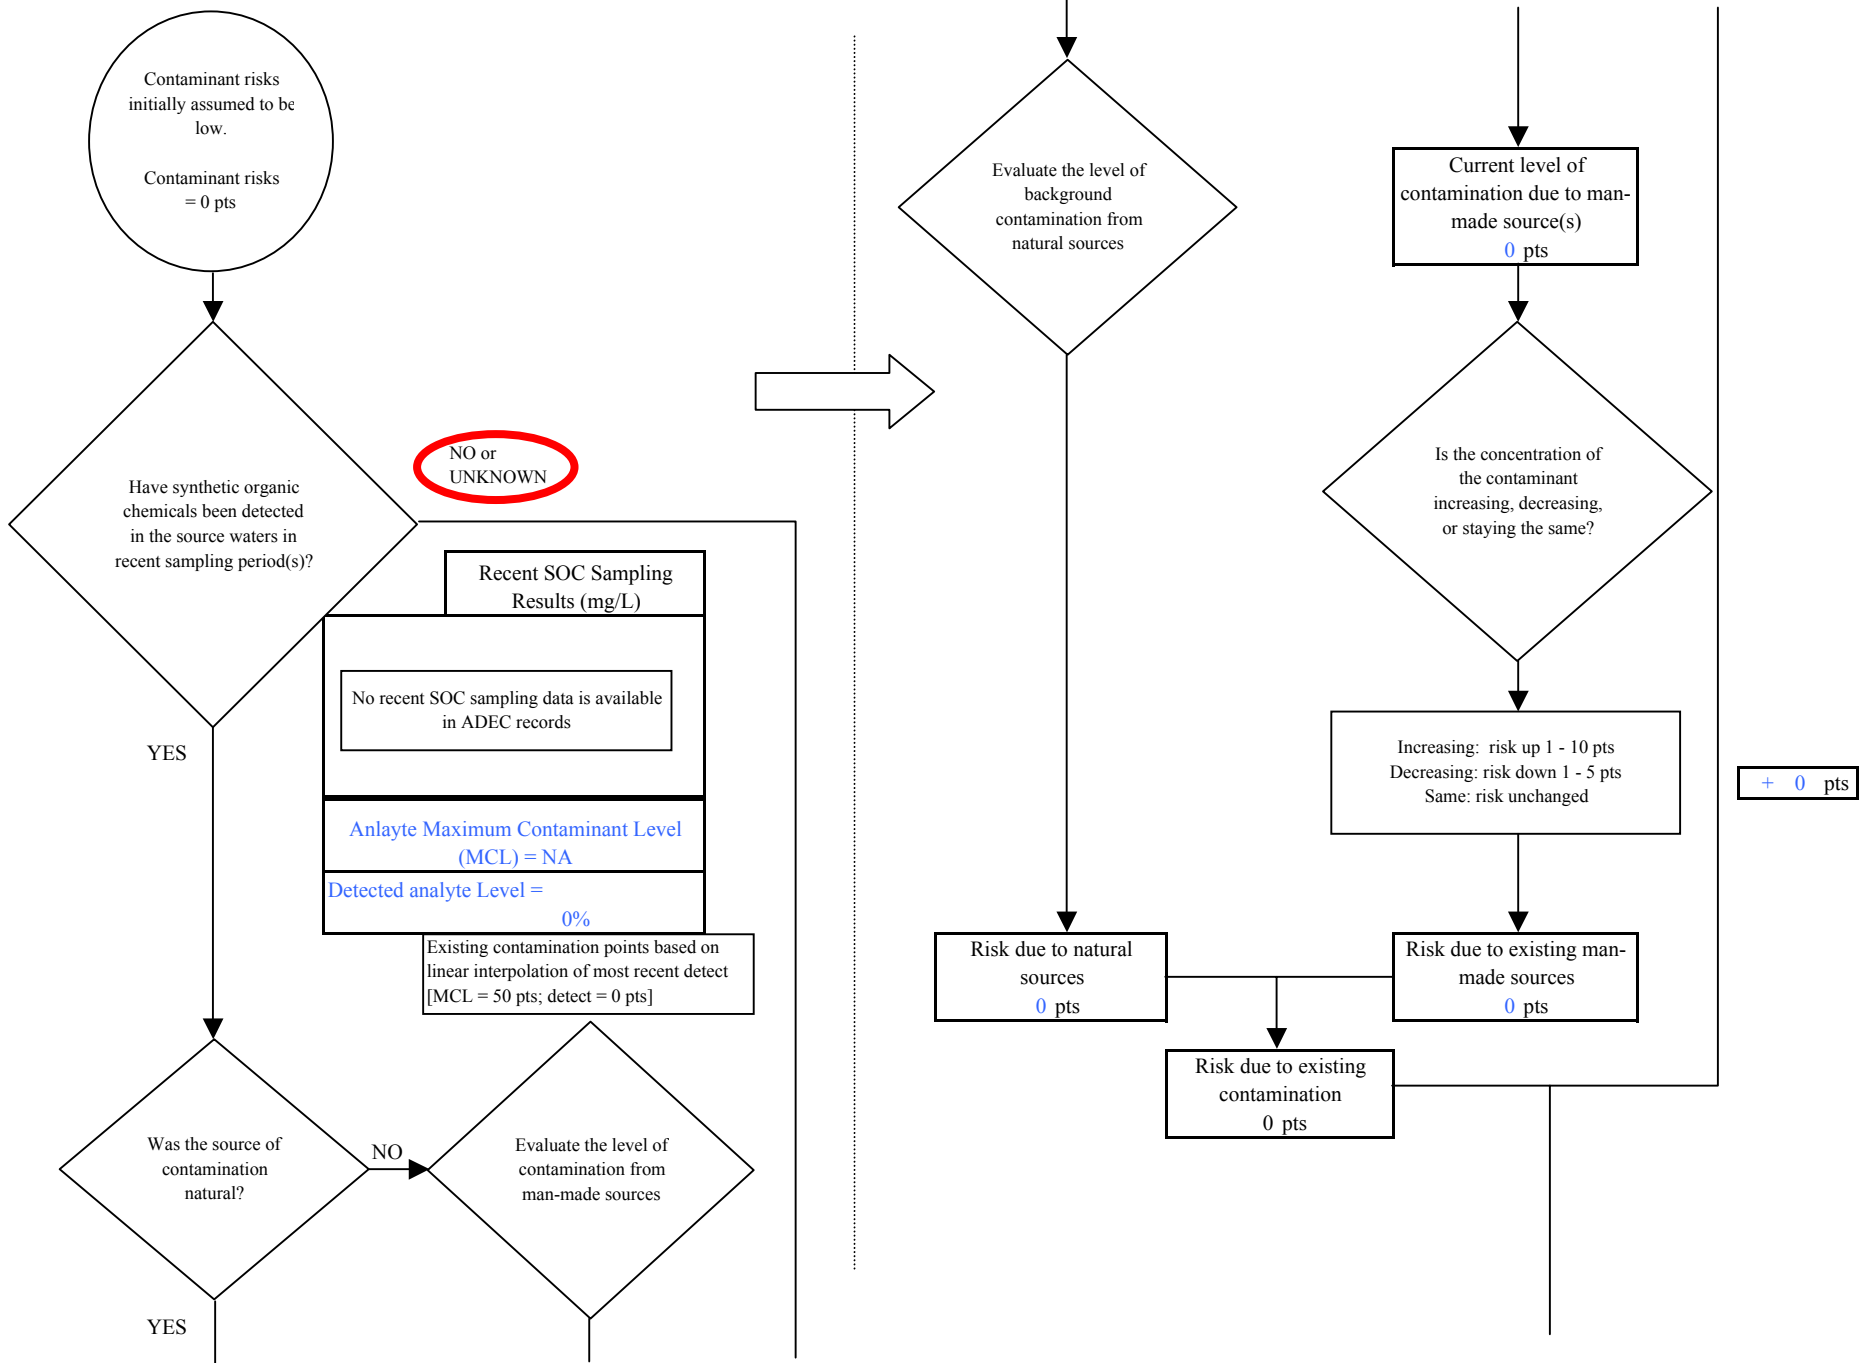

**Chart 10. Contaminant risks for LKSD Kongiganak Water System (PWS No. 271245.001) - Synthetic Organic Chemicals**

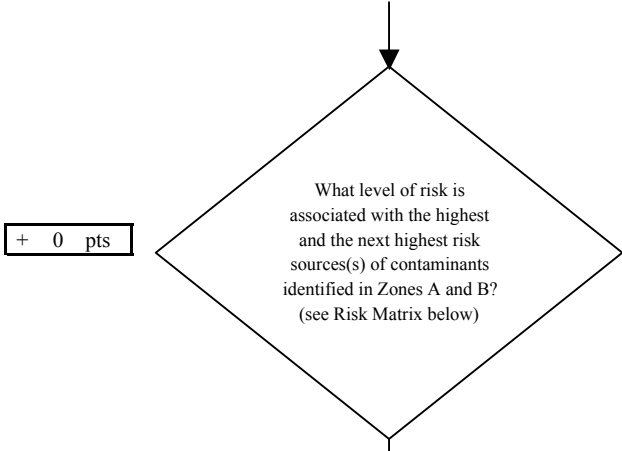



Risk Levels for SOC Sources identified in Zones A and C

	Zone A	Zone B	Total
Very Highs(s)	0	0	0
High(s)	0	0	0
Medium(s)	0	0	0
Low(s)	0	0	0


	LOW 10 pts	MEDIUM 20 pts	HIGH 30 pts	VERY HIGH 40 pts
LOW	≥ 10 sources + 10 pts	≥ 10 sources + 5 pts	≥ 20 sources + 5 pts	----
MEDIUM	----	≥ 2 sources + 5 pts	≥ 5 sources + 5 pts	≥ 10 sources + 5 pts
HIGH	----	----	≥ 1 source + 10 pts	≥ 2 sources + 10 pts
VERY HIGH	----	----	----	≥ 1 source + 10 pts

Matrix Score                    0


Note: Septic systems, sewerlines, and roads are each assigned a risk ranking for each individual contaminant source in the CSI. The VA, however, counts these contaminant sources as a group and assigns a calculated number of either "lows" or "mediums" based on the density.

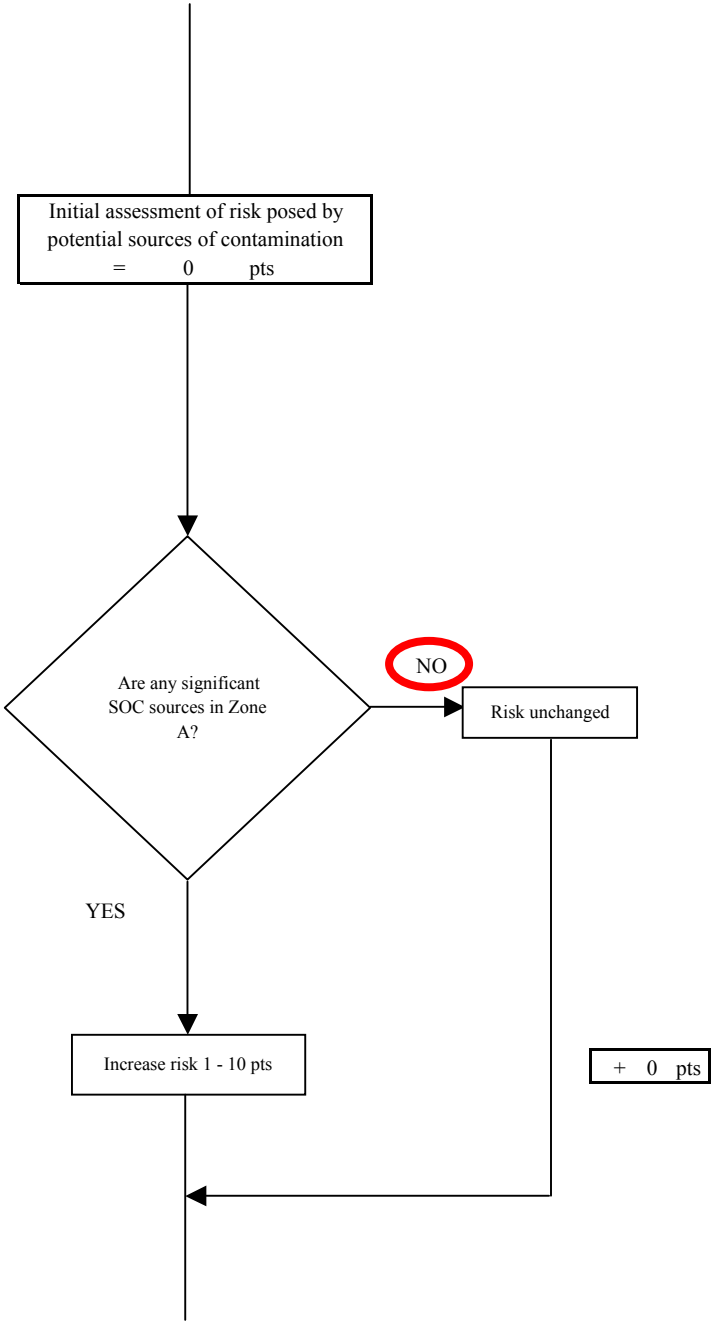


**Chart 10. Contaminant risks for LKSD Kongiganak Water System (PWS No. 271245.001) - Synthetic Organic Chemicals**

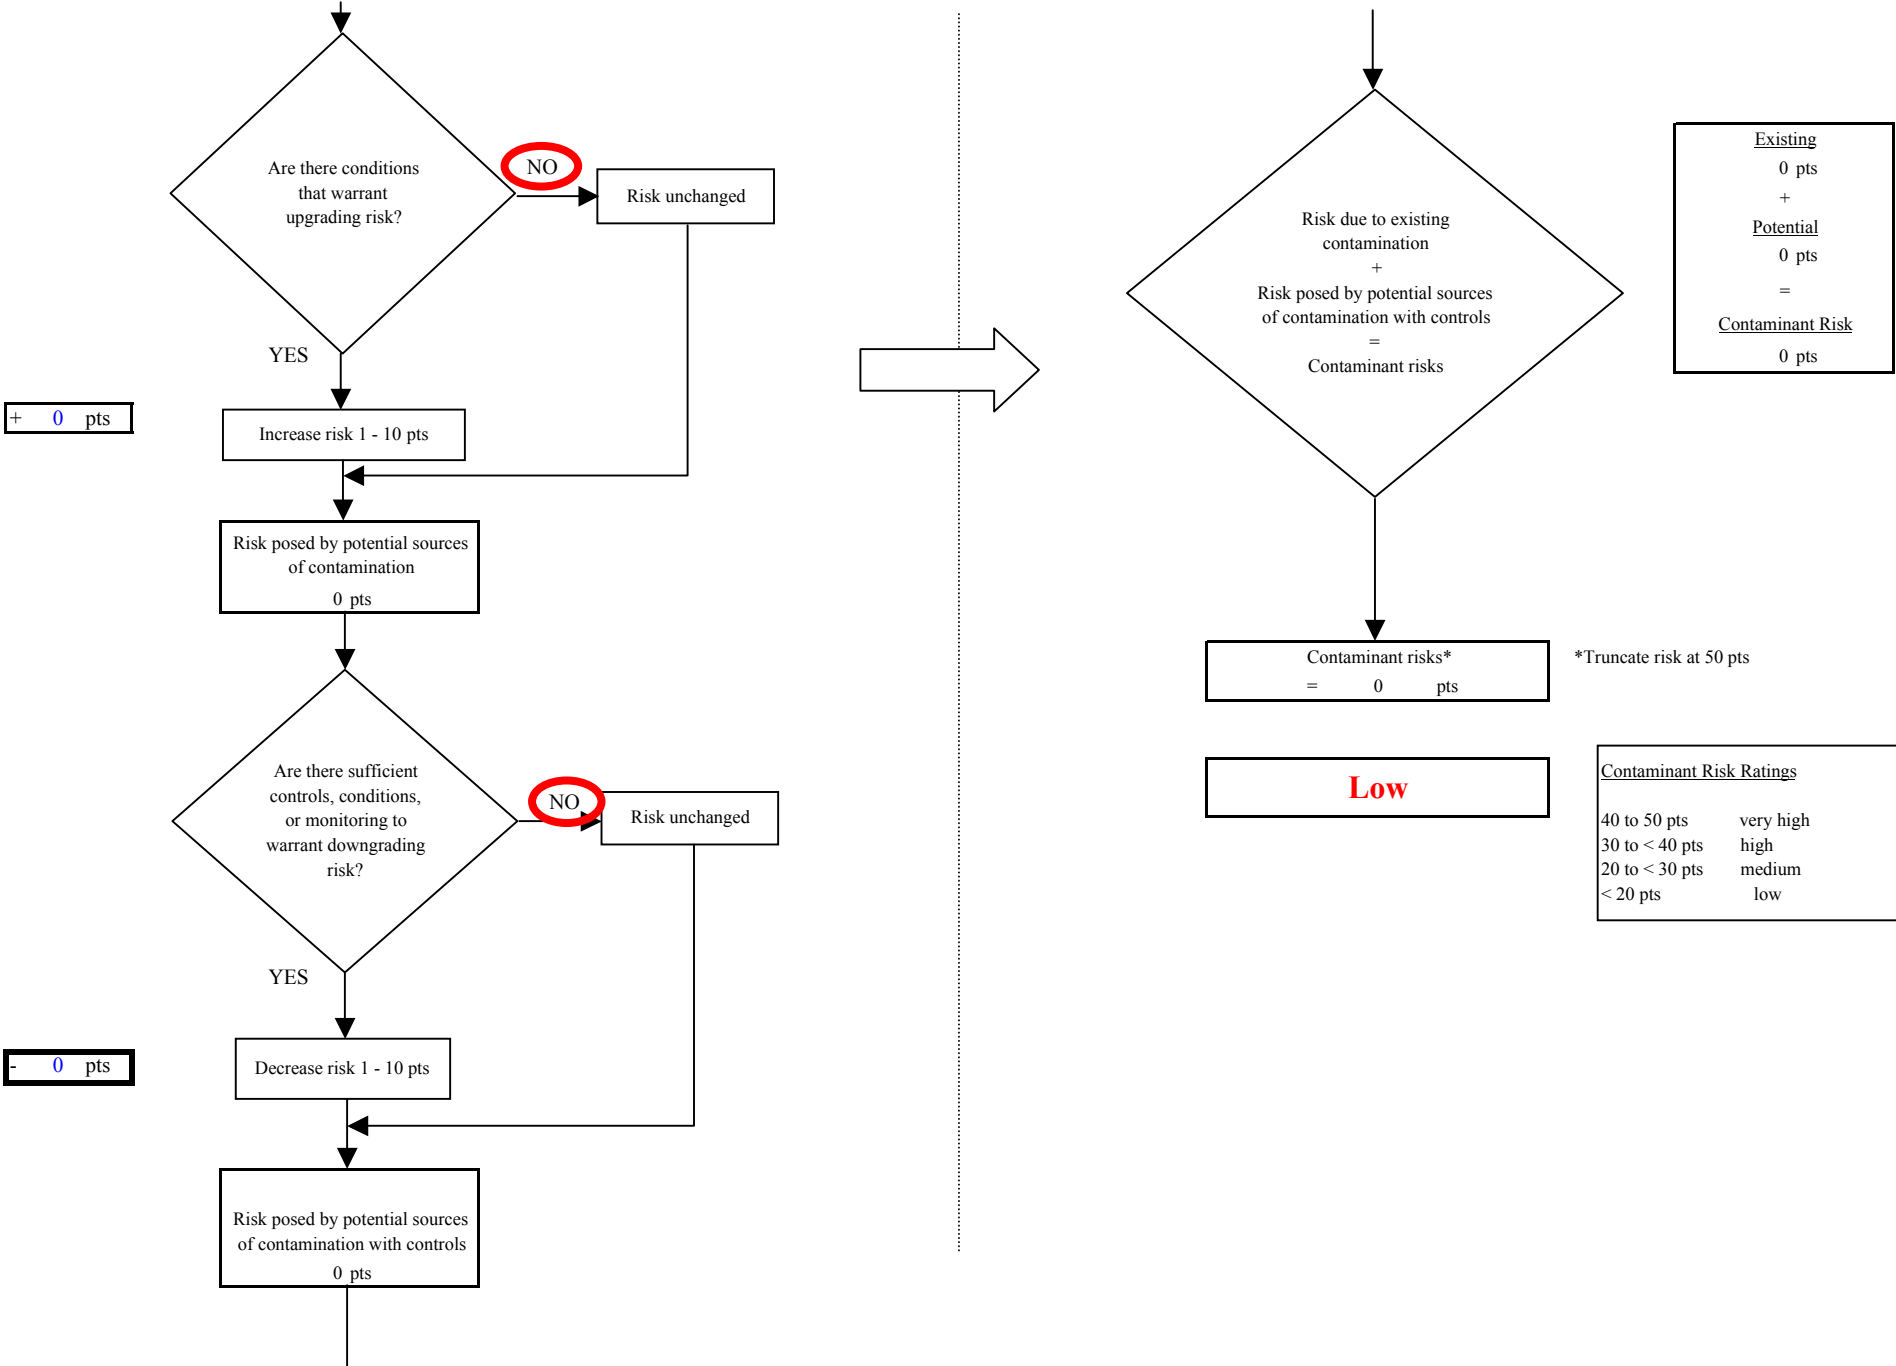

**Chart 11. Vulnerability analysis for LKSD Kongiganak Water System (PWS No. 271245.001) - Synthetic Organic Chemicals**

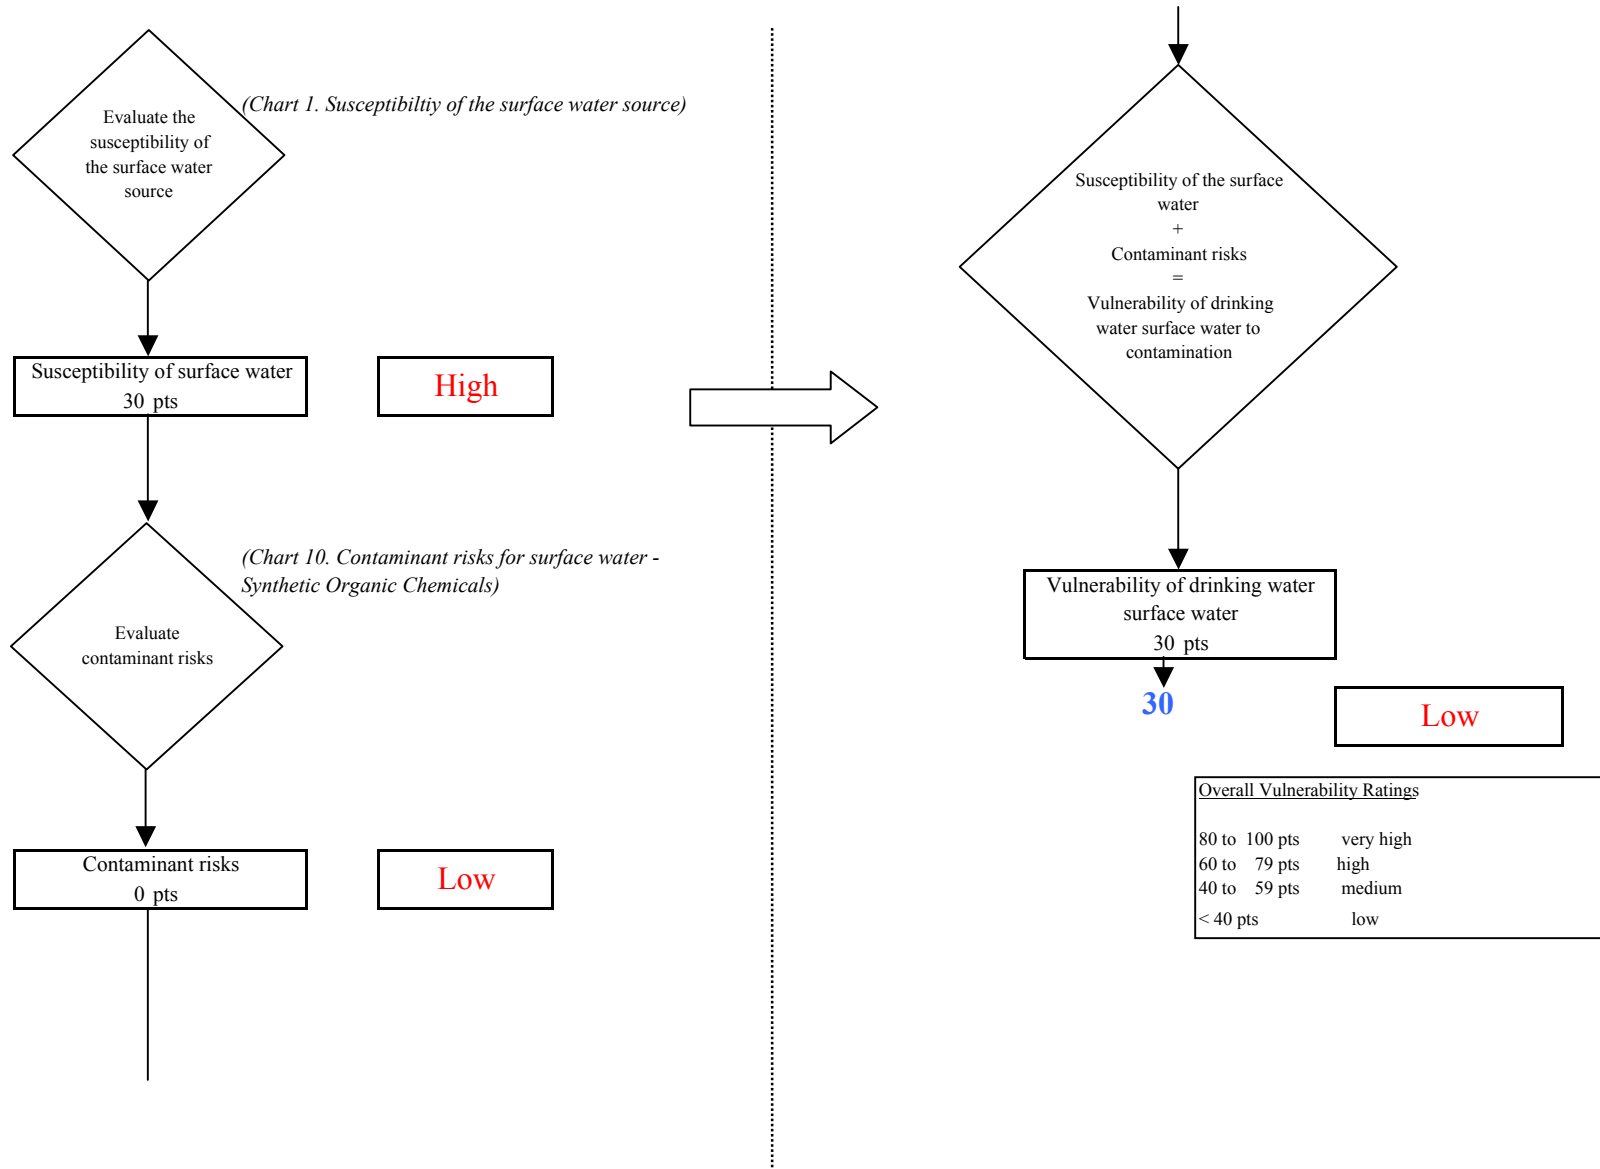

**Chart 12. Contaminant risks for LKSD Kongiganak Water System (PWS No. 271245.001) - Other Organic Chemicals**

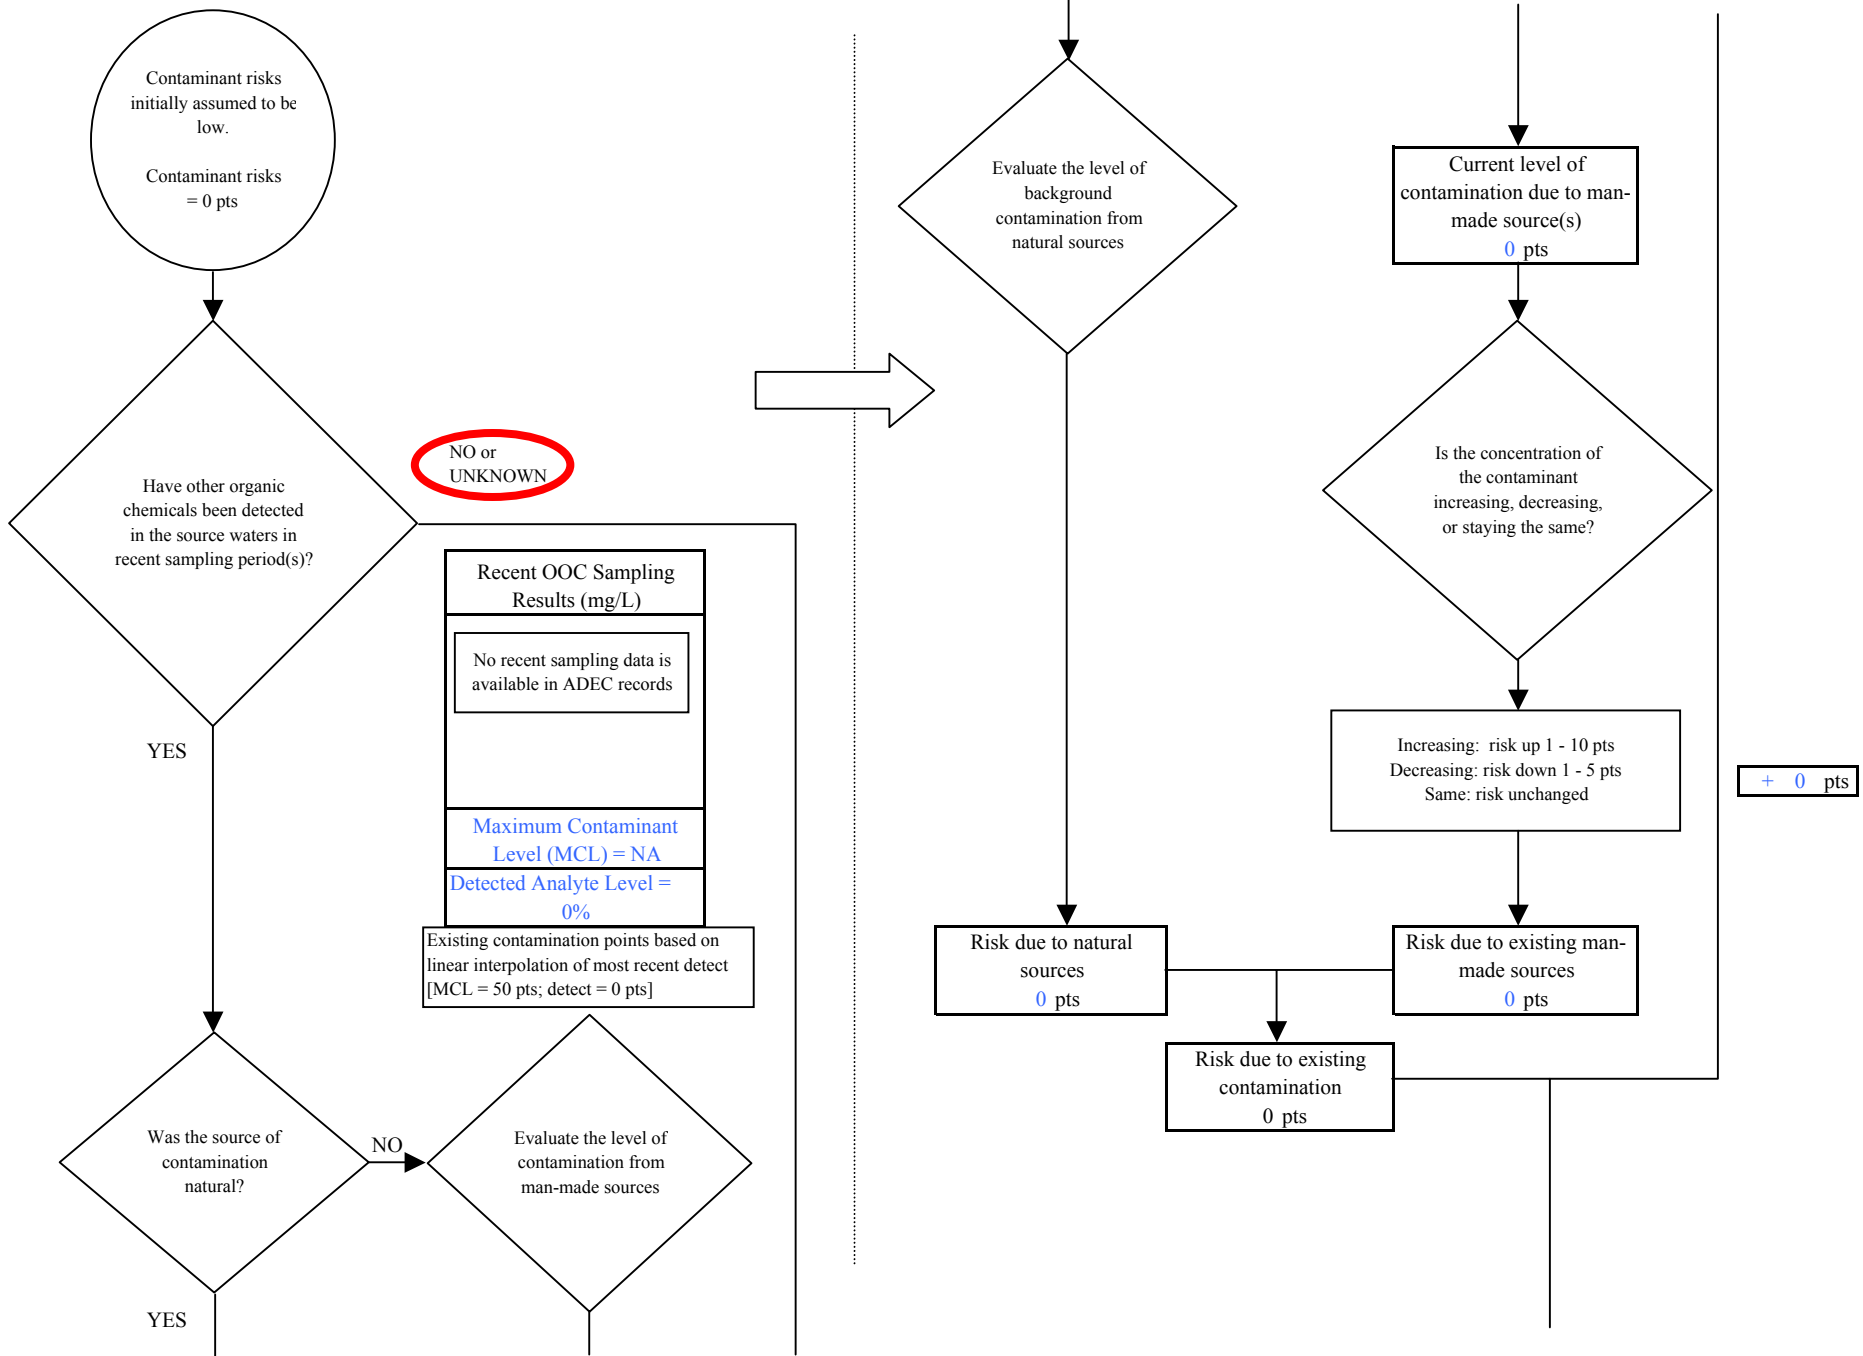

**Chart 12. Contaminant risks for LKSD Kongiganak Water System (PWS No. 271245.001) - Other Organic Chemicals**


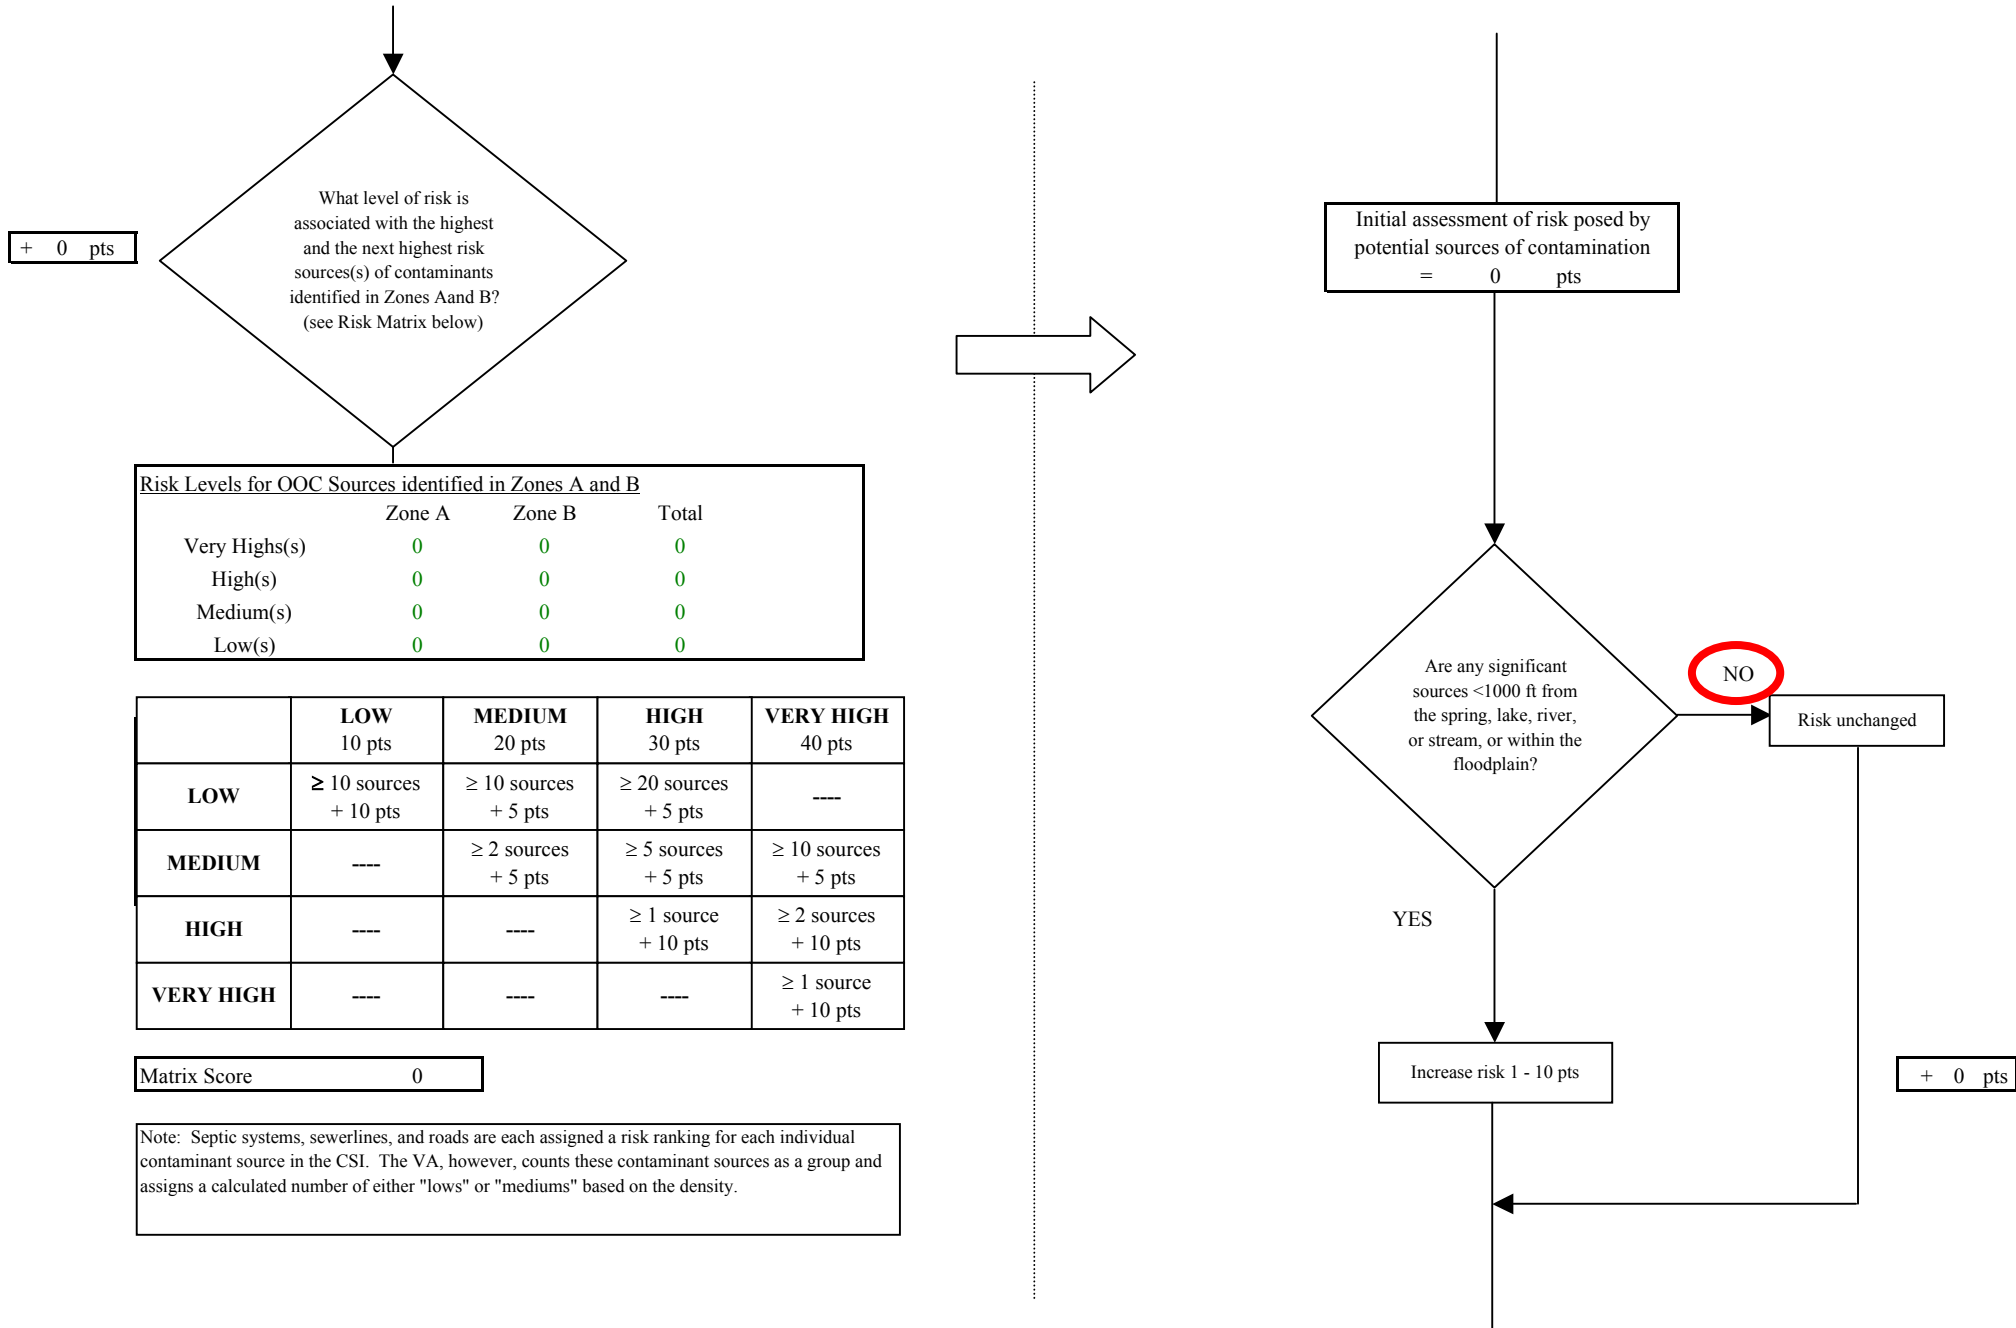


Chart 12. Contaminant risks for LKSD Kongiganak Water System (PWS No. 271245.001) - Other Organic Chemicals



**Chart 13. Vulnerability analysis for LKSD Kongiganak Water System (PWS No. 271245.001) - Other Organic Chemicals**

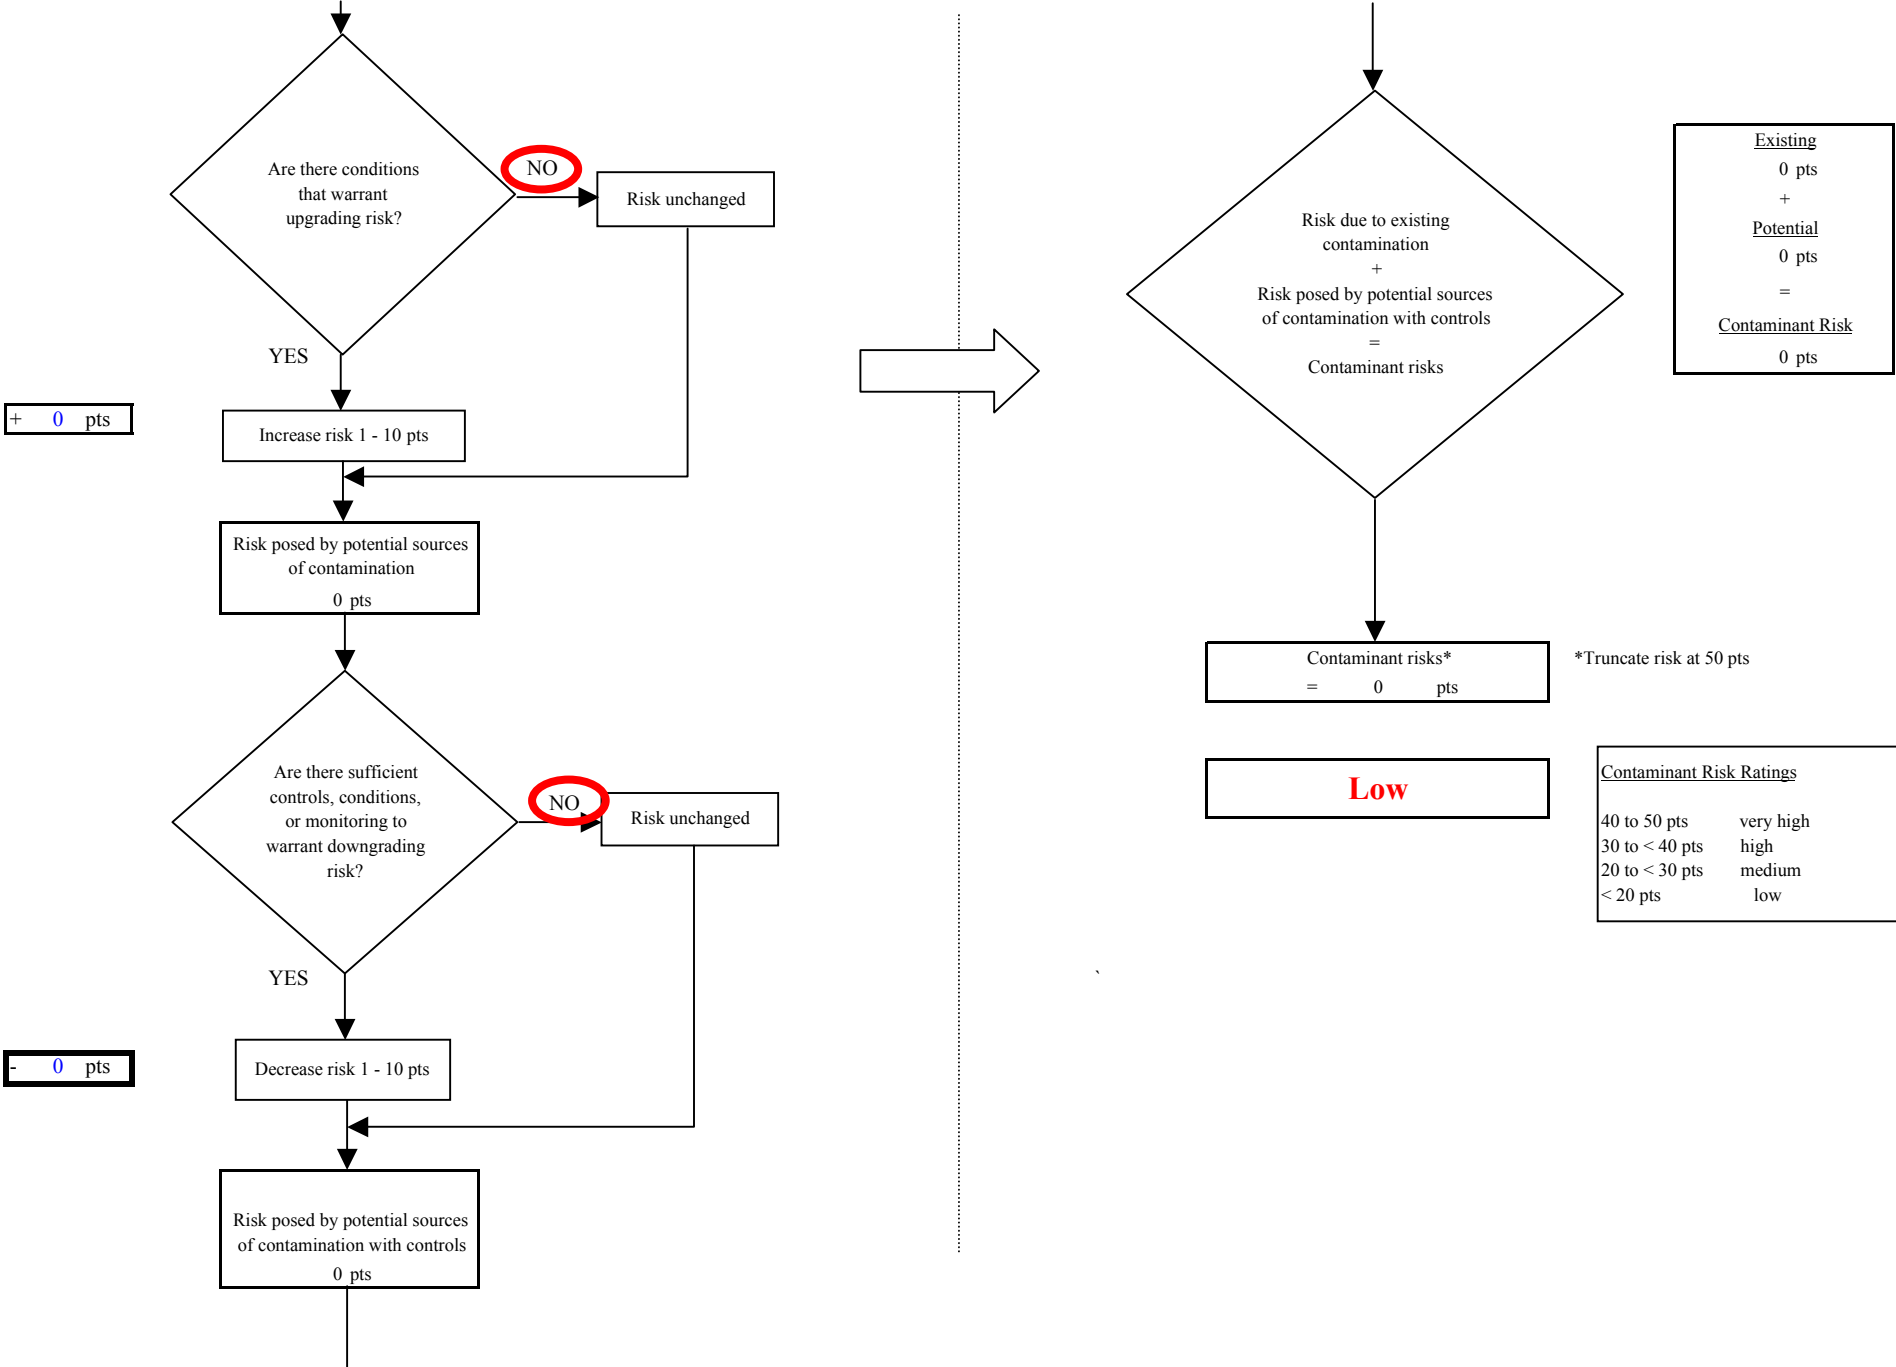