



Source Water Assessment

A Hydrogeologic Susceptibility and Vulnerability Assessment for Napaskiak East Watering Point Drinking Water System, Napaskiak, Alaska

PWSID # 271952.001

April 2004

DRINKING WATER PROTECTION PROGRAM REPORT 1144 Alaska Department of Environmental Conservation

Source Water Assessment for Napaskiak East Watering Point Drinking Water System Napaskiak, Alaska

PWSID # 271952.001

DRINKING WATER PROTECTION PROGRAM REPORT 1144

The Drinking Water Protection Program (DWPP) is producing Source Water Assessments in compliance with the Safe Drinking Water Act Amendments of 1996. Each assessment includes a delineation of the source water area, an inventory of potential and existing contaminant sources that may impact the water, a risk ranking for each of these contaminants, and an evaluation of the potential vulnerability of these drinking water sources.

These assessments are intended to provide public water systems owners/operators, communities, and local governments with the best available information that may be used to protect the quality of their drinking water. The assessments combine information obtained from various sources, including the U.S. Environmental Protection Agency, Alaska Department of Environmental Conservation (ADEC), public water system owners/operators, and other public information sources. The results of this assessment are subject to change if additional data becomes available. It is anticipated this assessment will be updated every five years to reflect any changes in the vulnerability and/or susceptibility of public drinking water source. If you have any additional information that may affect the results of this assessment, please contact the Program Coordinator of DWPP, (907) 269-7521.

CONTENTS

EXECUTIVE SUMMARY1 PUBLIC DRINKING WATER SYSTEM1			INVENTORY OF POTENTIAL AND EXISTING CONTAMINANT SOURCES			
		R PROTECTION AREA2	RANKING OF CONTAMINANT RISKS2 VULNERABILITY OF DRINKING WATER			
			SYSTEM			
		TABI	LES			
			2			
			4			
			4			
		APPENI	DICES			
APPENDIX	A.	Napaskiak East Watering Point Drink	ing Water Protection Area (Map A)			
	В.	Contaminant Source Inventory for Na	paskiak East Watering Point (Table 1)			
		Contaminant Source Inventory and R Bacteria and Viruses (Table 2)	isk Ranking for Napaskiak East Watering Point –			
		` ,	isk Ranking for Napaskiak East Watering Point -			
		Contaminant Source Inventory and Ri Volatile Organic Chemicals (Table 4)	sk Ranking for Napaskiak East Watering Point –			
		Contaminant Source Inventory and Ri Heavy Metals, Cyanide and Other Inc	sk Ranking for Napaskiak East Watering Point –			
			sk Ranking for Napaskiak East Watering Point -			
		Contaminant Source Inventory and Ri Other Organic Chemicals (Table 7)	sk Ranking for Napaskiak East Watering Point –			
	C.	Napaskiak East Watering Point Drink and Existing Contaminant Source	ring Water Protection Area and Potential es (Map C)			
	D.		ant Source Inventory and Risk Ranking for Public Drinking Water Source (Charts 1 – 14)			

Source Water Assessment for Napaskiak East Watering Point Source of Public Drinking Water, Napaskiak, Alaska

Drinking Water Protection Program Alaska Department of Environmental Conservation

EXECUTIVE SUMMARY

The Napaskiak East Watering Point has one Public Water System (PWS) wells. The well (PWS No. 271952.001) has been used as a drinking water source since it was drilled in 1993.

The well is a Class A (community and non-transient/non-community) water system located on the east side of HUD housing in Napaskiak, Alaska. Available records indicate that there is water storage with a capacity of 1,600-gallons, and that the drinking water is treated with calcium hypochlorite. This system operates year round and serves approximately 367 residents through one service connection. The wellhead received a susceptibility rating of **Very High** and the aquifer received a susceptibility rating of **Very High**. Combining these two ratings produce a **Very High** rating for the natural susceptibility of the well.

Identified potential and current sources of contaminants for the public drinking water source include: domestic wastewater treatment plant disposal ponds/lagoons, nonresidential pit toilets, landfills, aboveground fuel tanks, wastewater holding tanks, ADEC recognized contaminated sites, water supply wells, cemeteries, petroleum product bulk station/terminals, airports, roads, electric power generation, firehouses, and a medical/veterinary facility. These identified potential and existing sources of contamination are considered as sources of bacteria and viruses, nitrates and/or nitrites, volatile organic chemicals, heavy metals, cyanide and other inorganic chemicals, synthetic organic chemicals, and other organic chemicals contaminant categories.

Overall, the water well received a vulnerability rating of **Very High** for bacteria and viruses, nitrates and nitrites, volatile organic chemicals, heavy metals, cyanide and other inorganic chemicals, synthetic organic chemicals, and other organic chemicals contaminant categories.

PUBLIC DRINKING WATER SYSTEM

The Napaskiak East Watering Point well is a Class A (community/non-transient/non-community) public water system. The system is located on the east side of HUD housing in Napaskiak, Alaska (Sec. 8, T7N, R71W, Seward Meridian; see Map A of Appendix A). Napaskiak is located on the east bank of the Kuskokwim River, along the Napaskiak Slough, seven miles southeast of Bethel. The community has a population of 408 (ADCED, 2003). Average annual precipitation for Bethel is 16 inches, including approximately 50 inches of snowfall. Temperatures range from 42 to 62°F in summer and -2 to 19°F in winter.

The community of Napaskiak obtains their water from community wells and hauls the treated water from one of two watering points to residences. Honey buckets are disposed of by residents in bunkers at various locations and the sewage is then pumped and transported to the sewage lagoon. (ADCED, 2003). Napaskiak Electric Utility provides electricity. Power generating facilities are fueled by diesel. Refuse is collected by the City of Napaskiak and transported to the City operated landfill (ADCED, 2003).

According to information supplied by ADEC for the Napaskiak East Watering Point PWS, the depth of the primary water well is 50 feet below the ground surface and is screened in a confined aquifer based on available construction details. The well is located within a floodplain.

Information acquired from a March 1997 sanitary survey for the public water system indicated that the land surface was not sloped away from the well. Generally, land surfaces that slope away from the wellhead promote surface water drainage, which reduces the potential of contaminant migration down the well casing annulus. The sanitary survey indicates that the well is grouted according to ADEC regulations. Proper grouting provides added protection against contaminants traveling along the well casing annulus and into source waters.

The Bethel area is near the southern border of the continuous permafrost zone and the City, and most of the area west of the Kuskokwim River, appear to be underlain with permafrost. The permafrost generally extends to a depth of at least 300 feet bgs, with depths of over 600 feet bgs recorded in some areas. The geology in the area consists primarily of unconsolidated floodplain alluvium, silt deposits, and reworked silt. The Bethel area consists of poorly drained wetlands that have permanently ponded water in local depressions. Sloughs, small lakes, ponds, and marshes in meander scars surround Bethel and surrounding communities (Dames & Moore, 1996).

DRINKING WATER PROTECTION AREA

In order to evaluate whether a drinking water source is at risk, we must first evaluate what are the most likely pathways for surface contamination to reach the groundwater. These areas are determined by looking at the characteristics of the soil, groundwater, aquifer, and well.

The most probable area for contamination to reach the drinking water well is the area that contributes water to the well, the groundwater recharge area. This area is designated as the drinking water protection area (DWPA). Because releases of contaminants within the protection area are most likely to impact the drinking water well, this area will serve as the focus for voluntary protection efforts. An analytical calculation was used to determine the size and shape of the DWPA for the Napaskiak East Watering Point PWS. The input parameters describing the attributes of the aquifer in this calculation were adopted from Groundwater (Freeze and Cherry, 1979). Available geology and groundwater contours were also considered to take into account any uncertainties in groundwater flow and aquifer characteristics to arrive at a meaningful protection area.

The protection areas established for wells by the ADEC are usually separated into four zones, limited by the watershed. These zones correspond to differences in the time-of-travel (TOT) of the water moving through the aquifer to the well (Please refer to the Guidance Manual for Class A Public Water Systems for additional information).

The time of travel for contaminants within the water varies and is dependent on the physical and chemical characteristics of each contaminant. The following is a summary of the four protection area zones for wells and the calculated time -of-travel for each:

Table 1. Definition of Zones

Zone	Definition
A	¹ / ₄ the distance for the 2-yr. time -of-travel
В	Less than the 2 year time-of-travel
C	Less Than the 5 year time -of-travel
D	Less than the 10 year time -of-travel
	·

The DWPA for the Napaskiak East Watering Point PWS was determined using an analytical calculation and includes Zones A, B, C, and D (See Map A of Appendix A).

INVENTORY OF POTENTIAL AND EXISTING CONTAMINANT SOURCES

The Drinking Water Protection Program has completed an inventory of potential and existing sources of contamination within the Napaskiak East Watering Point DWPA. This inventory was completed through a search of agency records and other publicly available information. Potential sources of contamination to the drinking water aquifer include a wide range of categories and types. Potential drinking water contaminants are found within agricultural, residential, commercial, and industrial areas, but can also occur within areas that have little or no development.

For the basis of all Class A public water system assessments, six categories of drinking water contaminants were inventoried. They include:

- Bacteria and viruses.
- Nitrates and/or nitrites,
- Volatile organic chemicals,
- Heavy metals, cyanide and other inorganic chemicals,
- Synthetic organic chemicals,
- Other organic chemicals.

The sources are displayed on Map C of Appendix C and summarized in Table 1 of Appendix B.

RANKING OF CONTAMINANT RISKS

Once the potential and existing sources of contamination have been identified, they are assigned a ranking according to what type and level of risk they represent. Ranking of contaminant risks for a "potential" or "existing" source of contamination is a function of toxicity and volumes of specific contaminants associated with that source. Rankings include:

• Low,

- Medium,
- High, and
- Very High.

The time-of-travel for contaminants within the water varies and is dependent on the physical and chemical characteristics of each contaminant. Bacteria and Viruses are only inventoried in Zones A and B because of their short life span. Only "Very High" and "High" rankings are inventoried within the outer Zone D due to the probability of contaminant dilution by the time the contaminants get to the well. Tables 2 through 4 in Appendix B contain the ranking of potential and existing sources of contamination with respect to bacteria and viruses, nitrates and/or nitrites, volatile organic chemicals, heavy metals, cyanide and other inorganic chemicals, synthetic organic chemicals, and other organic chemicals.

VULNERABILITY OF THE DRINKING WATER SYSTEM

Vulnerability of a drinking water source to contamination is a combination of two factors:

- Natural susceptibility, and
- Contaminant risks.

Appendix D contains fourteen charts, which together form the 'Vulnerability Analysis' for a source water assessment for a public drinking water source. Chart 1 analyzes the 'Susceptibility of the Wellhead' to contamination by looking at the construction of the well and its surrounding area. Chart 2 analyzes the 'Susceptibility of the Aquifer' to contamination by looking at the naturally occurring attributes of the water source and influences on the groundwater system that might lead to contamination. Chart 3 analyzes 'Contaminant Risks' for the drinking water source with respect to bacteria and viruses. The 'Contaminant Risks' portion of the analysis considers potential sources of contaminants as well as a review of contamination that has or may have occurred, but has not arrived or been detected at the well. Chart 4 contains the 'Vulnerability Analysis for Bacteria and Viruses'. Charts 5 through 14 contain the Contaminant Risks and Vulnerability Analyses for nitrates and nitrites, volatile organic chemicals, heavy metals, cyanide and other inorganic chemicals, synthetic organic chemicals, and other organic chemicals, respectively.

A score for the Natural Susceptibility is reached by considering the properties of the well and the aquifer.

Susceptibility of the Wellhead (0 – 25 Points) (Chart 1 of Appendix D)

+

Susceptibility of the Aquifer (0 – 25 Points) (Chart 2 of Appendix D)

=

Natural Susceptibility (Susceptibility of the Well) (0-50 Points)

A ranking is assigned for the Natural Susceptibility according to the point score:

Natural Susceptibility Ratings							
40 to 50 pts	Very High						
30 to < 40 pts	High						
20 to < 30 pts	Medium						
< 20 pts	Low						

The Napaskiak East Watering Point's water well is in a confined aquifer. Confined aquifers are less susceptible to potential groundwater quality impacts posed by the migration of surface water contaminants downward from the surface. Table 2 shows the susceptibility scores and ratings for this PWS.

Table 2. Susceptibility

	Score	Rating
Susceptibility of the	20	Very High
Wellhead		
Susceptibility of the	23	Very High
Aquifer		
Natural Susceptibility	43	Very High

Contaminant risks to a drinking water source depend on the type, number or density, and distribution of contaminant sources. This score has been derived from an examination of existing and historical contamination that has been detected at the drinking water source through routine sampling. It also evaluates potential sources of contamination. Flow charts are used to assign a point score, and ratings are assigned in the same way as for the natural susceptibility:

Contaminant Risk Ratings							
40 to 50 pts	Very High						
30 to < 40 pts	High						
20 to < 30 pts	Medium						
< 20 pts	Low						

Category	Score	Rating
Bacteria and Viruses	50	Very High
Nitrates and/or Nitrites	50	Very High
Volatile Organic Chemical	ls 50	Very High
Heavy Metals, Cyanide an	ıd	
Other Inorganic Chemicals	40	Very High
Synthetic Organic Chemica	als 50	Very High
Other Organic Chemicals	50	Very High

Finally, an overall vulnerability score is assigned for each water system by combining each of the contaminant risk scores with the natural susceptibility score:

Natural Susceptibility (0 – 50 points)

+

Contaminant Risks (0 – 50 points)

=

 $\label{eq:Vulnerability} Vulnerability of the \\ Drinking Water Source to Contamination (0-100).$

Again, rankings are assigned according to a point score:

Overall Vulnerability Ratings							
80 to 100 pts	Very High						
60 to < 80 pts	High						
40 to < 60 pts	Medium						
< 40 pts	Low						

Table 4 contains the overall vulnerability scores (0 – 100) and ratings for each of the six categories of drinking water contaminants. Note: scores are rounded off to the nearest five.

Table 4. Overall Vulnerability

Category	Score	Rating
Bacteria and Viruses	95	Very High
Nitrates and Nitrites	95	Very High
Volatile Organic Chemicals	95	Very High
Heavy Metals, Cyanide and		
Other Inorganic Chemicals	85	Very High
Synthetic Organic Chemicals	95	Very High

Other Organic Chemicals

Very High

Bacteria and Viruses

The contaminant risk for bacteria and viruses is **Very High**. The risk is primarily attributed to the presence of a landfill and a domestic wastewater treatment plant disposal pond/lagoon in ZoneA (see Table 2 – Appendix B).

95

No positive bacteria counts have been reported in recent (within five years) sampling events (See Chart 3 – Contaminant Risks for Bacteria and Viruses in Appendix D). Only a small amount of bacteria and viruses are required to endanger public health.

After combining the contaminant risk for bacteria and viruses with the natural susceptibility of the well, the overall vulnerability of the well to contamination is **Very High**.

Nitrates and Nitrites

The contaminant risk for nitrates and nitrites is **Very High**. The risk to this source of public drinking water is primarily attributed to the presence of a landfill and a domestic wastewater treatment plant disposal pond/lagoon in Zone A (see Table 3 – Appendix B).

Nitrates are very mobile, moving at approximately the same rate as water. The sampling history for this well indicates that low levels of nitrates have been detected in recent sampling events. However, the reported concentrations of nitrates do not exceed the maximum contaminant level (MCL) of 10 mg/L. Nitrate concentrations in uncontaminated groundwater are typically less than 2 mg/L; therefore, nitrate concentrations above 2 mg/L may be indicative of man-made sources (See Chart 5 - Contaminant Risks for Nitrates and/or Nitrites in Appendix D).

Nitrate levels are often derived from the decomposition of organic matter in soils. Although the nitrate source is unknown, such occurrences may be attributed to septic systems or other sources. After combining the contaminant risk for nitrates and nitrites with the natural susceptibility of the well, the overall vulnerability of the well to nitrate and nitrite contamination is **Very High**

Volatile Organic Chemicals

The contaminant risk for volatile organic chemicals is **Very High**. The risk is primarily attributed to the presence of petroleum product bulk stations/terminals, landfills, ADEC recognized contaminated sites, and an airport located in Zone A.

Numerous other potential contaminant sources are also found within the protection area (see Table 4 – Appendix B).

Detectable concentrations of trihalomethanes (TTHM) were reported in sampling events for this public water system. However, the detectible concentrations of trihalomethanes reported in 1998, were below the MCL of 0.08 mg/L. Trihalomethanes are considered byproducts of the water treatment process and are not from the source waters. Since the reported concentration of TTHM's in recent sampling events did not exceed the applicable MCL, risk points were not retained.

Aside from being byproducts of the drinking water treatment process, possible sources of volatile organic chemicals include facilities with automobiles, residential areas, fuel tanks, roads, and airports. See Table 4 in Appendix D for a complete listing.

After combining the contaminant risk for volatile organic chemicals with the natural susceptibility of the well, the overall vulnerability of the well to contamination is **Very High**

Heavy Metals, Cyanide and Other Inorganic Chemicals

The contaminant risk for heavy metals, cyanide and other inorganic chemicals is **Very High**. The risk is primarily attributed to the presence of a landfill located in Zone A. Numerous other potential contaminant sources are also found within the protection area (see Table 5 – Appendix B).

Based on review of recent sampling records for this public water system, moderate levels of copper and lead have been detected in recent sampling history, but have not exceeded their respective MCLs of 1.3 mg/L and 0.015 mg/L (see Chart 9 – Contaminant Risks for Heavy Metals, Cyanide, and Other Inorganic Chemicals in Appendix D).

The reported concentrations of copper and lead in recent sampling events are not likely to be representative of source water conditions. These two analytes are likely attributed to either the water treatment process or water distribution network, therefore, no risk points were assigned based on the presence of these analytes.

After combining the contaminant risk for heavy metals, cyanide and other inorganic chemicals with the natural susceptibility of the well, the overall vulnerability of the well to contamination is **Very High**.

Synthetic Organic Chemicals

The contaminant risk for synthetic organic chemicals is **Very High**. The risk is primarily attributed to the presence of a landfill in Zone A. Numerous other potential contaminant sources are also found within the protection area (see Table 6 – Appendix B).

No recent sampling data was available in ADEC records for the Napaskiak East Watering Point (See Chart 11 – Contaminant Risks for Synthetic Organic Chemicals in Appendix D).

After combining the contaminant risk for synthetic organic chemicals with the natural susceptibility of the well, the overall vulnerability of the well to contamination is **Very High**

Other Organic Chemicals

The contaminant risk for other organic chemicals is **Very High**. The risk is primarily attributed to the presence of petroleum product bulk stations/terminals, electric power generation, and a landfill in Zone A. Numerous other potential contaminant sources are also found within the protection area (see Table 7 – Appendix B).

No recent sampling data was available in ADEC records for the Napaskiak East Watering Point (See Chart 13 – Contaminant Risks for Other Organic Chemicals in Appendix D).

After combining the contaminant risk for other organic chemicals with the natural susceptibility of the well, the overall vulnerability of the well to contamination is **Very High**

Using the Source Water Assessment

This assessment of contaminant risks can be used as a foundation for local voluntary protection efforts as well as a basis for the continuous efforts on the part of the community of Napaskiak to protect public health. It is anticipated that Source Water Assessments will be updated every five years to reflect any changes in the vulnerability and/or susceptibility of the drinking water source.


REFERENCES

- Alaska Department of Community and Economic Development (ADCED), 2003 [WWW document]. URL: http://www.dced.state.ak.us/cbd/commdb/CF COMDB.htm
- Alaska Department of Environmental Conservation, Contaminated Sites Database, 2003 [WWW database], URL http://www.state.ak.us/dec/dspar/csites/cs search.htm
- Alaska Department of Environmental Conservation, Leaking Underground Storage Tank Database, 2003 [WWW database], URL http://www.dec.state.ak.us/spar/stp/ust/search/fac_search.asp
- Dames & Moore, 1996. Final Water and Sewer Facilities Master Plan Update Report, City of Bethel.
- Freeze, R. A., and Cherry, J.A. 1979, Groundwater, Prentice-Hall, Englewood Cliffs, New Jersey
- United States Environmental Protection Agency (EPA), 2002 [WWW document]. URL http://www.epa.gov/safewater/mcl.html.

APPENDIX A

Drinking Water Protection Area Location Map (Map A)

Public Water Well System for PWS #271952.001 Napaskiak East Watering Point

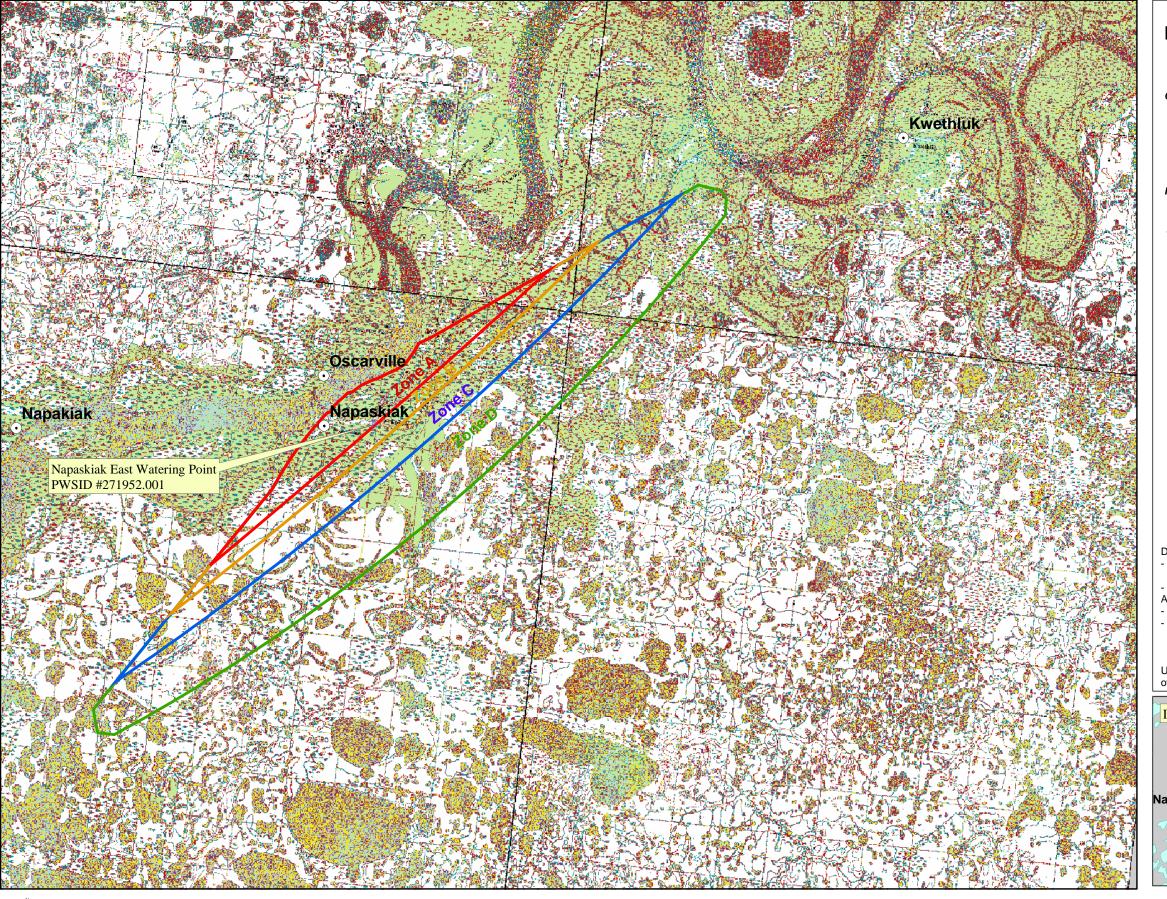



Public Water System Well

Groundwater Protection Zones

- Zone A Several Months Travel Time
- Zone B Less Than 2 Years Travel Time
- Zone C Less Than 5 Years Travel Time Zone D – Less Than 10 Years Travel Time

Hydrography/Physical

Parcels






Contours

Data Sources:

- Contaminant Sources, Public Water System Wells, Contours
 Alaska Department of Environmental Conservation (ADEC)
 Critical Facilities, Federal Emergency Management Agency (FEMA)

- United States Geological Survey (USGS)
 Drinking Water Protection Areas based on "Alaska Drinking Water Protection Program Guidance Manual for Class A Public Water Systems" published by ADEC

URS Corporation does not guarantee the accuracy or validity of the data provided.

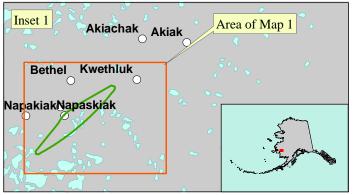

Napaskiak East Watering Point PWS 271952.001 Appendix A Map A



APPENDIX B

Contaminant Source Inventory and Risk Ranking (Tables 1-7)

Contaminant Source Inventory for Napaskiak East Watering Point

PWSID 271952.001

Contaminant Source Type	Contaminant Source ID	CS ID tag	Zone	Map Number	Comments
Domestic wastewater treatment plant disposal ponds/lagoons	D02	D02-01	A	C	
Pit toilets (open hole), nonresidential (one or more)	D16	D16-01	A	C	Assume 5 or less honeybucket pits in Zone A
Landfills (municipal; Class III)	D51	D51-01	A	C	
Tanks, heating oil, residential (above ground)	R08	R08-01	A	C	Assume 70 or less residential heating oil tanks in Zone A
Tanks, diesel (above ground)	T06	T06-01	A	C	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-01	A	С	Napaskiak Electric Utility
Tanks, heating oil, nonresidential (aboveground)	T14	T14-02	A	C	Clinic
Tanks, heating oil, nonresidential (aboveground)	T14	T14-03	A	C	Store
Tanks, heating oil, nonresidential (aboveground)	T14	T14-04	A	C	Teachers Quarters
Tanks, heating oil, nonresidential (aboveground)	T14	T14-05	A	C	UUT
Tanks, heating oil, nonresidential (aboveground)	T14	T14-06	A	C	Moravian Church
Tanks, heating oil, nonresidential (aboveground)	T14	T14-07	A	С	Russian Orthodox Church
Tanks, heating oil, nonresidential (aboveground)	T14	T14-08	A	С	Community Hall
Tanks, heating oil, nonresidential (aboveground)	T14	T14-09	A	С	Fire Station
Tanks, heating oil, nonresidential (aboveground)	T14	T14-10	A	С	National Guard Armory
Tanks, heating oil, nonresidential (aboveground)	T14	T14-11	A	С	National Guard Armory, Old
Tanks, heating oil, nonresidential (aboveground)	T14	T14-12	A	C	City Office
Tanks, heating oil, nonresidential (aboveground)	T14	T14-13	A	С	Tribal Office
Tanks, heating oil, nonresidential (aboveground)	T14	T14-14	A	С	Utility Office
Tanks, heating oil, nonresidential (aboveground)	T14	T14-15	A	С	Police Station
Tanks, heating oil, nonresidential (aboveground)	T14	T14-16	A	С	Post Office
Tanks, heating oil, nonresidential (aboveground)	T14	T14-17	A	С	School Internet Satellite
Tanks, heating oil, nonresidential (aboveground)	T14	T14-18	A	С	UUT Satellite
Tanks, heating oil, nonresidential (aboveground)	T14	T14-19	A	С	Z. John Williams School

Contaminant Source Type	Contaminant Source ID	CS ID tag	Zone	Map Number	Comments
Wastewater Holding Tank	T22	T22-02	A	C	Assume 50 or less wastewater holding tanks in Zone A
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-01	A	С	Napaskiak School, RecKey #1993250128702, Status: Active, diesel spill.
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-02	A	С	AKARNG Napaskiak FSA, RecKey #1997250113401, Status: Active, petroleum contamination in soil.
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-03	A	С	AKARNG Napaskiak FSA, RecKey #1997250113401, Status: Active, petroleum contamination in soil.
Water supply wells	W09	W09-01	A	C	2 water supply wells in Zone A
Cemeteries	X01	X01-01	A	C	
Petroleum product bulk station/terminals	X11	X11-01	A	C	
Petroleum product bulk station/terminals	X11	X11-02	A	С	LKSD
Airports	X14	X14-01	A	С	
Highways and roads, dirt/gravel	X24	X24-01	A	С	Assume 1-20 roads in Zone A
Electric power generation (fossil fuels)	X36	X36-01	A	С	
Firehouses	X38	X38-01	A	С	
Medical/veterinary facilities (doctor or dentist offices, hospitals, nursing homes)	X40	X40-01	A	С	

Table 2

Contaminant Source Inventory and Risk Ranking for Napaskiak East Watering Point Sources of Bacteria and Viruses

Contaminant Source Type	Contaminant Source ID	CS ID tag	Zone	Risk Ranking for Analysis	Map Number	Comments
Domestic wastewater treatment plant disposal ponds/lagoons	D02	D02-01	A	High	С	
Pit toilets (open hole), nonresidential (one or more	D16	D16-01	A	Medium	C	Assume 5 or less honeybucket pits in Zone A
Landfills (municipal; Class III)	D51	D51-01	A	High	С	
Wastewater Holding Tank	T22	T22-02	A	Low	С	Assume 50 or less wastewater holding tanks in Zone A
Highways and roads, dirt/gravel	X24	X24-01	A	Low	С	Assume 1-20 roads in Zone A
Medical/veterinary facilities (doctor or dentist offices, hospitals, nursing homes)	X40	X40-01	A	Medium	С	

Table 3

Contaminant Source Inventory and Risk Ranking for Napaskiak East Watering Point Sources of Nitrates/Nitrites

Contaminant Source Type	Contaminant Source ID	CS ID tag	Zone	Risk Ranking for Analysis	Map Number	Comments
Domestic wastewater treatment plant disposal ponds/lagoons	D02	D02-01	A	High	С	
Pit toilets (open hole), nonresidential (one or more	D16	D16-01	A	Medium	C	Assume 5 or less honeybucket pits in Zone A
Landfills (municipal; Class III)	D51	D51-01	A	Very High	C	
Wastewater Holding Tank	T22	T22-02	A	Low	С	Assume 50 or less wastewater holding tanks in Zone A
Cemeteries	X01	X01-01	A	Medium	С	
Airports	X14	X14-01	A	Low	С	
Highways and roads, dirt/gravel	X24	X24-01	A	Low	С	Assume 1-20 roads in Zone A
Medical/veterinary facilities (doctor or dentist offices, hospitals, nursing homes)	X40	X40-01	A	Low	С	

Table 4

Contaminant Source Inventory and Risk Ranking for Napaskiak East Watering Point Sources of Volatile Organic Chemicals

Contaminant Source Type	Contaminant Source ID	CS ID tag	Zone	Risk Ranking for Analysis	Map Number	Comments
Domestic wastewater treatment plant disposal ponds/lagoons	D02	D02-01	A	Low	С	
Pit toilets (open hole), nonresidential (one or more	D16	D16-01	A	Low	C	Assume 5 or less honeybucket pits in Zone A
Landfills (municipal; Class III)	D51	D51-01	A	High	C	
Tanks, heating oil, residential (above ground)	R08	R08-01	A	Medium	C	Assume 70 or less residential heating oil tanks in Zone A
Tanks, diesel (above ground)	T06	T06-01	A	Medium	C	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-01	A	Low	C	Napaskiak Electric Utility
Tanks, heating oil, nonresidential (aboveground)	T14	T14-02	A	Low	С	Clinic
Tanks, heating oil, nonresidential (aboveground)	T14	T14-03	A	Low	С	Store
Tanks, heating oil, nonresidential (aboveground)	T14	T14-04	A	Low	С	Teachers Quarters
Tanks, heating oil, nonresidential (aboveground)	T14	T14-05	A	Low	С	UUT
Tanks, heating oil, nonresidential (aboveground)	T14	T14-06	A	Low	С	Moravian Church
Tanks, heating oil, nonresidential (aboveground)	T14	T14-07	A	Low	С	Russian Orthodox Church
Tanks, heating oil, nonresidential (aboveground)	T14	T14-08	A	Low	С	Community Hall
Tanks, heating oil, nonresidential (aboveground)	T14	T14-09	A	Low	С	Fire Station
Tanks, heating oil, nonresidential (aboveground)	T14	T14-10	A	Low	С	National Guard Armory
Tanks, heating oil, nonresidential (aboveground)	T14	T14-11	A	Low	С	National Guard Armory, Old
Tanks, heating oil, nonresidential (aboveground)	T14	T14-12	A	Low	С	City Office
Tanks, heating oil, nonresidential (aboveground)	T14	T14-13	A	Low	С	Tribal Office
Tanks, heating oil, nonresidential (aboveground)	T14	T14-14	A	Low	С	Utility Office
Tanks, heating oil, nonresidential (aboveground)	T14	T14-15	A	Low	С	Police Station
Tanks, heating oil, nonresidential (aboveground)	T14	T14-16	A	Low	С	Post Office
Tanks, heating oil, nonresidential (aboveground)	T14	T14-17	A	Low	С	School Internet Satellite
Tanks, heating oil, nonresidential (aboveground)	T14	T14-18	A	Low	С	UUT Satellite

Table 4 (continued)

Contaminant Source Inventory and Risk Ranking for Napaskiak East Watering Point Sources of Volatile Organic Chemicals

Contaminant Source Type	Contaminant Source ID	CS ID tag	Zone	Risk Ranking for Analysis	Map Number	Comments
Tanks, heating oil, nonresidential (aboveground)	T14	T14-19	A	Low	С	Z. John Williams School
Wastewater Holding Tank	T22	T22-02	A	Medium	С	Assume 50 or less wastewater holding tanks in Zone A
Contaminated sites, DEC recognized, non-Superfun non-RCRA	U04	U04-01	A	High	С	Napaskiak School, RecKey #1993250128702, Status: Active, diesel spill.
Contaminated sites, DEC recognized, non-Superfun non-RCRA	U04	U04-02	A	High	С	AKARNG Napaskiak FSA, RecKey #1997250113401, Status: Active, petroleum contamination in soil.
Contaminated sites, DEC recognized, non-Superfun non-RCRA	U04	U04-03	A	High	С	AKARNG Napaskiak FSA, RecKey #1997250113401, Status: Active, petroleum contamination in soil.
Petroleum product bulk station/terminals	X11	X11-01	A	Very High	C	
Petroleum product bulk station/terminals	X11	X11-02	A	Very High	C	LKSD
Airports	X14	X14-01	A	High	С	
Highways and roads, dirt/gravel	X24	X24-01	A	Low	С	Assume 1-20 roads in Zone A
Electric power generation (fossil fuels)	X36	X36-01	A	Medium	С	
Firehouses	X38	X38-01	A	Low	С	
Medical/veterinary facilities (doctor or dentist offices, hospitals, nursing homes)	X40	X40-01	A	Low	С	

Table 5

Contaminant Source Inventory and Risk Ranking for Napaskiak East Watering Point Sources of Heavy Metals, Cyanide and Other Inorganic Chemicals

Contaminant Source Type	Contaminant Source ID	CS ID tag	Zone	Risk Ranking for Analysis	Map Number	Comments
Domestic wastewater treatment plant disposal ponds/lagoons	D02	D02-01	A	Low	С	
Pit toilets (open hole), nonresidential (one or more	D16	D16-01	A	Low	C	Assume 5 or less honeybucket pits in Zone A
Landfills (municipal; Class III)	D51	D51-01	A	High	C	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-01	A	Low	C	Napaskiak Electric Utility
Tanks, heating oil, nonresidential (aboveground)	T14	T14-02	A	Low	C	Clinic
Tanks, heating oil, nonresidential (aboveground)	T14	T14-03	A	Low	C	Store
Tanks, heating oil, nonresidential (aboveground)	T14	T14-04	A	Low	С	Teachers Quarters
Tanks, heating oil, nonresidential (aboveground)	T14	T14-05	A	Low	С	UUT
Tanks, heating oil, nonresidential (aboveground)	T14	T14-06	A	Low	С	Moravian Church
Tanks, heating oil, nonresidential (aboveground)	T14	T14-07	A	Low	С	Russian Orthodox Church
Tanks, heating oil, nonresidential (aboveground)	T14	T14-08	A	Low	С	Community Hall
Tanks, heating oil, nonresidential (aboveground)	T14	T14-09	A	Low	С	Fire Station
Tanks, heating oil, nonresidential (aboveground)	T14	T14-10	A	Low	С	National Guard Armory
Tanks, heating oil, nonresidential (aboveground)	T14	T14-11	A	Low	С	National Guard Armory, Old
Tanks, heating oil, nonresidential (aboveground)	T14	T14-12	A	Low	С	City Office
Tanks, heating oil, nonresidential (aboveground)	T14	T14-13	A	Low	С	Tribal Office
Tanks, heating oil, nonresidential (aboveground)	T14	T14-14	A	Low	С	Utility Office
Tanks, heating oil, nonresidential (aboveground)	T14	T14-15	A	Low	С	Police Station
Tanks, heating oil, nonresidential (aboveground)	T14	T14-16	A	Low	С	Post Office
Tanks, heating oil, nonresidential (aboveground)	T14	T14-17	A	Low	С	School Internet Satellite
Tanks, heating oil, nonresidential (aboveground)	T14	T14-18	A	Low	С	UUT Satellite
Tanks, heating oil, nonresidential (aboveground)	T14	T14-19	A	Low	С	Z. John Williams School
Wastewater Holding Tank	T22	T22-02	A	Medium	С	Assume 50 or less wastewater holding tanks in Zone A

Table 5 (continued)

Contaminant Source Inventory and Risk Ranking for Napaskiak East Watering Point Sources of Heavy Metals, Cyanide and Other Inorganic Chemicals

Contaminant Source Type	Contaminant Source ID	CS ID tag	Zone	Risk Ranking for Analysis	Map Number	Comments
Contaminated sites, DEC recognized, non-Superfun non-RCRA	U04	U04-01	A	Low	С	Napaskiak School, RecKey #1993250128702, Status: Active, diesel spill.
Contaminated sites, DEC recognized, non-Superfun non-RCRA	U04	U04-02	A	Low	С	AKARNG Napaskiak FSA, RecKey #1997250113401, Status: Active, petroleum contamination in soil.
Contaminated sites, DEC recognized, non-Superfun non-RCRA	U04	U04-03	A	Low	С	AKARNG Napaskiak FSA, RecKey #1997250113401, Status: Active, petroleum contamination in soil.
Cemeteries	X01	X01-01	A	Low	C	
Petroleum product bulk station/terminals	X11	X11-01	A	Low	С	
Petroleum product bulk station/terminals	X11	X11-02	A	Low	С	LKSD
Airports	X14	X14-01	A	Low	С	
Highways and roads, dirt/gravel	X24	X24-01	A	Low	С	Assume 1-20 roads in Zone A
Electric power generation (fossil fuels)	X36	X36-01	A	Medium	С	
Firehouses	X38	X38-01	A	Low	С	
Medical/veterinary facilities (doctor or dentist offices, hospitals, nursing homes)	X40	X40-01	A	Low	С	

Table 6

Contaminant Source Inventory and Risk Ranking for Napaskiak East Watering Point Sources of Synthetic Organic Chemicals

Contaminant Source Type	Contaminant Source ID	CS ID tag	Zone	Risk Ranking for Analysis	Map Number	Comments
Domestic wastewater treatment plant disposal ponds/lagoons	D02	D02-01	A	Low	С	
Landfills (municipal; Class III)	D51	D51-01	A	Very High	C	
Contaminated sites, DEC recognized, non-Superfun non-RCRA	U04	U04-01	A	Low	С	Napaskiak School, RecKey #1993250128702, Status: Active, diesel spill.
Contaminated sites, DEC recognized, non-Superfun non-RCRA	U04	U04-02	A	Low	С	AKARNG Napaskiak FSA, RecKey #1997250113401, Status: Active, petroleum contamination in soil.
Contaminated sites, DEC recognized, non-Superfun non-RCRA	U04	U04-03	A	Low	С	AKARNG Napaskiak FSA, RecKey #1997250113401, Status: Active, petroleum contamination in soil.
Cemeteries	X01	X01-01	A	Medium	C	
Petroleum product bulk station/terminals	X11	X11-01	A	Low	С	
Petroleum product bulk station/terminals	X11	X11-02	A	Low	С	LKSD
Airports	X14	X14-01	A	Medium	С	
Medical/veterinary facilities (doctor or dentist offices, hospitals, nursing homes)	X40	X40-01	A	Low	С	

Table 7


Contaminant Source Inventory and Risk Ranking for Napaskiak East Watering Point Sources of Other Organic Chemicals

Contaminant Source Type	Contaminant Source ID	CS ID tag	Zone	Risk Ranking for Analysis	Map Number	Comments
Domestic wastewater treatment plant disposal ponds/lagoons	D02	D02-01	A	Low	С	
Landfills (municipal; Class III)	D51	D51-01	A	Very High	C	
Wastewater Holding Tank	T22	T22-02	A	Medium	С	Assume 50 or less wastewater holding tanks in Zone A
Contaminated sites, DEC recognized, non-Superfun non-RCRA	U04	U04-01	A	Low	С	Napaskiak School, RecKey #1993250128702, Status: Active, diesel spill.
Contaminated sites, DEC recognized, non-Superfun non-RCRA	U04	U04-02	A	Low	С	AKARNG Napaskiak FSA, RecKey #1997250113401, Status: Active, petroleum contamination in soil.
Contaminated sites, DEC recognized, non-Superfun non-RCRA	U04	U04-03	A	Low	С	AKARNG Napaskiak FSA, RecKey #1997250113401, Status: Active, petroleum contamination in soil.
Petroleum product bulk station/terminals	X11	X11-01	A	High	C	
Petroleum product bulk station/terminals	X11	X11-02	A	High	С	LKSD
Airports	X14	X14-01	A	Medium	С	
Highways and roads, dirt/gravel	X24	X24-01	A	Low	С	Assume 1-20 roads in Zone A
Electric power generation (fossil fuels)	X36	X36-01	A	High	C	

APPENDIX C

Drinking Water Protection Area and Potential and Existing Contaminant Sources (Map C)

Public Water Well System for PWS #271952.001 Napaskiak East Watering Point **Showing Potential and Existing Sources of Contamination**

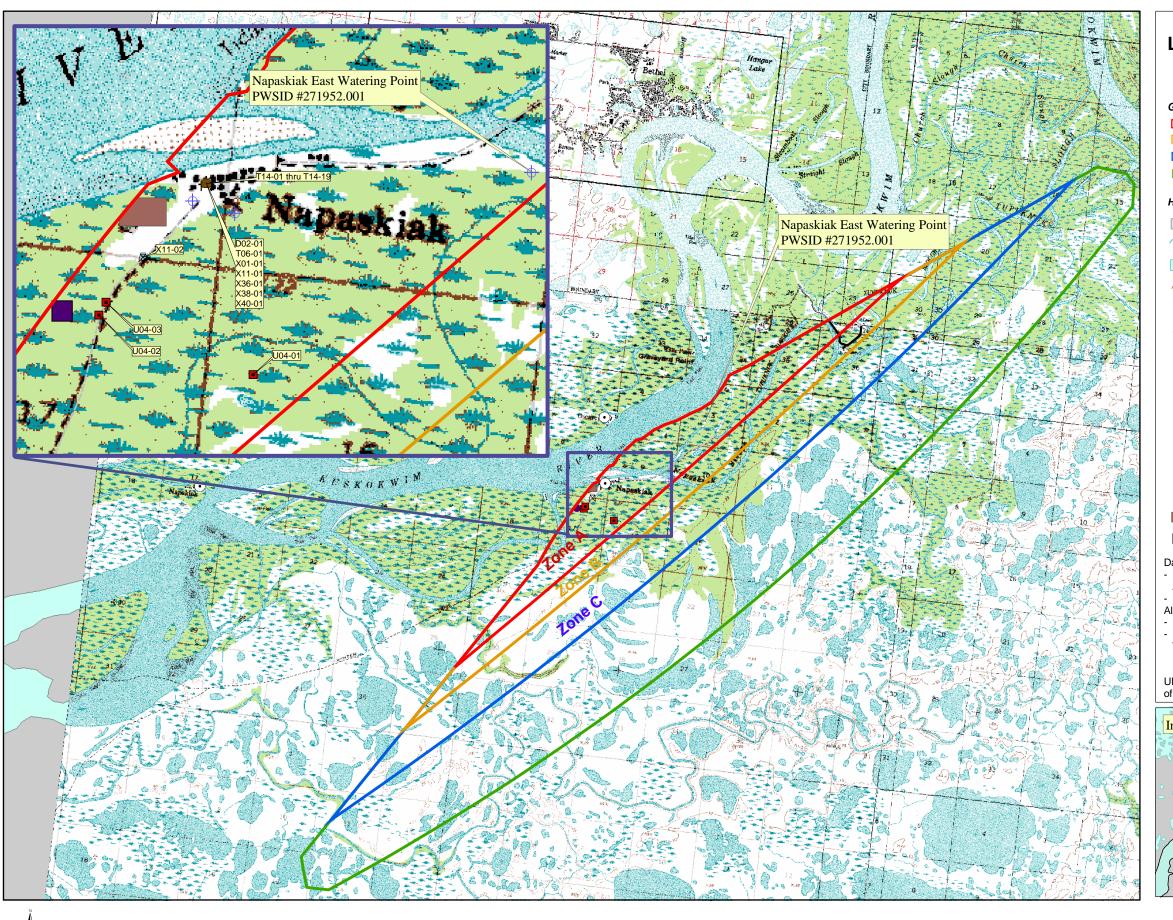



Public Water System Well

Groundwater Protection Zones

- Zone A Several Months Travel Time
- Zone B Less Than 2 Years Travel Time
- Zone C Less Than 5 Years Travel Time
- Zone D Less Than 10 Years Travel Time

Hydrography/Physical Transportation

- Primary Route (Class 1) Parcels Secondary Route (Class 2)
- Stream Road (Class 3)
- Lake or Pond ------ Road (Class 4)
- Contours ----- Road (Class 5, Four-wheel drive) Road Ferry Crossing


Existing or Potential Contaminant Sources

- Domestic wastewater treatment plant disposal ponds/lagoons (D02)
- Tanks, diesel (aboveground) (T06)
- Tanks, heating oil, nonresidential (aboveground) (T14)
- Cemetery (X01)
- Fuel Storage >500 gallons (X11)
- Electric power generation (fossil fuels) (X36)
- Firehouses (X38)
- Medical/veterinary facilities (X40)
- Landfills (Municipal, Class III) (D51)
- Airport or landing strip (X14)

Data Sources:

- Contaminant Sources, Public Water System Wells, Contours
- Alaska Department of Environmental Conservation (ADEC)
 Critical Facilities, Federal Emergency Management Agency (FEMA) All other data:
- United States Geological Survey (USGS)
 Drinking Water Protection Areas based on "Alaska Drinking Water Protection Program - Guidance Manual for Class A Public Water Systems" published by ADEC

URS Corporation does not guarantee the accuracy or validity of the data provided.

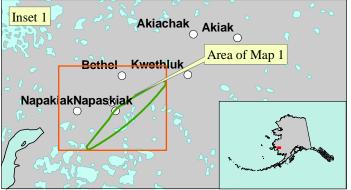

Napaskiak East Watering Point PWS 271952.001 Appendix C Map C

APPENDIX D

Vulnerability Analysis for Public Drinking Water Source (Charts 1-14)

Susceptibility initially assumed to be low. Susceptibility of wellhead = 0 pts Is the well Increase susceptibility 5 pts properly + 0 pts grouted? Is the well Increase susceptibility 20 pts 0 pts capped? YES YES Very High Susceptibility of wellhead 20 pts YES Increase susceptibility: Is the well 10 pts: suspected floodplain + 20 pts within a Wellhead Susceptibility Ratings 20 pts: known floodplain floodplain? 20 to 25 pts very high 15 to < 20 pts high 10 to < 15 pts medium NO' < 10 pts low Is the land NO surface sloped Increase susceptibility 5 pts + 0 pts away from the

Chart 1. Susceptibility of the wellhead - Napaskiak East Watering Point (PWS No. 271952.001)

Chart 2. Susceptibility of the aquifer Napaskiak East Watering Point (PWS No. 271952.001)

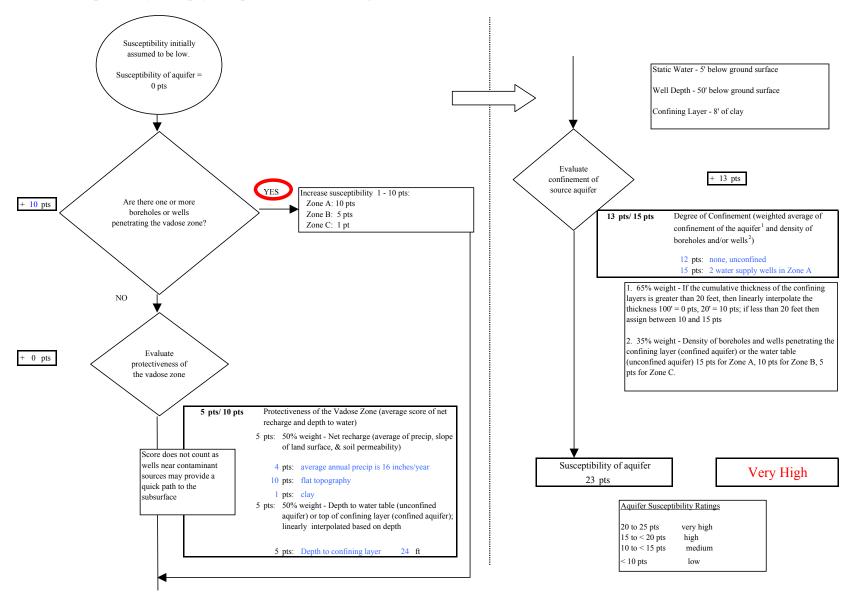


Chart 3. Contaminant risks for Napaskiak East Watering Point (PWS No. 271952.001) - Bacteria & Viruses

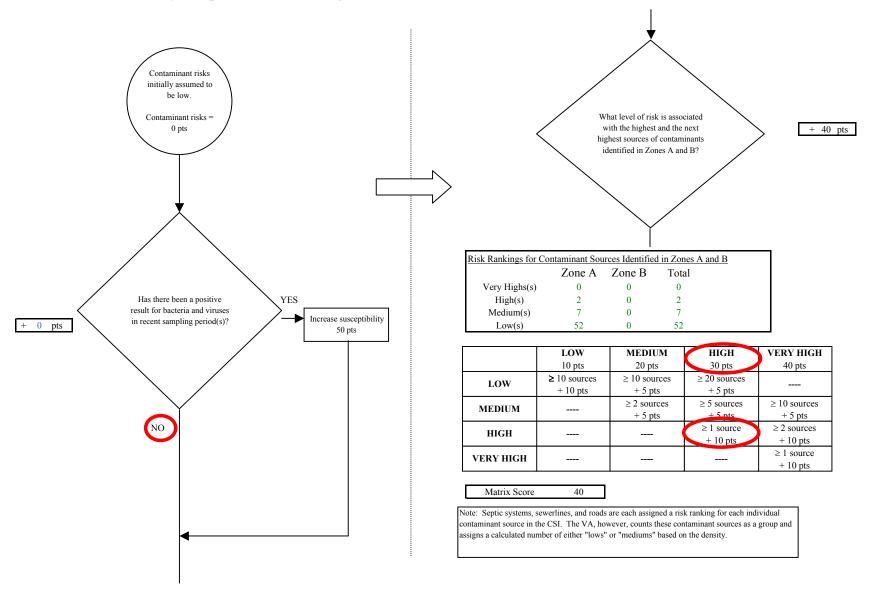
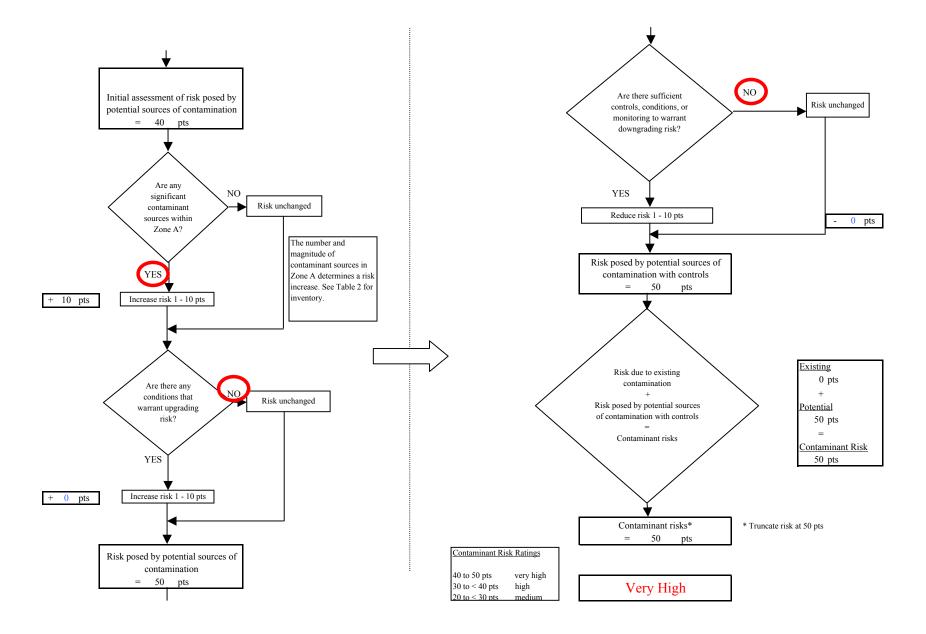


Chart 3. Contaminant risks for Napaskiak East Watering Point (PWS No. 271952.001) - Bacteria & Viruses





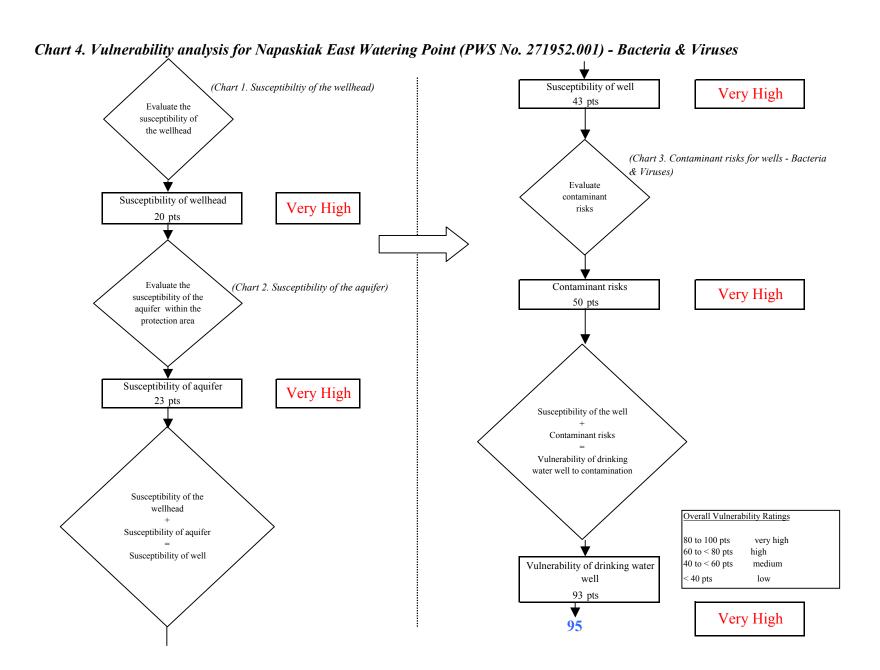


Chart 5. Contaminant risks for Napaskiak East Watering Point (PWS No. 271952.001) - Nitrates and Nitrites Contaminant risks initially assumed to be low. Current level of Evaluate the level of Contaminant risks background contamination due to man-= 0 pts contamination from made source(s) natural sources 0 pts Is the concentration of Has nitrates and/or NO the contaminant nitrites been detected in increasing, decreasing, the source waters in or staying the same? recent sampling period(s)? Recent Nitrate Sampling Results (mg/L) 7/7/2000 0.16 12/7/1998 ND The nitrate concentration is assumed to be natural if less than 2 mg/L (20%), or Increasing: risk up 1 - 10 pts YES attributed to man made Decreasing: risk down 1 - 5 pts sources if greater than 2 + 0 pts Same: risk unchanged mg/L. Maximum Contaminant Level (MCL) = 10 mg/LDetected Nitrate Level = Existing contamination points based on Risk due to existing man-Risk due to natural linear interpolation of most recent detect sources made sources [MCL = 50 pts; detect = 0 pts]1 pts Risk due to existing contamination 1 pts Was the source of Evaluate the level of NO. contamination contamination from natural? man-made sources

Chart 5. Contaminant risks for Napaskiak East Watering Point (PWS No. 271952.001) - Nitrates and Nitrites

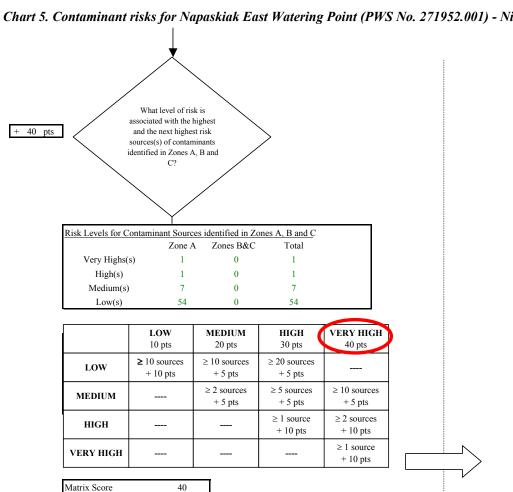

Note: Septic systems, sewerlines, and roads are each assigned a risk ranking for each individual contaminant source in the CSI. The VA, however, counts these contaminant sources as a group and assigns a calculated number of either "lows" or "mediums" based on the density.

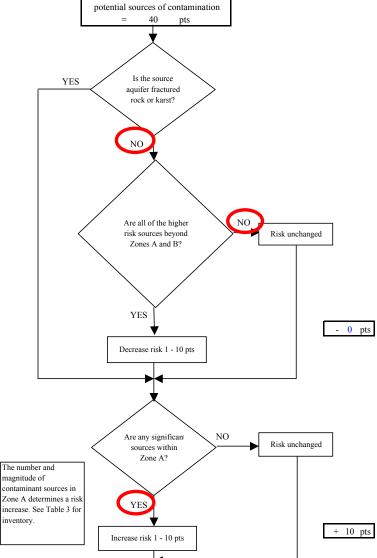

Initial assessment of risk posed by


Chart 5. Contaminant risks for Napaskiak East Watering Point (PWS No. 271952.001) - Nitrates and Nitrites Existing NO Are there conditions 1 pts Risk unchanged that warrant upgrading risk? Risk due to existing Potential contamination 50 pts The number and magnitude of Risk posed by potential sources contaminant sources in of contamination with controls Contaminant Risk Zone D determines a risk YES 51 pts increase. See Table 3 for Contaminant risks inventory. 0 pts Increase risk 1 - 10 pts Risk posed by potential sources of contamination 50 pts *Truncate risk at 50 pts Contaminant risks* 50 Contaminant Risk Ratings Are there sufficient Very High controls, conditions, NO. Risk unchanged or monitoring to 40 to 50 pts very high warrant downgrading 30 to < 40 pts high 20 to < 30 pts risk? medium < 20 pts low YES 0 pts Decrease risk 1 - 10 pts Risk posed by potential sources of contamination with controls

Page 8 of 25

Chart 6. Vulnerability analysis for Napaskiak East Watering Point (PWS No. 271952.001) - Nitrates and Nitrites (Chart 1. Susceptibiltiy of the wellhead) Susceptibility of well Very High 43 pts Evaluate the susceptibility of the wellhead (Chart 5. Contaminant risks for wells - Nitrates and Nitrites) Evaluate Susceptibility of wellhead contaminant risks Very High 20 pts Evaluate the (Chart 2. Susceptibility of the aquifer) Contaminant risks Very High susceptibility of the 50 pts aquifer within the protection area Susceptibility of aquifer Very High 23 pts Susceptibility of the well Contaminant risks Vulnerability of drinking water well to contamination Susceptibility of the wellhead Overall Vulnerability Ratings Susceptibility of aquifer 80 to 100 pts very high Susceptibility of well 60 to < 80 pts high 40 to < 60 pts medium Vulnerability of drinking water well < 40 pts 93 pts Very High 95

Chart 7. Contaminant risks for Napaskiak East Watering Point (PWS No. 271952.001) - Volatile Organic Chemicals Contaminant risks initially assumed to be Current level of Evaluate the level of Contaminant risks background contamination due to man-=0 pts contamination from made source(s) Although other analytes may have reported natural sources 1 pts above detection limits in recent sampling events, the analyte reporting the highest percent MCL exceedence was used for assessing risk points. Points are based on linear interpolation of most recent detect [MCL = 50 pts; detect = 0 pts] Is the concentration of the NO contaminant increasing, Have volatile organic decreasing, or staying the chemicals been detected ir Risk was downgraded same? the source waters in recent because TTHM's are sampling period(s)? water treatment Recent VOC Sampling Results (mg/L) byproducts and the MCL was not exceeded Total Trihalomethanes (TTHM) 12/7/1998 in recent sample result Increasing: risk up 1 - 10 pts YES Decreasing: risk down 1 - 5 pts + -1 pts Same: risk unchanged Maximum Contaminant Level (MCL) in mg/L % of MCI TTHM 0.08 1% Risk due to natural Risk due to existing mansources made sources 0 pts 0 pts Existing contamination points based on linear interpolation of most recen detect [MCL = 50 pts; detect = 0 pts] Risk due to existing contamination 0 pts NO. Was the source of Evaluate the level of contamination contamination from mannatural? made sources YES




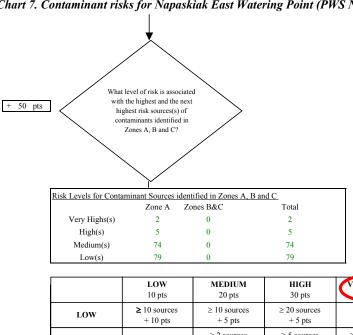

	LOW 10 pts	MEDIUM 20 pts	HIGH 30 pts	VERY HIGH 40 pts
LOW	≥ 10 sources + 10 pts	≥ 10 sources + 5 pts	≥ 20 sources + 5 pts	
MEDIUM		≥ 2 sources + 5 pts	≥ 5 sources + 5 pts	≥ 10 sources + 5 pts
HIGH			≥ 1 source + 10 pts	≥ 2 sources + 10 pts
VERY HIGH				≥ 1 source + 10 pts

Matrix Score 50

Note: Septic systems, sewerlines, and roads are each assigned a risk ranking for each individual contaminant source in tl CSI. The VA, however, counts these contaminant sources as a group and assigns a calculated number of either "lows" or "mediums" based on the density.

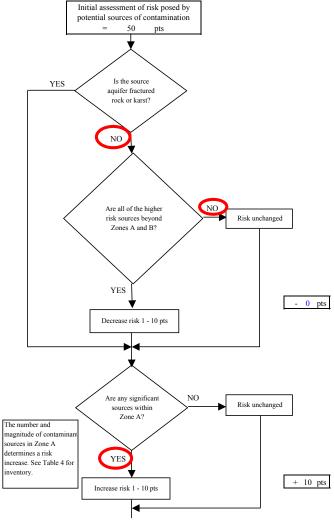


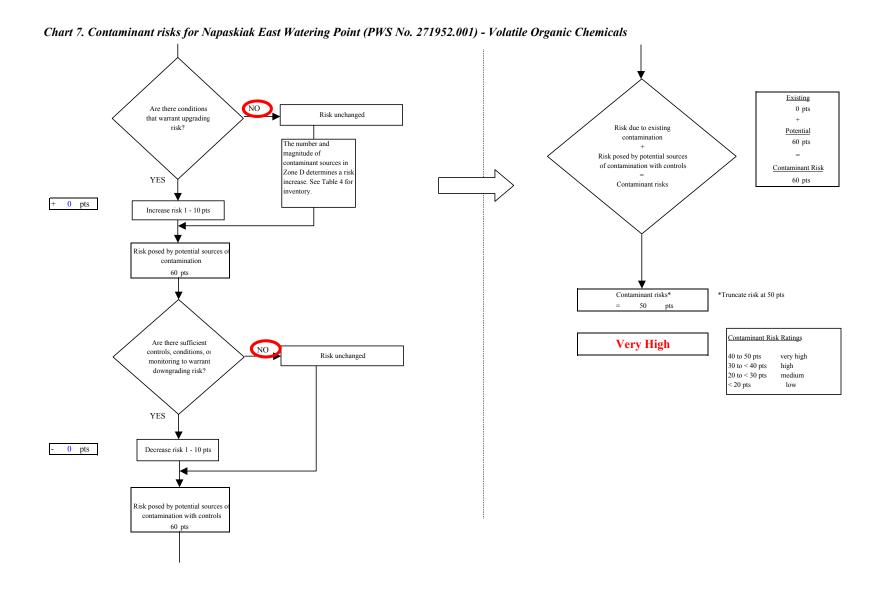



Chart 8. Vulnerability analysis for Napaskiak East Watering Point (PWS No. 271952.001) - Volatile Organic Chemicals (Chart 1. Susceptibiltiy of the wellhead) Susceptibility of well Very High 43 pts Evaluate the susceptibility of the wellhead (Chart 7. Contaminant risks for wells - Volatile Organic Chemicals) Evaluate Susceptibility of wellhead contaminant risks Very High 20 pts Evaluate the (Chart 2. Susceptibility of the aquifer) Contaminant risks Very High susceptibility of the 50 pts aquifer within the protection area Susceptibility of aquifer Very High 23 pts Susceptibility of the well Contaminant risks Vulnerability of drinking water well to contamination Susceptibility of the wellhead Overall Vulnerability Ratings Susceptibility of aquifer 80 to 100 pts very high Susceptibility of well 60 to < 80 pts high 40 to < 60 pts medium Vulnerability of drinking water well 93 pts Very High 95

Page 13 of 25

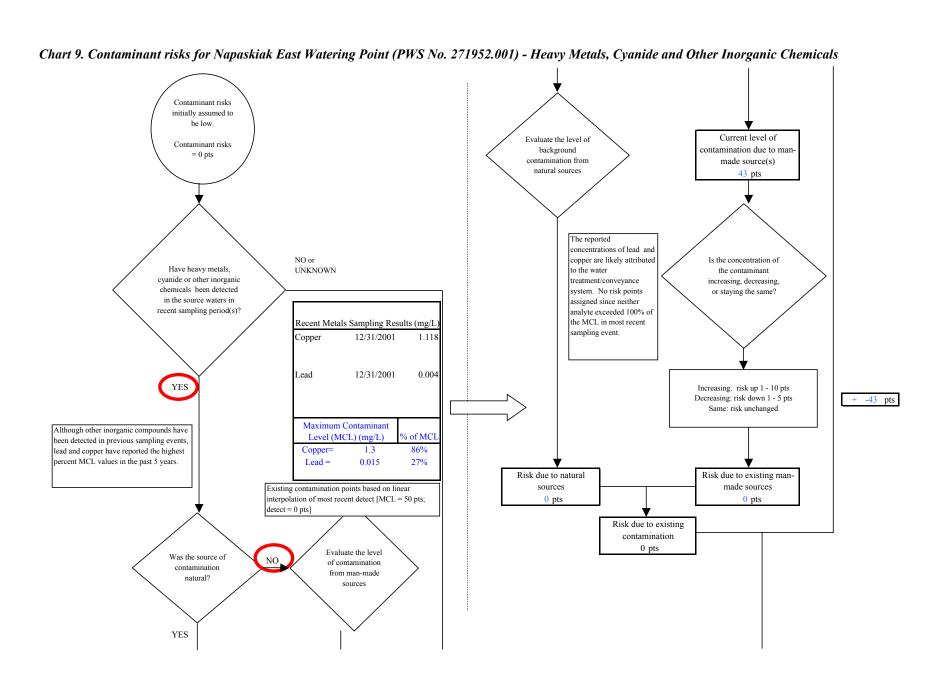

Page 14 of 25

Chart 9. Contaminant risks for Napaskiak East Watering Point (PWS No. 271952.001) - Heavy Metals, Cyanide and Other Inorganic Chemicals



	Zone A	Zones B&C	Total
Very Highs(s)	0	0	0
High(s)	1	0	1
Medium(s)	2	0	2
Low(s)	86	0	86

	LOW 10 pts	MEDIUM 20 pts	HIGH 30 pts	VERY HIGH 40 pts	
LOW	≥ 10 sources + 10 pts	≥ 10 sources + 5 pts	≥ 20 sources + 5 pts		
MEDIUM		≥ 2 sources + 5 pts	≥ 5 sources + 5 pts	≥ 10 sources + 5 pts	
HIGH			≥ 1 source + 10 pts	≥ 2 sources + 10 pts	
VERY HIGH				≥ 1 source + 10 pts	

Matrix Score 30

Note: Septic systems, sewerlines, and roads are each assigned a risk ranking for each individual contaminant source in the CSI. The VA, however, counts these contaminant sources as a group and assigns a calculated number of either "lows" or "mediums" based on the density.

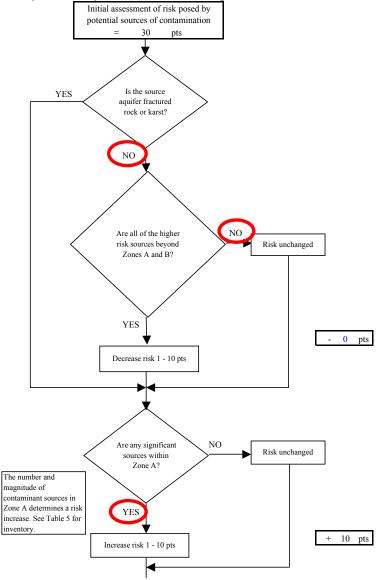


Chart 9. Contaminant risks for Napaskiak East Watering Point (PWS No. 271952.001) - Heavy Metals, Cyanide and Other Inorganic Chemicals Existing Are there conditions 0 pts Risk unchanged upgrading risk? Risk due to existing Potential contamination 40 pts The number and magnitude of Risk posed by potential sources contaminant sources in of contamination with controls Contaminant Risk Zone D determines a YES 40 pts risk increase. See Table Contaminant risks 5 for inventory. 0 pts Increase risk 1 - 10 pts Risk posed by potential sources of contamination 40 pts Contaminant risks* *Truncate risk at 50 pts 40 Contaminant Risk Ratings Are there sufficient **Very High** NQ controls, conditions, Risk unchanged 40 to 50 pts very high or monitoring to 30 to < 40 pts warrant downgrading high risk? 20 to < 30 pts medium < 20 pts low YES 0 pts Decrease risk 1 - 10 pts Risk posed by potential sources of contamination with controls 40 pts



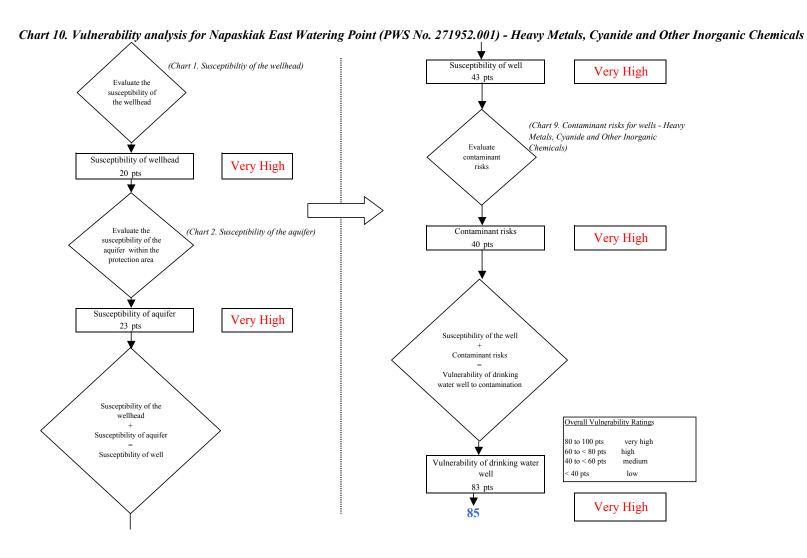


Chart 11. Contaminant risks for Napaskiak East Watering Point (PWS No. 271952.001) - Synthetic Organic Chemicals Contaminant risks initially assumed to be low. Current level of Evaluate the level of Contaminant risks background contamination due to man-= 0 ptscontamination from made source(s) natural sources NO or Is the concentration of Have synthetic organic UNKNOWN the contaminant chemicals been detected increasing, decreasing, in the source waters in or staying the same? recent sampling period(s)? Recent SOC Sampling Results (mg/L) No recent SOC sampling data was available in ADEC records for this PWSID Increasing: risk up 1 - 10 pts YES Decreasing: risk down 1 - 5 pts + 0 pts Same: risk unchanged Existing contamination points based on linear interpolation of most recent detect [MCL = 50 pts; detect = 0 pts]Risk due to natural Risk due to existing mansources made sources 0 pts 0 pts Risk due to existing contamination 0 pts Was the source of Evaluate the level of NO. contamination contamination from man-made sources YES

Page 18 of 25

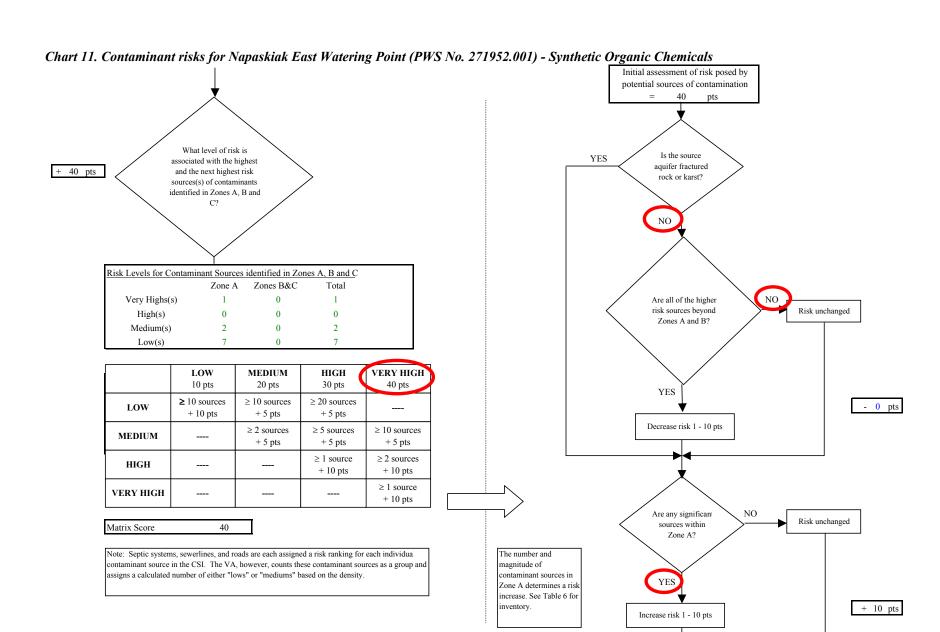

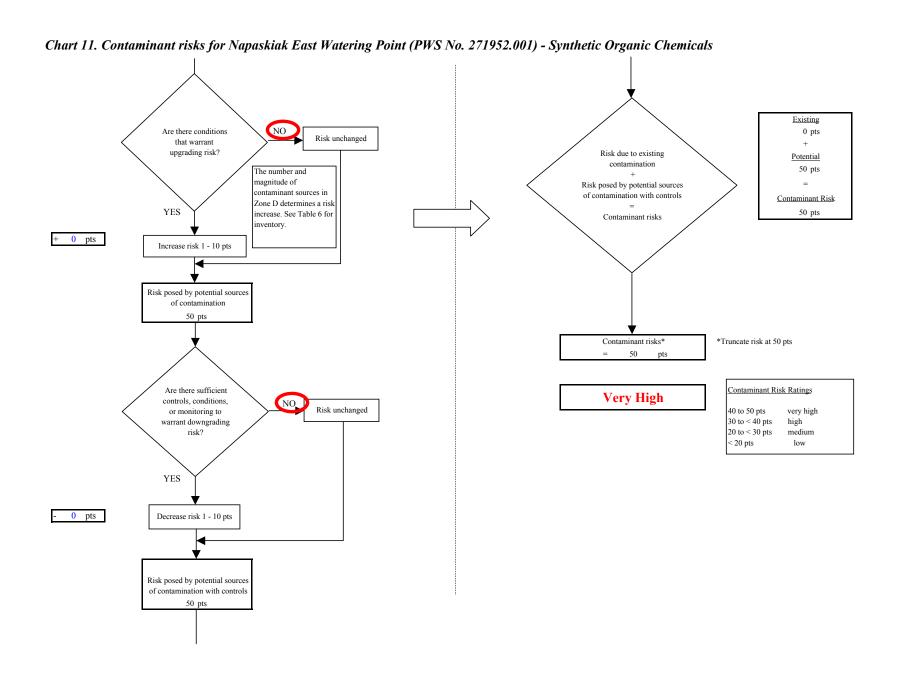

Page 20 of 25

Chart 12. Vulnerability analysis for Napaskiak East Watering Point (PWS No. 271952.001) - Synthetic Organic Chemicals (Chart 1. Susceptibiltiy of the wellhead) Susceptibility of well Very High 43 pts Evaluate the susceptibility of the wellhead (Chart 11. Contaminant risks for wells -Synthetic Organic Chemicals) Evaluate contaminant Susceptibility of wellhead Very High risks 20 pts Evaluate the (Chart 2. Susceptibility of the aquifer) Contaminant risks Very High susceptibility of the 50 pts aquifer within the protection area Susceptibility of aquifer Very High 23 pts Susceptibility of the well Contaminant risks Vulnerability of drinking water well to contamination Susceptibility of the wellhead Overall Vulnerability Ratings Susceptibility of aquifer 80 to 100 pts very high 60 to < 80 pts high Susceptibility of well 40 to < 60 pts Vulnerability of drinking water medium < 40 pts low Very High 95

Page 21 of 25

Chart 13. Contaminant risks for Napaskiak East Watering Point (PWS No. 271952.001) - Other Organic Chemicals Contaminant risks initially assumed to be low. Current level of Evaluate the level of Contaminant risks background contamination due to man-= 0 ptscontamination from made source(s) natural sources NO or Is the concentration of Have other organic UNKNOWN the contaminant chemicals been detected increasing, decreasing, in the source waters in or staying the same? recent sampling period(s)? Recent OOC Sampling Results (mg/L) No recent OOC sampling data was available in ADEC records for this PWSID Increasing: risk up 1 - 10 pts YES Decreasing: risk down 1 - 5 pts + 0 pts Same: risk unchanged Existing contamination points based on linear interpolation of most recent detect [MCL = 50 pts; detect = 0 pts]Risk due to natural Risk due to existing mansources made sources 0 pts 0 pts Risk due to existing contamination 0 pts Was the source of Evaluate the level of NO. contamination from natural? man-made sources YES

Page 22 of 25


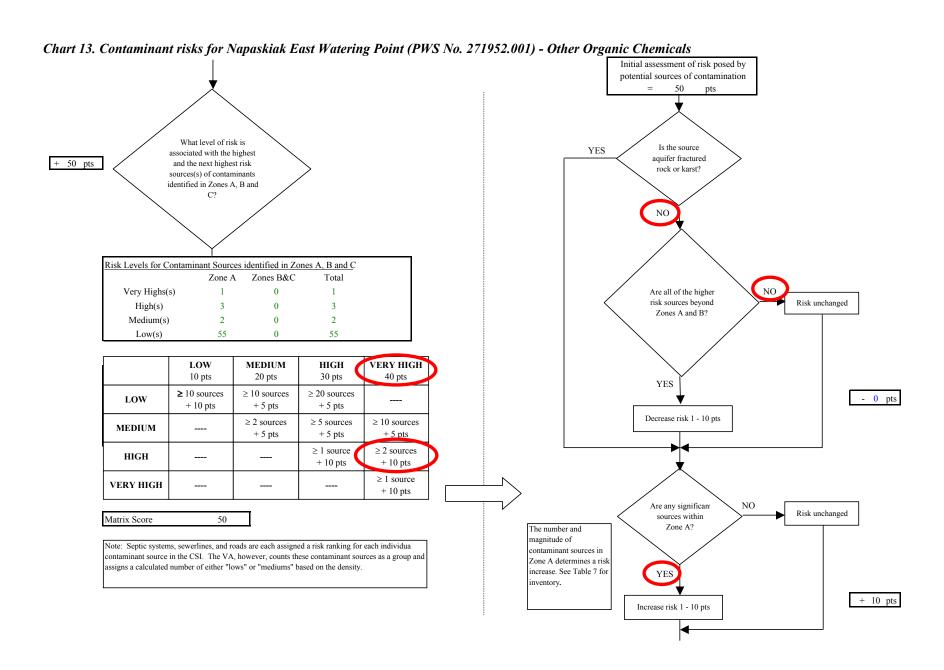


Chart 13. Contaminant risks for Napaskiak East Watering Point (PWS No. 271952.001) - Other Organic Chemicals Existing Are there conditions 0 pts Risk unchanged that warrant upgrading risk? Risk due to existing Potential contamination 60 pts The number and magnitude of Risk posed by potential sources contaminant sources in of contamination with controls Contaminant Risk Zone D determines a risk YES 60 pts increase. See Table 7 for Contaminant risks inventory. 0 pts Increase risk 1 - 10 pts Risk posed by potential sources of contamination 60 pts *Truncate risk at 50 pts Contaminant risks* 50 Are there sufficient Contaminant Risk Ratings Very High controls, conditions, NO. Risk unchanged or monitoring to 40 to 50 pts very high warrant downgrading 30 to < 40 pts high 20 to < 30 pts medium < 20 pts low YES 0 pts Decrease risk 1 - 10 pts Risk posed by potential sources of contamination with controls

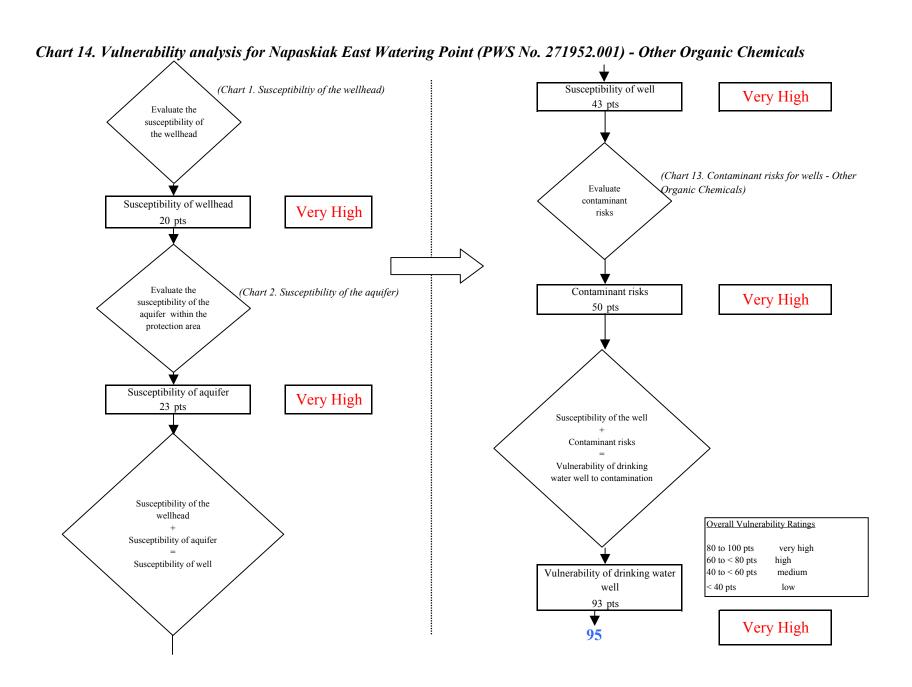

Page 25 of 25