



Source Water Assessment

A Hydrogeologic Susceptibility and Vulnerability Assessment for LKSD Z. J. Williams Memorial School Drinking Water System, Napaskiak, Alaska

PWSID # 270980.001

April 2004

DRINKING WATER PROTECTION PROGRAM REPORT 1113 Alaska Department of Environmental Conservation

Source Water Assessment for LKSD Z. J. Williams Memorial School Drinking Water System Napaskiak, Alaska

PWSID # 270980.001

DRINKING WATER PROTECTION PROGRAM REPORT 1113

The Drinking Water Protection Program (DWPP) is producing Source Water Assessments in compliance with the Safe Drinking Water Act Amendments of 1996. Each assessment includes a delineation of the source water area, an inventory of potential and existing contaminant sources that may impact the water, a risk ranking for each of these contaminants, and an evaluation of the potential vulnerability of these drinking water sources.

These assessments are intended to provide public water systems owners/operators, communities, and local governments with the best available information that may be used to protect the quality of their drinking water. The assessments combine information obtained from various sources, including the U.S. Environmental Protection Agency, Alaska Department of Environmental Conservation (ADEC), public water system owners/operators, and other public information sources. The results of this assessment are subject to change if additional data becomes available. It is anticipated this assessment will be updated every five years to reflect any changes in the vulnerability and/or susceptibility of public drinking water source. If you have any additional information that may affect the results of this assessment, please contact the Program Coordinator of DWPP, (907) 269-7521.

CONTENTS

EXECUTIVE SUMMARY1
PUBLIC DRINKING WATER SYSTEM1
DRINKING WATER PROTECTION AREA2

INVENTORY OF POTENTIAL AND EXISTING	
CONTAMINANT SOURCES	2
RANKING OF CONTAMINANT RISKS	2
VULNERABILITY OF DRINKING WATER	
SYSTEM	3

TABLES

Table 1.	Definition of Zones	2
Table 2.	Susceptibility	3
Table 3.	Contaminant Risks	4
Table 4.	Overall Vulnerability	4

APPENDICES

APPENDIX

- NDIX A. LKSD Z. J. Williams Memorial School Drinking Water Protection Area (Map A)
 - B. Contaminant Source Inventory for LKSD Z. J. Williams Memorial School (Table 1) Contaminant Source Inventory and Risk Ranking for LKSD Z. J. Williams Memorial School – Bacteria and Viruses (Table 2)
 - Contaminant Source Inventory and Risk Ranking for LKSD Z. J. Williams Memorial School Nitrates/Nitrites (Table 3)
 - Contaminant Source Inventory and Risk Ranking for LKSD Z. J. Williams Memorial School Volatile Organic Chemicals (Table 4)
 - Contaminant Source Inventory and Risk Ranking for LKSD Z. J. Williams Memorial School Heavy Metals, Cyanide and Other Inorganic Chemicals (Table 5)
 - Contaminant Source Inventory and Risk Ranking for LKSD Z. J. Williams Memorial School Synthetic Organic Chemicals (Table 6)
 - Contaminant Source Inventory and Risk Ranking for LKSD Z. J. Williams Memorial School Other Organic Chemicals (Table 7)
 - C. LKSD Z. J. Williams Memorial School Drinking Water Protection Area and Potential and Existing Contaminant Sources (Map C)
 - D. Vulnerability Analysis for Contaminant Source Inventory and Risk Ranking for LKSD Z. J. Williams Memorial School Public Drinking Water Source (Charts 1 – 14)

Source Water Assessment for LKSD Z. J. Williams Memorial School Source of Public Drinking Water, Napaskiak, Alaska

Drinking Water Protection Program Alaska Department of Environmental Conservation

EXECUTIVE SUMMARY

The LKSD Z. J. Williams Memorial School has one Public Water System (PWS) wells. The date of well construction is unknown; however, it is assumed that the well (PWS No. 270980.001) has been used as a drinking water source since that time.

The well is a Class A (community and nontransient/non-community) water system located approximately 0.125 miles south of the Napaskiak Slough, in Napaskiak, Alaska. Available records indicate that there is no drinking water storage, other than the pressure tank, and that the untreated drinking water source is derived directly from the wellhead. This system operates year round and serves approximately 121 residents through one service connection. The wellhead received a susceptibility rating of **Very High** and the aquifer received a susceptibility rating of **Very High**. Combining these two ratings produce a **Very High** rating for the natural susceptibility of the well.

Identified potential and current sources of contaminants for the public drinking water source include: domestic wastewater treatment plant disposal ponds/lagoons, nonresidential pit toilets, aboveground fuel tanks, wastewater holding tanks, water supply wells, cemeteries, petroleum product bulk station/terminals, pipelines, roads, electric power generation, firehouses, and a medical/veterinary facility. These identified potential and existing sources of contamination are considered as sources of bacteria and viruses, nitrates and/or nitrites, volatile organic chemicals, heavy metals, cyanide and other inorganic chemicals, synthetic organic chemicals, and other organic chemicals contaminant categories.

Overall, the water well received a vulnerability rating of **Very High** for bacteria and viruses, nitrates and nitrites, volatile organic chemicals, heavy metals, cyanide and other inorganic chemicals, and other organic chemicals, and a vulnerability rating of **High** for synthetic organic chemicals.

PUBLIC DRINKING WATER SYSTEM

The LKSD Z. J. Williams Memorial School well is a Class A (community/non-transient/non-community) public water system. The system is located approximately 0.125 miles south of the Napaskiak Slough, in Napaskiak, Alaska (Sec. 9, T7N, R71W, Seward Meridian; see Map A of Appendix A). Napaskiak is located on the east bank of the Kuskokwim River, along the Napaskiak Slough, seven miles southeast of Bethel. The community has a population of 408 (ADCED, 2003). Average annual precipitation for Bethel is 16 inches, including approximately 50 inches of snowfall. Temperatures range from 42 to 62°F in summer and -2 to 19°F in winter.

The community of Napaskiak obtains their water from community wells and hauls the treated water from one of two watering points to residences . Honey buckets are disposed of by residents in bunkers at various locations and the sewage is then pumped and transported to the sewage lagoon. (ADCED, 2003). Electricity is provided by the Napaskiak Electric Utility. Power generating facilities are fueled by diesel. Refuse is collected by the City of Napaskiak and transported to the City operated landfill (ADCED, 2003).

According to information supplied by ADEC for the LKSD Z. J. Williams Memorial School PWS, the depth of the primary water well is 180 feet below the ground surface. Well construction details are unknown; however, it is assumed that the well is screened in a confined aquifer based on surrounding wells. The well is located within a floodplain.

Information acquired from a September 1998 sanitary survey for the public water system indicated that the land surface was not sloped away from the well. Generally, land surfaces that slope away from the wellhead promote surface water drainage, which reduces the potential of contaminant migration down the well casing annulus. The sanitary survey indicates that it is unknown if the well is grouted according to ADEC regulations. Proper grouting provides added protection against contaminants traveling along the well casing annulus and into source waters.

The Bethel area is near the southern border of the continuous permafrost zone and the City, and most of the area west of the Kuskokwim River, appear to be underlain with permafrost. The permafrost generally extends to a depth of at least 300 feet bgs, with depths of over 600 feet bgs recorded in some areas. The geology in the area consists primarily of unconsolidated floodplain alluvium, silt deposits, and reworked silt. The Bethel area consists of poorly drained wetlands that have permanently ponded water in local depressions. Sloughs, small lakes, ponds, and marshes in meander scars surround Bethel and surrounding communities (Dames & Moore, 1996).

DRINKING WATER PROTECTION AREA

In order to evaluate whether a drinking water source is at risk, we must first evaluate what are the most likely pathways for surface contamination to reach the groundwater. These areas are determined by looking at the characteristics of the soil, groundwater, aquifer, and well.

The most probable area for contamination to reach the drinking water well is the area that contributes water to the well, the groundwater recharge area. This area is designated as the drinking water protection area (DWPA). Because releases of contaminants within the protection area are most likely to impact the drinking water well, this area will serve as the focus for voluntary protection efforts. An analytical calculation was used to determine the size and shape of the DWPA for the LKSD Z. J. Williams Memorial School PWS. The input parameters describing the attributes of the aquifer in this calculation were adopted from Groundwater (Freeze and Cherry, 1979). Available geology and groundwater contours were also considered to take into account any uncertainties in groundwater flow and aquifer characteristics to arrive at a meaningful protection area.

The protection areas established for wells by the ADEC are usually separated into four zones, limited by the watershed. These zones correspond to differences in the time-of-travel (TOT) of the water moving through the aquifer to the well (Please refer to the Guidance Manual for Class A Public Water Systems for additional information).

The time of travel for contaminants within the water varies and is dependent on the physical and chemical

characteristics of each contaminant. The following is a summary of the four protection area zones for wells and the calculated time -of-travel for each: **Table 1. Definition of Zones**

Zone	Definition				
А	¹ / ₄ the distance for the 2-yr. time -of-travel				
В	Less than the 2 year time-of-travel				
С	Less Than the 5 year time -of-travel				
D	Less than the 10 year time -of-travel				
	•				

The DWPA for the LKSD Z. J. Williams Memorial School PWS was determined using an analytical calculation and includes Zones A, B, C, and D (See Map A of Appendix A).

INVENTORY OF POTENTIAL AND EXISTING CONTAMINANT SOURCES

The Drinking Water Protection Program has completed an inventory of potential and existing sources of contamination within the LKSD Z. J. Williams Memorial School DWPA. This inventory was completed through a search of agency records and other publicly available information. Potential sources of contamination to the drinking water aquifer include a wide range of categories and types. Potential drinking water contaminants are found within agricultural, residential, commercial, and industrial areas, but can also occur within areas that have little or no development.

For the basis of all Class A public water system assessments, six categories of drinking water contaminants were inventoried. They include:

- Bacteria and viruses,
- Nitrates and/or nitrites,
- Volatile organic chemicals,
- Heavy metals, cyanide and other inorganic chemicals,
- Synthetic organic chemicals,
- Other organic chemicals.

The sources are displayed on Map C of Appendix C and summarized in Table 1 of Appendix B.

RANKING OF CONTAMINANT RISKS

Once the potential and existing sources of contamination have been identified, they are assigned a ranking according to what type and level of risk they represent. Ranking of contaminant risks for a "potential" or "existing" source of contamination is a function of toxicity and volumes of specific contaminants associated with that source. Rankings include:

- Low,
- Medium,
- High, and
- Very High.

The time-of-travel for contaminants within the water varies and is dependent on the physical and chemical characteristics of each contaminant. Bacteria and Viruses are only inventoried in Zones A and B because of their short life span. Only "Very High" and "High" rankings are inventoried within the outer Zone D due to the probability of contaminant dilution by the time the contaminants get to the well. Tables 2 through 4 in Appendix B contain the ranking of potential and existing sources of contamination with respect to bacteria and viruses, nitrates and/or nitrites, volatile organic chemicals, heavy metals, cyanide and other inorganic chemicals, synthetic organic chemicals, and other organic chemicals.

VULNERABILITY OF THE DRINKING WATER SYSTEM

Vulnerability of a drinking water source to contamination is a combination of two factors:

- Natural susceptibility, and
- Contaminant risks.

Appendix D contains fourteen charts, which together form the 'Vulnerability Analysis' for a source water assessment for a public drinking water source. Chart 1 analyzes the 'Susceptibility of the Wellhead' to contamination by looking at the construction of the well and its surrounding area. Chart 2 analyzes the 'Susceptibility of the Aquifer' to contamination by looking at the naturally occurring attributes of the water source and influences on the groundwater system that might lead to contamination. Chart 3 analyzes 'Contaminant Risks' for the drinking water source with respect to bacteria and viruses. The 'Contaminant Risks' portion of the analysis considers potential sources of contaminants as well as a review of contamination that has or may have occurred, but has not arrived or been detected at the well. Chart 4 contains the 'Vulnerability Analysis for Bacteria and Viruses'. Charts 5 through 14 contain the Contaminant Risks and Vulnerability Analyses for nitrates and nitrites, volatile organic chemicals, heavy metals, cyanide and other inorganic chemicals, synthetic organic chemicals, and other organic chemicals, respectively.

A score for the Natural Susceptibility is reached by considering the properties of the well and the aquifer.

Susceptibility of the Wellhead (0 – 25 Points) (Chart 1 of Appendix D)

+

Susceptibility of the Aquifer (0 – 25 Points) (Chart 2 of Appendix D)

=

Natural Susceptibility (Susceptibility of the Well) (0-50 Points)

A ranking is assigned for the Natural Susceptibility according to the point score:

Natural Susceptibility Ratings				
40 to 50 pts	Very High			
30 to < 40 pts	High			
20 to < 30 pts	Medium			
< 20 pts	Low			

The LKSD Z. J. Williams Memorial School's water well is in a confined aquifer. Confined aquifers are less susceptible to potential groundwater quality impacts posed by the migration of surface water contaminants downward from the surface. Table 2 shows the susceptibility scores and ratings for this PWS.

Table 2. Susceptibility

	Score	Rating
Susceptibility of the	25	Very High
Wellhead		
Susceptibility of the	22	Very High
Aquifer		
Natural Susceptibility	47	Very High

Contaminant risks to a drinking water source depend on the type, number or density, and distribution of contaminant sources. This score has been derived from an examination of existing and historical contamination that has been detected at the drinking water source through routine sampling. It also evaluates potential sources of contamination. Flow charts are used to assign a point score, and ratings are assigned in the same way as for the natural susceptibility:

Contaminant Risk Ratings				
40 to 50 pts	Very High			
30 to < 40 pts	High			
20 to < 30 pts	Medium			
< 20 pts	Low			

Table 3 summarizes the Contaminant Risks for each category of drinking water contaminants.

Table 3. Contaminant Risks

Category	Score	Rating
Bacteria and Viruses	45	Very High
Nitrates and/or Nitrites	50	Very High
Volatile Organic Chemical	s 50	Very High
Heavy Metals, Cyanide an	d	
Other Inorganic Chemicals	50	Very High
Synthetic Organic Chemica	als 25	Medium
Other Organic Chemicals	50	Very High

Finally, an overall vulnerability score is assigned for each water system by combining each of the contaminant risk scores with the natural susceptibility score:

Natural Susceptibility (0 – 50 points)

Contaminant Risks
$$(0 - 50 \text{ points})$$

=

Vulnerability of the Drinking Water Source to Contamination (0 - 100).

Again, rankings are assigned according to a point score:

Overall Vulnerability Ratings					
80 to 100 pts	Very High				
60 to < 80 pts	High				
40 to < 60 pts	Medium				
< 40 pts	Low				

Table 4 contains the overall vulnerability scores (0 - 100) and ratings for each of the six categories of drinking water contaminants. Note: scores are rounded off to the nearest five.

Table 4. Overall Vulnerability

Category	Score	Rating
Bacteria and Viruses	95	Very High
Nitrates and Nitrites	100	Very High
Volatile Organic Chemicals	100	Very High
Heavy Metals, Cyanide and		
Other Inorganic Chemicals	100	Very High
Synthetic Organic Chemicals	70	High
Other Organic Chemicals	100	Very High

Bacteria and Viruses

The contaminant risk for bacteria and viruses is **Very High**. The risk is primarily attributed to the presence of a domestic wastewater treatment plant disposal pond/lagoon in ZoneA (see Table 2 – Appendix B).

No positive bacteria counts have been reported in recent (within five years) sampling events (See Chart 3 – Contaminant Risks for Bacteria and Viruses in Appendix D). Only a small amo unt of bacteria and viruses are required to endanger public health.

After combining the contaminant risk for bacteria and viruses with the natural susceptibility of the well, the overall vulnerability of the well to contamination is **Very High**.

Nitrates and Nitrites

The contaminant risk for nitrates and nitrites is **Very High**. The risk to this source of public drinking water is primarily attributed to the presence of a domestic wastewater treatment plant disposal pond/lagoon in Zone A (see Table 3 – Appendix B).

Nitrates are very mobile, moving at approximately the same rate as water. The sampling history for this well indicates that low levels of nitrates have been detected in recent sampling events. However, the reported concentrations of nitrates do not exceed the maximum contaminant level (MCL) of 10 mg/L. Nitrate concentrations in uncontaminated groundwater are typically less than 2 mg/L; therefore, nitrate concentrations above 2 mg/L may be indicative of man-made sources (See Chart 5 -Contaminant Risks for Nitrates and/or Nitrites in Appendix D).

Nitrate levels are often derived from the decomposition of organic matter in soils. Although the nitrate source is unknown, such occurrences may be attributed to septic systems or other sources. After combining the contaminant risk for nitrates and nitrites with the natural susceptibility of the well, the overall vulnerability of the well to nitrate and nitrite

contamination is Very High

Volatile Organic Chemicals

The contaminant risk for volatile organic chemicals is **Very High**. The risk is primarily attributed to the presence of a petroleum product bulk stations/terminal located in Zone A. Numerous other potential contaminant sources are also found within the protection area (see Table 4 – Appendix B).

All recent sampling data for VOCs were below the detection levels for the LKSD Z. J. Williams Memorial School (See Chart 7 – Contaminant Risks for Volatile Organic Chemicals in Appendix D).

After combining the contaminant risk for volatile organic chemicals with the natural susceptibility of the well, the overall vulnerability of the well to contamination is **Very High**

Heavy Metals, Cyanide and Other Inorganic Chemicals

The contaminant risk for heavy metals, cyanide and other inorganic chemicals is **Very High**. The risk is primarily attributed to the presence of wastewater holding tanks and electric power generation located in Zone A. Numerous other potential contaminant sources are also found within the protection area (see Table 5 – Appendix B).

Based on review of recent sampling records for this public water system, high levels of arsenic have been detected in recent sampling history. The analyte exceeded the MCL of 0.05 mg/L (see Chart 9 – Contaminant Risks for Heavy Metals, Cyanide, and Other Inorganic Chemicals in Appendix D).

After combining the contaminant risk for heavy metals, cyanide and other inorganic chemicals with the natural susceptibility of the well, the overall vulnerability of the well to contamination is **Very High**.

Synthetic Organic Chemicals

The contaminant risk for synthetic organic chemicals is **Medium**. The risk is primarily attributed to the presence of a cemetery in Zone A. Numerous other potential contaminant sources are also found within the protection area (see Table 6 – Appendix B).

No recent sampling data was available in ADEC records for the LKSD Z. J. Williams Memorial School (See Chart 11 – Contaminant Risks for Synthetic Organic Chemicals in Appendix D). After combining the contaminant risk for synthetic organic chemicals with the natural susceptibility of the well, the overall vulnerability of the well to contamination is **High**.

Other Organic Chemicals

The contaminant risk for other organic chemicals is **Very High**. The risk is primarily attributed to the presence of petroleum product bulk stations/terminal, electric power generation, and a pipeline in Zone A. Numerous other potential contaminant sources are also found within the protection area (see Table 7 – Appendix B).

No recent sampling data was available in ADEC records for the LKSD Z. J. Williams Memorial School (See Chart 13 – Contaminant Risks for Other Organic Chemicals in Appendix D).

After combining the contaminant risk for other organic chemicals with the natural susceptibility of the well, the overall vulnerability of the well to contamination is **Very High**

Using the Source Water Assessment

This assessment of contaminant risks can be used as a foundation for local voluntary protection efforts as well as a basis for the continuous efforts on the part of the LKSD Z. J. Williams Memorial School and the community of Napaskiak to protect public health. It is anticipated that Source Water Assessments will be updated every five years to reflect any changes in the vulnerability and/or susceptibility of the drinking water source.

REFERENCES

Alaska Department of Community and Economic Development (ADCED), 2003 [WWW document]. URL: <u>http://www.dced.state.ak.us/cbd/commdb/CF_COMDB.htm</u>

Alaska Department of Environmental Conservation, Contaminated Sites Database, 2003 [WWW database], URL http://www.state.ak.us/dec/dspar/csites/cs_search.htm

Alaska Department of Environmental Conservation, Leaking Underground Storage Tank Database, 2003 [WWW database], URL <u>http://www.dec.state.ak.us/spar/stp/ust/search/fac_search.asp</u>


Dames & Moore, 1996. Final Water and Sewer Facilities Master Plan Update Report, City of Bethel.

Freeze, R. A., and Cherry, J.A. 1979, Groundwater, Prentice-Hall, Englewood Cliffs, New Jersey

United States Environmental Protection Agency (EPA), 2002 [WWW document]. URL <u>http://www.epa.gov/safewater/mcl.html</u>.

APPENDIX A

Drinking Water Protection Area Location Map (Map A)

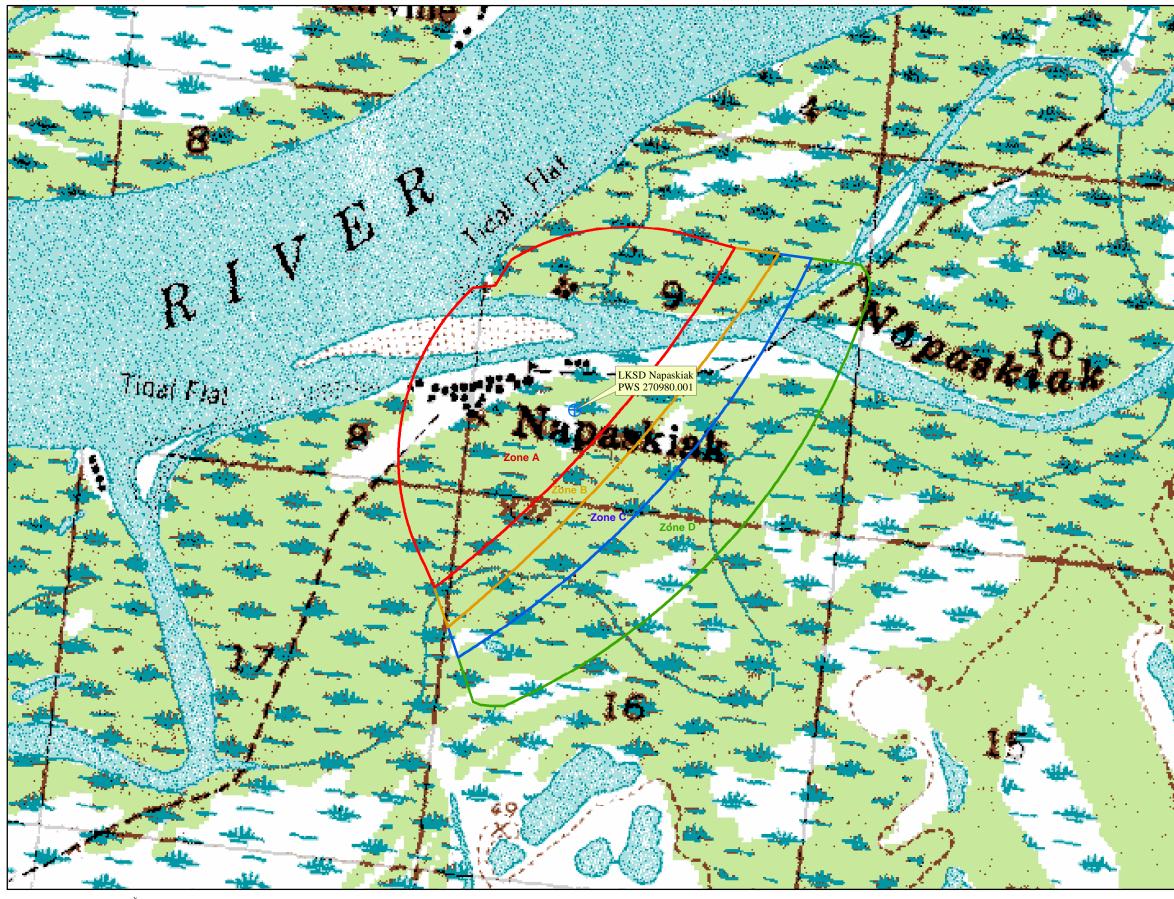

2 Miles 0.25 0.5 1.5



LEGEND

+ Public Water System Well

Hydrography/Physical

- Parcels \sim
- Stream
- Lake or Pond ∼ Contours
- ----- Watershed Boundary

Transportation

- Primary Route (Class 1)
- Secondary Route (Class 2)
- Road (Class 3)
- Road (Class 4)
- ----- Road (Class 5, Four-wheel drive)

Groundwater Protection Zones

Zone A Protection Area- Several Months Travel Time
Zone B Protection Area- 2 Years Travel Time
Zone C Protection Area- 5 Years Travel Time
Zone D Protection Area- 10 Years Travel Time


Data Sources: Contaminant Sources, Public Water System Wells, Contours Alaska Department of Environmental Conservation (ADEC)

Critical Facilities, Federal Emergency Management Agency (FEMA)

All other data: United States Geological Survey (USGS)

Drinking Water Protection Areas based on "Alaska Drinking Water Protection Program - Guidance Manual for Class A Public Water Systems" published by ADEC

URS Corporation does not guarantee the accuracy or validity of the data provided.

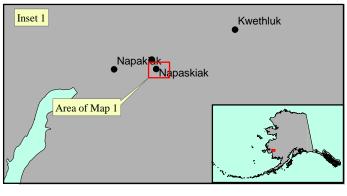

LKSD Napaskiak PWS 270980.001

Appendix A Map A

APPENDIX B

Contaminant Source Inventory and Risk Ranking (Tables 1-7)

Contaminant Source Inventory for LKSD Napaskiak

PWSID 270980.001

Contaminant Source Type	Contaminant Source ID	CS ID tag	Zone	Map Number	Comments
Domestic wastewater treatment plant disposal ponds/lagoons	D02	D02-01	А	С	
Pit toilets (open hole), nonresidential (one or more)	D16	D16-01	А	С	Assume 5 or less honeybucket pits located in Zone A
Tanks, heating oil, residential (above ground)	R08	R08-01	А	С	Assume 70 or less residential heating oil tanks in Zone A
Tanks, diesel (above ground)	T06	T06-01	А	С	School backup generator
Tanks, heating oil, nonresidential (aboveground)	T14	T14-01	А	С	Napaskiak Electric Utility
Tanks, heating oil, nonresidential (aboveground)	T14	T14-02	А	С	Clinic
Tanks, heating oil, nonresidential (aboveground)	T14	T14-03	А	С	Store
Tanks, heating oil, nonresidential (aboveground)	T14	T14-04	А	С	Teachers Quarters
Tanks, heating oil, nonresidential (aboveground)	T14	T14-05	А	С	UUT
Tanks, heating oil, nonresidential (aboveground)	T14	T14-06	А	С	Moravian Church
Tanks, heating oil, nonresidential (aboveground)	T14	T14-07	А	С	Russian Orthodox Church
Tanks, heating oil, nonresidential (aboveground)	T14	T14-08	А	С	Community Hall
Tanks, heating oil, nonresidential (aboveground)	T14	T14-09	А	С	Fire Station
Tanks, heating oil, nonresidential (aboveground)	T14	T14-10	А	С	National Guard Armory
Tanks, heating oil, nonresidential (aboveground)	T14	T14-11	А	С	Old National Guard Armory
Tanks, heating oil, nonresidential (aboveground)	T14	T14-12	А	С	City Office
Tanks, heating oil, nonresidential (aboveground)	T14	T14-13	А	С	Tribal Office
Tanks, heating oil, nonresidential (aboveground)	T14	T14-14	А	С	Utility Office
Tanks, heating oil, nonresidential (aboveground)	T14	T14-15	А	С	Police Station
Tanks, heating oil, nonresidential (aboveground)	T14	T14-16	А	С	Post Office
Tanks, heating oil, nonresidential (aboveground)	T14	T14-17	А	С	School Internet Satellite
Tanks, heating oil, nonresidential (aboveground)	T14	T14-18	А	С	UUT Satellite
Tanks, heating oil, nonresidential (aboveground)	T14	T14-19	А	С	Z. John William School
Wastewater Holding Tank	T22	T22-01	А	С	Assume 50 or less wastewater holding tanks in Zone A

Contaminant Source Type	Contaminant Source ID	CS ID tag	Zone	Map Number	Comments
Water supply wells	W09	W09-01	А	С	1 water supply well in Zone A
Cemeteries	X01	X01-01	А	С	
Petroleum product bulk station/terminals	X11	X11-01	А	С	LKSD
Highways and roads, dirt/gravel	X24	X24-01	А	С	Assume 1-20 roads in Zone A
Pipelines (oil and gas)	X28	X28-01	А	С	
Electric power generation (fossil fuels)	X36	X36-01	А	С	
Firehouses	X38	X38-01	А	С	
Medical/veterinary facilities (doctor or dentist offices, hospitals, nursing homes)	X40	X40-01	А	С	

Table 2

Contaminant Source Inventory and Risk Ranking for

LKSD Napaskiak Sources of Bacteria and Viruses

Contaminant Source Type	Contaminant Source ID	CS ID tag	Zone	Risk Ranking for Analysis	Map Number	Comments
Domestic wastewater treatment plant disposal ponds/lagoons	D02	D02-01	А	High	С	
Pit toilets (open hole), nonresidential (one or more	D16	D16-01	А	Medium	С	Assume 5 or less honeybucket pits located in Zone A
Wastewater Holding Tank	T22	T22-01	А	Low	С	Assume 50 or less wastewater holding tanks in Zone A
Highways and roads, dirt/gravel	X24	X24-01	А	Low	С	Assume 1-20 roads in Zone A
Medical/veterinary facilities (doctor or dentist offices, hospitals, nursing homes)	X40	X40-01	А	Medium	С	

Table 3

Contaminant Source Inventory and Risk Ranking for

LKSD Napaskiak Sources of Nitrates/Nitrites

Contaminant Source Type	Contaminant Source ID	CS ID tag	Zone	Risk Ranking for Analysis	Map Number	Comments
Domestic wastewater treatment plant disposal ponds/lagoons	D02	D02-01	А	High	С	
Pit toilets (open hole), nonresidential (one or more	D16	D16-01	А	Medium	С	Assume 5 or less honeybucket pits located in Zone A
Wastewater Holding Tank	T22	T22-01	А	Low	С	Assume 50 or less wastewater holding tanks in Zone A
Cemeteries	X01	X01-01	А	Medium	С	
Highways and roads, dirt/gravel	X24	X24-01	А	Low	С	Assume 1-20 roads in Zone A
Medical/veterinary facilities (doctor or dentist offices, hospitals, nursing homes)	X40	X40-01	А	Low	С	

Contaminant Source Inventory and Risk Ranking for

LKSD Napaskiak Sources of Volatile Organic Chemicals

Contaminant Source Type	Contaminant Source ID	CS ID tag	Zone	Risk Ranking for Analysis	Map Number	Comments
Domestic wastewater treatment plant disposal ponds/lagoons	D02	D02-01	А	Low	С	
Pit toilets (open hole), nonresidential (one or more	D16	D16-01	А	Low	С	Assume 5 or less honeybucket pits located in Zone A
Tanks, heating oil, residential (above ground)	R08	R08-01	А	Medium	С	Assume 70 or less residential heating oil tanks in Zone A
Tanks, diesel (above ground)	T06	T06-01	А	Medium	С	School backup generator
Tanks, heating oil, nonresidential (aboveground)	T14	T14-01	А	Low	С	Napaskiak Electric Utility
Tanks, heating oil, nonresidential (aboveground)	T14	T14-02	А	Low	С	Clinic
Tanks, heating oil, nonresidential (aboveground)	T14	T14-03	А	Low	С	Store
Tanks, heating oil, nonresidential (aboveground)	T14	T14-04	А	Low	С	Teachers Quarters
Tanks, heating oil, nonresidential (aboveground)	T14	T14-05	А	Low	С	UUT
Tanks, heating oil, nonresidential (aboveground)	T14	T14-06	А	Low	С	Moravian Church
Tanks, heating oil, nonresidential (aboveground)	T14	T14-07	А	Low	С	Russian Orthodox Church
Tanks, heating oil, nonresidential (aboveground)	T14	T14-08	А	Low	С	Community Hall
Tanks, heating oil, nonresidential (aboveground)	T14	T14-09	А	Low	С	Fire Station
Tanks, heating oil, nonresidential (aboveground)	T14	T14-10	А	Low	С	National Guard Armory
Tanks, heating oil, nonresidential (aboveground)	T14	T14-11	А	Low	С	Old National Guard Armory
Tanks, heating oil, nonresidential (aboveground)	T14	T14-12	А	Low	С	City Office
Tanks, heating oil, nonresidential (aboveground)	T14	T14-13	А	Low	С	Tribal Office
Tanks, heating oil, nonresidential (aboveground)	T14	T14-14	А	Low	С	Utility Office
Tanks, heating oil, nonresidential (aboveground)	T14	T14-15	А	Low	С	Police Station
Tanks, heating oil, nonresidential (aboveground)	T14	T14-16	А	Low	С	Post Office
Tanks, heating oil, nonresidential (aboveground)	T14	T14-17	А	Low	С	School Internet Satellite
Tanks, heating oil, nonresidential (aboveground)	T14	T14-18	А	Low	С	UUT Satellite
Tanks, heating oil, nonresidential (aboveground)	T14	T14-19	А	Low	С	Z. John William School

Table 4 (continued)

Contaminant Source Inventory and Risk Ranking for

PWSID 270980.001

LKSD Napaskiak Sources of Volatile Organic Chemicals

Contaminant Source Type	Contaminant Source ID	CS ID tag	Zone	Risk Ranking for Analysis	Map Number	Comments
Wastewater Holding Tank	T22	T22-01	А	Medium	С	Assume 50 or less wastewater holding tanks in Zone A
Petroleum product bulk station/terminals	X11	X11-01	А	Very High	С	LKSD
Highways and roads, dirt/gravel	X24	X24-01	А	Low	С	Assume 1-20 roads in Zone A
Pipelines (oil and gas)	X28	X28-01	А	Medium	С	
Electric power generation (fossil fuels)	X36	X36-01	А	Medium	С	
Firehouses	X38	X38-01	А	Low	С	
Medical/veterinary facilities (doctor or dentist offices, hospitals, nursing homes)	X40	X40-01	А	Low	С	

Table 5

Contaminant Source Inventory and Risk Ranking for

LKSD Napaskiak Sources of Heavy Metals, Cyanide and Other Inorganic Chemicals

Contaminant Source Type	Contaminant Source ID	CS ID tag	Zone	Risk Ranking for Analysis	Map Number	Comments
Domestic wastewater treatment plant disposal ponds/lagoons	D02	D02-01	А	Low	С	
Pit toilets (open hole), nonresidential (one or more	D16	D16-01	А	Low	С	Assume 5 or less honeybucket pits located in Zone A
Tanks, heating oil, nonresidential (aboveground)	T14	T14-01	А	Low	С	Napaskiak Electric Utility
Tanks, heating oil, nonresidential (aboveground)	T14	T14-02	А	Low	С	Clinic
Tanks, heating oil, nonresidential (aboveground)	T14	T14-03	А	Low	С	Store
Tanks, heating oil, nonresidential (aboveground)	T14	T14-04	А	Low	С	Teachers Quarters
Tanks, heating oil, nonresidential (aboveground)	T14	T14-05	А	Low	С	UUT
Tanks, heating oil, nonresidential (aboveground)	T14	T14-06	А	Low	С	Moravian Church
Tanks, heating oil, nonresidential (aboveground)	T14	T14-07	А	Low	С	Russian Orthodox Church
Tanks, heating oil, nonresidential (aboveground)	T14	T14-08	А	Low	С	Community Hall
Tanks, heating oil, nonresidential (aboveground)	T14	T14-09	А	Low	С	Fire Station
Tanks, heating oil, nonresidential (aboveground)	T14	T14-10	А	Low	С	National Guard Armory
Tanks, heating oil, nonresidential (aboveground)	T14	T14-11	А	Low	С	Old National Guard Armory
Tanks, heating oil, nonresidential (aboveground)	T14	T14-12	А	Low	С	City Office
Tanks, heating oil, nonresidential (aboveground)	T14	T14-13	А	Low	С	Tribal Office
Tanks, heating oil, nonresidential (aboveground)	T14	T14-14	А	Low	С	Utility Office
Tanks, heating oil, nonresidential (aboveground)	T14	T14-15	А	Low	С	Police Station
Tanks, heating oil, nonresidential (aboveground)	T14	T14-16	А	Low	С	Post Office
Tanks, heating oil, nonresidential (aboveground)	T14	T14-17	А	Low	С	School Internet Satellite
Tanks, heating oil, nonresidential (aboveground)	T14	T14-18	А	Low	С	UUT Satellite
Tanks, heating oil, nonresidential (aboveground)	T14	T14-19	А	Low	С	Z. John William School
Wastewater Holding Tank	T22	T22-01	А	Medium	С	Assume 50 or less wastewater holding tanks in Zone A
Cemeteries	X01	X01-01	А	Low	С	

Table 5 (continued)

Contaminant Source Inventory and Risk Ranking for

LKSD Napaskiak Sources of Heavy Metals, Cyanide and Other Inorganic Chemicals

Contaminant Source Type	Contaminant Source ID	CS ID tag	Zone	Risk Ranking for Analysis	Map Number	Comments
Petroleum product bulk station/terminals	X11	X11-01	А	Low	С	LKSD
Highways and roads, dirt/gravel	X24	X24-01	А	Low	С	Assume 1-20 roads in Zone A
Pipelines (oil and gas)	X28	X28-01	А	Low	С	
Electric power generation (fossil fuels)	X36	X36-01	А	Medium	С	
Firehouses	X38	X38-01	А	Low	С	
Medical/veterinary facilities (doctor or dentist offices, hospitals, nursing homes)	X40	X40-01	А	Low	С	

Table 6

Contaminant Source Inventory and Risk Ranking for

LKSD Napaskiak Sources of Synthetic Organic Chemicals

Contaminant Source Type	Contaminant Source ID	CS ID tag	Zone	Risk Ranking for Analysis	Map Number	Comments
Domestic wastewater treatment plant disposal ponds/lagoons	D02	D02-01	А	Low	С	
Cemeteries	X01	X01-01	А	Medium	С	
Petroleum product bulk station/terminals	X11	X11-01	А	Low	С	LKSD
Medical/veterinary facilities (doctor or dentist offices, hospitals, nursing homes)	X40	X40-01	А	Low	С	

Table 7

Contaminant Source Inventory and Risk Ranking for

LKSD Napaskiak Sources of Other Organic Chemicals

Contaminant Source Type	Contaminant Source ID	CS ID tag	Zone	Risk Ranking for Analysis	Map Number	Comments
Domestic wastewater treatment plant disposal ponds/lagoons	D02	D02-01	А	Low	С	
Wastewater Holding Tank	T22	T22-01	А	Medium	С	Assume 50 or less wastewater holding tanks in Zone A
Petroleum product bulk station/terminals	X11	X11-01	А	High	С	LKSD
Highways and roads, dirt/gravel	X24	X24-01	А	Low	С	Assume 1-20 roads in Zone A
Pipelines (oil and gas)	X28	X28-01	А	High	С	
Electric power generation (fossil fuels)	X36	X36-01	А	High	С	

APPENDIX C

Drinking Water Protection Area and Potential and Existing Contaminant Sources (Map C)

Public Water Well System for PWS #270980.001 LKSD Napaskiak Showing Potential and Existing Sources of Contamination



0.25 0.5 2 Miles




LEG	END
⊕ F	Public Water System Well
Hydro	graphy/Physical
	Parcels
\sim	Stream
	Lake or Pond
\sim	Contours
\sim	Watershed Boundary
Trans	portation
	Primary Route (Class 1)
	Secondary Route (Class 2)
	Road (Class 3)
	Road (Class 4)
	Road (Class 5, Four-wheel drive)
Ground	dwater Protection Zones
	Zone A Protection Area- Several Months Travel Time
	Zone B Protection Area- 2 Years Travel Time
	Zone C Protection Area- 5 Years Travel Time
	Zone D Protection Area- 10 Years Travel Time
Fyistir	ng or Potential Contaminant Sources
	Domestic wastewater treatment plant disposal pond(D02)
•	Aboveground diesel tank (T06)
	Nonresidential aboveground heating oil tank (T14)
+ [†] +	Cemetery (X01)
\square	Petroleum product bulk station/terminal (X11)
<u> </u>	Oil and gas pipeline (X28)
\$	
≁ ●	Electric power generation (fossil fuels) (X36)
_	Firehouse (X38)
H	Medical/veterinary facility (X40)
Data Sou Contamin	rces: ant Sources, Public Water System Wells, Contours

Contaminant Sources, Public Water System Wells, Contours Alaska Department of Environmental Conservation (ADEC) Critical Facilities, Federal Emergency Management Agency (FEMA)

All other data: United States Geological Survey (USGS) Drinking Water Protection Areas based on "Alaska Drinking Water Protection Program - Guidance Manual for Class A Public Water Systems" published by ADEC

URS Corporation does not guarantee the accuracy or validity of the data provided.

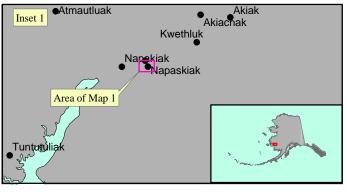

LKSD Napaskiak PWS 270980.001

Appendix C Map C

APPENDIX D

Vulnerability Analysis for Public Drinking Water Source (Charts 1-14)

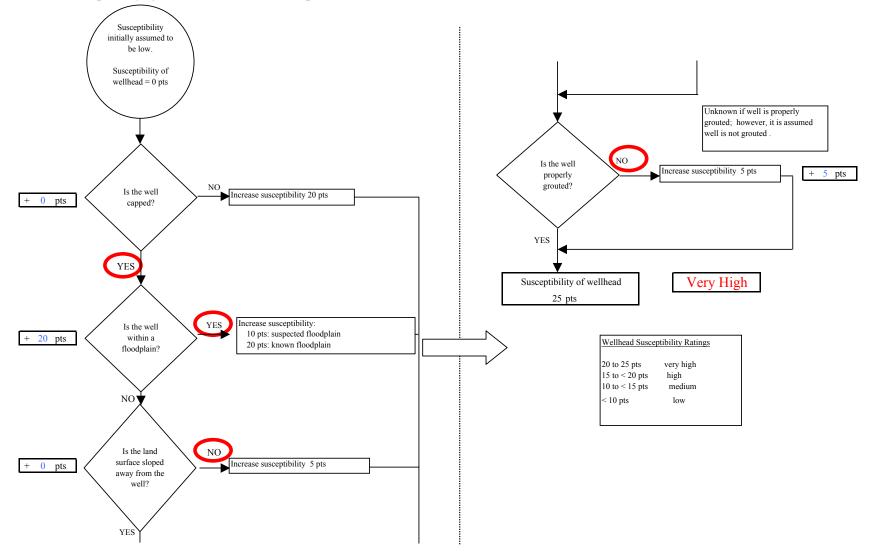


Chart 1. Susceptibility of the wellhead - LKSD Napaskiak School (PWS No. 270980.001)

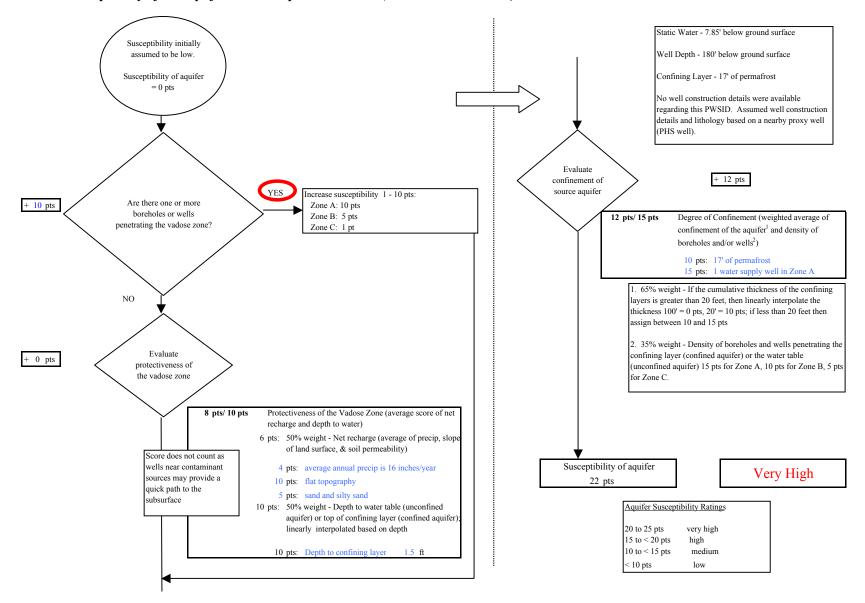


Chart 2. Susceptibility of the aquifer LKSD Napaskiak School (PWS No. 270980.001)

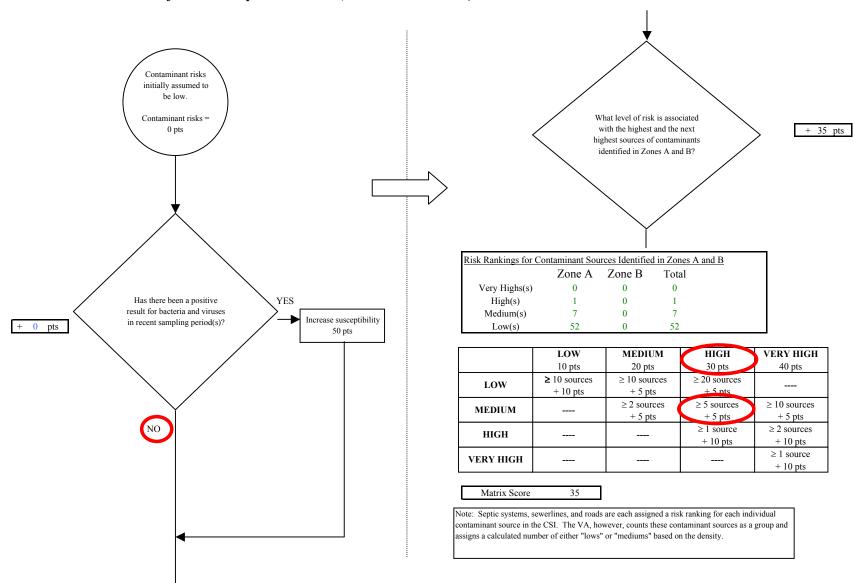


Chart 3. Contaminant risks for LKSD Napaskiak School (PWS No. 270980.001) - Bacteria & Viruses

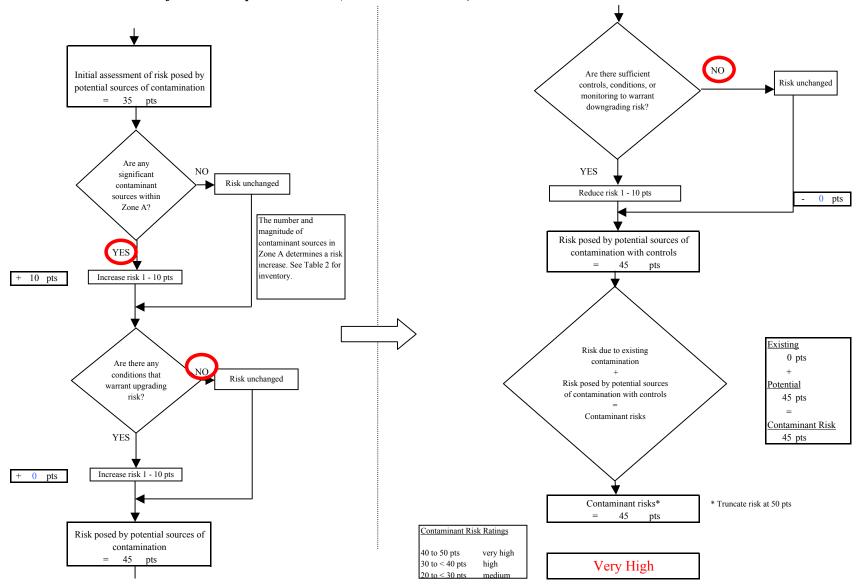


Chart 3. Contaminant risks for LKSD Napaskiak School (PWS No. 270980.001) - Bacteria & Viruses

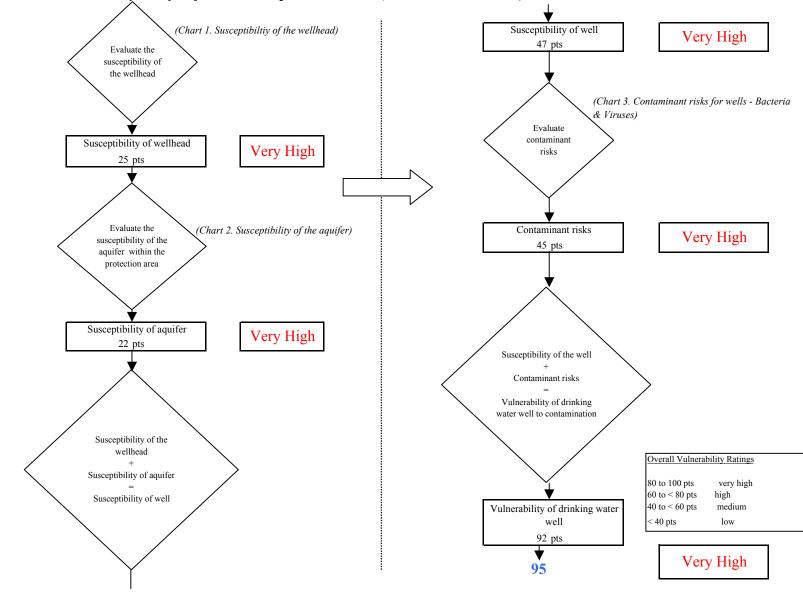


Chart 4. Vulnerability analysis for LKSD Napaskiak School (PWS No. 270980.001) - Bacteria & Viruses

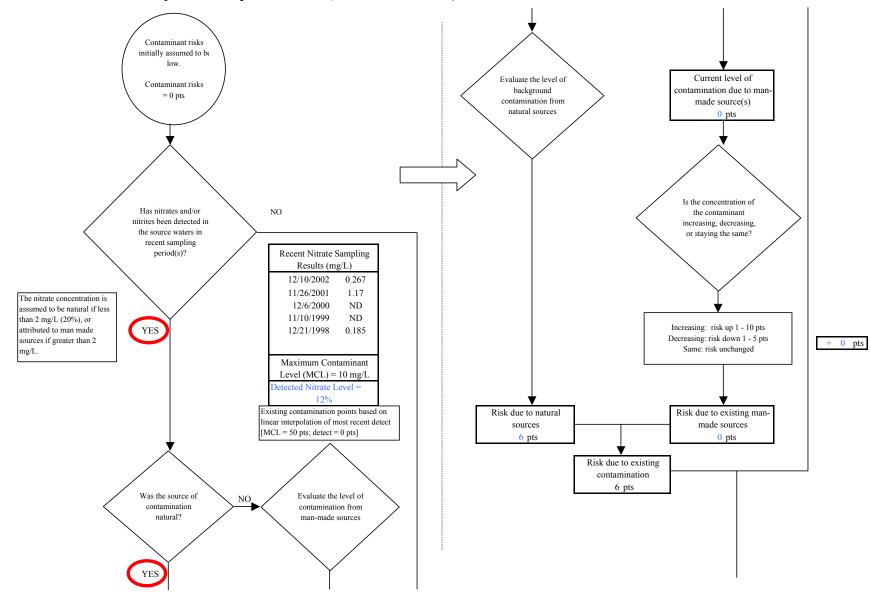


Chart 5. Contaminant risks for LKSD Napaskiak School (PWS No. 270980.001) - Nitrates and Nitrites

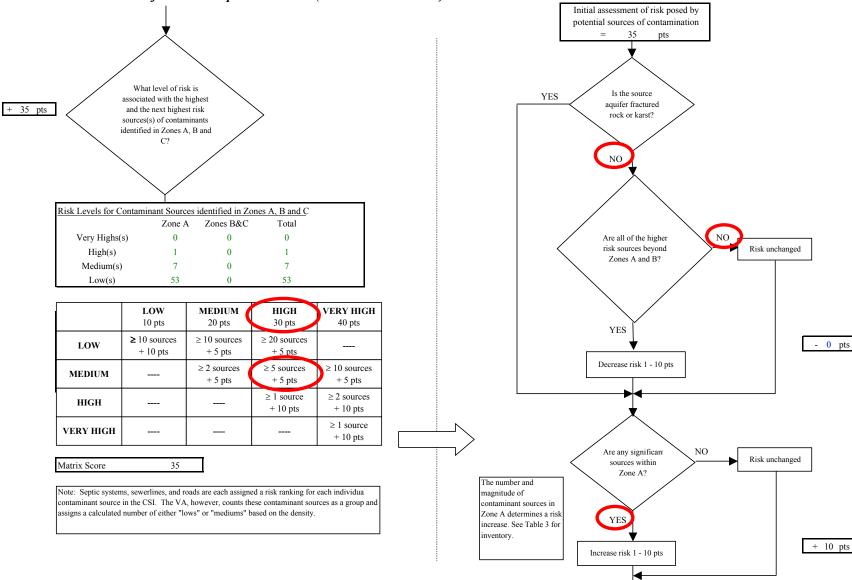


Chart 5. Contaminant risks for LKSD Napaskiak School (PWS No. 270980.001) - Nitrates and Nitrites

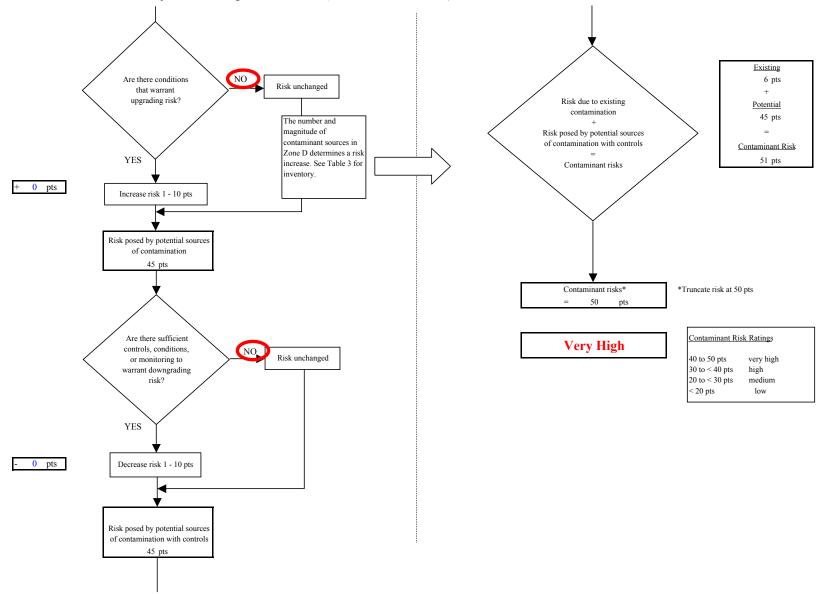


Chart 5. Contaminant risks for LKSD Napaskiak School (PWS No. 270980.001) - Nitrates and Nitrites

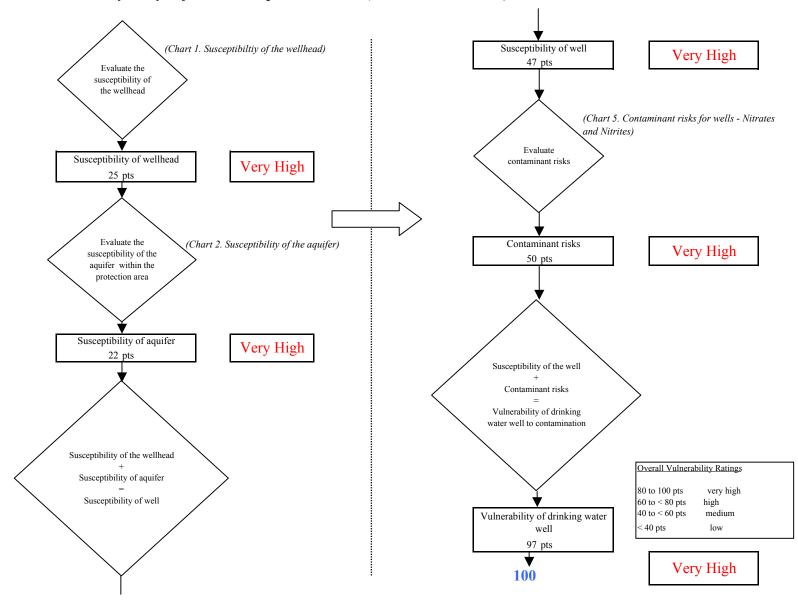


Chart 6. Vulnerability analysis for LKSD Napaskiak School (PWS No. 270980.001) - Nitrates and Nitrites

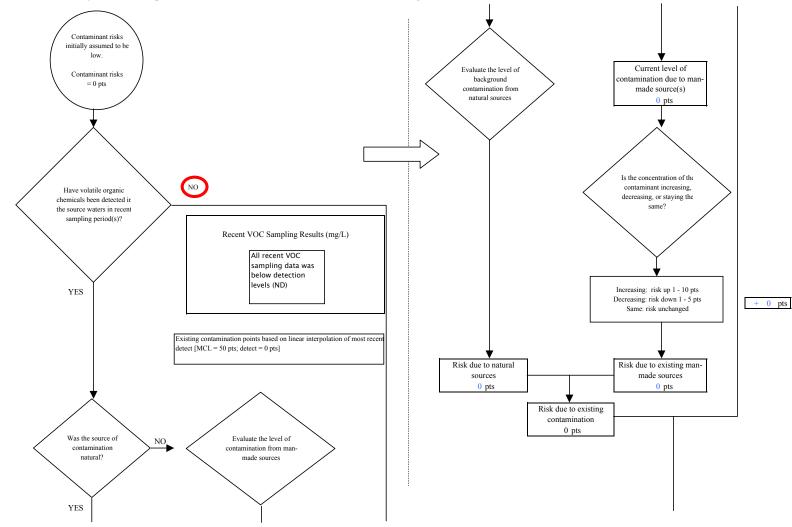


Chart 7. Contaminant risks for LKSD Napaskiak School (PWS No. 270980.001) - Volatile Organic Chemicals

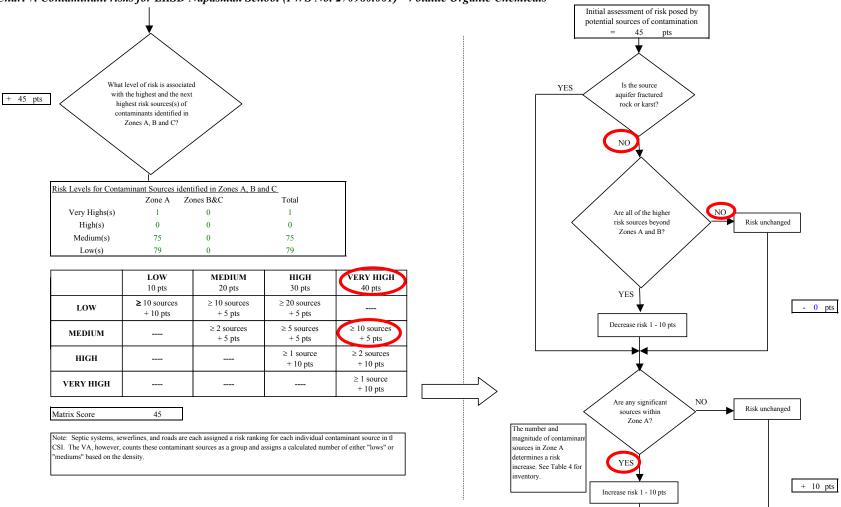


Chart 7. Contaminant risks for LKSD Napaskiak School (PWS No. 270980.001) - Volatile Organic Chemicals

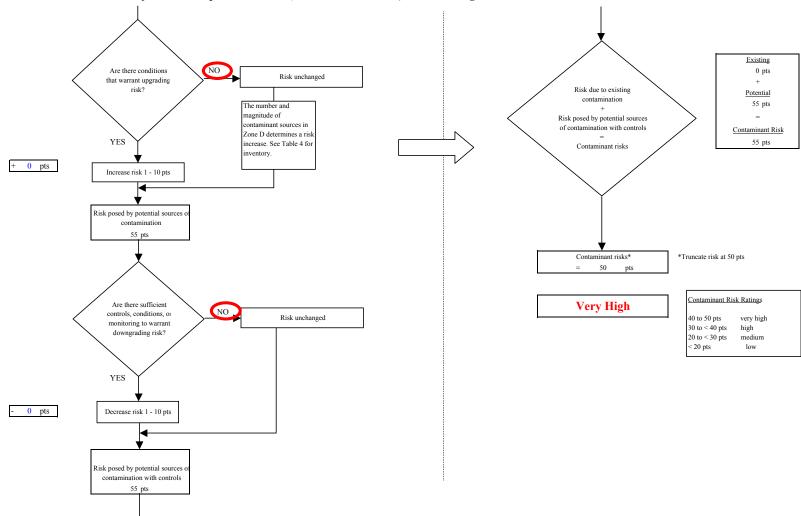


Chart 7. Contaminant risks for LKSD Napaskiak School (PWS No. 270980.001) - Volatile Organic Chemicals

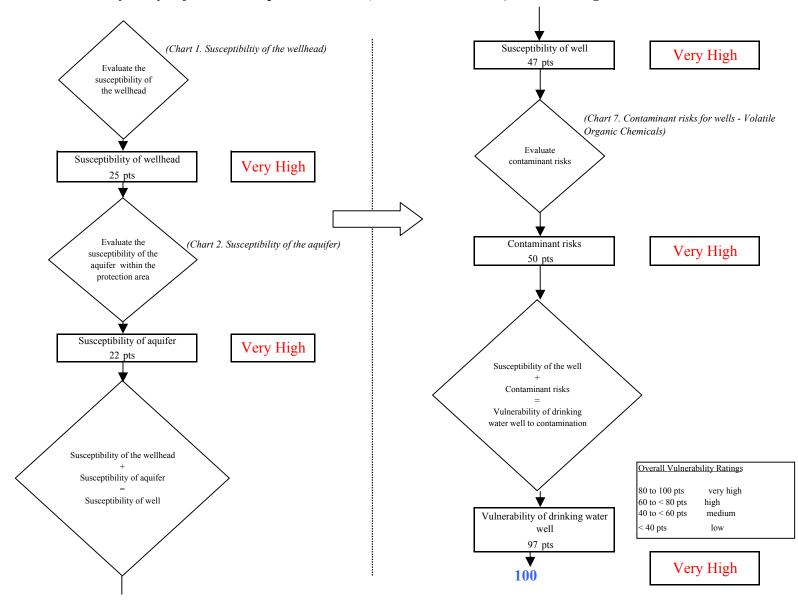


Chart 8. Vulnerability analysis for LKSD Napaskiak School (PWS No. 270980.001) - Volatile Organic Chemicals

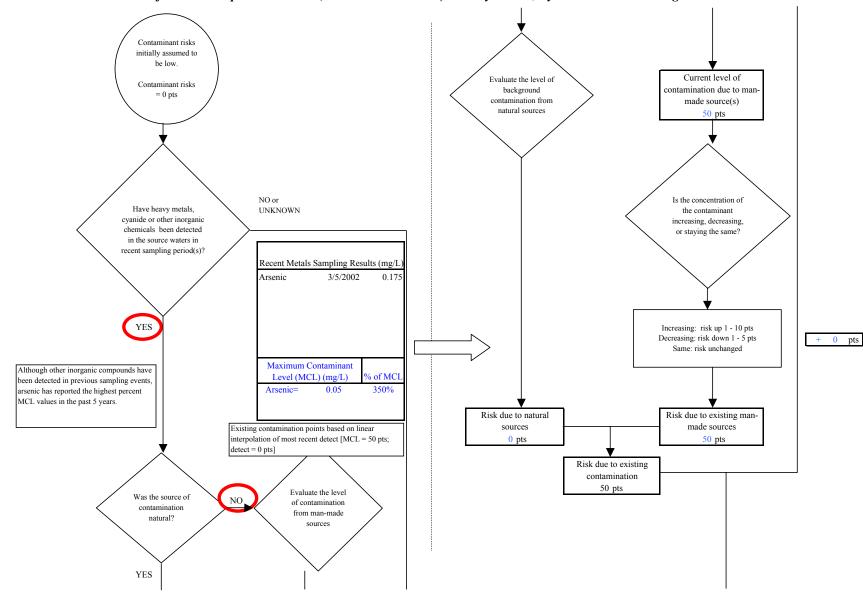


Chart 9. Contaminant risks for LKSD Napaskiak School (PWS No. 270980.001) - Heavy Metals, Cyanide and Other Inorganic Chemicals

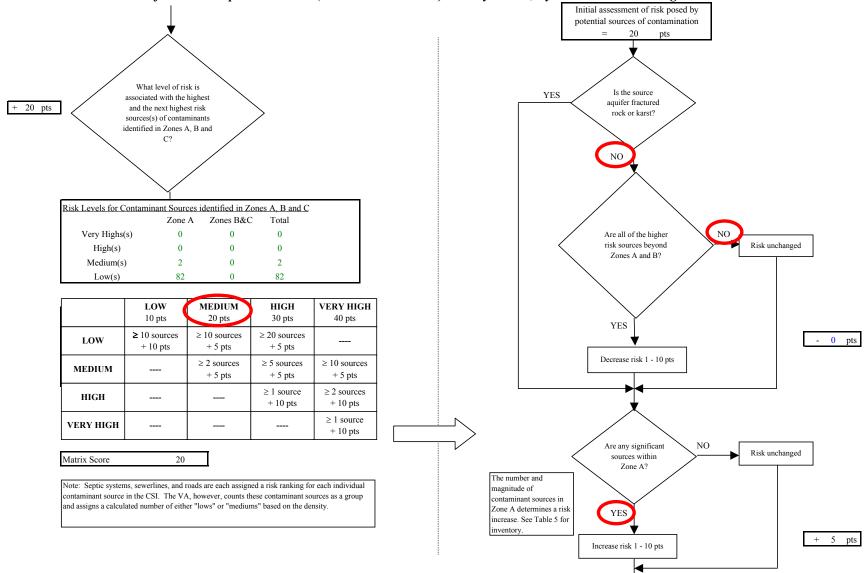


Chart 9. Contaminant risks for LKSD Napaskiak School (PWS No. 270980.001) - Heavy Metals, Cyanide and Other Inorganic Chemicals

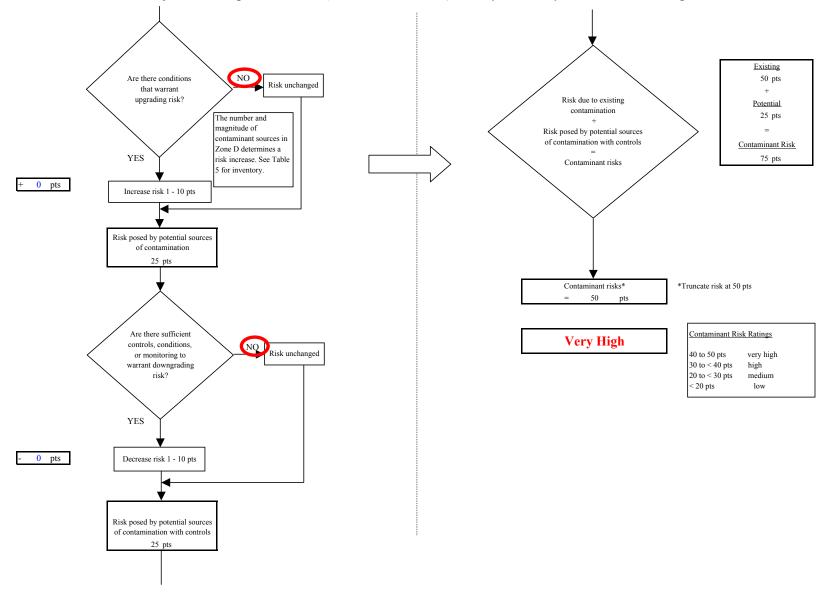


Chart 9. Contaminant risks for LKSD Napaskiak School (PWS No. 270980.001) - Heavy Metals, Cyanide and Other Inorganic Chemicals

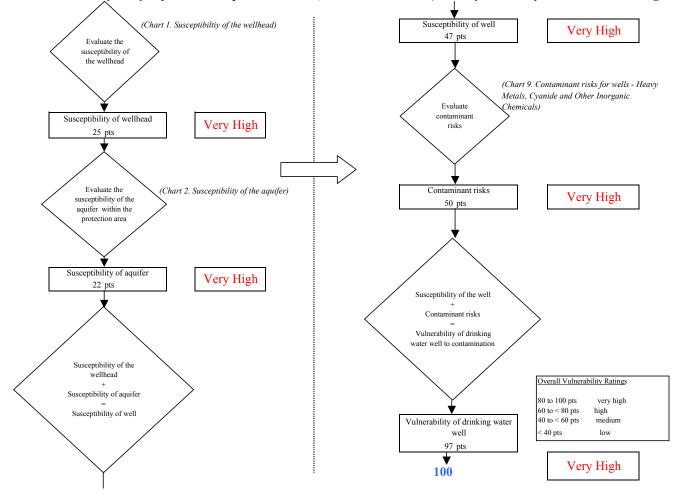


Chart 10. Vulnerability analysis for LKSD Napaskiak School (PWS No. 270980.001) - Heavy Metals, Cyanide and Other Inorganic Chemicals

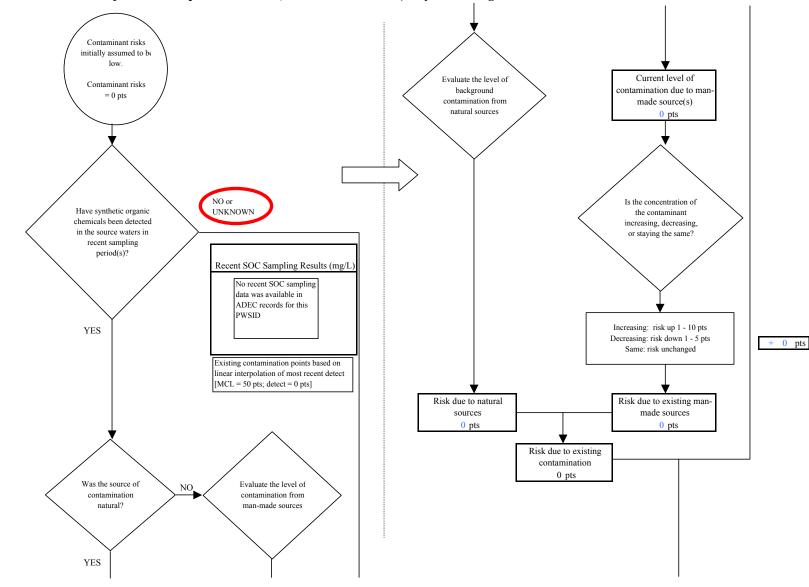


Chart 11. Contaminant risks for LKSD Napaskiak School (PWS No. 270980.001) - Synthetic Organic Chemicals

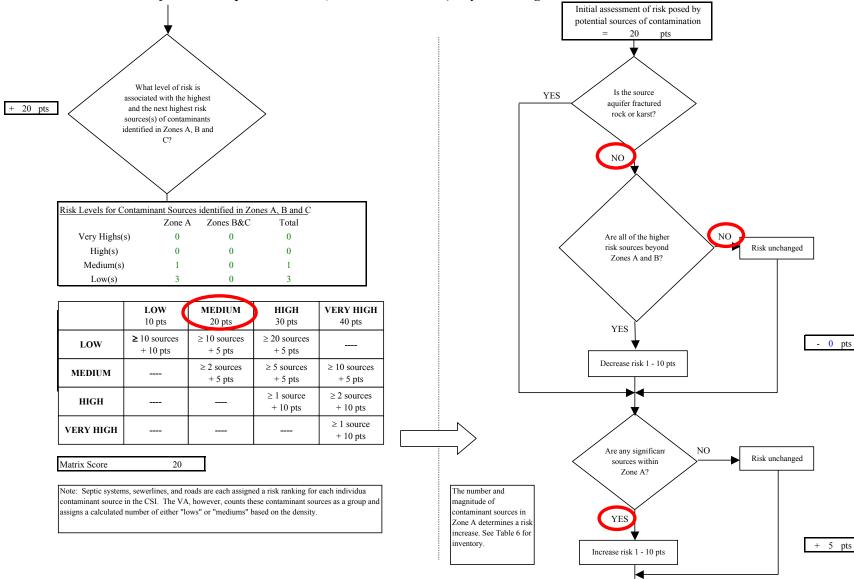


Chart 11. Contaminant risks for LKSD Napaskiak School (PWS No. 270980.001) - Synthetic Organic Chemicals

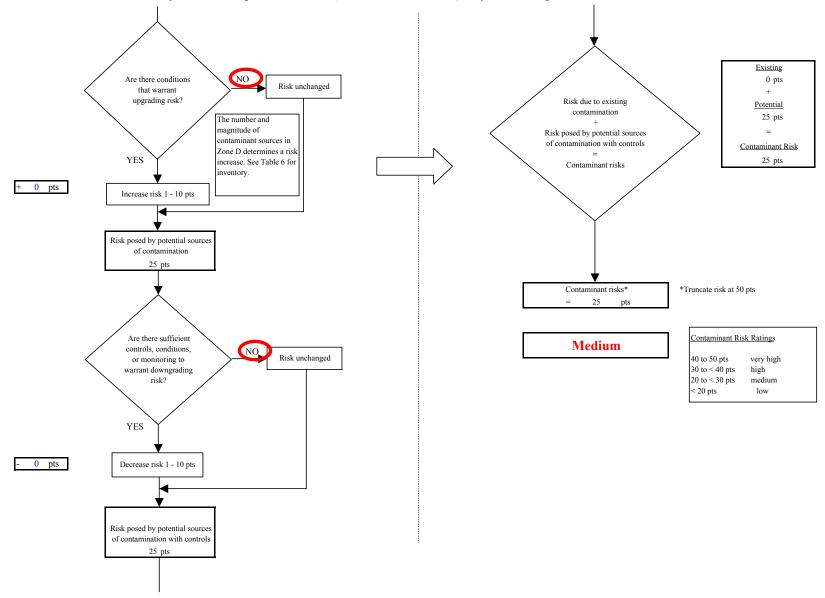


Chart 11. Contaminant risks for LKSD Napaskiak School (PWS No. 270980.001) - Synthetic Organic Chemicals

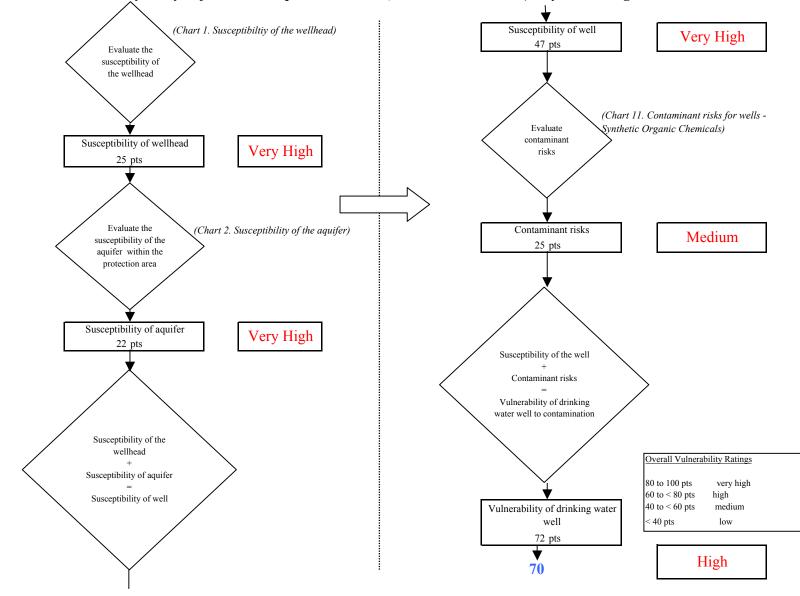


Chart 12. Vulnerability analysis for LKSD Napaskiak School (PWS No. 270980.001) - Synthetic Organic Chemicals

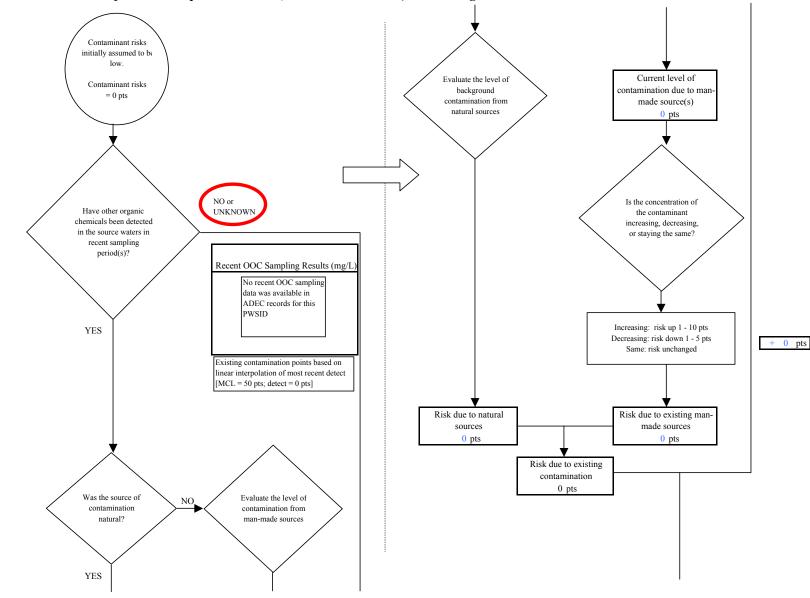


Chart 13. Contaminant risks for LKSD Napaskiak School (PWS No. 270980.001) - Other Organic Chemicals

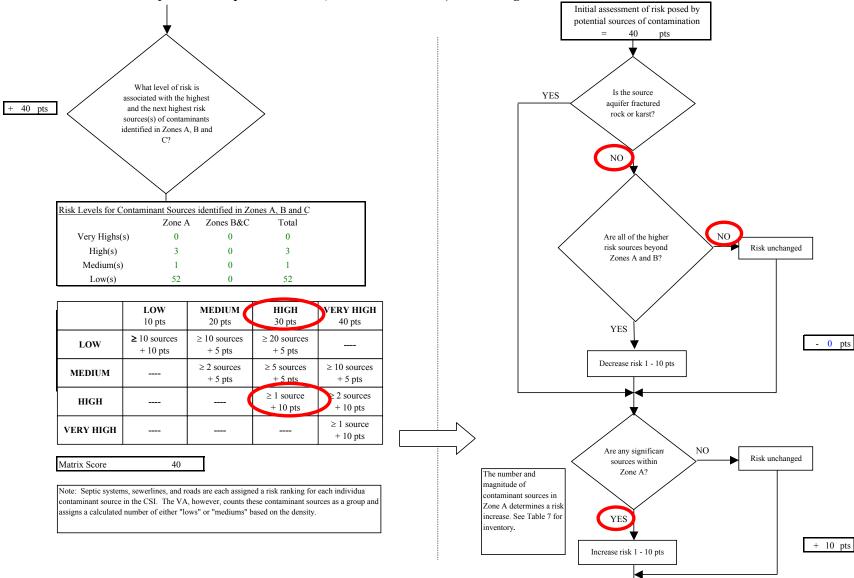


Chart 13. Contaminant risks for LKSD Napaskiak School (PWS No. 270980.001) - Other Organic Chemicals

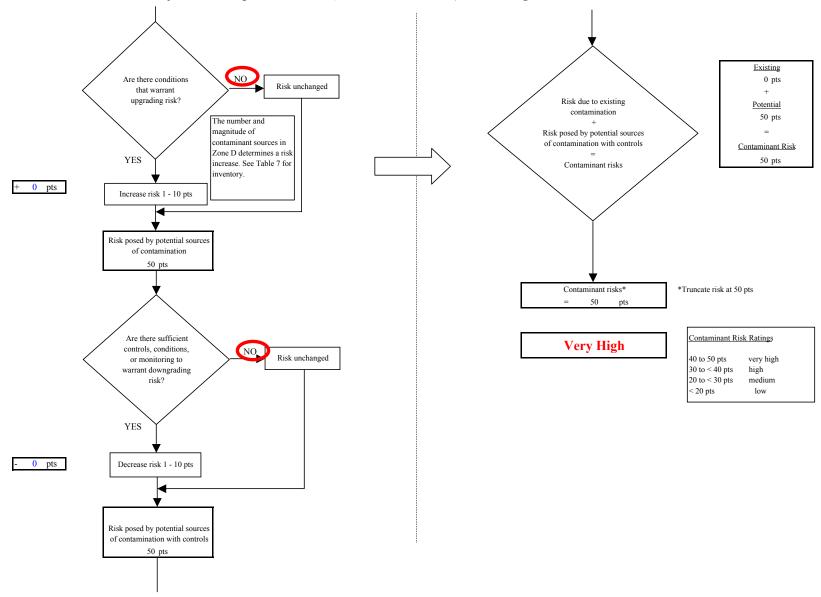


Chart 13. Contaminant risks for LKSD Napaskiak School (PWS No. 270980.001) - Other Organic Chemicals

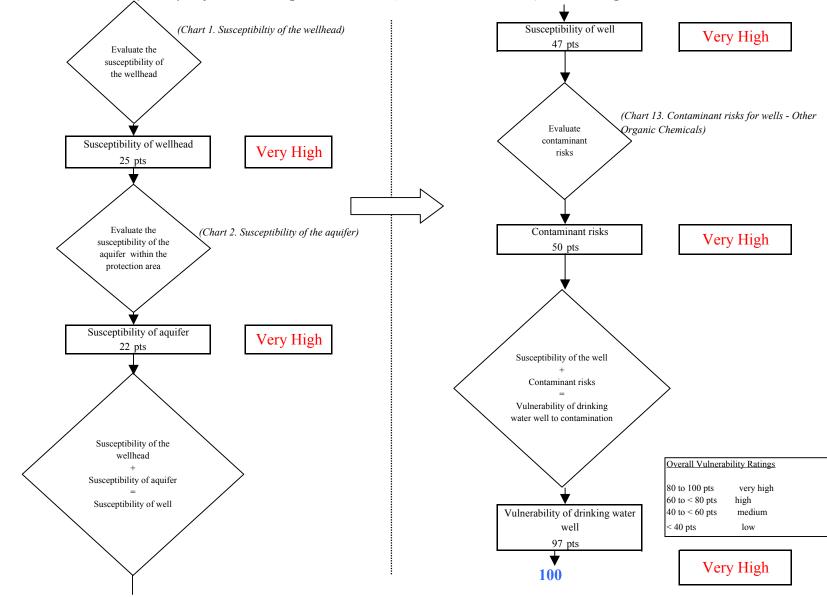


Chart 14. Vulnerability analysis for LKSD Napaskiak School (PWS No. 270980.001) - Other Organic Chemicals