

Source Water Assessment for Iris Circle Water Company

A Hydrogeologic Susceptibility and Vulnerability Assessment

DRINKING WATER PROTECTION PROGRAM REPORT 399
PWSID 226410.001

February 2002

Source Water Assessment for Iris Circle Water Company

By Chris Miller

DRINKING WATER PROTECTION PROGRAM REPORT 399

CONTENTS

	Page		Page
Executive Summary	1		
Introduction	1	Inventory of Potential and Existing Contaminant Sources	4
Description of the Matanuska – Susitna Valley, Alaska	1	Ranking of Contaminant Risks	4
Iris Circle Water Company Public Water Source	3	Vulnerability of Iris Circle Water Company Drinking Water Source	4
Assessment/Protection Area for Iris Circle Water Company		Summary	6
Drinking Water Source	3	References Cited	7

TABLES

TABLE	1. Natural Susceptibility - Susceptibility of the Wellhead and Aquifer to Contamination	5
	2. Contaminant Risks	5
	3. Overall Vulnerability of Iris Circle Water Company Public Drinking Water Source to Contamination	6

ILLUSTRATIONS

FIGURE	1. Index map showing the location of well assessment	1
FIGURE	2. Map showing groundwater flow in the Matanuska-Susitna Valley	2

APPENDICES

APPENDIX	A. Iris Circle Water Company Drinking Water Protection Area (Map 1)	
	B. Contaminant Source Inventory for Iris Circle Water Company (Table 1) Contaminant Source Inventory and Risk Ranking for Iris Circle Water Company – Bacteria and Viruses (Table 2) Contaminant Source Inventory and Risk Ranking for Iris Circle Water Company – Nitrates/Nitrites (Table 3) Contaminant Source Inventory and Risk Ranking for Iris Circle Water Company – Volatile Organic Chemicals (Table 4) Contaminant Source Inventory and Risk Ranking for Iris Circle Water Company – Heavy Metals, Cyanide and Other Inorganic Chemicals (Table 5) Contaminant Source Inventory and Risk Ranking for Iris Circle Water Company – Synthetic Organic Chemicals (Table 6) Contaminant Source Inventory and Risk Ranking for Iris Circle Water Company – Other Organic Chemicals (Table 7)	
	C. Iris Circle Water Company Drinking Water Protection Area and Potential and Existing Contaminant Sources (Map 2 and 3)	
	D. Vulnerability Analysis for Contaminant Source Inventory and Risk Ranking for Iris Circle Water Company Public Drinking Water Source (Chart 1 – Chart 14)	

Hydrogeologic Susceptibility and Vulnerability Assessment for Iris Circle Water Company Public Drinking Water Source, Palmer, Alaska

By Chris Miller, ADEC

Drinking Water Protection Program Alaska Department of Environmental Conservation

EXECUTIVE SUMMARY

The Iris Circle Water Company is a Class A (community) drinking water source consisting of one well. Identified potential and current sources of contaminants for Iris Circle Water Company includes: one paved road three gravel roads, residential septic systems, one landfill and lawns and gardens. These existing and potential sources of contamination are considered a source of bacteria and viruses, nitrates and/or nitrites, and volatile organic chemicals. Overall, Iris Circle Water Company public water source received vulnerability rating of **High** for bacteria and viruses and nitrates/nitrites and **Low** for volatile organic chemicals, heavy metals, synthetics organic chemicals and other organic chemicals

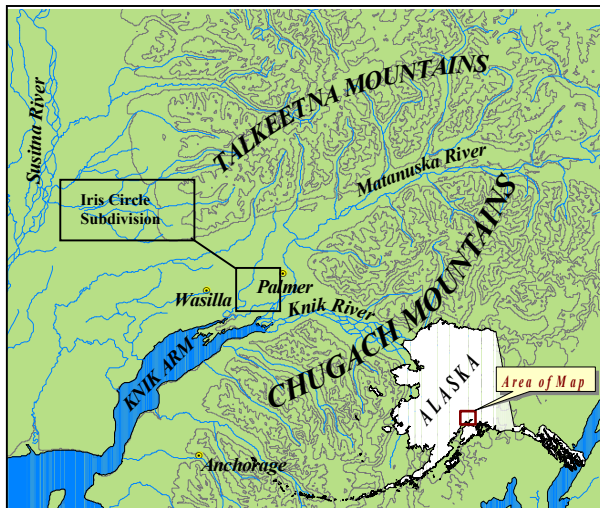


Figure 1. Index Map showing the location of the Matanuska-Susitna Valley and Sutton Elementary School

INTRODUCTION

The purpose of this environmental assessment is to provide public water system owners/operators, communities, and local governments with information they can use to preserve the quality of Alaska's public drinking water supplies. This assessment was completed for the Iris Circle Water Company source of public drinking water. This source consists of one well in the Sutton area (Figure 1). This assessment, known under the Alaska Drinking Water Protection Program as the *Source Water Assessment*, has combined a review of the natural hydrogeologic sensitivity with potential and existing contaminant risks to arrive at an overall vulnerability of the drinking water source to contamination. This assessment has been completed as a basis for local voluntary protection efforts and to assist agencies in their efforts to reduce risk to this public drinking water supply.

DESCRIPTION OF THE MATANUSKA-SUSITNA VALLEY-AREA, ALASKA

Location

The Matanuska-Susitna Valley is part of the lowland lying about 50 miles north of Anchorage in south-central Alaska. The well described in this report is part of the Matanuska River Watershed. This study area is roughly bounded on the north by the Talkeetna Mountains; on the west by Wasilla Creek; on the south by the Knik River; and on the east by the Chugach Mountains. The area covers approximately 150 square miles.

Climate

The climate of the Matanuska-Susitna Valley is the result of a combination of marine and continental influences. The climate is somewhat transitional in that it does not experience large daily and annual temperature fluctuations like those experienced in the

interior of Alaska nor does it experience high amounts of precipitation typified by gulf coast regions. Mean annual precipitation is approximately 15 inches per year. On the average, the Valley receives a total snow accumulation of 58 inches per year. Precipitation generally increased inland toward the Talkeetna Mountains where annual precipitation may exceed 60 inches. Mean daily temperature ranges from 67° F during July to 5° F in January [*Western Regional Climate Center, 2000*].

Physiography and Groundwater Conditions

The Matanuska-Susitna Valley is surrounded by rugged mountains that rise abruptly above the valley floor. The Chugach Mountains at the southern edge of the valley reach altitudes greater than 6300 feet. These mountains are composed primarily of metamorphosed sedimentary marine and volcanic rocks. Along the northern edge of the valley, peaks in the Talkeetna Mountains reach altitudes of 3000 to 5000 feet. The Talkeetna Mountains are composed mainly of igneous rocks, chiefly granite intrusives and

subordinate lavas and tuffs; Cretaceous and Tertiary sedimentary rocks form the south flank of the mountains. Although the altitude of the valley floor ranges from sea level at Knik Arm to 1000 feet at the base of Wishbone Hill, the local relief is commonly not more than 100 to 200 feet.

The Matanuska and Knik River’s drain the area. These rivers are braided glacial outwash streams having wide floodplains. Drainage is poor in many interstream tracts resulting in large areas of swampy ground with shallow lakes occupying depressions.

The Matanuska-Susitna Valley is floored with unconsolidated deposits, chiefly glacial drift that represents several episodes of glacial advances and retreats. The drift includes till, outwash stream deposits, and estuarine and lake deposits. Physiographic features formed by these deposits in or adjacent to the study area include end moraine, lateral moraines, eskers, crevasse fillings, and other pitted

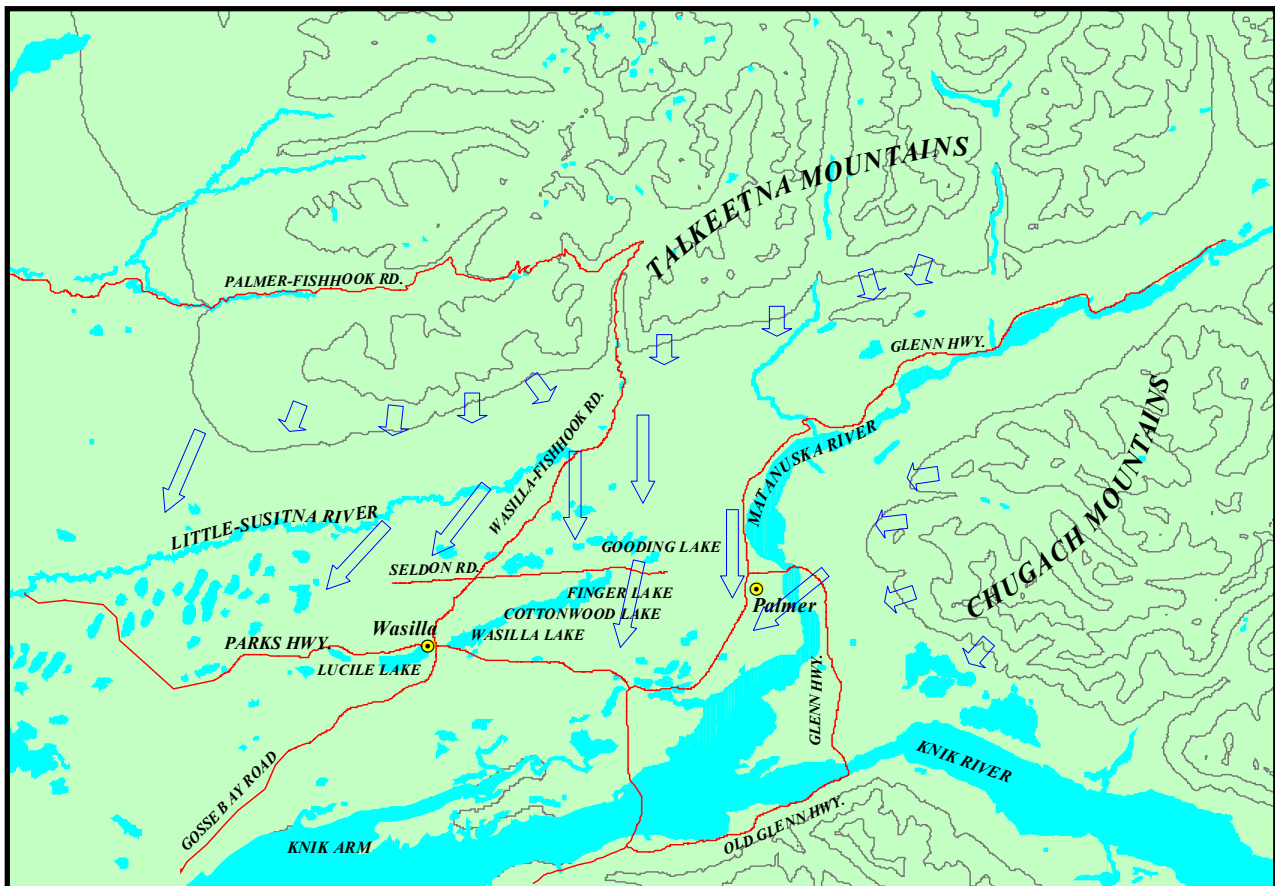


Figure 2. Map showing groundwater flow in the Matanuska-Susitna Valley (Jokela, Munter and Evans, 1991).

features, river terraces, outwash floodplains and an extensive estuarine flat (Trainer, 1960).

The glacial till and bedrock form aquifers of minor importance. The chief hydrologic significance of the till is in confining the artesian aquifer. Generally, the till is poorly permeable, although locally thin layers of sand may yield small quantities of water. Till that is present at or near the land surface in much of the area makes the acquisition of shallow groundwater difficult. The bedrock is poorly permeable. It yields water only from fractures, whose location and frequency cannot be easily predicted.

The chief aquifers are composed of outwash sand and gravel laid down by melt-water streams or in lakes. The outwash deposits are of two chief forms. The first consists of sheet-like deposits that lie just beneath the ground surface. These deposits range in thickness from a few feet to more than 100 feet. They typically rest on till or bedrock. The water in these deposits is unconfined. The other outwash deposits are buried beneath till. They are known to be as much as 50 to 60 feet thick, and probably are considerably thicker in some places. They commonly contain confined, or artesian, groundwater. Well logs and data from pumping tests suggest that outwash sand and gravel form a continuous or nearly continuous sheet in an area of more than 10 square miles north and west of Palmer (Jakola et al, 1991).

In the Mat-Su Valley, groundwater is primarily recharged by snowmelt and precipitation infiltrating both directly and also from the infiltration into the foothill slopes of the Talkeetna and Chugach Mountains. In addition,, aquifers may be recharged by streams where surface water percolates into surrounding permeable sediments (losing reaches of streams). This is the case for the water-table aquifers in the terrace south of Palmer and in the Bodenbug Butte area, which receive underground flow from the Matanuska River. Groundwater flow in the confined aquifers is generally from the north and north-northwest. The direction of groundwater flow in the upper unconfined aquifer is more variable due to the influence from surficial topography as well as its close connection with surface water bodies (Trainer,1960).

IRIS CIRCLE WATER COMPANY PUBLIC WATER SOURCE

Iris Circle Water Company public water source is a Class A (community) water source, which is privately owned and operated. The source consists of one well located approximately 900 ft west of the Glenn Highway, in the middle of the Iris Circle cul-de-sac.

The well is at an approximate elevation of 175 feet above sea level. The well is grouted. Records show the well penetrates soil, boulder and cobbles from the surface to 20' below the surface, gravely clay from 20' to 86' below the surface, gravely sand from 86'-93' and gravel from 93' to 118'. Originally the well was at a depth of 98' but records indicate that it was deepened. The current depth of the well is 118' and has a 5' screen from 113' to 118'. The static water level when the well was initially drilled was 65 feet below the surface. The static water level when the well was deepened was 80' below the surface. Records indicate that the well was constructed and deepened in late 1970.

The water system at Iris Circle Water Company consists of a one 200-gallon and two 88 gallon hydropneumatic tanks. The system collectively serves approximately 37 residents through 21 service connections and operates 365 days per year.

ASSESSMENT AND PROTECTION AREA FOR IRIS CIRCLE WATER COMPANY DRINKING WATER SOURCE

The Drinking Water Protection and Assessment Area that has been established for Iris Circle Water Company is the area that is most sensitive to contamination. This area has served as a basis for assessing the risk of the drinking water source to contamination. This zone around the drinking water source is the most critical area for the preservation of the quality of the drinking water for this source. For simplicity, this area will be known as your Drinking Water Protection Area and will serve as the area of focus for voluntary protection efforts.

Conceptually, groundwater enters the aquifer systems along the front range of the Talkeetna Mountains and flows toward Cook Inlet. An analytical calculation was used to calculate the size and shape of the area that contributes water to the well. The input parameters describing the attributes of the aquifer in this calculation were adopted from the well log and the recent Sanitary Survey. This analytical calculation was used as a guide in establishing the protection area for Iris Circle Water Company. Additional methods were further employed to take into account any uncertainties in groundwater flow and aquifer characteristics to arrive at a meaningful and conservative protection area with respect to public health (Please refer to the Guidance Manual for Class A Public Water Systems for additional information).

The Drinking Water Protection Areas established for wells by the Alaska Department of Environmental Conservation (ADEC) are separated into zones. These

zones correspond to a time-of-travel. Time-of-travel is the time required for water to move in the saturated zone of the ground from a specific point to the well. The Drinking Water Protection Areas for Iris Circle Water Company contains four zones, Zone A, Zone B, Zone C and Zone D (Map 1, Appendix A). Zone A corresponds to the area between the well and the distance equal to ¼ of the distance of the 2-year time-of-travel. Depending on where a contaminant source is located within Zone A, travel time for a contaminant to the well may be on the order of several days to several hours. Zone A also extends down gradient from the well to take into account the area of the aquifer that is influenced by pumping of the well. The Zone B protection area for Iris Circle Water Company corresponds to a time-of-travel of less than two years and extends toward base of the Talkeetna Mountains. Zone C protection area corresponds to a time-of-travel of greater than 2 years and less than 5 years. Zone D corresponds to a time-of-travel of greater than 5 years and less than 10 years.

INVENTORY OF POTENTIAL AND EXISTING CONTAMINANT SOURCES

The Drinking Water Protection Program has completed an inventory of potential and existing sources of contamination within Iris Circle Water Company Drinking Water Protection Area. This survey was completed through a search of agency records and other publicly available information.

Potential sources of contamination to drinking water supplies cover a wide range of categories and types. Potential drinking water contaminants are found within agricultural, residential, commercial, and industrial areas, but can also occur within areas that have little or no development.

For the basis of this assessment and all Class A public water system assessments, six categories of drinking water contaminants were inventoried. They include:

- Bacteria and viruses
- Nitrates and/or nitrites
- Volatile organic chemicals
- Heavy metals, cyanide, and other inorganic chemicals
- Synthetic organic chemicals
- Other organic chemicals

Table 1 in Appendix C lists the Contaminant Source Inventory for Iris Circle Water Company. Below is a summary of the categories of the contaminant sources inventoried within the Equestrian Acres protection area:

- Paved and gravel roads
- Residential Septic Systems
- Residential Areas
- Large Capacity Septic Systems (Class V Injection Wells)

These potential contaminant sources present risks for all six categories of drinking water contaminants for Iris Circle Water Company drinking water source.

RANKING OF CONTAMINANT RISKS

Potential and existing sources of contamination have been identified, sorted, and ranked according to what type and level of risk they represent. Ranking of contaminant risks for a “potential” or “existing” source of contamination is a function of toxicity and volumes of specific contaminants associated with that source. Contaminant risks are further a function of the number and density of those types of contaminant sources as well as the proximity of those sources to the well (Appendices B & C).

VULNERABILITY OF IRIS CIRCLE WATER COMPANY DRINKING WATER SOURCES

Vulnerability of a drinking water source to contamination is a combination of two factors:

- Natural susceptibility; and
- Contaminant risks.

Each of the three categories of drinking water contaminants has been analyzed and an overall vulnerability score of 0 to 100 is ultimately assigned:

$$\begin{aligned}
 &\text{Natural Susceptibility (0 – 50 points)} \\
 &\qquad\qquad\qquad + \\
 &\qquad\qquad\qquad \text{Contaminant Risks (0 – 50 points)} \\
 &\qquad\qquad\qquad = \\
 &\qquad\qquad\qquad \text{Vulnerability of the} \\
 &\qquad\qquad\qquad \text{Drinking Water Source to Contamination (0 – 100).}
 \end{aligned}$$

A score for the Natural Susceptibility is achieved by analyzing the properties of the well and the aquifer.

$$\begin{aligned}
 &\text{Susceptibility of the Wellhead (0 – 25 Points)} \\
 &\qquad\qquad\qquad + \\
 &\qquad\qquad\qquad \text{Susceptibility of the Aquifer (0 – 25 Points)} \\
 &= \text{Natural Susceptibility (Susceptibility of the Well)} \\
 &\qquad\qquad\qquad (0 – 50 Points)
 \end{aligned}$$

The Iris Circle Water Company well is completed in a semi-confined aquifer setting. The well penetrates a gravelly clay layer from 20-66' below the surface. This clay layer may provide a protective barrier from the movement of contaminants in the subsurface.

However, records indicate that protective barriers throughout the Matanuska-Susitna basin are discontinuous and thin. This can be attributed to the layers pinching out near the base of the Talkeetna Mountains and the repeated glaciation that occurred in the area. The discontinuous, thin layers reduce the protectiveness and increase the range of contaminant movement in the subsurface.

Combining the susceptibilities of the wellhead and the aquifer to contamination leads to a score (0 – 50 points) and rating of overall Susceptibility (Appendix D). Table 1 shows the overall Susceptibility score and rating for Iris Circle Water Company.

Table 1. Natural Susceptibility - Susceptibility of the Wellheads and Aquifer to Contamination

	Score	Rating
Susceptibility of the Wellheads	0	Low
Susceptibility of the Aquifer	18	High
Natural Susceptibility	18	Low

Contaminant risks to a drinking water source depend on the type, number or density, and distribution of contaminant sources. A score (0 – 50 points) and rating of Contaminant Risks (See Appendix D) is assigned based on the findings of the Contaminant Source Inventory (See Appendix B - Table 1 – Table 7). This portion of the analysis examines recent existing or historical contamination that has been detected at the drinking water sources through routine sampling. It also reviews contamination that has or may have occurred but has not arrived or been detected at the either well. Table 2 summarizes the Contaminant Risks for each category of drinking water contaminants.

Table 2. Contaminant Risks

Contaminant Risks	Score	Rating
Bacteria and Viruses	50	Very High
Nitrates and/or Nitrites	50	Very High
Volatile Organic Chemicals	12	Low
Heavy Metals, Cyanide, And Other Inorganic Chemicals	15	Low
Synthetic Organic Chemicals	12	Low

Other Organic Chemicals	12	Low
-------------------------	----	-----

Appendix D contains fourteen charts, which together form the 'Vulnerability Analysis' for a Class A public drinking water system. Chart 1 analyzes the 'Susceptibility of the Wellhead' to contamination by looking at the construction of the well and its surrounding area. Chart 2 analyzes the 'Susceptibility of the Aquifer' to contamination by looking at the naturally occurring attributes of the water source and influences on the groundwater system that might lead to contamination. Chart 3 analyzes 'Contaminant Risks' for the drinking water source with respect to bacteria and viruses. The 'Contaminant Risks' portion of the analysis considers potential sources of contaminants as well as a review of contamination that has or may have occurred but has not arrived or been detected at the well. Lastly, Chart 4 contains the 'Vulnerability Analysis for Bacteria and Viruses'. Charts 5 through 14 contain the Contaminant Risks and Vulnerability Analysis for nitrates and nitrites, volatile organic chemicals, heavy metals, synthetic organic chemicals, and other organic chemicals, respectively.

Vulnerability of drinking water sources to contamination is the combination of susceptibility of the aquifer and the well with contaminant risks. Table 3 contains the overall vulnerability scores (0 – 100) and ratings for each of the six categories of drinking water contaminants (See Appendix D). Note: scores are rounded off to the nearest five.

Table 3. Overall Vulnerability of Iris Circle Water Company Public Drinking Water Source to Contamination by Category

Category	Score	Rating
Bacteria and Viruses	75	High
Nitrates and Nitrites	75	High
Volatile Organic Chemicals	35	Low
Heavy Metals, Cyanide, and Other Inorganic Chemicals	35	Low
Synthetic Organic Chemicals	31	Low
Other Organic Chemicals	30	Low

Tables 2 through 7 in Appendix B contain the ranking of potential and existing sources of contamination with respect to bacteria and viruses, nitrates and/or nitrites, heavy metals, synthetic organic chemicals, and other organic chemicals, respectively.

The contaminant risks for the Bacteria/Viruses are driven by the potential risk associated with large capacity septic systems (Class V Injection Wells) and residential septic systems. No detection of Bacteria and Viruses has occurred in recent sampling history. Combining the contamination risk with the natural susceptibility of the well leads to an overall vulnerability to bacteria and virus contamination of high.

The contaminant risks for Nitrate/Nitrites are driven by the potential risk associated with large capacity septic systems (Class V Injection Wells) and residential septic systems and the risk associated with existing contamination. Recent historical sampling data indicates that Nitrates were detected at 40% the maximum contaminant level (MCL) of 10 mg/l during the most recent sampling event (7/12/01). (See Chart 5 – Contaminant Risks for Nitrates and/or Nitrites in Appendix D.) The MCL is the maximum level of contaminant that is allowed to exist in drinking water and still be consumed by humans without harmful effects. Combining the contamination risk with the natural susceptibility of the well leads to an overall vulnerability to nitrate/nitrite contamination of high.

Nitrates and/or nitrites are found in natural background concentration at this site, as elsewhere in Alaska. Other sources of nitrate and/or nitrites are human sewage, livestock manure, especially from feedlots and fertilizers. Due to high solubility and weak retention by soil, nitrates are very mobile often moving at approximately the same rate as water. It is unknown whether the existing contamination is naturally occurring or human influenced. According to the EPA, short-term exposure to levels excessively above the MCL has caused serious illness and sometimes death. Serious illness in infants can occur due to the conversion of nitrate to nitrite by the body, which can interfere with the oxygen-carrying capacity of the child's blood. This can be an acute condition in which health deteriorates rapidly over a period of days. Symptoms include shortness of breath and blueness of the skin. Long term exposure to nitrates and nitrites at levels above the MCL can lead to diuresis, increased starchy deposits and hemorrhaging of the spleen (USEPA, 2001).

Nitrate levels in Iris Circle Subdivision's well appear to be increasing overtime. Nitrate levels increased from 1.5 mg/l in 1974 to 3.97 mg/l in 2001. Because naturally occurring nitrate levels are typically less than 2 mg/l, it is suspected that the increase in nitrates may be from human-made sources. (Wang, Strelakos, Jokela, 2000) This increase may be due to increased development and the installation of residential and large

capacity septic systems within Zone A and Zone B Protection Areas.

Nitrates/Nitrites and Bacteria and Viruses high potential risk ranking is strongly influenced by the presence of large capacity septic systems (LCSS's) in Zone A. LCSS are considered Class V injection wells and are regulated by the EPA and states through the federal Underground Injection Control Program (UICP). LCSS were originally defined as septic systems having the capacity to serve 20 or more persons-per day (USEPA, 1999). However, the definition has recently been expanded to include septic systems serving more than one single-family residence.

The contaminant risks for volatile organic chemicals are driven by the potential risk associated with roads, large capacity septic systems, residential areas and residential septic systems.

Recent historical sampling indicate no detection of volatile organic chemicals. Combining the contaminant risk with the natural susceptibility of the well leads to an overall vulnerability to volatile organic chemical contamination of low.

The contaminant risks for heavy metals and inorganic are driven by the potential risks associated with roads, large capacity septic systems, residential areas and residential area septic systems and the risks associated with existing contamination.

Recent historical sampling indicates that nickel was detected at very low levels. Sampling done on 7/12/01 detected nickel at 0.00536 mg/l or 5% the MCL of 0.1mg/l. Combining the contaminant risk with the natural susceptibility of the well leads to an overall vulnerability to heavy metals and inorganic chemical contamination of low

According to the United States Environmental Protection Agency (USEPA), nickel is a metal found in natural deposits as ores containing other elements. The greatest use of nickel is in making stainless steel and other alloys.

Nickel is not known to cause any health problems when people are exposed to it at levels above the MCL for relatively short periods of time. Nickel has the potential to cause the following effects from long term exposure at levels above the MCL: decreased body weight; heart and liver damage; skin irritation. (USEPA, 2001). The levels detected at Iris Circle Water Company are very low and remain safe for human consumption. It is unknown whether the existing

contamination is naturally occurring or human influenced.

The contaminant risks for synthetic organic chemicals is driven by the potential risk associated with residential septic systems and residential areas.

Recent sampling history indicates that no synthetic organic contamination has been detected. Combining the contaminant risk with the natural susceptibility of the well leads to an overall vulnerability to synthetic chemical contamination of low.

The contamination risk for other organic chemicals is driven by the potential risk associated with roads, septic systems and residential areas.

Recent sampling history indicates that no contamination from other organic chemicals have been detected. Combining the contaminant risk with the natural susceptibility of the well leads to an overall vulnerability to other organic chemical contamination of low.

SUMMARY

A *Source Water Assessment* has been completed for the source of public drinking water serving Iris Circle Water Company. The overall vulnerability of this source to contamination is **High** for nitrate/nitrite and bacteria and viruses; and **Low** for volatile organic chemicals, heavy metals and inorganic chemicals, synthetic organic chemicals and other organic chemicals. This assessment of contaminant risks can be used as a foundation for local voluntary protection efforts as well as a basis for the continuous efforts on the part of Iris Circle Water Company to protect public health. It is anticipated that *Source Water Assessments* will be updated every five years to reflect any changes in the vulnerability and/or susceptibility of Iris Circle Water Company's public drinking water source.

REFERENCES CITED

Jakola, J.B., Munter, J.A., and Evans, J.G., 1991, Ground-water resources of the Palmer-big Lake area, Alaska: a conceptual model. Division of Geological & Geophysical Surveys Reported of Investigations 90-4, State of Alaska Department of Natural Resources, Fairbanks, AK.

Trainer, F.W., 1960, Geology and Groundwater Resources, Matanuska Valley, Alaska, U.S. Geological Survey Water Supply Paper 1494 U.S. Printing Office, Washington, D.C.

Western Regional Climate Center, 2000, August 24, Web extension to the *Western Regional Climate Center* [WWW document]. URL http://www.uaa.alaska.edu/enri/ascc_web/ascc_home.html.

U.S. EPA. 2001. Office of Water. Retrieved February 2002. [WWW document]. URL <http://www.epa.gov/safewater/hfacts.html#Inorganic>

U.S. EPA. 2001. Office of Water. Retrieved February 2002. [WWW document] URL <http://www.epa.gov/safewater/dwh/c-ioc/nickel.html>






U.S. EPA. 1999 The Class V Underground Injection Control Study, Vol. 5 Large-Capacity Septic Systems. Office Ground Water and Drinking Water. EPA/816-R-99-014e. September 1999.

Wang, B., Strelakos, P.M., Jokela, B., 2000, Nitrate Source Indicators in Groundwater of the Scimitar Subdivision, Peters Creek Area, Anchorage Alaska; U.S. Geological Survey Water Resources Investigations Report 00-4137, 25p.

APPENDIX A

Iris Circle Water Company Drinking Water Protection Area

Drinking Water Protection Area for Iris Circle Water Company

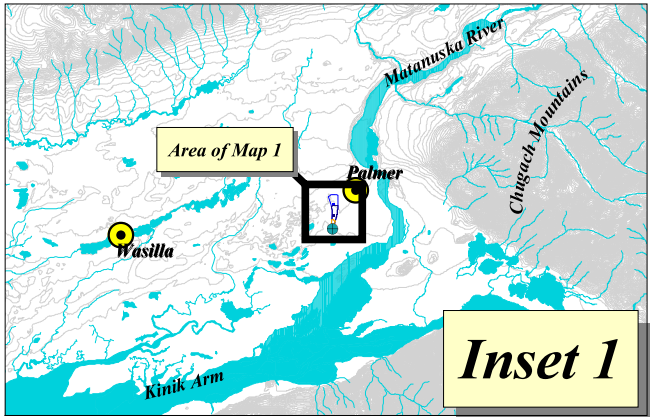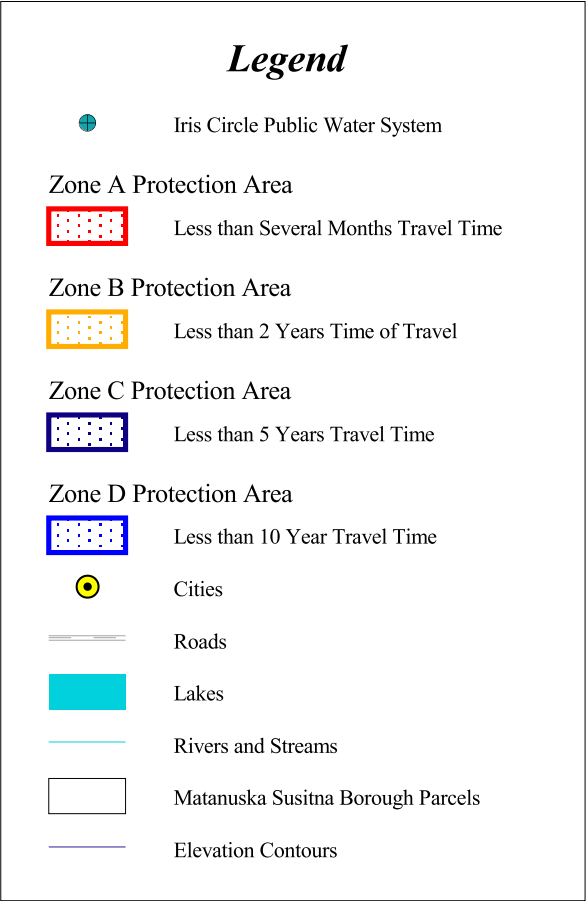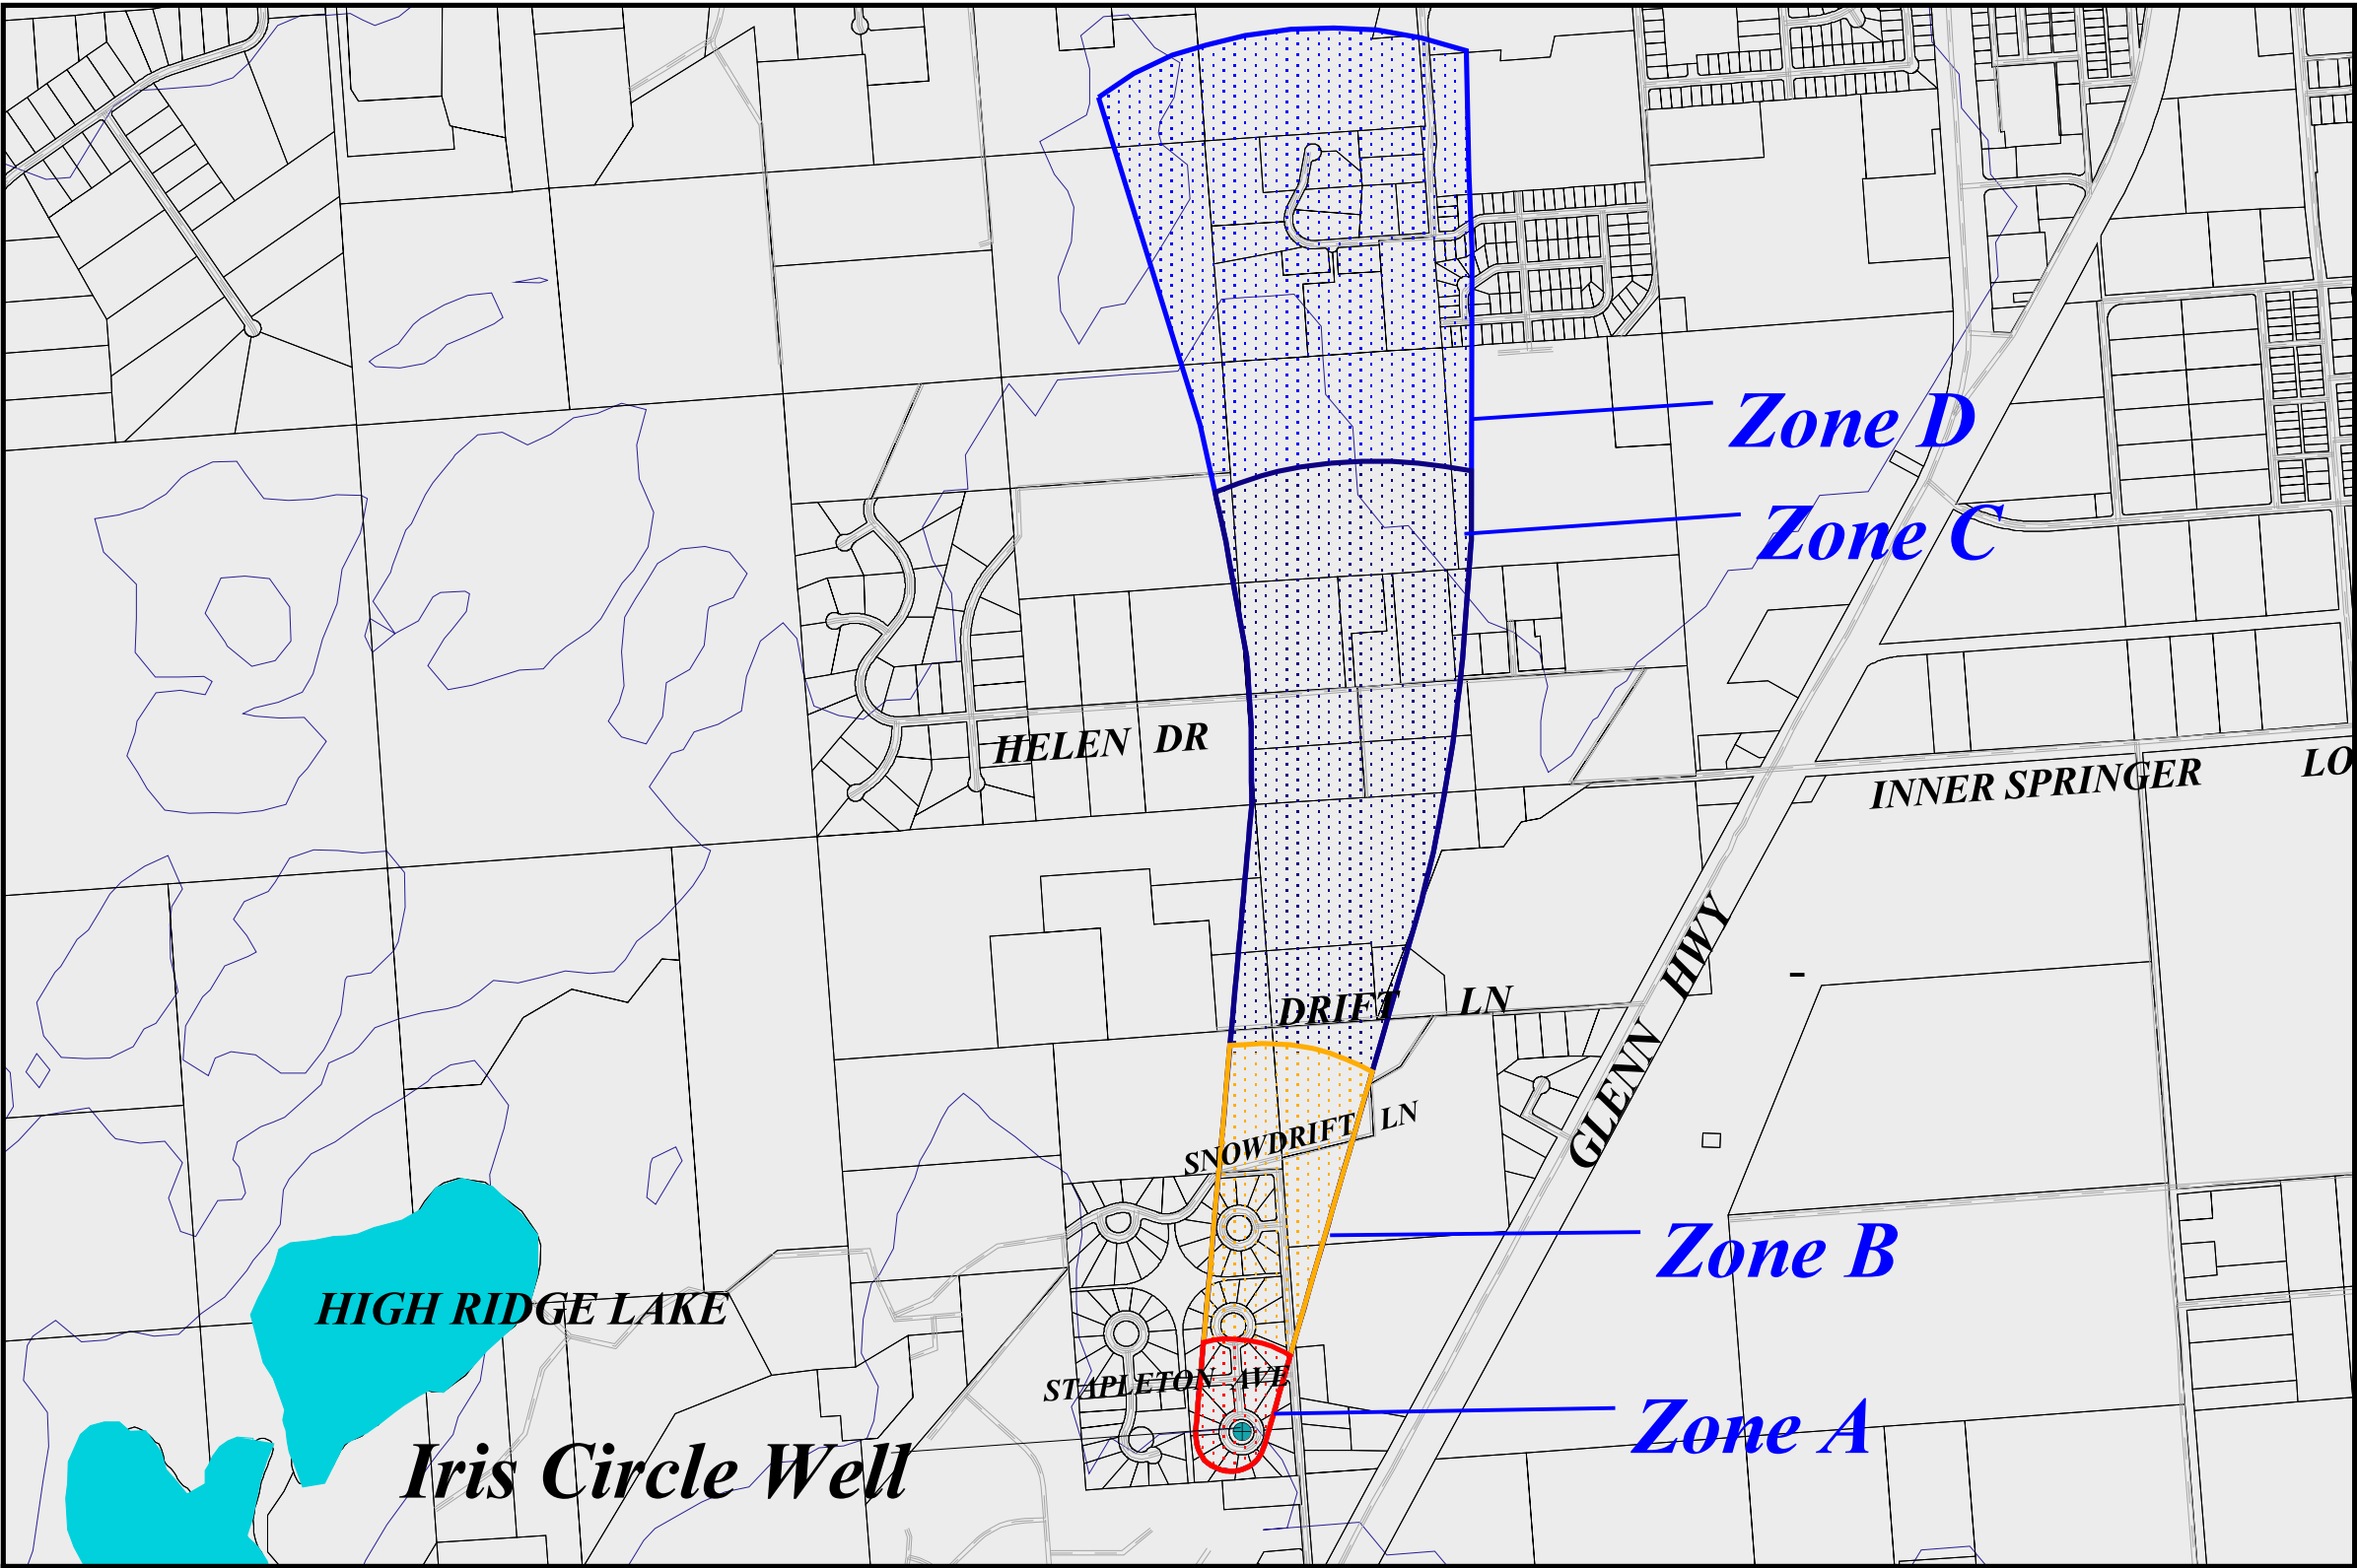

PWSID 226410.001

Map 1

APPENDIX B

Contaminant Source Inventory and Risk Ranking for Iris Circle Water Company

Table 1

**Contaminant Source Inventory for
Iris Circle Water Company**

PWSID 226410.001

Contaminant Source Type	Contaminant Source ID	CS ID tag	Zone	Location	Map Number	Comments
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-01	A	Near Iris Circle	3	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-02	A	Iris Circle	3	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-03	A	Iris Circle	3	
Residential Areas	R01	R01-01	A	Zone A Residential Areas	2	3.5 acres
Septic systems (serves one single-family home)	R02	R02-01	A	Near Iris Circle	3	
Septic systems (serves one single-family home)	R02	R02-02	A	Near Iris Circle	3	
Septic systems (serves one single-family home)	R02	R02-03	A	Near Iris Circle	3	
Septic systems (serves one single-family home)	R02	R02-04	A	Near Iris Circle	3	
Septic systems (serves one single-family home)	R02	R02-05	A	Near Stapelton Avenue	3	
Septic systems (serves one single-family home)	R02	R02-06	A	Near Iris Circle	3	
Septic systems (serves one single-family home)	R02	R02-07	A	Near Iris Circle	3	
Septic systems (serves one single-family home)	R02	R02-08	A	Near Wildrose Circle	3	
Septic systems (serves one single-family home)	R02	R02-09	A	Near Wildrose Circle	3	
Highways and roads, paved (cement or asphalt)	X20	X20-01	A	Iris Circle	2	
Highways and roads, paved (cement or asphalt)	X20	X20-02	A	Stapleton Avenue	2	
Highways and roads, paved (cement or asphalt)	X20	X20-03	A	Wildrose Circle	2	
Residential Areas	R01	R01-02	B	Zone B Residential Areas	2	6.5 acres
Septic systems (serves one single-family home)	R02	R02-10	B	Near Wildrose Circle	3	
Septic systems (serves one single-family home)	R02	R02-11	B	Near Snow Drift Lane	3	
Septic systems (serves one single-family home)	R02	R02-12	B	Near Wildrose Circle	3	
Septic systems (serves one single-family home)	R02	R02-13	B	Near Snowdrift Lane	3	
Highways and roads, paved (cement or asphalt)	X20	X20-04	B	Natasha Road	2	
Highways and roads, paved (cement or asphalt)	X20	X20-05	B	Helen Drive	2	

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Location</i>	<i>Map Number</i>	<i>Comments</i>
Highways and roads, dirt/gravel	X24	X24-01	B	Blunck Street	2	Not maintained
Highways and roads, dirt/gravel	X24	X24-02	B	Shooting Star Circle	2	Not maintained
Residential Areas	R01	R01-03	C	Zone C Residential Areas	2	33 acres
Septic systems (serves one single-family home)	R02	R02-14	C		3	
Septic systems (serves one single-family home)	R02	R02-15-25	C	Residential Septics in Zone C	3	
Highways and roads, dirt/gravel	X24	X24-03	C	Drift Lane	2	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-04	D	Woodstock Drive	3	Map 3 Inset

Table 2

*Contaminant Source Inventory and Risk Ranking for
Iris Circle Water Company
Sources of Bacteria and Viruses*

PWSID 226410.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Location</i>	<i>Map Number</i>	<i>Comments</i>
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-01	A	High	Near Iris Circle	3	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-02	A	High	Iris Circle	3	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-03	A	High	Iris Circle	3	
Septic systems (serves one single-family home)	R02	R02-01	A	Low	Near Iris Circle	3	
Septic systems (serves one single-family home)	R02	R02-02	A	Low	Near Iris Circle	3	
Septic systems (serves one single-family home)	R02	R02-03	A	Low	Near Iris Circle	3	
Septic systems (serves one single-family home)	R02	R02-04	A	Low	Near Iris Circle	3	
Septic systems (serves one single-family home)	R02	R02-05	A	Low	Near Stapelton Avenue	3	
Septic systems (serves one single-family home)	R02	R02-06	A	Low	Near Iris Circle	3	
Septic systems (serves one single-family home)	R02	R02-07	A	Low	Near Iris Circle	3	
Residential Areas	R01	R01-01	A	Low	Zone A Residential Areas	2	3.5 acres
Septic systems (serves one single-family home)	R02	R02-08	A	Low	Near Wildrose Circle	3	
Septic systems (serves one single-family home)	R02	R02-09	A	Low	Near Wildrose Circle	3	
Highways and roads, paved (cement or asphalt)	X20	X20-01	A	Low	Iris Circle	2	
Highways and roads, paved (cement or asphalt)	X20	X20-02	A	Low	Stapleton Avenue	2	
Highways and roads, paved (cement or asphalt)	X20	X20-03	A	Low	Wildrose Circle	2	
Residential Areas	R01	R01-02	B	Low	Zone B Residential Areas	2	6.5 acres
Septic systems (serves one single-family home)	R02	R02-10	B	Low	Near Wildrose Circle	3	
Septic systems (serves one single-family home)	R02	R02-11	B	Low	Near Snow Drift Lane	3	
Septic systems (serves one single-family home)	R02	R02-12	B	Low	Near Wildrose Circle	3	
Septic systems (serves one single-family home)	R02	R02-13	B	Low	Near Snowdrift Lane	3	
Highways and roads, paved (cement or asphalt)	X20	X20-04	B	Low	Natasha Road	2	

Table 2 (continued)

Contaminant Source Inventory and Risk Ranking for
Iris Circle Water Company
Sources of Bacteria and Viruses

PWSID 226410.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Location</i>	<i>Map Number</i>	<i>Comments</i>
Highways and roads, paved (cement or asphalt)	X20	X20-05	B	Low	Helen Drive	2	
Highways and roads, dirt/gravel	X24	X24-01	B	Low	Blunck Street	2	Not maintained
Highways and roads, dirt/gravel	X24	X24-02	B	Low	Shooting Star Circle	2	Not maintained
Residential Areas	R01	R01-03	C	Low	Zone C Residential Areas	2	33 acres
Septic systems (serves one single-family home)	R02	R02-14	C	Low		3	
Septic systems (serves one single-family home)	R02	R02-15-25	C	Low	Residential Septics in Zone C	3	
Highways and roads, dirt/gravel	X24	X24-03	C	Low	Drift Lane	2	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-04	D	High	Woodstock Drive	3	Map 3 Inset

Table 3

*Contaminant Source Inventory and Risk Ranking for
Iris Circle Water Company
Sources of Nitrates/Nitrites*

PWSID 226410.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Location</i>	<i>Map Number</i>	<i>Comments</i>
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-01	A	High	Near Iris Circle	3	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-02	A	High	Iris Circle	3	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-03	A	High	Iris Circle	3	
Septic systems (serves one single-family home)	R02	R02-01	A	Low	Near Iris Circle	3	
Septic systems (serves one single-family home)	R02	R02-02	A	Low	Near Iris Circle	3	
Septic systems (serves one single-family home)	R02	R02-03	A	Low	Near Iris Circle	3	
Septic systems (serves one single-family home)	R02	R02-04	A	Low	Near Iris Circle	3	
Septic systems (serves one single-family home)	R02	R02-05	A	Low	Near Stapelton Avenue	3	
Septic systems (serves one single-family home)	R02	R02-06	A	Low	Near Iris Circle	3	
Septic systems (serves one single-family home)	R02	R02-07	A	Low	Near Iris Circle	3	
Residential Areas	R01	R01-01	A	Low	Zone A Residential Areas	2	3.5 acres
Septic systems (serves one single-family home)	R02	R02-08	A	Low	Near Wildrose Circle	3	
Septic systems (serves one single-family home)	R02	R02-09	A	Low	Near Wildrose Circle	3	
Highways and roads, paved (cement or asphalt)	X20	X20-01	A	Low	Iris Circle	2	
Highways and roads, paved (cement or asphalt)	X20	X20-02	A	Low	Stapleton Avenue	2	
Highways and roads, paved (cement or asphalt)	X20	X20-03	A	Low	Wildrose Circle	2	
Residential Areas	R01	R01-02	B	Low	Zone B Residential Areas	2	6.5 acres
Septic systems (serves one single-family home)	R02	R02-10	B	Low	Near Wildrose Circle	3	
Septic systems (serves one single-family home)	R02	R02-11	B	Low	Near Snow Drift Lane	3	
Septic systems (serves one single-family home)	R02	R02-12	B	Low	Near Wildrose Circle	3	
Septic systems (serves one single-family home)	R02	R02-13	B	Low	Near Snowdrift Lane	3	
Highways and roads, paved (cement or asphalt)	X20	X20-04	B	Low	Natasha Road	2	

Table 3 (continued)

*Contaminant Source Inventory and Risk Ranking for
Iris Circle Water Company
Sources of Nitrates/Nitrites*

PWSID 226410.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Location</i>	<i>Map Number</i>	<i>Comments</i>
Highways and roads, paved (cement or asphalt)	X20	X20-05	B	Low	Helen Drive	2	
Highways and roads, dirt/gravel	X24	X24-01	B	Low	Blunck Street	2	Not maintained
Highways and roads, dirt/gravel	X24	X24-02	B	Low	Shooting Star Circle	2	Not maintained
Residential Areas	R01	R01-03	C	Low	Zone C Residential Areas	2	33 acres
Septic systems (serves one single-family home)	R02	R02-14	C	Low		3	
Septic systems (serves one single-family home)	R02	R02-15-25	C	Low	Residential Septics in Zone C	3	
Highways and roads, dirt/gravel	X24	X24-03	C	Low	Drift Lane	2	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-04	D	High	Woodstock Drive	3	Map 3 Inset

Table 4

*Contaminant Source Inventory and Risk Ranking for
Iris Circle Water Company
Sources of Volatile Organic Chemicals*

PWSID 226410.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Location</i>	<i>Map Number</i>	<i>Comments</i>
Highways and roads, paved (cement or asphalt)	X20	X20-01	A	Low	Iris Circle	2	
Highways and roads, paved (cement or asphalt)	X20	X20-02	A	Low	Stapleton Avenue	2	
Highways and roads, paved (cement or asphalt)	X20	X20-03	A	Low	Wildrose Circle	2	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-01	A	Low	Near Iris Circle	3	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-02	A	Low	Iris Circle	3	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-03	A	Low	Iris Circle	3	
Residential Areas	R01	R01-01	A	Low	Zone A Residential Areas	2	3.5 acres
Septic systems (serves one single-family home)	R02	R02-01	A	Low	Near Iris Circle	3	
Septic systems (serves one single-family home)	R02	R02-02	A	Low	Near Iris Circle	3	
Septic systems (serves one single-family home)	R02	R02-03	A	Low	Near Iris Circle	3	
Septic systems (serves one single-family home)	R02	R02-04	A	Low	Near Iris Circle	3	
Septic systems (serves one single-family home)	R02	R02-05	A	Low	Near Stapelton Avenue	3	
Septic systems (serves one single-family home)	R02	R02-06	A	Low	Near Iris Circle	3	
Septic systems (serves one single-family home)	R02	R02-07	A	Low	Near Iris Circle	3	
Septic systems (serves one single-family home)	R02	R02-08	A	Low	Near Wildrose Circle	3	
Septic systems (serves one single-family home)	R02	R02-09	A	Low	Near Wildrose Circle	3	
Residential Areas	R01	R01-02	B	Low	Zone B Residential Areas	2	6.5 acres
Septic systems (serves one single-family home)	R02	R02-10	B	Low	Near Wildrose Circle	3	
Septic systems (serves one single-family home)	R02	R02-11	B	Low	Near Snow Drift Lane	3	
Septic systems (serves one single-family home)	R02	R02-12	B	Low	Near Wildrose Circle	3	
Septic systems (serves one single-family home)	R02	R02-13	B	Low	Near Snowdrift Lane	3	
Highways and roads, paved (cement or asphalt)	X20	X20-04	B	Low	Natasha Road	2	

Table 4 (continued)

*Contaminant Source Inventory and Risk Ranking for
Iris Circle Water Company
Sources of Volatile Organic Chemicals*

PWSID 226410.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Location</i>	<i>Map Number</i>	<i>Comments</i>
Highways and roads, paved (cement or asphalt)	X20	X20-05	B	Low	Helen Drive	2	
Highways and roads, dirt/gravel	X24	X24-01	B	Low	Blunck Street	2	Not maintained
Highways and roads, dirt/gravel	X24	X24-02	B	Low	Shooting Star Circle	2	Not maintained
Residential Areas	R01	R01-03	C	Low	Zone C Residential Areas	2	33 acres
Septic systems (serves one single-family home)	R02	R02-14	C	Low		3	
Septic systems (serves one single-family home)	R02	R02-15-25	C	Low	Residential Septics in Zone C	3	
Highways and roads, dirt/gravel	X24	X24-03	C	Low	Drift Lane	2	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-04	D	Low	Woodstock Drive	3	Map 3 Inset

Table 5

*Contaminant Source Inventory and Risk Ranking for
Iris Circle Water Company
Sources of Heavy Metals, Cyanide and Other Inorganic Chemicals*

PWSID 226410.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Location</i>	<i>Map Number</i>	<i>Comments</i>
Highways and roads, paved (cement or asphalt)	X20	X20-01	A	Low	Iris Circle	2	
Highways and roads, paved (cement or asphalt)	X20	X20-02	A	Low	Stapleton Avenue	2	
Highways and roads, paved (cement or asphalt)	X20	X20-03	A	Low	Wildrose Circle	2	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-01	A	Low	Near Iris Circle	3	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-02	A	Low	Iris Circle	3	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-03	A	Low	Iris Circle	3	
Residential Areas	R01	R01-01	A	Low	Zone A Residential Areas	2	3.5 acres
Septic systems (serves one single-family home)	R02	R02-01	A	Low	Near Iris Circle	3	
Septic systems (serves one single-family home)	R02	R02-02	A	Low	Near Iris Circle	3	
Septic systems (serves one single-family home)	R02	R02-03	A	Low	Near Iris Circle	3	
Septic systems (serves one single-family home)	R02	R02-04	A	Low	Near Iris Circle	3	
Septic systems (serves one single-family home)	R02	R02-05	A	Low	Near Stapelton Avenue	3	
Septic systems (serves one single-family home)	R02	R02-06	A	Low	Near Iris Circle	3	
Septic systems (serves one single-family home)	R02	R02-07	A	Low	Near Iris Circle	3	
Septic systems (serves one single-family home)	R02	R02-08	A	Low	Near Wildrose Circle	3	
Septic systems (serves one single-family home)	R02	R02-09	A	Low	Near Wildrose Circle	3	
Residential Areas	R01	R01-02	B	Low	Zone B Residential Areas	2	6.5 acres
Septic systems (serves one single-family home)	R02	R02-10	B	Low	Near Wildrose Circle	3	
Septic systems (serves one single-family home)	R02	R02-11	B	Low	Near Snow Drift Lane	3	
Septic systems (serves one single-family home)	R02	R02-12	B	Low	Near Wildrose Circle	3	
Septic systems (serves one single-family home)	R02	R02-13	B	Low	Near Snowdrift Lane	3	
Highways and roads, paved (cement or asphalt)	X20	X20-04	B	Low	Natasha Road	2	

Table 5 (continued)

Contaminant Source Inventory and Risk Ranking for

Iris Circle Water Company

PWSID 226410.001

Sources of Heavy Metals, Cyanide and Other Inorganic Chemicals

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Location</i>	<i>Map Number</i>	<i>Comments</i>
Highways and roads, paved (cement or asphalt)	X20	X20-05	B	Low	Helen Drive	2	
Highways and roads, dirt/gravel	X24	X24-01	B	Low	Blunck Street	2	Not maintained
Highways and roads, dirt/gravel	X24	X24-02	B	Low	Shooting Star Circle	2	Not maintained
Residential Areas	R01	R01-03	C	Low	Zone C Residential Areas	2	33 acres
Septic systems (serves one single-family home)	R02	R02-14	C	Low		3	
Septic systems (serves one single-family home)	R02	R02-15-25	C	Low	Residential Septics in Zone C	3	
Highways and roads, dirt/gravel	X24	X24-03	C	Low	Drift Lane	2	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-04	D	Low	Woodstock Drive	3	Map 3 Inset

Table 6

*Contaminant Source Inventory and Risk Ranking for
Iris Circle Water Company
Sources of Synthetic Organic Chemicals*

PWSID 226410.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Location</i>	<i>Map Number</i>	<i>Comments</i>
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-01	A	Low	Near Iris Circle	3	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-02	A	Low	Iris Circle	3	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-03	A	Low	Iris Circle	3	
Residential Areas	R01	R01-01	A	Low	Zone A Residential Areas	2	3.5 acres
Septic systems (serves one single-family home)	R02	R02-01	A	Low	Near Iris Circle	3	
Septic systems (serves one single-family home)	R02	R02-02	A	Low	Near Iris Circle	3	
Septic systems (serves one single-family home)	R02	R02-03	A	Low	Near Iris Circle	3	
Septic systems (serves one single-family home)	R02	R02-04	A	Low	Near Iris Circle	3	
Septic systems (serves one single-family home)	R02	R02-05	A	Low	Near Stapelton Avenue	3	
Septic systems (serves one single-family home)	R02	R02-06	A	Low	Near Iris Circle	3	
Septic systems (serves one single-family home)	R02	R02-07	A	Low	Near Iris Circle	3	
Septic systems (serves one single-family home)	R02	R02-08	A	Low	Near Wildrose Circle	3	
Septic systems (serves one single-family home)	R02	R02-09	A	Low	Near Wildrose Circle	3	
Residential Areas	R01	R01-02	B	Low	Zone B Residential Areas	2	6.5 acres
Septic systems (serves one single-family home)	R02	R02-10	B	Low	Near Wildrose Circle	3	
Septic systems (serves one single-family home)	R02	R02-11	B	Low	Near Snow Drift Lane	3	
Septic systems (serves one single-family home)	R02	R02-12	B	Low	Near Wildrose Circle	3	
Septic systems (serves one single-family home)	R02	R02-13	B	Low	Near Snowdrift Lane	3	
Residential Areas	R01	R01-03	C	Low	Zone C Residential Areas	2	33 acres
Septic systems (serves one single-family home)	R02	R02-14	C	Low		3	
Septic systems (serves one single-family home)	R02	R02-15-25	C	Low	Residential Septics in Zone C	3	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-04	D	Low	Woodstock Drive	3	Map 3 Inset

Table 6 (continued)

*Contaminant Source Inventory and Risk Ranking for
Iris Circle Water Company
Sources of Synthetic Organic Chemicals*

PWSID 226410.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Location</i>	<i>Map Number</i>	<i>Comments</i>
--------------------------------	------------------------------	------------------	-------------	----------------------------------	-----------------	-------------------	-----------------

Table 7

*Contaminant Source Inventory and Risk Ranking for
Iris Circle Water Company
Sources of Other Organic Chemicals*





PWSID 226410.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Location</i>	<i>Map Number</i>	<i>Comments</i>
Highways and roads, paved (cement or asphalt)	X20	X20-01	A	Low	Iris Circle	2	
Highways and roads, paved (cement or asphalt)	X20	X20-02	A	Low	Stapleton Avenue	2	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-01	A	Low	Near Iris Circle	3	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-02	A	Low	Iris Circle	3	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-03	A	Low	Iris Circle	3	
Residential Areas	R01	R01-01	A	Low	Zone A Residential Areas	2	3.5 acres
Septic systems (serves one single-family home)	R02	R02-01	A	Low	Near Iris Circle	3	
Septic systems (serves one single-family home)	R02	R02-02	A	Low	Near Iris Circle	3	
Septic systems (serves one single-family home)	R02	R02-03	A	Low	Near Iris Circle	3	
Septic systems (serves one single-family home)	R02	R02-04	A	Low	Near Iris Circle	3	
Septic systems (serves one single-family home)	R02	R02-05	A	Low	Near Stapelton Avenue	3	
Septic systems (serves one single-family home)	R02	R02-06	A	Low	Near Iris Circle	3	
Septic systems (serves one single-family home)	R02	R02-07	A	Low	Near Iris Circle	3	
Septic systems (serves one single-family home)	R02	R02-08	A	Low	Near Wildrose Circle	3	
Septic systems (serves one single-family home)	R02	R02-09	A	Low	Near Wildrose Circle	3	
Highways and roads, paved (cement or asphalt)	X20	X20-03	A	Low	Wildrose Circle	2	
Residential Areas	R01	R01-02	B	Low	Zone B Residential Areas	2	6.5 acres
Septic systems (serves one single-family home)	R02	R02-10	B	Low	Near Wildrose Circle	3	
Septic systems (serves one single-family home)	R02	R02-11	B	Low	Near Snow Drift Lane	3	
Septic systems (serves one single-family home)	R02	R02-12	B	Low	Near Wildrose Circle	3	
Septic systems (serves one single-family home)	R02	R02-13	B	Low	Near Snowdrift Lane	3	
Highways and roads, paved (cement or asphalt)	X20	X20-04	B	Low	Natasha Road	2	

APPENDIX C

Iris Circle Water Company Drinking Water Protection Area And Potential & Existing Contaminant Sources





Drinking Water Protection Area and Potential and Existing Sources of Contamination for Iris Circle Water Company

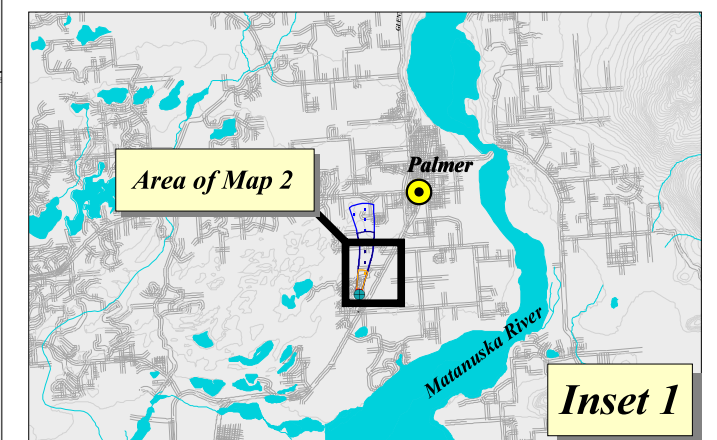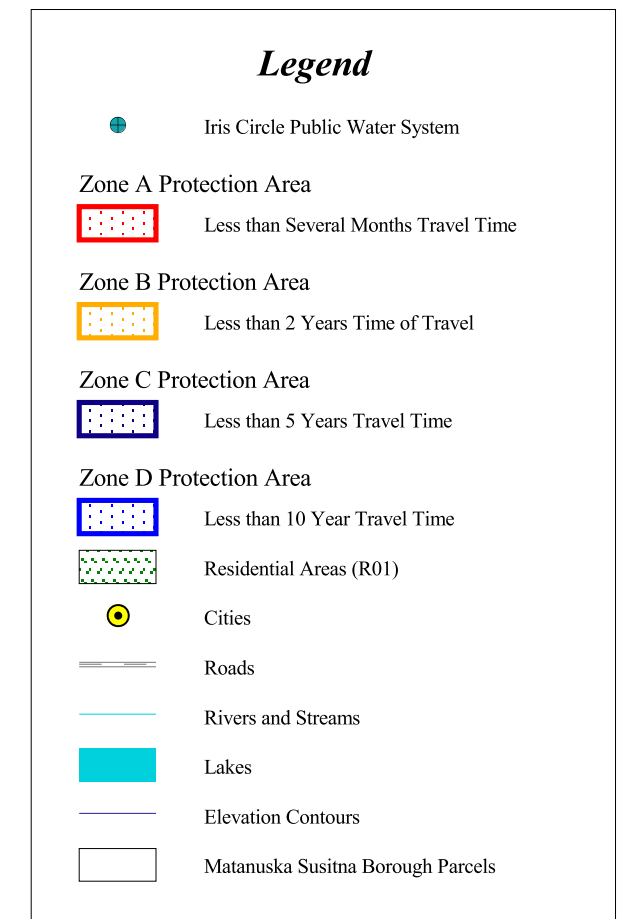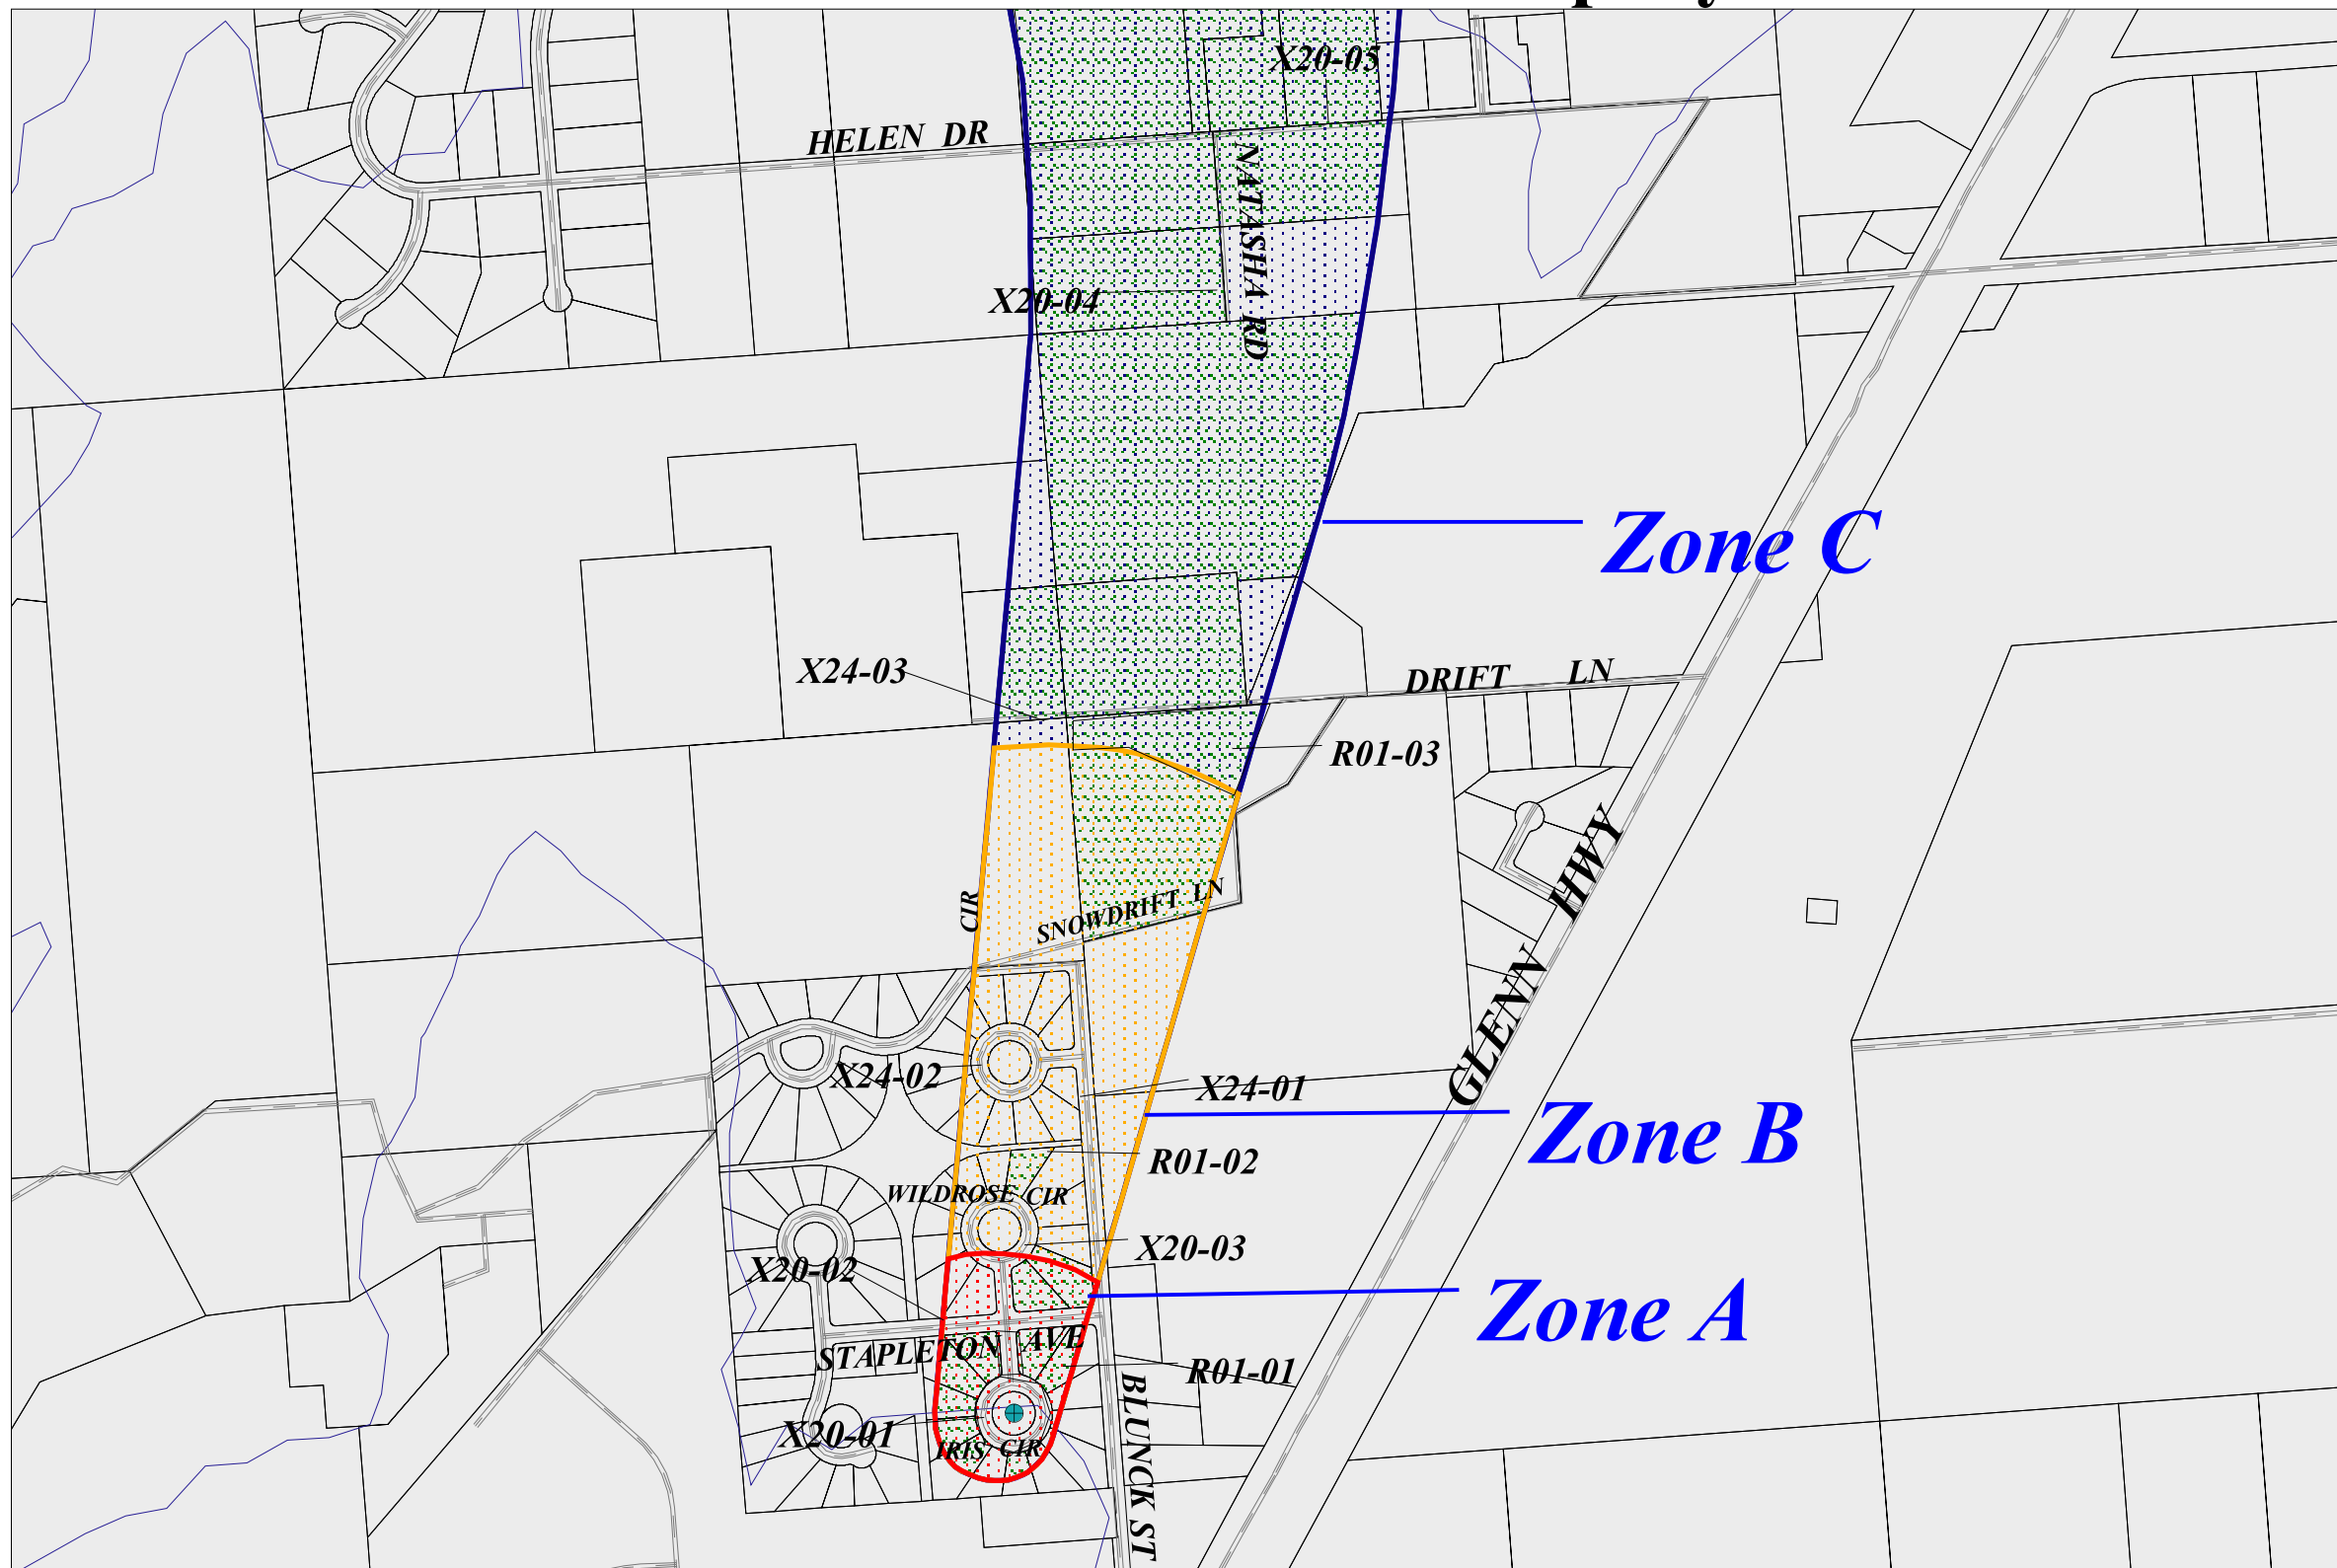

PWSID 226410.001

Map 2

Drinking Water Protection Area and Potential and Existing Contaminant Sources for Iris Circle Water Company

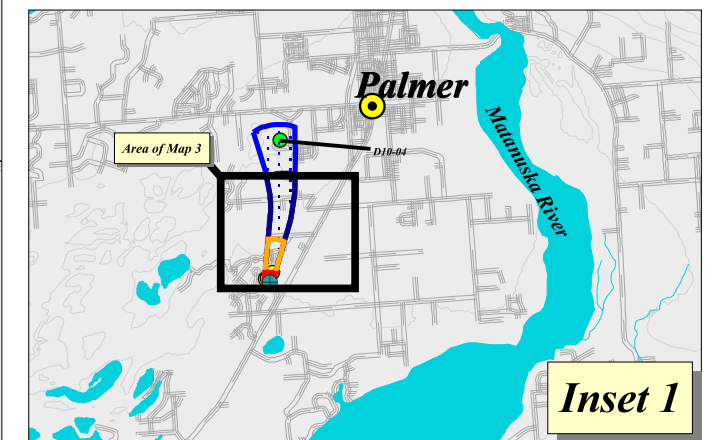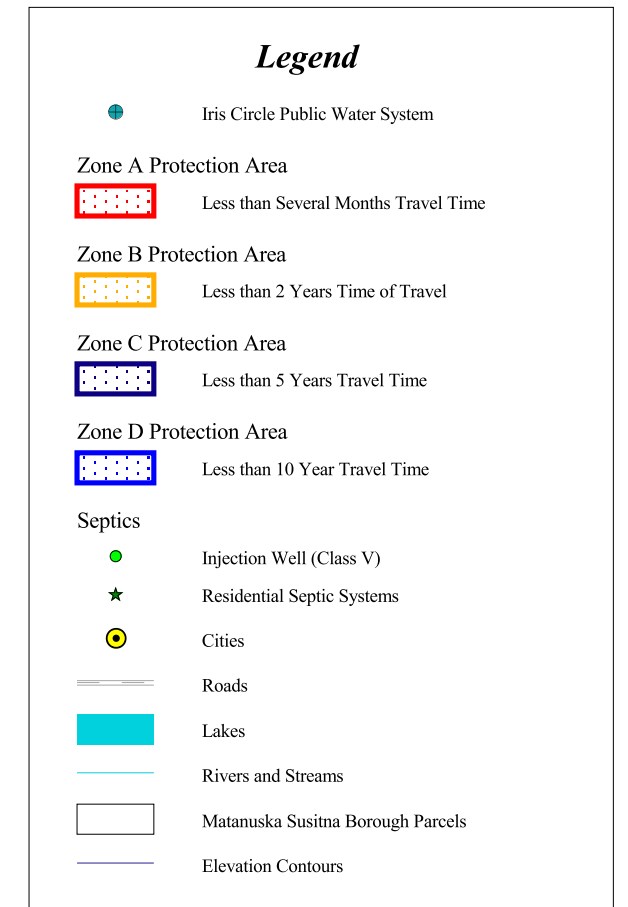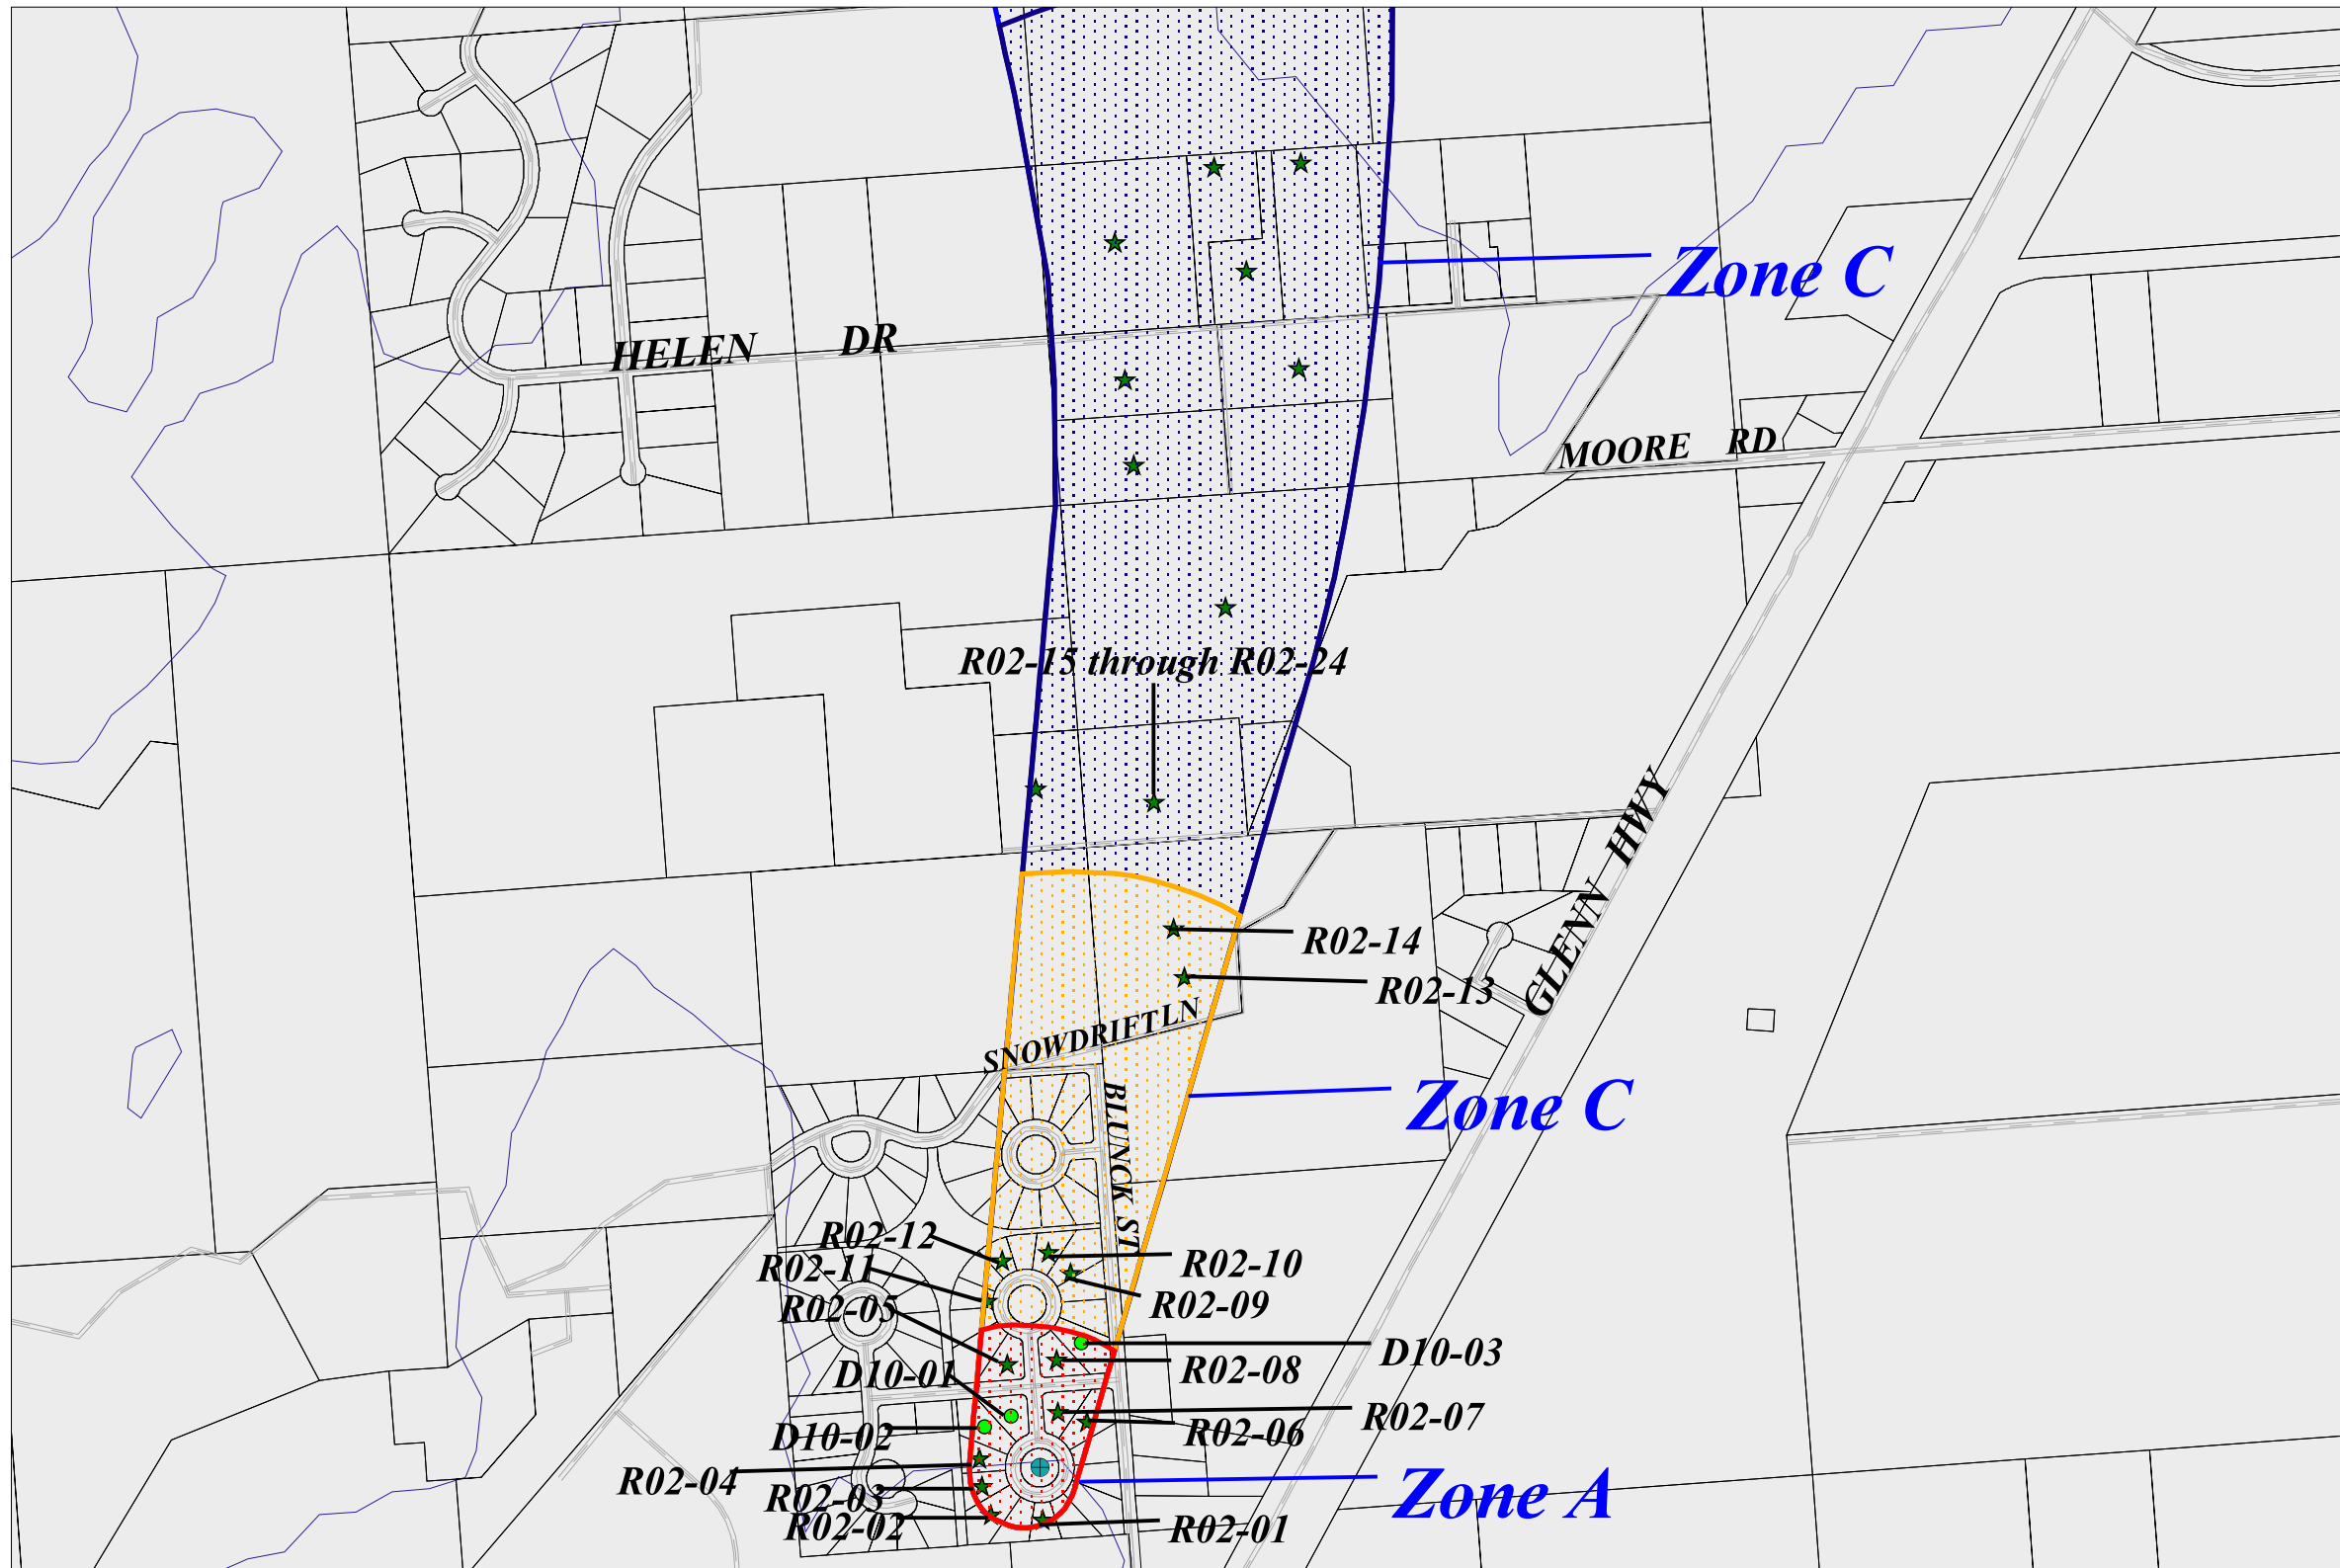

PWSID 226410.001

Map 3

APPENDIX D

Vulnerability Analysis for Iris Circle Water Company Public Drinking Water Source

Chart 1. Susceptibility of the wellhead - Iris Circle

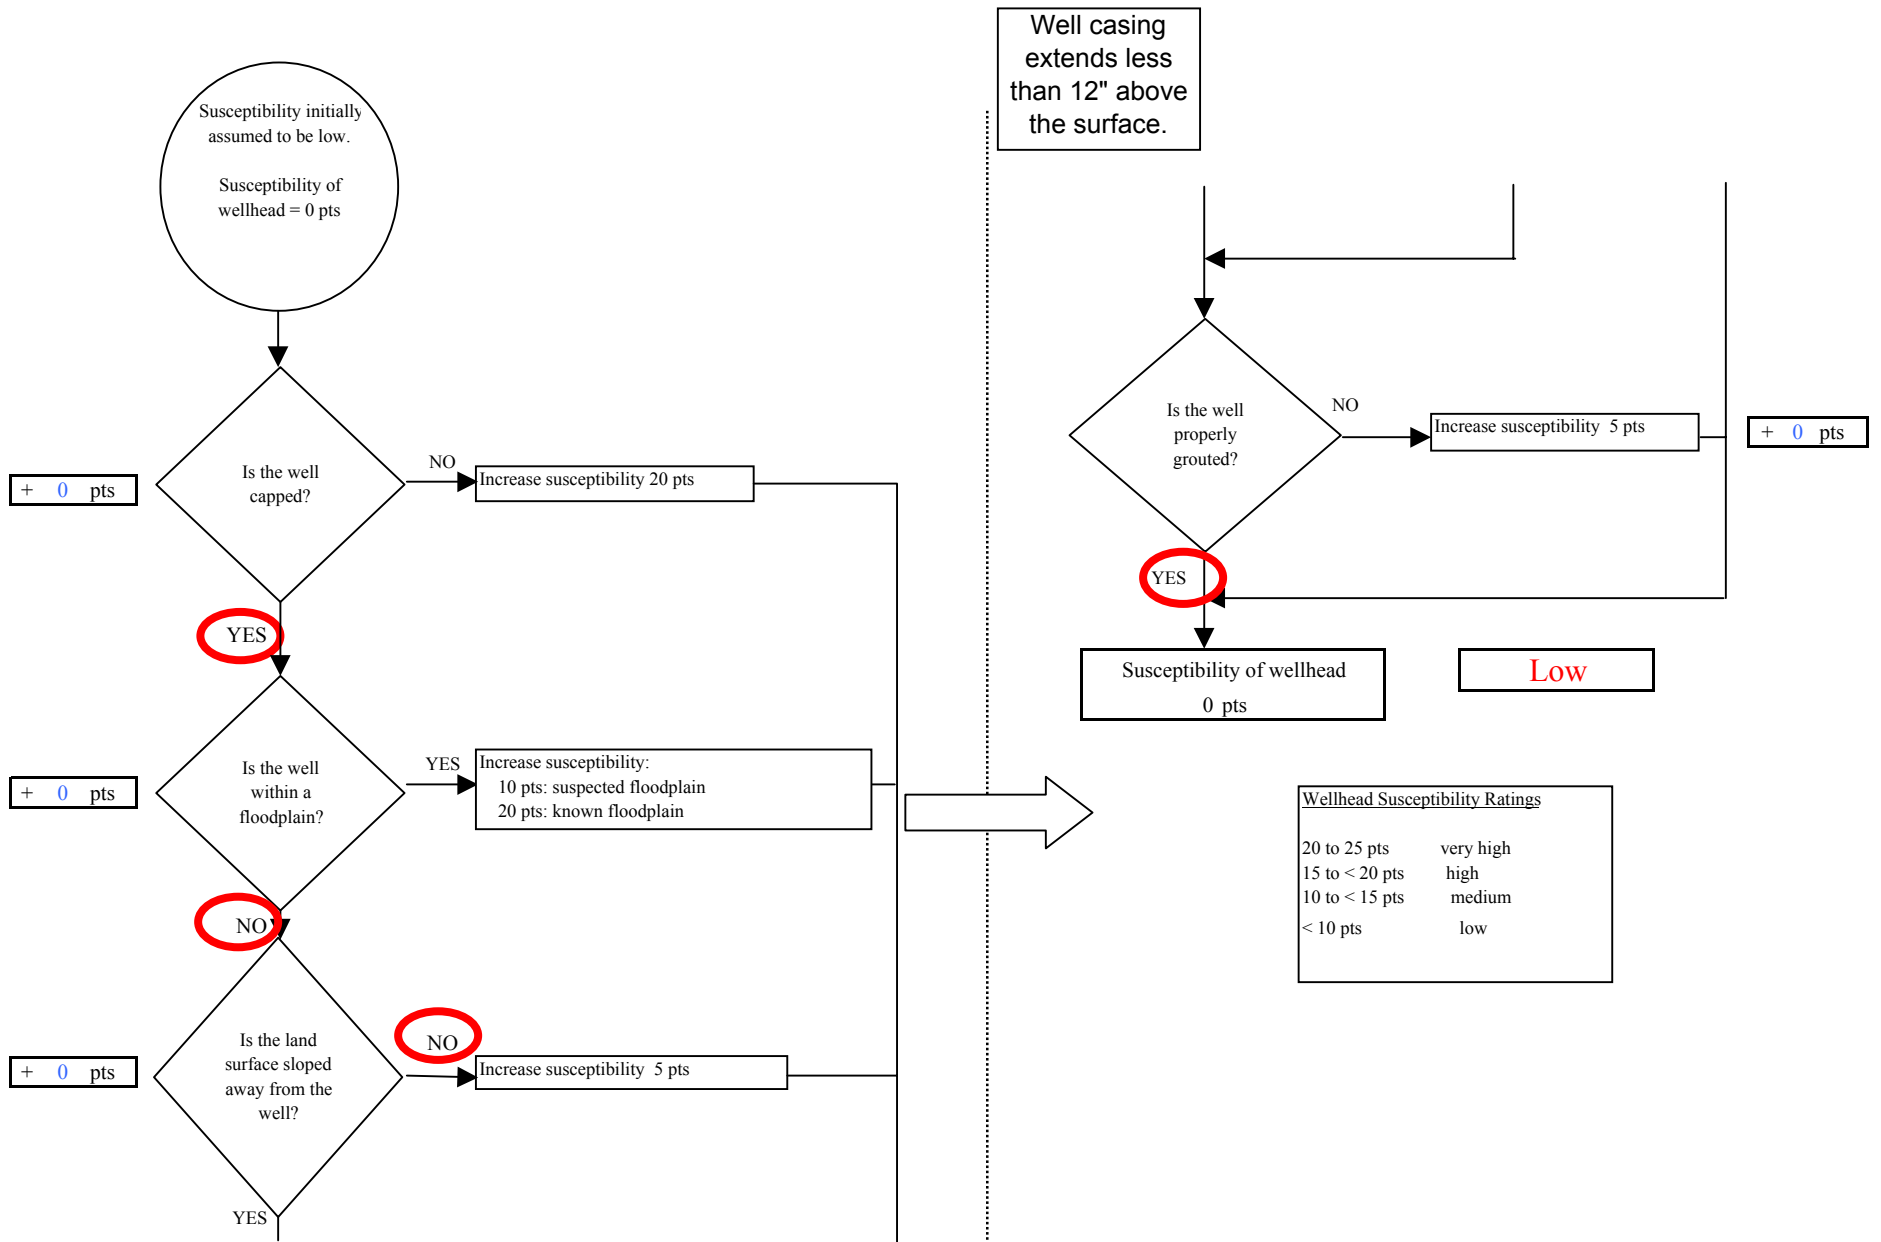


Chart 2. Susceptibility of the aquifer - Iris Circle

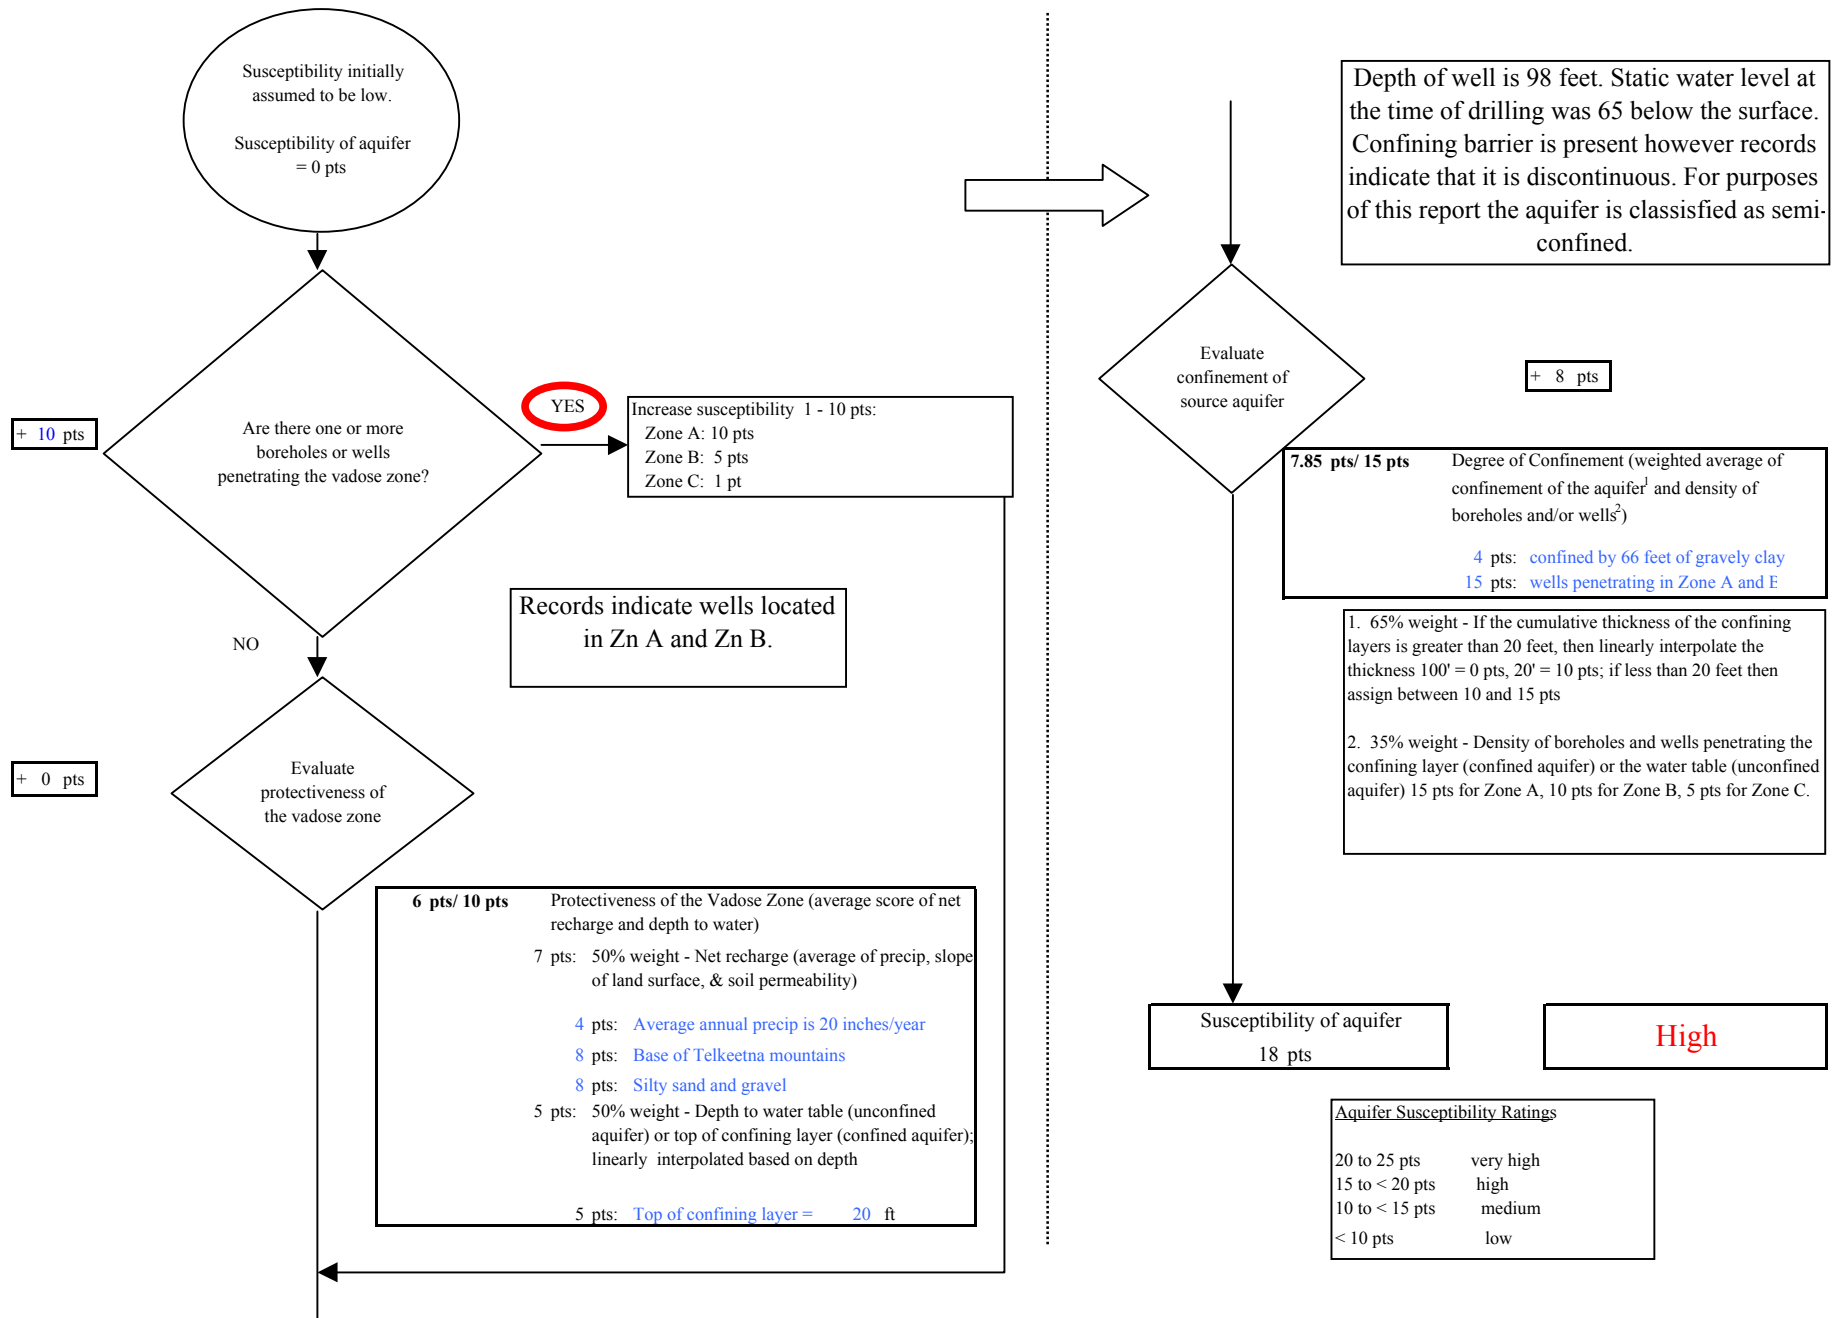


Chart 3. Contaminant risks for Iris Circle - Bacteria & Viruses




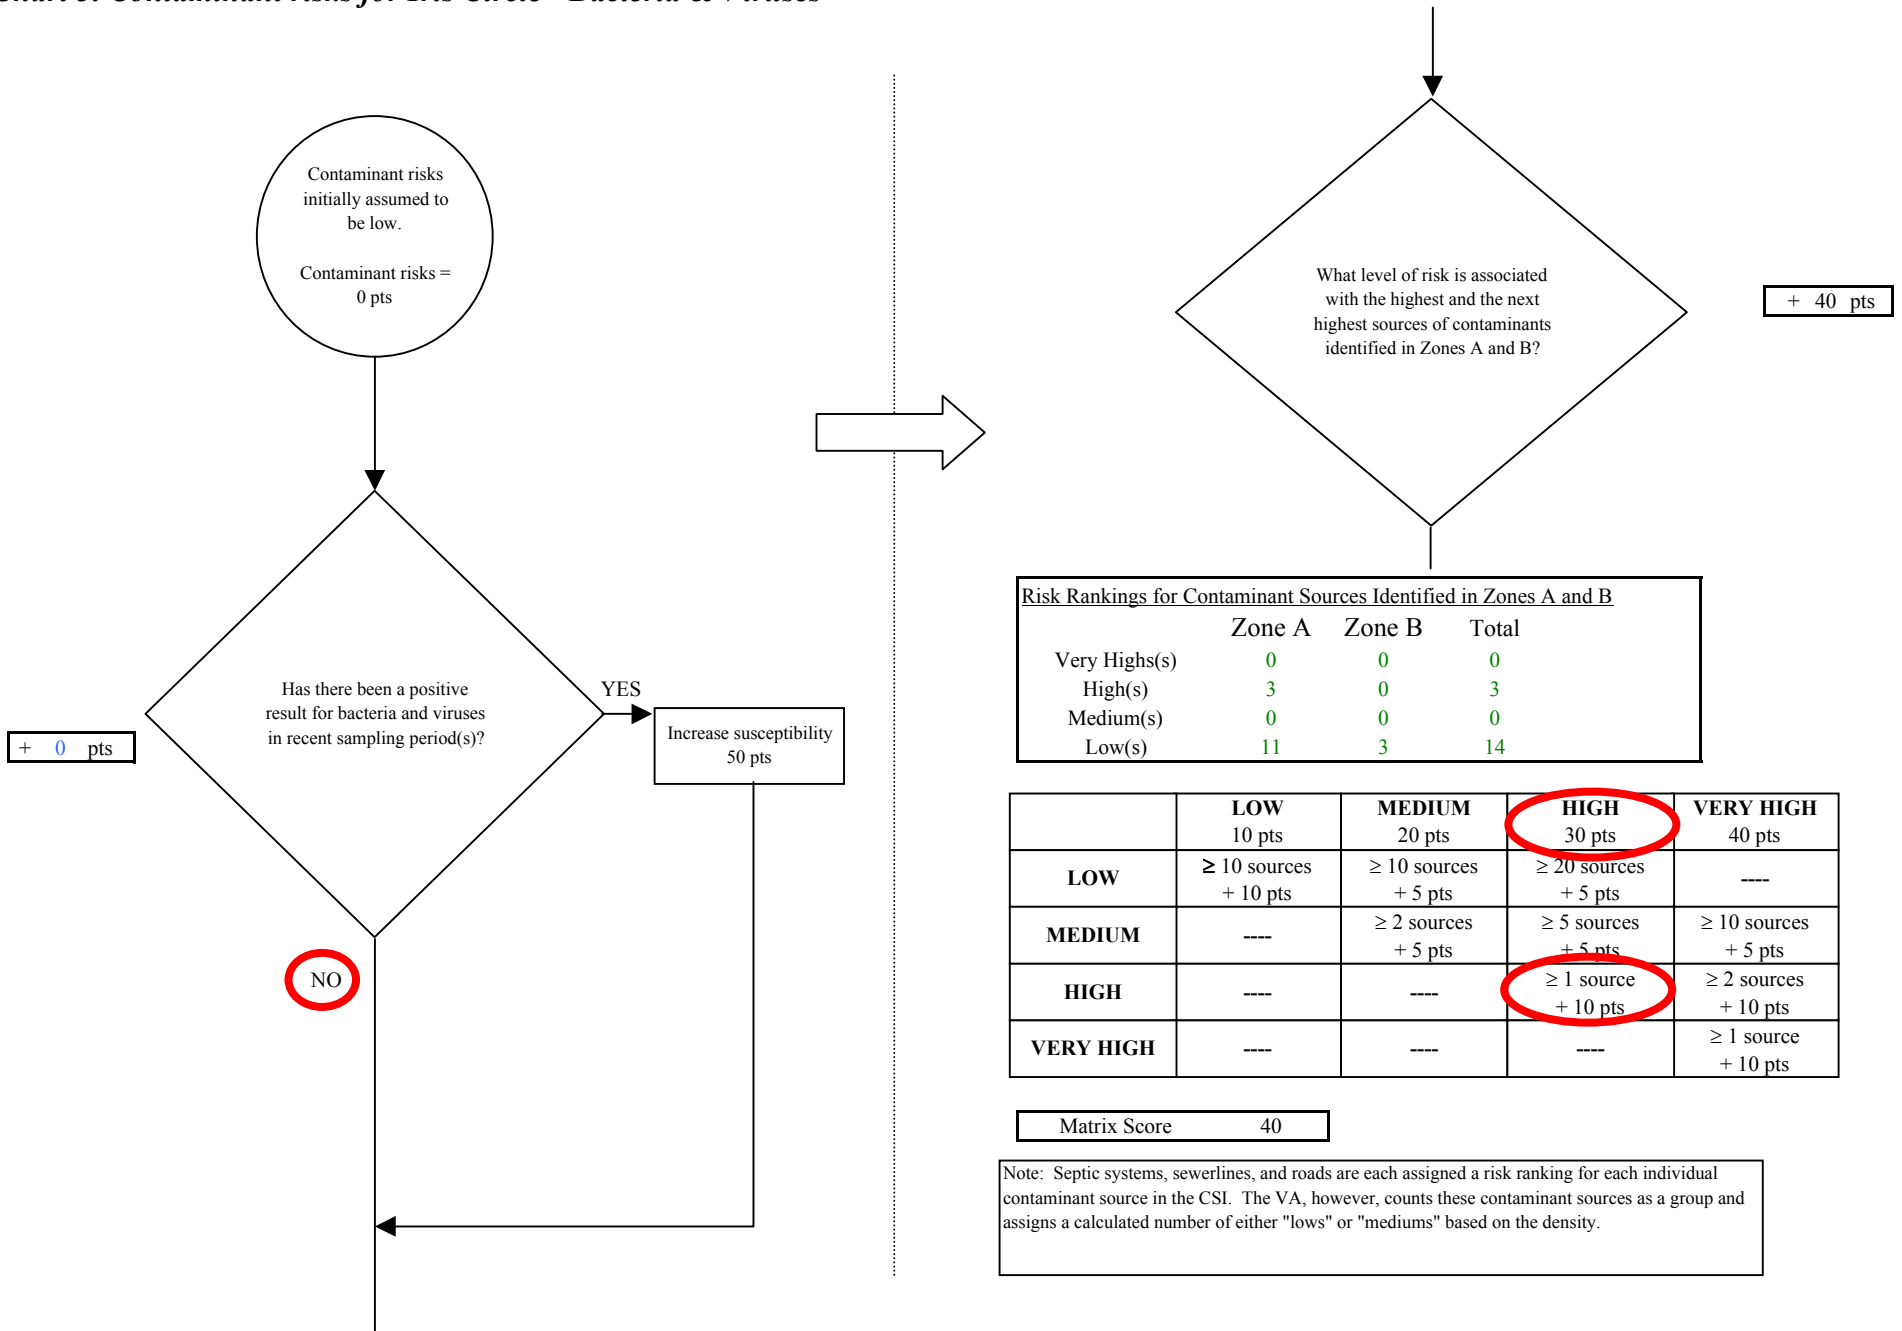


Chart 3. Contaminant risks for Iris Circle - Bacteria & Viruses

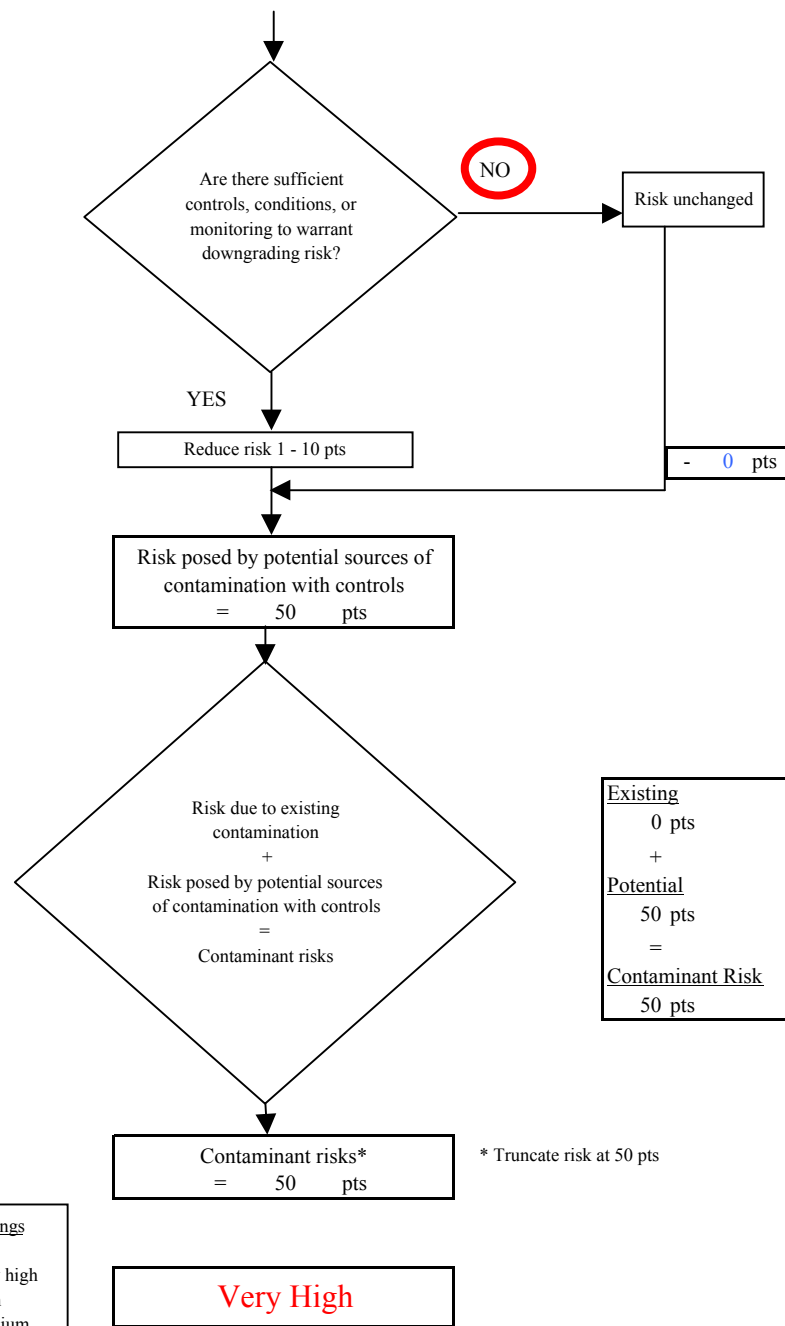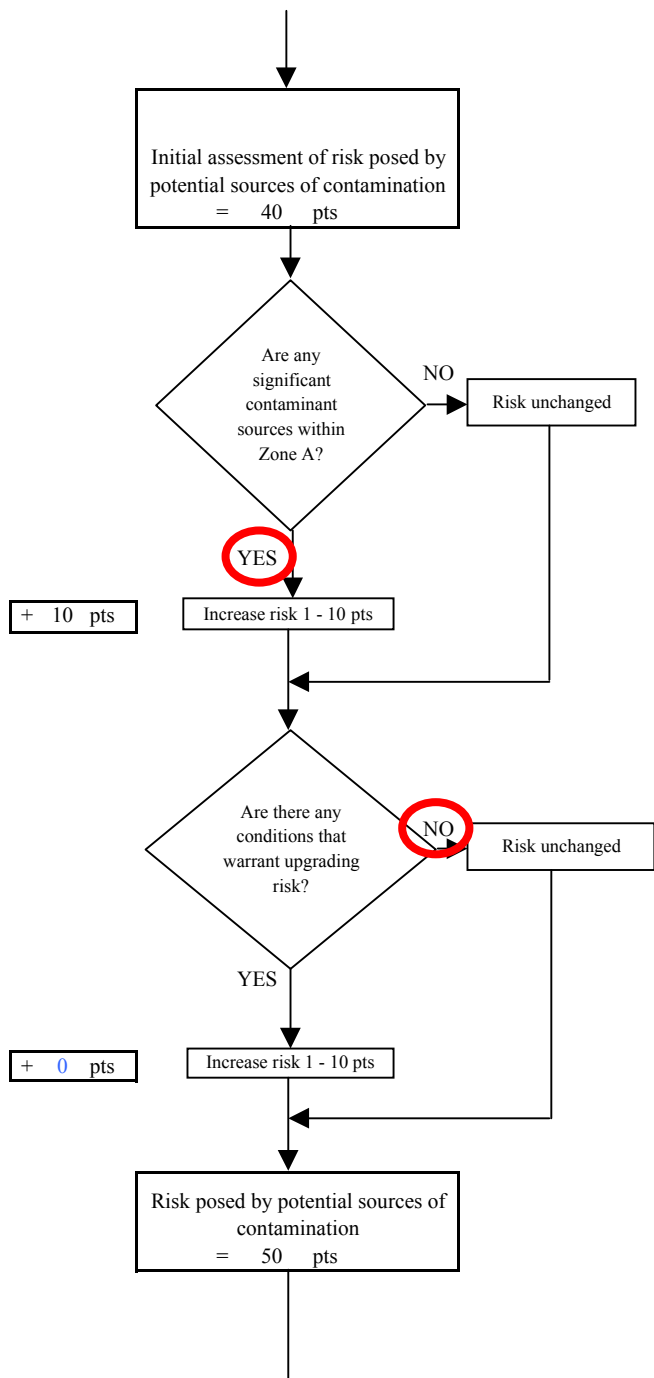

<u>Existing</u>
0 pts
+
<u>Potential</u>
50 pts
=
<u>Contaminant Risk</u>
50 pts

Contaminant Risk Ratings	
40 to 50 pts	very high
30 to < 40 pts	high
20 to < 30 pts	medium
< 20 pts	low

* Truncate risk at 50 pts

Chart 4. Vulnerability analysis for Iris Circle - Bacteria & Viruses

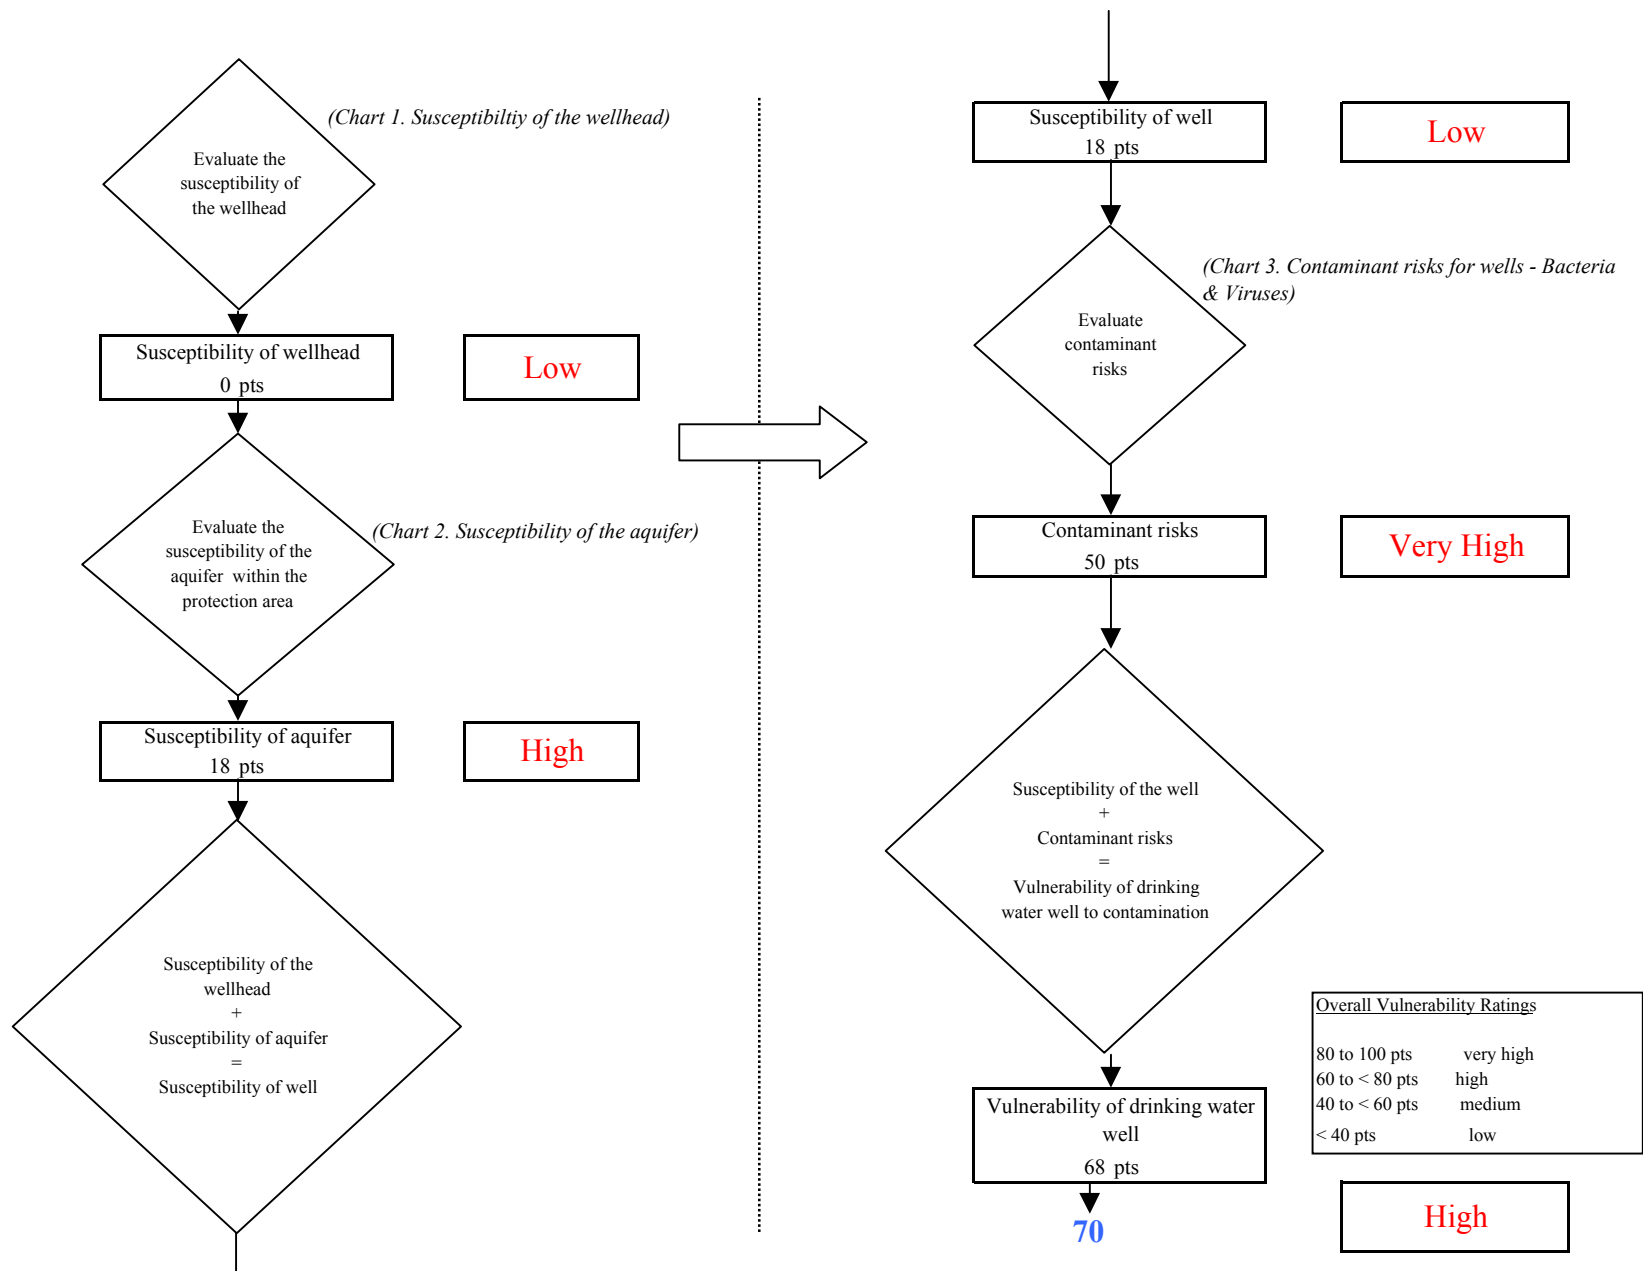


Chart 5. Contaminant risks for Iris Circle - Nitrates and Nitrites

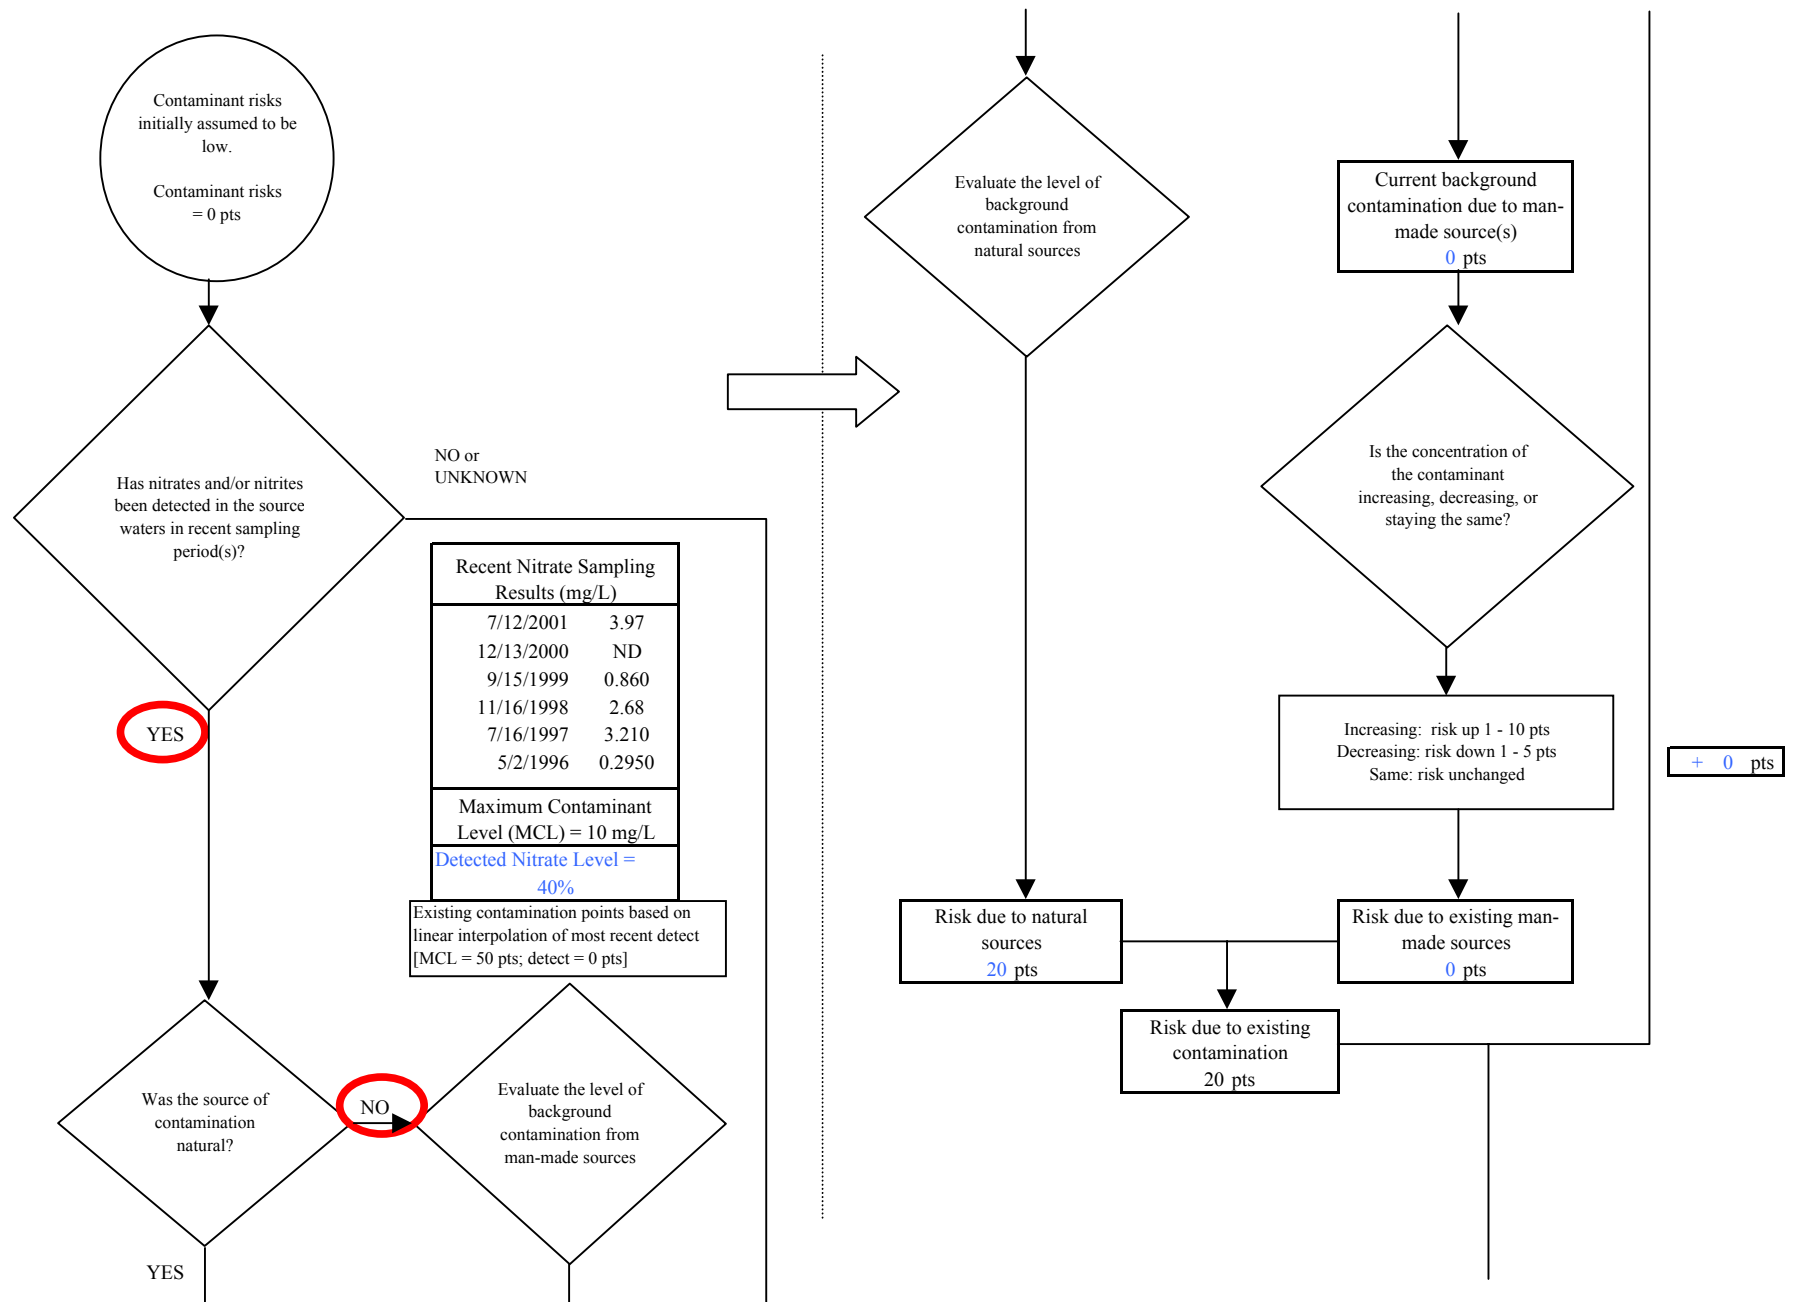


Chart 5. Contaminant risks for Iris Circle - Nitrates and Nitrites


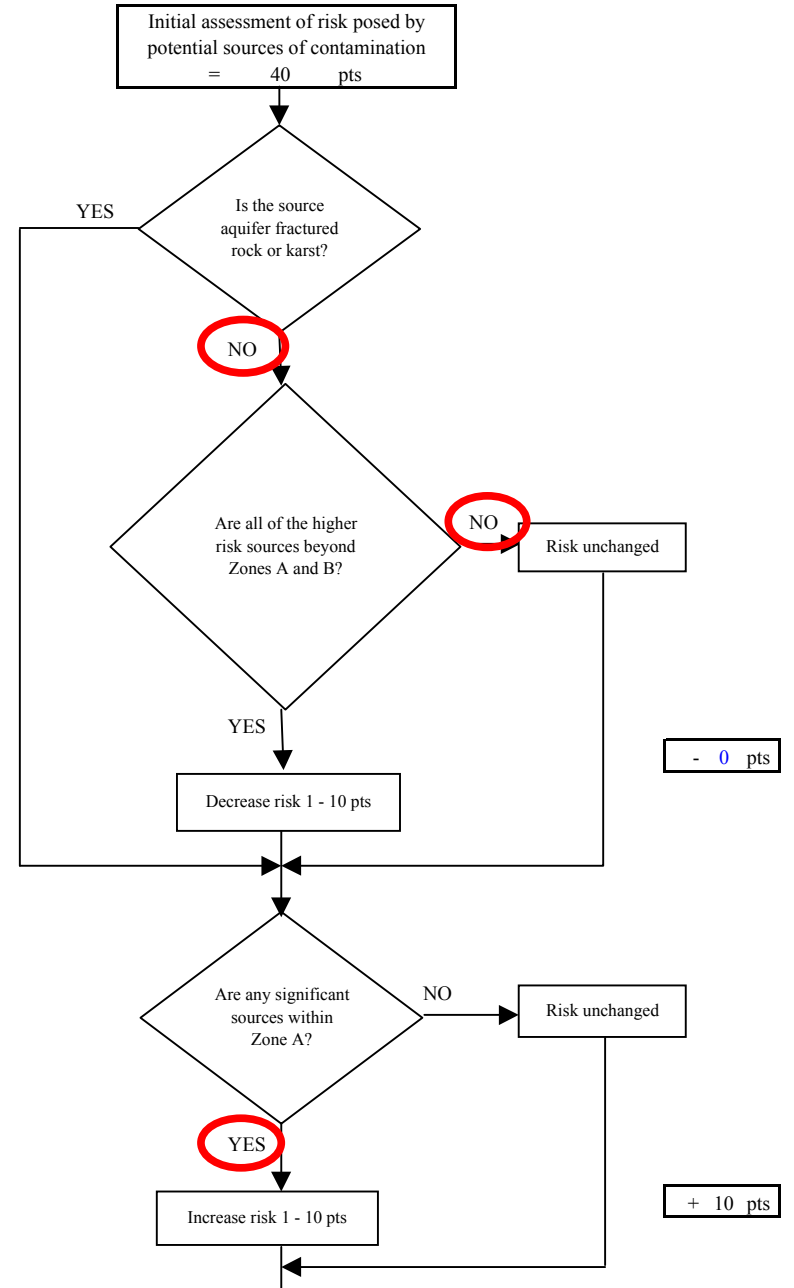
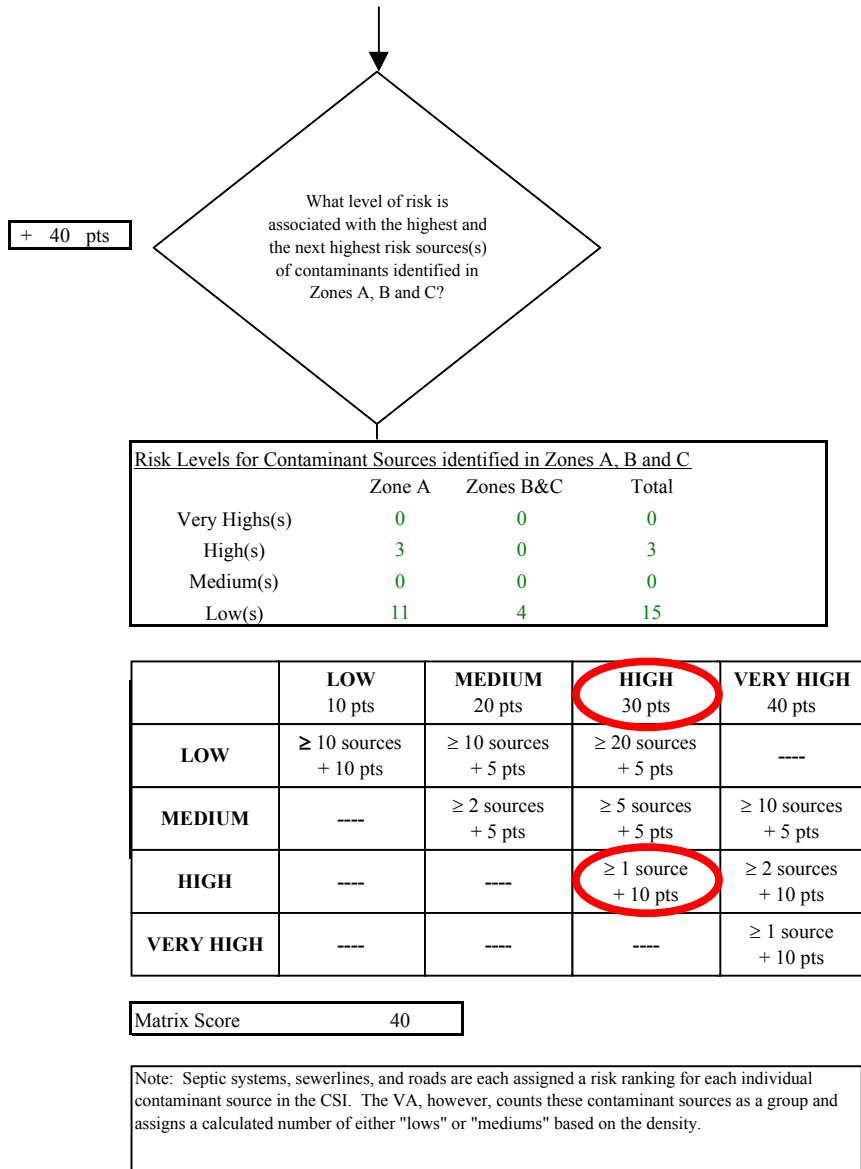


Chart 5. Contaminant risks for Iris Circle - Nitrates and Nitrites

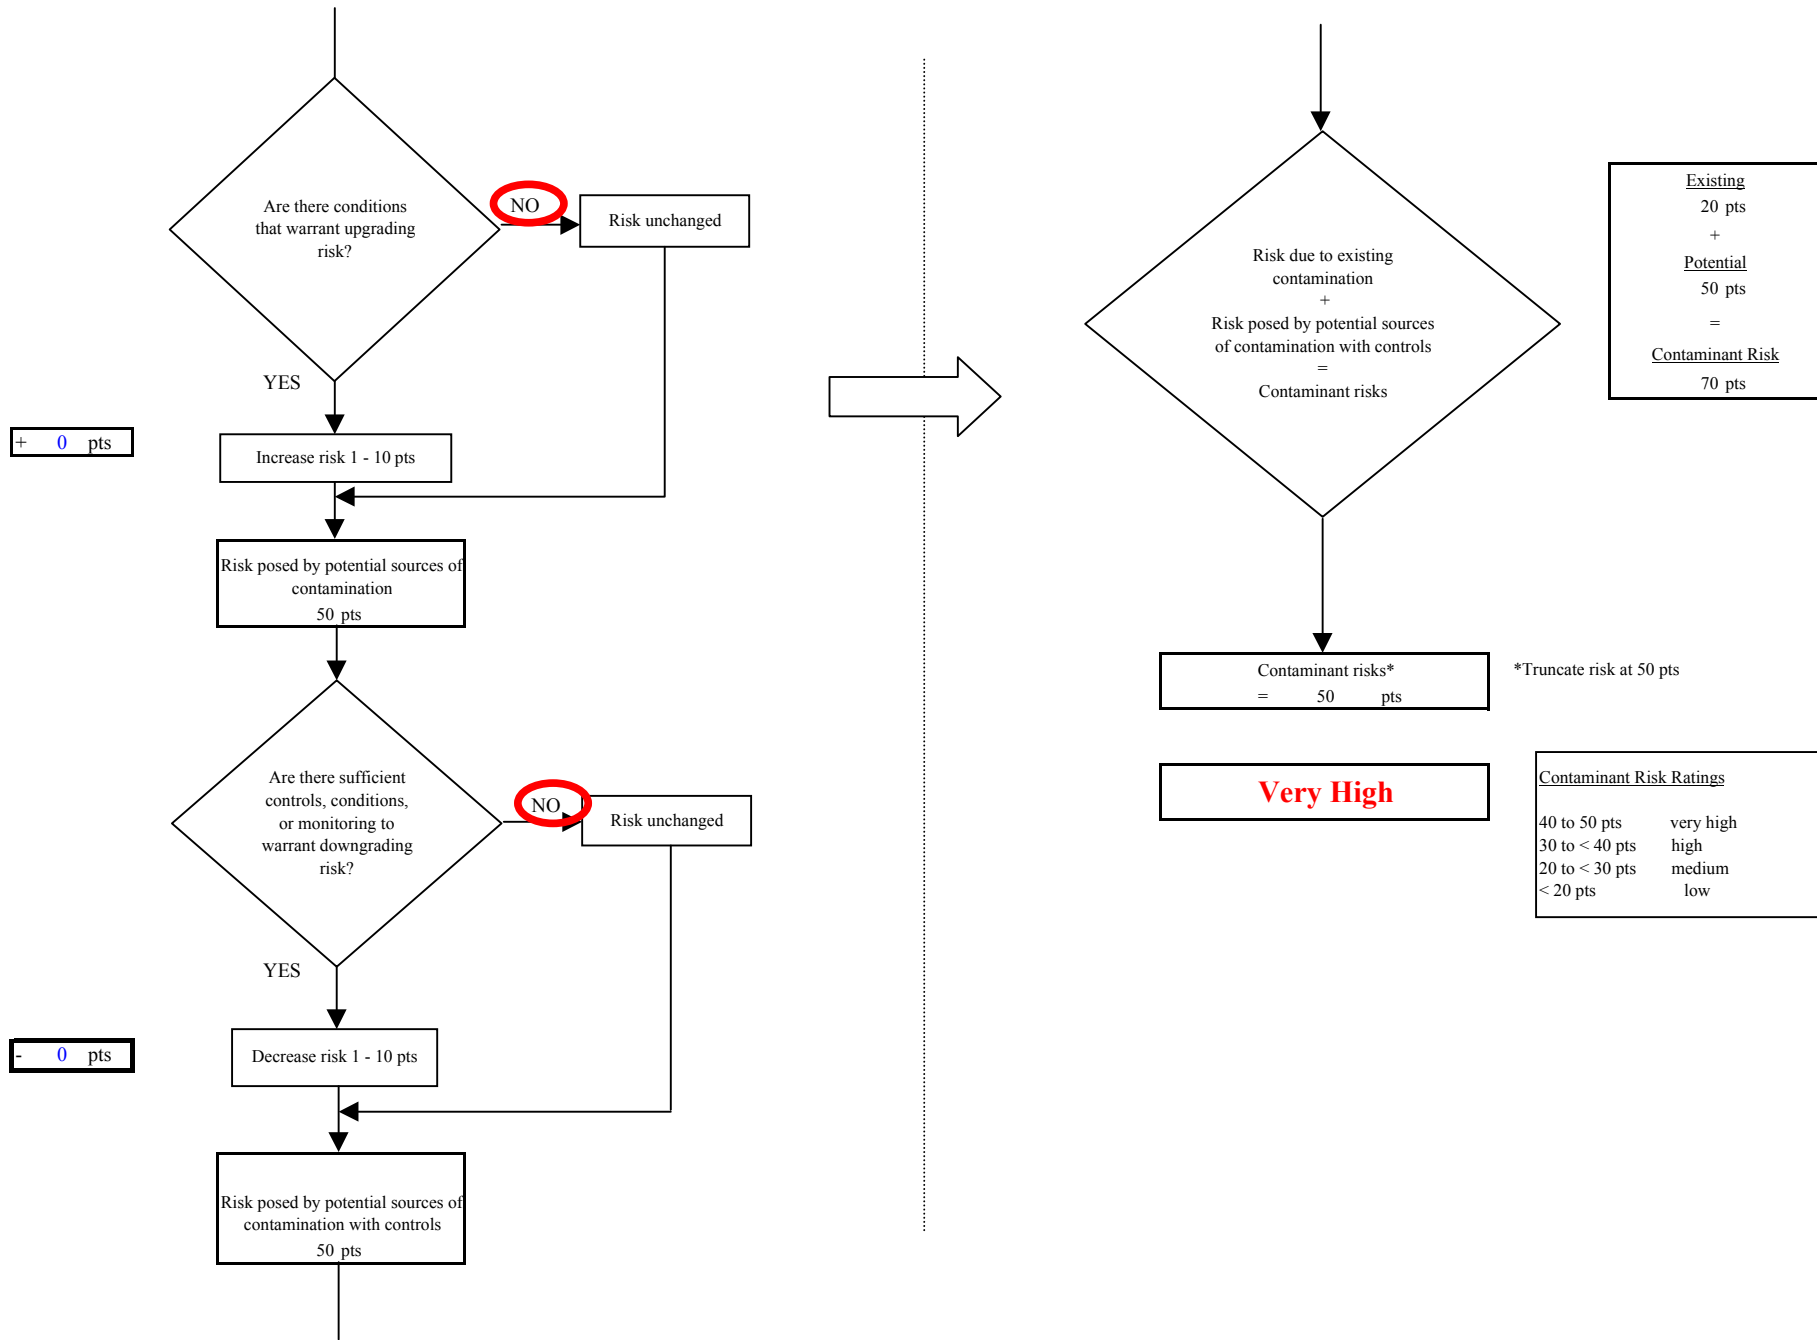


Chart 6. Vulnerability analysis for Iris Circle - Nitrates and Nitrites

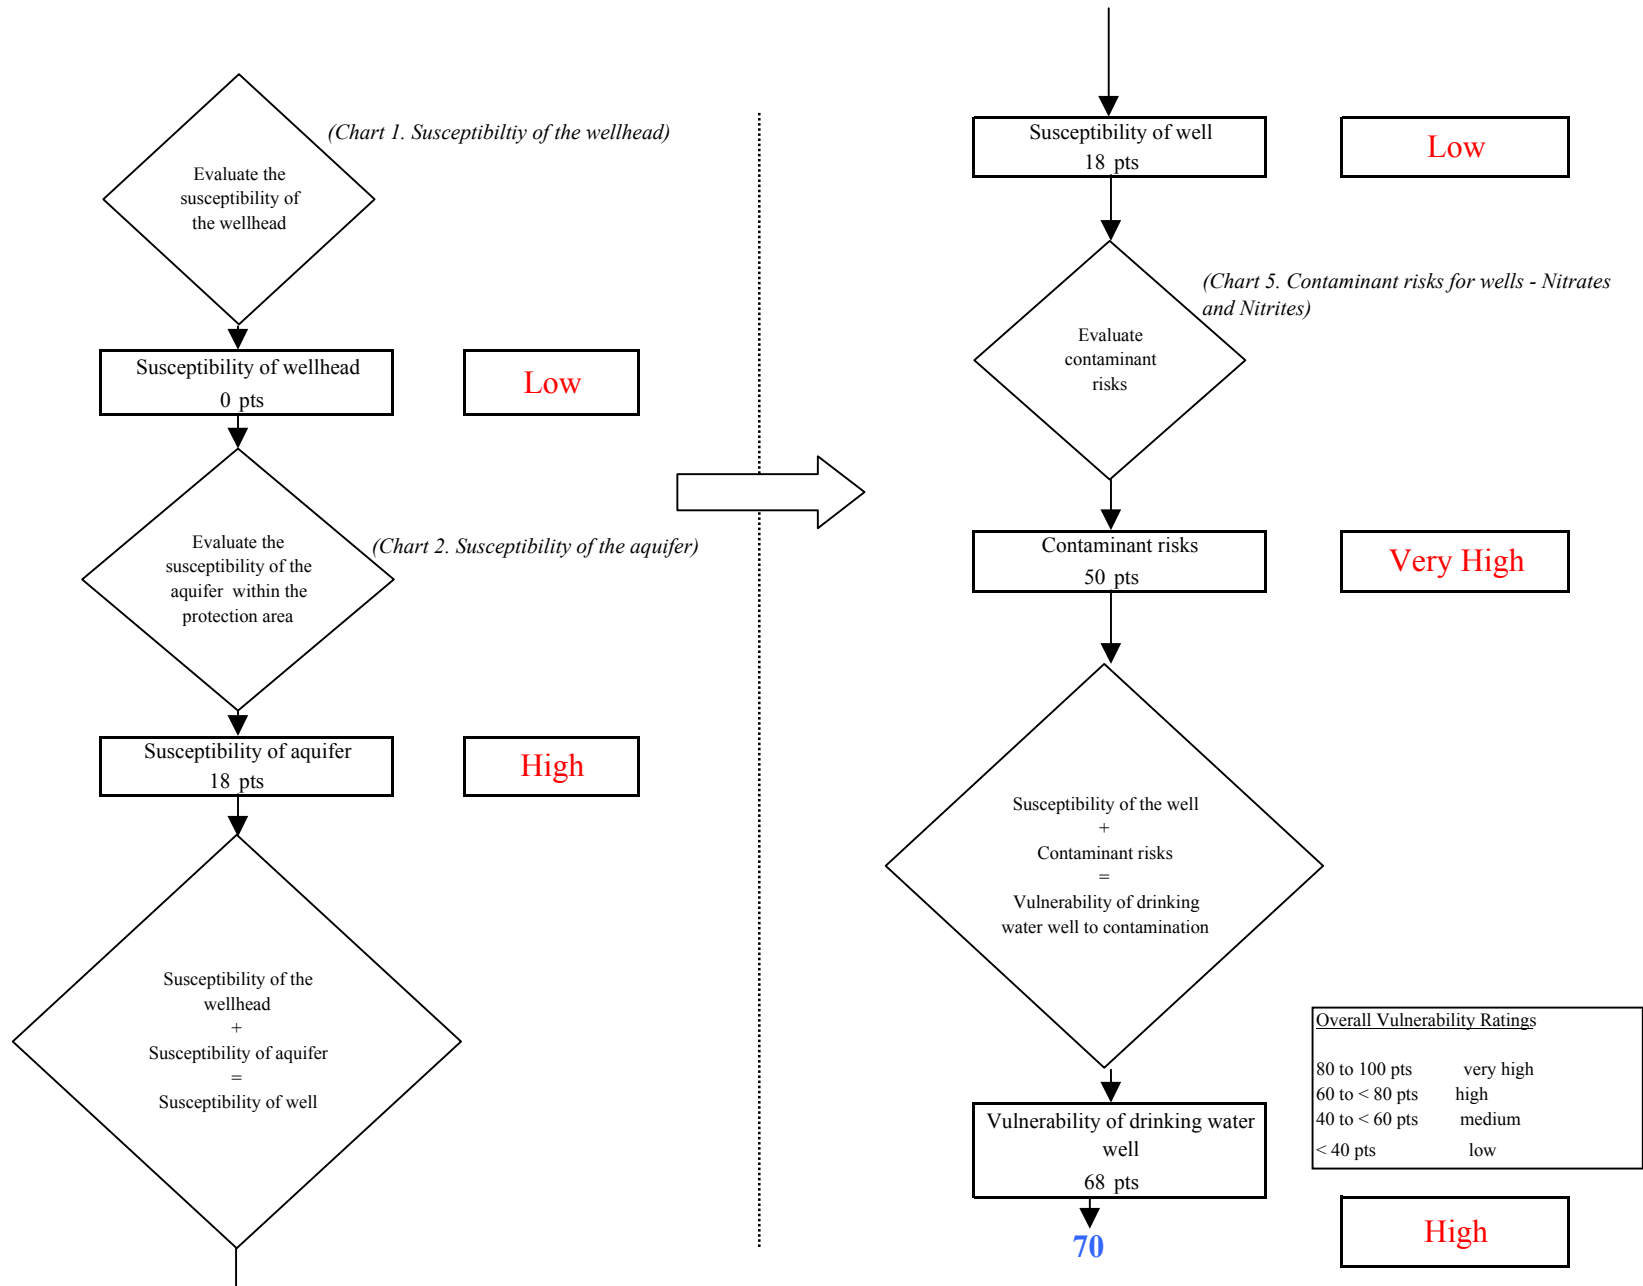


Chart 7. Contaminant risks for Iris Circle - Volatile Organic Chemicals

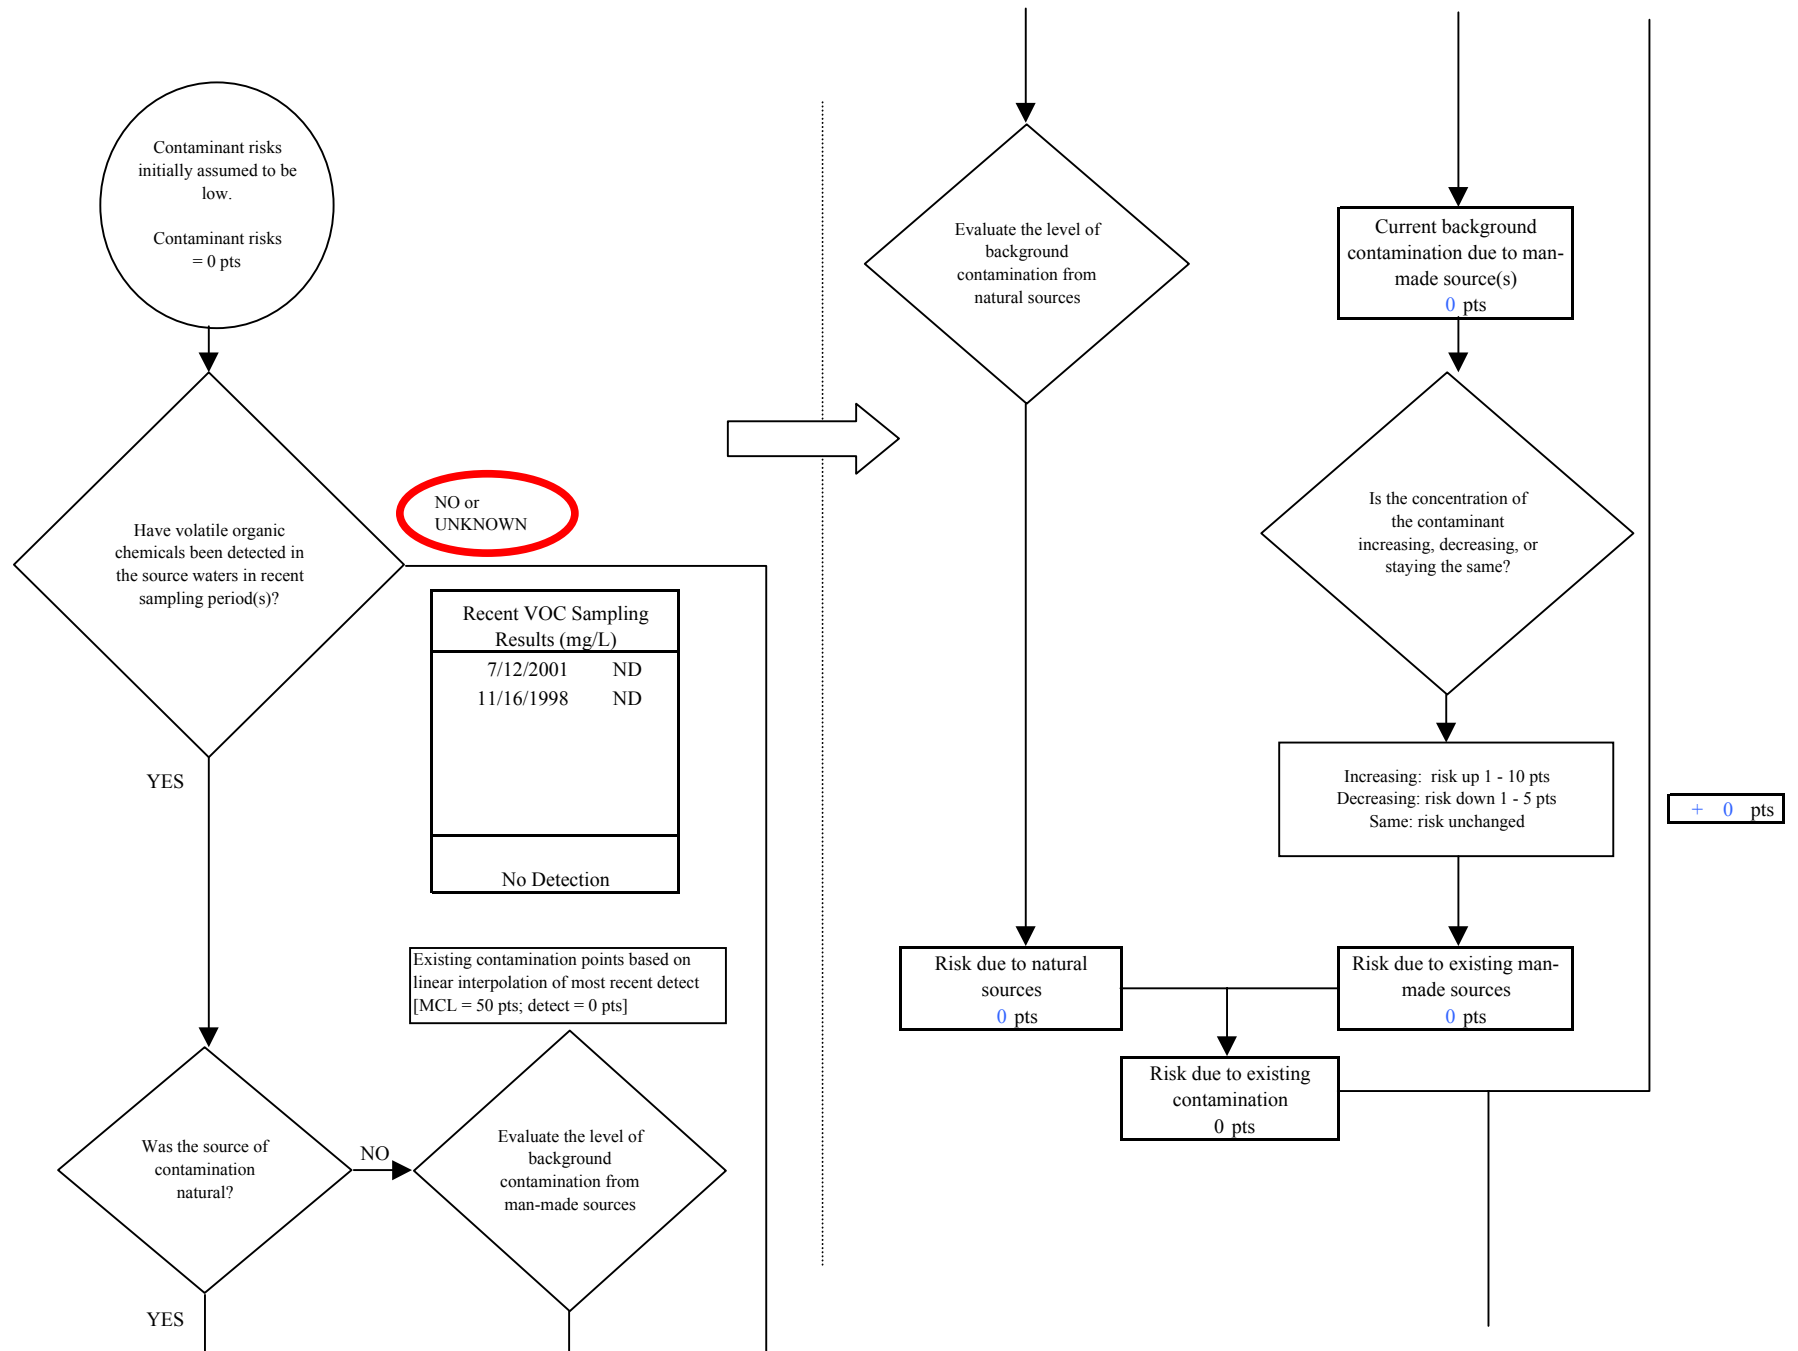


Chart 7. Contaminant risks for Iris Circle - Volatile Organic Chemicals

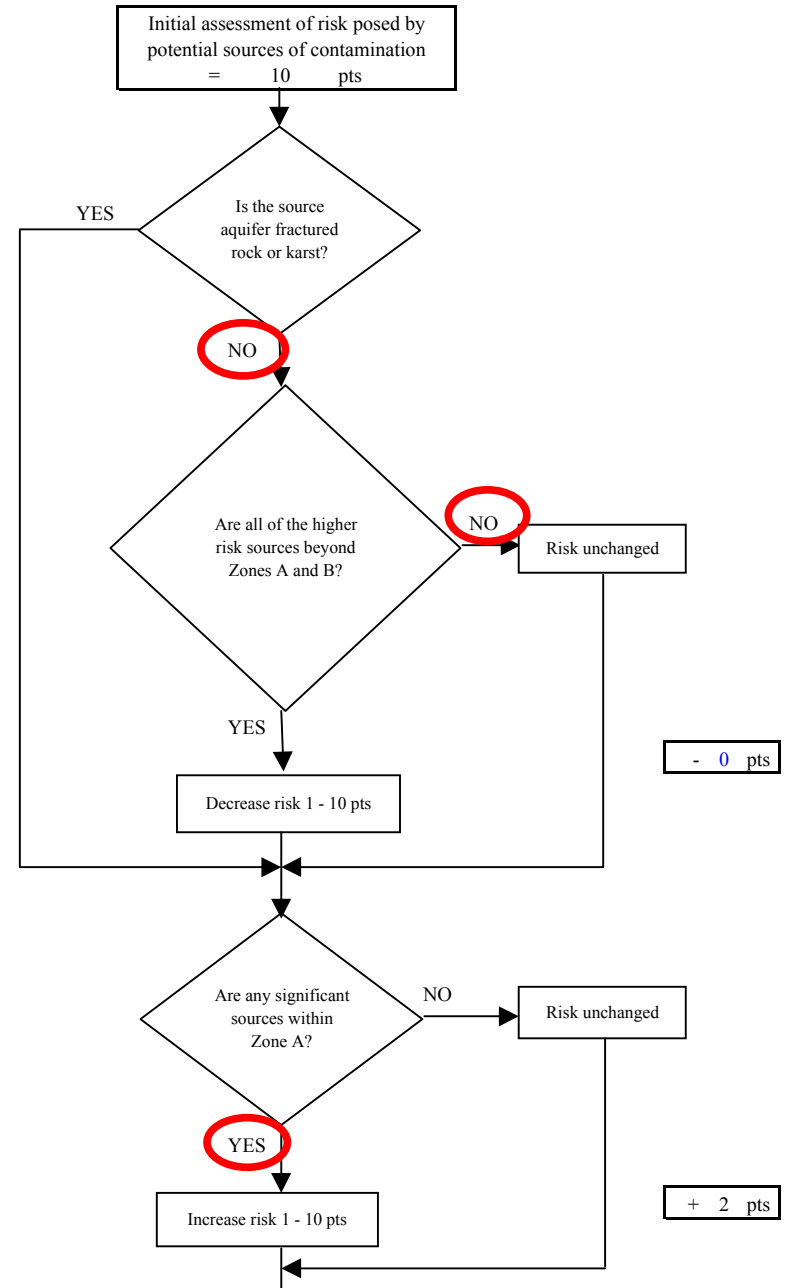
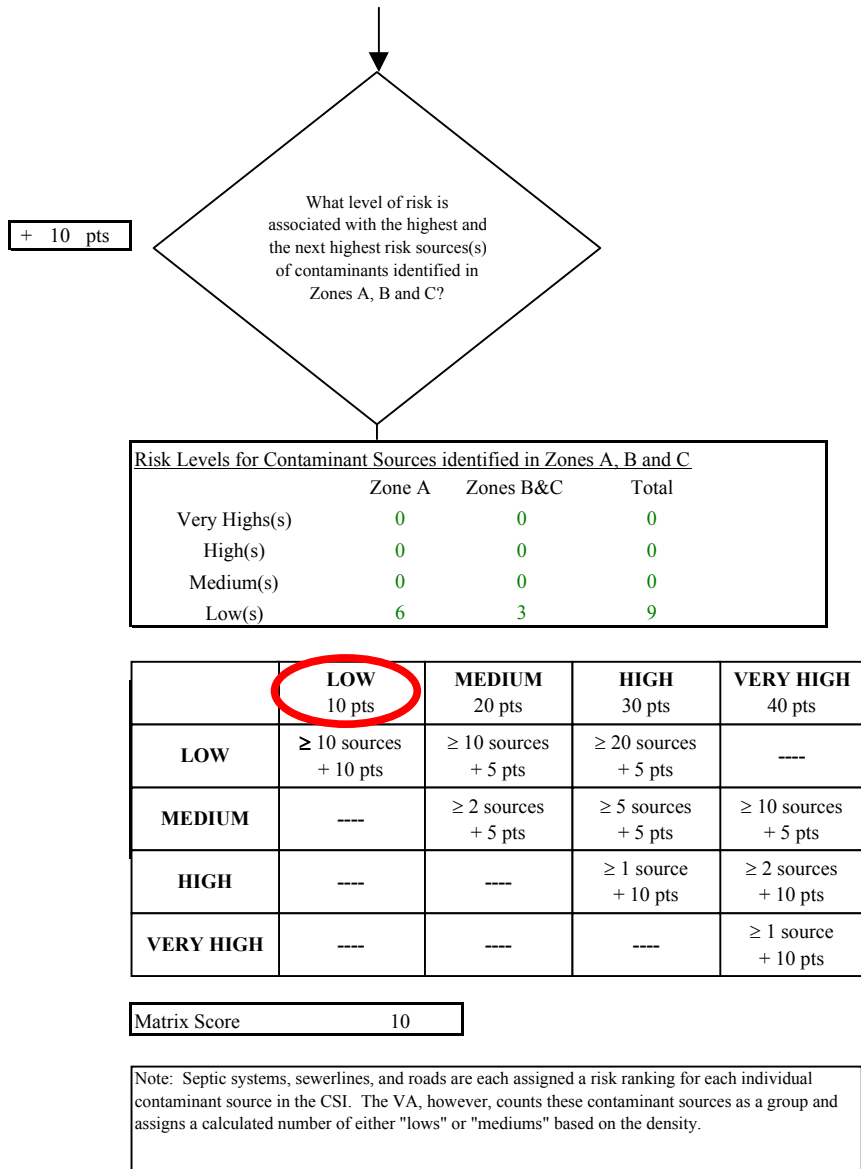


Chart 7. Contaminant risks for Iris Circle - Volatile Organic Chemicals

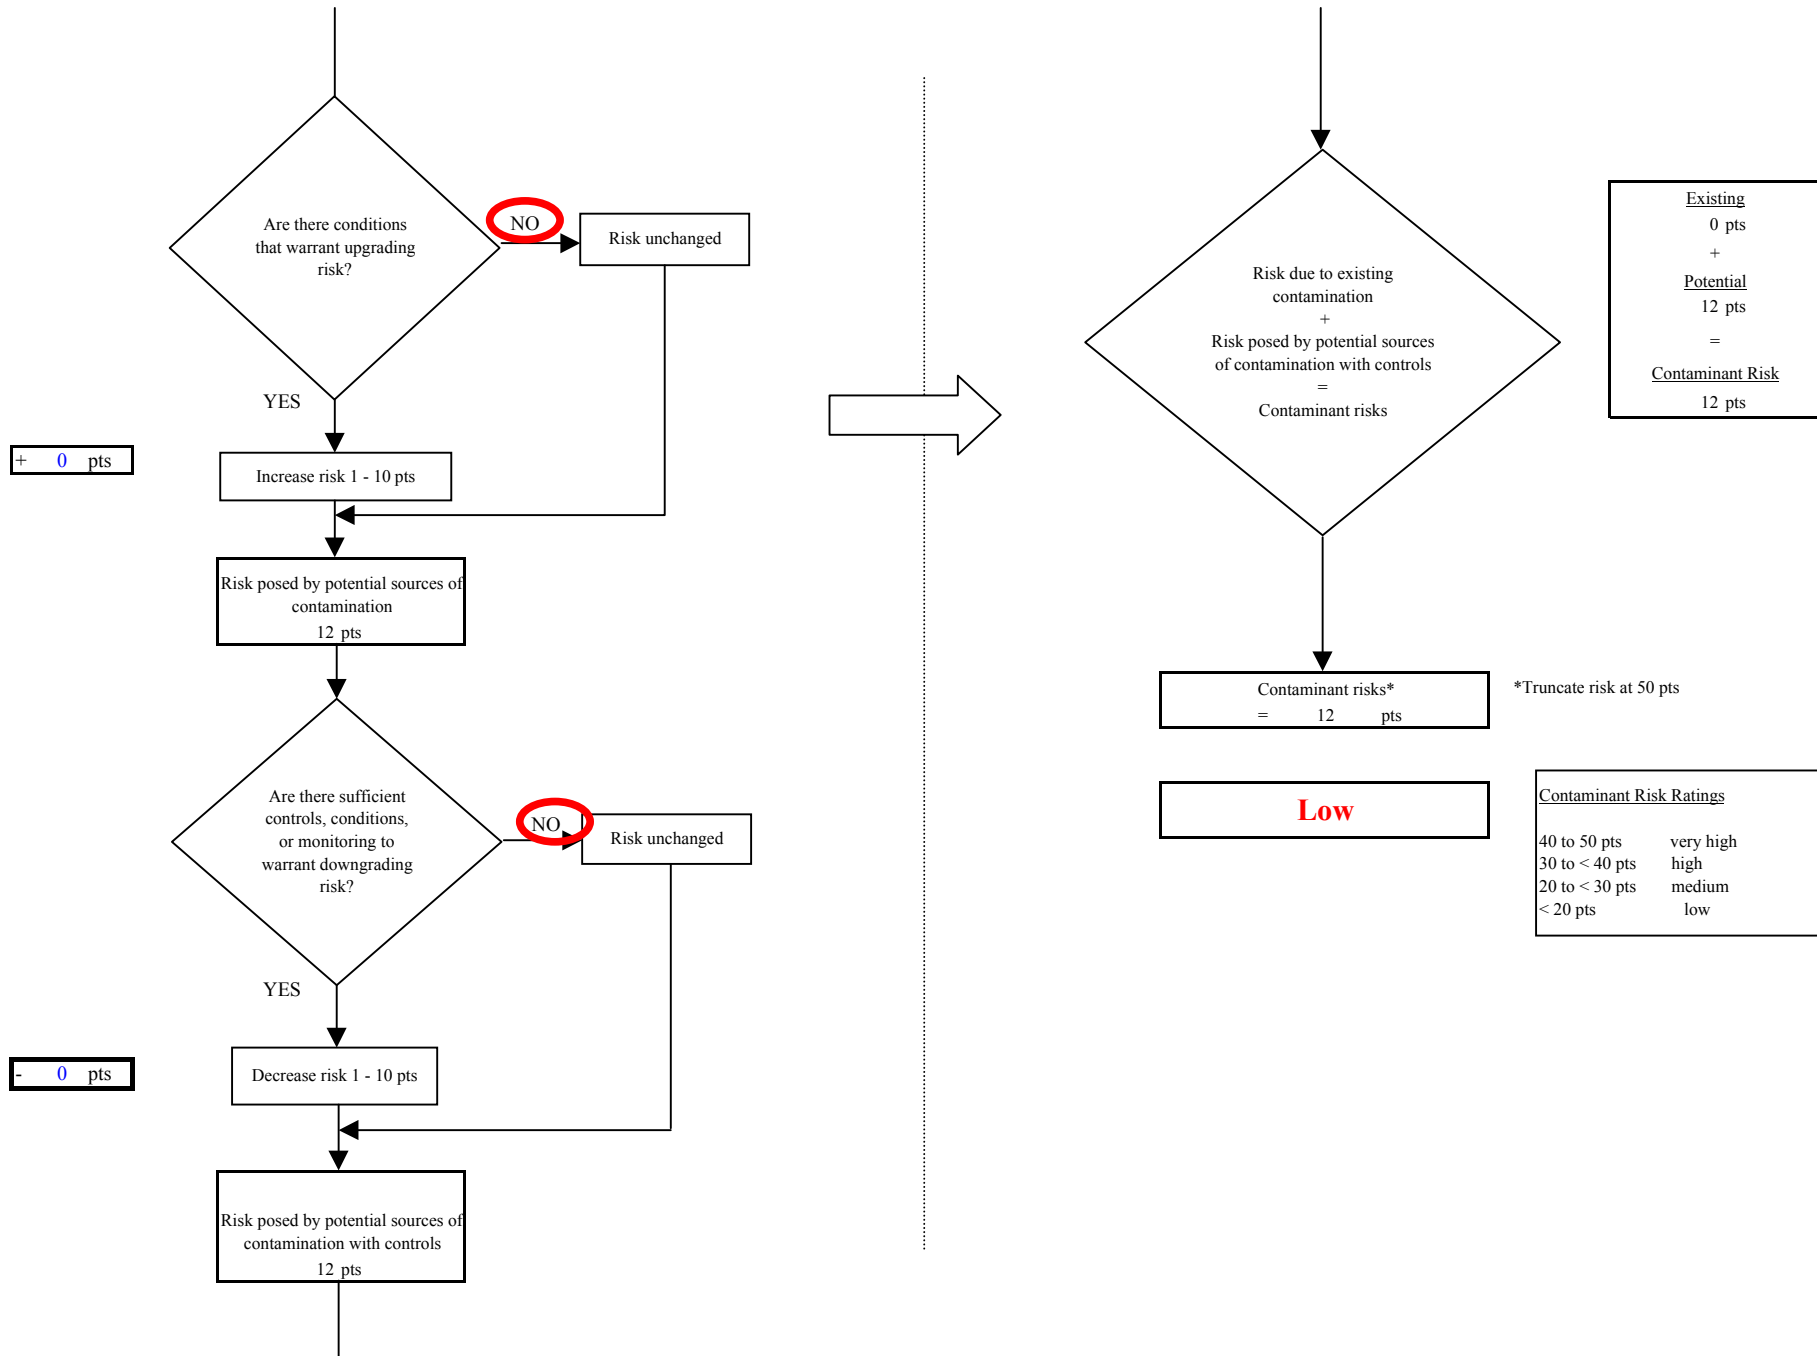


Chart 8. Vulnerability analysis for Iris Circle - Volatile Organic Chemicals

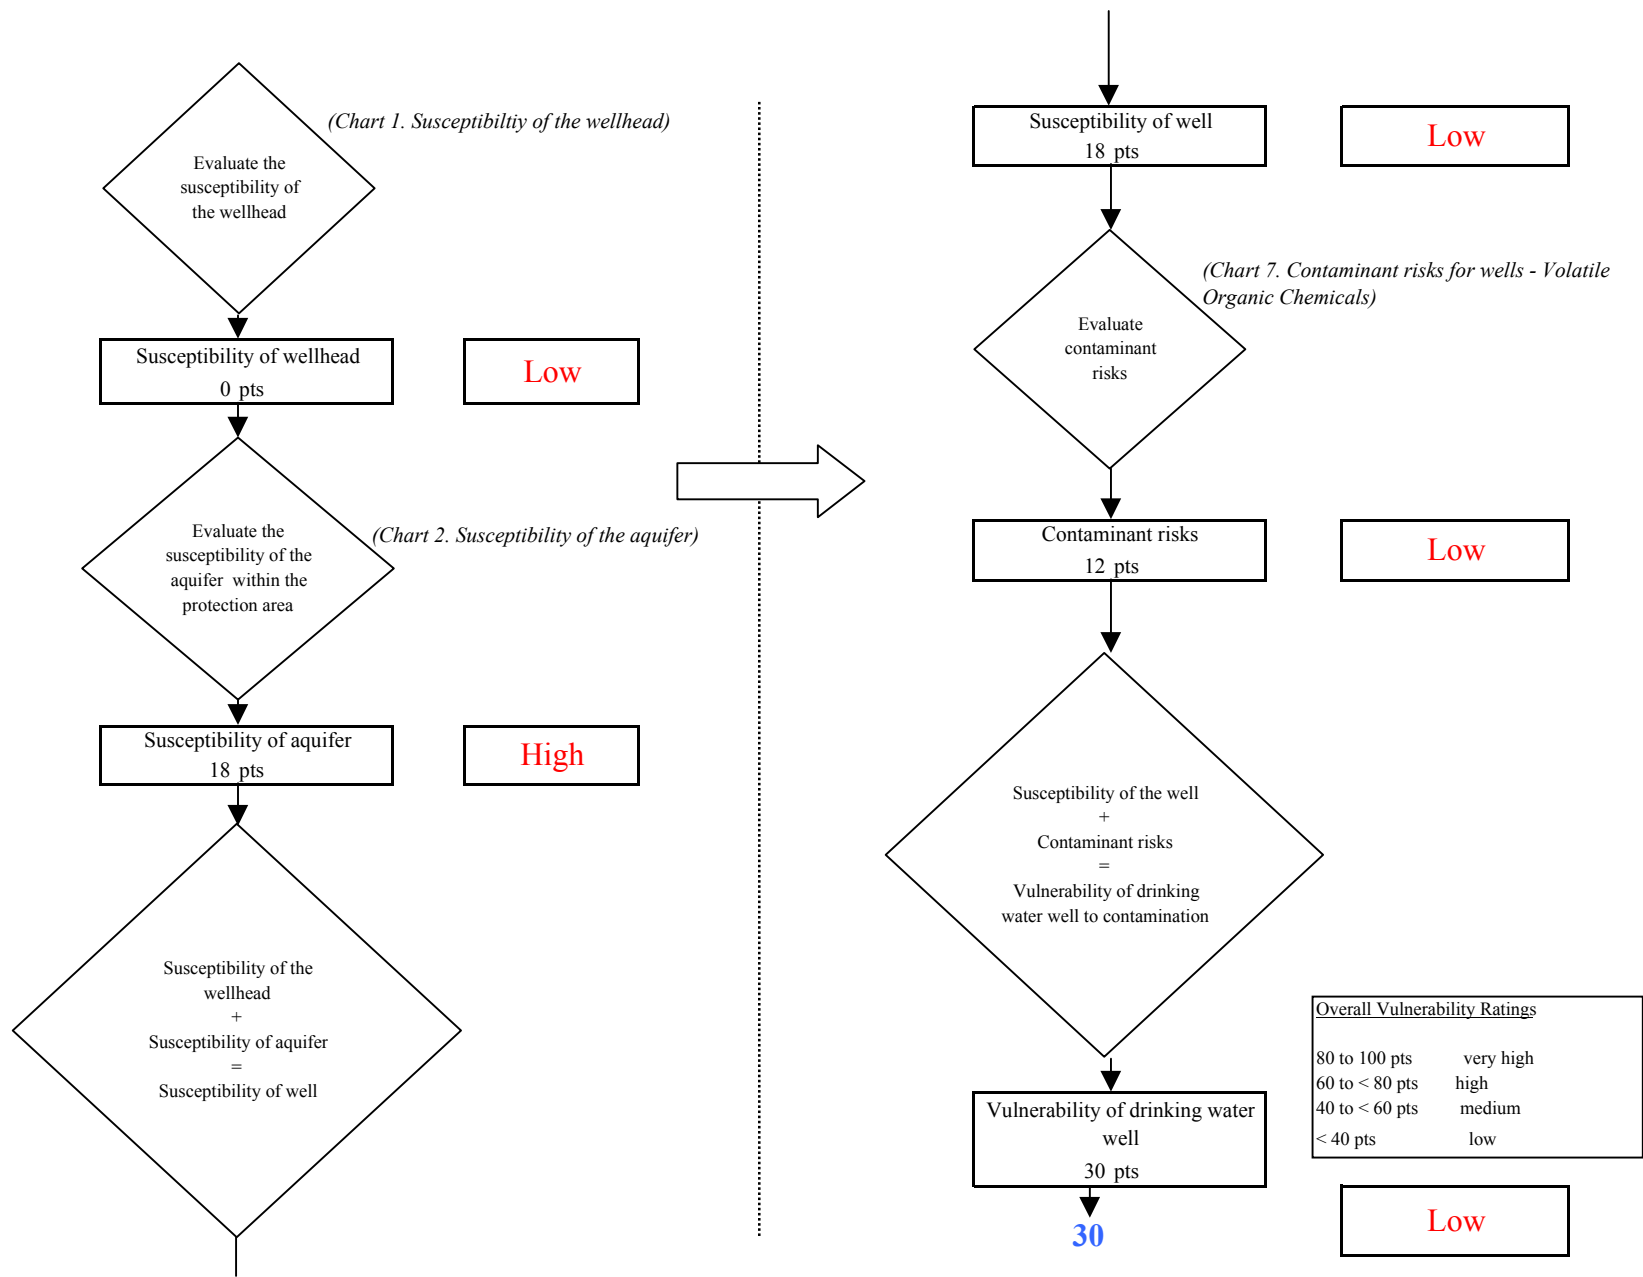


Chart 9. Contaminant risks for Iris Circle - Heavy Metals, Cyanide and Other Inorganic Chemicals



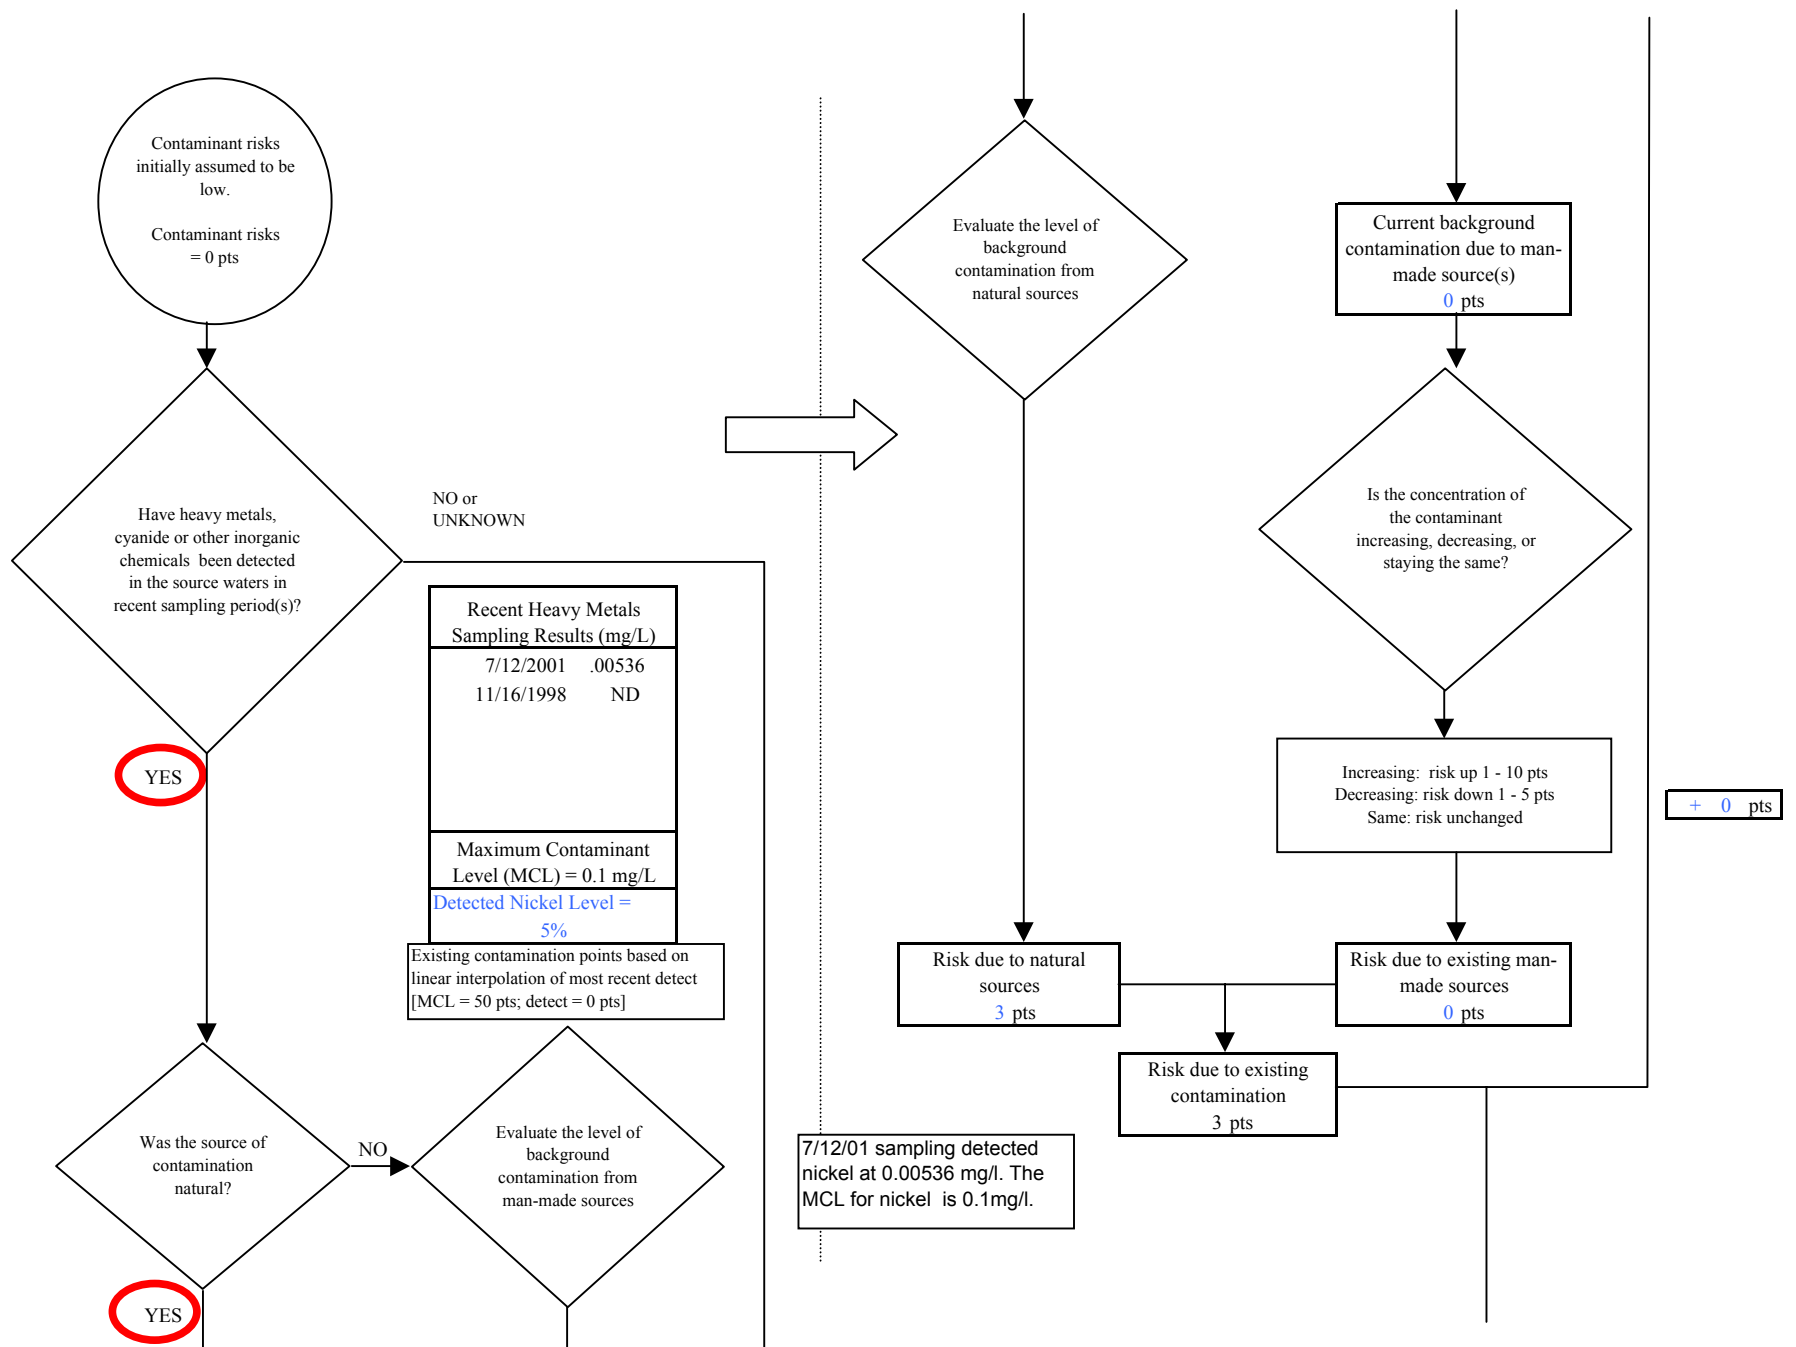


Chart 9. Contaminant risks for Iris Circle - Heavy Metals, Cyanide and Other Inorganic Chemicals

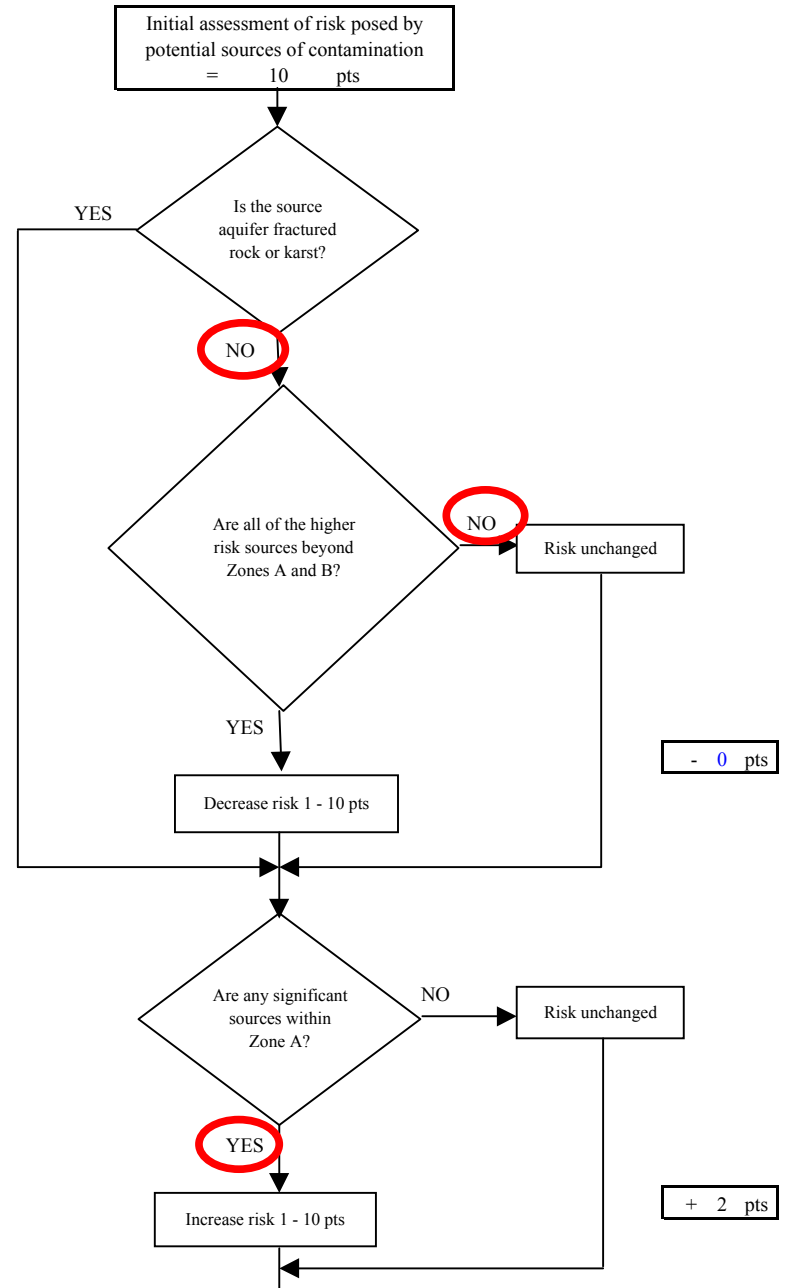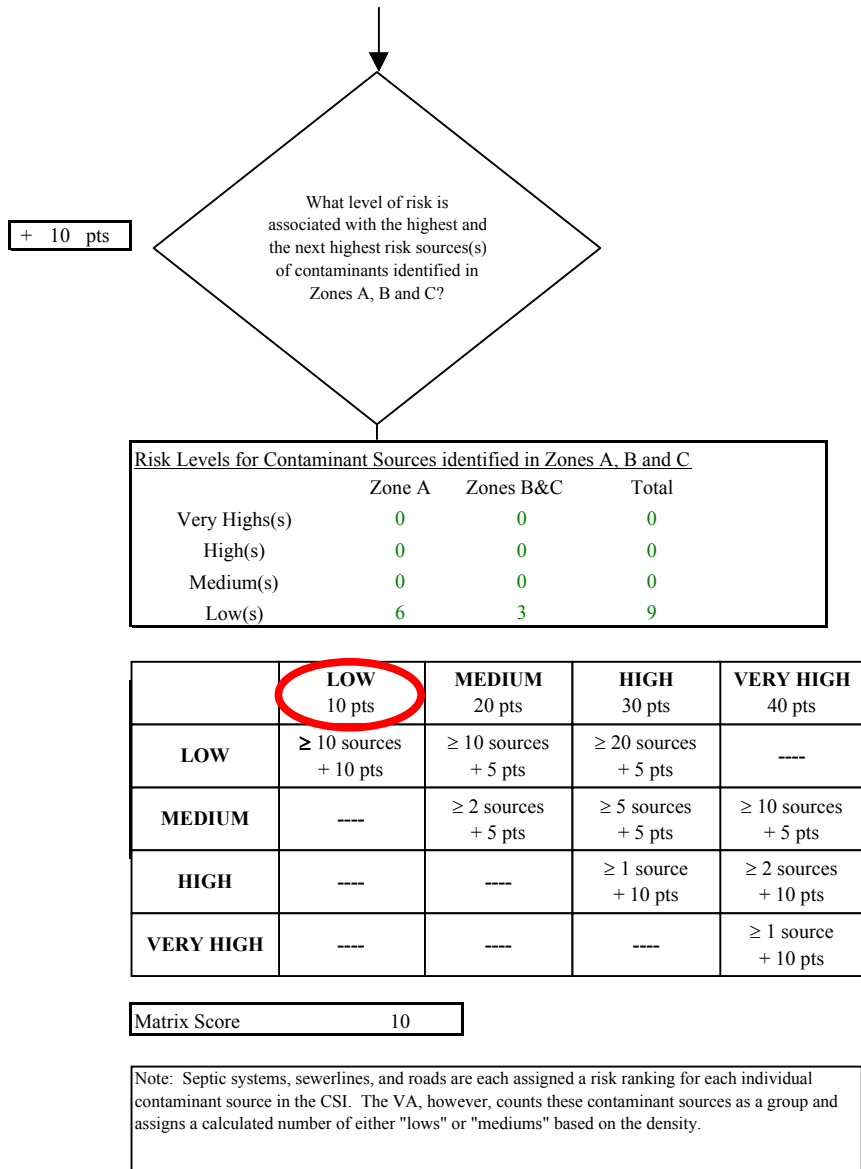

Are all of the higher risk sources beyond Zones A and B?

NO

Risk unchanged

Decrease risk 1 - 10 pts

- 0 pts

Are any significant sources within Zone A?

NO

Risk unchanged

YES

+

+ 2 pts

Increase risk 1 - 10 pts

+

+ 2 pts

Chart 9. Contaminant risks for Iris Circle - Heavy Metals, Cyanide and Other Inorganic Chemicals

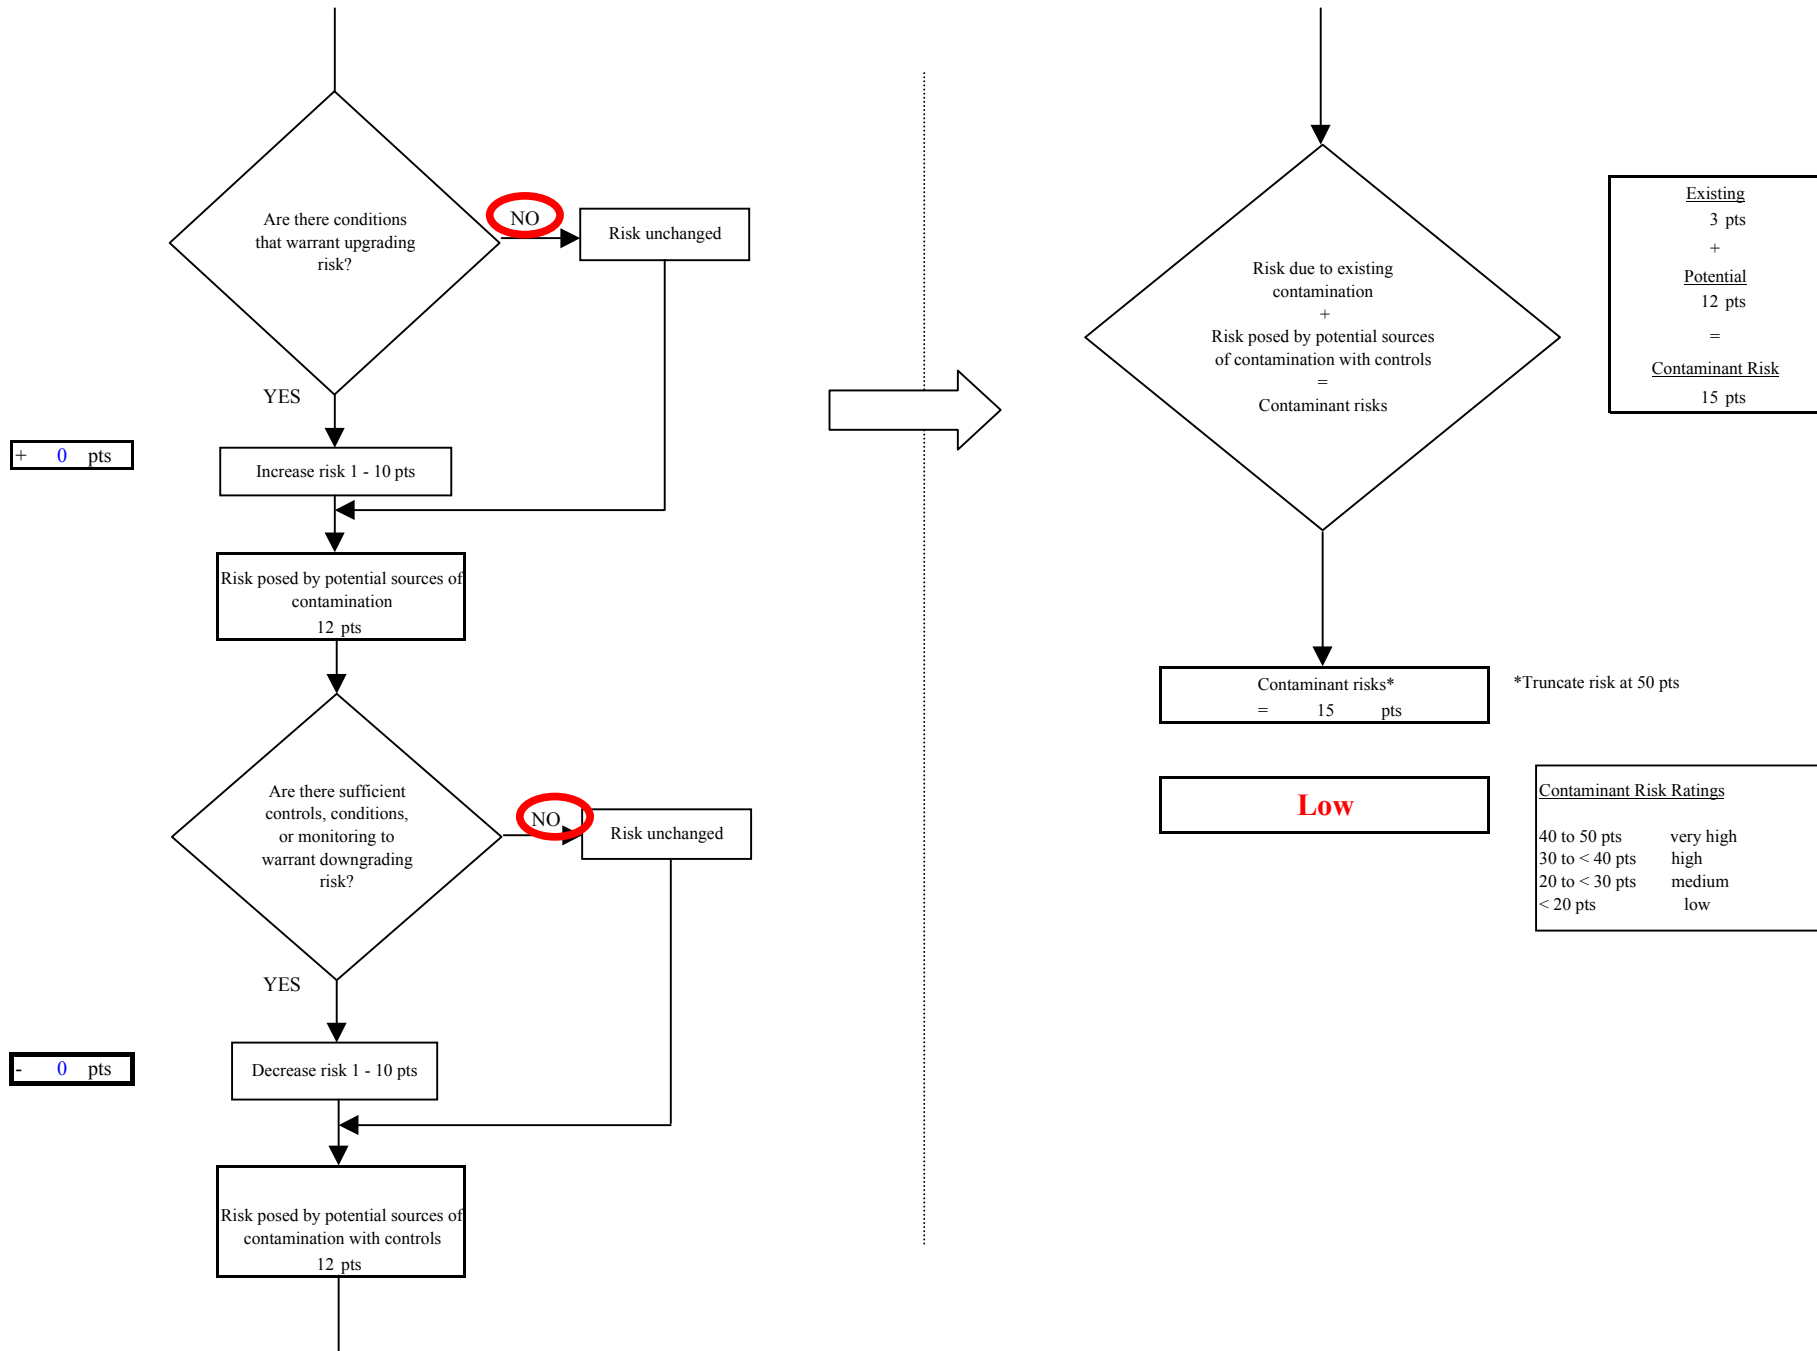


Chart 10. Vulnerability analysis for Iris Circle - Heavy Metals, Cyanide and Other Inorganic Chemicals

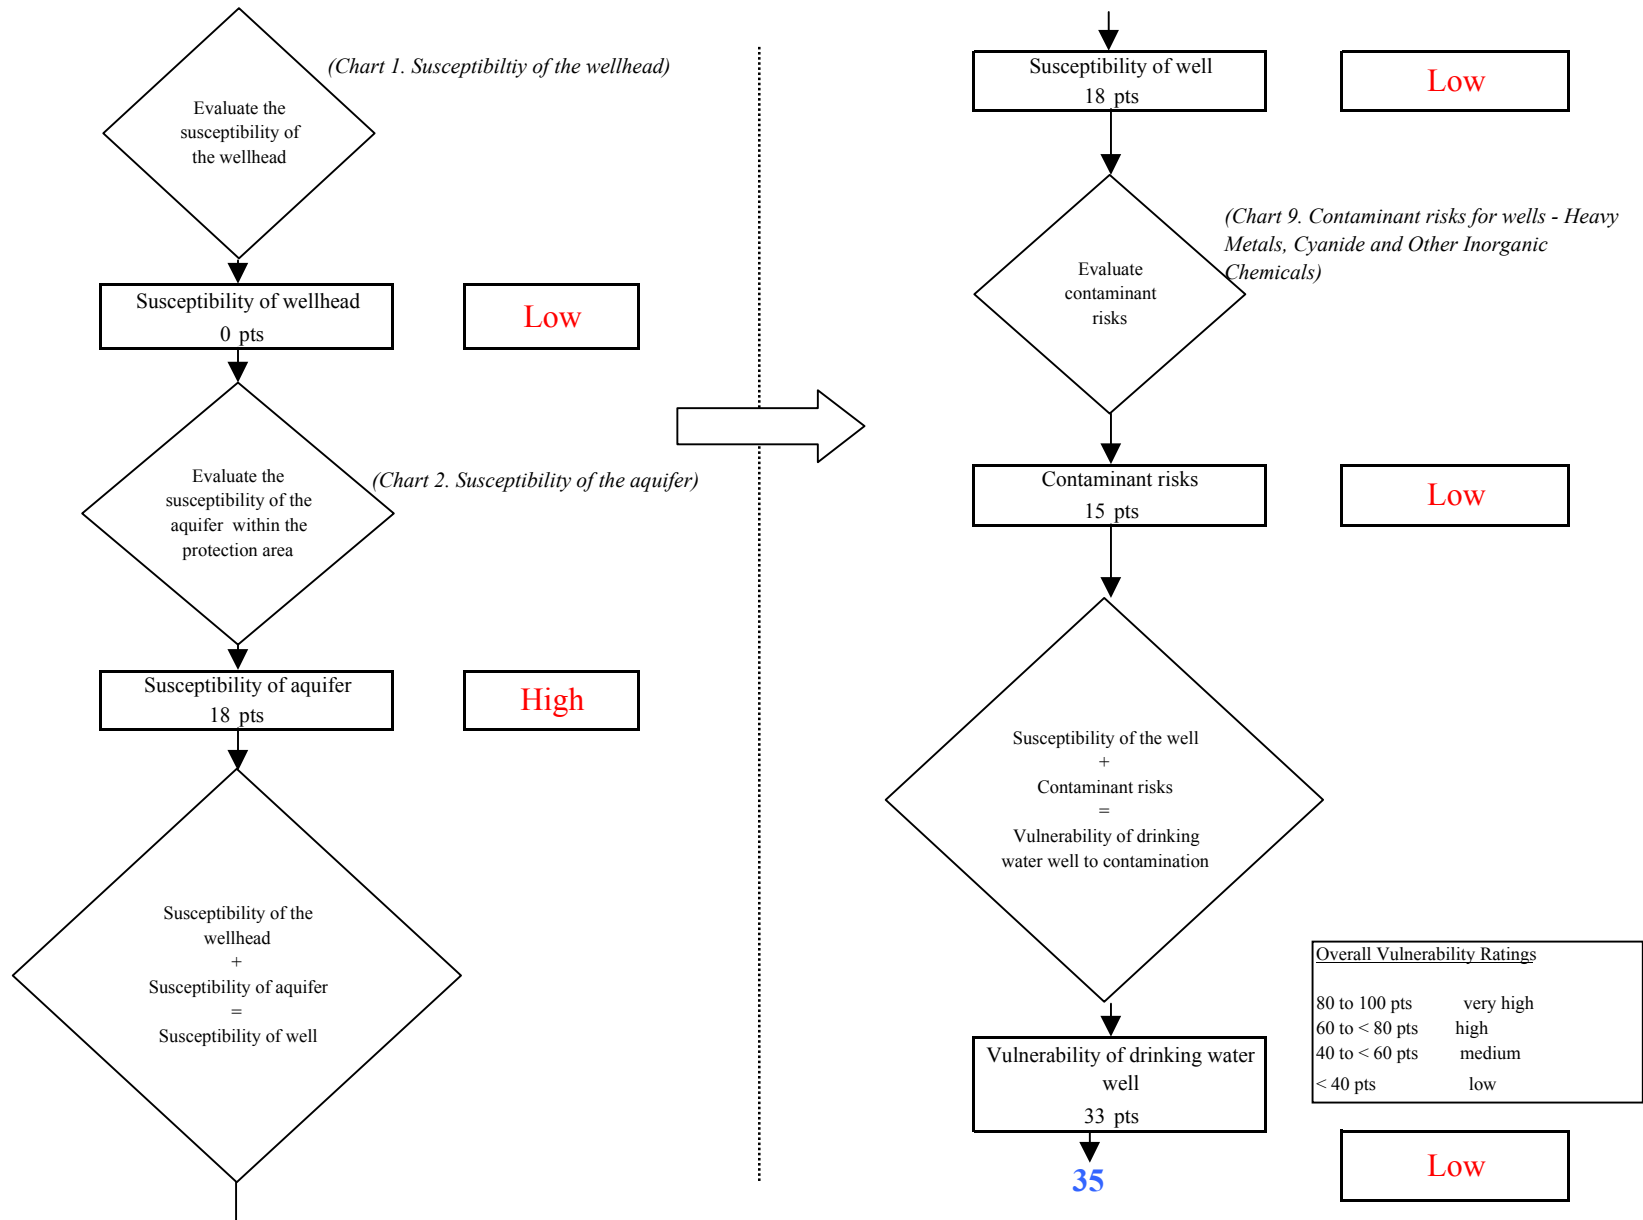


Chart 11. Contaminant risks for Iris Circle - Synthetic Organic Chemicals

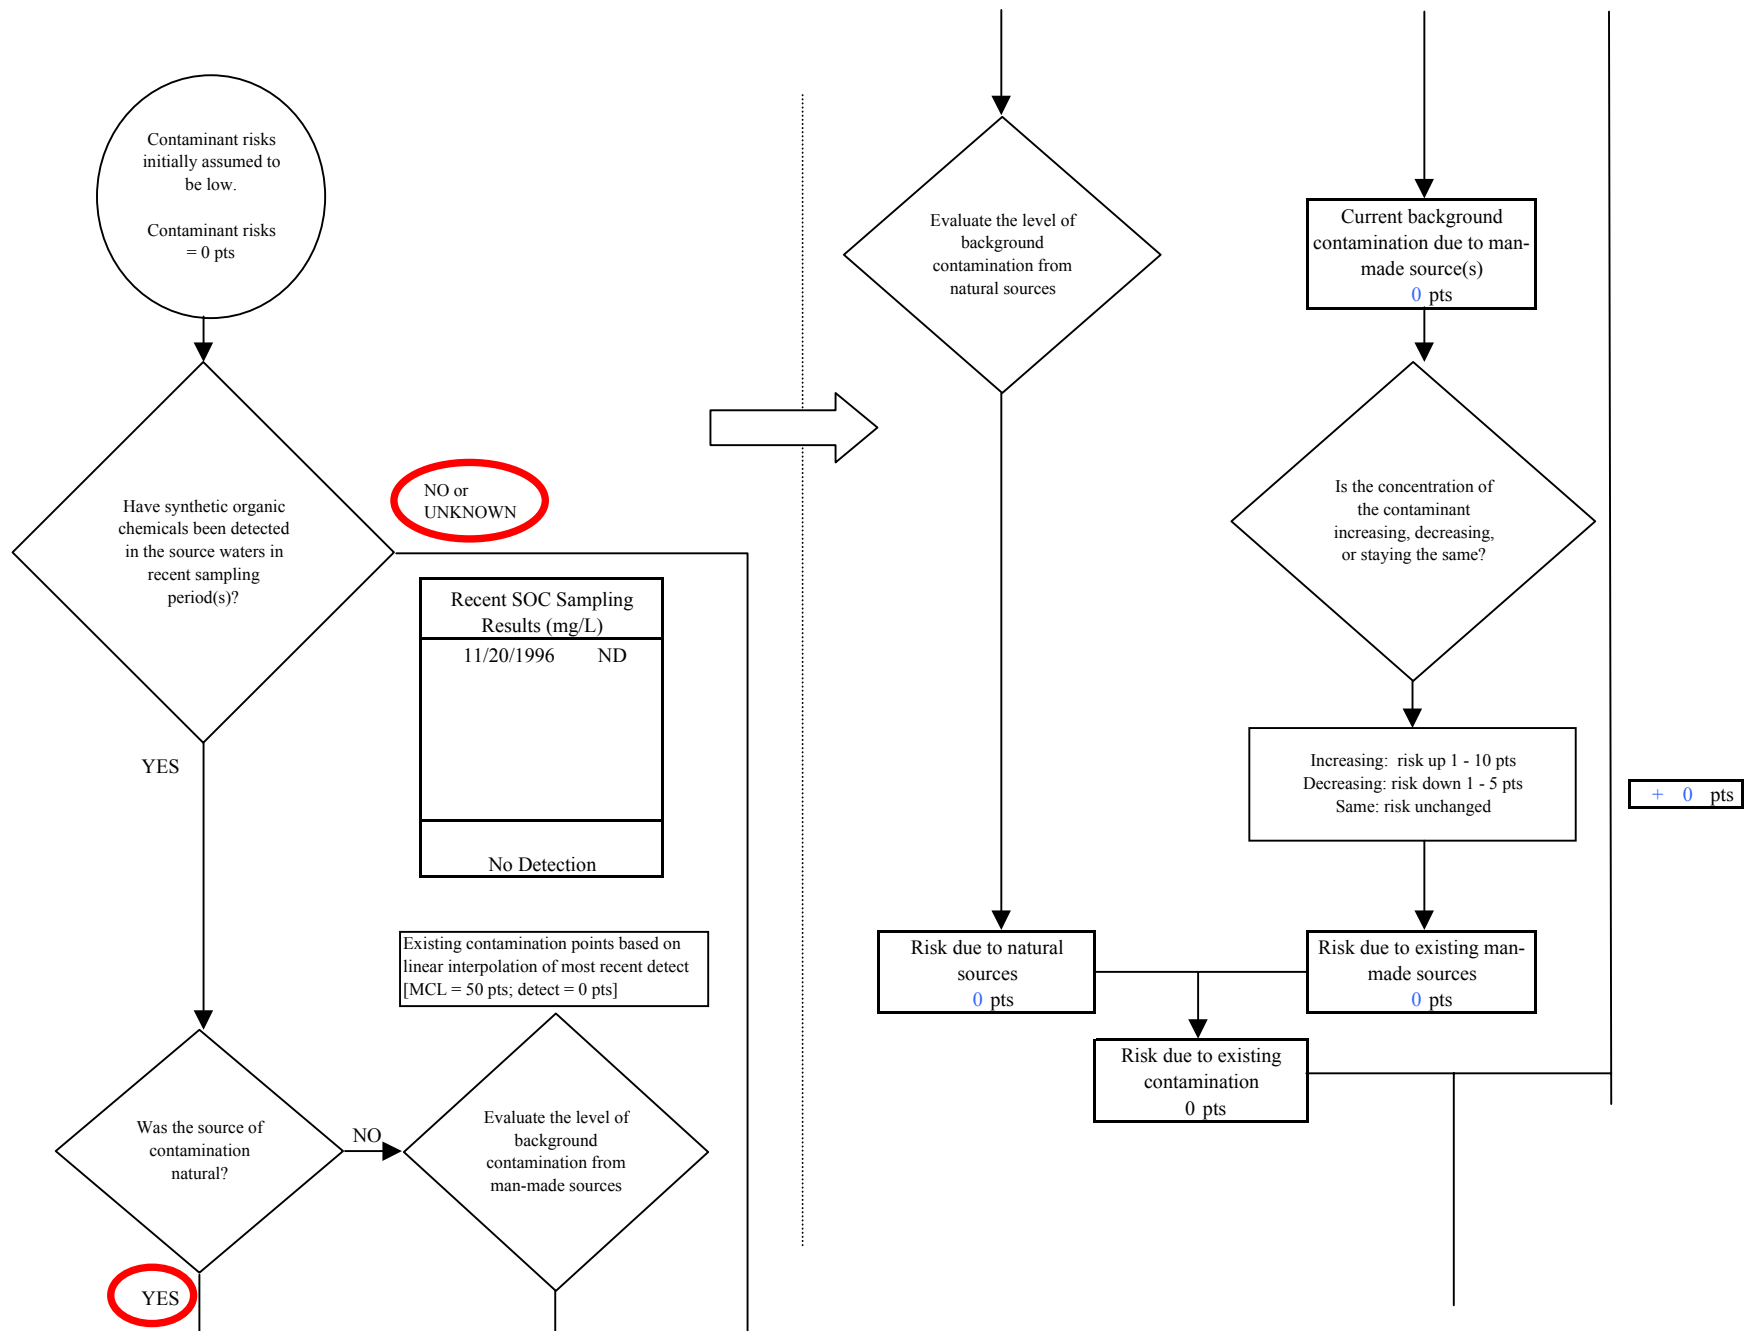


Chart 11. Contaminant risks for Iris Circle - Synthetic Organic Chemicals

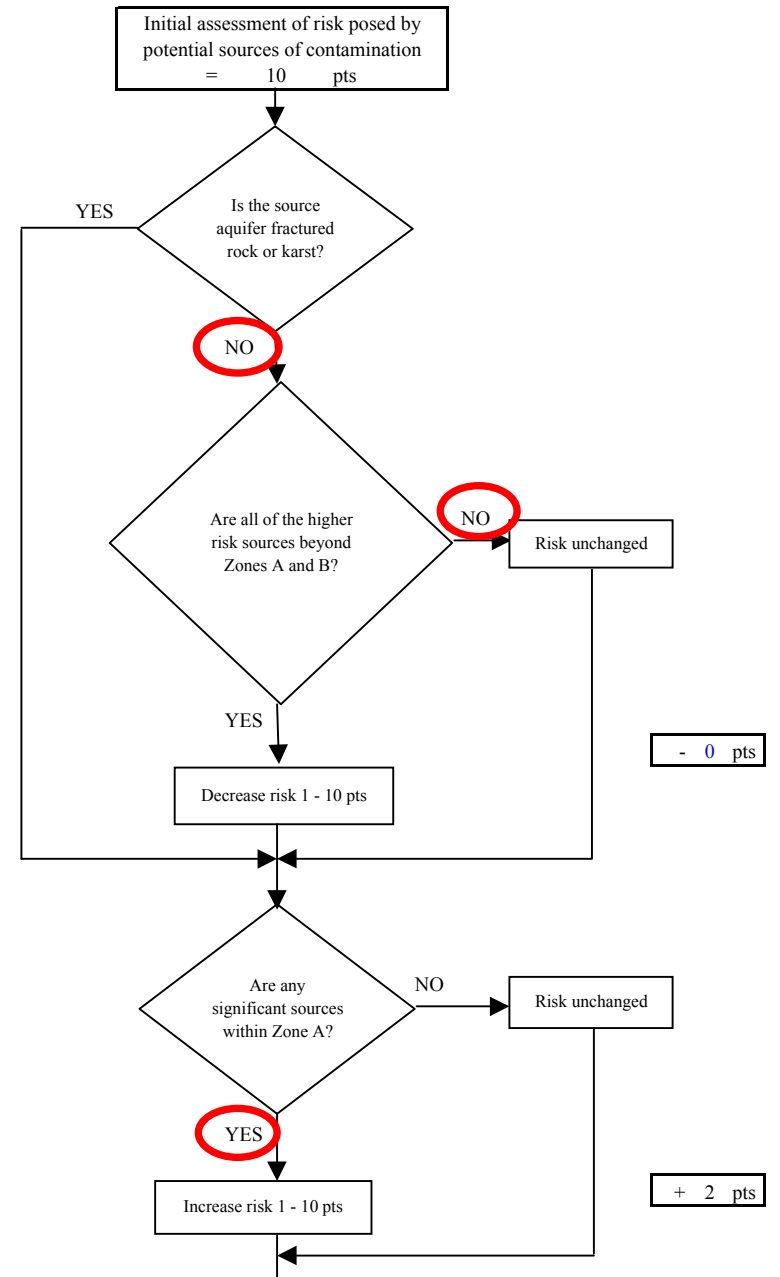
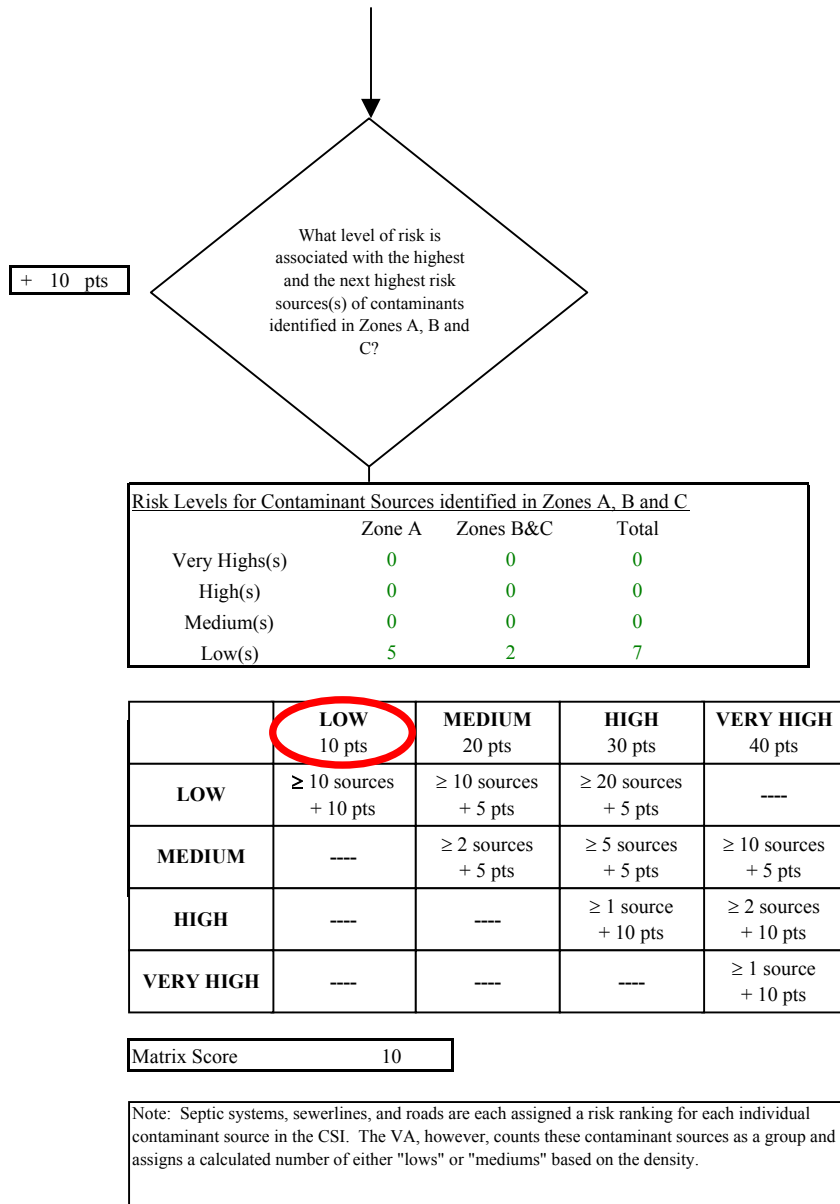


Chart 11. Contaminant risks for Iris Circle - Synthetic Organic Chemicals

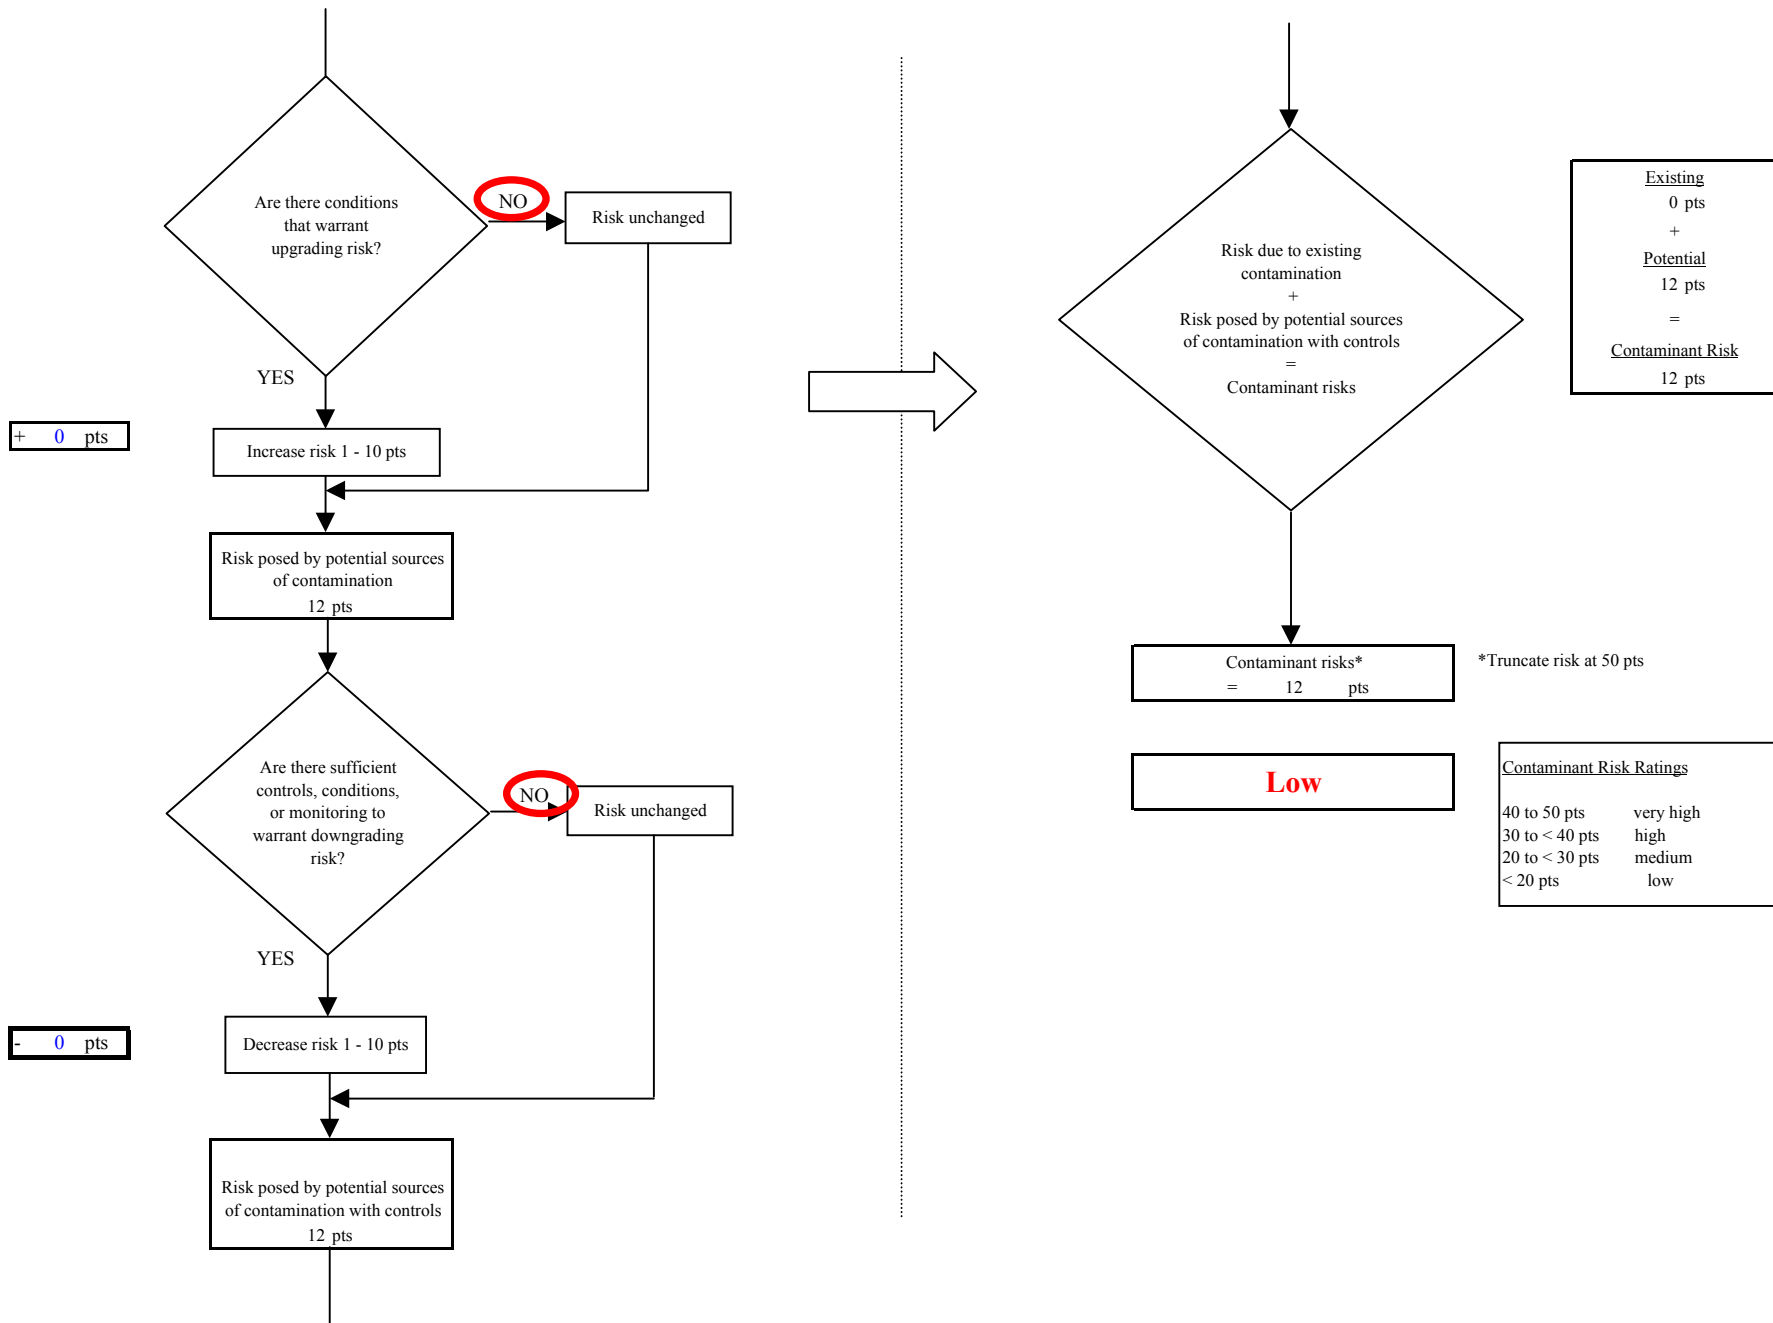


Chart 12. Vulnerability analysis for Iris Circle - Synthetic Organic Chemicals

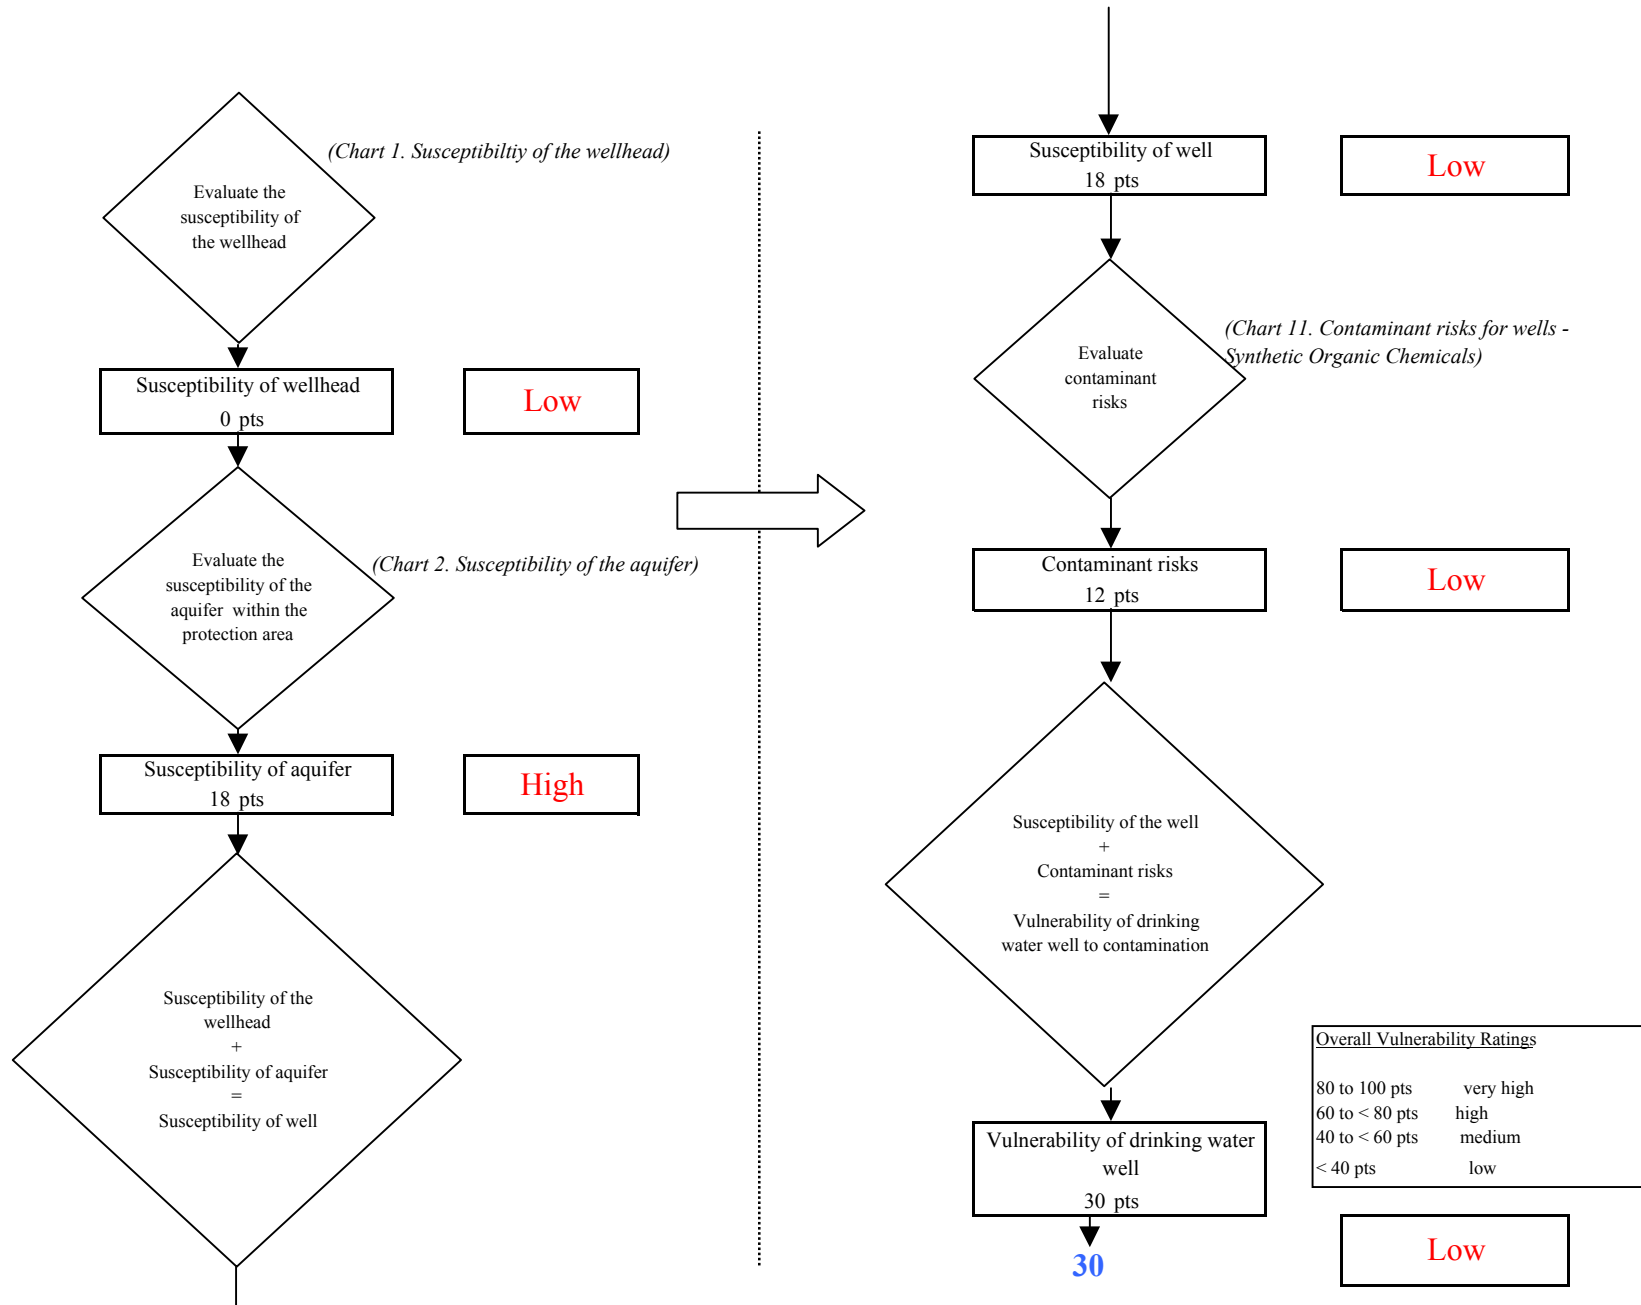


Chart 13. Contaminant risks for Iris Circle - Other Organic Chemicals

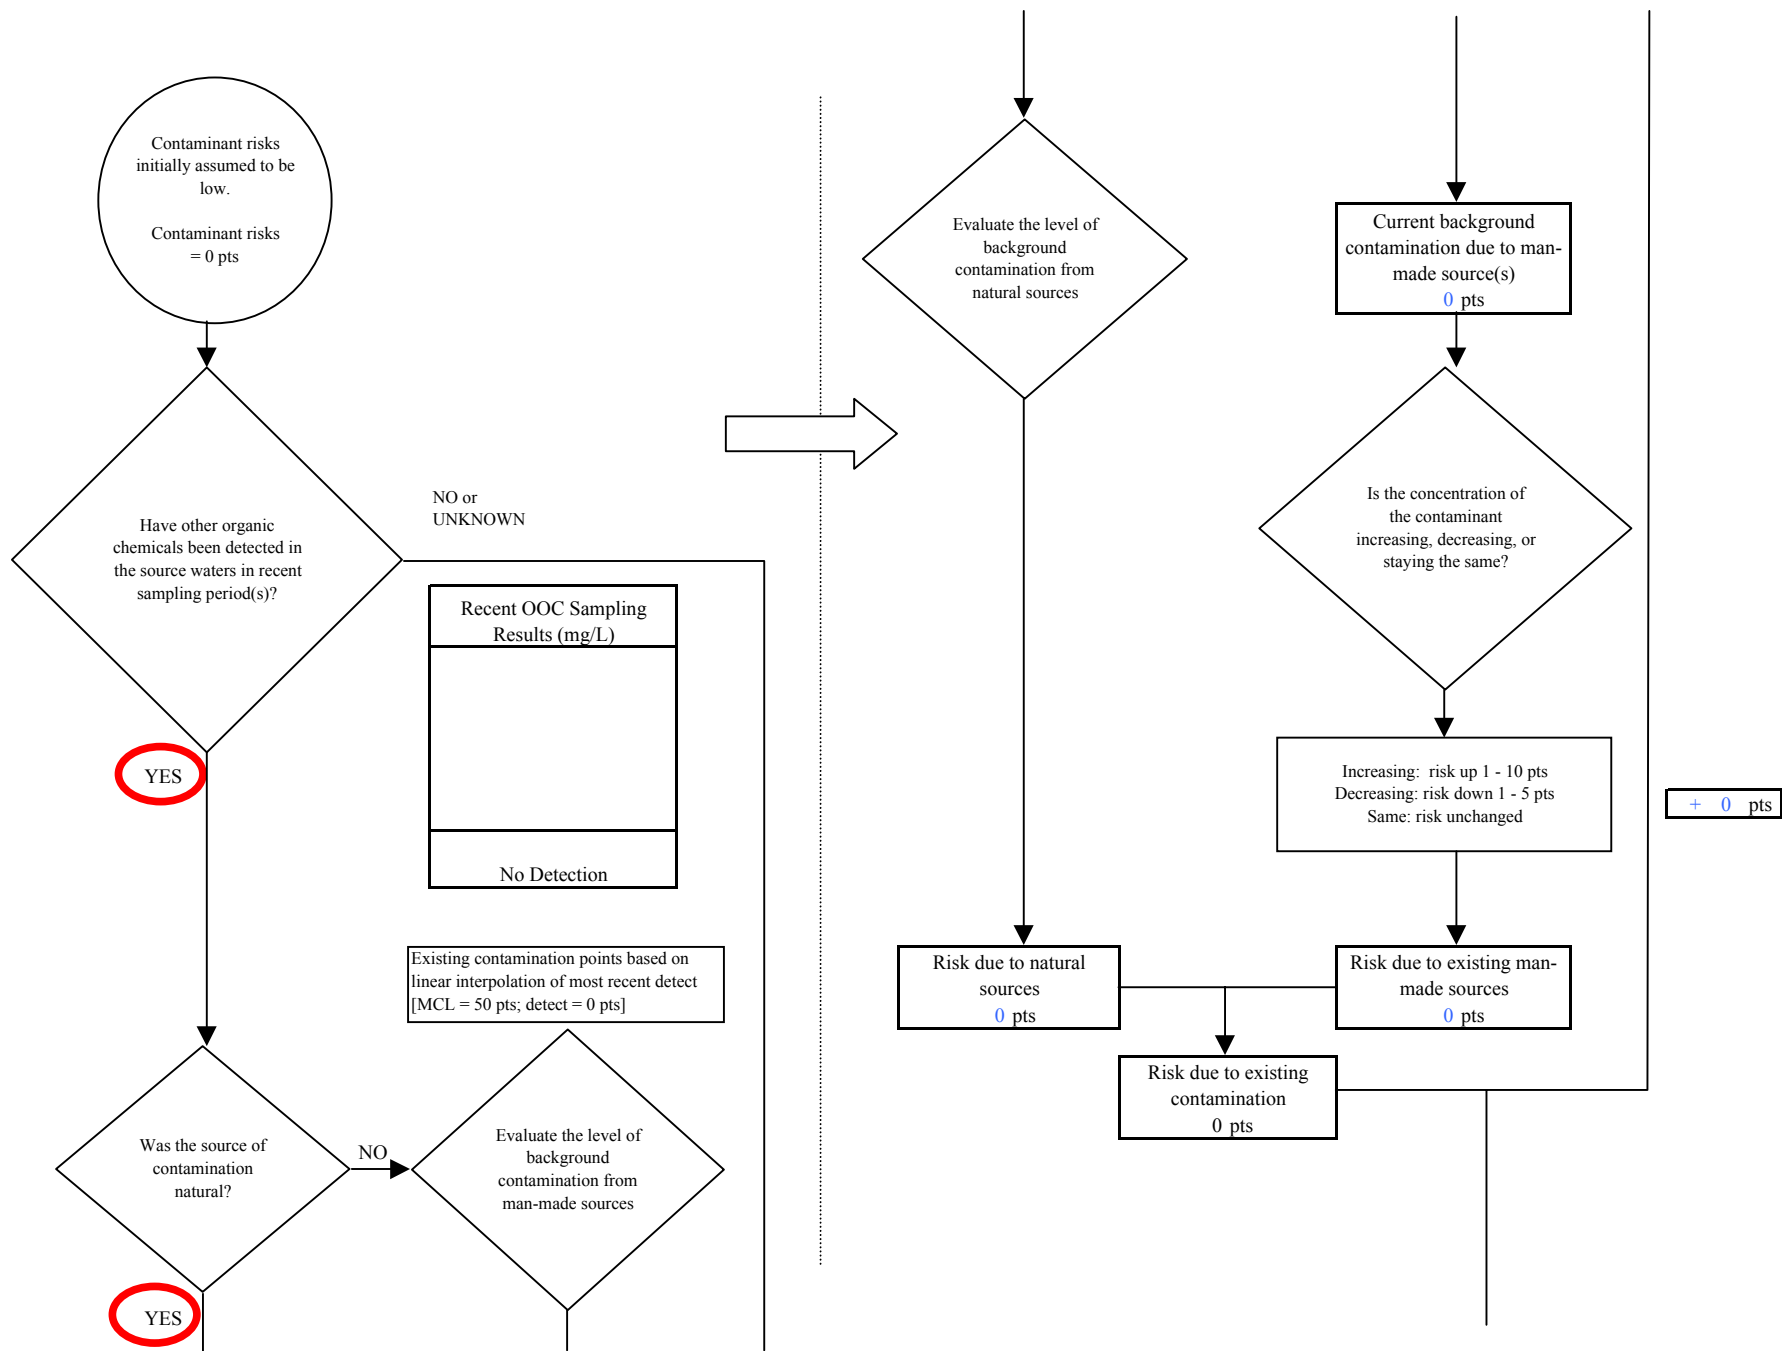


Chart 13. Contaminant risks for Iris Circle - Other Organic Chemicals

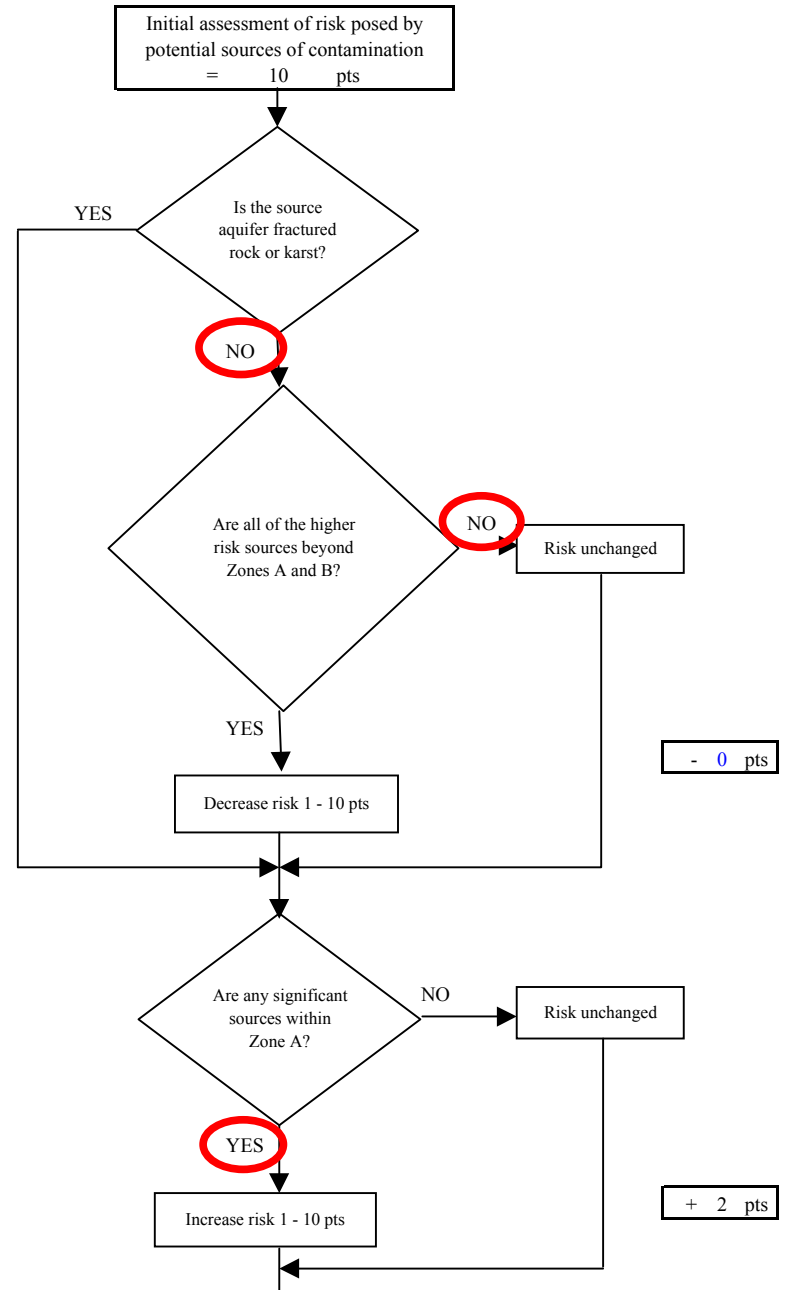
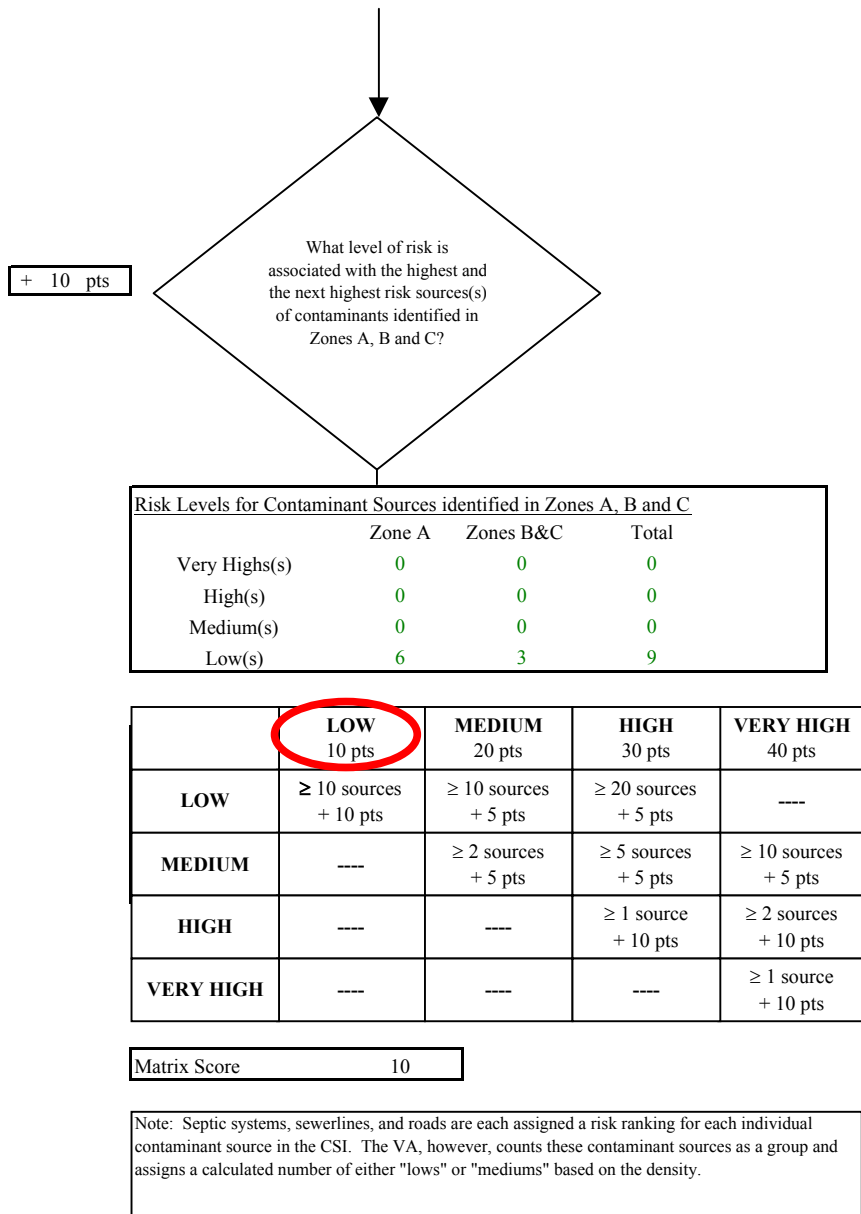


Chart 13. Contaminant risks for Iris Circle - Other Organic Chemicals

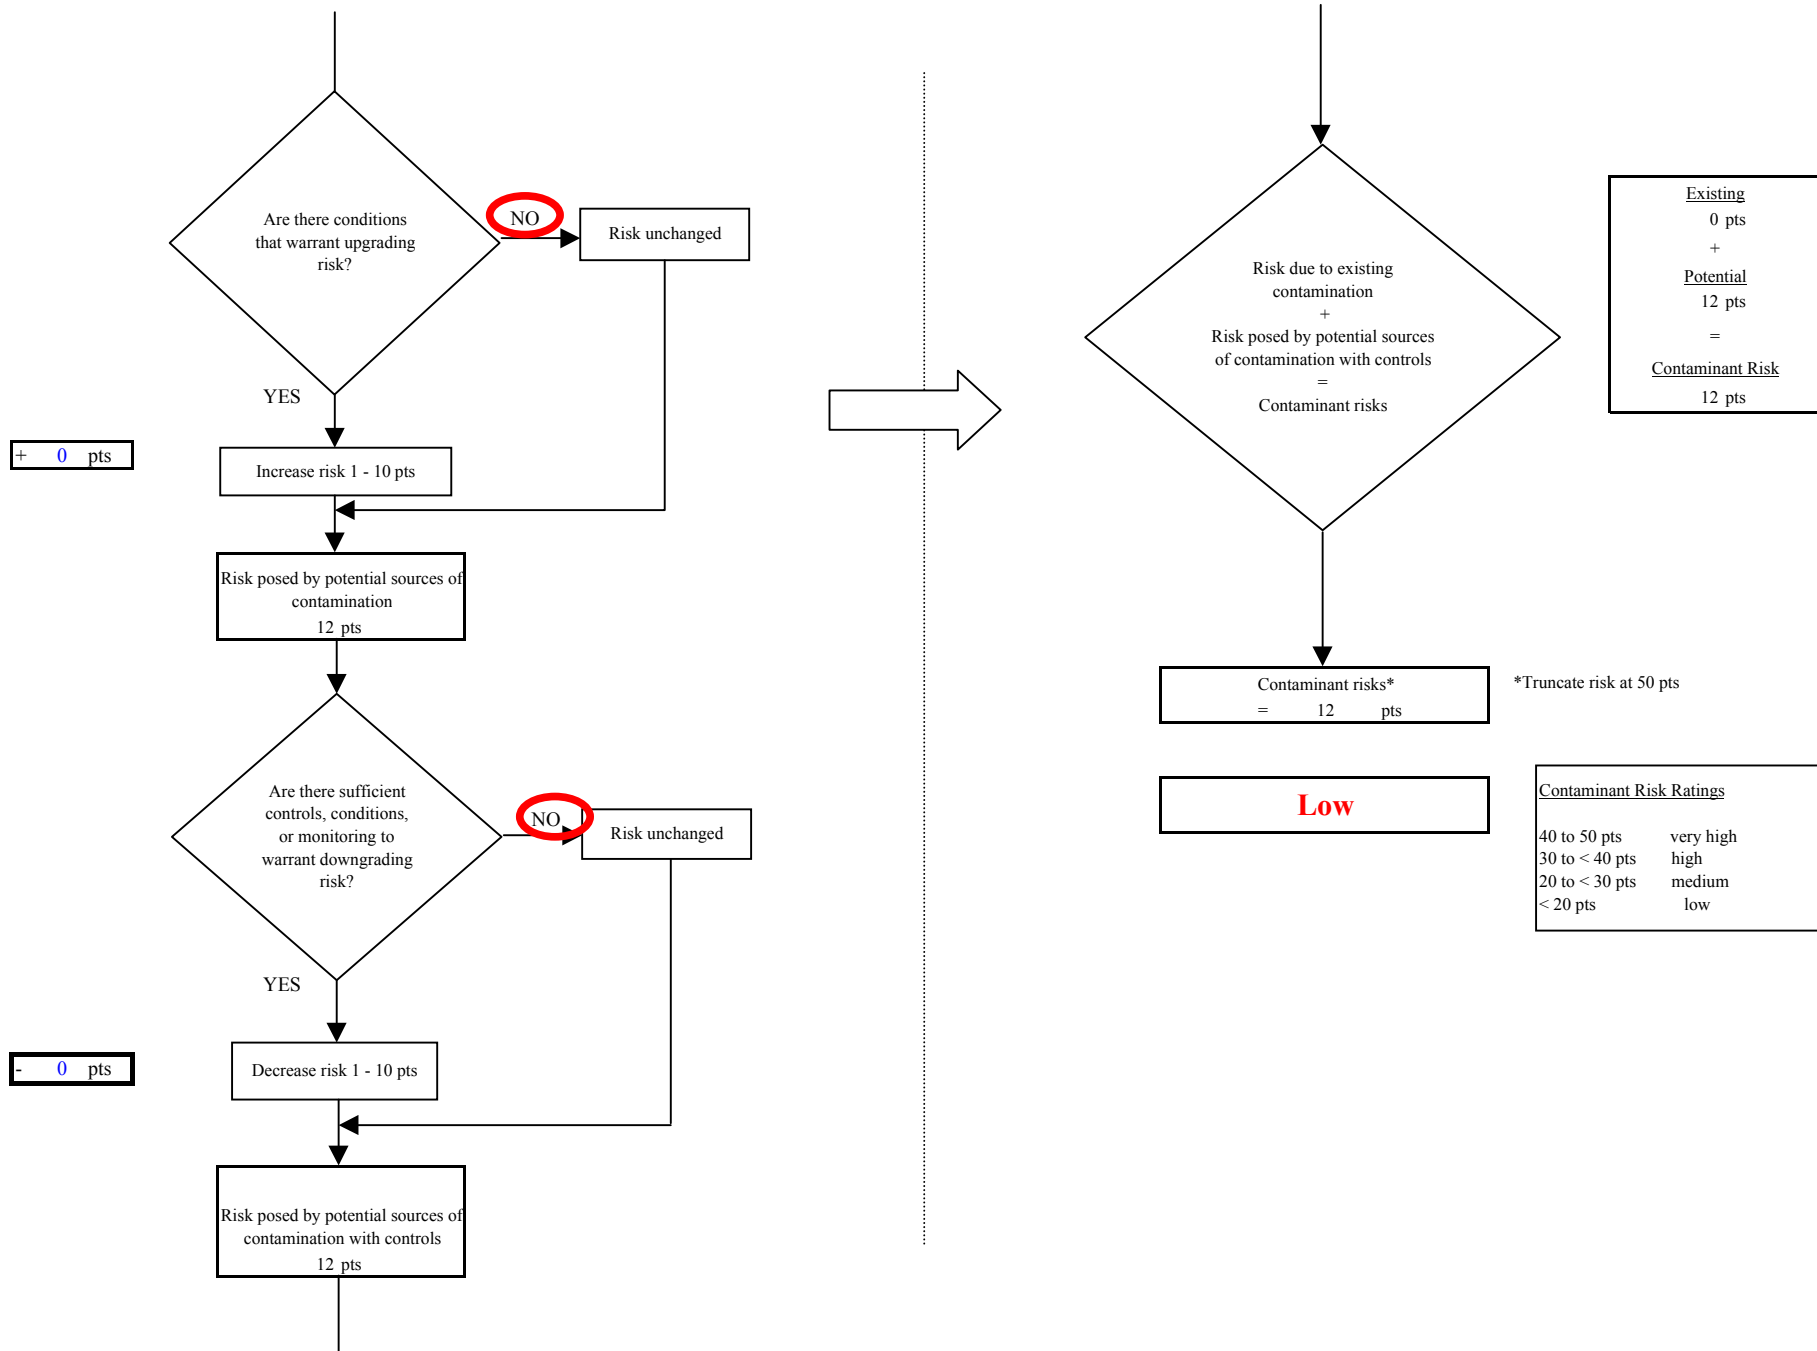


Chart 14. Vulnerability analysis for Iris Circle - Other Organic Chemicals

