

---

# Source Water Assessment

A Hydrogeologic Susceptibility and  
Vulnerability Assessment for  
the Copper River School District  
Slana School  
Drinking Water System,  
Slana, Alaska

PWSID # 381503.001

June 2004

DRINKING WATER PROTECTION PROGRAM REPORT 1402  
Alaska Department of Environmental Conservation

Source Water Assessment for  
the Copper River School District  
Slana School  
Drinking Water System  
Slana, Alaska

PWSID # 381503.001

DRINKING WATER PROTECTION PROGRAM REPORT 1402

The Drinking Water Protection Program (DWPP) is producing Source Water Assessments in compliance with the Safe Drinking Water Act Amendments of 1996. Each assessment includes a delineation of the source water area, an inventory of potential and existing contaminant sources that may impact the water, a risk ranking for each of these contaminants, and an evaluation of the potential vulnerability of these drinking water sources.

These assessments are intended to provide public water systems owners/operators, communities, and local governments with the best available information that may be used to protect the quality of their drinking water. The assessments combine information obtained from various sources, including the U.S. Environmental Protection Agency, Alaska Department of Environmental Conservation (ADEC), public water system owners/operators, and other public information sources. The results of this assessment are subject to change if additional data becomes available. It is anticipated this assessment will be updated every five years to reflect any changes in the vulnerability and/or susceptibility of public drinking water source. If you have any additional information that may affect the results of this assessment, please contact the Program Coordinator of DWPP, (907) 269-7521.

## CONTENTS

EXECUTIVE SUMMARY .....	1	INVENTORY OF POTENTIAL AND EXISTING	
PUBLIC DRINKING WATER SYSTEM .....	1	CONTAMINANT SOURCES .....	2
DRINKING WATER PROTECTION AREA .....	2	RANKING OF CONTAMINANT RISKS .....	2
		VULNERABILITY OF DRINKING WATER	
		SYSTEM .....	3

## TABLES

Table 1. Definition of Zones .....	2
Table 2. Susceptibility .....	3
Table 3. Contaminant Risks .....	4
Table 4. Overall Vulnerability .....	4

## APPENDICES

APPENDIX	A. CRSD Slana School Public Water System Drinking Water Protection Area (Map A)
	B. Contaminant Source Inventory for CRSD Slana School Public Water System (Table 1) Contaminant Source Inventory and Risk Ranking for CRSD Slana School Public Water System – Bacteria and Viruses (Table 2) Contaminant Source Inventory and Risk Ranking for CRSD Slana School Public Water System – Nitrates/Nitrites (Table 3) Contaminant Source Inventory and Risk Ranking for CRSD Slana School Public Water System – Volatile Organic Chemicals (Table 4) Contaminant Source Inventory and Risk Ranking for CRSD Slana School Public Water System – Heavy Metals, Cyanide and Other Inorganic Chemicals (Table 5) Contaminant Source Inventory and Risk Ranking for CRSD Slana School Public Water System – Synthetic Organic Chemicals (Table 6) Contaminant Source Inventory and Risk Ranking for CRSD Slana School Public Water System – Other Organic Chemicals (Table 7)
	C. CRSD Slana School Public Water System Drinking Water Protection Area and Potential and Existing Contaminant Sources (Map C)
	D. Vulnerability Analysis for Contaminant Source Inventory and Risk Ranking for CRSD Slana School Public Water System Public Drinking Water Source (Charts 1 – 14)

# Source Water Assessment for Copper River School District, Slana School Public Water System Source of Public Drinking Water, Slana, Alaska

---

## Drinking Water Protection Program Alaska Department of Environmental Conservation

### EXECUTIVE SUMMARY

The Copper River School District (CRSD) Slana School Public Water System (PWS) has one well. The well (PWS No. 381503.001) has been used as a drinking water source since it was drilled in July of 1992.

The well is a Class A (community and non-transient non-community) water system located southwest of the School at Milepost 1 Nebesna Road in Slana, Alaska. Available records indicate that the system has two 70-gallon pressure tanks and that the drinking water source is untreated. This system operates year round and serves approximately 35 non-residents. The wellhead received a susceptibility rating of **Low** and the aquifer received a susceptibility rating of **Medium**. Combining these two ratings produce a **Low** rating for the natural susceptibility of the well.

Identified potential and current sources of contaminants for the public drinking water source include: large capacity septic systems, pit toilets, fuel tanks, ADEC recognized contaminated sites, electric power generation facilities, landfills and placer mines. A detailed inventory can be found in Table 1 of Appendix B. These identified potential and existing sources of contamination are considered sources of bacteria and viruses, nitrates and/or nitrites, volatile organic chemicals, heavy metals, cyanide and other inorganic chemicals, synthetic organic chemicals, and other organic chemicals contaminant categories.

Overall, the well received a vulnerability rating of **High** for bacteria and viruses, nitrates and nitrites, volatile organic chemicals, synthetic organic chemicals, and other organic chemicals and a vulnerability rating of **Medium** for heavy metals, cyanide and other inorganic chemicals.

### PUBLIC DRINKING WATER SYSTEM

The CRSD Slana School PWS well is a Class A (community/non-transient/non-community) public water system. The system is located southwest of the

School at Milepost 1 Nebesna Road in Slana, Alaska (Sec. 29, T011N, R008E, Copper River Meridian, see Map A of Appendix A). The community of Slana is located at the junction of the Slana and Copper Rivers, 53 miles southwest of Tok. The community has a population of 118 (ADCED, 2003). Average annual precipitation in Slana is 13 inches, including approximately 61 inches of snowfall. Temperatures can be as extreme as -62 to 91°F.

The community of Slana obtains most of their water supply from individual wells. The school uses their own water system. Outhouses, honeybuckets and septic systems are used for sewage disposal (ADCED, 2003). Slana residents provide their own power with individual generators powered by diesel. The landfill was closed in 1990 and it is assumed that refuse is hauled by individuals to Tok for disposal.

According to information supplied by ADEC for the CRSD Slana School PWS, the depth of the well is 40 feet below the ground surface. Based on available well construction details, it is assumed that the well is screened in a confined aquifer. The well is not located within a floodplain.

Information acquired from a June 2002 sanitary survey for the PWS indicated that the land surface was sloped away from the well. Generally, land surfaces that slope away from the wellhead promote surface water drainage, which reduces the potential of contaminant migration down the well casing annulus. The sanitary survey indicates that the well is grouted according to ADEC regulations. Proper grouting provides added protection against contaminants traveling along the well casing annulus and into source waters.

The Tok area is in the eastern reaches of the Tanana-Kuskokwim Lowland, a broad depression bordering the Alaska Range on the north. Coalescing alluvial fans composed of moderately well-sorted silt, sand and gravel are the principal surficial deposits in the Tok area. The thickness of the unconsolidated material is estimated to be as much as 760 meters. Not all of this thickness is alluvium; however, because alluvial deposits are typically not deposited

below sea level. It is likely that deep sediments in the area are poorly sorted lacustrine, glacial, or marine sediments of low permeability. The area was glaciated in at least three episodes, which is evidenced by the presence of terminal moraines in the Delta and Gerstle River valleys and in the valleys of several small creeks draining the north face of the Alaska Range. Five major soil types exist in the Big Delta area: Salchaket, Jarvis, Nenana, Chena, and Tanana. These soils range in drainage from the somewhat poorly drained Salchaket to well drained Chena. The area lies in the discontinuous permafrost zone (Nelson, 1995).

### DRINKING WATER PROTECTION AREA

In order to evaluate whether a drinking water source is at risk, we must first evaluate what are the most likely pathways for surface contamination to reach the groundwater. These areas are determined by looking at the characteristics of the soil, groundwater, aquifer, and well.

The most probable area for contamination to reach the drinking water well is the area that contributes water to the well, the groundwater recharge area. This area is designated as the drinking water protection area (DWPA). Because releases of contaminants within the protection area are most likely to impact the drinking water well, this area will serve as the focus for voluntary protection efforts. An analytical calculation was used to determine the size and shape of the DWPA for the CRSD Slana School PWS. The input parameters describing the attributes of the aquifer in this calculation were adopted from Groundwater (Freeze and Cherry, 1979). Available geology and groundwater contours were also considered to take into account any uncertainties in groundwater flow and aquifer characteristics to arrive at a meaningful protection area.

The protection areas established for wells by the ADEC are usually separated into four zones, limited by the watershed. These zones correspond to differences in the time-of-travel (TOT) of the water moving through the aquifer to the well (Please refer to the Guidance Manual for Class A Public Water Systems for additional information).

The time of travel for contaminants within the water varies and is dependent on the physical and chemical characteristics of each contaminant. The following is a summary of the four protection area zones for wells and the calculated time-of-travel for each:

**Table 1. Definition of Zones**

Zone	Definition
A	¼ the distance for the 2-yr. time-of-travel
B	Less than the 2 year time-of-travel
C	Less Than the 5 year time-of-travel
D	Less than the 10 year time-of-travel

The DWPA for the CRSD Slana School PWS was determined using an analytical calculation and includes Zones A, B, C, and D (See Map A of Appendix A).

### INVENTORY OF POTENTIAL AND EXISTING CONTAMINANT SOURCES

The Drinking Water Protection Program has completed an inventory of potential and existing sources of contamination within the CRSD Slana School PWS DWPA. This inventory was completed through a search of agency records and other publicly available information. Potential sources of contamination to the drinking water aquifer include a wide range of categories and types. Potential drinking water contaminants are found within agricultural, residential, commercial, and industrial areas, but can also occur within areas that have little or no development.

For the basis of all Class A public water system assessments, six categories of drinking water contaminants were inventoried. They include:

- Bacteria and viruses,
- Nitrates and/or nitrites,
- Volatile organic chemicals,
- Heavy metals, cyanide and other inorganic chemicals,
- Synthetic organic chemicals, and
- Other organic chemicals.

The sources are displayed on Map C of Appendix C and summarized in Table 1 of Appendix B.

### RANKING OF CONTAMINANT RISKS

Once the potential and existing sources of contamination have been identified, they are assigned a ranking according to what type and level of risk they represent. Ranking of contaminant risks for a “potential” or “existing” source of contamination is a function of toxicity and volumes of specific contaminants associated with that source. Rankings include:

- Low,
- Medium,
- High, and
- Very High.

The time-of-travel for contaminants within the water varies and is dependent on the physical and chemical characteristics of each contaminant. Bacteria and Viruses are only inventoried in Zones A and B because of their short life span. Only “Very High” and “High” rankings are inventoried within the outer Zone D due to the probability of contaminant dilution by the time the contaminants get to the well. Tables 2 through 4 in Appendix B contain the ranking of potential and existing sources of contamination with respect to bacteria and viruses, nitrates and/or nitrites, volatile organic chemicals, heavy metals, cyanide and other inorganic chemicals, synthetic organic chemicals, and other organic chemicals.

### VULNERABILITY OF THE DRINKING WATER SYSTEM

Vulnerability of a drinking water source to contamination is a combination of two factors:

- Natural susceptibility, and
- Contaminant risks.

Appendix D contains fourteen charts, which together form the ‘Vulnerability Analysis’ for a source water assessment for a public drinking water source. Chart 1 analyzes the ‘Susceptibility of the Wellhead’ to contamination by looking at the construction of the well and its surrounding area. Chart 2 analyzes the ‘Susceptibility of the Aquifer’ to contamination by looking at the naturally occurring attributes of the water source and influences on the groundwater system that might lead to contamination. Chart 3 analyzes ‘Contaminant Risks’ for the drinking water source with respect to bacteria and viruses. The ‘Contaminant Risks’ portion of the analysis considers potential sources of contaminants as well as a review of contamination that has or may have occurred, but has not arrived or been detected at the well. Chart 4 contains the ‘Vulnerability Analysis for Bacteria and Viruses’. Charts 5 through 14 contain the Contaminant Risks and Vulnerability Analyses for nitrates and nitrites, volatile organic chemicals, heavy metals, cyanide and other inorganic chemicals, synthetic organic chemicals, and other organic chemicals, respectively.

A score for the Natural Susceptibility is reached by considering the properties of the well and the aquifer.

Susceptibility of the Wellhead (0 – 25 Points)  
(Chart 1 of Appendix D)

+

Susceptibility of the Aquifer (0 – 25 Points)  
(Chart 2 of Appendix D)

=

Natural Susceptibility (Susceptibility of the Well)  
(0 – 50 Points)

A ranking is assigned for the Natural Susceptibility according to the point score:

Natural Susceptibility Ratings	
40 to 50 pts	Very High
30 to < 40 pts	High
20 to < 30 pts	Medium
< 20 pts	Low

The CRSD Slana School PWS’s water well is completed in a confined aquifer. Confined aquifers are less susceptible to potential groundwater quality impacts posed by the migration of surface water contaminants downward from the surface. Table 2 shows the susceptibility scores and ratings for this PWS.

**Table 2. Susceptibility**

	Score	Rating
Susceptibility of the Wellhead	0	Low
Susceptibility of the Aquifer	13	Medium
Natural Susceptibility	13	Low

Contaminant risks to a drinking water source depend on the type, number or density, and distribution of contaminant sources. This score has been derived from an examination of existing and historical contamination that has been detected at the drinking water source through routine sampling. It also evaluates potential sources of contamination. Flow charts are used to assign a point score, and ratings are assigned in the same way as for the natural susceptibility:

Contaminant Risk Ratings	
40 to 50 pts	Very High
30 to < 40 pts	High
20 to < 30 pts	Medium
< 20 pts	Low

Table 3 summarizes the Contaminant Risks for each category of drinking water contaminants.

**Table 3. Contaminant Risks**

Category	Score	Rating
Bacteria and Viruses	50	Very High
Nitrates and/or Nitrites	50	Very High
Volatile Organic Chemicals	50	Very High
Heavy Metals, Cyanide and		
Other Inorganic Chemicals	42	Very High
Synthetic Organic Chemicals	47	Very High
Other Organic Chemicals	50	Very High

Finally, an overall vulnerability score is assigned for each water system by combining each of the contaminant risk scores with the natural susceptibility score:

$$\begin{aligned}
 &\text{Natural Susceptibility (0 – 50 points)} \\
 &\quad + \\
 &\text{Contaminant Risks (0 – 50 points)} \\
 &\quad = \\
 &\text{Vulnerability of the} \\
 &\text{Drinking Water Source to Contamination (0 – 100)}.
 \end{aligned}$$

Again, rankings are assigned according to a point score:

Overall Vulnerability Ratings	
80 to 100 pts	Very High
60 to < 80 pts	High
40 to < 60 pts	Medium
< 40 pts	Low

Table 4 contains the overall vulnerability scores (0 – 100) and ratings for each of the six categories of drinking water contaminants. Note: scores are rounded off to the nearest five.

**Table 4. Overall Vulnerability**

Category	Score	Rating
Bacteria and Viruses	65	High
Nitrates and Nitrites	65	High
Volatile Organic Chemicals	65	High
Heavy Metals, Cyanide and		
Other Inorganic Chemicals	55	Medium
Synthetic Organic Chemicals	60	High
Other Organic Chemicals	65	High

**Bacteria and Viruses**

The contaminant risk for bacteria and viruses is **Very High**. The risk is primarily attributed to the presence of a large capacity septic system located in Zone A. Numerous other potential contaminant sources are also found within the protection area (see Table 2 – Appendix B).

Coliforms (a bacteria) are found naturally in the environment and although they aren’t necessarily a health threat, they are an indicator of other potentially harmful bacteria in the water, more specifically, fecal coliforms and E. coli, which only come from human and animal fecal waste. Harmful bacteria can cause diarrhea, cramps, nausea, headaches, or other symptoms (EPA, 2002). Positive samples increase the overall vulnerability of the drinking water source, indicating that the source is susceptible to bacteria and virus contamination.

No positive bacteria counts have been reported in recent (within five years) sampling events (See Chart 3 – Contaminant Risks for Bacteria and Viruses in Appendix D). Only a small amount of bacteria and viruses are required to endanger public health.

After combining the contaminant risk for bacteria and viruses with the natural susceptibility of the well, the overall vulnerability of the well to contamination is **High**.

**Nitrates and Nitrites**

The contaminant risk for nitrates and nitrites is **Very High**. The risk to this source of public drinking water is primarily attributed to the presence of a large capacity septic system in Zone A and a landfill in Zone B. Numerous other potential contaminant sources are also found within the protection area (see Table 3 – Appendix B).

Nitrates are very mobile, moving at approximately the same rate as water. The sampling history for this well indicates that nitrates have been detected in recent sampling events, however they did not exceed

the MCL of 10mg/L. Nitrate concentrations in uncontaminated groundwater are typically less than 2 mg/L; therefore, nitrate concentrations above 2 mg/L may be indicative of man-made sources (See Chart 5 - Contaminant Risks for Nitrates and/or Nitrites in Appendix D).

Nitrate levels are often derived from the decomposition of organic matter in soils. Although the nitrate source is unknown, such occurrences may be attributed to septic systems or other sources.

After combining the contaminant risk for nitrates and nitrites with the natural susceptibility of the well, the overall vulnerability of the well to nitrate and nitrite contamination is **High**.

### **Volatile Organic Chemicals**

The contaminant risk for volatile organic chemicals is **Very High**. The risk is primarily attributed to the presence of underground gasoline fuel tanks and an ADEC recognized contaminated site located in Zone A. Numerous other potential contaminant sources are also found within the protection area (see Table 4 – Appendix B).

No recent sampling data was available in ADEC records for the CRSD Slana School PWS (See Chart 7 – Contaminant Risks for Volatile Organic Chemicals in Appendix D).

Possible sources of volatile organic chemicals include facilities with automobiles, residential areas, fuel tanks, and roads. See Table 4 in Appendix B for a complete listing.

After combining the contaminant risk for volatile organic chemicals with the natural susceptibility of the well, the overall vulnerability of the well to contamination is **High**.

### **Heavy Metals, Cyanide and Other Inorganic Chemicals**

The contaminant risk for heavy metals, cyanide and other inorganic chemicals is **Very High**. The risk is primarily attributed to the presence of fuel tanks in Zone A and a landfill in Zone B. Numerous other potential contaminant sources are also found within the protection area (see Table 5 – Appendix B).

Based on review of recent sampling records for this PWS, moderate levels of copper and lead have been detected, however have not exceeded their MCL's of 1.3 and 0.015 mg/L (respectively) (see Chart 9 – Contaminant Risks for Heavy Metals, Cyanide, and Other Inorganic Chemicals in Appendix D).

The reported concentrations of copper and lead are likely attributed to the water treatment/conveyance system. After combining the contaminant risk for heavy metals, cyanide and other inorganic chemicals with the natural susceptibility of the well, the overall vulnerability of the well to contamination is **Medium**.

### **Synthetic Organic Chemicals**

The contaminant risk for synthetic organic chemicals is **Very High**. The risk is primarily attributed to a landfill located in Zone B (see Table 6 – Appendix B).

No recent sampling data was available in ADEC records for the CRSD Slana School PWS (See Chart 11 – Contaminant Risks for Synthetic Organic Chemicals in Appendix D).

After combining the contaminant risk for synthetic organic chemicals with the natural susceptibility of the well, the overall vulnerability of the well to contamination is **High**.

### **Other Organic Chemicals**

The contaminant risk for other organic chemicals is **Very High**. The risk is primarily attributed to the presence of an electric power generation facility in Zone A and a landfill in Zone B. Several other potential contaminant sources are also found within the protection area (see Table 7 – Appendix B).

No recent sampling data was available in ADEC records for the CRSD Slana School PWS (See Chart 13 – Contaminant Risks for Other Organic Chemicals in Appendix D).

After combining the contaminant risk for other organic chemicals with the natural susceptibility of the well, the overall vulnerability of the well to contamination is **High**.

### **Using the Source Water Assessment**

This assessment of contaminant risks can be used as a foundation for local voluntary protection efforts as well as a basis for the continuous efforts on the part of the community of Slana to protect public health. It is anticipated that Source Water Assessments will be updated every five years to reflect any changes in the vulnerability and/or susceptibility of the drinking water source.




## REFERENCES

- Alaska Department of Community and Economic Development (ADCED), 2003 [WWW document]. URL: [http://www.dced.state.ak.us/cbd/commdb/CF\\_COMDB.htm](http://www.dced.state.ak.us/cbd/commdb/CF_COMDB.htm)
- Alaska Department of Environmental Conservation, Contaminated Sites Database, 2003 [WWW database], URL [http://www.state.ak.us/dec/dspar/csites/cs\\_search.htm](http://www.state.ak.us/dec/dspar/csites/cs_search.htm)
- Alaska Department of Environmental Conservation, Leaking Underground Storage Tank Database, 2003 [WWW database], URL [http://www.dec.state.ak.us/spar/stp/ust/search/fac\\_search.asp](http://www.dec.state.ak.us/spar/stp/ust/search/fac_search.asp)
- Freeze, R. A., and Cherry, J.A. 1979, Groundwater, Prentice-Hall, Englewood Cliffs, New Jersey
- Nelson, Gordon L. 1995. Overview of Environmental and Hydrogeologic Conditions near Big Delta, Alaska. U.S. Geological Survey Open File Report 95-180 (prepared in cooperation with the FAA).
- United States Environmental Protection Agency (EPA), 2002 [WWW document]. URL <http://www.epa.gov/safewater/mcl.html>.

# **APPENDIX A**

## **Drinking Water Protection Area Location Map (Map A)**

Public Water Well System for PWS #381503.001 CRSD Slana School

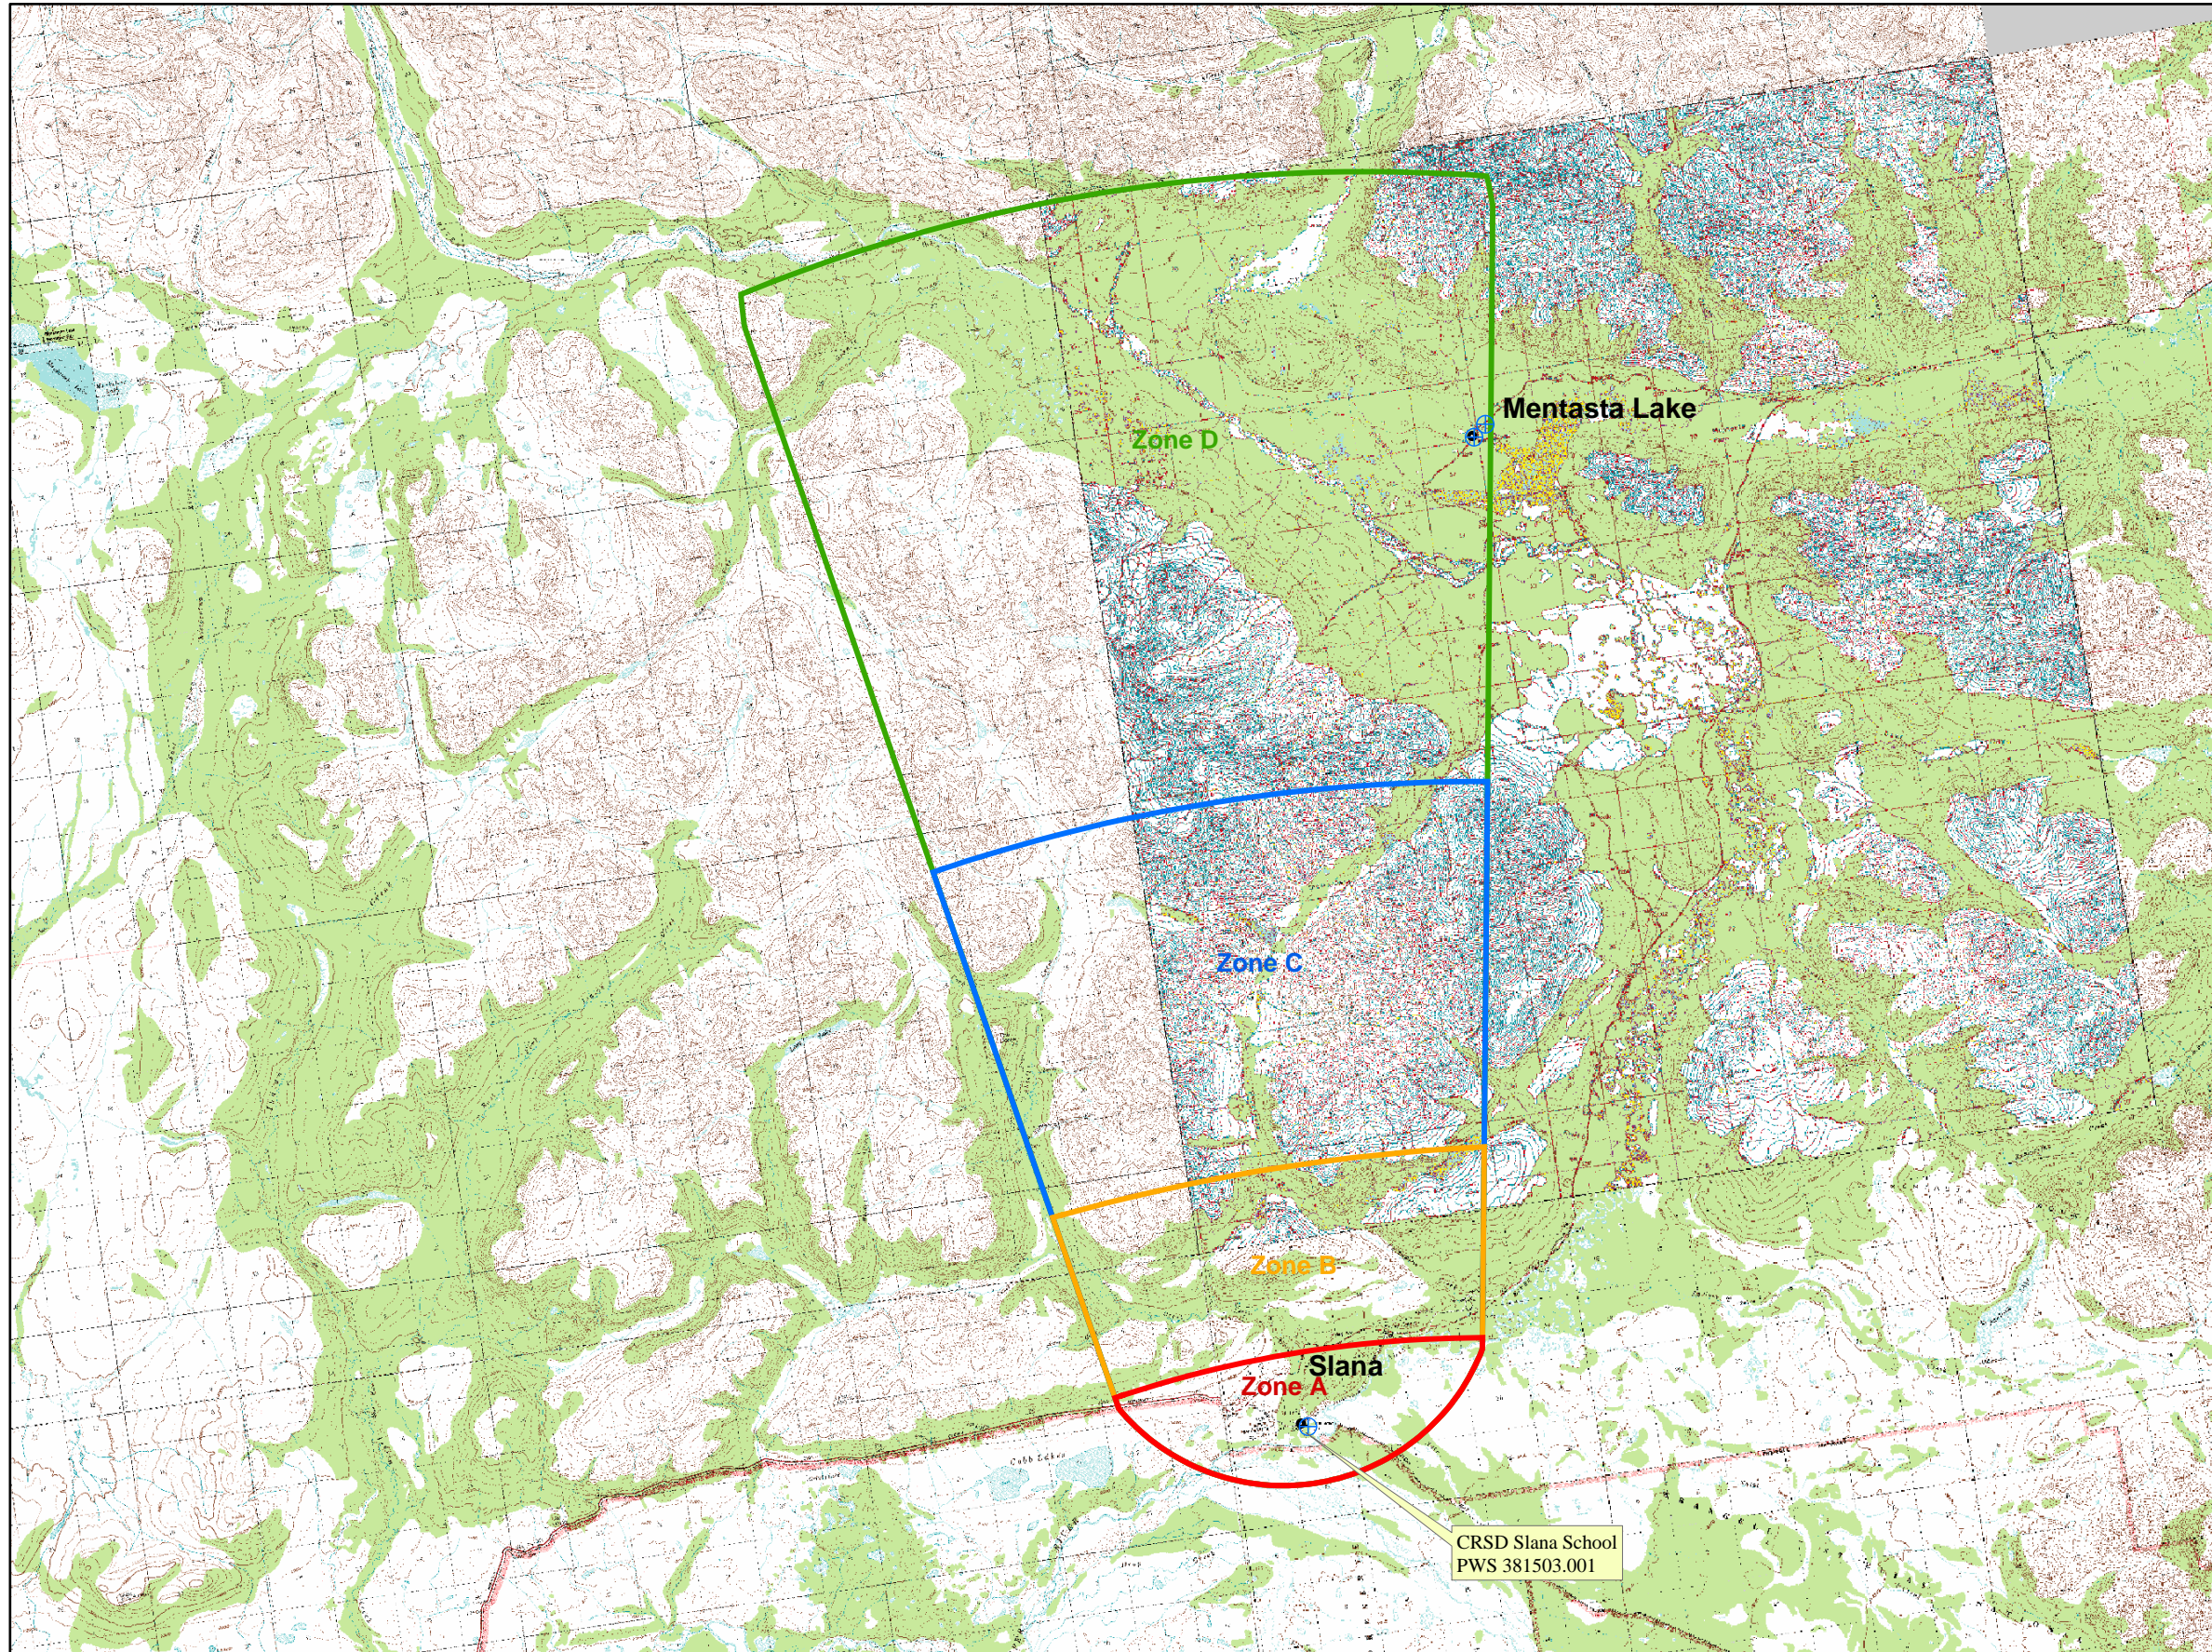

**LEGEND**

Public Water System Well

**Hydrography/Physical**

- Parcels
- Stream
- Lake or Pond
- Contours

**Transportation**


- Primary Route (Class 1)
- Secondary Route (Class 2)
- Road (Class 3)
- Road (Class 4)
- Road (Class 5, Four-wheel drive)

**Groundwater Protection Zones**

- Zone A Protection Area— Several Months Travel Time
- Zone B Protection Area— 2 Years Travel Time
- Zone C Protection Area— 5 Years Travel Time
- Zone D Protection Area— 10 Years Travel Time

Data Sources:  
 - Contaminant Sources, Public Water System Wells, Contours  
 Alaska Department of Environmental Conservation (ADEC)  
 - Critical Facilities, Federal Emergency Management Agency (FEMA)  
 All other data:  
 - United States Geological Survey (USGS)  
 - Drinking Water Protection Areas based on "Alaska Drinking Water Protection Program - Guidance Manual for Class A Public Water Systems" published by ADEC

URS Corporation does not guarantee the accuracy or validity of the data provided.



## **APPENDIX B**

### **Contaminant Source Inventory and Risk Ranking (Tables 1-7)**

**Table 1****Contaminant Source Inventory for  
Copper R SD - Slana School (New)****PWSID 381503.00**

<b>Contaminant Source Type</b>	<b>Contaminant Source ID</b>	<b>CS ID tag</b>	<b>Zone</b>	<b>Map Number</b>	<b>Comments</b>
Injection wells (Class V) Large-Capacity Septic System (Drainfie Disposal Method)	D10	D10-01	A	C	
Pit toilets (open hole), nonresidential (one or more)	D16	D16-01	A	C	Assume 35 or less outhouses in Zone A
Quarries (sand, gravel, rock, other?)	E10	E10-01	A	C	SLANA PIT
Septic systems (serves one single-family home)	R02	R02-01	A	C	Assume 25 or less residential septic systems in Zone A
Tanks, heating oil, residential (above ground)	R08	R08-01	A	C	Assume 15 or less residential heating oil tanks in Zone A
Tanks, gasoline (underground)	T12	T12-01	A	C	
Tanks, heating oil, nonresidential (underground)	T16	T16-01	A	C	
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-01	A	C	NPS Nabesna Mine Tailings, RecKey #1994330915101, Status: Active, h metals contamination in mide waste tailings piles. Cabin Creek is on the impaired water body list impacted by the tailings.
Highways and roads, dirt/gravel	X24	X24-01	A	C	Assume 1-20 roads in Zone A
Electric power generation (fossil fuels)	X36	X36-01	A	C	
Gasoline stations (without repair shop)	C15	C15-01	B	C	DUFFYS ROADHOUSE
Injection wells (Class V) Large-Capacity Septic System (Drainfie Disposal Method)	D10	D10-02	B	C	DUFFYS ROADHOUSE
Injection wells (Class V) Large-Capacity Septic System (Drainfie Disposal Method)	D10	D10-03	B	C	AK DIV PARKS-PORCUPINE CREEK
Landfills (municipal; Class III)	D51	D51-01	B	C	Landfills (municipal; Class III), Slana
Metals mining, placer (active or inactive?)	E04	E04-01	B	C	AHTELL CREEK
Metals mining, placer (active or inactive?)	E04	E04-02	B	C	WILLOW CREEK
Quarries (sand, gravel, rock, other?)	E10	E10-02	B	C	GOLD QUARTZ
Quarries (sand, gravel, rock, other?)	E10	E10-03	B	C	LUCKY PEOPLE
Quarries (sand, gravel, rock, other?)	E10	E10-04	B	C	SILVER SHIELD

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Map Number</i>	<i>Comments</i>
Tanks, diesel (underground)	T08	T08-01	B	C	DUFFYS ROADHOUSE
Tanks, gasoline (underground)	T12	T12-02	B	C	DUFFYS ROADHOUSE
Tanks, gasoline (underground)	T12	T12-03	B	C	DUFFYS ROADHOUSE
Tanks, gasoline (underground)	T12	T12-04	B	C	DUFFYS ROADHOUSE
Closed Leaking Underground Fuel Storage Tank (LUST) Sites	U08	U08-01	B	C	Duffys Roadhouse, RecKey #1993330006401, Facility ID 2497, Event II 2 USTs removed in 1995 with 35 cubic yards of contaminated soil. Contamination remains in pit because backhoe could not reach further.
Airports	X14	X14-01	B	C	Duffys Tavern Landing
Highways and roads, dirt/gravel	X24	X24-02	B	C	Assume 1-20 roads in Zone B
Metals mining, placer (active or inactive?)	E04	E04-03	C	C	BOULDER CREEK
Metals mining, placer (active or inactive?)	E04	E04-04	C	C	BOULDER CREEK
Metals mining, placer (active or inactive?)	E04	E04-05	C	C	GRUBSTAKE CREEK
Metals mining, placer (active or inactive?)	E04	E04-06	C	C	SLOPE CREEK
Metals mining, placer (active or inactive?)	E04	E04-07	C	C	SLOPE CREEK
Quarries (sand, gravel, rock, other?)	E10	E10-05	C	C	DISCOVERY
Quarries (sand, gravel, rock, other?)	E10	E10-06	C	C	INDIAN
Quarries (sand, gravel, rock, other?)	E10	E10-07	C	C	STEPHANIE
Quarries (sand, gravel, rock, other?)	E10	E10-08	C	C	THE DOME
Quarries (sand, gravel, rock, other?)	E10	E10-09	C	C	UNNAMED OCCURRENCE
Laundromats without dry cleaning	C22	C22-01	D	C	
Domestic wastewater collection systems (sewer lines or lift stati	D01	D01-01	D	C	
Domestic wastewater treatment plant disposal ponds/lagoons	D02	D02-01	D	C	
Injection wells (Class V) Large-Capacity Septic System (Drainfie Disposal Method)	D10	D10-04	D	C	AKGATEWAY SD-MENTASTA LAKE SCH

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Map Number</i>	<i>Comments</i>
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-05	D	C	
Landfills (municipal; Class III)	D51	D51-02	D	C	Landfills (municipal; Class III), Mentasta Lake
Quarries (sand, gravel, rock, other?)	E10	E10-10	D	C	JODY-SLANA
Quarries (sand, gravel, rock, other?)	E10	E10-11	D	C	JUDY
Quarries (sand, gravel, rock, other?)	E10	E10-12	D	C	LOST CREEK
Quarries (sand, gravel, rock, other?)	E10	E10-13	D	C	PTARMIGAN WEST
Quarries (sand, gravel, rock, other?)	E10	E10-14	D	C	SILVER BOWL
Quarries (sand, gravel, rock, other?)	E10	E10-15	D	C	SLANA RIVER
Tanks, gasoline (above ground)	T10	T10-01	D	C	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-01	D	C	
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-02	D	C	Mentasta Village Clinic, RecKey # 1990330112901, Status: Inactive, a hi of leakage from a heating fuel tank located behind the clinic resulted in contaminated soils.
Rail corridors	X30	X30-01	D	C	

Table 2

*Contaminant Source Inventory and Risk Ranking for  
Copper R SD - Slana School (New)  
Sources of Bacteria and Viruses*

PWSID 381503.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-01	A	High	C	
Pit toilets (open hole), nonresidential (one or more)	D16	D16-01	A	Medium	C	Assume 35 or less outhouses in Zone A
Septic systems (serves one single-family home)	R02	R02-01	A	Low	C	Assume 25 or less residential septic systems in Zone A
Highways and roads, dirt/gravel	X24	X24-01	A	Low	C	Assume 1-20 roads in Zone A
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-02	B	High	C	DUFFYS ROADHOUSE
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-03	B	High	C	AK DIV PARKS-PORCUPINE CREEK
Landfills (municipal; Class III)	D51	D51-01	B	High	C	Landfills (municipal; Class III), Slana
Closed Leaking Underground Fuel Storage Tank (LUST) Sites	U08	U08-01	B	Low	C	Duffys Roadhouse, RecKey #1993330006401, Facility ID 2497, Event ID USTs removed in 1995 with 35 cubic yards of contaminated soil. Contamination remains in pit because backhoe could not reach further.
Highways and roads, dirt/gravel	X24	X24-02	B	Low	C	Assume 1-20 roads in Zone B
Domestic wastewater treatment plant disposal ponds/lagoons	D02	D02-01	D	High	C	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-04	D	High	C	AKGATEWAY SD-MENTASTA LAKE SCH
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-05	D	High	C	
Landfills (municipal; Class III)	D51	D51-02	D	High	C	Landfills (municipal; Class III), Mentasta Lake



Table 3

*Contaminant Source Inventory and Risk Ranking for  
Copper R SD - Slana School (New)  
Sources of Nitrates/Nitrites*

PWSID 381503.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-01	A	High	C	
Pit toilets (open hole), nonresidential (one or more)	D16	D16-01	A	Medium	C	Assume 35 or less outhouses in Zone A
Quarries (sand, gravel, rock, other?)	E10	E10-01	A	Low	C	SLANA PIT
Septic systems (serves one single-family home)	R02	R02-01	A	Low	C	Assume 25 or less residential septic systems in Zone A
Highways and roads, dirt/gravel	X24	X24-01	A	Low	C	Assume 1-20 roads in Zone A
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-02	B	High	C	DUFFYS ROADHOUSE
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-03	B	High	C	AK DIV PARKS-PORCUPINE CREEK
Landfills (municipal; Class III)	D51	D51-01	B	Very High	C	Landfills (municipal; Class III), Slana
Quarries (sand, gravel, rock, other?)	E10	E10-02	B	Low	C	GOLD QUARTZ
Quarries (sand, gravel, rock, other?)	E10	E10-03	B	Low	C	LUCKY PEOPLE
Quarries (sand, gravel, rock, other?)	E10	E10-04	B	Low	C	SILVER SHIELD
Closed Leaking Underground Fuel Storage Tank (LUST) Sites	U08	U08-01	B	Low	C	Duffys Roadhouse, RecKey #1993330006401, Facility ID 2497, Event ID USTs removed in 1995 with 35 cubic yards of contaminated soil. Contamination remains in pit because backhoe could not reach further.
Airports	X14	X14-01	B	Low	C	Duffys Tavern Landing
Highways and roads, dirt/gravel	X24	X24-02	B	Low	C	Assume 1-20 roads in Zone B
Quarries (sand, gravel, rock, other?)	E10	E10-05	C	Low	C	DISCOVERY
Quarries (sand, gravel, rock, other?)	E10	E10-06	C	Low	C	INDIAN
Quarries (sand, gravel, rock, other?)	E10	E10-07	C	Low	C	STEPHANIE
Quarries (sand, gravel, rock, other?)	E10	E10-08	C	Low	C	THE DOME

Table 3 (continued)

*Contaminant Source Inventory and Risk Ranking for  
Copper R SD - Slana School (New)  
Sources of Nitrates/Nitrites*

PWSID 381503.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Quarries (sand, gravel, rock, other?)	E10	E10-09	C	Low	C	UNNAMED OCCURRENCE
Domestic wastewater treatment plant disposal ponds/lagoons	D02	D02-01	D	High	C	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-04	D	High	C	AKGATEWAY SD-MENTASTA LAKE SCH
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-05	D	High	C	
Landfills (municipal; Class III)	D51	D51-02	D	Very High	C	Landfills (municipal; Class III), Mentasta Lake

Table 4

*Contaminant Source Inventory and Risk Ranking for  
Copper R SD - Slana School (New)  
Sources of Volatile Organic Chemicals*

PWSID 381503.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-01	A	Low	C	
Pit toilets (open hole), nonresidential (one or more)	D16	D16-01	A	Low	C	Assume 35 or less outhouses in Zone A
Quarries (sand, gravel, rock, other?)	E10	E10-01	A	Low	C	SLANA PIT
Septic systems (serves one single-family home)	R02	R02-01	A	Low	C	Assume 25 or less residential septic systems in Zone A
Tanks, heating oil, residential (above ground)	R08	R08-01	A	Medium	C	Assume 15 or less residential heating oil tanks in Zone A
Tanks, gasoline (underground)	T12	T12-01	A	High	C	
Tanks, heating oil, nonresidential (underground)	T16	T16-01	A	Low	C	
Contaminated sites, DEC recognized, non-Superfund non-RCRA	U04	U04-01	A	High	C	NPS Nabesna Mine Tailings, RecKey #1994330915101, Status: Active, heavy metals contamination in mine waste tailings piles. Cabin Creek is on the impaired water body list impacted by the tailings.
Highways and roads, dirt/gravel	X24	X24-01	A	Low	C	Assume 1-20 roads in Zone A
Electric power generation (fossil fuels)	X36	X36-01	A	Medium	C	
Gasoline stations (without repair shop)	C15	C15-01	B	High	C	DUFFYS ROADHOUSE
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-02	B	Low	C	DUFFYS ROADHOUSE
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-03	B	Low	C	AK DIV PARKS-PORCUPINE CREEK
Landfills (municipal; Class III)	D51	D51-01	B	High	C	Landfills (municipal; Class III), Slana
Quarries (sand, gravel, rock, other?)	E10	E10-02	B	Low	C	GOLD QUARTZ
Quarries (sand, gravel, rock, other?)	E10	E10-03	B	Low	C	LUCKY PEOPLE
Quarries (sand, gravel, rock, other?)	E10	E10-04	B	Low	C	SILVER SHIELD
Tanks, diesel (underground)	T08	T08-01	B	High	C	DUFFYS ROADHOUSE

*Contaminant Source Inventory and Risk Ranking for  
Copper R SD - Slana School (New)  
Sources of Volatile Organic Chemicals*

*PWSID 381503.001*

*Table 4 (continued)*

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Tanks, gasoline (underground)	T12	T12-02	B	High	C	DUFFYS ROADHOUSE
Tanks, gasoline (underground)	T12	T12-03	B	High	C	DUFFYS ROADHOUSE
Tanks, gasoline (underground)	T12	T12-04	B	High	C	DUFFYS ROADHOUSE
Closed Leaking Underground Fuel Storage Tank (LUST) Sites	U08	U08-01	B	High	C	Duffys Roadhouse, RecKey #1993330006401, Facility ID 2497, Event ID USTs removed in 1995 with 35 cubic yards of contaminated soil. Contamination remains in pit because backhoe could not reach further.
Airports	X14	X14-01	B	High	C	Duffys Tavern Landing
Highways and roads, dirt/gravel	X24	X24-02	B	Low	C	Assume 1-20 roads in Zone B
Quarries (sand, gravel, rock, other?)	E10	E10-05	C	Low	C	DISCOVERY
Quarries (sand, gravel, rock, other?)	E10	E10-06	C	Low	C	INDIAN
Quarries (sand, gravel, rock, other?)	E10	E10-07	C	Low	C	STEPHANIE
Quarries (sand, gravel, rock, other?)	E10	E10-08	C	Low	C	THE DOME
Quarries (sand, gravel, rock, other?)	E10	E10-09	C	Low	C	UNNAMED OCCURRENCE
Landfills (municipal; Class III)	D51	D51-02	D	High	C	Landfills (municipal; Class III), Mentasta Lake
Contaminated sites, DEC recognized, non-Superfund non-RCRA	U04	U04-02	D	High	C	Mentasta Village Clinic, RecKey # 1990330112901, Status: Inactive, a his of leakage from a heating fuel tank located behind the clinic resulted in contaminated soils.

Table 5

Contaminant Source Inventory and Risk Ranking for  
Copper R SD - Slana School (New)

PWSID 381503.001

Sources of Heavy Metals, Cyanide and Other Inorganic Chemicals

Contaminant Source Type	Contaminant Source ID	CS ID tag	Zone	Risk Ranking for Analysis	Map Number	Comments
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-01	A	Low	C	
Pit toilets (open hole), nonresidential (one or more)	D16	D16-01	A	Low	C	Assume 35 or less outhouses in Zone A
Septic systems (serves one single-family home)	R02	R02-01	A	Low	C	Assume 25 or less residential septic systems in Zone A
Tanks, gasoline (underground)	T12	T12-01	A	Medium	C	
Tanks, heating oil, nonresidential (underground)	T16	T16-01	A	Low	C	
Contaminated sites, DEC recognized, non-Superfund non-RCRA	U04	U04-01	A	Low	C	NPS Nabesna Mine Tailings, RecKey #1994330915101, Status: Active, heavy metals contamination in mine waste tailings piles. Cabin Creek is on the impaired water body list impacted by the tailings.
Highways and roads, dirt/gravel	X24	X24-01	A	Low	C	Assume 1-20 roads in Zone A
Electric power generation (fossil fuels)	X36	X36-01	A	Medium	C	
Gasoline stations (without repair shop)	C15	C15-01	B	Low	C	DUFFYS ROADHOUSE
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-02	B	Low	C	DUFFYS ROADHOUSE
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-03	B	Low	C	AK DIV PARKS-PORCUPINE CREEK
Landfills (municipal; Class III)	D51	D51-01	B	High	C	Landfills (municipal; Class III), Slana
Metals mining, placer (active or inactive?)	E04	E04-01	B	Low	C	AHTELL CREEK
Metals mining, placer (active or inactive?)	E04	E04-02	B	Low	C	WILLOW CREEK
Tanks, gasoline (underground)	T12	T12-02	B	Medium	C	DUFFYS ROADHOUSE
Tanks, gasoline (underground)	T12	T12-03	B	Medium	C	DUFFYS ROADHOUSE
Tanks, gasoline (underground)	T12	T12-04	B	Medium	C	DUFFYS ROADHOUSE

Table 5 (continued)

*Contaminant Source Inventory and Risk Ranking for  
Copper R SD - Slana School (New)  
Sources of Heavy Metals, Cyanide and Other Inorganic Chemicals*

PWSID 381503.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Closed Leaking Underground Fuel Storage Tank (LUST) Sites	U08	U08-01	B	Low	C	Duffys Roadhouse, RecKey #1993330006401, Facility ID 2497, Event ID USTs removed in 1995 with 35 cubic yards of contaminated soil. Contamination remains in pit because backhoe could not reach further.
Airports	X14	X14-01	B	Low	C	Duffys Tavern Landing
Highways and roads, dirt/gravel	X24	X24-02	B	Low	C	Assume 1-20 roads in Zone B
Metals mining, placer (active or inactive?)	E04	E04-03	C	Low	C	BOULDER CREEK
Metals mining, placer (active or inactive?)	E04	E04-04	C	Low	C	BOULDER CREEK
Metals mining, placer (active or inactive?)	E04	E04-05	C	Low	C	GRUBSTAKE CREEK
Metals mining, placer (active or inactive?)	E04	E04-06	C	Low	C	SLOPE CREEK
Metals mining, placer (active or inactive?)	E04	E04-07	C	Low	C	SLOPE CREEK
Landfills (municipal; Class III)	D51	D51-02	D	High	C	Landfills (municipal; Class III), Mentasta Lake

*Contaminant Source Inventory and Risk Ranking for  
Copper R SD - Slana School (New)  
Sources of Synthetic Organic Chemicals*

*PWSID 381503.001*

**Table 6**

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-01	A	Low	C	
Septic systems (serves one single-family home)	R02	R02-01	A	Low	C	Assume 25 or less residential septic systems in Zone A
Contaminated sites, DEC recognized, non-Superfund non-RCRA	U04	U04-01	A	Low	C	NPS Nabesna Mine Tailings, RecKey #1994330915101, Status: Active, he metals contamination in mide waste tailings piles. Cabin Creek is on the impaired water body list impacted by the tailings.
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-02	B	Low	C	DUFFYS ROADHOUSE
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-03	B	Low	C	AK DIV PARKS-PORCUPINE CREEK
Landfills (municipal; Class III)	D51	D51-01	B	Very High	C	Landfills (municipal; Class III), Slana
Closed Leaking Underground Fuel Storage Tank (LUST) Sites	U08	U08-01	B	Low	C	Duffys Roadhouse, RecKey #1993330006401, Facility ID 2497, Event ID USTs removed in 1995 with 35 cubic yards of contaminated soil. Contamination remians in pit because backhoe could not reach further.
Airports	X14	X14-01	B	Medium	C	Duffys Tavern Landing
Landfills (municipal; Class III)	D51	D51-02	D	Very High	C	Landfills (municipal; Class III), Mentasta Lake

Table 7

*Contaminant Source Inventory and Risk Ranking for  
Copper R SD - Slana School (New)  
Sources of Other Organic Chemicals*

PWSID 381503.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-01	A	Low	C	
Quarries (sand, gravel, rock, other?)	E10	E10-01	A	Low	C	SLANA PIT
Septic systems (serves one single-family home)	R02	R02-01	A	Low	C	Assume 25 or less residential septic systems in Zone A
Contaminated sites, DEC recognized, non-Superfund non-RCRA	U04	U04-01	A	Low	C	NPS Nabesna Mine Tailings, RecKey #1994330915101, Status: Active, he metals contamination in mide waste tailings piles. Cabin Creek is on the impaired water body list impacted by the tailings.
Highways and roads, dirt/gravel	X24	X24-01	A	Low	C	Assume 1-20 roads in Zone A
Electric power generation (fossil fuels)	X36	X36-01	A	High	C	
Gasoline stations (without repair shop)	C15	C15-01	B	Low	C	DUFFYS ROADHOUSE
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-02	B	Low	C	DUFFYS ROADHOUSE
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-03	B	Low	C	AK DIV PARKS-PORCUPINE CREEK
Landfills (municipal; Class III)	D51	D51-01	B	Very High	C	Landfills (municipal; Class III), Slana
Quarries (sand, gravel, rock, other?)	E10	E10-02	B	Low	C	GOLD QUARTZ
Quarries (sand, gravel, rock, other?)	E10	E10-03	B	Low	C	LUCKY PEOPLE
Quarries (sand, gravel, rock, other?)	E10	E10-04	B	Low	C	SILVER SHIELD
Closed Leaking Underground Fuel Storage Tank (LUST) Sites	U08	U08-01	B	Low	C	Duffys Roadhouse, RecKey #1993330006401, Facility ID 2497, Event ID USTs removed in 1995 with 35 cubic yards of contaminated soil. Contamination remians in pit because backhoe could not reach further.
Airports	X14	X14-01	B	Medium	C	Duffys Tavern Landing
Highways and roads, dirt/gravel	X24	X24-02	B	Low	C	Assume 1-20 roads in Zone B
Quarries (sand, gravel, rock, other?)	E10	E10-05	C	Low	C	DISCOVERY



Table 7 (continued)

Contaminant Source Inventory and Risk Ranking for  
Copper R SD - Slana School (New)  
Sources of Other Organic Chemicals


PWSID 381503.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Quarries (sand, gravel, rock, other?)	E10	E10-06	C	Low	C	INDIAN
Quarries (sand, gravel, rock, other?)	E10	E10-07	C	Low	C	STEPHANIE
Quarries (sand, gravel, rock, other?)	E10	E10-08	C	Low	C	THE DOME
Quarries (sand, gravel, rock, other?)	E10	E10-09	C	Low	C	UNNAMED OCCURRENCE
Landfills (municipal; Class III)	D51	D51-02	D	Very High	C	Landfills (municipal; Class III), Mentasta Lake

## **APPENDIX C**

### **Drinking Water Protection Area and Potential and Existing Contaminant Sources (Map C)**

**Public Water Well System for PWS #381503.001 CRSD Slana School  
Sources of Existing and Potential Contamination**

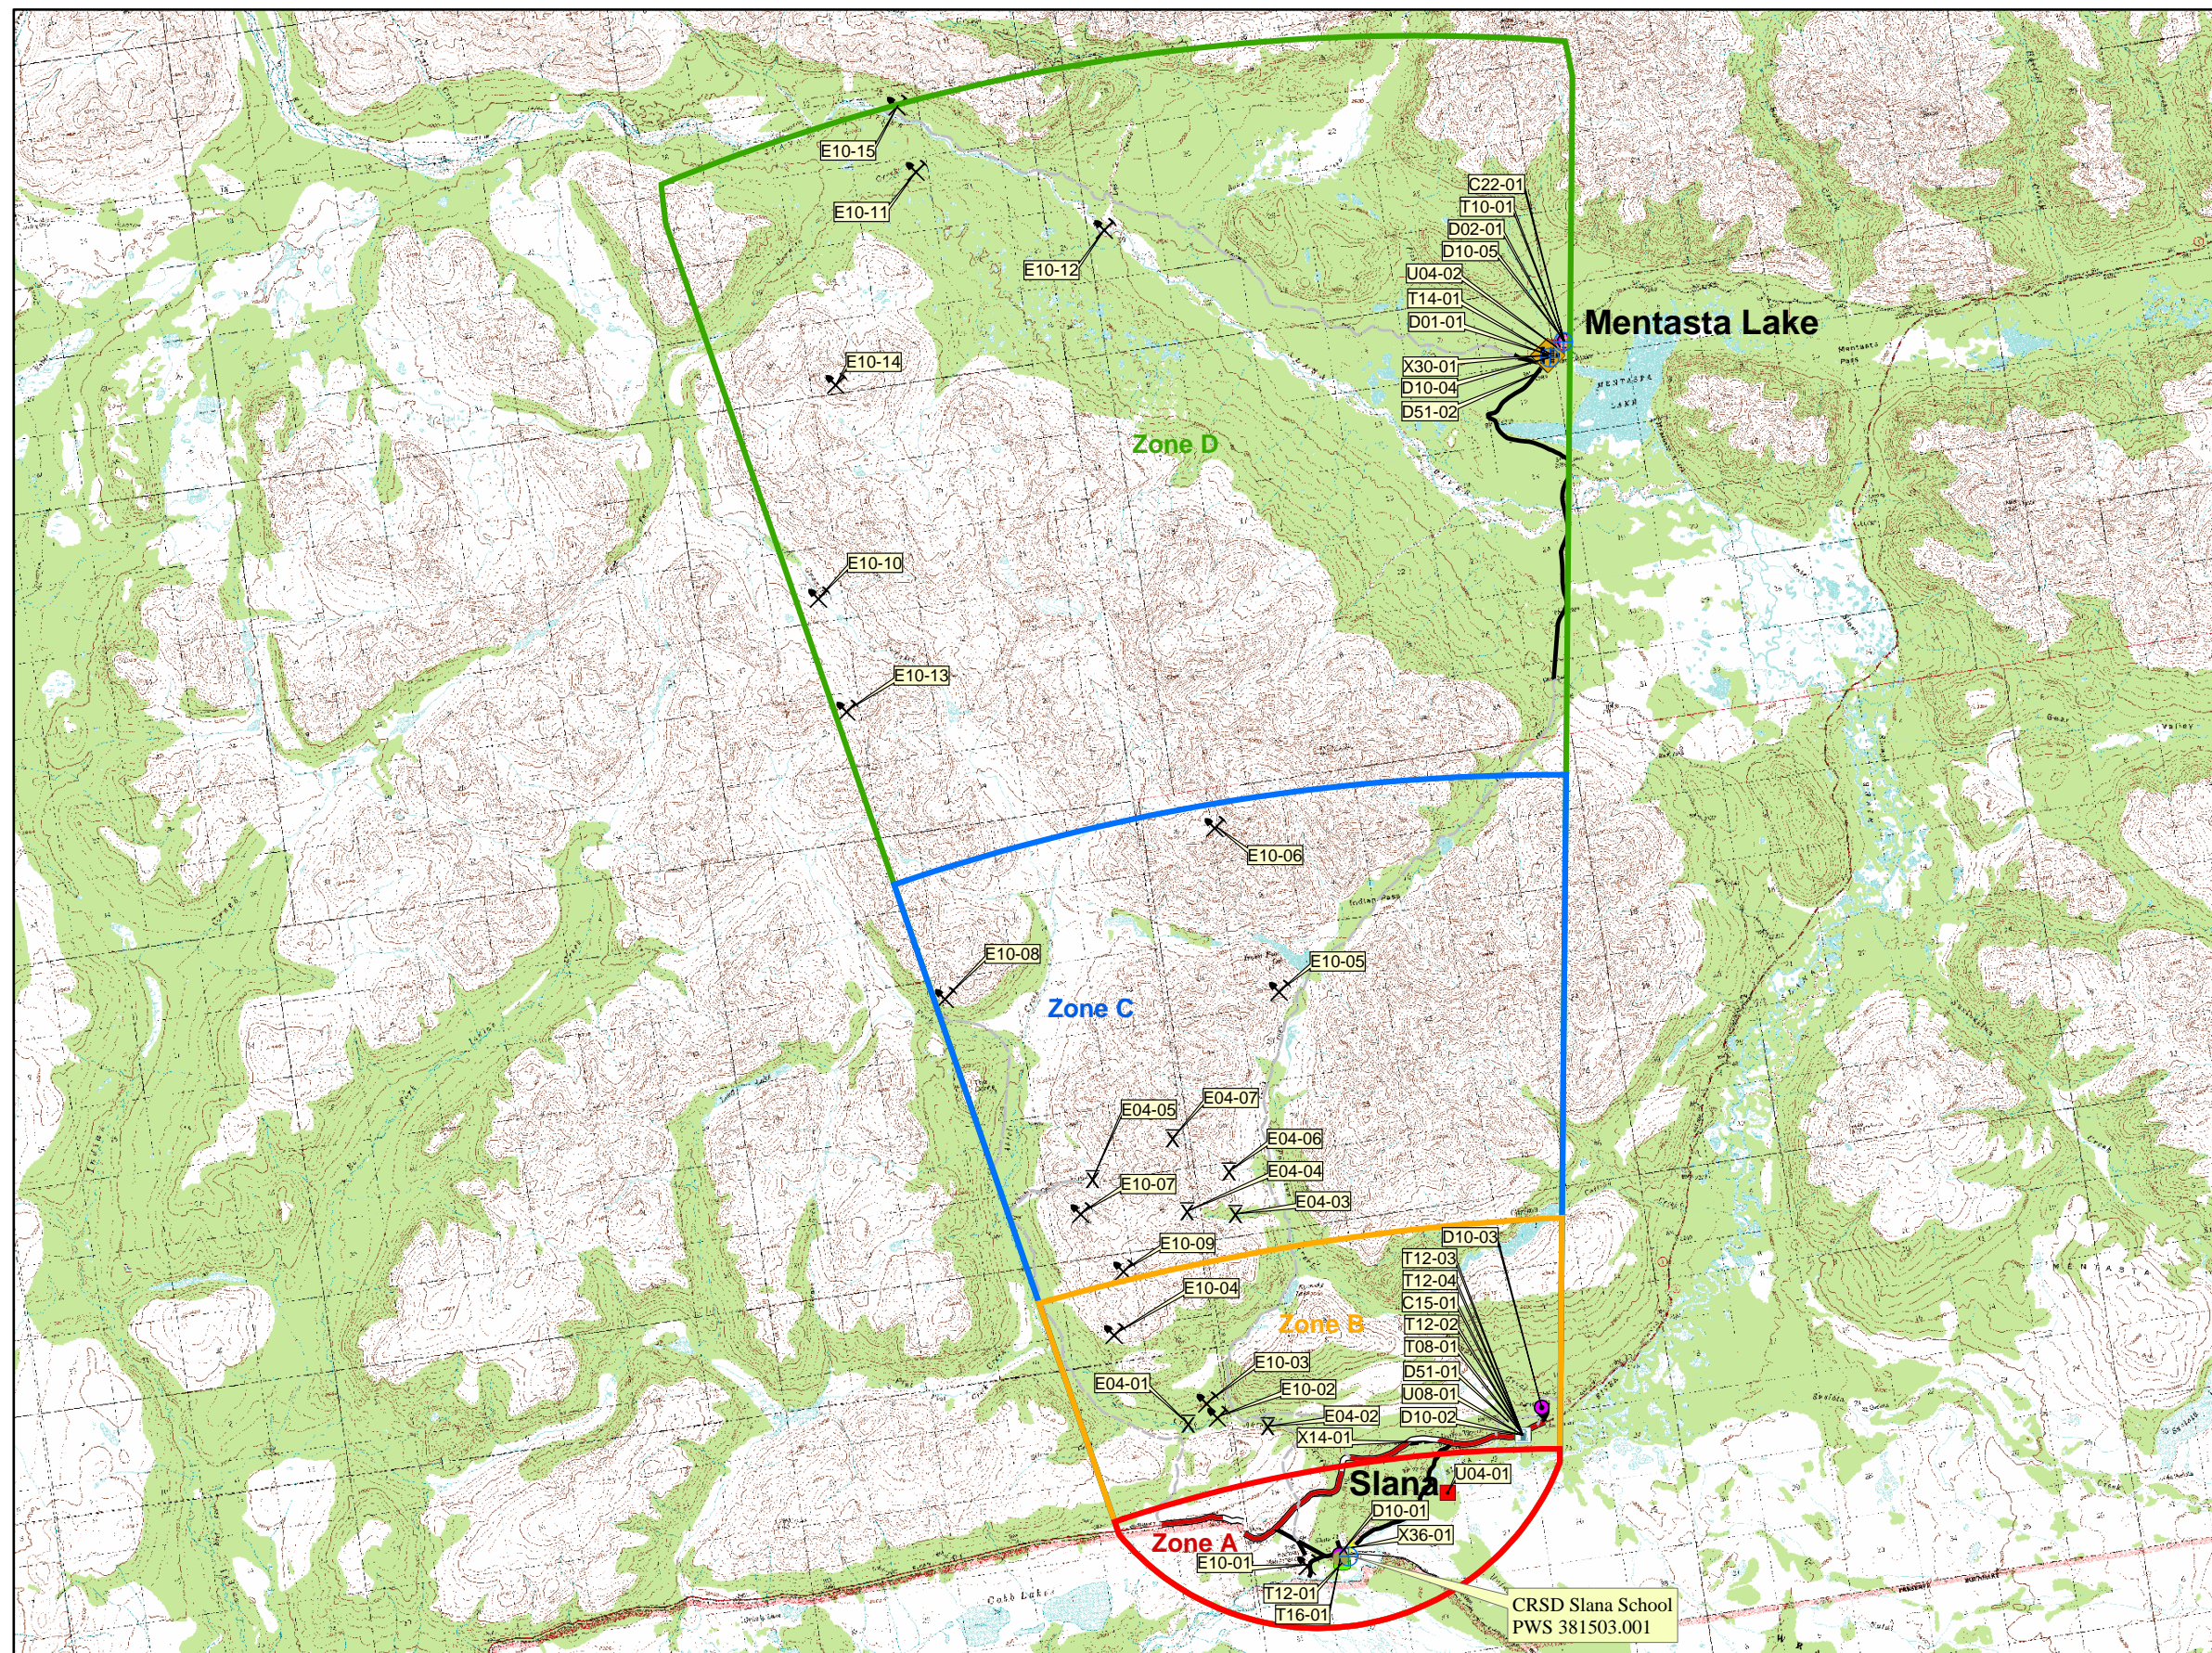

**LEGEND**

Public Water System Well

**Hydrography/Physical**

- Parcels
- Stream
- Lake or Pond
- Contours

**Transportation**

- Primary Route (Class 1)
- Secondary Route (Class 2)
- Road (Class 3)
- Road (Class 4)
- Road (Class 5, Four-wheel drive)

**Groundwater Protection Zones**

- Zone A Protection Area— Several Months Travel Time
- Zone B Protection Area— 2 Years Travel Time
- Zone C Protection Area— 5 Years Travel Time
- Zone D Protection Area— 10 Years Travel Time

**Existing or Potential Contaminant Sources**

- Gasoline stations (without repair shop) (C15)
- Laundromats without dry cleaning (C22)
- Domestic wastewater collection systems (sewer lines or lift stations) (D01)
- Injection Wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method) (D10)
- Placer Mines (E04)
- Other mines or Quarries (E10)
- Tanks, diesel (underground) (T08)
- Tanks, gasoline (aboveground) (T10)
- Tanks, gasoline (underground) (T12)
- Tanks, heating oil, nonresidential (aboveground) (T14)
- Tanks, heating oil, nonresidential (underground) (T16)
- Contaminated sites, DEC recognized, non-Superfund, non-RCRA (U04)
- Closed Leaking Underground Storage Tank (LUST) (lubricants or other petroleum products) (U08)
- Rail Corridors (X30)
- Electric Power Generation (fossil fuels) (X36)
- Domestic Wastewater Treatment Plant Disposal Lagoon (D02)
- Landfills (Municipal, Class III) (D51)
- Airport or landing strip (X14)



**Data Sources:**

- Contaminant Sources, Public Water System Wells, Contours Alaska Department of Environmental Conservation (ADEC)
- Critical Facilities, Federal Emergency Management Agency (FEMA)

**All other data:**

- United States Geological Survey (USGS)
- Drinking Water Protection Areas based on "Alaska Drinking Water Protection Program - Guidance Manual for Class A Public Water Systems" published by ADEC


URS Corporation does not guarantee the accuracy or validity of the data provided.




## **APPENDIX D**

### **Vulnerability Analysis for Public Drinking Water Source (Charts 1-14)**


**Chart 1. Susceptibility of the wellhead - Copper River School District - Slana School (PWS No.381503.001)**

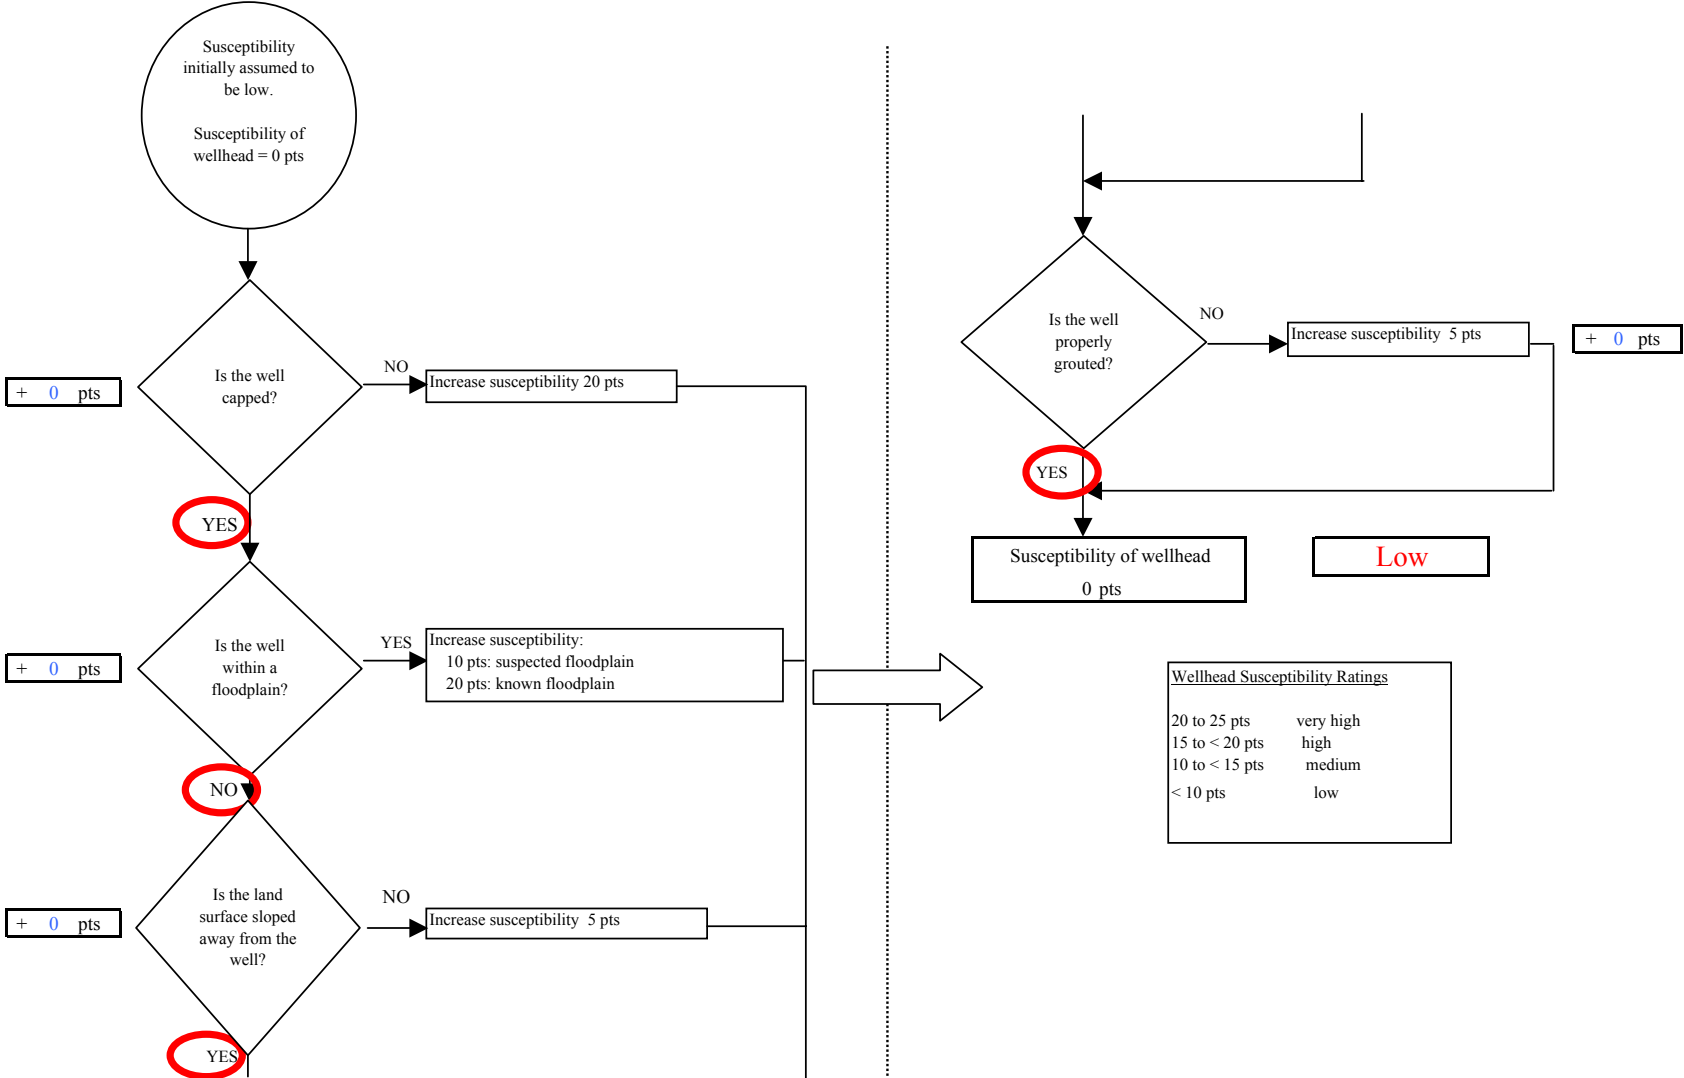


**Chart 2. Susceptibility of the aquifer Copper River School District - Slana School (PWS No.381503.001)**

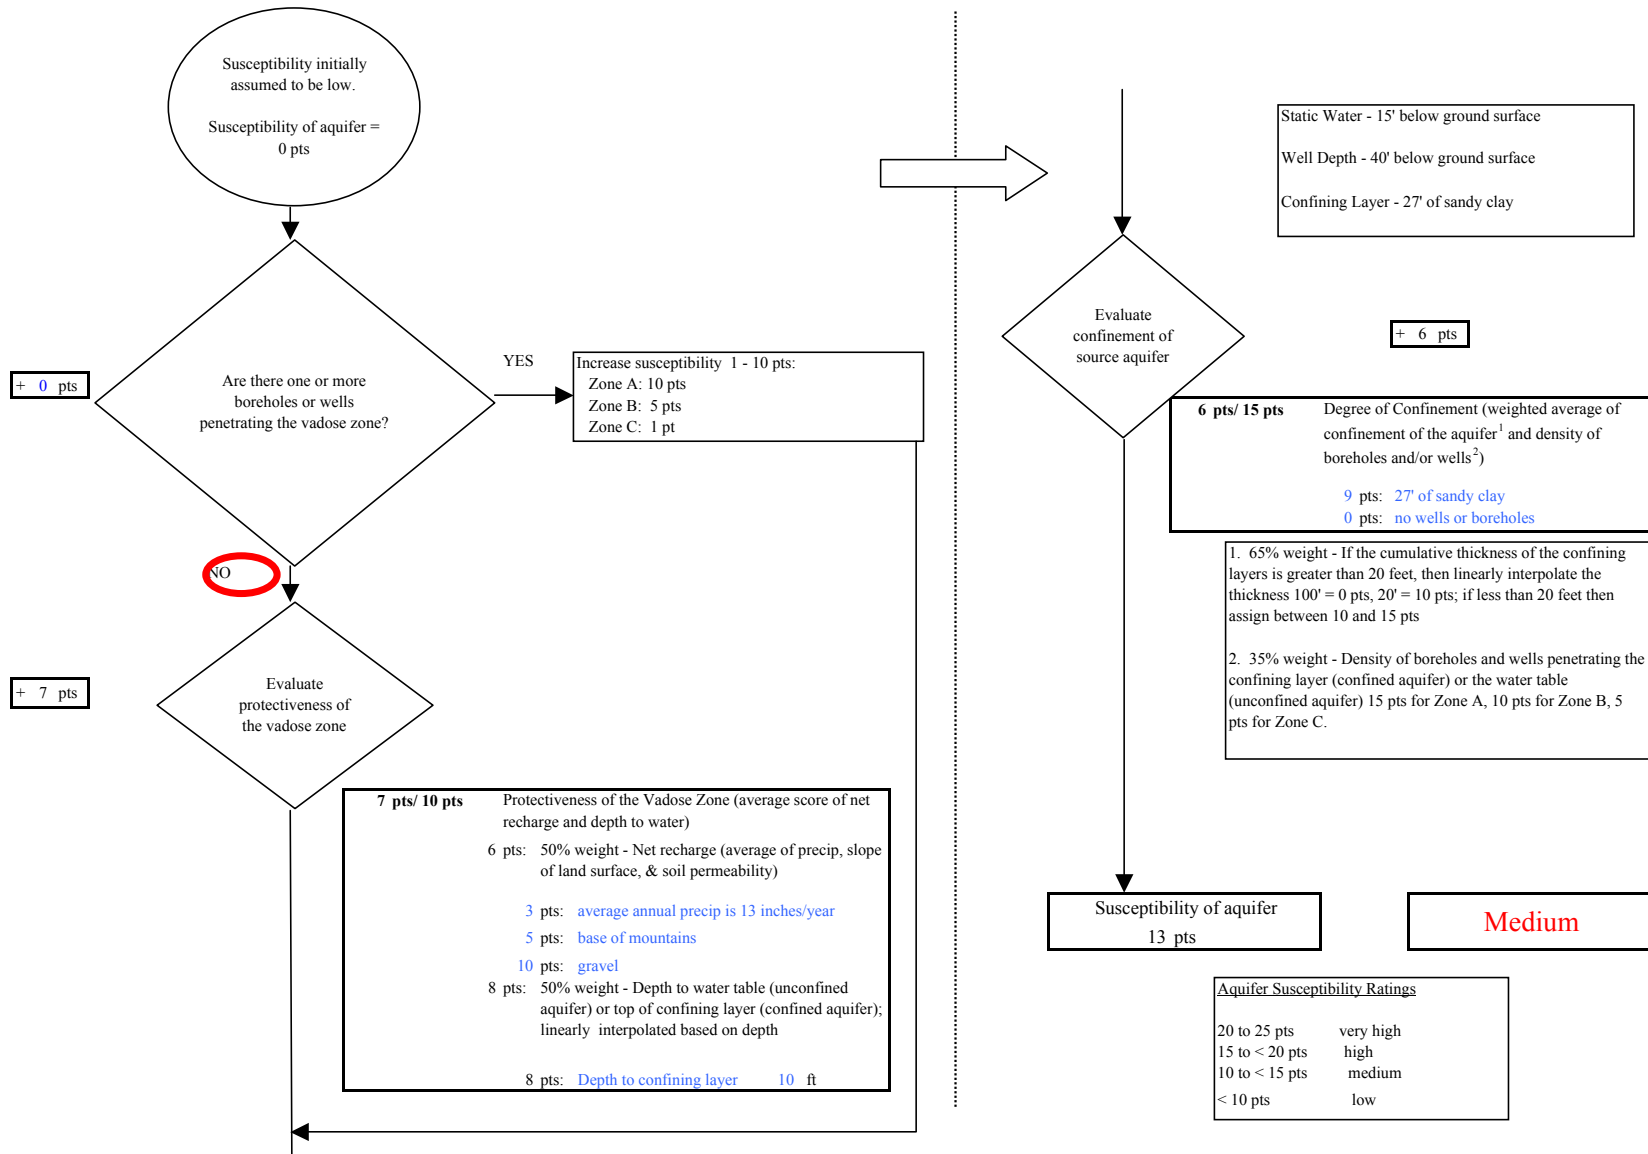

**Chart 3. Contaminant risks for Copper River School District - Slana School (PWS No.381503.001) - Bacteria & Viruses**

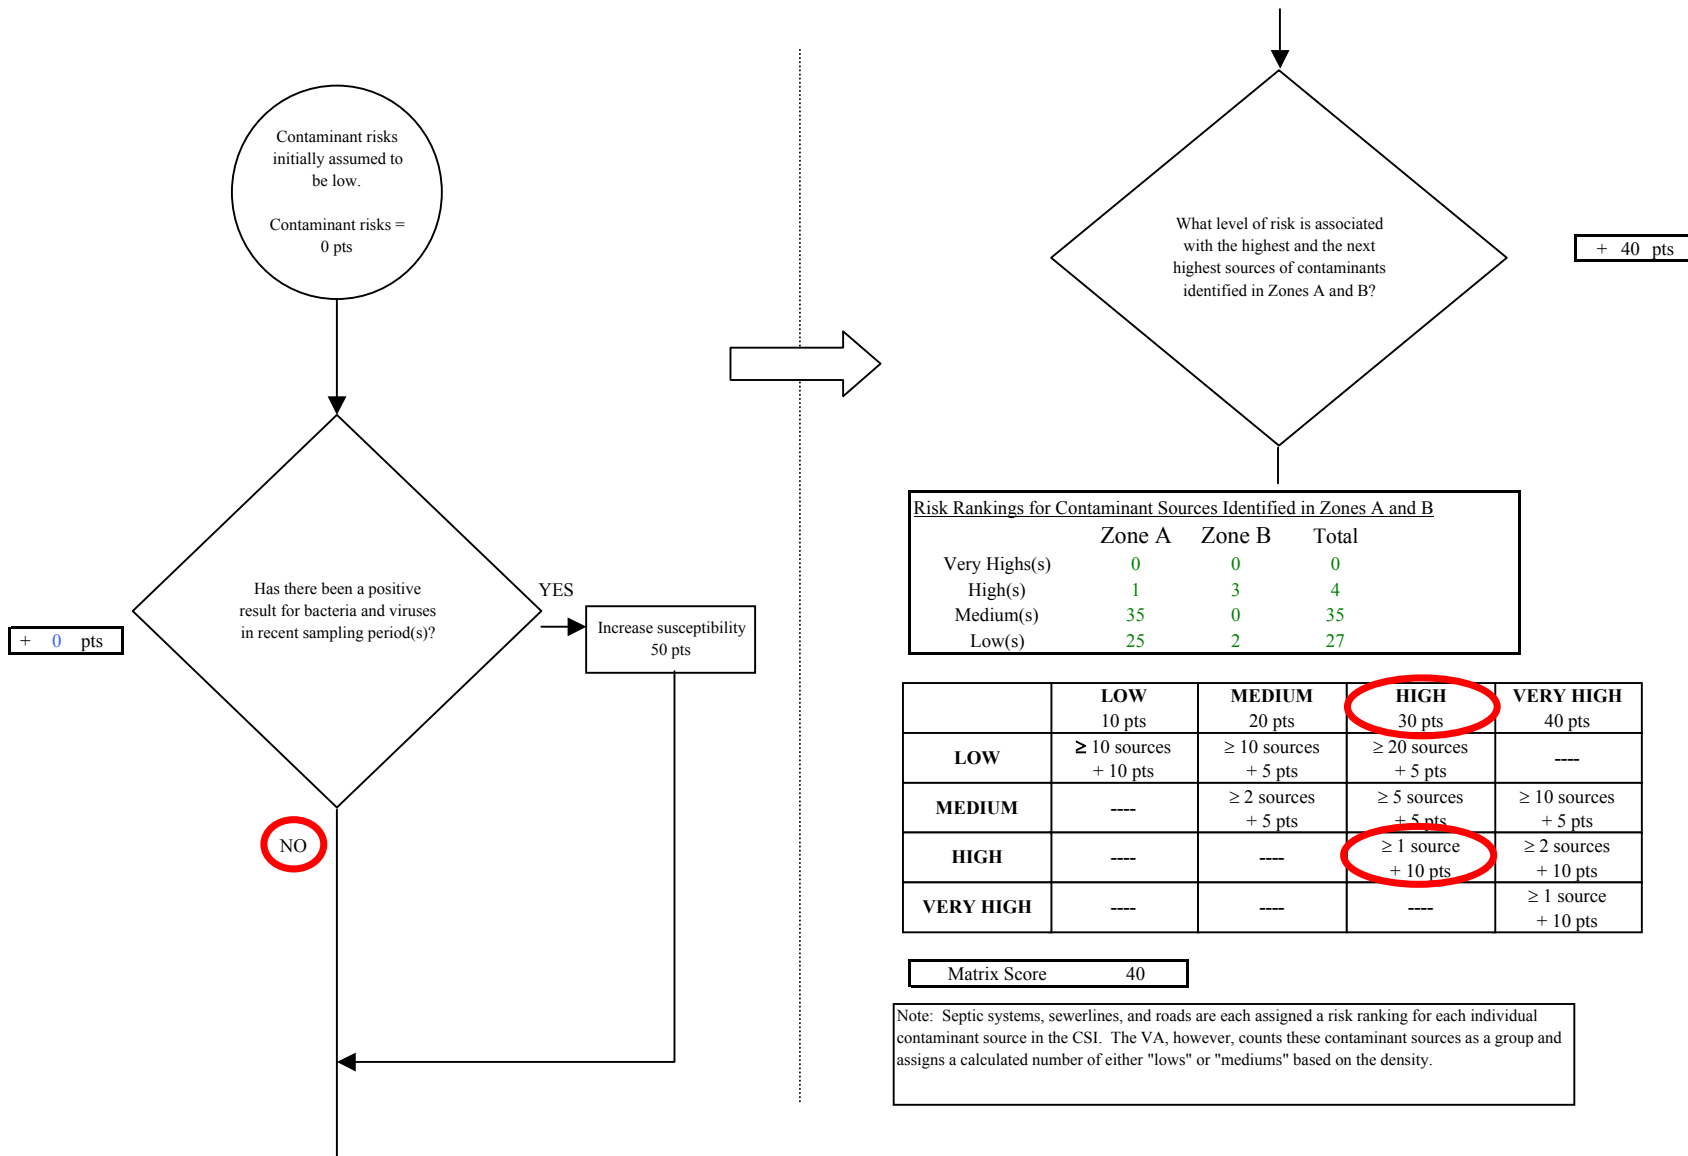

**Chart 3. Contaminant risks for Copper River School District - Slana School (PWS No.381503.001) - Bacteria & Viruses**

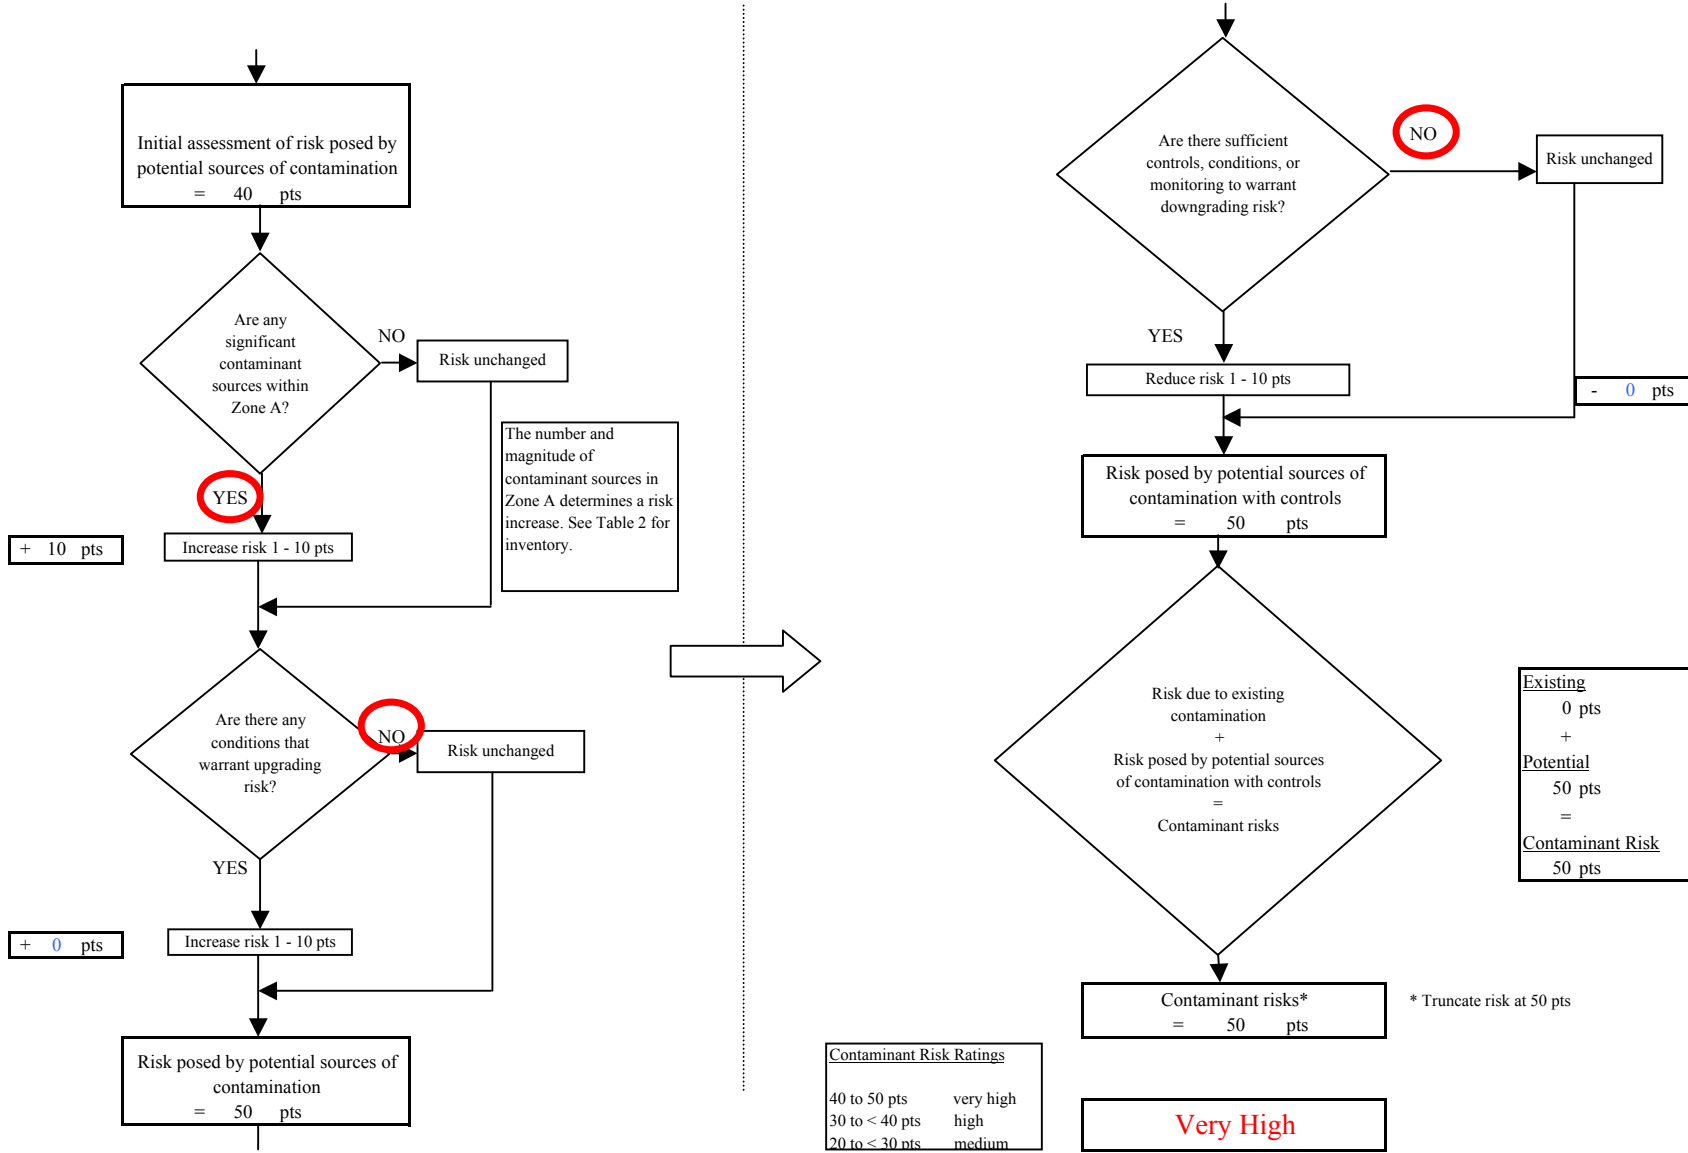



**Chart 4. Vulnerability analysis for Copper River School District - Slana School (PWS No.381503.001) - Bacteria & Viruses**

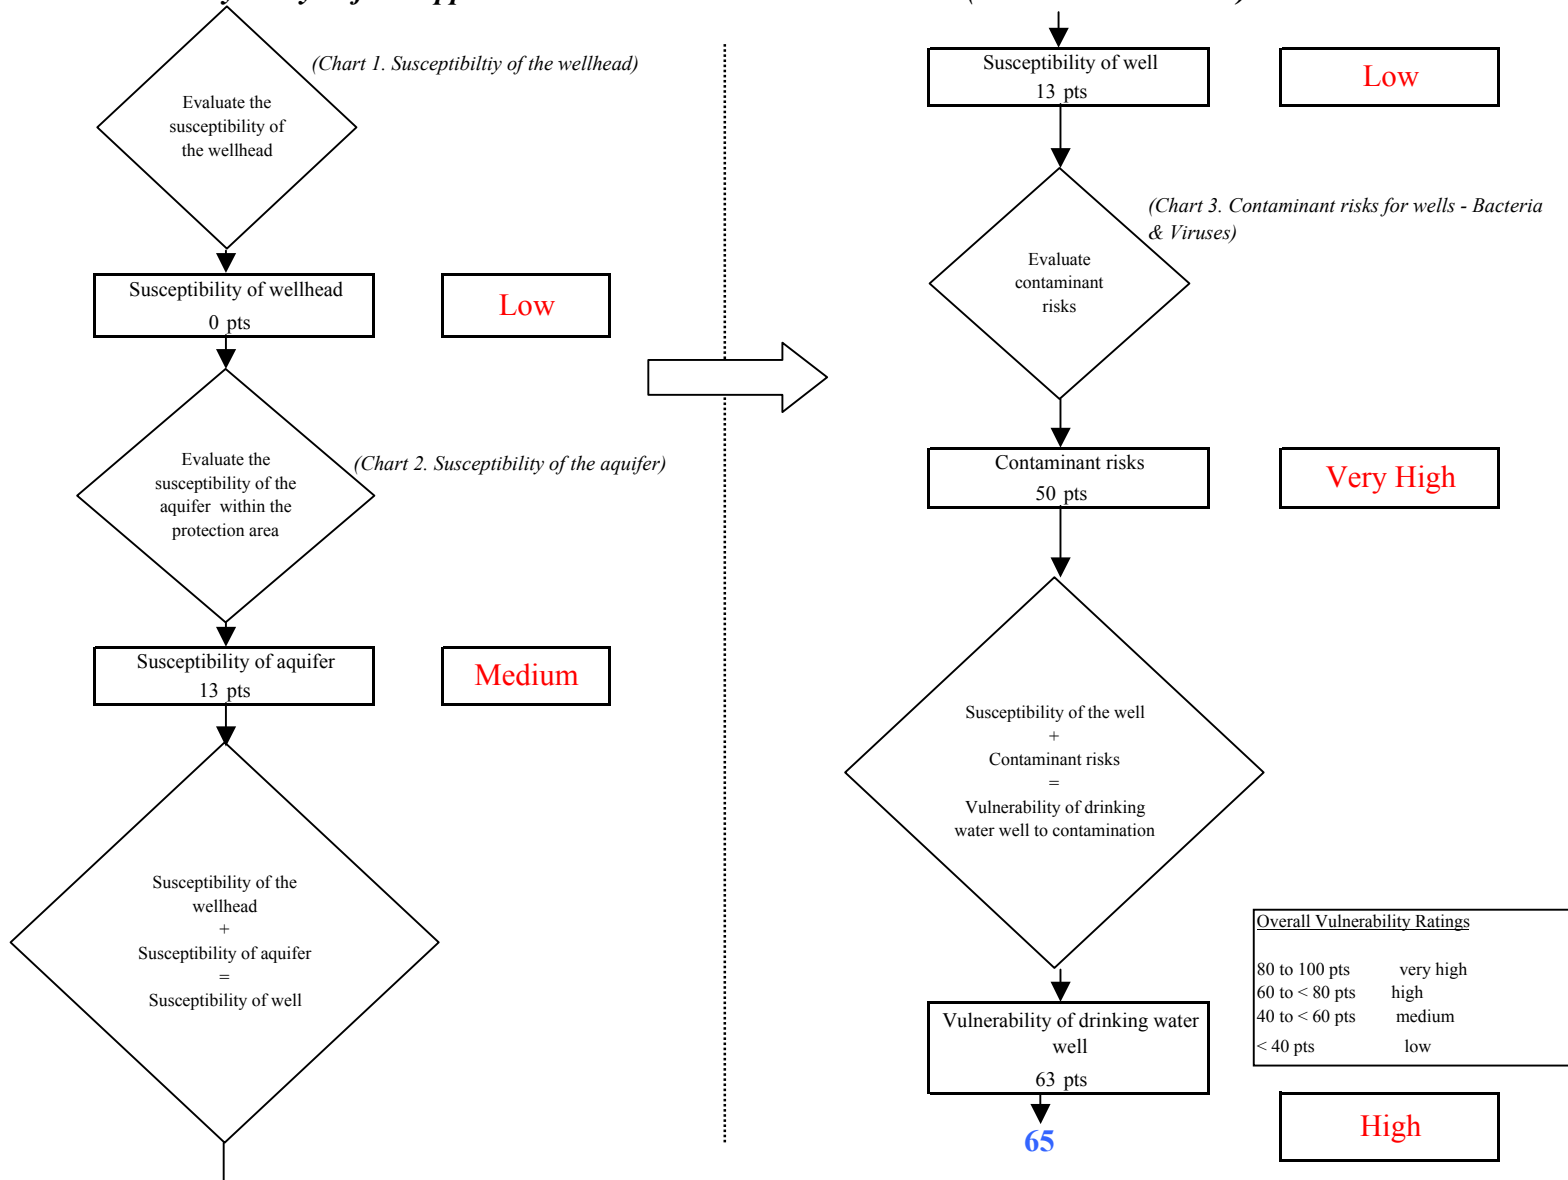


Chart 5. Contaminant risks for Copper River School District - Slana School (PWS No.381503.001) - Nitrates and Nitrites





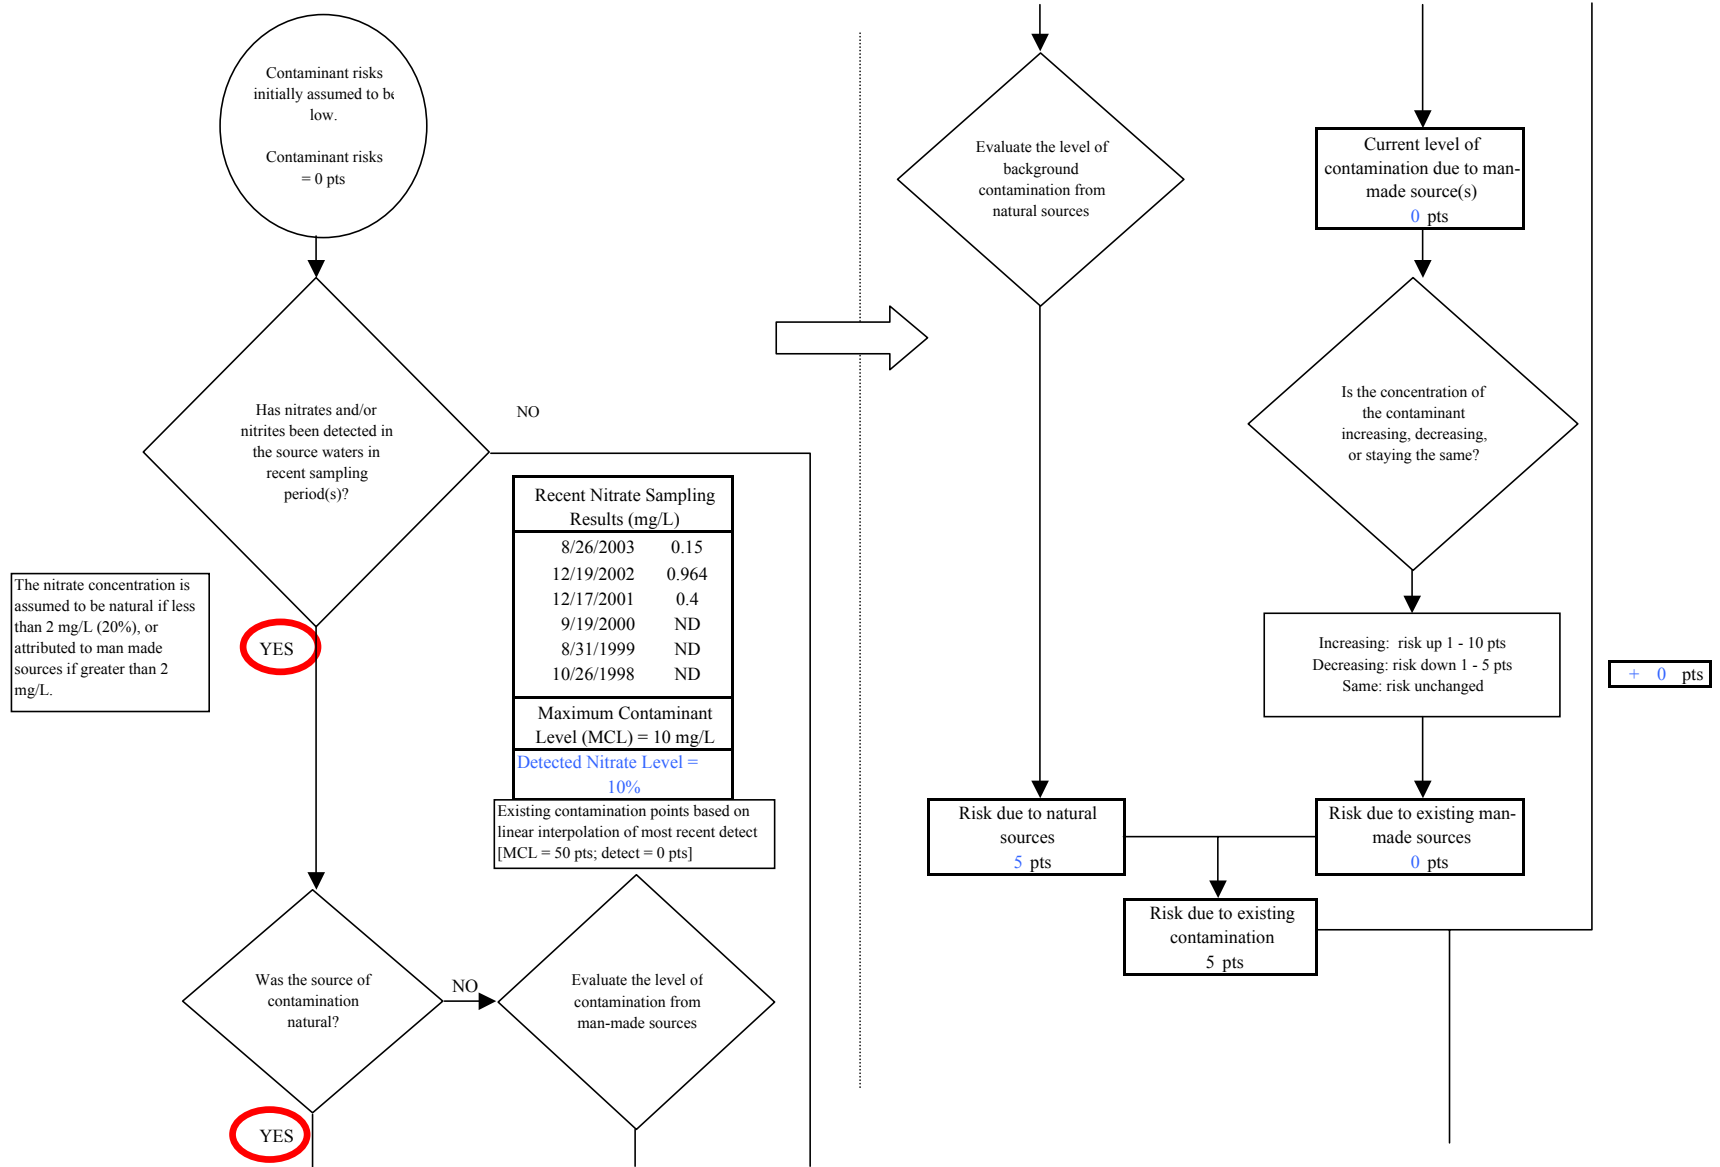



Chart 5. Contaminant risks for Copper River School District - Slana School (PWS No.381503.001) - Nitrates and Nitrites

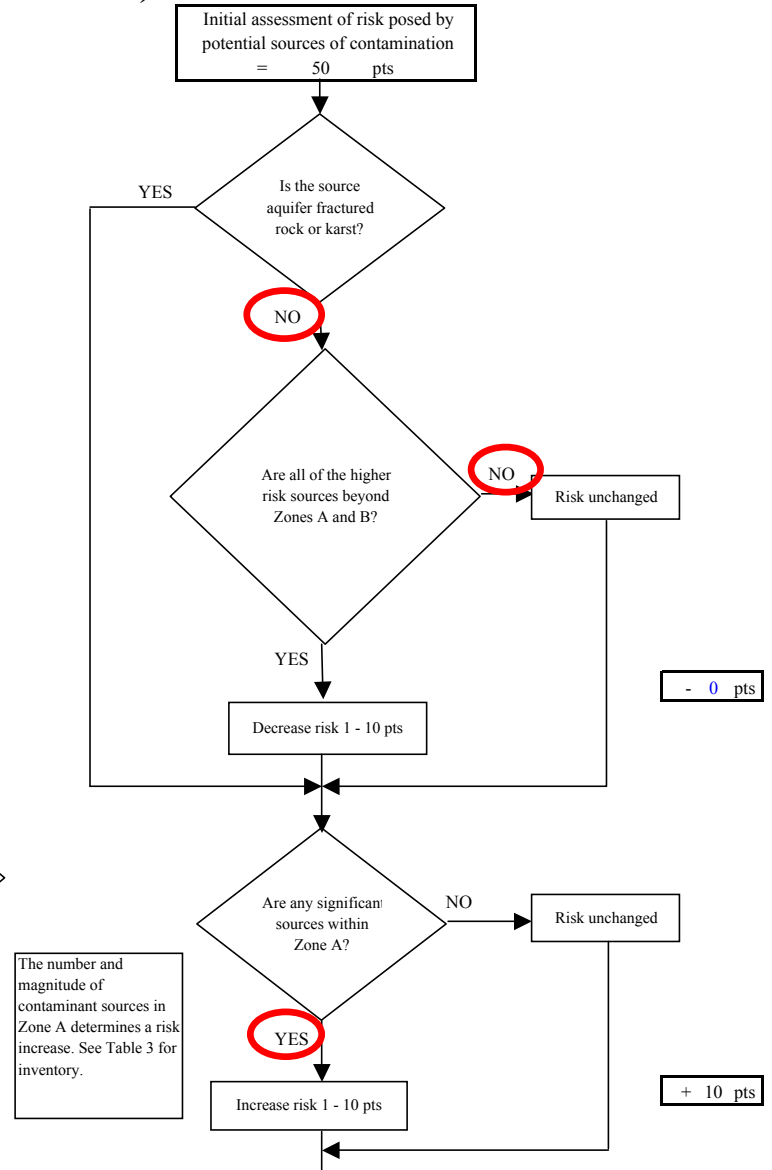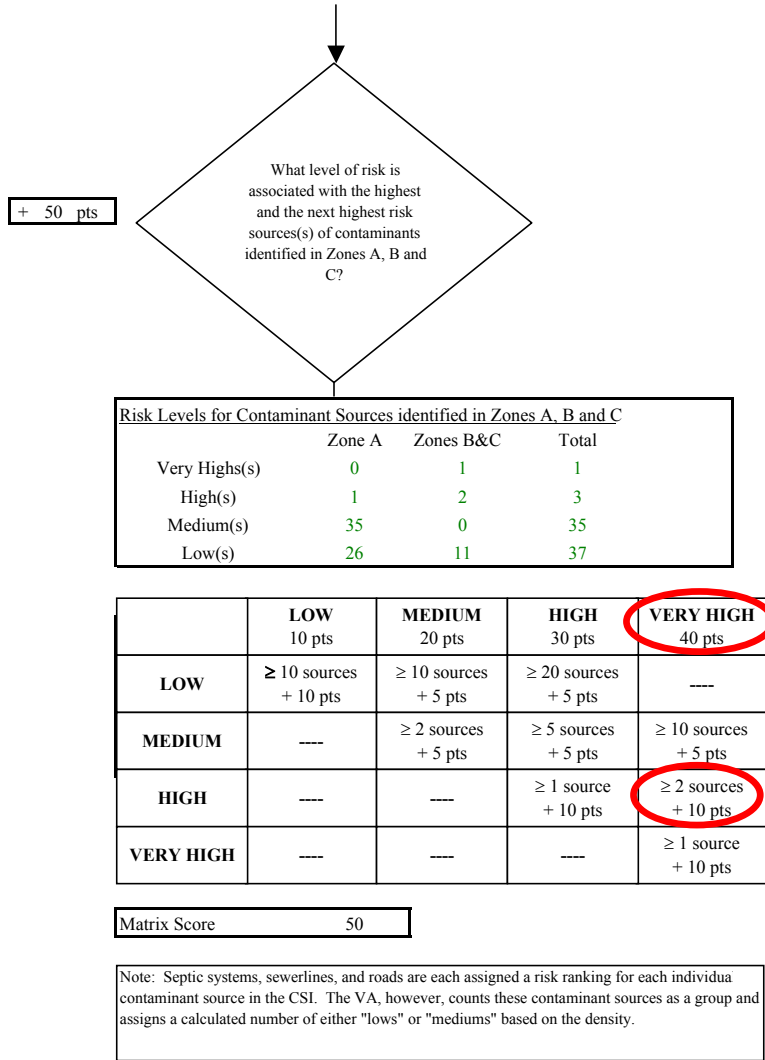


**Chart 5. Contaminant risks for Copper River School District - Slana School (PWS No.381503.001) - Nitrates and Nitrites**

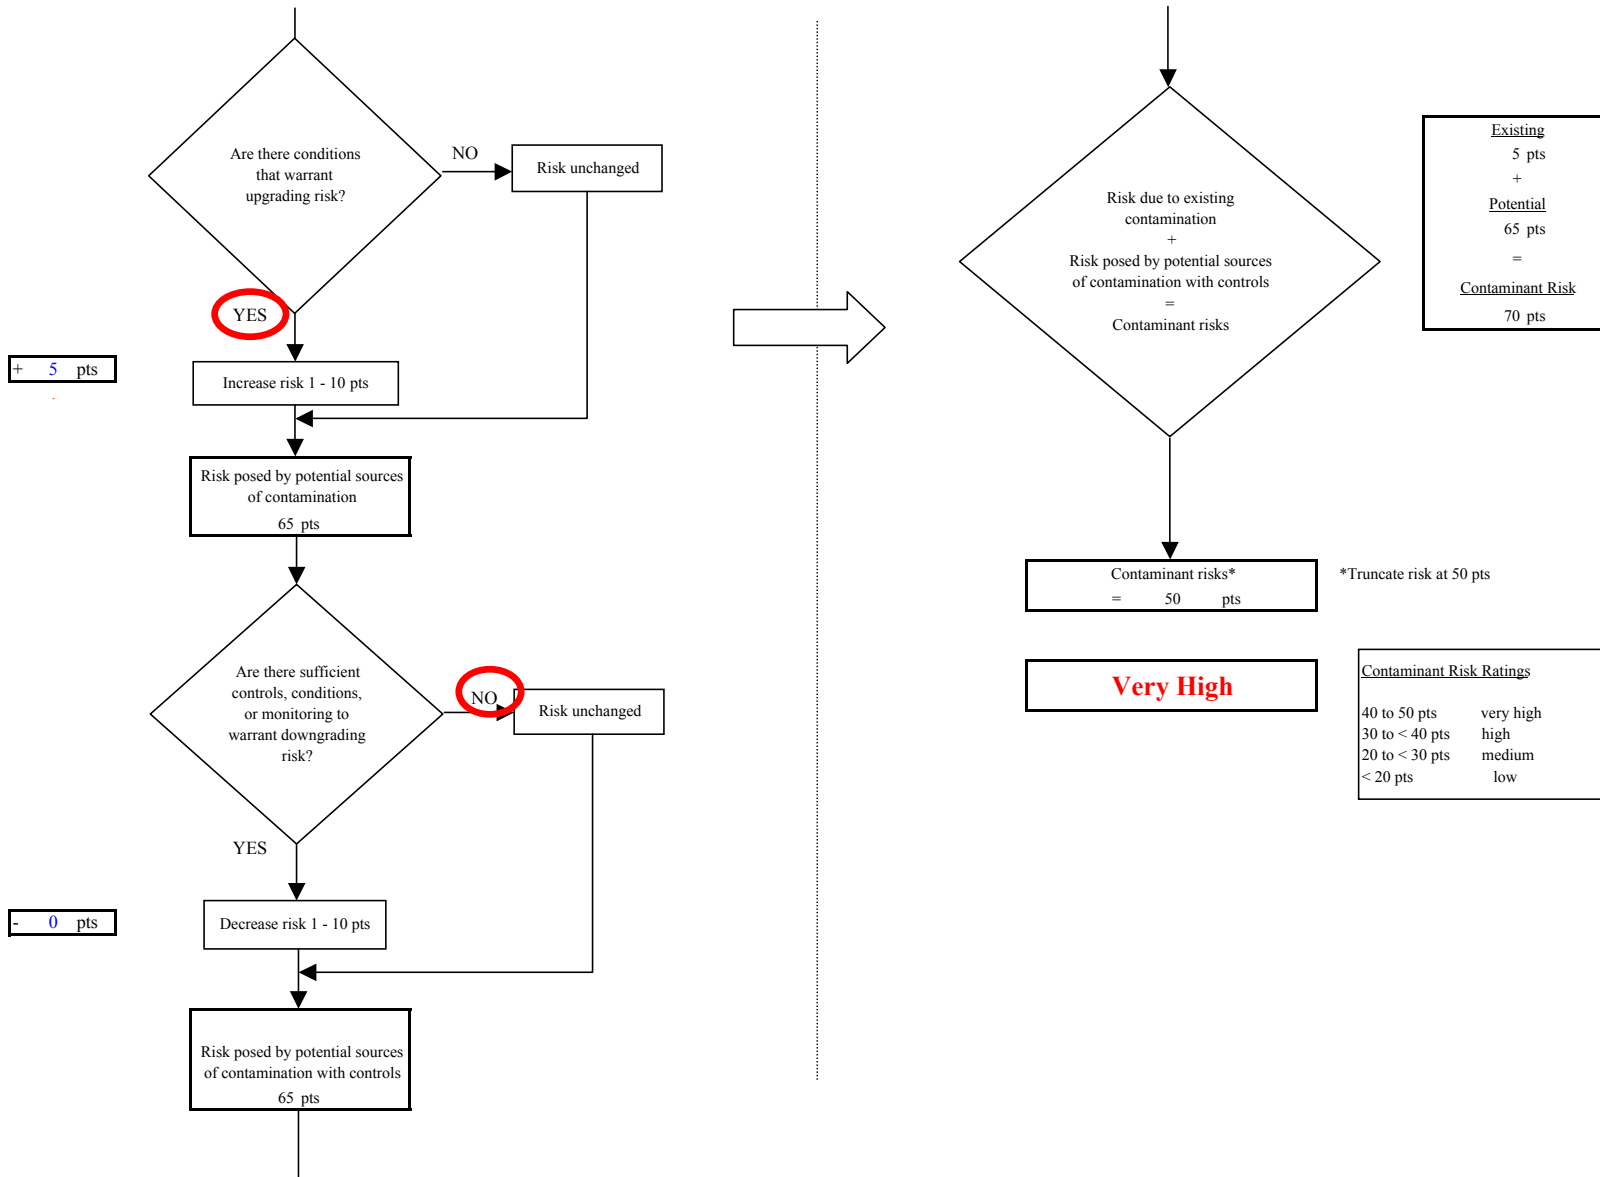


**Chart 6. Vulnerability analysis for Copper River School District - Slana School (PWS No.381503.001) - Nitrates and Nitrites**

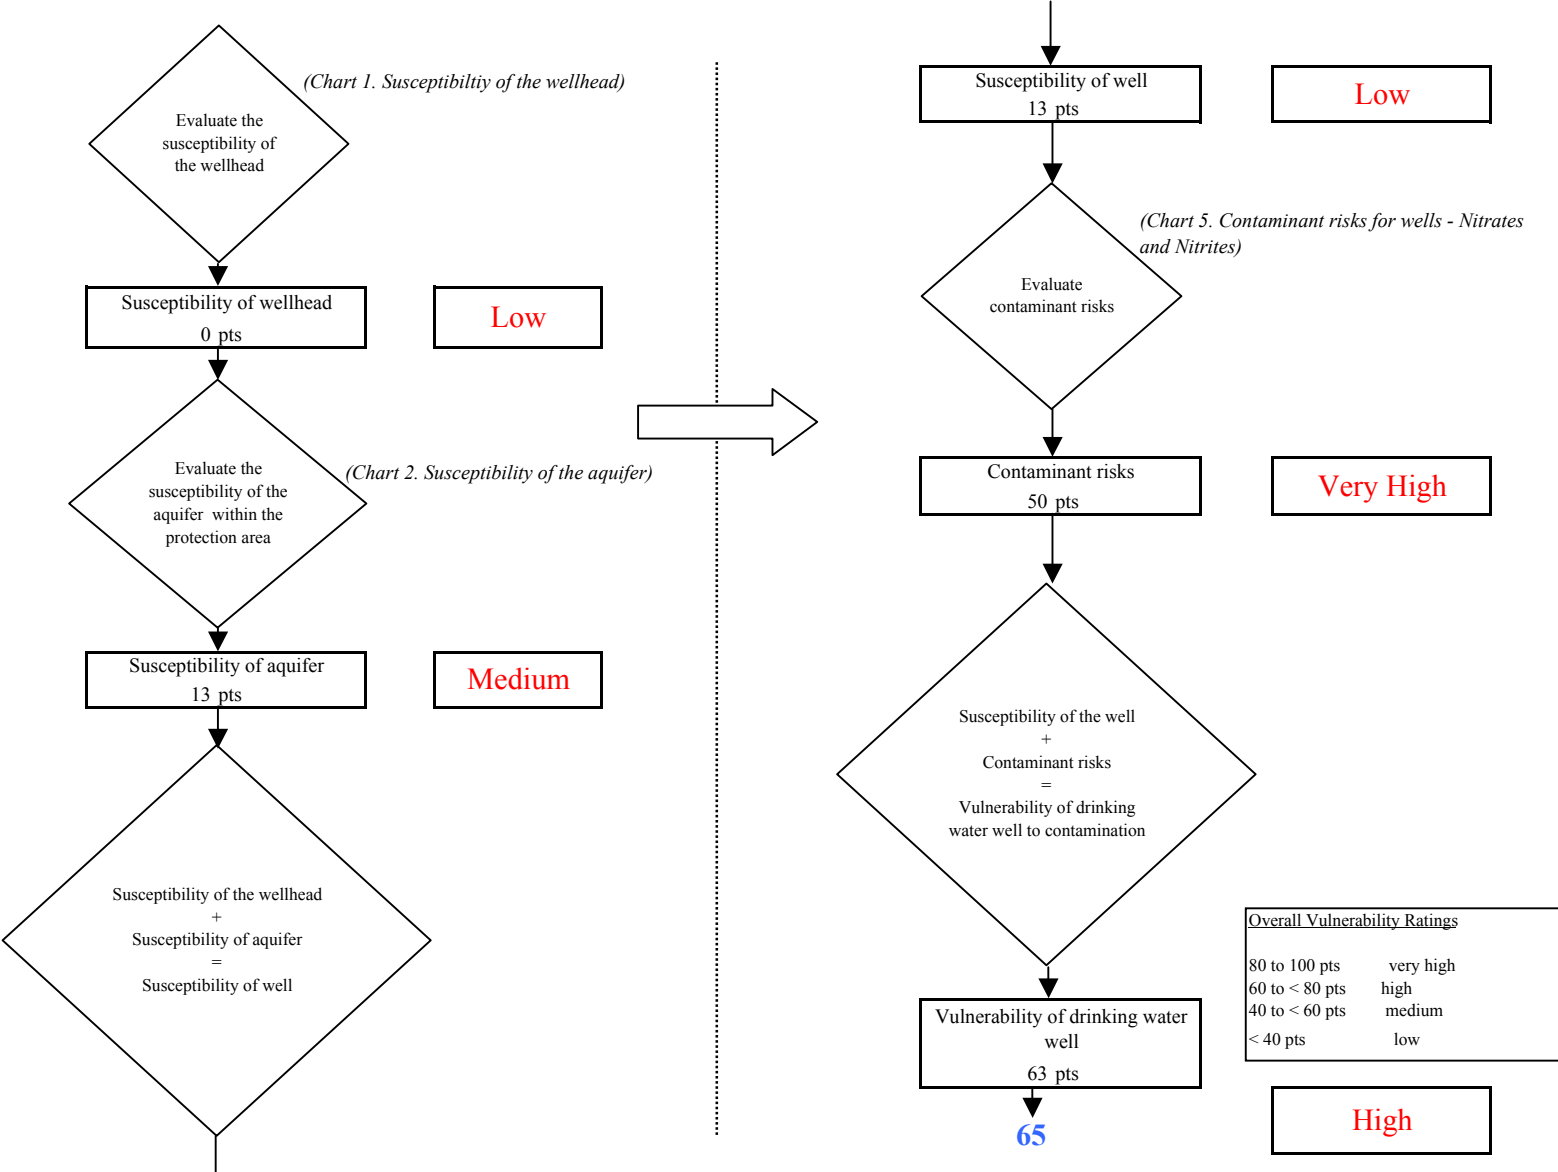


**Chart 7. Contaminant risks for Copper River School District - Slana School (PWS No.381503.001) - Volatile Organic Chemicals**

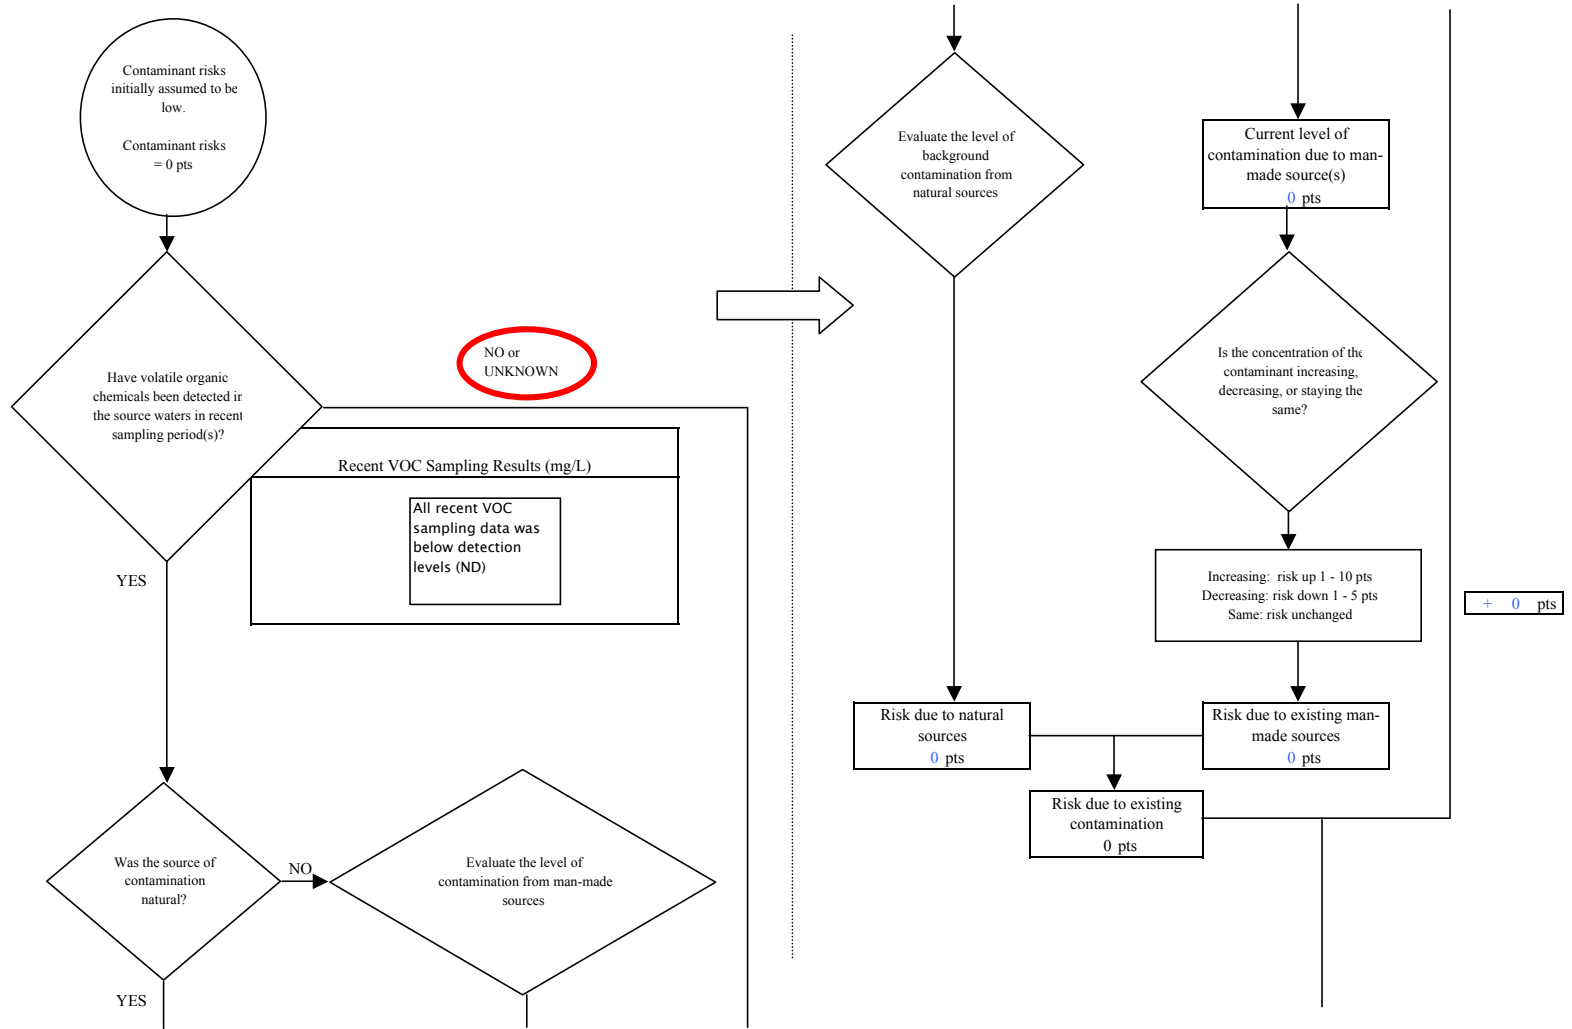

**Chart 7. Contaminant risks for Copper River School District - Slana School (PWS No.381503.001) - Volatile Organic Chemicals**

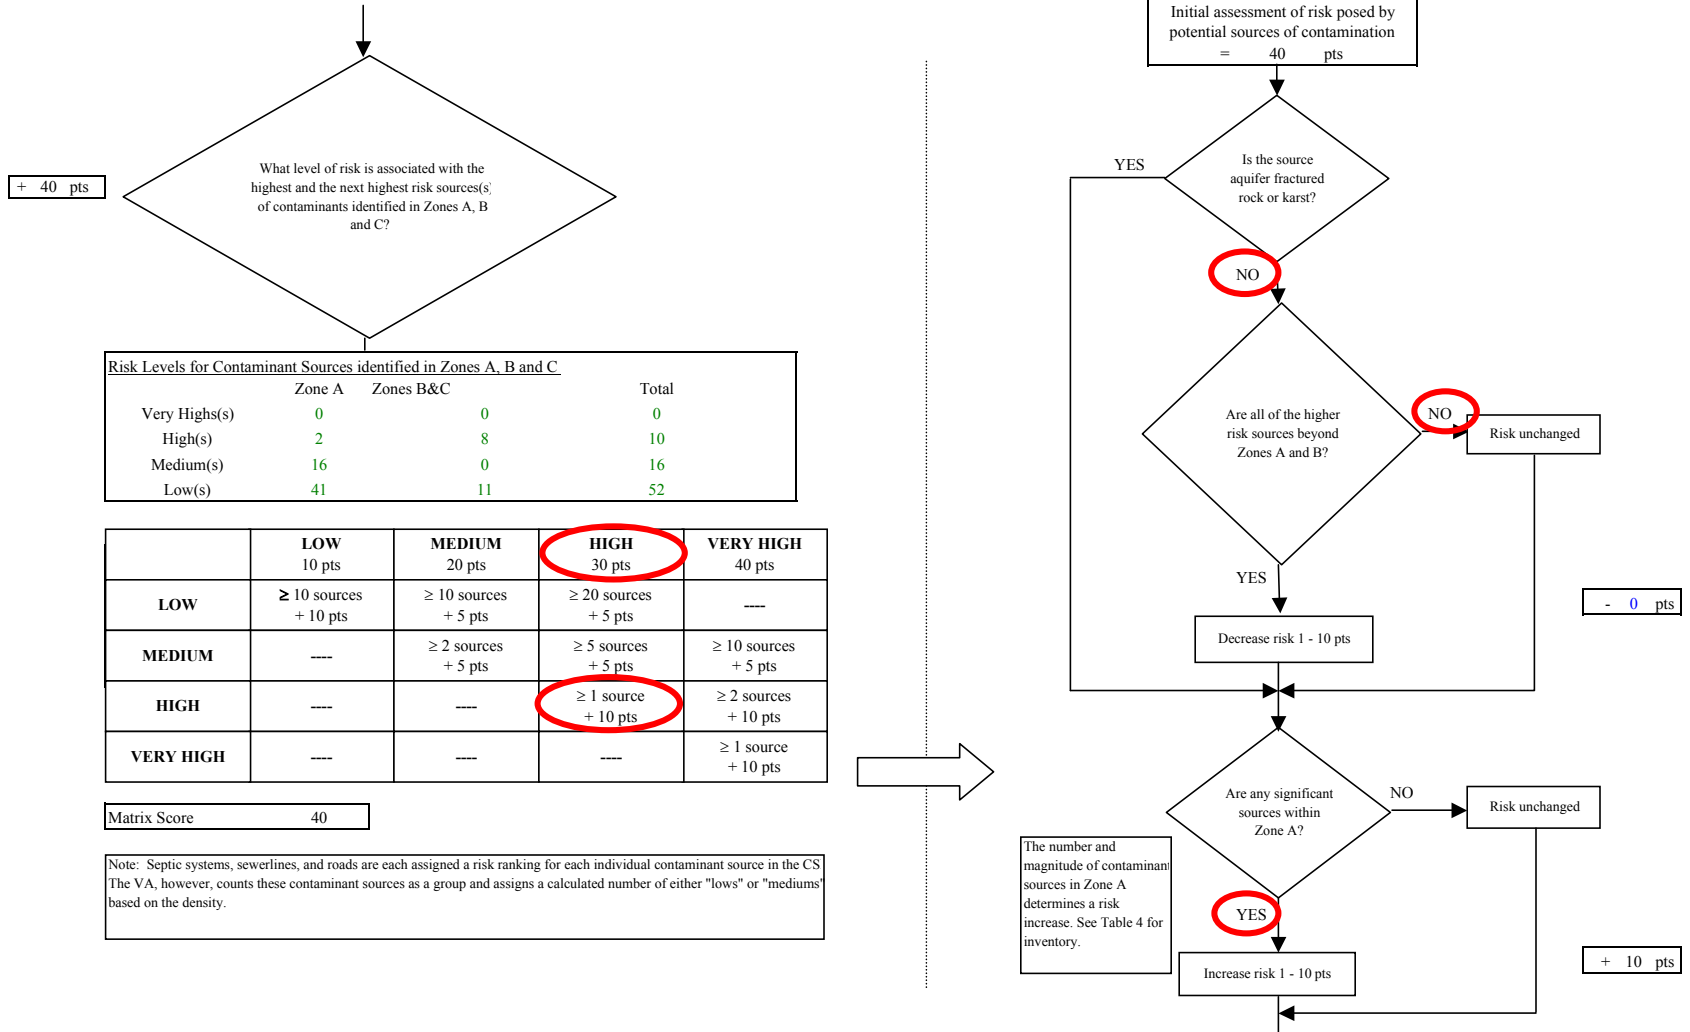


**Chart 7. Contaminant risks for Copper River School District - Slana School (PWS No.381503.001) - Volatile Organic Chemicals**

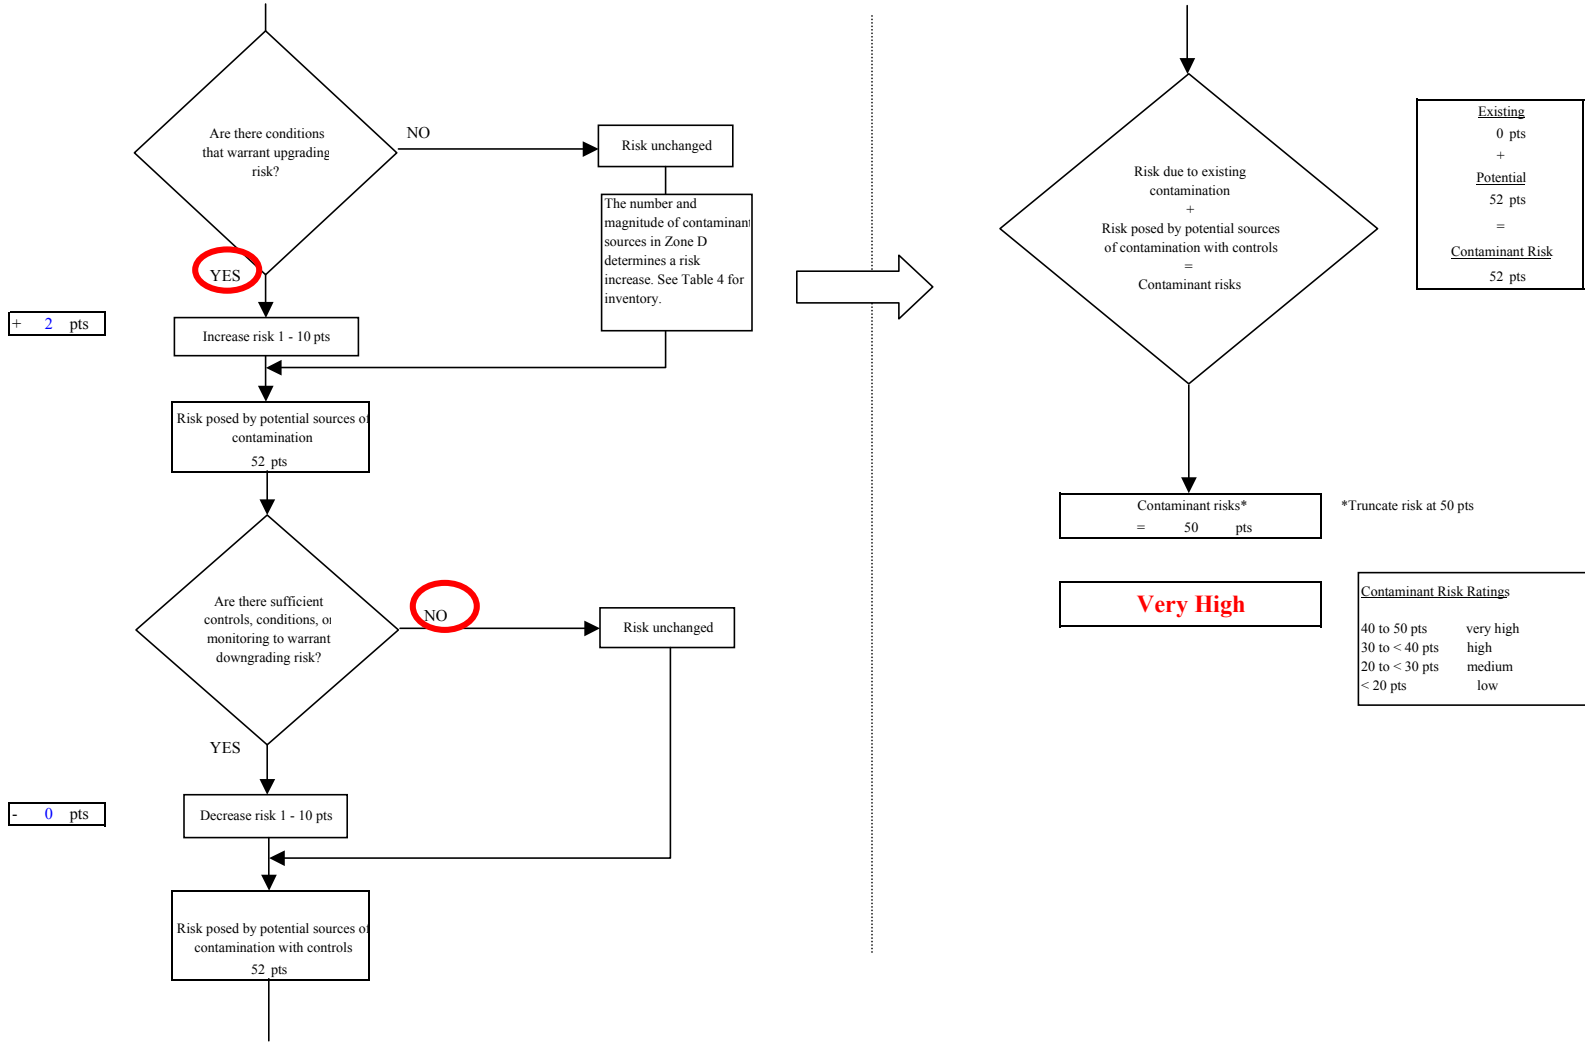



**Chart 8. Vulnerability analysis for Copper River School District - Slana School (PWS No.381503.001) - Volatile Organic Chemicals**

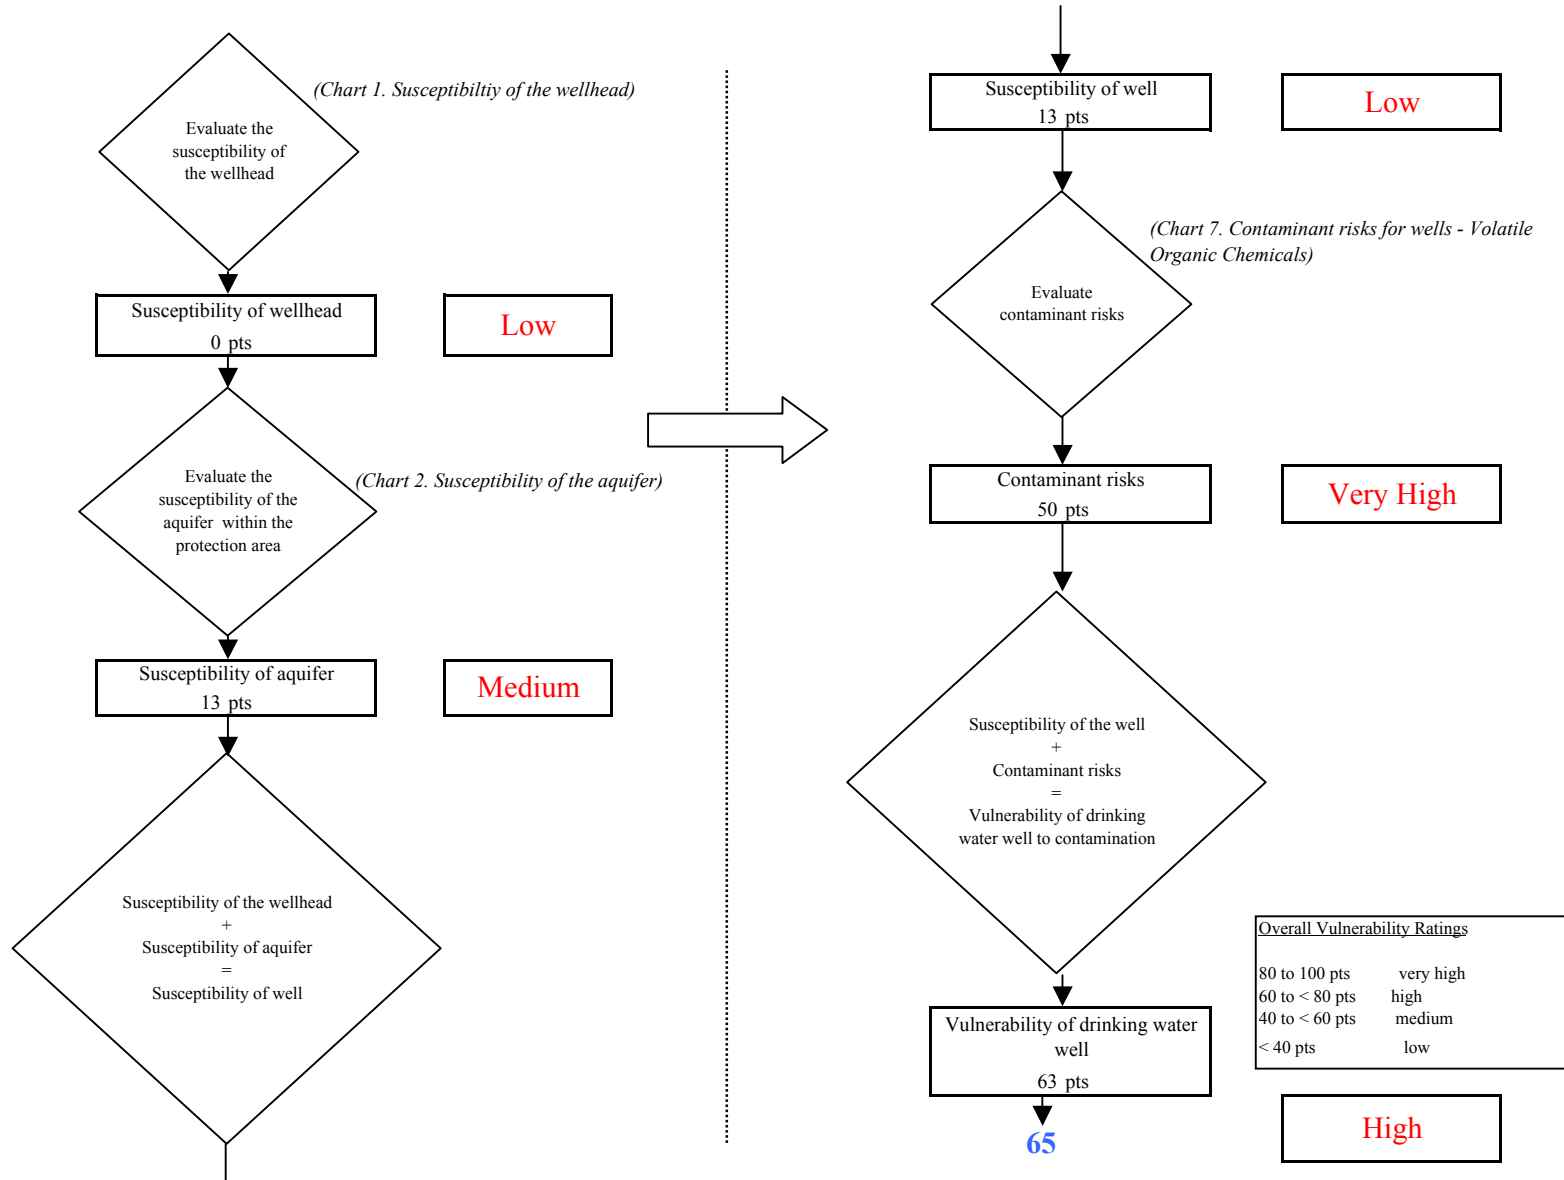

**Chart 9. Contaminant risks for Copper River School District - Slana School (PWS No.381503.001) - Heavy Metals, Cyanide and Other Inorganic Chemicals**




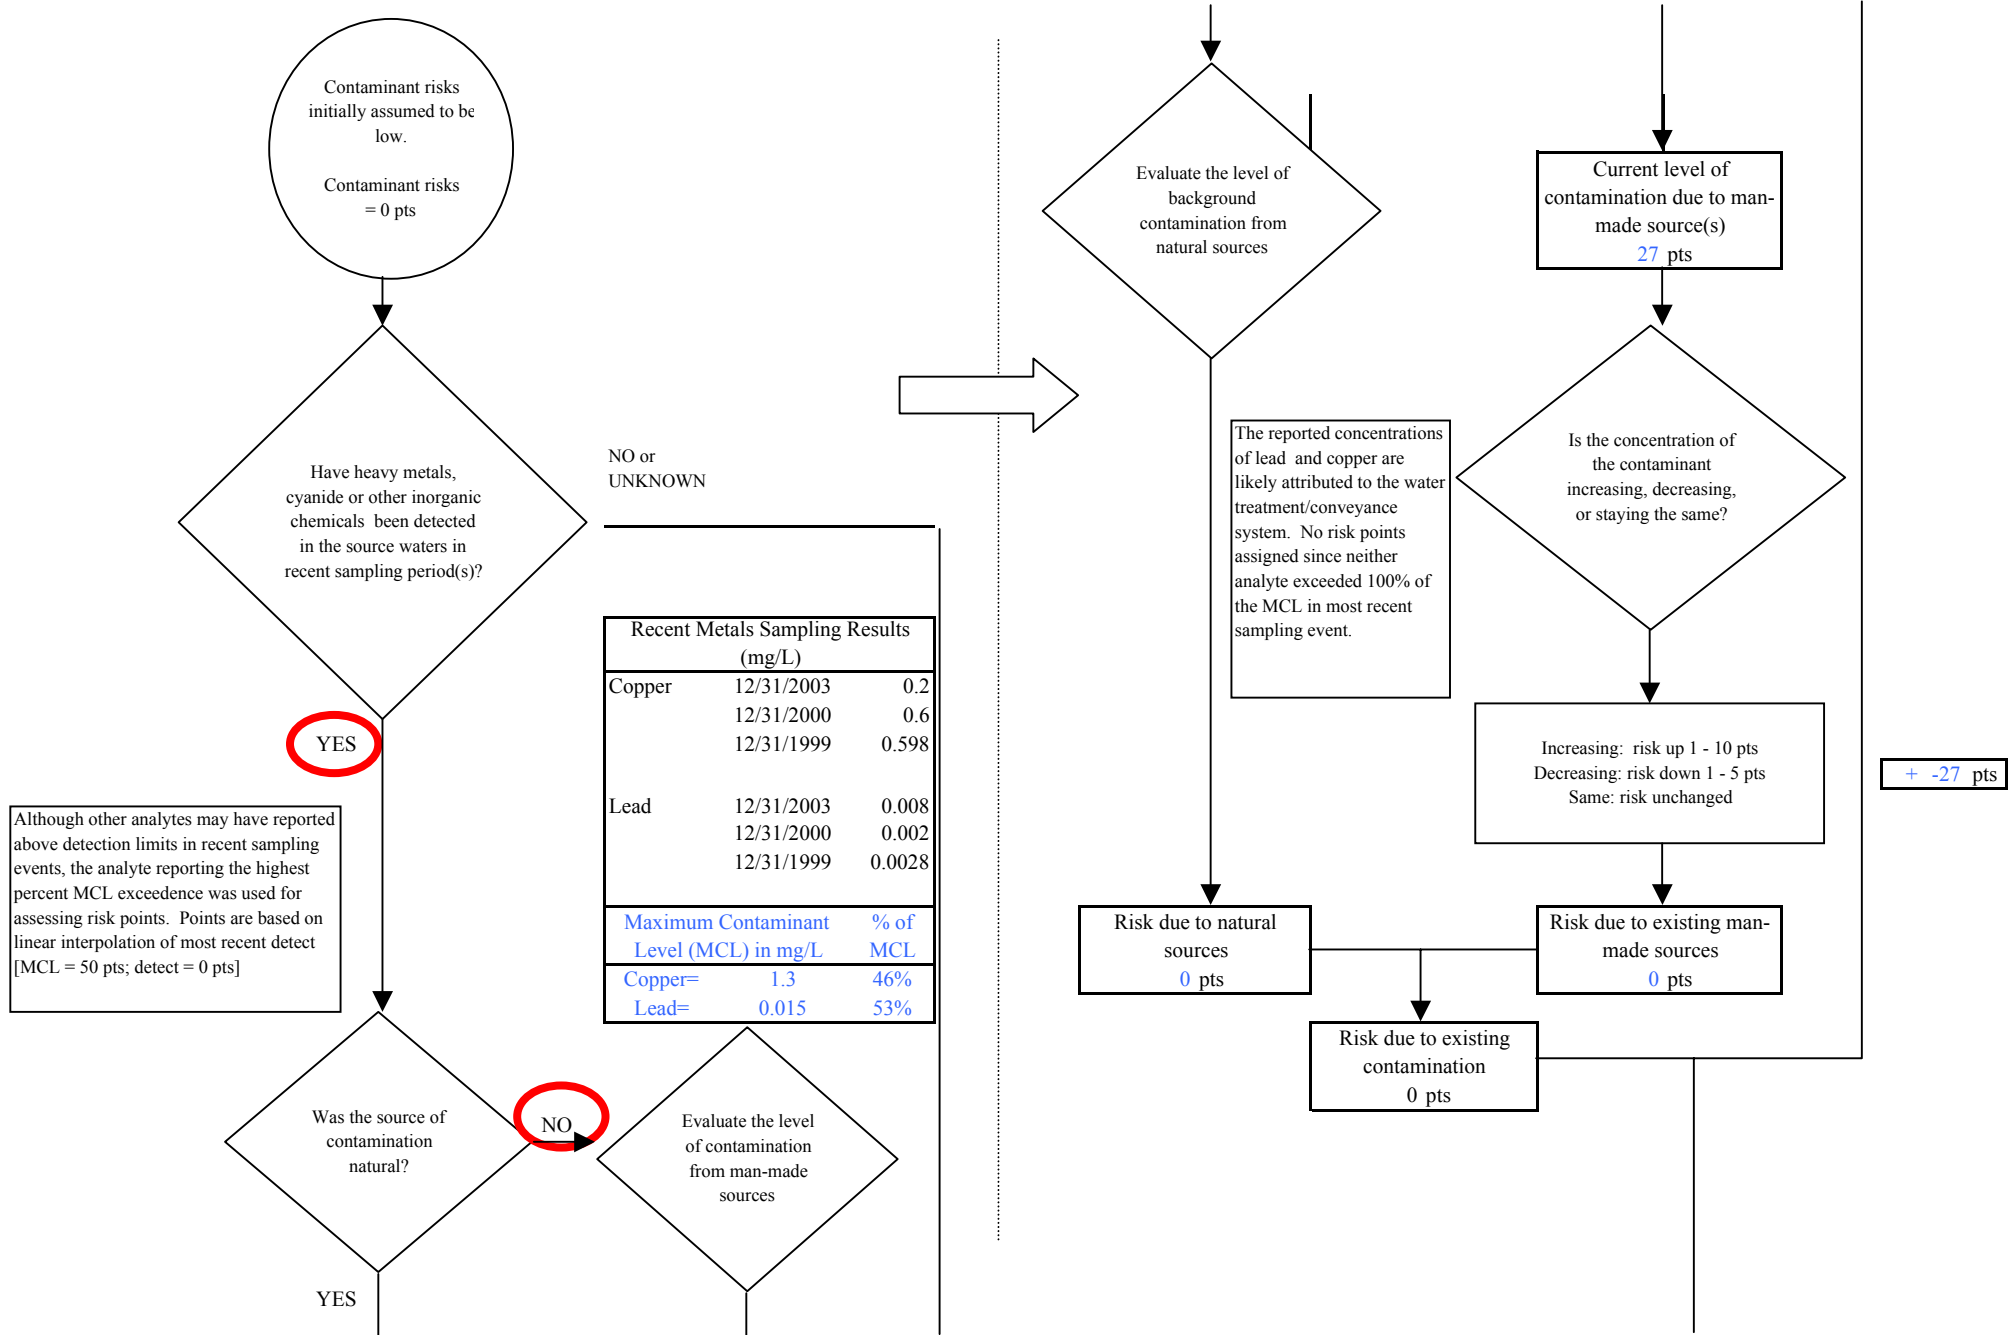



Chart 9. Contaminant risks for Copper River School District - Slana School (PWS No.381503.001) - Heavy Metals, Cyanide and Other Inorganic Chemicals

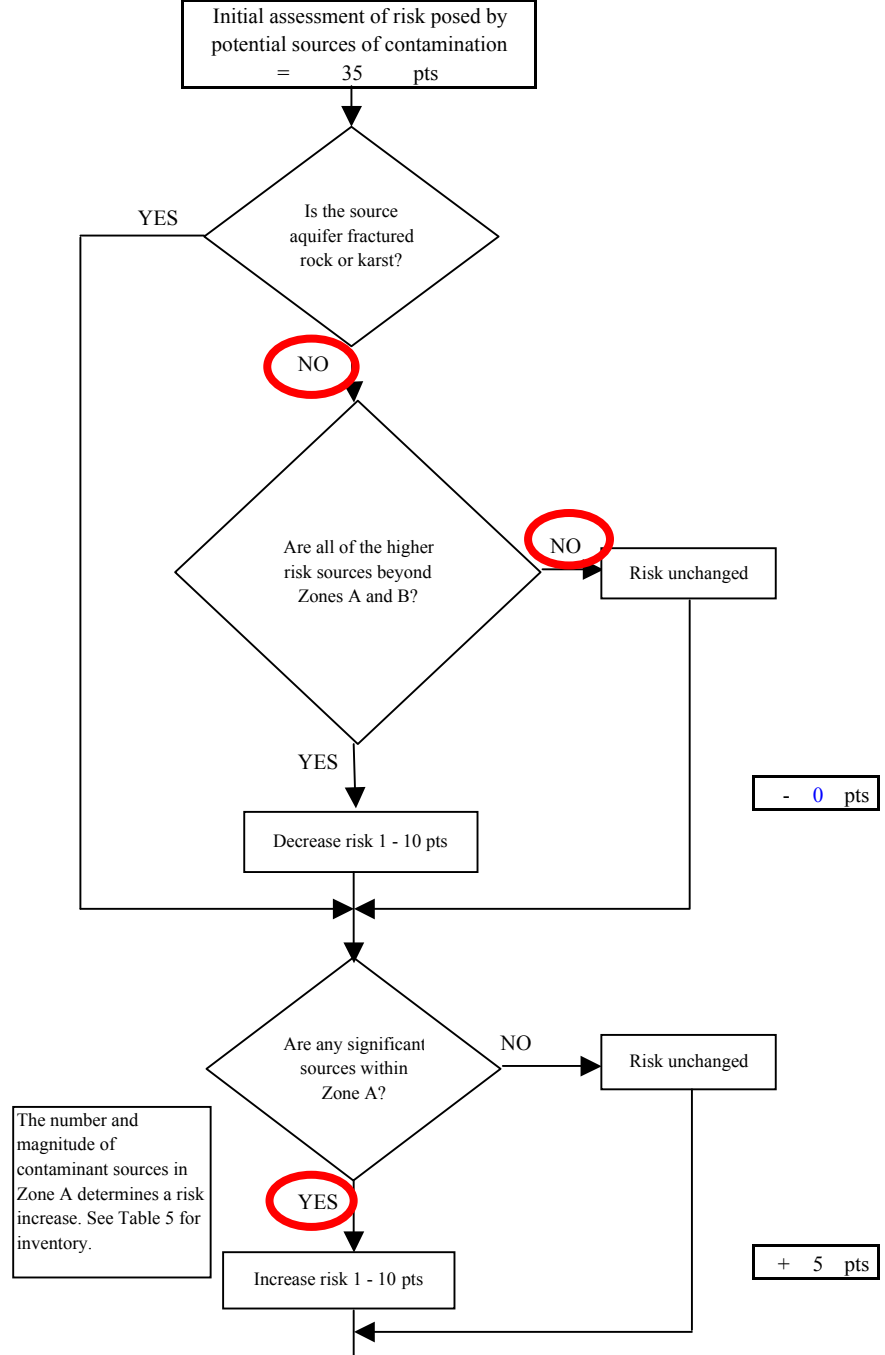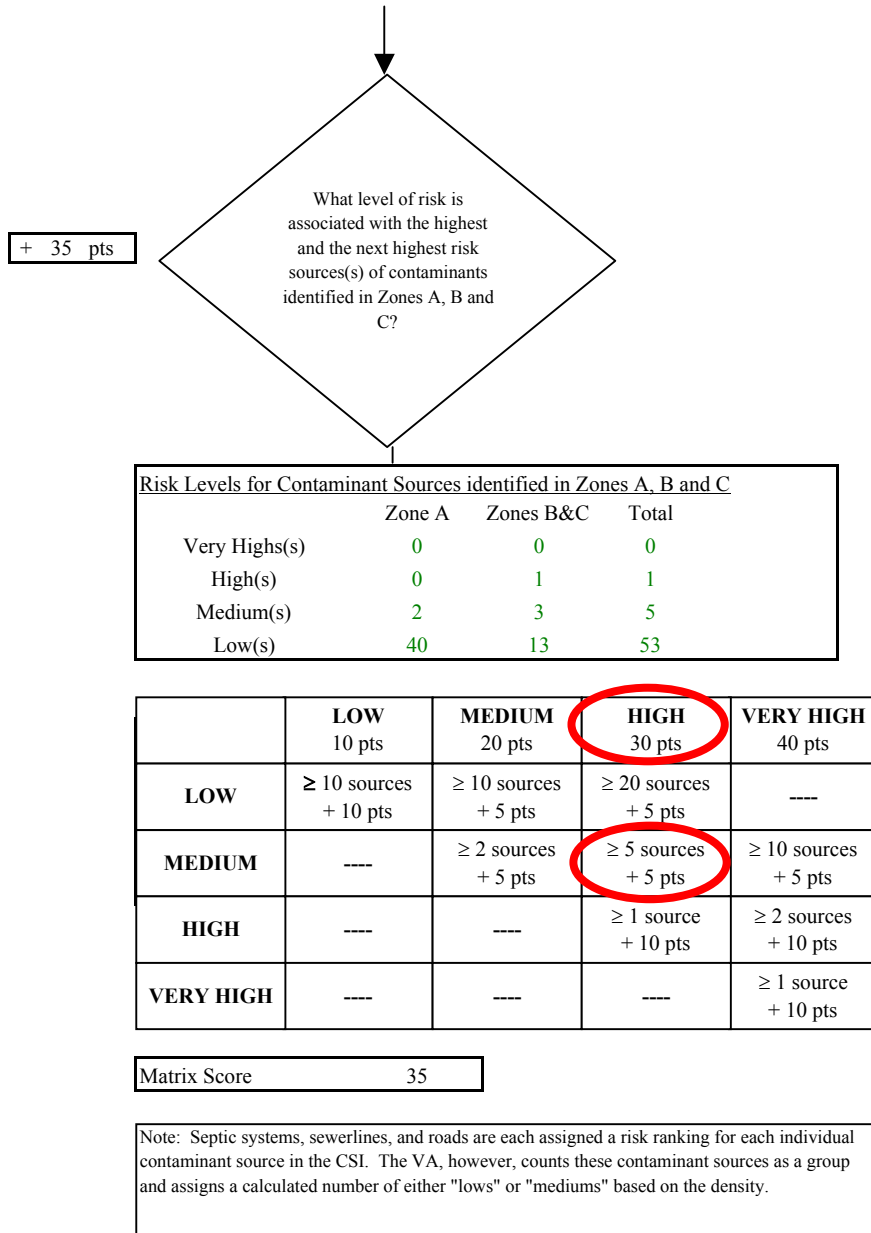


**Chart 9. Contaminant risks for Copper River School District - Slana School (PWS No.381503.001) - Heavy Metals, Cyanide and Other Inorganic Chemicals**

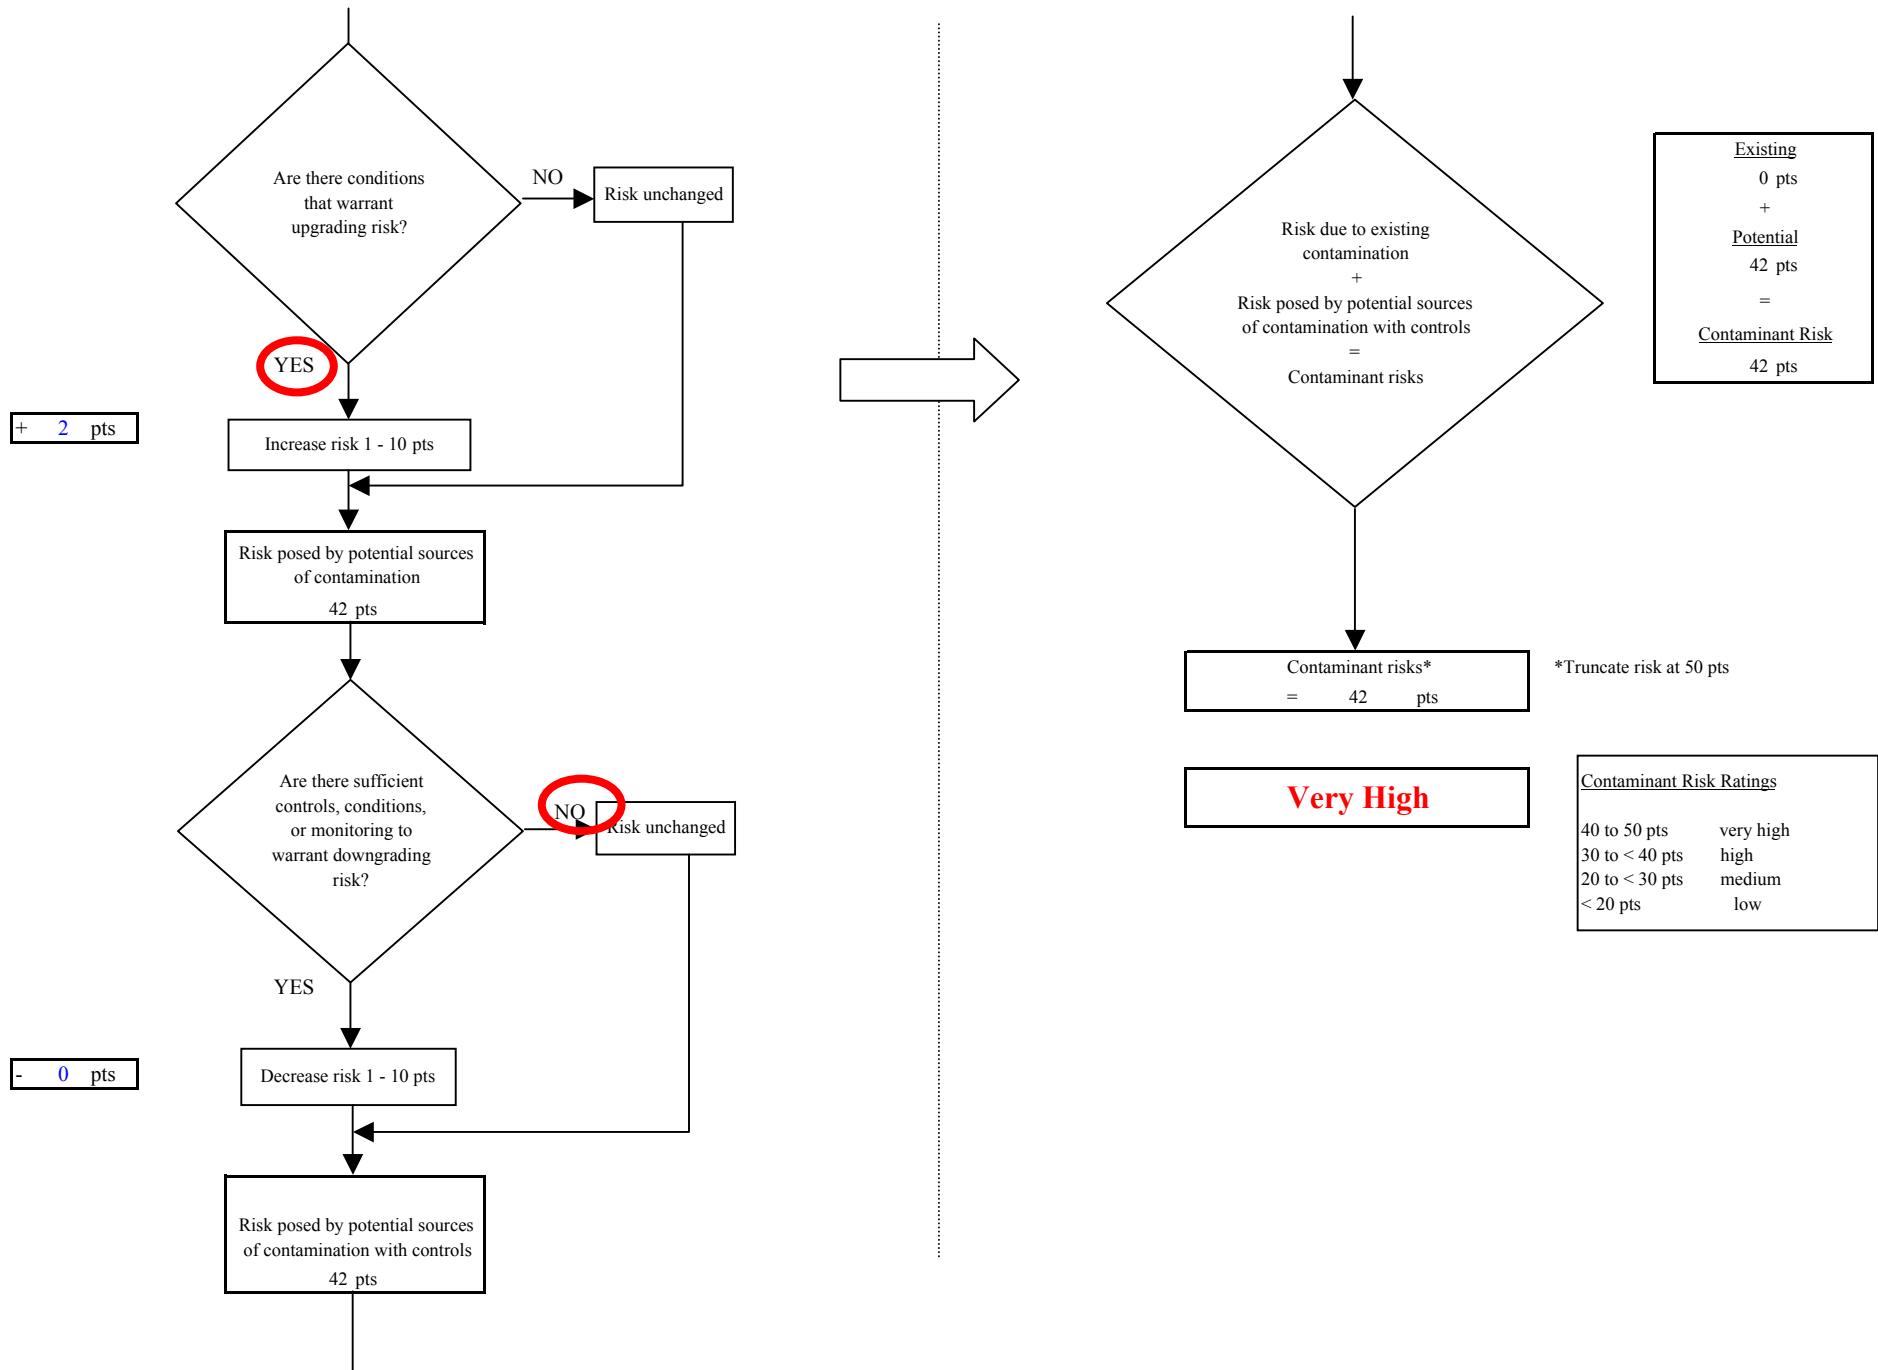




**Chart 10. Vulnerability analysis for Copper River School District - Slana School (PWS No.381503.001) - Heavy Metals, Cyanide and Other Inorganic Chemicals**

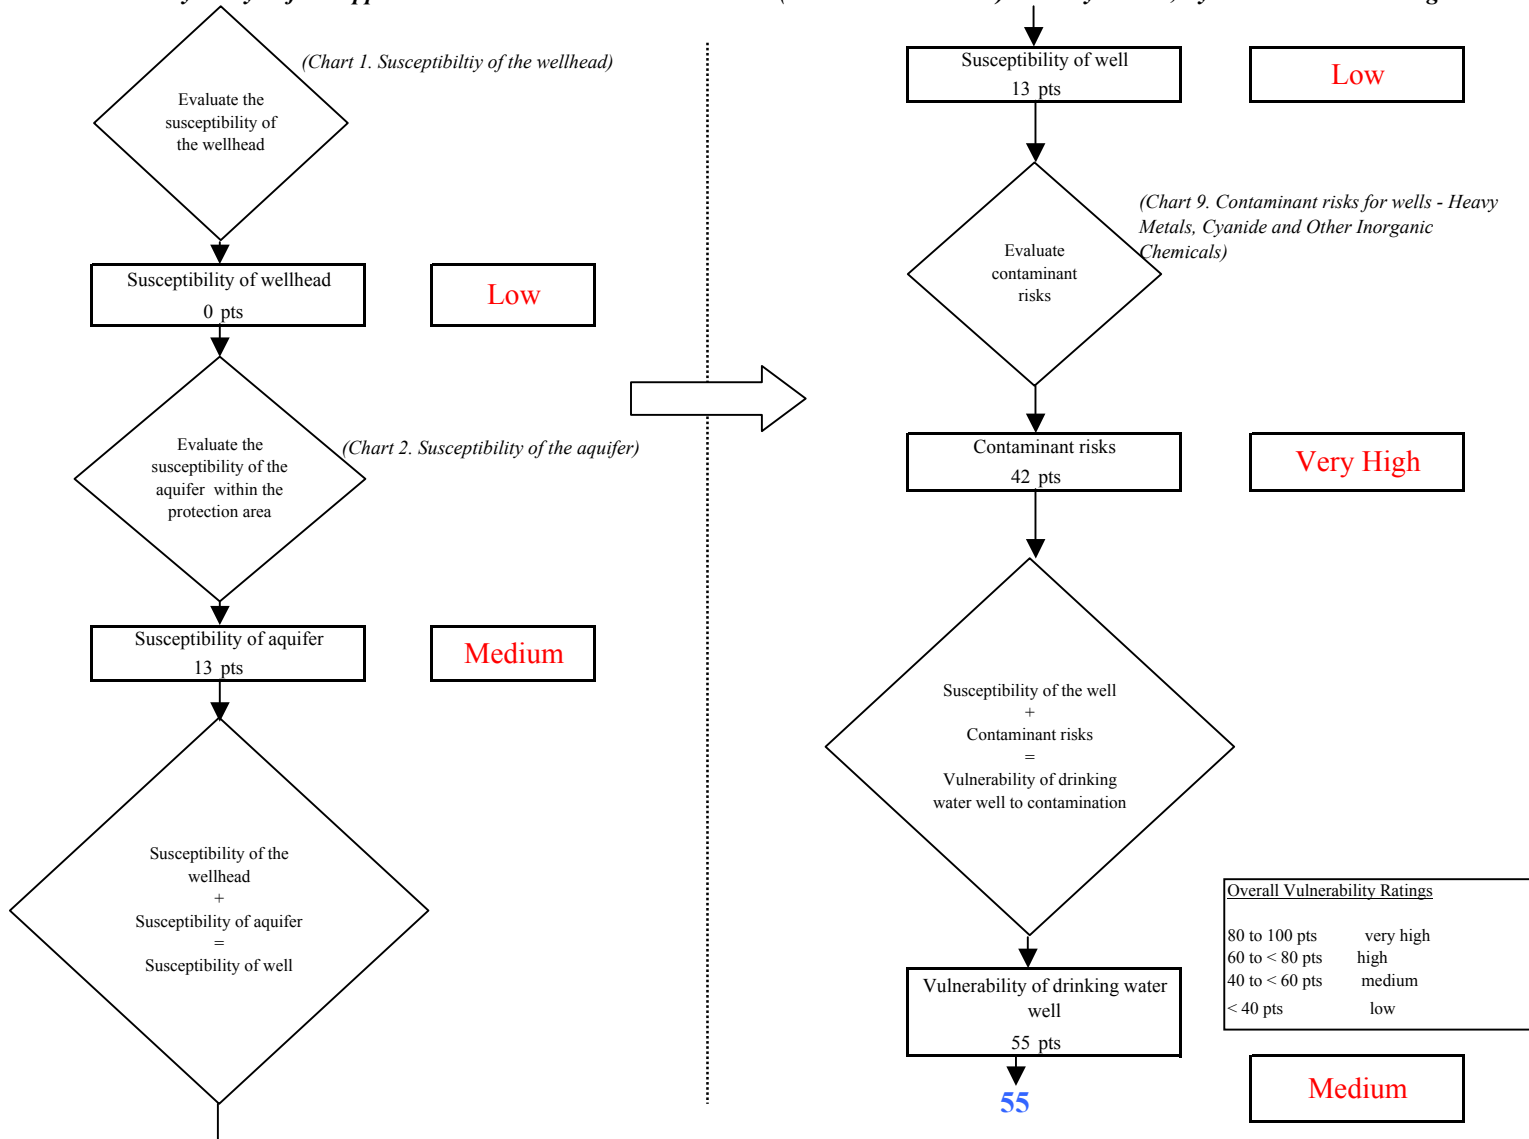


**Chart 11. Contaminant risks for Copper River School District - Slana School (PWS No.381503.001) - Synthetic Organic Chemicals**

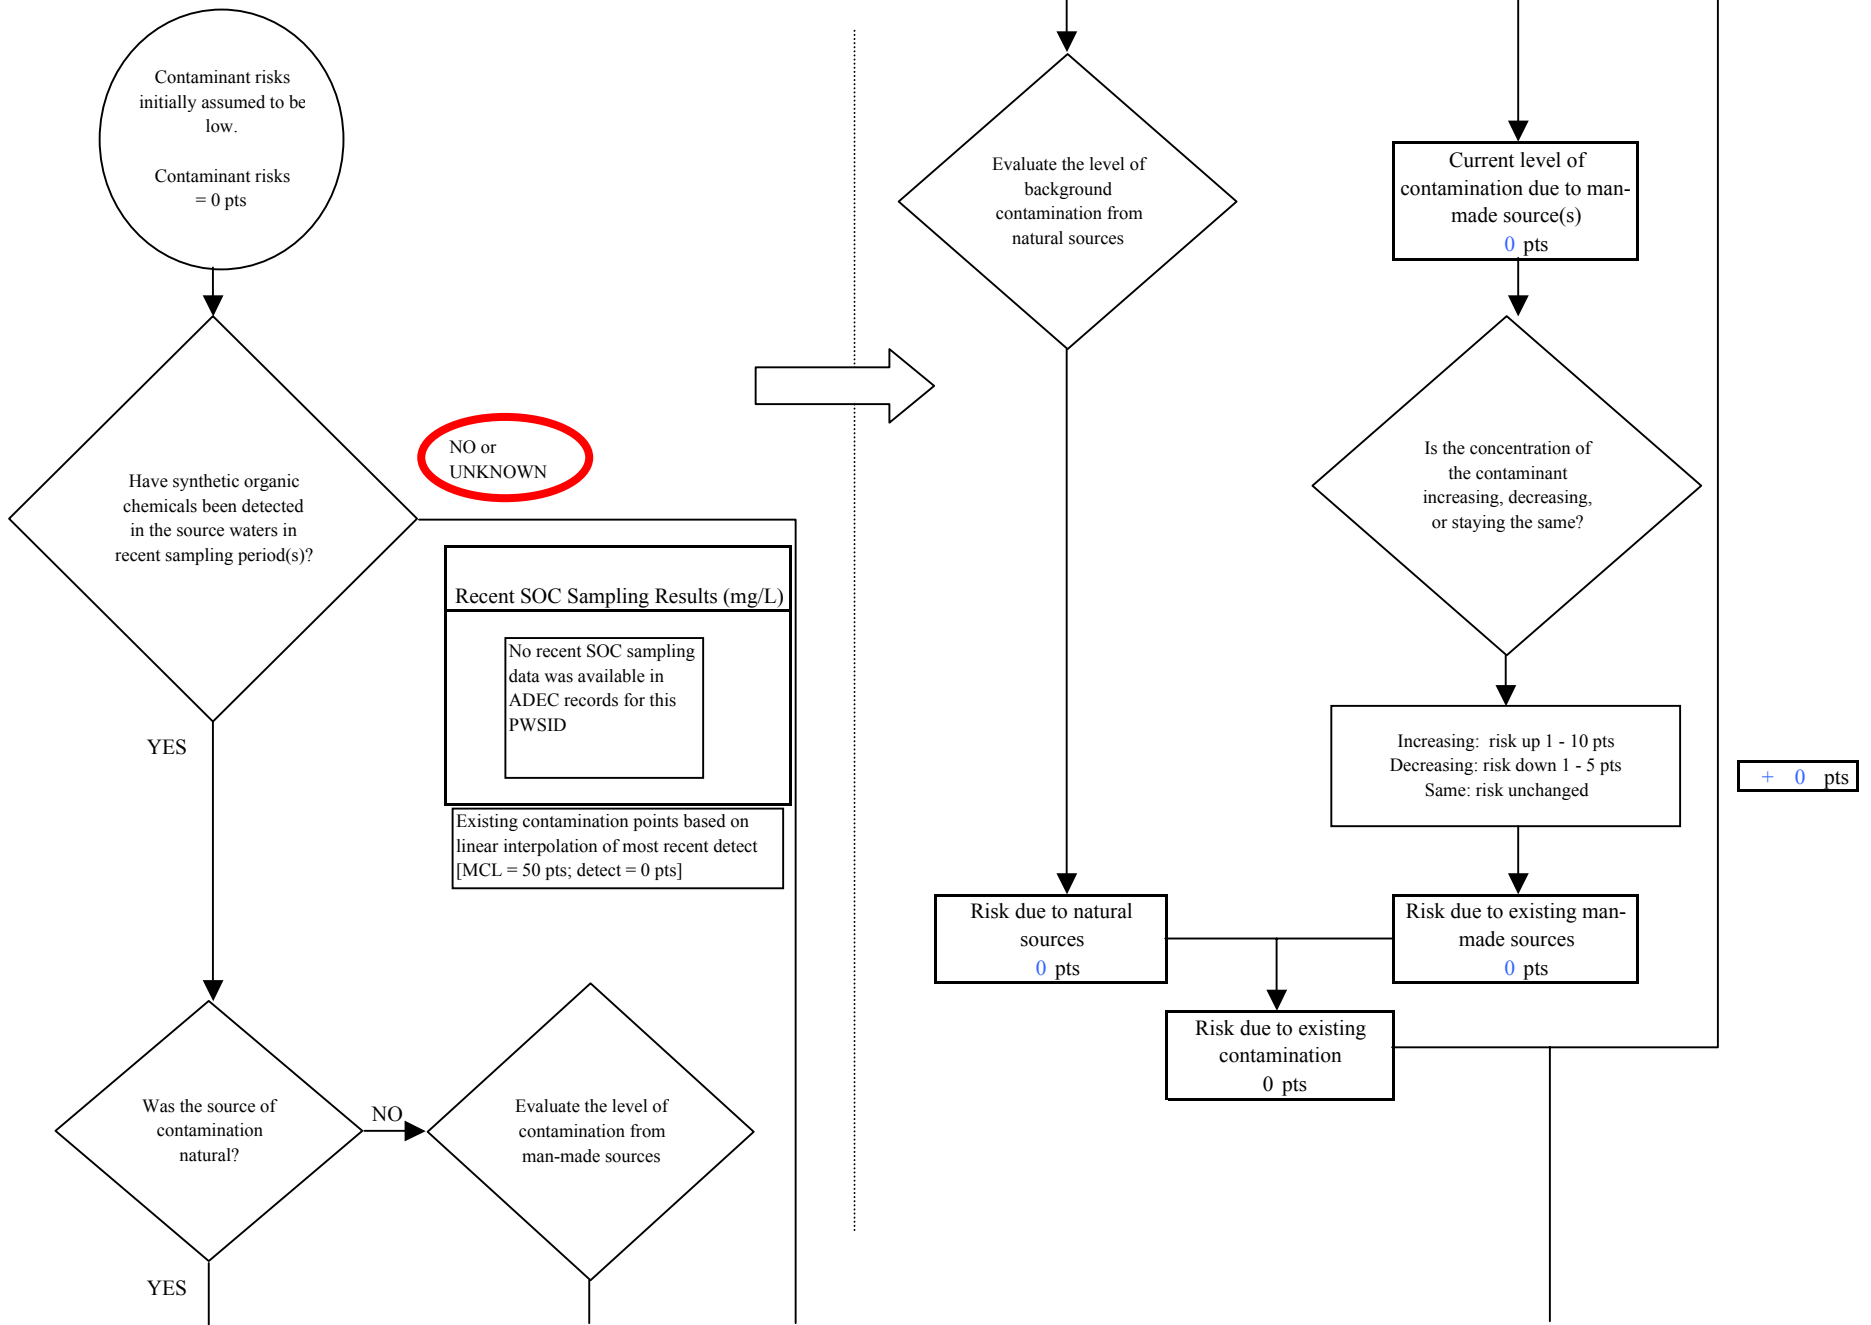

**Chart 11. Contaminant risks for Copper River School District - Slana School (PWS No.381503.001) - Synthetic Organic Chemicals**

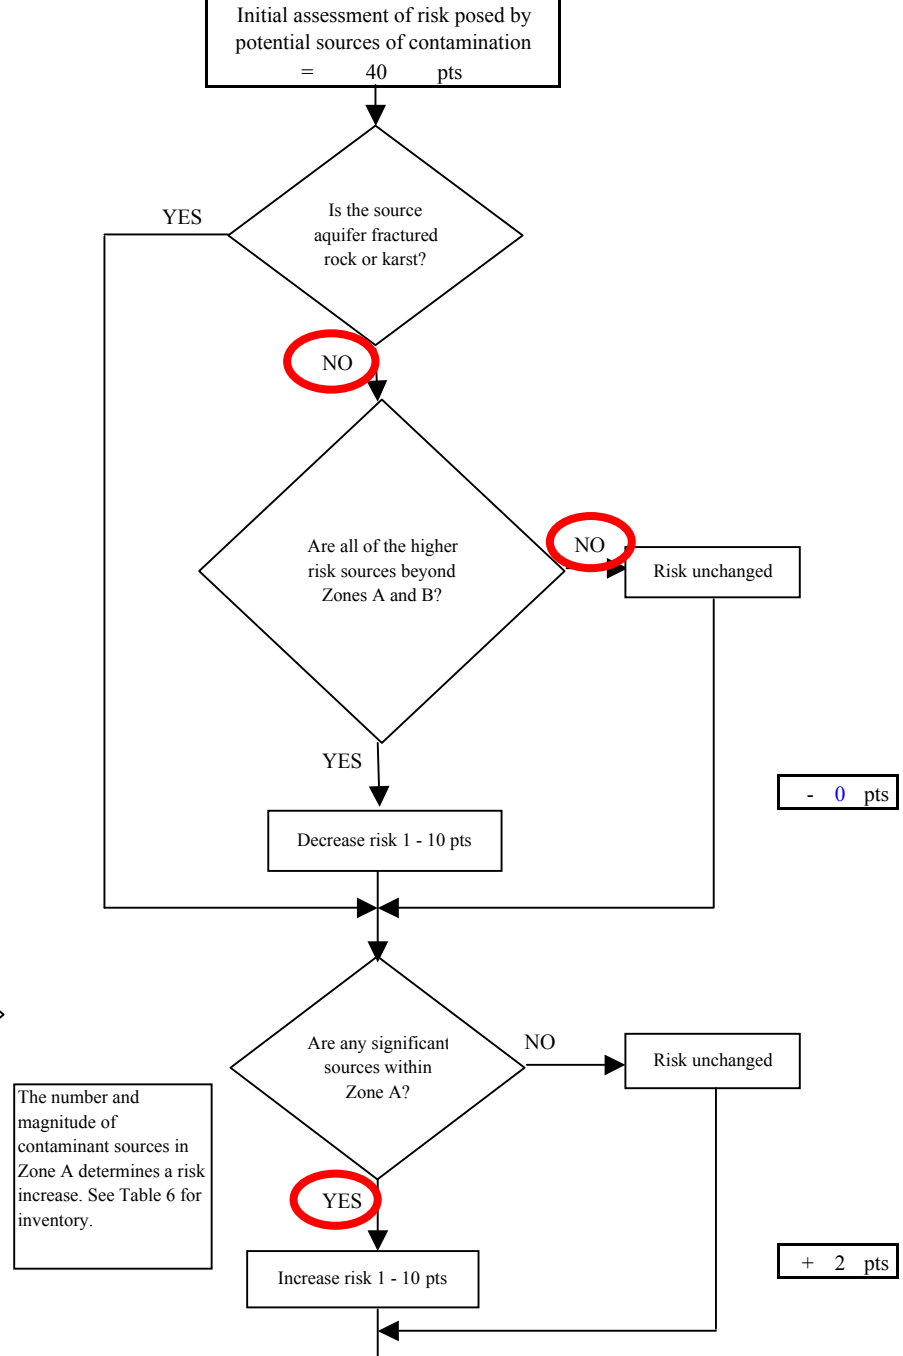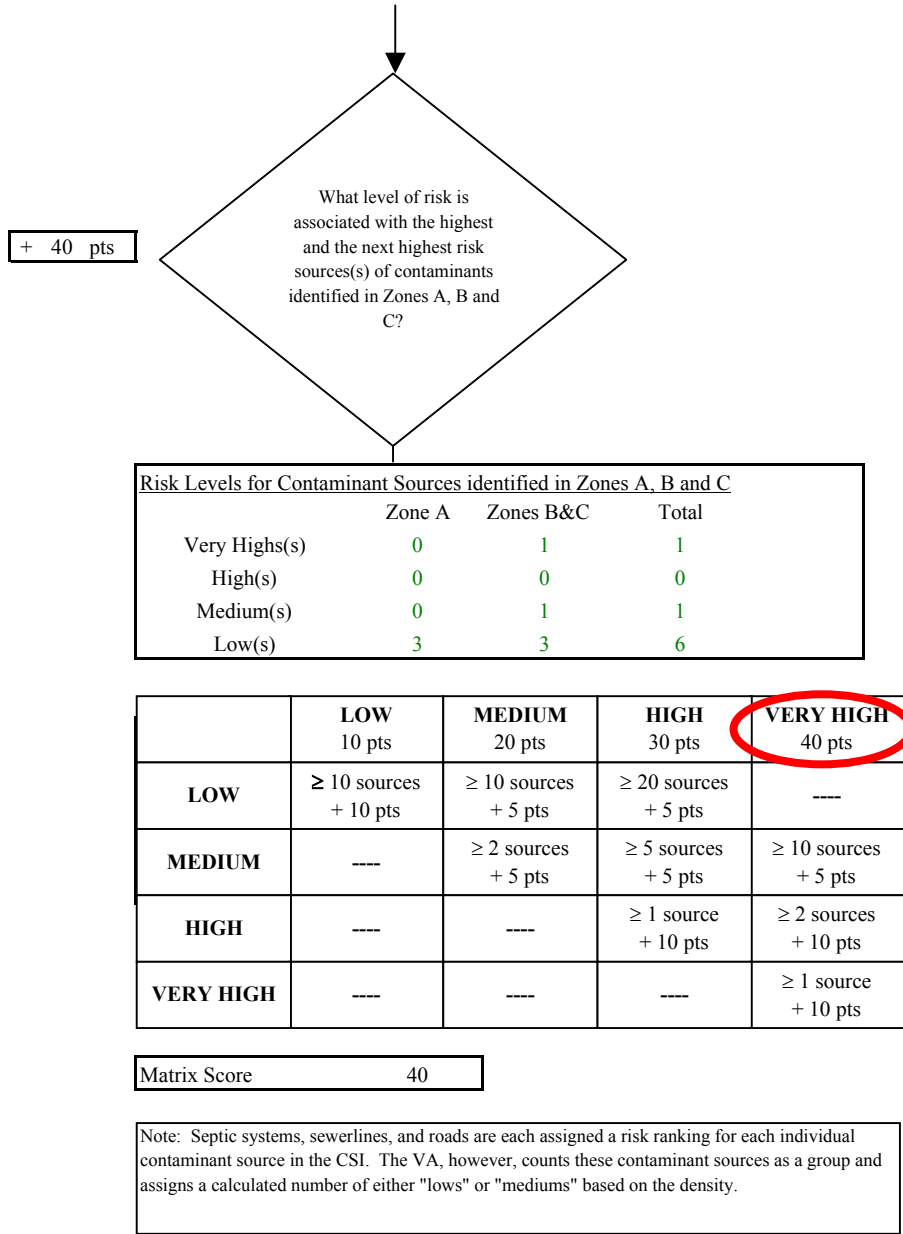


**Chart 11. Contaminant risks for Copper River School District - Slana School (PWS No.381503.001) - Synthetic Organic Chemicals**

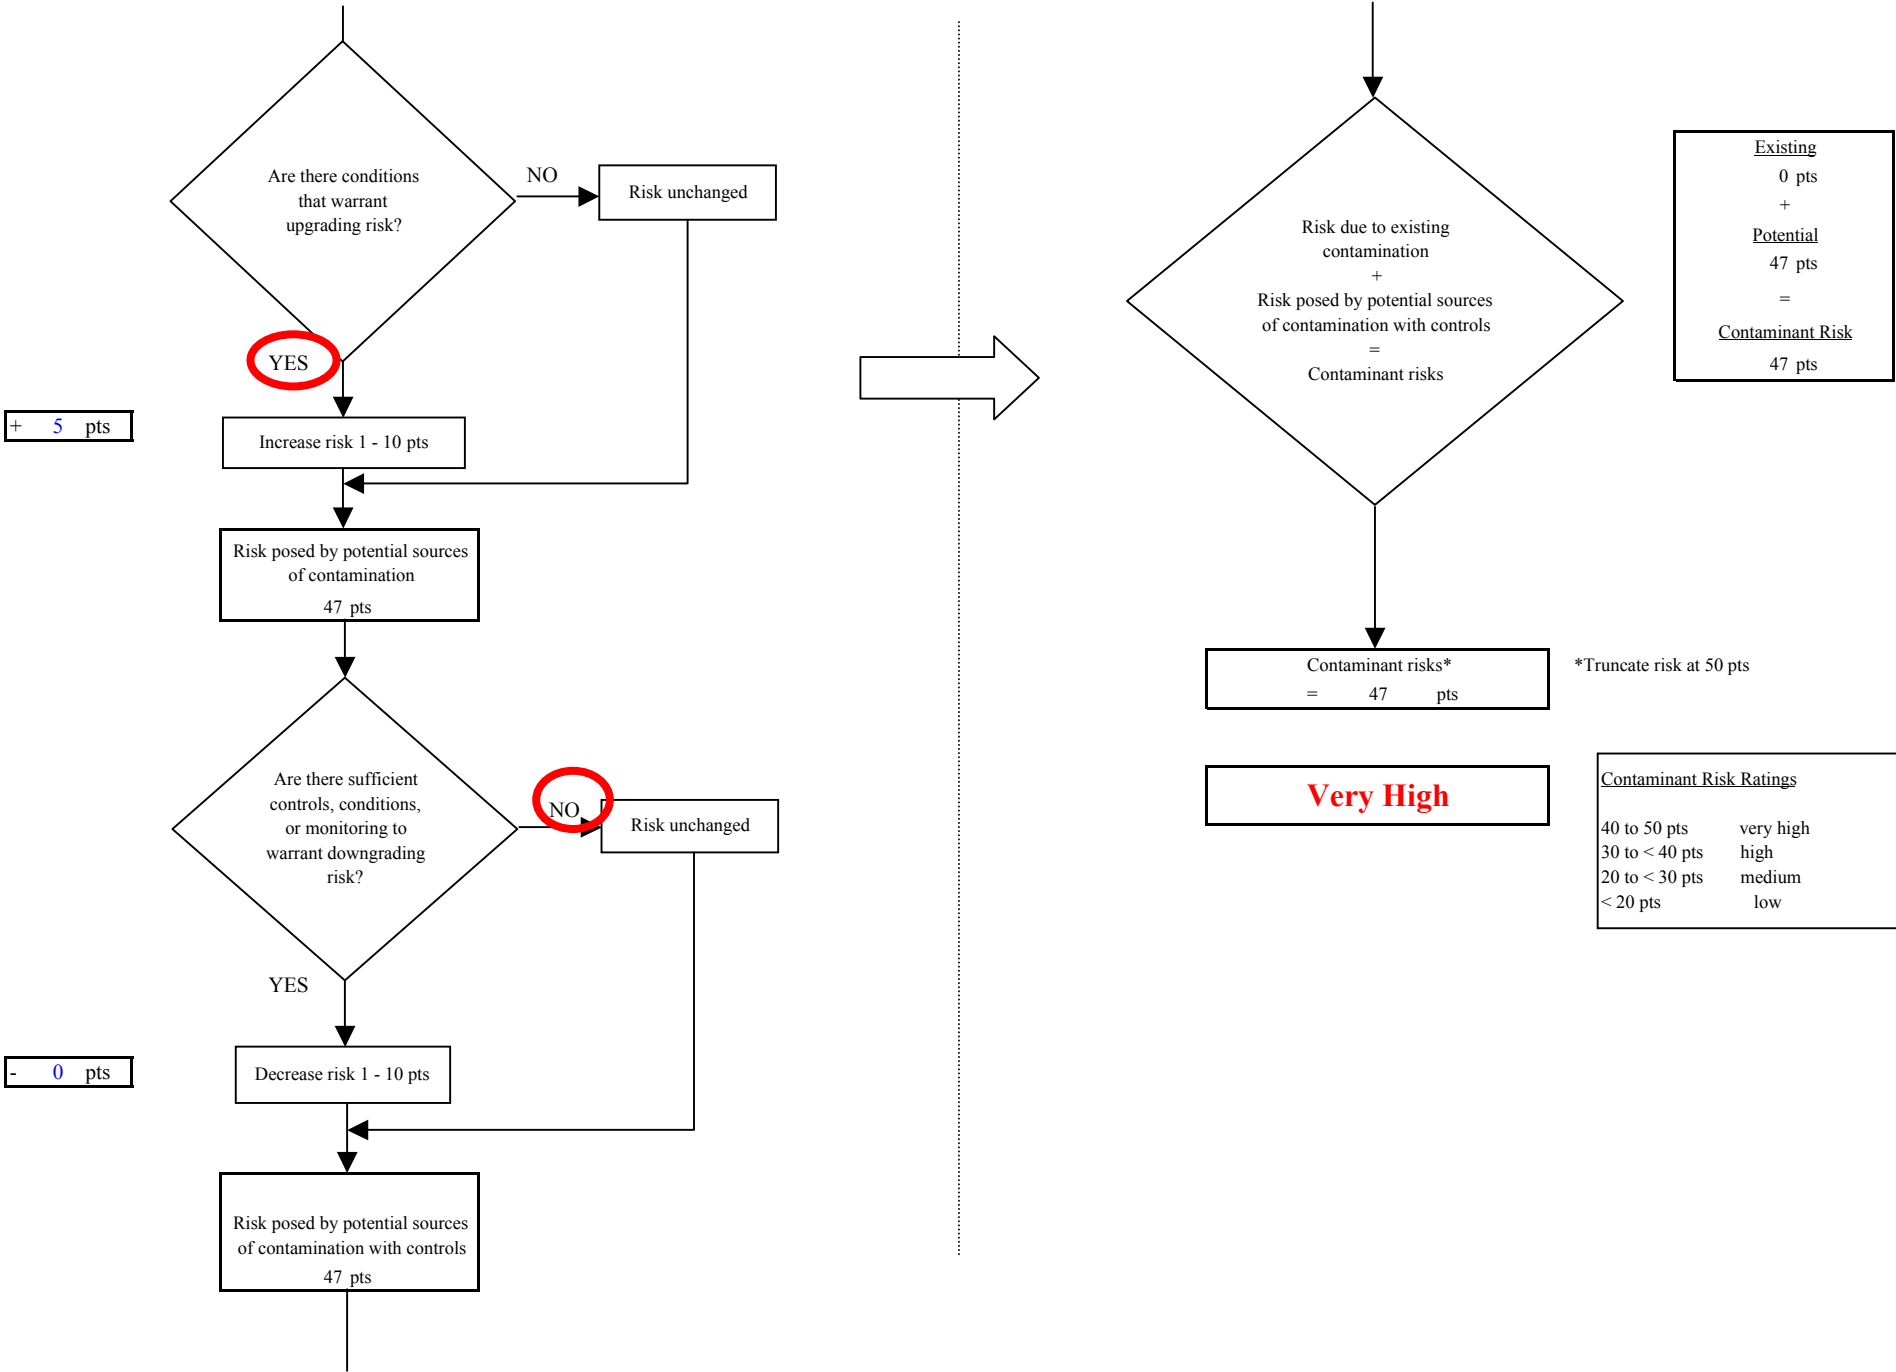




**Chart 12. Vulnerability analysis for Copper River School District - Slana School (PWS No.381503.001) - Synthetic Organic Chemicals**

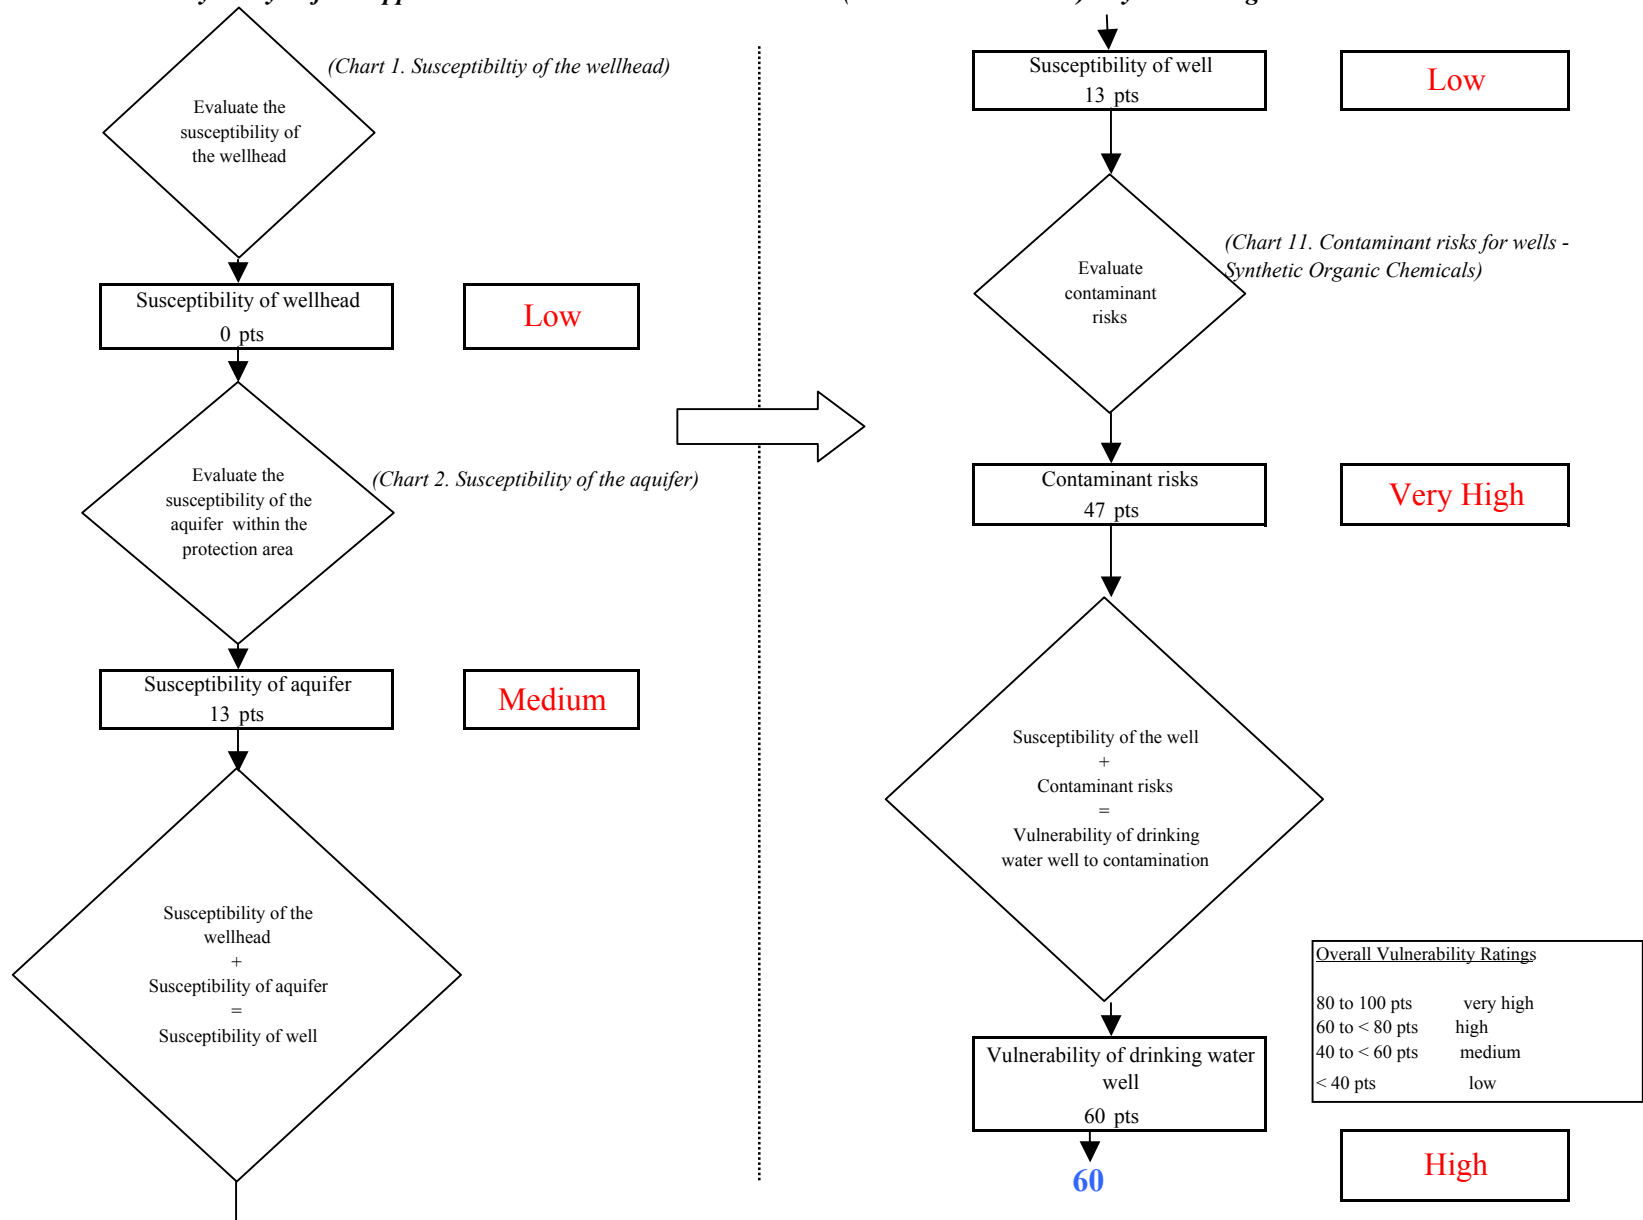

**Chart 13. Contaminant risks for Copper River School District - Slana School (PWS No.381503.001) - Other Organic Chemicals**

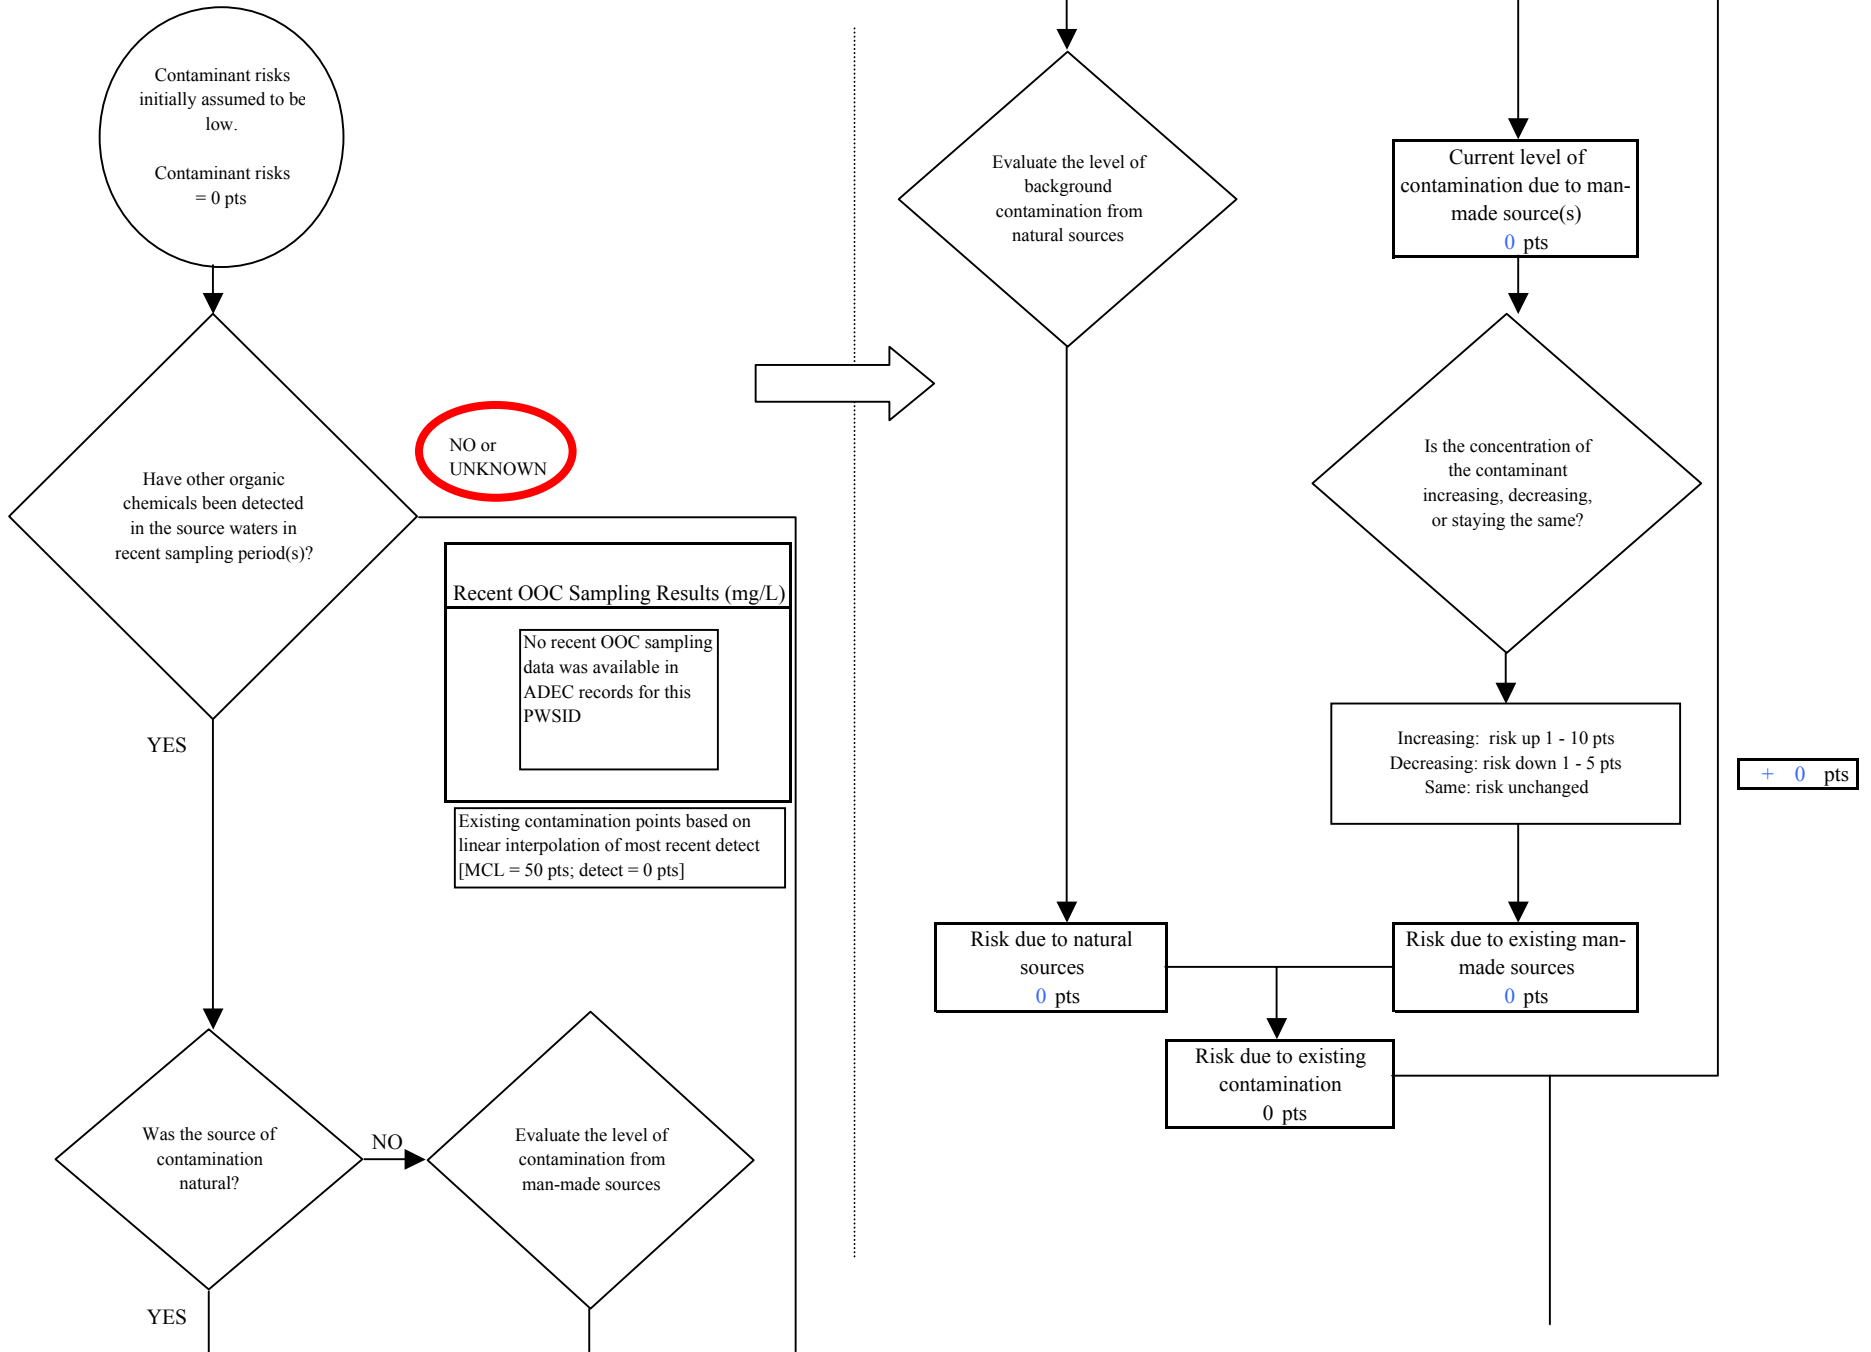

**Chart 13. Contaminant risks for Copper River School District - Slana School (PWS No.381503.001) - Other Organic Chemicals**

What level of risk is associated with the highest and the next highest risk sources(s) of contaminants identified in Zones A, B and C?

+ 40 pts


	Zone A	Zones B&C	Total
Very High(s)	0	1	1
High(s)	1	0	1
Medium(s)	0	1	1
Low(s)	5	13	18


	LOW 10 pts	MEDIUM 20 pts	HIGH 30 pts	VERY HIGH 40 pts
<b>LOW</b>	≥ 10 sources + 10 pts	≥ 10 sources + 5 pts	≥ 20 sources + 5 pts	----
<b>MEDIUM</b>	----	≥ 2 sources + 5 pts	≥ 5 sources + 5 pts	≥ 10 sources + 5 pts
<b>HIGH</b>	----	----	≥ 1 source + 10 pts	≥ 2 sources + 10 pts
<b>VERY HIGH</b>	----	----	----	≥ 1 source + 10 pts

Matrix Score            40

Note: Septic systems, sewerlines, and roads are each assigned a risk ranking for each individual contaminant source in the CSI. The VA, however, counts these contaminant sources as a group and assigns a calculated number of either "lows" or "mediums" based on the density.

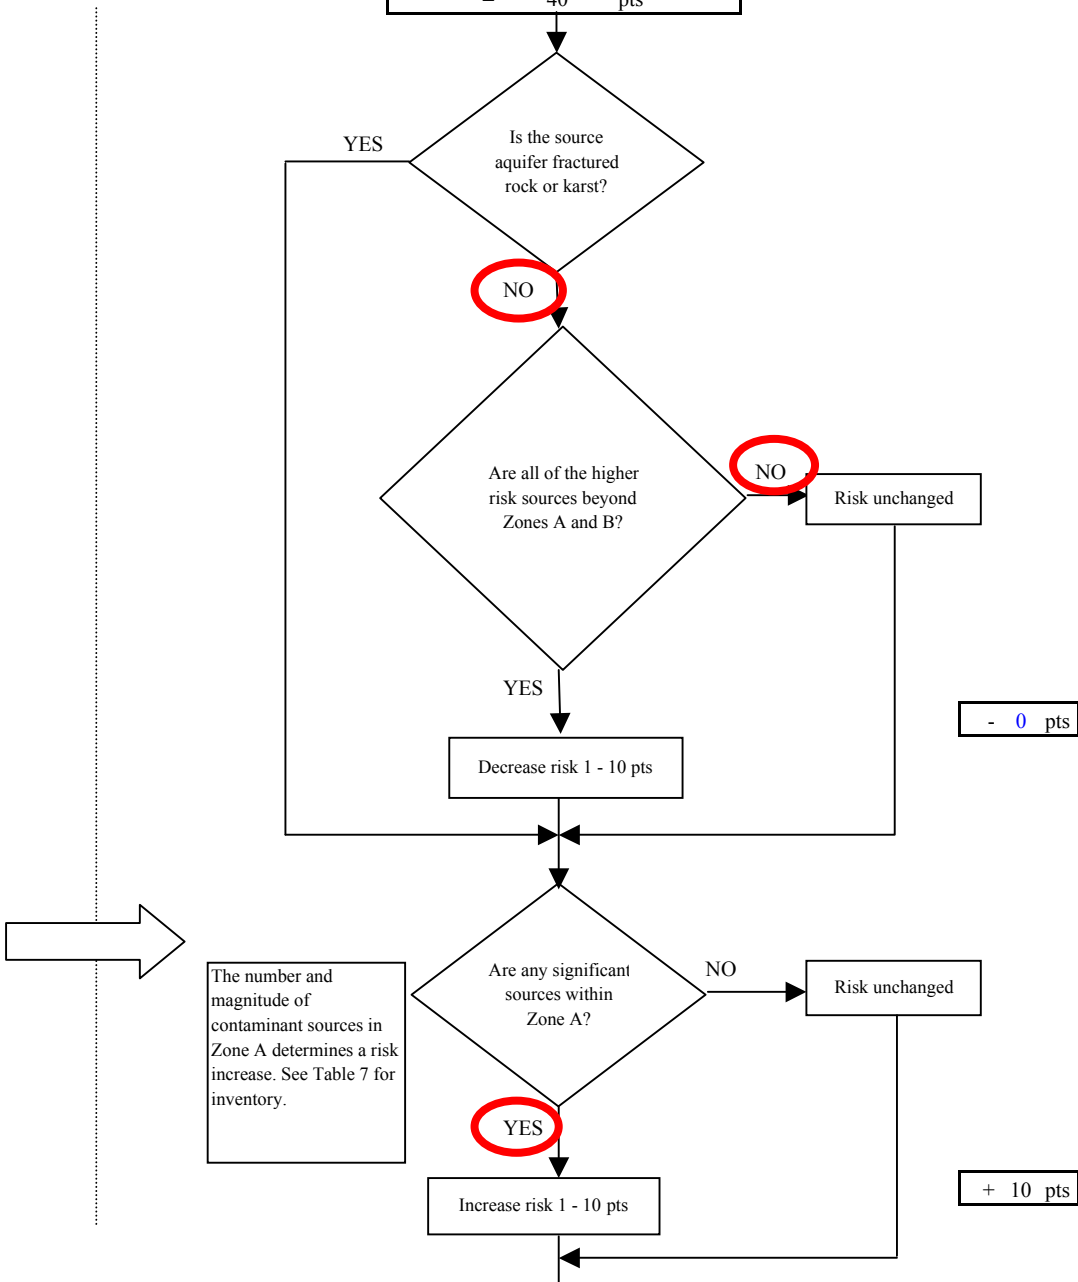

**Chart 13. Contaminant risks for Copper River School District - Slana School (PWS No.381503.001) - Other Organic Chemicals**

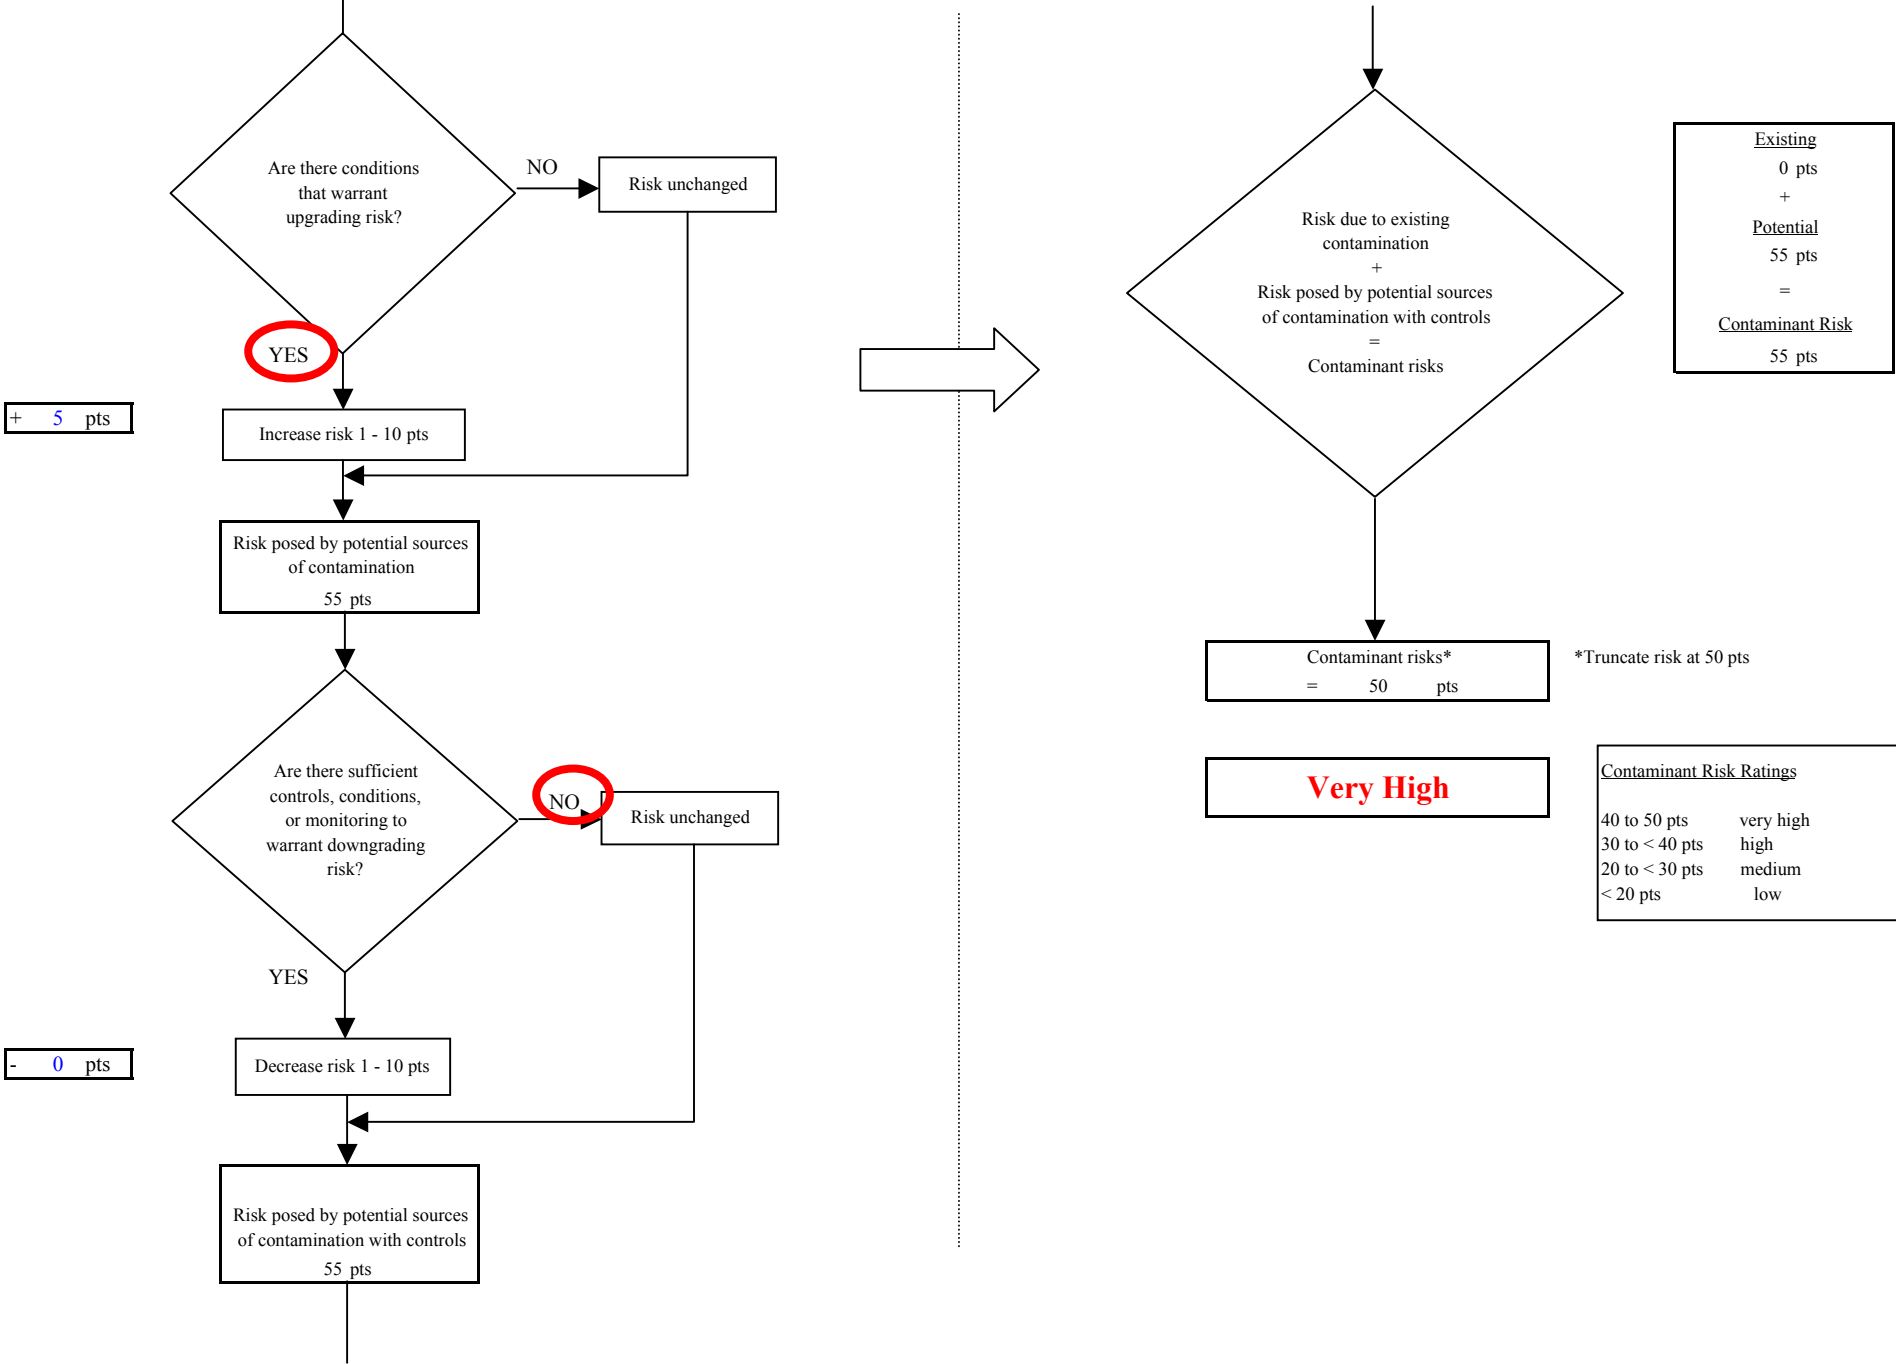

**Chart 14. Vulnerability analysis for Copper River School District - Slana School (PWS No.381503.001) - Other Organic Chemicals**

