



# **Source Water Assessment**

A Hydrogeologic Susceptibility and Vulnerability Assessment for Zapadni Bay Harbour Drinking Water System, St. George Island, Alaska

PWSID # 263029.007 June 2004

DRINKING WATER PROTECTION PROGRAM REPORT 1465 Alaska Department of Environmental Conservation

# Source Water Assessment for Zapadni Bay Harbour Drinking Water System St. George Island, Alaska

# PWSID # 263029.007

#### DRINKING WATER PROTECTION PROGRAM REPORT 1465

The Drinking Water Protection Program (DWPP) is producing Source Water Assessments in compliance with the Safe Drinking Water Act Amendments of 1996. Each assessment includes a delineation of the source water area, an inventory of potential and existing contaminant sources that may impact the water, a risk ranking for each of these contaminants, and an evaluation of the potential vulnerability of these drinking water sources.

These assessments are intended to provide public water systems owners/operators, communities, and local governments with the best available information that may be used to protect the quality of their drinking water. The assessments combine information obtained from various sources, including the U.S. Environmental Protection Agency, Alaska Department of Environmental Conservation (ADEC), public water system owners/operators, and other public information sources. The results of this assessment are subject to change if additional data becomes available. It is anticipated this assessment will be updated every five years to reflect any changes in the vulnerability and/or susceptibility of public drinking water source. If you have any additional information that may affect the results of this assessment, please contact the Program Coordinator of DWPP, (907) 269-7521.

### CONTENTS

ZAPADNI BAY WATER SYS ZAPADNI BAY	SUMMARY	INVENTORY OF POTENTIAL AND EXISTING CONTAMINANT SOURCES
	TA	BLES
Table 2. Susce Table 3. Conta	eptibilityaminant Risksaminant Risksall Vulnerability	
	APPE	NDICES
APPENDIX	A. Zapadni Bay Harbour Drinking W	ater Protection Area (Map A)
	Bacteria and Viruses (Table 2 Contaminant Source Inventory and Nitrates/Nitrites (Table 3)	d Risk Ranking for Zapadni Bay Harbour – 2) d Risk Ranking for Zapadni Bay Harbour – d Risk Ranking for Zapadni Bay Harbour –
	C. Zapadni Bay Harbour Drinking W and Existing Contaminant So	
		ninant Source Inventory and Risk Ranking for Drinking Water Source (Charts 1 – 8)

# Source Water Assessment for Zapadni Bay Harbour Source of Public Drinking Water, St. George Island, Alaska

# **Drinking Water Protection Program Alaska Department of Environmental Conservation**

#### EXECUTIVE SUMMARY

Zapadni Bay Harbour has seven Public Water System (PWS) wells. The date of well construction is unknown, however, it is assumed that the well (PWSID# 263029.007) has been used as a drinking water source since it was drilled. Based on the well construction date of the other Zapadni Bay Harbour PWS wells, it is assumed that the well was drilled in approximately 1988. This source water assessment report is exclusively limited to PWSID# 263029.007.

The well is a Class B (transient/non-community) water system located on the east side of Zapadni Rookery Road on St. George Island, Alaska. It is unknown if the drinking water source is treated. Available records indicate that there is a 500,000gallon storage tank for drinking water. This system operates year round and serves approximately 450 non-residents and 20 residents. The wellhead received a susceptibility rating of **Low** and the aquifer received a susceptibility rating of Very High. Combining these two ratings produce a **High** rating for the natural susceptibility of the well. Identified potential and current sources of contaminants for the primary public drinking water source include: water supply wells, roads, and a landfill. These identified potential and existing sources of contamination are considered as sources of bacteria and viruses, nitrates and/or nitrites, and volatile organic chemicals. Overall, the water well received a vulnerability rating of **Medium** for the bacteria and viruses, nitrates and nitrites, and volatile organic chemicals contaminant categories.

# ZAPADNI BAY HARBOUR PUBLIC DRINKING WATER SYSTEM

The Zapadni Bay Harbour well is a Class B (transient/non-community) public water system. The well is located on the east side of Zapadni Rookery Road on St. George Island, Alaska (Sec. 3, T42S, R130W, Seward Meridian; see Map A of Appendix A). Zapadni Bay Harbour is located on the western coast of St. George Island, approximately 47 miles south of St. Paul Island, 750 air miles west of

Anchorage, and 250 miles northwest of Unalaska. The community of St. George has a population of 149 (ADCED, 2003). Average annual precipitation on St. George Island is 23 inches of rain, with 57 inches of snowfall. Temperatures range from 24 to 52°F.

The community of St. George is served by a piped water and sewer system. St. George Island receives electrical power from the St. George Municipal Electric Utility. Power generating facilities are fueled by diesel. Refuse is collected by the City of St. George and transported to the landfill (ADCED, 2003).

According to information supplied by ADEC for the Zapadni Bay Harbour PWS, the depth of the primary water well is 85 feet below the ground surface. The well is not screened and, based on well construction details, is in an unconfined aquifer. Unconfined aquifers are more susceptible to groundwater impacts resulting from the downward migration of surface contaminants. The well is not located within a floodplain.

Information acquired from ADEC for the public water system indicated that the land surface was sloped away from the well. Generally, land surfaces that slope away from the wellhead promote surface water drainage, which reduces potential of contaminant migration down the well casing annulus. It is assumed that the well is not grouted according to ADEC regulations based on the well construction date (1988). Proper grouting provides added protection against contaminants traveling along the well casing annulus and into source waters.

St. George Island is the second largest of five islands in the Pribilof Islands group. The island is about eleven miles long and two miles wide. The central portion of the island bulges to the south widening to five miles and forming the Zapadni Bay embayment. High bluffs at the northwestern end of the island and Ulakaia Hill at the east central part of the island reach approximately 1,000 feet above mean sea level. St. George village lies just northeast of Ulakaia Hill, along the northeastern shore.

St. George Island is comprised of basalt flows resting on a locally exposed peridotite basement. The flows are often partly vesicular and frequently separated by scoriaceous material. Tuffs and pyroclastic deposits form a small but significant percentage of St. George Island. Unconsolidated sediments, including beach deposits, colluvium, retransported and windblown silt, and highly fractured rubble obscure underlying rocks over much of the island surface.

The hydrogeoglogy of St. George Island has been described simply as an island system of highly permeable lava flows with a low rate of groundwater recharge due to low total precipitation (Wheaton, 1984).

#### ZAPADNI BAY HARBOUR DRINKING WATER PROTECTION AREA

In order to evaluate whether a drinking water source is at risk, we must first evaluate what are the most likely pathways for surface contamination to reach the groundwater. These areas are determined by looking at the characteristics of the soil, groundwater, aquifer, and well.

The most probable area for contamination to reach the drinking water well is the area that contributes water to the well, the groundwater recharge area. This area is designated as the drinking water protection area (DWPA). Because releases of contaminants within the protection area are most likely to impact the drinking water well, this area will serve as the focus for voluntary protection efforts. An analytical calculation was used to determine the size and shape of the DWPA for the Zapadni Bay Harbour PWS. The input parameters describing the attributes of the aquifer in this calculation were adopted from Groundwater (Freeze and Cherry, 1979). Available geology and groundwater contours were also considered to take into account any uncertainties in groundwater flow and aquifer characteristics to arrive at a meaningful protection area.

The protection areas established for wells by the ADEC are usually separated into four zones, limited by the watershed. These zones correspond to differences in the time-of-travel (TOT) of the water moving through the aquifer to the well (Please refer to the Guidance Manual for Class B Public Water Systems for additional information).

The time of travel for contaminants within the water varies and is dependent on the physical and chemical characteristics of each contaminant. The following is a summary of the four protection area zones for wells and the calculated time -of-travel for each:

Table 1. Definition of Zones

Zone	Definition
A	<sup>1</sup> / <sub>4</sub> the distance for the 2-yr. time -of-travel
В	Less than the 2 year time-of-travel
C	Less Than the 5 year time -of-travel
D	Less than the 10 year time -of-travel

The DWPA for the Zapadni Bay Harbour PWS was determined using an analytical calculation and includes Zones A, B, and D (See Map A of Appendix A).

# INVENTORY OF POTENTIAL AND EXISTING CONTAMINANT SOURCES

The Drinking Water Protection Program has completed an inventory of potential and existing sources of contamination within the Zapadni Bay Harbour DWPA. This inventory was completed through a search of agency records and other publicly available information. Potential sources of contamination to the drinking water aquifer include a wide range of categories and types. Potential drinking water contaminants are found within agricultural, residential, commercial, and industrial areas, but can also occur within areas that have little or no development.

For the basis of all Class B public water system assessments, three categories of drinking water contaminants were inventoried. They include:

- Bacteria and viruses,
- Nitrates and/or nitrites,
- Volatile organic chemicals.

The sources are displayed on Map C of Appendix C and summarized in Table 1 of Appendix B.

#### RANKING OF CONTAMINANT RISKS

Once the potential and existing sources of contamination have been identified, they are assigned a ranking according to what type and level of risk they represent. Ranking of contaminant risks for a "potential" or "existing" source of contamination is a function of toxicity and volumes of specific contaminants associated with that source. Rankings include:

- Low.
- Medium,

- High, and
- Very High.

The time-of-travel for contaminants within the water varies and is dependent on the physical and chemical characteristics of each contaminant. Bacteria and Viruses are only inventoried in Zones A and B because of their short life span. Only "Very High" and "High" rankings are inventoried within the outer Zone D due to the probability of contaminant dilution by the time the contaminants get to the well. Tables 2 through 4 in Appendix B contain the ranking of potential and existing sources of contamination with respect to bacteria and viruses, nitrates and/or nitrites, and volatile organic chemicals.

# **VULNERABILITY** OF THE ZAPADNI BAY HARBOUR DRINKING WATER SYSTEM

Vulnerability of a drinking water source to contamination is a combination of two factors:

- Natural susceptibility, and
- Contaminant risks.

Appendix D contains eight charts, which together form the 'Vulnerability Analysis' for a source water assessment for a public drinking water source. Chart 1 analyzes the 'Susceptibility of the Wellhead' to contamination by looking at the construction of the well and its surrounding area. Chart 2 analyzes the 'Susceptibility of the Aquifer' to contamination by looking at the naturally occurring attributes of the water source and influences on the groundwater system that might lead to contamination. Chart 3 analyzes 'Contaminant Risks' for the drinking water source with respect to bacteria and viruses. The 'Contaminant Risks' portion of the analysis considers potential sources of contaminants as well as a review of contamination that has or may have occurred, but has not arrived or been detected at the well. Lastly. Chart 4 contains the 'Vulnerability Analysis for Bacteria and Viruses'. Charts 5 through 8 contain the Contaminant Risks and Vulnerability Analyses for nitrates and nitrites and volatile organic chemicals, respectively.

A score for the Natural Susceptibility is reached by considering the properties of the well and the aquifer.

Susceptibility of the Wellhead (0 – 25 Points) (Chart 1 of Appendix D)

Susceptibility of the Aquifer (0 – 25 Points) (Chart 2 of Appendix D) Natural Susceptibility (Susceptibility of the Well) (0 - 50 Points)

A ranking is assigned for the Natural Susceptibility according to the point score:

Natural Susceptibility Ratings								
40 to 50 pts	Very High							
30 to < 40 pts	High							
20 to < 30 pts	Medium							
< 20 pts	Low							

The Zapadni Bay Harbour's water well is in an unconfined aquifer. Unconfined aquifers are more susceptible to potential groundwater quality impacts posed by the migration of surface water contaminants downward from the surface. Table 2 shows the susceptibility scores and ratings for this PWS.

Table 2. Susceptibility

	Score	Rating
Susceptibility of the	5	Low
Wellhead		
Susceptibility of the	25	Very High
Aquifer		
Natural Susceptibility	30	High

Contaminant risks to a drinking water source depend on the type, number or density, and distribution of contaminant sources. This score has been derived from an examination of existing and historical contamination that has been detected at the drinking water source through routine sampling. It also evaluates potential sources of contamination. Flow charts are used to assign a point score, and ratings are assigned in the same way as for the natural susceptibility:

Contaminant Risk Ratings							
40 to 50 pts	Very High						
30 to < 40 pts	High						
20 to < 30 pts	Medium						
< 20 pts	Low						

Table 3 summarizes the Contaminant Risks for each category of drinking water contaminants.

Table 3. Contaminant Risks

Category	Score	Rating
Bacteria and Viruses	12	Low
Nitrates and/or Nitrites	21	Medium
Volatile Organic Chemical	s 14	Low

Finally, an overall vulnerability score is assigned for each water system by combining each of the contaminant risk scores with the natural susceptibility score:

Natural Susceptibility (0 – 50 points)

+

Contaminant Risks (0 – 50 points)

=

Vulnerability of the Drinking Water Source to Contamination (0 – 100).

Again, rankings are assigned according to a point score:

Overall Vulnerability Ratings							
80 to 100 pts	Very High						
60 to < 80 pts	High						
40 to < 60 pts	Mediu m						
< 40 pts	Low						

Table 4 contains the overall vulnerability scores (0 – 100) and ratings for each of the three categories of drinking water contaminants. Note: scores are rounded off to the nearest five.

**Table 4. Overall Vulnerability** 

Category	Score	Rating
Bacteria and Viruses	40	Medium
Nitrates and Nitrites	50	Medium
Volatile Organic Chemicals	45	Medium

#### **Bacteria and Viruses**

The contaminant risk for bacteria and viruses is **Low**. The risk is primarily attributed to the presence of a landfill located in Zone D (see Table 2 – Appendix B).

Coliforms (a bacteria) are found naturally in the environment and although they aren't necessarily a health threat, they are an indicator of other potentially harmful bacteria in the water, more specifically, fecal coliforms and E. coli, which only come from human and animal fecal waste. Harmful bacteria can cause diarrhea, cramps, nausea, headaches, or other symptoms (EPA, 2003). Positive samples increase the overall vulnerability of the drinking water source, indicating that the source is susceptible to bacteria and virus contamination.

No positive bacteria counts have been reported in recent (within five years) sampling events (See Chart 3 – Contaminant Risks for Bacteria and Viruses in Appendix D). Only a small amount of bacteria and viruses are required to endanger public health.

After combining the contaminant risk for bacteria and viruses with the natural susceptibility of the well, the overall vulnerability of the well to contamination is **Medium**.

#### **Nitrates and Nitrites**

The contaminant risk for nitrates and nitrites is **Medium**. The risk to this source of public drinking water is primarily attributed to the presence a landfill in Zone D (see Table 3 – Appendix B).

Nitrates are very mobile, moving at approximately the same rate as water. The sampling history for this well indicates that low levels of nitrates have been detected in recent sampling events. However, the reported concentrations of nitrates do not exceed the maximum contaminant level (MCL) of 10 mg/L. Nitrate concentrations in uncontaminated groundwater are typically less than 2 mg/L; therefore, nitrate concentrations above 2 mg/L may be indicative of man-made sources (See Chart 5 - Contaminant Risks for Nitrates and/or Nitrites in Appendix D).

Nitrate levels are often derived from the decomposition of organic matter in soils. Although the nitrate source is unknown, such occurrences may be attributed to septic systems or other sources. After combining the contaminant risk for nitrates and nitrites with the natural susceptibility of the well, the overall vulnerability of the well to nitrate and nitrite contamination is **Medium** 

#### **Volatile Organic Chemicals**

The contaminant risk for volatile organic chemicals is **Low**. The risk is primarily attributed to the presence of a landfill located in Zone D. Several other

potential contaminant sources are also found within the protection area (see Table 4 – Appendix B).

No recent sampling data was available in ADEC records for Zapadni Bay Harbour (See Chart 7 – Contaminant Risks for Volatile Organic Chemicals in Appendix D).

After combining the contaminant risk for volatile organic chemicals with the natural susceptibility of the well, the overall vulnerability of the well to contamination is **Medium**.

#### **Using the Source Water Assessment**

This assessment of contaminant risks can be used as a foundation for local voluntary protection efforts as well as a basis for the continuous efforts on the part of Zapadni Bay Harbour and the community of St. George Island to protect public health. It is anticipated that Source Water Assessments will be updated every five years to reflect any changes in the vulnerability and/or susceptibility of the drinking water source.

#### **REFERENCES**

Alaska Department of Community and Economic Development (ADCED), 2003 [WWW document]. URL: <a href="http://www.dced.state.ak.us/cbd/commdb/CF">http://www.dced.state.ak.us/cbd/commdb/CF</a> COMDB.htm

Freeze, R. A., and Cherry, J.A. 1979, Groundwater, Prentice-Hall, Englewood Cliffs, New Jersey


United States Environmental Protection Agency (EPA), 2002 [WWW document]. URL <a href="http://www.epa.gov/safewater/mcl.html">http://www.epa.gov/safewater/mcl.html</a>.

Wheaton, Scott R. 1984, Hydrogeologic Analysis and Well Site Recommendations at St. George Island and City of St. George, Alaska, U.S. Public Health Service, Alaska Area Native Health Service.

# **APPENDIX A**

# Drinking Water Protection Area Location Map (Map A)

#### Public Water Well System for PWSID 263029.007 Zapadni Bay Harbour

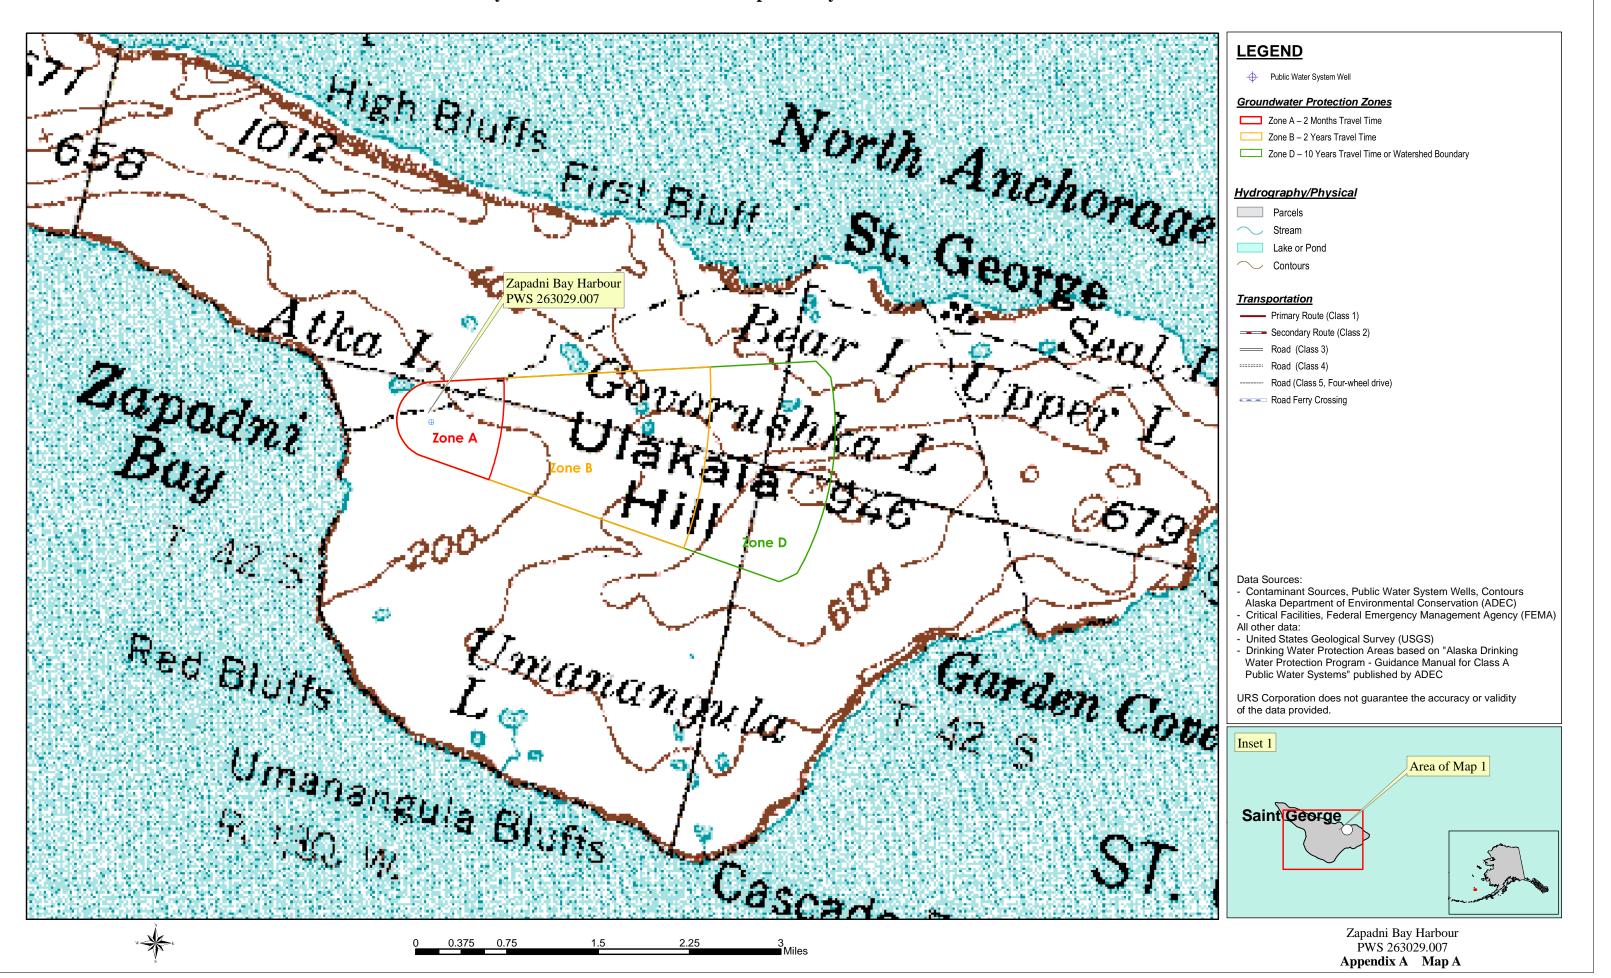

# **APPENDIX B**

# Contaminant Source Inventory and Risk Ranking (Tables 1-7)

# Contaminant Source Inventory for Zapadni Bay Harbour

#### PWSID 263029.001

Contaminant Source Type	Contaminant Source ID	CS ID tag	Zone	Map Number	Comments
Water supply wells	W09	W09-01	A	С	6 water supply wells in Zone A
Highways and roads, dirt/gravel	X24	X24-01	A	С	Assume 1-20 roads in Zone A
Highways and roads, dirt/gravel	X24	X24-02	В	С	Assume 1-20 roads in Zone B
Landfills (municipal; Class III)	D51	D51-01	D	С	

#### Table 2

### Contaminant Source Inventory and Risk Ranking for Zapadni Bay Harbour Sources of Bacteria and Viruses

Contaminant Source Type	Contaminant Source ID	CS ID tag	Zone	Risk Ranking for Analysis	Map Number	Comments
Highways and roads, dirt/gravel	X24	X24-01	A	Low	С	Assume 1-20 roads in Zone A
Highways and roads, dirt/gravel	X24	X24-02	В	Low	С	Assume 1-20 roads in Zone B
Landfills (municipal; Class III)	D51	D51-01	D	High	С	

#### Table 3

### Contaminant Source Inventory and Risk Ranking for Zapadni Bay Harbour Sources of Nitrates/Nitrites

Contaminant Source Type	Contaminant Source ID	CS ID tag	Zone	Risk Ranking for Analysis	Map Number	Comments
Highways and roads, dirt/gravel	X24	X24-01	A	Low	С	Assume 1-20 roads in Zone A
Highways and roads, dirt/gravel	X24	X24-02	В	Low	С	Assume 1-20 roads in Zone B
Landfills (municipal; Class III)	D51	D51-01	D	Very High	С	

#### Table 4

# Contaminant Source Inventory and Risk Ranking for Zapadni Bay Harbour Sources of Volatile Organic Chemicals

Contaminant Source Type	Contaminant Source ID	CS ID tag	Zone	Risk Ranking for Analysis	Map Number	Comments
Highways and roads, dirt/gravel	X24	X24-01	A	Low	С	Assume 1-20 roads in Zone A
Highways and roads, dirt/gravel	X24	X24-02	В	Low	С	Assume 1-20 roads in Zone B
Landfills (municipal; Class III)	D51	D51-01	D	High	С	

# Table 5

# Zapadni Bay Harbour Sources of Heavy Metals, Cyanide and Other Inorganic Chemicals

Contaminant Source Inventory and Risk Ranking for

Contaminant Source Type	Contaminant Source ID	CS ID tag	Zone	Risk Ranking for Analysis	Map Number	Comments
Highways and roads, dirt/gravel	X24	X24-01	A	Low	С	Assume 1-20 roads in Zone A
Highways and roads, dirt/gravel	X24	X24-02	В	Low	С	Assume 1-20 roads in Zone B
Landfills (municipal; Class III)	D51	D51-01	D	High	С	

#### Table 6

# Contaminant Source Inventory and Risk Ranking for Zapadni Bay Harbour Sources of Synthetic Organic Chemicals

Contaminant Source Type	Contaminant Source ID	CS ID tag	Zone	Risk Ranking for Analysis	Map Number	Comments
Landfills (municipal; Class III)	D51	D51-01	D	Very High	С	

#### Table 7


# Contaminant Source Inventory and Risk Ranking for Zapadni Bay Harbour Sources of Other Organic Chemicals

Contaminant Source Type	Contaminant Source ID	CS ID tag	Zone	Risk Ranking for Analysis	Map Number	Comments
Highways and roads, dirt/gravel	X24	X24-01	A	Low	С	Assume 1-20 roads in Zone A
Highways and roads, dirt/gravel	X24	X24-02	В	Low	С	Assume 1-20 roads in Zone B
Landfills (municipal; Class III)	D51	D51-01	D	Very High	С	

# **APPENDIX C**

# Drinking Water Protection Area and Potential and Existing Contaminant Sources (Map C)

### Public Water Well System for PWSID 263029.007 Zapadni Bay Harbour Showing Potential and Existing Sources of Contamination

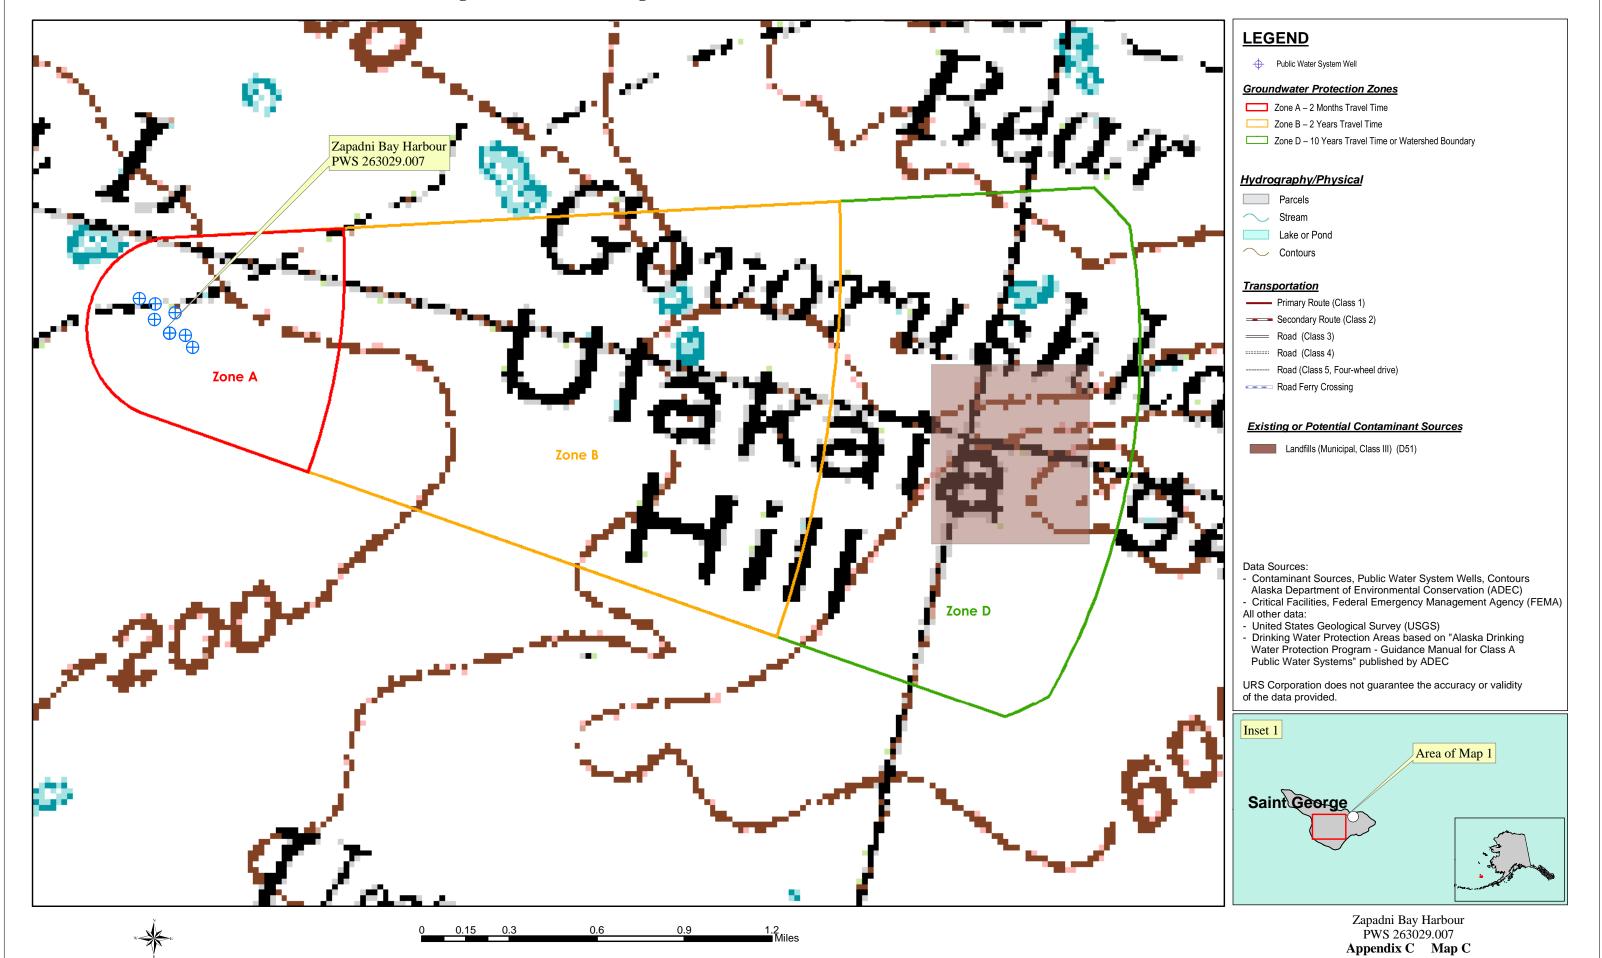

# **APPENDIX D**

Vulnerability Analysis for Public Drinking Water Source (Charts 1-8)

Chart 1. Susceptibility of the wellhead - Zapadni Bay Harbour (263029.007) Susceptibility initially assumed to be low. Unknown if well is properly Susceptibility of grouted; however, it is assumed wellhead = 0 pts well is not grouted based on date of well construction (1988) NO Is the well Increase susceptibility 5 pts + 5 pts properly grouted? Is the well Increase susceptibility 20 pts 0 pts capped? YES YES Susceptibility of wellhead Low 5 pts YES Increase susceptibility: Is the well 10 pts: suspected floodplain + 0 pts within a Wellhead Susceptibility Ratings 20 pts: known floodplain floodplain? 20 to 25 pts very high 15 to < 20 pts 10 to < 15 pts medium NO < 10 pts low Is the land surface sloped Increase susceptibility 5 pts 0 pts away from the

Page 1 of 13

Chart 2. Susceptibility of the aquifer Zapadni Bay Harbour (263029.007)

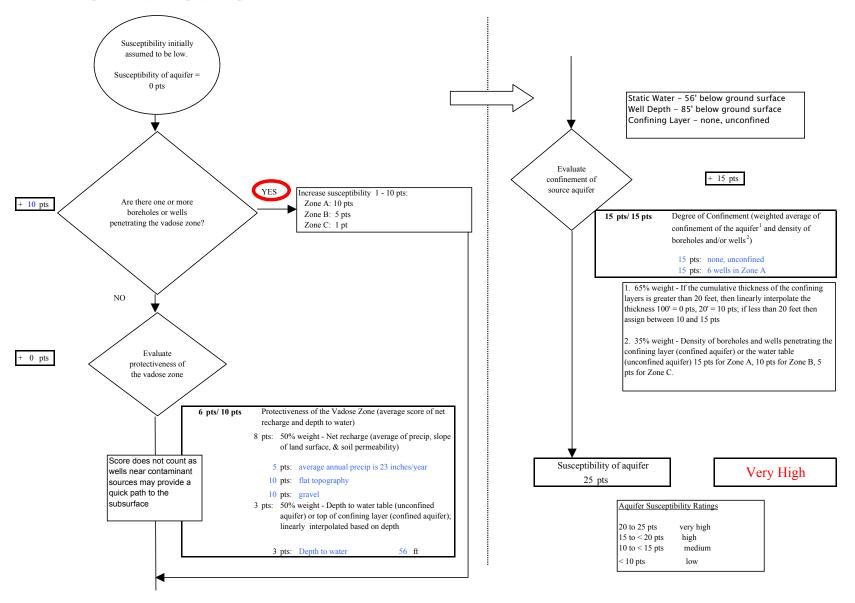


Chart 3. Contaminant risks for Zapadni Bay Harbour (263029.007) - Bacteria & Viruses

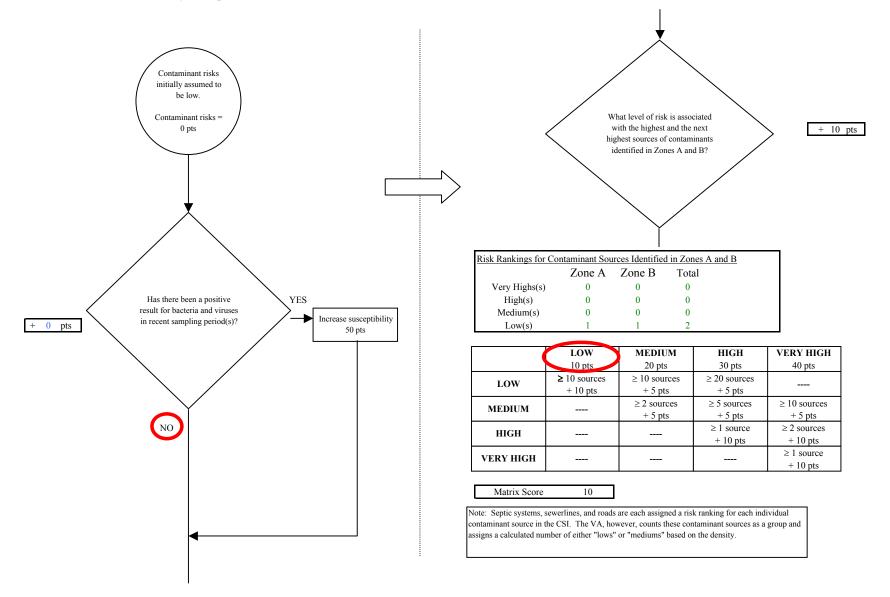


Chart 3. Contaminant risks for Zapadni Bay Harbour (263029.007) - Bacteria & Viruses NO Are there sufficient Initial assessment of risk posed by Risk unchanged controls, conditions, or potential sources of contamination monitoring to warrant = 10 pts downgrading risk? Are any YES significant Risk unchanged contaminant Reduce risk 1 - 10 pts sources within - 0 pts Zone A? The number and magnitude of Risk posed by potential sources of contaminant sources YES contamination with controls in Zone A 12 determines a risk 2 pts Increase risk 1 - 10 pts increase. See Table 2 for inventory. Existing Risk due to existing 0 pts contamination Are there any NQ conditions that Risk unchanged Risk posed by potential sources warrant upgrading Potential of contamination with controls risk? 12 pts Contaminant risks Contaminant Risk YES 12 pts Increase risk 1 - 10 pts + 0 pts Contaminant risks\* \* Truncate risk at 50 pts 12 Contaminant Risk Ratings Risk posed by potential sources of contamination very high 40 to 50 pts = 12 30 to < 40 pts high Low  $20 \text{ to} \le 30 \text{ pts}$ 

Page 4 of 13



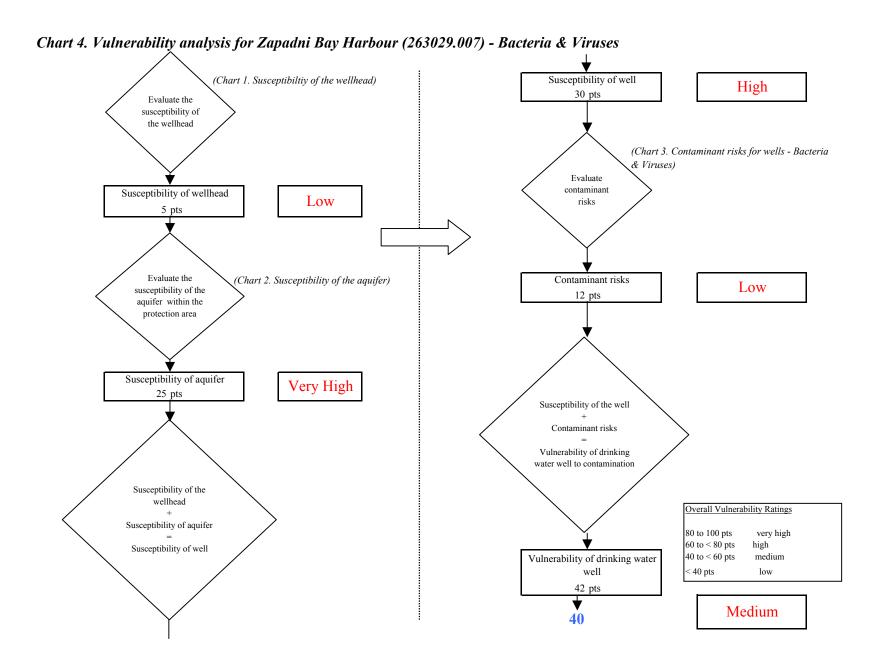


Chart 5. Contaminant risks for Zapadni Bay Harbour (263029.007) - Nitrates and Nitrites Contaminant risks initially assumed to be low. Current level of Evaluate the level of Contaminant risks background contamination due to man-= 0 ptscontamination from made source(s) natural sources Is the concentration of Has nitrates and/or NO the contaminant nitrites been detected in increasing, decreasing, the source waters in or staying the same? recent sampling period(s)? Recent Nitrate Sampling Results (mg/L) 9/5/2000 0.714 1/11/2000 Increasing: risk up 1 - 10 pts YES Decreasing: risk down 1 - 5 pts + 0 pts Same: risk unchanged Maximum Contaminant Level (MCL) = 10 mg/LDetected Nitrate Level = Existing contamination points based on Risk due to existing man-Risk due to natural linear interpolation of most recent detect sources made sources [MCL = 50 pts; detect = 0 pts]4 pts Risk due to existing contamination 4 pts Was the source of Evaluate the level of NO. contamination contamination from natural? man-made sources

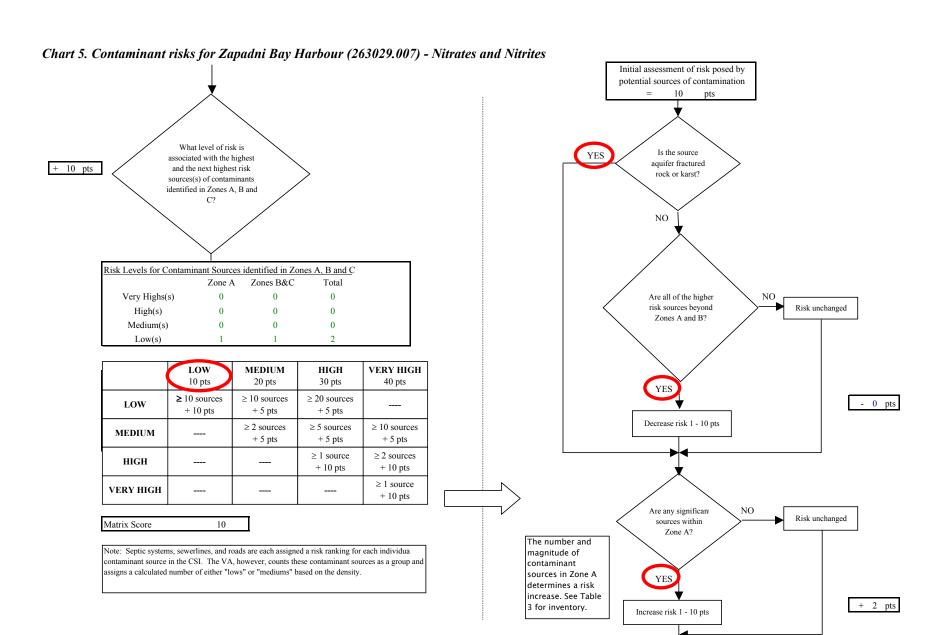

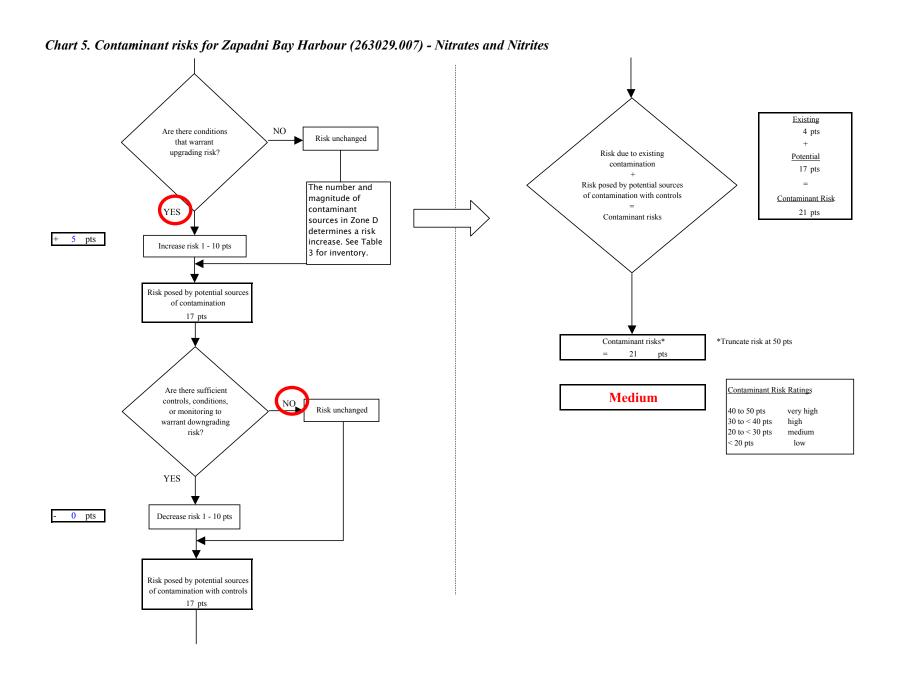

Page 8 of 13


Chart 6. Vulnerability analysis for Zapadni Bay Harbour (263029.007) - Nitrates and Nitrites (Chart 1. Susceptibiltiy of the wellhead) Susceptibility of well High 30 pts Evaluate the susceptibility of the wellhead (Chart 5. Contaminant risks for wells - Nitrates and Nitrites) Evaluate Susceptibility of wellhead contaminant risks Low 5 pts Evaluate the (Chart 2. Susceptibility of the aquifer) Contaminant risks Medium susceptibility of the 21 pts aquifer within the protection area Susceptibility of aquifer Very High 25 pts Susceptibility of the well Contaminant risks Vulnerability of drinking water well to contamination Susceptibility of the wellhead Overall Vulnerability Ratings Susceptibility of aquifer 80 to 100 pts very high Susceptibility of well 60 to < 80 pts high 40 to < 60 pts medium Vulnerability of drinking water well < 40 pts 51 pts Medium **50** 

Page 9 of 13

Chart 7. Contaminant risks for Zapadni Bay Harbour (263029.007) - Volatile Organic Chemicals Contaminant risks initially assumed to be low. Current level of Evaluate the level of Contaminant risks background contamination due to man-= 0 ptscontamination from made source(s) natural sources NO or Is the concentration of Have volatile organic UNKNOWN the contaminant chemicals been detected increasing, decreasing, in the source waters in or staying the same? recent sampling Recent VOC Sampling period(s)? Results (mg/L) No recent VOC sampling data was available in ADEC database for this Increasing: risk up 1 - 10 pts PWSID YES Decreasing: risk down 1 - 5 pts + 0 pts Same: risk unchanged Existing contamination points based on linear interpolation of most recent detect [MCL = 50 pts; detect = 0 pts]Risk due to existing man-Risk due to natural made sources sources 0 pts Risk due to existing contamination 0 pts Was the source of Evaluate the level of NO. contamination contamination from natural? man-made sources YES

Page 10 of 13

Chart 7. Contaminant risks for Zapadni Bay Harbour (263029.007) - Volatile Organic Chemicals



sk Levels for Contaminant Sources identified in Zones A, B and C						
	Zone A	Zones B&C	Total			
Very Highs(s)	0	0	0			
High(s)	0	0	0			
Medium(s)	0	0	0			
Low(s)	1	1	2			

	LOW 10 pts	MEDIUM 20 pts	HIGH 30 pts	VERY HIGH 40 pts
LOW	≥ 10 sources + 10 pts	≥ 10 sources + 5 pts	≥ 20 sources + 5 pts	
MEDIUM		≥ 2 sources + 5 pts	≥ 5 sources + 5 pts	≥ 10 sources + 5 pts
HIGH			≥ 1 source + 10 pts	≥ 2 sources + 10 pts
VERY HIGH				≥ 1 source + 10 pts

Matrix Score 10

Note: Septic systems, sewerlines, and roads are each assigned a risk ranking for each individua contaminant source in the CSI. The VA, however, counts these contaminant sources as a group and assigns a calculated number of either "lows" or "mediums" based on the density.

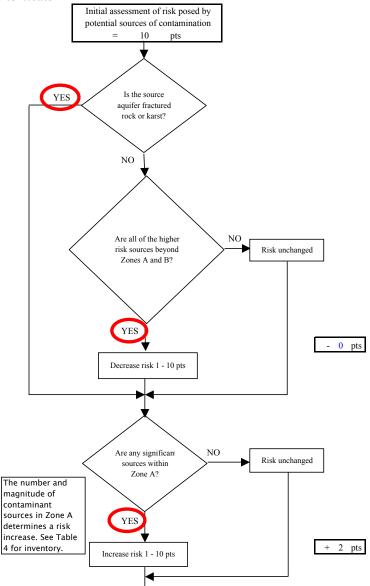


Chart 7. Contaminant risks for Zapadni Bay Harbour (263029.007) - Volatile Organic Chemicals Existing Are there conditions NO 0 pts Risk unchanged that warrant upgrading risk? Risk due to existing Potential contamination The number and 14 pts magnitude of Risk posed by potential sources contaminant of contamination with controls Contaminant Risk sources in Zone D YES determines a risk 14 pts Contaminant risks increase. See Table 4 for inventory. 2 pts Increase risk 1 - 10 pts Risk posed by potential sources of contamination 14 pts \*Truncate risk at 50 pts Contaminant risks\* 14 Are there sufficient Contaminant Risk Ratings Low controls, conditions, or monitoring to Risk unchanged 40 to 50 pts very high warrant downgrading 30 to < 40 pts high 20 to < 30 pts medium < 20 pts low YES 0 pts Decrease risk 1 - 10 pts Risk posed by potential sources of contamination with controls

Page 12 of 13

Chart 8. Vulnerability analysis for Zapadni Bay Harbour (263029.007) - Volatile Organic Chemicals (Chart 1. Susceptibiltiy of the wellhead) Susceptibility of well High 30 pts Evaluate the susceptibility of the wellhead (Chart 7. Contaminant risks for wells - Volatile Organic Chemicals) Evaluate contaminant Susceptibility of wellhead Low risks 5 pts Evaluate the (Chart 2. Susceptibility of the aquifer) Contaminant risks Low susceptibility of the 14 pts aquifer within the protection area Susceptibility of aquifer Very High 25 pts Susceptibility of the well Contaminant risks Vulnerability of drinking water well to contamination Susceptibility of the wellhead Overall Vulnerability Ratings Susceptibility of aquifer 80 to 100 pts very high 60 to < 80 pts high Susceptibility of well Vulnerability of drinking water 40 to < 60 ptsmedium well < 40 pts low 44 pts Medium 45

Page 13 of 13