

Source Water Assessment

A Hydrogeologic Susceptibility and
Vulnerability Assessment for
Sunshine Restaurant
Drinking Water System,
Talkeetna, Alaska
Sunshine Restaurant #224206

DRINKING WATER PROTECTION PROGRAM REPORT 235
Alaska Department of Environmental Conservation

AUGUST 2002

Source Water Assessment for
Sunshine Restaurant
Drinking Water System,
Talkeetna, Alaska
Sunshine Restaurant #224206

By Shannon & Wilson, Inc.

DRINKING WATER PROTECTION PROGRAM REPORT 235

The Drinking Water Protection Program is producing Source Water Assessments in compliance with the Safe Drinking Water Act Amendments of 1996. Each assessment includes a delineation of the source water area, an inventory of potential and existing contaminant sources that may impact the water, a risk ranking for each of these contaminants, and an evaluation of the potential vulnerability of these drinking water sources.

These assessments are intended to provide public water systems owners/operators, communities, and local governments with the best available information that may be used to protect the quality of their drinking water. The assessments combine information obtained from various sources, including the U.S. Environmental Protection Agency, Alaska Department of Environmental Conservation (ADEC), public water system owners/operators, and other public information sources. The results of this assessment are subject to change if additional data becomes available. If you have any additional information that may affect the results of this assessment, please contact the Program Coordinator of DWPP, (907) 269-7521.

CONTENTS

	Page		Page
Executive Summary	1	Inventory of Potential and Existing Contaminant Sources	3
Introduction	1	Ranking of Contaminant Risks	3
Description of the Middle Susitna River Region	2	Vulnerability of Sunshine Restaurant	
Sunshine Restaurant Public Drinking Water System	2	Drinking Water Source	3
Sunshine Restaurant Protection Area	2	Summary	5
		References Cited	6

TABLES

	Page
Table 1 - Definition of Zones	3
Table 2 - Natural Susceptibility - Susceptibility of the Wellhead and Aquifer to Contamination	4
Table 3 - Contaminant Risks	4
Table 4 - Overall Vulnerability of Sunshine Restaurant to Contamination by Category	4

ILLUSTRATIONS

		Page
FIGURE	1. Index map showing Talkeetna and the Middle Susitna River Region	1

APPENDICES

APPENDIX	<p>A. Sunshine Restaurant Drinking Water Protection Area (Map 1)</p> <p>B. Contaminant Source Inventory for Sunshine Restaurant (Table 1) Contaminant Source Inventory and Risk Ranking for Sunshine Restaurant – Bacteria and Viruses (Table 2) Contaminant Source Inventory and Risk Ranking for Sunshine Restaurant – Nitrates/Nitrites (Table 3) Contaminant Source Inventory and Risk Ranking for Sunshine Restaurant – Volatile Organic Chemicals (Table 4)</p> <p>C. Sunshine Restaurant Drinking Water Protection Area and Potential and Existing Contaminant Sources (Map 2)</p> <p>D. Vulnerability Analysis for Contaminant Source Inventory and Risk Ranking for Sunshine Restaurant Public Drinking Water Source (Charts 1 – 8)</p>
----------	---

Source Water Assessment for Sunshine Restaurant Source of Public Drinking Water, Talkeetna, Alaska

By Shannon & Wilson, Inc.

Drinking Water Protection Program Alaska Department of Environmental Conservation

EXECUTIVE SUMMARY

The Sunshine Restaurant is a Class B (transient/non-community) water system consisting of one well located at approximately mile 99 of the Parks Highway. Identified potential and current sources of contaminants for Sunshine Restaurant public drinking water source include: gasoline stations; large-capacity and single-family septic system; residential areas; above ground and underground gasoline and diesel tanks; and gravel roads. These identified potential and existing sources of contamination are considered sources of bacteria and viruses, nitrates and/or nitrites, and volatile organic chemicals. Overall, the public water sources for Sunshine Restaurant received a vulnerability rating of **High** for volatile organic chemicals, **High** for bacteria and viruses, and **High** for nitrates and nitrites.

INTRODUCTION

The Alaska Department of Environmental Conservation (ADEC) is completing source water assessments for all public drinking water sources in the State of Alaska. The purpose of this assessment is to provide owners and/or operators, communities, and local governments with information they can use to preserve the quality of Alaska's public drinking water supplies. The results of this source water assessment can be used to decide where voluntary protection efforts are needed and feasible, and also what efforts will be most effective in reducing contaminant risks to your water system. Shannon & Wilson has been contracted to perform these assessments under the supervision of ADEC.

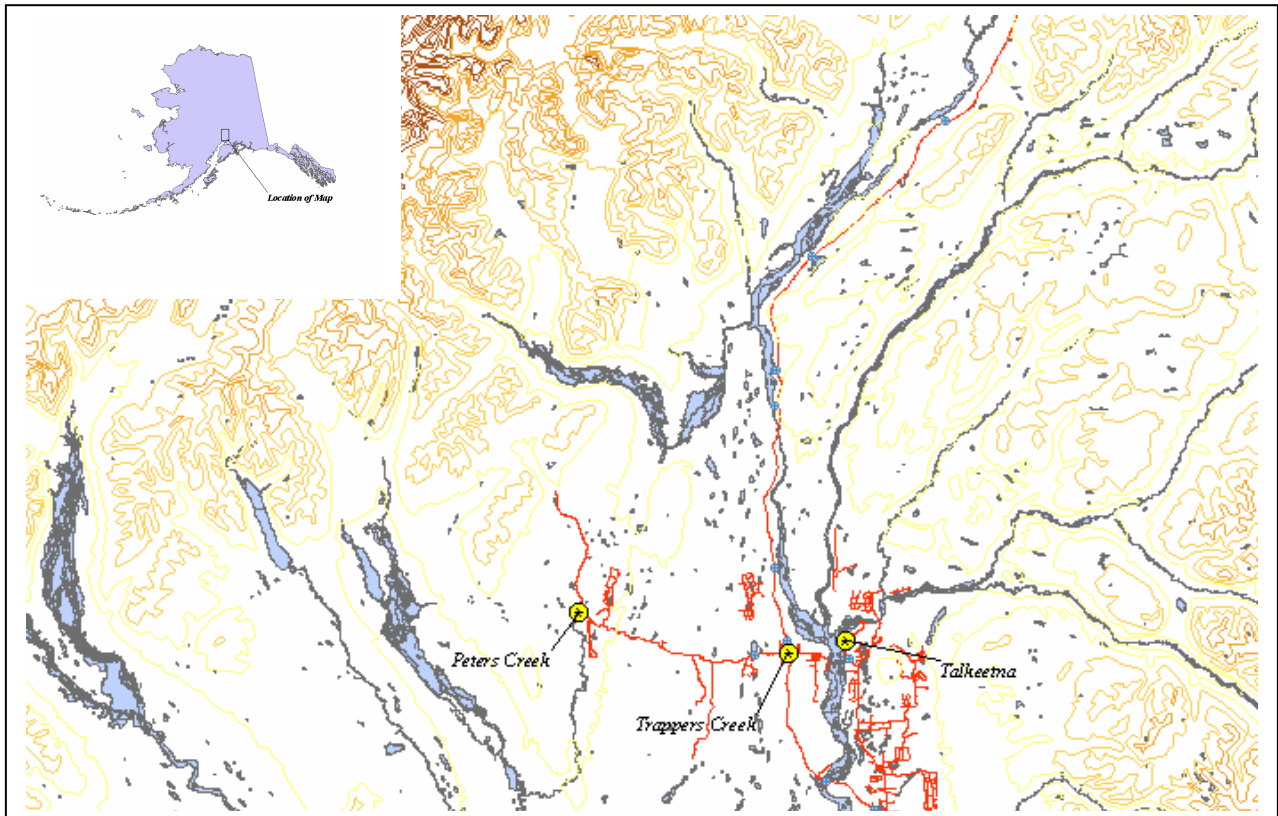


Figure 1. Index map showing Talkeetna and the Middle Susitna River Region.

This source water assessment combines a review of the natural conditions at the site and the potential and existing contaminant risks. These are combined to determine the overall vulnerability of the drinking water source to contamination.

DESCRIPTION OF THE MIDDLE SUSITNA RIVER REGION

Location

The Susitna River watershed is the largest watershed in Southcentral Alaska with the community of Talkeetna located at the confluence of the Chulitna, Talkeetna, and Susitna rivers. The area surrounding Talkeetna is shown in Figure 1. Talkeetna is located in the Matanuska-Susitna (Mat-Su) Borough.

Glacial and alluvial forces have shaped the Susitna River Region surrounding Talkeetna. These forces have resulted in the broad U-shaped river valleys, lakes, streams and undulating ridges and hills. Landforms in and around the Middle Susitna River Region are typified by the broad river floodplains, low ridges and lowlands.

Precipitation

Talkeetna averages about 30 inches of precipitation per year, including about 107 inches of snowfall.

Topography and Drainage

The area topography varies from about 300 feet to 400 feet within the river floodplains to several thousand feet on the surrounding ridges and mountain flanks.

Groundwater

Although the quality can vary significantly in a short distance, groundwater supplies are generally abundant in the area. Many homes and businesses in the area rely on individual wells for their water supply. Most of these wells are shallow with depths of less than 100 feet to 200 feet. Static water levels in many of these wells are less than 15 feet below the surface. The coarse, alluvial, sandy gravel in the floodplains of the areas streams and rivers provides a large aquifer even in the winter when infiltration is low.

Geology and Soils

Most of the soils in the area provide good sources of sand, gravel and topsoil. The deposition of silt, clay and organic muck in old lakes, oxbows and depressions means that some areas have soil conditions that vary over relatively short distances.

SUNSHINE RESTAURANT PUBLIC DRINKING WATER SYSTEM

Sunshine Restaurant is a Class B (transient/non-community) water system. The system consists of one well at Mile 99 of the Parks Highway.

There was not a well log available for the water system, so the well construction information was estimated based on surrounding similar type wells. A total depth of approximately 69 feet below ground surface and a 6-inch well casing were based on surrounding wells. It is assumed that the well is installed with a cap providing a sanitary seal. A properly installed sanitary seal may provide protection against contaminants from entering the source waters at the well casing. It is also assumed that the land surface is appropriately sloped away from the well providing adequate surface water drainage. Based on the assumed age of the well, the well is presumed to be not grouted according to ADEC regulations. Proper grouting provides added protection against contaminants travelling along the well casing and into source waters.

This system operates year-round and serves no residents and more than 40 non-residents through one service connection.

SUNSHINE RESTAURANT DRINKING WATER PROTECTION AREA

In order to evaluate whether a drinking water source is at risk, we must first evaluate what are the most likely pathways for surface contamination to reach the groundwater. Some areas are more likely to allow contamination to reach the well than others. These areas are determined by looking at the characteristics of the soil, groundwater, aquifer, and well.

The most probable area for contamination to reach the drinking water well is the area that contributes water to the well, the groundwater recharge area. This area is designated as the Drinking Water Protection Area (DWPA). Because a release of contaminants within the DWPA are most likely to impact the drinking water well, this area will serve as the focus for voluntary protection efforts.

An analytical calculation was used to determine the size and shape of the DWPA. The input parameters describing the attributes of the aquifer in this calculation were adopted from the U.S. Geological Survey (*Patrick, Brabets, and Glass, 1989*), and State of Alaska Department of Water Resources. Additional methods were also used to take into account any uncertainties in groundwater flow and aquifer characteristics to arrive at a meaningful DWPA (Please

refer to the Guidance Manual for Class B Public Water Systems for additional information).

The DWPA's established for wells by the ADEC are separated into four zones. These zones correspond to differences in the time-of-travel (TOT) of the water moving through the aquifer to the well. The time of travel for contaminants within the water varies and is dependent on the physical and chemical characteristics of each contaminant. The following is a summary of the four DWPA zones and the calculated TOT for each:

Table 1. Definition of Zones

Zone	Definition
A	¼ the distance for the 2 year TOT
B	Less than the 2 year TOT
C	Less Than the 5 year TOT
D	Less than the 10 year TOT

As an example, water moving through the aquifer in Zone B will reach the well in less than 2 years from the time it crosses the outer limit of Zone B.

Zone A also incorporates the area downgradient from the well to take into account the area of the aquifer that is influenced by pumping of the well. Water within the aquifer in Zone A will reach the well in several hours to several months.

INVENTORY OF POTENTIAL AND EXISTING CONTAMINANT SOURCES

The Drinking Water Protection Program has completed an inventory of potential and existing sources of contamination within the Sunshine Restaurant DWPA. This inventory was completed through a search of agency records and other publicly available information. Potential sources of contamination to the drinking water aquifer include a wide range of categories and types. Potential drinking water contaminants are found within agricultural, residential, commercial, and industrial areas, but can also occur within areas that have little or no development.

For the basis of all Class B public water system assessments, three categories of drinking water contaminants were inventoried, they include:

- Bacteria and viruses;
- Nitrates and/or nitrites; and
- Volatile organic chemicals.

Inventoried potential sources of contamination within Zones A through Zone D were associated with residential and light industrial type activities. The sources are summarized in the tables in Appendix B.

RANKING OF CONTAMINANT RISKS

Once the potential and existing sources of contamination have been identified, they are sorted and ranked according to what type and level of risk they represent. Ranking of contaminant risks for a “potential” or “existing” source of contamination is a function of toxicity and volumes of specific contaminants associated with that source. Further, contaminant risks are a function of the number and density of those types of contaminant sources as well as the proximity of those sources to the well.

VULNERABILITY OF SUNSHINE RESTAURANT DRINKING WATER SOURCE

Vulnerability of a drinking water source to contamination is a combination of two factors:

- Natural susceptibility; and
- Contaminant risks.

Each of the three categories of drinking water contaminants has been analyzed and an overall vulnerability score of 0 to 100 is ultimately assigned:

$$\begin{aligned}
 & \text{Natural Susceptibility (0 – 50 points)} \\
 & \quad + \\
 & \text{Contaminant Risks (0 – 50 points)} \\
 & \quad = \\
 & \text{Vulnerability of the} \\
 & \text{Drinking Water Source to Contamination (0 – 100).}
 \end{aligned}$$

A score for the Natural Susceptibility is achieved by analyzing the properties of the well and the aquifer.

$$\begin{aligned}
 & \text{Susceptibility of the Wellhead (0 – 25 Points)} \\
 & \quad + \\
 & \text{Susceptibility of the Aquifer (0 – 25 Points)} \\
 & \quad = \\
 & \text{Natural Susceptibility (Susceptibility of the Well)} \\
 & \quad \text{(0 – 50 Points)}
 \end{aligned}$$

The well for Sunshine Restaurant is completed in an unconfined aquifer setting. Because an unconfined aquifer is recharged by surface water and precipitation that migrates downward from the surface, contaminants at the surface have the potential to adversely impact this aquifer. Table 2 shows the Overall Susceptibility score and rating for Sunshine Restaurant.

Table 2. Natural Susceptibility - Susceptibility of the Wellhead and Aquifer to Contamination

	Score	Rating
Susceptibility of the Wellhead	5	Low
Susceptibility of the Aquifer	16	High
Natural Susceptibility	21	Medium

Contaminant risks to a drinking water source depend on the type, number or density, and distribution of contaminant sources. This data has been derived from an examination of existing or historical contamination that has been detected at the drinking water source through routine sampling. It also evaluates potential sources of contamination. Table 3 summarizes the Contaminant Risks for each category of drinking water contaminants.

Table 3. Contaminant Risks

Category	Score	Rating
Bacteria and Viruses	50	Very High
Nitrates and/or Nitrites	50	Very High
Volatile Organic Chemicals	48	Very High

Appendix D contains eight charts, which together form the ‘Vulnerability Analysis’ for a source water assessment for a public drinking water source. Chart 1 analyzes the ‘Susceptibility of the Wellhead’ to contamination by looking at the construction of the well and its surrounding area. Chart 2 analyzes the ‘Susceptibility of the Aquifer’ to contamination by looking at the naturally-occurring attributes of the water source and influences on the groundwater system that might lead to contamination. Chart 3 analyzes ‘Contaminant Risks’ for the drinking water source with respect to bacteria and viruses. The ‘Contaminant Risks’ portion of the analysis considers potential sources of contaminants as well as a review of contamination that has or may have occurred, but has not arrived or been detected at the well. Lastly, Chart 4 contains the ‘Vulnerability Analysis for Bacteria and Viruses.’ Charts 5 through 8 contain the Contaminant Risks and Vulnerability Analyses for nitrates and nitrites and volatile organic chemicals, respectively.

Table 4 contains the overall vulnerability scores (0 - 100) and ratings for each of the three categories of drinking water contaminants. Note: scores are rounded off to the nearest five.

Table 4. Overall Vulnerability of Sunshine Restaurant to Contamination by Category

Category	Score	Rating
Bacteria and Viruses	70	High
Nitrates and Nitrites	70	High
Volatile Organic Chemicals	70	High

Tables 2 through 4 in Appendix B contain the ranking of potential and existing sources of contamination with respect to bacteria and viruses, nitrates and/or nitrites, and volatile organic chemicals.

The gasoline stations; large-capacity and single-family septic system; residential areas; aboveground and underground gasoline and diesel tanks; and gravel roads create a risk increase for the bacteria and viruses, nitrates and nitrites, and volatile organic compounds.

Only a small amount of bacteria and viruses are required to endanger public health. Bacteria and viruses have not been detected during recent water sampling of the system at Sunshine Restaurant.

Nitrates and/or nitrites are found in natural background concentration at this site, as elsewhere throughout Alaska. Nitrate concentrations in uncontaminated groundwater are typically less than 2 milligrams per liter (mg/L) and are derived primarily from the decomposition of organic matter in soils, adopted from the U.S. Geological Survey (Wang, et al., 2000).

Sampling history for Sunshine Restaurant well indicates that low concentrations of nitrate have been detected (see Chart 5 - Contaminant Risks for Nitrates and/or Nitrites in Appendix D). The maximum reported existing nitrate concentration is approximately 0.53 mg/L or 5% of the Maximum Contaminant Level (MCL) of 10 mg/L. The MCL is the maximum level of contaminant that is allowed to exist in drinking water and still be consumed by humans without harmful health effects. Due to the high solubility and weak retention by soil, nitrates are very mobile, moving at approximately the same rate as water. Though existing nitrate contamination was detected at the site, concentrations remain at very safe levels with respect to human health.

The gasoline stations; large-capacity and single-family septic system; residential areas; aboveground and underground gasoline and diesel tanks; and gravel roads located in Zones A, B and C, form the greatest risk for volatile organic chemicals.

SUMMARY

A *Source Water Assessment* has been completed for the sources of public drinking water serving Sunshine Restaurant. The overall vulnerability of this source to contamination is **High** for volatile organic chemicals, **High** for bacteria and viruses, and **High** for nitrates and nitrites. This assessment of contaminant risks can be used as a foundation for local voluntary protection efforts as well as a basis for the continuous efforts on the part of Sunshine Restaurant to protect public health. It is anticipated that *Source Water Assessments* will be updated every five years to reflect any changes in the vulnerability and/or susceptibility of Sunshine Restaurant public drinking water source.


REFERENCES CITED

- Patrick, L.D., Brabets, T.P., and Glass, R.L., 1989, Simulation of ground-water flow at Anchorage, Alaska: US Geological Survey Water-Resources Investigations Report 88-4139, 41p.
- Wang, B., Strelakos, P.M., and Jokela, J.B., 2000, Nitrate source indicators in ground water of the scimitar subdivision, Peters Creek Area, Anchorage, Alaska: US Geological Survey Water-Resources Investigations Report 00-4137.
- Weather Underground, June 18, 2002, Web extension to the *Western Regional Climate Center* [WWW document]. URL <http://www.wunderground.com>


APPENDIX A

Sunshine Restaurant Drinking Water Protection Area (Map 1)


Drinking Water Protection Areas for Sunshine Restaurant

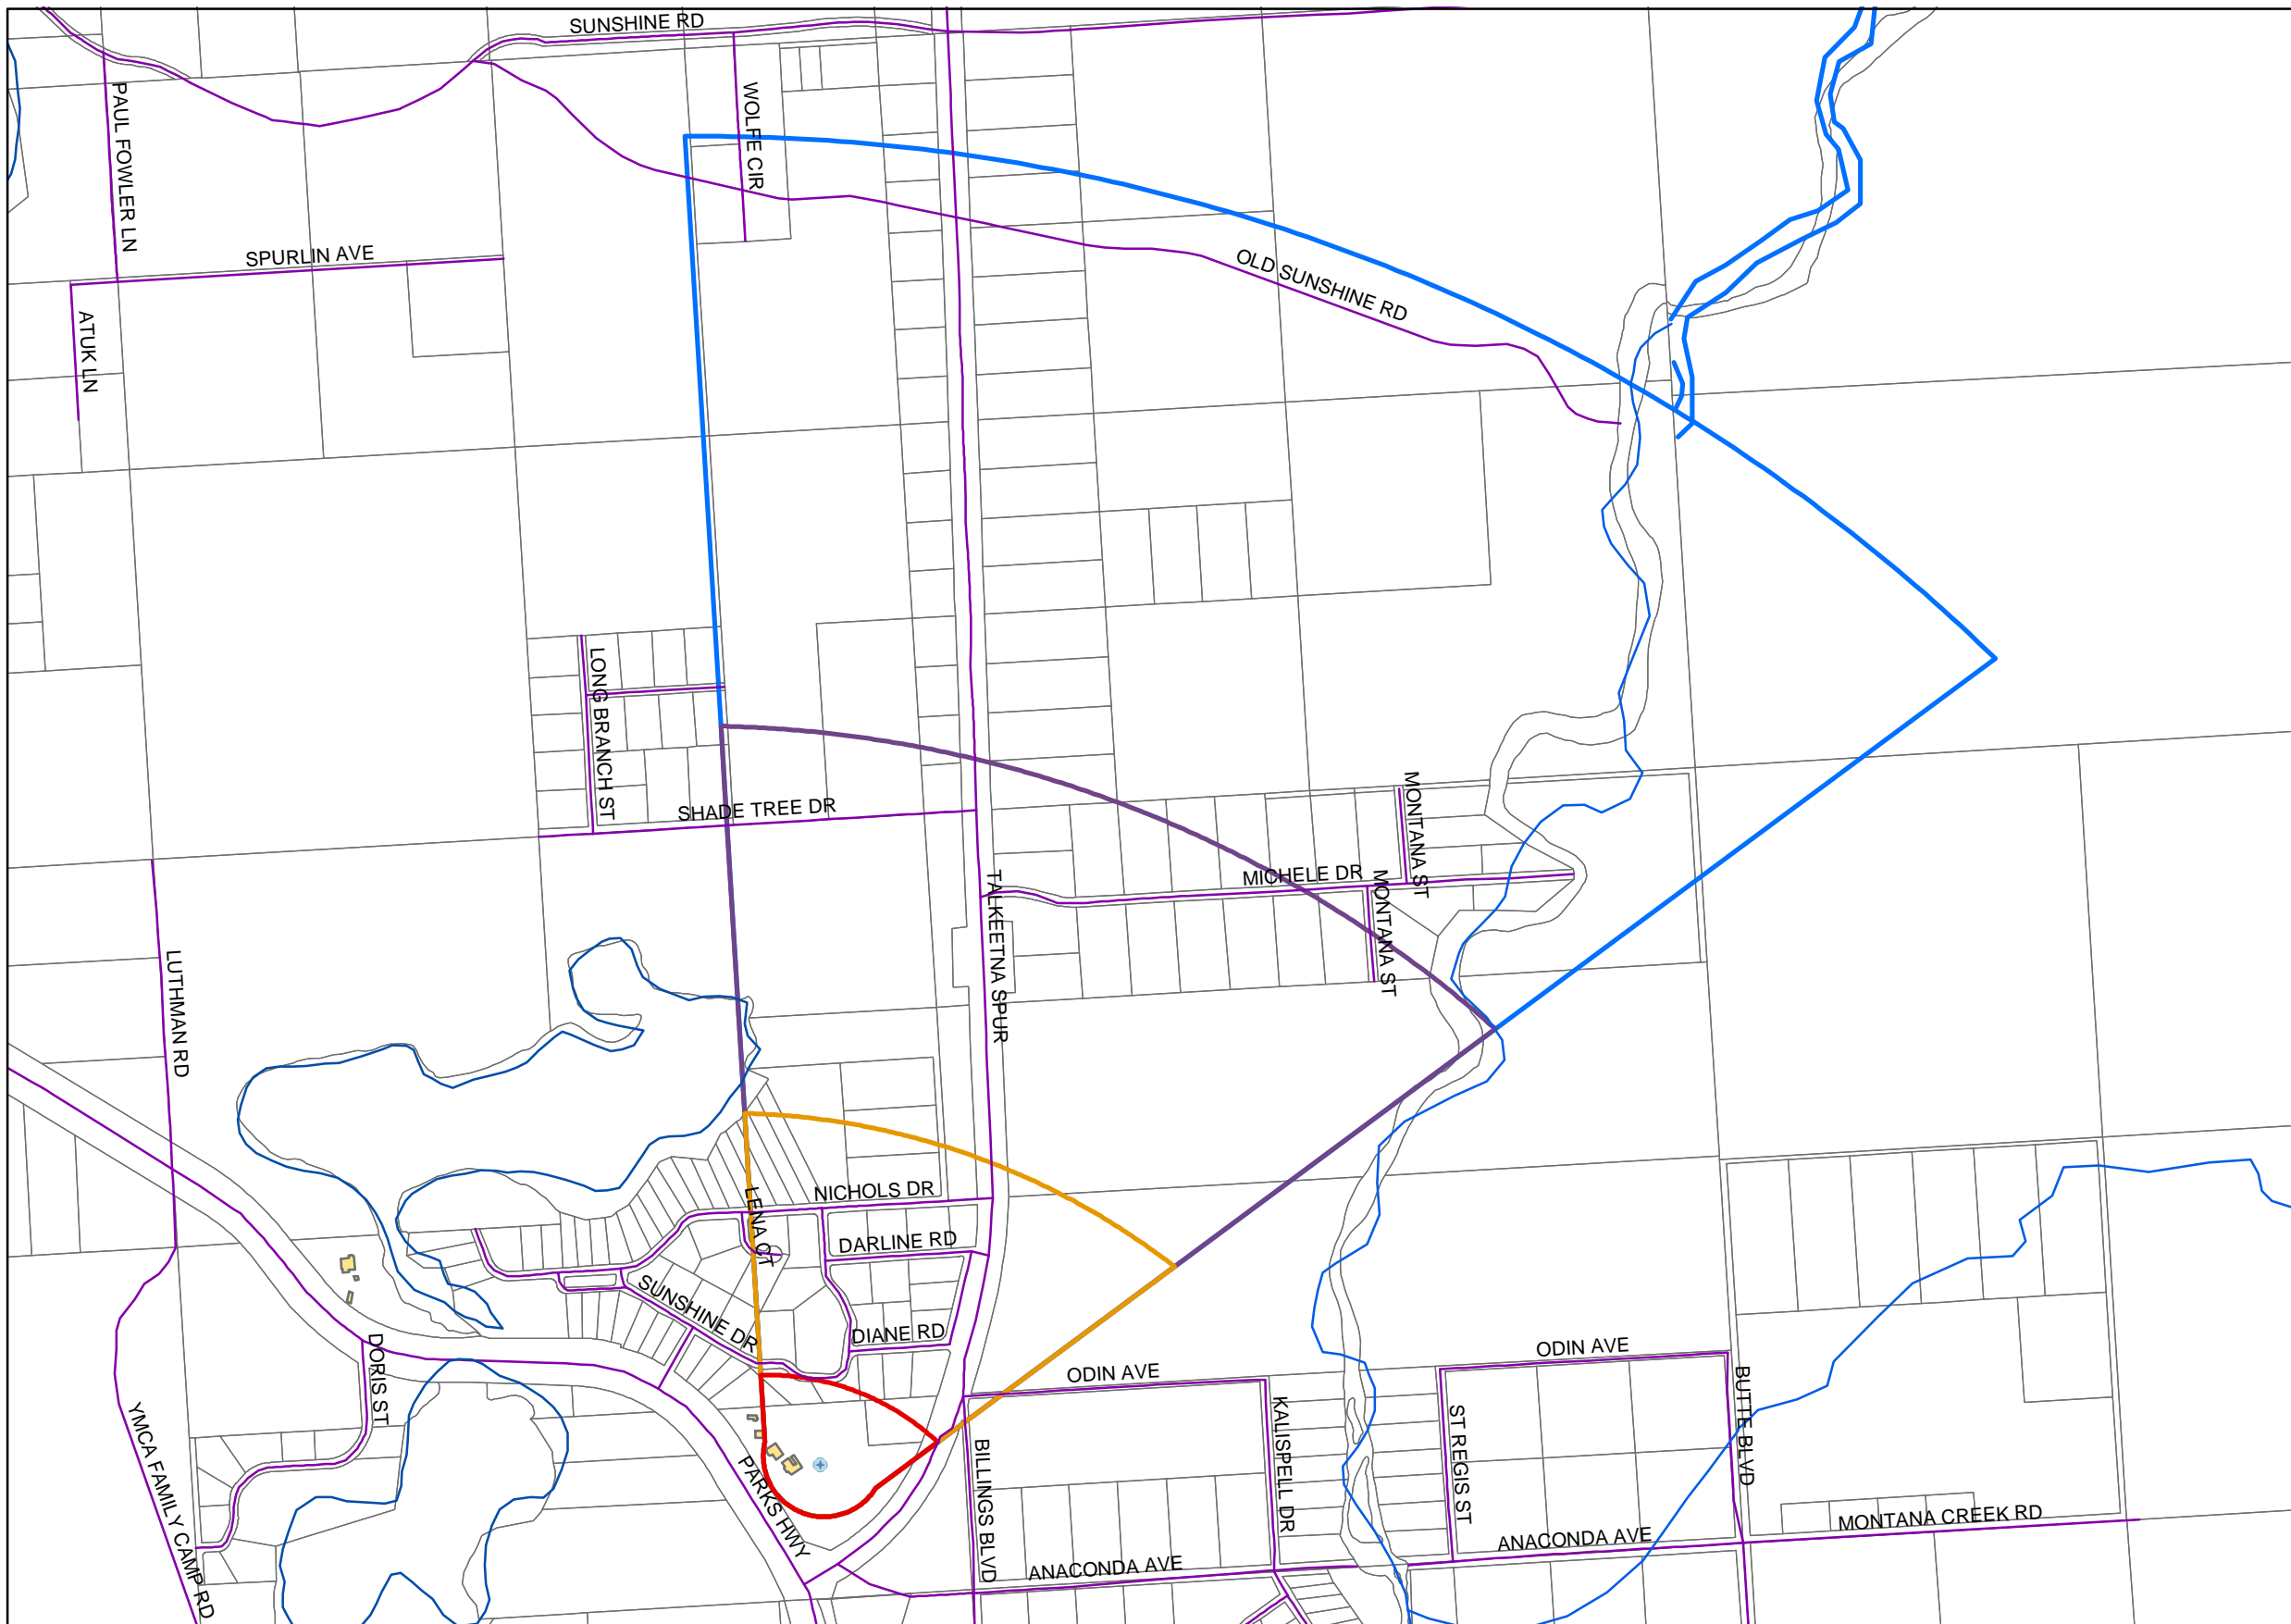

- Sunshine Restaurant Well
- MSB Roads
- Smaller Rivers
- Main Rivers
- Lakes
- MSB Land Parcels
- Site Buildings
- Zone A Protection Area**
- Several Months Travel Time
- Zone B Protection Area**
- Less than 2-Years Travel Time
- Zone C Protection Area**
- Less than 5-Years Travel Time
- Zone D Protection Area**
- Less than 10-Years Travel Time

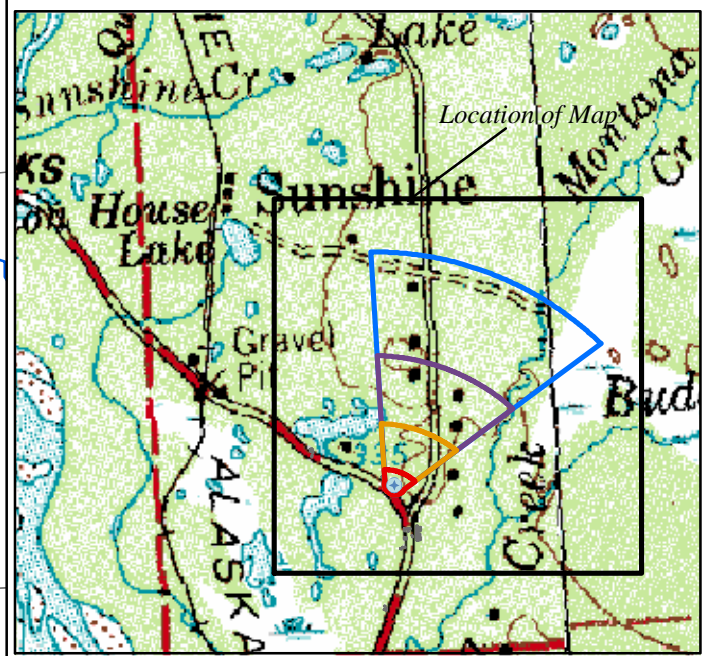

PWSID 224206.001



Map 1

APPENDIX B

Contaminant Source Inventory and Risk Ranking for Sunshine Restaurant (Tables 1-4)

Table 1**Contaminant Source Inventory for
Sunshine Restaurant****PWSID 224206.001**

Contaminant Source Type	Contaminant Source ID	CS ID tag	Zone	Location	Map Number	Comments
Gasoline stations (without repair shop)	C15	C15-1	A	Sunshine Restaurant site	3	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-1	A	Between Sunshine Drive and Park Highway	3	
Residential Areas	R01	R1-1	A	South of Sunshine Drive, west of Talkeetna Spur, north of well	2	5 acres
Septic systems (serves one single-family home)	R02	R2-1	A	Corner of Parks and Talkeetna Spur	3	
Tanks, gasoline (above ground)	T10	T10-1	A	Sunshine Restaurant site	3	
Tanks, gasoline (above ground)	T10	T10-2	A	Sunshine Restaurant site	3	
Tanks, gasoline (underground)	T12	T12-1	A	Sunshine Restaurant site	3	
Tanks, gasoline (underground)	T12	T12-2	A	Sunshine Restaurant site	3	
Tanks, diesel (above ground)	T06	T6-1	A	Sunshine Restaurant site	3	
Tanks, diesel (underground)	T08	T8-1	A	Sunshine Restaurant site	3	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-2	B	West of Talkeetna Spur, south of Nichols Drive	3	
Residential Areas	R01	R1-2	B	Residences north and south of Nichols Drive	2	48 acres
Septic systems (serves one single-family home)	R02	R2-2	B	East of Sunshine Drive and south of Diane Road	3	
Septic systems (serves one single-family home)	R02	R2-3	B	Between Sunshine Drive and Parks Highway	3	
Septic systems (serves one single-family home)	R02	R2-4	B	Off Darline Road	3	
Septic systems (serves one single-family home)	R02	R2-5	B	Corner of Nichols Drive and Talkeetna Spur	3	
Septic systems (serves one single-family home)	R02	R2-6	B	Off Nichols Drive, NW of Lena Court	3	
Septic systems (serves one single-family home)	R02	R2-7	B	Off Nichols Drive, NW of Lena Court	3	
Highways and roads, dirt/gravel	X24	X24-1	B	Sunshine Drive	2	
Highways and roads, dirt/gravel	X24	X24-2	B	Odin Avenue	2	
Highways and roads, dirt/gravel	X24	X24-3	B	Diane Road	2	

Table 1 (continued)

**Contaminant Source Inventory for
Sunshine Restaurant**

PWSID 224206.001

Contaminant Source Type	Contaminant Source ID	CS ID tag	Zone	Location	Map Number	Comments
Highways and roads, dirt/gravel	X24	X24-4	B	Nichols Drive	2	
Highways and roads, dirt/gravel	X24	X24-5	B	Lena Court	2	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-3	C	East of Talkeetna Spur, south of Michele Drive	3	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-4	C	South of Michele Drive, west of Talkeetna Spur	3	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-5	C	North of Michele Drive, east of Talkeetna Spur	3	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-6	C	Near Talkeetna Spur and Shade Tree Drive	3	
Residential Areas	R01	R1-3	C	Residences along Michele and Nichols Drive	2	78 acres
Septic systems (serves one single-family home)	R02	R2-8-R2-13	C	6 sites in Zone C	3	
Highways and roads, dirt/gravel	X24	X24-6	C	Michele Drive	2	
Highways and roads, dirt/gravel	X24	X24-7	C	Montana Street	2	
Highways and roads, dirt/gravel	X24	X24-8	C	Shade Tree Drive	2	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-7	D	Off Talkeetna Spur, south of Old Sunshine Road	3	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-8	D	East of Talkeetna Spur and north of Old Sunshine Road	3	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-9	D	West of Talkeetna Spur and north of Old Sunshine Road	3	

Contaminant Source Inventory and Risk Ranking for

PWSID 224206.001

Table 2

Sunshine Restaurant

Sources of Bacteria and Viruses

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Overall Rank after Analysis</i>	<i>Location</i>	<i>Map Number</i>	<i>Comments</i>
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-1	A	High	1	Between Sunshine Drive and Park Highway	3	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-2	B	High	2	West of Talkeetna Spur, south of Nichols Drive	3	
Septic systems (serves one single-family home)	R02	R2-1	A	Low	3	Corner of Parks and Talkeetna Spur	3	
Residential Areas	R01	R1-2	B	Low	4	Residences north and south of Nichols Drive	2	48 acres
Septic systems (serves one single-family home)	R02	R2-2	B	Low	5	East of Sunshine Drive and south of Diane Road	3	
Septic systems (serves one single-family home)	R02	R2-3	B	Low	6	Between Sunshine Drive and Parks Highway	3	
Septic systems (serves one single-family home)	R02	R2-4	B	Low	7	Off Darline Road	3	
Septic systems (serves one single-family home)	R02	R2-5	B	Low	8	Corner of Nichols Drive and Talkeetna Spur	3	
Septic systems (serves one single-family home)	R02	R2-6	B	Low	9	Off Nichols Drive, NW of Lena Court	3	
Septic systems (serves one single-family home)	R02	R2-7	B	Low	10	Off Nichols Drive, NW of Lena Court	3	
Highways and roads, dirt/gravel	X24	X24-1	B	Low		Sunshine Drive	2	
Highways and roads, dirt/gravel	X24	X24-2	B	Low		Odin Avenue	2	
Highways and roads, dirt/gravel	X24	X24-3	B	Low		Diane Road	2	
Highways and roads, dirt/gravel	X24	X24-4	B	Low		Nichols Drive	2	
Highways and roads, dirt/gravel	X24	X24-5	B	Low		Lena Court	2	

Contaminant Source Inventory and Risk Ranking for

PWSID 224206.001

Table 3

Sunshine Restaurant

Sources of Nitrates/Nitrites

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Overall Rank after Analysis</i>	<i>Location</i>	<i>Map Number</i>	<i>Comments</i>
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-1	A	High	1	Between Sunshine Drive and Park Highway	3	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-2	B	High	2	West of Talkeetna Spur, south of Nichols Drive	3	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-3	C	High	3	East of Talkeetna Spur, south of Michele Drive	3	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-4	C	High	4	South of Michele Drive, west of Talkeetna Spur	3	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-5	C	High	5	North of Michele Drive, east of Talkeetna Spur	3	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-6	C	High	6	Near Talkeetna Spur and Shade Tree Drive	3	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-7	D	High	7	Off Talkeetna Spur, south of Old Sunshine Road	3	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-8	D	High	8	East of Talkeetna Spur and north of Old Sunshine Road	3	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-9	D	High	9	West of Talkeetna Spur and north of Old Sunshine Road	3	
Septic systems (serves one single-family home)	R02	R2-1	A	Low	10	Corner of Parks and Talkeetna Spur	3	
Residential Areas	R01	R1-2	B	Low		Residences north and south of Nichols Drive	2	48 acres
Septic systems (serves one single-family home)	R02	R2-2	B	Low		East of Sunshine Drive and south of Diane Road	3	

Contaminant Source Inventory and Risk Ranking for

PWSID 224206.001

Sunshine Restaurant

Sources of Nitrates/Nitrites

Table 3 (continued)

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Overall Rank after Analysis</i>	<i>Location</i>	<i>Map Number</i>	<i>Comments</i>
Septic systems (serves one single-family home)	R02	R2-3	B	Low		Between Sunshine Drive and Parks Highway	3	
Septic systems (serves one single-family home)	R02	R2-4	B	Low		Off Darline Road	3	
Septic systems (serves one single-family home)	R02	R2-5	B	Low		Corner of Nichols Drive and Talkeetna Spur	3	
Septic systems (serves one single-family home)	R02	R2-6	B	Low		Off Nichols Drive, NW of Lena Court	3	
Septic systems (serves one single-family home)	R02	R2-7	B	Low		Off Nichols Drive, NW of Lena Court	3	
Highways and roads, dirt/gravel	X24	X24-1	B	Low		Sunshine Drive	2	
Highways and roads, dirt/gravel	X24	X24-2	B	Low		Odin Avenue	2	
Highways and roads, dirt/gravel	X24	X24-3	B	Low		Diane Road	2	
Highways and roads, dirt/gravel	X24	X24-4	B	Low		Nichols Drive	2	
Highways and roads, dirt/gravel	X24	X24-5	B	Low		Lena Court	2	
Residential Areas	R01	R1-3	C	Low		Residences along Michele and Nichols Drive	2	78 acres
Septic systems (serves one single-family home)	R02	R2-8-R2-13	C	Low		6 sites in Zone C	3	
Highways and roads, dirt/gravel	X24	X24-6	C	Low		Michele Drive	2	
Highways and roads, dirt/gravel	X24	X24-7	C	Low		Montana Street	2	
Highways and roads, dirt/gravel	X24	X24-8	C	Low		Shade Tree Drive	2	

Contaminant Source Inventory and Risk Ranking for

PWSID 224206.001

Table 4

Sunshine Restaurant

Sources of Volatile Organic Chemicals

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Overall Rank after Analysis</i>	<i>Location</i>	<i>Map Number</i>	<i>Comments</i>
Gasoline stations (without repair shop)	C15	C15-1	A	High	1	Sunshine Restaurant site	3	
Tanks, gasoline (underground)	T12	T12-1	A	High	2	Sunshine Restaurant site	3	
Tanks, gasoline (underground)	T12	T12-2	A	High	3	Sunshine Restaurant site	3	
Tanks, diesel (underground)	T08	T8-1	A	High	4	Sunshine Restaurant site	3	
Tanks, gasoline (above ground)	T10	T10-1	A	Medium	5	Sunshine Restaurant site	3	
Tanks, gasoline (above ground)	T10	T10-2	A	Medium	6	Sunshine Restaurant site	3	
Tanks, diesel (above ground)	T06	T6-1	A	Medium	7	Sunshine Restaurant site	3	
Septic systems (serves one single-family home)	R02	R2-1	A	Low	8	Corner of Parks and Talkeetna Spur	3	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-1	A	Low	9	Between Sunshine Drive and Park Highway	3	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-2	B	Low	10	West of Talkeetna Spur, south of Nichols Drive	3	
Residential Areas	R01	R1-2	B	Low		Residences north and south of Nichols Drive	2	48 acres
Septic systems (serves one single-family home)	R02	R2-2	B	Low		East of Sunshine Drive and south of Diane Road	3	
Septic systems (serves one single-family home)	R02	R2-3	B	Low		Between Sunshine Drive and Parks Highway	3	
Septic systems (serves one single-family home)	R02	R2-4	B	Low		Off Darline Road	3	
Septic systems (serves one single-family home)	R02	R2-5	B	Low		Corner of Nichols Drive and Talkeetna Spur	3	
Septic systems (serves one single-family home)	R02	R2-6	B	Low		Off Nichols Drive, NW of Lena Court	3	

Contaminant Source Inventory and Risk Ranking for

PWSID 224206.001

Table 4 (continued)

Sunshine Restaurant


Sources of Volatile Organic Chemicals

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Overall Rank after Analysis</i>	<i>Location</i>	<i>Map Number</i>	<i>Comments</i>
Septic systems (serves one single-family home)	R02	R2-7	B	Low		Off Nichols Drive, NW of Lena Court	3	
Highways and roads, dirt/gravel	X24	X24-1	B	Low		Sunshine Drive	2	
Highways and roads, dirt/gravel	X24	X24-2	B	Low		Odin Avenue	2	
Highways and roads, dirt/gravel	X24	X24-3	B	Low		Diane Road	2	
Highways and roads, dirt/gravel	X24	X24-4	B	Low		Nichols Drive	2	
Highways and roads, dirt/gravel	X24	X24-5	B	Low		Lena Court	2	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-3	C	Low		East of Talkeetna Spur, south of Michele Drive	3	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-4	C	Low		South of Michele Drive, west of Talkeetna Spur	3	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-5	C	Low		North of Michele Drive, east of Talkeetna Spur	3	
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-6	C	Low		Near Talkeetna Spur and Shade Tree Drive	3	
Residential Areas	R01	R1-3	C	Low		Residences along Michele and Nichols Drive	2	78 acres
Septic systems (serves one single-family home)	R02	R2-8-R2-13	C	Low		6 sites in Zone C	3	
Highways and roads, dirt/gravel	X24	X24-6	C	Low		Michele Drive	2	
Highways and roads, dirt/gravel	X24	X24-7	C	Low		Montana Street	2	
Highways and roads, dirt/gravel	X24	X24-8	C	Low		Shade Tree Drive	2	



APPENDIX C

Sunshine Restaurant Drinking Water Protection Area and Potential and Existing Contaminant Sources (Maps 2-3)


Drinking Water Protection Areas for Sunshine Restaurant and Potential and Existing Sources of Contamination

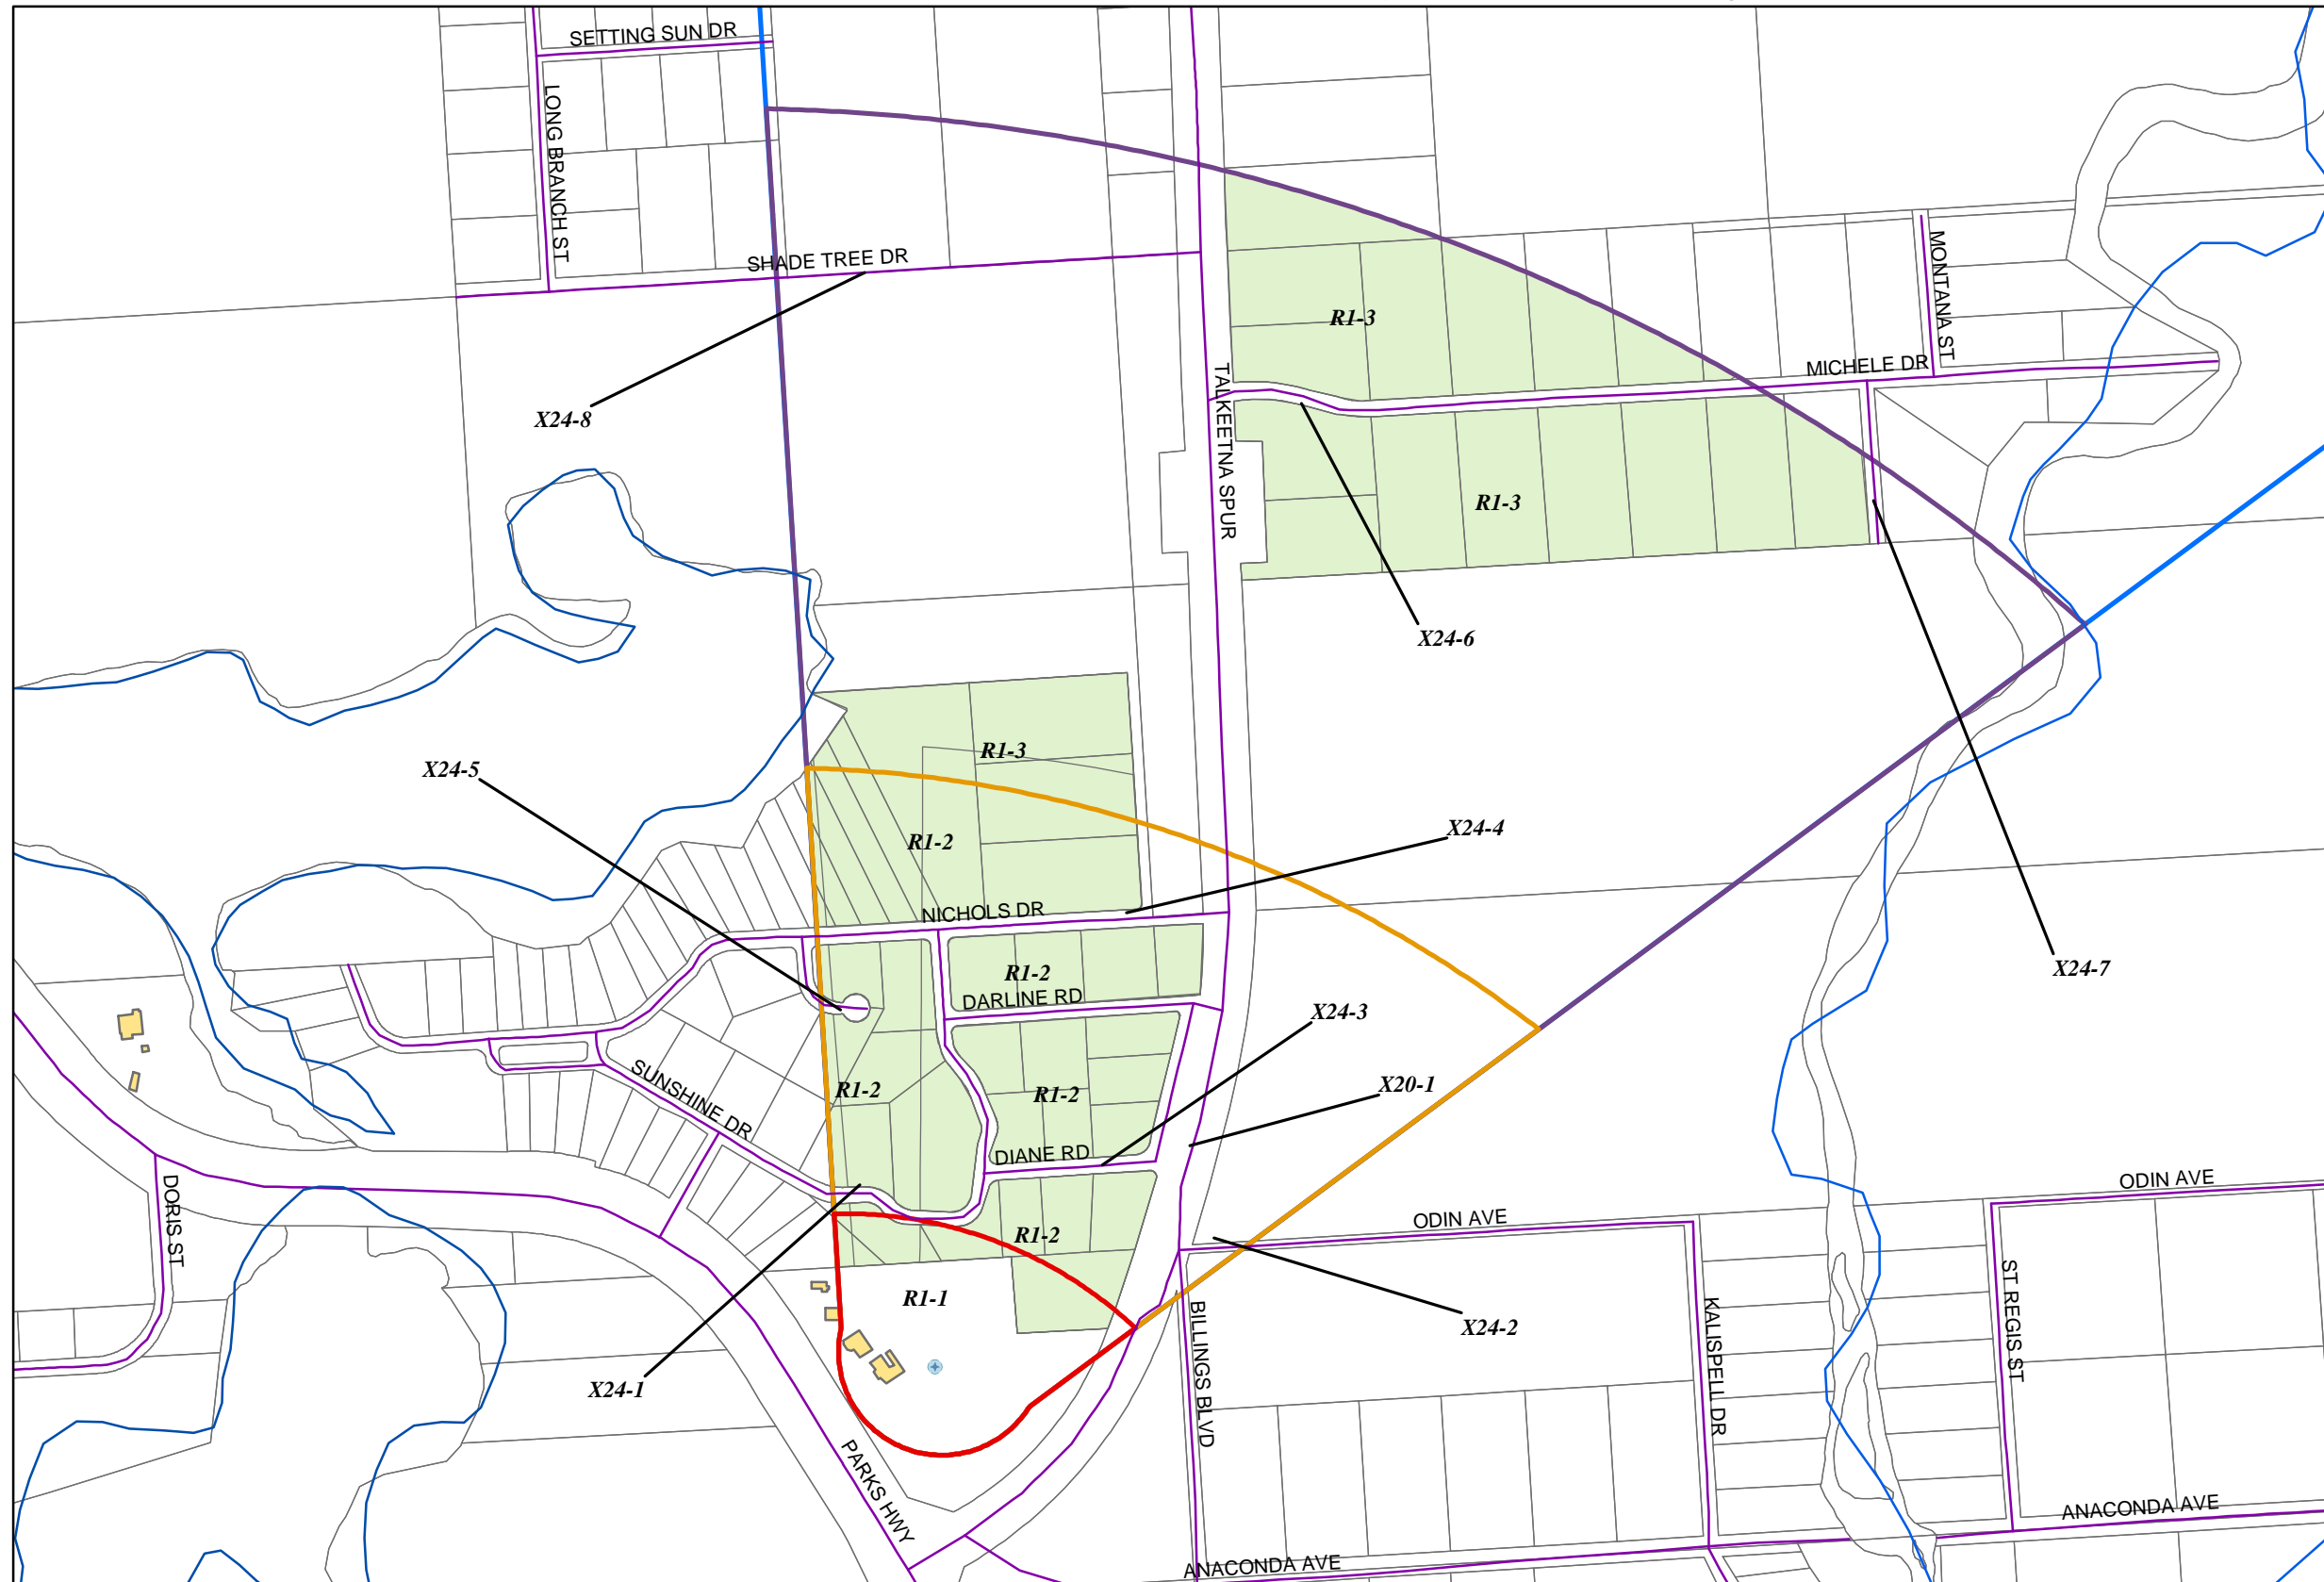

- Sunshine Restaurant Well
- MSB Roads
- Smaller Rivers
- Main Rivers
- Lakes
- MSB Land Parcels
- Site Buildings
- Residential Areas (R1)
- Zone A Protection Area**
- Several Months Travel Time
- Zone B Protection Area**
- Less than 2-Years Travel Time
- Zone C Protection Area**
- Less than 5-Years Travel Time
- Zone D Protection Area**
- Less than 10-Years Travel Time

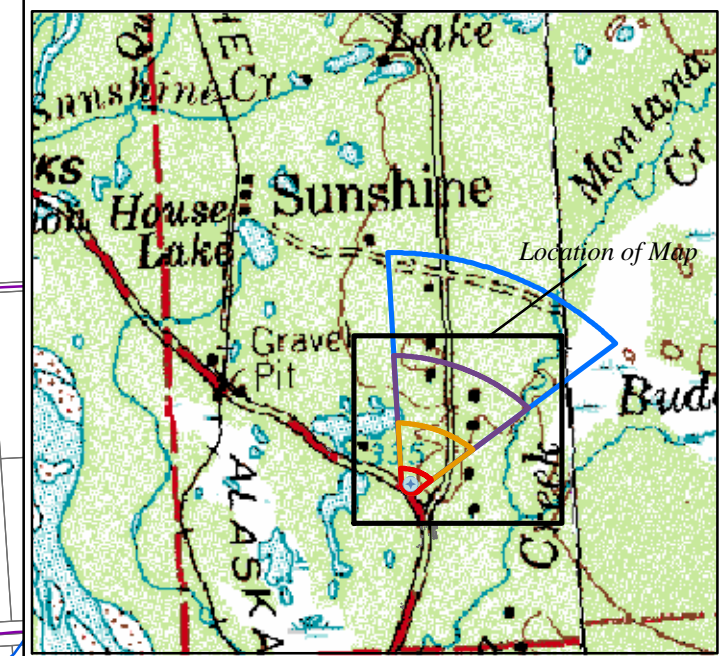


PWSID 224206.001





Map 2


Drinking Water Protection Areas for Sunshine Restaurant and Potential and Existing Sources of Contamination

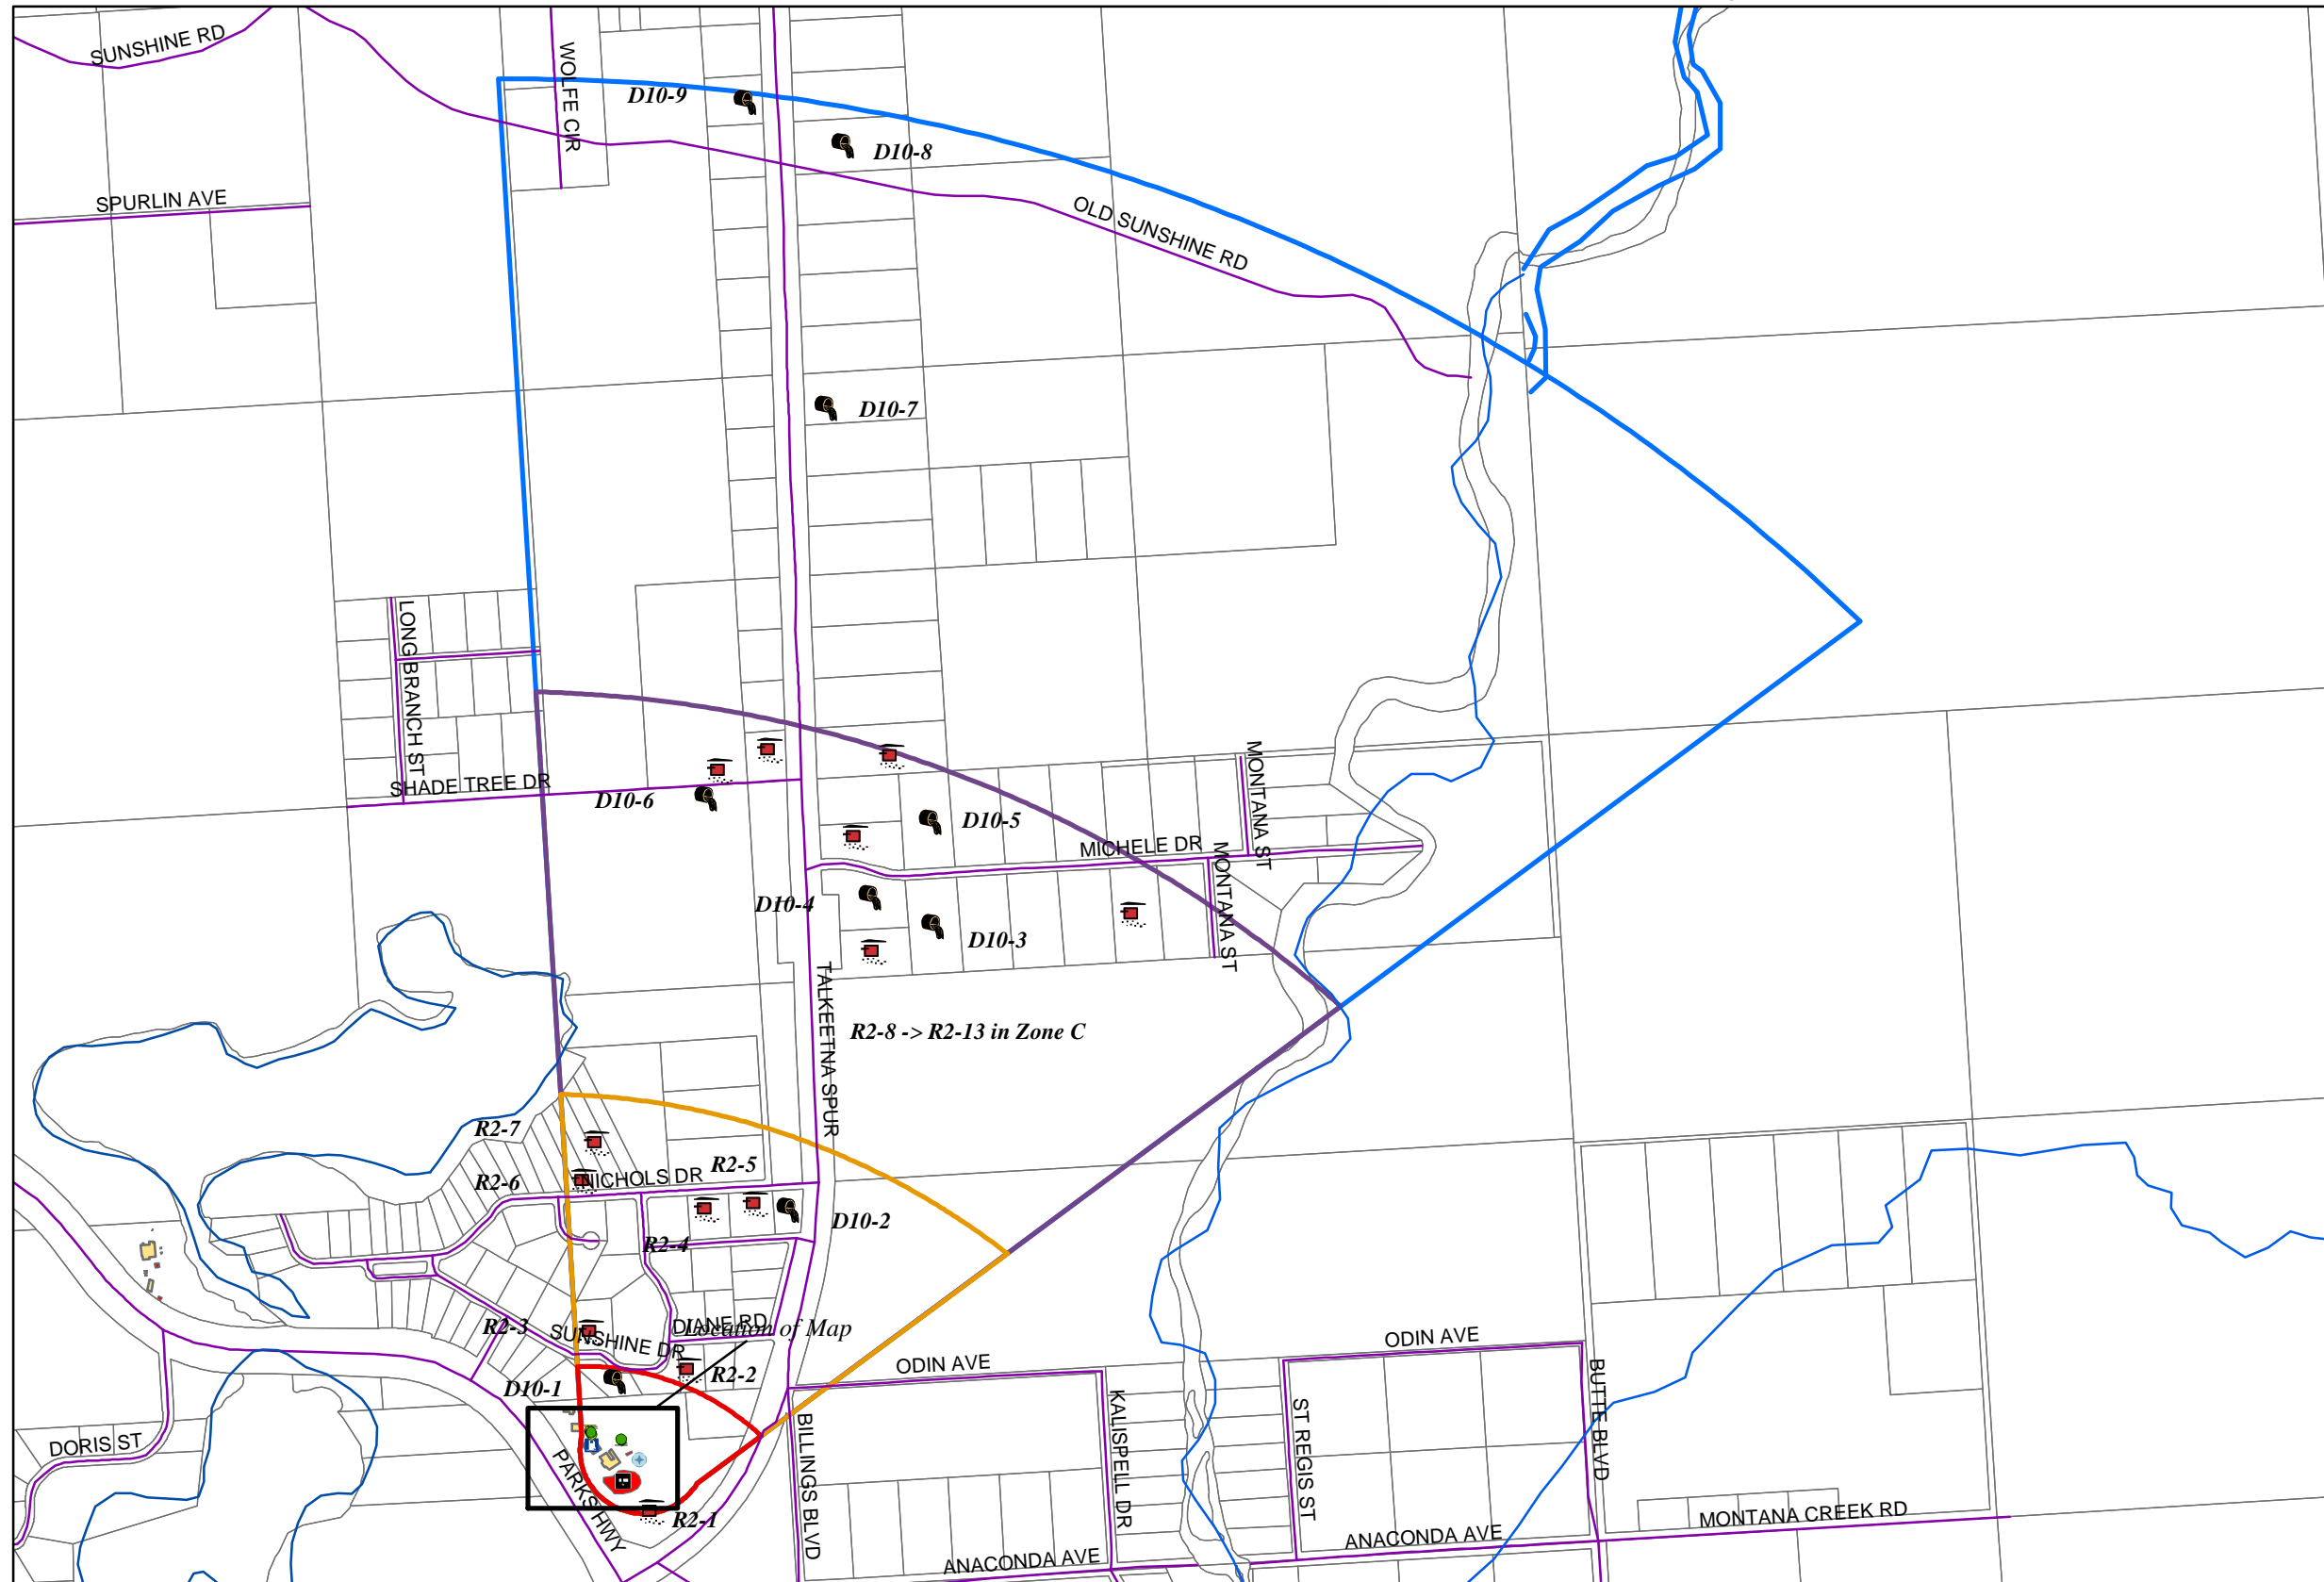

- Sunshine Restaurant Well
- Camprgrounds and RV Parks (X35)
- Gasoline Stations without repair shops (C15)
- Tanks, diesel (aboveground) (T6)
- Tanks, diesel (underground) (T8)
- Tanks, gasoline (aboveground) (T10)
- Tanks, gasoline (underground) (T12)
- Large Capacity Septic System (D10)
- Single Family Septic System (R2)
- MSB Roads
- MSB Land Parcels
- Site Buildings
- Zone A Protection Area**
- Several Months Travel Time
- Zone B Protection Area**
- Less than 2-Years Travel Time
- Zone C Protection Area**
- Less than 5-Years Travel Time
- Zone D Protection Area**
- Less than 10-Years Travel Time

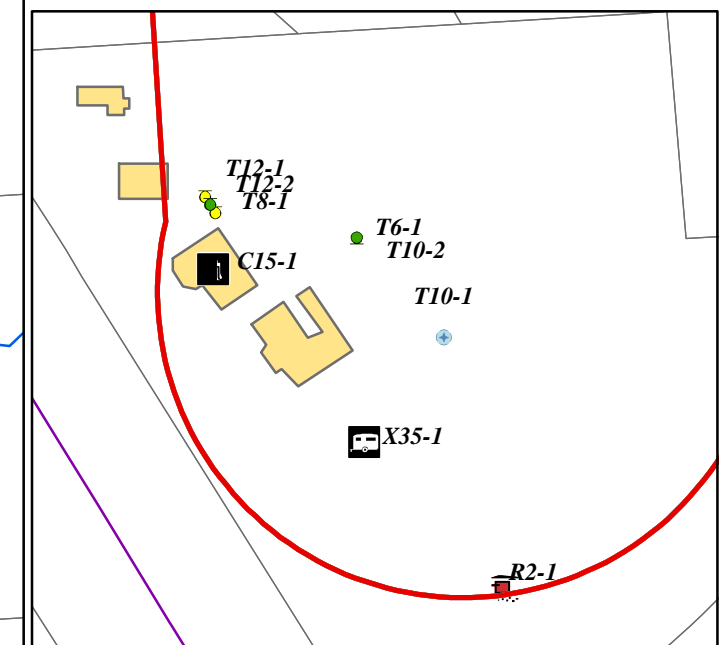

PWSID 224206.001



Map 3

APPENDIX D

Vulnerability Analysis for Sunshine Restaurant Public Drinking Water Source (Charts 1-8)

Chart 1. Susceptibility of the wellhead - Sunshine Restaurant

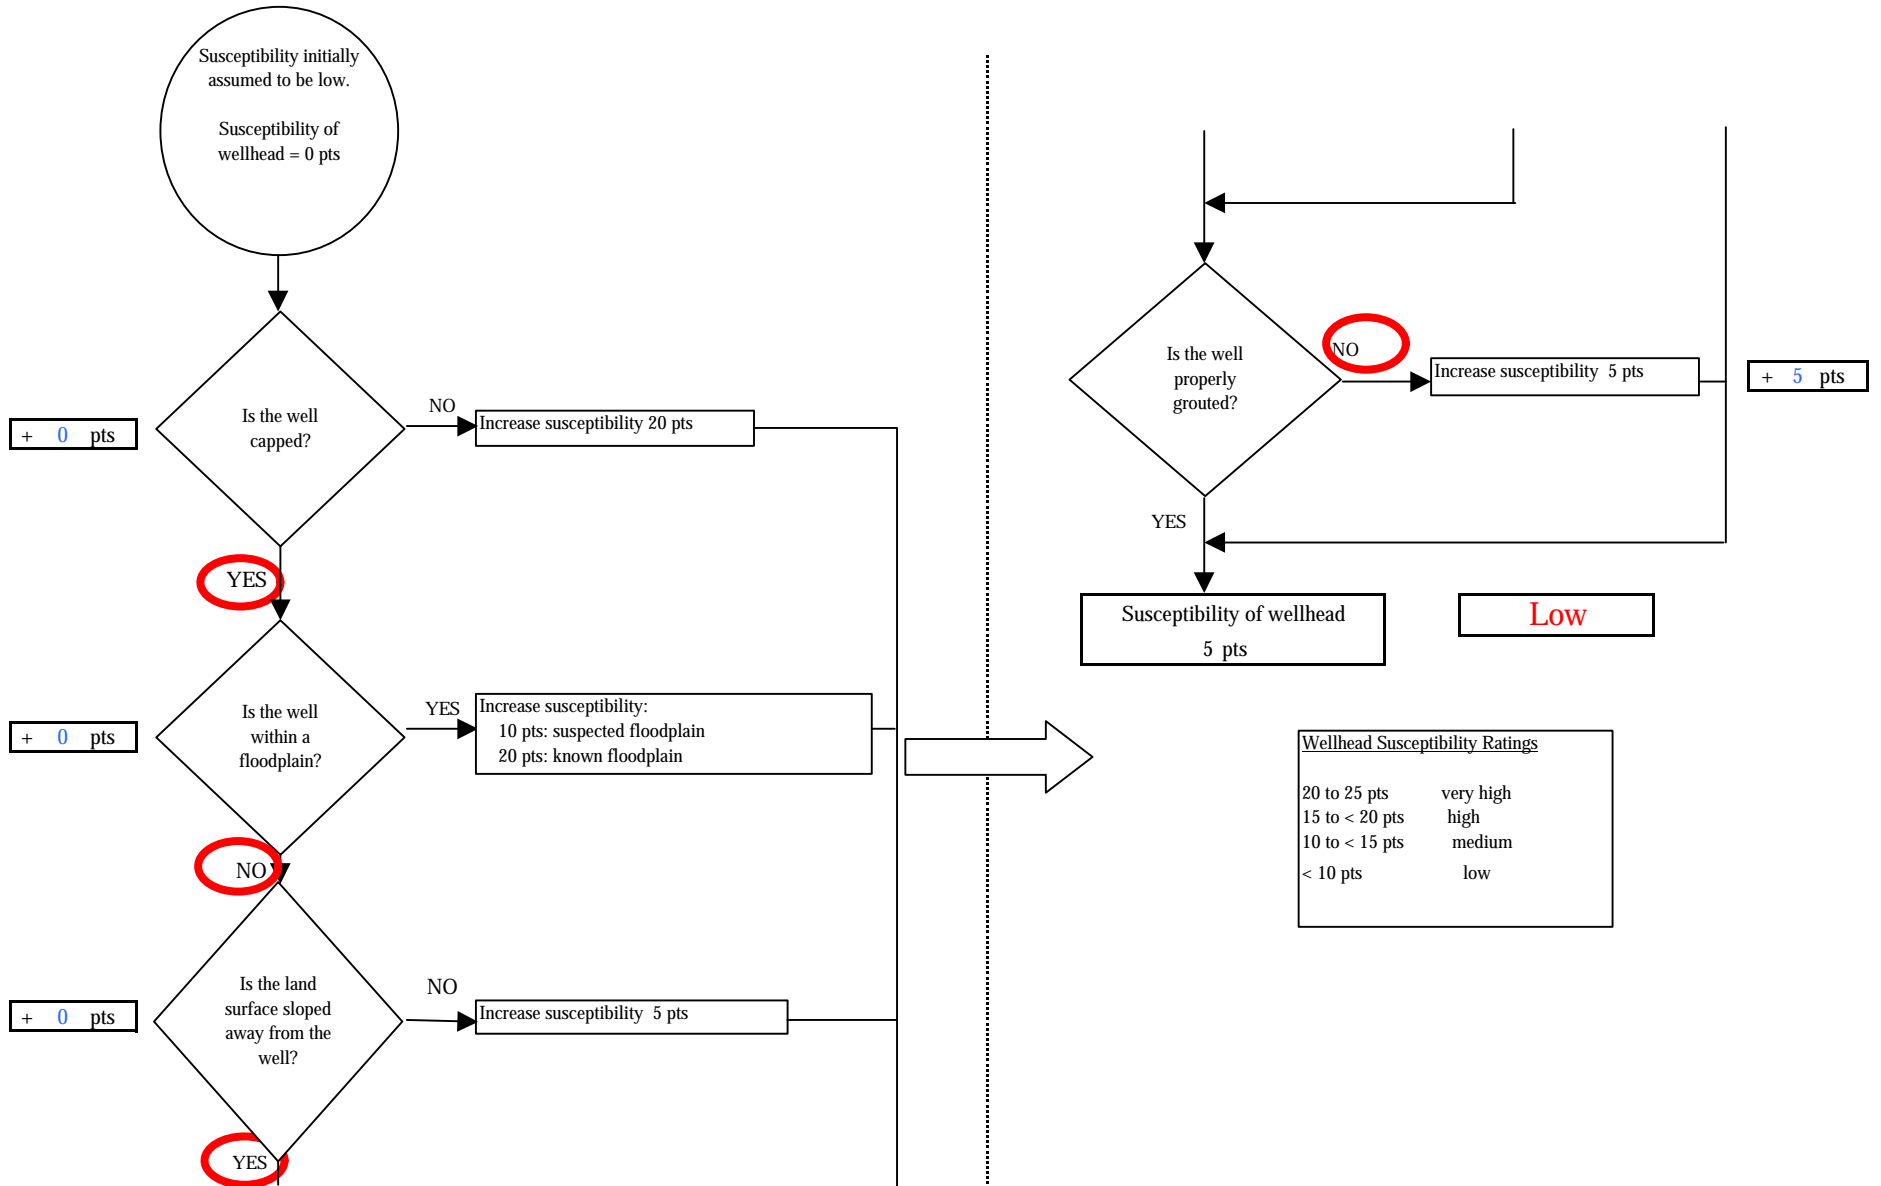


Chart 2. Susceptibility of the aquifer - Sunshine Restaurant




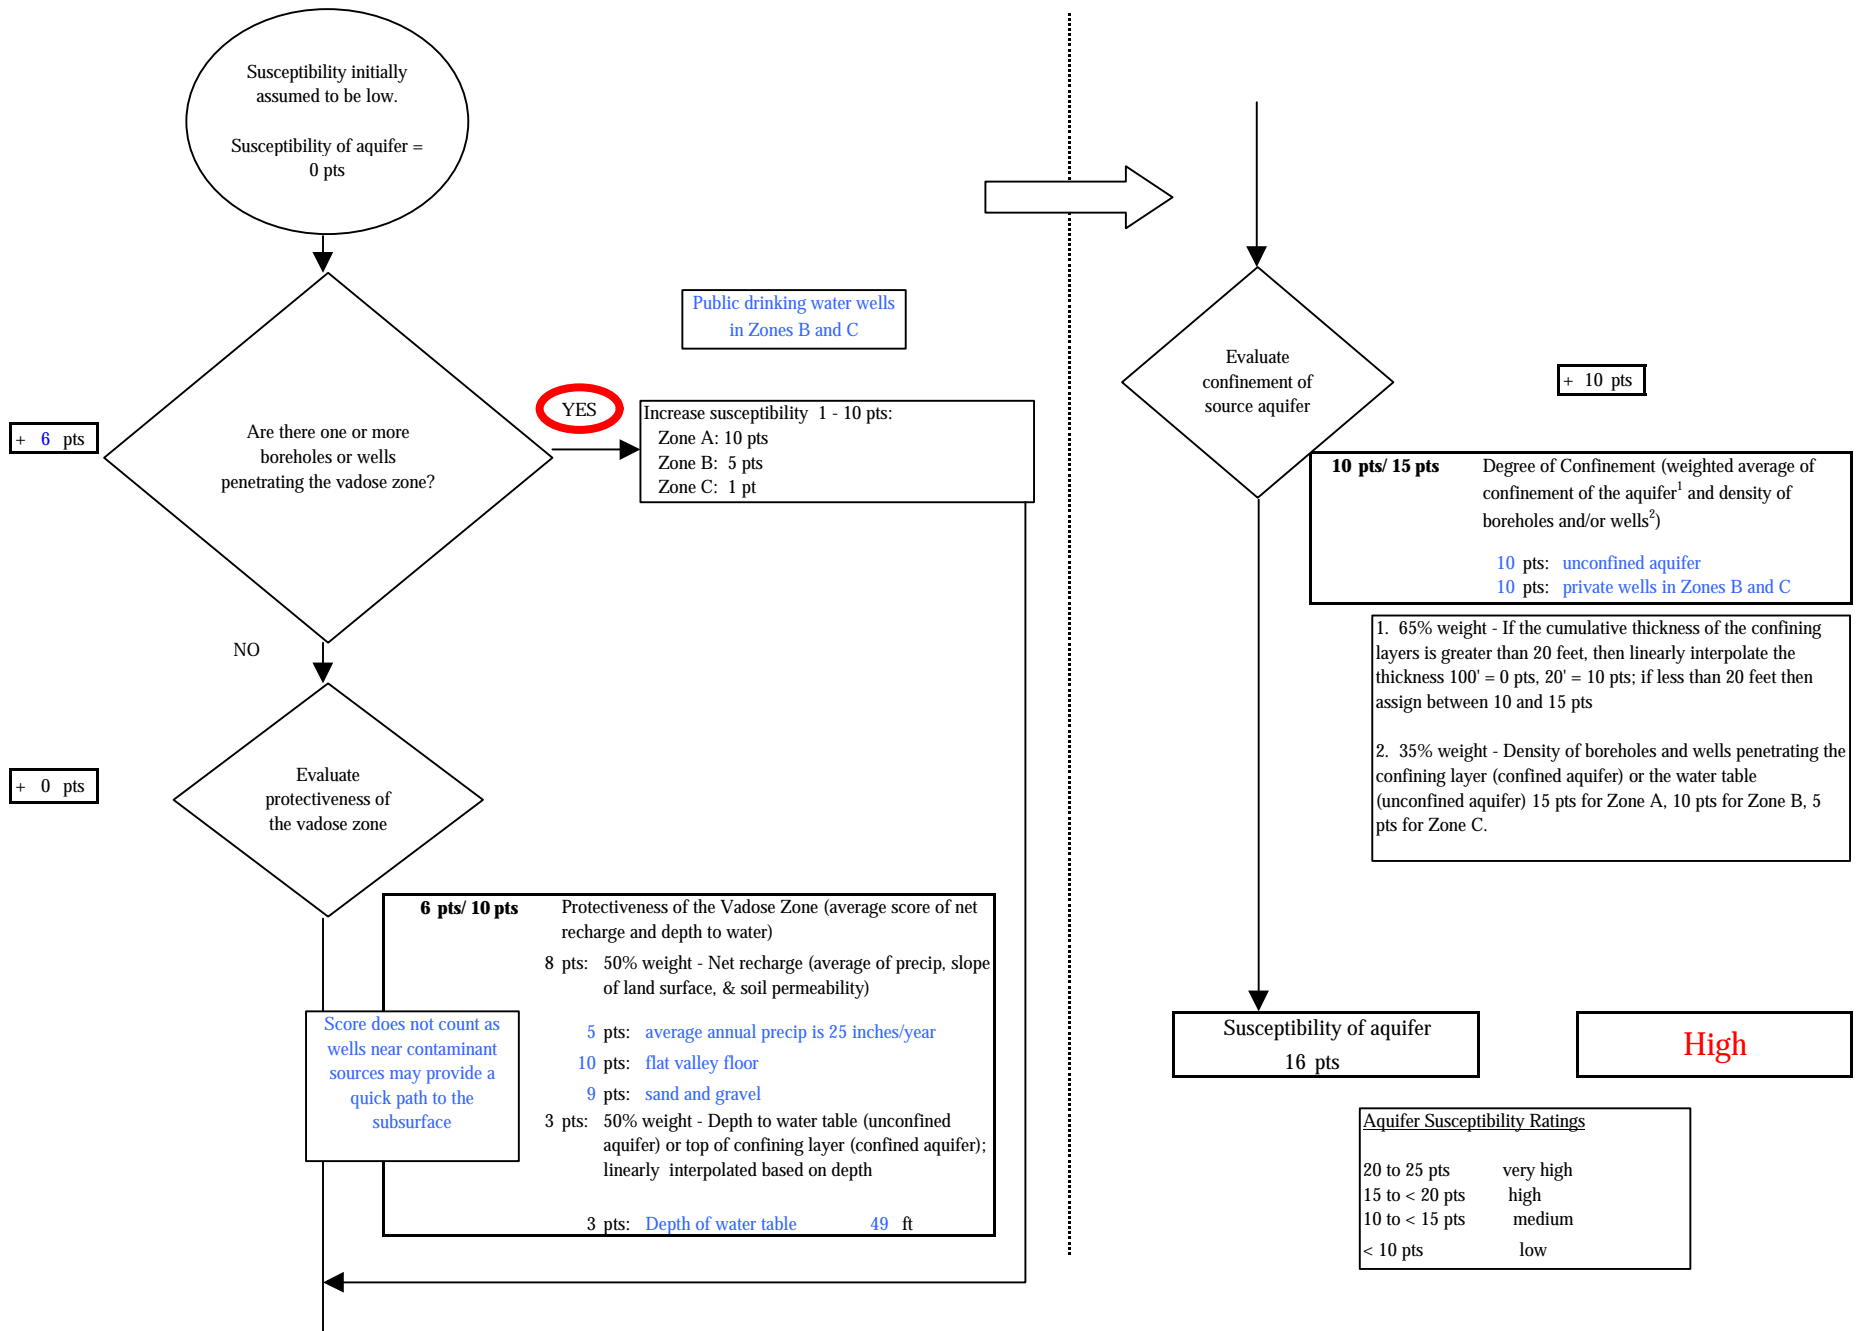


Chart 3. Contaminant risks for Sunshine Restaurant - Bacteria & Viruses

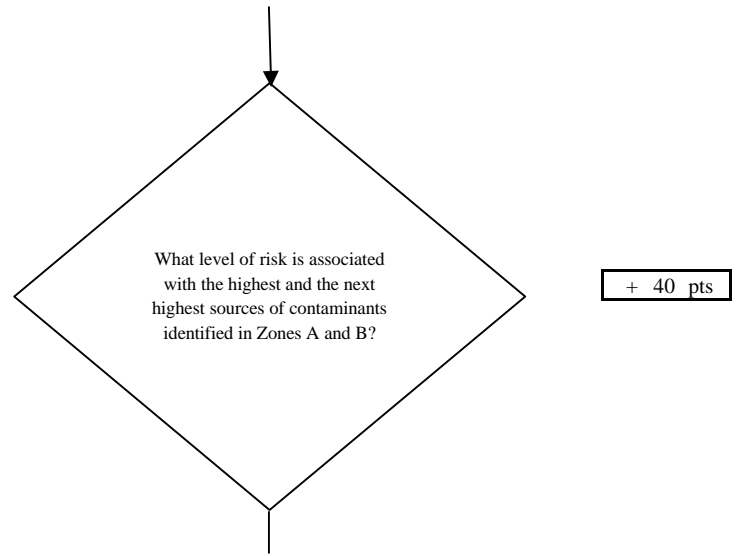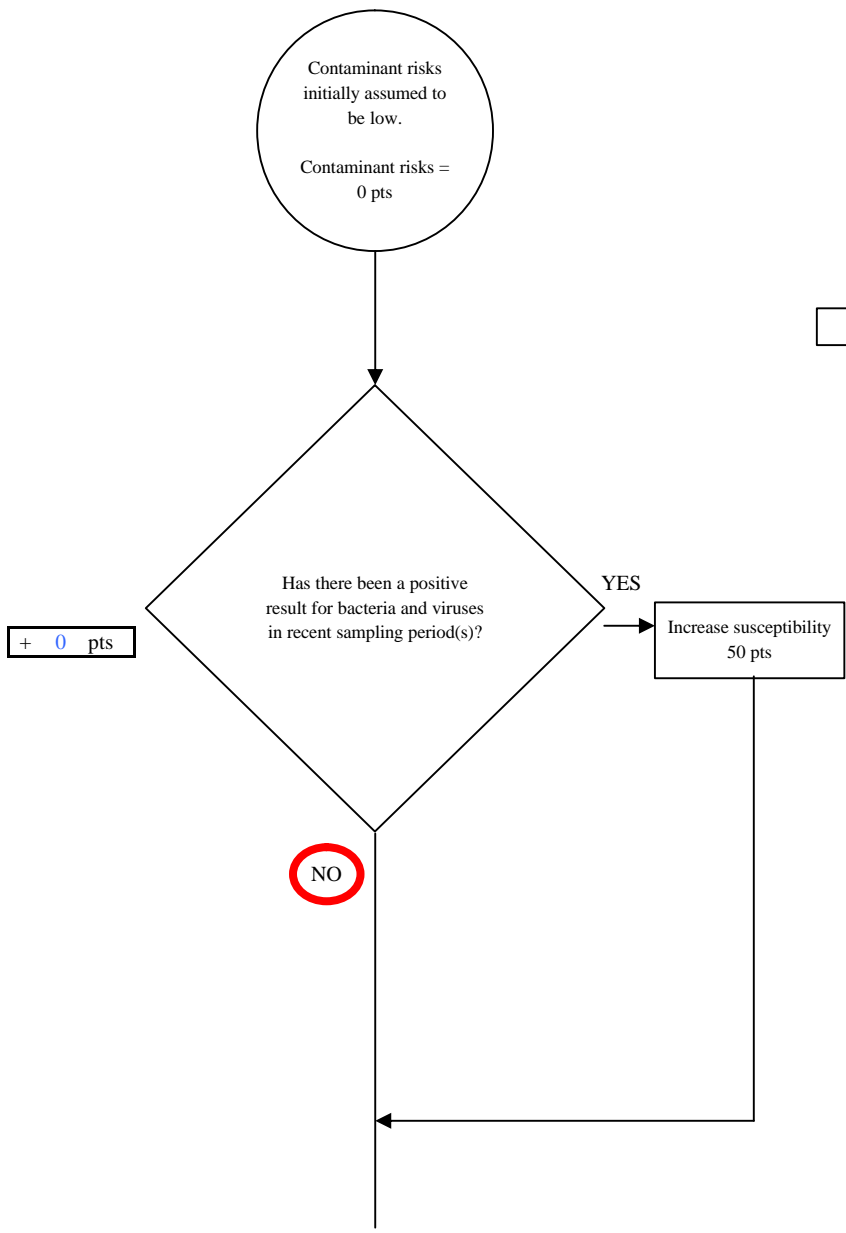

Risk Rankings for Contaminant Sources Identified in Zones A and B



	Zone A	Zone B	Total
Very High(s)	0	0	0
High(s)	1	1	2
Medium(s)	0	0	0
Low(s)	1	3	4

	LOW 10 pts	MEDIUM 20 pts	HIGH 30 pts	VERY HIGH 40 pts
LOW	³ 10 sources + 10 pts	≥ 10 sources + 5 pts	≥ 20 sources + 5 pts	----
MEDIUM	----	≥ 2 sources + 5 pts	≥ 5 sources + 5 pts	≥ 10 sources + 5 pts
HIGH	----	----	≥ 1 source + 10 pts	≥ 2 sources + 10 pts
VERY HIGH	----	----	----	≥ 1 source + 10 pts


Matrix Score 40

Note: Septic systems, sewerlines, and roads are each assigned a risk ranking for each individual contaminant source in the CSI. The VA, however, counts these contaminant sources as a group and assigns a calculated number of either "lows" or "mediums" based on the density.

Chart 3. Contaminant risks for Sunshine Restaurant - Bacteria & Viruses

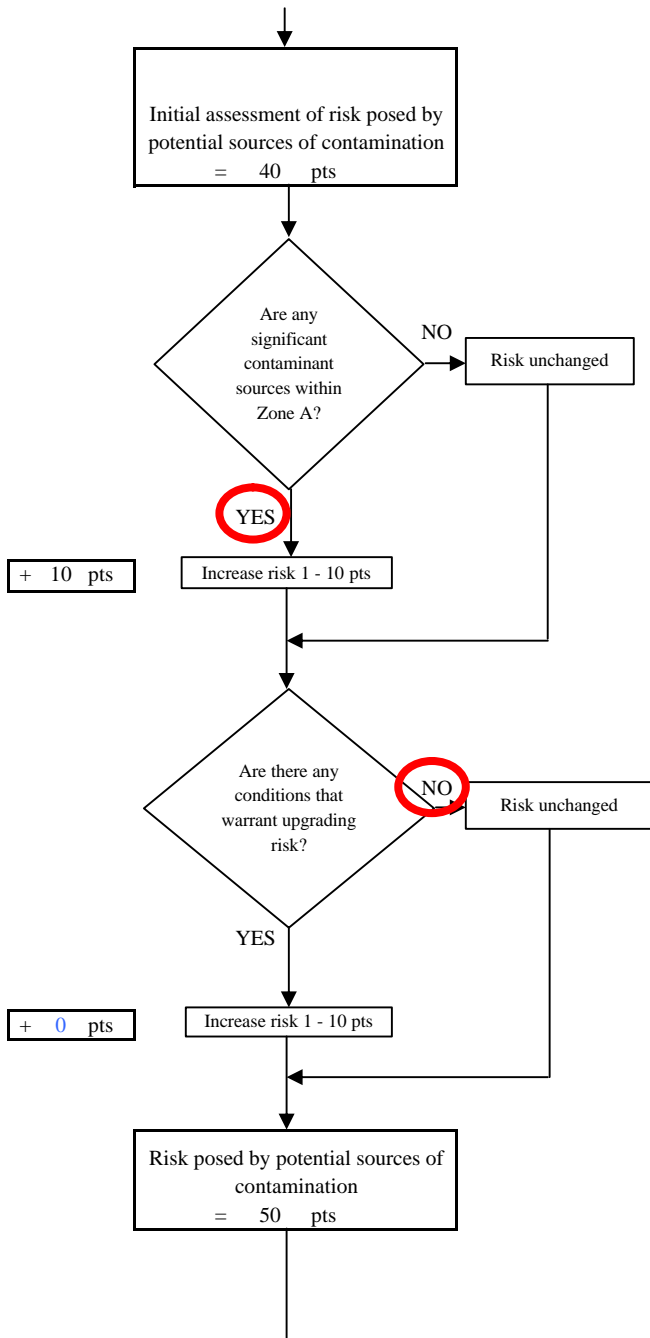

Contaminant Risk Ratings	
40 to 50 pts	very high
30 to < 40 pts	high
20 to < 30 pts	medium
< 20 pts	low

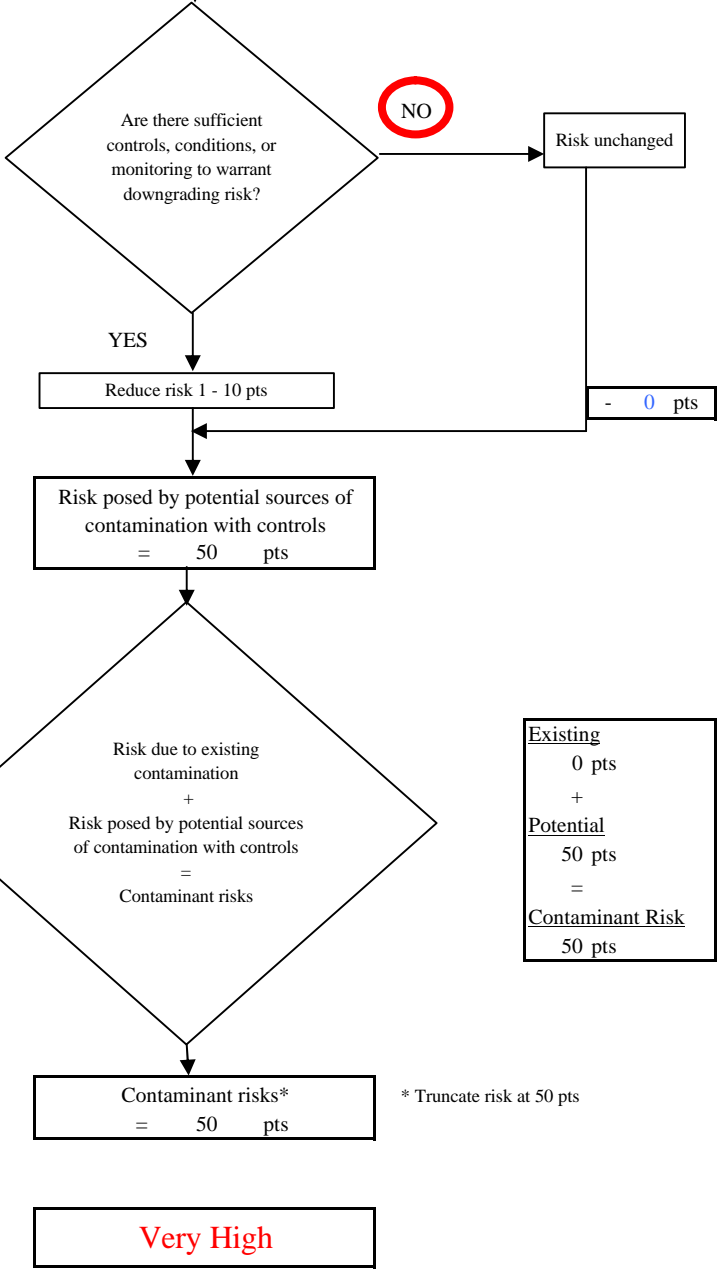

Existing	0 pts
+	
Potential	50 pts
=	
Contaminant Risk	50 pts

* Truncate risk at 50 pts

Chart 4. Vulnerability analysis for Sunshine Restaurant - Bacteria & Viruses

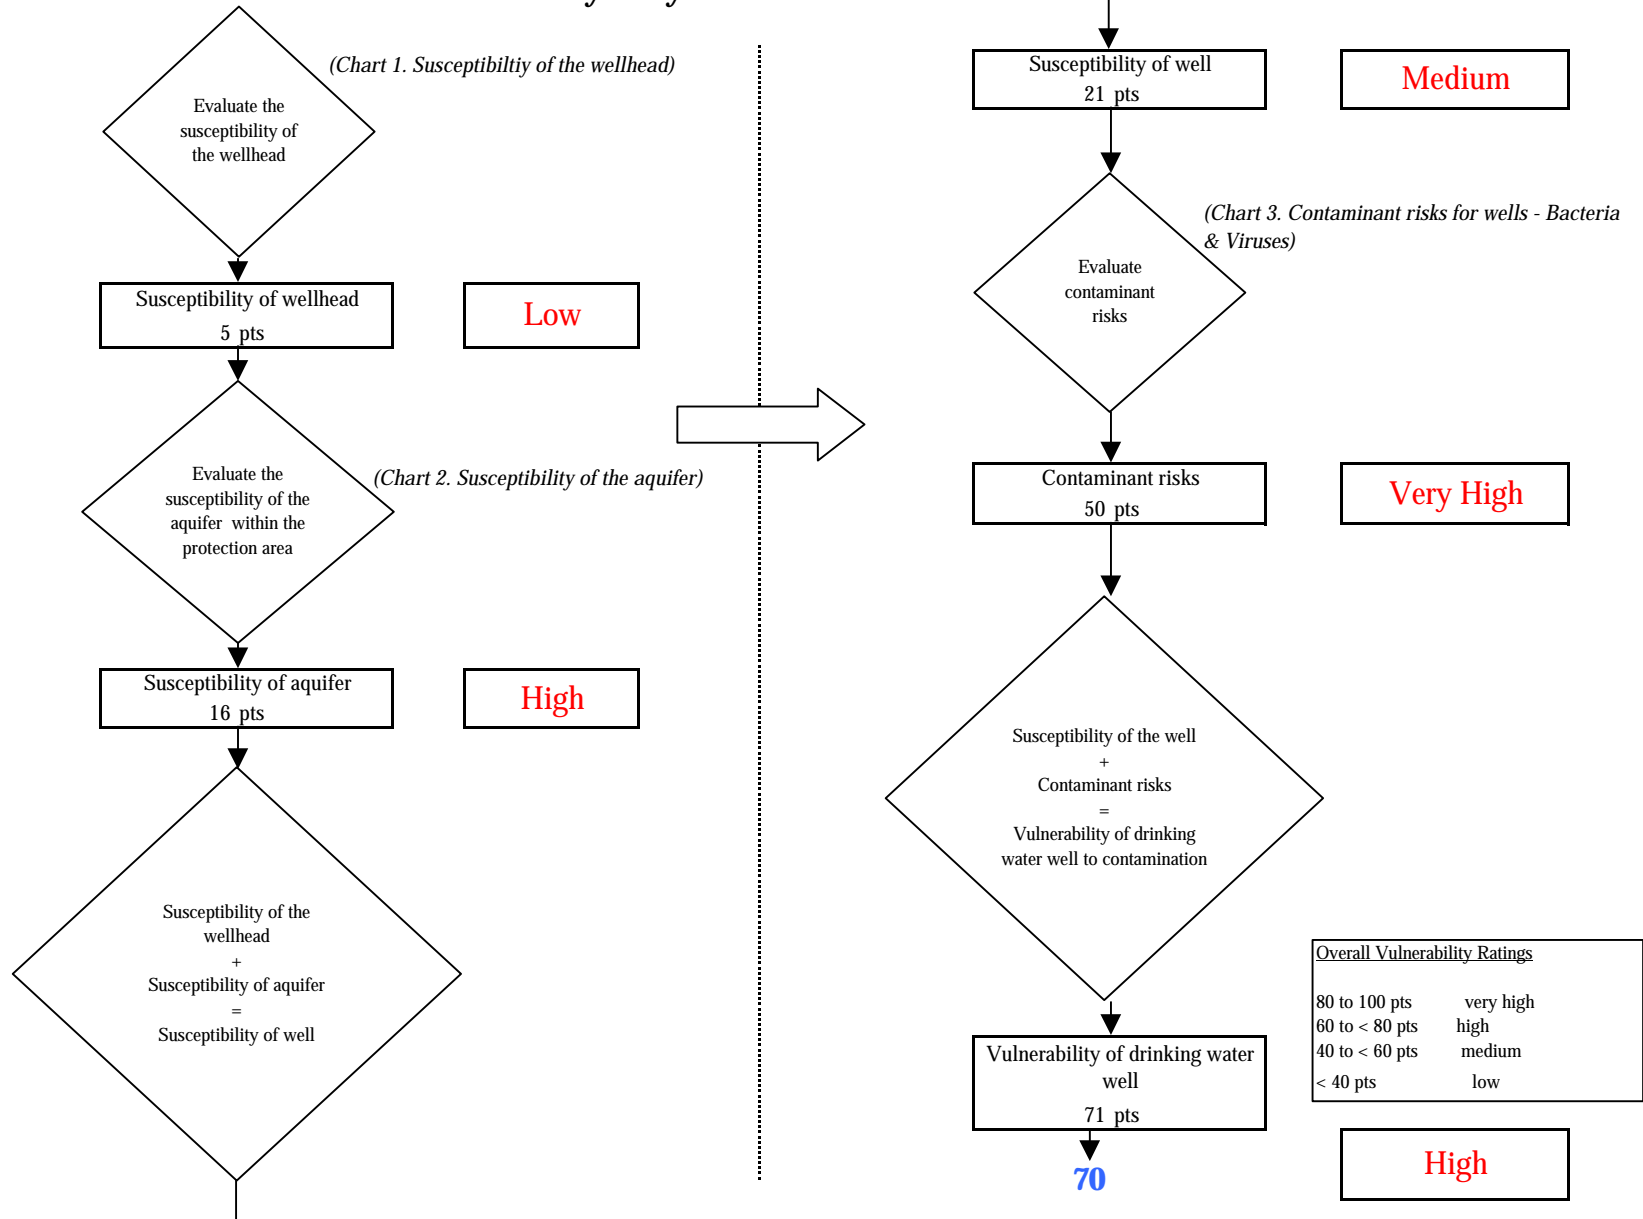


Chart 5. Contaminant risks for Sunshine Restaurant - Nitrates and Nitrites


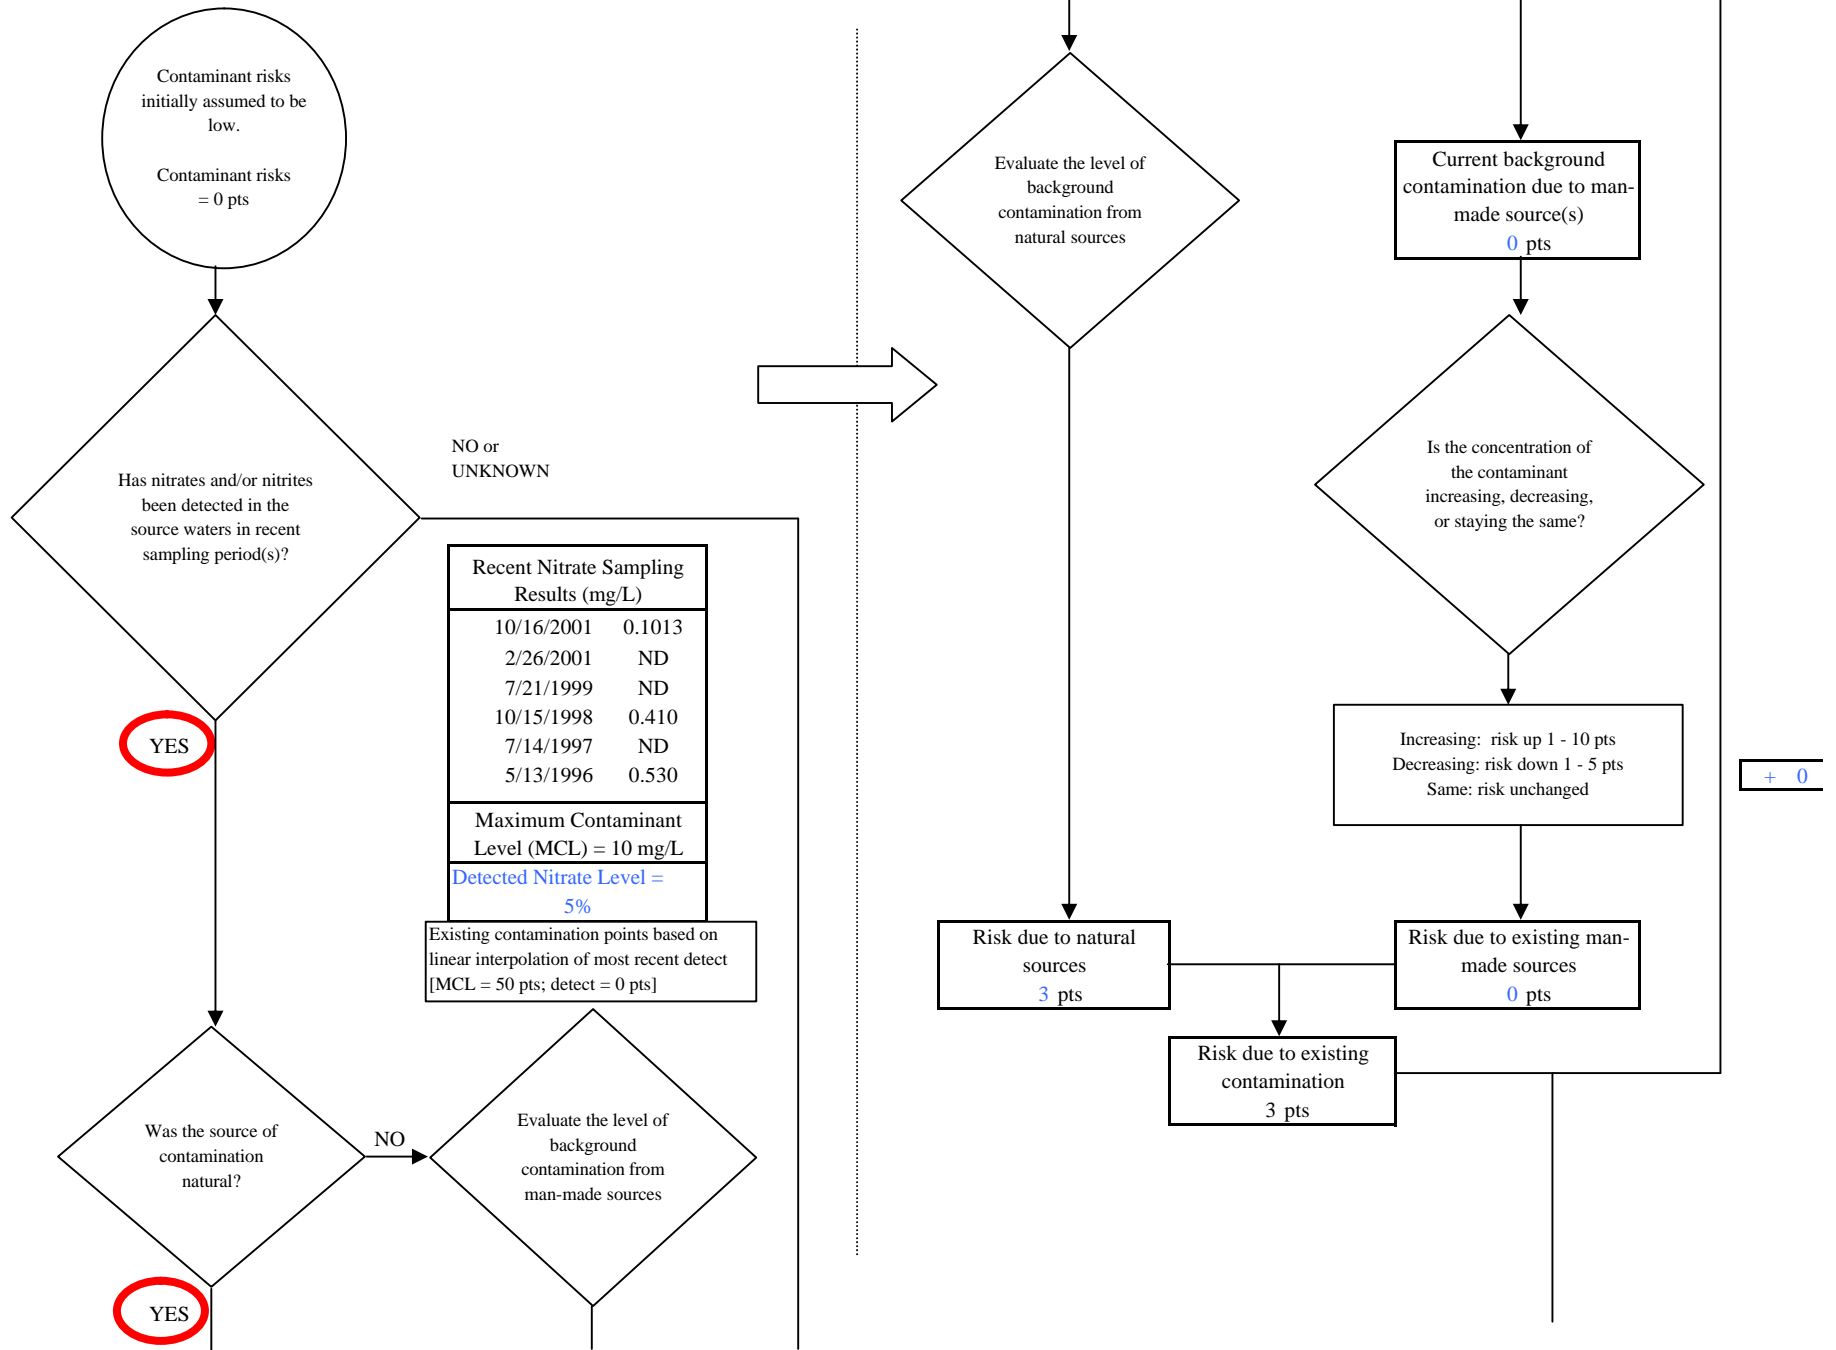


Chart 5. Contaminant risks for Sunshine Restaurant - Nitrates and Nitrites

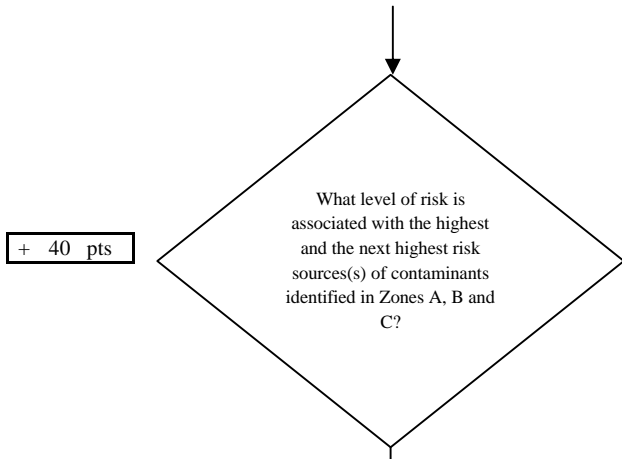

Risk Levels for Contaminant Sources identified in Zones A, B and C			
	Zone A	Zones B&C	Total
Very Highs(s)	0	0	0
High(s)	1	5	6
Medium(s)	0	0	0
Low(s)	0	5	5

High Risk in Zone A, based on High Capacity Septic System

	LOW 10 pts	MEDIUM 20 pts	HIGH 30 pts	VERY HIGH 40 pts
LOW	≥ 10 sources + 10 pts	≥ 10 sources + 5 pts	≥ 20 sources + 5 pts	----
MEDIUM	----	≥ 2 sources + 5 pts	≥ 5 sources + 5 pts	≥ 10 sources + 5 pts
HIGH	----	----	≥ 1 source + 10 pts	≥ 2 sources + 10 pts
VERY HIGH	----	----	----	≥ 1 source + 10 pts

Matrix Score 40

Note: Septic systems, sewerlines, and roads are each assigned a risk ranking for each individual contaminant source in the CSI. The VA, however, counts these contaminant sources as a group and assigns a calculated number of either "lows" or "mediums" based on the density.

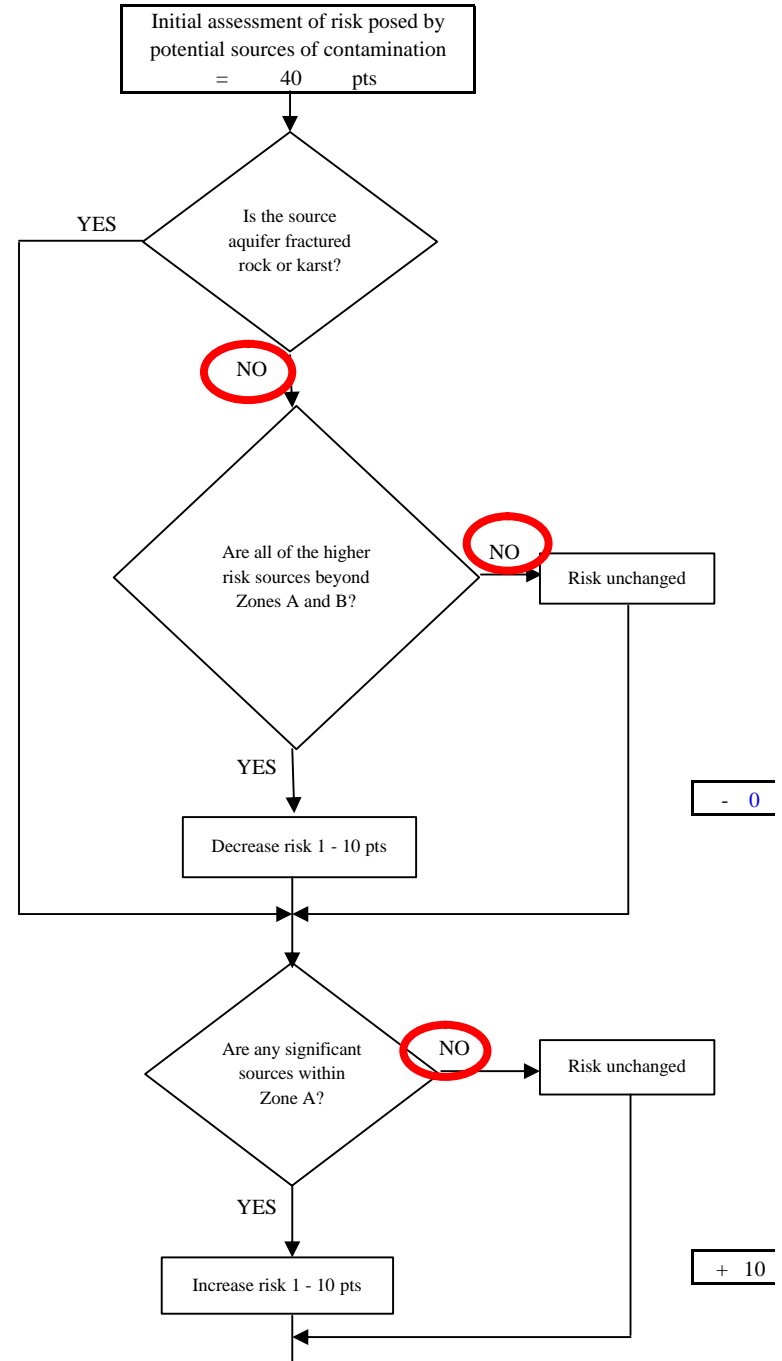



Chart 5. Contaminant risks for Sunshine Restaurant - Nitrates and Nitrites

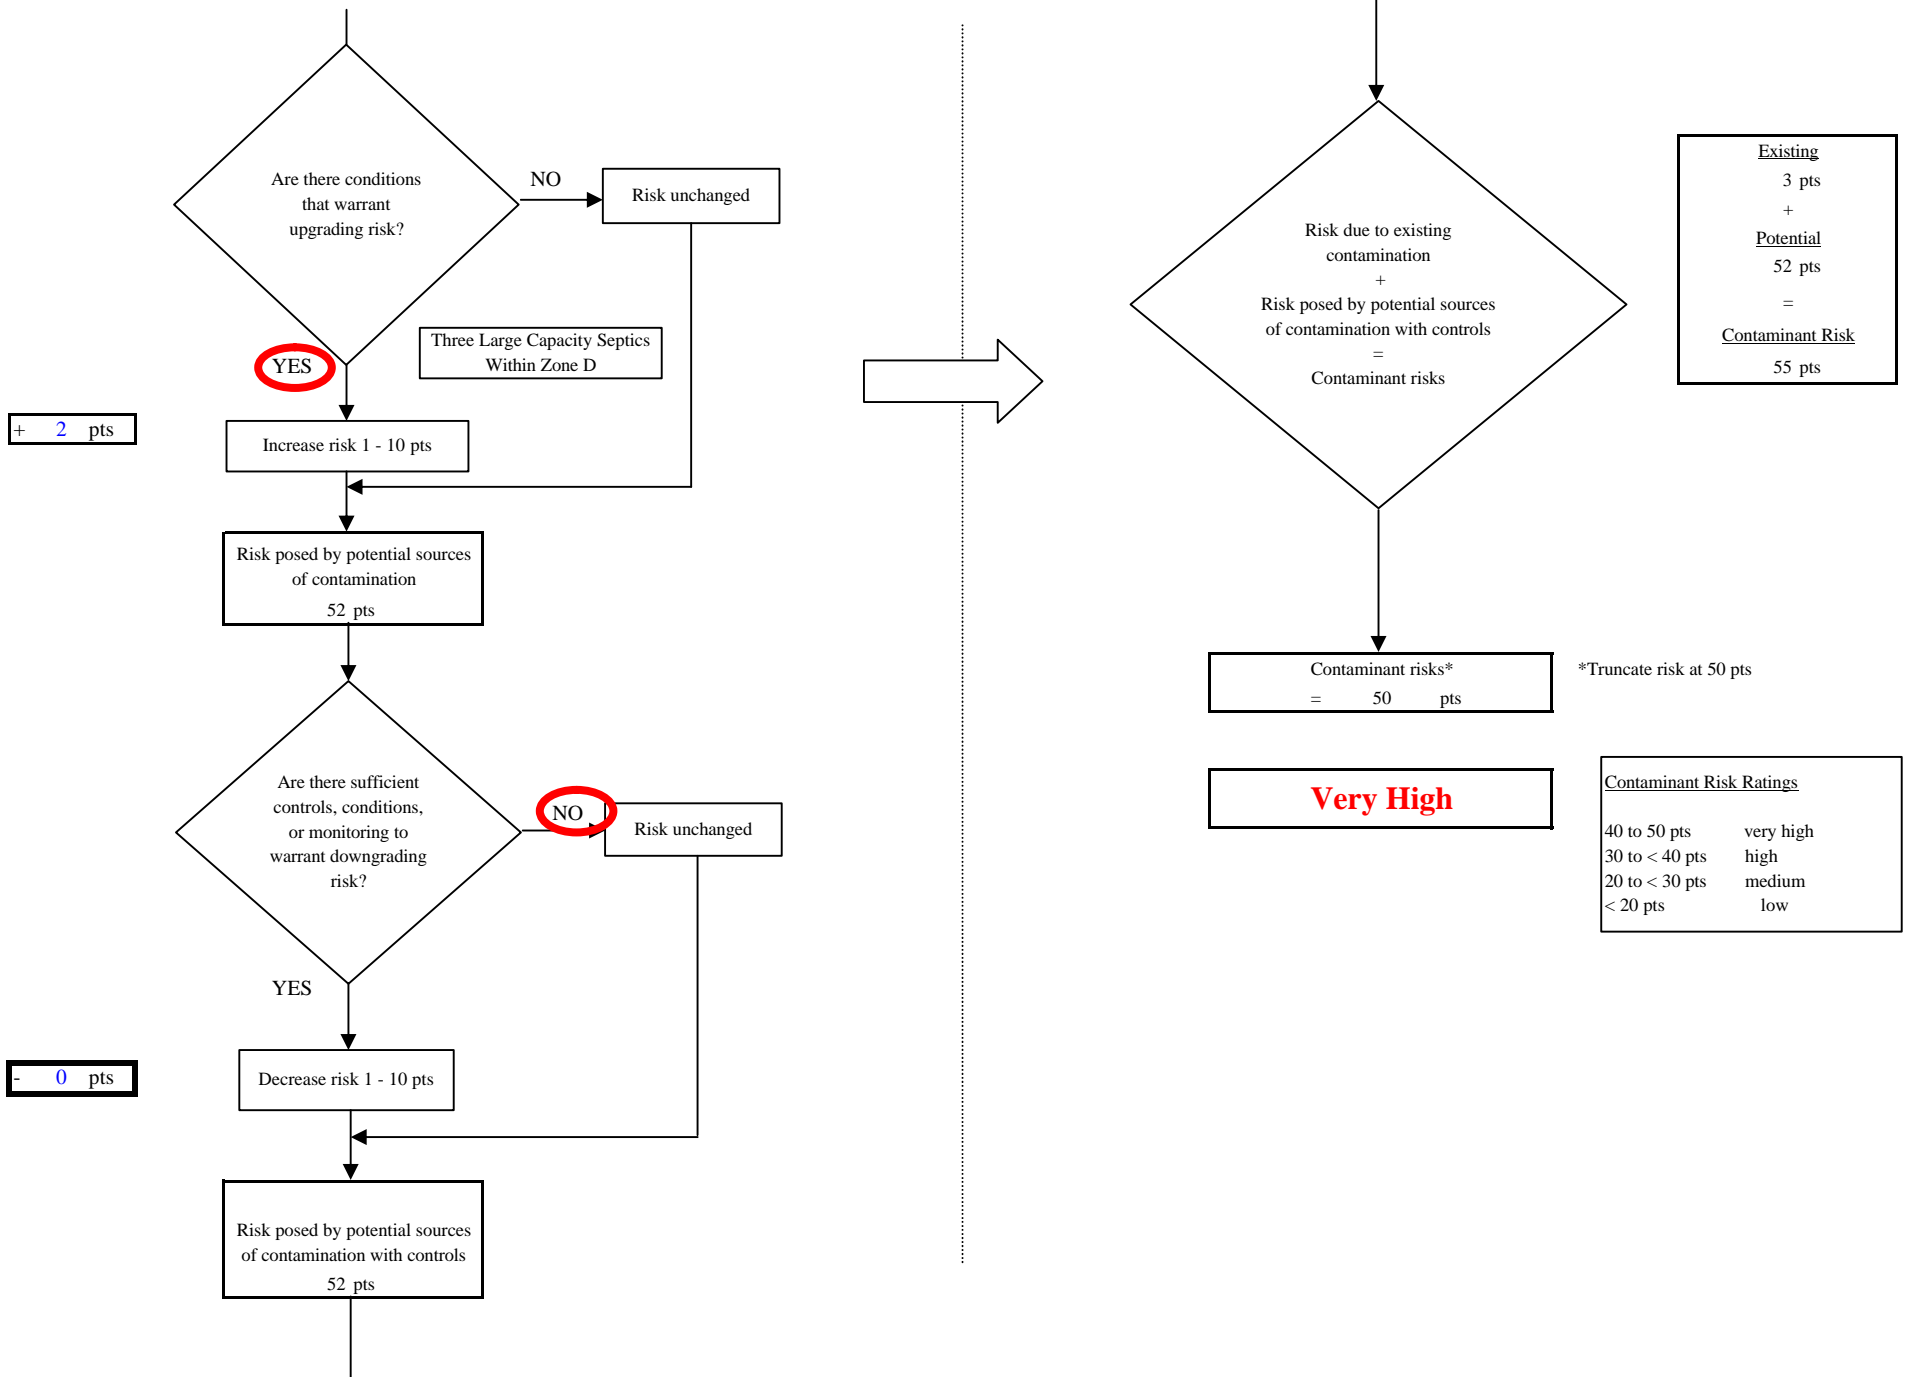


Chart 6. Vulnerability analysis for Sunshine Restaurant - Nitrates and Nitrites

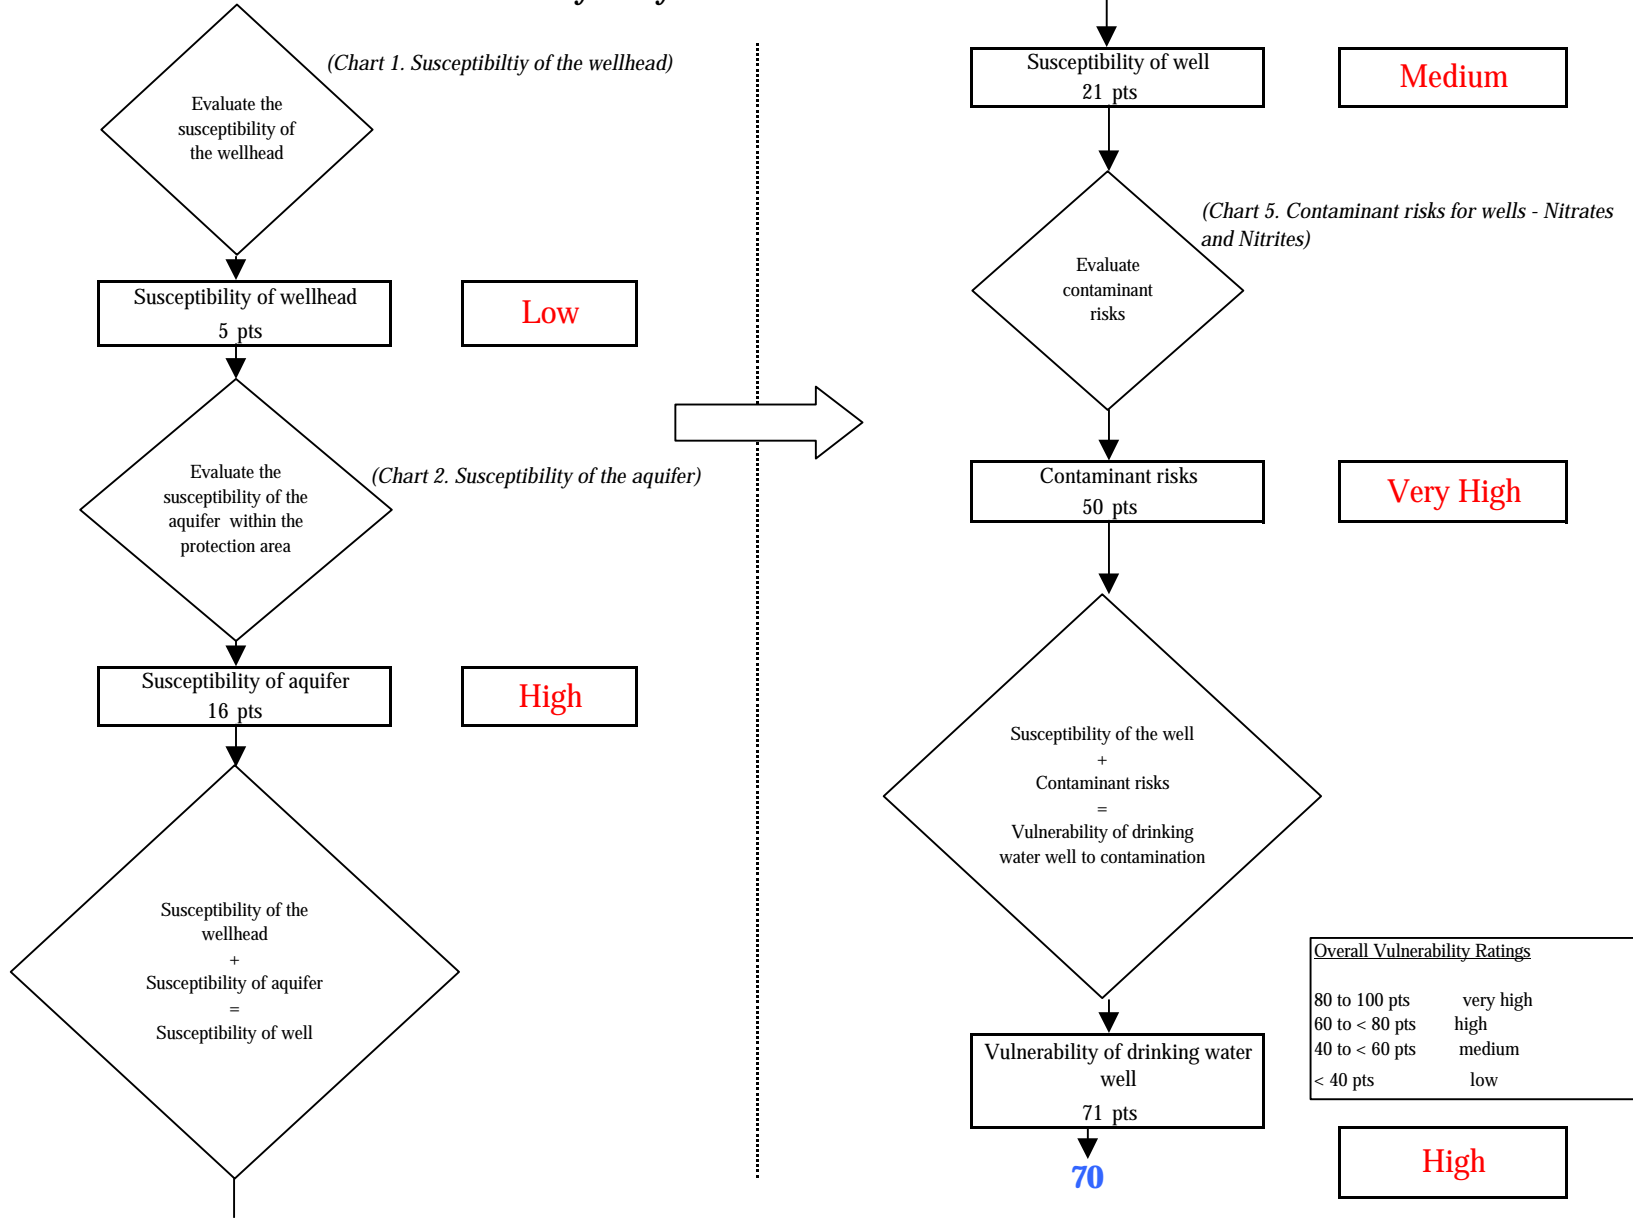


Chart 7. Contaminant risks for Sunshine Restaurant - Volatile Organic Chemicals


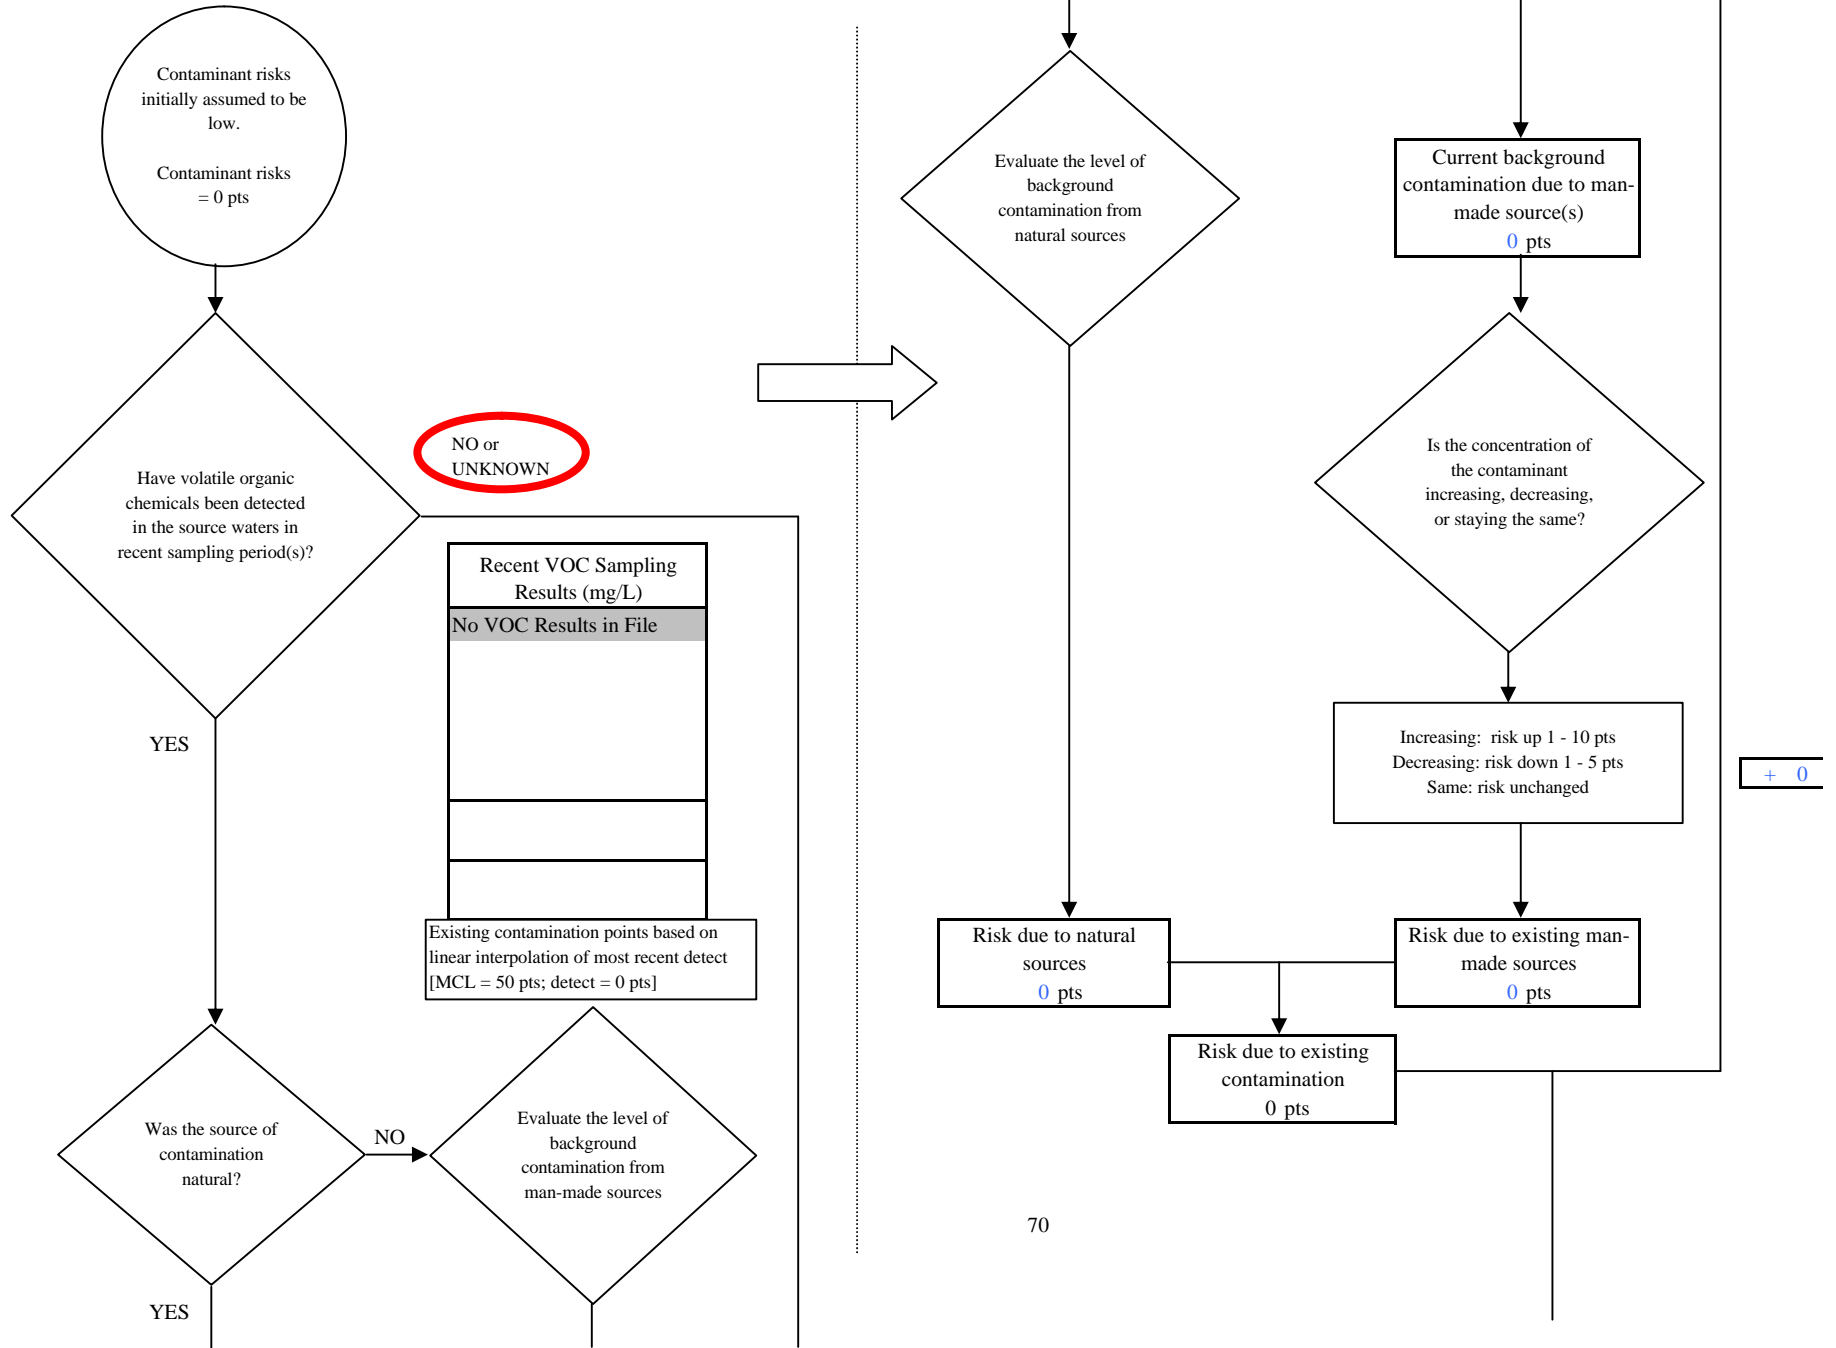


Chart 7. Contaminant risks for Sunshine Restaurant - Volatile Organic Chemicals

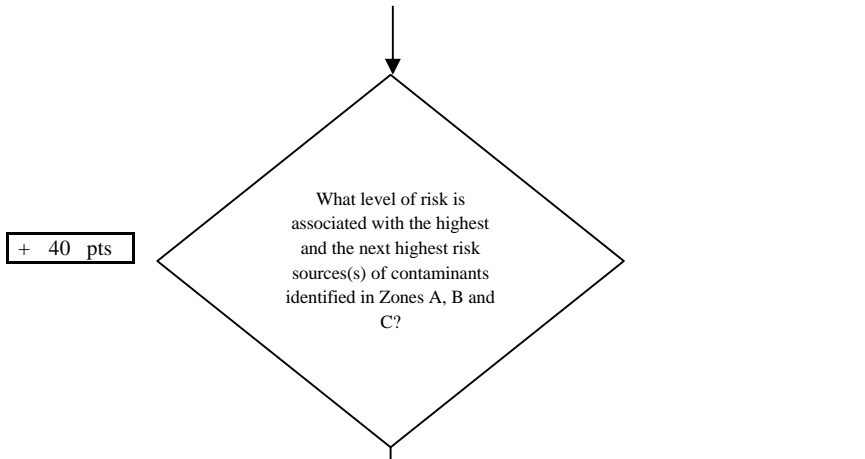

Risk Levels for Contaminant Sources identified in Zones A, B and C			
	Zone A	Zones B&C	Total
Very Highs(s)	0	0	0
High(s)	4	0	4
Medium(s)	3	0	3
Low(s)	2	9	11

	LOW 10 pts	MEDIUM 20 pts	HIGH 30 pts	VERY HIGH 40 pts
LOW	³ 10 sources + 10 pts	≥ 10 sources + 5 pts	≥ 20 sources + 5 pts	----
MEDIUM	----	≥ 2 sources + 5 pts	≥ 5 sources + 5 pts	≥ 10 sources + 5 pts
HIGH	----	----	≥ 1 source + 10 pts	≥ 2 sources + 10 pts
VERY HIGH	----	----	----	≥ 1 source + 10 pts

Matrix Score 40

Note: Septic systems, sewerlines, and roads are each assigned a risk ranking for each individual contaminant source in the CSI. The VA, however, counts these contaminant sources as a group and assigns a calculated number of either "lows" or "mediums" based on the density.

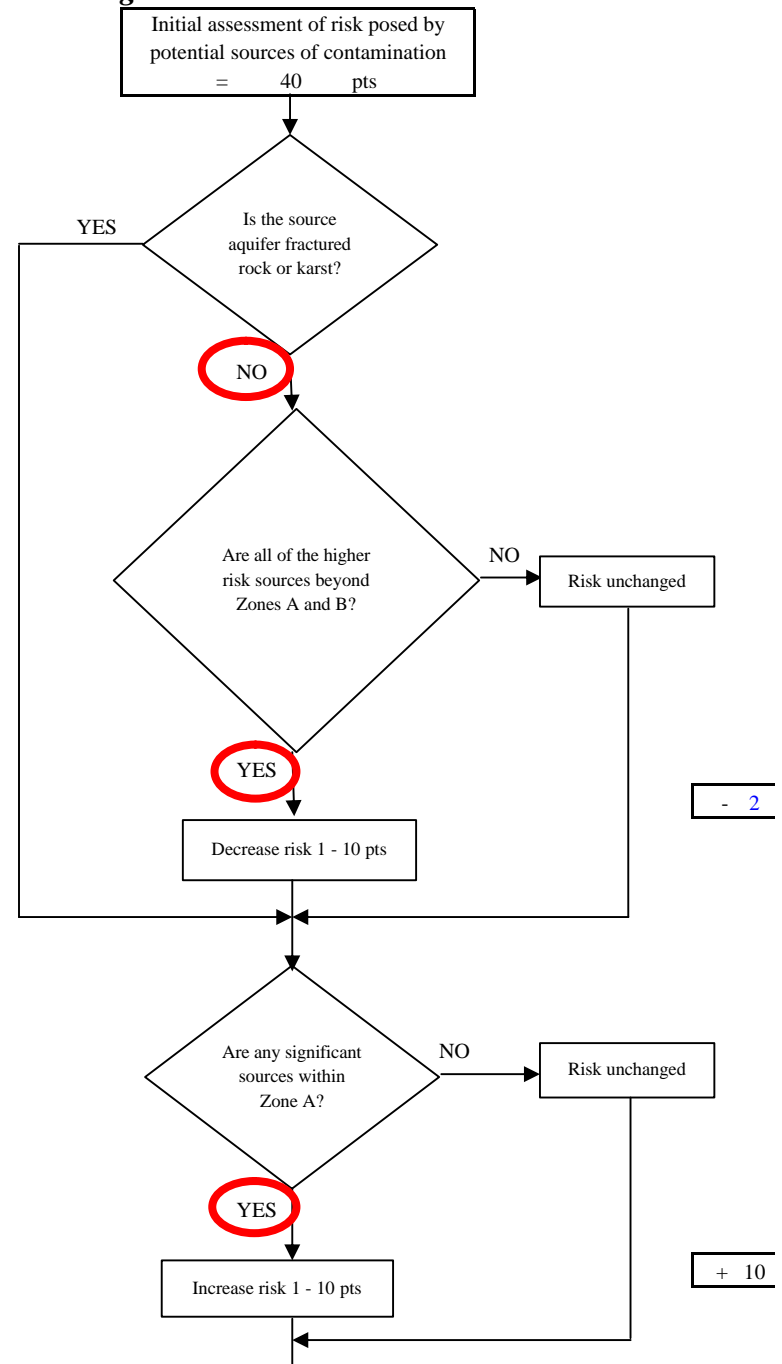



Chart 7. Contaminant risks for Sunshine Restaurant - Volatile Organic Chemicals

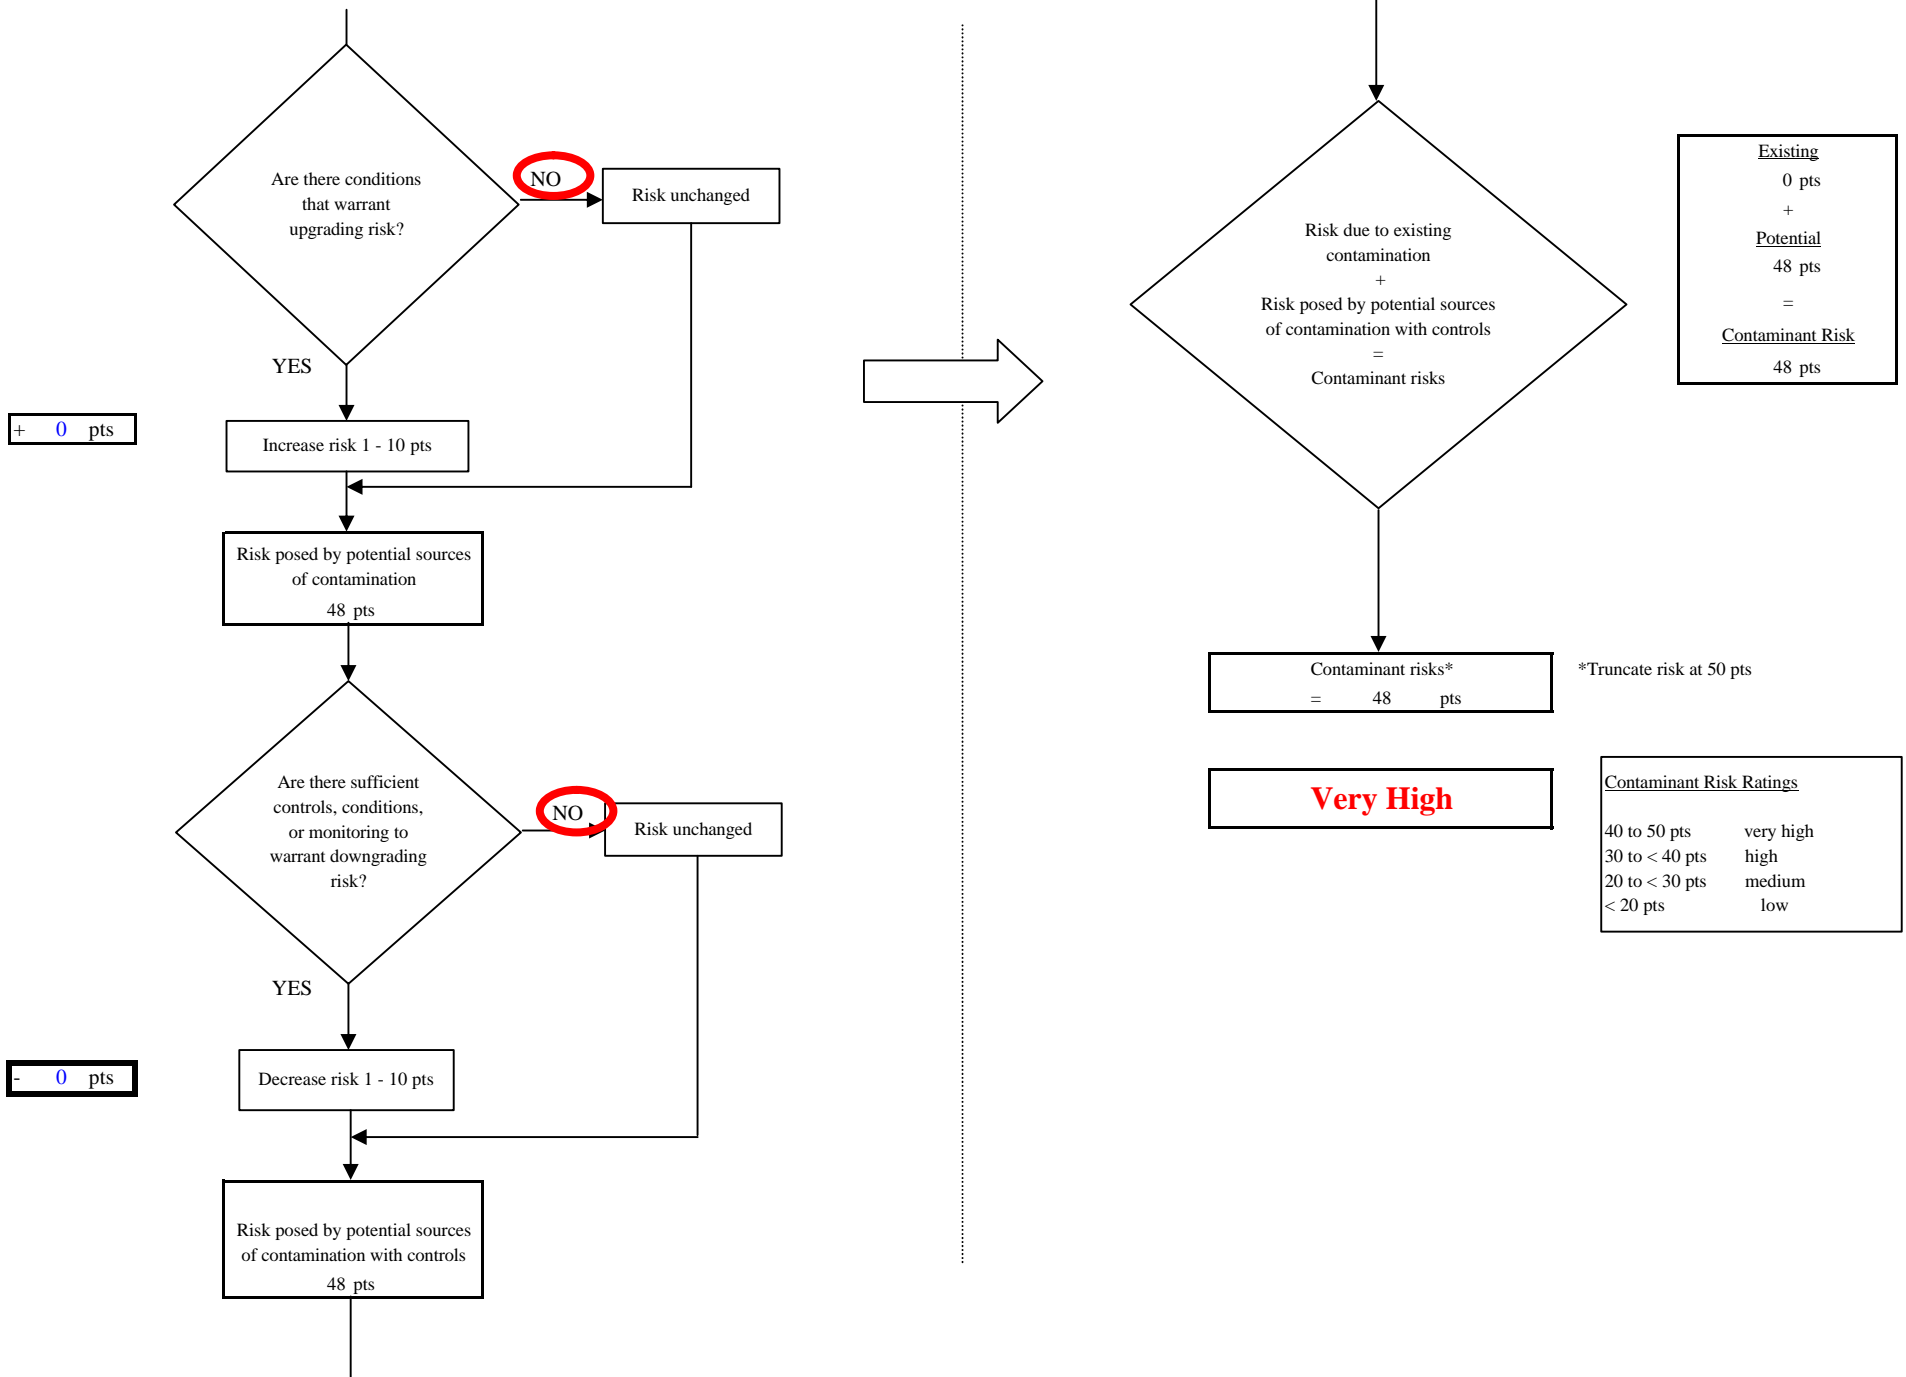


Chart 8. Vulnerability analysis for Sunshine Restaurant - Volatile Organic Chemicals

