



---

# Source Water Assessment

A Hydrogeologic Susceptibility and  
Vulnerability Assessment for  
Mt. McKinley Princess Lodge - Well 2  
Public Drinking Water System,  
Talkeetna Area, Alaska  
PWSID # 225601.002

DRINKING WATER PROTECTION REPORTS 1672

Alaska Department of Environmental Conservation

December, 2008

Source Water Assessment for  
Mt. McKinley Princess Lodge - Well 2  
Public Drinking Water System  
Talkeetna Area, Alaska  
PWSID# 225601.002

DRINKING WATER PROTECTION REPORT 1672

The Drinking Water Protection (DWP) section of the Drinking Water Program is producing Source Water Assessments in compliance with the Safe Drinking Water Act Amendments of 1996. Each assessment includes a delineation of the source water area, an inventory of potential and existing contaminant sources that may impact the water, a risk ranking for each of these contaminants, and an evaluation of the potential vulnerability of these drinking water sources.

These assessments are intended to provide public water systems owners/operators, communities, and local governments with the best available information that may be used to protect the quality of their drinking water. The assessments combine information obtained from various sources, including the U.S. Environmental Protection Agency, Alaska Department of Environmental Conservation (DEC), public water system owners/operators, and other public information sources. The results of this assessment are subject to change if additional data becomes available. It is anticipated this assessment will be updated every five years to reflect any changes in the vulnerability and/or susceptibility of public drinking water source. If you have any additional information that may affect the results of this assessment, please contact the DWP staff at the following number: 1-866-956-7656.

December, 2008

## CONTENTS

	Page		
Executive Summary.....	1	Ranking of Contaminant Risks .....	2
Mt. McKinley Princess Lodge - Well 2 Public Drinking Water System.....	1	Vulnerability of Mt. McKinley Princess Lodge - Well 2 Drinking Water System.....	2
Mt. McKinley Princess Lodge - Well 2 Drinking Water Protection Area.....	1	References .....	5
Inventory of Potential and Existing Contaminant Sources .....	2	Appendix A .....	7
		Appendix B.....	9
		Appendix C.....	11

## TABLES

Table 1. Definition of Zones.....	2
Table 2. Susceptibility .....	3
Table 3. Contaminant Risks.....	3
Table 4. Overall Vulnerability.....	4

## APPENDICES

APPENDIX	A. Mt. McKinley Princess Lodge - Well 2 Drinking Water Protection Area (Map A)
	B. Contaminant Source Inventory for Mt. McKinley Princess Lodge - Well 2 (Table 1) Contaminant Source Inventory and Risk Ranking for Mt. McKinley Princess Lodge - Well 2 – Bacteria and Viruses (Table 2) Contaminant Source Inventory and Risk Ranking for Mt. McKinley Princess Lodge - Well 2 – Nitrates/Nitrites (Table 3) Contaminant Source Inventory and Risk Ranking for Mt. McKinley Princess Lodge - Well 2 – Volatile Organic Chemicals (Table 4)
	C. Mt. McKinley Princess Lodge - Well 2 Drinking Water Protection Area and Potential and Existing Contaminant Sources (Map C)

# Source Water Assessment for Mt. McKinley Princess Lodge - Well 2 Source of Public Drinking Water, Talkeetna Area, Alaska

---

## Drinking Water Protection Alaska Department of Environmental Conservation

### EXECUTIVE SUMMARY

The public water system for Mt. McKinley Princess Lodge is a Class B (transient/non-community) water system consisting of four wells located near the Parks Highway, approximately 50 road miles north of Talkeetna, Alaska. This report applies only to Well 2 (PWSID 225601.002). The wellhead received a susceptibility rating of **Very High** and the aquifer received a susceptibility rating of **Very High**. Combining these two ratings produces a **Very High** rating for the natural susceptibility of the well. Identified potential and current sources of contaminants for Mt. McKinley Princess Lodge - Well 2 public drinking water source include: a large-capacity septic system, residential septic systems, heating oil tanks, and a park. These identified potential and existing sources of contamination are considered as sources of bacteria and viruses, nitrates and/or nitrites, and volatile organic chemicals. Overall, the public water sources for Mt. McKinley Princess Lodge - Well 2 received a vulnerability rating of **Very High** for bacteria and viruses, as well as nitrates and nitrites. The system received a vulnerability rating of **High** for volatile organic chemicals. This assessment of contaminant risks can be used as a foundation for local voluntary protection efforts as well as a basis for the continuous efforts on the part of Mt. McKinley Princess Lodge 2 to protect public health.

### MT. MCKINLEY PRINCESS LODGE - WELL 2 PUBLIC DRINKING WATER SYSTEM

The Mt. McKinley Princess Lodge public water system is a Class B (transient/non-community) water system. The system consists of four wells located near the Parks Highway approximately 103 road miles south of the Denali National Park and Preserve entrance and 50 road miles north of Talkeetna, Alaska (see Map A in Appendix A). This report applies only to Well 2 (PWSID 225601.002).

Talkeetna lies at the confluence of the Talkeetna and Susitna Rivers, about 115 miles north of Anchorage. Temperatures in the area range from -33 to 33 in January and from 42 to 83 in July. The area also receives 28 inches of precipitation and 70 inches of snowfall annually. Talkeetna has a population of 848

and is within the Matanuska-Susitna Borough. The Borough has an overall population of 80,088 (ADCCED, 2008).

Most residents in the area use individual water wells and septic systems, but the Borough does maintain a piped water and sewer system. Electricity is provided to the community by Matanuska Electric Association and refuse is transported to a transfer station at Mile 11.5 of the Talkeetna Spur Road (ADCCED, 2008).

According to the well log, Well 2 at Mt. McKinley Princess Lodge extends approximately 343 feet below the ground surface and is completed in an unconfined aquifer. This system operates from May to September and serves 178 residents and 152 non-residents through 24 service connections.

### MT. MCKINLEY PRINCESS LODGE - WELL 2 DRINKING WATER PROTECTION AREA

In order to evaluate whether a drinking water source is at risk, we must first evaluate what are the most likely pathways for surface contamination to reach the groundwater. These areas are determined by looking at the characteristics of the soil, groundwater, aquifer, and well.

The most probable area for contamination to reach the drinking water well is the drinking water protection area. The drinking water protection area is the area circling the well (the area influenced by pumping) and also the area upgradient of the well, usually forming a parabola shape. Because releases of contaminants within the protection area are most likely to impact the well, this area will serve as the focus for voluntary protection efforts.

There are many different methods for calculating the size of protection areas. Drinking Water Protection (DWP) uses a combination of two simple groundwater flow equations, the Thiem and uniform flow equations for all groundwater wells screened in unconsolidated material. The orientation of the protection zone is then drawn using a water table elevation map (if available) or a land surface elevation map of the area. The protection zone calculated by DWP is an estimate using the available information and resources, and may differ slightly from the actual capture zone. Because of uncertainties and changing site conditions, a factor of

safety is added to the protection zone to form the drinking water protection area for the well.

The parameters used to calculate the shape of this protection zone are general for the whole alluvial plain and were obtained from various United States Geological Survey (USGS) reports, area well logs, and the Groundwater textbook by Freeze and Cherry (Freeze and Cherry, 1979).

The protection areas established for wells by the DEC are usually separated into two zones, limited by the watershed. These zones correspond to differences in the time-of-travel (TOT) of the water moving through the aquifer to the well. An analytical calculation was used to determine the size and shape of the protection area.

The time-of-travel for contaminants within the water varies and is dependent on the physical and chemical characteristics of each contaminant. The following is a summary of the two protection area zones for wells and the calculated time-of-travel for each:

**Table 1. Definition of Zones**

<b>Zone</b>	<b>Definition</b>
A	Several months time-of-travel
B	Less than the 2 year time-of-travel

The drinking water protection area for Mt. McKinley Princess Lodge - Well 2 was determined using an analytical calculation and includes Zones A and B (see Map A of Appendix A).

**INVENTORY OF POTENTIAL AND EXISTING CONTAMINANT SOURCES**

DWP has completed an inventory of potential and existing sources of contamination within the Mt. McKinley Princess Lodge - Well 2 drinking water protection area. This inventory was completed through a search of agency records and other publicly available information. Potential sources of contamination to the drinking water aquifer include a wide range of categories and types. Potential drinking water contaminants are found within agricultural, residential, commercial, and industrial areas, but can also occur within areas that have little or no development.

For the basis of all Class B public water system assessments, the following three categories of drinking water contaminants were inventoried:

- Bacteria and viruses;
- Nitrates and/or nitrites;
- Volatile organic chemicals

The sources are displayed on Map C of Appendix C and summarized in Table 1 of Appendix B.

**RANKING OF CONTAMINANT RISKS**

Once the potential and existing sources of contamination have been identified, they are assigned a ranking according to what type and level of risk they represent. Ranking of contaminant risks for a “potential” or “existing” source of contamination is a function of toxicity and volumes of specific contaminants associated with that source. Rankings include:

- Low;
- Medium;
- High; and
- Very High.

Tables 2 through 4 in Appendix B contain the ranking of potential and existing sources of contamination with respect to bacteria and viruses, nitrates and/or nitrites, and volatile organic chemicals.

**VULNERABILITY OF MT. MCKINLEY PRINCESS LODGE - WELL 2 DRINKING WATER SYSTEM**

Vulnerability of a drinking water source to contamination is a combination of two factors:

- Natural Susceptibility; and
- Contaminant Risks.

A score for the Natural Susceptibility of the well is reached by considering the properties of the well and the aquifer.

$$\begin{aligned}
 &\text{Susceptibility of the Wellhead (0-25 Points)} \\
 &\quad + \\
 &\quad \text{Susceptibility of the Aquifer (0-25 Points)} \\
 &\quad = \\
 &\text{Natural Susceptibility of the Well (0-50 Points)}
 \end{aligned}$$

A ranking is assigned for the Natural Susceptibility according to the point score:

<b>Natural Susceptibility Ratings</b>	
40-50 pts	Very High
30 to < 40 pts	High
20 to < 30 pts	Medium
< 20 pts	Low

Factors contributing to the susceptibility of the wellhead are: whether the sanitary seal is in place, protection from flooding, and if the well casing is properly grouted.

The wellhead for Mt. McKinley Princess Lodge - Well 2 received a **Very High** susceptibility rating. No sanitary survey is available for this system, therefore it is assumed that there is no sanitary seal installed, the land surface is not appropriately sloped away from the well, and the well is not grouted according to DEC regulations. Sanitary seals prevent potential contaminants from entering the well, while sloping of the land surface away from the wellhead provides adequate surface water drainage, and concrete or grouting around the wellhead helps to prevent potential contaminants from traveling down the outside of the well casing.

Factors contributing to the susceptibility of the aquifer are: whether the aquifer is confined or unconfined, whether the well is completed in unconsolidated or fractured bedrock, whether wells and bore holes are penetrating the aquifer and, if applicable, the confining layer.

According to the well log, Well 2 at Mt. McKinley Princess Lodge draws water from an unconfined aquifer consisting of sand and gravel. It received a **Very High** susceptibility rating because of its unconfined nature and the presence of other wells penetrating the vadose zone of the protection area. Because an unconfined aquifer is recharged by surface water and precipitation that migrates downward from the surface, it is susceptible to contamination from outside sources. The presence of other wells penetrating the vadose zone can allow contaminants to travel down to the shared aquifer with precipitation and runoff.

Table 2 summarizes the Susceptibility scores and ratings for the Mt. McKinley Princess Lodge - Well 2 system.

**Table 2. Susceptibility**

	<b>Score</b>	<b>Rating</b>
Susceptibility of the Wellhead	25	Very High
Susceptibility of the Aquifer	25	Very High
Natural Susceptibility	50	Very High

Contaminant risks are derived from an evaluation of the routine sampling results of the water system and the presence of potential sources of contamination. Contaminant risks to a drinking water source depend on the type and distribution of contaminant sources. Flow charts are used to assign a point score, and ratings are assigned in the same way as for the natural susceptibility:

<b>Contaminant Risk Ratings</b>	
40-50 pts	Very High
30 to < 40 pts	High
20 to < 30 pts	Medium
< 20 pts	Low

Table 3 summarizes the Contaminant Risks for each category of drinking water contaminants for the Mt. McKinley Princess Lodge - Well 2 system.

**Table 3. Contaminant Risks**

<b>Category</b>	<b>Score</b>	<b>Rating</b>
Bacteria and Viruses	40	Very High
Nitrates and/or Nitrites	44	Very High
Volatile Organic Chemicals	12	Low

Finally, an overall vulnerability score is assigned for each water system by combining each of the contaminant risk scores with the natural susceptibility score:

$$\begin{aligned}
 &\text{Natural Susceptibility (0-50 Points)} \\
 &\quad + \\
 &\quad \text{Contaminant Risks (0-50 Points)} \\
 &\quad = \\
 &\text{Vulnerability of the Drinking Water Source to} \\
 &\quad \text{Contamination (0-100 Points)}
 \end{aligned}$$

Again, rankings are assigned according to a point score:

<b>Overall Vulnerability Ratings</b>	
80-100 pts	Very High
60 to < 80 pts	High
40 to < 60 pts	Medium
< 40 pts	Low

Table 4 contains the overall vulnerability scores (0-100) and ratings for each of the three categories of drinking water contaminants for the Mt. McKinley Princess Lodge - Well 2 system. Note: scores are rounded off to the nearest five.

**Table 4. Overall Vulnerability**

Category	Score	Rating
Bacteria and Viruses	90	Very High
Nitrates and/or Nitrites	95	Very High
Volatile Organic Chemicals	60	High

#### **Bacteria and Viruses**

The contaminant risk for bacteria and viruses is **Very High**, with a large-capacity septic system, residential septic systems, and a park contributing to the risk to the drinking water well.

Coliforms (a bacteria) are found naturally in the environment and although they aren't necessarily a health threat, they are an indicator of other potentially harmful bacteria in the water, more specifically, fecal coliforms and E. coli, which only come from human and animal fecal waste. Harmful bacteria can cause diarrhea, cramps, nausea, headaches, or other symptoms (EPA, 2008).

Only a small amount of bacteria and viruses are required to endanger public health. Positive samples increase the overall vulnerability of the drinking water source, indicating that the source is susceptible to bacteria and virus contamination. Bacteria and viruses have not been detected during recent water sampling of the system at Mt. McKinley Princess Lodge - Well 2 (data reviewed in April, 2008).

After combining the contaminant risk for bacteria and viruses with the natural susceptibility of the well, the overall vulnerability of the well to contamination is **Very High**.

#### **Nitrates and Nitrites**

The contaminant risk for nitrates and nitrites is **Very High**, with a large-capacity septic system, residential septic systems, and a park contributing to the risk to the drinking water well.

Sampling history for Mt. McKinley Princess Lodge - Well 2 indicates that nitrates have been detected in the water (the highest detected level within the last 5 years of sampling was 0.738 mg/l on 4/22/2005, data reviewed in April, 2008).

After combining the contaminant risk for nitrates and nitrites with the natural susceptibility of the well, the overall vulnerability of the well to contamination is **Very High**.

#### **Volatile Organic Chemicals**

The contaminant risk for volatile organic chemicals is **Low**, with a large-capacity septic system, residential septic systems, and heating oil tanks contributing to the risk to the drinking water well.

The drinking water at Mt. McKinley Princess Lodge - Well 2 has been sampled for volatile organic chemicals recently, but with no positive results (data reviewed in April, 2008).

After combining the contaminant risk for volatile organic chemicals with the natural susceptibility of the well, the overall vulnerability of the well to contamination is **High**.

#### **Using the Source Water Assessment**

This assessment of contaminant risks can be used as a foundation for local voluntary protection efforts as well as a basis for the continuous efforts on the part of Mt. McKinley Princess Lodge to protect public health. It is anticipated that Source Water Assessments will be updated every five years to reflect any changes in the vulnerability and/or susceptibility of Mt. McKinley Princess Lodge - Well 2 drinking water source.

## REFERENCES

Alaska Department of Commerce, Community and Economic Development (ADCCED), Accessed 2008 [WWW document]. URL: [http://www.commerce.state.ak.us/dca/commdb/CF\\_COMDB.htm](http://www.commerce.state.ak.us/dca/commdb/CF_COMDB.htm)

Freeze, R.A. and Cherry, J.A., 1979. Groundwater. Prentice-Hall, Englewood Cliffs, NJ.

United States Environmental Protection Agency (EPA), Accessed 2008 [WWW document]. URL: <http://www.epa.gov/safewater/contaminants/index.html>.



## **APPENDIX A**

### **Mt. McKinley Princess Lodge - Well 2 Drinking Water Protection Area Location Map (Map A)**

Public Water Well System for PWS #225601.002 Mt. McKinley Princess Lodge



**Legend**




- Class B Public Water System
- Groundwater Protection Zones**
- Zone A Protection Area - Several Months Travel Time
- Zone B Protection Area - 2 Years Travel Time

**Data Sources:**  
 Contaminant Sources, Public Water System Wells, Alaska Department of Environmental Conservation (ADEC)

**All other data:**  
 United States Geological Survey (USGS)

**Drinking Water Protection Areas based on "Alaska Drinking Water Protection Program - Guidance Manual for Class B Public Water Systems" published by ADEC**

**URS Corporation does not guarantee the accuracy or validity of the data provided.**

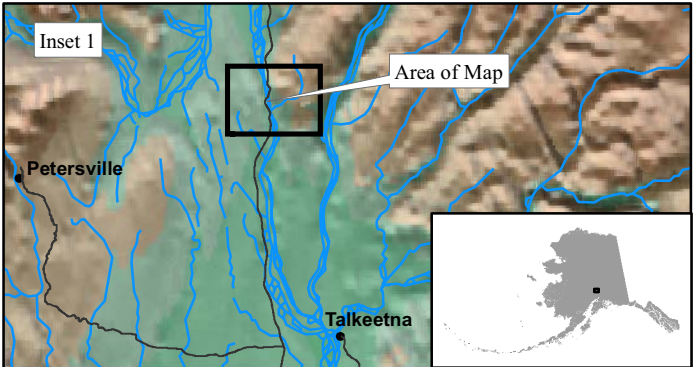

Mt. McKinley Princess Lodge  
 PWS 225601.002  
**Appendix A Map A**

## **APPENDIX B**

### **Contaminant Source Inventory and Risk Ranking for Mt. McKinley Princess Lodge - Well 2 (Tables 1-4)**

**Table 1**

**Contaminant Source Inventory for  
Mt. McKinley Princess Lodge**

**PWSID 225601.002**

<b>Contaminant Source Type</b>	<b>Contaminant Source ID</b>	<b>CS ID tag</b>	<b>Zone</b>	<b>Map Number</b>	<b>Comments</b>
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-01	A	C	
Residential Septics	R02	R02-01	A	C	
Residential Septics	R02	R02-02	A	C	
Residential Septics	R02	R02-03	A	C	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-01	A	C	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-02	A	C	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-03	A	C	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-04	A	C	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-05	A	C	
Municipal or city parks (with green areas)	X04	X04	A	C	Denali State Park
Residential Septics	R02	R02-04	B	C	
Residential Septics	R02	R02-05	B	C	
Residential Septics	R02	R02-06	B	C	
Residential Septics	R02	R02-07	B	C	

Table 2

*Contaminant Source Inventory and Risk Ranking for  
Mt. McKinley Princess Lodge  
Sources of Bacteria and Viruses*

PWSID 225601.002

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-01	A	High	C	
Residential Septics	R02	R02-01	A	Low	C	
Residential Septics	R02	R02-02	A	Low	C	
Residential Septics	R02	R02-03	A	Low	C	
Municipal or city parks (with green areas)	X04	X04	A	Medium	C	Denali State Park
Residential Septics	R02	R02-04	B	Low	C	
Residential Septics	R02	R02-05	B	Low	C	
Residential Septics	R02	R02-06	B	Low	C	
Residential Septics	R02	R02-07	B	Low	C	

Table 3

*Contaminant Source Inventory and Risk Ranking for  
Mt. McKinley Princess Lodge  
Sources of Nitrates/Nitrites*

PWSID 225601.002

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-01	A	High	C	
Residential Septics	R02	R02-01	A	Low	C	
Residential Septics	R02	R02-02	A	Low	C	
Residential Septics	R02	R02-03	A	Low	C	
Municipal or city parks (with green areas)	X04	X04	A	Medium	C	Denali State Park
Residential Septics	R02	R02-04	B	Low	C	
Residential Septics	R02	R02-05	B	Low	C	
Residential Septics	R02	R02-06	B	Low	C	
Residential Septics	R02	R02-07	B	Low	C	

**Table 4**

*Contaminant Source Inventory and Risk Ranking for  
Mt. McKinley Princess Lodge  
Sources of Volatile Organic Chemicals*

*PWSID 225601.002*


<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-01	A	Low	C	
Residential Septics	R02	R02-01	A	Low	C	
Residential Septics	R02	R02-02	A	Low	C	
Residential Septics	R02	R02-03	A	Low	C	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-01	A	Low	C	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-02	A	Low	C	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-03	A	Low	C	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-04	A	Low	C	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-05	A	Low	C	
Residential Septics	R02	R02-04	B	Low	C	
Residential Septics	R02	R02-05	B	Low	C	
Residential Septics	R02	R02-06	B	Low	C	
Residential Septics	R02	R02-07	B	Low	C	

## **APPENDIX C**

### **Mt. McKinley Princess Lodge - Well 2 Drinking Water Protection Area and Potential and Existing Contaminant Sources (Map C)**



**Public Water Well System for PWS #225601.002 Mt. McKinley Princess Lodge  
Showing Potential and Existing Sources of Contamination**

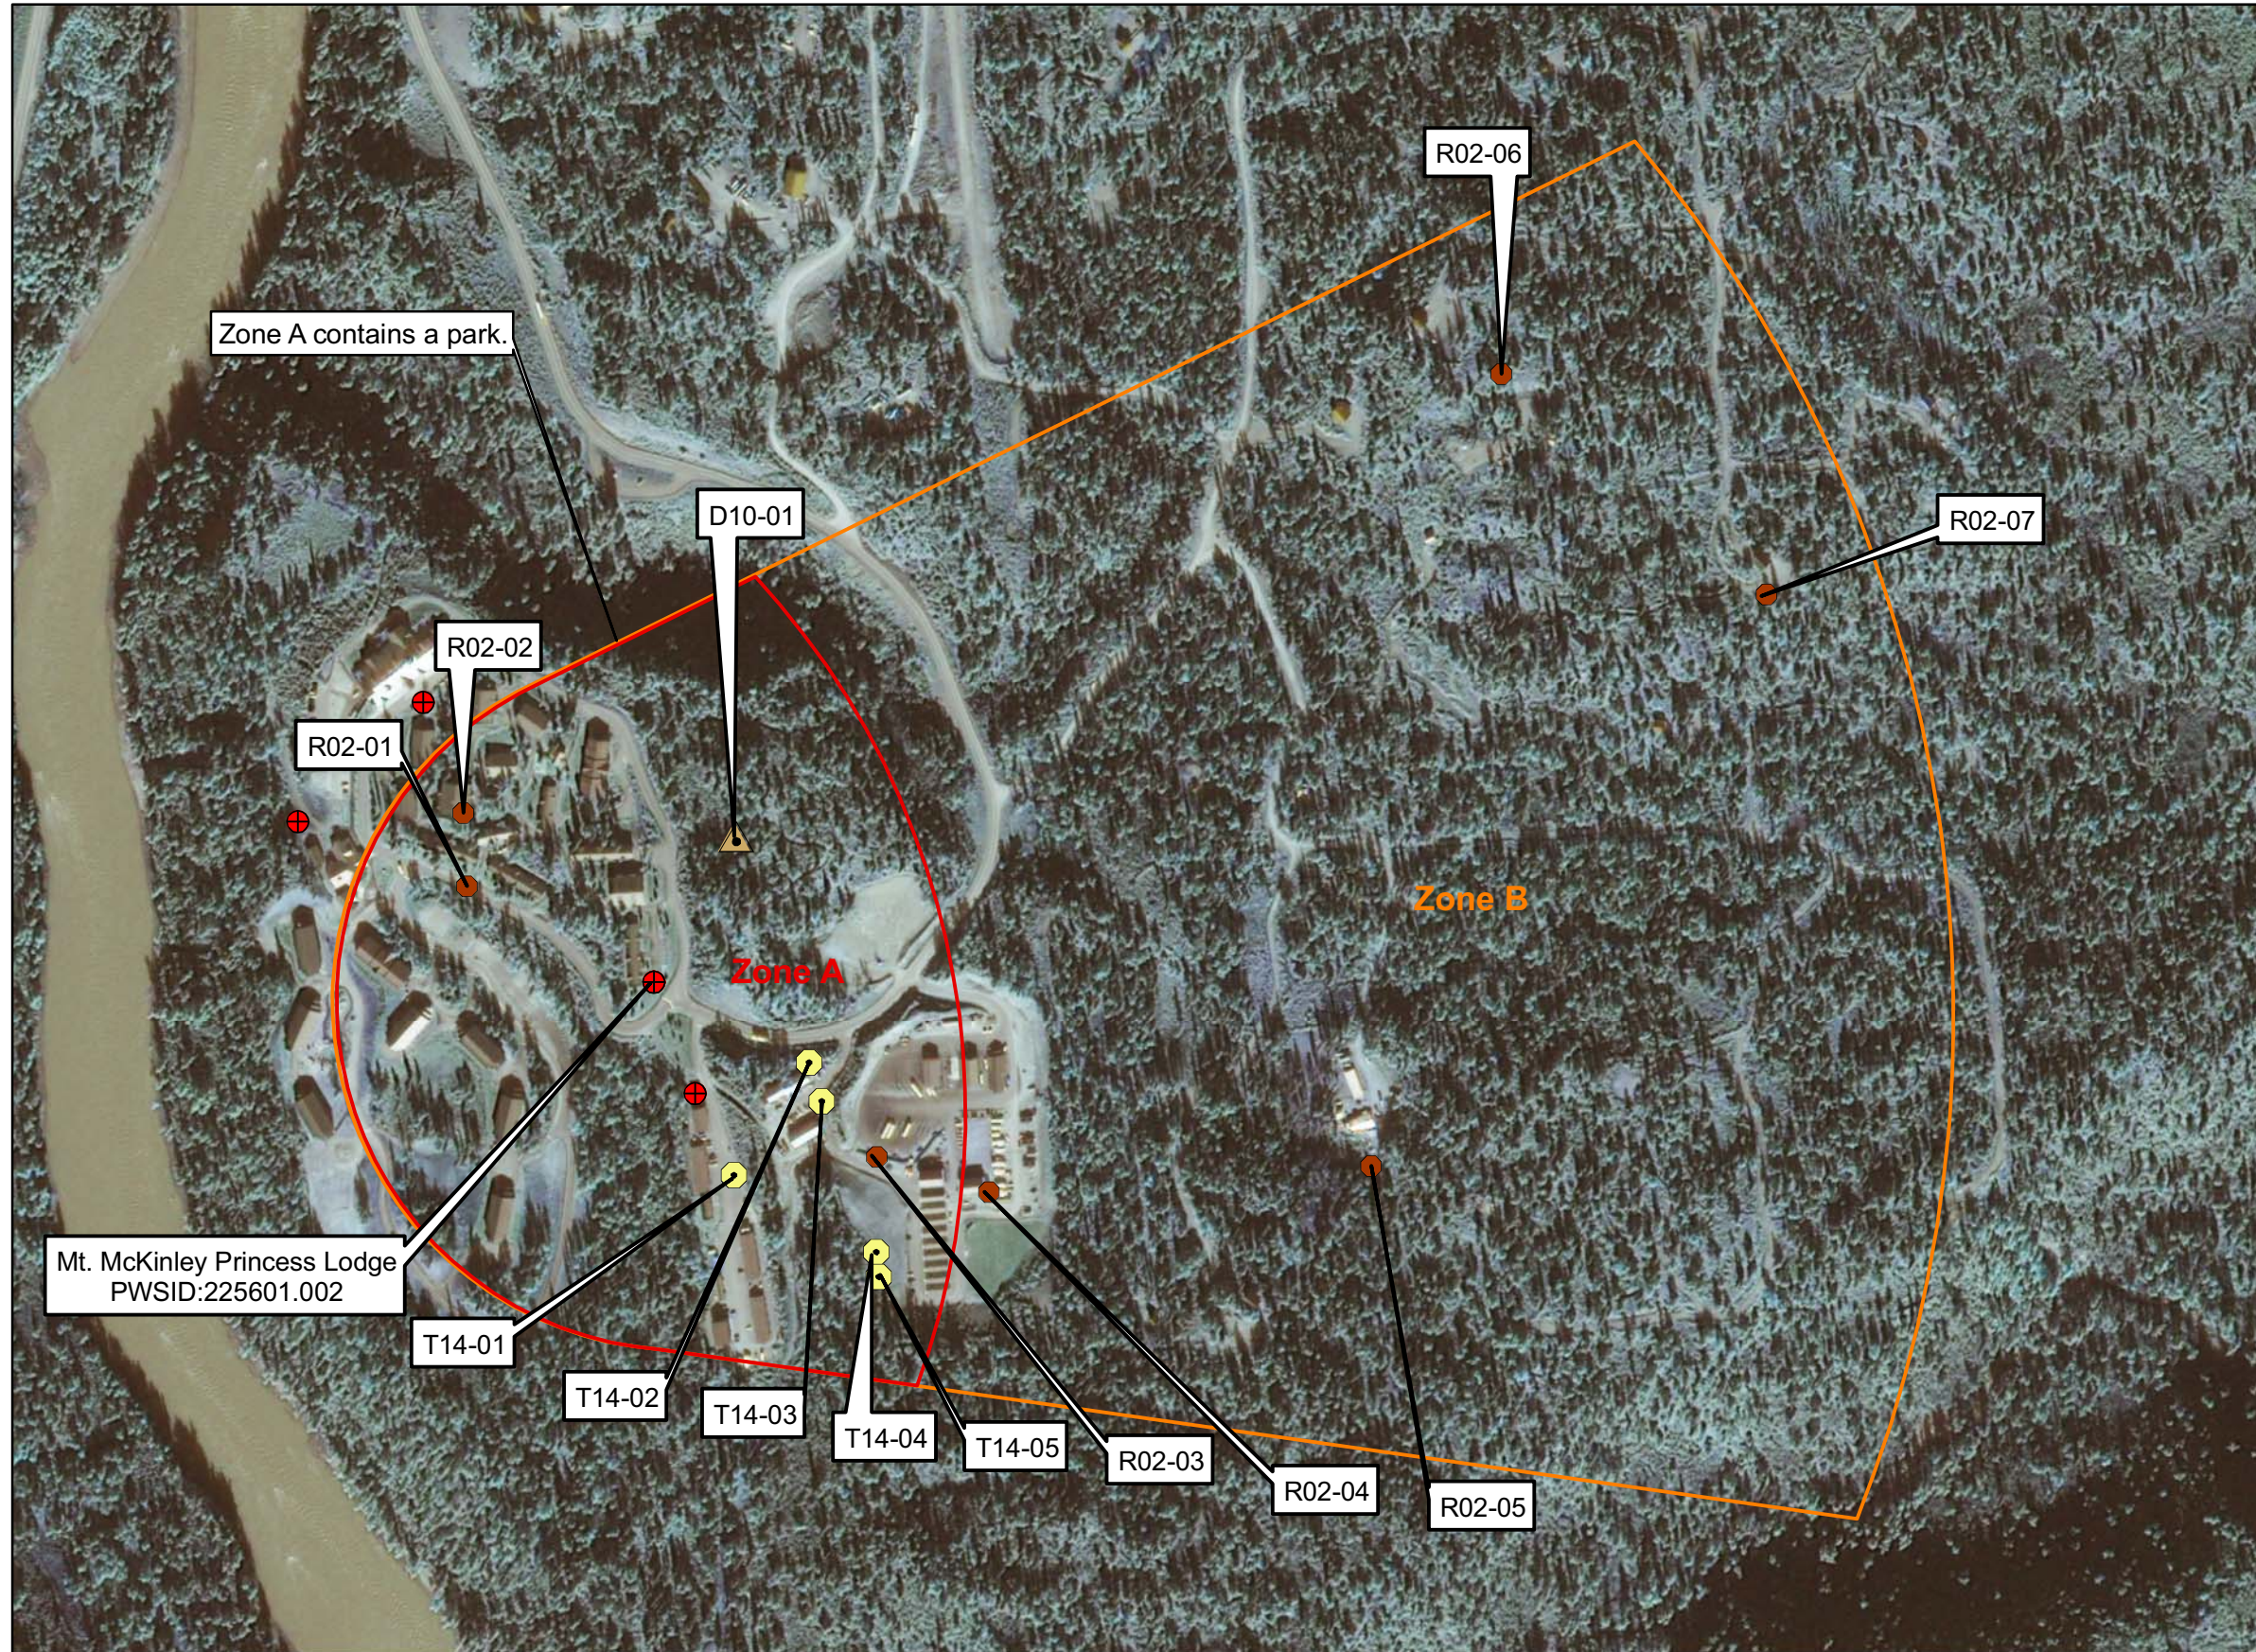

**Legend**

- Class B Public Water System
- Groundwater Protection Zones**
- Zone A Protection Area - Several Months Travel Time
  - Zone B Protection Area - 2 Years Travel Time
- Existing or Potential Contaminant Sources**
- Tanks, heating oil, nonresidential (aboveground) (T14)
  - ▲ Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method) (D10)
  - Residential Septics (R02)

**Data Sources:**  
Contaminant Sources, Public Water System Wells, Alaska Department of Environmental Conservation (ADEC)

**All other data:**  
Alaska Statewide Digital Mapping Initiative (SDMI)

**Drinking Water Protection Areas based on "Alaska Drinking Water Protection Program - Guidance Manual for Class B Public Water Systems" published by ADEC**

**URS Corporation does not guarantee the accuracy or validity of the data provided.**

