



Source Water Assessment

A Hydrogeologic Susceptibility and
Vulnerability Assessment for
the Aleutian Village Trailer Court
Drinking Water System,
Valdez, Alaska

PWSID # 298608.001

June 2004

DRINKING WATER PROTECTION PROGRAM REPORT 1375
Alaska Department of Environmental Conservation

Source Water Assessment for the Aleutian Village Trailer Court Drinking Water System Valdez, Alaska

PWSID # 298608.001

DRINKING WATER PROTECTION PROGRAM REPORT 1375

The Drinking Water Protection Program (DWPP) is producing Source Water Assessments in compliance with the Safe Drinking Water Act Amendments of 1996. Each assessment includes a delineation of the source water area, an inventory of potential and existing contaminant sources that may impact the water, a risk ranking for each of these contaminants, and an evaluation of the potential vulnerability of these drinking water sources.

These assessments are intended to provide public water systems owners/operators, communities, and local governments with the best available information that may be used to protect the quality of their drinking water. The assessments combine information obtained from various sources, including the U.S. Environmental Protection Agency, Alaska Department of Environmental Conservation (ADEC), public water system owners/operators, and other public information sources. The results of this assessment are subject to change if additional data becomes available. It is anticipated this assessment will be updated every five years to reflect any changes in the vulnerability and/or susceptibility of public drinking water source. If you have any additional information that may affect the results of this assessment, please contact the Program Coordinator of DWPP, (907) 269-7521.

CONTENTS

EXECUTIVE SUMMARY.....	1	INVENTORY OF POTENTIAL AND EXISTING	
PUBLIC DRINKING WATER SYSTEM	1	CONTAMINANT SOURCES	2
DRINKING WATER PROTECTION AREA.....	2	RANKING OF CONTAMINANT RISKS	3
		VULNERABILITY OF DRINKING WATER	
		SYSTEM	3

TABLES

Table 1. Definition of Zones	2
Table 2. Susceptibility	4
Table 3. Contaminant Risks	4
Table 4. Overall Vulnerability.....	4

APPENDICES

APPENDIX	A. Aleutian Village Trailer Court Public Water System Drinking Water Protection Area (Map A)
	B. Contaminant Source Inventory for Aleutian Village Trailer Court Public Water System (Table 1) Contaminant Source Inventory and Risk Ranking for Aleutian Village Trailer Court Public Water System – Bacteria and Viruses (Table 2) Contaminant Source Inventory and Risk Ranking for Aleutian Village Trailer Court Public Water System – Nitrates/Nitrites (Table 3) Contaminant Source Inventory and Risk Ranking for Aleutian Village Trailer Court Public Water System – Volatile Organic Chemicals (Table 4) Contaminant Source Inventory and Risk Ranking for Aleutian Village Trailer Court Public Water System – Heavy Metals, Cyanide and Other Inorganic Chemicals (Table 5) Contaminant Source Inventory and Risk Ranking for Aleutian Village Trailer Court Public Water System – Synthetic Organic Chemicals (Table 6) Contaminant Source Inventory and Risk Ranking for Aleutian Village Trailer Court Public Water System – Other Organic Chemicals (Table 7)
	C. Aleutian Village Trailer Court Public Water System Drinking Water Protection Area and Potential and Existing Contaminant Sources (Map C)
	D. Vulnerability Analysis for Contaminant Source Inventory and Risk Ranking for Aleutian Village Trailer Court Public Water System Public Drinking Water Source (Charts 1 – 14)

Source Water Assessment for Aleutian Village Trailer Court Public Water System Source of Public Drinking Water, Valdez, Alaska

Drinking Water Protection Program Alaska Department of Environmental Conservation

EXECUTIVE SUMMARY

The Aleutian Village Trailer Court Public Water System (PWS) consists of a four-well cluster of wells within 10' of each other. This assessment is limited exclusively to (PWS No. 298608.001). Well construction details are not available for this public water system, however it is assumed to have been in operation since at least 1978.

The well is a Class A (community and non-transient non-community) water system located at the Aleutian Village Trailer Court off the Richardson Highway and Airport Road in Valdez, Alaska. Available records indicate that the system has secondary storage capacity of 1,000-gallons and that the drinking water source is not treated. This system operates year round and serves approximately 300 residents through approximately 100 service connections. The wellhead received a susceptibility rating of **Low** and the aquifer received a susceptibility rating of **Very High**. Combining these two ratings produce a **Medium** rating for the natural susceptibility of the well.

Identified potential and current sources of contaminants for the public drinking water source include: injection wells, landfills, airports, and fuel tanks. A detailed inventory can be found in Table 1 of Appendix B. These identified potential and existing sources of contamination are considered sources of bacteria and viruses, nitrates and/or nitrites, volatile organic chemicals, heavy metals, cyanide and other inorganic chemicals, synthetic organic chemicals, and other organic chemicals contaminant categories.

Overall, the well received a vulnerability rating of **High** for bacteria and viruses, nitrates and nitrites, volatile organic chemicals, heavy metals, cyanide and other inorganic chemicals, synthetic organic chemicals and other organic chemicals.

PUBLIC DRINKING WATER SYSTEM

The Aleutian Village Trailer Court PWS well is a Class A (community/non-transient/non-community) public water system. The system is located at the intersection of the Richardson Highway and Airport Road in Valdez, Alaska (Sec. 32, T008S, R006W, Copper River Meridian, see Map A of Appendix A). Valdez is located on the north shore of Port Valdez in Prince William Sound. The community has a population of 4060 (ADCED, 2003). Total annual precipitation in Valdez is 62 inches, including approximately 325 inches of snowfall. Average temperatures range from 21 to 30°F in January and 46 to 61°F in July.

A piped water and sewer distribution system serves the majority of homes. Over 95% of households are fully plumbed (ADCED, 2003). The remaining community residents haul water and utilize individual wells and septic tanks (ADCED, 2003). Valdez receives electrical power from Copper Valley Electric Association, a REA Cooperative. Power generating facilities are hydro-powered with diesel backup. Refuse is collected by the City and disposed of at the community landfill, also operated by the City.

According to information supplied by ADEC for the Aleutian Village Trailer Court PWS, the depth of the well is assumed to be 49 feet below the ground surface. It is unknown but assumed the well is screened and is completed in an unconfined aquifer. Based on the location, the well is suspected to not be located within a floodplain.

The December 2002 sanitary survey indicates that the land surface was sloped away from the well. Generally, land surfaces that slope away from the wellhead promote surface water drainage, which reduces the potential of contaminant migration down the well casing annulus. Records also indicate that the well is grouted according to ADEC regulations. Proper grouting provides added protection against contaminants traveling along the well casing annulus and into source waters.

Valdez is a narrow, steep-walled fjord in the Chugach Mountains and is the northeastern-most extension of Price William Sound. The topography and drainage of Valdez are directly related to past and present alpine glacial activity. Valdez Glacier has scoured and shaped the valley. In the past, other smaller glaciers have filled the valleys and coalesced with Valdez Glacier to completely cover the area. All of the glaciers have been receding during historical time and continue their retreat. The resultant topography is comprised of a gently sloping glacial outwash apron, which laps up against the ice scoured bedrock spurs. Valdez Glacier extends down to the City of Valdez from the northeast, and its delta coalesces with the delta deposited by Lowe River flowing from the east (NTS, 1978).

Deposits in the Valdez area consist of two main units including bedrock and glacio-fluvial outwash. The bedrock consists of interbedded slate, phillite, and greywacke prevailing in thick beds. The bedrock sequence also includes minor amounts of argillite and some arkosic sandstone that grades locally in to conglomerate (NTS, 1978).

Glacio-fluvial materials constitute the deposits in the river valleys leading into Valdez. The outwash plains of the Robe River, the Lowe River, and the stream from Valdez Glacier coalesce to form a broad delta at the eastern end of Valdez. The grain size of the alluvium ranges from silt, sand, and gravel near the tidewater and becomes increasingly coarse upstream (NTS, 1978).

DRINKING WATER PROTECTION AREA

In order to evaluate whether a drinking water source is at risk, we must first evaluate what are the most likely pathways for surface contamination to reach the groundwater. These areas are determined by looking at the characteristics of the soil, groundwater, aquifer, and well.

The most probable area for contamination to reach the drinking water well is the area that contributes water to the well, the groundwater recharge area. This area is designated as the drinking water protection area (DWPA). Because releases of contaminants within the protection area are most likely to impact the drinking water well, this area will serve as the focus for voluntary protection efforts. An analytical calculation was used to determine the size and shape of the DWPA for the Aleutian Village Trailer Court PWS. The input parameters describing the attributes of the aquifer in this calculation were adopted from Groundwater (Freeze and Cherry, 1979). Available geology and groundwater contours

were also considered to take into account any uncertainties in groundwater flow and aquifer characteristics to arrive at a meaningful protection area.

The protection areas established for wells by the ADEC are usually separated into four zones, limited by the watershed. These zones correspond to differences in the time-of-travel (TOT) of the water moving through the aquifer to the well (Please refer to the Guidance Manual for Class A Public Water Systems for additional information).

The time of travel for contaminants within the water varies and is dependent on the physical and chemical characteristics of each contaminant. The following is a summary of the four protection area zones for wells and the calculated time-of-travel for each:

Table 1. Definition of Zones

Zone	Definition
A	¼ the distance for the 2-yr. time-of-travel
B	Less than the 2 year time-of-travel
C	Less Than the 5 year time-of-travel
D	Less than the 10 year time-of-travel

The DWPA for the Aleutian Village Trailer Court PWS was determined using an analytical calculation and includes Zones A, B, and D to the watershed boundary (See Map A of Appendix A).

INVENTORY OF POTENTIAL AND EXISTING CONTAMINANT SOURCES

The Drinking Water Protection Program has completed an inventory of potential and existing sources of contamination within the Aleutian Village Trailer Court PWS DWPA. This inventory was completed through a search of agency records and other publicly available information. Potential sources of contamination to the drinking water aquifer include a wide range of categories and types. Potential drinking water contaminants are found within agricultural, residential, commercial, and industrial areas, but can also occur within areas that have little or no development.

For the basis of all Class A public water system assessments, six categories of drinking water contaminants were inventoried. They include:

- Bacteria and viruses,
- Nitrates and/or nitrites,
- Volatile organic chemicals,
- Heavy metals, cyanide and other inorganic

- chemicals,
- Synthetic organic chemicals, and
- Other organic chemicals.

The sources are displayed on Map C of Appendix C and summarized in Table 1 of Appendix B.

RANKING OF CONTAMINANT RISKS

Once the potential and existing sources of contamination have been identified, they are assigned a ranking according to what type and level of risk they represent. Ranking of contaminant risks for a “potential” or “existing” source of contamination is a function of toxicity and volumes of specific contaminants associated with that source. Rankings include:

- Low,
- Medium,
- High, and
- Very High.

The time-of-travel for contaminants within the water varies and is dependent on the physical and chemical characteristics of each contaminant. Bacteria and Viruses are only inventoried in Zones A and B because of their short life span. Only “Very High” and “High” rankings are inventoried within the outer Zone D due to the probability of contaminant dilution by the time the contaminants get to the well. Tables 2 through 7 in Appendix B contain the ranking of potential and existing sources of contamination with respect to bacteria and viruses, nitrates and/or nitrites, volatile organic chemicals, heavy metals, cyanide and other inorganic chemicals, synthetic organic chemicals, and other organic chemicals.

VULNERABILITY OF THE DRINKING WATER SYSTEM

Vulnerability of a drinking water source to contamination is a combination of two factors:

- Natural susceptibility, and
- Contaminant risks.

Appendix D contains fourteen charts, which together form the ‘Vulnerability Analysis’ for a source water assessment for a public drinking water source. Chart 1 analyzes the ‘Susceptibility of the Wellhead’ to contamination by looking at the construction of the well and its surrounding area. Chart 2 analyzes the ‘Susceptibility of the Aquifer’ to contamination by looking at the naturally occurring attributes of the

water source and influences on the groundwater system that might lead to contamination. Chart 3 analyzes ‘Contaminant Risks’ for the drinking water source with respect to bacteria and viruses. The ‘Contaminant Risks’ portion of the analysis considers potential sources of contaminants as well as a review of contamination that has or may have occurred, but has not arrived or been detected at the well. Chart 4 contains the ‘Vulnerability Analysis for Bacteria and Viruses’. Charts 5 through 14 contain the Contaminant Risks and Vulnerability Analyses for nitrates and nitrites, volatile organic chemicals, heavy metals, cyanide and other inorganic chemicals, synthetic organic chemicals, and other organic chemicals, respectively.

A score for the Natural Susceptibility is reached by considering the properties of the well and the aquifer.

Susceptibility of the Wellhead (0 – 25 Points)
(Chart 1 of Appendix D)

+

Susceptibility of the Aquifer (0 – 25 Points)
(Chart 2 of Appendix D)

=

Natural Susceptibility (Susceptibility of the Well)
(0 – 50 Points)

A ranking is assigned for the Natural Susceptibility according to the point score:

Natural Susceptibility Ratings	
40 to 50 pts	Very High
30 to < 40 pts	High
20 to < 30 pts	Medium
< 20 pts	Low

The Aleutian Village Trailer Court PWS’s water well is completed in an unconfined aquifer. Unconfined aquifers are more susceptible to potential groundwater quality impacts posed by the migration of surface water contaminants downward from the surface. Table 2 shows the susceptibility scores and ratings for this PWS.

Table 2. Susceptibility

	Score	Rating
Susceptibility of the Wellhead	0	Low
Susceptibility of the Aquifer	25	Very High
Natural Susceptibility	25	Medium

Contaminant risks to a drinking water source depend on the type, number or density, and distribution of contaminant sources. This score has been derived from an examination of existing and historical contamination that has been detected at the drinking water source through routine sampling. It also evaluates potential sources of contamination. Flow charts are used to assign a point score, and ratings are assigned in the same way as for the natural susceptibility:

Contaminant Risk Ratings	
40 to 50 pts	Very High
30 to < 40 pts	High
20 to < 30 pts	Medium
< 20 pts	Low

Table 3 summarizes the Contaminant Risks for each category of drinking water contaminants.

Table 3. Contaminant Risks

Category	Score	Rating
Bacteria and Viruses	50	Very High
Nitrates and/or Nitrites	50	Very High
Volatile Organic Chemicals	45	Very High
Heavy Metals, Cyanide and Other Inorganic Chemicals	50	Very High
Synthetic Organic Chemicals	50	Very High
Other Organic Chemicals	50	Very High

Finally, an overall vulnerability score is assigned for each water system by combining each of the contaminant risk scores with the natural susceptibility score:

$$\begin{array}{r}
 \text{Natural Susceptibility (0 – 50 points)} \\
 + \\
 \text{Contaminant Risks (0 – 50 points)} \\
 =
 \end{array}$$

Vulnerability of the Drinking Water Source to Contamination (0 – 100).

Again, rankings are assigned according to a point score:

Overall Vulnerability Ratings	
80 to 100 pts	Very High
60 to < 80 pts	High
40 to < 60 pts	Medium
< 40 pts	Low

Table 4 contains the overall vulnerability scores (0 – 100) and ratings for each of the six categories of drinking water contaminants. Note: scores are rounded off to the nearest five.

Table 4. Overall Vulnerability

Category	Score	Rating
Bacteria and Viruses	75	High
Nitrates and Nitrites	75	High
Volatile Organic Chemicals	70	High
Heavy Metals, Cyanide and Other Inorganic Chemicals	75	High
Synthetic Organic Chemicals	75	High
Other Organic Chemicals	75	High

Bacteria and Viruses

The contaminant risk for bacteria and viruses is **Very High**. The risk is primarily attributed to the presence of a large capacity septic system and a landfill located in Zone A. Numerous other potential contaminant sources are also found within the protection area (see Table 2 – Appendix B).

Coliforms (a bacteria) are found naturally in the environment and although they aren't necessarily a health threat, they are an indicator of other potentially harmful bacteria in the water, more specifically, fecal coliforms and E. coli, which only come from human and animal fecal waste. Harmful bacteria can cause diarrhea, cramps, nausea, headaches, or other symptoms (EPA, 2002). Positive samples increase the overall vulnerability of the drinking water source, indicating that the source is susceptible to bacteria and virus contamination.

No positive bacteria counts have been reported in recent (within five years) sampling events (See Chart 3 – Contaminant Risks for Bacteria and Viruses in Appendix D). Only a small amount of bacteria and viruses are required to endanger public health.

After combining the contaminant risk for bacteria and viruses with the natural susceptibility of the well, the overall vulnerability of the well to contamination is **High**.

Nitrates and Nitrites

The contaminant risk for nitrates and nitrites is **Very High**. The risk to this source of public drinking water is primarily attributed to the presence of a landfill located in Zone A. Numerous other potential contaminant sources are also found within the protection area (see Table 3 – Appendix B).

Nitrates are very mobile, moving at approximately the same rate as water. The sampling history for this well indicates that nitrates have been detected in recent sampling events, however they did not exceed the MCL of 10 mg/L. Nitrate concentrations in uncontaminated groundwater are typically less than 2 mg/L; therefore, nitrate concentrations above 2 mg/L may be indicative of man-made sources (See Chart 5 - Contaminant Risks for Nitrates and/or Nitrites in Appendix D).

Nitrate levels are often derived from the decomposition of organic matter in soils. Although the nitrate source is unknown, such occurrences may be attributed to septic systems or other sources.

After combining the contaminant risk for nitrates and nitrites with the natural susceptibility of the well, the overall vulnerability of the well to nitrate and nitrite contamination is **High**.

Volatile Organic Chemicals

The contaminant risk for volatile organic chemicals is **Very High**. The risk is primarily attributed to the presence of a landfill and an airport located in Zone A. Numerous other potential contaminant sources are also found within the protection area (see Table 4 – Appendix B).

All recent sampling data for Volatile Organic Chemicals reported results below detection levels (See Chart 7 – Contaminant Risks for Volatile Organic Chemicals in Appendix D).

After combining the contaminant risk for volatile organic chemicals with the natural susceptibility of the well, the overall vulnerability of the well to contamination is **High**.

Heavy Metals, Cyanide and Other Inorganic Chemicals

The contaminant risk for heavy metals, cyanide and other inorganic chemicals is **Very High**. The risk is primarily attributed to the presence of a landfill located in Zone A. Numerous other potential contaminant sources are also found within the protection area (see Table 5 – Appendix B).

Based on review of recent sampling records for this public water system, moderate levels of copper and lead have been detected in recent sampling history, however they did not exceed their respective MCLs of 1.3 mg/L and 0.015 mg/L (see Chart 9 – Contaminant Risks for Heavy Metals, Cyanide, and Other Inorganic Chemicals in Appendix D).

The reported concentrations of copper and lead are likely attributed to the water treatment/conveyance system. After combining the contaminant risk for heavy metals, cyanide and other inorganic chemicals with the natural susceptibility of the well, the overall vulnerability of the well to contamination is **High**.

Synthetic Organic Chemicals

The contaminant risk for synthetic organic chemicals is **Very High**. The risk is primarily attributed to a landfill and an airport located in Zone A. Numerous other potential contaminant sources are also found within the protection area (see Table 6 – Appendix B).

No recent sampling data was available in ADEC records for the Aleutian Village Trailer Court PWS (See Chart 11 – Contaminant Risks for Synthetic Organic Chemicals in Appendix D).

After combining the contaminant risk for synthetic organic chemicals with the natural susceptibility of the well, the overall vulnerability of the well to contamination is **High**.

Other Organic Chemicals

The contaminant risk for other organic chemicals is **Very High**. The risk is primarily attributed to the presence of landfills located in Zone A. Several other potential contaminant sources are also found within the protection area (see Table 7 – Appendix B).

No recent sampling data was available in ADEC records for the Aleutian Village Trailer Court PWS (See Chart 13 – Contaminant Risks for Other Organic Chemicals in Appendix D).

After combining the contaminant risk for other organic chemicals with the natural susceptibility of the well, the overall vulnerability of the well to contamination is **High**.

Using the Source Water Assessment

This assessment of contaminant risks can be used as a foundation for local voluntary protection efforts as well as a basis for the continuous efforts on the part of the community of Valdez to protect public health. It is anticipated that Source Water Assessments will be updated every five years to reflect any changes in the vulnerability and/or susceptibility of the drinking water source.

REFERENCES

- Alaska Department of Community and Economic Development (ADCED), 2003 [WWW document]. URL: http://www.dced.state.ak.us/cbd/commdb/CF_COMDB.htm
- Alaska Department of Environmental Conservation, Contaminated Sites Database, 2003 [WWW database], URL http://www.state.ak.us/dec/dspar/csites/cs_search.htm
- Alaska Department of Environmental Conservation, Leaking Underground Storage Tank Database, 2003 [WWW database], URL http://www.dec.state.ak.us/spar/stp/ust/search/fac_search.asp
- Freeze, R. A., and Cherry, J.A. 1979, Groundwater, Prentice-Hall, Englewood Cliffs, New Jersey
- Northern Technical Services (NTS), September 1978. Information from Preliminary Site and Soils Investigation of Proposed Plant Sites at Valdez and Kenai, Alaska for Alaska Petrochemical Company.
- United States Environmental Protection Agency (EPA), 2002 [WWW document]. URL <http://www.epa.gov/safewater/mcl.html>.

APPENDIX A

Drinking Water Protection Area Location Map (Map A)

APPENDIX B

Contaminant Source Inventory and Risk Ranking (Tables 1-7)


APPENDIX C

Drinking Water Protection Area and Potential and Existing Contaminant Sources (Map C)

APPENDIX D

Vulnerability Analysis for Public Drinking Water Source (Charts 1-14)

Public Water Well System for PWS #298608.001 Aleutian Village Trailer Court

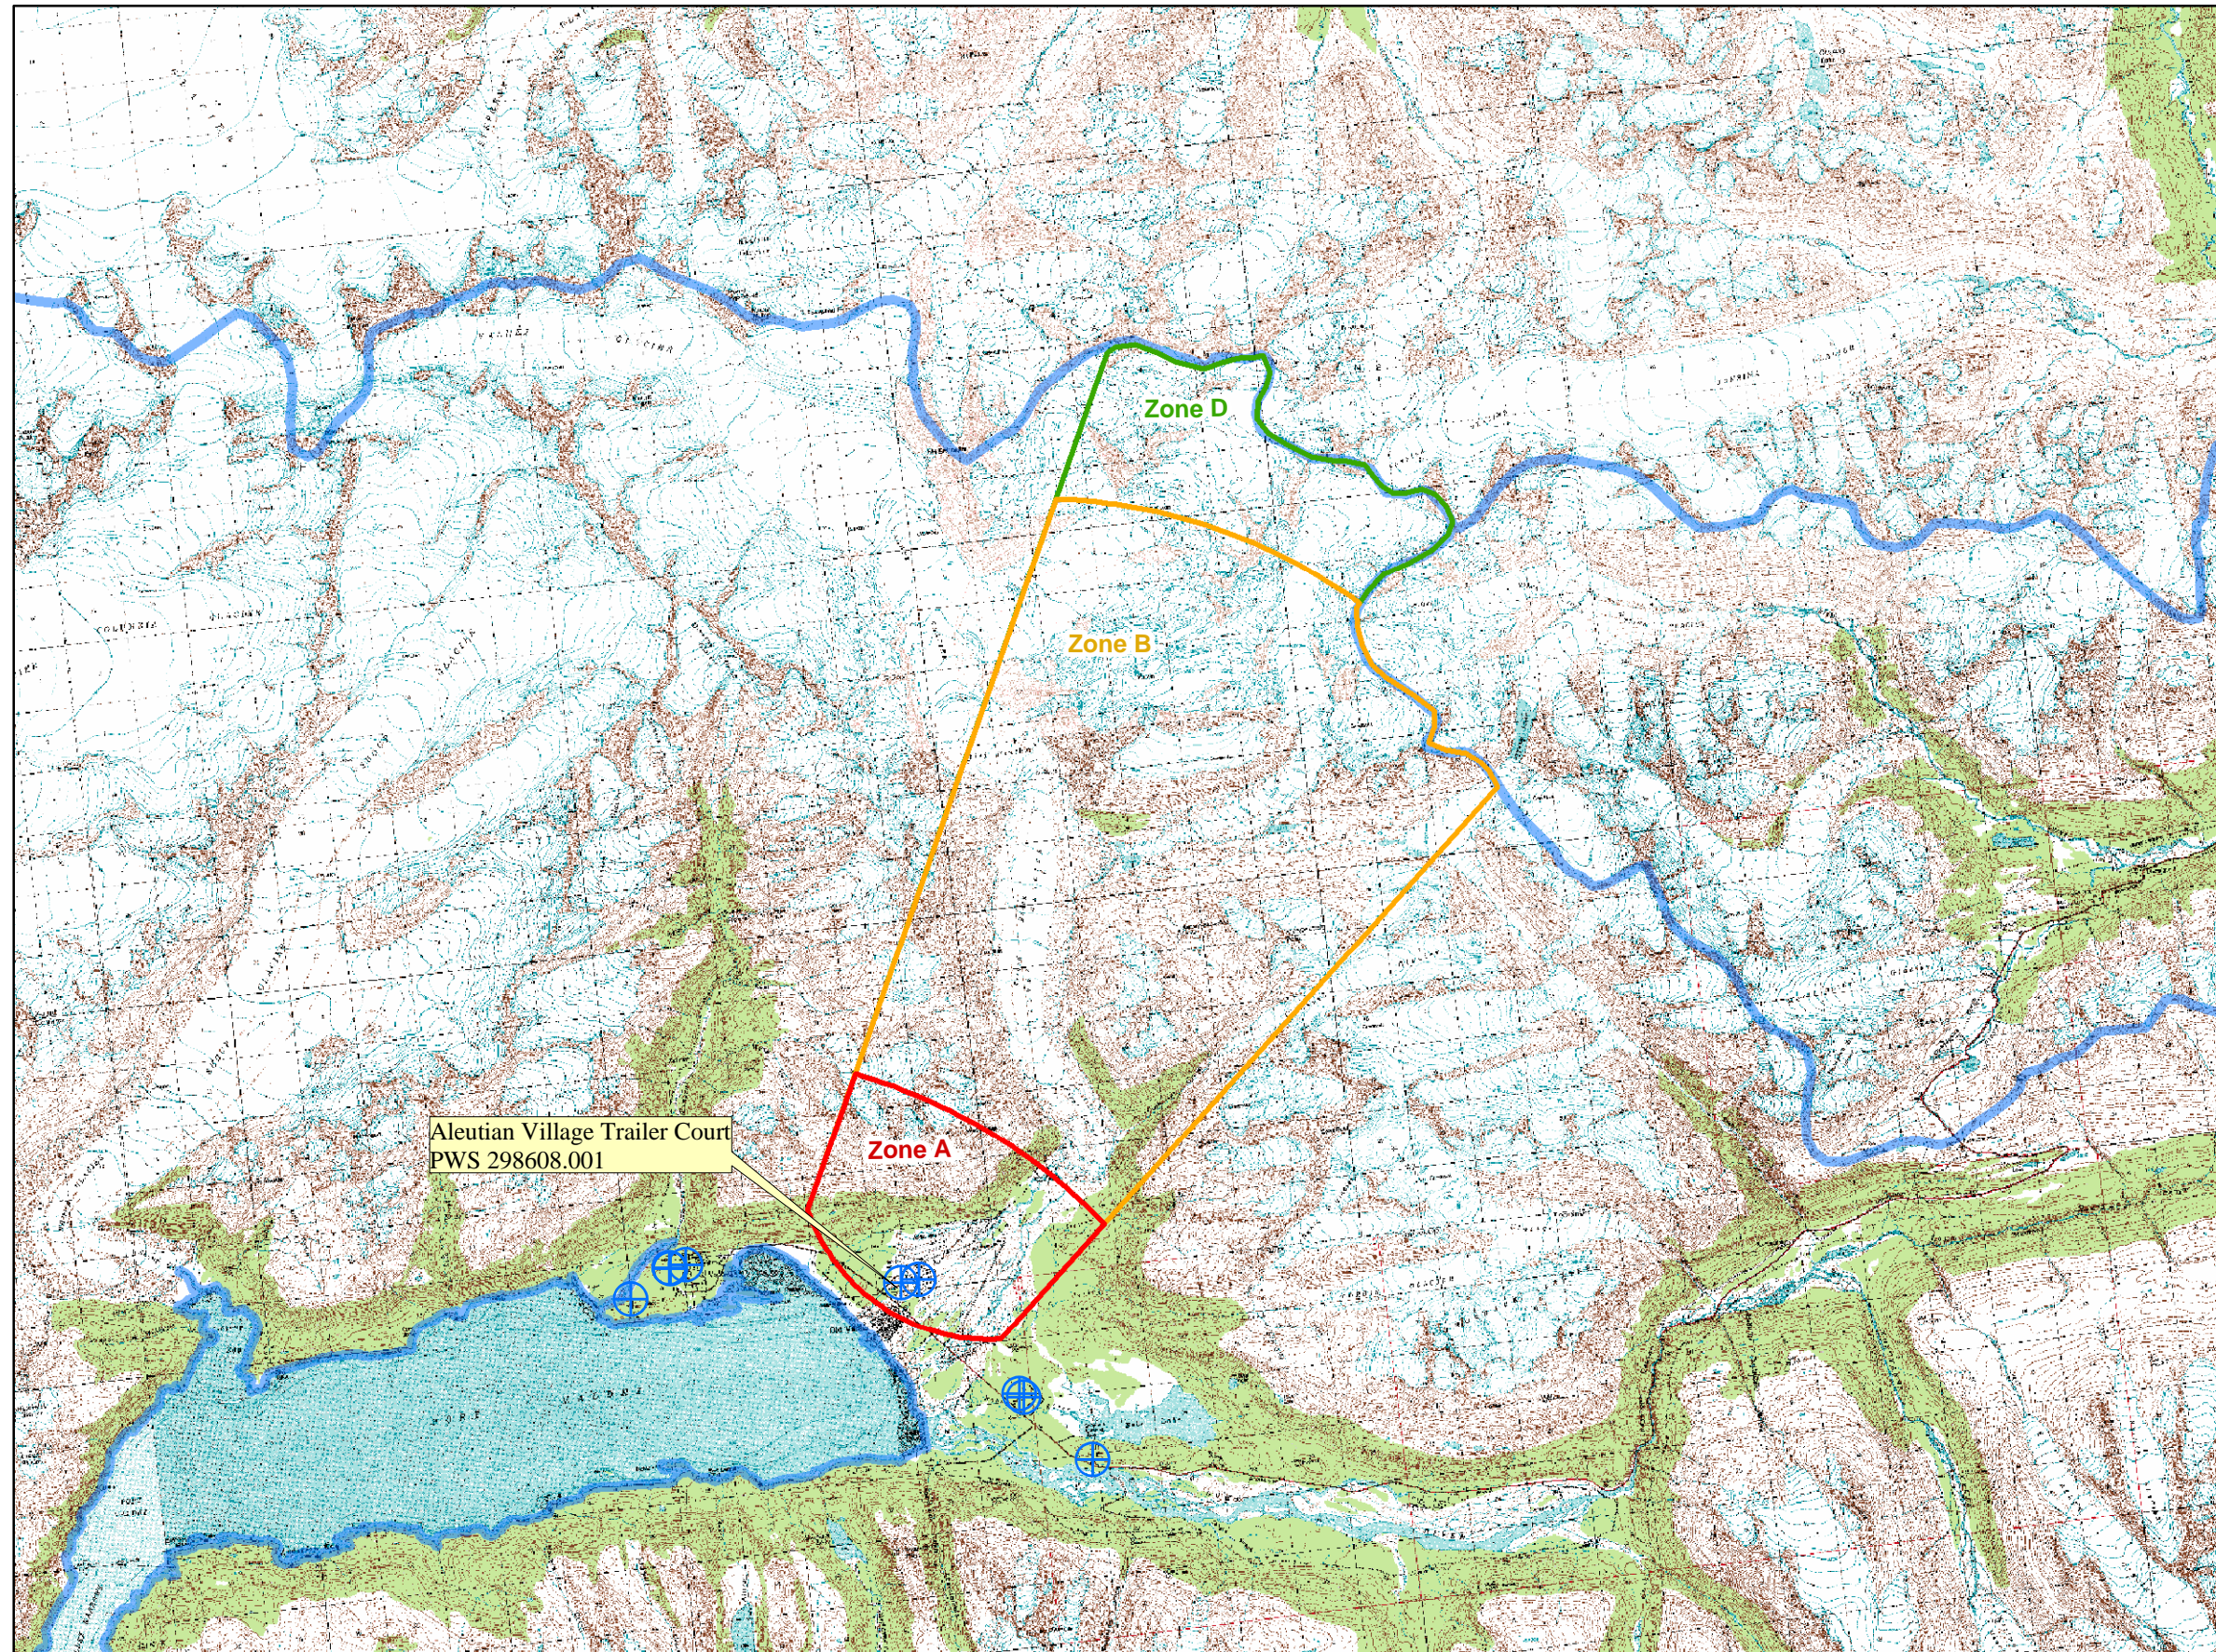

LEGEND

⊕ Public Water System Well

Hydrography/Physical

- ▭ Parcels
- ~ Stream
- ▭ Lake or Pond
- ~ Contours
- ~ Watershed Boundary

Transportation

- Primary Route (Class 1)
- - - Secondary Route (Class 2)
- Road (Class 3)
- ⋯ Road (Class 4)
- ⋯⋯ Road (Class 5, Four-wheel drive)

Protection Zones

- ▭ Zone A Protection Area— Several Months Travel Time
- ▭ Zone B Protection Area— 2 Years Travel Time
- ▭ Zone D Protection Area— 10 Years Travel Time or Watershed Boundary

Data Sources:
 - Contaminant Sources, Public Water System Wells, Contours Alaska Department of Environmental Conservation (ADEC)
 - Critical Facilities, Federal Emergency Management Agency (FEMA)
 All other data:
 - United States Geological Survey (USGS)
 - Drinking Water Protection Areas based on "Alaska Drinking Water Protection Program - Guidance Manual for Class A Public Water Systems" published by ADEC
 URS Corporation does not guarantee the accuracy or validity of the data provided.


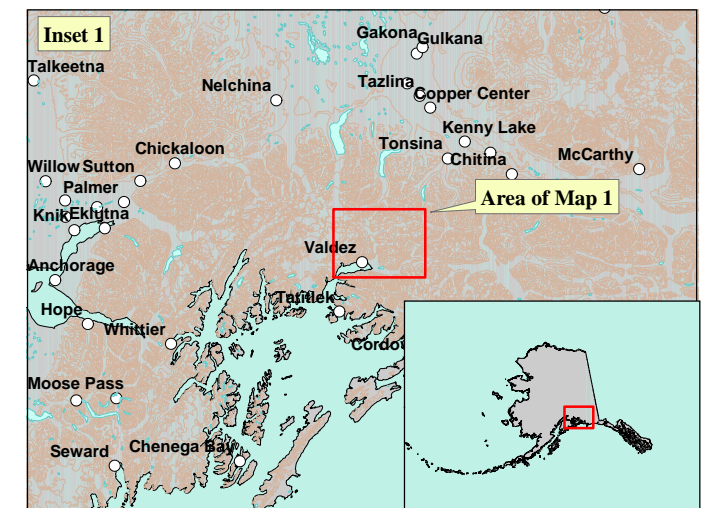


Table 1

**Contaminant Source Inventory for
Aleutian Village Trailer Court**

PWSID 298608.001

Contaminant Source Type	Contaminant Source ID	CS ID tag	Zone	Map Number	Comments
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D01-01	A	C	Assume 1200 or less sewer lines in Zone A
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-01	A	C	
Pit toilets (open hole), nonresidential (one or more)	D16	D16-01	A	C	Assume 45 or less pit toilets/outhouses in Zone A
Landfills (municipal; Class II)	D50	D50-01	A	C	Valdez, Balefill
Landfills (industrial; type of industrial waste?)	D52	D52-01	A	C	Valdez Construction, Landfill
Landfills (industrial; type of industrial waste?)	D52	D52-02	A	C	Valdez, City of Biosolids Land Application
Quarries (sand, gravel, rock, other?)	E10	E10-01	A	C	GLACIER STREAM PIT
Quarries (sand, gravel, rock, other?)	E10	E10-02	A	C	GOLD STANDARD
Quarries (sand, gravel, rock, other?)	E10	E10-03	A	C	JOHNSON PIT
Septic systems (serves one single-family home)	R02	R02-01	A	C	Assume 285 or less individual septic systems in Zone A
Tanks, heating oil, residential (above ground)	R08	R08-01	A	C	Assume 1100 or less residential heating oil tanks in Zone A
Airports	X14	X14-01	A	C	VALDEZ AIRPORT
Highways and roads, dirt/gravel	X24	X24-01	A	C	Assume 1-20 roads in Zone A
Quarries (sand, gravel, rock, other?)	E10	E10-04	B	C	DONOHU
Quarries (sand, gravel, rock, other?)	E10	E10-05	B	C	GLACIER PIT & PORTABLE MILL
Quarries (sand, gravel, rock, other?)	E10	E10-06	B	C	IBEX
Quarries (sand, gravel, rock, other?)	E10	E10-07	B	C	PINOCHLE
Quarries (sand, gravel, rock, other?)	E10	E10-08	B	C	RAMSAY-RUTHERFORD
Quarries (sand, gravel, rock, other?)	E10	E10-09	B	C	ROSE JOHNSON
Quarries (sand, gravel, rock, other?)	E10	E10-10	B	C	VALDEZ BONANZA

*Contaminant Source Inventory and Risk Ranking for
Aleutian Village Trailer Court
Sources of Bacteria and Viruses*

PWSID 298608.001

Table 2

Contaminant Source Type	Contaminant Source ID	CS ID tag	Zone	Risk Ranking for Analysis	Map Number	Comments
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D01-01	A	High	C	Assume 1200 or less sewer lines in Zone A
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-01	A	High	C	
Pit toilets (open hole), nonresidential (one or more)	D16	D16-01	A	Medium	C	Assume 45 or less pit toilets/outhouses in Zone A
Landfills (municipal; Class II)	D50	D50-01	A	High	C	Valdez, Balefill
Septic systems (serves one single-family home)	R02	R02-01	A	Low	C	Assume 285 or less individual septic systems in Zone A
Highways and roads, dirt/gravel	X24	X24-01	A	Low	C	Assume 1-20 roads in Zone A

Table 3

*Contaminant Source Inventory and Risk Ranking for
Aleutian Village Trailer Court
Sources of Nitrates/Nitrites*

PWSID 298608.001

Contaminant Source Type	Contaminant Source ID	CS ID tag	Zone	Risk Ranking for Analysis	Map Number	Comments
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D01-01	A	High	C	Assume 1200 or less sewer lines in Zone A
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-01	A	High	C	
Pit toilets (open hole), nonresidential (one or more)	D16	D16-01	A	Medium	C	Assume 45 or less pit toilets/outhouses in Zone A
Landfills (municipal; Class II)	D50	D50-01	A	Very High	C	Valdez, Balefill
Quarries (sand, gravel, rock, other?)	E10	E10-01	A	Low	C	GLACIER STREAM PIT
Quarries (sand, gravel, rock, other?)	E10	E10-02	A	Low	C	GOLD STANDARD
Quarries (sand, gravel, rock, other?)	E10	E10-03	A	Low	C	JOHNSON PIT
Septic systems (serves one single-family home)	R02	R02-01	A	Low	C	Assume 285 or less individual septic systems in Zone A
Airports	X14	X14-01	A	Low	C	VALDEZ AIRPORT
Highways and roads, dirt/gravel	X24	X24-01	A	Low	C	Assume 1-20 roads in Zone A
Quarries (sand, gravel, rock, other?)	E10	E10-04	B	Low	C	DONOHU
Quarries (sand, gravel, rock, other?)	E10	E10-05	B	Low	C	GLACIER PIT & PORTABLE MILL
Quarries (sand, gravel, rock, other?)	E10	E10-06	B	Low	C	IBEX
Quarries (sand, gravel, rock, other?)	E10	E10-07	B	Low	C	PINOCHLE
Quarries (sand, gravel, rock, other?)	E10	E10-08	B	Low	C	RAMSAY-RUTHERFORD
Quarries (sand, gravel, rock, other?)	E10	E10-09	B	Low	C	ROSE JOHNSON
Quarries (sand, gravel, rock, other?)	E10	E10-10	B	Low	C	VALDEZ BONANZA

*Contaminant Source Inventory and Risk Ranking for
Aleutian Village Trailer Court
Sources of Volatile Organic Chemicals*

PWSID 298608.001

Table 4

Contaminant Source Type	Contaminant Source ID	CS ID tag	Zone	Risk Ranking for Analysis	Map Number	Comments
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D01-01	A	Low	C	Assume 1200 or less sewer lines in Zone A
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-01	A	Low	C	
Pit toilets (open hole), nonresidential (one or more)	D16	D16-01	A	Low	C	Assume 45 or less pit toilets/outhouses in Zone A
Landfills (municipal; Class II)	D50	D50-01	A	High	C	Valdez, Balefill
Quarries (sand, gravel, rock, other?)	E10	E10-01	A	Low	C	GLACIER STREAM PIT
Quarries (sand, gravel, rock, other?)	E10	E10-02	A	Low	C	GOLD STANDARD
Quarries (sand, gravel, rock, other?)	E10	E10-03	A	Low	C	JOHNSON PIT
Septic systems (serves one single-family home)	R02	R02-01	A	Low	C	Assume 285 or less individual septic systems in Zone A
Tanks, heating oil, residential (above ground)	R08	R08-01	A	Medium	C	Assume 1100 or less residential heating oil tanks in Zone A
Airports	X14	X14-01	A	High	C	VALDEZ AIRPORT
Highways and roads, dirt/gravel	X24	X24-01	A	Low	C	Assume 1-20 roads in Zone A
Quarries (sand, gravel, rock, other?)	E10	E10-04	B	Low	C	DONOHU
Quarries (sand, gravel, rock, other?)	E10	E10-05	B	Low	C	GLACIER PIT & PORTABLE MILL
Quarries (sand, gravel, rock, other?)	E10	E10-06	B	Low	C	IBEX
Quarries (sand, gravel, rock, other?)	E10	E10-07	B	Low	C	PINOCHLE
Quarries (sand, gravel, rock, other?)	E10	E10-08	B	Low	C	RAMSAY-RUTHERFORD
Quarries (sand, gravel, rock, other?)	E10	E10-09	B	Low	C	ROSE JOHNSON
Quarries (sand, gravel, rock, other?)	E10	E10-10	B	Low	C	VALDEZ BONANZA

*Contaminant Source Inventory and Risk Ranking for
Aleutian Village Trailer Court*

PWSID 298608.001

Table 5

Sources of Heavy Metals, Cyanide and Other Inorganic Chemicals

Contaminant Source Type	Contaminant Source ID	CS ID tag	Zone	Risk Ranking for Analysis	Map Number	Comments
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D01-01	A	Low	C	Assume 1200 or less sewer lines in Zone A
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-01	A	Low	C	
Pit toilets (open hole), nonresidential (one or more)	D16	D16-01	A	Low	C	Assume 45 or less pit toilets/outhouses in Zone A
Landfills (municipal; Class II)	D50	D50-01	A	High	C	Valdez, Balefill
Septic systems (serves one single-family home)	R02	R02-01	A	Low	C	Assume 285 or less individual septic systems in Zone A
Airports	X14	X14-01	A	Low	C	VALDEZ AIRPORT
Highways and roads, dirt/gravel	X24	X24-01	A	Low	C	Assume 1-20 roads in Zone A

*Contaminant Source Inventory and Risk Ranking for
Aleutian Village Trailer Court
Sources of Synthetic Organic Chemicals*

PWSID 298608.001

Table 6

Contaminant Source Type	Contaminant Source ID	CS ID tag	Zone	Risk Ranking for Analysis	Map Number	Comments
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D01-01	A	Low	C	Assume 1200 or less sewer lines in Zone A
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-01	A	Low	C	
Landfills (municipal; Class II)	D50	D50-01	A	Very High	C	Valdez, Balefill
Septic systems (serves one single-family home)	R02	R02-01	A	Low	C	Assume 285 or less individual septic systems in Zone A
Airports	X14	X14-01	A	Medium	C	VALDEZ AIRPORT


*Contaminant Source Inventory and Risk Ranking for
Aleutian Village Trailer Court
Sources of Other Organic Chemicals*

PWSID 298608.001

Table 7

Contaminant Source Type	Contaminant Source ID	CS ID tag	Zone	Risk Ranking for Analysis	Map Number	Comments
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D01-01	A	Low	C	Assume 1200 or less sewer lines in Zone A
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-01	A	Low	C	
Landfills (municipal; Class II)	D50	D50-01	A	Very High	C	Valdez, Balefill
Landfills (industrial; type of industrial waste?)	D52	D52-01	A	Very High	C	Valdez Construction, Landfill
Landfills (industrial; type of industrial waste?)	D52	D52-02	A	Very High	C	Valdez, City of Biosolids Land Application
Quarries (sand, gravel, rock, other?)	E10	E10-01	A	Low	C	GLACIER STREAM PIT
Quarries (sand, gravel, rock, other?)	E10	E10-02	A	Low	C	GOLD STANDARD
Quarries (sand, gravel, rock, other?)	E10	E10-03	A	Low	C	JOHNSON PIT
Septic systems (serves one single-family home)	R02	R02-01	A	Low	C	Assume 285 or less individual septic systems in Zone A
Airports	X14	X14-01	A	Medium	C	VALDEZ AIRPORT
Highways and roads, dirt/gravel	X24	X24-01	A	Low	C	Assume 1-20 roads in Zone A
Quarries (sand, gravel, rock, other?)	E10	E10-04	B	Low	C	DONOHU
Quarries (sand, gravel, rock, other?)	E10	E10-05	B	Low	C	GLACIER PIT & PORTABLE MILL
Quarries (sand, gravel, rock, other?)	E10	E10-06	B	Low	C	IBEX
Quarries (sand, gravel, rock, other?)	E10	E10-07	B	Low	C	PINOCHLE
Quarries (sand, gravel, rock, other?)	E10	E10-08	B	Low	C	RAMSAY-RUTHERFORD
Quarries (sand, gravel, rock, other?)	E10	E10-09	B	Low	C	ROSE JOHNSON
Quarries (sand, gravel, rock, other?)	E10	E10-10	B	Low	C	VALDEZ BONANZA

**Public Water Well System for PWS #298608.001 Aleutian Village Trailer Court
Showing Potential and Existing Sources of Contamination**

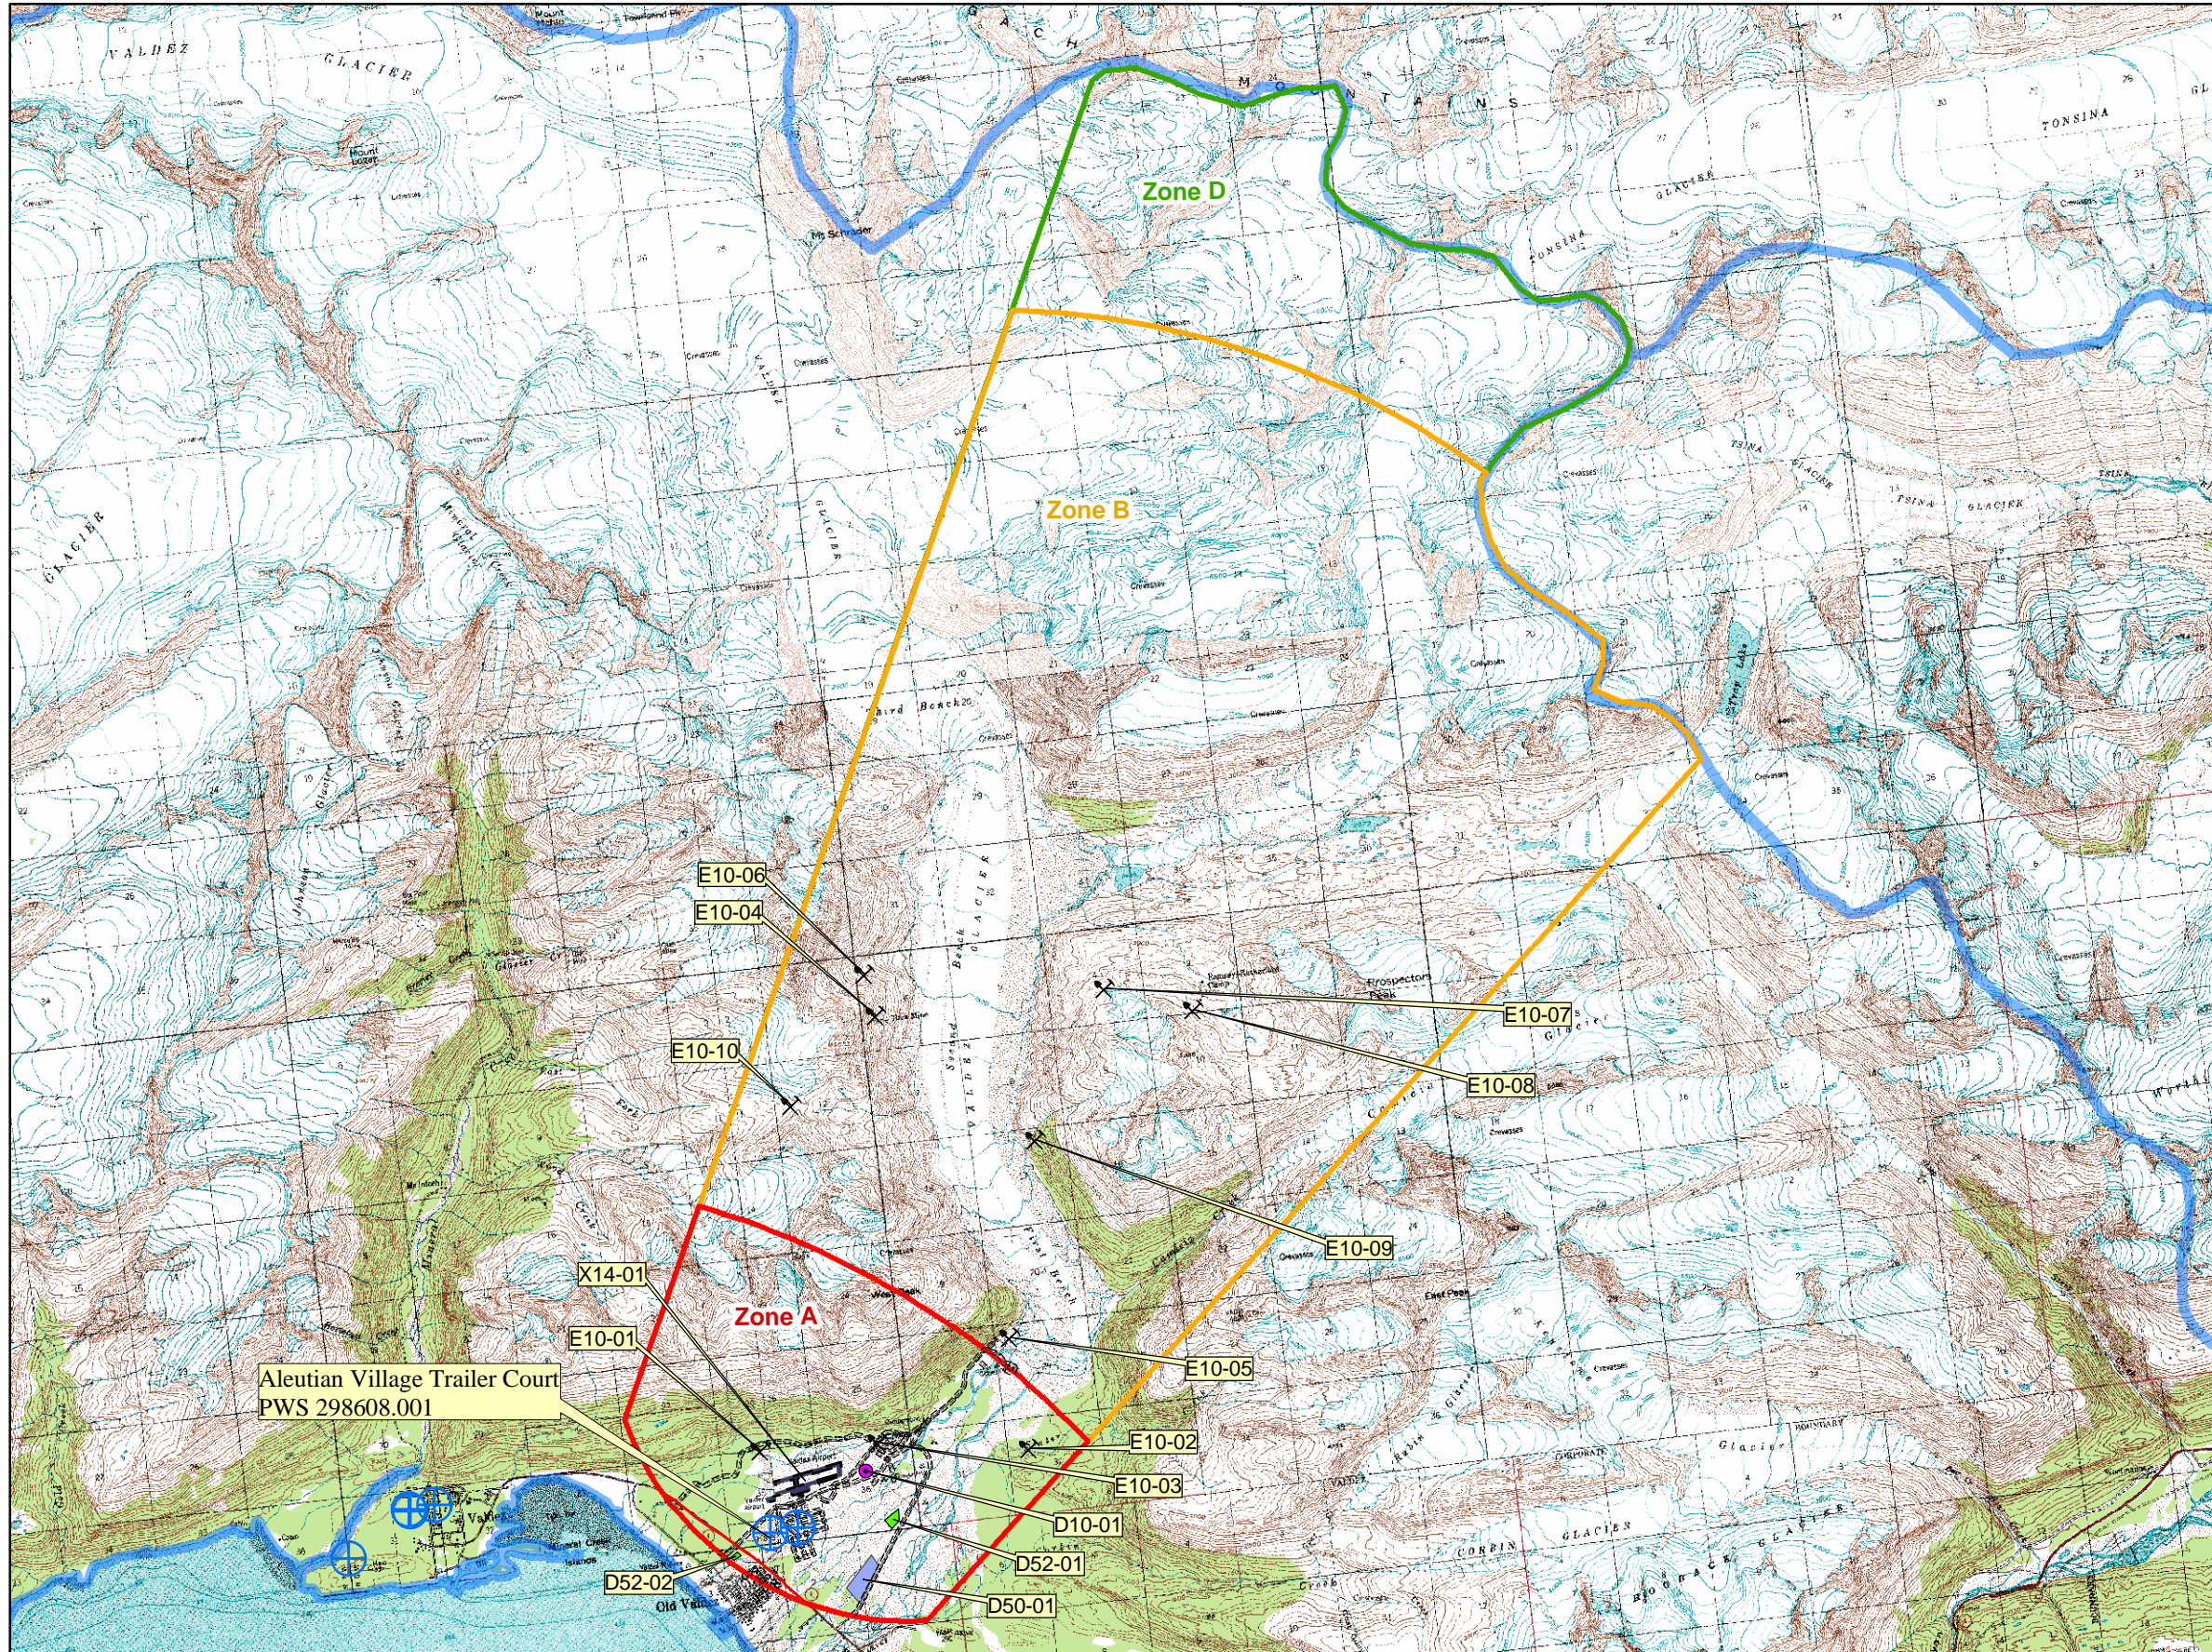

LEGEND

- ⊕ Public Water System Well

Hydrography/Physical

- ▭ Parcels
- ~ Stream
- ▭ Lake or Pond
- ~ Contours
- ~ Watershed Boundary

Transportation

- Primary Route (Class 1)
- - - Secondary Route (Class 2)
- Road (Class 3)
- ⋯ Road (Class 4)
- ⋯ Road (Class 5, Four-wheel drive)

Protection Zones

- ▭ Zone A Protection Area— Several Months Travel Time
- ▭ Zone B Protection Area— 2 Years Travel Time
- ▭ Zone D Protection Area— 10 Years Travel Time or Watershed Boundary

Existing or Potential Contaminant Sources

- ⊗ Other mines or Quarries (E10)
- ⊙ Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method) (D10)
- ▭ Landfills (municipal; Class II) (D50)
- ▭ Landfills (industrial) (D52)
- ▭ Airport or landing strip (X14)

Data Sources:

- Contaminant Sources, Public Water System Wells, Contours Alaska Department of Environmental Conservation (ADEC)
- Critical Facilities, Federal Emergency Management Agency (FEMA)

All other data:

- United States Geological Survey (USGS)
- Drinking Water Protection Areas based on "Alaska Drinking Water Protection Program - Guidance Manual for Class A Public Water Systems" published by ADEC

URS Corporation does not guarantee the accuracy or validity of the data provided.

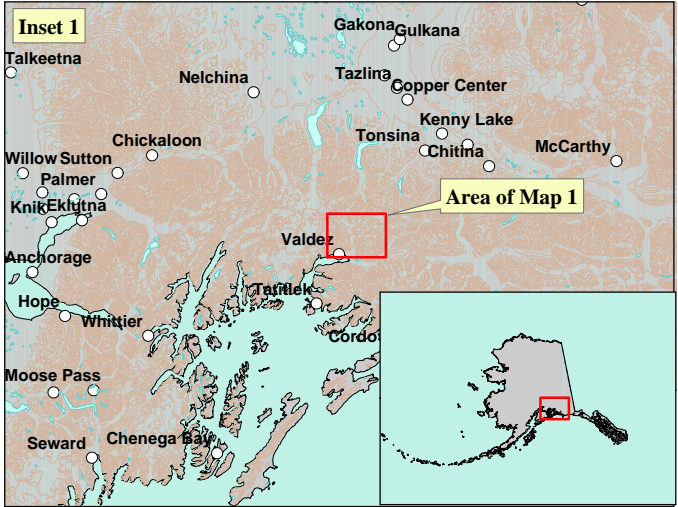


Chart 1. Susceptibility of the wellhead - Aleutian Village Trailer Court (PWS No. 298608.001)

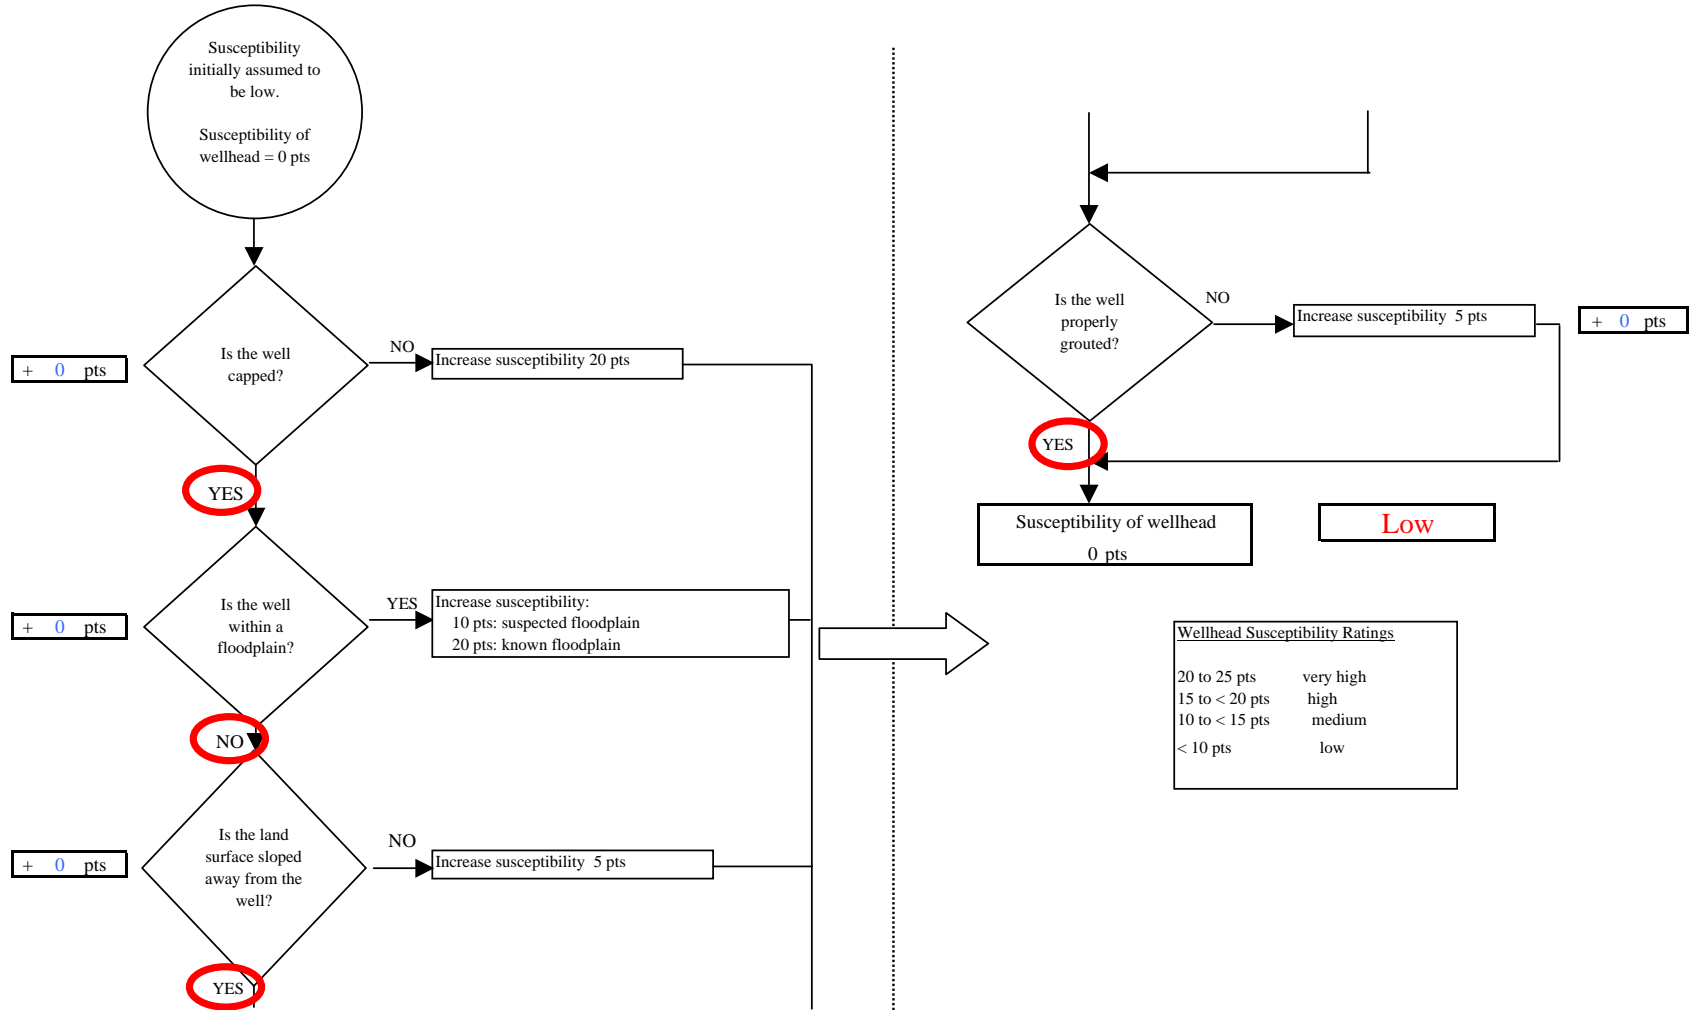


Chart 2. Susceptibility of the aquifer Aleutian Village Trailer Court (PWS No. 298608.001)

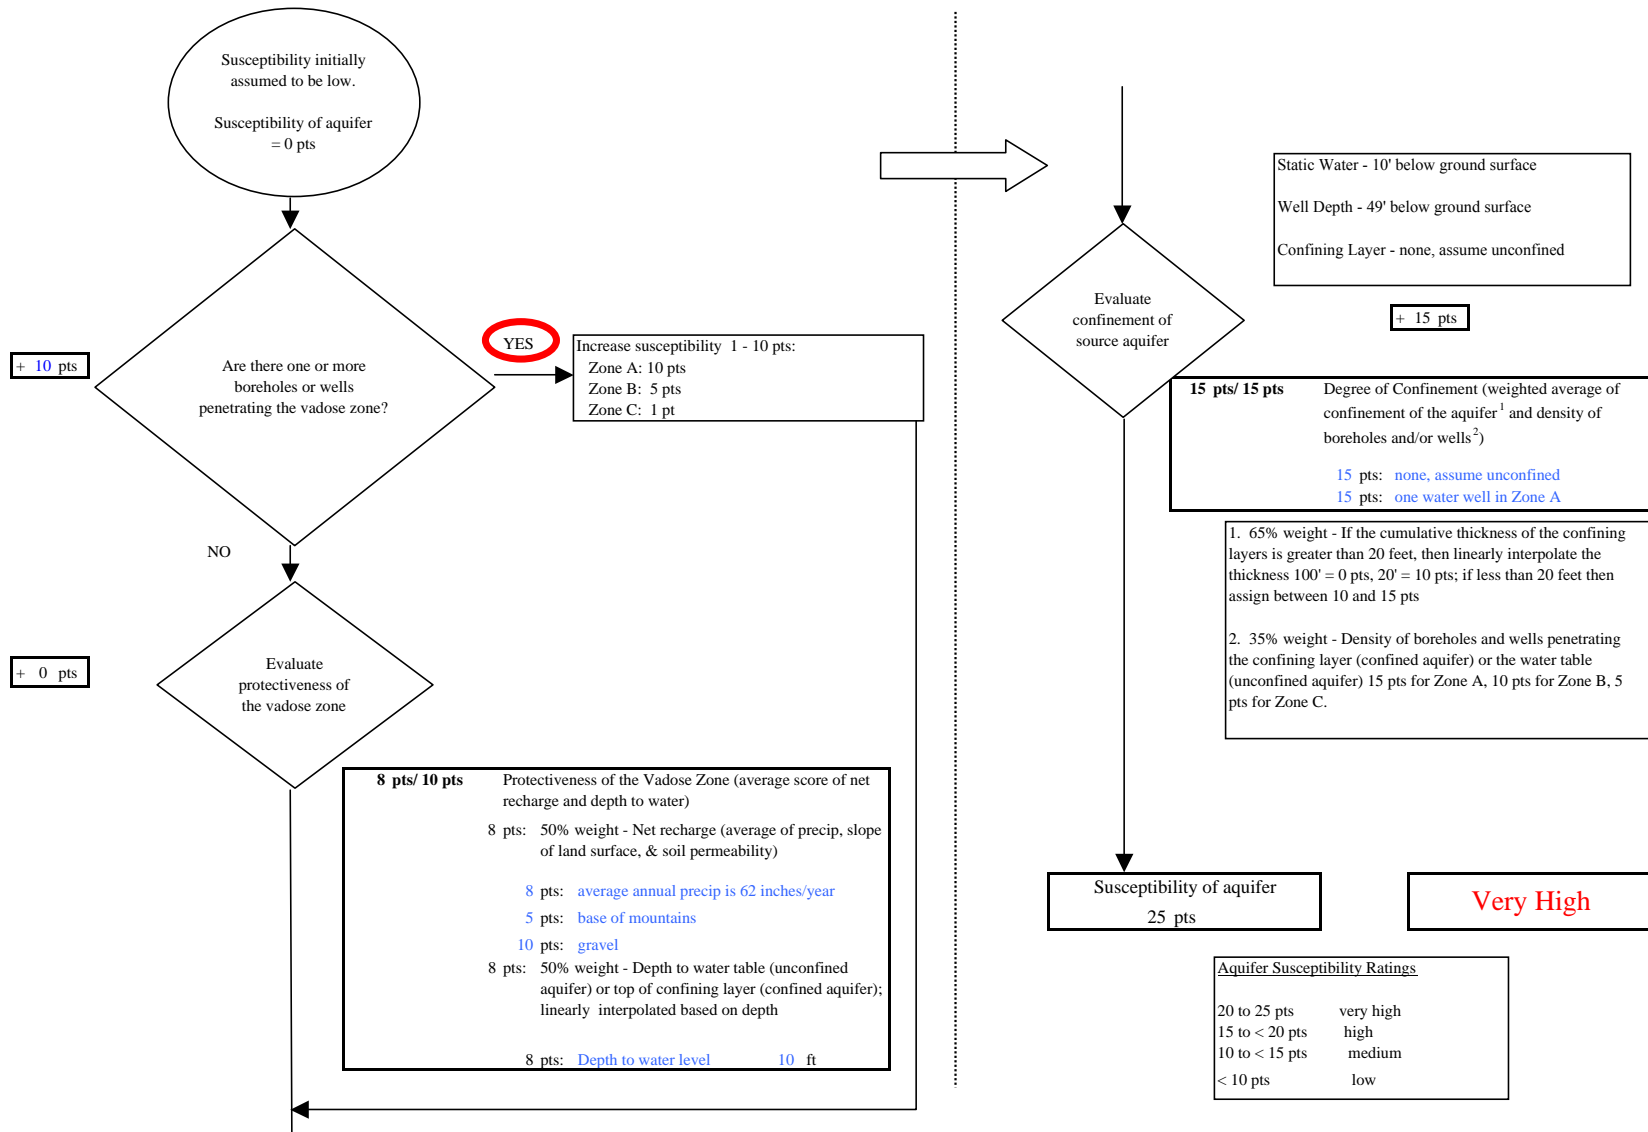


Chart 3. Contaminant risks for Aleutian Village Trailer Court (PWS No. 298608.001) - Bacteria & Viruses

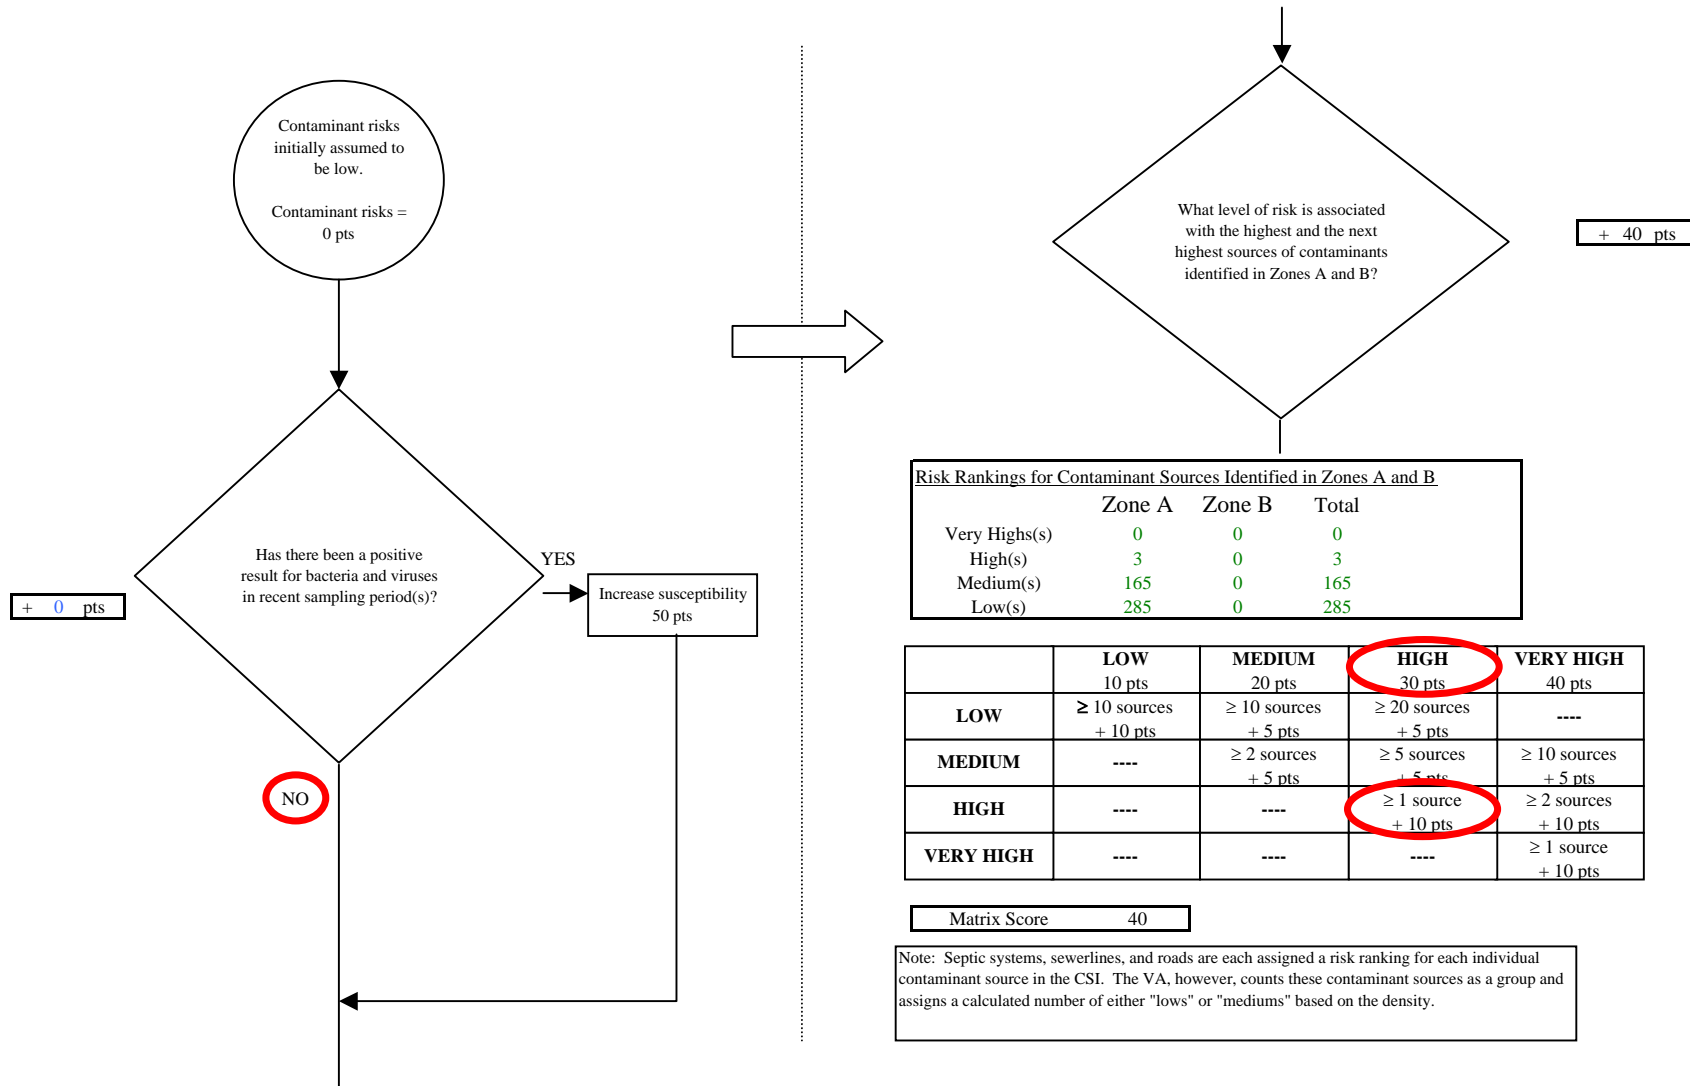


Chart 3. Contaminant risks for Aleutian Village Trailer Court (PWS No. 298608.001) - Bacteria & Viruses

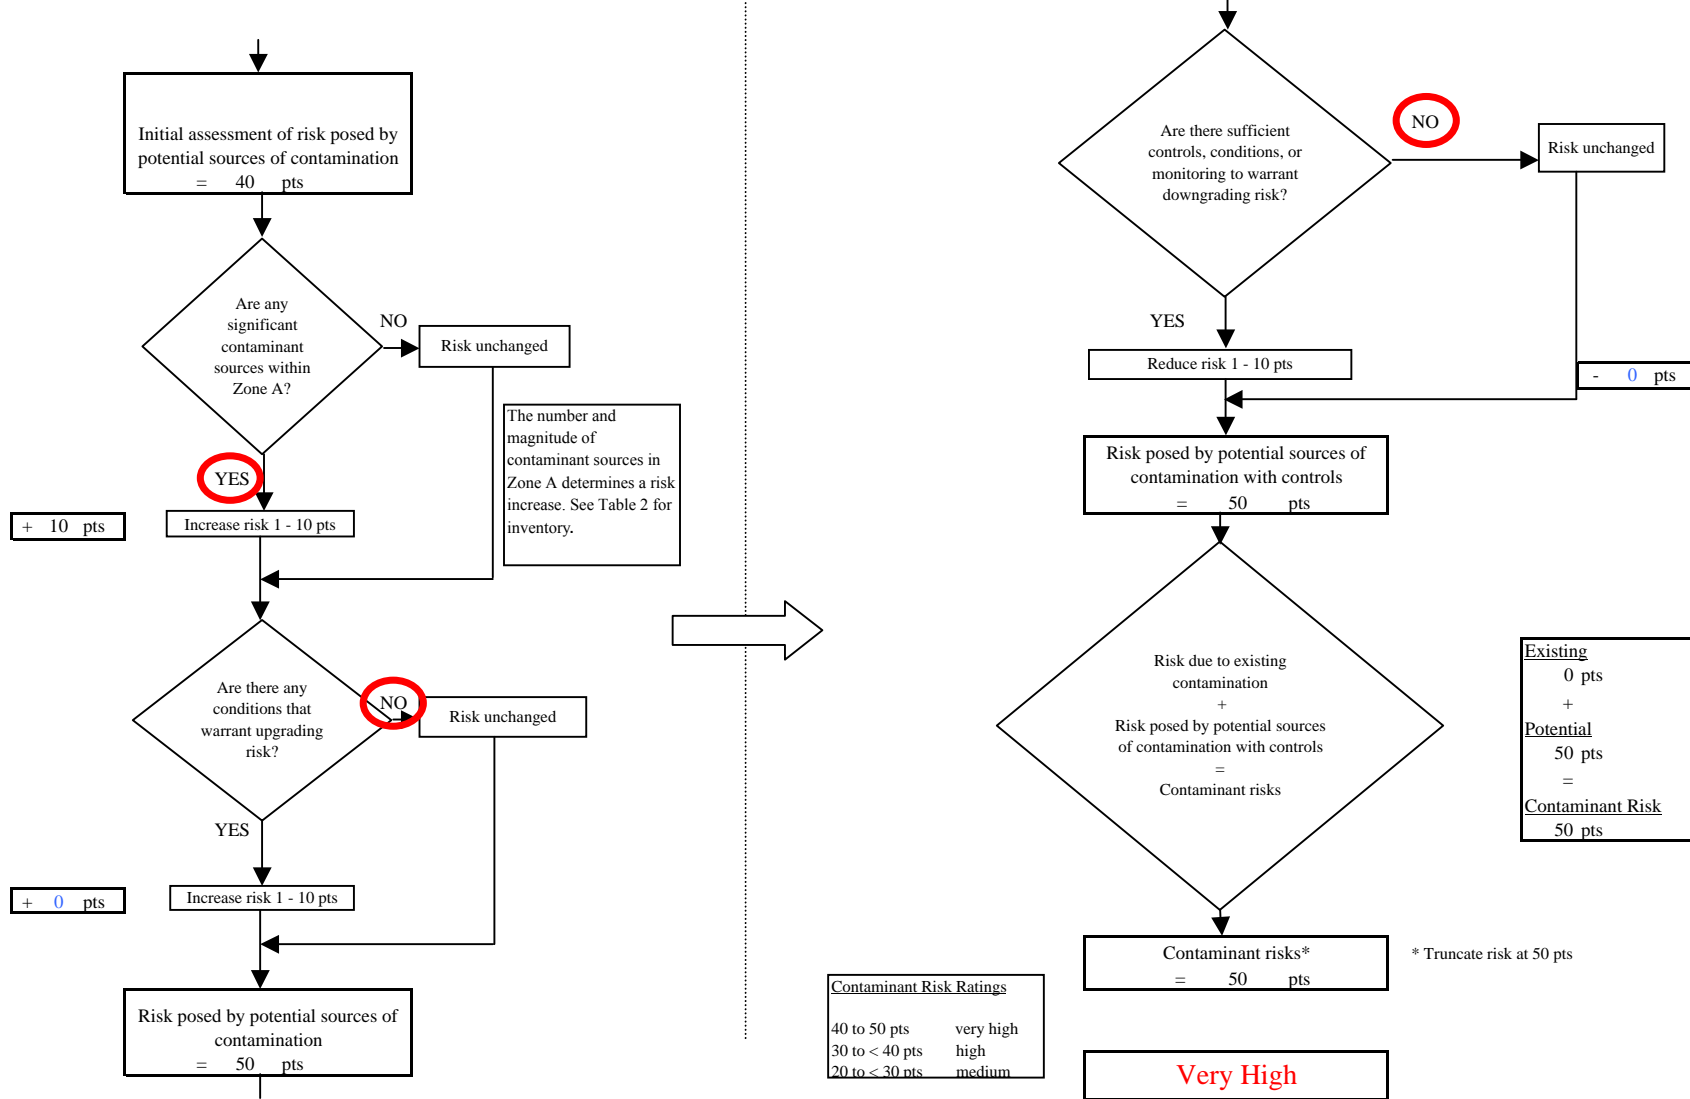


Chart 4. Vulnerability analysis for Aleutian Village Trailer Court (PWS No. 298608.001) - Bacteria & Viruses

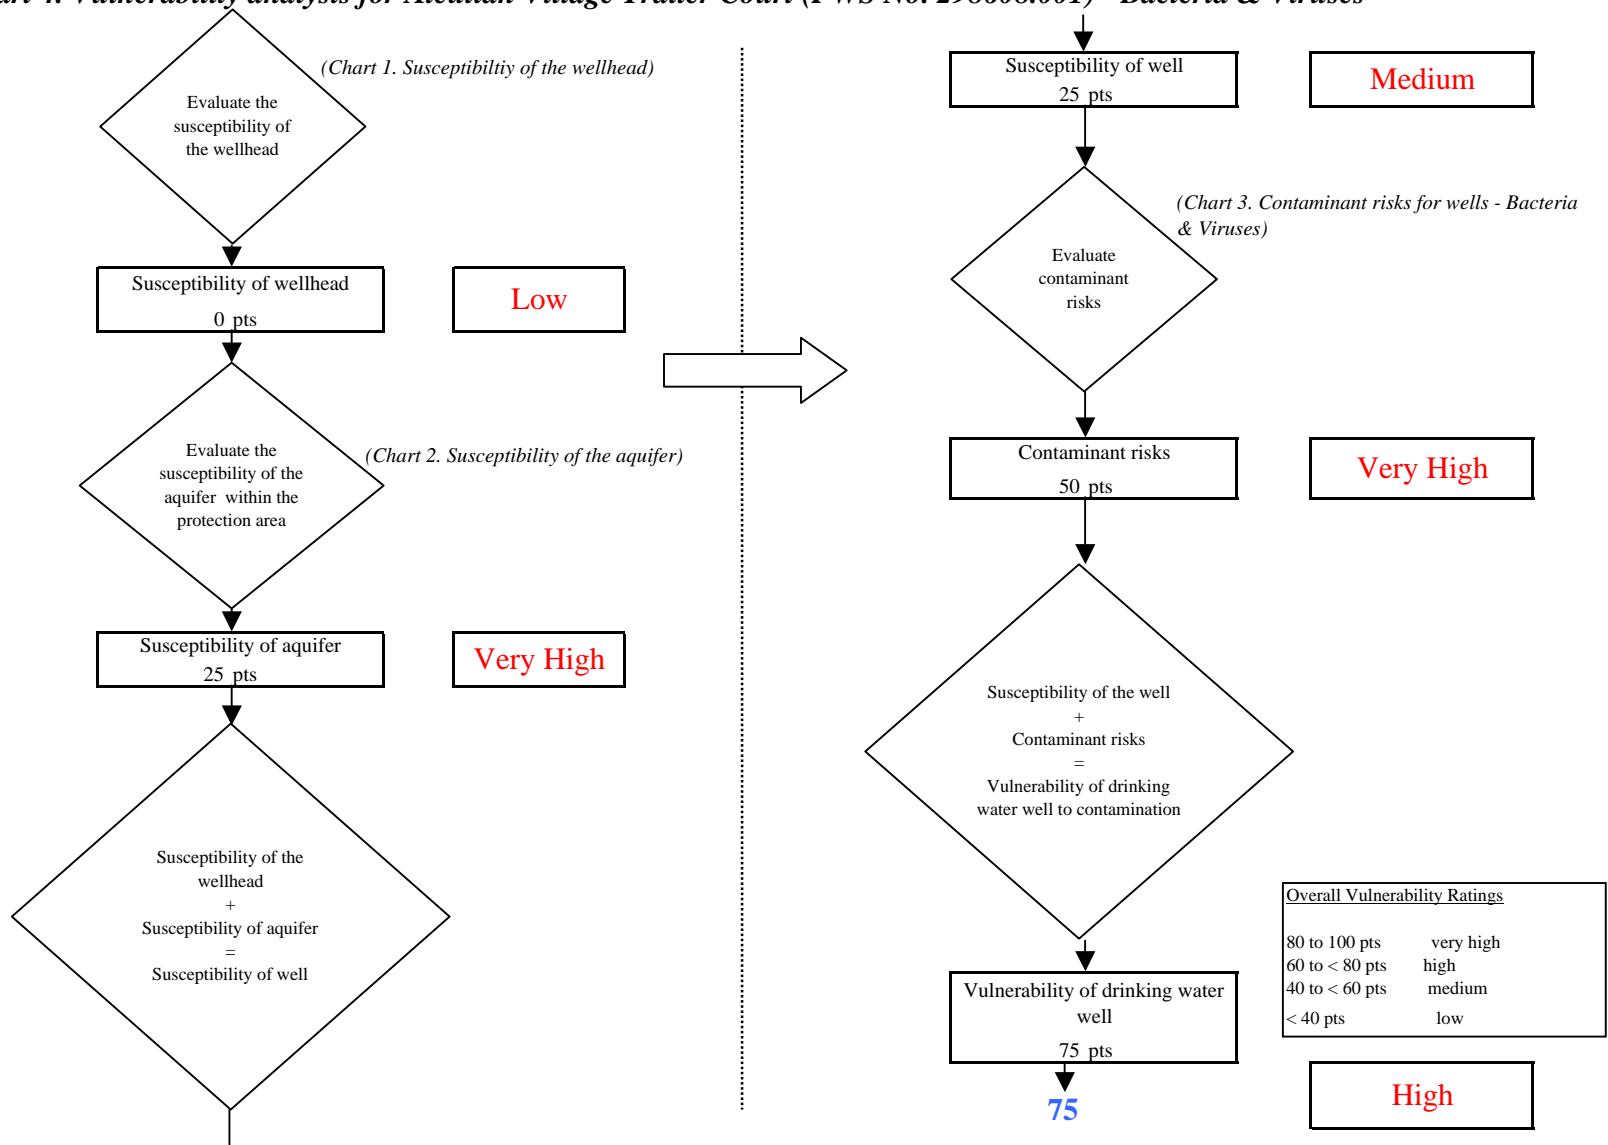


Chart 5. Contaminant risks for Aleutian Village Trailer Court (PWS No. 298608.001) - Nitrates and Nitrites

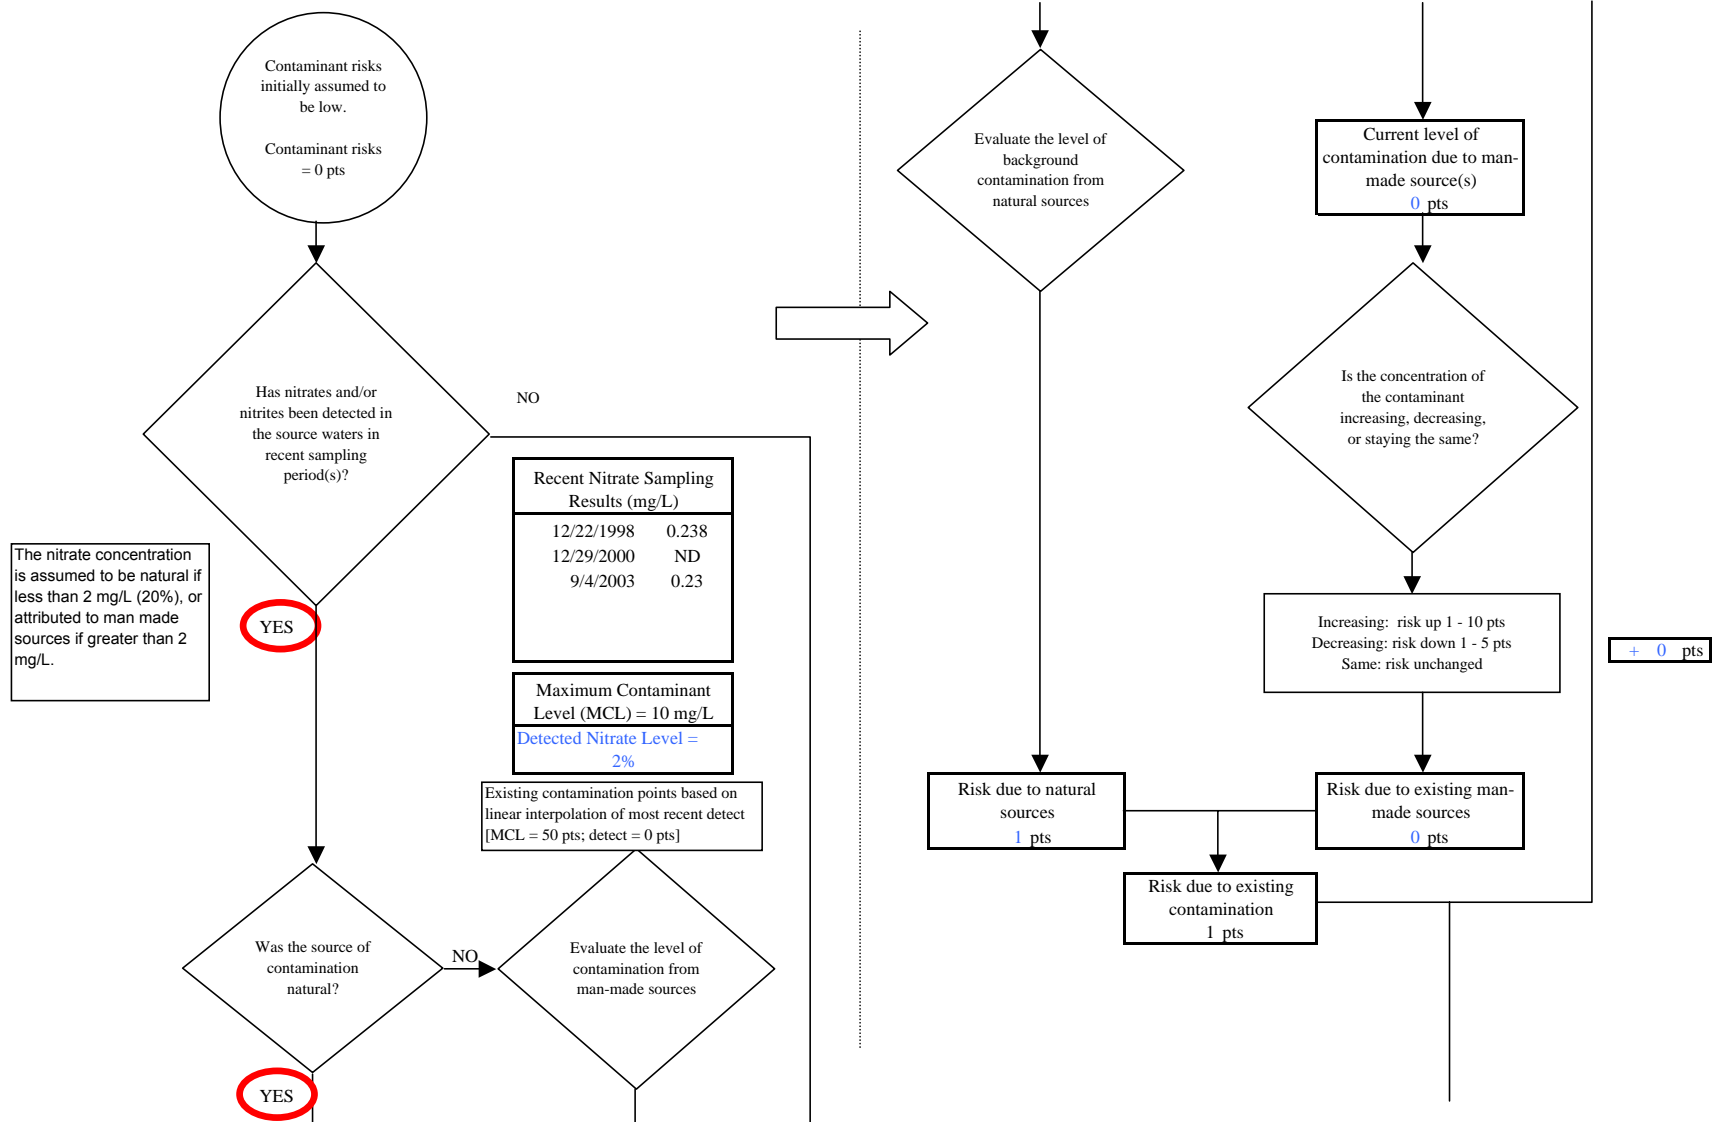


Chart 5. Contaminant risks for Aleutian Village Trailer Court (PWS No. 298608.001) - Nitrates and Nitrites

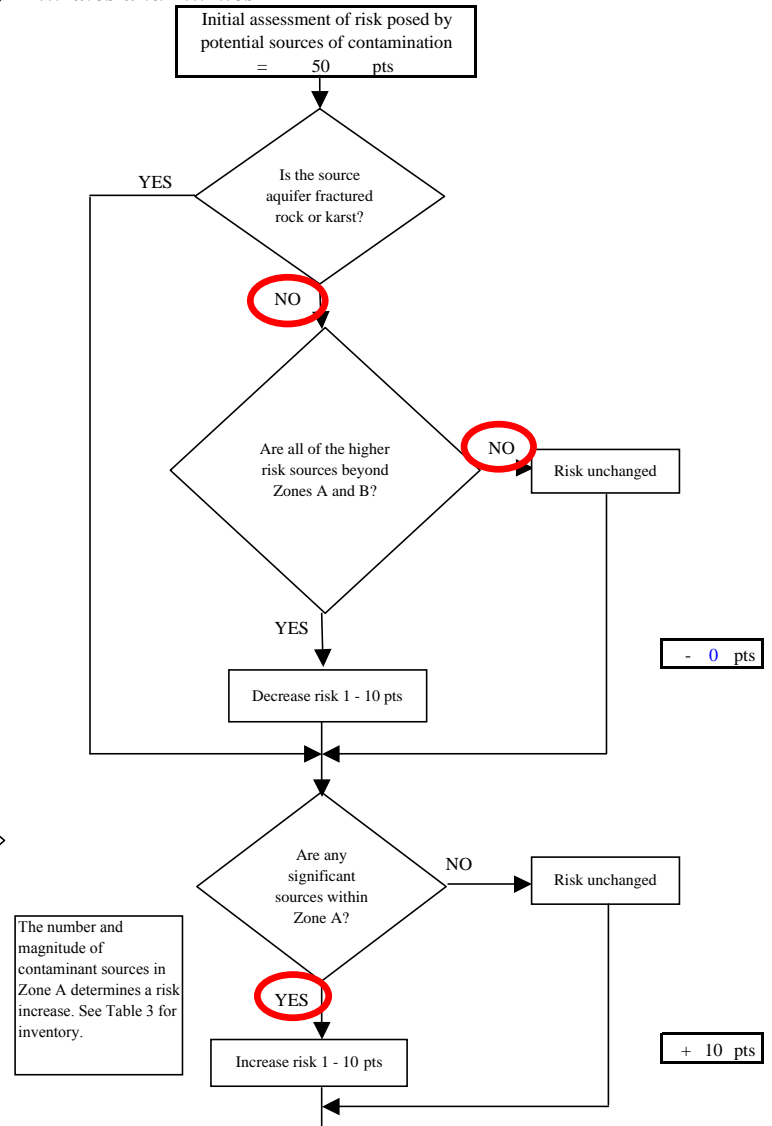

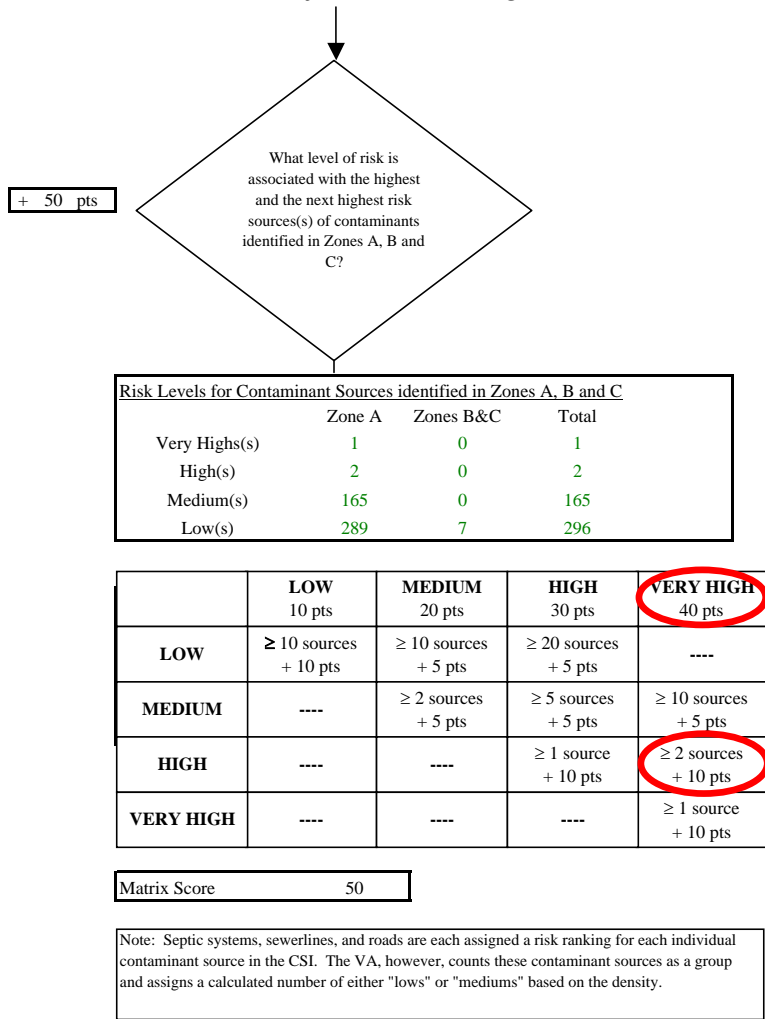


Chart 5. Contaminant risks for Aleutian Village Trailer Court (PWS No. 298608.001) - Nitrates and Nitrites

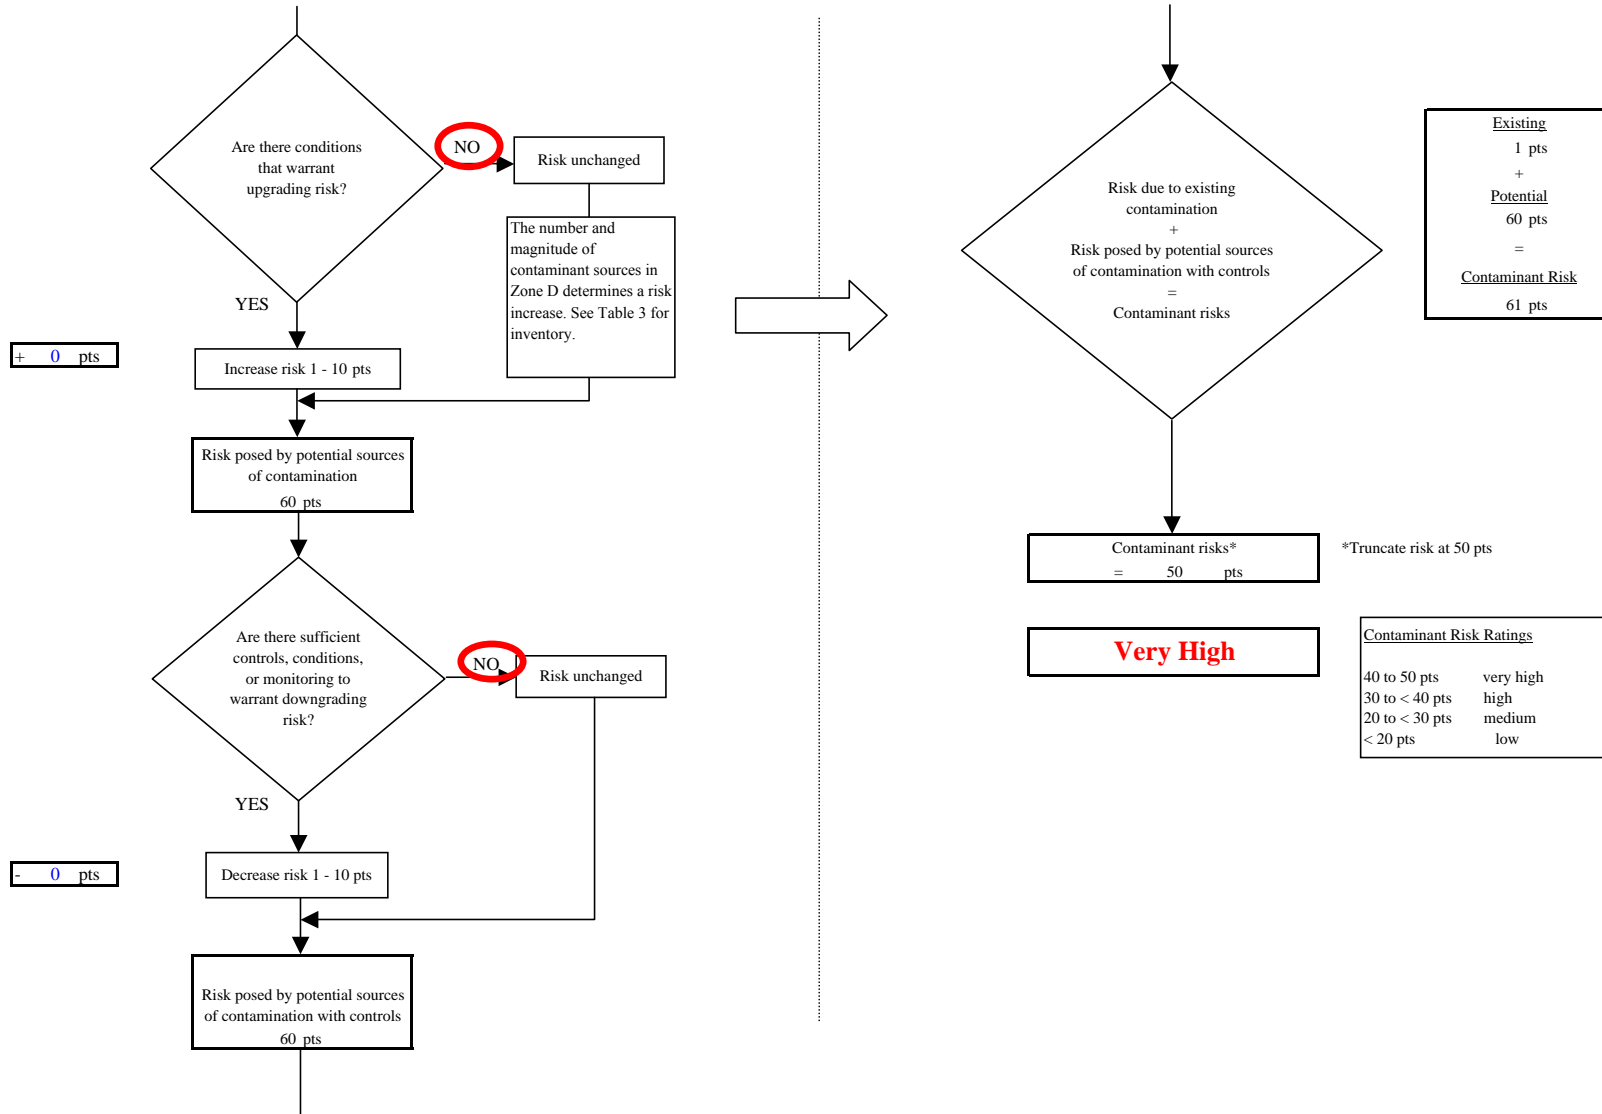


Chart 6. Vulnerability analysis for Aleutian Village Trailer Court (PWS No. 298608.001) - Nitrates and Nitrites

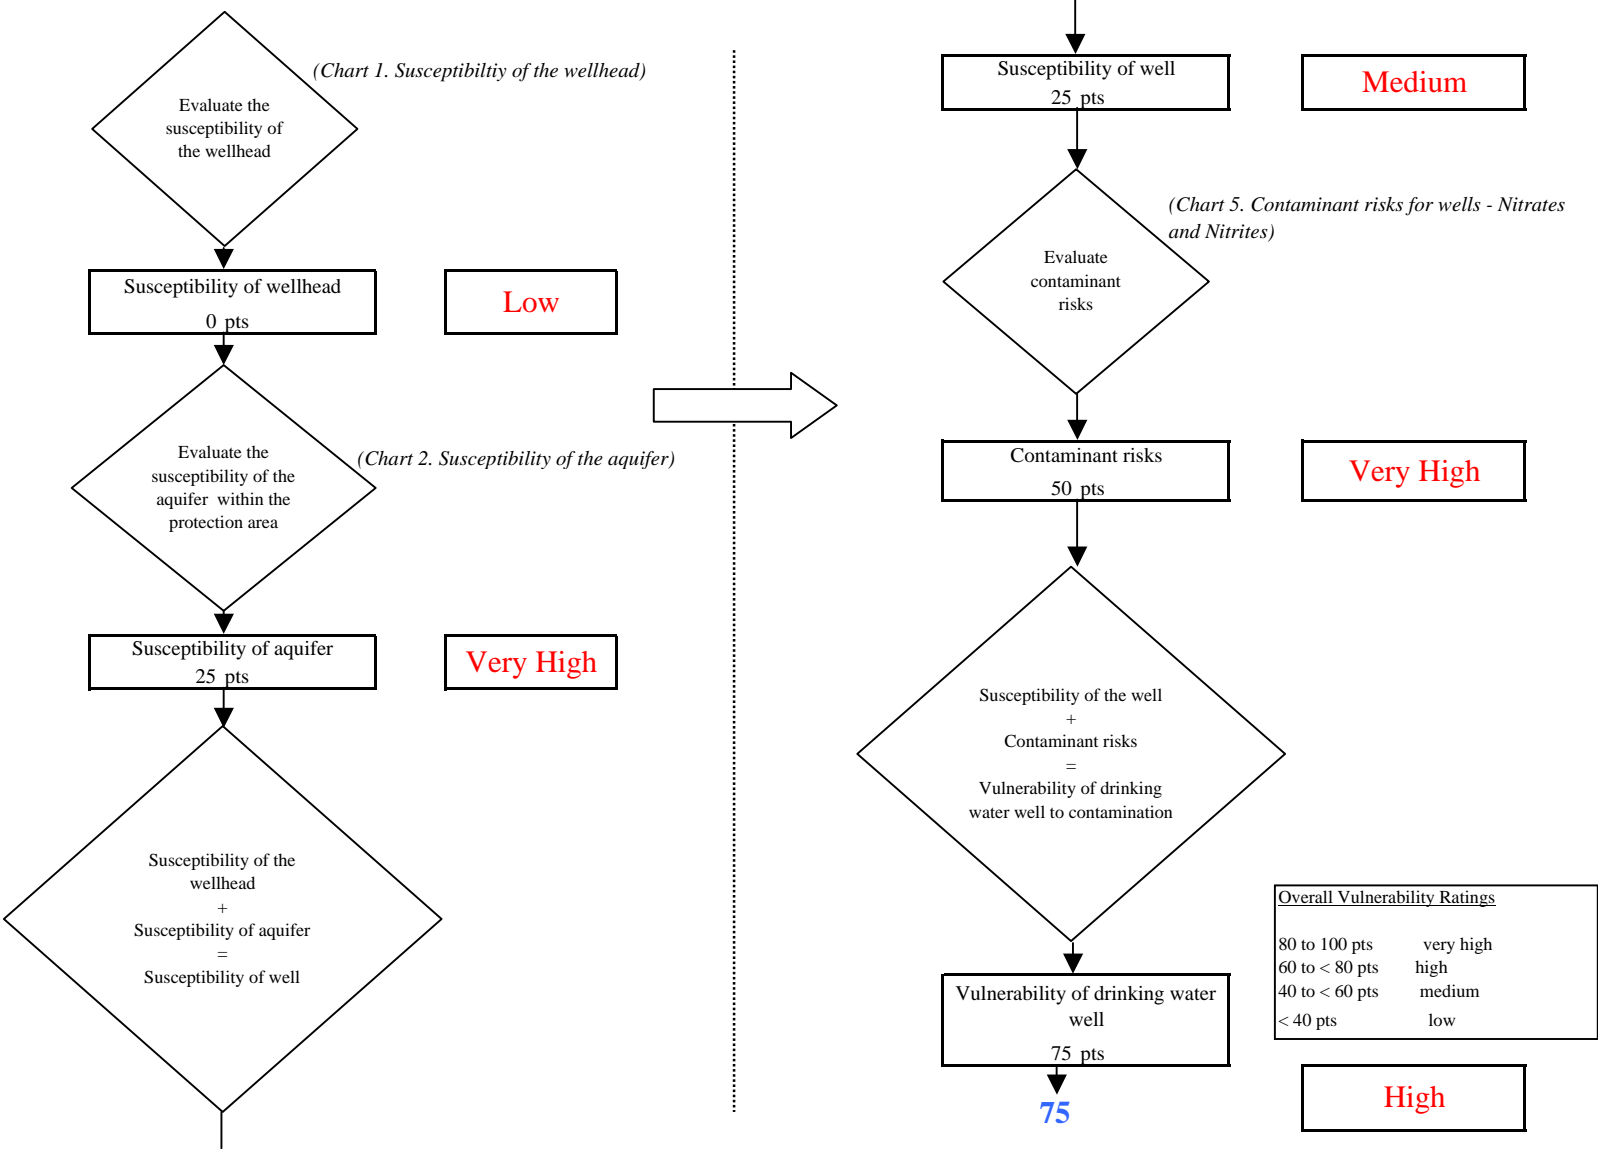


Chart 7. Contaminant risks for Aleutian Village Trailer Court (PWS No. 298608.001) - Volatile Organic Chemicals

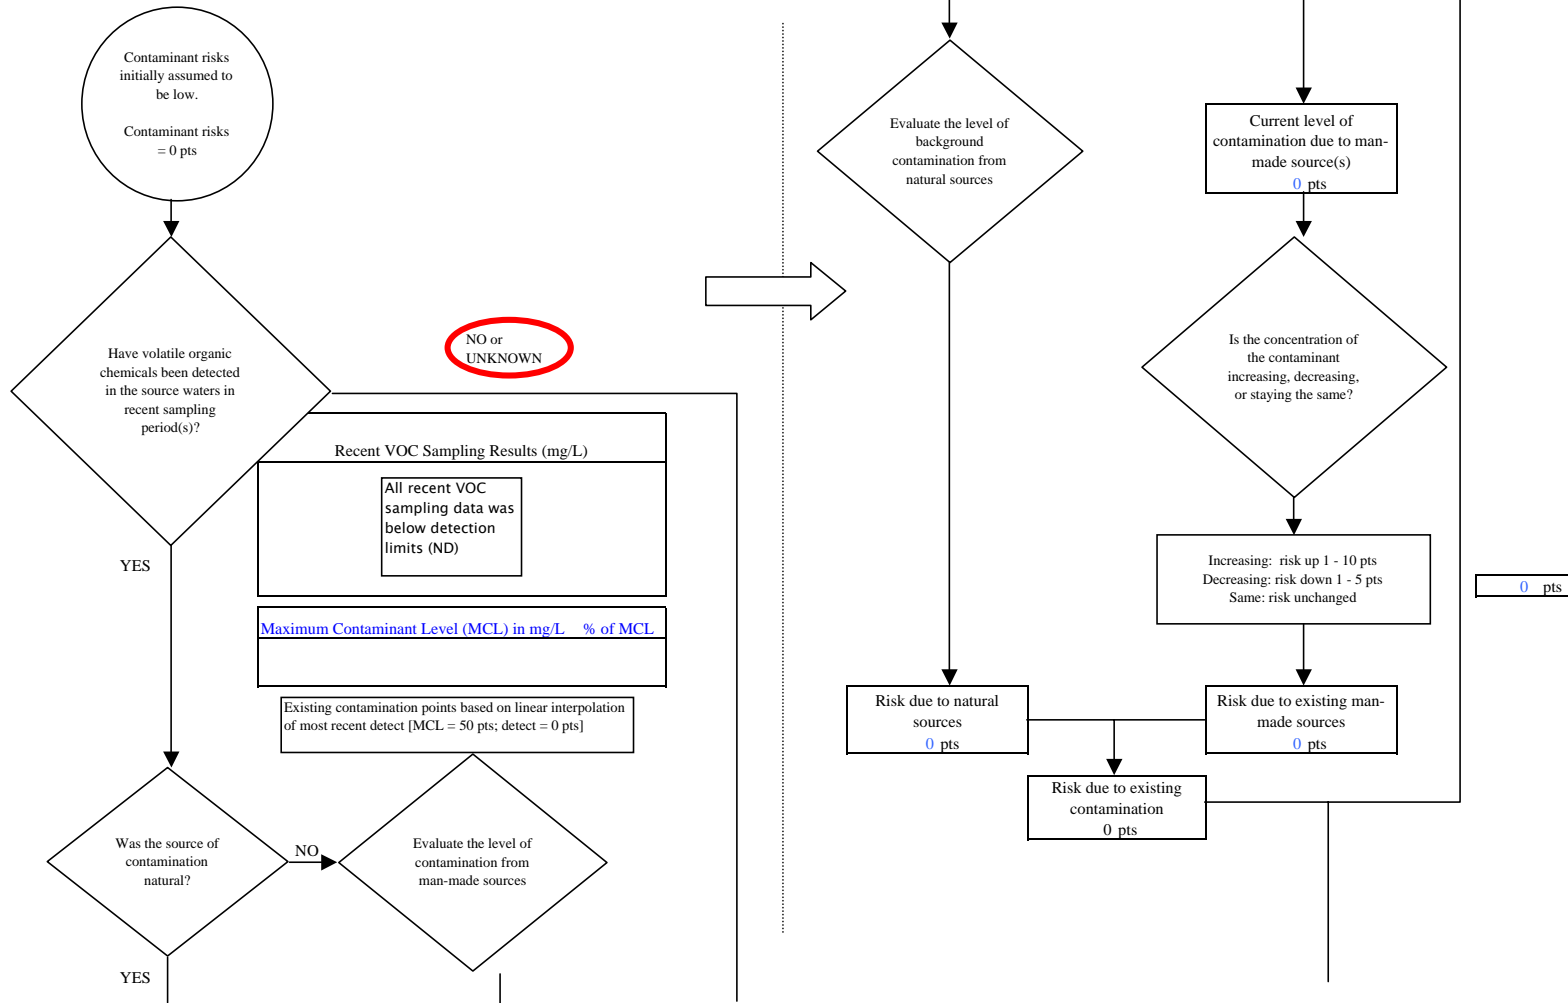


Chart 7. Contaminant risks for Aleutian Village Trailer Court (PWS No. 298608.001) - Volatile Organic Chemicals

↓

+ 40 pts

What level of risk is associated with the highest and the next highest risk sources(s) of contaminants identified in Zones A, B and C?

	Zone A	Zones B&C	Total
Very High(s)	0	0	0
High(s)	2	0	2
Medium(s)	1144	0	1144
Low(s)	141	7	148

	LOW 10 pts	MEDIUM 20 pts	HIGH 30 pts	VERY HIGH 40 pts
LOW	≥ 10 sources + 10 pts	≥ 10 sources + 5 pts	≥ 20 sources + 5 pts	----
MEDIUM	----	≥ 2 sources + 5 pts	≥ 5 sources + 5 pts	≥ 10 sources + 5 pts
HIGH	----	----	≥ 1 source + 10 pts	≥ 2 sources + 10 pts
VERY HIGH	----	----	----	≥ 1 source + 10 pts

Matrix Score 40

Note: Septic systems, sewerlines, and roads are each assigned a risk ranking for each individual contaminant source in the CSI. The VA, however, counts these contaminant sources as a group and assigns a calculated number of either "lows" or "mediums" based on the density.

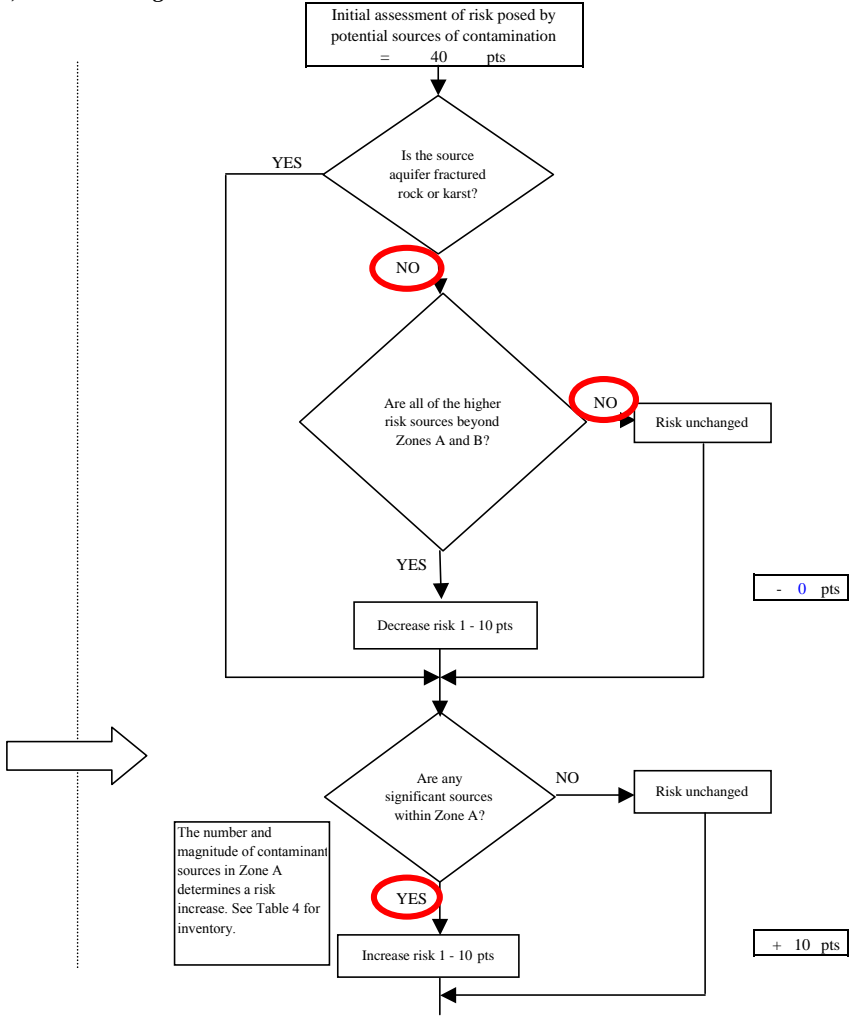


Chart 7. Contaminant risks for Aleutian Village Trailer Court (PWS No. 298608.001) - Volatile Organic Chemicals

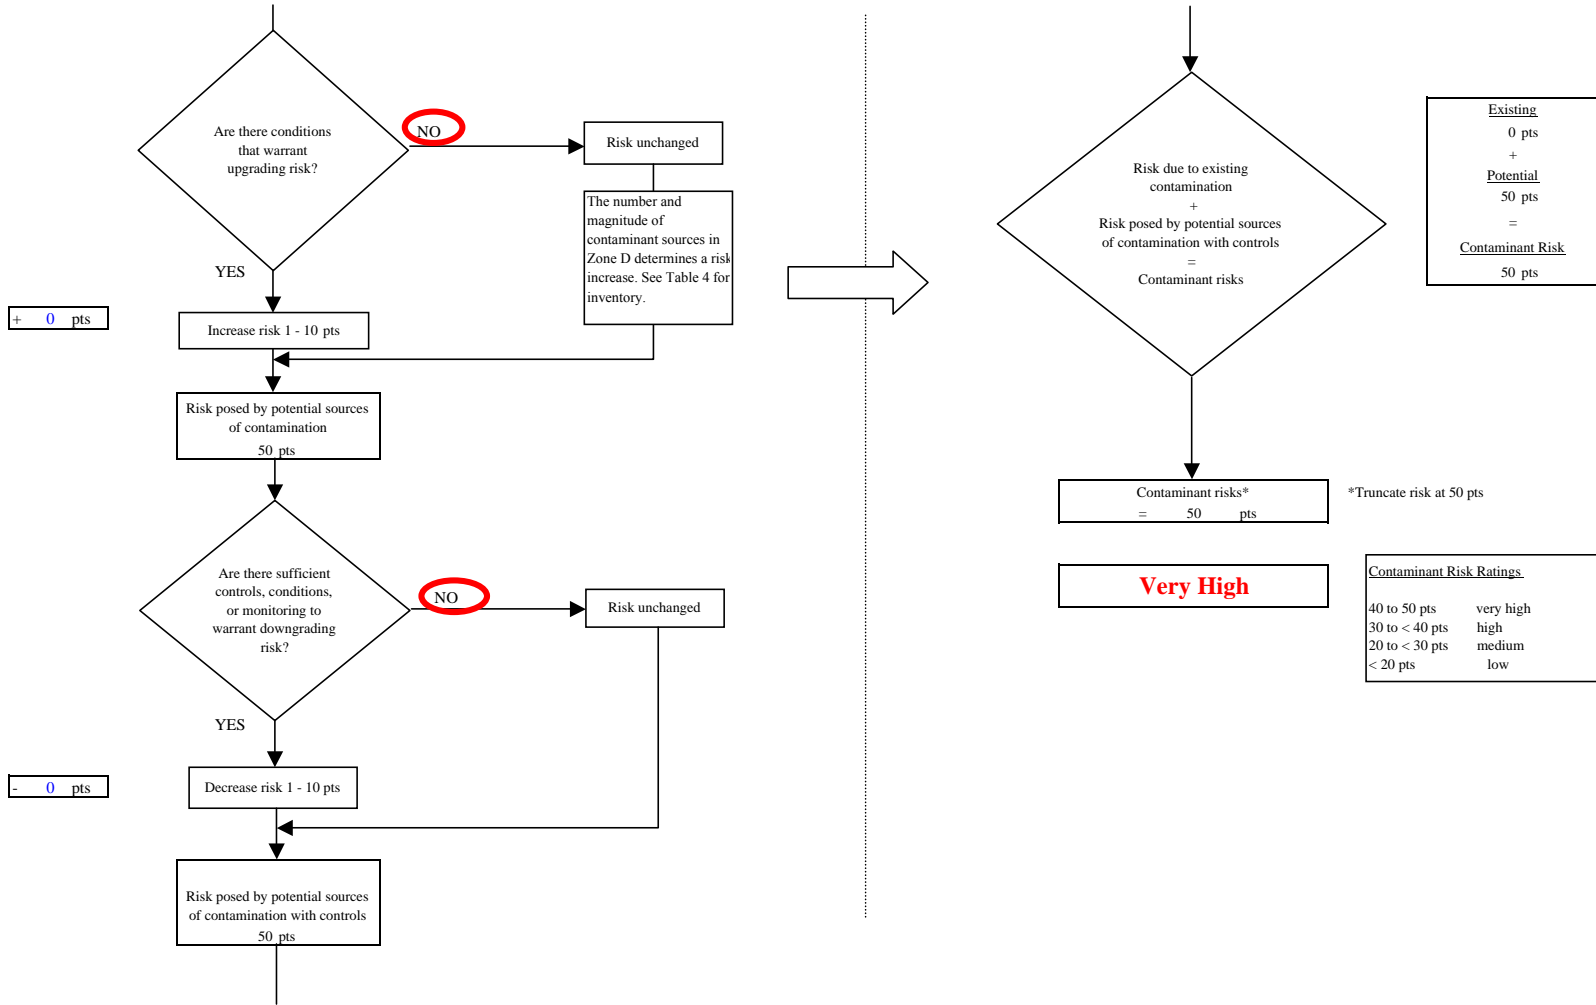


Chart 8. Vulnerability analysis for Aleutian Village Trailer Court (PWS No. 298608.001) - Volatile Organic Chemicals

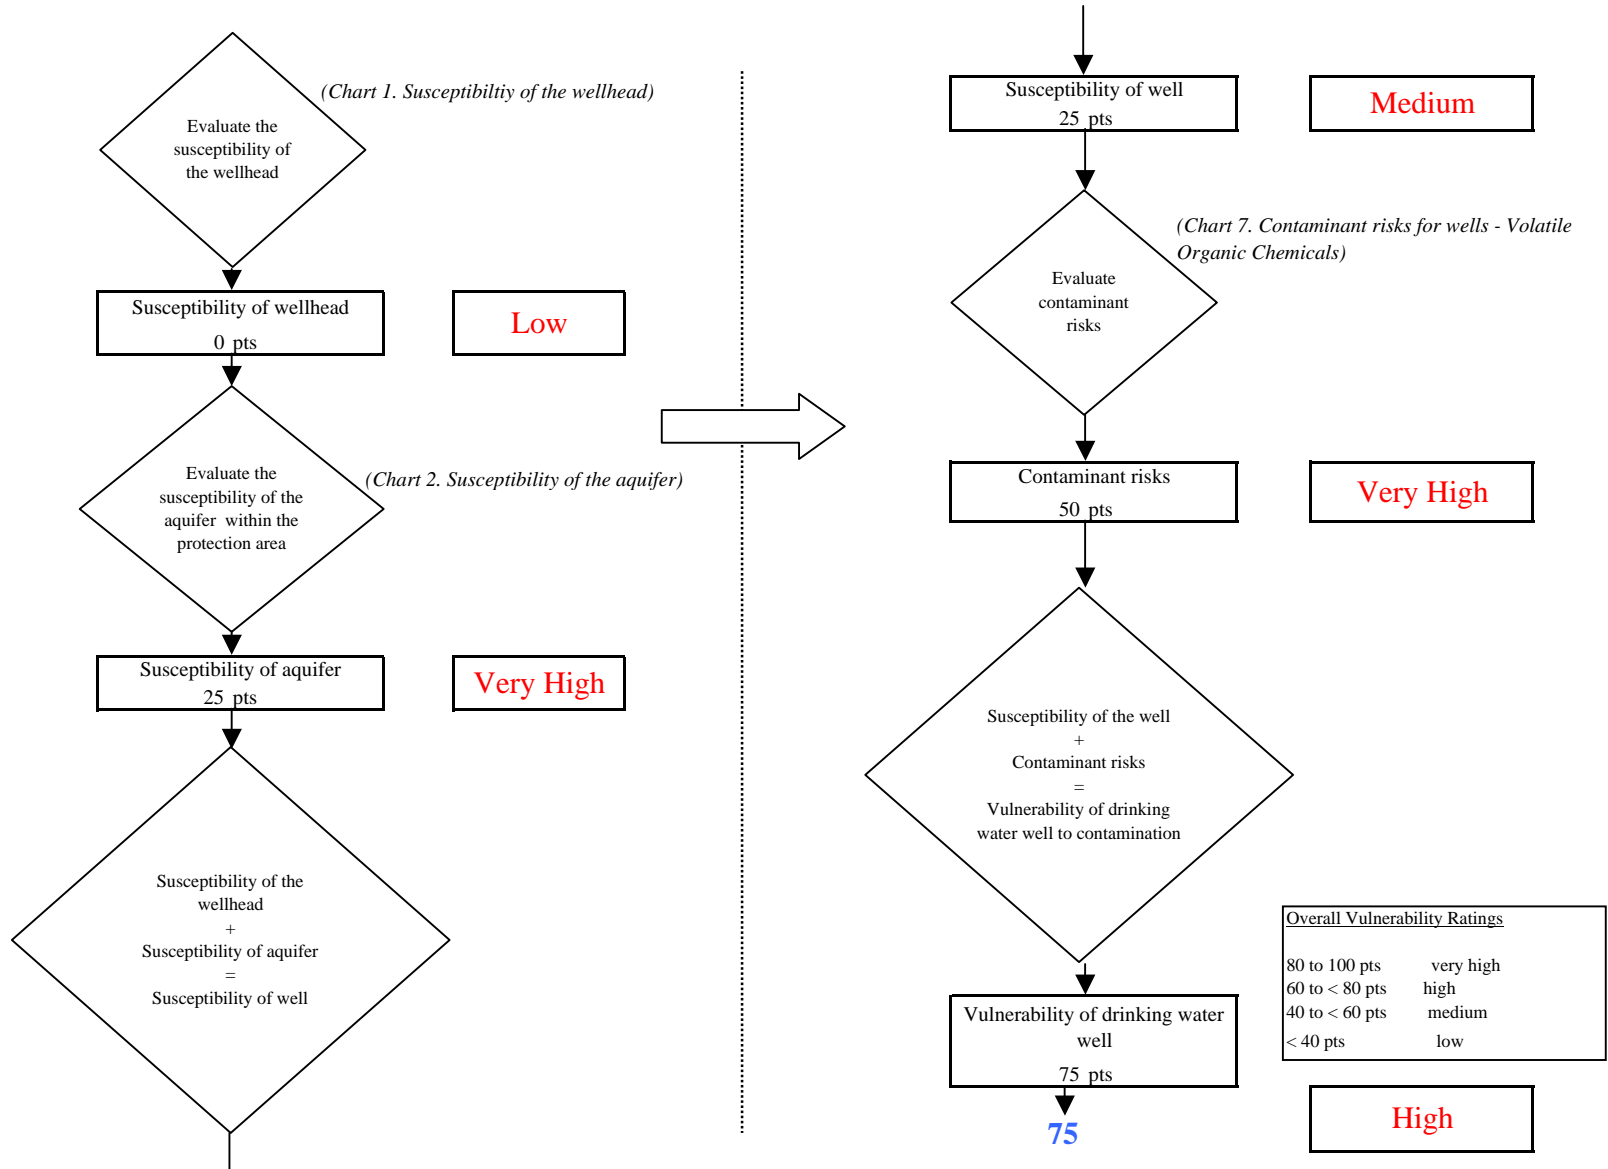


Chart 9. Contaminant risks for Aleutian Village Trailer Court (PWS No. 298608.001) - Heavy Metals, Cyanide and Other Inorganic Chemicals

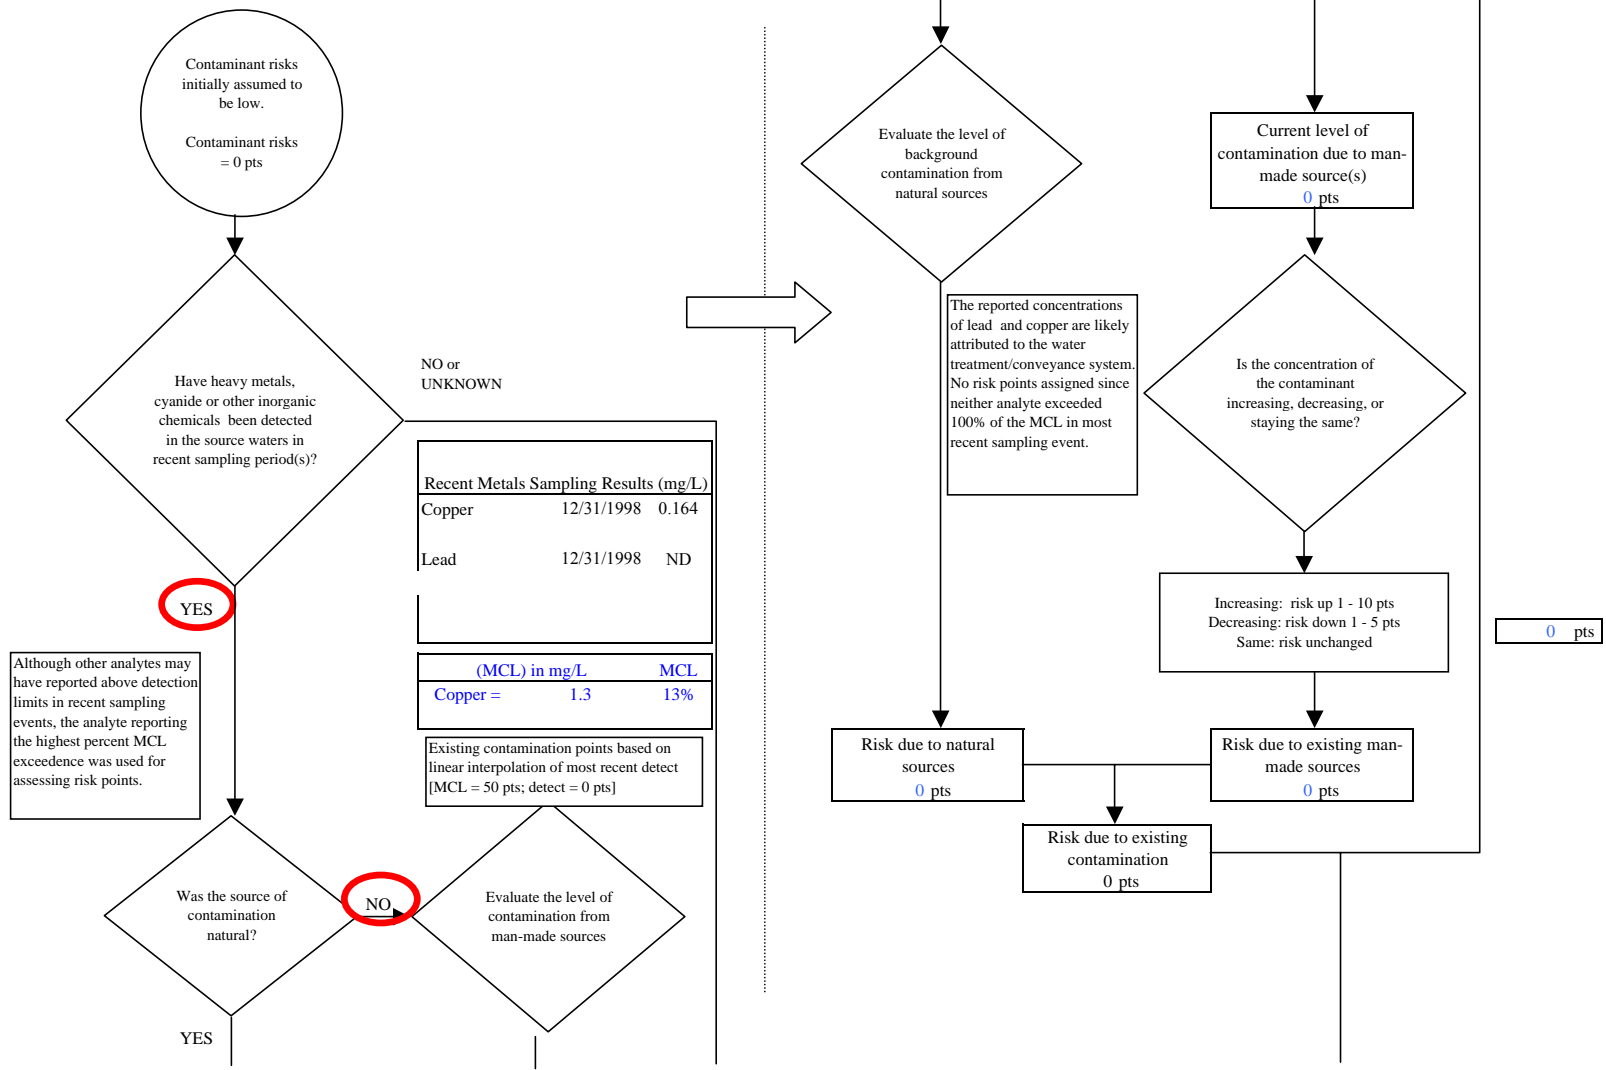


Chart 9. Contaminant risks for Aleutian Village Trailer Court (PWS No. 298608.001) - Heavy Metals, Cyanide and Other Inorganic Chemicals

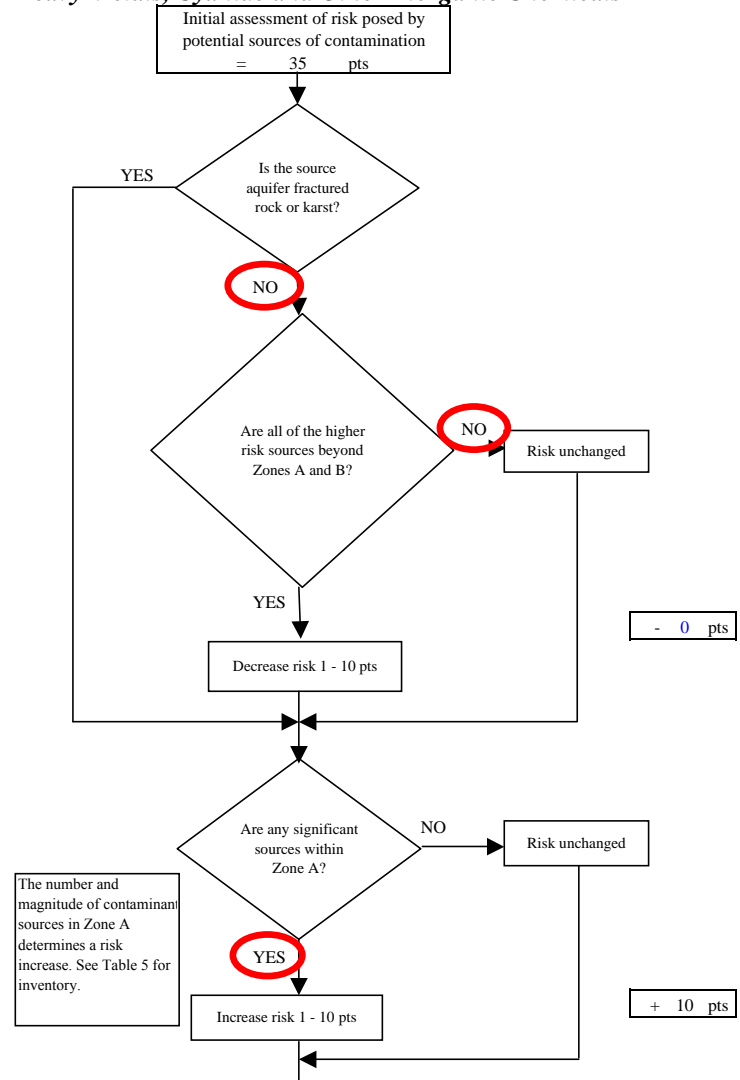
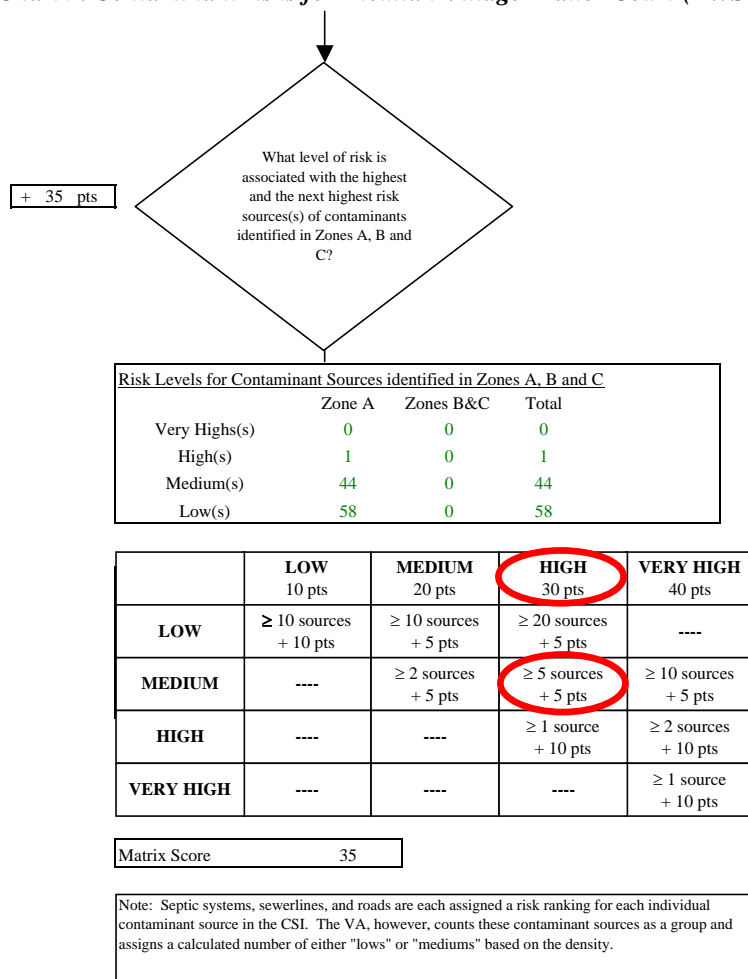


Chart 9. Contaminant risks for Aleutian Village Trailer Court (PWS No. 298608.001) - Heavy Metals, Cyanide and Other Inorganic Chemicals

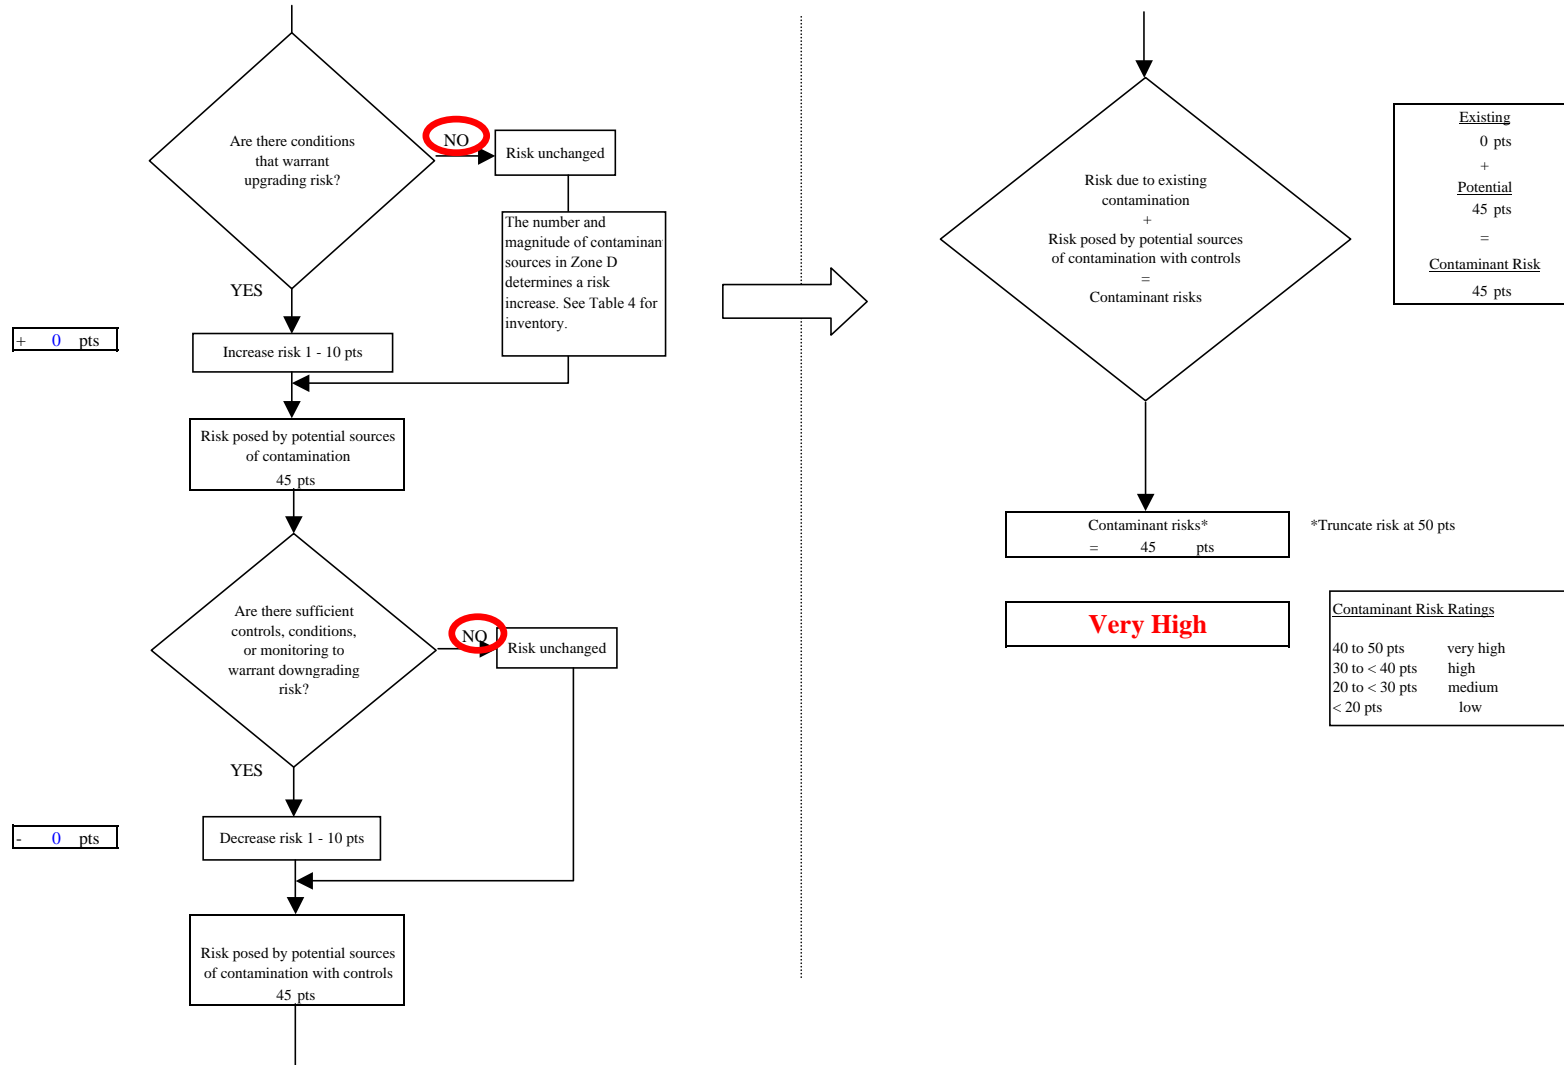


Chart 10. Vulnerability analysis for Aleutian Village Trailer Court (PWS No. 298608.001) - Heavy Metals, Cyanide and Other Inorganic Chem

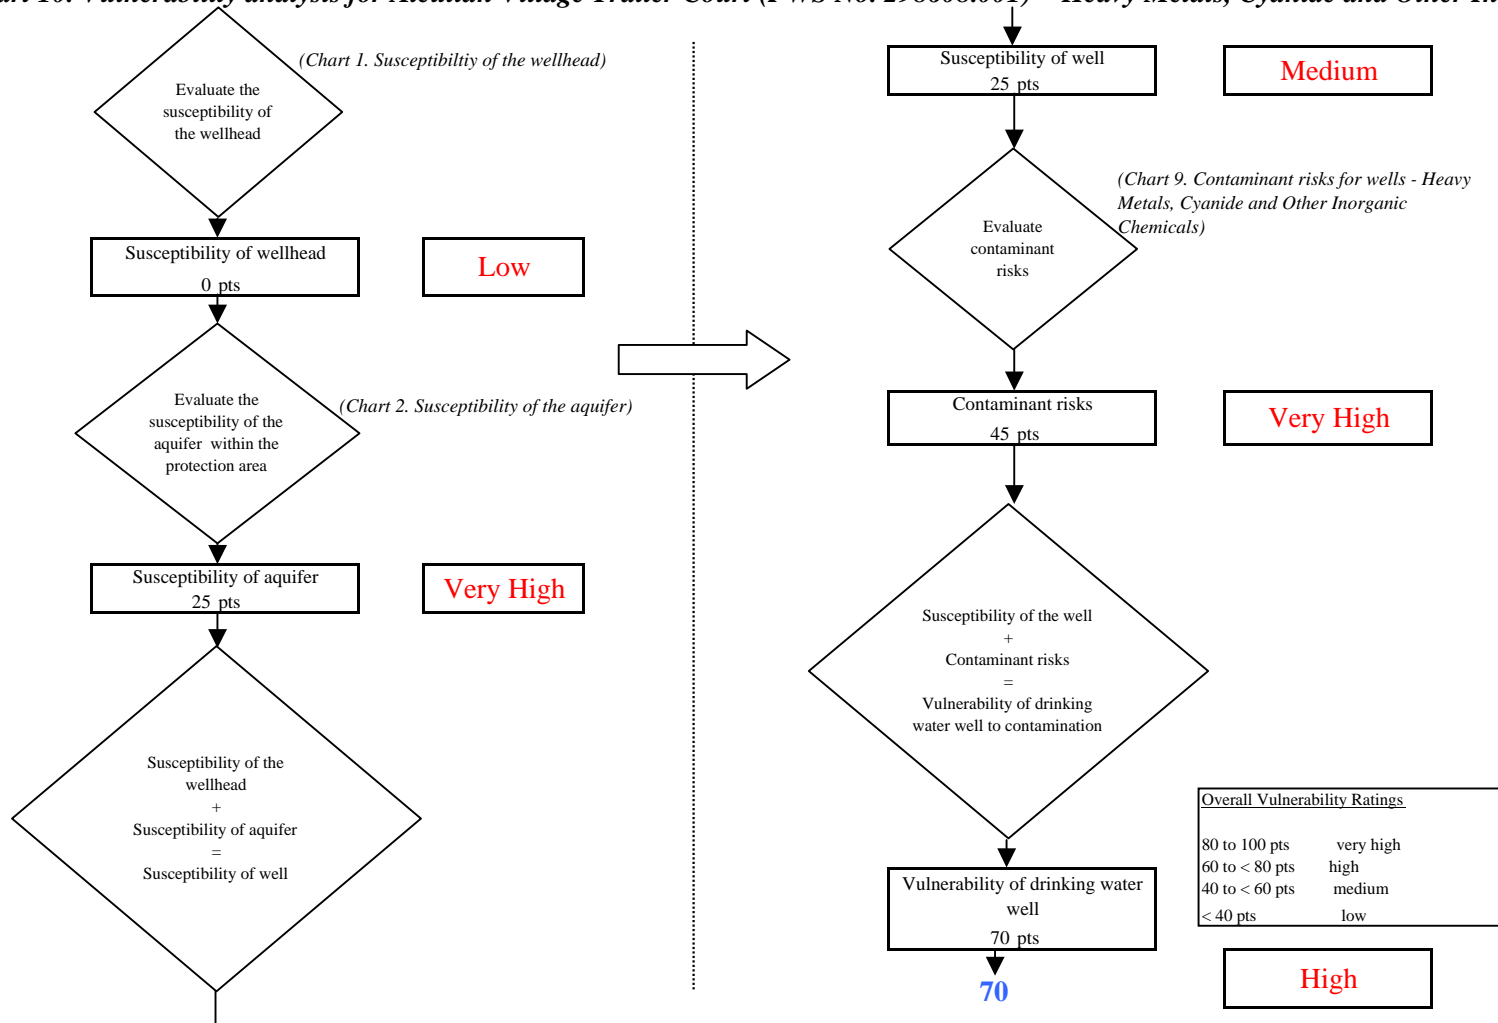


Chart 11. Contaminant risks for Aleutian Village Trailer Court (PWS No. 298608.001) - Synthetic Organic Chemicals

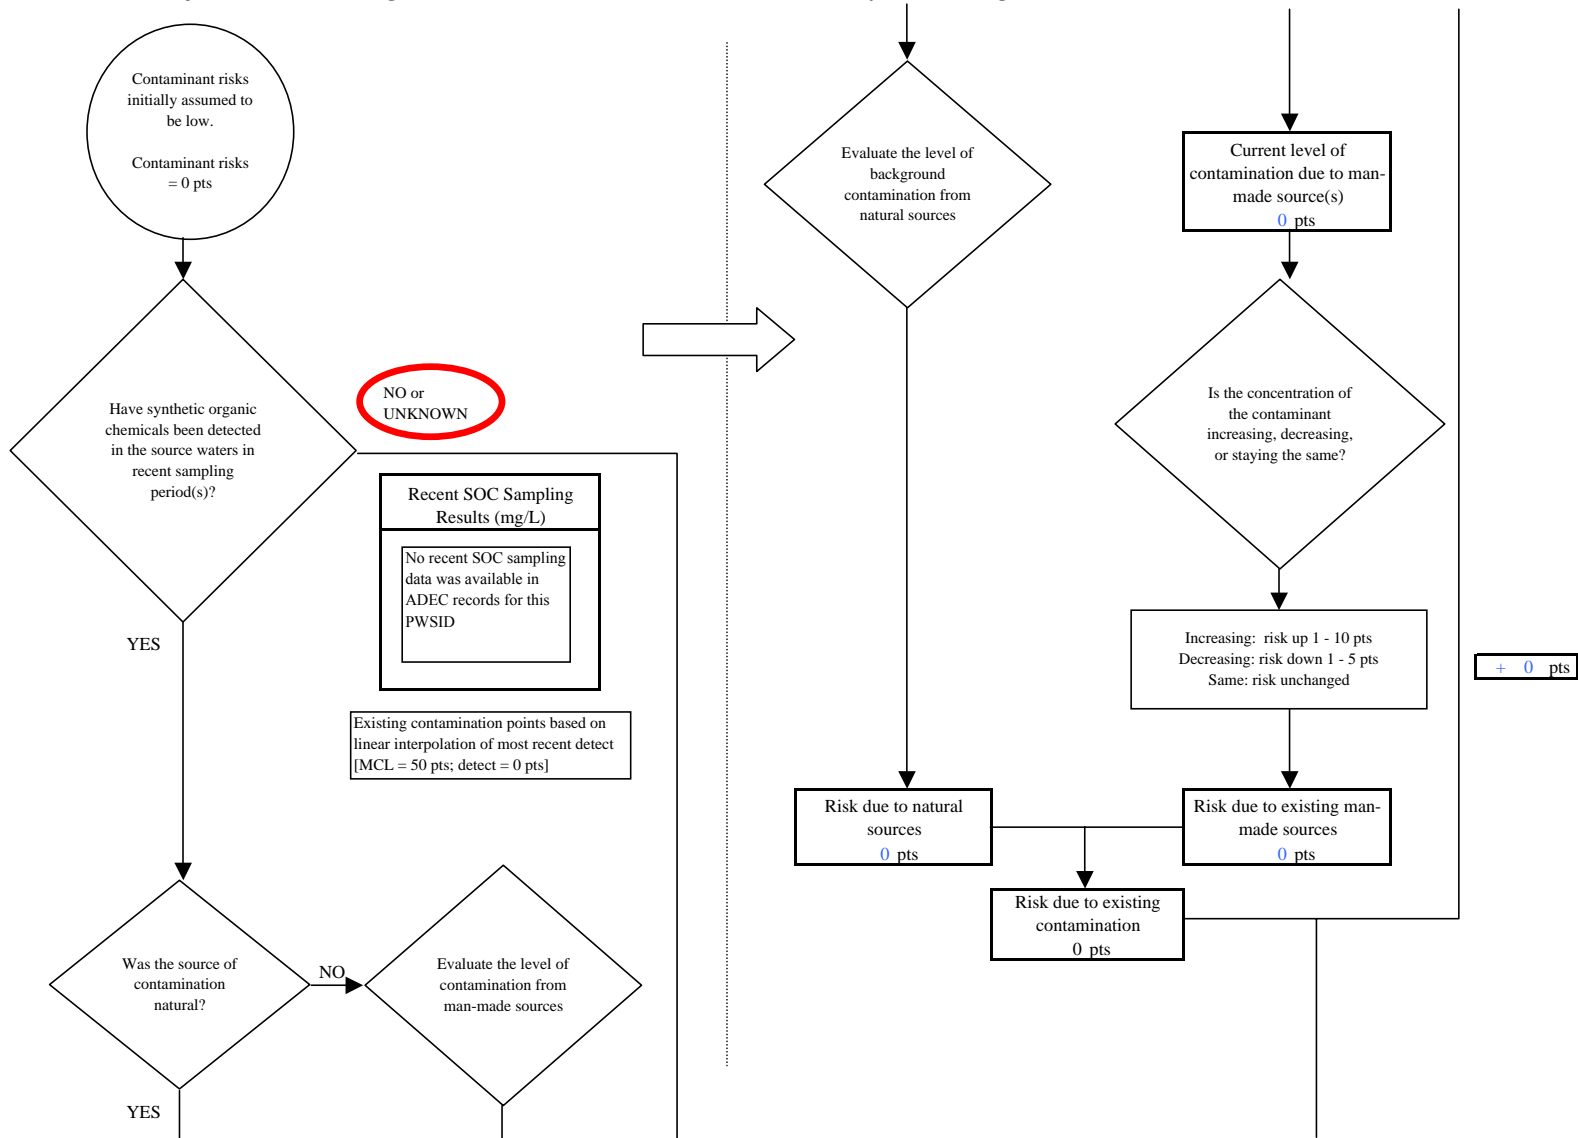


Chart 11. Contaminant risks for Aleutian Village Trailer Court (PWS No. 298608.001) - Synthetic Organic Chemicals

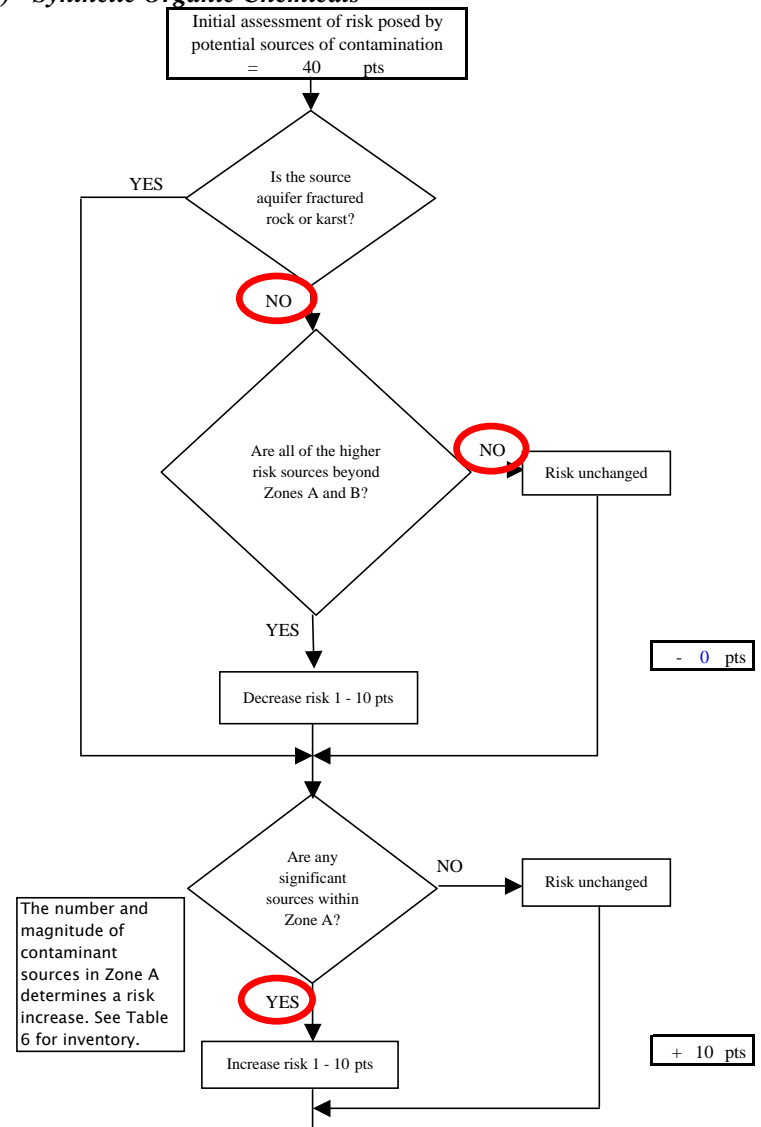
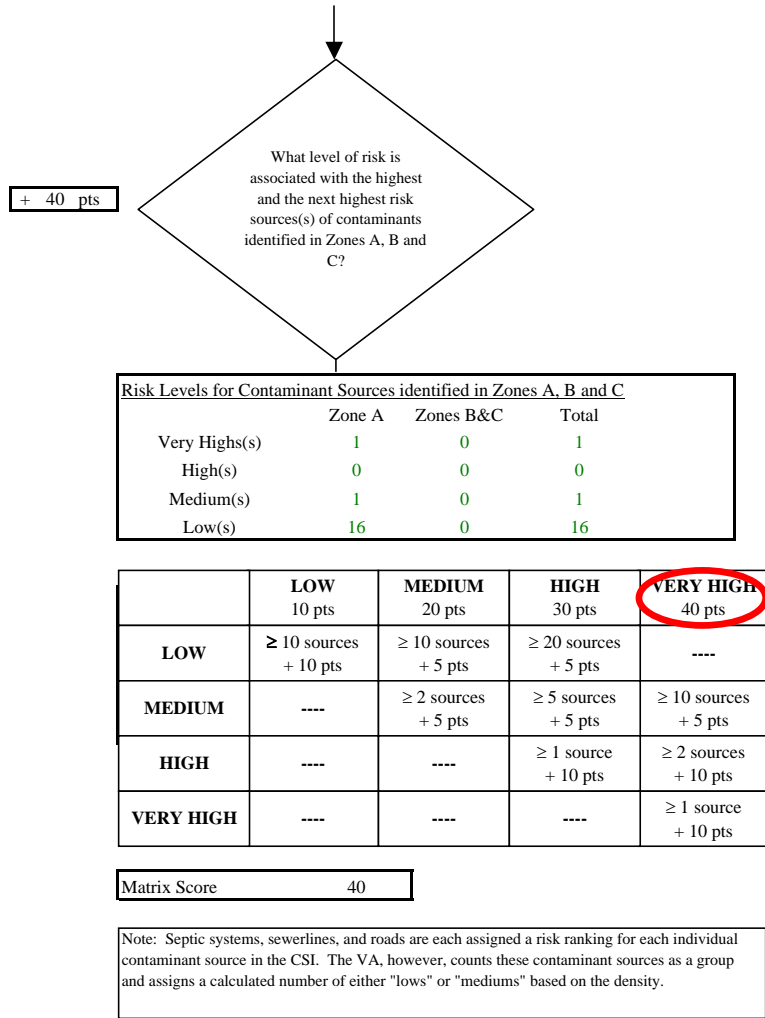


Chart 11. Contaminant risks for Aleutian Village Trailer Court (PWS No. 298608.001) - Synthetic Organic Chemicals

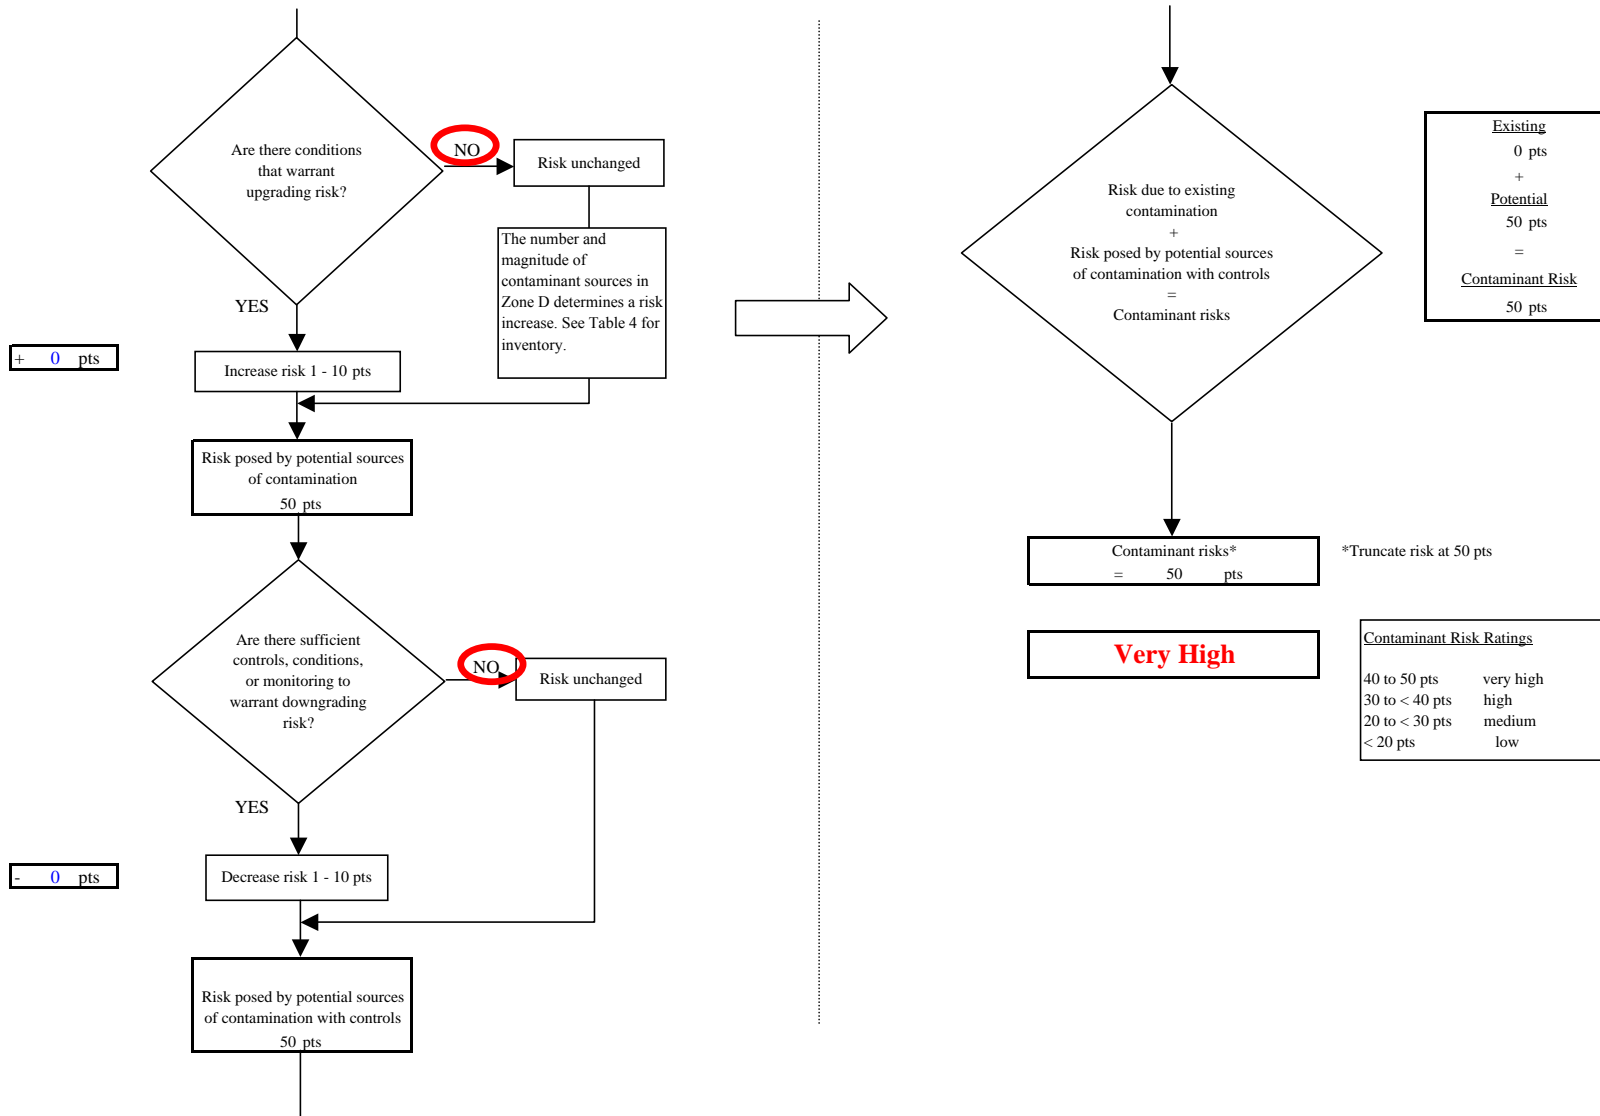


Chart 12. Vulnerability analysis for Aleutian Village Trailer Court (PWS No. 298608.001) - Synthetic Organic Chemicals

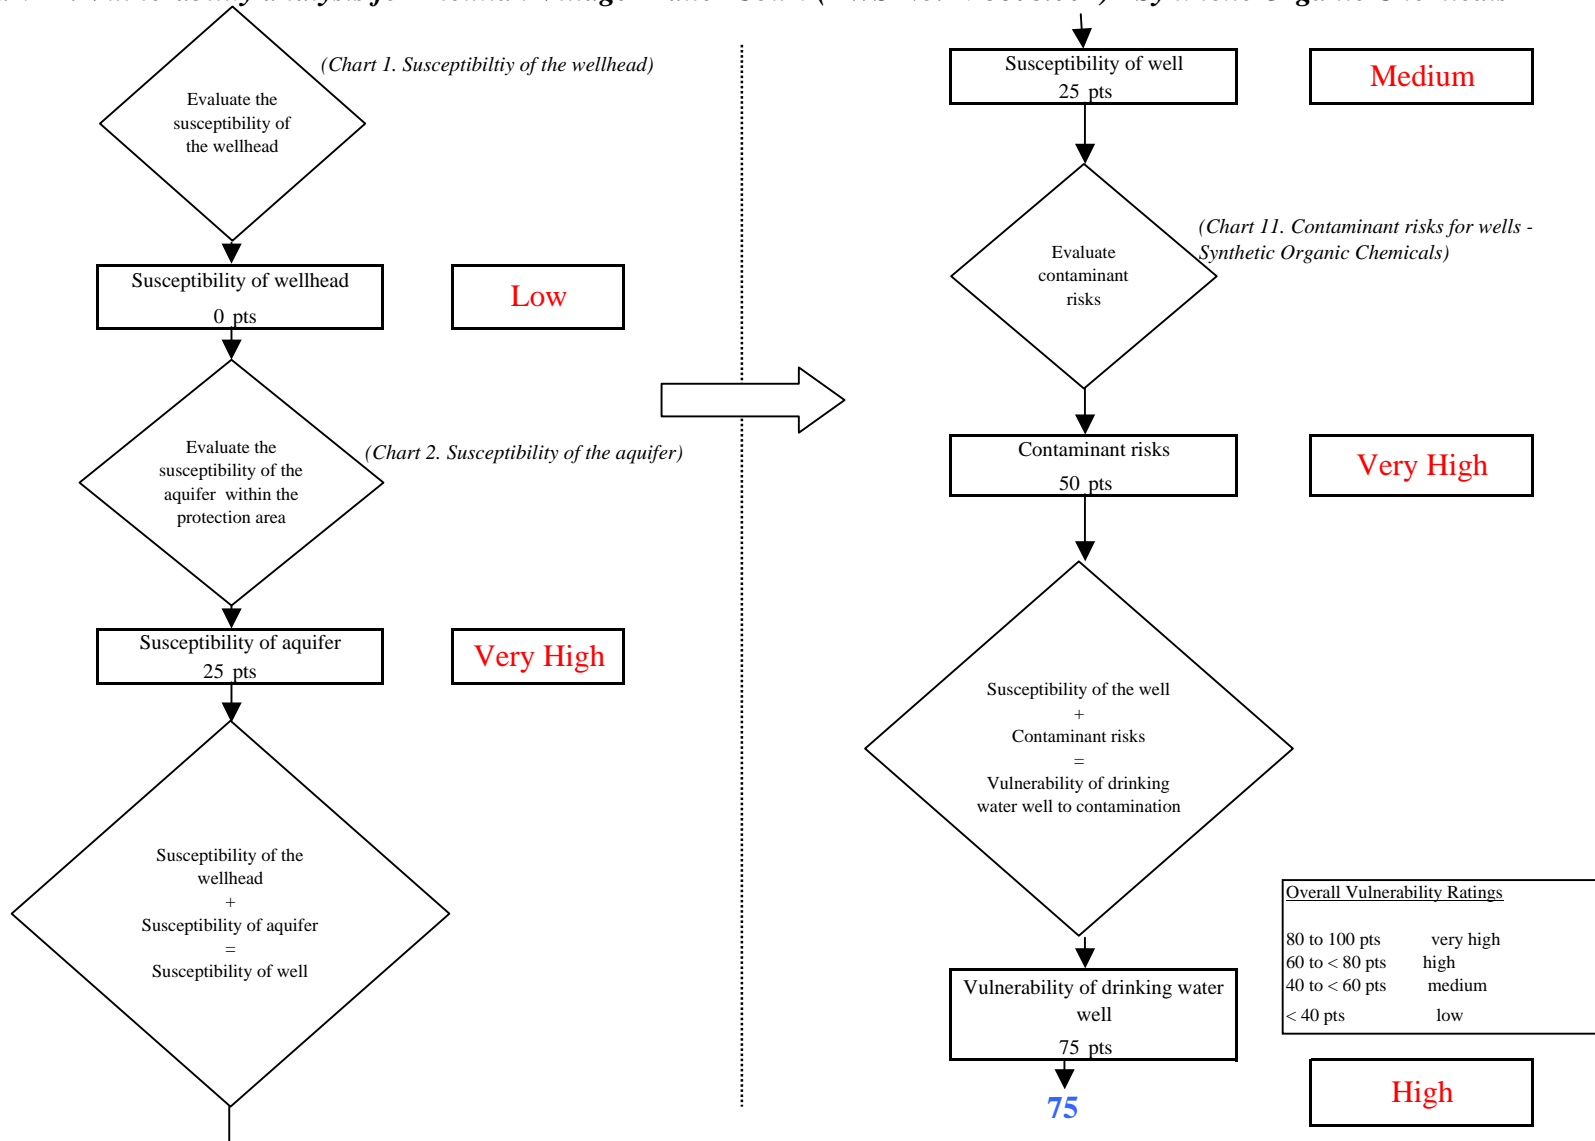


Chart 13. Contaminant risks for Aleutian Village Trailer Court (PWS No. 298608.001) - Other Organic Chemicals

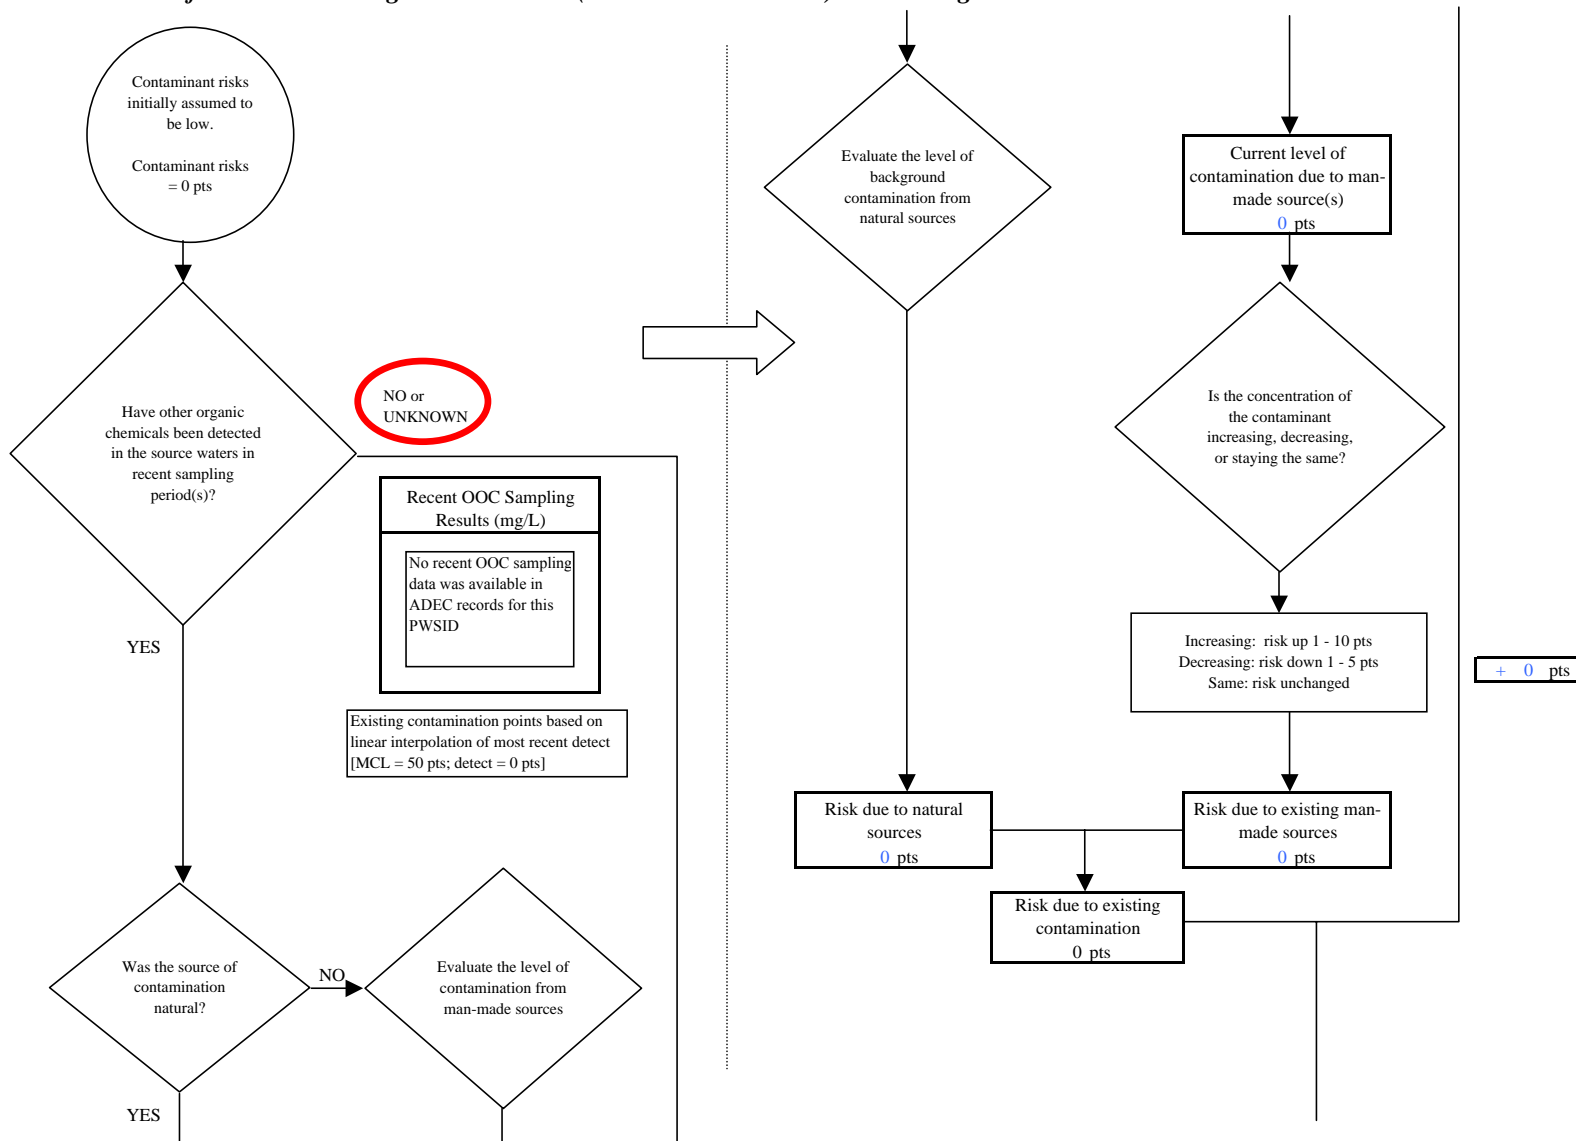


Chart 13. Contaminant risks for Aleutian Village Trailer Court (PWS No. 298608.001) - Other Organic Chemicals

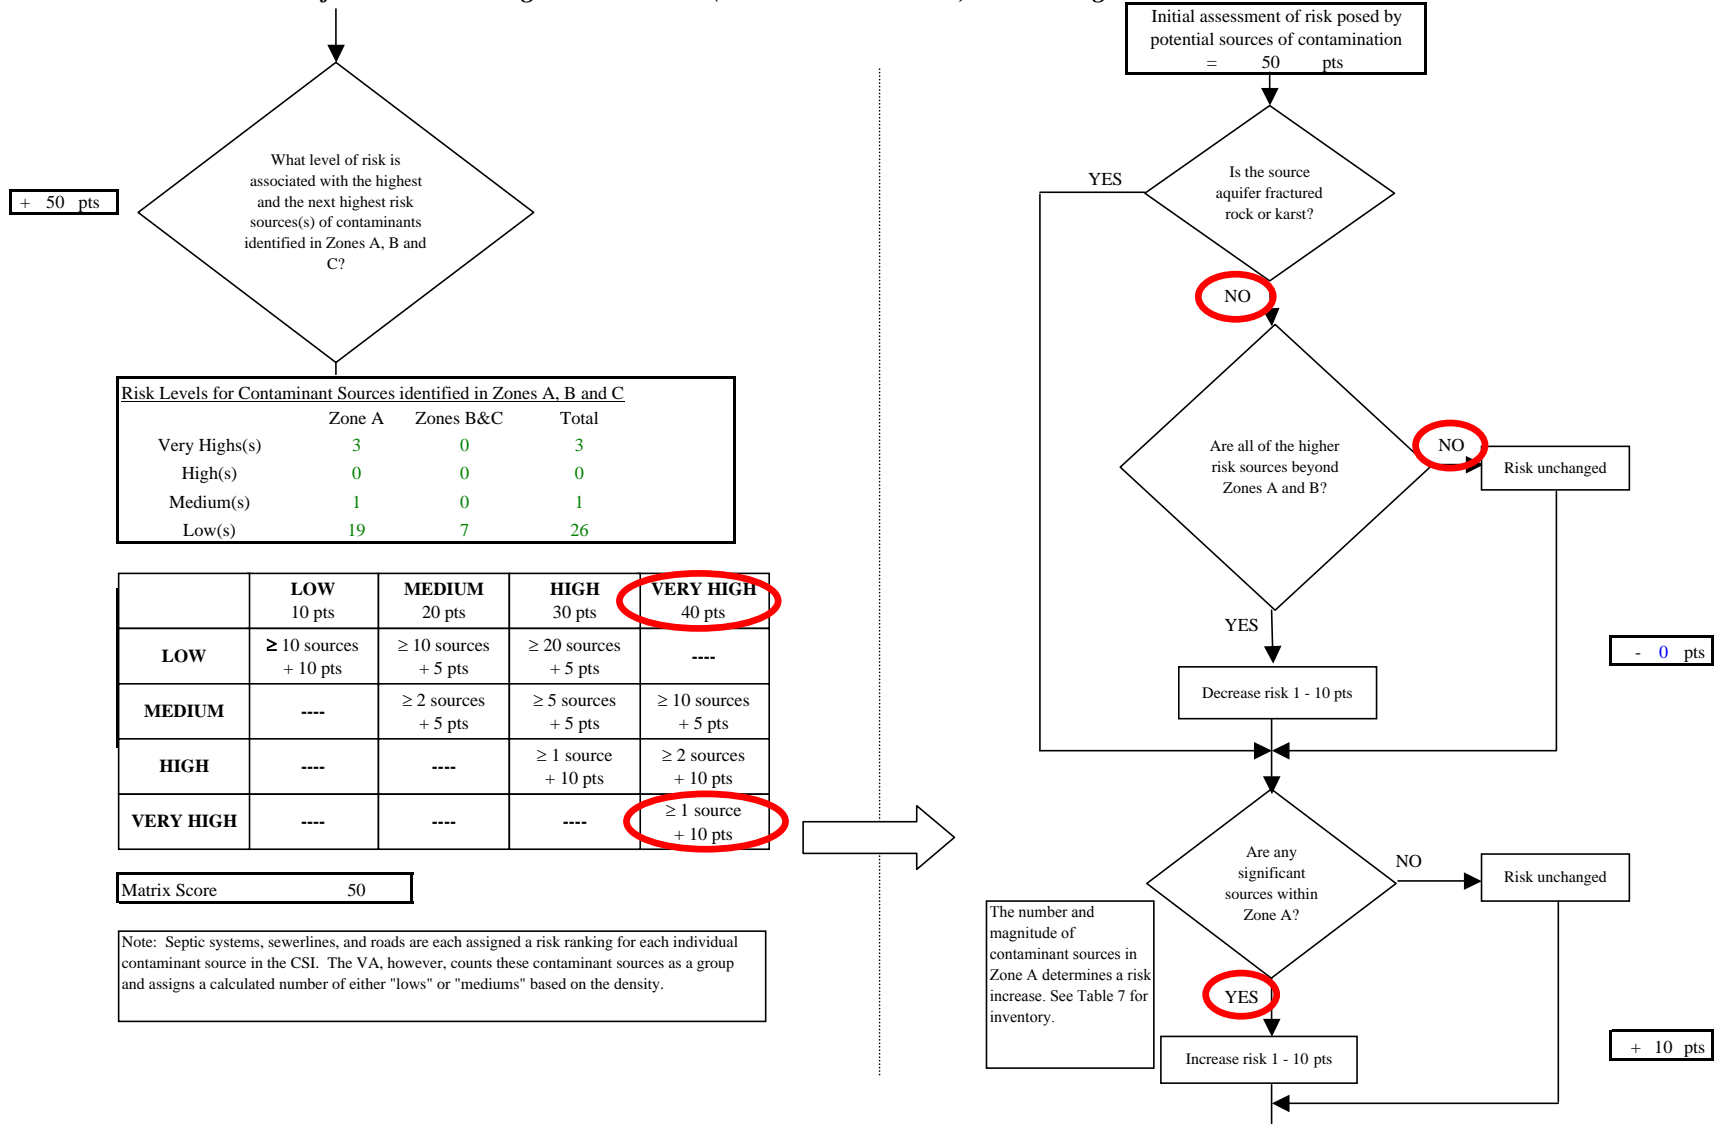


Chart 13. Contaminant risks for Aleutian Village Trailer Court (PWS No. 298608.001) - Other Organic Chemicals

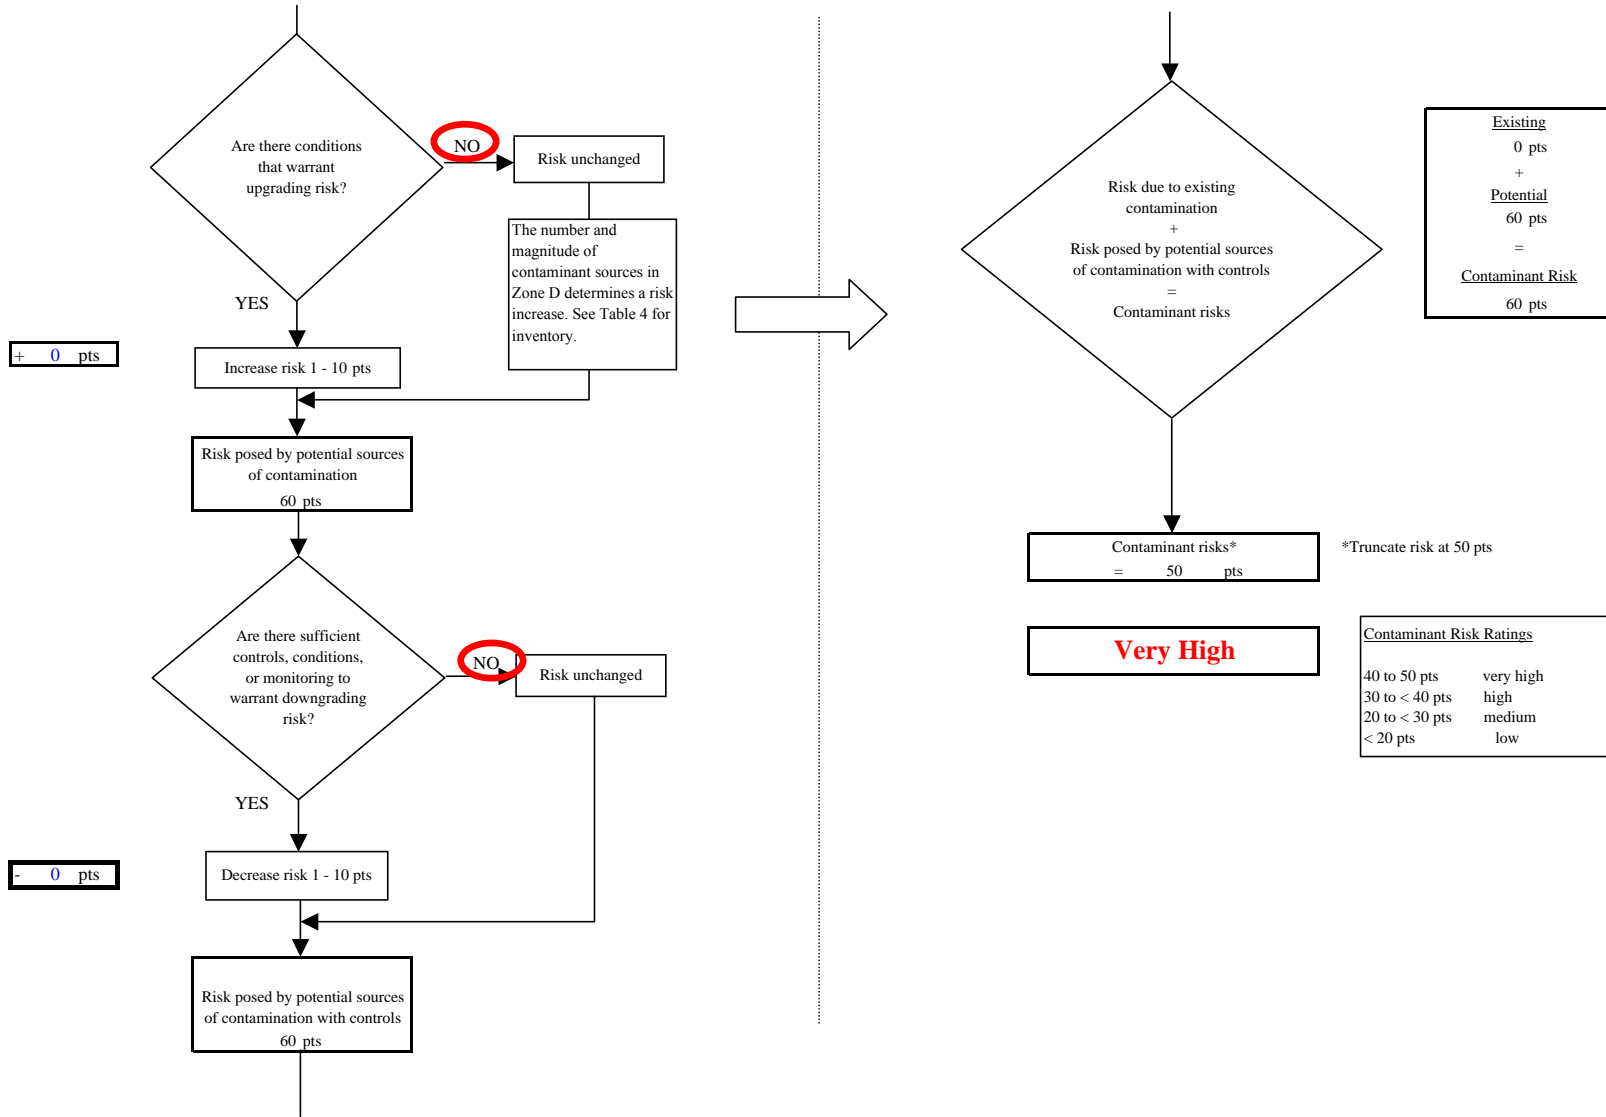


Chart 14. Vulnerability analysis for Aleutian Village Trailer Court (PWS No. 298608.001) - Other Organic Chemicals

