



A Source Water Assessment (SWA) for PWSID #225989.001 - CROSSROADS CENTER MALL (PIZZA CACHE)

What is an SWA?

The Drinking Water Protection group of the Drinking Water Program is producing Source Water Assessments (SWAs) in compliance with the Safe Drinking Water Act (SDWA) Amendments of 1996. Each SWA includes:

- A delineation of the drinking water source area;
- Inventory of potential and existing sources of contamination;
- Risk ranking for the identified contaminants;
- Evaluation of the overall vulnerability to the PWS source.

What is a Protection Area?

The most probable area for contamination to reach the drinking water well is within the drinking water protection area (DWPA). The DWPA for a groundwater source is the area around the well (the area influenced by pumping) and also the area upgradient of the well, usually forming a parabola shape. Because releases of contaminants within the DWPA are most likely to impact the well, this area will serve as the focus for voluntary protection efforts.

The DWPAs established for wells by DEC are separated into 2 zones, limited by the watershed. The following is a summary of the two zones for wells and the estimated time-of-travel for each:

Zone	Definition
A	Several months time-of-travel
B	Less than the 2 year time-of-travel

Natural Susceptibility

Susceptibility of a groundwater source is a measure of a water supply's potential to become contaminated based on information gathered on the wellhead and the aquifer.

Table 1: Public Water System Source Information

PWS Name	CROSSROADS CENTER MALL (PIZZA CACHE)
PWS ID Number	225989.001
State Asgn ID No.	WL001
Facility Name	WL WELL
Source Type	Groundwater
Federal Classification	Non-Transient Non-Community (NTNC) Water System
Total Depth of Well (ft bls*)	103
Static Water Level (ft bls*)	76
Aquifer Type	Unconfined
Aquifer Formation	Sand and gravel
Description of Barrier (ft bls*)	N/A

**ft bls" = feet below land surface

Executive Summary

The public water system (PWS) for CROSSROADS CENTER MALL (PIZZA CACHE) is a Non-Transient Non-Community (NTNC) water system consisting of one well (WL001) at Wasilla, Alaska. An assessment of the susceptibility of the wellhead and aquifer to contamination, and the vulnerability of the PWS to potential and existing contamination were evaluated as of November, 2012. The wellhead received a susceptibility rating of **Medium** and the aquifer received a susceptibility rating of **High**. Combining these two ratings produces a **Medium** rating for the natural susceptibility of the well. Identified potential and existing sources of contamination for the CROSSROADS CENTER MALL WL001 include a large-capacity septic system, twelve identified Class V injection wells used for motor vehicle waste disposal, approximately twenty-four (24) cumulative acres of residential areas, approximately twenty-four (24) residential septic systems, six (6) identified individual private water wells, six (6) paved roads, one (1) gravel/dirt road, one (1) electric substation, one (1) aircraft maintenance shop, and one (1) airport. These are considered sources one or more of the following six (6) contaminant risk categories: bacteria and viruses; nitrates and/or nitrites; volatile organic chemicals (VOCs); heavy metals, cyanide, and other inorganic chemicals (inorganic chemicals); synthetic organic chemicals (SOCs); and other organic chemicals (OOCs).

Combining the natural susceptibility of the well with the six (6) contaminant risk categories, the CROSSROADS CENTER MALL WL001 received an overall vulnerability rating of **High** for bacteria and viruses; **High** for nitrates and/or nitrites; **High** for VOCs; **High** for inorganic chemicals; and a **Medium** for SOCs and **High** for OOCs.

Introduction

Source Water Assessments (SWAs) are intended to provide PWS operators, owners, communities, and local governments with the best available information that may be used to protect the quality of their drinking water. The SWA for the CROSSROADS CENTER MALL WL001 is a tool to be used as the foundation or "stepping stone" to comprehensive management and protection of its groundwater resource. Protecting the quality of your drinking water is a sensible investment.

Drinking Water Protection Area

For groundwater sources, a combination of a numerical flow model and natural factors such as drainage divides, subsurface barriers, and manmade structures are used to determine the size and shape of the Drinking Water Protection Area (DWPA). The orientation of the DWPA is typically drawn using a groundwater surface, or a land surface, elevation map. Because of uncertainties and changing site conditions, a factor of safety is added in calculating the size of the DWPA. (See Map1 of the Appendices)

Natural Susceptibility (Wellhead and Aquifer)

The **susceptibility of a wellhead** to the introduction of contaminants to the drinking water is determined by, but

	<p>not limited to, the following risk factors: presence of a sanitary seal, protection from flooding, and presence of adequate grouting.</p> <p>The wellhead for the CROSSROADS CENTER MALL WL001 received a Medium susceptibility rating. The most recent sanitary survey (completed July 30, 2012) indicates that the well is capped with a sanitary seal, and that the well is not in a floodplain; however, the sanitary survey indicates that the land surface is not sloped to drain away from the wellhead, and that the well log does not indicate whether subsurface grout seal was installed to the required depth. A sanitary seal prevents potential contaminants from entering the well while sloping of the land surface and grouting help to prevent potential contaminants from traveling down the outside of the well casing, or through casing seams/cracks to the inside of the well casing, and into the well and/or aquifer.</p> <p>The susceptibility of an aquifer to the introduction of contaminants is determined by, but not limited to, the following risk factors: whether the aquifer is confined or unconfined, whether the well is completed in unconsolidated or fractured bedrock, whether other nearby wells and bore holes are penetrating the aquifer and if applicable the characteristics of the confining layer(s).</p> <p>The CROSSROADS CENTER MALL WL001 draws water from an unconfined aquifer completed in sand and gravel. It received a High susceptibility rating because unconfined aquifers are relatively conducive to infiltration of contaminants from the surface to the aquifer. An unconfined aquifer is generally more influenced than a confined aquifer by precipitation and infiltration of surface water potentially carrying contaminants that migrate downward from the surface to the aquifer, which may be further accelerated by stresses on the aquifer such as pumping from nearby wells; several individual private wells were identified near this PWS.</p>
--	--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------

The **Natural Susceptibility** of the well to contamination is **Low**. Table 2 summarizes the susceptibility ratings for the CROSSROADS CENTER MALL WL001.

Table 2: Susceptibility Ratings	
	<i>Rating</i>
Susceptibility of the wellhead	Medium
+	
Susceptibility of the Aquifer	High
=	
Natural Susceptibility	Medium

Inventory of Potential and Existing Sources Contamination

The Drinking Water Protection (DWP) group has completed an inventory of potential and existing sources of contamination within the DWPA for the CROSSROADS CENTER MALL WL001. This inventory was completed through a search of agency records and other publicly available information. Potential sources of contamination include a wide range of categories and types. Potential drinking water contaminants are found within agricultural, residential, commercial, and industrial areas, but can also occur within areas that have little or no development.

The identified potential sources of contamination are summarized in Table 3 and are portrayed in Map 2 of the Appendices.

Table 3: Contaminant Source Inventory			
Contaminant Source Type	Contaminant Source ID	Zone	Comments
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	A	
Injection wells (Class V) Motor Vehicle Waste Disposal Well	D42	A	
Residential Areas	R01	A	Approximately 6.5 acres; estimated from MSB parcels.
Septic systems (serves one single-family home)	R02	A	Approximately 8; inferred from MSB parcels with building values.

Water supply wells	W09	A	Water Right LAS 22631; http://dnr.alaska.gov/projects/las/Case_Abstract.cfm?Filetype=LAS&FileNumber=22631
Water supply wells	W09	A	Water Right LAS 24981; http://dnr.alaska.gov/projects/las/Case_Abstract.cfm?Filetype=LAS&FileNumber=24981
Water supply wells	W09	A	Water Right LAS 10154; http://dnr.alaska.gov/projects/las/Case_Abstract.cfm?Filetype=LAS&FileNumber=10154
Highways and roads, paved (cement or asphalt)	X20	A	Gruman Cir; Bogard Rd; N Lazy Eight Ct; N Travel Air Dr.
Highways and roads, dirt/gravel	X24	A	Unregistered (private?) residential deadend.
Electric substation	X37	A	
Aircraft maintenance shops	C01	B	
Injection wells (Class V) Motor Vehicle Waste Disposal Well	D42	B	
Residential Areas	R01	B	Approximately 17.8 acres; estimated from MSB parcels.
Septic systems (serves one single-family home)	R02	B	Approximately 16; inferred from MSB parcels with building values.
Water supply wells	W09	B	Water Right ADL 209918; http://dnr.alaska.gov/projects/las/Case_Abstract.cfm?Filetype=ADL&FileNumber=209918
Water supply wells	W09	B	Water Right LAS 10202; http://dnr.alaska.gov/projects/las/Case_Abstract.cfm?Filetype=LAS&FileNumber=10202
Water supply wells	W09	B	Water Right LAS 27777; http://dnr.alaska.gov/projects/las/Case_Abstract.cfm?Filetype=LAS&FileNumber=27777
Airports	X14	B	
Highways and roads, paved (cement or asphalt)	X20	B	Gruman Cir; N Travel Air Dr; Sam's Dr; John-John Ct.

Contaminant Risks

Inventoried contaminant sources are sorted by the Drinking Water Protection (DWP) group according to the six (6) major categories of contaminants regulated for drinking water: 1) bacteria and viruses; 2) nitrates and/or nitrites; 3) volatile organic chemicals (VOCs); 4) heavy metals, cyanide, and other inorganic chemicals (inorganic chemicals); 5) synthetic organic chemicals (SOCs); and 6) other organic chemicals (OOCs). The contaminant sources are then given a ranking (within each category) according to the density of sources within the DWPA, the PWS sampling history, as well as the degree of risk posed to human health based on the volume, toxicity, persistence, and the mobility of the contaminants involved.

The contaminant risk rankings are summarized in Table 4.

Contaminant Source Type	Contaminant Source ID	Zone	Contaminant Source Risk Ranking					
			Bacteria & Viruses	Nitrates and/or Nitrites	VOCs	Inorganic Chemicals*	SOCs	OOCs
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	A	High	Low	Low	Low	Low	Low

Injection wells (Class V) Motor Vehicle Waste Disposal Well	D42	A	Low	N/A	High	High	Low	Medium
Residential Areas	R01	A	Low	Low	Low	Low	Low	Low
Septic systems (serves one single-family home)	R02	A	Low	Low	Low	Low	Low	Low
Highways and roads, paved (cement or asphalt)	X20	A	Low	N/A	Low	Low	N/A	Low
Highways and roads, dirt/gravel	X24	A	Low	Low	Low	Low	N/A	Low
Electric substation	X37	A	N/A	N/A	Low	Low	N/A	High
Aircraft maintenance shops	C01	B	N/A	N/A	Low	Low	N/A	Low
Injection wells (Class V) Motor Vehicle Waste Disposal Well	D42	B	Low	N/A	High	High	Low	Medium
Residential Areas	R01	B	Low	Low	Low	Low	Low	Low
Septic systems (serves one single-family home)	R02	B	Low	Low	Low	Low	Low	Low
Airports	X14	B	N/A	Low	High	Low	Medium	Medium
Highways and roads, paved (cement or asphalt)	X20	B	Low	Low	Low	Low	N/A	Low
Contaminant Category Risk Ranking**			Very High	Very High	Very High	Very High	Medium	Very High

* Includes heavy metals, cyanide, and other inorganic chemicals.

** Scores based on additional factors, such as sampling history, and number/density of sources.

The contaminant category risk ranking for Bacteria & Viruses is **Very High**. This ranking is driven primarily by a combination of the sampling history, as well as a large-capacity septic system and several Class V injection wells used for motor vehicle waste disposal located within the Zone A DWPA; and several residential septic systems, roads, and residential areas located within the DWPA. A positive Total Coliform (which may include fecal coliform and *E. Coli*, but not a confirmation of the presence of either) was last reported for a repeat sample collected in February 2008; *E. Coli* was not detected. Coliforms are naturally present in the environment, as well as feces; fecal coliforms and *E. Coli* only come from human and animal fecal waste. Total Coliforms is not a health threat in itself; it is used to indicate whether other potentially harmful bacteria may be present.

The contaminant category risk ranking for Nitrates and/or Nitrites is **Very High**. This ranking is driven primarily by a combination of the sampling history, as well as a large-capacity septic system located within the Zone A DWPA; and several residential septic systems, roads, and residential areas located within the DWPA. Nitrates and/or nitrites has been detected in samples collected in recent years, but an increasing or decreasing trend is not apparent; the most recent sample collected March 2012, showed a total nitrate-nitrite concentration of 0.848 milligrams per liter (mg/L), which is 8.48% of the maximum contaminant level (MCL) of 10 mg/L for nitrate. Sources of nitrate and/or nitrite may include runoff from fertilizer use, leaking from septic tanks, sewage, and/or erosion from natural deposits. A relatively low concentration and absence of a clear trend implies that the source is natural, rather than anthropogenic. Potential health effects include serious illness and, if untreated, death for infants below the age of six months; symptoms include a shortness of breath and blue-baby syndrome.

The contaminant category risk ranking for VOCs is **Very High**. This ranking is driven primarily by a combination of the sampling history, as well as a large-capacity septic system, several Class V injection wells used for motor vehicle waste disposal, and an electrical substation located within the Zone A DWPA; and an airport, aircraft maintenance shop, several residential septic systems, roads, and residential areas located within the DWPA. VOCs have not been detected in samples collected in recent years. Sources of VOCs may be either natural or anthropogenic. Potential health effects are typically compounding long-term, and not acute.

The contaminant category risk ranking for Inorganic Chemicals is **Very High**. This ranking is driven primarily by a combination of the sampling history, as well as a large-capacity septic system, several Class V injection wells used for motor vehicle waste disposal, and an electrical substation located within the Zone A DWPA; and an airport, aircraft maintenance shop, several residential septic systems, roads, and residential areas located within the DWPA. Barium was detected at a concentration of 22.90 micrograms per liter ($\mu\text{g/L}$) (1.15% of the MCL of $2\mu\text{g/L}$) December 2010. Sources of barium may include discharge from drilling wastes, discharge from metal refineries, and/or erosion of natural deposits. A potential health effect from long-term exposure above the MCL includes an increase in blood pressure.

The contaminant category risk ranking for SOCs **Medium**. This ranking is driven primarily by a combination of the sampling history, as well as a large-capacity septic system, several Class V injection wells used for motor vehicle waste disposal located within the Zone A DWPA; and an airport, several residential septic systems, and residential areas located within the DWPA. This PWS has received an SOC Monitoring Waiver for compliance period 2011-2013.

The contaminant category risk ranking for OOCs **Very High**. This ranking is driven primarily by a combination of the sampling history, as well as a large-capacity septic system, several Class V injection wells used for motor vehicle waste disposal, and an electrical substation located within the Zone A DWPA; and an airport, aircraft maintenance shop, several residential septic systems, roads, and residential areas located within the DWPA. This PWS has received an SOC Monitoring Waiver for compliance period 2011-2013.

Overall Vulnerability of the Drinking Water Source to Contamination

An overall vulnerability is determined for each water system by combining each of the contaminant category risk rankings with the natural susceptibility score:

$$\text{Overall Vulnerability of the Drinking Water Source to Contamination} = \text{Natural Susceptibility} + \text{Contaminant Risks}$$

Table 5 summarizes the overall vulnerability ratings for each of the six (6) contaminant categories.

Category	Rating
Bacteria and Viruses	High
Nitrates and/or Nitrites	High
Volatile Organic Chemicals	High
Heavy Metals, Cyanide, and Other Inorganic Chemicals	High
Synthetic Organic Chemicals	Medium
Other Organic Chemicals	High

Using the Source Water Assessment

This assessment of contaminant risks and source vulnerability can be used as a foundation for local voluntary protection efforts as well as a basis for the continuous efforts on the part of the CROSSROADS CENTER MALL PWS to protect public health. Communities can use the Source Water Assessment (SWA) to create a *drinking water protection plan* to manage the identified potential and existing sources of regulated drinking water contaminants and to prevent or minimize new contaminant threats in the drinking water protection area.

The CROSSROADS CENTER MALL PWS can use a number of different drinking water protection methods to limit or prevent contamination of its drinking water source.

- Non-Regulatory Options include:
 - Public education about where drinking water comes from and the effects of contaminants is probably the most effective and least costly method of protection;
 - Household hazardous waste collection - household hazardous wastes are usually generated in small amounts but can have a big impact on the environment;
 - The source water assessment report is a tool that can be used to prioritize protection strategies identified in a drinking water protection plan;
 - Taking proactive measures towards proper waste storage and disposal can help eliminate the need to find an alternative drinking water source by preventing source water contamination;
 - Conservation easements - easements can assist in protecting the area by limiting development;
 - Make a written plan on what you will do if an accidental spill happens that could contaminate your source of drinking water; and
 - Local drinking water protection plan (an example or template is available from DEC).
- Regulatory Options include:
 - Source protection regulations prohibiting the presence or use of all or specific chemicals within the drinking water protection area;

- Zoning ordinances to control development within the different protection areas around the source;
- Subdivision ordinance; and
- Operating standards for industrial and other activities within the different protection areas around the source.

Source Water Assessments can be updated to reflect any changes in the vulnerability and/or susceptibility of the CROSSROADS CENTER MALL PWS source (WL001). The data that is used to generate the SWA is updated on an on-going basis as identified in the field or if changes are identified and brought to the attention of the Drinking Water Program.

Where to go from here?

The SWA is a comprehensive evaluation of the potential risk of contamination to the PWS and the source(s) of drinking water used by the system. Identifying potential sources of contamination and the vulnerability of the PWS is an important first step in protecting the drinking water source from contamination. However, in order to prevent contamination from occurring, action must be taken by the PWS owner and/or operator. The SWA can be used by the PWS to educate the local community and to prioritize community-driven protection strategies. Inviting community members, council members, and local government officials to help develop a *drinking water protection plan* is one essential component towards successful drinking water protection efforts. For questions regarding, or assistance to begin, the process of developing a *drinking water protection plan*, please contact the Drinking Water Protection group toll-free at #1-866-956-7656 (within Alaska only), or direct at #907-269-7656.

Other Resources

The Drinking Water Protection group, the EPA, and local organizations are available to help you build on this SWA report as you continue to improve drinking water protection in your community.

DEC, Drinking Water Protection - http://dec.alaska.gov/eh/dw/DWP/DWP_main.html

EPA, Drinking Water Protection - <http://cfpub.epa.gov/safewater/sourcewater/index.cfm>

Groundwater Foundation - <http://www.groundwater.org>


ARWA (Alaska Rural Water Association) - <http://www.arwa.org>

Groundwater Protection Council- <http://www.gwpc.org>

National Ground Water Association: <http://www.ngwa.org/Pages/default.aspx>


Appendices

- CROSSROADS CENTER MALL WL001 Drinking Water Protection Area Location Map (Map 1);
- CROSSROADS CENTER MALL WL001 Drinking Water Protection Area with Potential and Existing Contaminant Sources (Map 2);
- Example Best Management Strategies for Potential Contaminants Identified within a Drinking Water Source Protection Area.

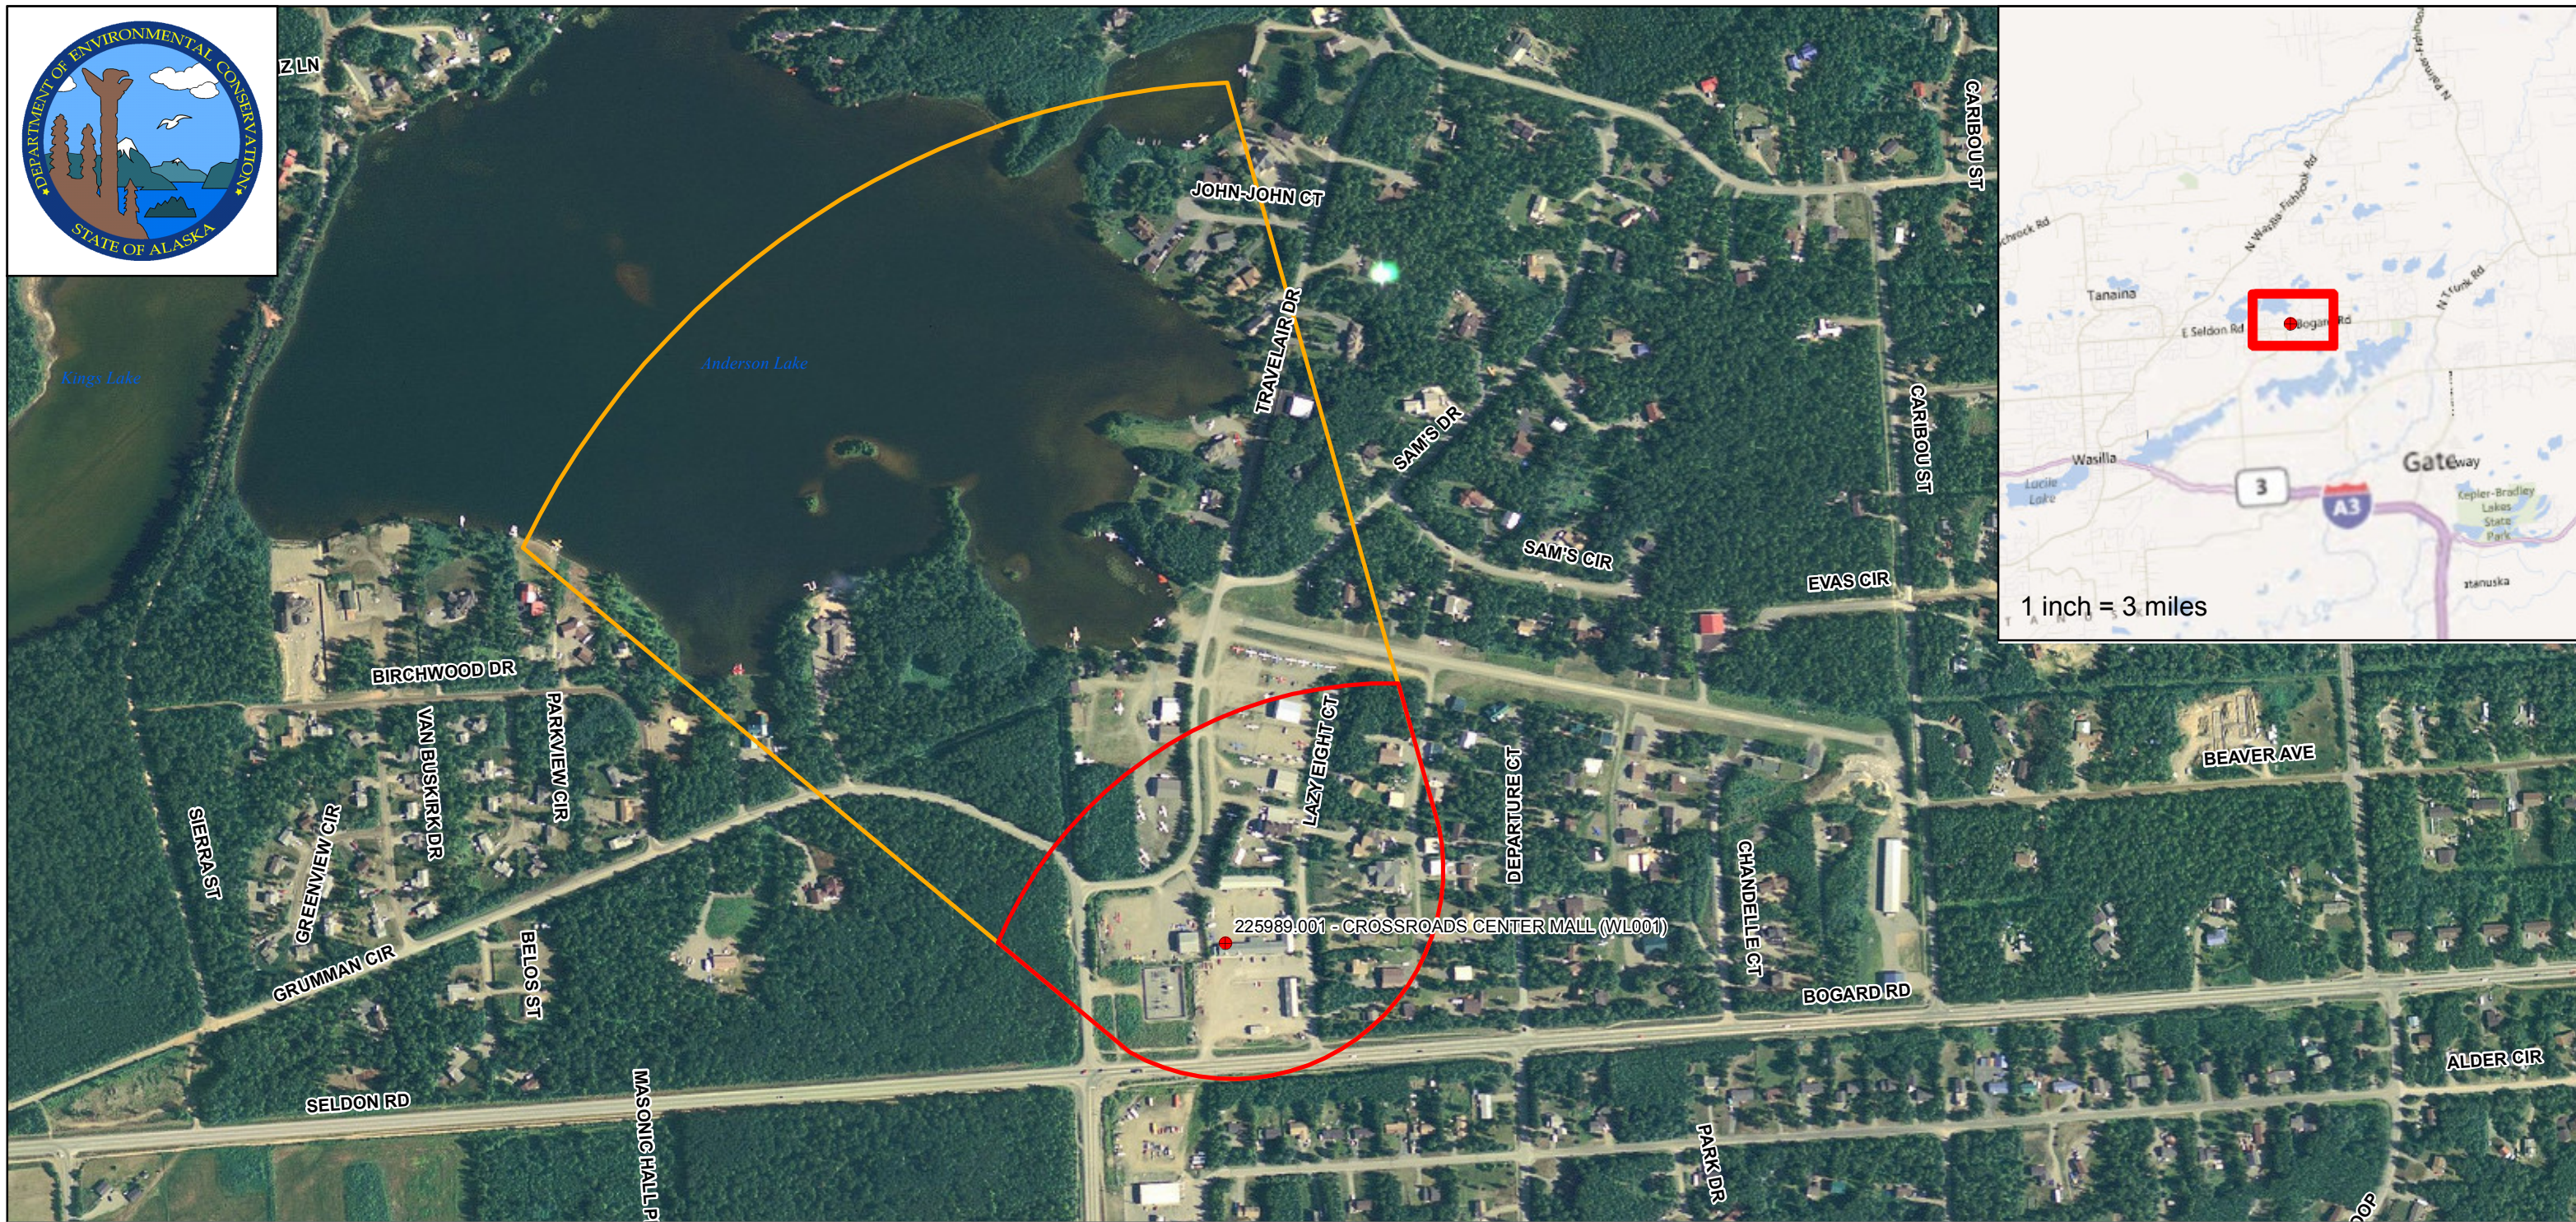


Map 1 - CROSSROADS CENTER MALL

**PWSID 225989.001
WL001**



Public Water Systems		Drinking Water Protection Areas	
⊕	Community Water System (Formerly Class A)	 	Zone A (GW-Several Months Time of Travel or SW 1000 ft buffer)
●	NonTransient/NonCommunity (Formerly Class A)	 	Zone B (GW-2 Yr Time of Travel or SW-1 mile buffer)
●	NonCommunity (Formerly Class B)		
⊕	NonPublic (Class C-State Regulated)		

Data sources:
 Aerial imagery: ESRI World Imagery
 Inset basemap: BING Basemap
 Public Water System Sources and Drinking Water Protection Areas: State of Alaska Department of Environmental Conservation (DEC) - Drinking Water Program

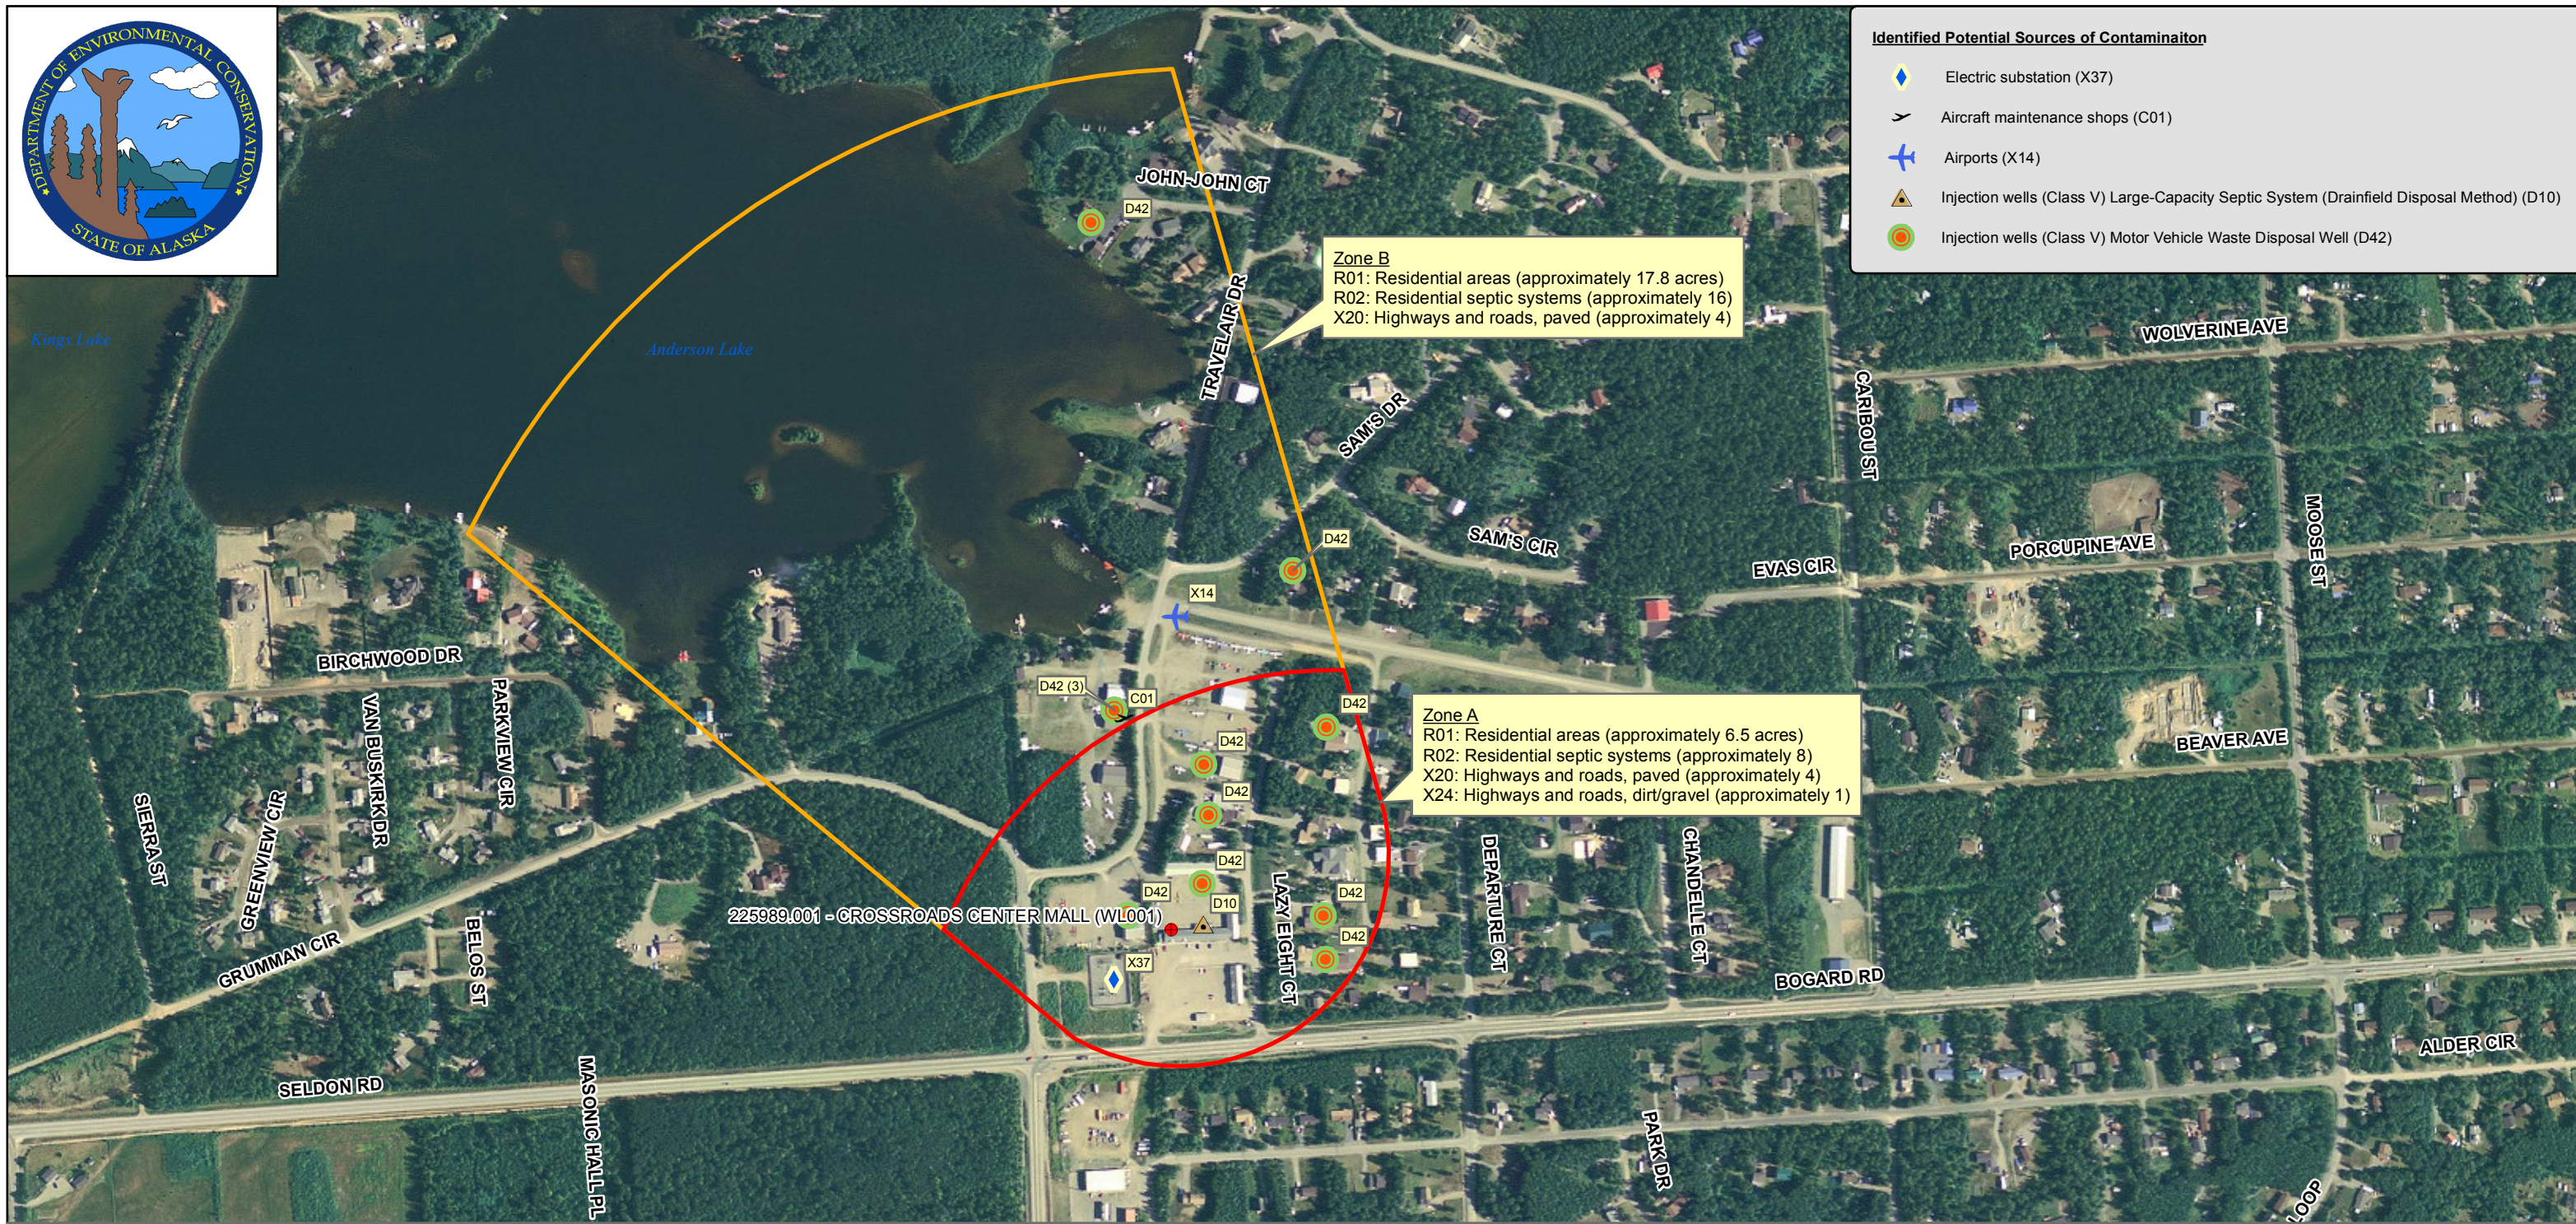

Identified Potential Sources of Contamination

- Electric substation (X37)
- Aircraft maintenance shops (C01)
- Airports (X14)
- Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method) (D10)
- Injection wells (Class V) Motor Vehicle Waste Disposal Well (D42)


Zone B
 R01: Residential areas (approximately 17.8 acres)
 R02: Residential septic systems (approximately 16)
 X20: Highways and roads, paved (approximately 4)

Zone A
 R01: Residential areas (approximately 6.5 acres)
 R02: Residential septic systems (approximately 8)
 X20: Highways and roads, paved (approximately 4)
 X24: Highways and roads, dirt/gravel (approximately 1)

225989.001 - CROSSROADS CENTER MALL (WL001)

Map 2 - CROSSROADS CENTER MALL (PIZZA CACHE)

PWSID 225989.001 WL001

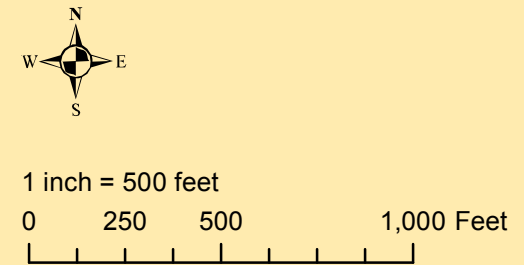

Public Water Systems		Drinking Water Protection Areas	
	Community Water System (Formerly Class A)		Zone A (GW-Several Months Time of Travel or SW 1000 ft buffer)
	NonTransient/NonCommunity (Formerly Class A)		Zone B (GW-2 Yr Time of Travel or SW-1 mile buffer)
	NonCommunity (Formerly Class B)		
	NonPublic (Class C-State Regulated)		

Data sources:
 Aerial imagery: ESRI World Imagery
 Inset basemap: BING Basemap
 Public Water System Sources and Drinking Water Protection Areas: State of Alaska Department of Environmental Conservation (DEC) - Drinking Water Program

Best Management Strategies for Potential Contaminants Identified within a Drinking Water Source Protection Area

Best Management Strategies (BMP's)	Contaminant Source ID's	Contaminant Source ID's	Contaminant Source ID's	Contaminant Source ID's
General BMP's for all Activities				
Avoid the activity or reduce its occurrence.	All	All	All	All
Move the activity indoors.	All	All	All	All
Use less material.	All	All	All	All
Use least toxic material available.	All	All	All	All
Create and maintain vegetative areas near activities.	All	All	All	All
Locate activities as far as possible from surface drainage paths.	All	All	All	All
Keep storm drain systems clean.	All	All	All	All
Reduce, reuse and recycle as much as possible.	All	All	All	All
Be an advocate for stormwater pollution prevention.	All	All	All	All
Report Violators.	All	All	All	All
Cleaning, Washing and Industrial Activities				
Cleaning and washing of tools, engines and manufacturing equipment .	Waste Water Disposal (D01-D62)	Industrial (I01-I36)	Commercial Activities (C01-C44)	Miscellaneous
Illicit connections to stormwater drains should be eliminated.	Waste Water Disposal (D01-D62)	Industrial (I01-I36)	Commercial Activities (C01-C44)	Miscellaneous
Employees should be educated.	Waste Water Disposal (D01-D62)	Industrial (I01-I36)	Commercial Activities (C01-C44)	Miscellaneous
All wastewater should be discharged to a holding tank, process treatment system, or sanitary sewer. Never discharge to septic system or stormwater drains.	Waste Water Disposal (D01-D62)	Industrial (I01-I36)	Commercial Activities (C01-C44)	Miscellaneous
If soaps and detergents are used, use least toxic chemical capable of doing the job. Use non-phosphate detergents, if possible.	Waste Water Disposal (D01-D62)	Industrial (I01-I36)	Commercial Activities (C01-C44)	Miscellaneous
Limit the amount of water used for washing activities to limit the potential runoff of carrying pollutants beyond the designated wash pad or capture system.	Waste Water Disposal (D01-D62)	Industrial (I01-I36)	Commercial Activities (C01-C44)	Miscellaneous
Recycle wash water for subsequent washings.	Waste Water Disposal (D01-D62)	Industrial (I01-I36)	Commercial Activities (C01-C44)	Miscellaneous
Implement one of following stormwater treatment BMP's:	Waste Water Disposal (D01-D62)	Industrial (I01-I36)	Commercial Activities (C01-C44)	Miscellaneous
Oil water separator.	Waste Water Disposal (D01-D62)	Industrial (I01-I36)	Commercial Activities (C01-C44)	Miscellaneous
Wet vault for settling.	Waste Water Disposal (D01-D62)	Industrial (I01-I36)	Commercial Activities (C01-C44)	Miscellaneous
Infiltration Basin.	Waste Water Disposal (D01-D62)	Industrial (I01-I36)	Commercial Activities (C01-C44)	Miscellaneous
Filtration for media designed for pollutant present.	Waste Water Disposal (D01-D62)	Industrial (I01-I36)	Commercial Activities (C01-C44)	Miscellaneous
Catch basin with a filter insert for pressure washing.	Waste Water Disposal (D01-D62)	Industrial (I01-I36)	Commercial Activities (C01-C44)	Miscellaneous
Paved wash area should be swept daily.	Waste Water Disposal (D01-D62)	Industrial (I01-I36)	Commercial Activities (C01-C44)	Miscellaneous
Greasy buildup on cooking equipment must be removed and properly disposed of prior to washing to reduce the amount of material that can contaminate runoff.	Waste Water Disposal (D01-D62)	Industrial (I01-I36)	Commercial Activities (C01-C44)	Miscellaneous
Use a tub or similar device to contain washwater.	Waste Water Disposal (D01-D62)	Industrial (I01-I36)	Commercial Activities (C01-C44)	Miscellaneous
If activity can not be moved indoors or contained by a tub, the washing area must drain to a sanitary sewer, holding tank or process treatment system and provisions should be made to prevent stormwater run-off onto the washing area.	Waste Water Disposal (D01-D62)	Industrial (I01-I36)	Commercial Activities (C01-C44)	Miscellaneous
If a holding tank is used, the contents must be pumped and disposed of appropriately.	Waste Water Disposal (D01-D62)	Industrial (I01-I36)	Commercial Activities (C01-C44)	Miscellaneous
A cover should be placed over wash area to prevent rain from falling on dirty equipment and producing contaminated runoff.	Waste Water Disposal (D01-D62)	Industrial (I01-I36)	Commercial Activities (C01-C44)	Miscellaneous
Take vehicles to commercial car wash.	Waste Water Disposal (D01-D62)	Industrial (I01-I36)	Commercial Activities (C01-C44)	Miscellaneous
Designated wash areas must be marked well, with signs indicated where and how washing should occur. Any inlets to sanitary sewer or storm drain should be marked "No Dumping".	Waste Water Disposal (D01-D62)	Industrial (I01-I36)	Commercial Activities (C01-C44)	Miscellaneous
Clean catch basins regularly.	Waste Water Disposal (D01-D62)	Industrial (I01-I36)	Commercial Activities (C01-C44)	Miscellaneous
Consider washing vehicles less frequently.	Waste Water Disposal (D01-D62)	Industrial (I01-I36)	Commercial Activities (C01-C44)	Miscellaneous
If pressure washing waste water doesn't collect in a centralized area, such as an area that is very flat, or you are on a grassed area, a tarp should be placed under the washing area to collect paint chips and other debris that may be loosened by the spray.	Waste Water Disposal (D01-D62)	Industrial (I01-I36)	Commercial Activities (C01-C44)	Miscellaneous
Pressure washing of boats should occur where runoff control can be achieved.	Waste Water Disposal (D01-D62)	Industrial (I01-I36)	Commercial Activities (C01-C44)	Miscellaneous

Best Management Strategies for Potential Contaminants Identified within a Drinking Water Source Protection Area

Best Management Strategies (BMP's)	Contaminant Source ID's	Contaminant Source ID's	Contaminant Source ID's	Contaminant Source ID's
Spread filter fabric under object being washed.	Waste Water Disposal (D01-D62)	Industrial (I01-I36)	Commercial Activities (C01-C44)	Miscellaneous
Spill cleanup material should be stocked near liquid transfer area and employees should be trained in emergency spill response procedures and correct use of spill clean up materials.	Waste Water Disposal (D01-D62)	Industrial (I01-I36)	Commercial Activities (C01-C44)	Miscellaneous
If a sump or holding tank is used for spill containment, its contents should be pumped out and disposed of appropriately.	Waste Water Disposal (D01-D62)	Industrial (I01-I36)	Commercial Activities (C01-C44)	Miscellaneous
Drip pans should be provided underneath hose and pipe connections and other leak prone areas during liquid transfer operations. Drip pans should be cleaned regularly and stored nearby transfer area.	Waste Water Disposal (D01-D62)	Industrial (I01-I36)	Commercial Activities (C01-C44)	Miscellaneous
A trained employee should be present during loading and unloading of materials.	Waste Water Disposal (D01-D62)	Industrial (I01-I36)	Commercial Activities (C01-C44)	Miscellaneous
Use a temporary storm drain cover during transfer of materials.	Waste Water Disposal (D01-D62)	Industrial (I01-I36)	Commercial Activities (C01-C44)	Miscellaneous
Pumps and hoses used for liquid transfer should be in good condition.	Waste Water Disposal (D01-D62)	Industrial (I01-I36)	Commercial Activities (C01-C44)	Miscellaneous
Cover transfer area with roof to avoid rain contact.	Waste Water Disposal (D01-D62)	Industrial (I01-I36)	Commercial Activities (C01-C44)	Miscellaneous
A designated area for liquid transfer could be paved and sloped to a sump or holding tank to facilitate capture.	Waste Water Disposal (D01-D62)	Industrial (I01-I36)	Commercial Activities (C01-C44)	Miscellaneous
If a liquid transfer area can not be paved, then a containment/run-on structure such as a curb, dike or berm should be provided.	Waste Water Disposal (D01-D62)	Industrial (I01-I36)	Commercial Activities (C01-C44)	Miscellaneous
Implement an inventory control system to track purchase and consumption of liquids.	Waste Water Disposal (D01-D62)	Industrial (I01-I36)	Commercial Activities (C01-C44)	Miscellaneous
If paving the fuel transfer area, use Portland Cement because asphalt deteriorates.	Waste Water Disposal (D01-D62)	Industrial (I01-I36)	Commercial Activities (C01-C44)	Miscellaneous
Do not hose down maintenance repair areas. Instead sweep weekly to collect dirt and use absorbent pads to collect spills.	Waste Water Disposal (D01-D62)	Industrial (I01-I36)	Commercial Activities (C01-C44)	Miscellaneous
If transfer occurs at temporary site, a tarp, cloth or drip pan should be used.	Waste Water Disposal (D01-D62)	Industrial (I01-I36)	Commercial Activities (C01-C44)	Miscellaneous
Drain all fluids from wrecked vehicles and remove coolants.	Waste Water Disposal (D01-D62)	Industrial (I01-I36)	Commercial Activities (C01-C44)	Miscellaneous
Sweep all driveways and gutters that show an accumulation of materials.	Waste Water Disposal (D01-D62)	Industrial (I01-I36)	Commercial Activities (C01-C44)	Miscellaneous
A catch basin insert filter should be used during rainy weather.	Waste Water Disposal (D01-D62)	Industrial (I01-I36)	Commercial Activities (C01-C44)	Miscellaneous
Painting, finishing and coating materials should be stored in areas protected from the rain .	Waste Water Disposal (D01-D62)	Industrial (I01-I36)	Commercial Activities (C01-C44)	Miscellaneous
Never clean brushes, equipment into storm drain, gutters, ditch, stream or other water body.	Waste Water Disposal (D01-D62)	Industrial (I01-I36)	Commercial Activities (C01-C44)	Miscellaneous
Properly dispose of hazardous wastes.	Waste Water Disposal (D01-D62)	Industrial (I01-I36)	Commercial Activities (C01-C44)	Miscellaneous
Wood treatment should not occur during rain or when rain is expected.	Waste Water Disposal (D01-D62)	Industrial (I01-I36)	Commercial Activities (C01-C44)	Miscellaneous
Keep treated wood away from surface drainage areas.	Waste Water Disposal (D01-D62)	Industrial (I01-I36)	Commercial Activities (C01-C44)	Miscellaneous
Agricultural Activities				
Maintain ground cover.	Agricultural Sources (A01-A10)			
Practice conservation tillage.	Agricultural Sources (A01-A10)			
Practice conservation coverage.	Agricultural Sources (A01-A10)			
Utilize contour farming.	Agricultural Sources (A01-A10)			
Plant critical areas.	Agricultural Sources (A01-A10)			
Plant and maintain vegetative buffers and filter strips.	Agricultural Sources (A01-A10)			
Practice conservation irrigation.	Agricultural Sources (A01-A10)			
Use integrated pest management activities.	Agricultural Sources (A01-A10)			
If possible crops should be planted away from surface drainages.	Agricultural Sources (A01-A10)			
Contact NRCS for developing fertilization schedules.	Agricultural Sources (A01-A10)			
Proper pesticide application should be followed.	Agricultural Sources (A01-A10)			
Never apply pesticides, herbicides, fungicides when rain is expected.	Agricultural Sources (A01-A10)			
Do not apply chemicals when it is windy.	Agricultural Sources (A01-A10)			
Use manual pest control procedures.	Agricultural Sources (A01-A10)			
Pesticide application should not occur within 200 of surface water.	Agricultural Sources (A01-A10)			
Store pesticide, herbicides and fungicides in protected areas.	Agricultural Sources (A01-A10)			
Compost material should be kept away from surface drainage.	Agricultural Sources (A01-A10)			

Best Management Strategies for Potential Contaminants Identified within a Drinking Water Source Protection Area

Best Management Strategies (BMP's)	Contaminant Source ID's	Contaminant Source ID's	Contaminant Source ID's	Contaminant Source ID's
Fuel Storage				
Replace leaking and deteriorating tanks with good tanks.	Petroleum Storage Tanks (T01-T24)	Miscellaneous		
Tanks should have overflow detection.	Petroleum Storage Tanks (T01-T24)	Miscellaneous		
Spilled liquids should be collected and disposed appropriately.	Petroleum Storage Tanks (T01-T24)	Miscellaneous		
Use double walled tanks.	Petroleum Storage Tanks (T01-T24)	Miscellaneous		
Do not store containers in direct contact with the ground.	Petroleum Storage Tanks (T01-T24)	Miscellaneous		
Use funnels to pour fuel.	Petroleum Storage Tanks (T01-T24)	Miscellaneous		
Demolitions				
Schedule demolitions to take part in dry part of year.				
Light spraying of water can control some of the dust.				
Logging				
Preserve vegetation along streams.	Natural Resource Extraction Activities (E01-E12)	Miscellaneous		
Logging road should have crushed rock or spall apron construction.	Natural Resource Extraction Activities (E01-E12)	Miscellaneous		
Avoid logging on steep slopes.	Natural Resource Extraction Activities (E01-E12)	Miscellaneous		
Drainage ditches and culverts should direct runoff into vegetated areas or stormwater treatment systems.	Natural Resource Extraction Activities (E01-E12)	Miscellaneous		
Mining/Natural Resource Extraction:				
If the material is appropriate, use excavated spoil material to form compacted beams along the down slope sides to contain runoff.	Natural Resource Extraction Activities (E01-E12)	Miscellaneous		
Semi-permanent stockpiles should be seeded to promote vegetation growth to limit erosion from stockpiles.	Natural Resource Extraction Activities (E01-E12)	Miscellaneous		
Use detention ponds to promote settling of suspended solids or infiltration basins to filter suspended solids, to clean up runoff before it leaves the site.	Natural Resource Extraction Activities (E01-E12)	Miscellaneous		
Use anchorage tarps to cover stockpiles at small-scale mining operations.	Natural Resource Extraction Activities (E01-E12)	Miscellaneous		
Residential BMP's				
Wash your car directly over your lawn or make sure wash water drains to a vegetative area. This allows the water and soap to soak into the ground instead of running off into a local water body.	Residential Sources (R01-R09)	Miscellaneous		
Select soap without phosphates.	Residential Sources (R01-R09)	Miscellaneous		
Sweep driveways and street gutters before washing vehicle to clean up dirt, leaves, trash and other materials that may flow to the storm drain along with your wash water.	Residential Sources (R01-R09)	Miscellaneous		
Commercial products are available that allow you to clean a vehicle without water.	Residential Sources (R01-R09)	Miscellaneous		
Use a nozzle on your hose to save water.	Residential Sources (R01-R09)	Miscellaneous		
Do not wash your car is rain is expected.	Residential Sources (R01-R09)	Miscellaneous		
Consider not washing your car at home.	Residential Sources (R01-R09)	Miscellaneous		
Recycle all oils, antifreeze, solvents and batteries.	Residential Sources (R01-R09)	Miscellaneous		
Never dump new or used automotive fluids or solvents on the ground, in a storm drain or street gutter, or in a water body. Eventually, it will make its way to local surface waters or groundwater.	Residential Sources (R01-R09)	Miscellaneous		
Do not mix wastes. The chlorinated solvents in some carburetor cleaners can contaminate a huge tank of used oil, rendering it unsuitable for recycling. Keep wastes in separate containers and properly labeled.	Residential Sources (R01-R09)	Miscellaneous		
To dispose of oil filters, punch a hole in the top and let drain for 24 hours. This is where a large funnel in the tip of your oil storage container will come in handy. After draining, wrap in 2 layers of plastic and dispose of in your regular garbage or recycle by taking it to the household hazardous waste line.	Residential Sources (R01-R09)	Miscellaneous		
Use care in draining and collecting antifreeze.	Residential Sources (R01-R09)	Miscellaneous		
Perform your service activities on concrete or asphalt.	Residential Sources (R01-R09)	Miscellaneous		
If doing body work outside, be sure to use a tarp to catch material resulting from grinding, sanding and painting. Double bag wastes.	Residential Sources (R01-R09)	Miscellaneous		
Follow manufacturer's directions when applying fertilizers.	Residential Sources (R01-R09)	Miscellaneous		
Consider planting a vegetative buffer zone.	Residential Sources (R01-R09)	Miscellaneous		

Best Management Strategies for Potential Contaminants Identified within a Drinking Water Source Protection Area

Best Management Strategies (BMP's)	Contaminant Source ID's	Contaminant Source ID's	Contaminant Source ID's	Contaminant Source ID's
Store all fertilizers and pesticides in covered location.	Residential Sources (R01-R09)	Miscellaneous		
Compost yard clippings.	Residential Sources (R01-R09)	Miscellaneous		
Pull weeds instead of spraying.	Residential Sources (R01-R09)	Miscellaneous		
Work fertilizers into the soil.	Residential Sources (R01-R09)	Miscellaneous		
Dispose of hazardous material and their containers properly.	Residential Sources (R01-R09)	Miscellaneous		
Store hazardous material off of the ground and away from children.		Miscellaneous		
Use ground cloths and drip pans when working outdoors with hazardous materials.	Residential Sources (R01-R09)	Miscellaneous		
Let latex paints dry before placing in garbage.	Residential Sources (R01-R09)	Miscellaneous		
Use less toxic products whenever possible.	Residential Sources (R01-R09)	Miscellaneous		
Follow manufacturer's directions in the use of all materials.	Residential Sources (R01-R09)	Miscellaneous		
When hazardous material are used, place inside a tub or bucket to minimize spills.	Residential Sources (R01-R09)	Miscellaneous		
Properly maintain septic systems.	Residential Sources (R01-R09)	Miscellaneous		
Monitor septic systems for signs of failure: odors, surface sewage or green areas.	Residential Sources (R01-R09)	Miscellaneous		
Pump septic systems out every two to five years depending on hydraulic loading.	Residential Sources (R01-R09)	Miscellaneous		
Garbage disposal increase the need for increase pumping of solids.	Residential Sources (R01-R09)	Miscellaneous		
Household chemicals such as solvents, drain cleaners, oils, pants, pharmaceuticals, and pesticides can interfere with the proper operation of septic systems.	Residential Sources (R01-R09)	Miscellaneous		
Vehicles and heavy equipment should be kept off the drainfield.	Residential Sources (R01-R09)	Miscellaneous		
Trees should not be planted in drainfield.	Residential Sources (R01-R09)	Miscellaneous		
Clean up your dog poop and horse manure.				
Wells and Boreholes				
Identify abandoned wells and boreholes and properly decommission.	Wells and Boreholes (W01-W09)	Miscellaneous		
Assure that all wells and boreholes are properly grouted and are securely sealed.	Wells and Boreholes (W01-W09)	Miscellaneous		
Assure that all wells and boreholes are properly constructed.	Wells and Boreholes (W01-W09)	Miscellaneous		
Educate community about the implications of abandoned wells.	Wells and Boreholes (W01-W09)	Miscellaneous		
Natural Products Processing/Storage				
Storage of soil, wood chips, saw dust, gravel, sand, salt should be covered.	Natural Products Processing/Storage (N01-N10)	Miscellaneous		
Store solid and food wasted in containers and check for leaks.	Natural Products Processing/Storage (N01-N10)	Miscellaneous		
Restrict animal access to stream or lakes by fences.	Natural Products Processing/Storage (N01-N10)	Miscellaneous		
Military Activities				
Assure all Military activities follow State and Federal guidelines.	Military Activities			
Uncontrolled Sites				
Assure all Military activities follow State and Federal guidelines.	Uncontrolled Sites			
Educate community about the implications of the uncontrolled sites.	Uncontrolled Sites			